



PREMDOR (ENTERGY BRAND) DOUBLE DOOR WITH SIDELITES IN WOOD FRAMES WITH A BUMPER THRESHOLD (INSWING)

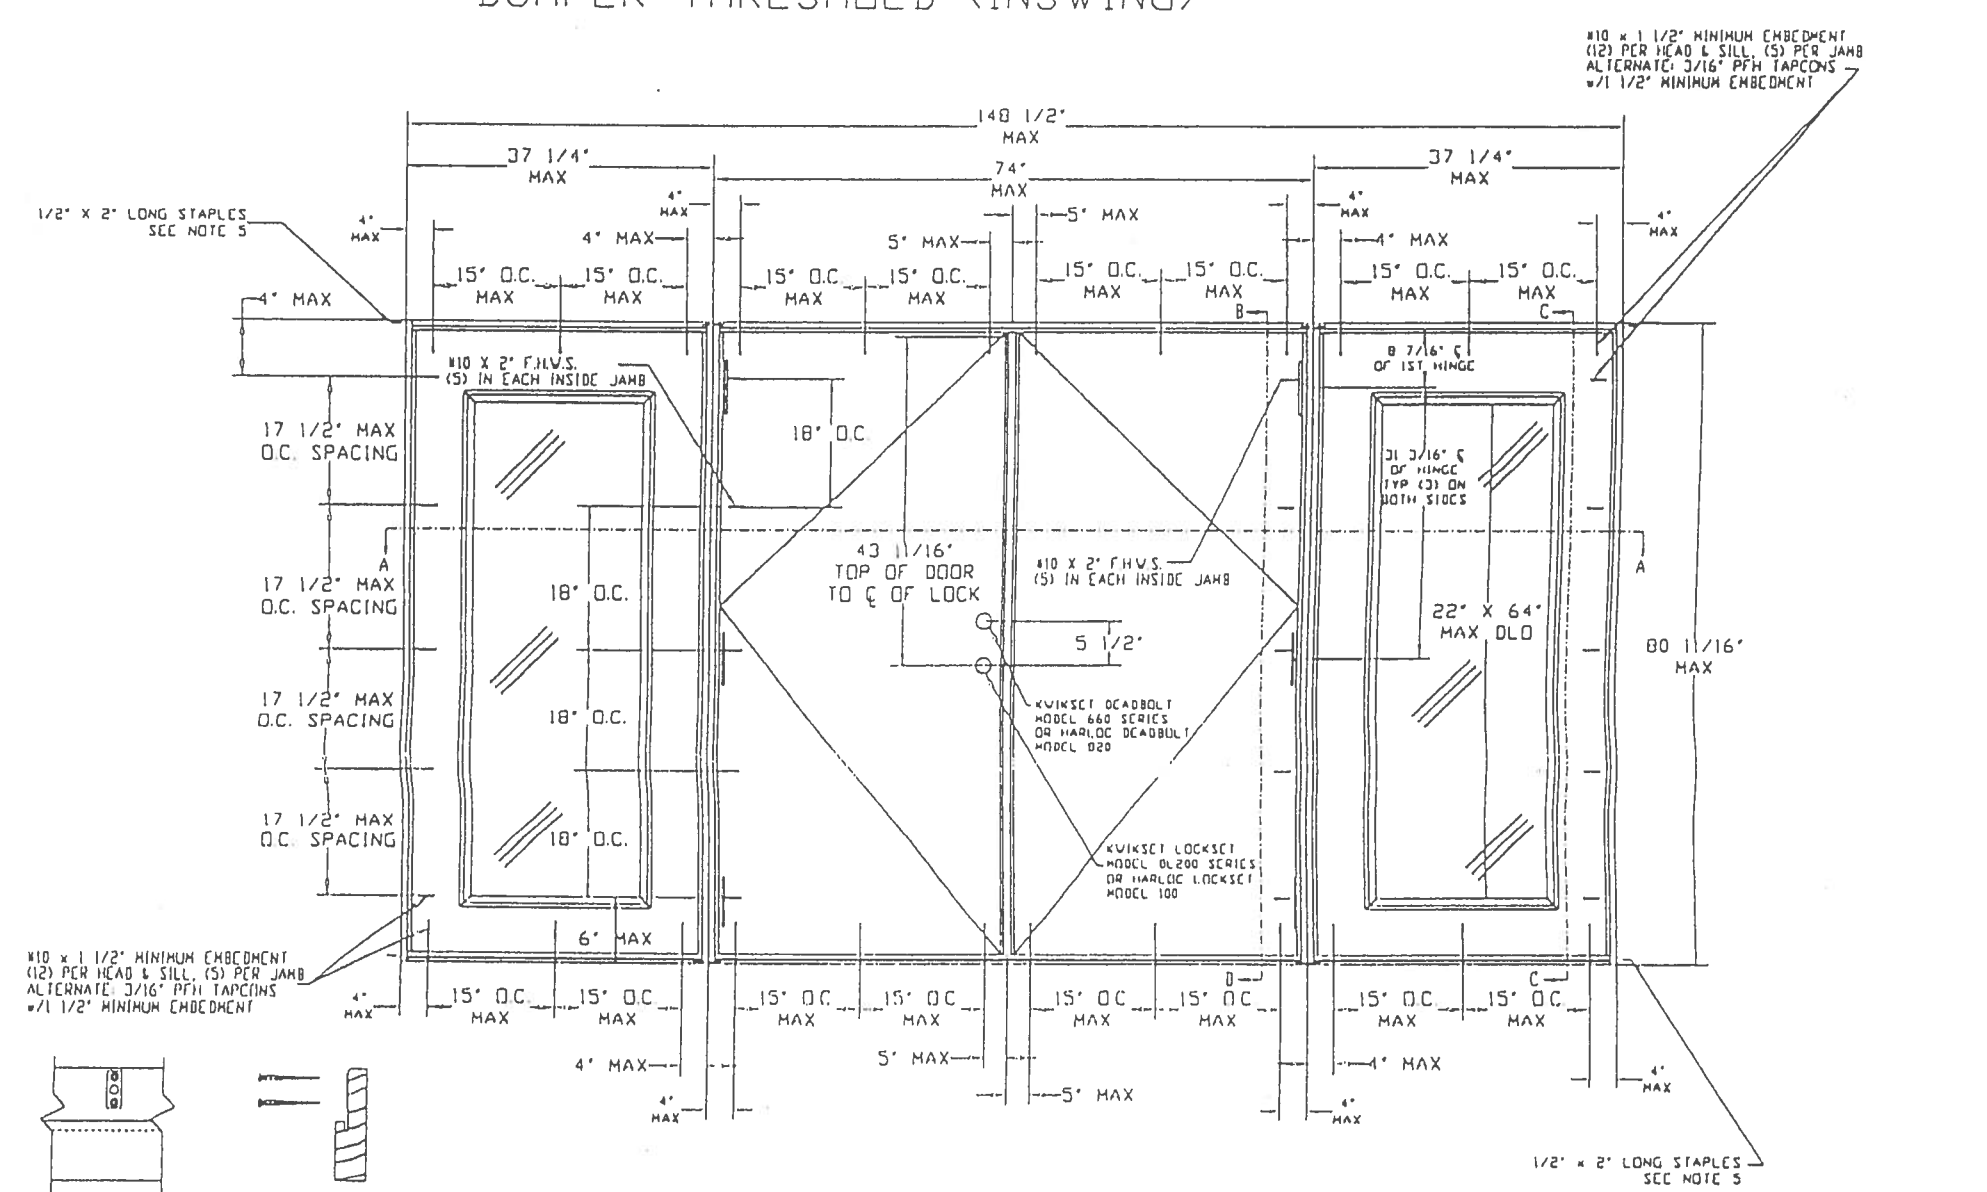


ATTACH ASTRAGAL THROW BOLT STRIKE PLATE TO THE HEADER AND THRESHOLD WITH #10 x 1 3/4\"/>

- NOTES:
- 1.) WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
  - 2.) THE PRECEDING DRAWINGS ARE INTENDED TO QUALIFY THE FOLLOWING INSTALLATIONS.

- A. WOOD FRAME CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY WOOD OPENING.
- B. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY STRUCTURAL WOOD BUCK.
- C. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED DIRECTLY TO CONCRETE OR MASONRY WITH OR WITHOUT A NON-STRUCTURAL ONE BY WOOD BUCK.
- 3. ALL ANCHORING SCREWS TO BE #10 WITH MINIMUM 1 1/2\"/>
- 4. UNIT MUST BE INSTALLED WITH 'MIAMI-DADE COUNTY APPROVED' SHUTTERS
- 5. THREE STAPLES PER SIDE JAMB INTO HEADER ON SIDELITES AND DOOR, THREE STAPLES PER JAMB INTO THRESHOLD ON SIDELITES AND DOOR.
- 6. LATEX SEALANT TO BE APPLIED AT SIDE BY SIDE JAMBS AND SIDELITES.
- 7. DOOR/SIDELITE HEADER, DOOR/SIDELITE JAMBS, AND SIDELITE BASE CORNERS ARE COPED AND BUTT JOINED.
- 8. DOORS SHALL BE PRE-PAINTED WITH A WATER-BASED EPOXY RUST INHIBITIVE PRIMER PAINT WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.
- 9. FRAMES SHALL BE PRE-PAINTED WITH AN ACRYLIC LATEX WATER-BASED/ WATER-REDUCIBLE WHITE PRIMER WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.

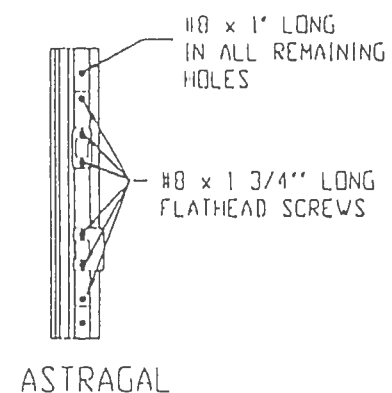

ASTRAGAL

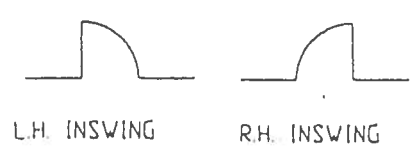

| DESIGN PRESSURE RATINGS |                                                  |                                                    |
|-------------------------|--------------------------------------------------|----------------------------------------------------|
|                         | WHERE WATER INFILTRATION REQUIREMENT IS NEEDED * | WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED |
| Positive                | NOT APPROVED*                                    | +55.0 psf                                          |
| Negative                | NOT APPROVED*                                    | -55.0 psf                                          |

\* UNITS SHALL BE INSTALLED ONLY AT LOCATIONS PROTECTED BY A CANOPY OR OVERHANG SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO SILL IS LESS THAN 45 DEGREES. UNLESS UNIT IS INSTALLED IN NON-HABITABLE AREAS WHERE THE UNIT AND THE AREA ARE DESIGNED TO ACCEPT WATER INFILTRATION.

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE JUN 05 2001  
BY *Mamuel*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO 01-0314-24

|                                              |  |  |                                                           |                               |               |    |
|----------------------------------------------|--|--|-----------------------------------------------------------|-------------------------------|---------------|----|
| LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :  |  |  | C                                                         | DADE COUNTY MODIFICATIONS     | 1/11/00       | JD |
| EXTRUSIONS: UNLESS NOTED, STD. COM'L. 10L'S. |  |  | B                                                         | ADDED PAGE 5 (DOOR OPTIONS)   | 10-1-98       | RS |
| ENGINEER:                                    |  |  | A                                                         | ADD OTHER DOOR CONFIGURATIONS | 12/18/97      | RS |
|                                              |  |  | LTR.                                                      | REVISIONS                     | DATE          | BY |
| DR. BY R.S.                                  |  |  | PART NAME: ENTERGY (WOOD CODE) DOUBLE DOOR WITH SIDELITES |                               |               |    |
| DATE 7-29-97                                 |  |  | MATERIAL:                                                 |                               | SCALE: N.T.S. |    |
| PREMDOR ENTRY SYSTEMS                        |  |  |                                                           | 31-1029-EW-1                  |               |    |
| 911 E. JEFFERSON                             |  |  |                                                           | SHEET 1 OF 6                  |               |    |
| PITTSBURG, KS 66762                          |  |  |                                                           |                               |               |    |
|                                              |  |  |                                                           | REVISION LETTER C             |               |    |



OTHER

79 5/16"

MAX

BLANK TOP  
4-PANEL

OTHER

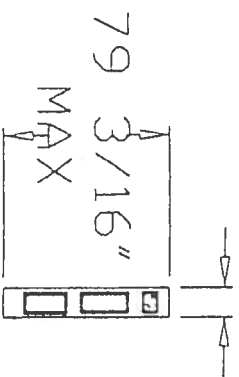

SL-10

SL-25

SL-55

SL-300

SL-40

SL-90A

SL-908







SL-90C

SL-308

SL-30C

SL-70

SL-80



PD-1

PD-2

PD-10

PD-11

PD-12





PD-13

PD-14

PD-15

PD-16

PD-17



PD-18

PD-19

PD-27

PD-28

PD-29

PD-30

PD-31

PD-32

PD-33

PD-34

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE JUN 05 2000  
BY *Manner*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO 01-0314.24

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :  
EXTENSIONS: UNLESS NOTED, STD. CORN. 10.5

ENGINEER:

DR. BY J.D.

DATE 1/15/01

LR

PART NAME: PREMDOR DOOR OPTIONS

SCALE:

PREMDOR ENTRY SYSTEMS

31-1029-EW-1

911 E. JEFFERSON  
PITTSBURGH, KS. 66762

SHEET 6 OF 6