



CODE INFORMATION	
CODE VERSION	REV 2017 001 Edition, 0002-11-15
MANUFACTURER	CARPORTS ANYWHERE
BUILDING TYPE	UTILITY STRUCTURE
CONSTRUCTION TYPE	A-B
RISK CATEGORY	1
FIRE PROTECTION	NONE
FIRE SUPPRESSION SYSTEM	NONE
OCCUPANCY	UTILITY U
BASIC WIND SPEED	Max 135-150 mph
EXPOSURE	C
ENCLOSURE	ENCLOSURED
INTERNAL PRESSURE COEFFICIENT	+/- 0.18
IMPORTANCE FACTOR	1.0
ROOF DEAD LOAD	10 psf
ROOF LIVE LOAD	20 psf OR 30 psf POINT LOAD
FLOOR DEAD LOAD	10 psf
FLOOR LIVE LOAD	20 psf
"R" RATING OF WALLS, FLOOR, ROOF	N/A
MODULES PER BUILDING	1
HURRICANE PROTECTION USAGE	NO
HURRICANE SHELTER USAGE	NO
SQUARE FOOTAGE	VARIABLE

REVISIONS			
REV	DESCRIPTION	DATE	BY

Drawn By: MTB
Date: 4/22/20
Location: FLORIDA
Model: ENCLOSED GENERIC ENGINEERING


GENERAL NOTES

1. THIS BUILDING IS EXEMPT FROM THE FBC ENERGY CONSERVATION CODE PER SECTION C101.4.2.
2. ALL STEEL TUBING SHALL BE 50 KSI STEEL.
3. PLUMBING, ELECTRICAL, INGRESS/EGRESS, PROPERTY SET-BACKS, AND/OR OTHER LOCAL CODE REQUIREMENTS ARE THE RESPONSIBILITY OF THE OWNER.
4. ROOF AND WALL SHEATHING SECURED WITH #12-14x1" SELF-DRILLING SCREWS WITH SEAL WASHERS @ 6" O.C. MAX.
5. FIELD FRAMING CONNECTIONS SECURED WITH #12-14x3/4" SELF-DRILLING SCREWS.
6. ALL SHOP FRAMING CONNECTIONS ARE TO BE WELDED. NO WELDING ON-SITE. ALL WELDING DONE IN SHOP.
7. CONCRETE EXPANSION ANCHORS ARE TO BE MINIMUM 1/2"x3" 2500LB TENSILE STRENGTH.
8. 12 OR 14GA FRAMING IS 2.5"x2.5" TUBE STEEL. RIPPLES ARE 2.25"x2.25" TUBE STEEL.

CONCRETE CONTRACTOR COPY

6/20/20

Matthew T. Baldwin P.E.

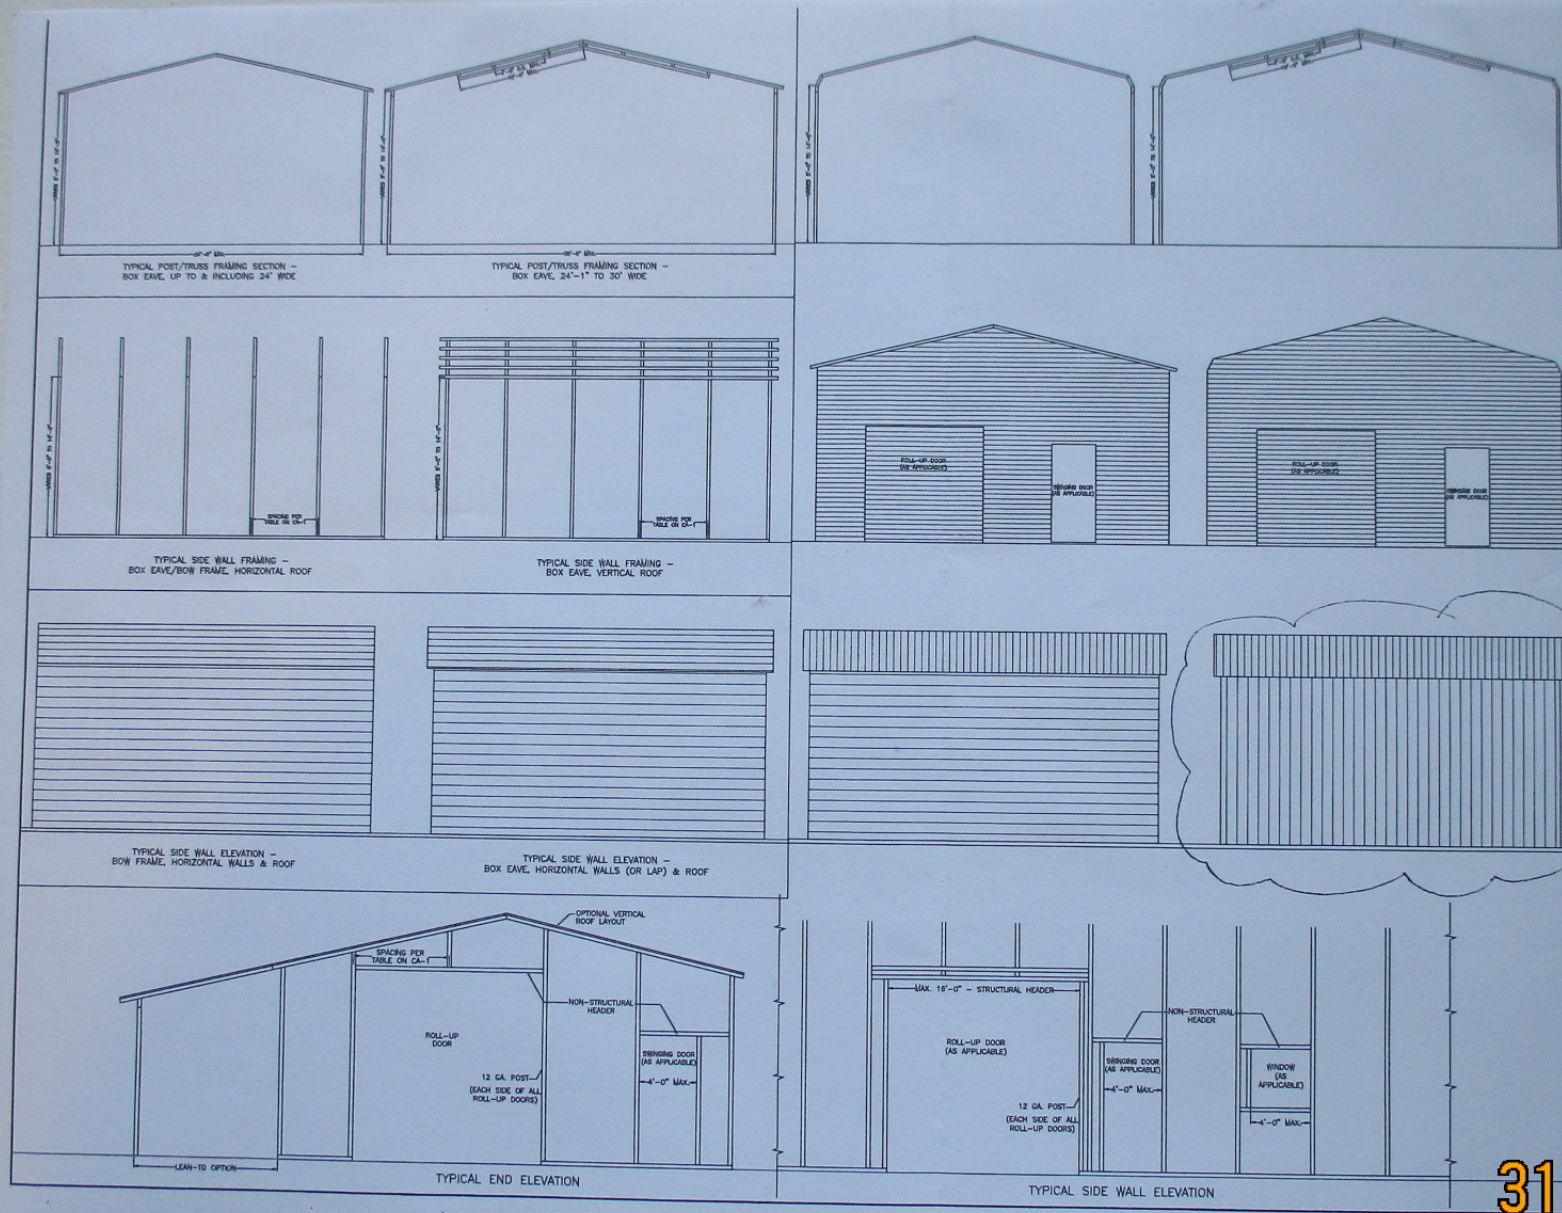

31/10/2020