




**NICHOLAS
PAUL
GEISLER
ARCHITECT**
N.C.A.R.B. Certified

1758 NW Brown Road
Lake City, FL 32055
386/365-4355

Design No. L512

Unrestrained Assembly Rating - 1 Hour
Finish Rating-21 Min.

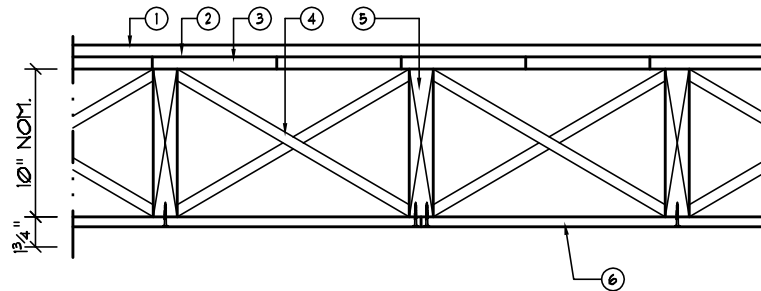

1, 2, 3. Finish flooring-Min. 23/32 in. thick T & G plywood, min. grade "Underlayment" or "Sturd-I-Floor" conforming to PS 1-74 specifications. Face grain to be perpendicular to joists with joints of the finish flooring and sub-flooring staggered. Vapor retarder-Optional-Commercial, rosin-sized building paper 0.010 in. thick.
Sub-flooring-Min. 15/32 in. thick T & G plywood, min. grade "Underlayment" or "Sturd-I-Floor" conforming to PS 1-83 specifications. Face grain to be perpendicular to joists with joints staggered.

4. Cross Bridging-1 by 3 in., or equal.

5. Wood Joists-2 by 10 in. spaced 16 in. O.C., fire-stopped.

6. Wallboard. Gypsum-1/2" or 5/8 in. thick, 4 ft wide, with wallboard installed perpendicular to joists with butted end joints of boards located at the joists. Nailed to joists with 6d cement-coated cooler nails and spaced 6 in. O.C. in the field of the board. Nails to be 1/2 in. from the butted end joints.

Canadian Gypsum Co., Ltd., Type C.

Celotex Corp.-Type FRP.

Domtar Gypsum-Type 5.

United States Gypsum Co., Type C, O, or 1P-X2.

8. Alternate Finishing System (Not Shown):
joints covered with fiber tape and joint compound. As an alternate, nom 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of Classified veneer baseboard. Joints reinforced.

*Bearing the UL Classification Marking

DIESEL REPAIR SHOP @ BROWN ROAD for MARK HADDOX CONSTRUCTION
NICHOLAS PAUL GEISLER, ARCHITECT AR0007005
04 MAY 2021

Digitally signed by: N. P. GEISLER
DN: CN = N. P. GEISLER C = US
O = AR0007005 OU =
ARCHITECT
Date: 2021.05.05 14:30:18 -05'00'