


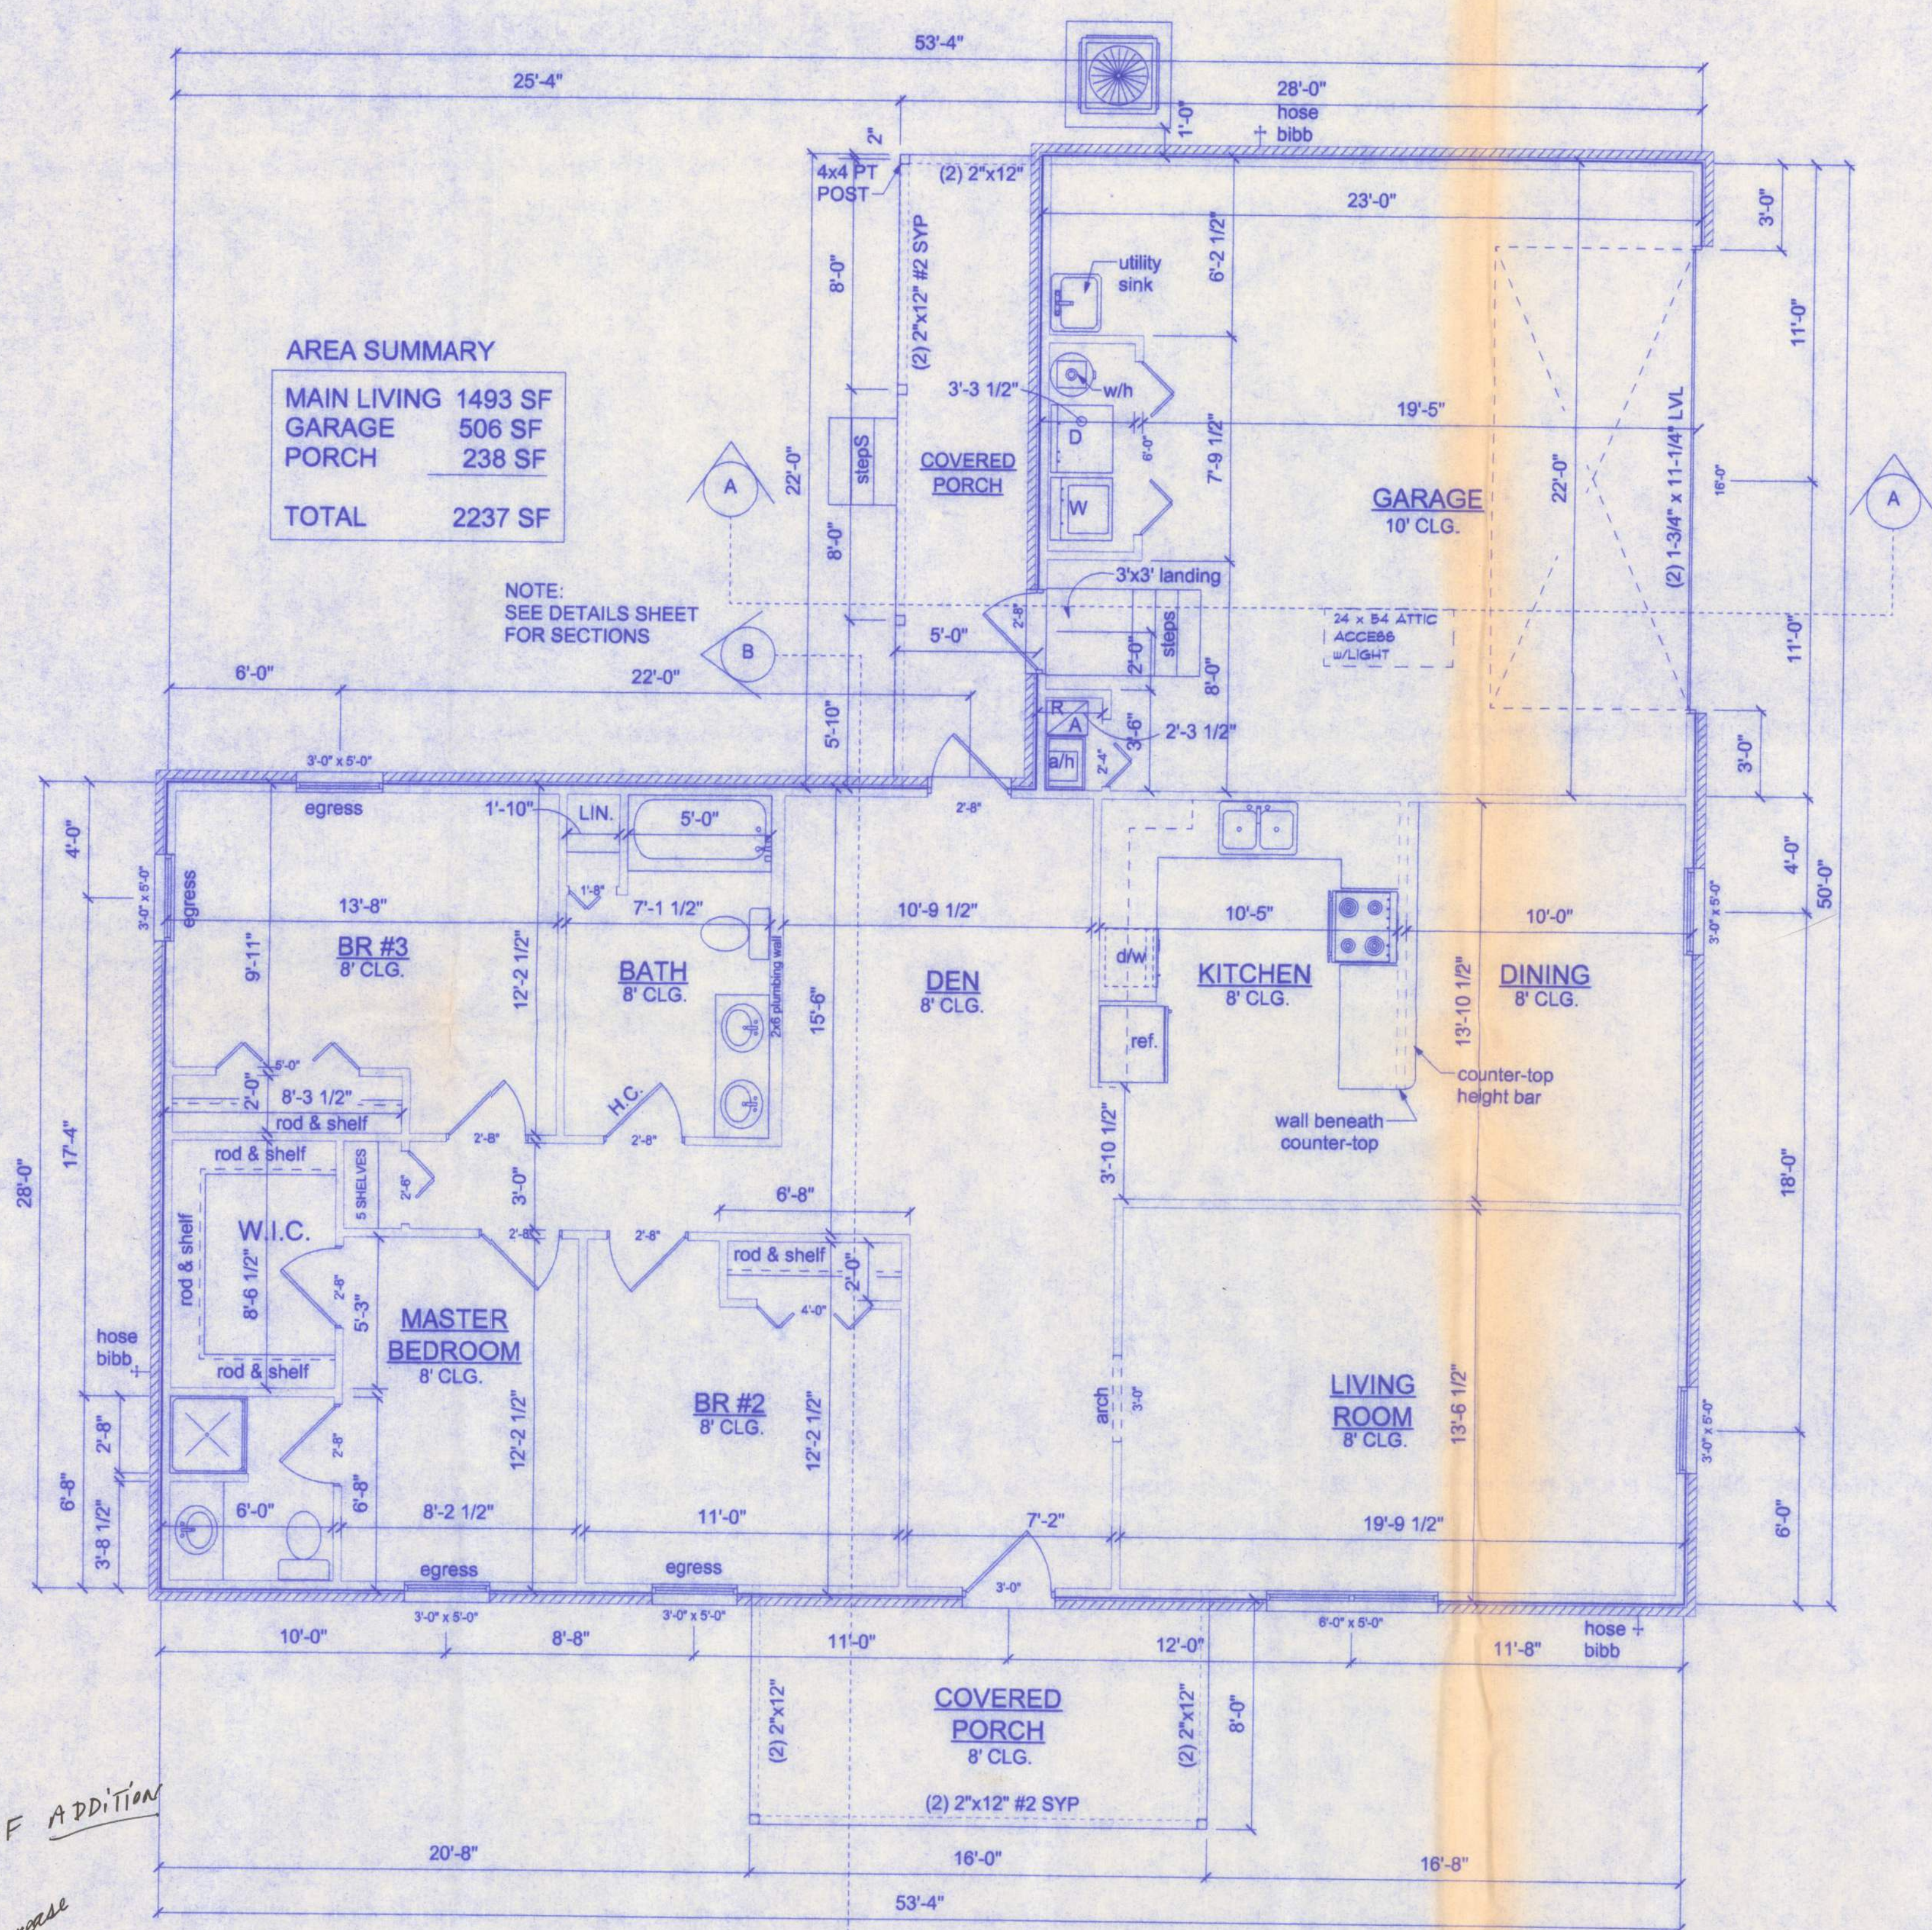

AREA SUMMARY

|              |                |
|--------------|----------------|
| MAIN LIVING  | 1493 SF        |
| GARAGE       | 506 SF         |
| PORCH        | 238 SF         |
| <b>TOTAL</b> | <b>2237 SF</b> |

NOTE:  
SEE DETAILS SHEET  
FOR SECTIONS

| PRODUCT CODE             | SIZE          | HINGE DIRECTION | COUNT |
|--------------------------|---------------|-----------------|-------|
| 32x80 therma-tru steel   | 2'-8"         | R               | 1     |
| 36x80 therma-tru steel   | 3'-0"         | L               | 1     |
| 32x80 therma-tru french  | 2'-8"         | L               | 1     |
| 192x84 amaar garage door | 16'-0"        | N               | 1     |
| 1868 BF                  | 1'-8"         | L               | 1     |
| 2668 BF                  | 2'-6"         | L               | 1     |
| 2868 colonial masonite   | 2'-8"         | L               | 4     |
| 2868 colonial masonite   | 2'-8"         | R               | 2     |
| SH 3050                  | 3'-0" x 5'-0" | N               | 8     |

NOTE:  
ALL WIND LOADS ARE IN ACCORDANCE WITH SECTION  
1606, FLORIDA BUILDING CODE, 2001 EDITION.

|                                 |                                                                      |
|---------------------------------|----------------------------------------------------------------------|
| BASIC WIND SPEED                | 110 MPH                                                              |
| IMPORTANCE FACTOR               | 1.0                                                                  |
| BUILDING CATEGORY               | 2                                                                    |
| EXPOSURE                        | B                                                                    |
| INTERNAL PRESSURE               | +/- 0.18                                                             |
| COEFFICIENT                     |                                                                      |
| COMPONENT AND CLADDING PRESSURE | WALLS +21.6/-29.1 PSF<br>ROOF +12.5/-29.1 PSF<br>OVERHANGS -71.6 PSF |
| TYPE OF STRUCTURE               | ENCLOSED                                                             |

NOTE:  
EXTERIOR WINDOWS AND GLASS DOORS SHALL BE TESTED BY  
AN APPROVED INDEPENDENT TESTING LABORATORY, AND BEAR  
AN AAMA OR WDMA OR OTHER APPROVED LABEL IDENTIFYING THE  
MANUFACTURER, PERFORMANCE CHARACTERISTICS AND  
APPROVED PRODUCT EVALUATION ENTITY TO INDICATE COMPLIANCE  
WITH THE REQUIREMENTS OF THE FOLLOWING SPECIFICATION:

ANSI/AAMA/NWDA 101/IS2 2/97

THE CONSTRUCTION SHALL BE TESTED IN ACCORDANCE WITH  
ASTM E 330, STANDARD TEST METHODS FOR STRUCTURAL  
PERFORMANCE OF EXTERIOR WINDOWS, CURTAIN WALLS, AND  
DOORS BY UNIFORM STATIC AIR PRESSURE.

NOTE:  
THE MINIMUM NATURAL VENTILATION AREA REQUIRED FOR  
GARAGES SHALL BE 4 PERCENT OF THE FLOOR AREA BEING  
VENTILATED. THE MINIMUM MECHANICAL VENTILATION  
FOR GARAGES SHALL BE 100 CFM PER CAR.

NOTE:  
BATHROOM EXHAUST SHALL BE DIRECTED TO OUTSIDE OF BUILDING.  
EXHAUST AIR SHALL NOT BE DIRECTED ONTO WALKWAYS. AIR  
EXHAUST OPENINGS SHALL BE PROTECTED WITH CORROSION-RESISTANT  
SCREENS, LOUVERS OR GRILLS IF TERMINATING OUT DOORS.


2237  
-1248  
989 SF ADDITION

79.2 sq increase

**NEW FLOOR PLAN**  
SCALE: 1/4" = 1'-0"

**CLARENCE ROSSIN  
RESIDENCE**

161 N.W. MADISON STREET  
SUITE #102  
LAKE CITY, FL. 32055  
(386) 758-4209



**Freeman**  
Design Group Inc.

|             |          |
|-------------|----------|
| DATE        | DRAWN BY |
| 11/09/04    | J.T.D.   |
| REVISIONS   |          |
| SHEET       | A-2      |
| OF          | 8        |
| PROJECT NO. |          |

CERTIFICATE OF AUTHORIZATION # 00000701