





SHEET NUMBER

OF 4 SHEETS

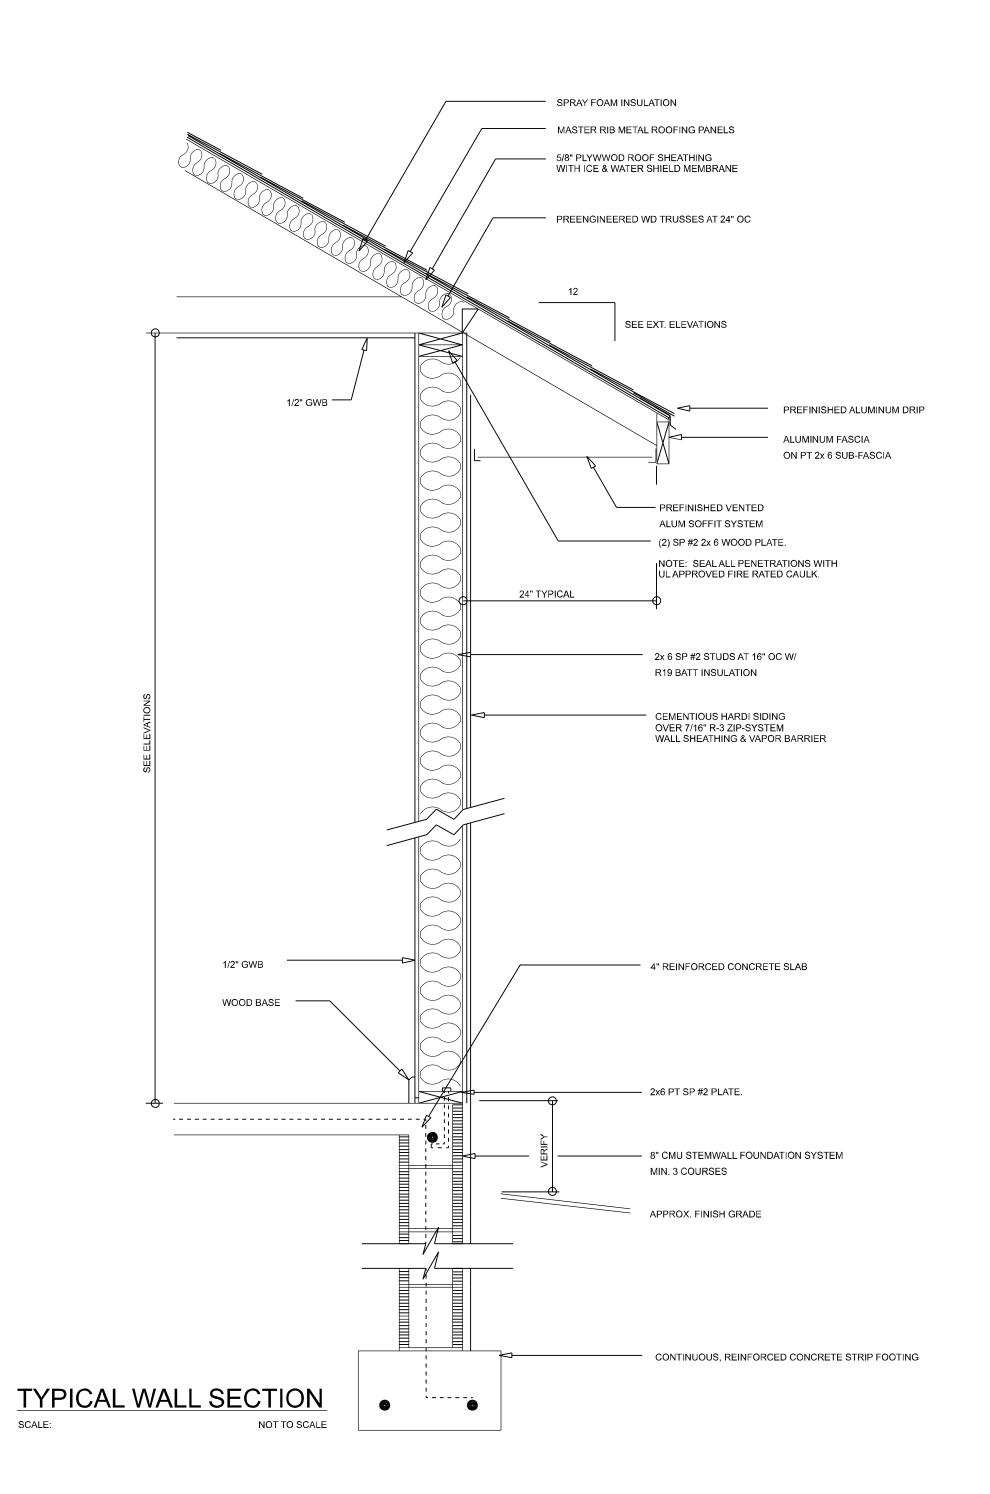


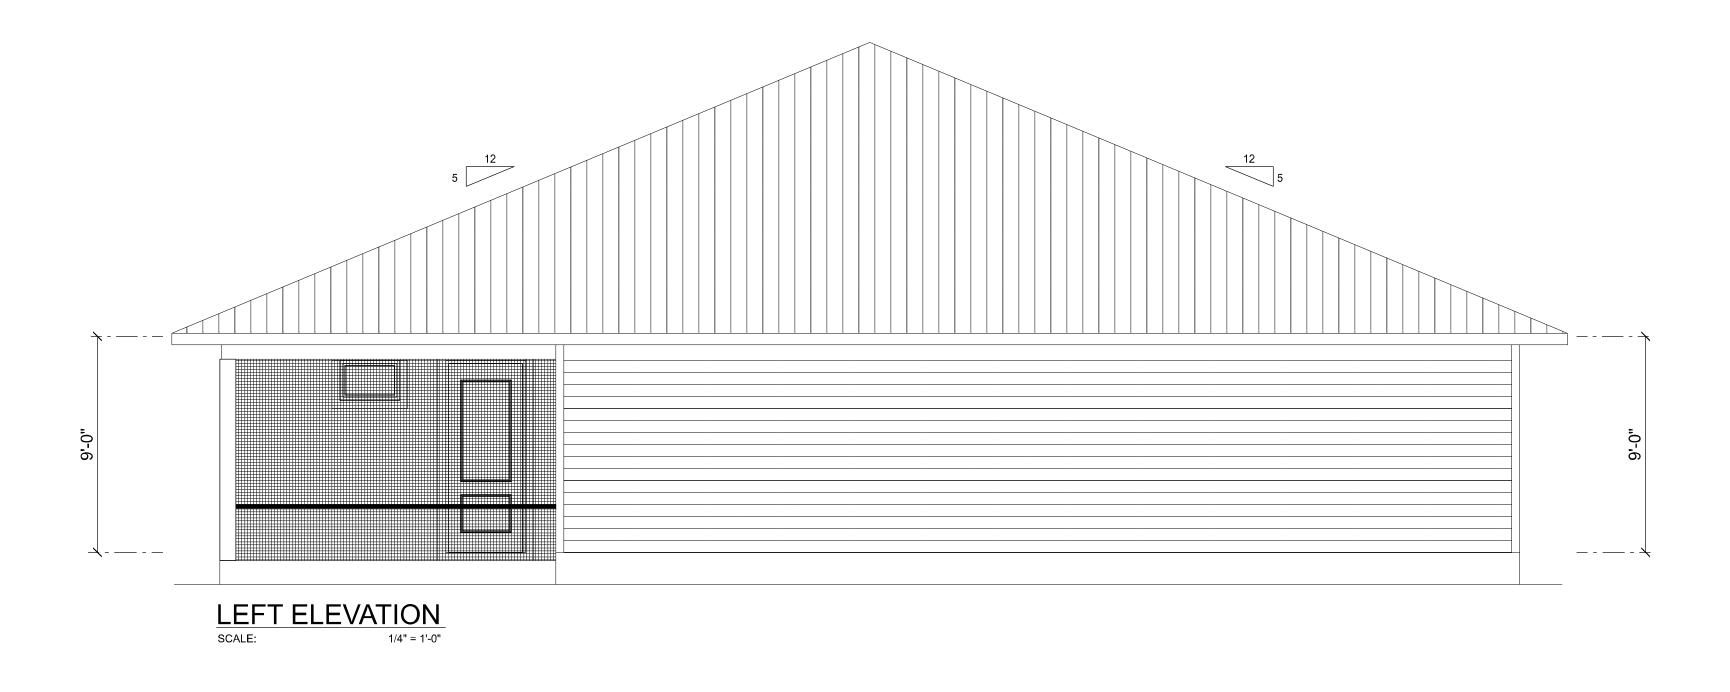


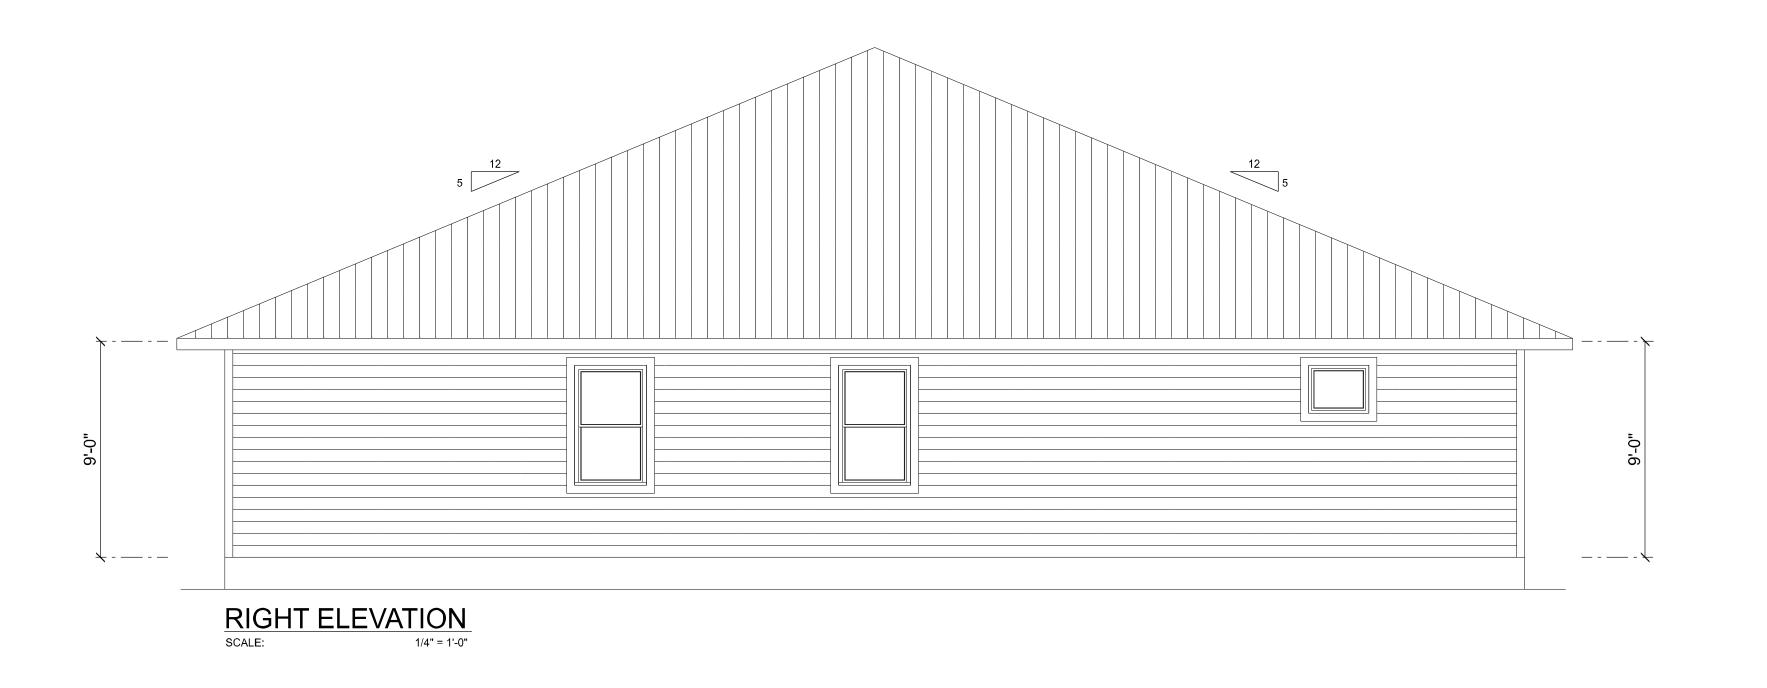


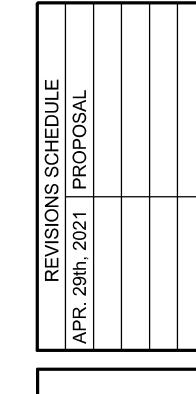

Bill & Jessica Spence 313 SW Cross Pointe Ct, Lake City, Fl 32024

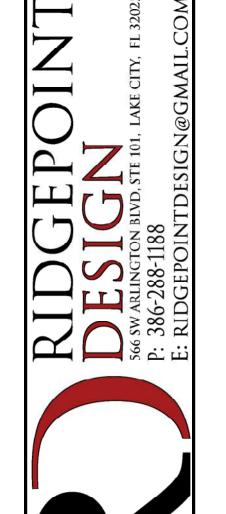



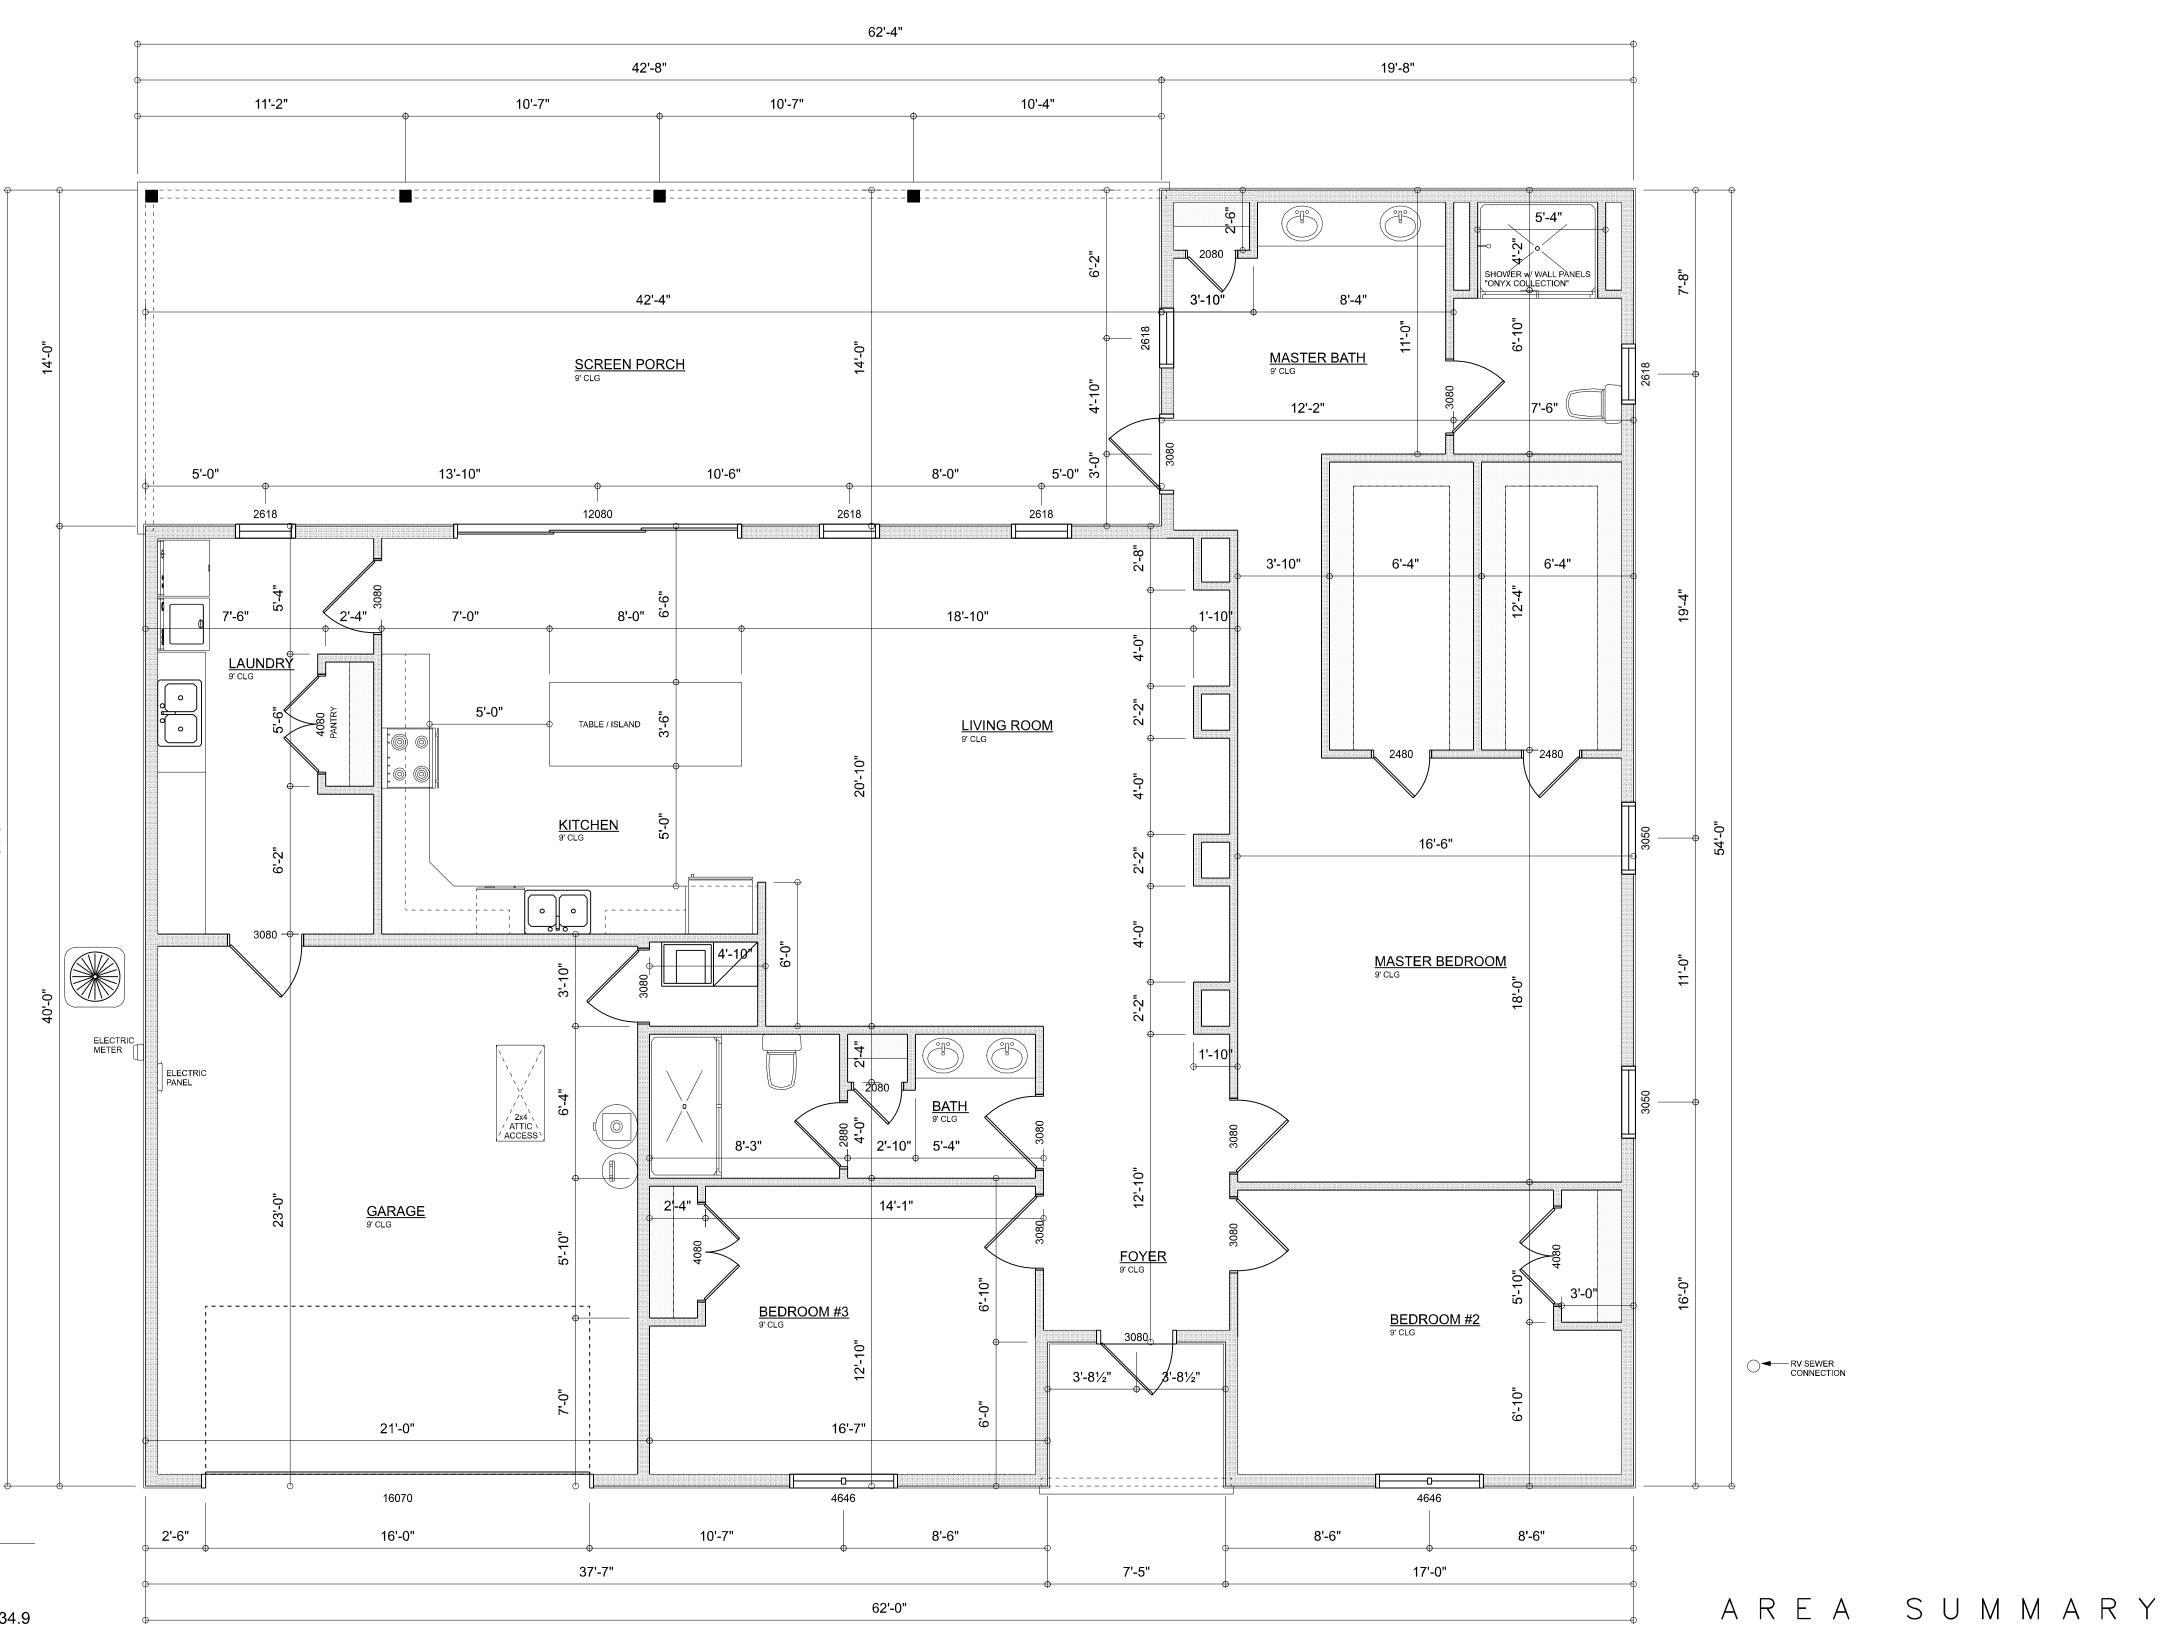

REVISIONS SCHEDULE
APR. 29th, 2021 | PROPOSAL

& Jessica Spence oss Pointe Ct, Lake City, Fl 32024

RIDGEPOINTDESIGN@GMAIL.COM

SS A

HEATED & COOLED

BACK PORCH

FRONT PORCH

TOTAL AREA

GARAGE

2,250

593

461

3,348

TOTAL CUBIC FOOTAGE OF CONDITIONED SPACE IS: 20,052

44

S.F.

S.F.

S.F.

A.3

OF 4 SHEETS

Garage fire separations shall comply with the following:

1. The private garage shall be separated from the dwelling unit and its attic area by means of a minimum 1/2-inch (12.7 mm) gypsum board applied to the garage side. Garages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8-inch Type X gypsum board or equivalent. Door openings between a private garage and the dwelling unit shall be equipped with either solid wood doors, or solid or honeycomb core steel doors not less than 13/8 inches (34.9 mm) thick, or doors in compliance with Section 715.3.3. Openings from a private garage directly into a room used for sleeping purposes shall not be permitted.

2. Ducts in a private garage and ducts penetrating the walls or ceilings separating the dwelling unit from the garage shall be constructed of a minimum 0.019-inch (0.48 mm) sheet steel and shall have no openings into the garage.

3. A separation is not required between a Group R-3 and U carport provided the carport is entirely open on two or more sides and there are not enclosed areas above.

4. When installing an attic access and/or pull-down stair unit in the garage, devise shall have a minimum 20 min. fire rating.

DIMENSIONED FLOOR PLAN

1/4" = 1'-0"

ELECTRICAL LEGEND		
ELECTRICAL	COUNT	SYMBOL
CEILING FAN	6	
CAN LIGHT 6inch	37	0
LED CEILING LIGHT 1x4	6	
PENDANT LIGHT	2	
MOTION SECURITY LIGHT	4	<u>Q</u> D
ELECTRIC METER	1	
ELECTRIC PANEL	2	11
AC DISCONNECT	5	
EXHAUST FAN	2	₩
OUTLET	32	Ф
OUTLET 220v	4	b
OUTLET GFI	17	⊕ GFI
OUTLET WP	3	Ůwp.
STANDARD LIGHT	2	
SWITCH	25	\$
SWITCH 3 WAY	7	\$3
UNDER CABINET LIGHT	4	
VANITY BAR LIGHT - SMALL	4	000
SWITCH DIMMER	2	⊙
CARBON DETECTOR	1	©
SMOKE DETECTOR	4	•

ELECTRICAL PLAN NOTES:

INSTALLATION SHALL BE PER LATEST NAT'L ELECTRIC CODE.

WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS

CONSULT WITH THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED

ALL SMOKE DETECTORS SHALL BE 120v W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS

TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.

ALL RECEPTICALS, NOT OTHERWISE NOTED, SHALL BE ARC FAULT INTERRUPTER TYPE, EXCEPT DEDICATED OUTLETS

ALL RECEPTICALS IN WET AREAS SHALL BE GROUND FAULT INTERRUPTER TYPE (GFI)

ALL EXTERIOR RECEPTICALS SHALL BE WEATHERPROOF GROUD FAULT INTERRUPTER TYPE (WP/GFI)

NOTE:
ELECTRICAL CONT'R SHALL PREPARE "AS-BUILT" SHOP
DWGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY
CHANGES TO THE ELEC. PLAN, ADD'NS TO THE ELEC. PLAN,
RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS
IDENTIFIED W/ CKT Nr. DESCRIPTION & BRKR, SERVICE ENT.
& ALL UNDERGROUND WIRE LOCATIONS/ROUTING / DEPTH.
RISER DIA. SHALL INCLUDE WIRE SIZES/TYPE & EQUIPMENT
TYPE W/ RATINGS & LOADS.
CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS

TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY

100 AMP BREAKER FOR POWER TO SHOP : -----© SOFFIT HEIGHT @ SOFFIT HEIGHT



