
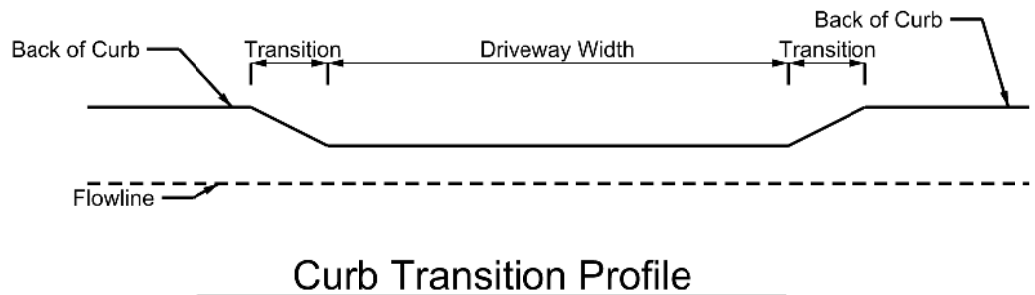
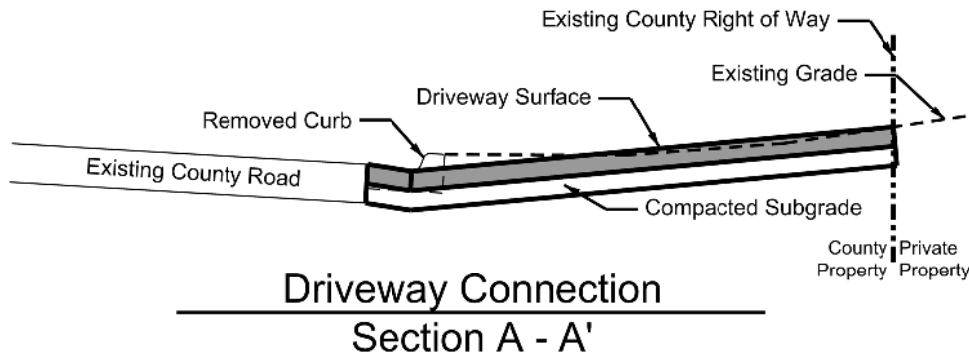


Curb and Gutter Removal

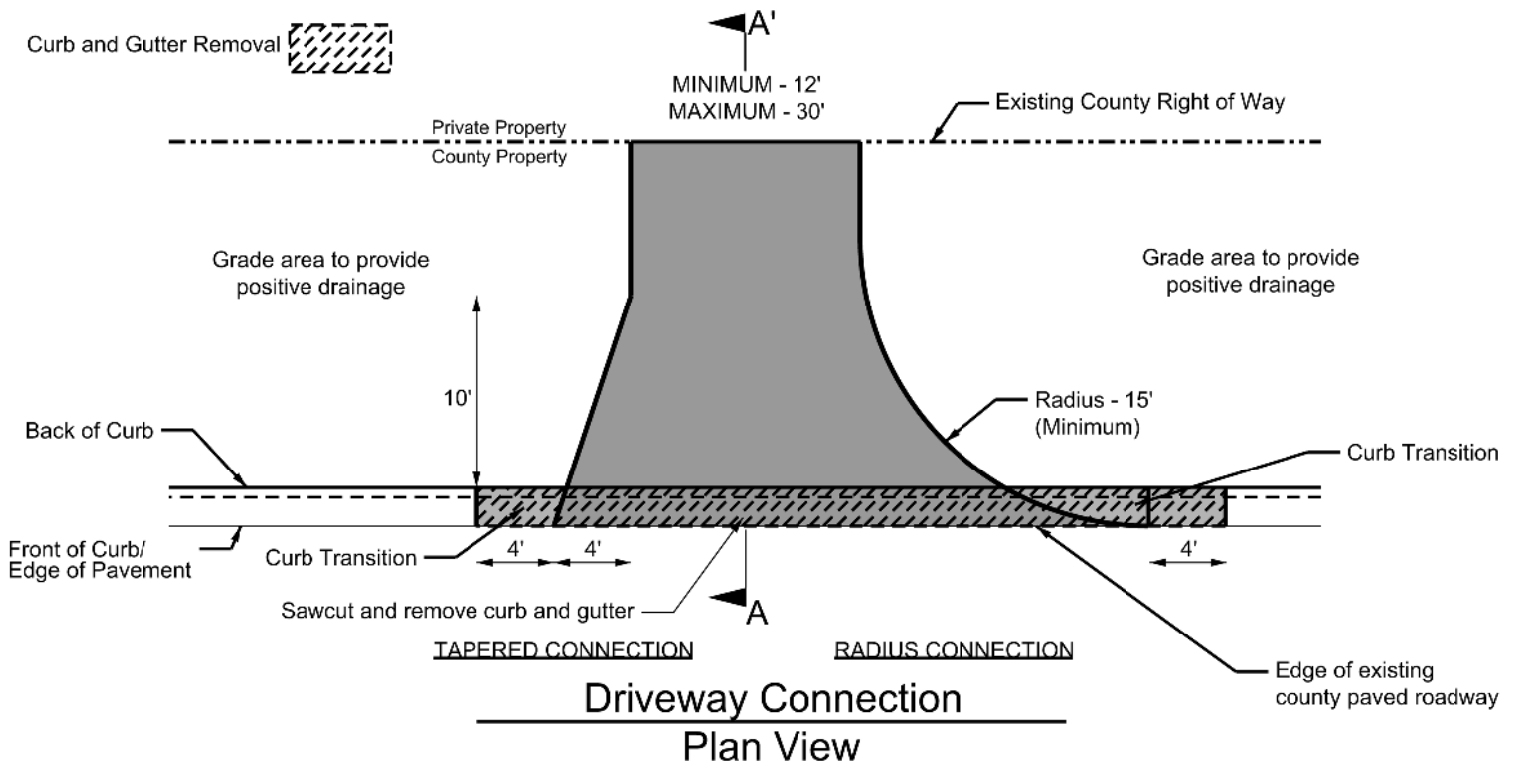

Notes:

1. Seed and Mulch all disturbed areas
2. Driveway wearing surface shall be (1) 6" concrete or (2) 1.5" asphalt and 6" of compacted limerock
3. Subgrade material - Minimum 12" suitable material (per FDOT) compacted in 6" lifts
4. All construction methods shall comply with FDOT standard specifications
5. Driveway shall have sufficient length and size for all vehicular queuing, stacking, maneuvering, standing and parking to be carried out, OUTSIDE of county right of way.
6. Driveway slopes shall comply with FDOT Standard Plans, Section 330 (515 - Design Standards).
7. If driveway is constructed at a down gradient from the roadway, steps should be taken to ensure stormwater runoff does not travel down the drive, but runoff into the swale/grassed area.

Approval: _____

Effective Date: _____

COLUMBIA COUNTY
BOARD OF COUNTY
COMMISSIONERS



RESIDENTIAL
DRIVEWAY

Curb and Gutter
Connection
No Culvert

SHEET NO

300-5