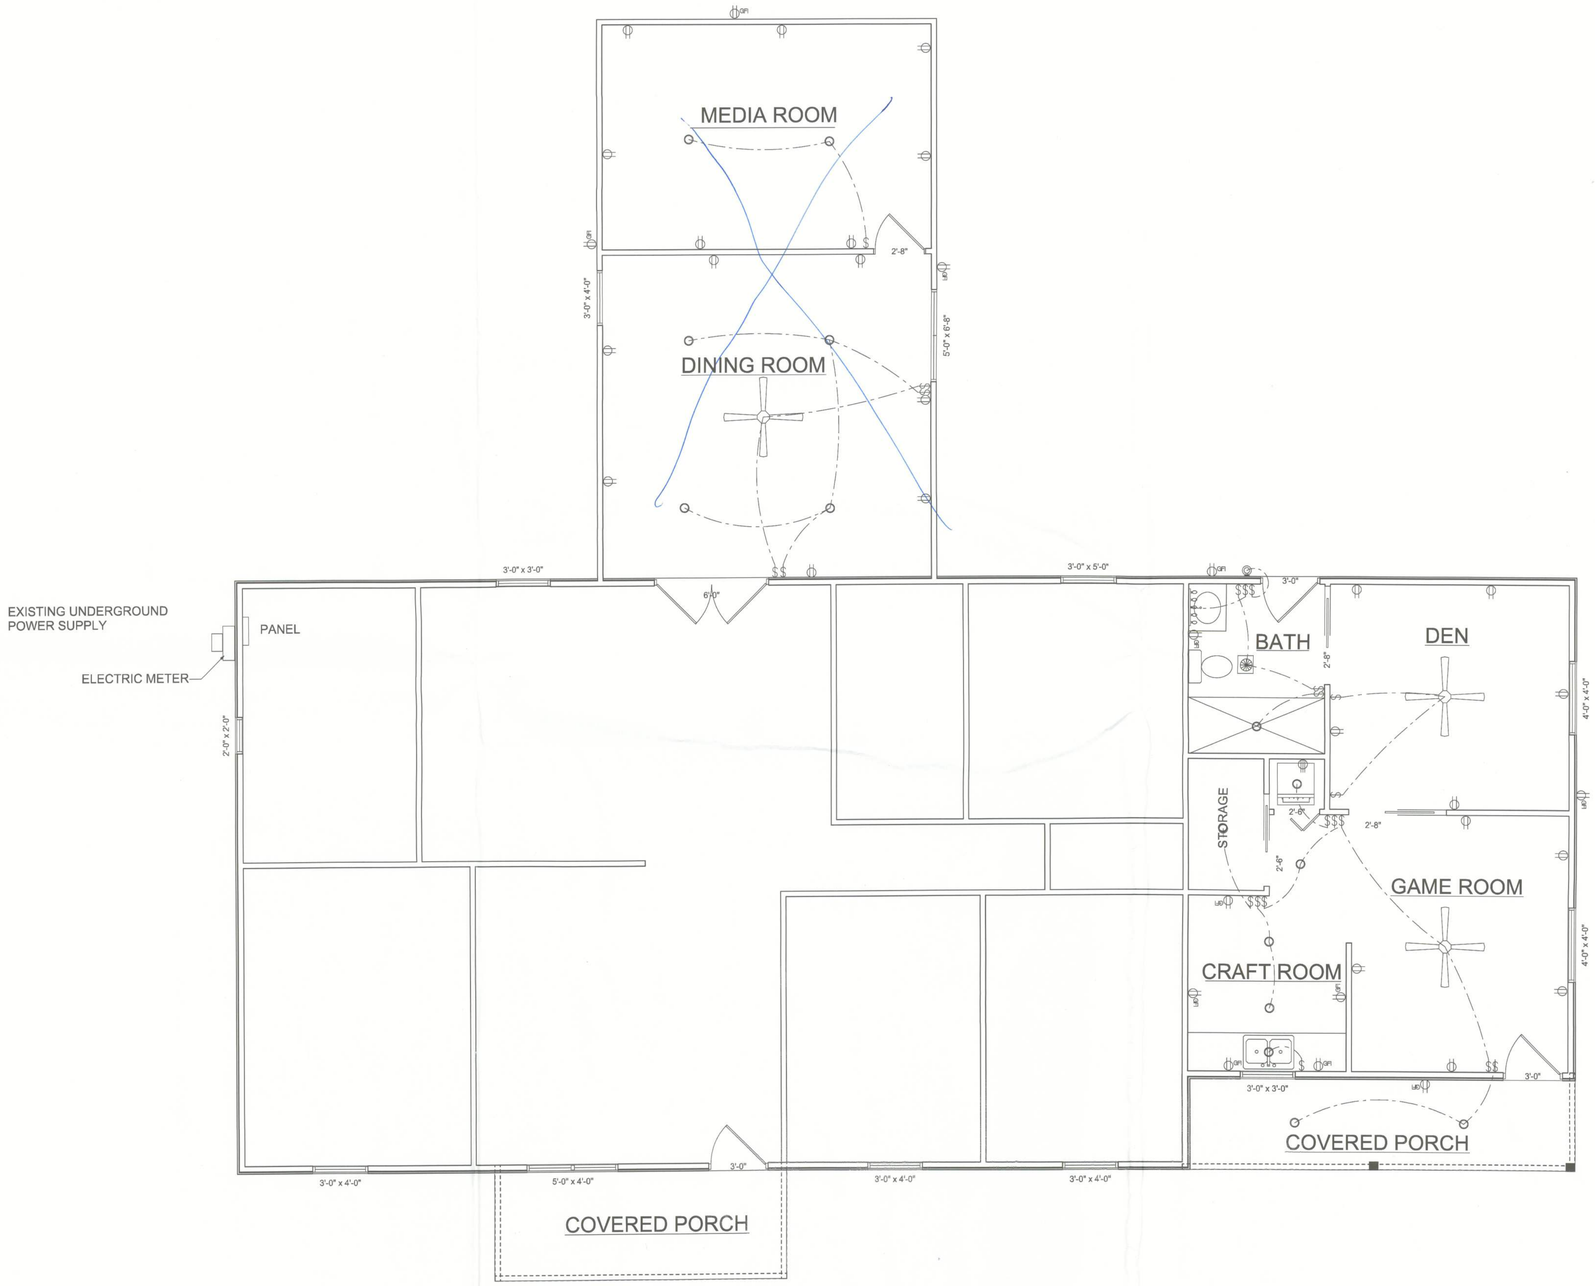

Electrical symbols	
$	single pole switch
$DM	dimmer switch
$3	3 way switch
	110 outlet
	220 OUTLET
GFI	GFI outlet
	switched outlet
	std overhead light
	recessed light
	light / exhaust fan 80 cfm
	arc fault rec.
	wall mount light fixture
	std overhead light
	double flood light
	track bar light
	vanity bar light
	floresent light
	ceiling fan -light
	smoke detector
	phone outlet
TV	tv outlet
TS	THERMOSTAT

ELECTRICAL

SCALE 1/4" = 1'-0"

Shall meet all 2009 NEC codes

1. THIS ELECTRICAL SYSTEM SHALL BE INSTALLED IN ACCORD WITH THE REQUIREMENTS OF THE 2007 FBC & THE 2009 AMENDMENTS TO THE 2007 FBC
2- ALL SMOKE DETECTORS SHALL BE HARD WIRED W/ BATTERY BACKUP AND WIRED TO ALARM SIMULTANEOUSLY.
3. ALL BATHROOM FANS SHALL EXHAUST TO OUTSIDE 80 CFM MIN.
4. ALL BEDROOM RECEPTICALS SHALL BE ARC FAULT

OSTEEN ADDITION
479 SEDGEFIELD ROAD
FT WHITE, FL DS09-247

WILLIAM JOHNSON
CUSTOM DRAFTING
16909 N.E.21st. STREET
GAINESVILLE, FL. 32609
PH (352) 485-1942 (352) 494-2041

SHEET:
6