



VSE Project Number: U3607.0051.211

July 8, 2021

Pure Energy Solar
ATTENTION: Wayne Irwin
2121 NW 2nd St.
Gainesville, FL 32609

**REFERENCE: Thomas Residence: 249 Southwest Oak Glen, Fort White, FL 32038
Solar Array Installation**

To Whom It May Concern:

Per your request, we have reviewed the existing structure at the above referenced site. The purpose of our review was to determine the adequacy of the existing structure to support the proposed installation of solar panels on the roof as shown on the panel layout plan.

Based upon our review, we conclude that the existing structure is adequate to support the proposed solar panel installation.

Design Parameters

Code: 2020 Florida Building Code - Building, 7th Edition (2018 IBC)

Risk Category: II

Design wind speed, Vult: 121 mph (3-sec gust) per ASCE 7-16

Wind exposure category: C

Connection to Roof

Mounting connection: (1) 5/16" lag screw w/ min. 2.5" threaded embedment into framing at max. 48" o.c. along rails
(2) rails per row of panels, evenly spaced; panel length perpendicular to the rails not to exceed 67 in. Rail cantilever shall not exceed 50% of connection spacing.

At flat hip framing, if occurs, reduce connection spacing listed above by 50% or see attached detail for blocking option.

Conclusions

Based upon our review, we conclude that the existing structure is adequate to support the proposed solar panel installation. In the area of the solar array, other live loads will not be present or will be greatly reduced (2020 FBC - Building, Section 1607.12.5). The gravity loads, and thus the stresses of the structural elements, in the area of the solar array are either decreased or increased by no more than 5%. Therefore, the requirements of Section 807.5 of the 2020 FBC - Existing Building are met and the structure is permitted to remain unaltered.

The solar array will be flush-mounted (no more than 10" above the roof surface) and parallel to the roof surface. Thus, we conclude that any additional wind loading on the structure related to the addition of the proposed solar array is negligible. The attached calculations verify the capacity of the connections of the solar array to the existing roof against wind (uplift), the governing load case. Because the increase in lateral forces is less than 10%, this addition meets the requirements of the exception in Section 807.5 of the 2020 FBC - Existing Building. Thus the existing lateral force resisting system is permitted to remain unaltered.

Limitations



VSE Project Number: U3607.0051.211

Thomas Residence

7/8/2021

Installation of the solar panels must be performed in accordance with manufacturer recommendations. All work performed must be in accordance with accepted industry-wide methods and applicable safety standards. The contractor must notify Vector Structural Engineering, LLC should any damage, deterioration or discrepancies between the as-built condition of the structure and the condition described in this letter be found. Connections to existing roof framing must be staggered, except at array ends, so as not to overload any existing structural member. The use of solar panel support span tables provided by others is allowed only where the building type, site conditions, site-specific design parameters, and solar panel configuration match the description of the span tables. The design of the solar panel racking (mounts, rails, etc.) and electrical engineering is the responsibility of others. Waterproofing around the roof penetrations is the responsibility of others. Vector Structural Engineering assumes no responsibility for improper installation of the solar array.

VECTOR STRUCTURAL ENGINEERING, LLC

FL Firm License: COA 26626

Coleman D
Larsen

Digitally signed
by Coleman D
Larsen
Date:
2021.07.08
16:24:37 -06'00'



07/08/2021

Coleman Larsen, P.E.

FL License: 78189 - Expires: 02/28/2023

Project Engineer

Enclosures

CDL/shs

This item has been digitally signed and sealed by Coleman Larsen on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.





DRAPER, UTAH
(801) 990-1775
WWW.VECTORSOLAR.COM

Copyright © 2021

Vector Structural Engineering, LLC


This drawing contains proprietary information belonging to Vector Structural Engineering, LLC, and may be neither wholly nor partially copied or reproduced without the prior written permission of Vector Structural Engineering, LLC.

SUBJECT CONNECTION @ MANUFACTURED HIP TRUSS

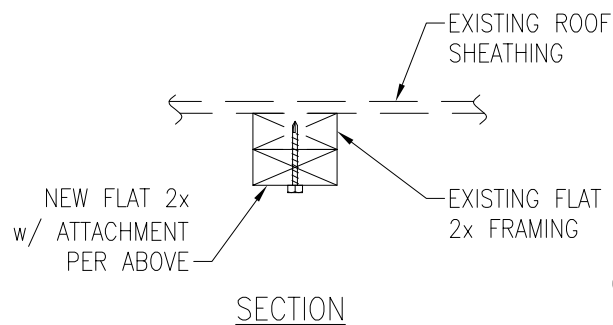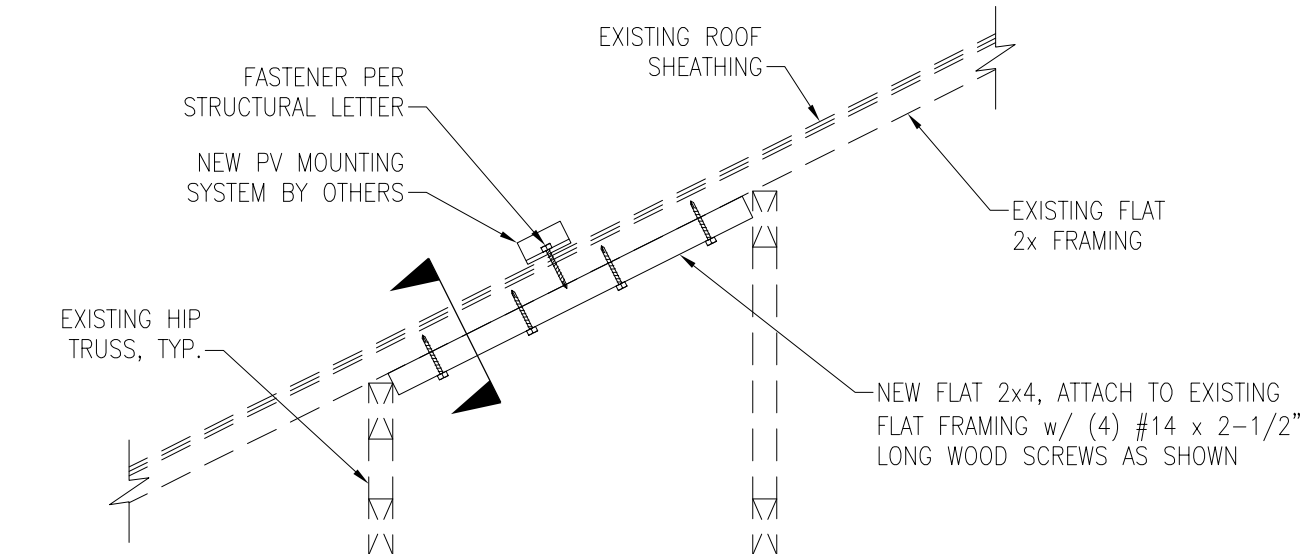

Coleman D. Larsen

Digitally signed by Coleman D. Larsen
Date: 2021.07.08 16:24:59 -06'00'

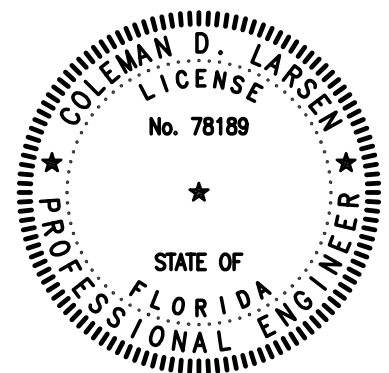

07/08/2021

NOTES:

1. GRADE OF NEW DIMENSIONAL LUMBER SHALL BE SPF #2, DFL #2, OR BETTER.
2. CONSULT ENGINEER WHERE CONDITIONS DIFFER FROM THAT SHOWN.
3. RETROFIT REQUIRED @ ROOF AREAS SUPPORTING SOLAR PANELS ONLY, U.N.O. IN LETTER.

This item has been digitally signed and sealed by Coleman D. Larsen on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



JOB NO.: U3607.0051.211
SUBJECT: WIND PRESSURE

PROJECT: Thomas Residence

Components and Cladding Wind Calculations

Label: Solar Panel Array

Note: Calculations per ASCE 7-16

SITE-SPECIFIC WIND PARAMETERS:

Basic Wind Speed [mph]: 121
Exposure Category: C
Risk Category: II

Notes:

ADDITIONAL INPUT & CALCULATIONS:

Height of Roof, h [ft]:	15	(Approximate)			
Comp/Cladding Location:	Hip Roofs $27^\circ < \theta \leq 45^\circ$				
Enclosure Classification:	Enclosed Buildings				
Zone 1 GCp:	1.20	Figure 30.3-2H	Zone 1 γ_a :	0.78	Fig. 29.4-8
Zone 2r GCp:	1.35	(negative coeff.)	Zone 2r γ_a :	0.78	
Zone 2e GCp:	1.40		Zone 2e γ_a :	0.78	
Zone 3 GCp:	1.66		Zone 3 γ_a :	0.78	
α :	9.5	Table 26.11-1			
z_g [ft]:	900	Table 26.11-1			
K_h :	0.85	Table 26.10-1			
K_e :	1.00	Table 26.9-1			
K_{zt} :	1	Equation 26.8-1			
K_d :	0.85	Table 26.6-1			
Velocity Pressure, q_h [psf]:	27.0	Equation 26.10-1			
γ_E :	1.50	Section 29.4.4			

WIND PRESSURES:

Equation 29.4-7 $p = q_h(GC_p)(\gamma_E)(\gamma_a)$

Zone 1, p [psf]:	37.8	psf (1.0 W)
Zone 2r, p [psf]:	42.8	psf (1.0 W)
Zone 2e, p [psf]:	44.3	psf (1.0 W)
Zone 3, p [psf]:	52.4	psf (1.0 W)

(a = 3 ft)



JOB NO.: U3607.0051.211
SUBJECT: CONNECTION

PROJECT: Thomas Residence

Calculate Uplift Forces on Connection

	Pressure (0.6 Dead -0.6 Wind) (psf)	Max Trib. Width ¹ (ft)	Max Trib. Area ² (ft ²)	Max Uplift Force (lbs)
Zone 1	20.9	4.0	11.2	233
Zone 2r	23.9	4.0	11.2	266
Zone 2e	24.8	4.0	11.2	277
Zone 3	29.6	4.0	11.2	331

Calculate Connection Capacity

Lag Screw Size [in]:	5/16	NDS Table 2.3.2
C _d :	1.6	
Embedment ³ [in]:	2.5	NDS Table 12.2A
Grade:	SPF (G = 0.42)	
Nominal Capacity [lbs/in]:	205	
Number of Screws:	1	
Prying Coefficient:	1.4	
Total Capacity [lbs]:	586	

Determine Result

Maximum Demand [lbs]:	331
Lag Screw Capacity [lbs]:	586

Result: **Capacity > Demand, Connection is adequate.**

Notes

1. 'Max Trib. Width' is the width along the rails tributary to the connection.
2. 'Max Trib Area' is the product of the 'Max. Trib Width' and 1/2 the panel width/height perpendicular to the rails. (2) rails per row of panels. Length of panels perpendicular to the rails shall not exceed 67".
3. Embedment is measured from the top of the framing member to the beginning of the tapered tip of the lag screw. Embedment in sheathing or other material is not effective. The length of the tapered tip is not part of the embedment length.



JOB NO.: U3607.0051.211
SUBJECT: GRAVITY LOADS

PROJECT: Thomas Residence

GRAVITY LOADS

Roof Pitch: :12

ROOF DEAD LOAD (D)	Design material weight [psf]	Increase due to pitch	Material weight [psf]
Asphalt Shingles	2.3	1.16	2.0
1/2" Plywood	1.2	1.16	1.0
Framing	3.0		3.0
Insulation	0.5		0.5
1/2" Gypsum Clg.	2.3	1.16	2.0
M, E & Misc	1.5		1.5
Total Existing Roof DL	10.8		
PV Array DL	3.5	1.16	3

ROOF LIVE LOAD (Lr)

Existing Design Roof Live Load [psf]

ASCE 7-16 Table 4.3-1

Roof Live Load With PV Array [psf]

2020 FBC - Building, Section 1607.12.5



JOB NO.: U3607.0051.211
SUBJECT: LOAD COMPARISON

PROJECT: Thomas Residence

Summary of Loads

	Existing	With PV Array
D [psf]	11	14
Lr [psf]	20	0
S [psf]	0	0

Maximum Gravity Loads:

	Existing	With PV Array	
(D + Lr) / Cd [psf]	25	16	ASCE 7-16, Section 2.4.1
(D + S) / Cd [psf]	12	16	ASCE 7-16, Section 2.4.1

(Cd = Load Duration Factor = 0.9 for D, 1.15 for S, and 1.25 for Lr)

Maximum Gravity Load [psf]:	25	16
-----------------------------	----	----


Ratio Proposed Loading to Current Loading:

64%

OK

The gravity loads, and thus the stresses of the structural elements, in the area of the solar array are either decreased or increased by no more than 5%. Therefore, the requirements of Section 807.5 of the 2020 FBC - Existing Building are met and the structure is permitted to remain unaltered.

PROJECT: Thomas Residence

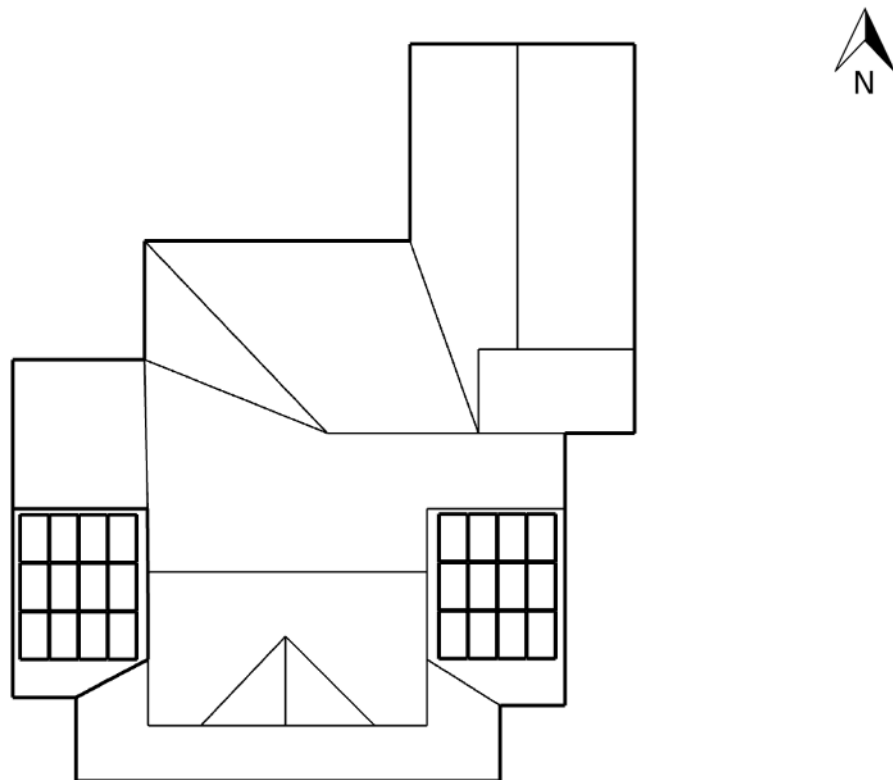

kl i

2 GkVGr