


[DBPR HOME](#) / [ABOUT DBPR](#) / [DBPR DIVISIONS](#) / [CONTACT DBPR](#)
[BCIS Home](#) | [Log In](#) | [User Registration](#) | [Hot Topics](#) | [Submit Surcharge](#) | [Stats & Facts](#) | [Publications](#) | [Contact Us](#) | [BCIS Site Map](#) | [Links](#) | [Search](#)


Product Approval

USER: Public User

[Product Approval Menu](#) > [Product or Application Search](#) > [Application List](#) > **Application Detail**

OFFICE OF THE
SECRETARY

FL #	FL15216-R13
Application Type	Revision
Code Version	2023
Application Status	Approved
Comments	
Archived	<input type="checkbox"/>
Product Manufacturer	Owens Corning Roofing and Asphalt, LLC
Address/Phone/Email	One Owens Corning Parkway Toledo, OH 43645 (740) 321-6345 Greg.Keeler@owenscorning.com
Authorized Signature	Keeler Greg Greg.Keeler@owenscorning.com
Technical Representative	Greg Keeler
Address/Phone/Email	2790 Columbus Road Granville, OH 43023 (740) 321-6345 greg.keeler@owenscorning.com
Quality Assurance Representative	
Address/Phone/Email	
Category	Roofing
Subcategory	Underlayments
Compliance Method	Evaluation Report from a Florida Registered Architect or a Licensed Florida Professional Engineer <input type="checkbox"/> Evaluation Report - Hardcopy Received
Florida Engineer or Architect Name who developed the Evaluation Report	Robert Nieminen
Florida License	PE-59166
Quality Assurance Entity	Intertek Testing Services NA, Inc. - QA Entity
Quality Assurance Contract Expiration Date	12/31/2026
Validated By	John W. Knezevich, PE <input checked="" type="checkbox"/> Validation Checklist - Hardcopy Received
Certificate of Independence	FL15216_R13_COI_2023_07_COI_NIEMINEN.pdf
Referenced Standard and Year (of Standard)	Standard ASTM D8257
	Year 2020
Equivalence of Product Standards Certified By	
Sections from the Code	

Product Approval Method

Method 1 Option D

Date Submitted

10/23/2023

Date Validated

10/23/2023

Date Pending FBC Approval

10/30/2023

Date Approved

12/12/2023

Summary of Products

FL #	Model, Number or Name	Description
15216.1	RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments	Synthetic roof underlayments
Limits of Use Approved for use in HVHZ: Yes Approved for use outside HVHZ: Yes Impact Resistant: N/A Design Pressure: N/A Other: Refer to PEER Section 5 for Limits of Use.		Installation Instructions FL15216_R13_II_2023_10_23_FINAL_PEER-OC-003.A_FL15216-R13.pdf Verified By: Robert Nieminen PE-59166 Created by Independent Third Party: Yes Evaluation Reports FL15216_R13_AE_2023_10_23_FINAL_PEER-OC-003.A_FL15216-R13.pdf Created by Independent Third Party: Yes

[Back](#)[Next](#)

[Contact Us](#) :: [2601 Blair Stone Road, Tallahassee FL 32399](#) Phone: 850-487-1824

The State of Florida is an AA/EEO employer. [Copyright 2007-2013 State of Florida](#). :: [Privacy Statement](#) :: [Accessibility Statement](#) :: [Refund Statement](#)

Under Florida law, email addresses are public records. If you do not want your e-mail address released in response to a public-records request, do not send electronic mail to this entity. Instead, contact the office by phone or by traditional mail. If you have any questions, please contact 850.487.1395. *Pursuant to Section 455.275(1), Florida Statutes, effective October 1, 2012, licensees licensed under Chapter 455, F.S. must provide the Department with an email address if they have one. The emails provided may be used for official communication with the licensee. However email addresses are public record. If you do not wish to supply a personal address, please provide the Department with an email address which can be made available to the public. To determine if you are a licensee under Chapter 455, F.S., please click [here](#).

Product Approval Accepts:



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

P.E. EVALUATION REPORT (PEER)

Owens Corning Roofing and Asphalt, LLC

One Owens Corning Parkway
Toledo, OH 43659
(740) 321-6345

PEER-OC-003.A.R14

FL15216-R13

Date of Issuance: 02/17/2012

Revision 14: 10/23/2023

SCOPE:

This P.E. Evaluation Report (henceforth 'PEER') is issued under **F.A.C. Rule 61G20-3** and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The products described herein have been evaluated for compliance with the **8th Edition (2023) Florida Building Code** [sections noted herein](#).

DESCRIPTION: RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein and [FBC 1507.1.1](#) and [FBC HVHZ 1518.2](#).

CONTINUED COMPLIANCE: This PEER is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our PEERs by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance, or the production facility location(s). NEMO ETC, LLC requires a complete review of its PEER relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: The Florida Product Approval Number (FL#) preceded by the words "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the PEER is displayed, then it shall be done in its entirety.


INSPECTION: Upon request, a copy of this entire PEER shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This PEER consists of pages 1 through 4.

Prepared by:

Digitally signed by
Robert Nieminen
Date: 2023.10.23
'13:53:23 -04'00

This item has been digitally signed and sealed by Robert Nieminen, P.E.
Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.
Robert Nieminen, Florida P.E. 59166, FBC ANE1983
NEMO ETC, LLC, Florida CA #32455

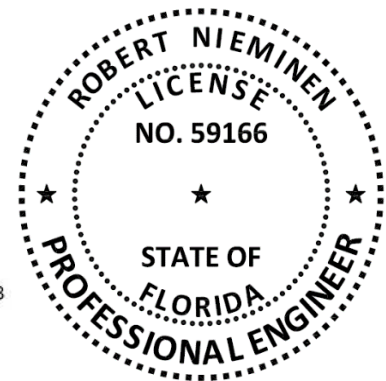

CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products for which the PEERs are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

©2019 NEMO ETC, LLC

ROOFING COMPONENT EVALUATION:
1. SCOPE:

Product Category: Roofing
Sub-Category: Underlayment
Product Approval Method: Method 1, Option D – Codified Material, Evaluation by Engineer
Compliance Statement: RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments, as produced by Owens Corning Roofing and Asphalt, LLC, have demonstrated compliance with the following sections of the 8th Edition (2023) Florida Building Code through testing in accordance with applicable sections of the following Standards. Compliance is subject to the [Installation Requirements](#) and [Limitations of Use](#) set forth herein.

2. STANDARDS:

SECTION	PROPERTIES	STANDARD
1507.1.1, R905.1.1, 1518.2	Material standard	ASTM D8257

3. REFERENCES:

ENTITY	EXAMINATION	REFERENCE	DATE
PRI (TST5878)	ASTM D8257-20	1378T0138	02/25/2021
PRI (TST5878)	ASTM D8257-20	1378T0139	03/23/2021
PRI (TST5878)	ASTM D8257-20	1378T0141	05/18/2021
PRI (TST5878)	ASTM D8257-20	1378T0273	10/25/2022
ITS (QUA1673)	ITS Audit Manual	3144566COQ-006A	09/10/2020
ITS (QUA1673)	Quality Control	Service Confirmation	08/13/2021
ITS (QUA1673)	Quality Control	Florida BCIS	Current

4. PRODUCT DESCRIPTION:

TABLE 1: EVALUATED UNDERLAYMENTS			
PRODUCT	SPECIFICATION	PLANT(S)	DESCRIPTION
RhinoRoof U10	ASTM D8257 ¹	Qingdao, China Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment
RhinoRoof U20	ASTM D8257 ¹	Qingdao, China Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment
ABC Pro Guard 20	ASTM D8257 ¹	Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment
SRS TopShield TS20	ASTM D8257 ¹	Silvassa, India	Multilayered polymer woven coated synthetic roof underlayment

5. LIMITATIONS:

- 5.1 This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this PEER, or previous versions thereof, is/was used for permitting or design guidance. PEERs are not to be construed as representing any attributes not specifically listed, nor are PEERs to be construed as an endorsement of the subject, or a recommendation for its use. There is no warranty by NEMO ETC, LLC or Robert Nieminen, P.E., express or implied, as to any finding or other matter in this PEER, or as to any product covered by the PEER.
- 5.2 This PEER pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.3 This PEER does not include evaluation of fire classification. Refer to **FBC 1505** or **FBC HVHZ 1516** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.

- 5.4 **RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments** may be used with any prepared roof cover where the product is specifically referenced within FBC approval documents. If not listed, a request may be made to the Authority Having Jurisdiction for approval based on this evaluation combined with supporting data for the prepared roof covering.

5.5 **Allowable roof covers:**

TABLE 2: ROOF COVER OPTIONS					
<u>FBC NON-HVHZ:</u>	1507.2	1507.3	1507.4 & 1507.5	1507.7	1507.8 & 1507.9
<u>FBC HVHZ:</u>	RAS 115, 1518.2.1	RAS 118, 119 & 120	RAS 133, 1518.2.1	1518.2.1	RAS 130, 1518.10
UNDERLAYMENT	ASPHALT SHINGLES	ROOF TILE	METAL	SLATE OR SLATE-TYPE SHINGLES	WOOD
RhinoRoof U10	Yes	No	Yes	No	NON-HVHZ: No HVHZ: Yes
RhinoRoof U20	Yes	No	Yes	No	NON-HVHZ: No HVHZ: Yes
ABC Pro Guard 20	Yes	No	Yes	No	NON-HVHZ: No HVHZ: Yes
SRS TopShield TS20	Yes	No	Yes	No	NON-HVHZ: No HVHZ: Yes

5.6 **Exposure Limitations:**

TABLE 3: EXPOSURE LIMITATIONS	
UNDERLAYMENT	MAXIMUM EXPOSURE (DAYS)
RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 or SRS TopShield TS20	90

6. INSTALLATION:

- 6.1 **RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments** shall be installed in accordance with the manufacturer's published installation instructions subject to the [Limitations of Use](#) herein and the specifics noted below.
- 6.2 Re-fasten any loose decking panels, and check for protruding nail heads. Sweep the substrate thoroughly to remove any dust and debris prior to application.

6.3 RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 Roof Underlayments:

6.3.1 **NON-HVHZ JURISDICTIONS:**

Shall be installed in compliance with requirements for a synthetic underlayment (ASTM D8257) in **FBC 1507.1.1.1** or **FBC Residential R905.1.1.1** for the type of prepared roof covering to be installed, and the manufacturer's installation instructions. FBC requirements take precedence over the manufacturer's installation instructions. FBC requirements take precedence over the manufacturer's installation instructions.

6.3.2	HVHZ JURISDICTIONS:	
6.3.2.1	DECK TYPE 1:	Wood, Non-Insulated
	DECK DESCRIPTION:	Min. 19/32-inch plywood or wood plank
	SYSTEM TYPE E-1:	Underlayment mechanically fastened to deck
	UNDERLAYMENT:	Two (2) layers of RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 in accordance with FBC HVHZ 1518.2.1(3).
	FASTENING:	Grid pattern of 12-inches between the overlaps, with 6-inch spacing at the overlaps, in accordance with FBC HVHZ 1518.2.1(3).
	SURFACING:	FBC HVHZ Approved asphalt shingles, metal roof panels or metal shingles, slate or slate type shingles.
6.3.2.2	DECK TYPE 1:	Wood, Non-Insulated
	DECK DESCRIPTION:	Min. 19/32-inch plywood
	SYSTEM TYPE E-1:	Self-adhering strips to plywood joints; underlayment mechanically fastened to deck
	SECONDARY WATER BARRIER:	Min. 3¾-inch wide strips of FBC HVHZ Approved self-adhering underlayment over joints of the plywood roof deck prior to installation of subsequent layer(s) in accordance with FBC HVHZ 1518.2.1(2). Do not overlap end-joints or T-joints. All end-joints and T-joints shall be butted firmly side by side, flush with each other but not overlapped.
	UNDERLAYMENT:	RhinoRoof U10, RhinoRoof U20, ABC Pro Guard 20 and SRS TopShield TS20 in accordance with FBC HVHZ Table 1518.2.1.
	FASTENING:	Grid pattern of 12-inches between the overlaps, with 6-inch spacing at the overlaps, in accordance with FBC HVHZ Table 1518.2.1.
	SURFACING:	FBC HVHZ Approved metal shingles, slate, slate type shingles, wood shingles or wood shakes.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

9. QUALITY ASSURANCE ENTITY:

[Intertek Testing Services NA Inc. – QUA1673](#); (312) 906-7779; maura.norlander@intertek.com

- END OF PEER -

ⁱ Agreement between purchaser and seller, as set forth in Section 4.3, Note 1 of ASTM D8257-20, should be established as to slip resistance.