

CAROL CHADWICK, P.E.

Civil Engineer

1208 S.W. Fairfax Glen
Lake City, FL 32025

307.680.1772

ccpcwyo@gmail.com

www.carolchadwickpe.com

August 9, 2022

Kim Koon

KDK Permitting

386.688.2345

kdkpermitting@gmail.com

re: ELEVATION LETTER – 385 SW SUMAC LANE, LAKE CITY, FL

As requested, I inspected the building site for the proposed construction at the above referenced site. The existing mobile home on the property will be removed. The proposed location of the home had been staked. Per the attached SRWMD flood report, the site is not in a flood plain and no wetlands are present. The site naturally drains to the northeast. Photo 1 shows the proposed home location looking north. Photo 2 shows the existing driveway looking south.



Per Lidar data on the Columbia County website, the existing road centerline elevation varies from 106.1' +/- to 103.8' +/- . The existing elevation at the building site is 96.9' +/- . The minimum finished floor elevation of the structure will be **99.50'**. The finished floor of the home will be below the required elevation of one foot above the adjacent road.

CAROL CHADWICK, P.E.

Page 2

I certify that the minimum finished floor elevation listed above will protect the structure against water damage from a base flood event, as defined in Article 8 of the Land Development Regulations.

Should you have any questions, please don't hesitate to contact me.

Respectfully,

Digitally signed
by Carol
Chadwick
DN: c=US,
o=Florida,
dnQualifier=A01
410D0000017EB
6D924CE000595
4C, cn=Carol
Chadwick
Date: 2022.08.09
15:49:13 -04'00'



Carol Chadwick, P.E.

attachment: SRWMD Flood Report, Site Plan by others dated June 20, 2022

EFFECTIVE FLOOD INFORMATION REPORT



Location Information

County: **COLUMBIA**
 Parcel: **28-4S-16-03231-011**
 Flood Zone: **X**
 Flood Risk: **LOW**

1% Annual Chance Base Flood Elev* **Not Applicable**
 10% Annual Chance Flood Elev* **Not Applicable**
 50% Annual Chance Flood Elev* **Not Applicable**

* Flood Elevations shown on this report are in NAVD 88 and are derived from FEMA flood mapping products, rounded to the nearest tenth of a foot. For more information, please see the note below

Legend with Flood Zone Designations

	1% Flood -Floodway (High Risk)		Area Not Included		CrossSections		Wetlands
	1% Flood - Zone AE (High Risk)		SFHA Decrease		County Boundaries		
	1% Flood - Zone A (HighRisk)		SFHA Increase		FIRM Panel Index		
	1% Flood - Zone VE (HighRisk)		Depressions		Parcels		
	0.2% Flood-Shaded Zone X (Moderate Risk)		BaseFlood Elevations (BFE)		River Marks		

Supplemental Information

Watershed	Santa Fe	Map Effective Date	2/4/2009	Special Flood Hazard Area	No
FIRM Panel(s)	12023C0380C				

Anywhere it can rain, it can flood
Know your risk.



www.srwmdfloodreport.com

The information herein represents the best available data as of the effective map date shown. The Federal Emergency Management Agency (FEMA) Flood Map Service Center (<https://msc.fema.gov>) maintains the database of Flood Insurance Studies and Digital Flood Insurance Rate Maps, as well as additional information such as how the Base Flood Elevations (BFEs) and/or floodways have been determined and previously issued Letters of Map Change. Requests to revise flood information may be provided to the District during the community review period on preliminary maps, or through the appropriate process with FEMA [Change Your Flood Zone Designation | FEMA.gov](https://www.floodsmart.com). Information about flood insurance may be obtained at (<https://www.floodsmart.com>)

Base Flood Elevation (BFE)

The elevation shown on the Flood Insurance Rate Map for Zones AE, AH, A1-A30, AR, AO, V1-V30, and VE that indicates the water surface elevation resulting from a flood that has a one percent chance of equaling or exceeding that level in any given year.

A

Areas with a 1% annual chance of flooding and a 26% chance of flooding over the life of a 30-year mortgage. Because detailed analyses are not performed for such areas; no depths or base flood elevations are shown within these zones.

AE, A1-A30

Areas with a 1% annual chance of flooding and a 26% chance of flooding over the life of a 30-year mortgage. In most instances, base flood elevations derived from detailed analyses are shown at selected intervals within these zones.

AH

Areas with a 1% annual chance of flooding and a 26% chance of flooding over the life of a 30-year mortgage. Usually areas of ponding with flood depths of 1 to 3 feet. Base Flood Elevations are determined.

AO

Areas with a 1% annual chance of flooding and a 26% chance of flooding over the life of a 30-year mortgage. Usually areas of sheet flow on sloping terrain with flood depths of 1 to 3 feet. Base Flood Elevations are determined.

Supplemental Information:

10%-chance flood elevations (10-year flood-risk elevations) and 50%-chance flood elevations (2-year flood-risk elevations), are calculated during detailed flooding studies but are not shown on FEMA Digital Flood Insurance Rate Maps (FIRMs). They have been provided as supplemental information in

AE FW (FLOODWAYS)

The channel of a river or other watercourse and the adjacent land areas that must be reserved in order to discharge the base flood (1% annual chance flood event). The floodway must be kept open so that flood water can proceed downstream and not be obstructed or diverted onto other properties.

Please note, if you develop within the regulatory floodway, you will need to contact your Local Government and the Suwannee River Water Management District prior to commencing with the activity. Please contact the District at 800.226.1066.

VE

Areas with a 1% annual chance of flooding over the life of a 30-year mortgage with additional hazards due to storm-induced velocity wave action. Base Flood Elevations (BFEs) derived from detailed analyses.

X 0.2 PCT (X Shaded, 0.2 PCT ANNUAL CHANCE FLOOD HAZARD)

Same as Zone X; however, detailed studies have been performed, and the area has been determined to be within the 0.2 percent annual chance floodplain (also known as the 500-year flood zone). Insurance purchase is not required in this zone but is available at a reduced rate and is recommended.

X

All areas outside the 1-percent annual chance floodplain are Zone X. This includes areas of 1% annual chance sheet flow flooding where average depths are less than 1 foot, areas of 1% annual chance stream flooding where the contributing drainage area is less than 1 square mile, or areas protected from the 1% annual chance flood by levees. No Base Flood Elevations or depths are shown within this zone. Insurance purchase is not required in these zones.

LINKS FEMA:

<http://www.fema.gov>

SRWMD:

<http://www.srwmd.state.fl.us>

CONTACT

SRWMD
9225 County Road 49
Live Oak, FL 32060

(386) 362-1001

Toll Free:
(800) 226-1066



Columbia County Property Appraiser Jeff Hampton | Lake City, Florida | 386-758-1083


PARCEL: 28-4S-16-03231-011 (15943) | MOBILE HOME (0200) | 10 AC
SE1/4 OF NW1/4 OF SE1/4, 831-804, LE 1295-1876,

NOTES:

WILLIAMS JOAN V			2022 Working Values		
Owner:	385 SW SUMAC LN LAKE CITY, FL 32024	Mkt Lnd	\$80,000	Appraised	\$102,029
Site:	385 SW SUMAC LN, LAKE CITY	Ag Lnd	\$0	Assessed	\$67,432
Sales	6/3/2015	Bldg	\$17,379	Exempt	\$42,432
Info	11/26/1996	XFOB	\$4,650		county:\$25,000
		Just	\$102,029	Total	city:\$0
				Taxable	other:\$0
					school:\$42,432

Columbia County, FL

This information was derived from data which was compiled by the Columbia County Property Appraiser Office solely for the governmental purpose of property assessment. This information should not be relied upon by anyone as a determination of the ownership of property or market value. No warranties, expressed or implied, are provided for the accuracy of the data herein, it's use, or it's interpretation. Although it is periodically updated, this information may not reflect the data currently on file in the Property Appraiser's office.

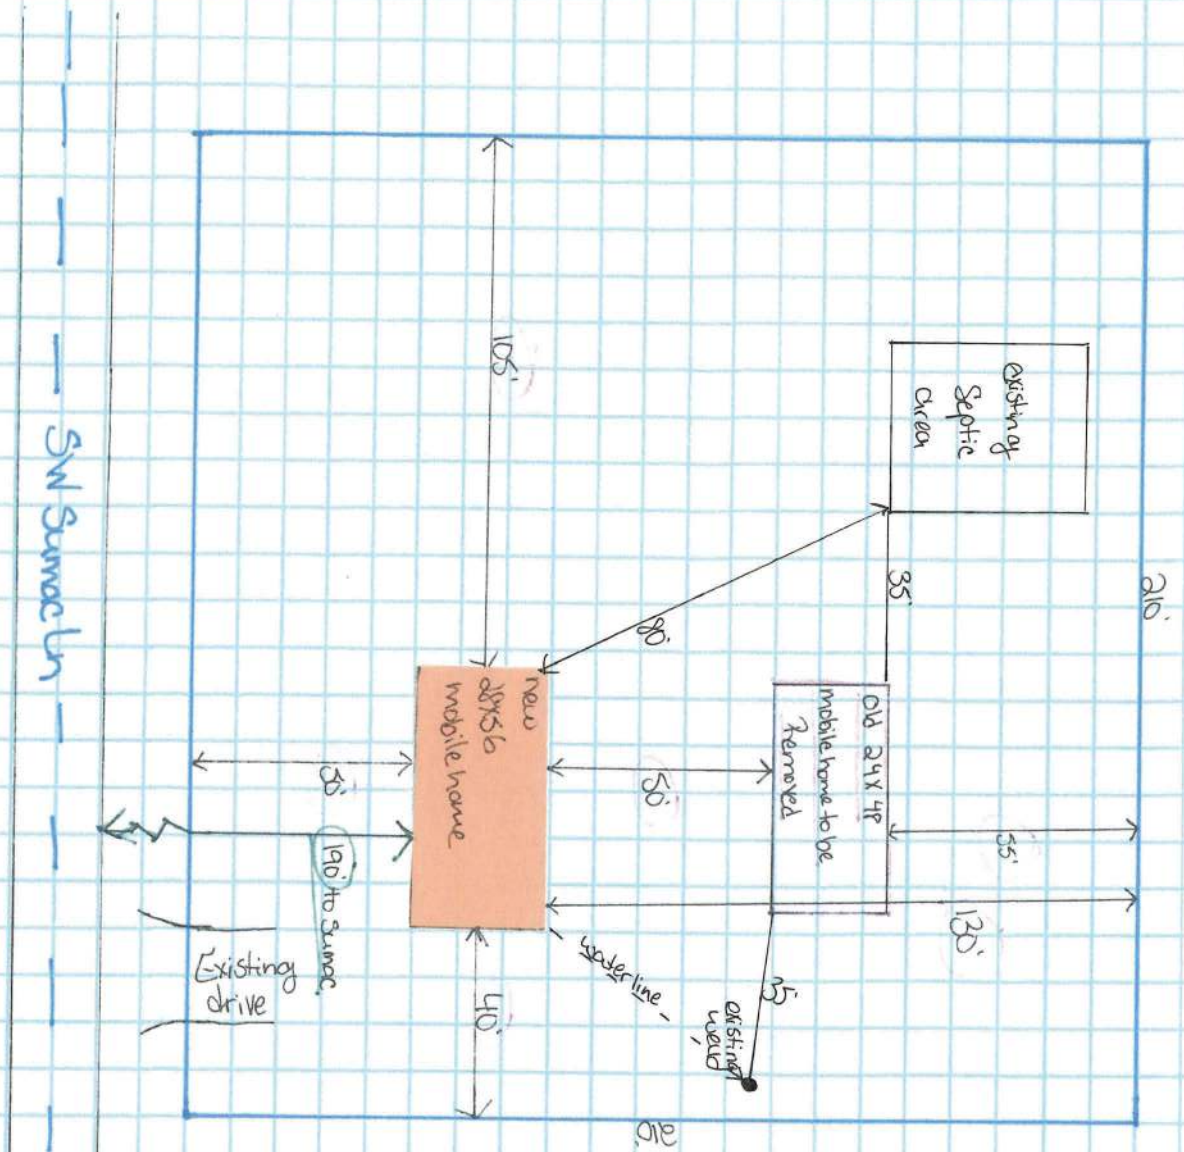

SW Sumac Ln

Joan Williams
 1 of 10 ac.
 28-45-16-05231-011
 385 SW Sumac Ln
 Lake City FL 32054
 Drawn by Kim Moon
 Kukulsky Moon
 G 20022
 1"=40'
 North