



Lumber design values are in accordance with ANSI/TPI 1 section 6.3  
These truss designs rely on lumber values established by others.

RE: 3975847 - FEAGIN - YATES RES.

MiTek, Inc.  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

**Site Information:**

Customer Info: FEAGIN CONSTRUCTION Project Name: Yates Res. Model: Custom  
Lot/Block: N/A Subdivision: N/A  
Address: 2183 SE October Road, N/A  
City: Columbia Cty State: FL

**Name Address and License # of Structural Engineer of Record, If there is one, for the building.**

Name: License #:  
Address: State:  
City:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.7  
Wind Code: ASCE 7-22 Wind Speed: 130 mph  
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 38 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

| No. | Seal#     | Truss Name | Date   | No. | Seal#     | Truss Name | Date   |
|-----|-----------|------------|--------|-----|-----------|------------|--------|
| 1   | T33792878 | CJ01       | 5/8/24 | 15  | T33792892 | T01G       | 5/8/24 |
| 2   | T33792879 | CJ01A      | 5/8/24 | 16  | T33792893 | T02        | 5/8/24 |
| 3   | T33792880 | CJ03       | 5/8/24 | 17  | T33792894 | T02G       | 5/8/24 |
| 4   | T33792881 | CJ03A      | 5/8/24 | 18  | T33792895 | T03        | 5/8/24 |
| 5   | T33792882 | CJ05       | 5/8/24 | 19  | T33792896 | T04        | 5/8/24 |
| 6   | T33792883 | CJ05A      | 5/8/24 | 20  | T33792897 | T05        | 5/8/24 |
| 7   | T33792884 | EJ01       | 5/8/24 | 21  | T33792898 | T06        | 5/8/24 |
| 8   | T33792885 | EJ02       | 5/8/24 | 22  | T33792899 | T07        | 5/8/24 |
| 9   | T33792886 | EJ02G      | 5/8/24 | 23  | T33792900 | T08        | 5/8/24 |
| 10  | T33792887 | HJ10       | 5/8/24 | 24  | T33792901 | T09        | 5/8/24 |
| 11  | T33792888 | HJ10A      | 5/8/24 | 25  | T33792902 | V01        | 5/8/24 |
| 12  | T33792889 | PB01       | 5/8/24 | 26  | T33792903 | V02        | 5/8/24 |
| 13  | T33792890 | PB01G      | 5/8/24 | 27  | T33792904 | V03        | 5/8/24 |
| 14  | T33792891 | T01        | 5/8/24 | 28  | T33792905 | V04        | 5/8/24 |




This item has been digitally signed and sealed by Velez, Joaquin, PE on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by  
MiTek USA, Inc. under my direct supervision based on the parameters  
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: Velez, Joaquin

My license renewal date for the state of Florida is February 28, 2025.

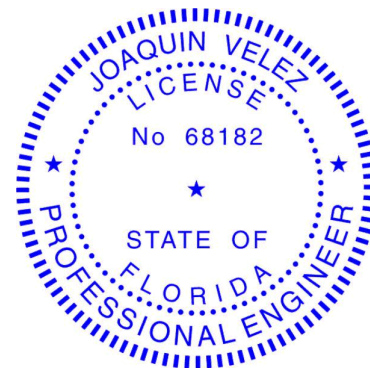

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

May 8, 2024

Velez, Joaquin

1 of 2



RE: 3975847 - FEAGIN - YATES RES.

MiTek, Inc.  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

**Site Information:**


Customer Info: FEAGIN CONSTRUCTION    Project Name: Yates Res.    Model: Custom  
Lot/Block: N/A    Subdivision: N/A  
Address: 2183 SE October Road, N/A  
City: Columbia Cty    State: FL

| No. | Seal#     | Truss Name | Date   |
|-----|-----------|------------|--------|
| 29  | T33792906 | V05        | 5/8/24 |
| 30  | T33792907 | V06        | 5/8/24 |
| 31  | T33792908 | V07        | 5/8/24 |
| 32  | T33792909 | V08        | 5/8/24 |
| 33  | T33792910 | V09        | 5/8/24 |
| 34  | T33792911 | V10        | 5/8/24 |
| 35  | T33792912 | V11        | 5/8/24 |
| 36  | T33792913 | V12        | 5/8/24 |
| 37  | T33792914 | V13        | 5/8/24 |
| 38  | T33792915 | V14        | 5/8/24 |

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792878 |
| 3975847 | CJ01  | Jack-Open  | 4   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:04 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-Ki0c6mv?TZh0qsWxYtOkdqloKT3vqKfdh?IZBFzIsWb

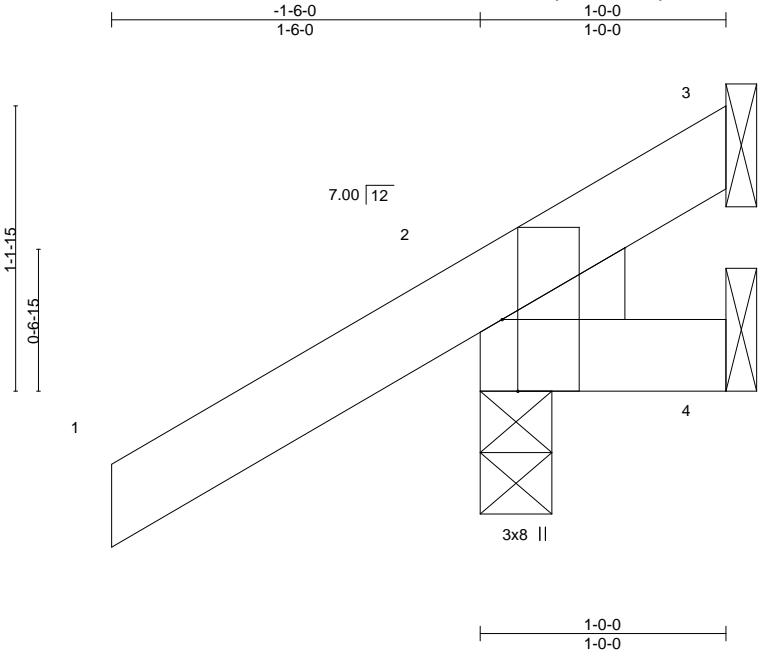

Scale = 1:9.4

| Plate Offsets (X,Y)-- |                 | [2:0-3-8,Edge]  |                           |
|-----------------------|-----------------|-----------------|---------------------------|
| <b>LOADING</b> (psf)  | <b>SPACING-</b> | 2-0-0           | <b>CSI.</b>               |
| TCLL 20.0             | Plate Grip DOL  | 1.25            | TC 0.18                   |
| TCDL 7.0              | Lumber DOL      | 1.25            | BC 0.02                   |
| BCLL 0.0 *            | Rep Stress Incr | YES             | WB 0.00                   |
| BCDL 10.0             | Code            | FBC2023/TPI2014 | Matrix-MP                 |
|                       |                 |                 | <b>DEFL.</b>              |
|                       |                 |                 | in (loc) l/defl L/d       |
|                       |                 |                 | Vert(LL) 0.00 7 >999 240  |
|                       |                 |                 | Vert(CT) 0.00 7 >999 180  |
|                       |                 |                 | Horz(CT) 0.00 2 n/a n/a   |
|                       |                 |                 | <b>PLATES</b> <b>GRIP</b> |
|                       |                 |                 | MT20 244/190              |
|                       |                 |                 | Weight: 7 lb FT = 20%     |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=51(LC 12)  
Max Uplift 3=-7(LC 1), 2=-70(LC 12), 4=-19(LC 19)  
Max Grav 3=6(LC 16), 2=179(LC 1), 4=16(LC 16)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 3, 70 lb uplift at joint 2 and 19 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792879 |
| 3975847 | CJ01A | JACK-OPEN  | 4   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:04 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-Ki0c6mv?TZh0qsWxYtOkdqlocT3qqKfdh?IZBFzIsWb

-1-6-0 1-6-0 1-2-0 1-2-0

Scale = 1:5.9

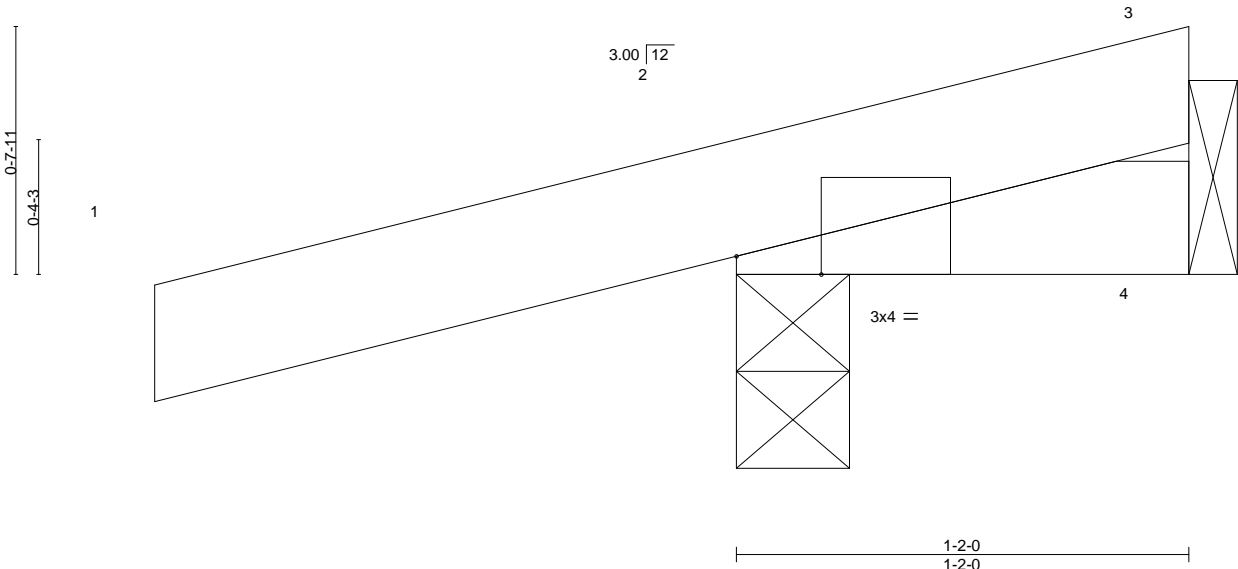

| Plate Offsets (X,Y)-- |       | [2:0-2-10,Edge] |                 |           |      |          |       |          |      |              |          |
|-----------------------|-------|-----------------|-----------------|-----------|------|----------|-------|----------|------|--------------|----------|
| LOADING (psf)         |       | SPACING-        |                 | CSI.      |      | DEFL.    |       |          |      | PLATES       |          |
| TCLL                  | 20.0  | Plate Grip DOL  | 1.25            | TC        | 0.17 | Vert(LL) | 0.00  | in (loc) | 5    | >999         | 240      |
| TCDL                  | 7.0   | Lumber DOL      | 1.25            | BC        | 0.03 | Vert(CT) | -0.00 | 5        | >999 | 180          |          |
| BCLL                  | 0.0 * | Rep Stress Incr | YES             | WB        | 0.00 | Horz(CT) | 0.00  | 2        | n/a  | n/a          |          |
| BCDL                  | 10.0  | Code            | FBC2023/TPI2014 | Matrix-MP |      |          |       |          |      |              |          |
|                       |       |                 |                 |           |      |          |       |          |      | Weight: 6 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-2-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 4=Mechanical  
Max Horz 2=30(LC 8)  
Max Uplift 2=-131(LC 8), 4=-16(LC 1)  
Max Grav 2=176(LC 1), 4=21(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 131 lb uplift at joint 2 and 16 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792880 |
| 3975847 | CJ03  | Jack-Open  | 4   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.730 s Apr 25 2024 MiTek Industries, Inc.
Tue May 7 14:39:05 2024
Page 1
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-oua\_J6weEtptS0576bvZA1Iz4tNPZvnwU7jhzlsWa



Scale = 1:15.3

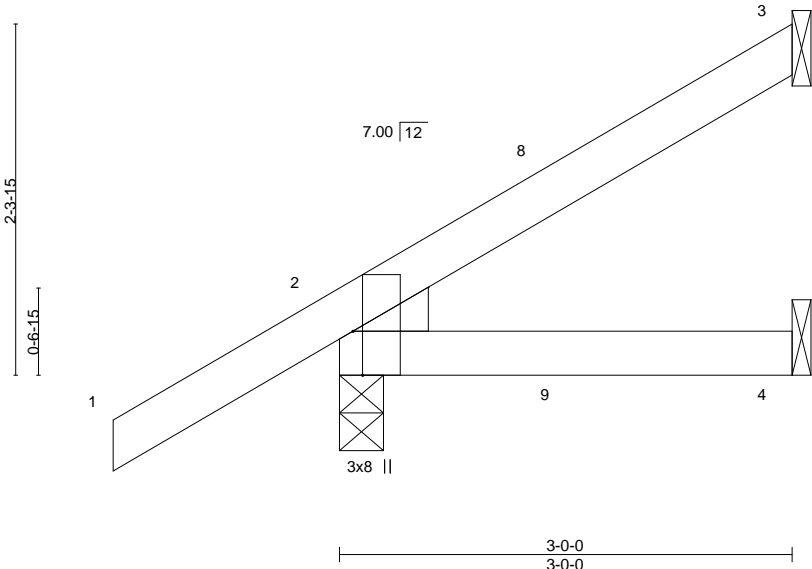

| Plate Offsets (X,Y)-- |       | [2:0-3-8,Edge]       |  |           |      |                           |       |     |      |                        |      |         |
|-----------------------|-------|----------------------|--|-----------|------|---------------------------|-------|-----|------|------------------------|------|---------|
| LOADING (psf)         |       | SPACING- 2-0-0       |  | CSI.      |      | DEFL. in (loc) l/defl L/d |       |     |      | PLATES GRIP            |      |         |
| TCLL                  | 20.0  | Plate Grip DOL 1.25  |  | TC        | 0.18 | Vert(LL)                  | 0.01  | 4-7 | >999 | 240                    | MT20 | 244/190 |
| TCDL                  | 7.0   | Lumber DOL 1.25      |  | BC        | 0.07 | Vert(CT)                  | -0.01 | 4-7 | >999 | 180                    |      |         |
| BCLL                  | 0.0 * | Rep Stress Incr YES  |  | WB        | 0.00 | Horz(CT)                  | -0.00 | 3   | n/a  | n/a                    |      |         |
| BCDL                  | 10.0  | Code FBC2023/TPI2014 |  | Matrix-MP |      |                           |       |     |      | Weight: 13 lb FT = 20% |      |         |

|                   |             |                 |   |
|-------------------|-------------|-----------------|---|
| <b>LUMBER-</b>    |             | <b>BRACING-</b> |   |
| TOP CHORD         | 2x4 SP No.2 | TOP CHORD       | Structural wood sheathing directly applied or 3-0-0 oc purlins. |
| BOT CHORD         | 2x4 SP No.2 | BOT CHORD       | Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| WEDGE             |             |                 |   |
| Left: 2x4 SP No.3 |             |                 |   |

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=95(LC 12)  
Max Uplift 3=-47(LC 12), 2=-58(LC 12), 4=-21(LC 9)  
Max Grav 3=61(LC 19), 2=210(LC 1), 4=50(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 2-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 47 lb uplift at joint 3, 58 lb uplift at joint 2 and 21 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792882 |
| 3975847 | CJ05  | Jack-Open  | 4   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:06 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-G48NXSxG?Byk3AgJglQCIFr6oHhnIE8w9IEgG8zlsWZ

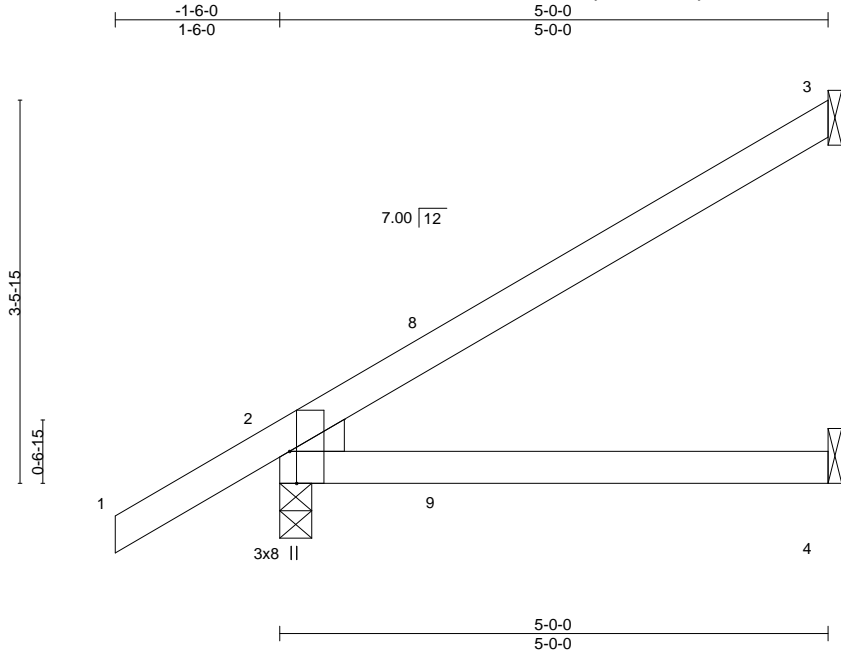

|                       |                      |       |           |          |           |        |     |               |          |
|-----------------------|----------------------|-------|-----------|----------|-----------|--------|-----|---------------|----------|
| Plate Offsets (X,Y)-- | [2:0-3-8,Edge]       |       |           |          |           |        |     |               |          |
| LOADING (psf)         | SPACING-             | 2-0-0 | CSI.      | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
| TCLL 20.0             | Plate Grip DOL       | 1.25  | TC 0.31   | Vert(LL) | 0.06 4-7  | >979   | 240 | MT20          | 244/190  |
| TCDL 7.0              | Lumber DOL           | 1.25  | BC 0.25   | Vert(CT) | -0.05 4-7 | >999   | 180 |               |          |
| BCLL 0.0 *            | Rep Stress Incr      | YES   | WB 0.00   | Horz(CT) | -0.01 3   | n/a    | n/a |               |          |
| BCDL 10.0             | Code FBC2023/TPI2014 |       | Matrix-MP |          |           |        |     | Weight: 20 lb | FT = 20% |

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=140(LC 12)  
Max Uplift 3=-86(LC 12), 2=-65(LC 12), 4=-36(LC 9)  
Max Grav 3=116(LC 19), 2=276(LC 1), 4=88(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 4-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 86 lb uplift at joint 3, 65 lb uplift at joint 2 and 36 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792883 |
| 3975847 | CJ05A | Jack-Open  | 4   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:06 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-G48NXSxG?Byk3AgJlQCIFr6dHhJIE8w9IEgG8zIsWZ



Scale = 1:12.3

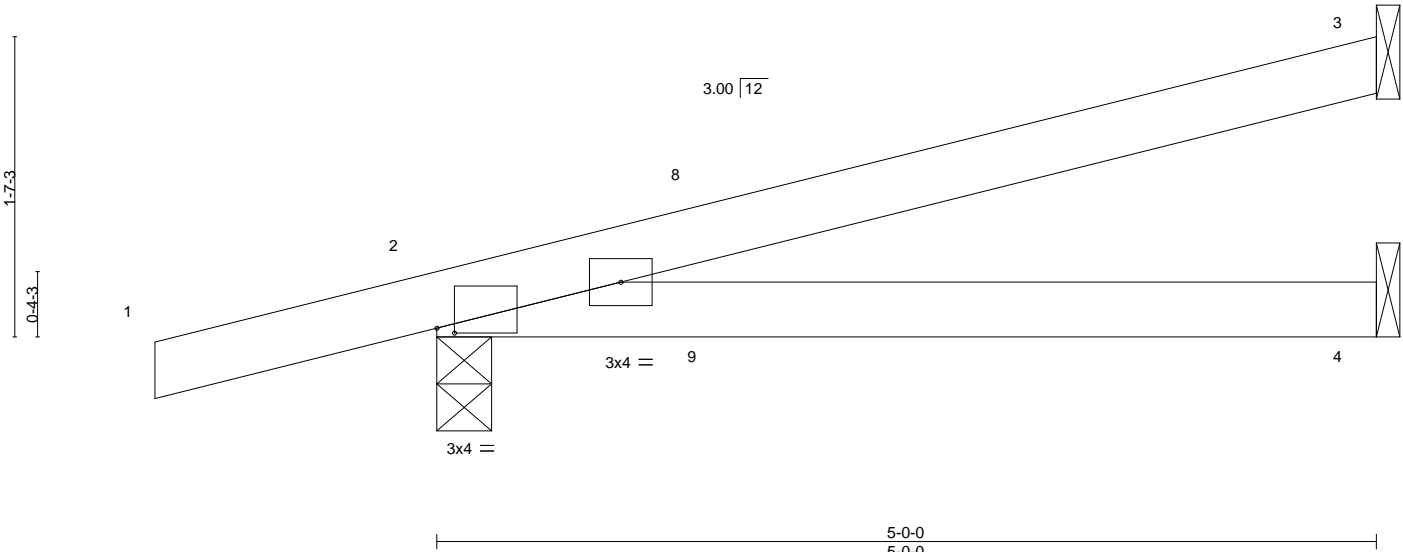

| Plate Offsets (X,Y)-- |       | [2:0-1-2,0-0-5]      |      |             |      |              |        |     |  |               |          |
|-----------------------|-------|----------------------|------|-------------|------|--------------|--------|-----|--|---------------|----------|
| <b>LOADING</b> (psf)  |       | <b>SPACING-</b>      |      | <b>CSI.</b> |      | <b>DEFL.</b> |        |     |  | <b>PLATES</b> |          |
| TCLL                  | 20.0  | Plate Grip DOL       | 1.25 | TC          | 0.26 | in (loc)     | l/defl | L/d |  | MT20          | GRIP     |
| TCDL                  | 7.0   | Lumber DOL           | 1.25 | BC          | 0.22 | 0.05 4-7     | >999   | 240 |  |               | 244/190  |
| BCLL                  | 0.0 * | Rep Stress Incr      | YES  | WB          | 0.00 | -0.05 4-7    | >999   | 180 |  |               |          |
| BCDL                  | 10.0  | Code FBC2023/TPI2014 |      | Matrix-MP   |      | -0.00 3      | n/a    | n/a |  | Weight: 18 lb | FT = 20% |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=67(LC 8)  
Max Uplift 3=66(LC 8), 2=174(LC 8), 4=36(LC 8)  
Max Grav 3=110(LC 1), 2=276(LC 1), 4=85(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 4-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 66 lb uplift at joint 3, 174 lb uplift at joint 2 and 36 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|         |       |              |     |     |                          |           |
|---------|-------|--------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type   | Qty | Ply | FEAGIN - YATES RES.      | T33792884 |
| 3975847 | EJ01  | Jack-Partial | 4   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:07 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-kGilkoxumU4bhKFWD?xRFSNGBh\_Z1g54NyzDoazlsWY

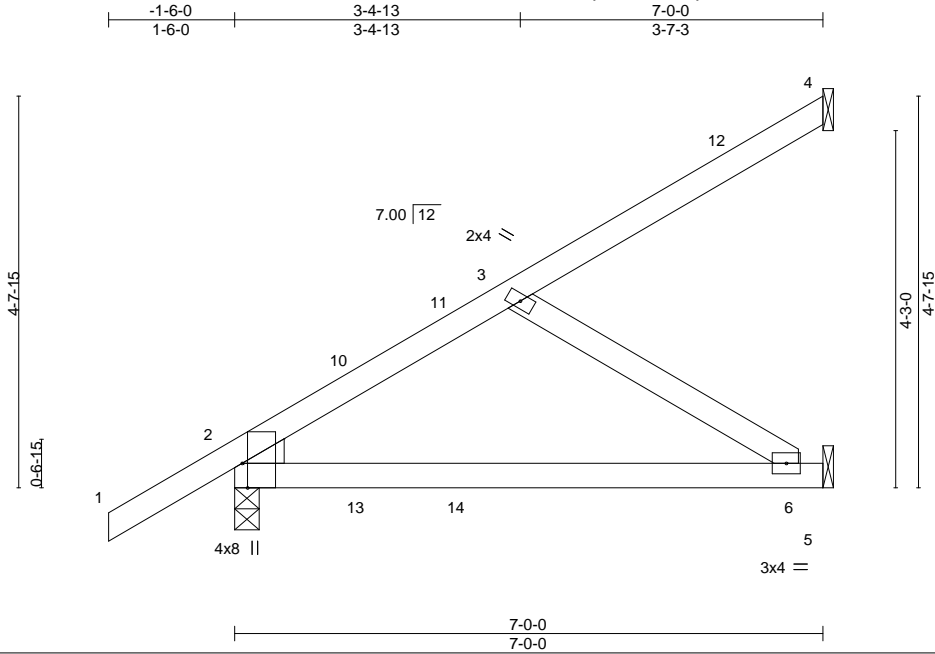

| Plate Offsets (X,Y)-- |       | [2:0-3-8,Edge]       |      |           |      |       |       |        |     |               |          |
|-----------------------|-------|----------------------|------|-----------|------|-------|-------|--------|-----|---------------|----------|
| LOADING (psf)         |       | SPACING-             |      | CSI.      |      | DEFL. |       |        |     | PLATES        |          |
| TCLL                  | 20.0  | Plate Grip DOL       | 1.25 | TC        | 0.34 | in    | (loc) | I/defl | L/d | MT20          | GRIP     |
| TCDL                  | 7.0   | Lumber DOL           | 1.25 | BC        | 0.41 | -0.07 | 6-9   | >999   | 240 |               | 244/190  |
| BCLL                  | 0.0 * | Rep Stress Incr      | YES  | WB        | 0.08 | -0.14 | 6-9   | >616   | 180 |               |          |
| BCDL                  | 10.0  | Code FBC2023/TPI2014 |      | Matrix-MS |      | 0.01  | 2     | n/a    | n/a |               |          |
|                       |       |                      |      |           |      |       |       |        |     | Weight: 32 lb | FT = 20% |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=179(LC 12)  
Max Uplift 4=54(LC 12), 2=77(LC 12), 5=90(LC 9)  
Max Grav 4=87(LC 19), 2=346(LC 1), 5=175(LC 3)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-6=-235/271

**NOTES-**

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 6-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 4, 77 lb uplift at joint 2 and 90 lb uplift at joint 5.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


|         |       |              |     |     |                          |           |
|---------|-------|--------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type   | Qty | Ply | FEAGIN - YATES RES.      | T33792885 |
| 3975847 | EJ02  | Jack-Partial | 6   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:07 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-kGilkoxumU4bhKFWD?xRFSNGgh\_Z1f64NyzDoazIsWY



Scale = 1:15.8

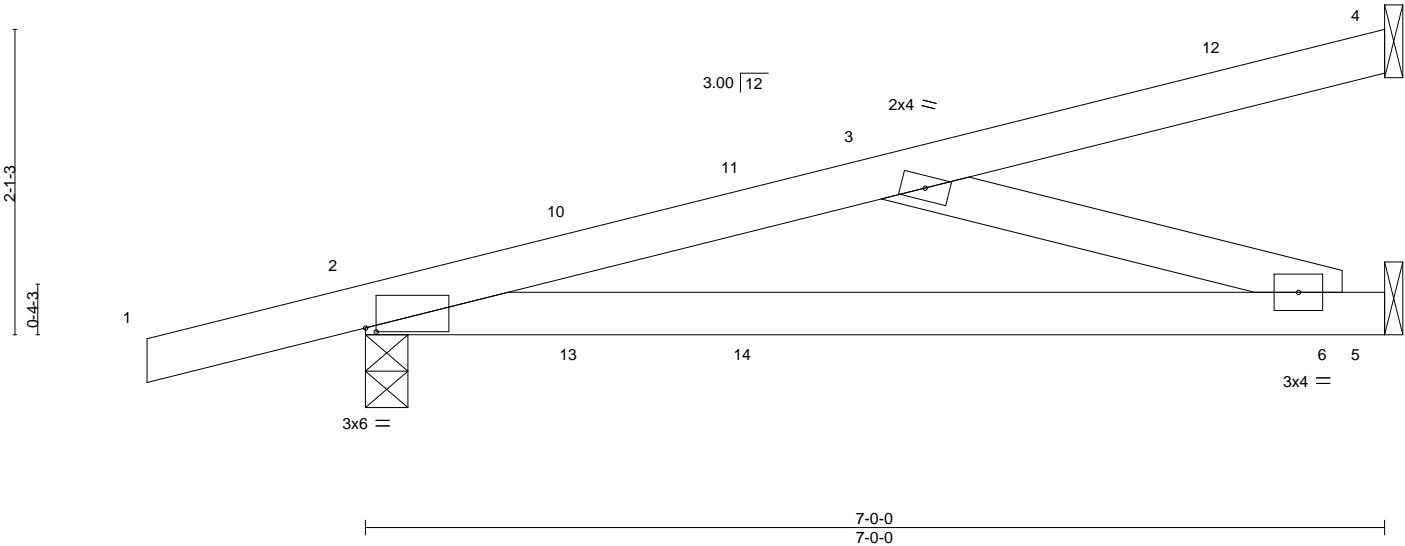

| Plate Offsets (X,Y)-- |                       | [2:0-0-14,0-0-5] |                                  |               |             |
|-----------------------|-----------------------|------------------|----------------------------------|---------------|-------------|
| <b>LOADING</b> (psf)  | <b>SPACING-</b> 2-0-0 | <b>CSI.</b>      | <b>DEFL.</b> in (loc) l/defl L/d | <b>PLATES</b> | <b>GRIP</b> |
| TCLL 20.0             | Plate Grip DOL 1.25   | TC 0.37          | Vert(LL) 0.07 6-9 >999 240       | MT20          | 244/190     |
| TCDL 7.0              | Lumber DOL 1.25       | BC 0.41          | Vert(CT) -0.12 6-9 >692 180      |               |             |
| BCLL 0.0 *            | Rep Stress Incr YES   | WB 0.15          | Horz(CT) 0.00 5 n/a n/a          |               |             |
| BCDL 10.0             | Code FBC2023/TPI2014  | Matrix-MS        |                                  | Weight: 28 lb | FT = 20%    |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 8-2-0 oc bracing.

**REACTIONS.**

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical  
Max Horz 2=86(LC 8)  
Max Uplift 4=43(LC 8), 2=-211(LC 8), 5=-106(LC 8)  
Max Grav 4=71(LC 1), 2=346(LC 1), 5=177(LC 3)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-454/398  
BOT CHORD 2-6=-472/440  
WEBS 3-6=-459/493

**NOTES-**

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 6-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 4, 211 lb uplift at joint 2 and 106 lb uplift at joint 5.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


|         |       |                           |     |     |                          |           |
|---------|-------|---------------------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type                | Qty | Ply | FEAGIN - YATES RES.      | T33792886 |
| 3975847 | EJ02G | Jack-Open Supported Gable | 2   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:07 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-kGilkoxumU4bhKFWD?xRFSNHkh1Y1fC4NyzDoazIsWY



Scale = 1:15.8

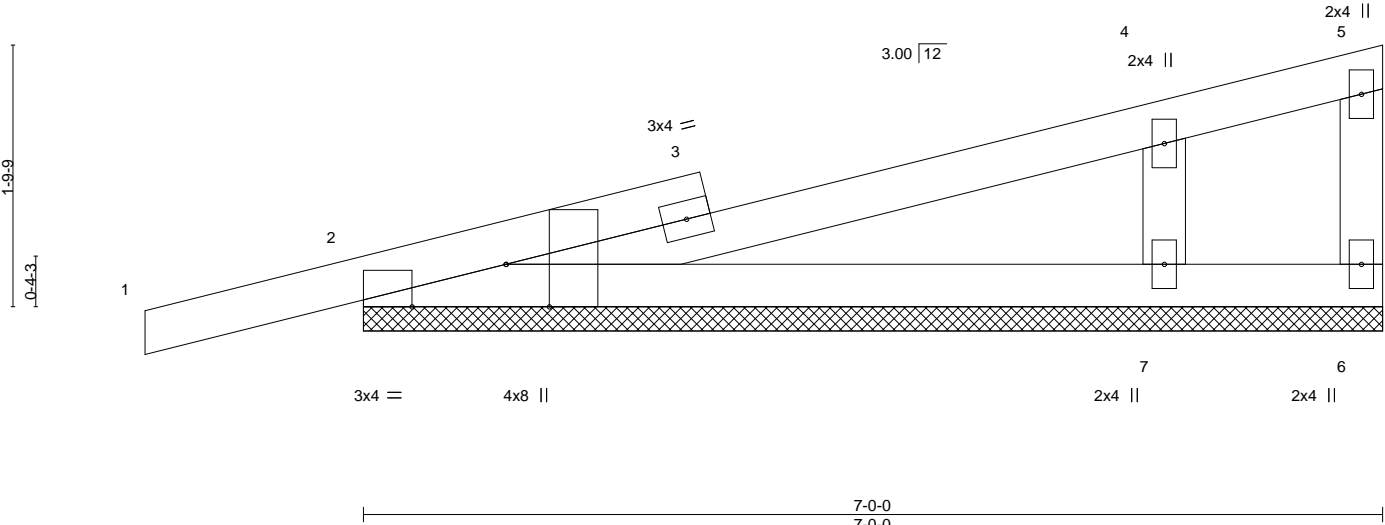

| Plate Offsets (X,Y)-- [2:0-3-8,Edge], [2:0-7-12,Edge] |       |                      |      |          |      |                           |       |   |     |             |               |          |
|---|-------|----------------------|------|----------|------|---------------------------|-------|---|-----|-------------|---------------|----------|
| LOADING (psf)   |       | SPACING- 2-0-0       |      | CSI.     |      | DEFL. in (loc) l/defl L/d |       |   |     | PLATES GRIP |               |          |
| TCLL  | 20.0  | Plate Grip DOL       | 1.25 | TC       | 0.30 | Vert(LL)                  | -0.00 | 1 | n/r | 120         | MT20          | 244/190  |
| TCDL  | 7.0   | Lumber DOL           | 1.25 | BC       | 0.22 | Vert(CT)                  | 0.01  | 1 | n/r | 120         |               |          |
| BCLL  | 0.0 * | Rep Stress Incr      | YES  | WB       | 0.14 | Horz(CT)                  | -0.00 | 6 | n/a | n/a         |               |          |
| BCDL  | 10.0  | Code FBC2023/TPI2014 |      | Matrix-S |      |                           |       |   |     |             | Weight: 29 lb | FT = 20% |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 7-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.                                   |
| WEBS 2x4 SP No.3      |   |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** (size) 2=7-0-0, 6=7-0-0, 7=7-0-0  
Max Horz 2=73(LC 8)  
Max Uplift 2=-122(LC 8), 6=-112(LC 1), 7=-147(LC 12)  
Max Grav 2=256(LC 1), 6=33(LC 12), 7=444(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 4-7=-305/471

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) Gable studs spaced at 2-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 122 lb uplift at joint 2, 112 lb uplift at joint 6 and 147 lb uplift at joint 7.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |                     |     |     |                          |           |
|---------|-------|---------------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type          | Qty | Ply | FEAGIN - YATES RES.      | T33792887 |
| 3975847 | HJ10  | Diagonal Hip Girder | 2   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:08 2024 Page 1

ID:wrB0X7HrGjFAXvw916TJ7zE\_0m-CTF7x8yWXoCSJUpinJsgogwNo4Gnm3JDccjnK0zIsWX

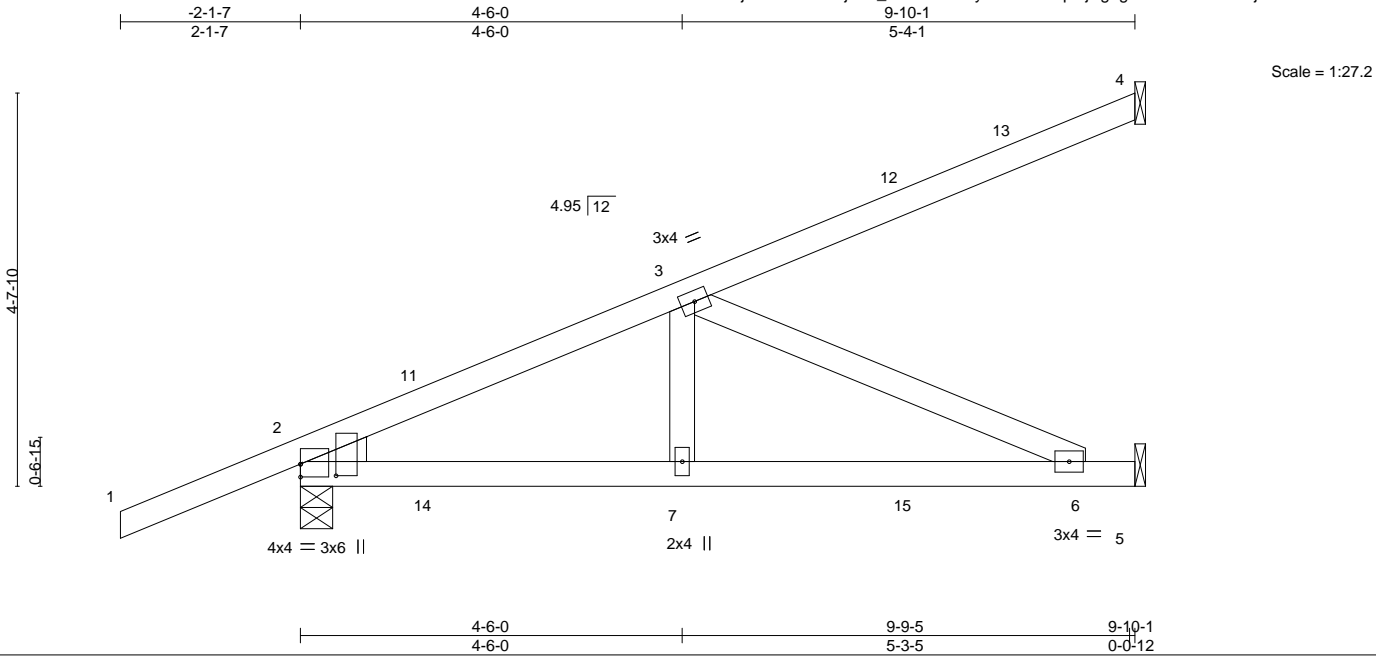

|                       |  |                                    |  |           |  |                           |          |               |          |
|-----------------------|--|------------------------------------|--|-----------|--|---------------------------|----------|---------------|----------|
| Plate Offsets (X,Y)-- |  | [2:0-0-0,0-1-13], [2:0-1-10,0-5-0] |  |           |  |                           |          |               |          |
| LOADING (psf)         |  | SPACING- 2-0-0                     |  | CSI.      |  | DEFL. in (loc) l/defl L/d |          | PLATES GRIP   |          |
| TCLL 20.0             |  | Plate Grip DOL 1.25                |  | TC 0.60   |  | Vert(LL) 0.12 6-7         | >993 240 | MT20          | 244/190  |
| TCDL 7.0              |  | Lumber DOL 1.25                    |  | BC 0.66   |  | Vert(CT) -0.14 6-7        | >814 180 |               |          |
| BCLL 0.0 *            |  | Rep Stress Incr NO                 |  | WB 0.34   |  | Horz(CT) -0.01 4          | n/a n/a  |               |          |
| BCDL 10.0             |  | Code FBC2023/TPI2014               |  | Matrix-MS |  |                           |          | Weight: 45 lb | FT = 20% |

LUMBER- TOP CHORD 2x4 SP No.2 BOT CHORD 2x4 SP No.2 WEBS 2x4 SP No.3 WEDGE Left: 2x4 SP No.3

BRACING- TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. BOT CHORD Rigid ceiling directly applied or 8-2-11 oc bracing.

REACTIONS. (size) 4=Mechanical, 2=0-4-9, 5=Mechanical  
Max Horz 2=178(LC 8)  
Max Uplift 4=-102(LC 8), 2=-314(LC 4), 5=-213(LC 5)  
Max Grav 4=151(LC 1), 2=528(LC 1), 5=298(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-709/381  
BOT CHORD 2-7=-439/567, 6-7=-439/567  
WEBS 3-7=-122/287, 3-6=-622/481

- NOTES-
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 102 lb uplift at joint 4, 314 lb uplift at joint 2 and 213 lb uplift at joint 5.
  - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 65 lb down and 75 lb up at 1-6-1, 65 lb down and 75 lb up at 1-6-1, 82 lb down and 52 lb up at 4-4-0, 82 lb down and 52 lb up at 4-4-0, and 110 lb down and 96 lb up at 7-1-15, and 110 lb down and 96 lb up at 7-1-15 on top chord, and 41 lb down and 49 lb up at 1-6-1, 41 lb down and 49 lb up at 1-6-1, 20 lb down and 29 lb up at 4-4-0, 20 lb down and 29 lb up at 4-4-0, and 41 lb down and 51 lb up at 7-1-15, and 41 lb down and 51 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-54, 5-8=-20

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |                     |     |     |                          |           |
|---------|-------|---------------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type          | Qty | Ply | FEAGIN - YATES RES.      | T33792887 |
| 3975847 | HJ10  | Diagonal Hip Girder | 2   | 1   | Job Reference (optional) |           |

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 7=-8(F=-4, B=-4) 12=-71(F=-35, B=-35) 15=-61(F=-30, B=-30)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))


**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

|         |       |                     |     |     |                          |           |
|---------|-------|---------------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type          | Qty | Ply | FEAGIN - YATES RES.      | T33792888 |
| 3975847 | HJ10A | Diagonal Hip Girder | 2   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:09 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJ7zE\_0m-gfpV9Uz8H6KJwdOuLQzvKtTY2UaQVRRMrGSKtTzIsWW



Scale = 1:21.9

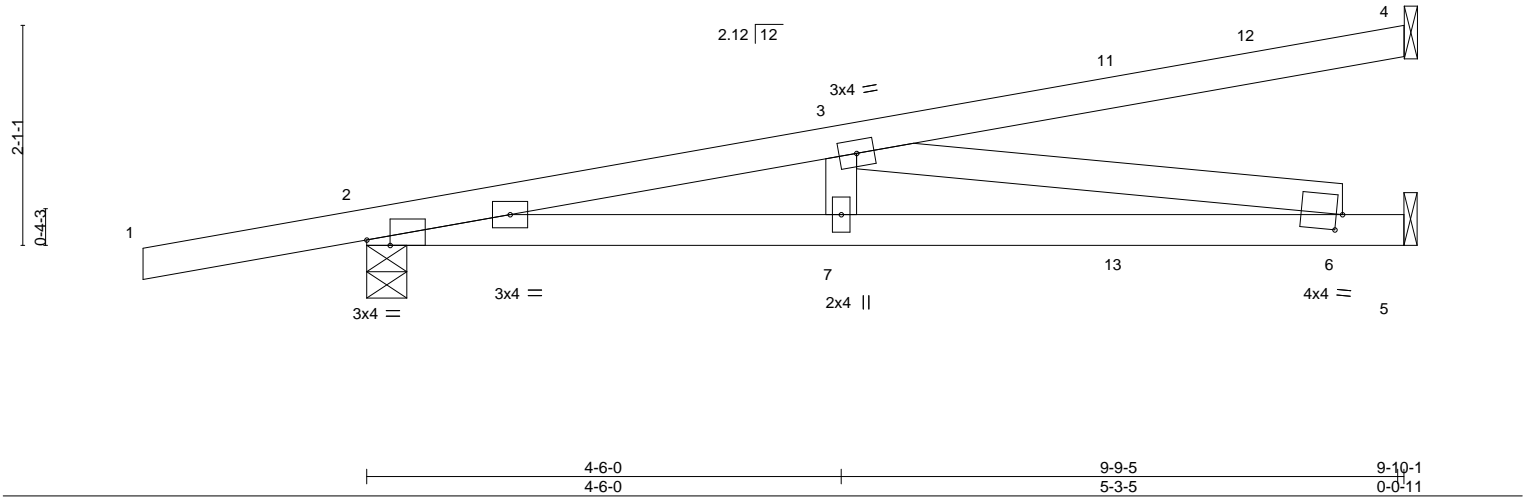

|                       |                                    |           |                |          |        |     |               |          |  |
|-----------------------|------------------------------------|-----------|----------------|----------|--------|-----|---------------|----------|--|
| Plate Offsets (X,Y)-- | [2:0-2-11,Edge], [6:0-0-11,0-1-13] |           |                |          |        |     |               |          |  |
| LOADING (psf)         | SPACING- 2-0-0                     | CSI.      | DEFL.          | in (loc) | l/defl | L/d | PLATES        | GRIP     |  |
| TCLL 20.0             | Plate Grip DOL 1.25                | TC 0.63   | Vert(LL) 0.16  | 6-7 >756 | 240    |     | MT20          | 244/190  |  |
| TCDL 7.0              | Lumber DOL 1.25                    | BC 0.83   | Vert(CT) -0.19 | 6-7 >615 | 180    |     |               |          |  |
| BCLL 0.0 *            | Rep Stress Incr NO                 | WB 0.67   | Horz(CT) 0.02  | 5 n/a    | n/a    |     |               |          |  |
| BCDL 10.0             | Code FBC2023/TPI2014               | Matrix-MS |                |          |        |     |               |          |  |
|                       |                                    |           |                |          |        |     | Weight: 41 lb | FT = 20% |  |

|                       |           |  |
|-----------------------|-----------|--|
| LUMBER-               | BRACING-  |  |
| TOP CHORD 2x4 SP No.2 | TOP CHORD | Structural wood sheathing directly applied or 4-10-3 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD | Rigid ceiling directly applied or 6-2-0 oc bracing.              |
| WEBS 2x4 SP No.3      |           |  |

|            |   |
|------------|---|
| REACTIONS. | (size) 4=Mechanical, 2=0-4-9, 5=Mechanical      |
|            | Max Horz 2=83(LC 4)                             |
|            | Max Uplift 4=84(LC 8), 2=334(LC 4), 5=176(LC 4) |
|            | Max Grav 4=158(LC 1), 2=531(LC 1), 5=294(LC 1)  |

|           |  |
|-----------|--|
| FORCES.   | (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. |
| TOP CHORD | 2-3=-1388/766  |
| BOT CHORD | 2-7=-799/1357, 6-7=-799/1357   |
| WEBS      | 3-7=-105/276, 3-6=-1378/812  |

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 4, 334 lb uplift at joint 2 and 176 lb uplift at joint 5.
  - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 22 lb down and 41 lb up at 4-4-0, 22 lb down and 41 lb up at 4-4-0, and 43 lb down and 78 lb up at 7-1-15, and 43 lb down and 78 lb up at 7-1-15 on top chord, and 49 lb down and 22 lb up at 1-6-1, 49 lb down and 22 lb up at 1-6-1, 18 lb down and 26 lb up at 4-4-0, 18 lb down and 26 lb up at 4-4-0, and 40 lb down and 53 lb up at 7-1-15, and 40 lb down and 53 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

|  |  |
|--|--|
| LOAD CASE(S) Standard  |  |
| 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25        |  |
| Uniform Loads (plf)  |  |
| Vert: 1-4=-54, 5-8=-20   |  |
| Concentrated Loads (lb)  |  |
| Vert: 3=0(F=-0, B=0) 7=-13(F=-7, B=-7) 11=-68(F=-34, B=-34) 13=-63(F=-32, B=-32) |  |

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792889 |
| 3975847 | PB01  | Piggyback  | 26  | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:09 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-gfpV9Uz8H6KJwdOuLQzvKtTf?UkoVbFMrGSKtZlsWW

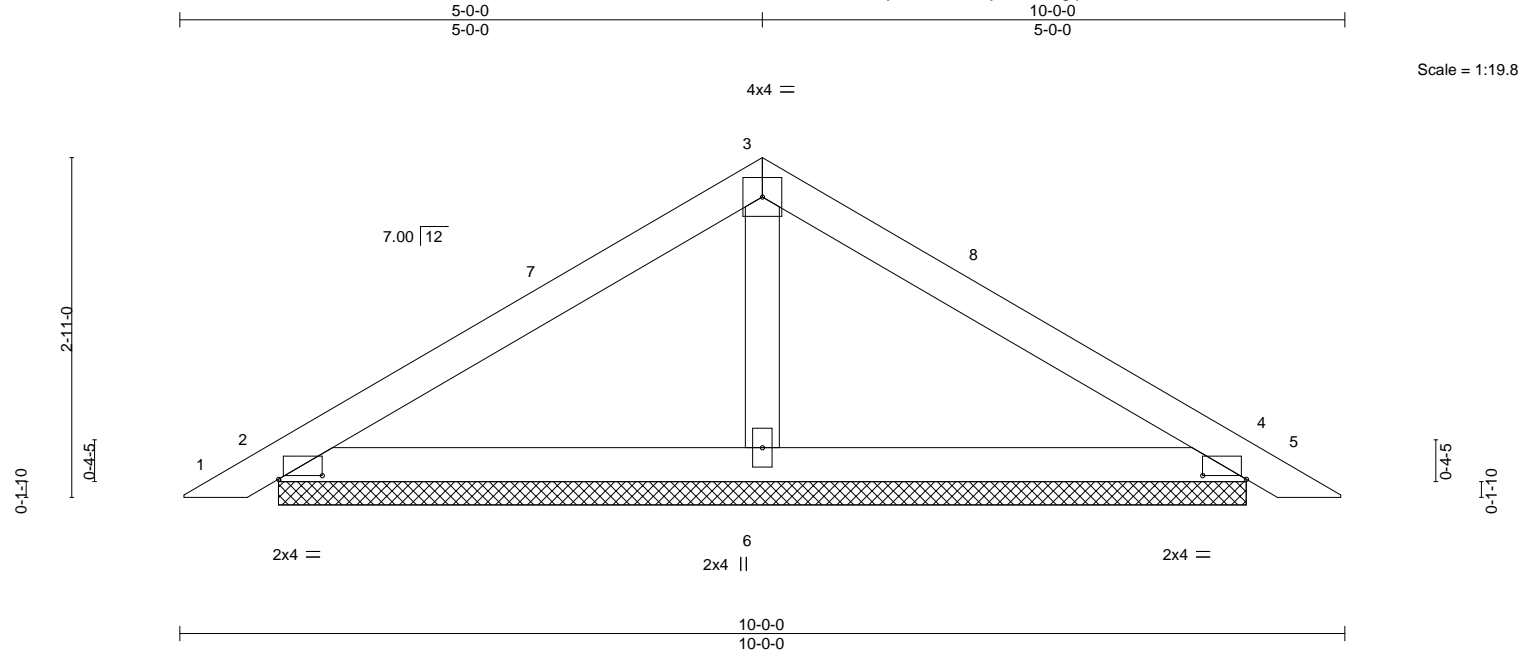

|  |       |                 |                 |          |      |                           |            |             |                        |
|--|-------|-----------------|-----------------|----------|------|---------------------------|------------|-------------|------------------------|
| Plate Offsets (X,Y)-- [2:0-4-8,0-0-6], [4:0-4-8,0-0-6] |       |                 |                 |          |      |                           |            |             |                        |
| LOADING (psf)  |       | SPACING- 2-0-0  |                 | CSI.     |      | DEFL. in (loc) l/defl L/d |            | PLATES GRIP |                        |
| TCLL   | 20.0  | Plate Grip DOL  | 1.25            | TC       | 0.19 | Vert(LL)                  | 0.01 5 n/r | 120         | MT20 244/190           |
| TCDL   | 7.0   | Lumber DOL      | 1.25            | BC       | 0.17 | Vert(CT)                  | 0.01 5 n/r | 120         |                        |
| BCLL   | 0.0 * | Rep Stress Incr | YES             | WB       | 0.04 | Horz(CT)                  | 0.00 4 n/a | n/a         |                        |
| BCDL   | 10.0  | Code            | FBC2023/TPI2014 | Matrix-S |      |                           |            |             | Weight: 33 lb FT = 20% |

|                       |  |
|-----------------------|--|
| LUMBER-               | BRACING-   |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |  |

|            |   |
|------------|---|
| REACTIONS. | (size) 2=8-3-11, 4=8-3-11, 6=8-3-11                 |
|            | Max Horz 2=-68(LC 10)                               |
|            | Max Uplift 2=-62(LC 12), 4=-71(LC 13), 6=-57(LC 12) |
|            | Max Grav 2=176(LC 1), 4=176(LC 1), 6=322(LC 1)      |

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-3-11 to 3-3-11, Zone1 3-3-11 to 5-0-0, Zone2 5-0-0 to 9-1-13, Zone1 9-1-13 to 9-8-5 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 2, 71 lb uplift at joint 4 and 57 lb uplift at joint 6.
  - 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792890 |
| 3975847 | PB01G | GABLE      | 2   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:10 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-9rNtMq\_m2PSAYnz4v8U8t5?suu6BE2PW4wCtPvzlsWV

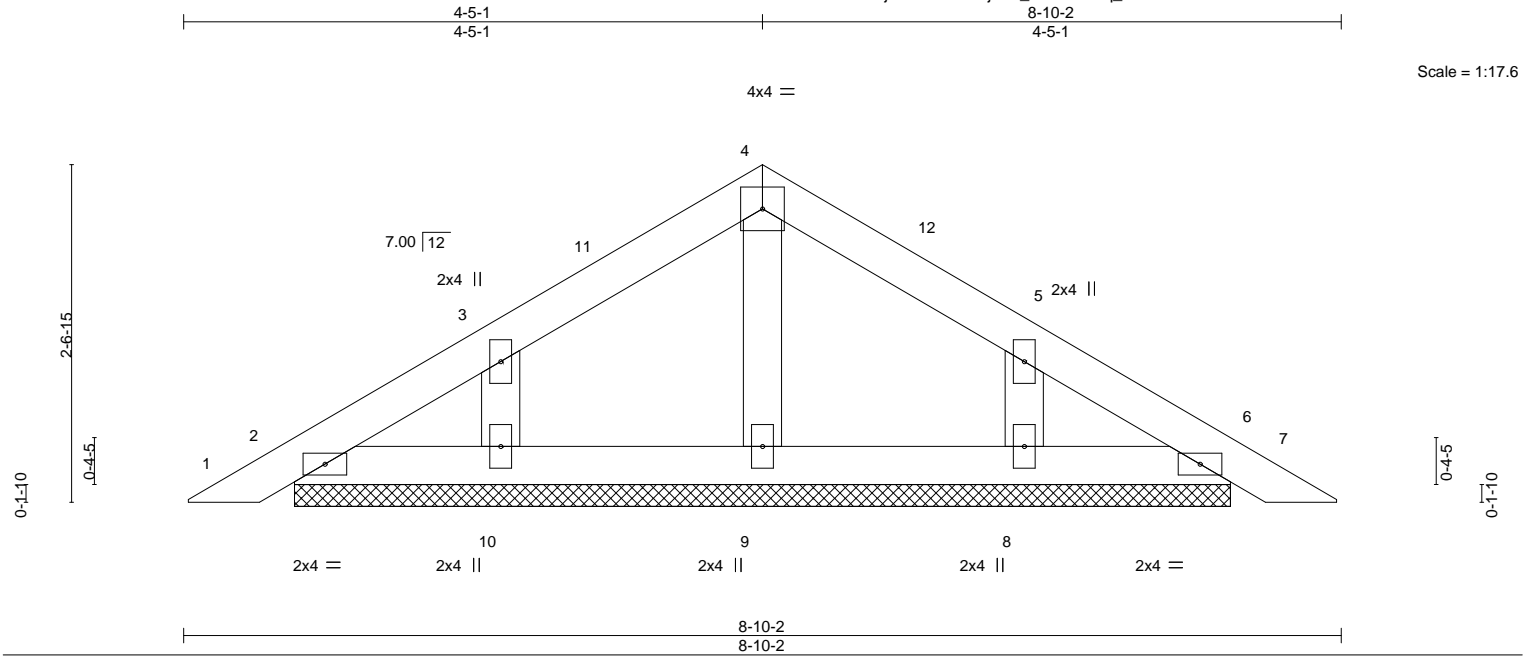

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.05  | Vert(LL) | -0.00    | 6      | n/r | MT20          | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.03  | Vert(CT) | 0.00     | 6      | n/r |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.05  | Horz(CT) | 0.00     | 6      | n/a |               |          |
| BCDL 10.0     | Code FBC2023/TP12014 |       | Matrix-S |          |          |        |     | Weight: 31 lb | FT = 20% |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

All bearings 7-1-13.  
(lb) - Max Horz 2=59(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 6, 10, 8  
Max Grav All reactions 250 lb or less at joint(s) 2, 6, 9, 10, 8

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-3-11 to 3-3-11, Zone1 3-3-11 to 4-5-1, Zone3 4-5-1 to 8-6-7 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 10, 8.
- 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


|         |       |                |     |     |                          |           |
|---------|-------|----------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type     | Qty | Ply | FEAGIN - YATES RES.      | T33792891 |
| 3975847 | T01   | Piggyback Base | 3   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:10 2024 Page 1

ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-9rNtMq\_m2PSAYnz4v8U8t5?mqutPEqaW4wCtPvzlsWV

|       |        |        |        |        |        |        |        |        |
|-------|--------|--------|--------|--------|--------|--------|--------|--------|
| 1-6-0 | 5-11-0 | 12-4-0 | 18-1-7 | 23-1-7 | 28-1-7 | 33-0-0 | 37-8-0 | 39-2-0 |
| 1-6-0 | 5-11-0 | 6-5-0  | 5-9-7  | 5-0-0  | 5-0-0  | 4-10-9 | 4-8-0  | 1-6-0  |

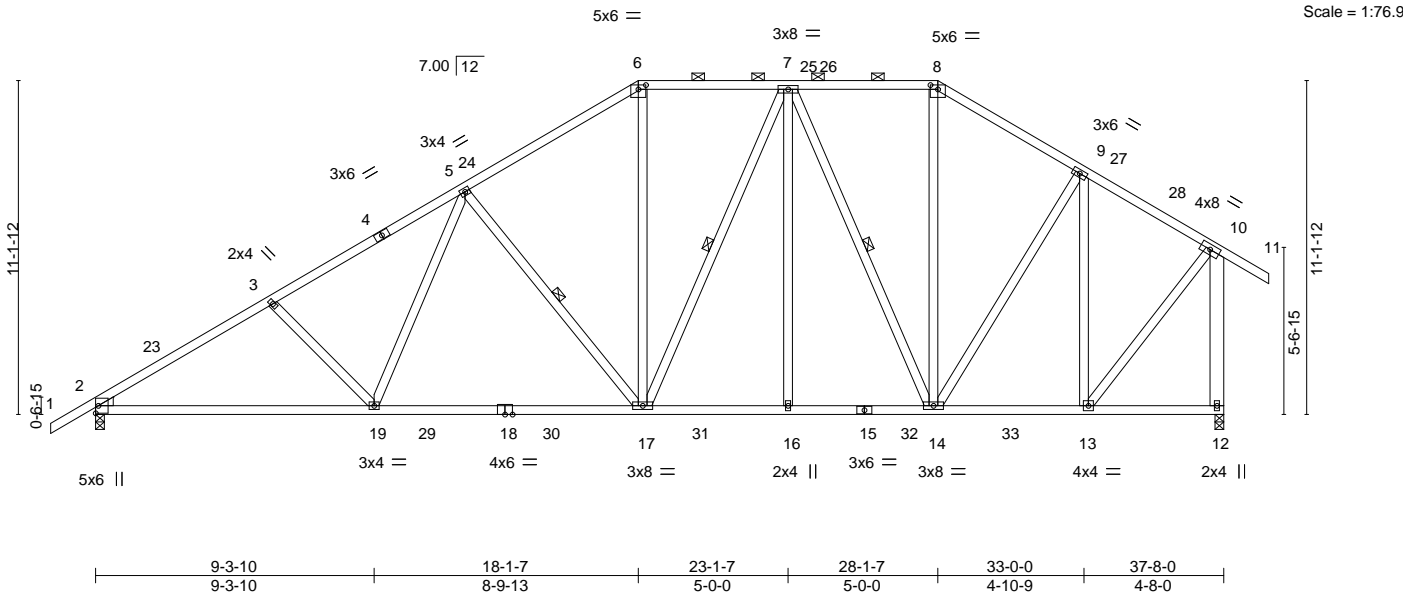

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.      | DEFL.    | in (loc)    | l/defl | L/d | PLATES         | GRIP     |
|---------------|----------------------|-------|-----------|----------|-------------|--------|-----|----------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.44   | Vert(LL) | -0.30 17-19 | >999   | 240 | MT20           | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.97   | Vert(CT) | -0.49 17-19 | >909   | 180 |                |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.93   | Horz(CT) | 0.08 12     | n/a    | n/a |                |          |
| BCDL 10.0     | Code FBC2023/TPI2014 |       | Matrix-MS |          |             |        |     | Weight: 286 lb | FT = 20% |

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
10-12: 2x6 SP No.2

#### WEDGE

Left: 2x4 SP No.3

#### REACTIONS.

(size) 2=0-3-8, 12=0-3-8  
Max Horz 2=358(LC 11)  
Max Uplift 2=420(LC 12), 12=367(LC 13)  
Max Grav 2=1660(LC 19), 12=1666(LC 2)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-2507/631, 3-5=-2343/607, 5-6=-1690/501, 6-7=-1402/480, 7-8=-1053/338,  
8-9=-1273/367, 9-10=-973/271, 10-12=-1599/376  
BOT CHORD 2-19=-635/2297, 17-19=-442/1876, 16-17=-295/1321, 14-16=-295/1321, 13-14=-182/797  
WEBS 3-19=-282/221, 5-19=-107/600, 5-17=-722/324, 6-17=-115/609, 7-17=-123/333,  
7-14=-698/223, 8-14=-123/429, 9-14=-168/496, 9-13=-759/201, 10-13=-216/1242

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 2-3-3, Zone1 2-3-3 to 18-1-7, Zone2 18-1-7 to 23-5-6, Zone1 23-5-6 to 28-1-7, Zone2 28-1-7 to 33-5-6, Zone1 33-5-6 to 39-2-0 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=420, 12=367.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




|         |       |                |     |     |                          |           |
|---------|-------|----------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type     | Qty | Ply | FEAGIN - YATES RES.      | T33792893 |
| 3975847 | T02   | Piggyback Base | 11  | 1   | Job Reference (optional) |           |



Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:12 2024 Page 1

ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-5EVENW?1a1iun57T0ZXcyW56WiYsik3pXEh\_TnZlsWT



Scale = 1:75.9

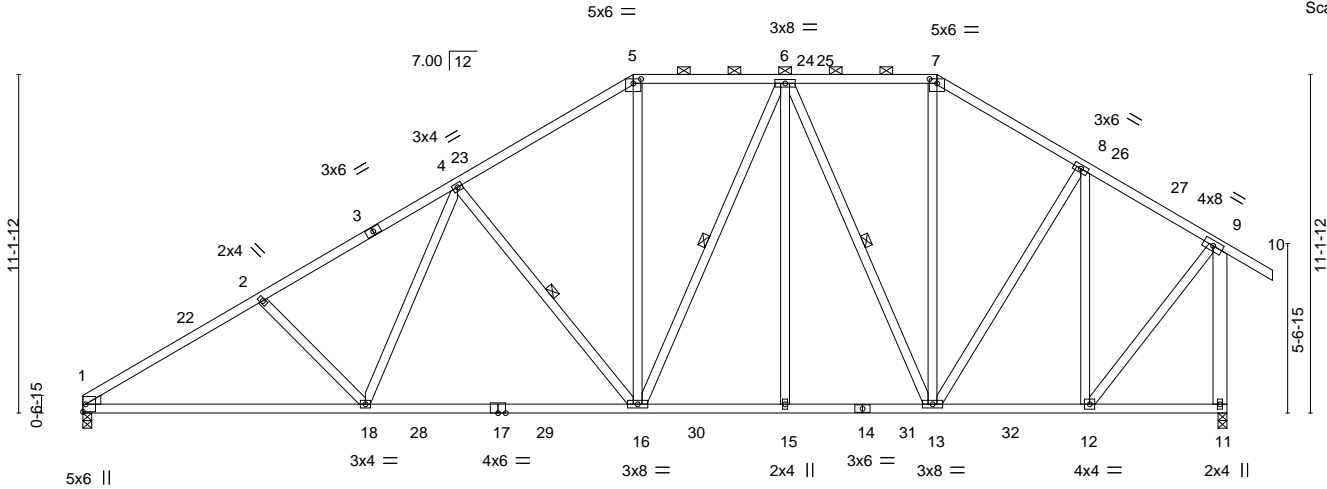

|                       |       |                                    |  |           |      |                           |       |       |      |                         |      |         |
|-----------------------|-------|------------------------------------|--|-----------|------|---------------------------|-------|-------|------|-------------------------|------|---------|
| Plate Offsets (X,Y)-- |       | [5:0-3-0,0-1-12], [7:0-3-0,0-1-12] |  |           |      |                           |       |       |      |                         |      |         |
| LOADING (psf)         |       | SPACING- 2-0-0                     |  | CSI.      |      | DEFL. in (loc) l/defl L/d |       |       |      | PLATES GRIP             |      |         |
| TCLL                  | 20.0  | Plate Grip DOL 1.25                |  | TC        | 0.43 | Vert(LL)                  | -0.30 | 16-18 | >999 | 240                     | MT20 | 244/190 |
| TCDL                  | 7.0   | Lumber DOL 1.25                    |  | BC        | 0.98 | Vert(CT)                  | -0.49 | 16-18 | >921 | 180                     |      |         |
| BCLL                  | 0.0 * | Rep Stress Incr YES                |  | WB        | 0.93 | Horz(CT)                  | 0.08  | 11    | n/a  | n/a                     |      |         |
| BCDL                  | 10.0  | Code FBC2023/TPI2014               |  | Matrix-MS |      |                           |       |       |      | Weight: 283 lb FT = 20% |      |         |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
9-11: 2x6 SP No.2

**WEDGE**

Left: 2x4 SP No.3

**REACTIONS.**

(size) 1=0-3-8, 11=0-3-8  
Max Horz 1=344(LC 11)  
Max Uplift 1=382(LC 12), 11=367(LC 13)  
Max Grav 1=1583(LC 19), 11=1667(LC 2)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-2521/639, 2-4=-2353/614, 4-5=-1692/502, 5-6=-1404/481, 6-7=-1055/339,  
7-8=-1274/368, 8-9=-973/273, 9-11=-1600/376  
BOT CHORD 1-18=-643/2311, 16-18=-445/1882, 15-16=-296/1323, 13-15=-296/1323, 12-13=-182/798  
WEBS 2-18=-290/225, 4-18=-113/610, 4-16=-727/326, 5-16=-116/610, 6-16=-123/334,  
6-13=-699/224, 7-13=-124/430, 8-13=-168/497, 8-12=-760/201, 9-12=-217/1244

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-9-3, Zone1 3-9-3 to 18-1-7, Zone2 18-1-7 to 23-5-6, Zone1 23-5-6 to 28-1-7, Zone2 28-1-7 to 33-5-6, Zone1 33-5-6 to 39-2-0 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=382, 11=367.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Nov 16 2023 MiTek Industries, Inc. Wed May 8 10:43:03 2024 Page 1  
 18-8-6 27-6-8 37-8-0 39-2-0  
 18-8-6 8-10-2 10-1-8 1-6-0

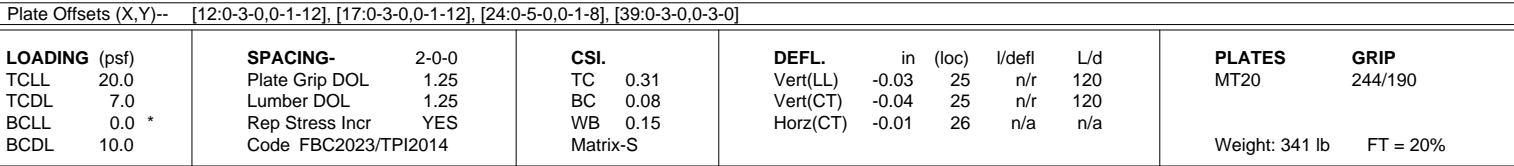

**REACTIONS.** All bearings 37-8-0.

(lb) - Max Horz 1=345(LC 11)

Max Uplift All uplift 100 lb or less at joint(s) 26, 1, 45, 44, 43, 42, 41, 40, 39, 38, 37, 36, 35, 34, 32, 30, 29, 28 except 27=200(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 26, 1, 45, 44, 43, 42, 41, 40, 39, 38, 37, 36, 35, 34, 32, 31, 30, 29, 28, 27

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 1-2=-292/255, 2-3=-262/233, 10-11=-173/285, 11-12=-161/260, 12-13=-158/268,  
13-14=-158/268, 14-15=-158/268, 15-16=-158/268, 16-17=-158/268, 17-18=-157/252,  
18-19=-175/288

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) Provide adequate drainage to prevent water ponding.
- 6) All plates are 2x4 MT20 unless otherwise indicated.
- 7) Gable requires continuous bottom chord bearing.
- 8) Gable studs spaced at 2-0-0 oc.
- 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 10) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 26, 1, 45, 44, 43, 42, 41, 40, 39, 38, 37, 36, 35, 34, 32, 30, 29, 28 except (jt=lb) 27=200.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8, 2024



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSS-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com)).

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




|                          |       |                |     |     |                     |           |
|--------------------------|-------|----------------|-----|-----|---------------------|-----------|
| Job                      | Truss | Truss Type     | Qty | Ply | FEAGIN - YATES RES. | T33792895 |
| 3975847                  | T03   | Piggyback Base | 1   | 1   |                     |           |
| Job Reference (optional) |       |                |     |     |                     |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:14 2024 Page 1  
ID:wrB0X7HrGjFAXvw916Tj7zE\_0m-1ddOCB1H6eyc1PHs8\_Z41xAPJVFCAe26\_YA5YgzIsWR



Scale = 1:73.4

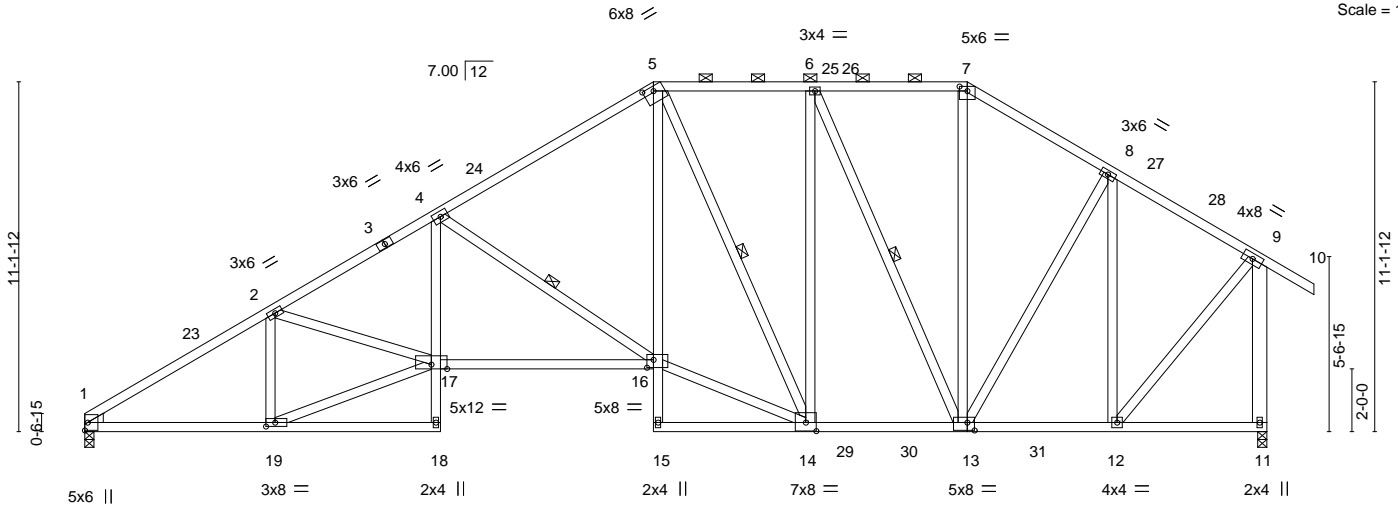

|   |  |                      |  |           |  |                               |  |                |          |
|---|--|----------------------|--|-----------|--|-------------------------------|--|----------------|----------|
| <div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div>         |  |                      |  |           |  |                               |  |                |          |
| Plate Offsets (X,Y)-- [5:0-4-0,0-1-11], [7:0-3-0,0-1-12], [13:0-2-12,0-3-0], [14:0-4-0,0-3-4], [16:0-2-8,0-3-0], [19:0-3-8,0-1-8] |  |                      |  |           |  |                               |  |                |          |
| LOADING (psf)   |  | SPACING- 2-0-0       |  | CSI.      |  | DEFL. in (loc) l/defl L/d     |  | PLATES GRIP    |          |
| TCLL 20.0   |  | Plate Grip DOL 1.25  |  | TC 0.60   |  | Vert(LL) -0.25 16-17 >999 240 |  | MT20           | 244/190  |
| TCDL 7.0  |  | Lumber DOL 1.25      |  | BC 0.92   |  | Vert(CT) -0.48 16-17 >939 180 |  |                |          |
| BCLL 0.0 *  |  | Rep Stress Incr YES  |  | WB 0.90   |  | Horz(CT) 0.18 11 n/a n/a      |  |                |          |
| BCDL 10.0   |  | Code FBC2023/TPI2014 |  | Matrix-MS |  |                               |  | Weight: 301 lb | FT = 20% |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2 \*Except\*  
4-18,5-15: 2x4 SP No.3  
WEBS 2x4 SP No.3 \*Except\*  
9-11: 2x6 SP No.2

**WEDGE**

Left: 2x4 SP No.3

**REACTIONS.**

(size) 1=0-3-8, 11=0-3-8  
Max Horz 1=344(LC 11)  
Max Uplift 1=345(LC 12), 11=310(LC 13)  
Max Grav 1=1523(LC 19), 11=1617(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=2435/551, 2-4=3027/720, 4-5=1947/467, 5-6=1268/377, 6-7=1001/338,  
7-8=1216/356, 8-9=970/278, 9-11=1543/355  
BOT CHORD 1-19=564/2227, 4-17=183/977, 16-17=607/2757, 5-16=309/1610, 13-14=295/1262,  
12-13=185/792  
WEBS 2-19=708/248, 17-19=589/2360, 2-17=129/535, 4-16=1332/461, 14-16=416/1808,  
6-14=89/452, 6-13=665/219, 7-13=97/406, 8-13=168/453, 8-12=707/182,  
9-12=197/1191, 5-14=1032/243

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-9-3, Zone1 3-9-3 to 18-1-7, Zone2 18-1-7 to 23-5-6, Zone1 23-5-6 to 28-1-7, Zone2 28-1-7 to 33-5-6, Zone1 33-5-6 to 39-2-0 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=345, 11=310.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|                          |       |                |     |     |                     |           |
|--------------------------|-------|----------------|-----|-----|---------------------|-----------|
| Job                      | Truss | Truss Type     | Qty | Ply | FEAGIN - YATES RES. | T33792896 |
| 3975847                  | T04   | Piggyback Base | 11  | 1   |                     |           |
| Job Reference (optional) |       |                |     |     |                     |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:15 2024 Page 1

ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-VpBmPX2vty4TeYs2hh4Ja8jXAvgJv7EFDCve46zlsWQ

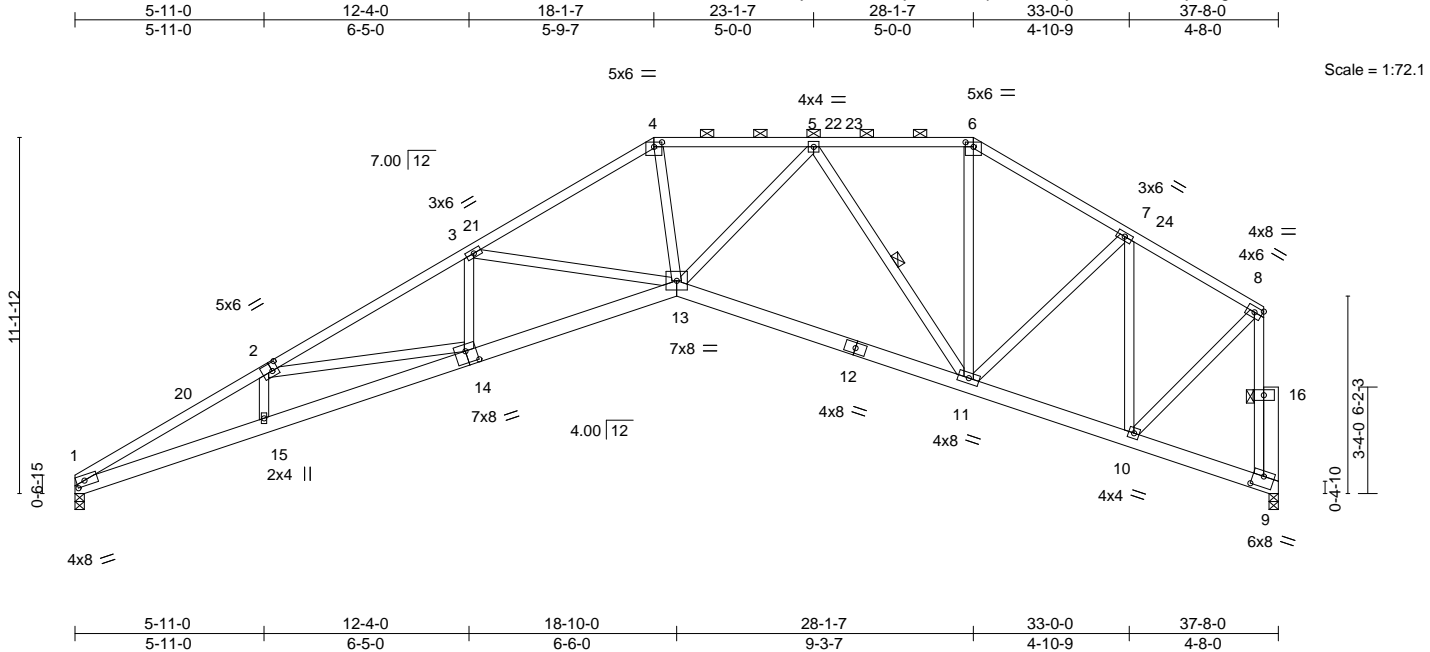

|   |       |                      |      |           |      |          |       |                     |      |             |                         |
|---|-------|----------------------|------|-----------|------|----------|-------|---------------------|------|-------------|-------------------------|
| Plate Offsets (X,Y)-- [1:0-3-0,0-2-0], [2:0-2-4,0-3-0], [4:0-3-0,0-1-12], [6:0-3-0,0-1-12], [9:0-4-0,0-4-0], [14:0-4-0,0-4-8] |       |                      |      |           |      |          |       |                     |      |             |                         |
| LOADING (psf)   |       | SPACING- 2-0-0       |      | CSI.      |      | DEFL.    |       | in (loc) l/defl L/d |      | PLATES GRIP |                         |
| TCLL  | 20.0  | Plate Grip DOL       | 1.25 | TC        | 0.78 | Vert(LL) | -0.32 | 14                  | >999 | 240         | MT20 244/190            |
| TCDL  | 7.0   | Lumber DOL           | 1.25 | BC        | 0.61 | Vert(CT) | -0.60 | 14-15               | >750 | 180         |                         |
| BCLL  | 0.0 * | Rep Stress Incr      | YES  | WB        | 0.78 | Horz(CT) | 0.46  | 9                   | n/a  | n/a         |                         |
| BCDL  | 10.0  | Code FBC2023/TPI2014 |      | Matrix-MS |      |          |       |                     |      |             | Weight: 261 lb FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2 \*Except\*  
1-14: 2x6 SP M 26  
WEBS 2x4 SP No.3  
OTHERS 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (3-3-5 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied or 7-2-7 oc bracing.  
WEBS 1 Row at midpt 5-11, 8-9

REACTIONS.

(size) 9=0-3-8, 1=0-3-8  
Max Horz 1=334(LC 11)  
Max Uplift 9=318(LC 13), 1=379(LC 12)  
Max Grav 9=1367(LC 1), 1=1380(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-4423/1362, 2-3=-4102/1199, 3-4=-3121/840, 4-5=-2813/814, 5-6=-1288/397, 6-7=-1553/411, 7-8=-1011/267, 8-9=-1350/345  
BOT CHORD 1-15=-1343/3910, 14-15=-1374/4006, 13-14=-1071/3680, 11-13=-589/2144, 10-11=-278/900  
WEBS 2-14=-384/281, 3-14=-61/377, 3-13=-939/463, 4-13=-299/1291, 5-13=-318/1166, 5-11=-1356/473, 6-11=-144/504, 7-11=-204/618, 7-10=-952/276, 8-10=-258/1089

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-9-3, Zone1 3-9-3 to 18-1-7, Zone2 18-1-7 to 23-5-6, Zone1 23-5-6 to 28-1-7, Zone2 28-1-7 to 33-5-6, Zone1 33-5-6 to 37-0-12 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Bearing at joint(s) 9, 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=318, 1=379.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|         |       |                 |     |     |                          |           |
|---------|-------|-----------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type      | Qty | Ply | FEAGIN - YATES RES.      | T33792897 |
| 3975847 | T05   | Half Hip Girder | 2   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:16 2024 Page 1  
ID:wrB0X7HrGjFAXvw916Tj7zE\_0m-z?k8dt2XeFCJGiREFObY6MFsrJ78efdOSfCcZzlsWP

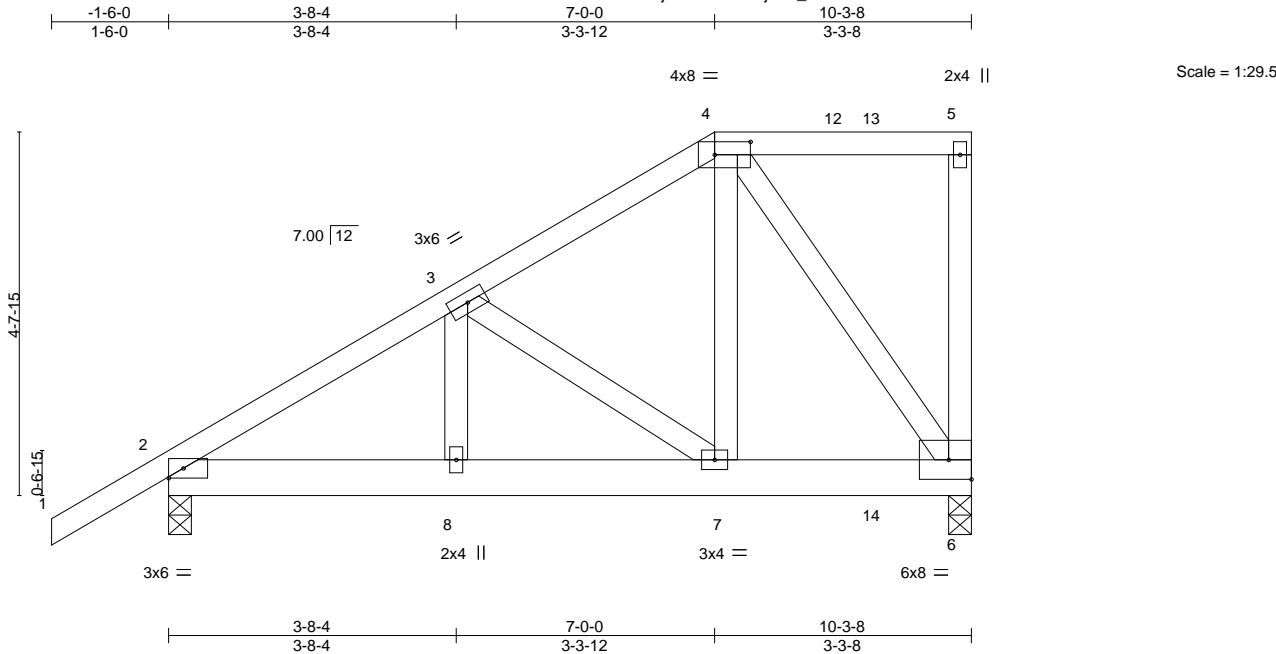

|                       |                      |       |             |              |           |        |     |               |             |
|-----------------------|----------------------|-------|-------------|--------------|-----------|--------|-----|---------------|-------------|
| Plate Offsets (X,Y)-- | [4:0-5-8,0-2-0]      |       |             |              |           |        |     |               |             |
| <b>LOADING</b> (psf)  | <b>SPACING-</b>      | 2-0-0 | <b>CSI.</b> | <b>DEFL.</b> | in (loc)  | l/defl | L/d | <b>PLATES</b> | <b>GRIP</b> |
| TCLL 20.0             | Plate Grip DOL       | 1.25  | TC 0.15     | Vert(LL)     | 0.02 7-8  | >999   | 240 | MT20          | 244/190     |
| TCDL 7.0              | Lumber DOL           | 1.25  | BC 0.19     | Vert(CT)     | -0.02 7-8 | >999   | 180 |               |             |
| BCLL 0.0 *            | Rep Stress Incr      | NO    | WB 0.38     | Horz(CT)     | 0.01 6    | n/a    | n/a |               |             |
| BCDL 10.0             | Code FBC2023/TPI2014 |       | Matrix-MS   |              |           |        |     | Weight: 71 lb | FT = 20%    |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=187(LC 25)  
Max Uplift 2=-242(LC 8), 6=-500(LC 5)  
Max Grav 2=612(LC 1), 6=837(LC 1)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-747/332, 3-4=-553/286  
BOT CHORD 2-8=-365/605, 7-8=-365/605, 6-7=-285/459  
WEBS 4-7=-399/663, 4-6=-759/472

**NOTES-**

- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=242, 6=500.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 79 lb down and 57 lb up at 7-0-0, and 79 lb down and 51 lb up at 9-0-12 on top chord, and 420 lb down and 354 lb up at 7-0-0, and 150 lb down and 110 lb up at 9-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-54, 4-5=-54, 6-9=-20  
Concentrated Loads (lb)  
Vert: 7=-420(B) 4=-24(B) 13=-24(B) 14=-150(B)

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|                          |       |            |     |     |                     |
|--------------------------|-------|------------|-----|-----|---------------------|
| Job                      | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES. |
| 3975847                  | T06   | Half Hip   | 2   | 1   | T33792898           |
| Job Reference (optional) |       |            |     |     |                     |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:16 2024 Page 1

ID:wrBOX7HrGjFAXvw916TJj7zE\_0m-z?k8dt2XeFCJGiREFObY6MFsRJ62egzOSfCcZzlsWP

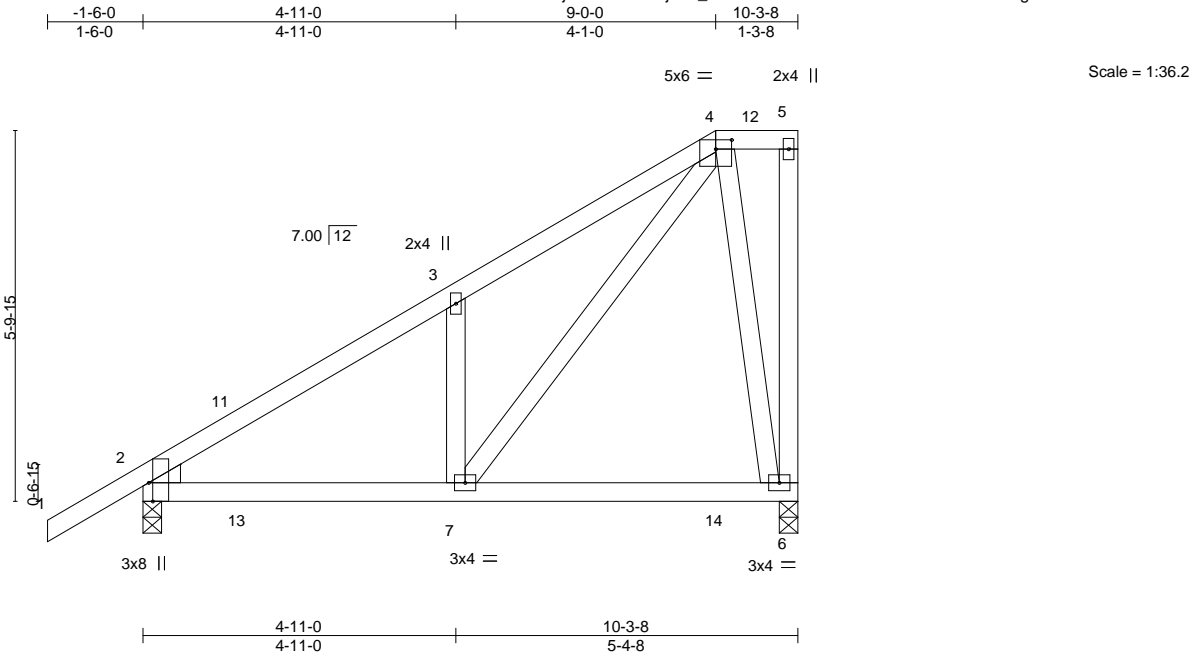

|                       |       |                                  |  |           |      |                           |       |     |             |     |                        |
|-----------------------|-------|----------------------------------|--|-----------|------|---------------------------|-------|-----|-------------|-----|------------------------|
| Plate Offsets (X,Y)-- |       | [2:0-3-8,Edge], [4:0-3-0,0-1-12] |  |           |      |                           |       |     |             |     |                        |
| LOADING (psf)         |       | SPACING- 2-0-0                   |  | CSI.      |      | DEFL. in (loc) l/defl L/d |       |     | PLATES GRIP |     |                        |
| TCLL                  | 20.0  | Plate Grip DOL 1.25              |  | TC        | 0.17 | Vert(LL)                  | -0.02 | 6-7 | >999        | 240 | MT20 244/190           |
| TCDL                  | 7.0   | Lumber DOL 1.25                  |  | BC        | 0.26 | Vert(CT)                  | -0.05 | 6-7 | >999        | 180 |                        |
| BCLL                  | 0.0 * | Rep Stress Incr YES              |  | WB        | 0.36 | Horz(CT)                  | -0.00 | 2   | n/a         | n/a |                        |
| BCDL                  | 10.0  | Code FBC2023/TPI2014             |  | Matrix-MS |      |                           |       |     |             |     | Weight: 66 lb FT = 20% |

|                       |   |
|-----------------------|---|
| LUMBER-               | BRACING-  |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.                                  |
| WEBS 2x4 SP No.3      |   |
| WEDGE                 |   |
| Left: 2x4 SP No.3     |   |

REACTIONS. (size) 6=0-3-8, 2=0-3-8  
Max Horz 2=233(LC 12)  
Max Uplift 6=-181(LC 9), 2=-113(LC 9)  
Max Grav 6=369(LC 1), 2=462(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-447/181, 3-4=-456/306  
BOT CHORD 2-7=-303/338  
WEBS 3-7=-272/213, 4-7=-407/454, 4-6=-322/287

- NOTES-
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 9-0-0, Zone3 9-0-0 to 10-1-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=181, 2=113.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|                          |       |            |     |     |                     |
|--------------------------|-------|------------|-----|-----|---------------------|
| Job                      | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES. |
| 3975847                  | T07   | Monopitch  | 13  | 1   | T33792899           |
| Job Reference (optional) |       |            |     |     |                     |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:17 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-RCIXqD39PZKAus?Rp66nfZo?ijRCN8TYhWOI9?zlsWO

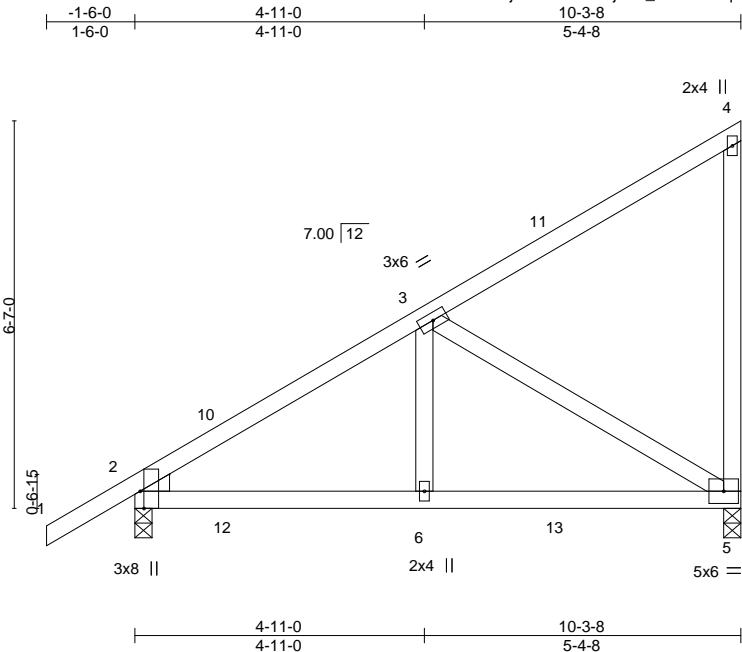

Scale = 1:39.1

| Plate Offsets (X,Y)-- |                 | [2:0-3-8,Edge]  |                                  |
|-----------------------|-----------------|-----------------|----------------------------------|
| <b>LOADING</b> (psf)  | <b>SPACING-</b> | 2-0-0           | <b>CSI.</b>                      |
| TCLL 20.0             | Plate Grip DOL  | 1.25            | TC 0.27                          |
| TCDL 7.0              | Lumber DOL      | 1.25            | BC 0.26                          |
| BCLL 0.0 *            | Rep Stress Incr | YES             | WB 0.28                          |
| BCDL 10.0             | Code            | FBC2023/TPI2014 | Matrix-MS                        |
|                       |                 |                 | <b>DEFL.</b> in (loc) l/defl L/d |
|                       |                 |                 | Vert(LL) -0.02 5-6 >999 240      |
|                       |                 |                 | Vert(CT) -0.04 5-6 >999 180      |
|                       |                 |                 | Horz(CT) 0.01 5 n/a n/a          |
|                       |                 |                 | <b>PLATES</b> <b>GRIP</b>        |
|                       |                 |                 | MT20 244/190                     |
|                       |                 |                 | Weight: 58 lb FT = 20%           |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 2=0-3-8, 5=0-3-8  
Max Horz 2=257(LC 12)  
Max Uplift 2=-103(LC 9), 5=-192(LC 12)  
Max Grav 2=462(LC 1), 5=369(LC 1)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-455/162  
BOT CHORD 2-6=-339/351, 5-6=-339/351  
WEBS 3-5=-399/385

**NOTES-**

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 10-1-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=103, 5=192.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |                 |     |     |                          |           |
|---------|-------|-----------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type      | Qty | Ply | FEAGIN - YATES RES.      | T33792900 |
| 3975847 | T08   | Half Hip Girder | 2   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:17 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-RCIXqD39PZKAus?Rp66nfZo\_xjNvN?YhWOI9?zlsWO  
1-6-0 4-3-14 7-0-0 12-0-0  
1-6-0 4-3-14 2-8-2 5-0-0  
Scale = 1:22.6

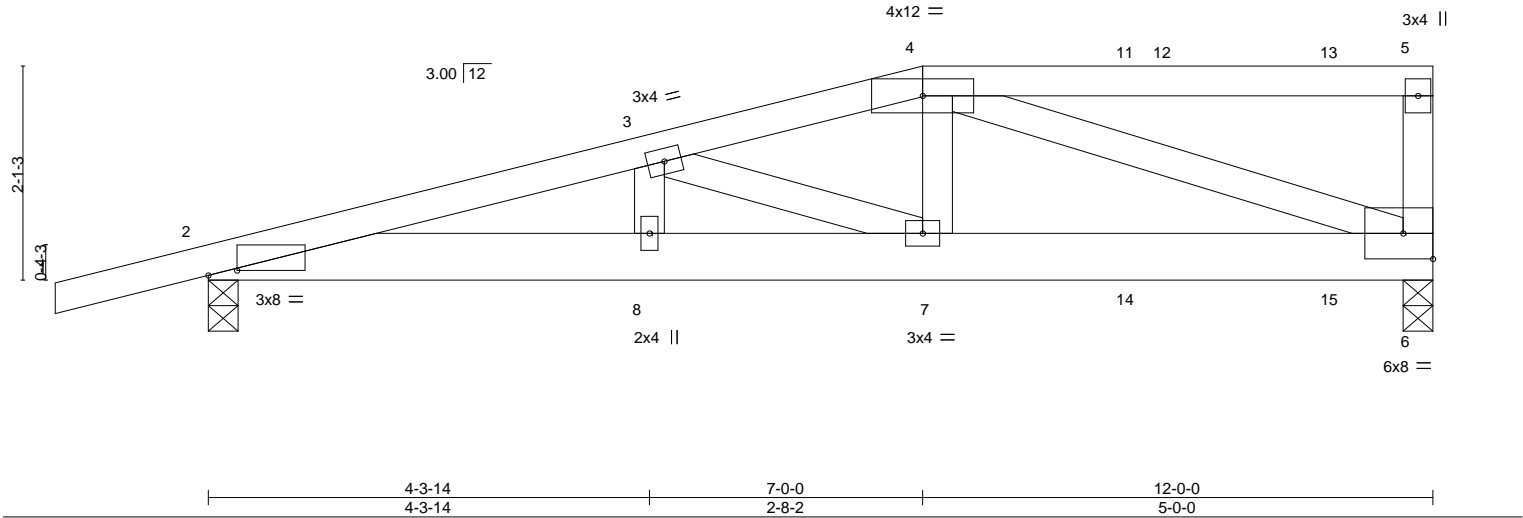

|                       |                      |       |           |          |           |        |     |               |          |
|-----------------------|----------------------|-------|-----------|----------|-----------|--------|-----|---------------|----------|
| Plate Offsets (X,Y)-- | [2:0-3-6,0-0-9]      |       |           |          |           |        |     |               |          |
| LOADING (psf)         | SPACING--            | 2-0-0 | CSI.      | DEFL.    | in (loc)  | l/defl | L/d | PLATES        | GRIP     |
| TCLL 20.0             | Plate Grip DOL       | 1.25  | TC 0.38   | Vert(LL) | 0.09 7-8  | >999   | 240 | MT20          | 244/190  |
| TCDL 7.0              | Lumber DOL           | 1.25  | BC 0.54   | Vert(CT) | -0.12 7-8 | >999   | 180 |               |          |
| BCLL 0.0 *            | Rep Stress Incr      | NO    | WB 0.83   | Horz(CT) | 0.02 6    | n/a    | n/a |               |          |
| BCDL 10.0             | Code FBC2023/TPI2014 |       | Matrix-MS |          |           |        |     | Weight: 64 lb | FT = 20% |

|                       |   |
|-----------------------|---|
| LUMBER-               | BRACING-  |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 4-0-7 oc purlins, except end verticals. |
| BOT CHORD 2x6 SP No.2 | BOT CHORD Rigid ceiling directly applied or 6-8-13 oc bracing.                                  |
| WEBS 2x4 SP No.3      |   |

|            |                                       |
|------------|---------------------------------------|
| REACTIONS. | (size) 2=0-3-8, 6=0-3-8               |
|            | Max Horz 2=88(LC 4)                   |
|            | Max Uplift 2=-459(LC 4), 6=-644(LC 4) |
|            | Max Grav 2=753(LC 1), 6=940(LC 1)     |

|           |  |
|-----------|--|
| FORCES.   | (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. |
| TOP CHORD | 2-3=-1982/1156, 3-4=-1734/1039   |
| BOT CHORD | 2-8=-1159/1910, 7-8=-1159/1910, 6-7=-1060/1736                               |
| WEBS      | 3-7=-355/300, 4-7=-465/755, 4-6=-1729/1057                                   |

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=459, 6=644.
  - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 36 lb down and 45 lb up at 7-0-0, 19 lb down and 44 lb up at 9-0-12, and 23 lb down and 44 lb up at 11-0-12, and 47 lb down and 136 lb up at 11-10-4 on top chord, and 422 lb down and 339 lb up at 7-0-0, and 157 lb down and 130 lb up at 9-0-12, and 159 lb down and 128 lb up at 11-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

|   |
|---|
| LOAD CASE(S) Standard   |
| 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25 |
| Uniform Loads (plf)   |
| Vert: 1-4=-54, 4-5=-54, 2-6=-20   |
| Concentrated Loads (lb)   |
| Vert: 5=61 7=-422(F) 4=-17(F) 11=-17(F) 13=-23(F) 14=-157(F) 15=-159(F)   |

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792901 |
| 3975847 | T09   | MONO TRUSS | 27  | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:18 2024 Page 1  
ID:wrBOX7HrGjFAXvw916TjJ7zE\_0m-wOsv2Z4nAtS1V0adNpe0CnL9m6kG6eOhvA8JhRzIsWN



Scale = 1:18.1

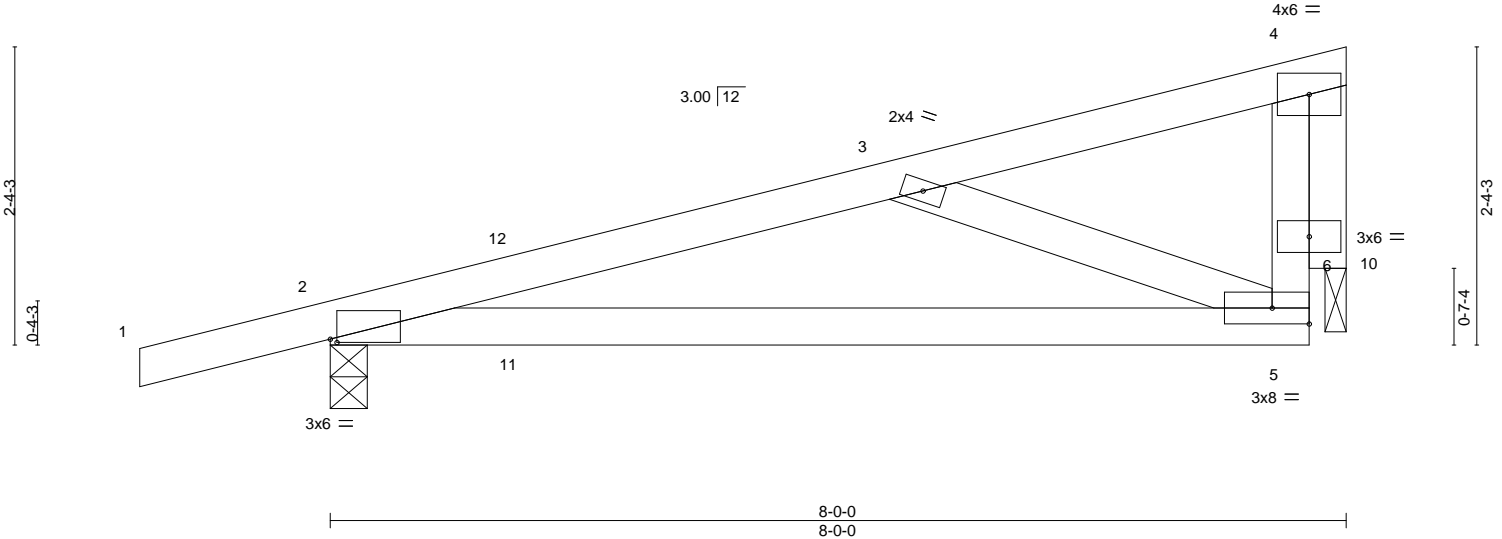

| Plate Offsets (X,Y)-- [2:0-0-10,0-0-5] |       |                       |      |             |      |                                  |       |     |      |               |               |          |
|--|-------|-----------------------|------|-------------|------|----------------------------------|-------|-----|------|---------------|---------------|----------|
| <b>LOADING</b> (psf)                   |       | <b>SPACING-</b> 2-0-0 |      | <b>CSI.</b> |      | <b>DEFL.</b> in (loc) l/defl L/d |       |     |      | <b>PLATES</b> | <b>GRIP</b>   |          |
| TCLL                                   | 20.0  | Plate Grip DOL        | 1.25 | TC          | 0.38 | Vert(LL)                         | 0.07  | 5-9 | >999 | 240           | MT20          | 244/190  |
| TCDL                                   | 7.0   | Lumber DOL            | 1.25 | BC          | 0.40 | Vert(CT)                         | -0.14 | 5-9 | >703 | 180           |               |          |
| BCLL                                   | 0.0 * | Rep Stress Incr       | YES  | WB          | 0.11 | Horz(CT)                         | -0.00 | 10  | n/a  | n/a           |               |          |
| BCDL                                   | 10.0  | Code FBC2023/TPI2014  |      | Matrix-MS   |      |                                  |       |     |      |               | Weight: 35 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 8-7-12 oc bracing.

REACTIONS.

(size) 2=0-3-8, 10=0-2-0  
Max Horz 2=92(LC 8)  
Max Uplift 2=-230(LC 8), 10=-157(LC 8)  
Max Grav 2=381(LC 1), 10=260(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-504/368  
BOT CHORD 2-5=-426/482  
WEBS 3-5=-427/375, 4-10=-268/237

NOTES-

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 7-6-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 10.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 10=157.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |
|---------|-------|------------|-----|-----|--------------------------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      |
| 3975847 | V01   | Valley     | 1   | 1   | T33792902                |
|         |       |            |     |     | Job Reference (optional) |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,


8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:18 2024 Page 1

ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-OaQHFv5QxAau7A9pwX9Fk\_tLnW7Jr4Er8qtsDvzlsWM

9-9-10 29-9-10 39-7-4

9-9-10 20-0-0 9-9-10

Scale = 1:65.6

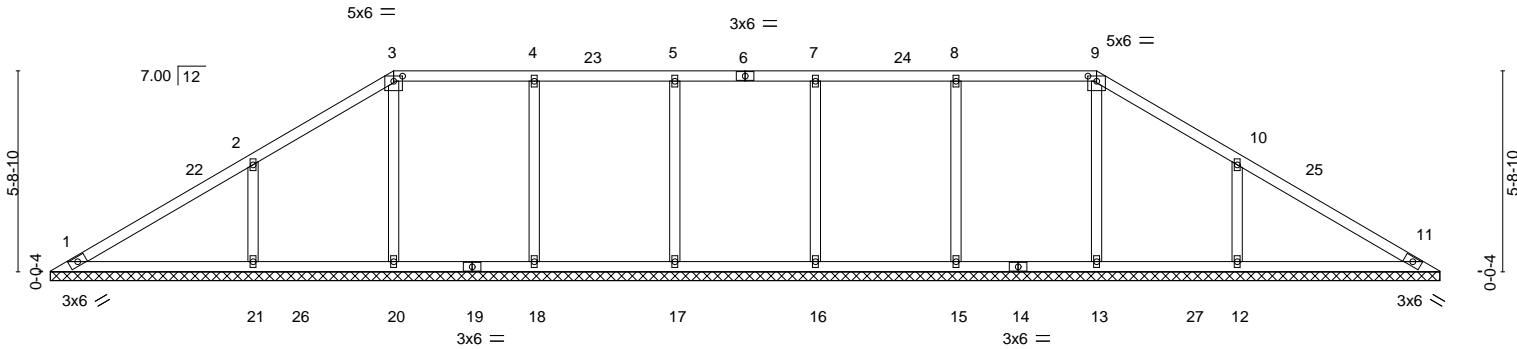

|  |         |        |
|--|---------|--------|
|  | 39-6-13 | 39-7-4 |
|  | 39-6-13 | 0-0-7  |

|                       |                                    |                 |
|-----------------------|------------------------------------|-----------------|
| Plate Offsets (X,Y)-- | [3:0-3-0,0-1-12], [9:0-3-0,0-1-12] |                 |
| LOADING (psf)         | SPACING-                           | 2-0-0           |
| TCLL 20.0             | Plate Grip DOL                     | 1.25            |
| TCDL 7.0              | Lumber DOL                         | 1.25            |
| BCLL 0.0 *            | Rep Stress Incr                    | YES             |
| BCDL 10.0             | Code                               | FBC2023/TPI2014 |
|                       | CSI.                               |                 |
|                       | TC                                 | 0.30            |
|                       | BC                                 | 0.22            |
|                       | WB                                 | 0.14            |
|                       | Matrix-S                           |                 |
|                       | DEFL.                              |                 |
|                       | Vert(LL)                           | n/a - n/a 999   |
|                       | Vert(CT)                           | n/a - n/a 999   |
|                       | Horz(CT)                           | 0.01 11 n/a n/a |
|                       | PLATES                             | GRIP            |
|                       | MT20                               | 244/190         |
|                       | Weight: 175 lb                     | FT = 20%        |

|                       |   |
|-----------------------|---|
| LUMBER-               | BRACING-  |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** All bearings 39-6-6.  
(lb) - Max Horz 1=134(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 11, 13, 16, 17, 20 except 15=109(LC 9), 18=108(LC 8), 21=216(LC 12), 12=216(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 11 except 13=319(LC 28), 15=396(LC 27), 16=373(LC 28), 17=373(LC 27), 18=396(LC 28), 20=325(LC 22), 21=538(LC 19), 12=538(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-21=327/237, 10-12=327/237

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 4-5-15, Zone1 4-5-15 to 9-9-10, Zone2 9-9-10 to 15-4-12, Zone1 15-4-12 to 29-9-10, Zone2 29-9-10 to 35-4-12, Zone1 35-4-12 to 39-0-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) All plates are 2x4 MT20 unless otherwise indicated.
  - 6) Gable requires continuous bottom chord bearing.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11, 13, 16, 17, 20 except (jt=lb) 15=109, 18=108, 21=216, 12=216.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|                          |       |            |     |     |                     |
|--------------------------|-------|------------|-----|-----|---------------------|
| Job                      | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES. |
| 3975847                  | V02   | Valley     | 1   | 1   | T33792903           |
| Job Reference (optional) |       |            |     |     |                     |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:19 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-OaQHFv5QxAau7A9pwX9Fk\_tLoW7Jr4Dr8qtsDuzlsWM  
9-9-10 25-9-10 35-7-4  
9-9-10 16-0-0 9-9-10  
Scale = 1:58.8

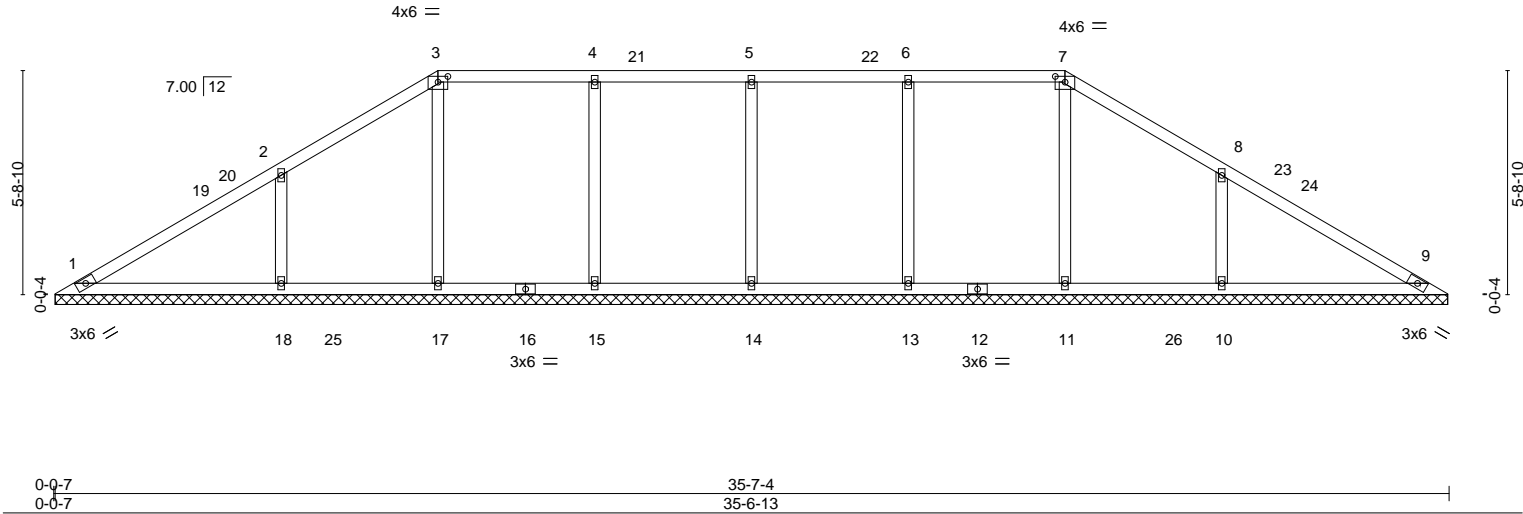

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES         | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|----------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.30  | Vert(LL) | n/a      | -      | n/a | MT20           | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.22  | Vert(CT) | n/a      | -      | n/a |                |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.14  | Horz(CT) | 0.00     | 9      | n/a |                |          |
| BCDL 10.0     | Code FBC2023/TPI2014 |       | Matrix-S |          |          |        |     | Weight: 155 lb | FT = 20% |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** All bearings 35-6-6.  
(lb) - Max Horz 1=134(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 11, 14, 17 except 13=109(LC 9), 15=109(LC 12), 18=216(LC 12), 10=216(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 9 except 11=318(LC 28), 13=398(LC 27), 14=366(LC 2), 15=398(LC 28), 17=324(LC 22), 18=538(LC 19), 10=539(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-18=327/237, 8-10=327/237

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 4-1-2; Zone1 4-1-2 to 9-9-10, Zone2 9-9-10 to 14-9-15, Zone1 14-9-15 to 25-9-10, Zone2 25-9-10 to 30-9-15, Zone1 30-9-15 to 35-0-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) All plates are 2x4 MT20 unless otherwise indicated.
  - 6) Gable requires continuous bottom chord bearing.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 11, 14, 17 except (jt=lb) 13=109, 15=109, 18=216, 10=216.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




|                          |       |            |     |     |                     |
|--------------------------|-------|------------|-----|-----|---------------------|
| Job                      | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES. |
| 3975847                  | V03   | Valley     | 1   | 1   | T33792904           |
| Job Reference (optional) |       |            |     |     |                     |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:20 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TjJ7zE\_0m-sn\_fTF52iUllIk?UEgUHCQVYwTYaXW\_NUdPIKzlsWL



Scale = 1:52.0

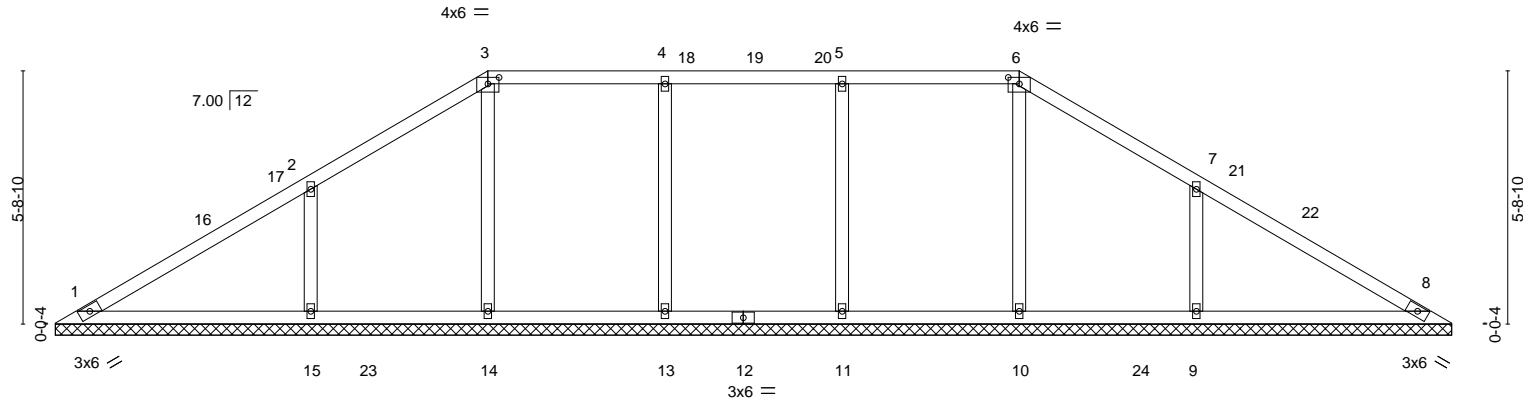

|  |         |        |
|--|---------|--------|
|  | 31-6-13 | 31-7-4 |
|  | 31-6-13 | 0-0-7  |

|                       |                                    |          |          |          |        |     |        |                |          |
|-----------------------|------------------------------------|----------|----------|----------|--------|-----|--------|----------------|----------|
| Plate Offsets (X,Y)-- | [3:0-3-0,0-1-12], [6:0-3-0,0-1-12] |          |          |          |        |     |        |                |          |
| LOADING (psf)         | SPACING- 2-0-0                     | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES | GRIP           |          |
| TCLL 20.0             | Plate Grip DOL 1.25                | TC 0.30  | Vert(LL) | n/a      | -      | n/a | 999    | MT20           | 244/190  |
| TCDL 7.0              | Lumber DOL 1.25                    | BC 0.22  | Vert(CT) | n/a      | -      | n/a | 999    |                |          |
| BCLL 0.0 *            | Rep Stress Incr YES                | WB 0.13  | Horz(CT) | 0.00     | 8      | n/a | n/a    |                |          |
| BCDL 10.0             | Code FBC2023/TPI2014               | Matrix-S |          |          |        |     |        | Weight: 136 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 31-6-6.  
(lb) - Max Horz 1=-134(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 8, 10, 14 except 11=-106(LC 9), 13=-106(LC 8), 15=-215(LC 12), 9=-215(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 8 except 10=318(LC 28), 11=392(LC 27), 13=392(LC 28), 14=326(LC 22), 15=538(LC 19), 9=538(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-15=-327/237, 7-9=-327/237

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-8-5; Zone1 3-8-5 to 9-9-10, Zone2 9-9-10 to 14-3-2, Zone1 14-3-2 to 21-9-10, Zone2 21-9-10 to 26-3-2, Zone1 26-3-2 to 31-0-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are 2x4 MT20 unless otherwise indicated.
- 6) Gable requires continuous bottom chord bearing.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 8, 10, 14 except (jt=lb) 11=106, 13=106, 15=215, 9=215.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792905 |
| 3975847 | V04   | Valley     | 1   | 1   | Job Reference (optional) |           |


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:21 2024 Page 1

ID:wrB0X7HrGjFAXvw916TjJ7zE\_0m-KzY1ga6gToqcMTJC2yBjpPyglKpmJ\_a7b8MzlmzlsWK



Scale = 1:46.0

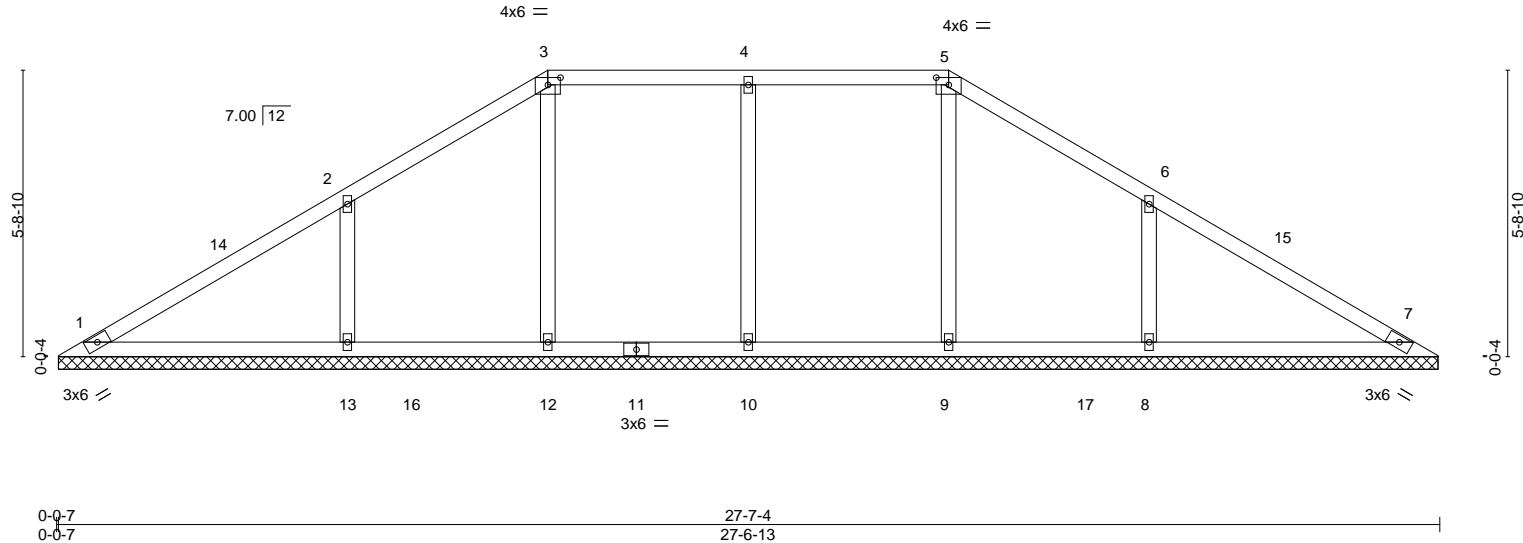

| LOADING (psf) |       | SPACING-             |      | CSI.     |      | DEFL.    |      | PLATES                  |         | GRIP |  |
|---------------|-------|----------------------|------|----------|------|----------|------|-------------------------|---------|------|--|
| TCLL          | 20.0  | Plate Grip DOL       | 1.25 | TC       | 0.30 | Vert(LL) | n/a  | MT20                    | 244/190 |      |  |
| TCDL          | 7.0   | Lumber DOL           | 1.25 | BC       | 0.22 | Vert(CT) | n/a  |                         |         |      |  |
| BCLL          | 0.0 * | Rep Stress Incr      | YES  | WB       | 0.15 | Horz(CT) | 0.00 |                         |         |      |  |
| BCDL          | 10.0  | Code FBC2023/TPI2014 |      | Matrix-S |      |          |      |                         |         |      |  |
|               |       |                      |      |          |      |          |      | Weight: 116 lb FT = 20% |         |      |  |

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

All bearings 27-6-6.  
(lb) - Max Horz 1=134(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 9, 12 except 10=-118(LC 9), 13=-215(LC 12), 8=-215(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 9=312(LC 28), 10=414(LC 28), 12=324(LC 22), 13=539(LC 19), 8=539(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 4-10=-252/143, 2-13=-327/236, 6-8=-327/236

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 9-9-10, Zone2 9-9-10 to 13-9-10, Zone1 13-9-10 to 17-9-10, Zone2 17-9-10 to 21-9-10, Zone1 21-9-10 to 27-0-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are 2x4 MT20 unless otherwise indicated.
- 6) Gable requires continuous bottom chord bearing.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 9, 12 except (jt=lb) 10=118, 13=215, 8=215.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792907 |
| 3975847 | V06   | Valley     | 1   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:22 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-o96Qtw7IE5zT\_duOcfiyMdVr?k9\_2SwHqo6WqCzIsWJ

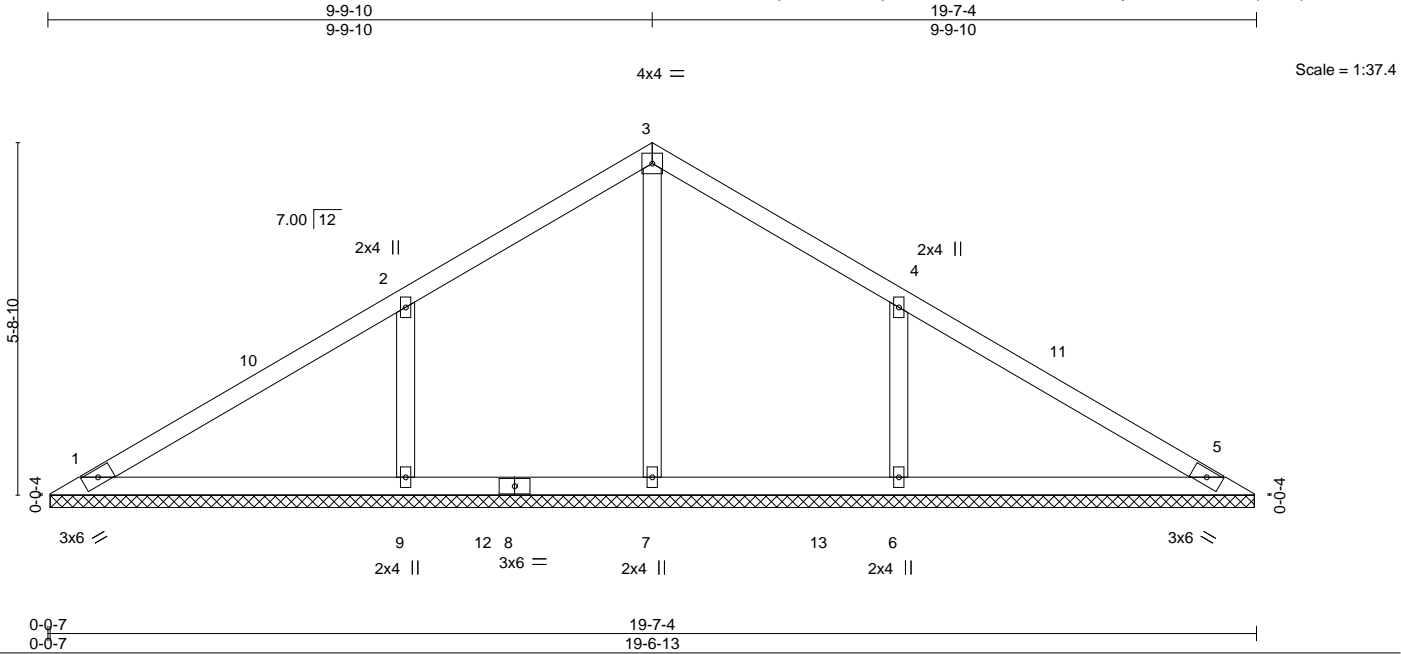

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.30  | Vert(LL) | n/a      | -      | n/a | MT20          | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.22  | Vert(CT) | n/a      | -      | n/a |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.08  | Horz(CT) | 0.00     | 5      | n/a |               |          |
| BCDL 10.0     | Code FBC2023/TP12014 |       | Matrix-S |          |          |        |     | Weight: 77 lb | FT = 20% |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** All bearings 19-6-7.  
(lb) - Max Horz 1=134(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 9=217(LC 12), 6=217(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=293(LC 22), 9=543(LC 19), 6=543(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-9=-328/239, 4-6=-328/238

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 9-9-10, Zone2 9-9-10 to 13-9-10, Zone1 13-9-10 to 19-0-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 9=217, 6=217.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792908 |
| 3975847 | V07   | Valley     | 1   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:22 2024 Page 1  
ID:wrBOX7HrGjFAXvw916Tj7zE\_0m-o96Qtw71E5zT\_duOcfiyMdVtBkBl2T9Hqo6WqCzIsWJ

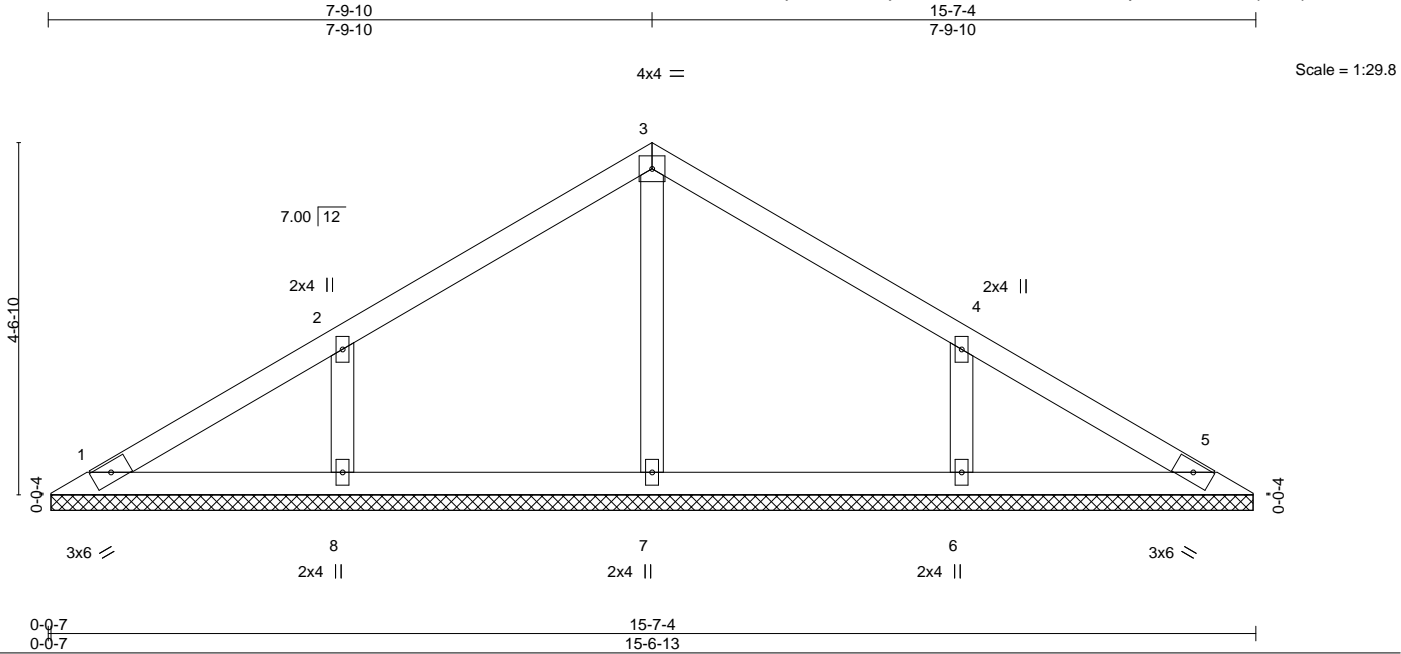

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.16  | Vert(LL) | n/a      | -      | n/a | MT20          | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.11  | Vert(CT) | n/a      | -      | n/a |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.06  | Horz(CT) | 0.00     | 5      | n/a |               |          |
| BCDL 10.0     | Code FBC2023/TP12014 |       | Matrix-S |          |          |        |     | Weight: 59 lb | FT = 20% |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** All bearings 15-6-7.  
(lb) - Max Horz 1=105(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=165(LC 12), 6=165(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=333(LC 19), 6=333(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-9-10, Zone1 3-9-10 to 7-9-10, Zone2 7-9-10 to 11-9-10, Zone1 11-9-10 to 15-0-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=165, 6=165.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792909 |
| 3975847 | V08   | Valley     | 1   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:23 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-GLfo5G8w\_P5KcnTa9NDBvq2?97UTnwOQ3Sr3MfzlsWI

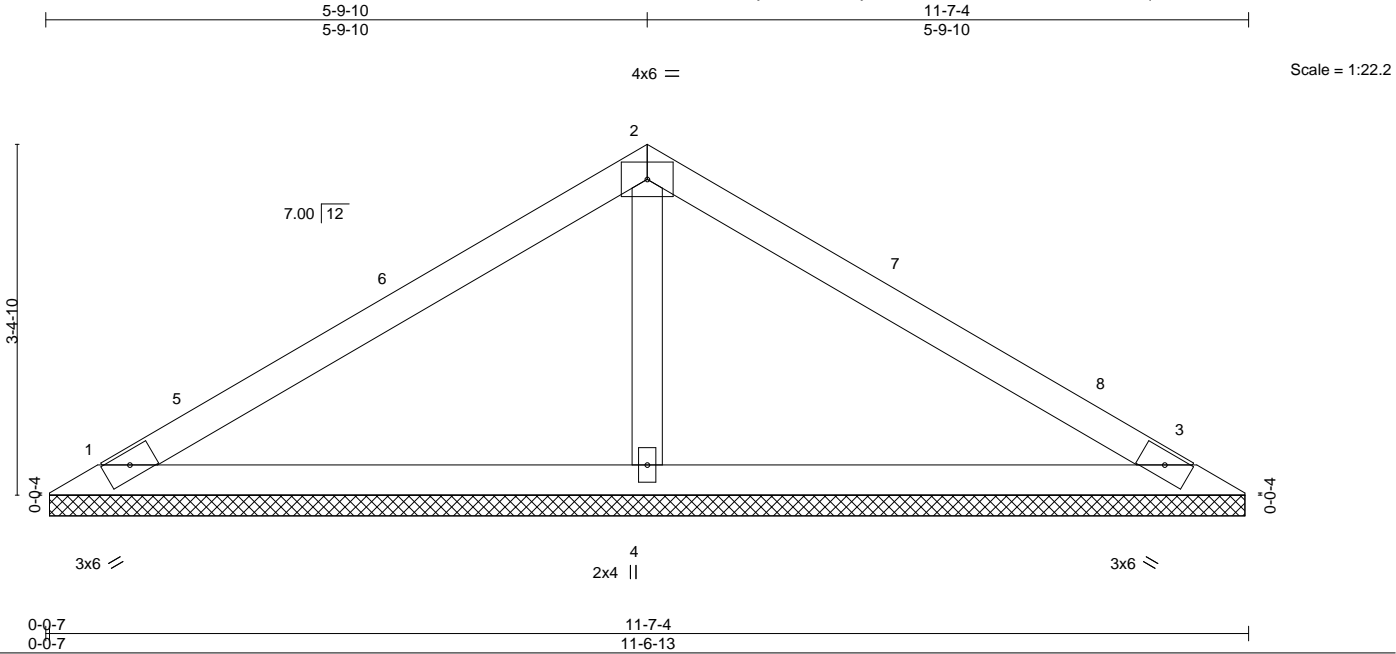

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES | GRIP                   |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|--------|------------------------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.34  | Vert(LL) | n/a      | -      | n/a | 999    | MT20                   |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.27  | Vert(CT) | n/a      | -      | n/a | 999    | 244/190                |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.06  | Horz(CT) | 0.00     | 3      | n/a | n/a    |                        |
| BCDL 10.0     | Code FBC2023/TPI2014 |       | Matrix-S |          |          |        |     |        |                        |
|               |                      |       |          |          |          |        |     |        | Weight: 39 lb FT = 20% |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** (size) 1=11-6-6, 3=11-6-6, 4=11-6-6  
Max Horz 1=-76(LC 10)  
Max Uplift 1=-60(LC 12), 3=-70(LC 13), 4=-75(LC 12)  
Max Grav 1=183(LC 1), 3=183(LC 1), 4=412(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-4=-260/143

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 5-9-10, Zone2 5-9-10 to 10-0-9, Zone1 10-0-9 to 11-0-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|   |       |            |     |     |                          |
|---|-------|------------|-----|-----|--------------------------|
| Job   | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      |
| 3975847   | V09   | Valley     | 1   | 1   | T33792910                |
| Builders FirstSource (Lake City,FL), Lake City, FL - 32055, |       |            |     |     | Job Reference (optional) |

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:23 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TjJ7zE\_0m-GLfo5G8w\_P5KcnTa9NDBvq23R7X2nwiQ3Sr3MfzlsWI



Scale = 1:15.7

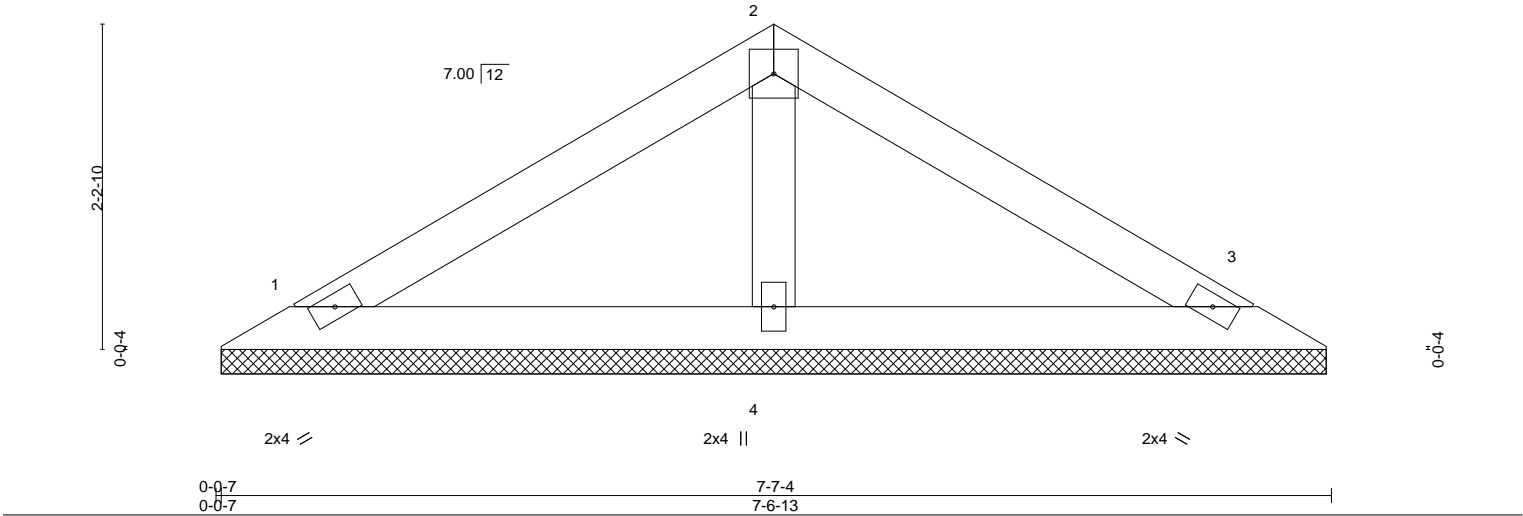

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in   | (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|------|-------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.13  | Vert(LL) | n/a  | -     | n/a    | 999 | MT20          | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.10  | Vert(CT) | n/a  | -     | n/a    | 999 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.04  | Horz(CT) | 0.00 | 3     | n/a    | n/a |               |          |
| BCDL 10.0     | Code FBC2023/TPI2014 |       | Matrix-S |          |      |       |        |     | Weight: 25 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=7-6-7, 3=7-6-7, 4=7-6-7  
Max Horz 1=47(LC 10)  
Max Uplift 1=37(LC 12), 3=44(LC 13), 4=46(LC 12)  
Max Grav 1=114(LC 1), 3=114(LC 1), 4=255(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.

This item has been  
digitally signed and  
sealed by Velez, Joaquin, PE  
on the date indicated here.  
Printed copies of this  
document are not considered  
signed and sealed and the  
signature must be verified  
on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792911 |
| 3975847 | V10   | Valley     | 1   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:24 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-kYDAIc9YljDBDx2nj4kQR2aCeXrAWM?al6bdu5zlsWH

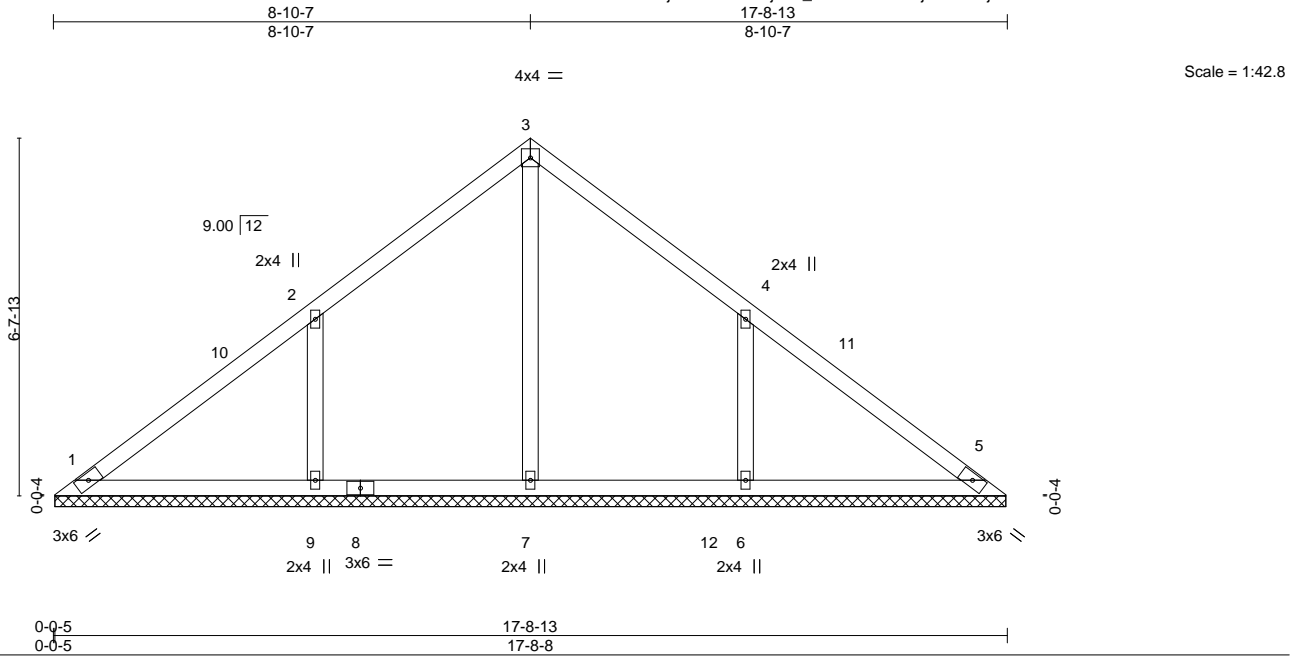

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.22  | Vert(LL) | n/a      | -      | n/a | 999           | MT20     |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.18  | Vert(CT) | n/a      | -      | n/a | 999           | 244/190  |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.10  | Horz(CT) | 0.00     | 5      | n/a | n/a           |          |
| BCDL 10.0     | Code FBC2023/TP12014 |       | Matrix-S |          |          |        |     |               |          |
|               |                      |       |          |          |          |        |     | Weight: 76 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 17-8-2.  
(lb) - Max Horz 1=-156(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 9=-237(LC 12), 6=-236(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=327(LC 22), 9=497(LC 19), 6=499(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-9=-303/255, 4-6=-303/255

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-5-4 to 3-5-4, Zone1 3-5-4 to 8-10-7, Zone2 8-10-7 to 12-10-7, Zone1 12-10-7 to 17-3-9 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 9=237, 6=236.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792912 |
| 3975847 | V11   | Valley     | 1   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:24 2024 Page 1

ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-kYDAIc9YljDBDx2nj4kQR2aDpXs7WMOal6bdu5zlsWH

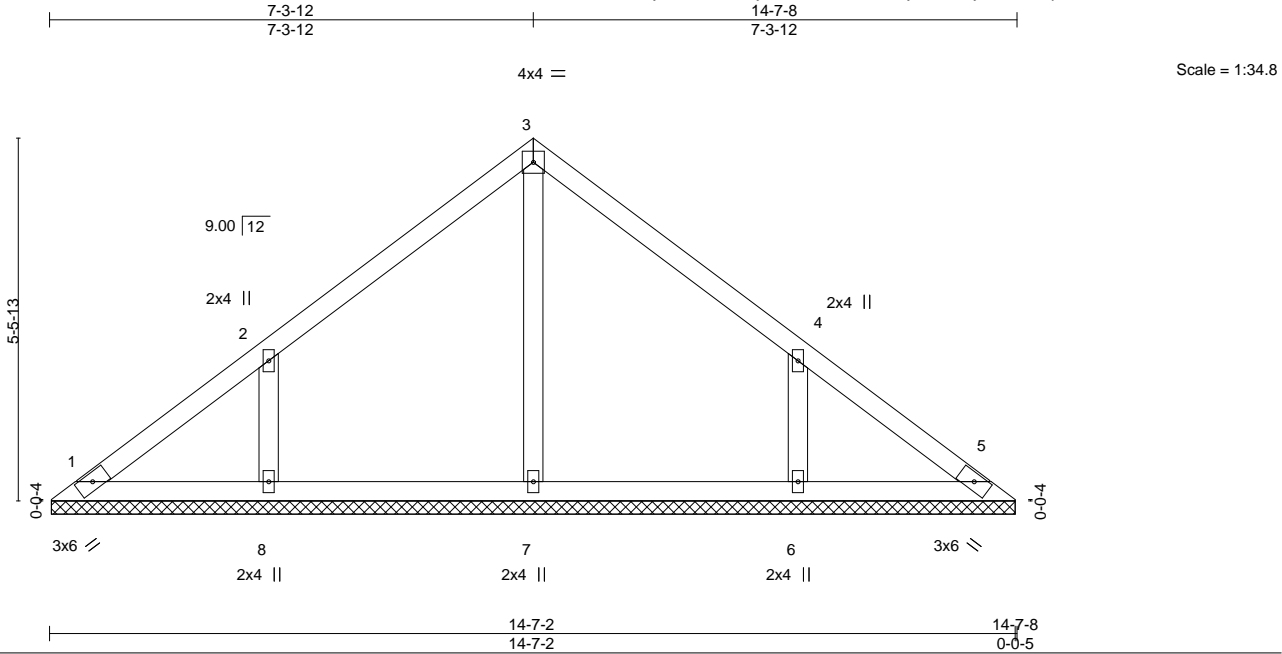

| LOADING (psf) | SPACING-             |       | CSI.     | DEFL.    | in   | (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|------|-------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 2-0-0 | TC 0.15  | Vert(LL) | n/a  | -     | n/a    | 999 | MT20          | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.11  | Vert(CT) | n/a  | -     | n/a    | 999 |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.08  | Horz(CT) | 0.00 | 5     | n/a    | n/a |               |          |
| BCDL 10.0     | Code FBC2023/TP12014 |       | Matrix-S |          |      |       |        |     | Weight: 60 lb | FT = 20% |

| LUMBER-               | BRACING-  |
|-----------------------|---|
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** All bearings 14-6-13.  
(lb) - Max Horz 1=127(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=192(LC 12), 6=192(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=326(LC 19), 6=326(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-5-4 to 3-3-12, Zone1 3-3-12 to 7-3-12, Zone2 7-3-12 to 11-3-12, Zone1 11-3-12 to 14-2-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=192, 6=192.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


|                          |       |            |     |     |                     |
|--------------------------|-------|------------|-----|-----|---------------------|
| Job                      | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES. |
| 3975847                  | V12   | Valley     | 1   | 1   | T33792913           |
| Job Reference (optional) |       |            |     |     |                     |

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:25 2024 Page 1

ID:wrBOX7HrGjFAXvw916TJj7zE\_0m-CknYWYy9AW0L2r5dzHnGf\_F7LVx9pFpfjWmKARXzIsWG

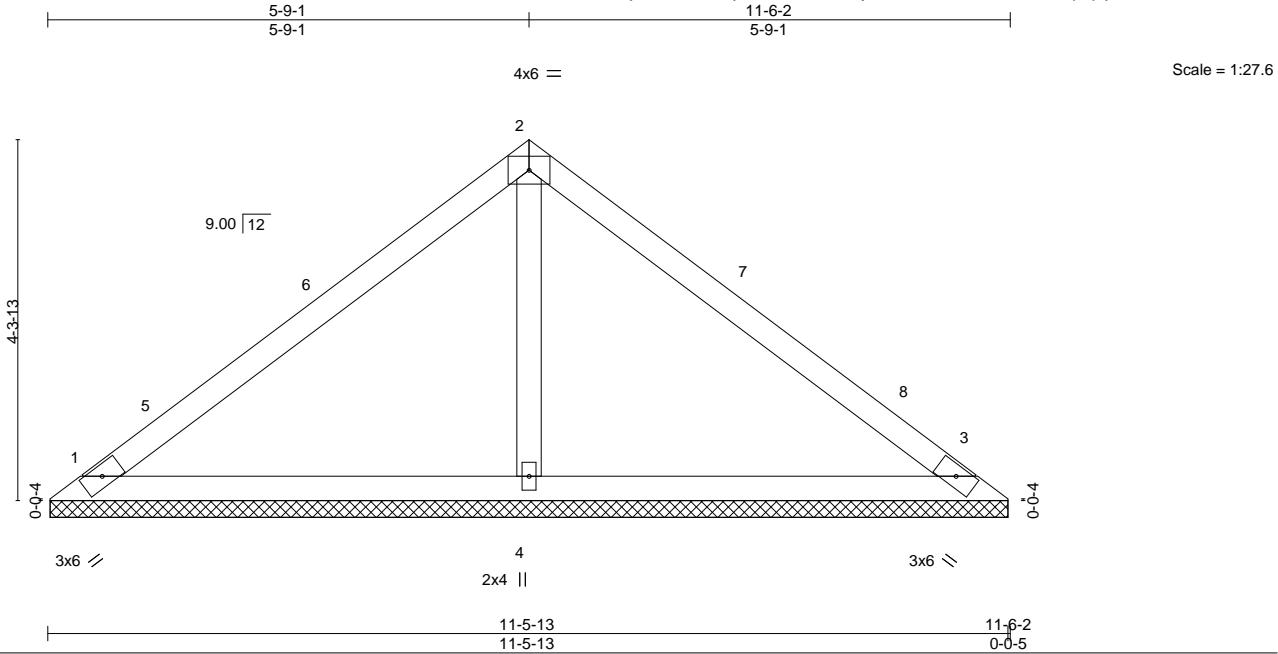

| LOADING (psf) | SPACING-             |  | CSI.     | DEFL.    | in   | (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|--|----------|----------|------|-------|--------|-----|---------------|----------|
| TCLL 20.0     | 2-0-0                |  | TC 0.35  | Vert(LL) | n/a  | -     | n/a    | 999 | MT20          | 244/190  |
| TCDL 7.0      | Plate Grip DOL 1.25  |  | BC 0.28  | Vert(CT) | n/a  | -     | n/a    | 999 |               |          |
| BCLL 0.0 *    | Lumber DOL 1.25      |  | WB 0.08  | Horz(CT) | 0.00 | 3     | n/a    | n/a |               |          |
| BCDL 10.0     | Rep Stress Incr YES  |  | Matrix-S |          |      |       |        |     |               |          |
|               | Code FBC2023/TPI2014 |  |          |          |      |       |        |     | Weight: 42 lb | FT = 20% |

|                |             |                 |   |
|----------------|-------------|-----------------|---|
| <b>LUMBER-</b> |             | <b>BRACING-</b> |   |
| TOP CHORD      | 2x4 SP No.2 | TOP CHORD       | Structural wood sheathing directly applied or 6-0-0 oc purlins. |
| BOT CHORD      | 2x4 SP No.2 | BOT CHORD       | Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS         | 2x4 SP No.3 |                 |   |

**REACTIONS.** (size) 1=11-5-8, 3=11-5-8, 4=11-5-8  
Max Horz 1=99(LC 9)  
Max Uplift 1=61(LC 12), 3=74(LC 13), 4=67(LC 12)  
Max Grav 1=200(LC 1), 3=200(LC 1), 4=387(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BC DL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-5-4 to 3-5-4, Zone1 3-5-4 to 5-9-1, Zone2 5-9-1 to 10-0-0, Zone1 10-0-0 to 11-0-14 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.

This item has been  
digitally signed and  
sealed by Velez, Joaquin, PE  
on the date indicated here.  
Printed copies of this  
document are not considered  
signed and sealed and the  
signature must be verified  
on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)



**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



|         |       |            |     |     |                          |           |
|---------|-------|------------|-----|-----|--------------------------|-----------|
| Job     | Truss | Truss Type | Qty | Ply | FEAGIN - YATES RES.      | T33792915 |
| 3975847 | V14   | Valley     | 1   | 1   | Job Reference (optional) |           |

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Apr 25 2024 MiTek Industries, Inc. Tue May 7 14:39:26 2024 Page 1  
ID:wrB0X7HrGjFAXvw916TJj7zE\_0m-hwLwjAphKTVTFC9rVnuWTgarLZc\_HitlQ4kz\_zlsWF

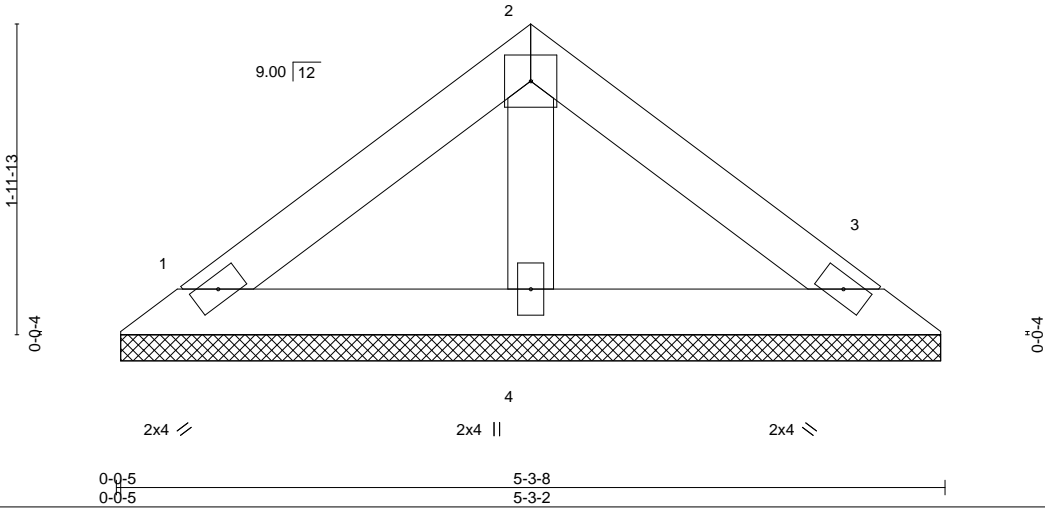

| LOADING (psf) | SPACING-             | 2-0-0 | CSI.     | DEFL.    | in (loc) | l/defl | L/d | PLATES        | GRIP     |
|---------------|----------------------|-------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0     | Plate Grip DOL       | 1.25  | TC 0.12  | Vert(LL) | n/a      | -      | n/a | MT20          | 244/190  |
| TCDL 7.0      | Lumber DOL           | 1.25  | BC 0.05  | Vert(CT) | n/a      | -      | n/a |               |          |
| BCLL 0.0 *    | Rep Stress Incr      | YES   | WB 0.03  | Horz(CT) | 0.00     | 3      | n/a |               |          |
| BCDL 10.0     | Code FBC2023/TP12014 |       | Matrix-P |          |          |        |     | Weight: 18 lb | FT = 20% |

|                       |   |
|-----------------------|---|
| <b>LUMBER-</b>        | <b>BRACING-</b>   |
| TOP CHORD 2x4 SP No.2 | TOP CHORD Structural wood sheathing directly applied or 5-3-8 oc purlins. |
| BOT CHORD 2x4 SP No.2 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.            |
| OTHERS 2x4 SP No.3    |   |

**REACTIONS.** (size) 1=5-2-13, 3=5-2-13, 4=5-2-13  
Max Horz 1=41(LC 8)  
Max Uplift 1=31(LC 12), 3=36(LC 13), 4=16(LC 12)  
Max Grav 1=90(LC 1), 3=90(LC 1), 4=146(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

May 8,2024


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

# Symbols

## PLATE LOCATION AND ORIENTATION

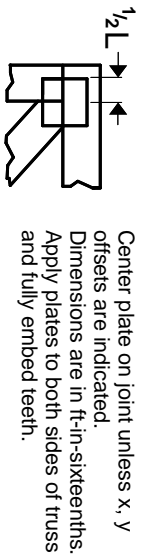

0-<sup>1</sup>/<sub>16</sub>"

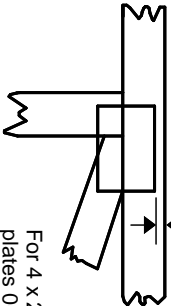

For 4 x 2 orientation, locate plates 0- <sup>1</sup>/<sub>16</sub>" from outside edge of truss.

—  
This symbol indicates the required direction of slots in connector plates.


\* Plate location details available in MITek software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


### Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System



1 2 3 Joint ID typ.

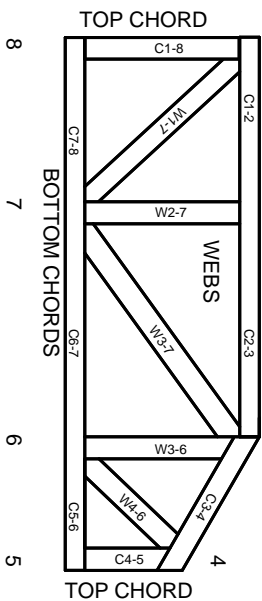

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

## Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

# MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.