


ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"


Wind Speed	Sheathing Thickness Plywood Or OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	12" oc
120 mph Exp. C	7/16"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. C	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RRS-01 (2 3/8" x 0.131")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	6" oc	6" oc
160 mph Exp. D	19/32"	ASTM F1667 RRS-03 (2 1/2" x 0.131") or ASTM F1667 RRS-04 (3" x 0.120")	4" oc	4" oc

Note: For sheathing located a minimum of 4 feet from the perimeter edge of the roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 6 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field. Note: This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

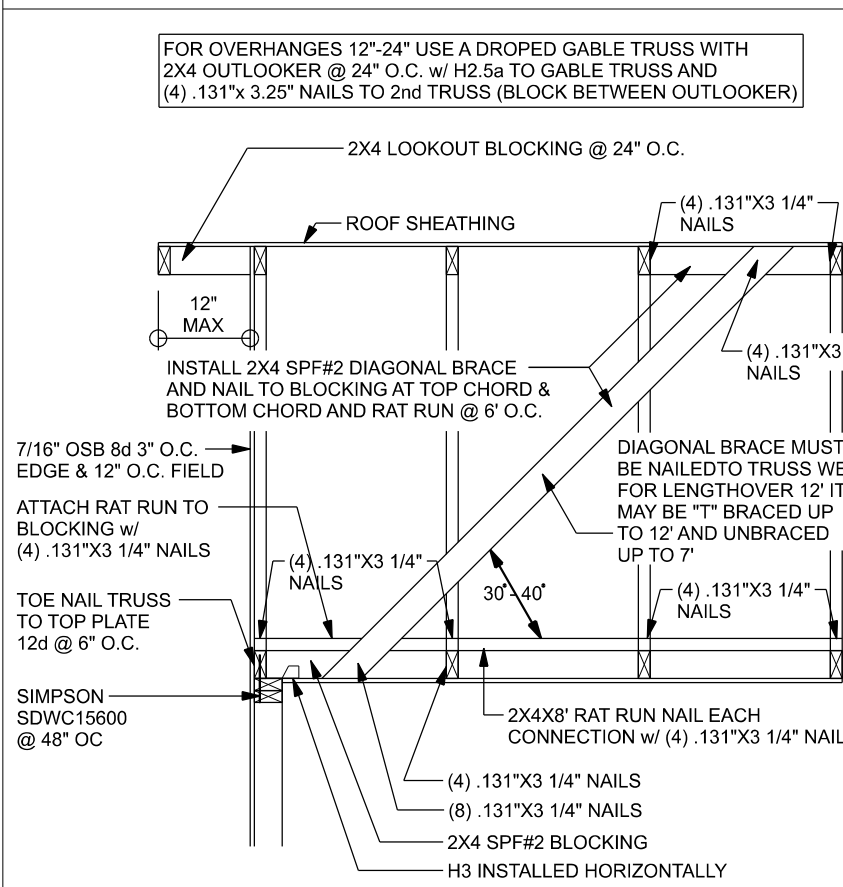


(TYP.) GABLE BRACING DETAIL
WOOD FRAME

SPACE RAT RUN & DIAGONAL BRACE 6'-0" O.C.
FOR GABLE HEIGHT UP TO 25'-0" 130 MPH, EXP. C, ENCLOSED

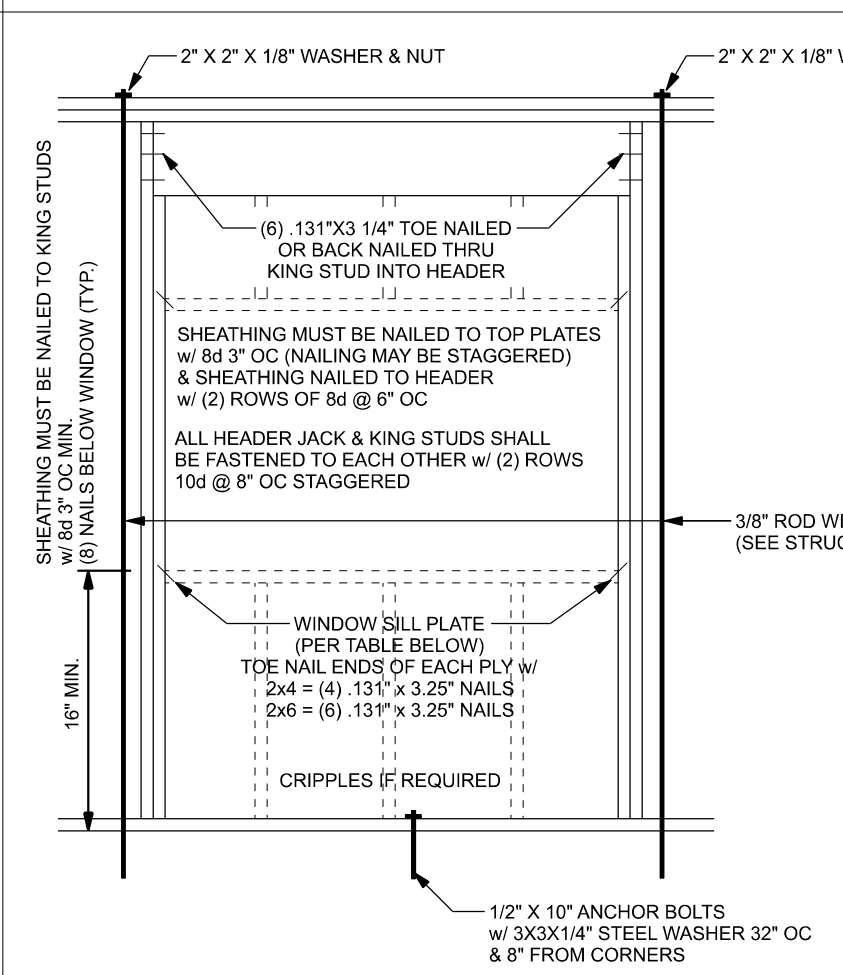


(TYP.) INTERSECTING WALL FRAMING
WOOD FRAME

TOP PLATE SPLICE 48" MIN. SPLICE LENGTH w/ (16) 131X3 1/4" NAILS

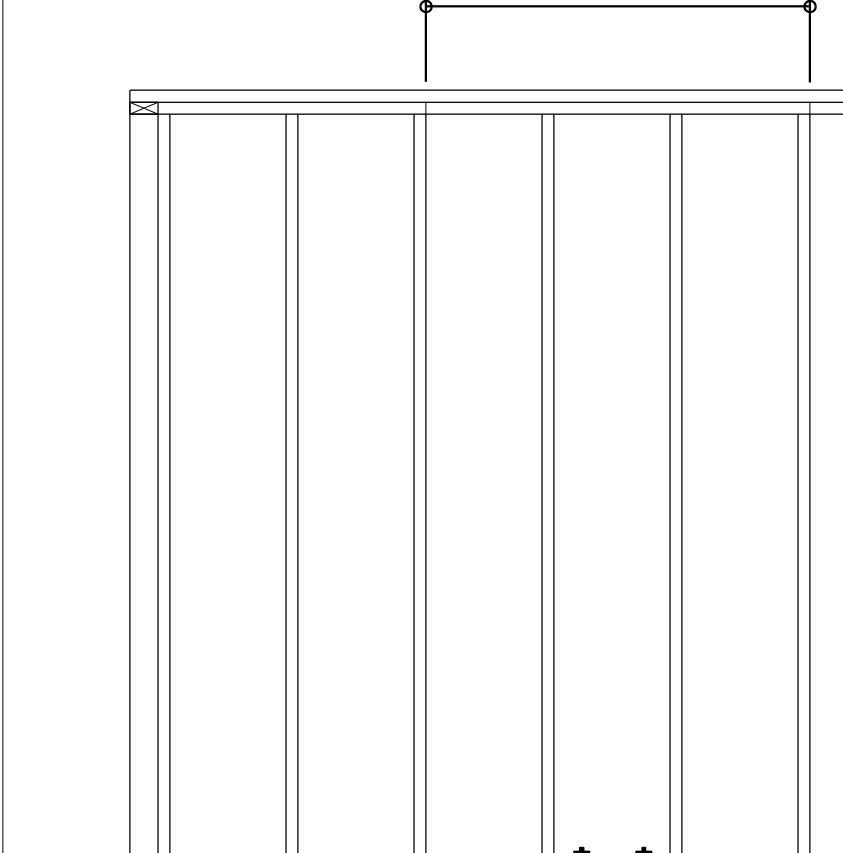


(TYP.) CORNER FRAMING
WOOD FRAME

MIN. 1/2" ANCHOR WITHIN 6" EACH SIDE OF PLATE JOINT

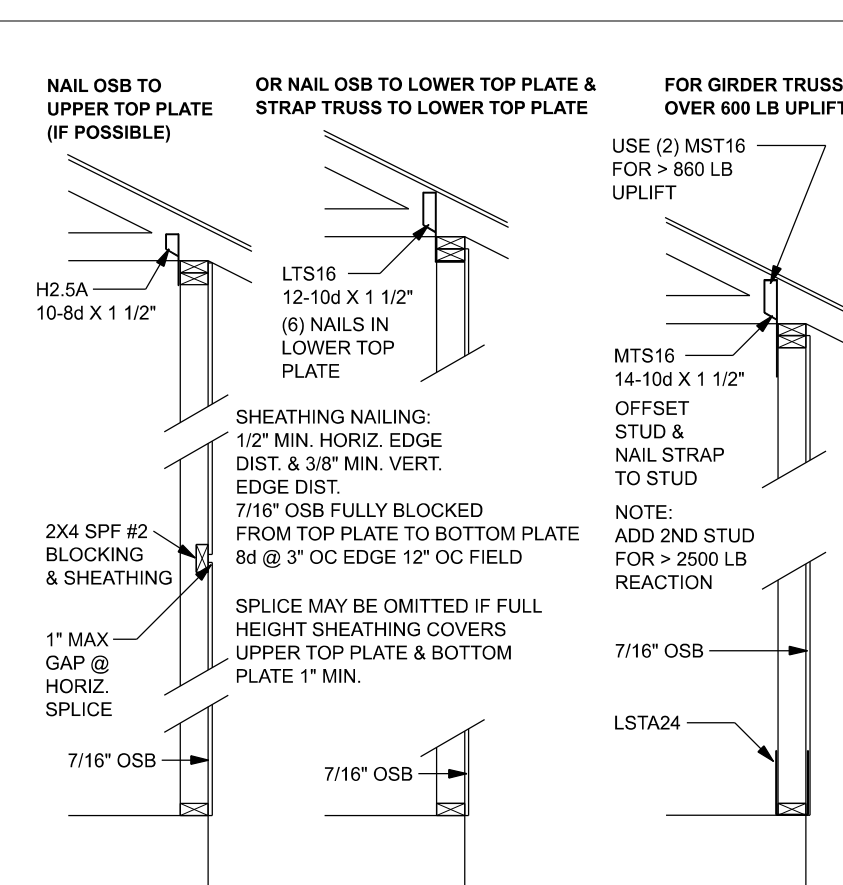


(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ RODS

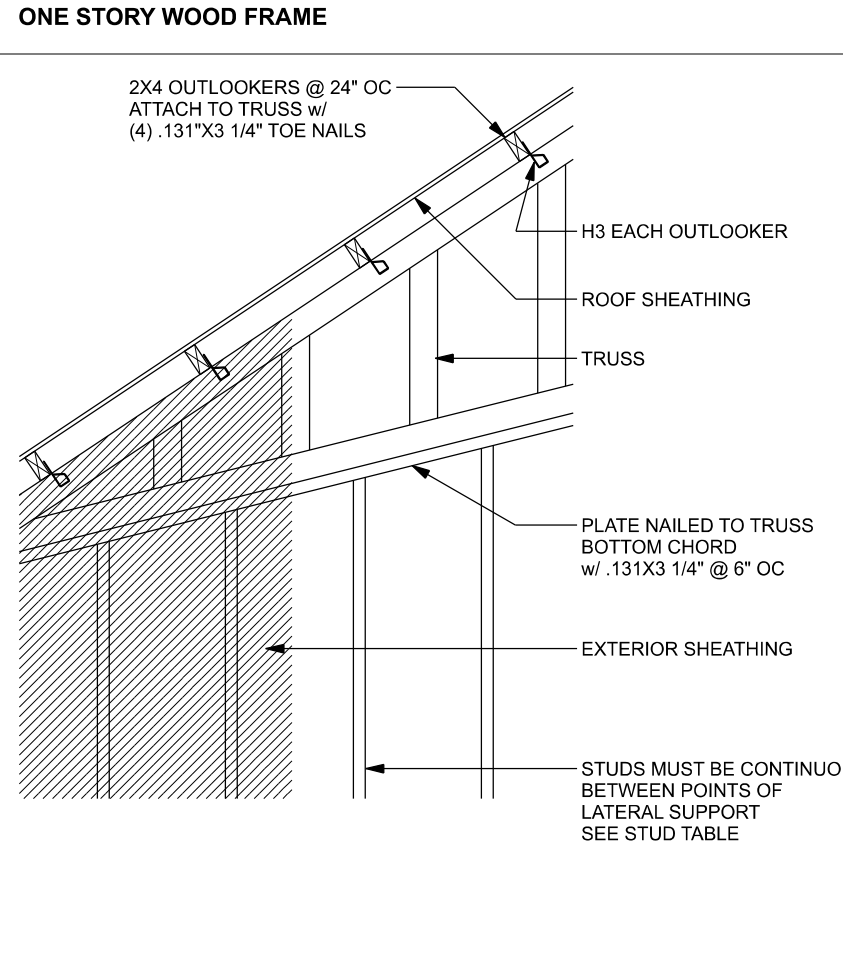

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

STUDS MUST BE CONTINUOUS BETWEEN POINTS OF LATERAL SUPPORT SEE STUD TABLE

OPTION: 1 (BUCKET) OPTION: 2 (POCKETED)

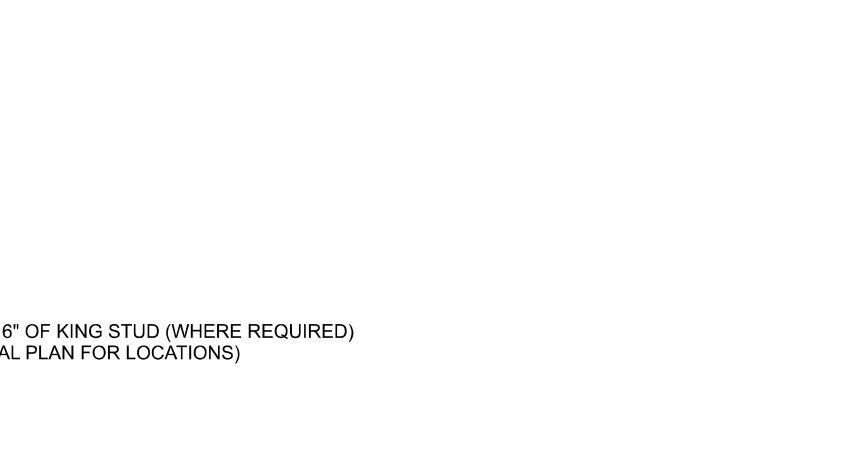

(TYP.) BEAM TO WALL
WOOD FRAME w/ RODS

ALLOWABLE UPLIFT: 1770 LB

NOTE: IF TRUSS TO BEAM STRAPS ARE NAILED TO BEAM SPL ARE NOT REQUIRED

NOTE: FULL HEIGHT 3/8" ROD IS NOT REQUIRED @ ENDS OF SHEARWALL WHERE THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

OPENING FORCE TRANSFER WOOD FRAME

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.


NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.


NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

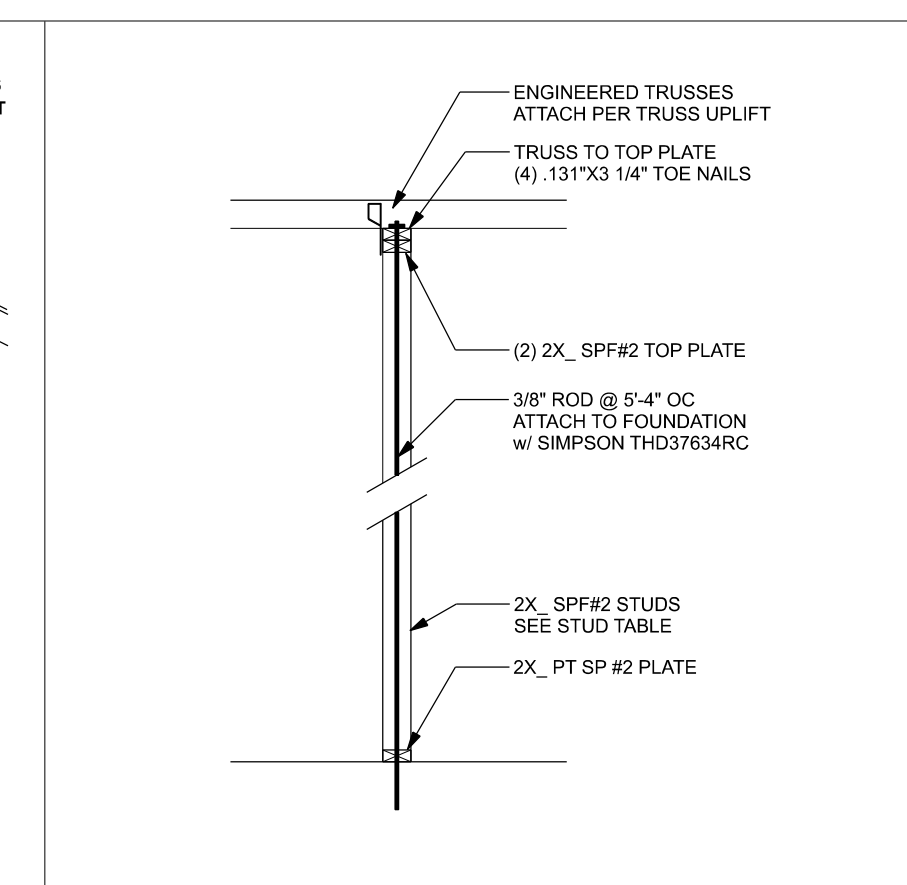


(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ RODS

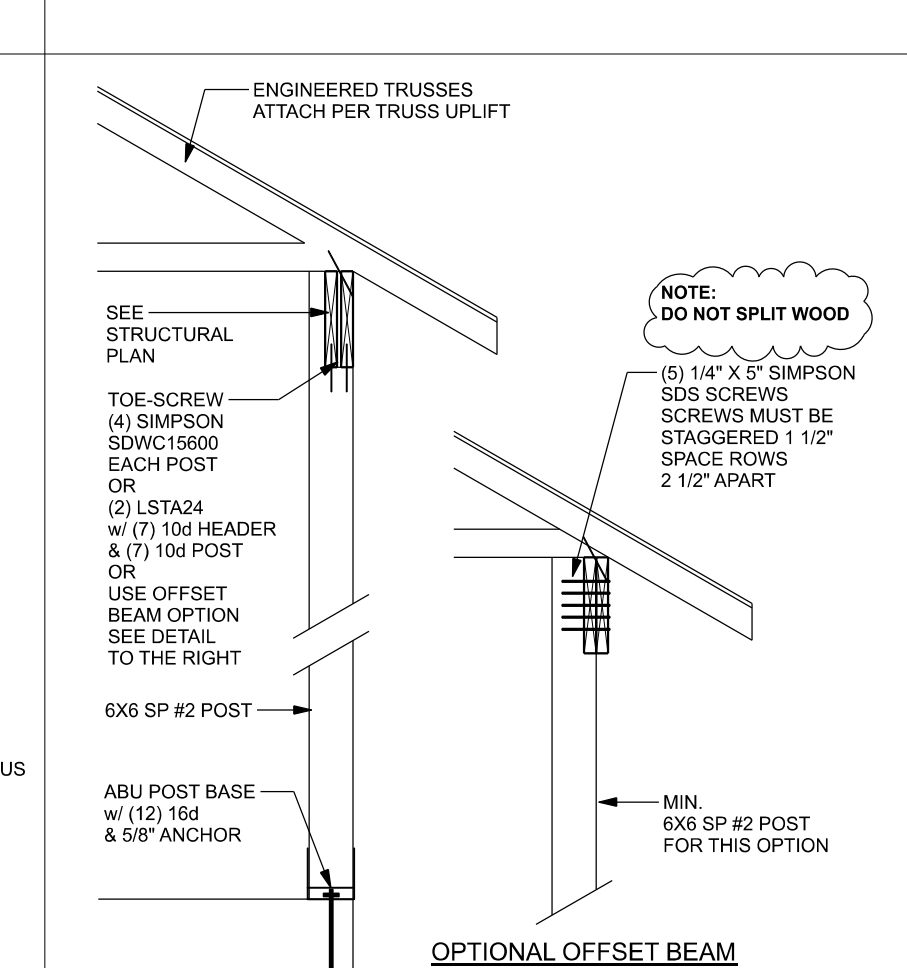

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

STUDS MUST BE CONTINUOUS BETWEEN POINTS OF LATERAL SUPPORT SEE STUD TABLE

OPTION: 1 (BUCKET) OPTION: 2 (POCKETED)

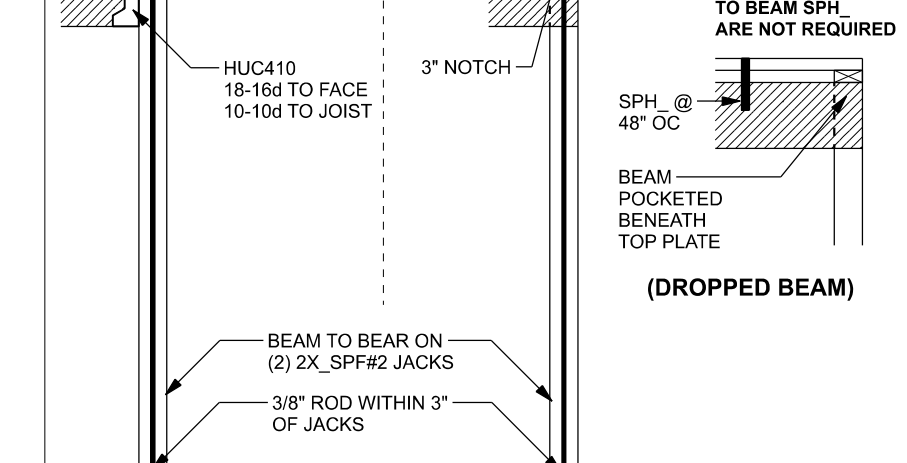

(TYP.) BEAM TO WALL
WOOD FRAME w/ RODS

ALLOWABLE UPLIFT: 1770 LB

NOTE: IF TRUSS TO BEAM STRAPS ARE NAILED TO BEAM SPL ARE NOT REQUIRED

NOTE: FULL HEIGHT 3/8" ROD IS NOT REQUIRED @ ENDS OF SHEARWALL WHERE THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

OPENING FORCE TRANSFER WOOD FRAME

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

Uplift SP Uplift SPF Truss Connector	To Plate	To Truss/Rafter
615 485 SDWC15600	-	-
415 290 H3	4-8dX1 1/2"	4-8dX1 1/2"
575 485 H2-5A	5-8dX1 1/2"	5-8dX1 1/2"
1345 1015 H10A	9-10d1 1/2"	9-10d1 1/2"
720 620 LTS12-20	6-10d1 1/2"	6-10d1 1/2"
1000 880 MTS12-30	7-10d1 1/2"	7-10d1 1/2"
1450 1245 HTS20-30	12-10d1 1/2"	12-10d1 1/2"
Uplift SP Uplift SPF Stud Ties	To One Member	To Other Member
1235 1235 LSTA21	8-10d	8-10d
1640 1455 MSTA24	9-10d	9-10d
1030 1030 CS20	7-10d	7-10d
Uplift SP Uplift SPF Stud Plate Ties	To Stud	To Plate
585 535 SP1	6-10d	4-10d
1055 605 SP2	6-10d	6-10d
771 771 LSTA24	10-10d	wrap under or over plate
1235 1235 LSTA24	14-10d	wrap under or over plate
Uplift SP Uplift SPF Holdowns @ Stenwall	To Stud / Post	Anchor
1825 1800 DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235 3640 HTT4	18-16dX2 1/2"	1/2"x12" Titen HD
Uplift SP Uplift SPF Holdowns @ Mono	To Stud / Post	Anchor
1825 1800 DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235 3640 HTT4	18-16dX2 1/2"	1/2"x12" Titen HD
Uplift SP Uplift SPF Post Bases @ Stenwall	To Post	Anchor
2200 ABU44	12-16d	5/8"x12" Drill & Epoxy
2300 ABU66	12-16d	5/8"x12" Drill & Epoxy
Uplift SP Uplift SPF Post Bases @ Mono	To Post	Anchor
2200 ABU44	12-16d	5/8"x7" Drill & Epoxy
2300 ABU66	12-16d	5/8"x7" Drill & Epoxy

EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS:

THIS STUD HEIGHT TABLE IS PER 2012 WFCM, TABLE 3.20B5, EXTERIOR LOAD BEARING & NON LOAD BEARING STUD LENGTHS FOR WALLS WITH OSB EXTERIOR AND 1/2" GYP INTERIOR RESISTING INTERIOR ZONE WINDLOADS, 130 MPH, EXPOSURE C, STUD DEFLECTION LIMIT H/240 (NOT OK FOR BRITTLE FINISH). STUD SPACINGS SHALL BE MULTIPLIED BY 0.8 FOR FRAMING LOCATED WITHIN 4 FEET OF CORNERS FOR END ZONE LOADING. (END ZONE EXAMPLE 16" O.C. x 0.8 = 12.8" O.C.)		
(1) 2x4 @ 16" OC	TO 10'-1" STUD HEIGHT	
(1) 2x4 @ 12" OC	TO 11'-2" STUD HEIGHT	
(1) 2x6 @ 16" OC	TO 15'-7" STUD HEIGHT	
(1) 2x6 @ 12" OC	TO 17'-3" STUD HEIGHT	

	SP #2	Fb	E
2x8	SP #2	925	1.4
2x10	SP #2	800	1.4
2x12	SP #2	750	1.4
GLB	24F-V3 SP	2600	1.9
LSL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2950	2.0
PSL	PARALAM	2900	2.0



(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & AB

NOTE: HAVE TRUSS DESIGNER LOAD TRUSS FOR 400 PLF DRAG LOAD

INTERIOR SHEAR WALL

ONE STORY WOOD FRAME w/ STRAPS & AB

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BEHIND THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT FOR WINDOWS NOT GREATER THAN 2' HIGHT OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.


GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP-2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 415LB EACH END, 2X4 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN. FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1500 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE).


CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F_c = 2500 PSI. WELDED WIRE REINFORCED SLAB 6" x 8" W14 x W14, FB = 80ksi, WELDED WIRE REINFORCEMENT FABRIC (W.W.M.) CONFORMING TO ASTM A185, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

F

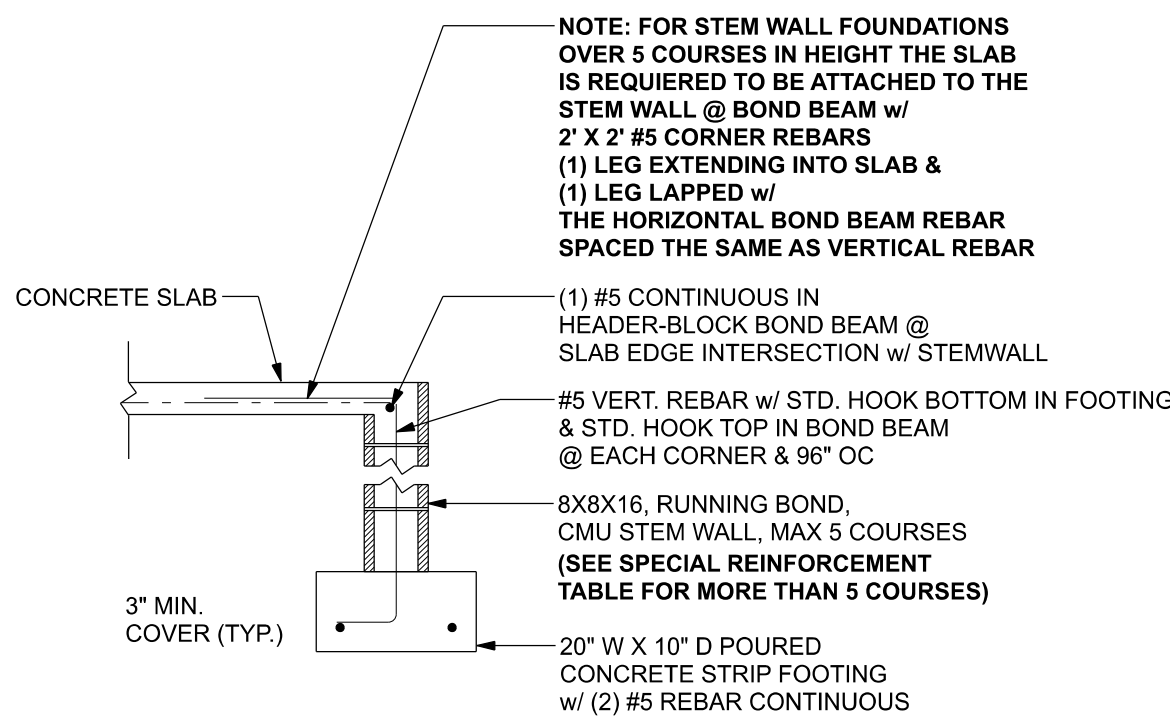


F1
S-2 STEM WALL FOOTING
SCALE: 1/2" = 1'-0"

BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL

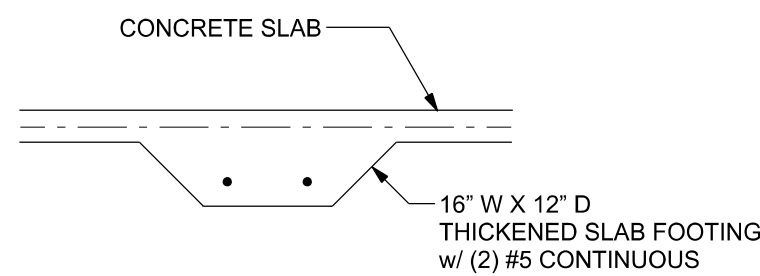


F2
S-2 INTERIOR BEARING FOOTING
SCALE: 1/2" = 1'-0"

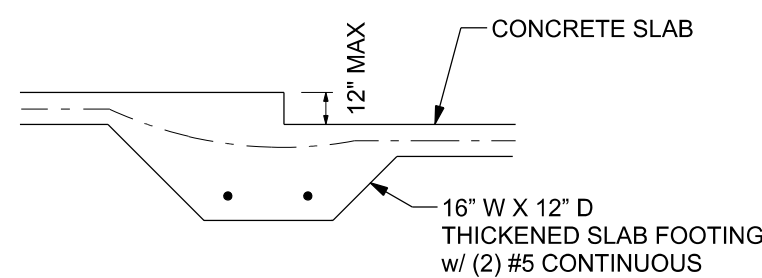

F3
S-2 INTERIOR BEARING STEP FOOTING
SCALE: 1/2" = 1'-0"

TALL STEM WALL TABLE:							
The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Duowall ladder reinforcement at 16" OC vertically or a horizontal bond beam with 1#5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.							
STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

MASONRY NOTE:		
MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.		
ACI 530.1-02 Section	Specific Requirements	
1.4A	Compressive strength	8" block bearing walls F _m = 1500 psi
2.1	Mortar	ASTM C 270, Type N, UNO
2.2	Grout	ASTM C 476, admixtures require approval
2.3	CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3	Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"
2.4	Reinforcing bars, #3 - #11	ASTM 615, Grade 40, F _y = 40 ksi, Lap splices min 40 bar dia. (25" for #5)
2.4F	Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A425, Class G60, 0.60 oz/lb or 30MSS
2.4F	Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class B2, 1.50 oz/lb or 30MSS
3.3.E.2	Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7	Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.

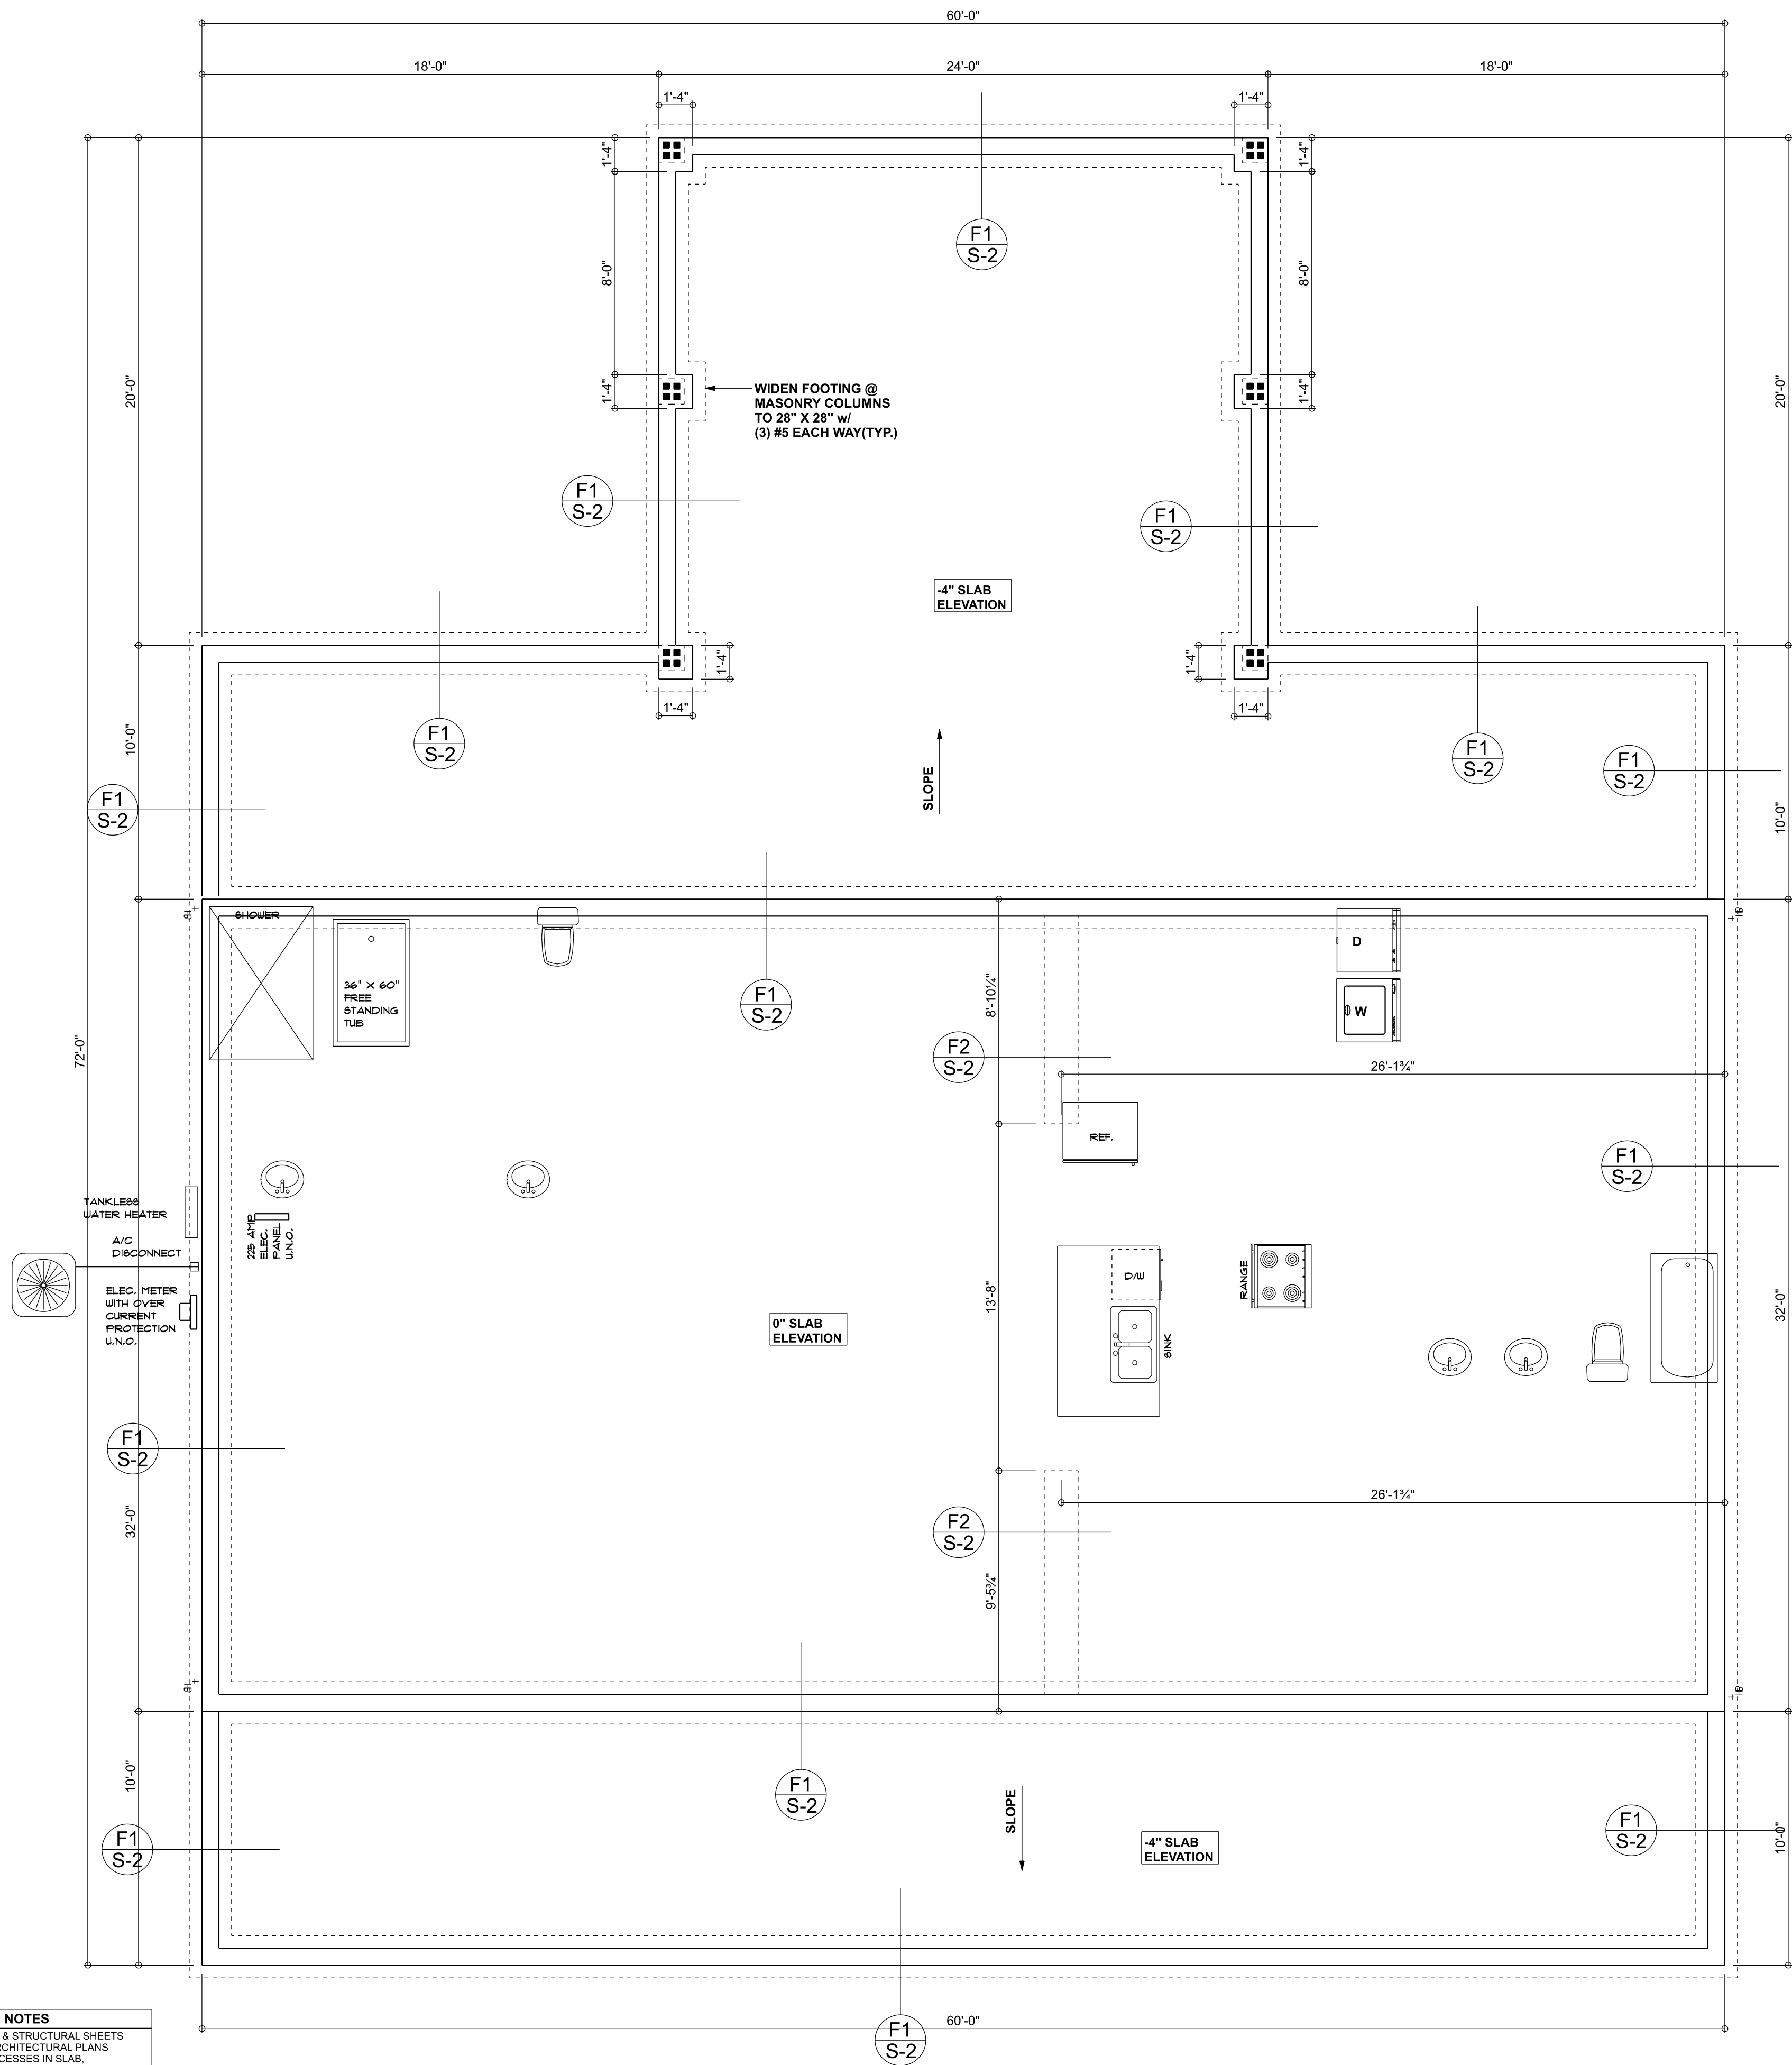

FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, STEP DOWNS, ETC. DISOSWAY DESIGN GROUP OR MARK DISOSWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING WALL AREAS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN.
FN - 3	THE SLAB SHALL BE 4" CONCRETE SLAB REINFORCED w/ 8061 4#14 WELDED WIRE MESH PLACED ON CHAIRS @ 1 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SCALED w/ POLY TAPE OVER TERMITE-TREATED & COMPACTED FILL.

Blake Construction

Platt Res.

PROJECT ADDRESS:
Lake City, FL

DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915

THIS PDF HAS DIGITAL SIGNATURE AND ELECTRONIC SEAL. PRINTED COPIES ARE NOT CONSIDERED SIGNED OR SEALED. YOU MUST VERIFY SIGNATURE ON THIS PDF. [CLICK HERE TO VERIFY.](#)




Friday, August 5, 2022

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
220550


S-2
OF 7 SHEETS

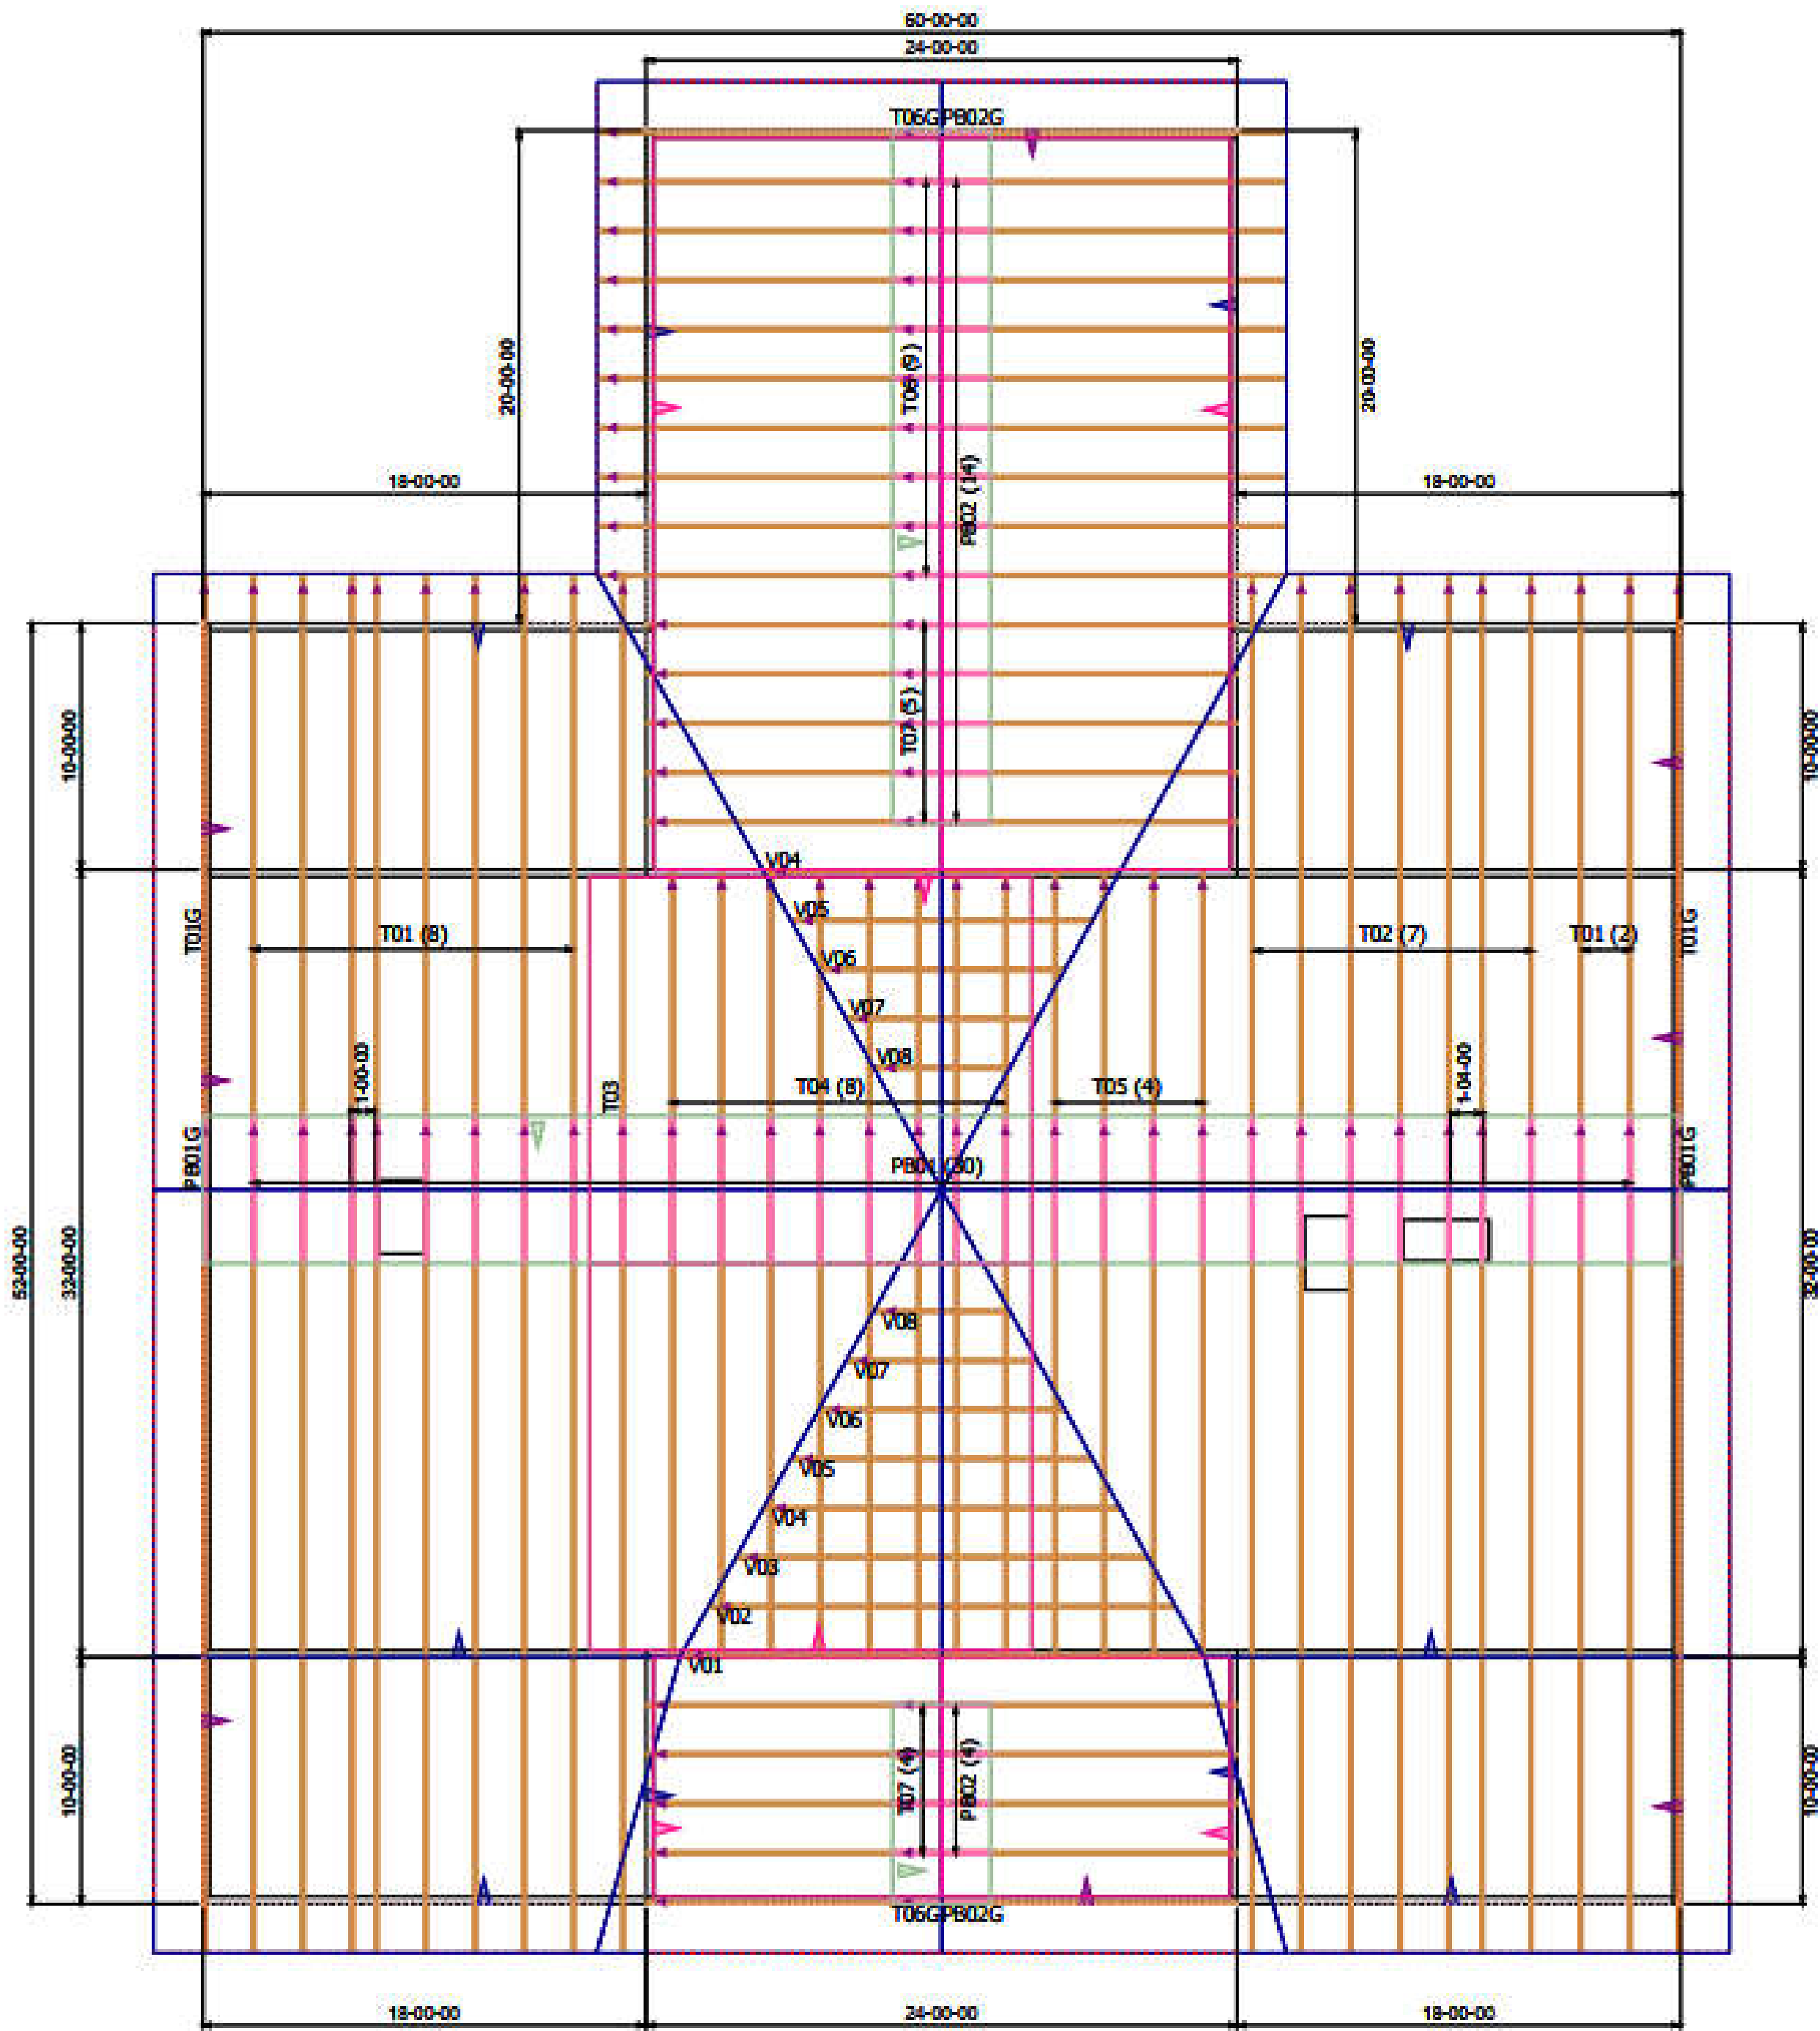



STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 USE ONE JACK STUD GIRDER SUPPORT PER 2500 LB LOAD
- SN-4 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-5 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI-03. BCSI-B1, BCSI-B2, & BCSI-B3 BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

HEADER LEGEND

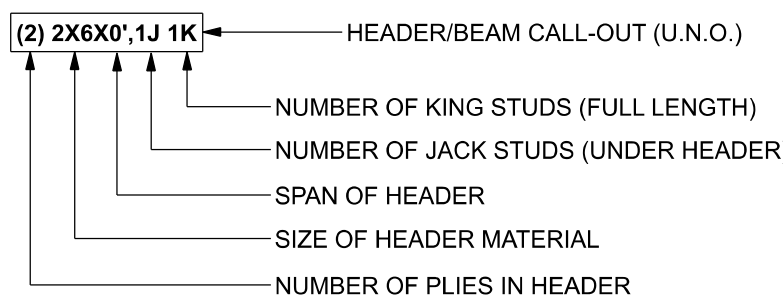

THREADED ROD LEGEND

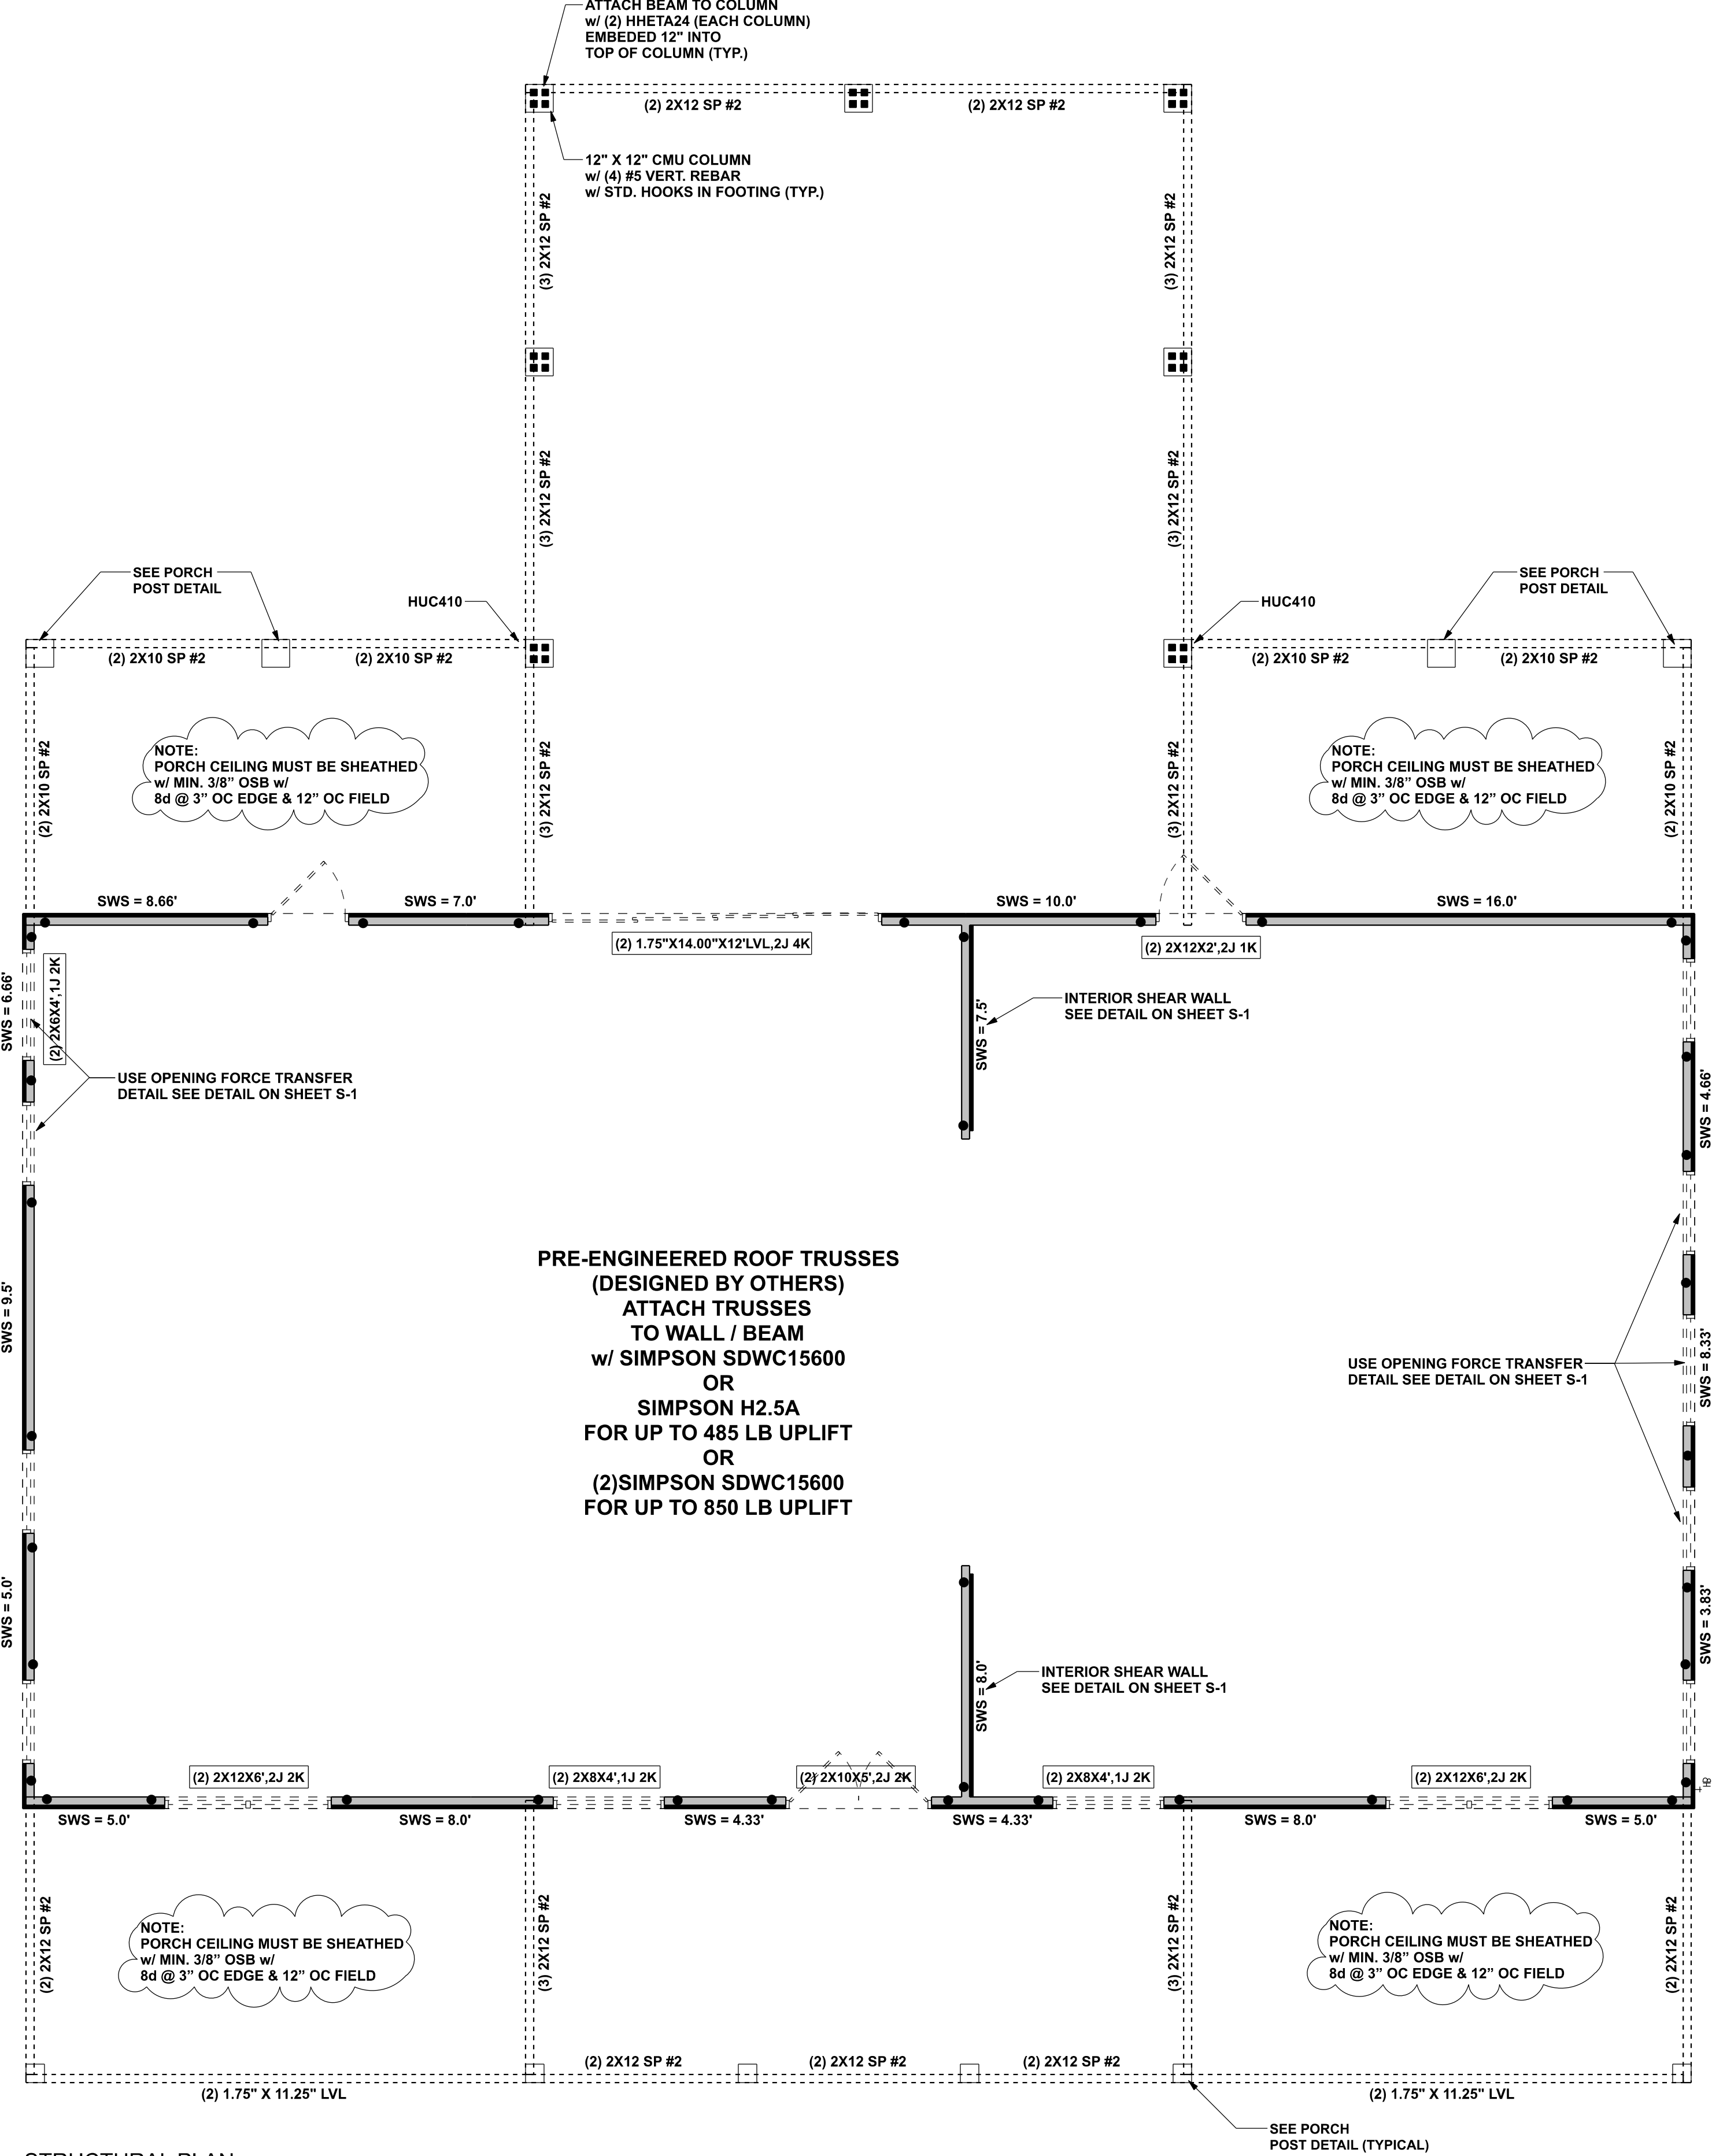

STRUCTURAL PLAN

SCALE: 1/4" = 1'-0"

ACTUAL vs REQUIRED SHEARWALL		
	TRANSVERSE	LONGITUDUNAL
ACTUAL	18183 LBF	18316 LBF
REQUIRED	17595 LBF	17550 LBF

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER, BUILDERS FIRST SOURCE JOB #3236478

Blake Construction

Platt Res.

PROJECT ADDRESS:
Lake City, FL

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915

THIS PDF HAS DIGITAL SIGNATURE AND ELECTRONIC SEAL. PRINTED COPIES ARE NOT CONSIDERED SIGNED OR SEALED. YOU MUST VERIFY SIGNATURE ON THIS PDF. [CLICK HERE TO VERIFY.](#)



Friday, August 5, 2022

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
220550

S-3
OF 7 SHEETS