

TYPICAL DESIGN WALL SECTION  
NON - STRUCTURAL DATA

SCALE: 1" = 1'-0"



FRONT ELEVATION

SCALE: 1/4" = 1'-0"



REAR ELEVATION

SCALE: 1/4" = 1'-0"



RIGHT ELEVATION

SCALE: 1/4" = 1'-0"



LEFT ELEVATION

SCALE: 1/4" = 1'-0"

ROOF VENT / ACCESS NOTES:

REQUIRED ATTIC ACCESS:  
BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE ATTIC ACCESS OPENING TO ATTIC AREAS THAT EXCEED 30 SQUARE FEET AND HAVE A VERTICAL HEIGHT OF 30" OR GREATER. THE VERTICAL HEIGHT SHALL BE MEASURED FROM THE TOP OF THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS. THE ROUGH-FRAMED OPENING SHALL NOT BE LESS THAN 22" X 30" AND SHALL BE LOCATED IN A HALLWAY OR OTHER READILY ACCESSIBLE LOCATION. WHEN LOCATED IN A WALL, THE OPENING SHALL BE A MIN. OF 22" WIDE X 30" HIGH. WHEN THE ACCESS IS LOCATED IN A CEILING, MIN. UNOBSTRUCTED HEADROOM IN THE ATTIC SPACE SHALL BE 30" AT SOME POINT ABOVE THE ACCESS MEASURED VERTICALLY FROM THE BOTTOM OF CEILING FRAMING MEMBERS.  
SEE SECTION M1305.1.3 FROM ACCESS REQUIREMENTS WHERE MECHANICAL EQUIPMENT IS LOCATED IN ATTICS

REQUIRED ROOF VENTILATION:  
ENCLOSED ATTIC AND ENCLOSED RAFTER SPACES FROMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS SHALL HAVE CROSS VENTILATION FOR EACH SEPARATE SPACE BY VENTILATING OPENING PROTECTED AGAINST THE ENTRANCE OF RAIN. VENTILATION OPENINGS SHALL HAVE A LEAST DIMENSION OF 1 1/8" MIN. AND 1 1/4" MAX. VENTILATION OPENINGS HAVING A LEAST DIMENSION LARGER THAN 1 1/4" SHALL BE PROVIDED WITH CORROSION-RESISTANT WIRE CLOTH SCREENING, HARDWARE CLOTH, OR SIMILAR MATERIAL WITH OPENINGS HAVING A LEAST DIMENSION OF 1 1/8" MIN. AND 1 1/4" MAX. OPENINGS IN ROOF FRAMING MEMBERS SHALL CONFORM TO THE REQUIREMENTS OF SEC. R902.1.5. REQUIRED VENTILATION OPENINGS SHALL OPEN DIRECTLY TO OUTSIDE AIR.

MINIMUM ROOF VENT AREA:  
THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/150 OF THE AREA OF THE VENTED SPACE.  
EXCEPTION: THE MINIMUM NET FREE VENTILATION AREA SHALL BE 1/300 OF THE VENTED SPACE PROVIDED ONE OR MORE OF THE FOLLOWING CONDITIONS ARE MET:  
1. IN CLIMATE ZONES 6, 7 AND 8, A CLASS I OR II VAPOR RETARDER IS INSTALLED ON THE WARM-IN WINTER SIDE OF THE CEILING.  
2. AT LEAST 40 PERCENT AND NOT MORE THAN 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE ATTIC OR RAFTER SPACE. UPPER VENTILATORS SHALL BE LOCATED NO MORE THAN 3 FEET BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE. MEASURED VERTICALLY WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS. WHERE THE LOCATION OF WALL OR ROOF FRAMING MEMBERS CONFLICTS WITH THE INSTALLATION OF UPPER VENTILATORS, INSTALLATION MORE THAN 3 FEET BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE SHALL BE PERMITTED.

ROR PRATA  
RESIDENCE

PROJECT ADDRESS:  
824 SW Highland Terr  
Columbia County, Florida


DIMENSIONS:  
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Dsosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:  
Mark Dsosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments & service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Dsosway.

CERTIFICATION: hereby certify that I have examined this plan and that the applicable portions of the plan relating to wind engineering comply with the 2017 Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DSOSWAY P.E. 53915

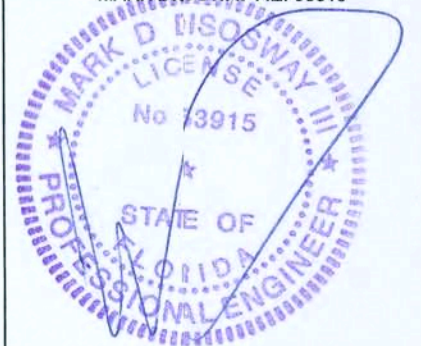


Tuesday, September 25, 2018

Mark Dsosway P.E.  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386754.5419  
disoswaydesign@gmail.com

JOB NUMBER:  
131003

41  
OF 6 SHEETS



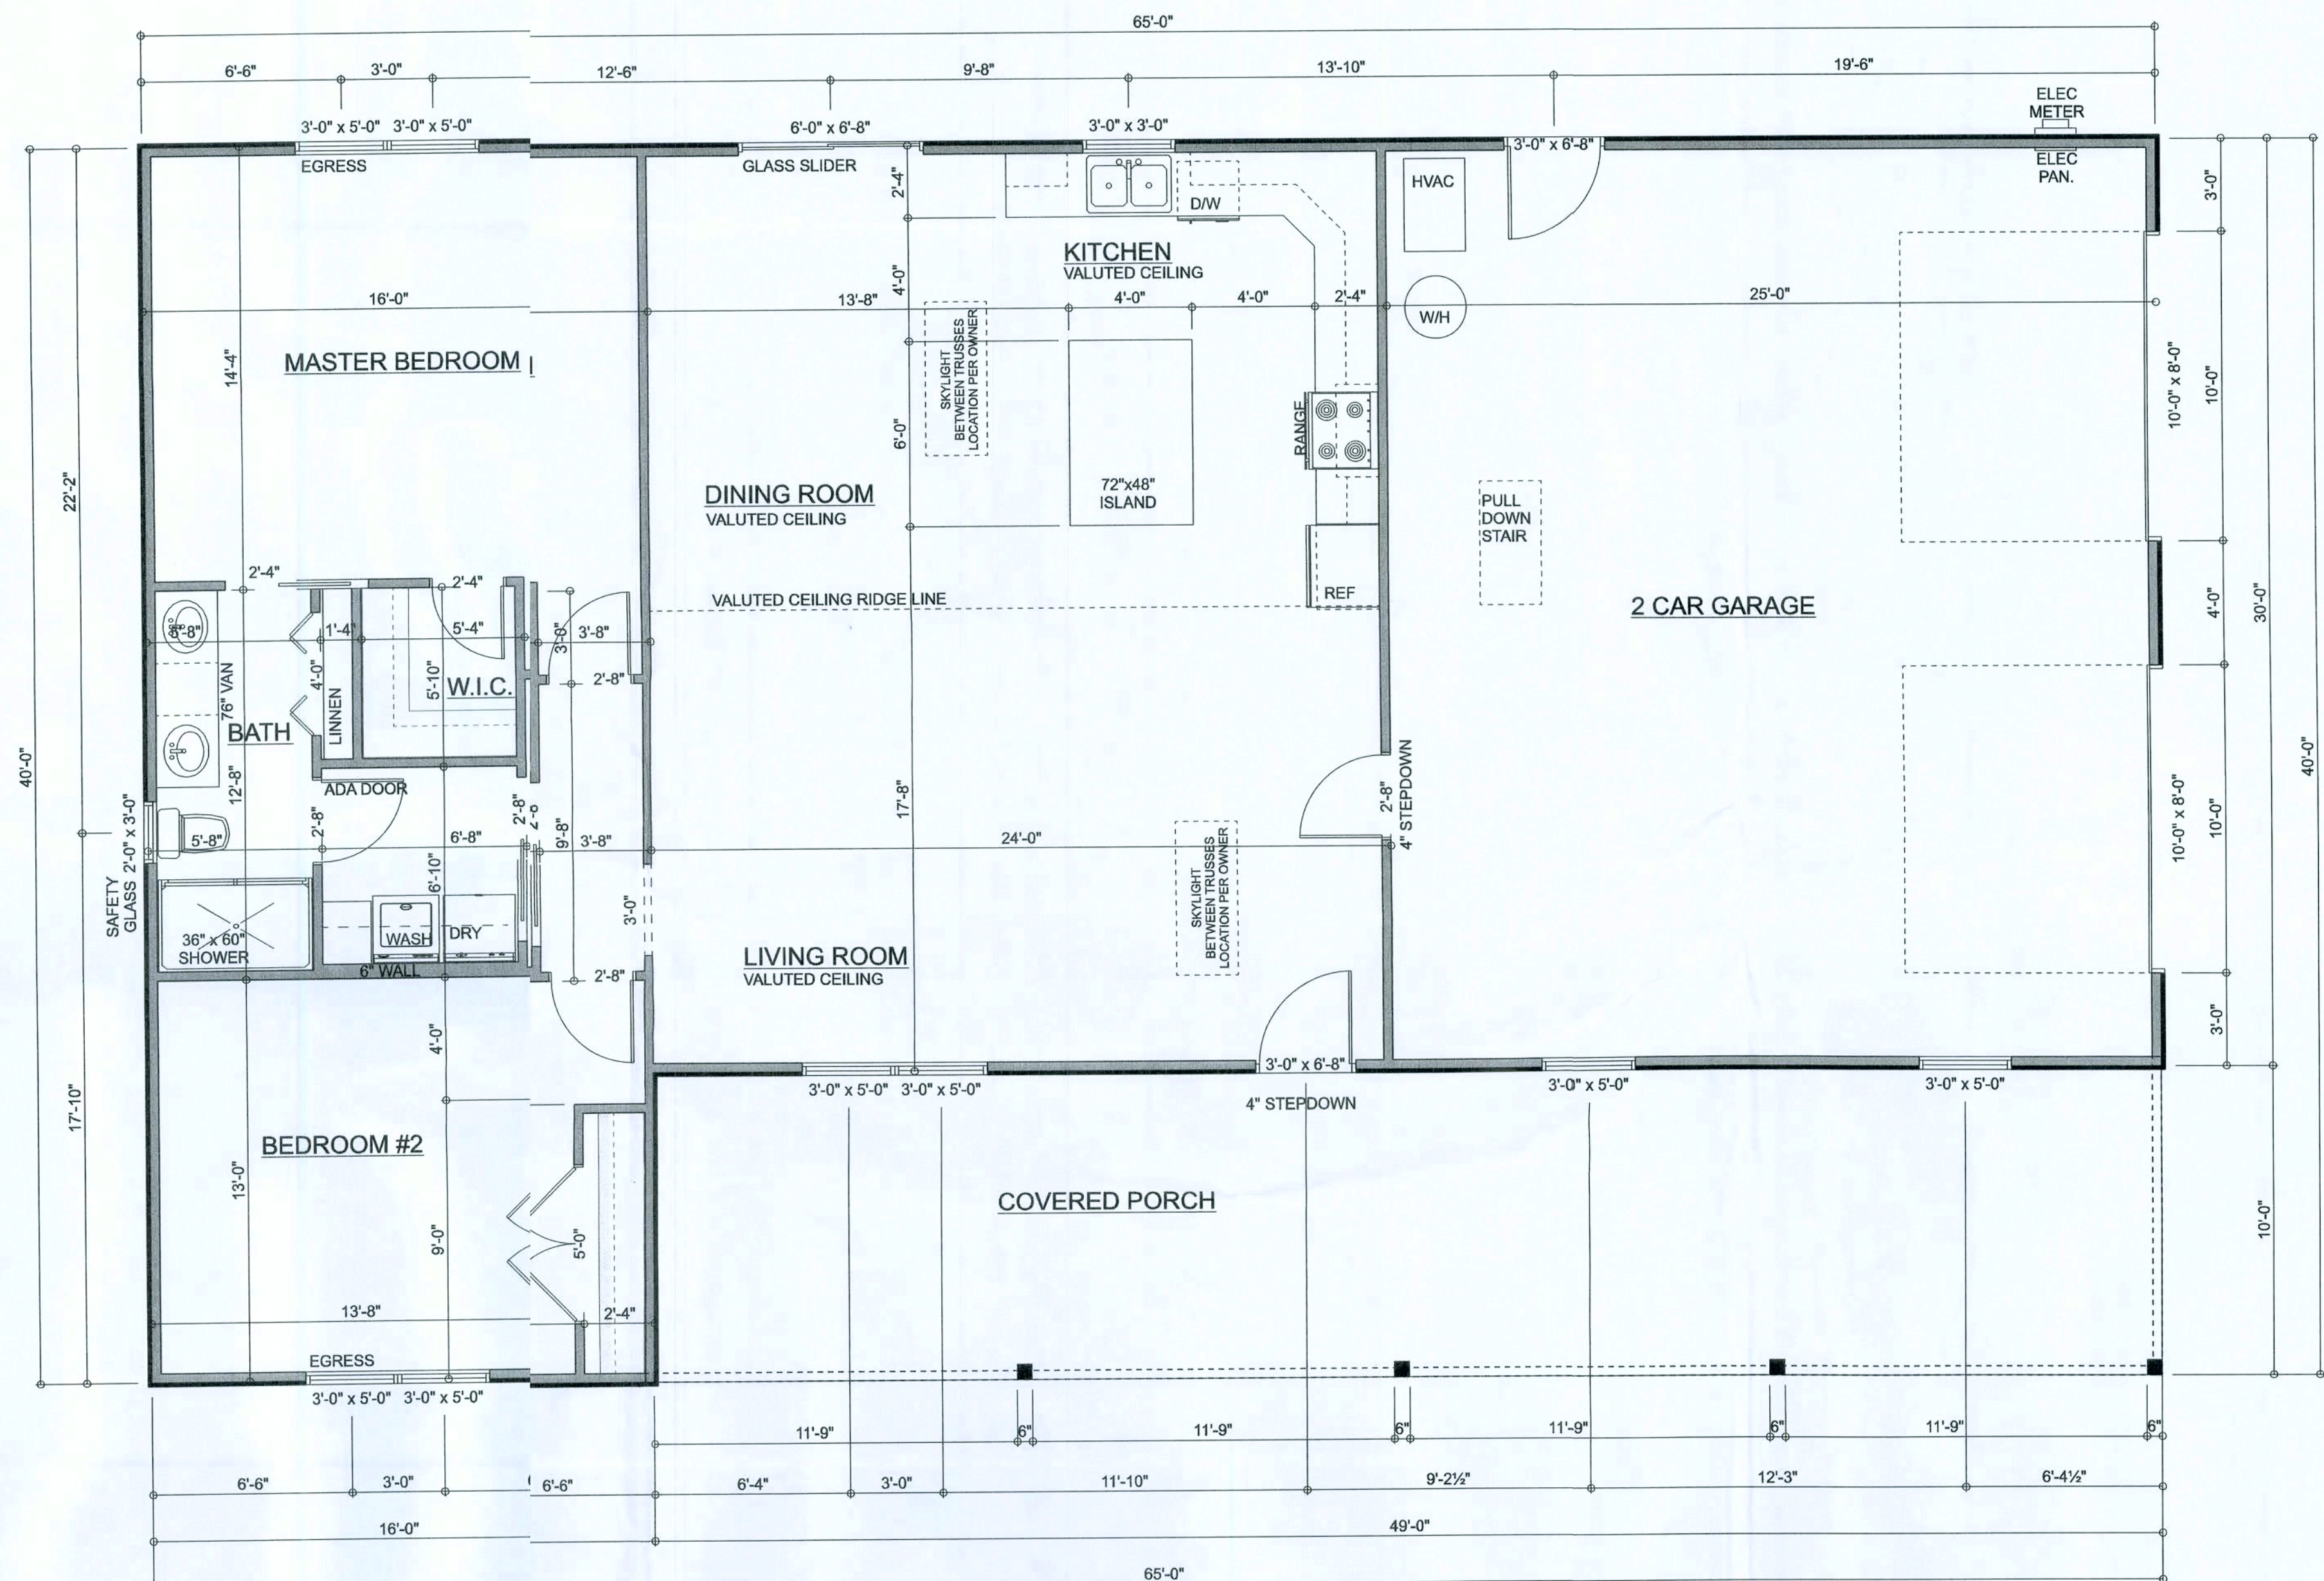

MAIN FLOOR LAYOUT

SCALE: 1/4" = 1'-0"  
ALL CEILING ARE 9'-0" FLAT  
UNLESS NOTED OTHERWISE

AREA TABLE:	
LIVING AREA =	1351 FT2
GARAGE AREA =	759 FT2
PORCH AREA =	490 FT2
TOTAL AREA =	2600 FT2

**R302.5.1 Opening protection:**  
Openings from a private garage directly into a room used for sleeping purposes shall not be permitted. Other openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches in thickness, solid or honeycomb-core steel doors not less than 1 3/8 inches thick, or 20-minute fire-rated doors, equipped with a self-closing device.

TABLE R302.6 DWELLING/GARAGE SEPARATION:	
SEPARATION	MATERIAL
From the residence and attics	Not less than 1/2-inch gypsum board or equivalent applied to the garage side
From all habitable rooms above the garage	Not less than 5/8-inch Type X gypsum board or equivalent
Structure(s) supporting floor/ceiling assemblies used for separation required by this section	Not less than 1/2-inch gypsum board or equivalent
Garages located less than 3 feet from a dwelling unit on the same lot	Not less than 1/2-inch gypsum board or equivalent applied to the interior side of exterior walls that are within this area

FOR PRATA  
RESIDENCE

PROJECT ADDRESS:  
824 SW Highland Terr  
Lake City, FL 32025  
Columbia County, Florida


**DIMENSIONS:**  
Stated dimensions are per scaled dimensions. Refer all questions to Mark Disosway, P.E., for resolution. Do not proceed without clarification.

**COPYRIGHTS AND PROPERTY RIGHTS:**  
Mark Disosway, P.E., hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

**CERTIFICATION:** hereby certify that I have examined this plan and that the applicable portions of the plan, relating to wind engineering comply with the 6th Edition Florida Building Code Residential (2017) to the best of my knowledge.

**LIMITATION:** This design is valid for one building, at specified location.

MARK DISOSWAY-PE, 53915

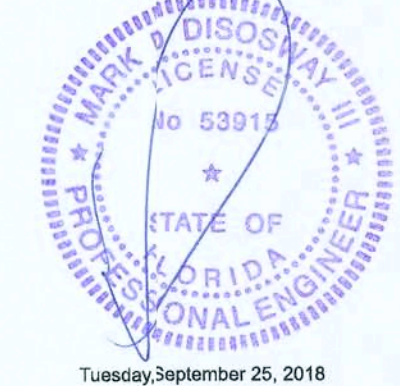

**Mark Disosway P.E.**  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
381.754.5419  
disoswaydesign@gmail.com

JOB NUMBER:


#81003

#2  
OF 6 SHEETS



ELECTRICAL PLAN NOTES:	
E-1	WIRE ALL APPLIANCES, HVAC UNITS AND OTHEEQUIPMENT PER MANUF. SPECIFICATIONS.
E-2	CONSULT THE OWNER FOR THE NUMBER OF SERATE TELEPHONE LINES TO BE INSTALLED.
E-3	ALL INSTALLATIONS SHALL BE PER NATH. ELERIC CODE.
E-4	ALL SMOKE DETECTORS SHALL BE 120V W BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND ALL BE INTERLOCKED TOGETHER. INSTALL INSIDEND NEAR ALL BEDROOMS.
E-5	TELEPHONE, TELEVISION AND OTHER LOW VORAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W APPLICABL SECTIONS OF NEC-LATEST EDITION.
E-6	ELECTRICAL CONTR SHALL BE RESPONSIBLE R THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
E-7	ENTRY OF SERVICE ( UNDERGROUND OR OVEHEAD ) TO BE DETERMINED BY POWER COMPANY.
E-8	ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLINGNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENs, BEDROOMS, SUN ROOMS, RECREATION ROOMS, CLOSETS, ALLWAYS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY ASD ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE INSTALLED PROVIDE PROTECTION OF THE BRANCH CIRCUIT.
E-9	ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION.
E-10	A SERVICE DISCONNECT WITH OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDG. ON THE LOAD SIDE OF THE METER, AT THE PLACE ELERIC CONDUCTORS ENTER THE BUILDING. SERVICE ENTRANCE CONDUCTORS MAY NOT ILOCATED INSIDE OF THE OF THE BUILDING WITHOUT SPIAL APPROVAL OF THE BUILDING OFFICIAL.
E-11	CARBON MONOXIDE ALARMS SHALL BE REQURED WITHIN 10' OF ALL ROOMS FOR SLEEPING PURPOSES IN ELIDINGS HAVING A FOSSIL FUEL-BURNING HEATER OR APPLIAN, A FIREPLACE, OR ATTACHED GARAGE.
E-12	ALL OUTLETS LOCATED IN RESIDENTIAL TO BE TAMPER-RESISTANT PER NEC.
E-13	A MINIMUM OF 75% OF PERMANENTLY INSTALD LAMPS OR LIGHTING FIXTURES SHALL BE HIGH EFFICACY114 FSC EC SEC. RM04.1

ELECTRICAL LEGEND	
	CEILING FAN (PRE-WIRE FOR LIGHT KIT)
	DOUBLE SECURITY LIGHT
	2X4 FLUORESCENT LIGHT FIXTURE
	RECESSED CAN LIGHT
	BATH EXHAUST FAN WITH LIGHT
	BATH EXHAUST FAN
	LIGHT FIXTURE
	DUPLEX OUTLET
	220v OUTLET
	GFI DUPLEX OUTLET
	SMOKE DETECTOR
	WALL SWITCH
	3 WAY WALL SWITCH
	4 WAY WALL SWITCH
	WATER PROOF GFI OUTLET
	PHONE JACK
	TELEVISION JACK
	GARAGE DOOR OPENER
	CARBON MONOXIDE ALARM

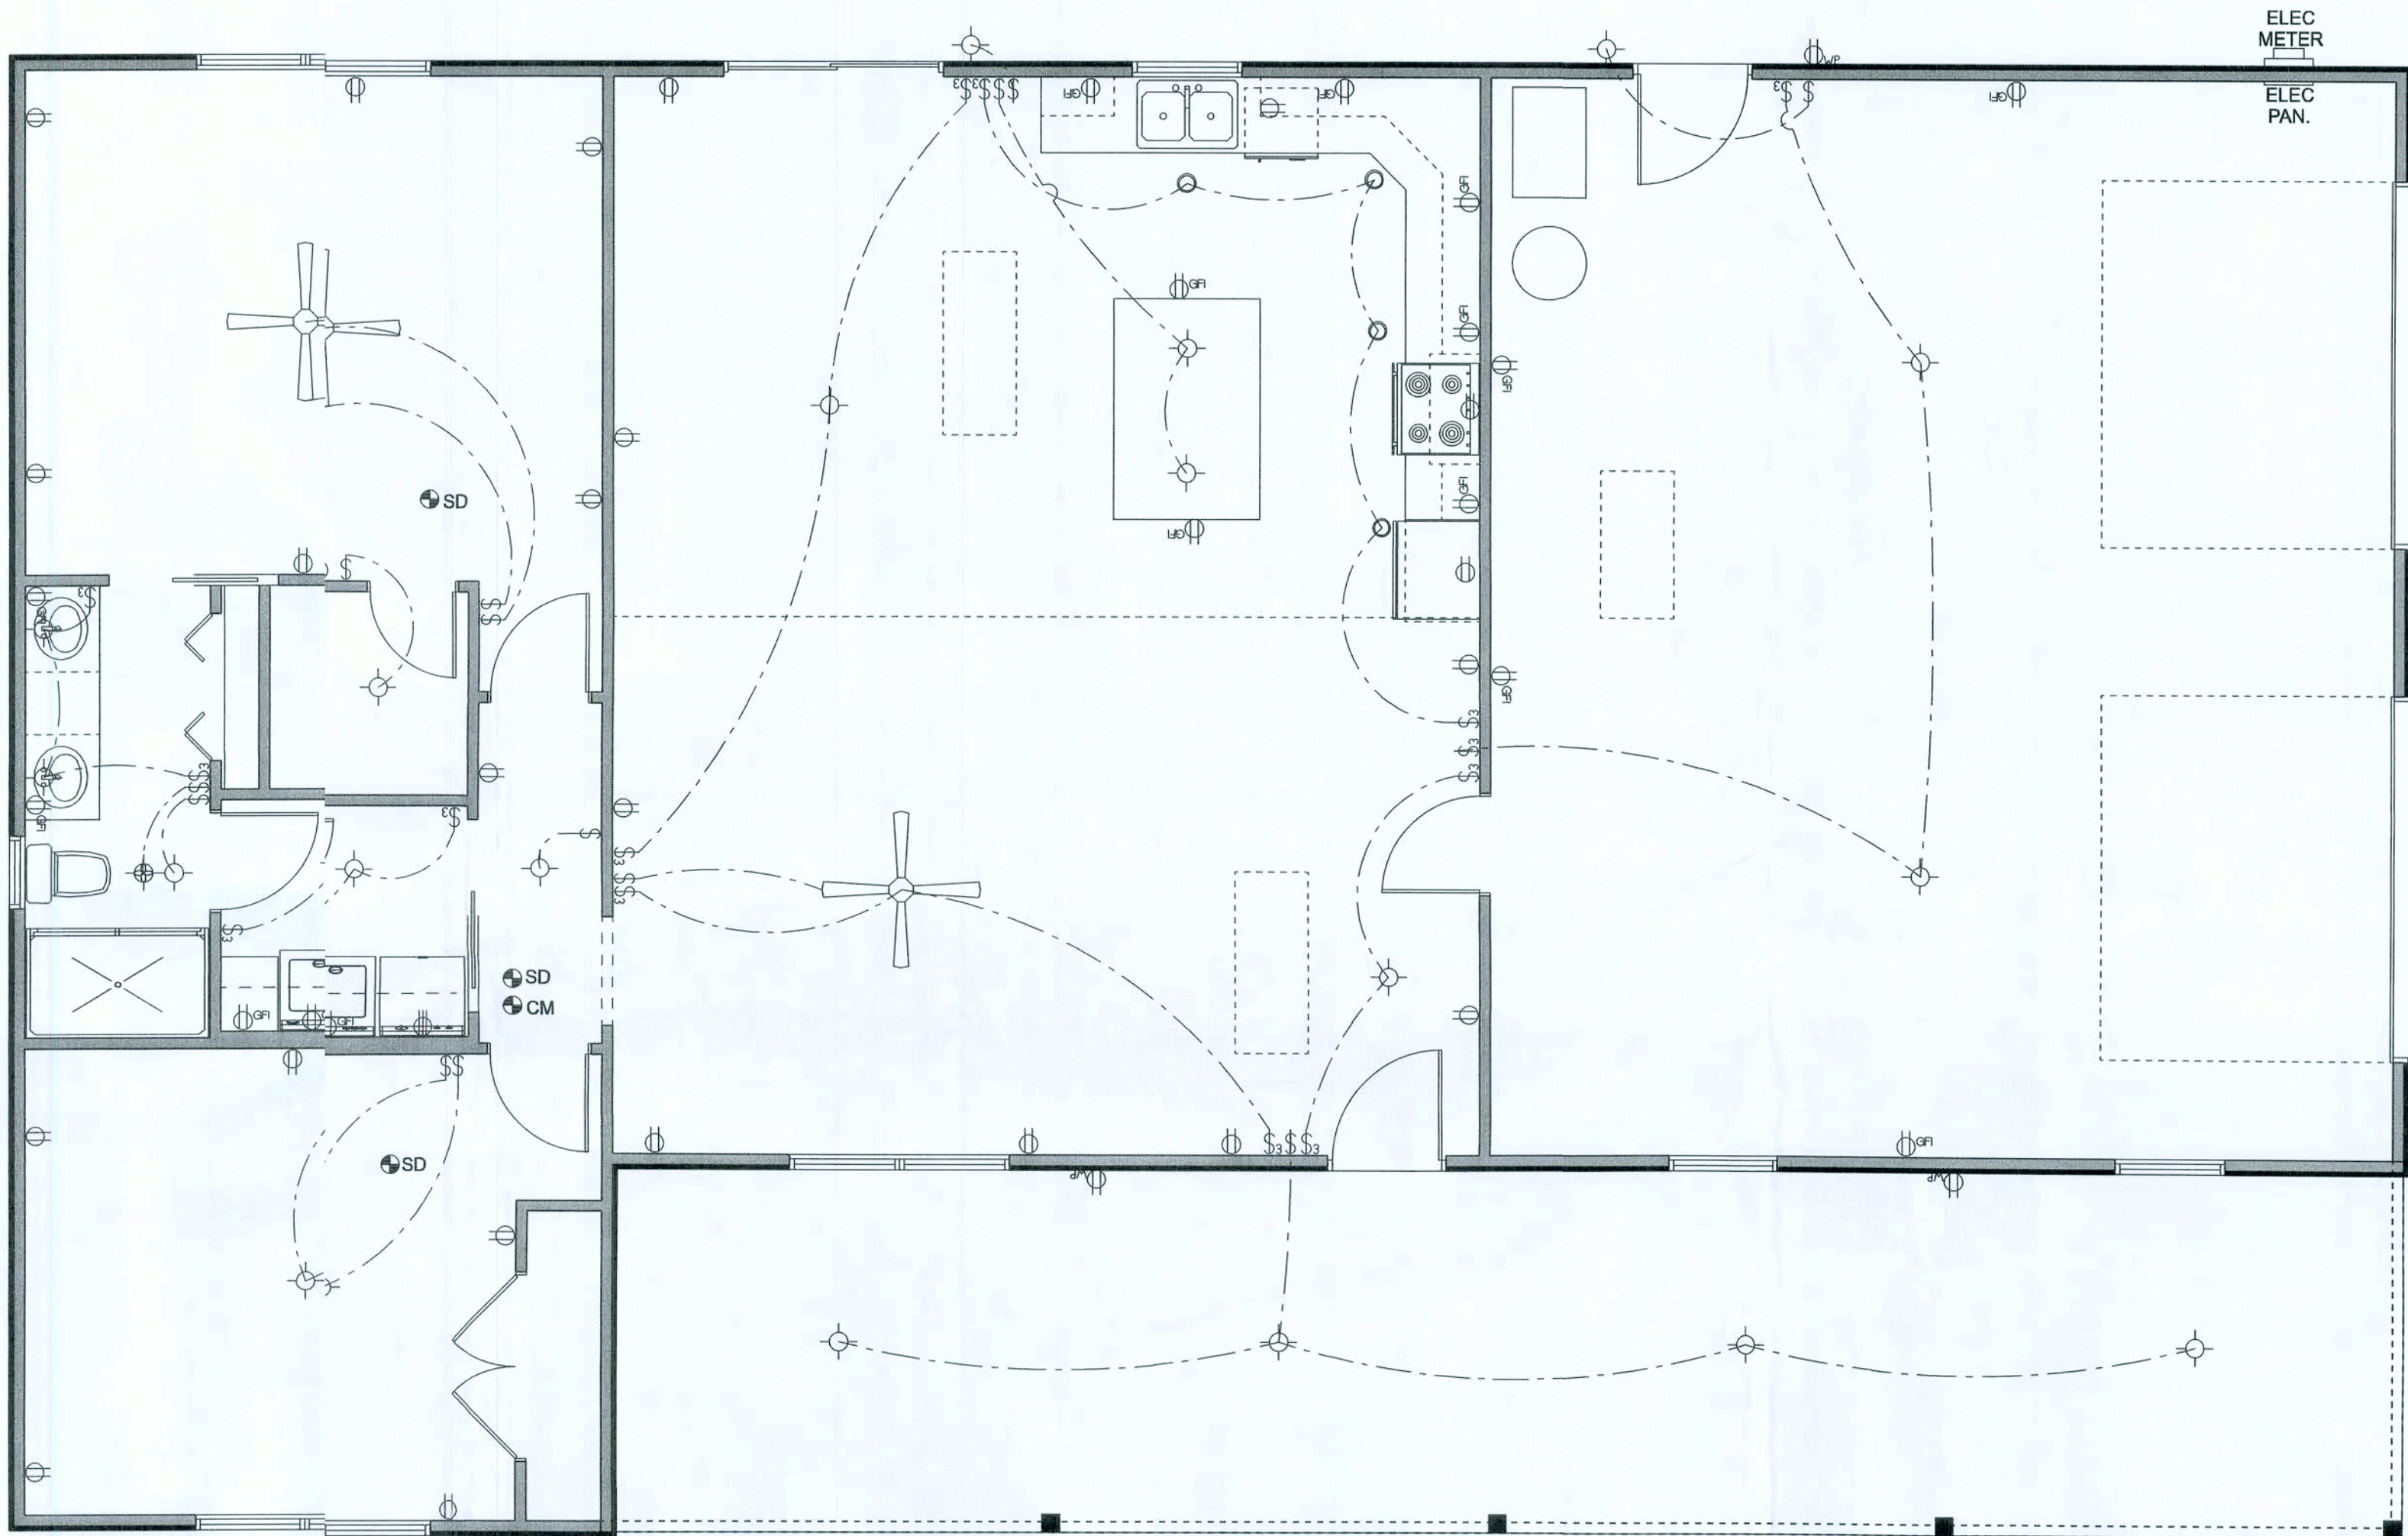

ELECTRICAL PLAN  
SCALE: 1/4" = 1'-0"

ROR PRATA  
RESIDENCE


PROJECT ADDRESS:  
524 SW Highland Terr  
Lake City  
Columbia County, Florida

DIMENSIONS:  
Stated dimensions are per code scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:  
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: hereby certify that I have examined this plan and that the applicable portions of the plan relating to wind engineering comply with the 6th Edition Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

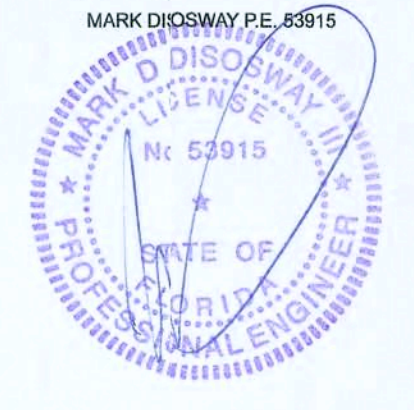


Tuesday, September 25, 2018


Mark Disosway P.E.  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386754.5419  
disoswaydesign@gmail.com

JOB NUMBER:  
131003  
#3  
OF 6 SHEETS




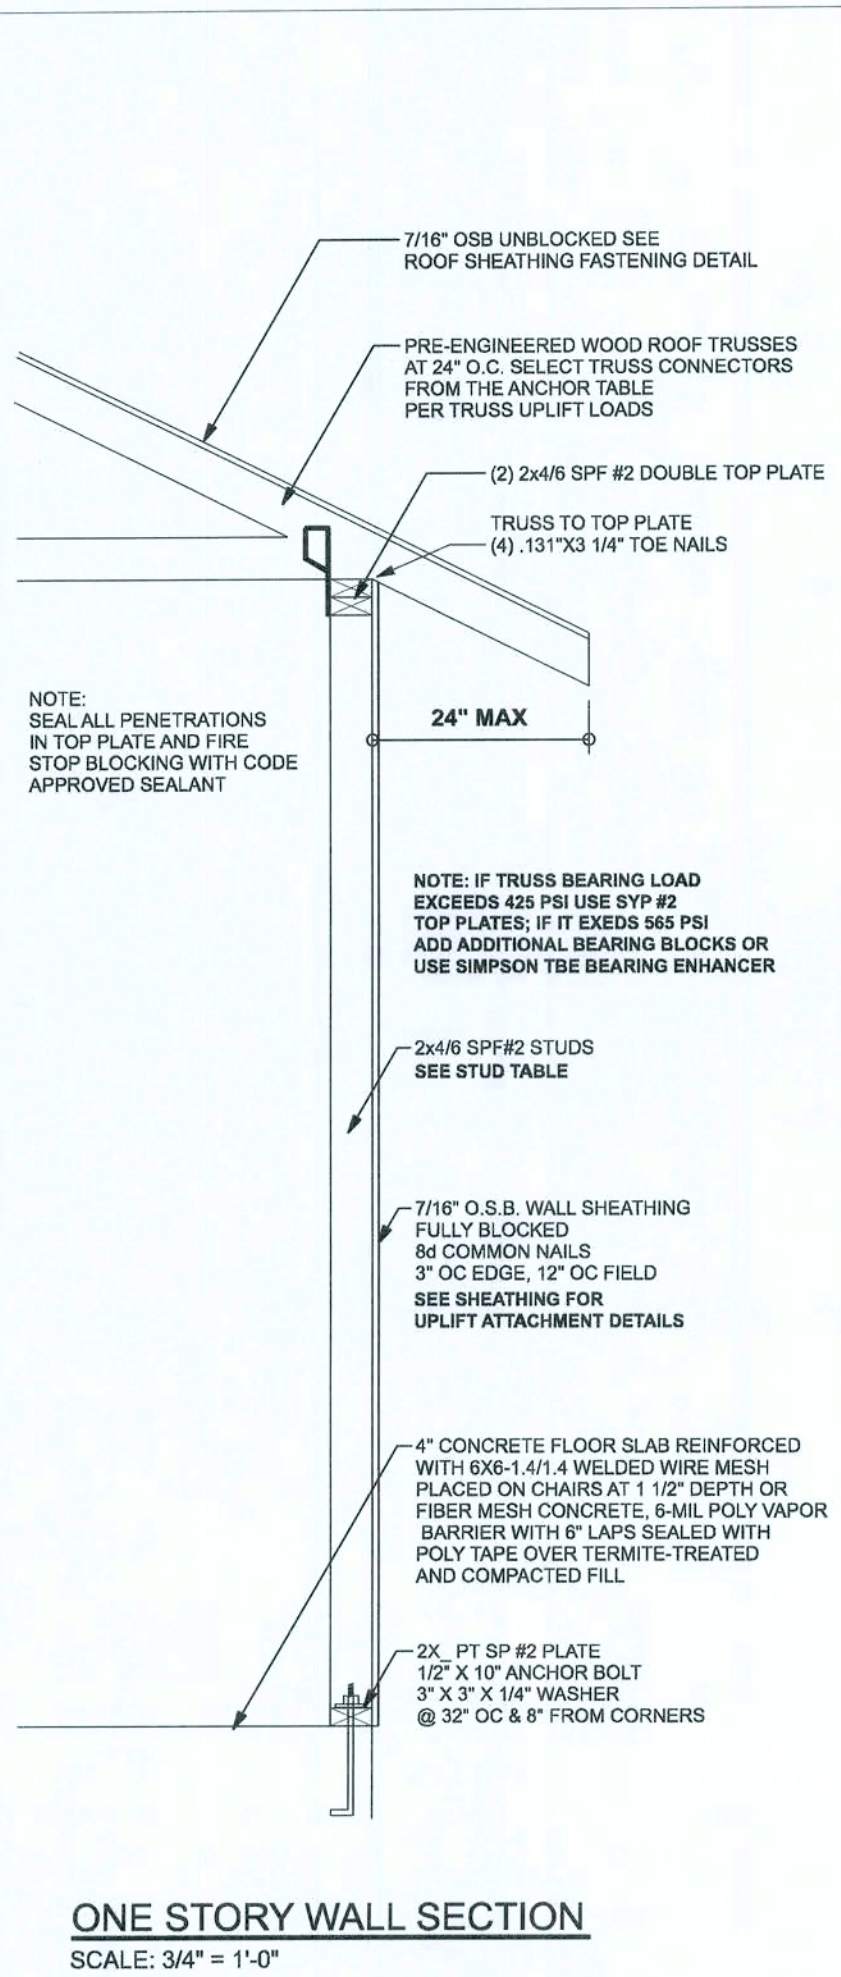


ONE STORY WALL SECTION  
SCALE: 3/4" = 1'-0"

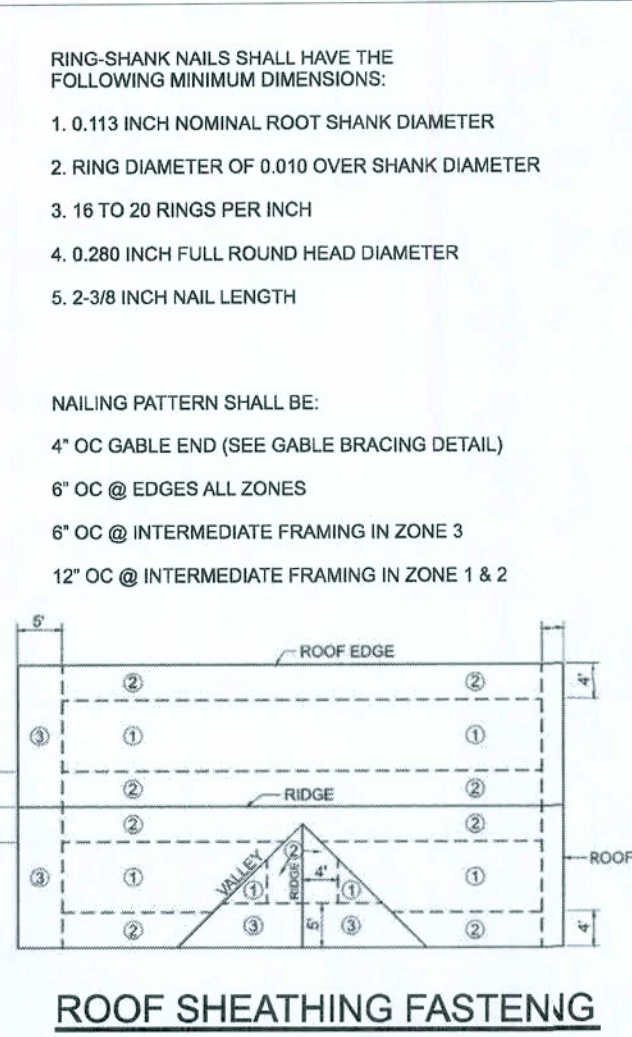

ROOF SHEATHING FASTENING

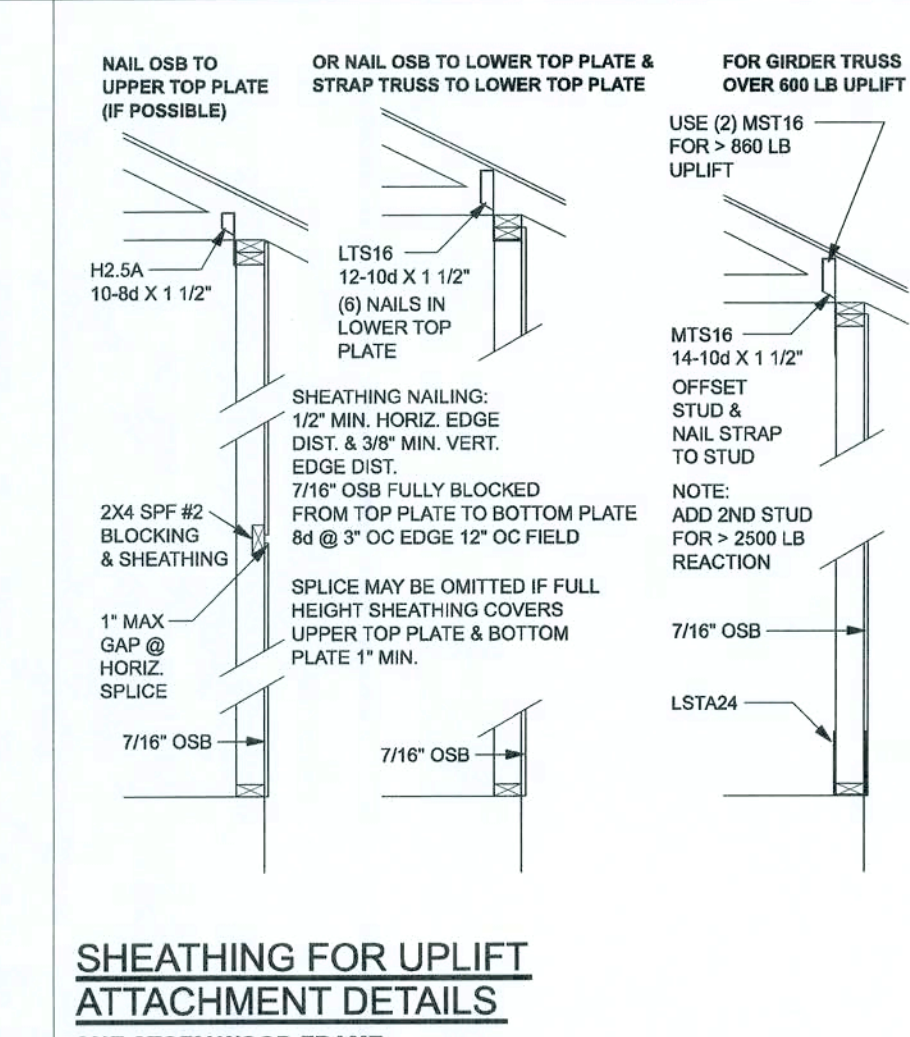

SHEATHING FOR UPLIFT ATTACHMENT DETAILS  
ONE STORY WOOD FRAME

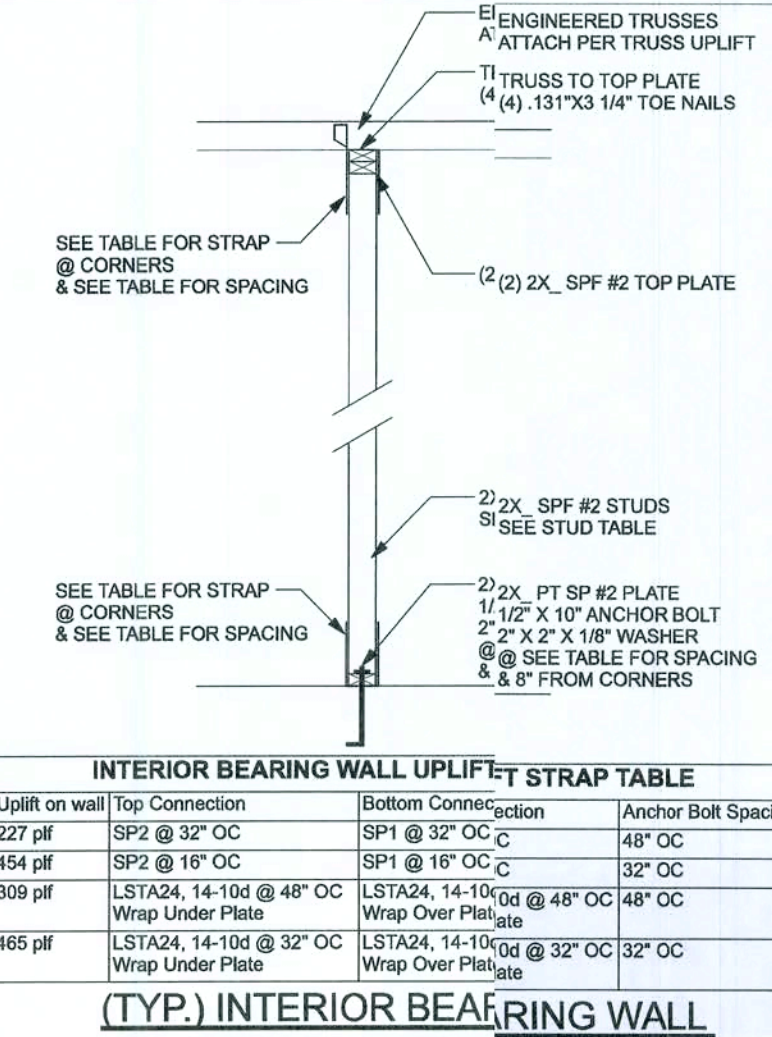

INTERIOR BEARING WALL UPLIFT STRAP TABLE  
(TYP.) INTERIOR BEARING WALL  
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS


CONNECTOR TABLE					
Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter	
615	485	SDWC16600	-	-	-
115	260	H3	4-8d@1'12"	4-8d@1'12"	-
575	495	H2.5A	5-8d@1'12"	5-8d@1'12"	-
1340	1015	H10A	9-10d@1'12"	9-10d@1'12"	-
720	620	LTS12-20	6-10d@1'12"	6-10d@1'12"	-
1000	860	MTS12-30	7-10d@1'12"	7-10d@1'12"	-
1450	1345	MTS20-30	12-10d@1'12"	12-10d@1'12"	-
Uplift SP	Uplift SPF	Strap Ties	To One Member	To Other Member	
1235	1235	LSTA21	8-10d	8-10d	-
1640	1455	MSTA24	9-10d	9-10d	-
1030	1030	CS20	7-10d	7-10d	-
Uplift SP	Uplift SPF	Stud Plate Ties	To Stud	To Plate	
685	535	SP1	6-10d	4-10d	-
1065	605	SP2	6-10d	6-10d	-
771	771	LSTA24	10-10d	wrap under or over plate	-
1235	1235	LSTA24	14-10d	wrap under or over plate	-
Uplift SP	Uplift SPF	Holdowns @ Stomwall	To Stud / Post	Anchor	
1625	1600	DT12Z	8-SDS 1/4"x1'12"	1/2"x12" Titen HD	-
4235	3540	HTT4	18-16d@2'12"	1/2"x12" Titen HD	-
Uplift SP	Uplift SPF	Holdowns @ Mono	To Stud / Post	Anchor	
1825	1600	DT12Z	8-SDS 1/4"x1'12"	1/2"x6" Titen HD	-
4235	3540	HTT4	18-16d@2'12"	1/2"x12" Titen HD	-
Uplift SP	Uplift SPF	Post Bases @ Stomwall	To Post	Anchor	
2200	2200	ABU44	12-16d	5/8"x12" Drill & Epoxy	-
2300	2300	ABU66	12-16d	5/8"x12" Drill & Epoxy	-
Uplift SP	Uplift SPF	Post Bases @ Mono	To Post	Anchor	
2200	2200	ABU44	12-16d	5/8"x7" Drill & Epoxy	-
2300	2300	ABU66	12-16d	5/8"x7" Drill & Epoxy	-

EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS:


THIS STUD HEIGHT TABLE IS PER 2012 WFCM, TABLE 3.20B5, EXTERIOR LOAD BEARING & NON LOAD BEARING STUD LENGTHS FOR WALLS WITH OSB EXTERIOR AND 1/2" GYP INTERIOR RESISTING INTERIOR ZONE WINDLOADS, 130 MPH, EXPOSURE C, STUD DEFLECTION LIMIT H/240 (NOT OK FOR BRITTLE FINISH). STUD SPACINGS SHALL BE MULTIPLIED BY 0.8 FOR FRAMING LOCATED WITHIN 4 FEET OF CORNERS FOR END ZONE LOADING (END ZONE EXAMPLE 16" O.C. x 0.8 = 12.8" O.C.)	
(1) 2x4 @ 16" OC	TO 10'-1" STUD HEIGHT
(1) 2x4 @ 12" OC	TO 11'-2" STUD HEIGHT
(1) 2x6 @ 16" OC	TO 15'-7" STUD HEIGHT
(1) 2x6 @ 12" OC	TO 17'-3" STUD HEIGHT

GRADE & SPECIES TABLE			
2x6	SP #2	Fb	E
2x10	SP #2	800	1.4
2x12	SP #2	750	1.4
GLB	24F-V3 SP	2600	1.9
LSL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2950	2.0
PAL	PARALAM	2900	2.0

PORCH POST CONNECTIONS		
Uplift Post	Top Connection	Bottom Connection
2200 4x4 SP #2 PT	(2) LSTA21	ABU44
2300 6x6 SP #2 PT	(2) LSTA21	ABU66

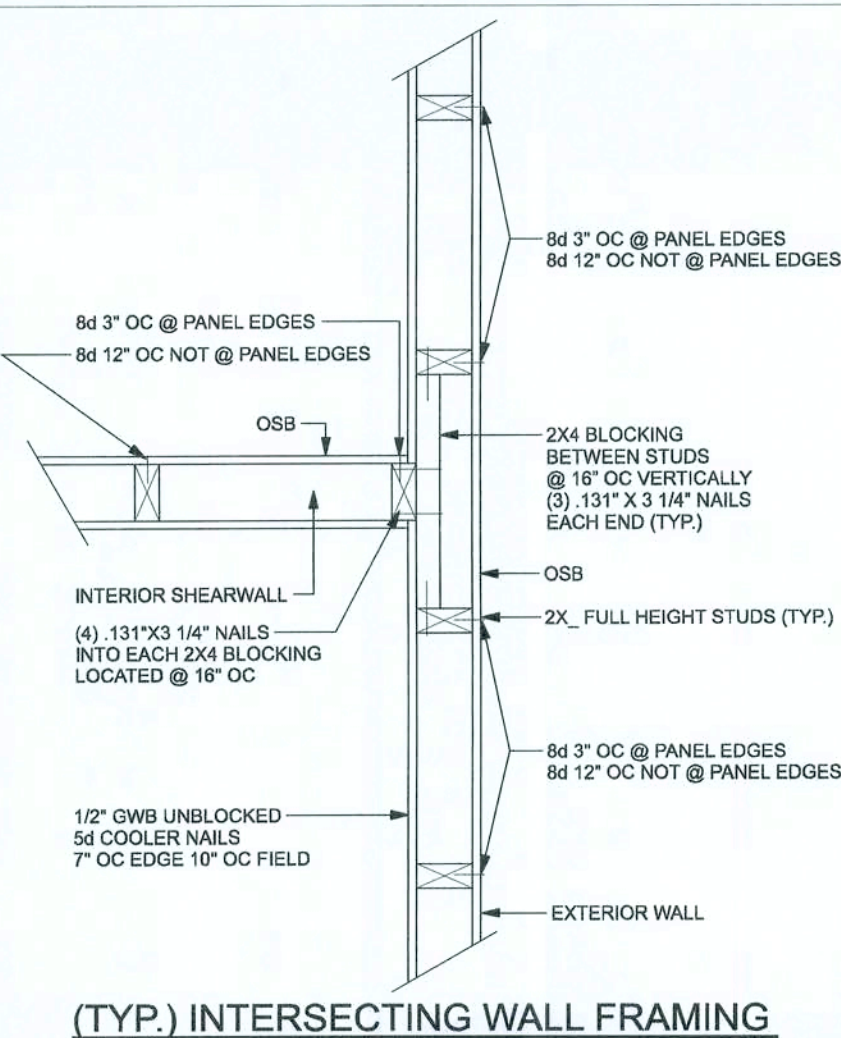


(TYP.) INTERSECTING WALL FRAMING  
WOOD FRAME

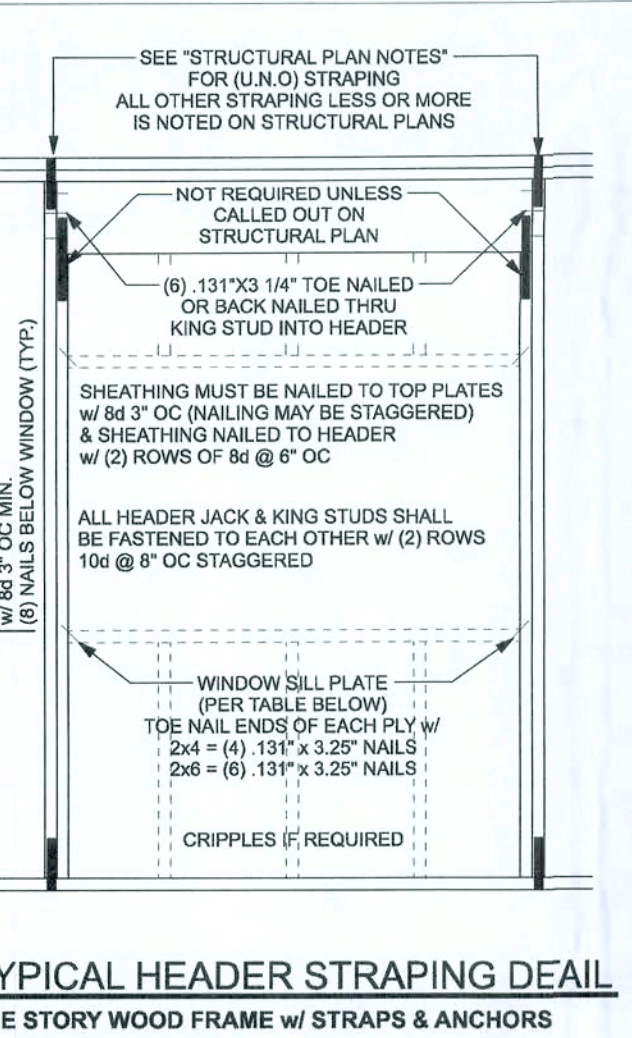


TYPICAL HEADER STRAPING DETAIL  
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

HEADER STRAP TABLE			
Uplift	Top Connection	Bottom Connection	
< 1235	LSTA24, 14-10d wrap over plate	LSTA24, 14-10d wrap under plate	(2) 2x6
< 1455	MSTA24, 18-10d header to jacks	DT12Z	
< 1800	(2) MSTA24, 18-10d header to jacks	DT12Z	
< 2910	(2) MSTA24, 18-10d header to jacks	HTT4	


SILL PLATE SPANS FOR 10'-0" WALL HEIGHT			
DESIGN WIND SPEED	MAX. SPANS FOR SPF #2	BASED ON WFCM TABLE A3.20B	
	(1) 2x4	(2) 2x4	(1) 2x6
130 MPH EXP. C	5'-2"	7'-9"	7'-7"
			11'-3"

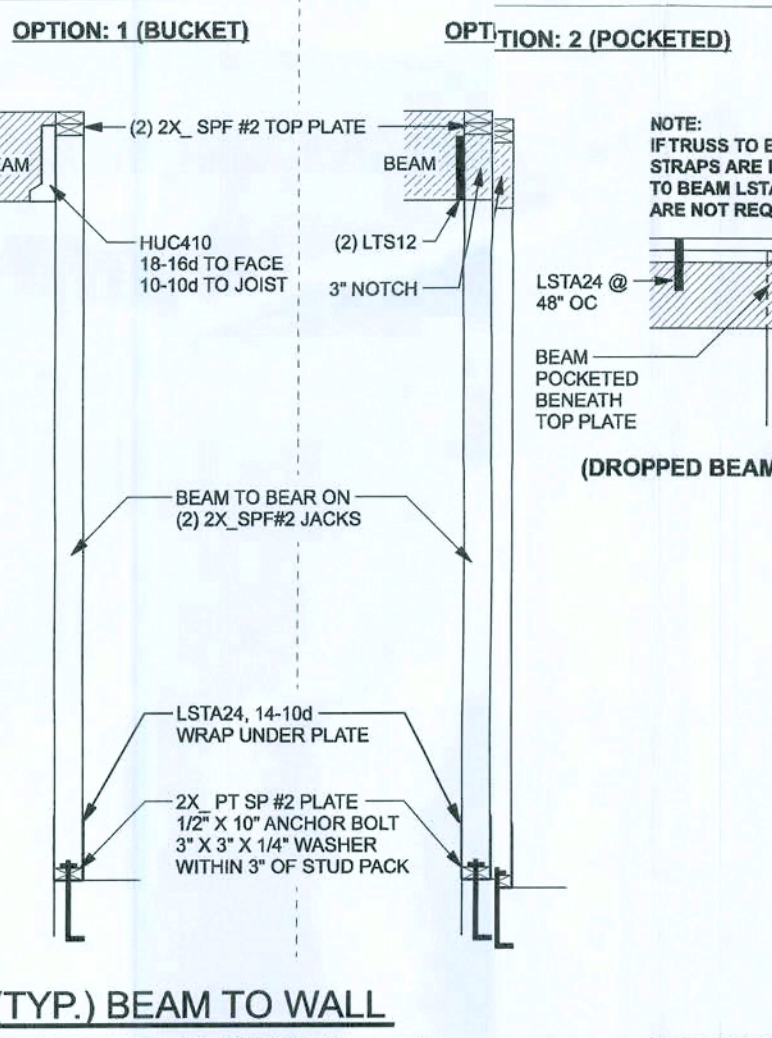


(TYP.) BEAM TO WALL  
WOOD FRAME w/ STRAPS & ANCHORS

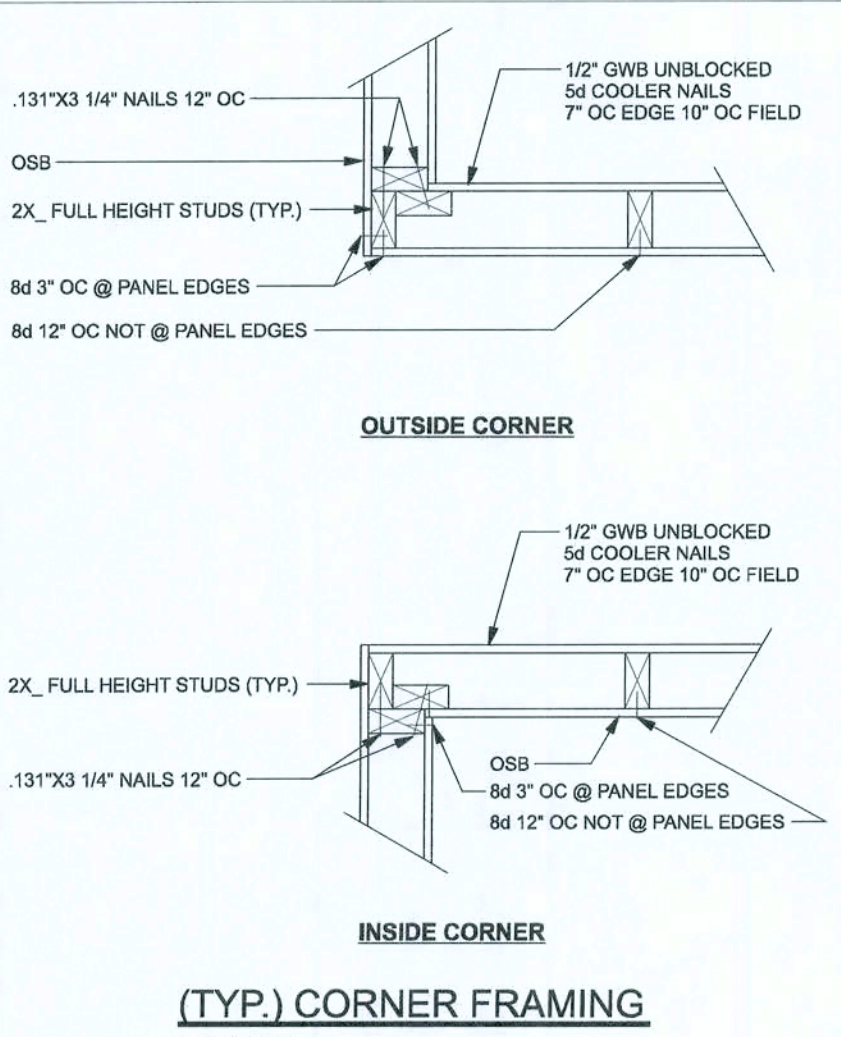

(TYP.) CORNER FRAMING  
WOOD FRAME

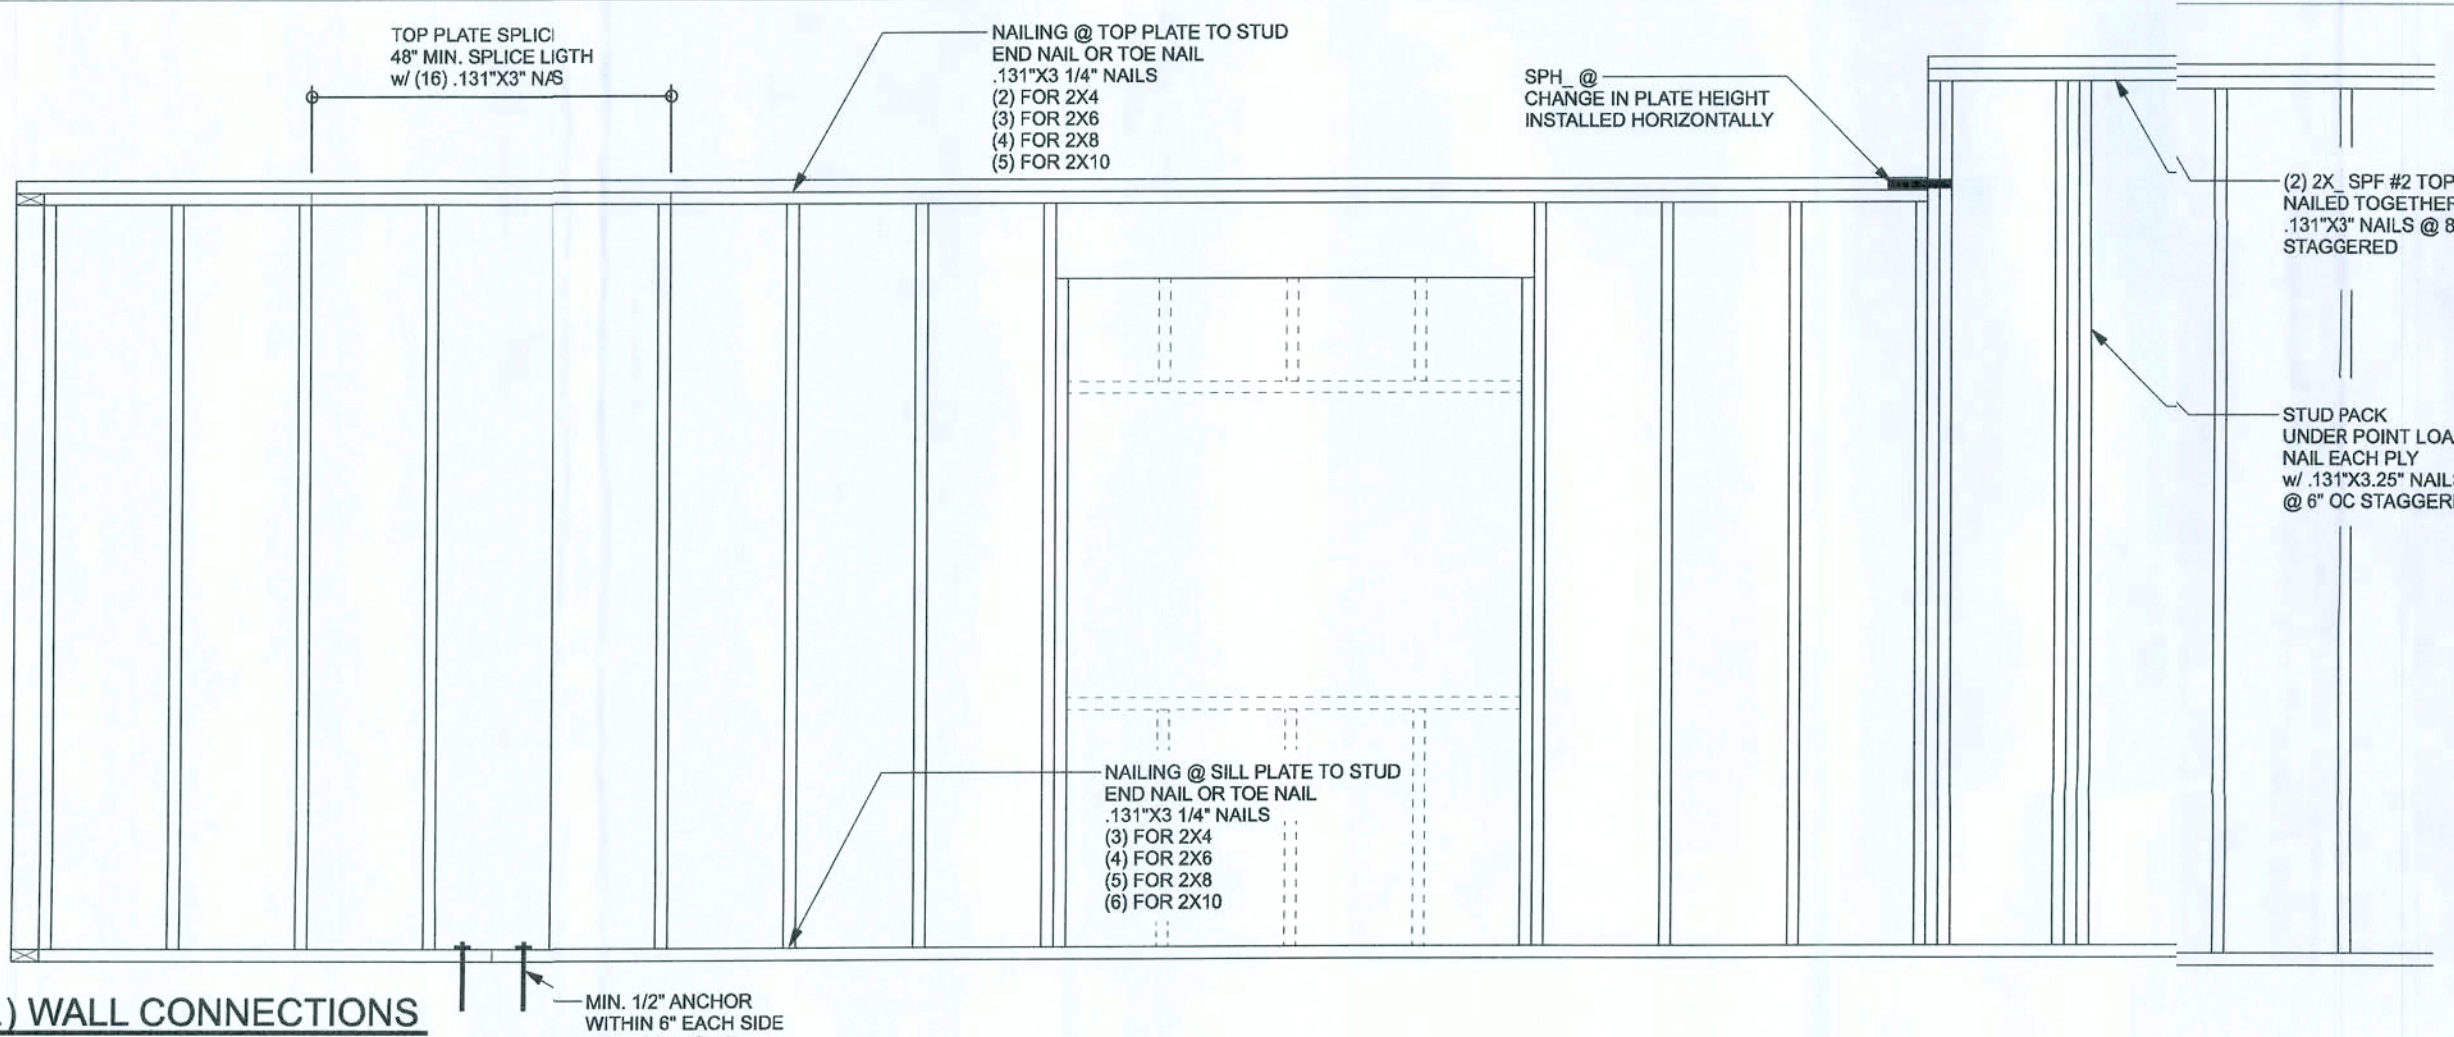

(TYP.) WALL CONNECTIONS  
ONE STORY WOOD FRAME

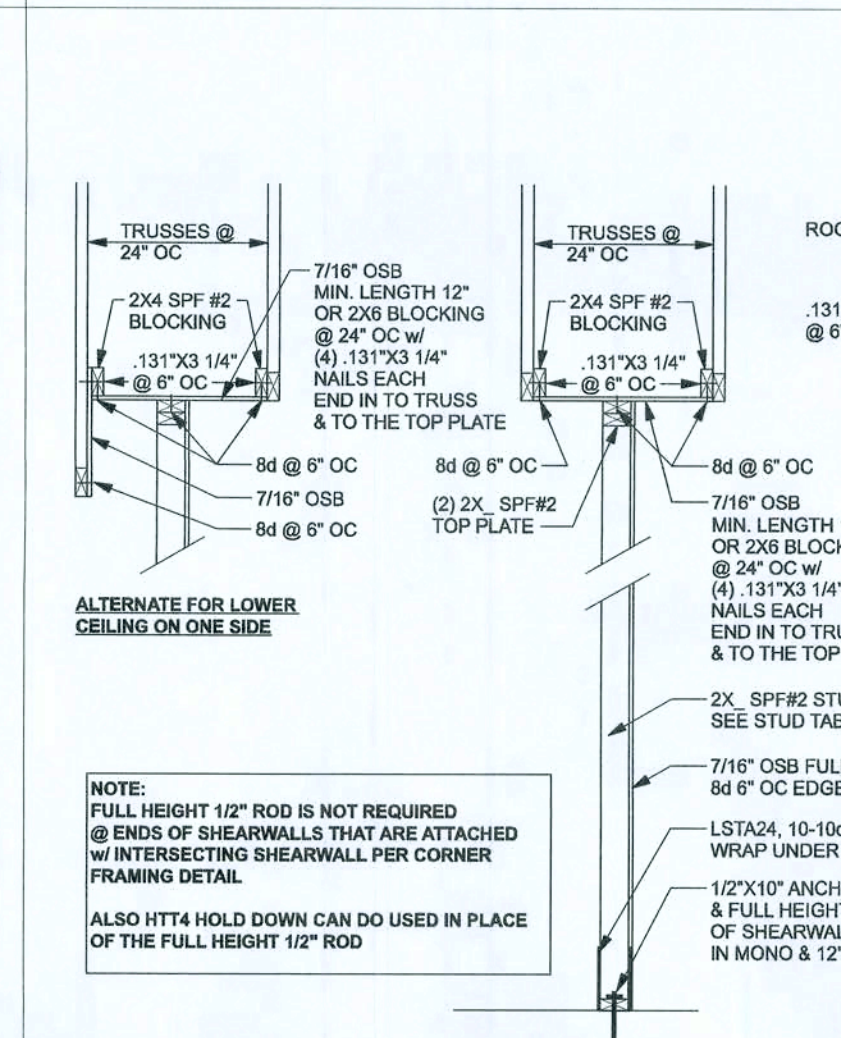

(TYP.) PORCH POST  
ONE STORY WOOD

GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 415LB EACH END; 2X6 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN.

FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET LOAD REQUIREMENTS (ASSUME 1800 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE).

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F<sub>c</sub> = 2000 PSI.

WELDED WIRE REINFORCED SLAB: 8" x 6" W14 x W14, FB = 85KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.R.F.) CONFORMING TO ASTM A185, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 2'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTH 1/2 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5:1. TYPICAL SPACING OF CUTS TO BE 18FT. DO NOT CUT WMM OR REINFORCING STEEL. RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.

REBAR: ASTM A615, GRADE 40, DEFORMED BARS, F<sub>y</sub> = 40 KSI, ALL LAP SPICES 40" DB (20" FOR #6 BARS), UNCL. ALL REINFORCEMENT SHALL BE DETAIL AND PLACED IN ACCORDANCE WITH ACI 315-98, U.N.O.


ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS; 7/16" OSB SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURERS INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.


ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CMU.

**BUILDER'S RESPONSIBILITY:**  
THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.  
CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.  
PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCR REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.  
PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION, IF YOU BELIEVE THE PLAN OMMITS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.  
VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

**ROOF SYSTEM DESIGN:**  
THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR, IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBCR REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

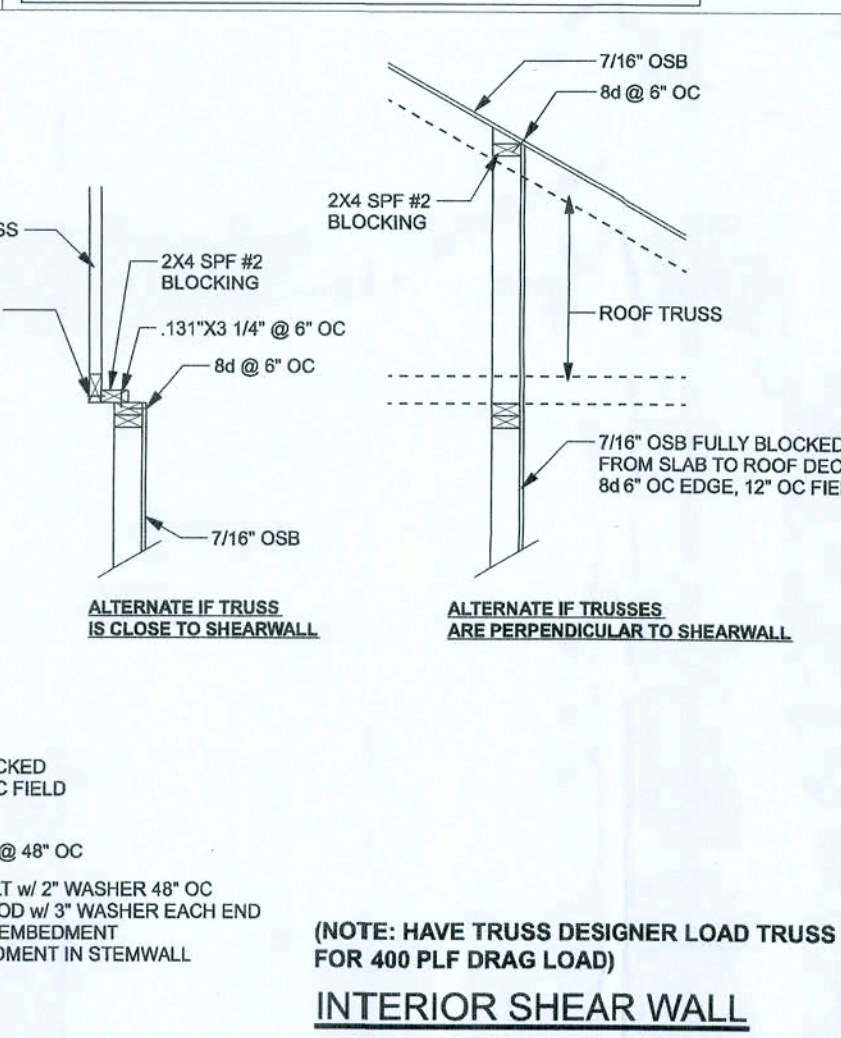

(NOTE: HAVE TRUSS DESIGNER LOAD TRUSS FOR 400 PLF DRAG LOAD)  
INTERIOR SHEAR WALL  
ONE STORY WOOD FRAME w/ STRAPS & AB

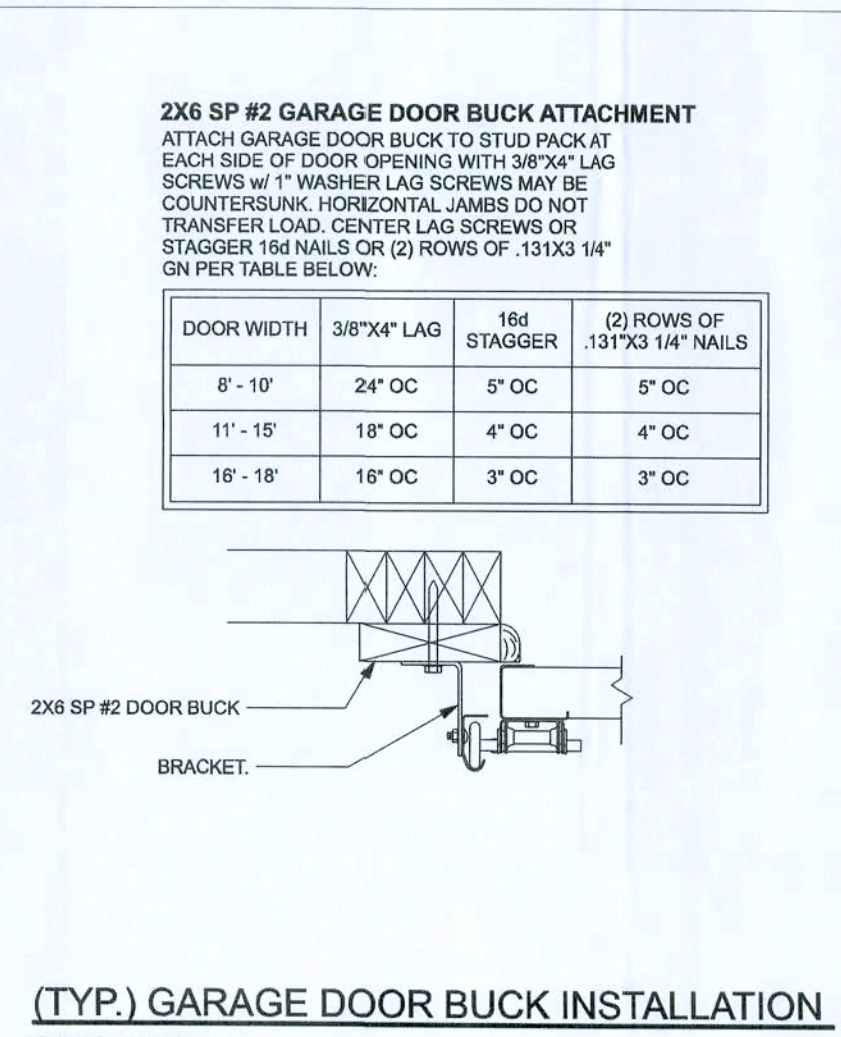

(TYP.) GARAGE DOOR BUCK INSTALLATION  
WOOD FRAME

DESIGN CRITERIA & LOADS:		
BUILDING CODE	6TH EDITION FLORIDA BUILDING CODE RESIDENTIAL (2017)	
CODE FOR DESIGN LOADS	ASCE 7-10	
<b>WINDLOADS</b>		
BASIC WIND SPEED (ASCE 7-10, 3S GUST)	130 MPH	
WIND EXPOSURE (BUILDER MUST FIELD VERIFY)	C	
TOPOGRAPHIC FACTOR (BUILDER MUST FIELD VERIFY)	1	
RISK CATEGORY	II	
ENCLOSURE CLASSIFICATION	ENCLOSED	
INTERNAL PRESSURE COEFFICIENT	0.18	
ROOF ANGLE	7-45 DEGREES	
MEAN ROOF HEIGHT	30 FT	
<b>C&amp;C DESIGN PRESSURES</b>	SEE TABLE	
<b>FLOOR LOADING</b>		
ROOMS OTHER THAN SLEEPING ROOM	40 PSF LIVE LOAD	
SLEEPING ROOMS	30 PSF LIVE LOAD	
<b>ROOF LOADING</b>		
FLAT OR < 4:12	20 PSF LIVE LOAD	
4:12 TO < 12:12	16 PSF LIVE LOAD	
12:12 & GREATER	12 PSF LIVE LOAD	
<b>SOIL BEARING CAPACITY</b>	1500 PSF	
<b>FLOOD ZONE</b>	THIS BUILDING IS NOT IN THE FLOOD ZONE	
<b>COMPONENT &amp; CLADDING DESIGN PRESSURES 130 MPH (EXP. C)</b>		
EFFECTIVE WIND AREA (F <sub>T2</sub> )	ZONE 4 INTERIOR	ZONE 5 END 4' FROM ALL OUTSIDE CORNER
0 - 20	+25.6(Vasd) -27.8(Vasd)	+25.6(Vasd) -34.2(Vasd)
0 - 20	+42.6(VuId) -46.2(VuId)	+42.6(VuId) -57(VuId)
<b>GARAGE DOOR DESIGN PRESSURES 130 MPH (EXP. C)</b>		
8x7 GARAGE DOOR	+22.6(Vasd) -25.5(Vasd)	
16x7 GARAGE DOOR	+21.7(Vasd) -24.1(Vasd)	

**BOB PRATA RESIDENCE**

PROJECT ADDRESS: 524 SW Highland Ter, Lake City, Columbia County Florida

DIMENSIONS: Stated dimensions approximate scaled dimensions. Refer questions to Mark Disoway, P.E. or resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 6th Edition Florida Building Code Residential (2017) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOWAY, P.E. 63915

STATE OF FLORIDA  
PROFESSIONAL ENGINEER  
No. 53345

Friday, September 28, 2018

Mark Disoway P.E.  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.54.5419  
disowaydesign@gmail.com

**JOB NUMBER:**  
181003


**S-1**  
OF 6SHEETS



MASONRY NOTE: MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.		
ACI 530.1-02 Section	Specific Requirements	
1.4A Compressive strength	8" block bearing walls P'm = 1500 psi	
2.1 Mortar	ASTM C 270, Type N, UNO	
2.2 Grout	ASTM C 476, admixtures require approval	
2.3 CMU standard	ASTM C 90-02, Normal weight, hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block	
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"	
2.4 Reinforcing bars, #3 - #11	ASTM A615, Grade 40, Fy = 40 ksi, Lap splices min 40 bar dia, (25" for #5)	
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A525, Class G60, 0.60 oz/lb or 304SS	
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or water, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class D2, 1.50 oz/lb or 304SS	
3.3.E Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.	
3.3.E Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.	

BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 1' BELOW UNDISTURBED SOIL OR ENGINEERED FILL PER FBC 2017-RES. SECTION R403.1.4

TALL STEM WALL TABLE: The table assumes 80 ksi reinforcing bars with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Duowall ladder reinforcement at 16" OC vertically or a horizontal bond beam with 1#5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.							
STEM WALL HEIGHT (FEET)	UNLINED EX-FILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	1.0	96	96	96	96	96	96
4.0	1.7	96	96	96	96	96	96
4.7	1.3	88	96	96	96	96	96
5.3	1.0	56	96	96	96	96	96
6.0	1.7	40	80	96	80	96	96
6.7	1.3	32	56	80	56	96	96
7.3	1.0	24	40	56	40	80	96
8.0	1.7	16	32	48	32	64	80
8.7	1.3	8	24	32	24	48	64
9.3	1.0	8	16	24	16	40	48

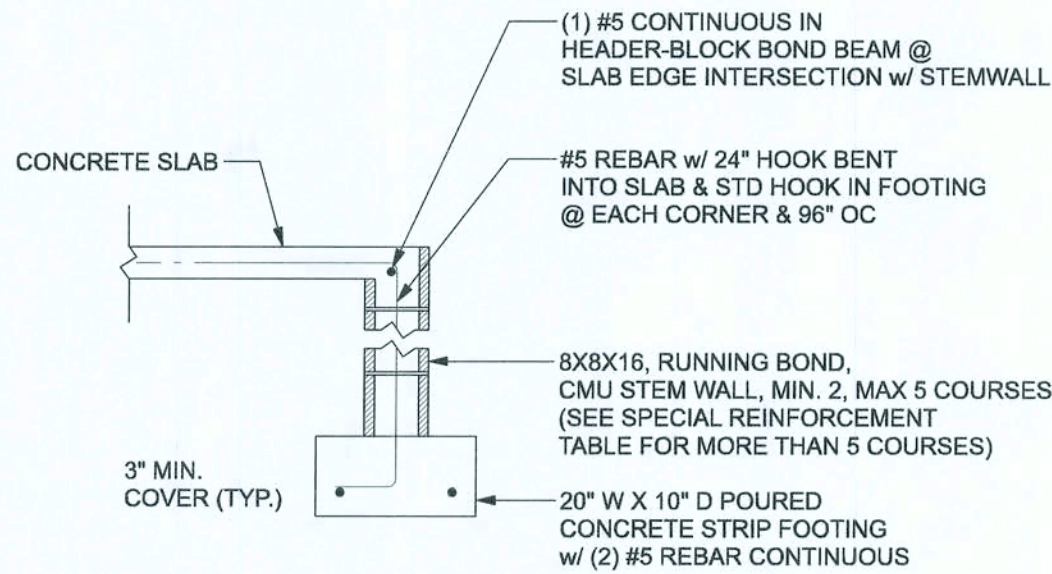


F1 S-2 OPTIONAL STEM WALL FOOTING SCALE: 1/2" = 1'-0"


#### FOUNDATION PLAN

SCALE: 1/4" = 1'-0"


FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES, STEPS, DOWN, ETC. DISOWAY DESIGN GROUP OR MARK DISOWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING WALLS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN.
FN - 3	THE SLAB SHALL BE 4" CONCRETE SLAB REINFORCED W/ POLY WAPOR BARRIERS W/ 6" LAPS SEALED W/ POLY TAPE OVER TERMITES-TREATED & COMPACTED FILL (ALSO, ANY OTHER CODE APPROVED METHOD CAN BE USED INSTEAD)

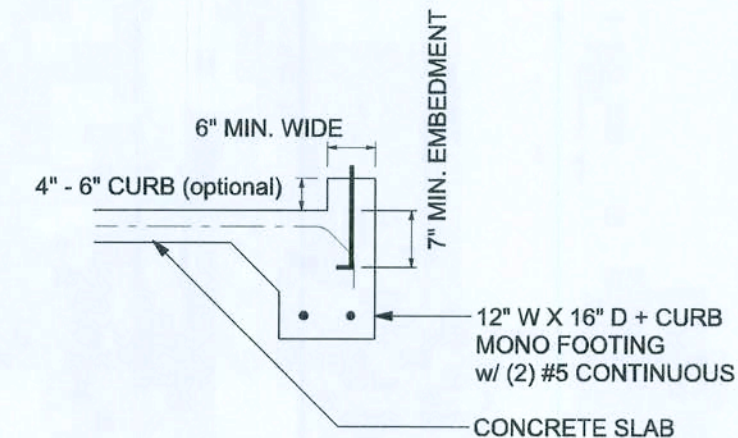


F4 S-2 MONOLITHIC CURB FOOTING SCALE: 1/2" = 1'-0"

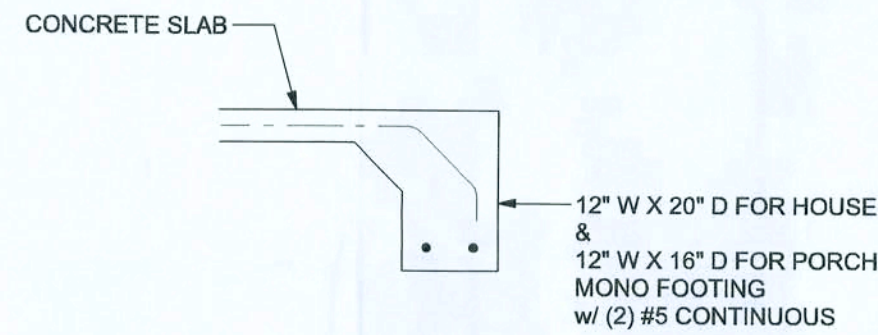

F1 S-2 MONOLITHIC FOOTING SCALE: 1/2" = 1'-0"

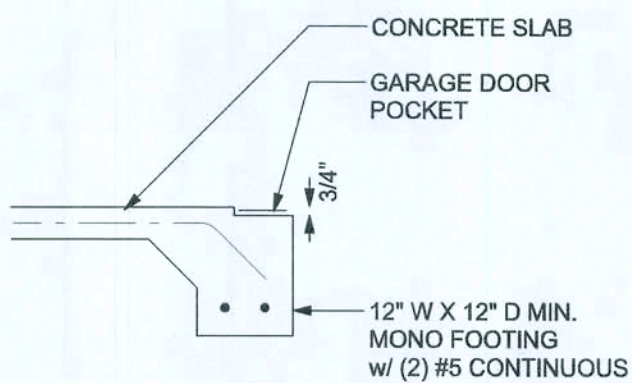

F5 S-2 GARAGE DOOR POCKET FOOTING SCALE: 1/2" = 1'-0"

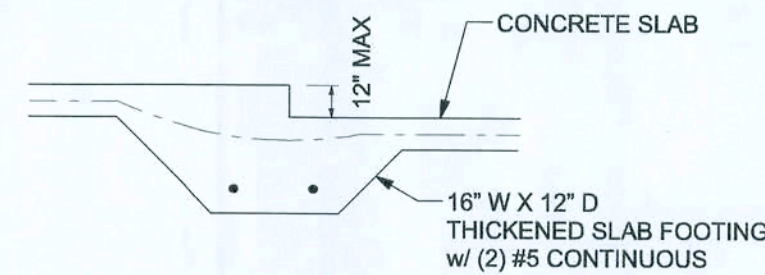

F3 S-2 INTERIOR BEARING STEP FOOTING SCALE: 1/2" = 1'-0"

BOB PRATA  
RESIDENCE

PROJECT ADDRESS:  
824 SW Highland Terr  
Lake City  
Columbia County, Florida

#### DIMENSIONS:


Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

**COPYRIGHTS AND PROPERTY RIGHTS:**  
Mark Disoway, P.E. hereby expressly reserves its common law copyright and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without the express written permission and consent of Mark Disoway.

**CERTIFICATION:** I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 6th Edition Florida Building Code Residential(2017) to the best of my knowledge.

**LIMITATION:** This design is valid for one building, at specified location.

MARK DISOWAY P.E. 53915

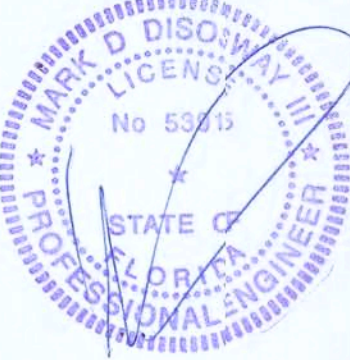

Tuesday, September 25, 2018

**Mark Disoway P.E.**  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.7545419  
disowaydesign@gmail.com

**JOB NUMBER:**  
181003

**S-2**

OF 6 SHEETS



