




F1 S-2 STEM WALL FOOTING
SCALE: 1/2" = 1'-0"

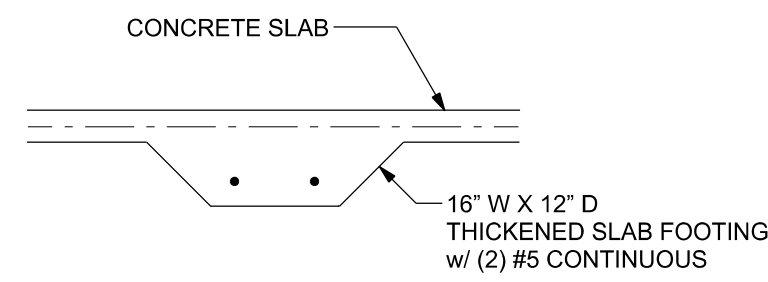

F2 S-2 INTERIOR BEARING FOOTING
SCALE: 1/2" = 1'-0"

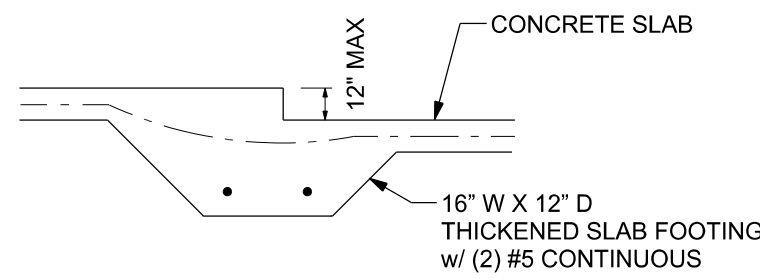

F3 S-2 INTERIOR BEARING STEP FOOTING
SCALE: 1/2" = 1'-0"

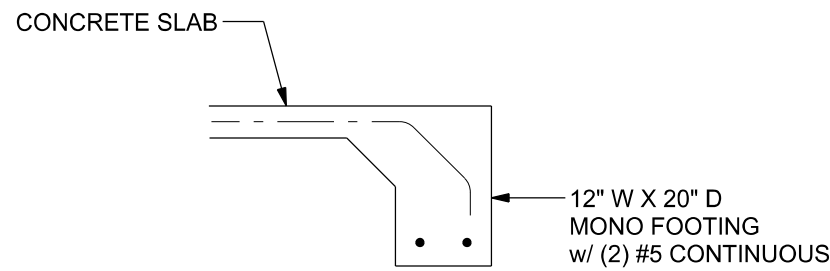

F4 S-2 MONOLITHIC FOOTING
SCALE: 1/2" = 1'-0"

TALL STEM WALL TABLE:						
The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16" OC vertically or a horizontal bond beam with 1#5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.						
STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)	
		#5	#7	#8	#5	#7
3.3	3.0	96	96	96	96	96
4.0	3.7	96	96	96	96	96
4.7	4.3	88	96	96	96	96
5.3	5.0	56	96	96	96	96
6.0	5.7	40	80	96	80	96
6.7	6.3	32	56	80	56	96
7.3	7.0	24	40	56	40	80
8.0	7.7	16	32	48	32	64
8.7	8.3	8	24	32	24	48
9.3	9.0	8	16	24	16	40

MASONRY NOTE:
MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.

ACI 530.1-02 Section	Specific Requirements
1.4A Compressive strength	8" block bearing walls F'm = 1500 psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, admixtures require approval
2.3 CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"
2.4 Reinforcing bars, #3 - #11	ASTM 615, Grade 60, Fy = 40 ksi, Lap splices min 40 bar dia. (25" for #5)
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A525, Class G60, 0.60 oz/lb or 304SS
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class B2, 1.50 oz/lb or 304SS
3.3.E.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.


BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES

- FN - 1 DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS. RECESSES IN SLAB, STEP DOWNS, ETC. DISOWAY DESIGN GROUP OR MARK DISOWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
- CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN
- FN - 2 IN ALL AREAS BY REVIEWING THE ROOF TRUSS PLAN
- FN - 3 THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ 8X6-1.4/1.4 WELDED WIRE MESH PLACED ON CHAIRS @ 1-1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLY TAPE OVER TERMITTE-TREATED & COMPACTED FILL (ALSO, ANY OTHER CODE APPROVED TERMITTE-TREATMENT METHOD CAN BE USED INSTEAD)

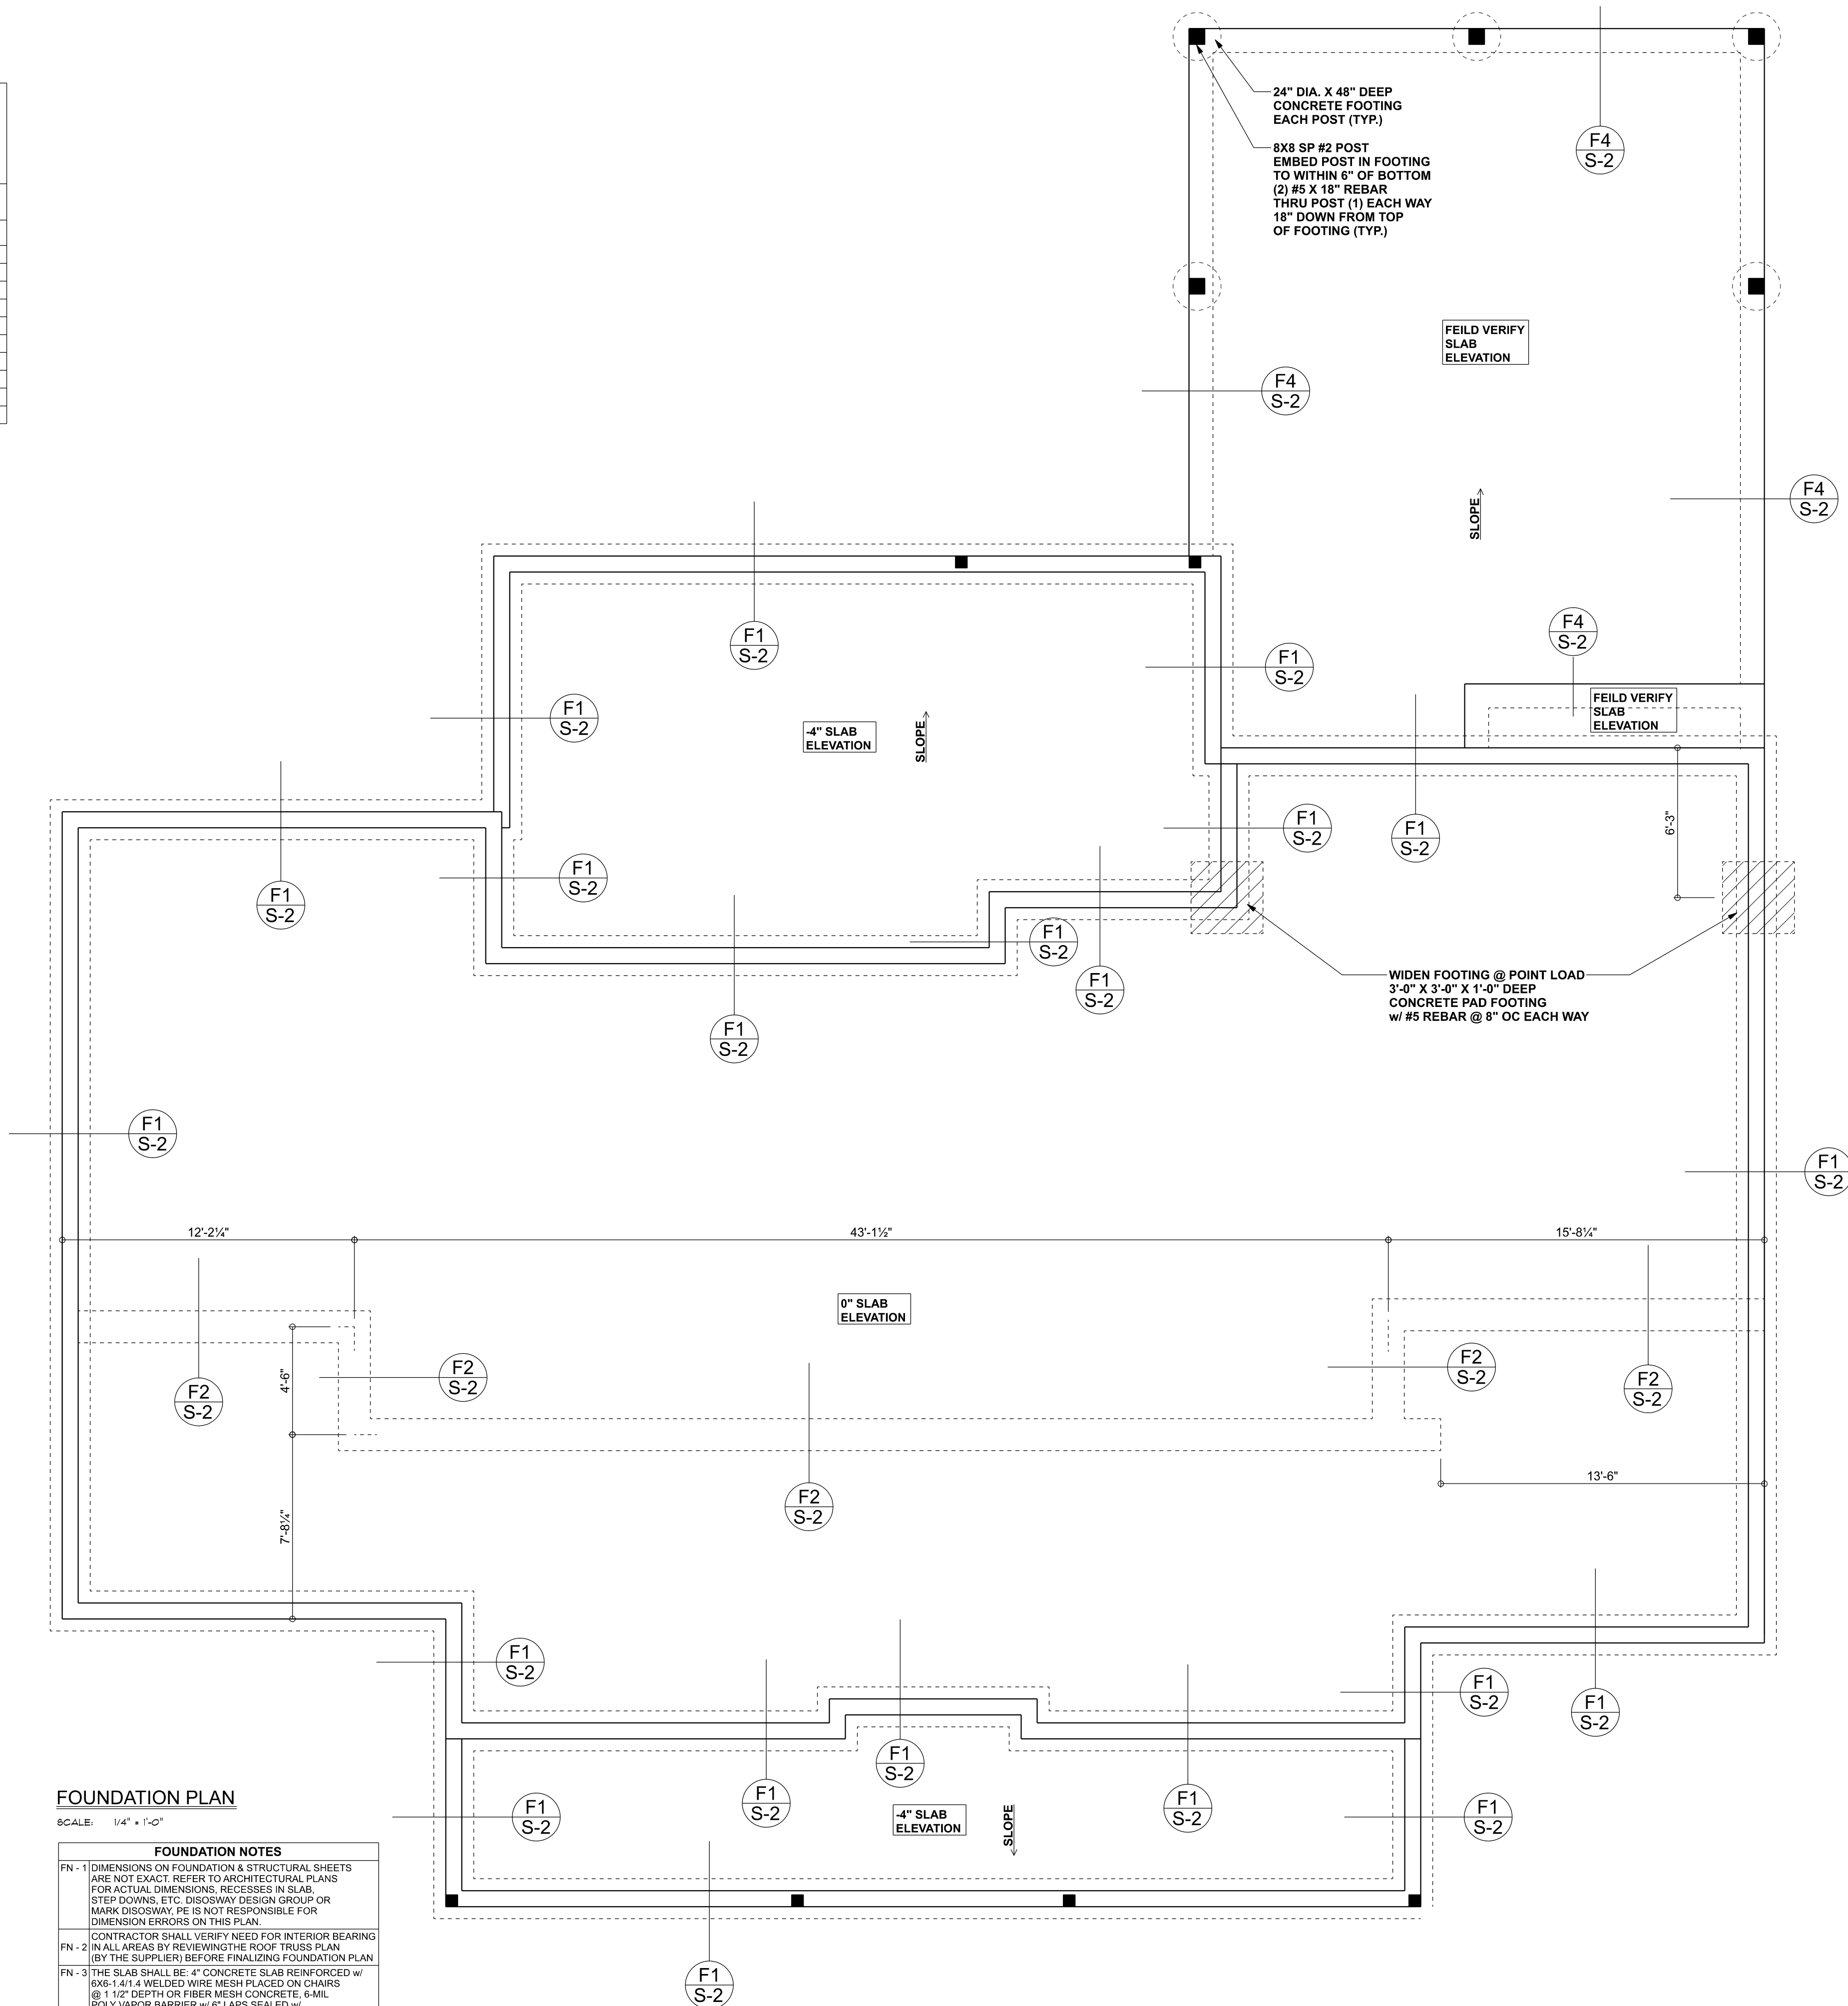

Nettles Res.

PROJECT ADDRESS:
Columbia County, FL

FL PE 53915

This item has been digitally signed and sealed by Mark Disoway, P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=US, O=Florida, dnQualifier=A01410C0000017E970, CN=Mark d Disoway
2023-12-28 14:11:15

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2023) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.


Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
231515

S-2
OF 3 SHEETS

LUMBER SIZE & GRADE MINIMUM REQUIREMENTS

CRIPPLE BOARD	2X6 SYP #2
RAFTER SPANS 20'-0" OR LESS	2X4 SYP #2
PURLIN / LATERAL BRACING	2X4 SYP #2
SLEEPERS	2X WIDTH OF RAFTER (SEAT CUT) SYP #3 OR 2 PARALLEL 2X4 SYP #3
CRIPPLES & BLOCKING	2X4 SPF #2 OR BETTER
TRUSS BELOW	SEE TRUSS DESIGN - SOUTHERN PINE MATERIAL

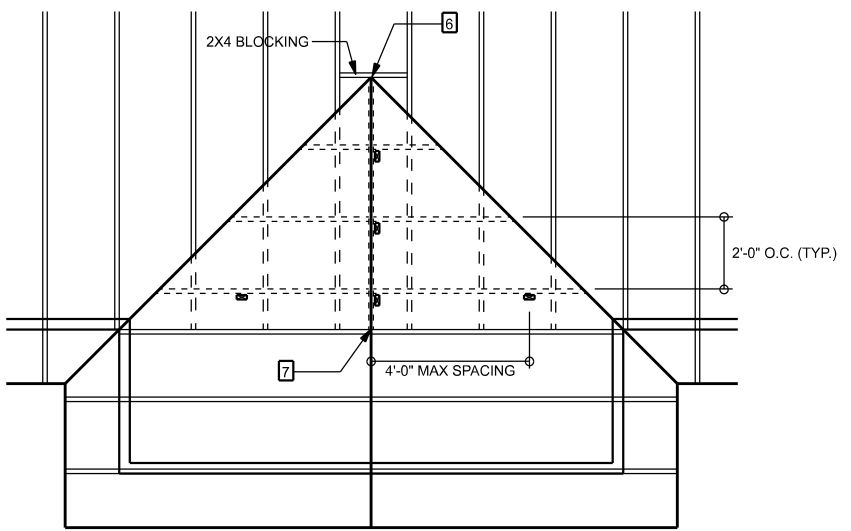

VALLEY ROOF PLAN MEMBER LEGEND

- TRUSS
- TRUSS UNDER VALLEY FRAMING
- VALLEY RAFTER OR RIDGE
- CRIPPLE

CRIPPLES 4'-0" O.C. FOR 20 psf (TL) AND 10 psf (TD) (TYP. SHINGLE ROOF) MAX

CONNECTION REQUIREMENT NOTES

1. 2X4 RAFTERS TO RIDGE	3-16d OR 6-131 x 3" TOE NAILS
2. CRIPPLE TO RIDGE	3-16d OR 6-131 x 3" FACE NAILS
3. CRIPPLE TO RAFTERS	3-16d OR 6-131 x 3" FACE NAILS
4. RAFTER TO SLEEPER OR BLOCKING	6-16d OR 12-131 x 3" TOE NAILS
5. SLEEPER TO TRUSS	4-16d OR 6-131 x 3" FACE NAILS EACH TRUSS
6. RIDGE BOARD TO ROOF BLOCK	3-16d OR 6-131 x 3" TOE NAILS
7. RIDGE BOARD TO TRUSS	3-16d OR 6-131 x 3" TOE NAILS
8. PURLIN TO TRUSS (TYP.)	3-16d OR 6-131 x 3" NAILS
9. PURLIN TO CRIPPLE (IF CRIPPLE IS ATTACHED TO PURLIN)	4-16d OR 6-131 x 3" NAILS
10. TRUSS TO BLOCKING	3-16d OR 6-131 x 3" END NAILS
11. CRIPPLE TO TRUSS	3-16d OR 6-131 x 3" FACE NAILS
12. CRIPPLE TO PURLIN	3-16d OR 6-131 x 3" FACE NAILS

GENERAL NOTES


- MAXIMUM RAFTER SPAN: 8'-0" FOR 2X4 SYP #2 FOR 20 PSF #2 OR SYP #2.
- MAXIMUM ROOF AREA FOR SUPPORT: 1000 SQ. FT. IN ZONE 2 & 3, 500 SQ. FT. IN ZONE 1 (EXAMPLE: 4'-0" O.C. X 4'-0" SPAN).
- PURLIN REQUIRED 2'-0" O.C. IF EXISTING SHEATHING IS REMOVED.
- PURLIN SHOULD OVERLAP SHEATHING ONE TRUSS SPACING MINIMUM.
- IN CASES THAT THIS IS IMPRACTICAL, OVERLAP SHEATHING A MINIMUM OF 6" AND NAIL UPWARDS THROUGH SHEATHING INTO PURLIN WITH A MINIMUM OF 3-8d COMMON WIRE NAILS.
- THIS DRAWING APPLIES TO VALLEYS WITH THE FOLLOWING CONDITIONS:
 - SPANS (DISTANCES BETWEEN HEELS) 40'-0" OR LESS
 - MAXIMUM WIND SPEED: 100 MPH
 - MAXIMUM MEAN ROOF HEIGHT: 30 FEET
 - MAXIMUM TOTAL LOADING: 40 psf
 - MEETS IRC / ASCE 7 WIND REQUIREMENTS
 - EXPOSURE CATEGORY "C", 1:1:1, Kd = 1.0
 - ENCLOSED BUILDING

CRIPPLE, BRACING & BLOCKING NOTES

- 2X4 CONTINUOUS LATERAL BRACE (CLB) MIN. IS REQUIRED FOR CRIPPLES 6'-0" TO 10'-0" LONG NAILED W/ 2-16d NAILS OR 2X4 1" OR SCAB BRACE NAILS TO FLAT EDGE OF CRIPPLE WITH 6 NAILS @ 6" O.C. 1" OR SCAB MUST BE 90% OF CRIPPLE WIDTH. CRIPPLES OVER 10'-0" LONG REQUIRE TWO CLB OR BOTH FACES W/ 1" OR SCAB. USE STRESS GRADED LUMBER A-B OR COMMON NAILS.
- NARROW EDGE OF CRIPPLE CAN FACE RIDGE OR RAFTER.
- AS LONG AS THE PROPER NUMBER OF NAILS ARE INSTALLED INTO RIDGE BOARD.
- INSTALL BLOCKING UNDER RAFTER IF SLEEPERS ARE NOT USED.
- INSTALL BLOCKING UNDER CRIPPLES IF CRIPPLES FALL BETWEEN LOWER TRUSS TOP CHORDS AND LATERAL BRACING IS NOT USED.
- APPROVAL NAILING IN ACCORDANCE TO NDS-1997 SECTION 12 NAILS ARE COMMON WIRE NAILS UNLESS NOTED OTHERWISE.

ROOF OVER FRAMING & BRACING DETAIL

SCALE: 1/4" = 1'-0"

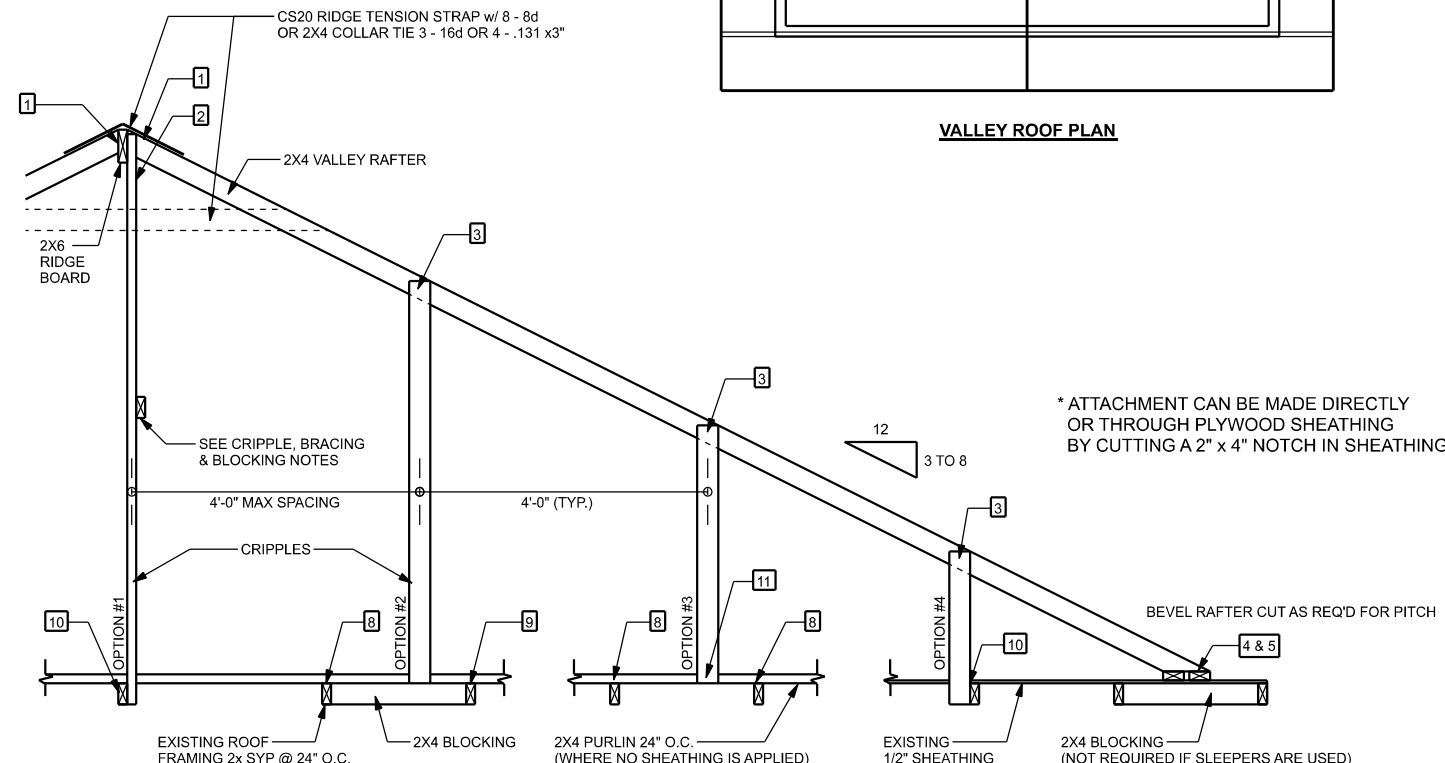

SECTION CUT PARALLEL TO VALLEY RAFTER

ALTERNATE IF TRUSSES ARE PERPENDICULAR TO SHEARWALL

NOTE: IF THE ABOVE DETAIL IS USED ON THE REAR PORCH WALL, THE REAR PORCH CEILING DOES NOT NEED TO BE SHEATHED

SEE PORCH POST DETAIL

NOTE: PORCH CEILING MUST BE SHEATHED W/ MIN. 3/8" OSB W/ 8d @ 3" OC EDGE & 12" OC FIELD

HEADER STRAPING USE OPTION #6

ENGINEERED TRUSSES ATTACH PER TRUSS UPLIFT

2X6 SP #2 RAFTERS @ 24" OC (6) 431" X 3.25" TO TRUSS (LAP 12") LSSJ26 TO VALLEY BEAM

CS20, 10-10d RIDGE TENSION TIE (TYP.)

SEE ROOF OVER FRAMING & BRACING DETAIL THIS SHEET

2X6 SP #2 LEDGER FOR TRUSS TO BUCKET TO ATTACHED TO TRUSS W/ (2) SIMPSON SDWS22500DB SCREWS @ MIN. 16" OC (TYP.)


2X6 SP #2 RAFTERS @ 24" OC LRU26Z TO RIDGE LSSJ26 TO VALLEY BEAM

SEE PORCH POST DETAIL

SEE PORCH POST DETAIL

SEE PORCH POST DETAIL

SEE PORCH POST DETAIL

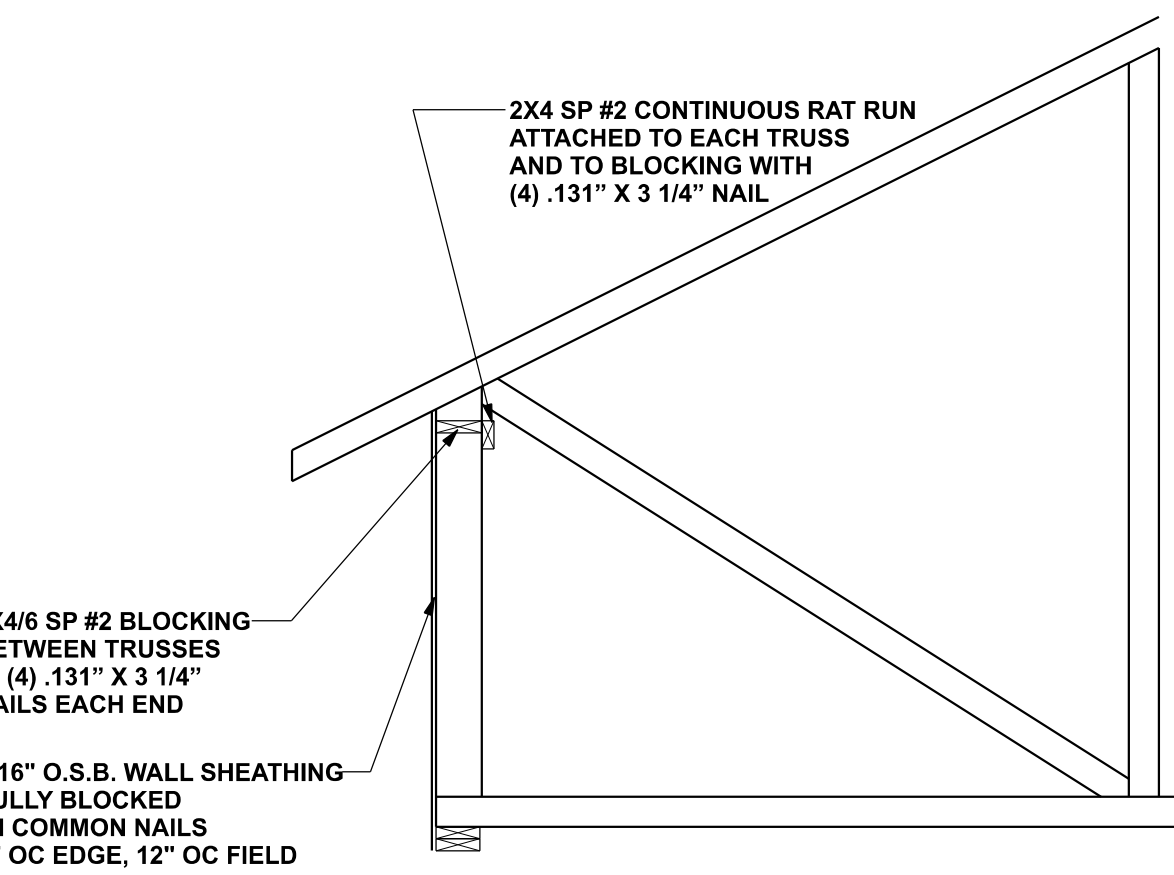

DETAIL @ TRUSSES WITH RAISED HEELS

SCALE: 1/2" = 1'-0"

STRUCTURAL PLAN NOTES

- SN-1 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS.
- SN-2 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCS1-03, BCS1-B1, BCS1-B2, & BCS1-B3. BCS1-B1, BCS1-B2, & BCS1-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE.

UNLESS NOTED OTHERWISE (MINIMUM REQUIERMENTS)

SEE STRUCTURAL PLAN FOR ANY SPECIFIC CALL OUTS


BEAM / HEADERS (SIZE)	ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (UNO)
HEADERS (JACK & KING STUDS)	ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (UNO)
HEADERS (STRAPING)	ALL HEADERS W/ UPLIFT TO BE STRAPPED OR SCREWED DOWN W/ MIN. OPTION #1 OR OPTION #3 (SEE DETAIL ON SHEET S-1) (U.N.O.) 1/2" X 10" ANCHOR BOLT W/ 3" X 3" X 1/4" WASHER MUST BE LOCATED WITHIN 6" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.)
JACK STUDS UNDER GIRDER TRUSS	USE ONE JACK STUD GIRDER SUPPORT PER 2000 LB LOAD

HEADER LEGEND

- (2) 2X6X0' 1J 1K - HEADER/BEAM CALL-OUT (U.N.O.)
- NUMBER OF KING STUDS EACH SIDE OF OPENING (FULL LENGTH)
- NUMBER OF JACK STUDS EACH SIDE OF OPENING (UNDER HEADER)
- SPAN OF HEADER
- SIZE OF HEADER MATERIAL
- NUMBER OF PLIES IN HEADER

STRUCTURAL PLAN

SCALE: 1/4" = 1'-0"

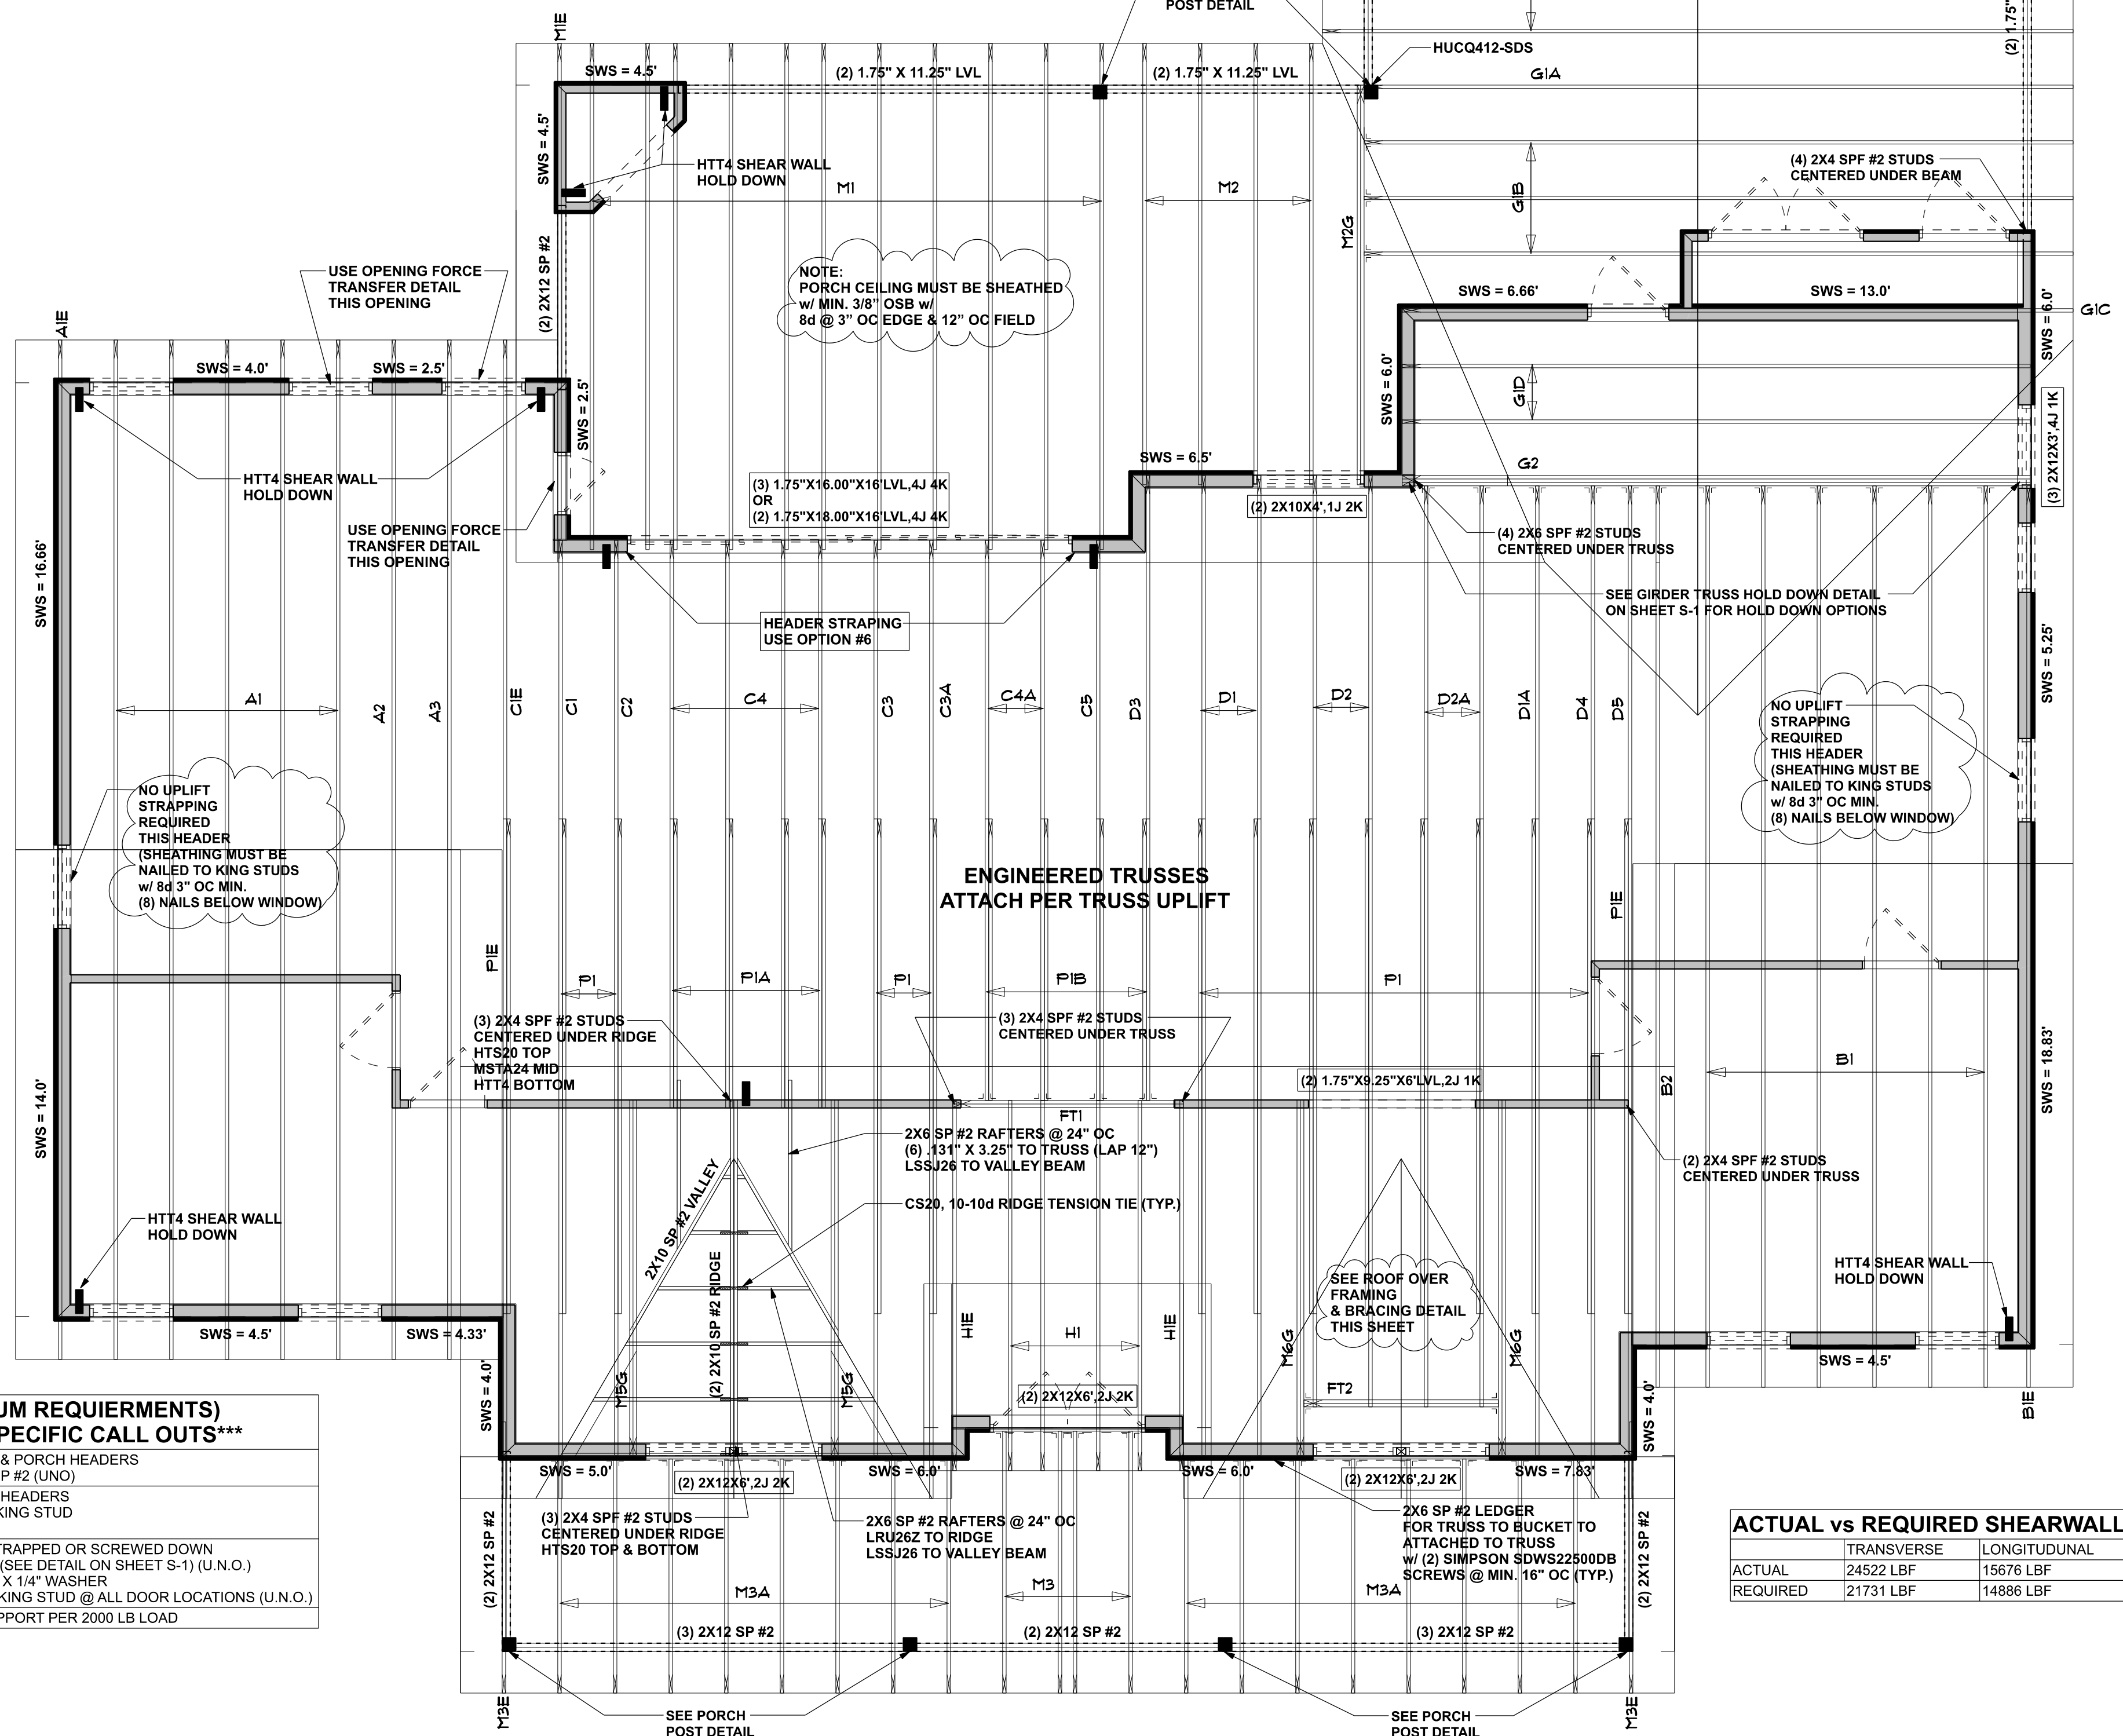

ACTUAL vs REQUIRED SHEARWALL

	TRANSVERSE	LONGITUDINAL
ACTUAL	24522 LBF	15676 LBF
REQUIRED	21731 LBF	14886 LBF

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER, W.B. HOWLAND TRUSS CO. JOB #23-0098

Netles Res.

PROJECT ADDRESS: Columbia County, FL

FL PE 53915

This item has been digitally signed and sealed by Mark Disoway, P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=U.S. O=Florida, dnQualifier=A014 10C0000017E97 DE07CA000746F 0, CN=Mark d Disoway 2023-12-28 14: 11:34

DIMENSIONS: Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 2018 Edition Florida Building Code Residential (2023) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:

231515

S-3

OF 3 SHEETS