


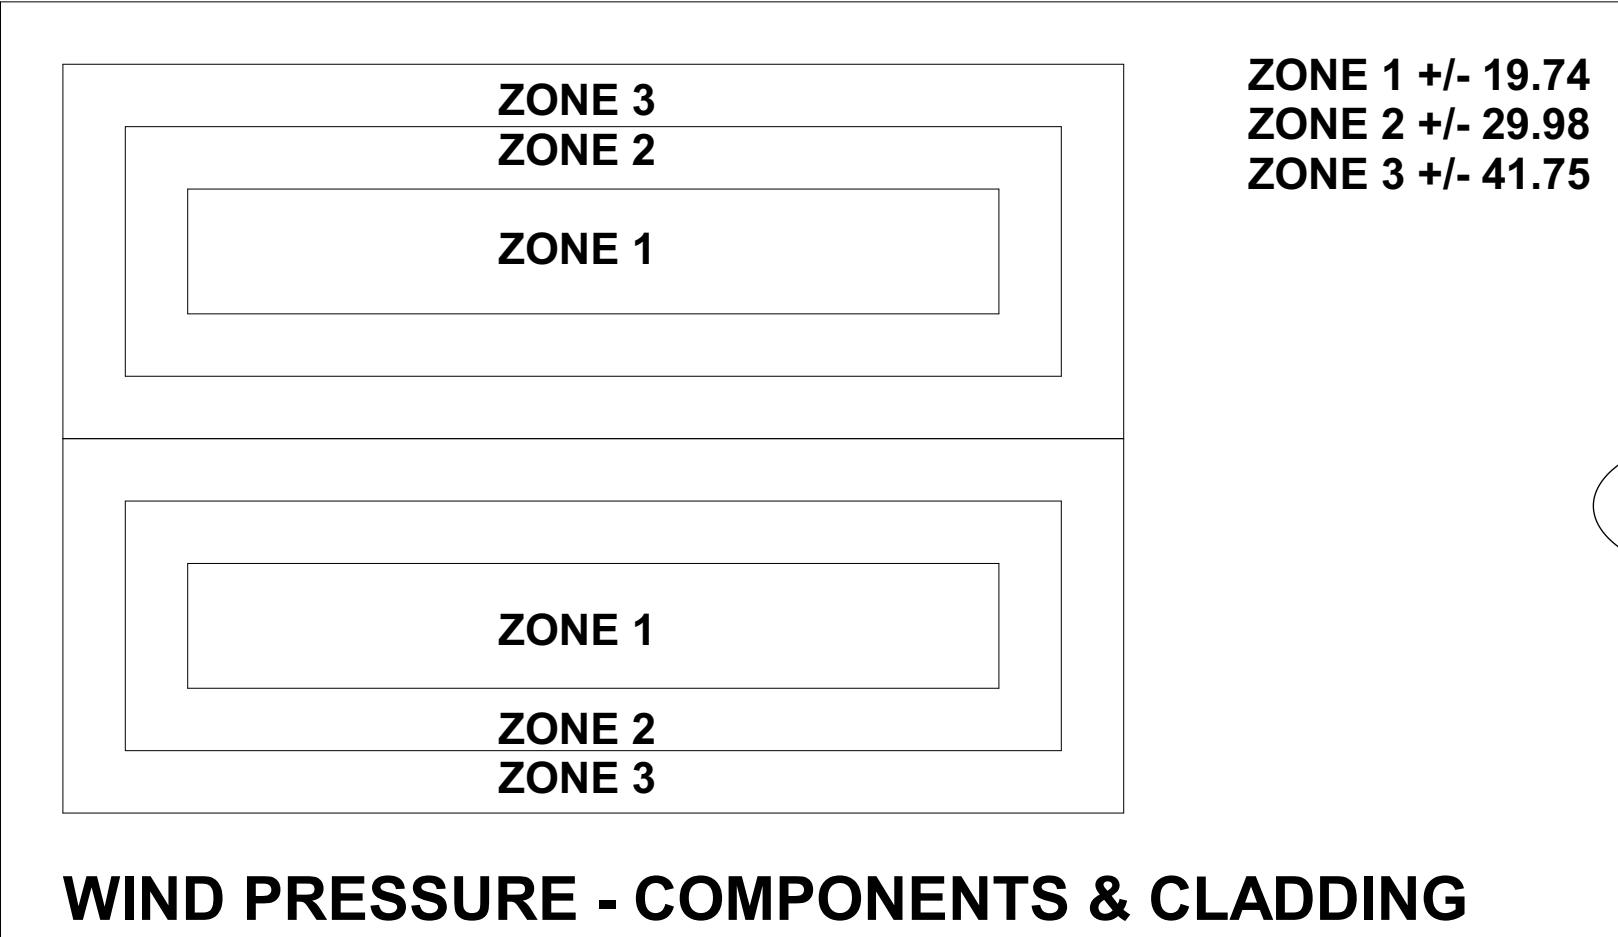

ZONE 1 +/- 19.74
ZONE 2 +/- 29.98
ZONE 3 +/- 41.75

WIND EXPOSURE CATEGORY

☒ X

☐ B

☐ C

☐ D

MAIN BUILDING DIMENSIONS

D-1		
BARN WIDTH (FT)	6"X6" POST	8"X8" POST
50	-	48'-8"
40	39'-1"	38'-8"
38	37'-1"	36'-8"
36	35'-1"	34'-8"
34	33'-1"	32'-8"
32	31'-1"	30'-8"
30	29'-1"	28'-8"
28	27'-1"	26'-8"
26	25'-1"	24'-8"
24	23'-1"	22'-8"
22	21'-1"	20'-8"
20	19'-1"	18'-8"
18	17'-1"	16'-8"
16	15'-1"	14'-8"
14	13'-1"	12'-8"
12	11'-1"	10'-8"

ULTIMATE & NOMINAL
WIND SPEEDS

ULTIMATE	NOMINAL
120	93
130	101
140	108
150	116
155	120
160	124

DESIGN CRITERIA:

FLORIDA BUILDING CODE 2020 7TH ED.
DESIGN LOADS PER ASCE 7-16
DESIGN SPEED - 130 MPH
ROOF LIVE LOAD - 12.5 PSF
DEAD LOAD - 2.5 PSF
WIND RISK CATEGORY - I
EXPOSURE CATEGORY - B
IMPORTANCE FACTOR - 1.0
INTERNAL WIND PRESSURE - +/- 0.18 PSI

POLE BARN SPECIFICATIONS

GABLE WIDTH : 50'
BUILDING LENGTH : 89'
EAVE HEIGHT : 14'
POLE SPACING : 12'
ROOF PITCH : 3:12
WALLS : OPEN
FLOOR : CONCRETE
ROOF METAL : 29 GA.
SIDE METAL : NONE
POST SIZE : 8"X8"
POST FOOTING SIZE : 24"X48"
CONCRETE : 3,000 PSI

MAIN POST HEIGHT (D-3)				OTHER
SIZE CIRCLED OR LESS				
10'	12'	14'	16'	20'


POST SPACING D-2 (FT)		
☐ 8	☐ 10	☒ 12

POST SIZE		
☐ 6"X6"	☒ 8"X8"	☐ 10"X10"

POST FOOTING SIZE	
F-1	18" DIA. X 48" DEEP
F-2	24" DIA. X 48" DEEP

ROOF PITCH			
3/12	4/14	5/12	6/12




METAL ROOF	
26 GA	29 GA

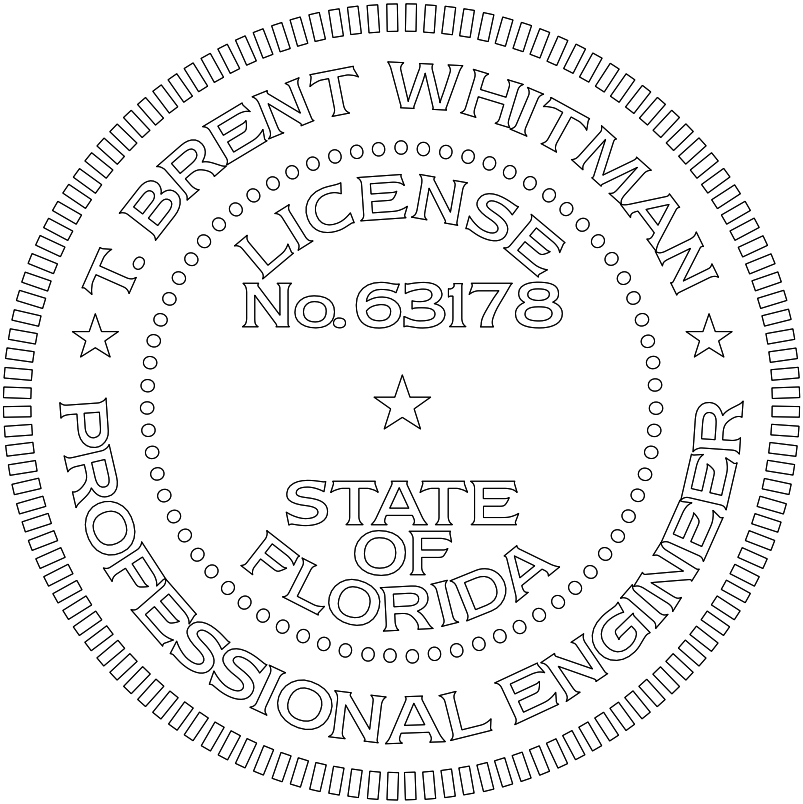

T. BRENT WHITMAN
LICENSE
No. 63178
STATE
OF
FLORIDA
PROFESSIONAL ENGINEER

Tomas B. Whitman, PE
MADISON ENGINEERING
This has been electronically signed and
sealed by TOMAS B. WHITMAN, PE
using a Digital signature and date.
Printed copies of this document are not
considered signed and sealed and the
signature must be verified on an
electronic device.


Tomas B
Whitman
2023.03.23
17:25:56 -04'00'

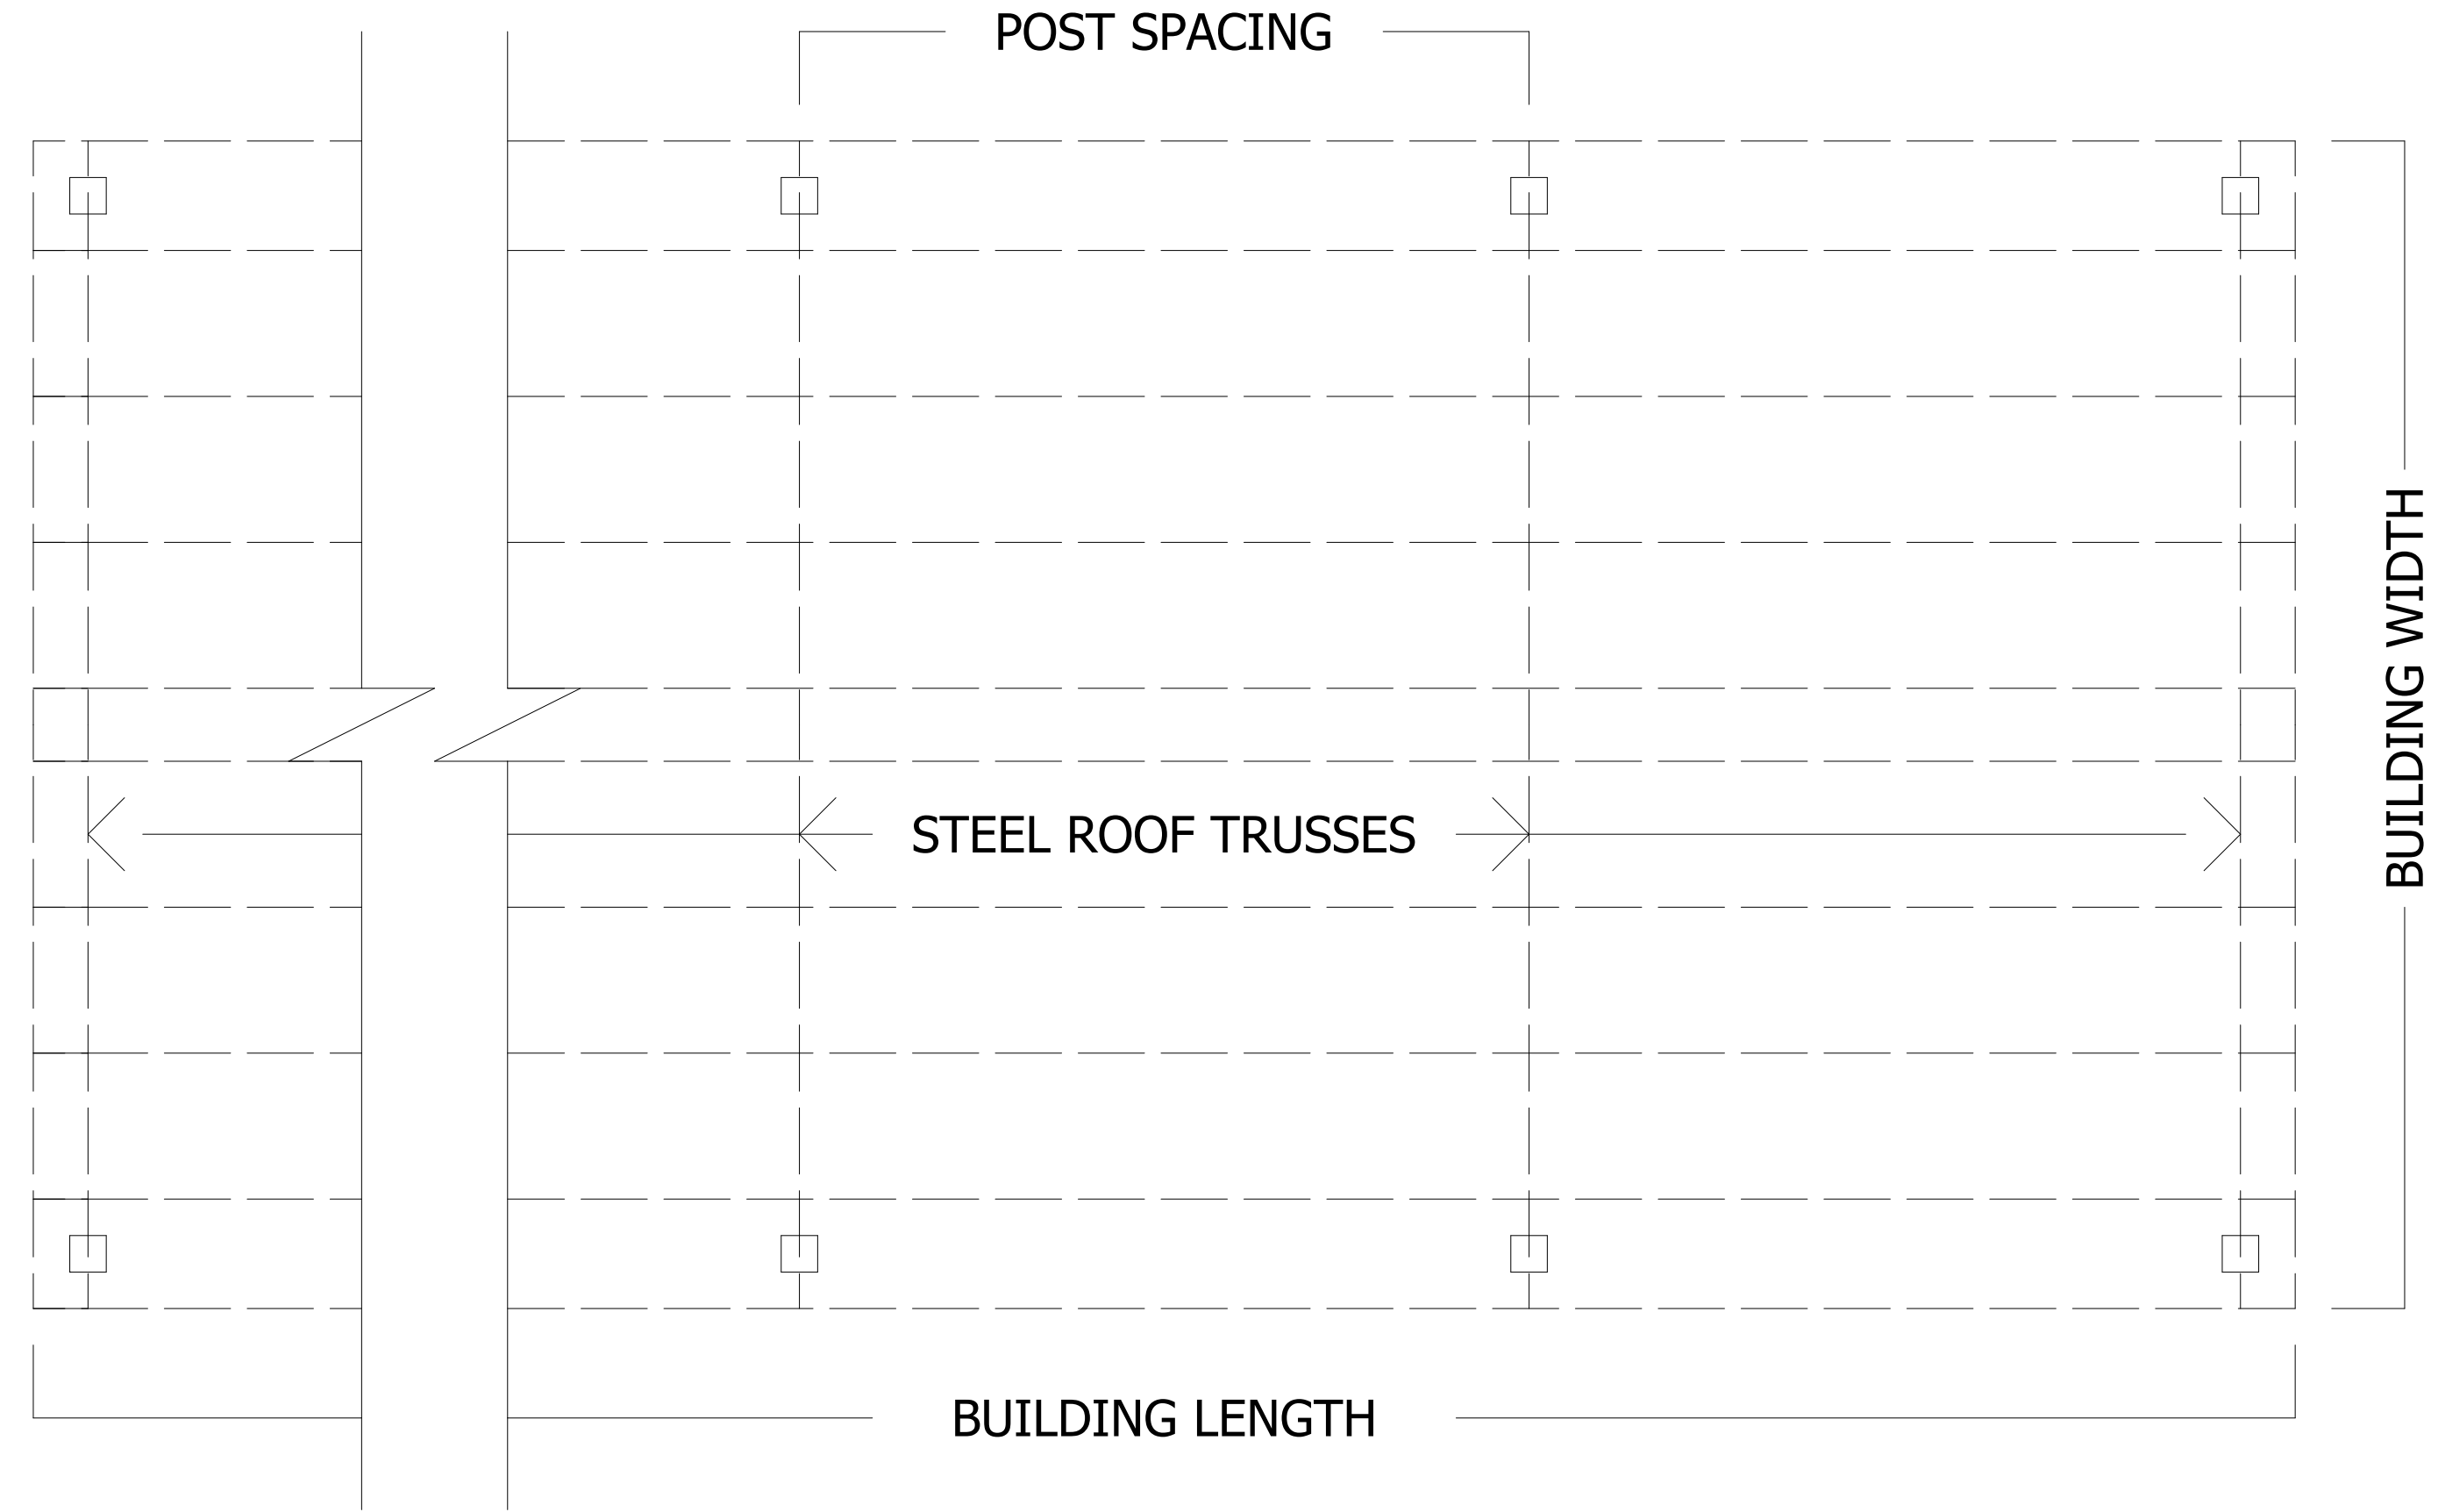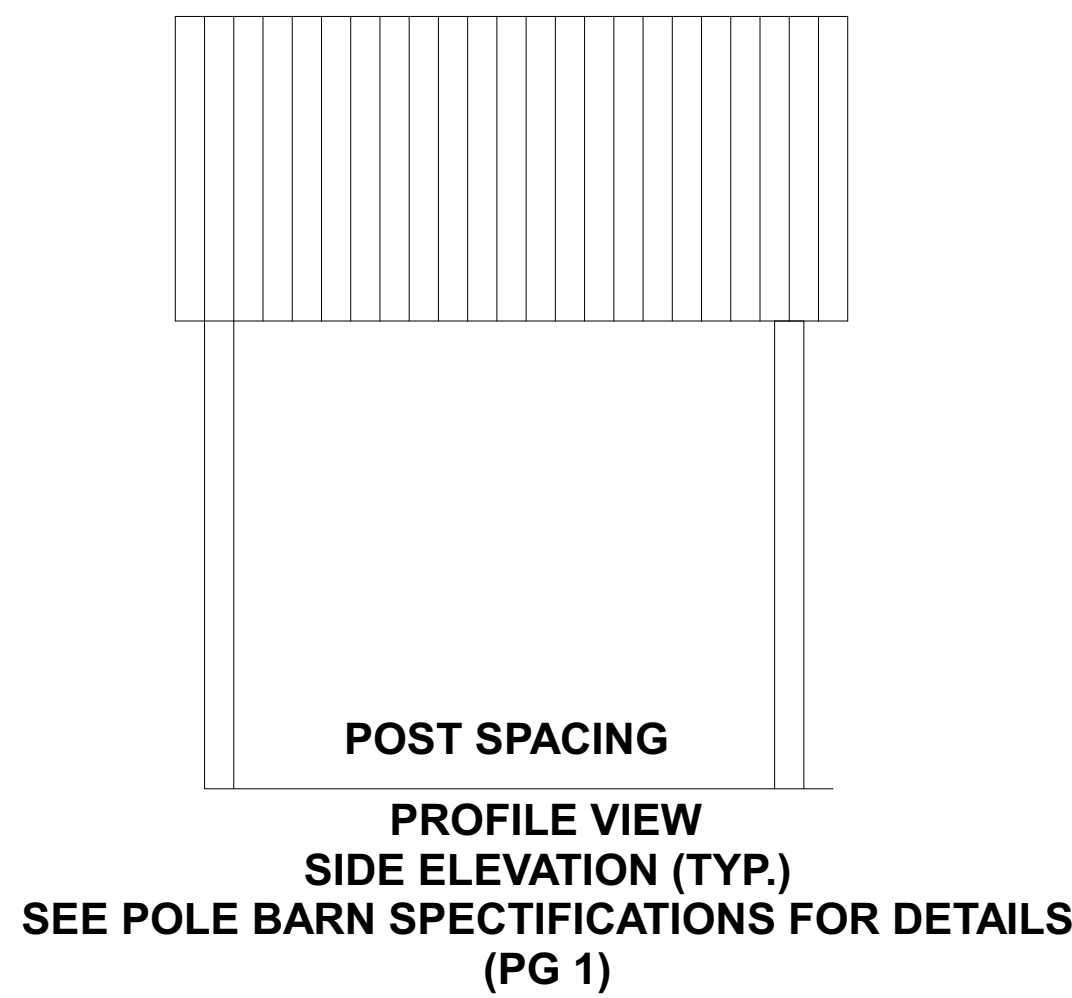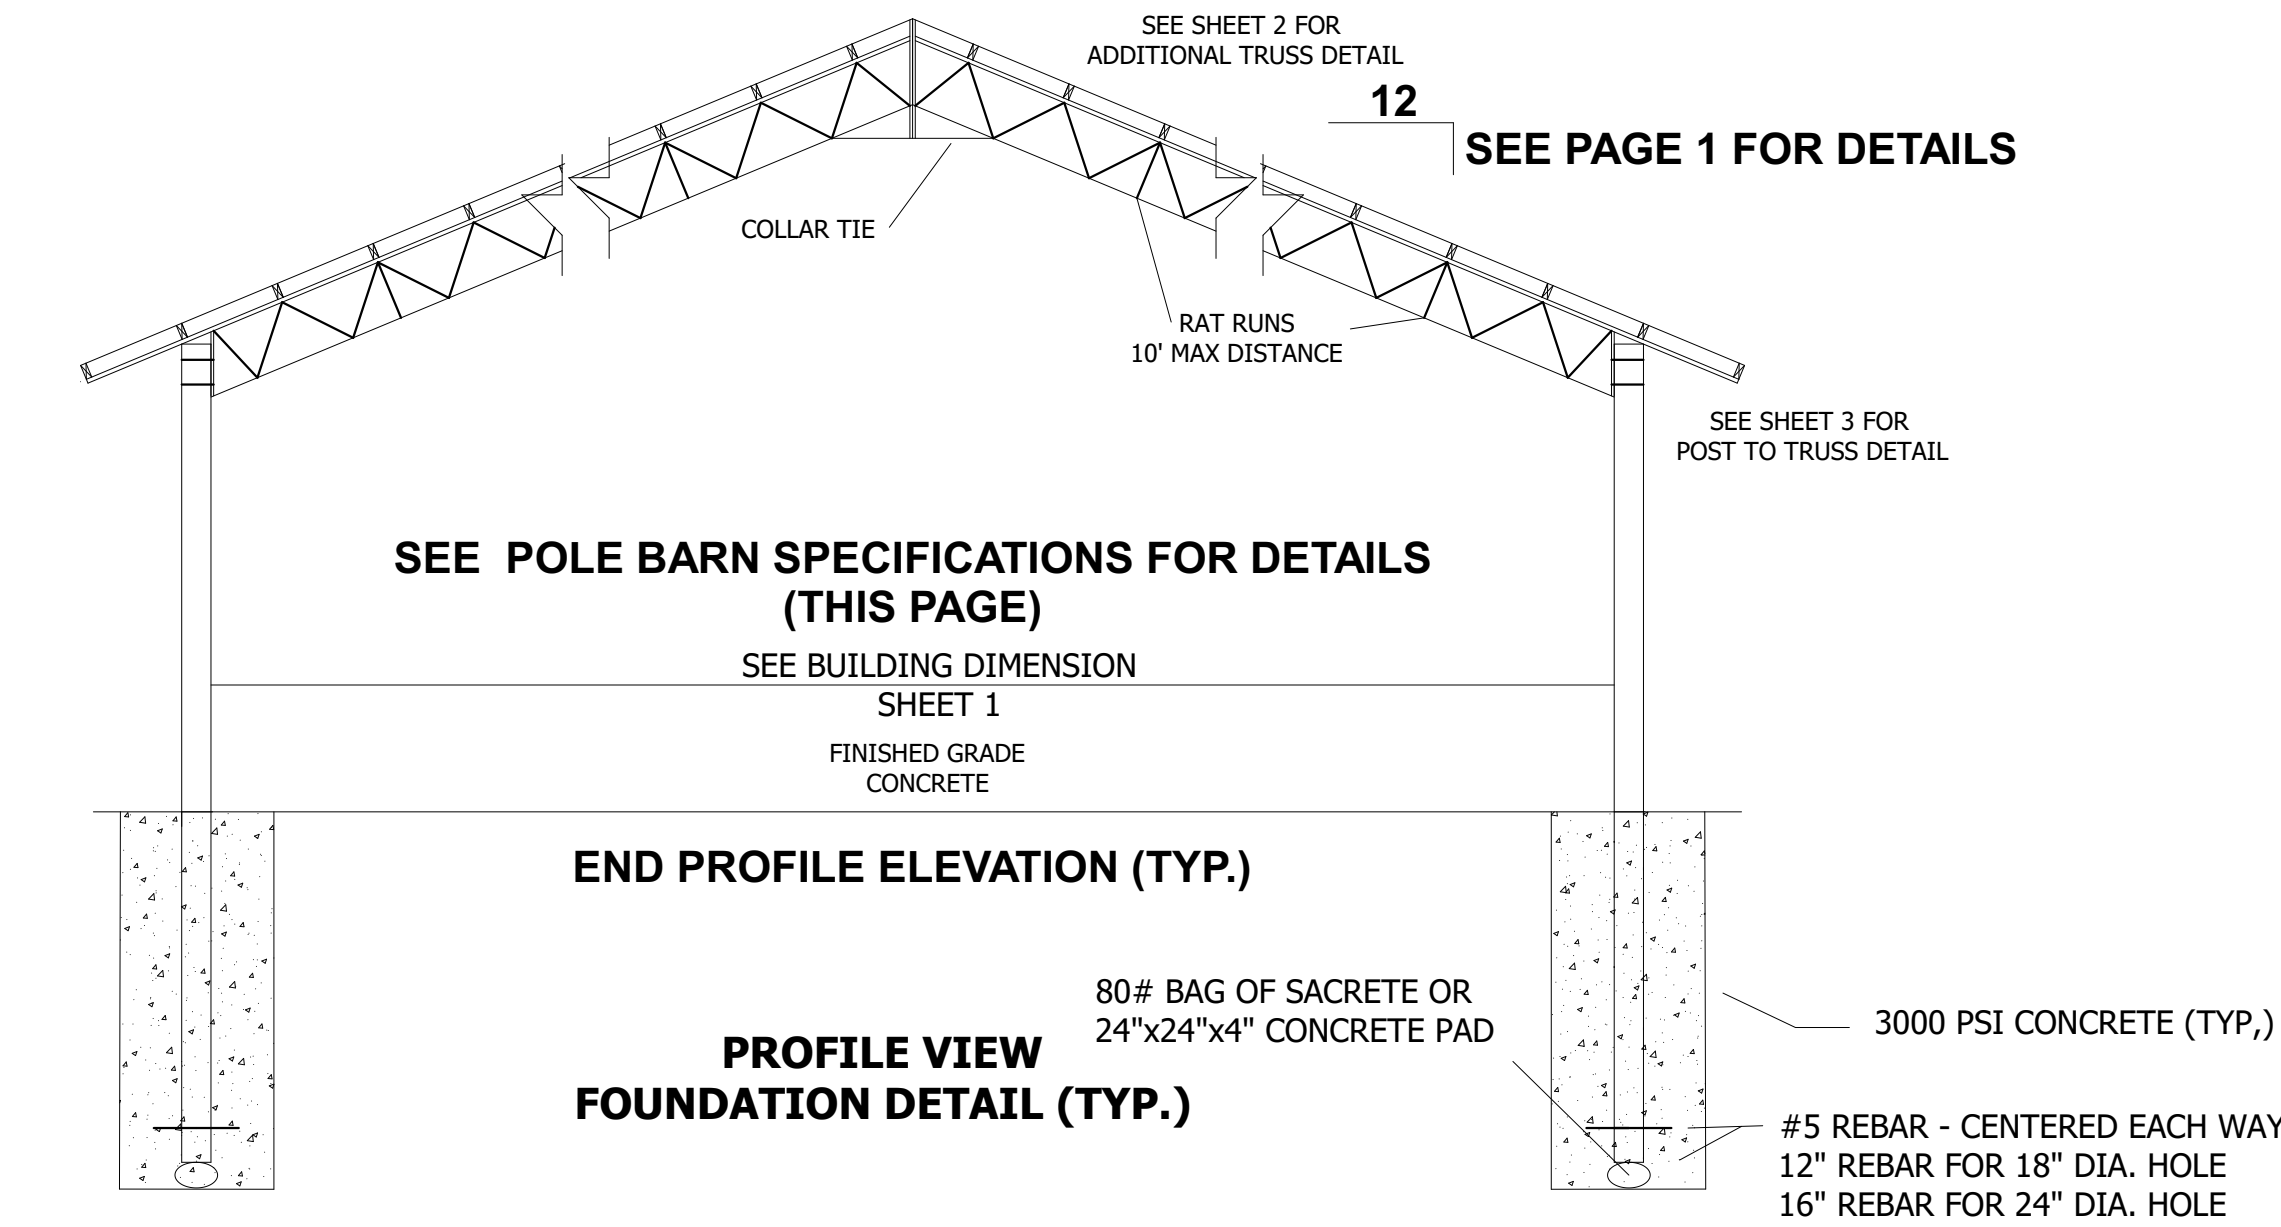

BARN PLAN VIEW (TYP.)

NOTES:

1. PURLINS SHALL BE 2X6 #2 SYP (MAX SPACE @2'-0" O.C.)
2. CONTRACTOR IS RESPONSIBLE FOR TEMPORARY & PERMANENT CONSTRUCTION BRACING.
3. ALL DEMINSIONS SHALL BE VERIFIED PRIOR TO FABRICATION.
4. ALL WELD PER AWS STANDARDS.
5. ALL STELL AND FABRICATION PER ASCI STANDARDS.
7. ITEM DEMINSIONS ARE TO BE MODIFIED FOR SHORTER TRUSS LENGTHS.
8. ALL FASTNERS SHALL BE INSTALLED PER MANUFACTURES SPECIFICATIONS.
9. TRUSS DESIGN CAN BE USED FOR TRUSS LENGTHS SHORTER THAN 25 FEET.
10. CONCRETE WORK SHALL CONFORM TO 'BUILDING CODE REQUIRMENTS FOR REINFORCED CONCRETE' (ACI-318).
11. ALL CONCRETE SHALL BE 3000 PSI MIN. W/ WWF OR FIBER



Tomas B. Whitman, P.E.
MADISON ENGINEERING
This has been electronically signed and
sealed by TOMAS B. WHITMAN, P.E.
using a Digital signature and date.
Printed copies of this document are not
considered signed and sealed and the
signature must be verified on an
electronic device.

Tomas B
Whitman
2023.03.23
17:26:19 -04'00'

POLE BARN A - 50 X 89
ABT TRUSSES

CHRIST CENTRAL MINISTRIES (50X89)

217 SW DYAL AVENUE, LAKE CITY, FL 32024

© COPYRIGHT 2022 ME


MAILED ONLY WITH DATED
ORIGINAL SIGNATURE AND
NEW OR UNEXPRESSED SEAL

T. BRENT WHITMAN, P.E.
FL. P.E. #63178 / GA. P.E. #031609

SHEET NO.

2





MADISON ENGINEERING, LLC
CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING



269 NE Ridge Loop
Madison, Florida 32340
Phone 850.973.7864
COA No.: 27216 www.madisonengineer.com

DESIGNED TBW
DRAWN DVD
CHECKED TBW
APPROVED TBW
JOB NO.: 35223137
DATE: MARCH 2023

COLUMBIA COUNTY

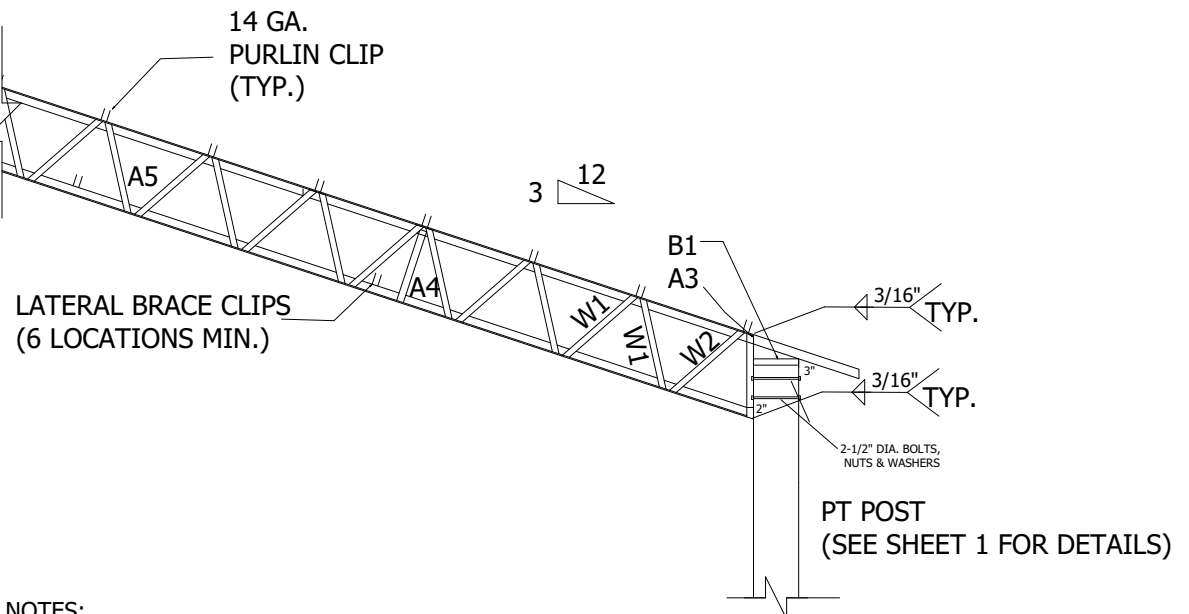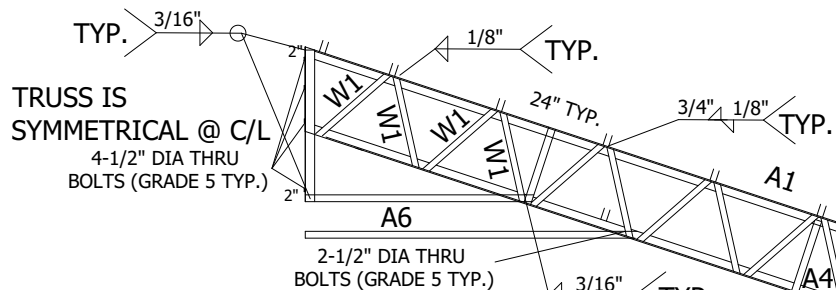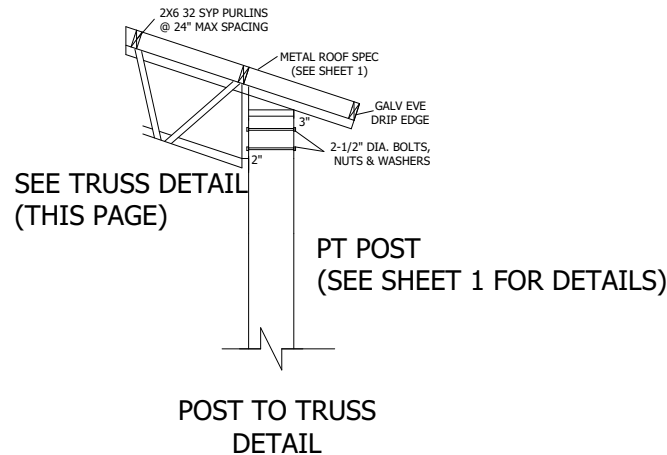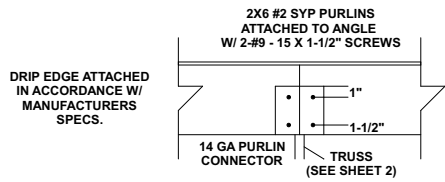

NOTES: TRUSS CROSS-SECTION

- 1- MATERIALS SHALL CONFORM TO STEEL ASTM 572.
- 2- ALL STEEL SHALL BE 50ksi IN ACCORD WITH CURRENT AISC MANUAL.
- 3- WELDING ELECTRODES SHALL BE TYPE E70XX
- 4- ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWS REQUIREMENTS
- 5- ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
- 6- BOL TS SHALL BE ASTM A325. w/ NUTS & WASHERS. TYP)
- 7- WELD STRENGTH 70 KSI MIN:
- 8- ALL POST SHALL BE #2 DENSE PRESSURE TREATED GROUND CONTACT.
- 9- PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
- 10- MIN EDGE DISTANCE FOR BOLTS HOLES SHALL BE 3/4" MIN
- 11- MAX TRUSS SPACING SHALL NOT EXCEED 12'-0" UNO.
- 12-THE DESIGNER DISCLAMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBIL TY OR EXERCISES NO CONTROL WITH REGUARD TO FABRICATION, HANDLING, AND INSTALLATION OF TRUSSES.

NOTES:

1. PURLINS SHALL BE 2X6 #2 SYP (MAX SPACE @2'-0" O.C.)
2. CONTRACTOR IS RESPONSIBLE FOR TEMPORARY & PERMANENT CONSTRUCTION BRACING.
3. ALL DEMINSIONS SHALL BE VERIFIED PRIOR TO FABRICATION.
4. ALL WELD PER AWS STANDARDS.
5. ALL STELL AND FABRICATION PER ASCI STANDARDS.
7. ITEM DEMINSIONS ARE TO BE MODIFIED FOR SHORTER TRUSS LENGTHS.
8. ALL FASTNERS SHALL BE INSTALLED PER MANUFACTURES SPECIFICATIONS.
9. TRUSS DESIGN CAN BE USED FOR TRUSS LENGTHS SHORTER THAN 50 FEET.
10. WELDING ELECTRODES SHALL BE E70XX
11. ALL WELDS SHALL BE IN ACCORDANCE WITH AWS REQUIRMENTS.
12. ALL POST SHALL BE #2 DENSE PRESSURE TREATED.

BILL OF MATERIALS			
ITEM NO.	DESCRIPTION		MATERIAL (50 KSI)
A1	TOP CHORD	LL 2 X 2 X 3/16*	ASTM 572
A2	BOTTOM CHORD	LL 2 X 2 X 3/16*	ASTM 572
A3	VERTICAL CHORD	LL 3 X 2 X 3/8*	ASTM 572
A4	VERTICAL CHORD	L 1 1/2 X 1 1/2 X 3/16	ASTM 572
A5	TIE	L 2 X 2 X 3/16	ASTM 572
A6	TIE	L 3 X 2 X 3/16	ASTM 572
W1	WEB	L 1-1/4 X 1-1/2 X 3/16	ASTM 572
W2	WEB	L 1-1/4 X 1-1/2 X 3/16	ASTM 572
B1	BASE	LL 2 X 2 X 3/16*	ASTM 572
NOTE: LL * DENOTES DOUBLE ANGELS			



Tomas B. Whitman, P.E.
This has been electronically signed and
sealed by TOMAS B. WHITMAN, P.E.
using a Digital signature and date.
Printed copies of this document are not
considered signed and sealed and the
signature must be verified on an
electronic device.

Tomas B
Whitman
2023.03.23
17:26:39 -04'00'

MADISON ENGINEERING, LLC
CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING



289 NE Ridge Loop
Maitland, FL 32751
Phone 407.973.7864
COA No: 27216 www.madisonengineer.com

POLE BARN A - 50X89

ABT TRUSSES

CHRIST CENTRAL MINISTRIES (50X89)

217 SW DIAL AVENUE, LAKE CITY, FL 32024

© COPYRIGHT 2022 ME



T. BRENT WHITMAN, P.E.






FL P.E. REG. NO. 63178

SHEET NO.

3


DESIGNED TEB
DRAWN DVD
CHECKED TEB
APPROVED TEB
JOB NO: 3523137
DATE: MARCH 2023

COLUMBIA COUNTY

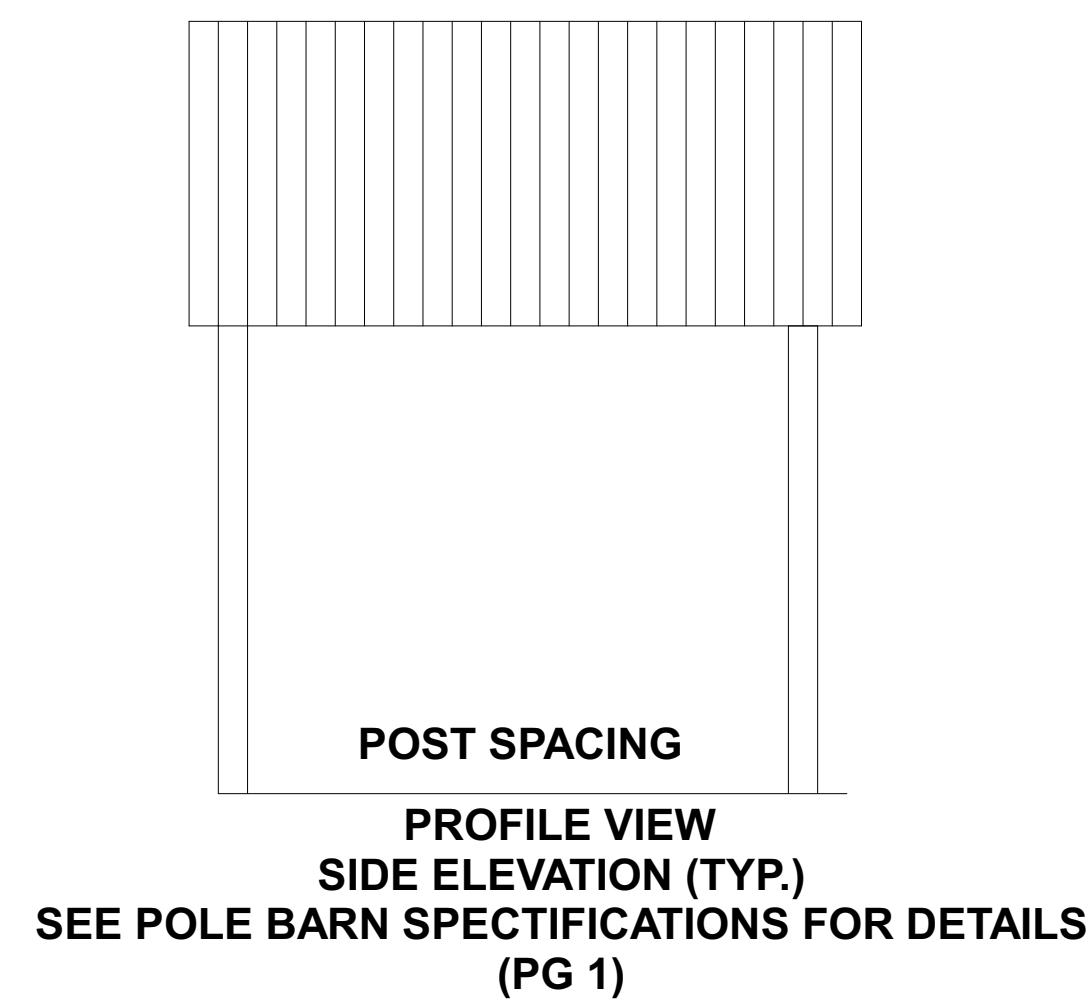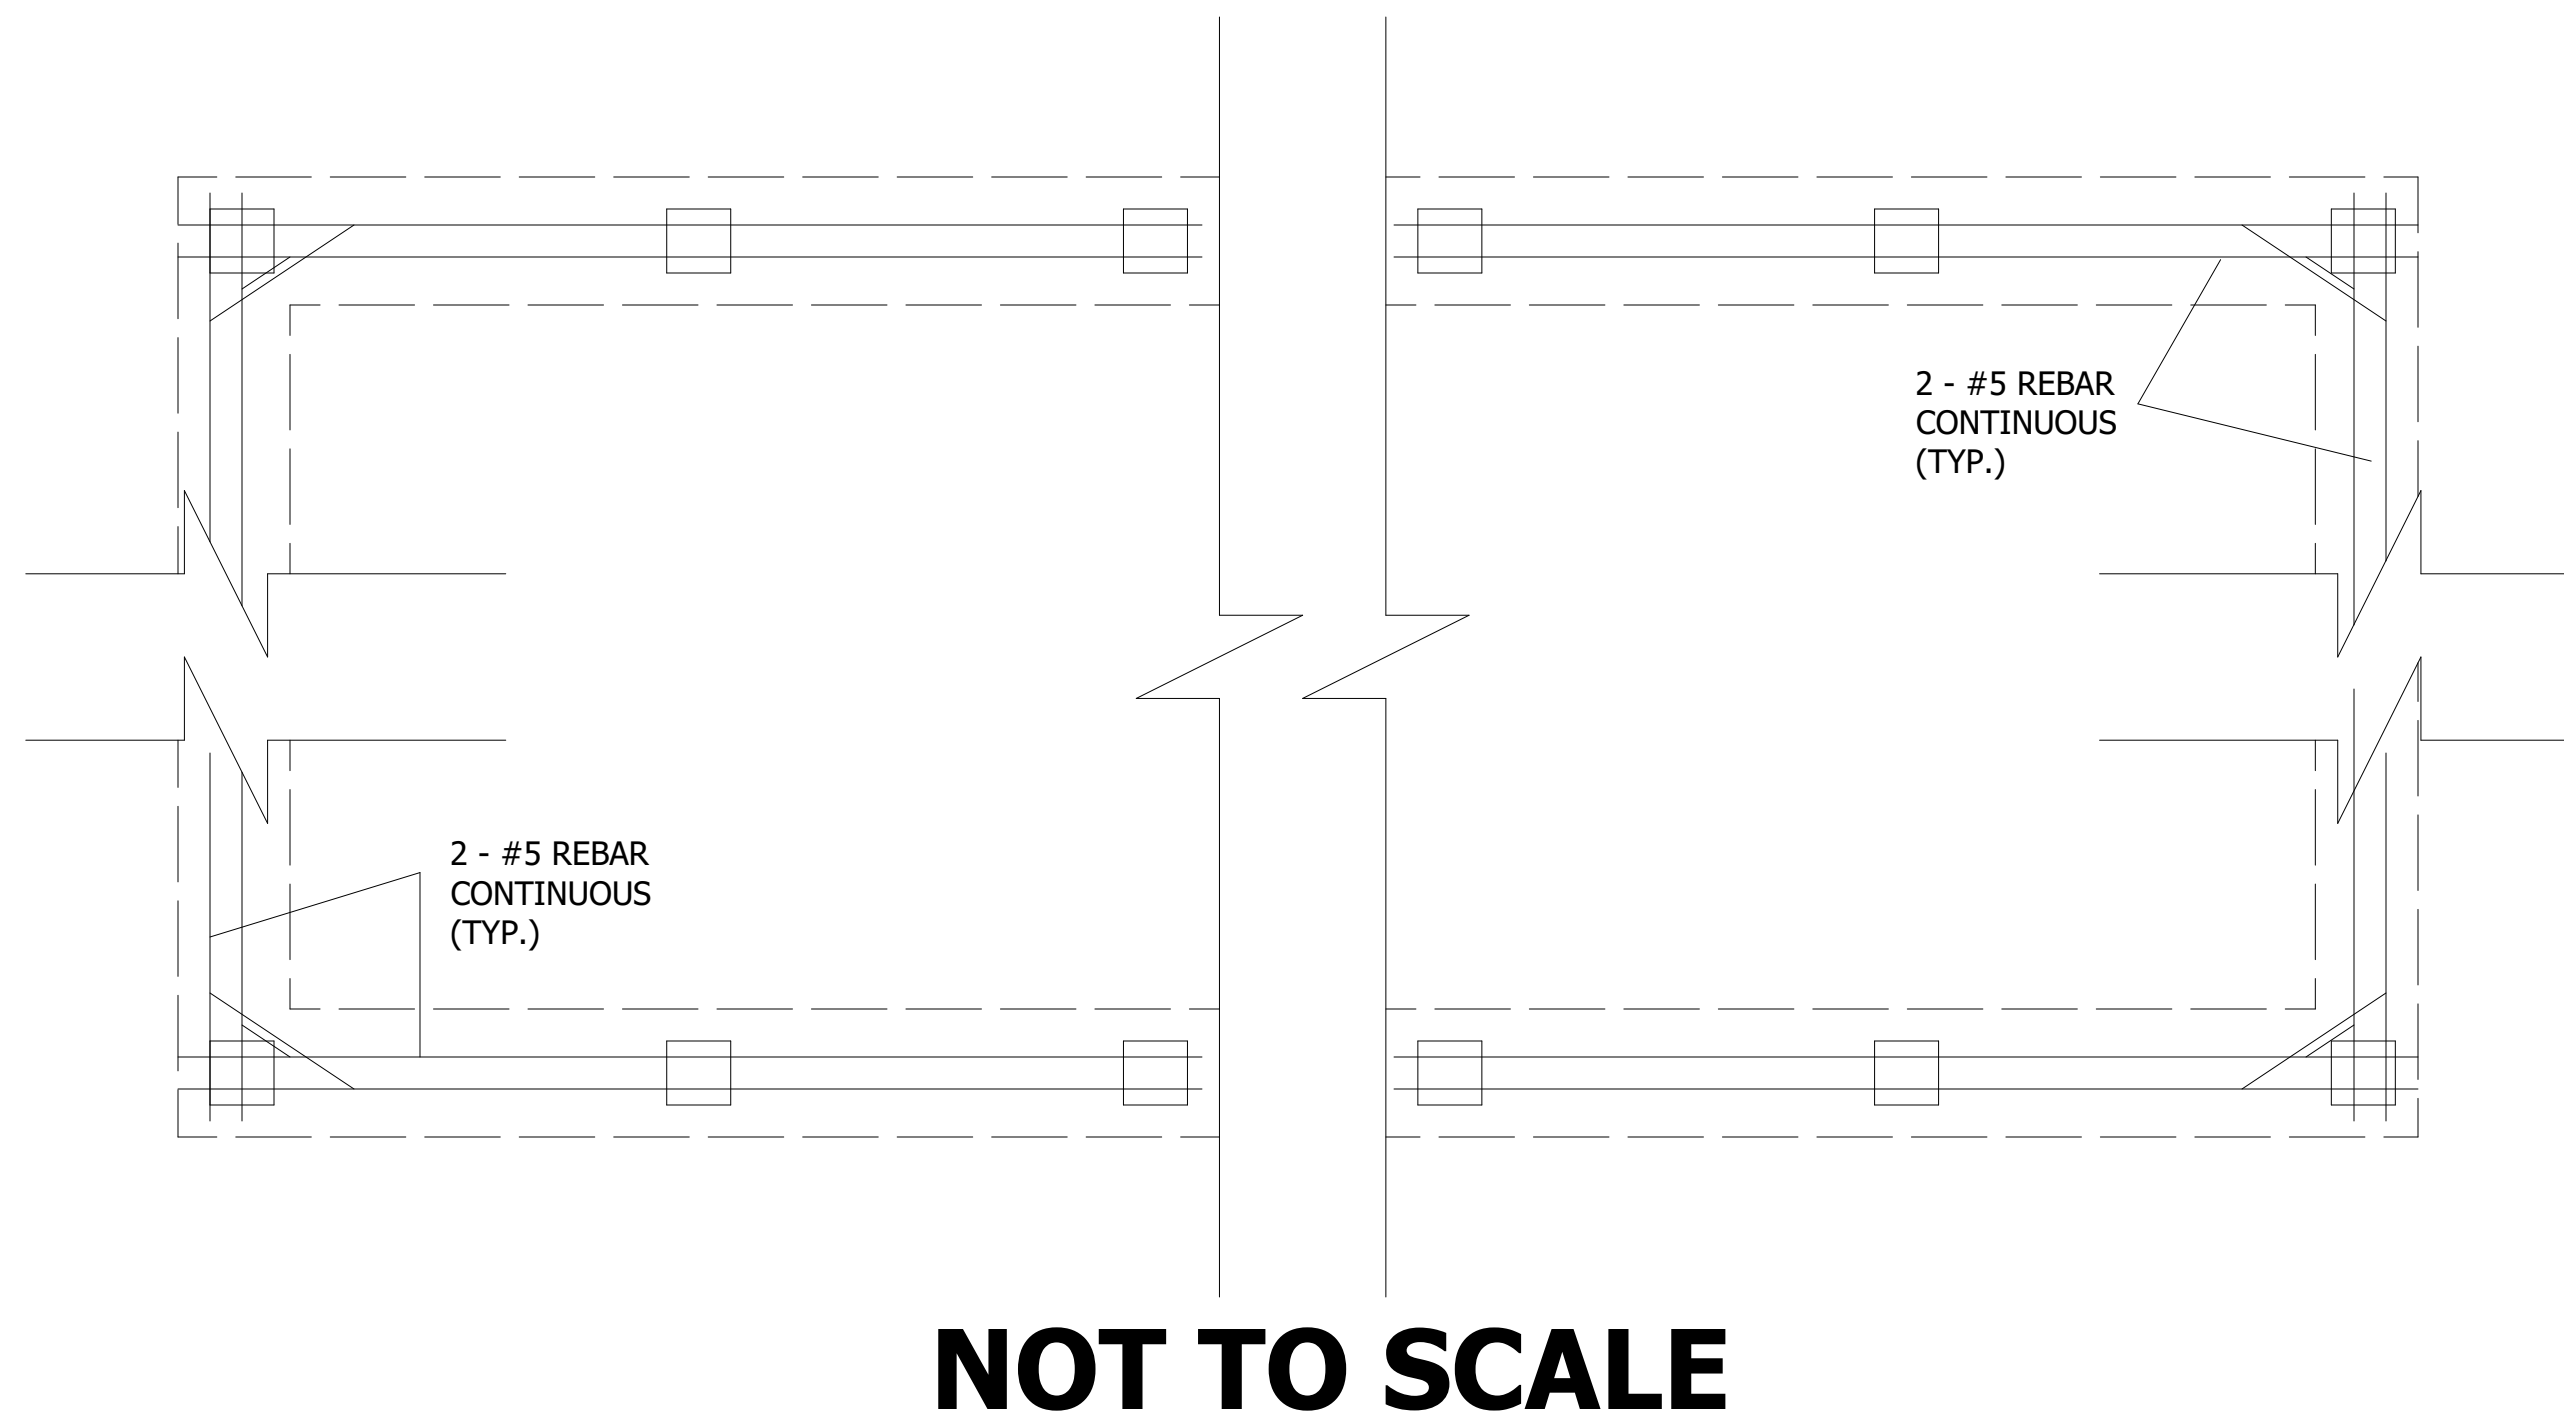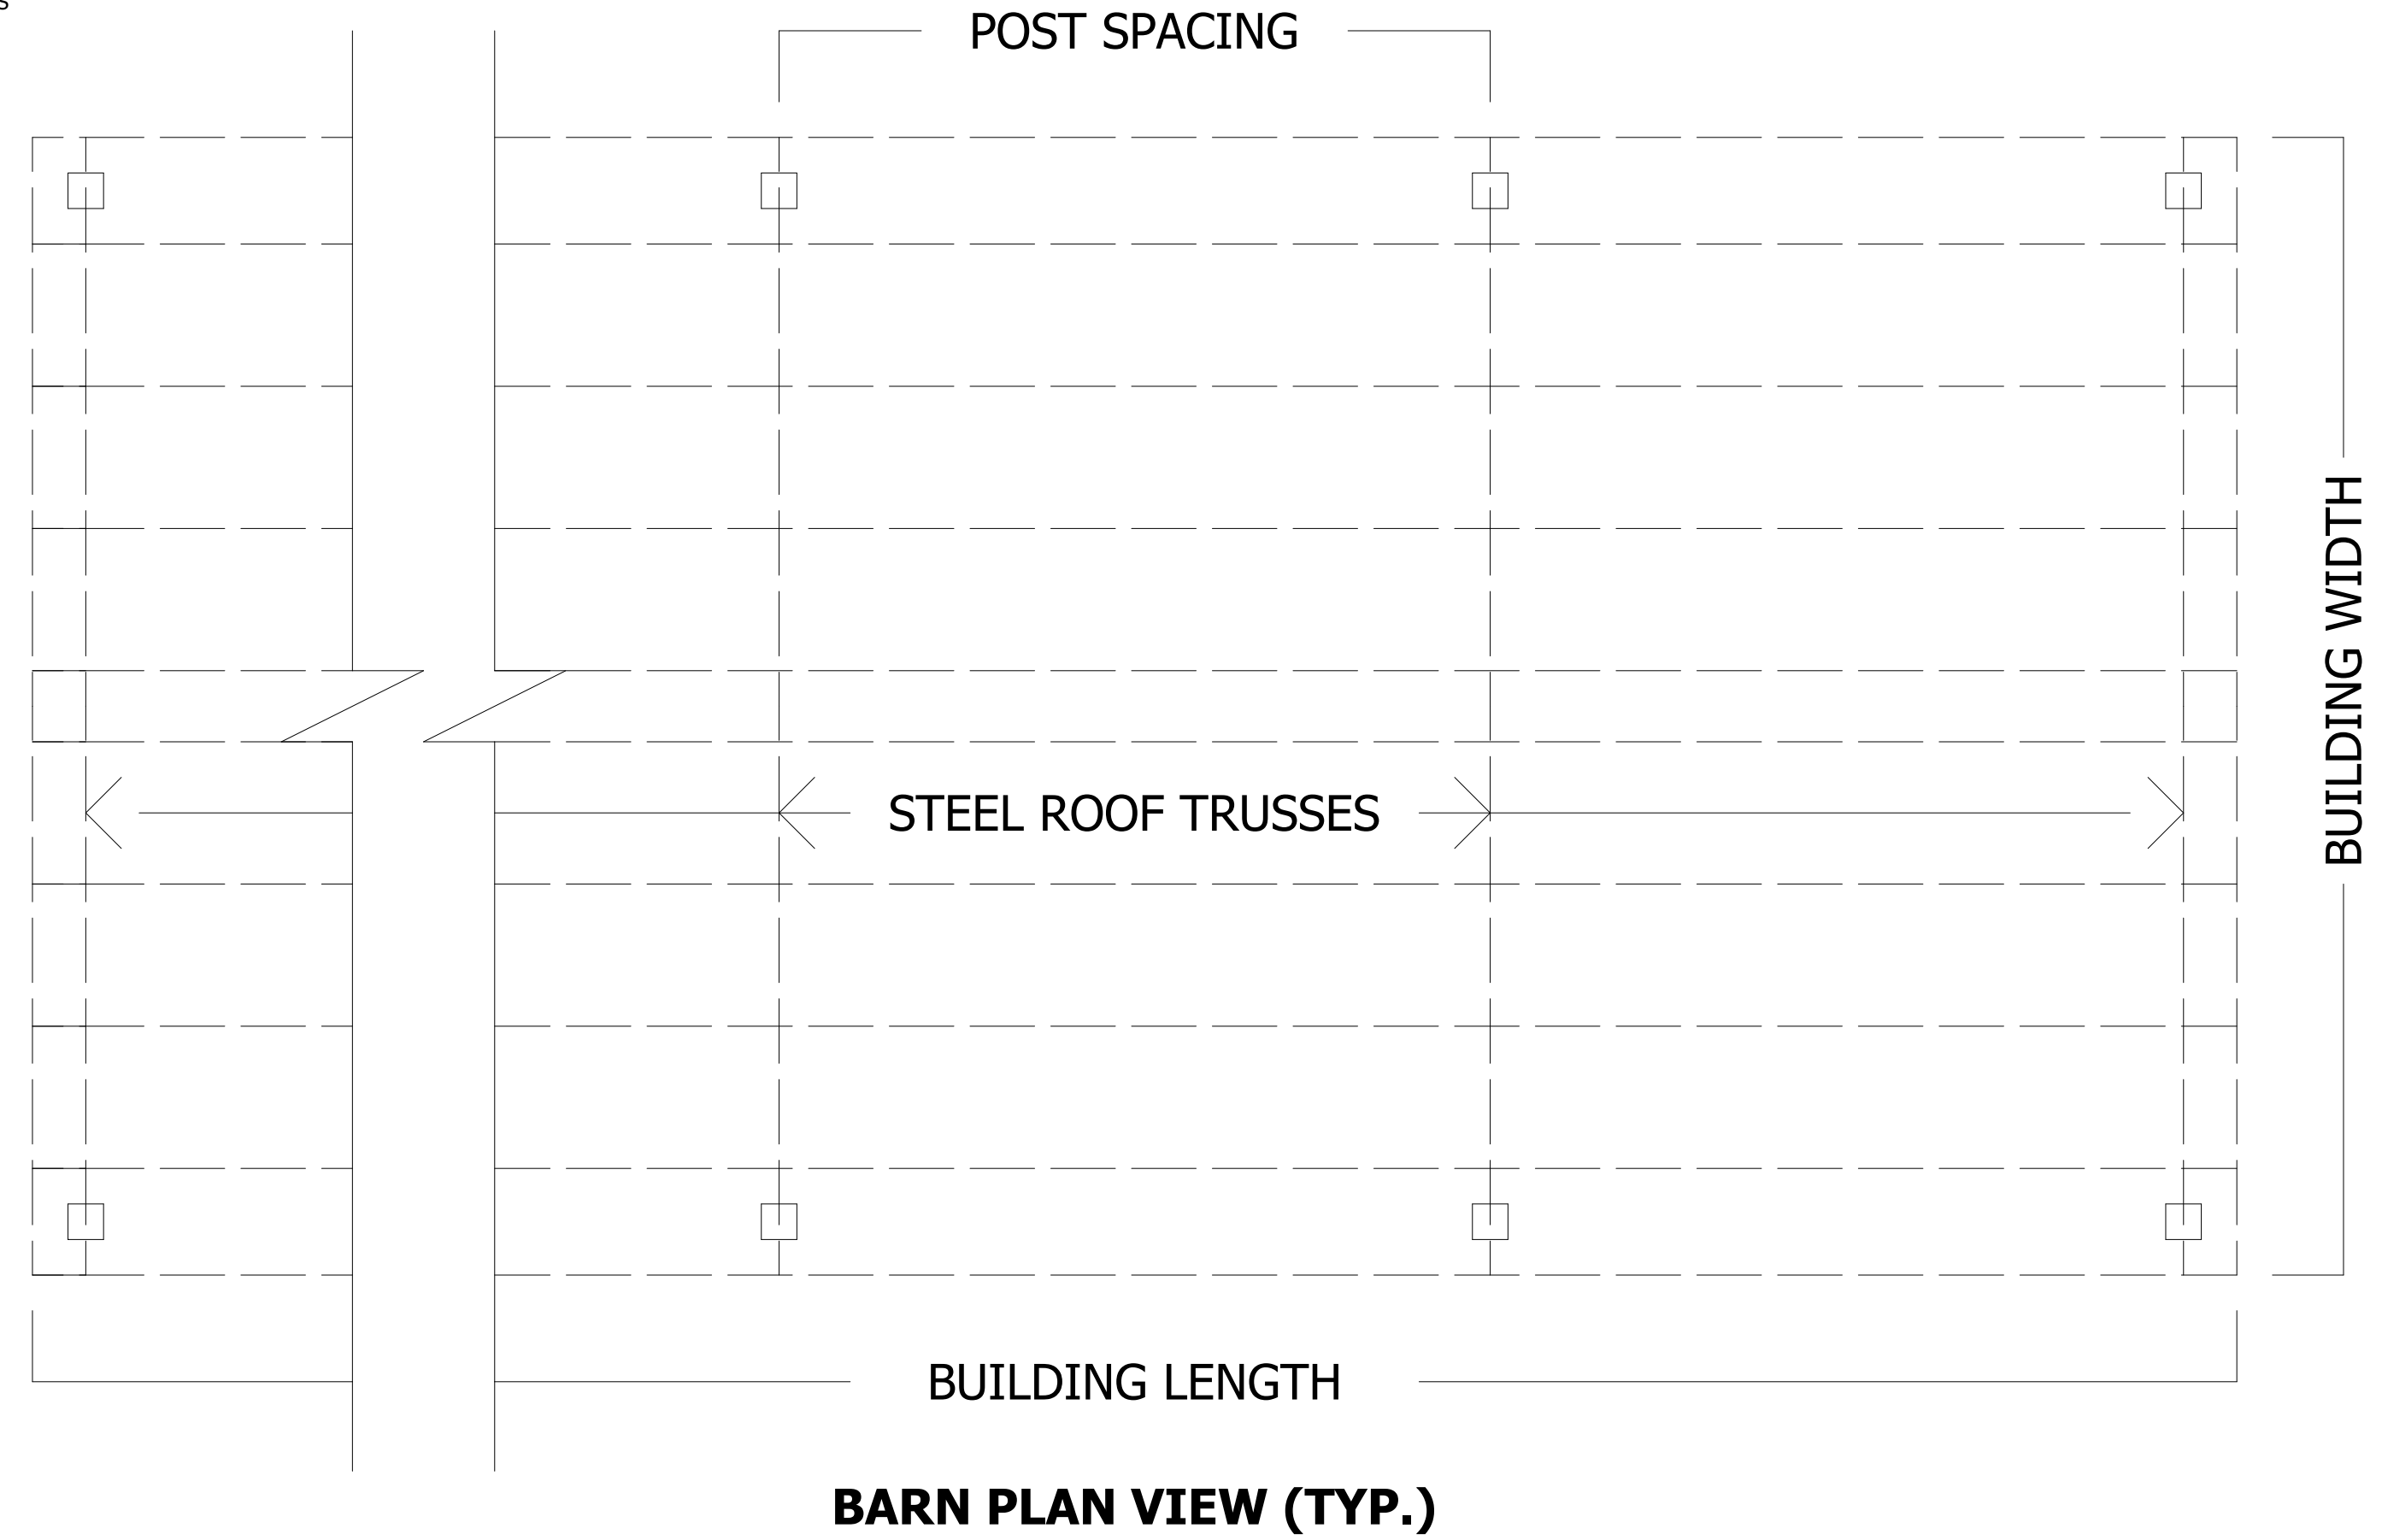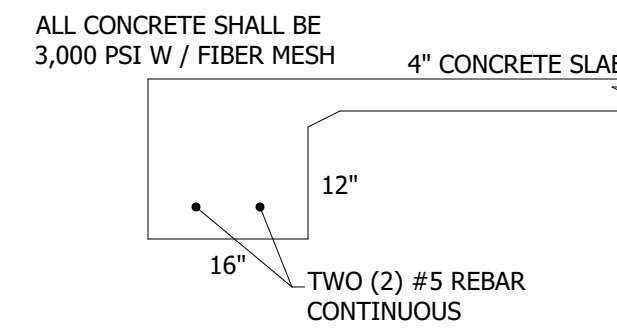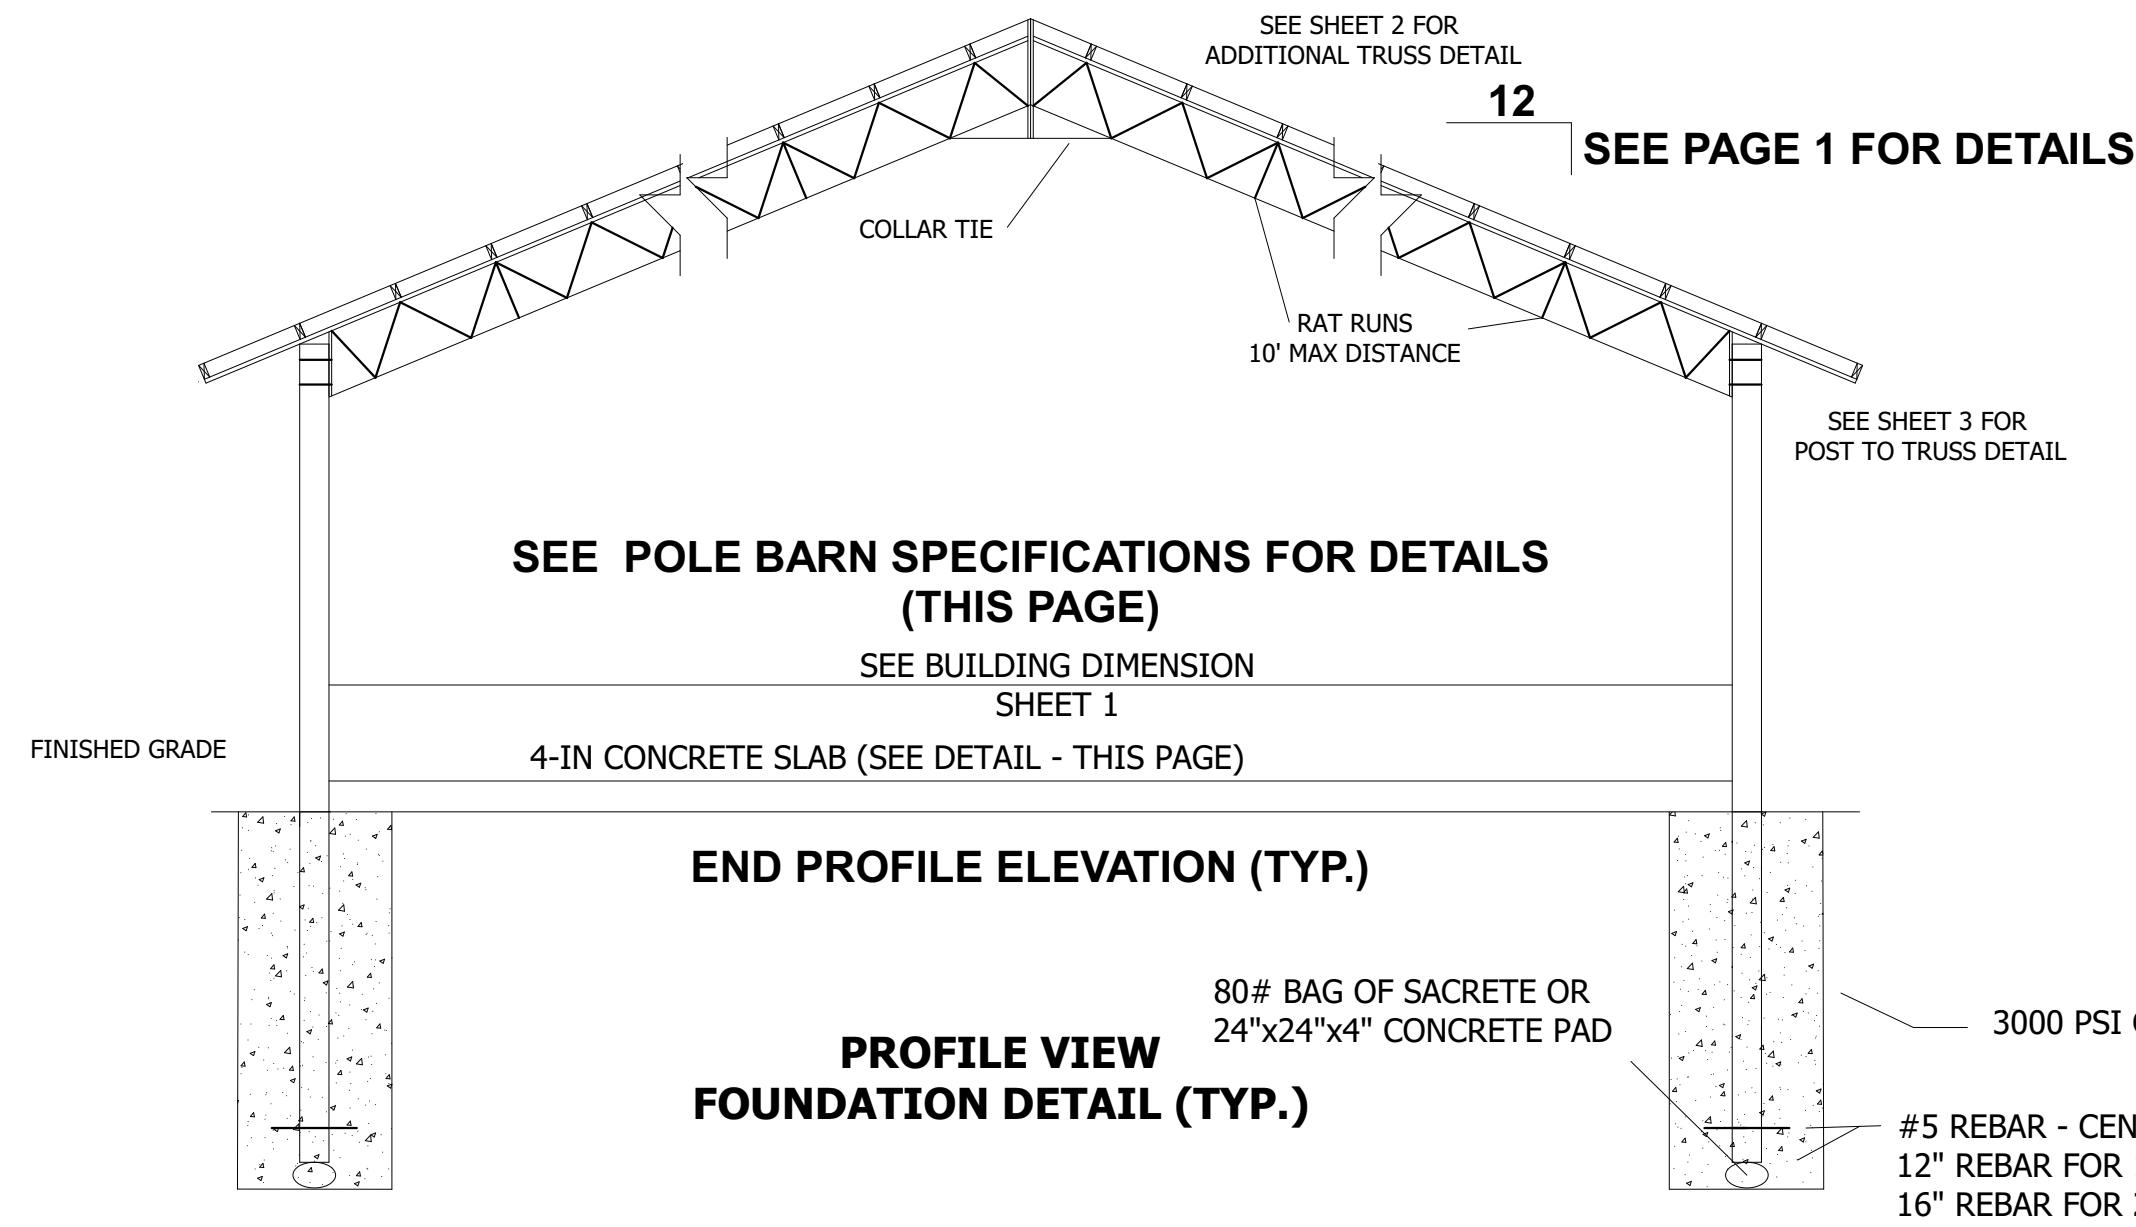

NOTES:

1. PURLINS SHALL BE 2X6 #2 SYP (MAX SPACE @2'-0" O.C.)
2. CONTRACTOR IS RESPONSIBLE FOR TEMPORARY & PERMANENT CONSTRUCTION BRACING.
3. ALL DEMINSIONS SHALL BE VERIFIED PRIOR TO FABRICATION.
4. ALL WELD PER AWS STANDARDS.
5. ALL STELL AND FABRICATION PER ASCI STANDARDS.
7. ITEM DEMINSIONS ARE TO BE MODIFIED FOR SHORTER TRUSS LENGTHS.
8. ALL FASTNERS SHALL BE INSTALLED PER MANUFACTURES SPECIFICATIONS.
9. TRUSS DESIGN CAN BE USED FOR TRUSS LENGTHS SHORTER THAN 25 FEET.
10. CONCRETE WORK SHALL CONFORM TO 'BUILDING CODE REQUIRMENTS FOR REINFORCED CONCRETE' (ACI-318).
11. ALL CONCRETE SHALL BE 3000 PSI MIN. W/ WWF OR FIBER




Tomas B. Whitman, PE
MADISON ENGINEERING
This has been electronically signed and sealed by TOMAS B. WHITMAN, PE using a Digital signature and date. Printed copies of this document are not considered signed and sealed and the signature must be verified on an electronic device.

Tomas B
Whitman
2023.03.23
17:26:58 -04'00'

POLE BARN A - 50 X 89
USA BAR KITS

CHRIST CENTRAL MINISTRIES (50X89)

217 SW DYAL AVENUE, LAKE CITY, FL 32024

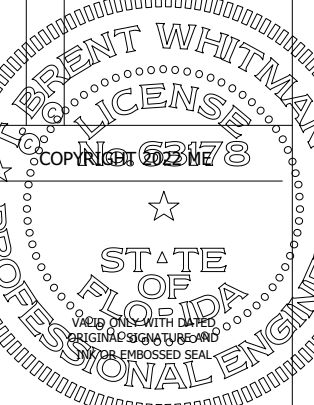


T. BRENT WHITMAN, P.E.
FL P.E. #63178 / GA P.E. #031609

SHEET NO.

4

MADISON ENGINEERING, LLC
CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING



269 NE Ridge Loop
Madison, Florida 32340
Phone 850.973.7864
COA No.: 27216 www.madisonengineer.com

DESIGNED TBW
DRAWN DVD
CHECKED TBW
APPROVED TBW
JOB NO.: 35223137
DATE: MARCH 2023

COLUMBIA COUNTY