

THE SEAL THAT APPEARS ON THESE DRAWINGS IS THE SEAL OF THE ENGINEER FOR THIS BUILDING MANUFACTURER WHO IS NOT THE ENGINEER OF RECORD.

2. CERTIFICATION RESTRICTION:
ENGINEER'S CERTIFICATION IS STRICTLY LIMITED TO THE DESIGN OF STRUCTURAL COMPONENTS DESIGNED AND MANUFACTURED BY THIS BUILDING MANUFACTURER. CERTIFICATION EXTENDS ONLY TO THE DESIGN LOADS AND STANDARDS INDICATED ON THESE PLANS. CERTIFICATION DOES NOT EXTEND TO FOUNDATION, MECHANICAL, ELECTRICAL, PLUMBING, FIRE PROTECTION, CIVIL WORK, ARCHITECTURAL RESPONSIBILITIES, OVERALL PROJECT COORDINATION, OR OTHER ASPECTS OF CODE COMPLIANCE NOT SPECIFICALLY REFERENCED BY THE MANUFACTURER'S ORDER DOCUMENTS. CERTIFICATION SHALL NOT EXTEND TO BUILDING ERECTION SUPERVISION OR INSPECTION.

3. ANCHOR RODS ARE ASSUMED TO CONFORM TO ASTM STANDARD F1554 GRADE 36, THE PREFERRED MATERIAL PER AISI SPECIFICATIONS. ANCHOR ROD DIAMETERS ARE DETERMINED BY ALLOWABLE SHEAR AND TENSION PER AISI SPECIFICATIONS. LENGTHS, EMBEDMENTS, HEAD STYLES, METHODS OF TRANSFERRING FORCES FROM THE ANCHOR RODS TO THE FOUNDATION, AND/OR OTHER ASSOCIATED ITEMS OF THE FOUNDATION ARE NOT BY BEHLN BUILDING SYSTEMS.

4. FOUNDATIONS MUST BE DESIGNED FOR LOCAL SOIL CONDITIONS BY A QUALIFIED FOUNDATION ENGINEER TO SAFELY SUPPORT COLUMN LOADS.

5. THIS BUILDING MANUFACTURER IS NOT RESPONSIBLE FOR ERRORS, OMISSIONS OR DAMAGES INCURRED IN THE ERECTION OF BUILDING COMPONENTS NOR FOR THE INSPECTION OF ERECTED COMPONENTS TO ASCERTAIN SAME. THE CONTRACTOR MUST BE INSTALLED BY ERECTOR TO PROVIDE ADEQUATE STABILITY DURING ERECTION.

6. BRACING INDICATED ON THE ERECTION DRAWINGS IS CRITICAL TO THE STABILITY OF THE COMPLETED STRUCTURE AND SHALL NOT BE REMOVED.

7. WALL & LINER PANELS ARE AN INTEGRAL PART OF THE STRUCTURAL SYSTEM. UNAUTHORIZED REMOVAL OF PANELS IS PROHIBITED.

8. FOR ALL BUILDINGS EXCEPT THOSE SITED IN CANADA, ALL FIELD WELDING SHALL BE DONE IN ACCORDANCE WITH THE AMERICAN WELDING SOCIETY (AWS) D1.1 OR D1.3 AS APPLICABLE BY AWS CERTIFIED WELDERS QUALIFIED TO PERFORM THE WELDING AS DIRECTED BY THE APPLICABLE WELDING PROCEDURE SPECIFICATION (WPS); FOR BUILDINGS SITED IN CANADA, ALL FIELD WELDING SHALL BE DONE IN ACCORDANCE WITH CSA (CANADIAN STANDARDS ASSOCIATION) WELD STANDARDS BY CWB (CANADIAN WELDING BUREAU) CERTIFIED WELDERS QUALIFIED TO PERFORM THE WELDING AS DIRECTED BY THE APPLICABLE WELDING PROCEDURE SPECIFICATION (WPS). A WPS MUST BE PREPARED BY THE CONTRACTOR FOR EACH WELDING VARIATION SPECIFIED, UNLESS OTHERWISE APPROVED. USE OF ELECTRODES, THE CONTRACTOR SHALL PROVIDE FOR ANY SPECIAL WELDING INSPECTION AS REQUIRED BY CODE.

9. ERECTION OF THIS METAL BUILDING SYSTEM SHALL COMPLY, AT A MINIMUM, WITH THE APPLICABLE ERECTION TOLERANCES STIPULATED IN SECTION 7 OF AISI 303 CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND TOLERANCES, SECTION 29 OF CSA S16 DESIGN OF STEEL STRUCTURES, AND SECTION 6 OF MEMA COMMON INDUSTRY PRACTICES.

10. BEHLN BUILDING SYSTEMS IS QUALITY ACCREDITED OR CERTIFIED AS FOLLOWS: INTERNATIONAL ACCREDITATION SERVICES (IAS) AC-472 INSPECTION PROGRAM FOR THE MANUFACTURE OF METAL BUILDING SYSTEMS CERTIFICATE NUMBER MB-1082; CAN/CSA A660-10 CERTIFICATION OF MANUFACTURERS OF STEEL BUILDING SYSTEMS CERTIFIED BY QUASAR, CERTIFICATE NUMBER BEHFM.

11. FOR ALL BUILDINGS EXCEPT THOSE SITED IN CANADA, ALL WELDING PERFORMED BY BEHLN HAS BEEN DONE IN ACCORDANCE WITH AWS WELD PROCEDURES BY AWS CERTIFIED WELDERS OR WITH CSA WELD PROCEDURES BY CWB CERTIFIED WELDERS. FOR ALL BUILDINGS SITED IN CANADA, ALL WELDING PERFORMED BY BEHLN HAS BEEN DONE IN ACCORDANCE WITH CSA WELD PROCEDURES BY CWB CERTIFIED WELDERS.


12. THE PREFERRED ATTACHMENT DETAIL FOR A PURLIN HANGER IS AN ATTACHMENT TO THE BACK OF THE WEB OF THE PURLIN. ATTACHING THIS HANGER TO THE FRONT OF THE PURLIN WITH THE HANGING LOAD REQUIREMENTS OF NFPA 13-9.2.1.3.1, C-CLAMPS SHALL NEVER BE DIRECTLY ATTACHED TO THE LIP OF THE PURLIN FLANGE AND MUST NEVER CAUSE DEFORMATION OF ANY PART OF THE PROFILE OF THE PURLIN.

1. STRUCTURAL WELDED SECTIONS	ASTM A572, A529 OR A1011, GR. 55
2. HOLLOW STRUCTURAL SECTIONS (HSS)	ASTM A500, GR. B
3. STEEL PIPE	ASTM A501 OR A53, GR. B. $F_y=36$ KSI
4. HOT ROLLED SECTIONS	ASTM A572, A529 OR A992, GR. 50
5. HOT ROLLED ANGLE	ASTM A36, $F_y=36$ KSI OR A572, GR. 50
6. HOT ROLLED ROD	ASTM A572, $F_y=50$ KSI OR $F_y=60$ KSI
7. CABLE BRACING	ASTM A475, EXTRA HIGH STRENGTH
8. COLD FORMED ROLLED SECTIONS	ASTM A1011 SS GR. 55 OR HSLAS GR. 55 CLASS 1, ASTM A653 SS GR. 55 OR HSLAS GR. 55 CLASS 1 (G40 GALV.), OR ASTM A653 SS GR. 50 CLASS 1 (G90 GALV.)
9. ROOF AND WALL SHEETING	ASTM A792, GR. 50 OR GR. 80
10. HIGH-STRENGTH BOLTS	ASTM A325, ASTM A325T
11. SECONDARY MEMBER CONNECTIONS	ASTM A307, ASTM A325, ASTM A325T
12. WASHERS	ASTM F436

WHEN HANDLING LONG TRIM, CARE SHOULD BE TAKEN TO AVOID DAMAGE CAUSED BY BUCKLING. ALL TRIM COMPONENTS HAVE A PROTECTIVE FILM ON THE COLORED SURFACE THAT MUST BE REMOVED PRIOR TO INSTALLATION. PROLONGED EXPOSURE TO RAIN AND/OR SUNLIGHT WILL ADVERSELY EFFECT THE PROTECTIVE FILM MAKING REMOVAL DIFFICULT. THIS BUILDING MANUFACTURER WILL ACCEPT NO RESPONSIBILITY FOR TRIM WHOSE PROTECTIVE FILM HAS BEEN EXPOSED FOR MORE THAN 3 WEEKS.



BEHLN IS NOT RESPONSIBLE FOR REPAIRS OR DAMAGED PRIMED SURFACES OR REMOVAL OF FOREIGN MATERIAL DUE TO IMPROPER STORAGE OR SITE CONDITIONS. BEHLN IS NOT RESPONSIBLE FOR CORROSION OR DEGRADATION OF THE SHOP APPLIED CORROSION DUE TO ATMOSPHERIC OR ENVIRONMENTAL CONDITIONS, NOR THE COMPATIBILITY OF THE PRIMER TO ANY FIELD APPLIED COATING. BEHLN WILL NOT BE RESPONSIBLE FOR CORROSION OR DAMAGE TO A PRIME PAINTED STRUCTURAL STEEL MEMBER THAT IS A DIRECT RESULT OF IMPROPER HANDLING, IMPROPER STORAGE, OR DUE TO SITE OR ATMOSPHERIC CONDITIONS. BEHLN ADVISES THAT PRIMAR STRUCTURAL MEMBERS BE INSPECTED UPON RECEIPT AND IMMEDIATELY NOTIFY BEHLN AND MEMBERS OF THE PROJECT IF THERE IS A PRIMER DEFICIENCY SO THAT BEHLN MAY IMMEDIATELY INVESTIGATE AND ADDRESS AS NEEDED.

	NONE	BY OTHERS	BY BEHLEN	MICRONESS OVER ZEE X4405	MICRONESS OVER ZEE X4405A	VAPOR BARRIER FLANGE BR.	RIGID CLIP BOARD
ROOF:	_____	██████	_____	_____	3"	_____	_____
WALL:	_____	██████	_____	0"	3"	_____	_____
THERMAL BLOCKS:	██████	_____	_____	_____	_____	_____	_____



BOONE OFFICE 2024
LAKE CITY, FLORIDA 32025

JOB NO. X4405

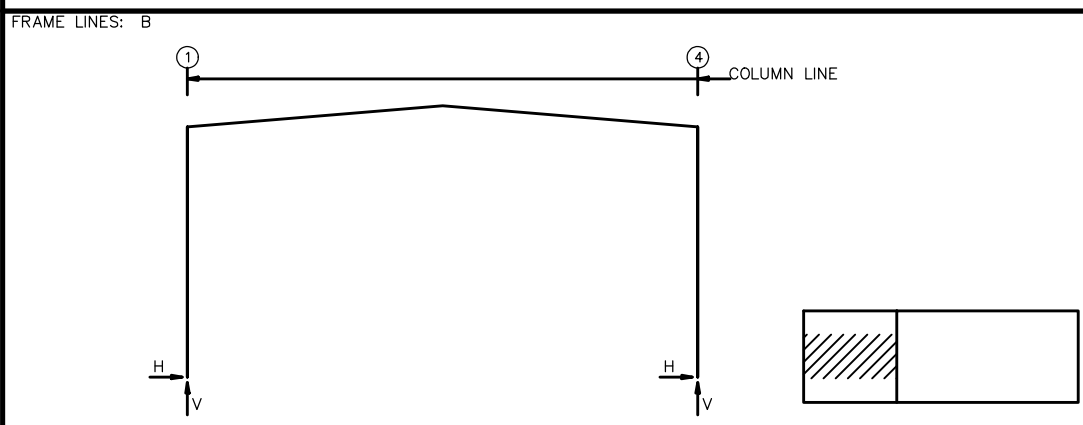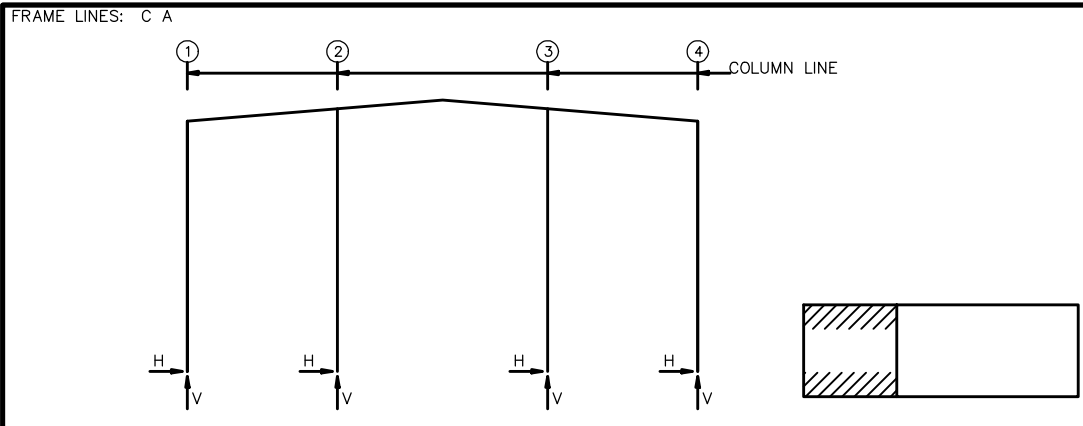

RIGID FRAME: MAXIMUM REACTIONS

Frm Line	Col Line	Load Id	Hmax	Vmax	Hmin	Vmin
C*	1	7	3.1	10.5	10	-3.4
C*	4	11	3.4	20.4	8	-0.3
C*	2	1	0.1	39.4	9	2.6
C*	3	1	-0.1	39.4	1	-0.1

C* Frame lines: C A

RIGID FRAME: MAXIMUM REACTIONS

Frm Line	Col Line	Load Id	Hmax	Vmax	Hmin	Vmin
B	1	5	5.8	29.0	10	-6.5
B	4	13	4.0	33.9	8	-5.7
B	4	11	6.5	-0.5	4	-5.8
B	4	12	-4.0	33.5	9	5.7

RIGID FRAME: BASIC COLUMN REACTIONS (k)

Frame Line	Column Line	Dead	Coll	Live	Wind Left1	Wind Right1	Wind Left2	Wind Right2	Seismic Left	Seismic Right
C*	1	0.1	7.9	0.0	0.6	-0.1	1.6	0.2	11.3	-4.5
C*	4	-0.1	7.9	0.0	0.6	-0.1	1.6	0.2	11.3	-4.5
C*	2	0.0	15.4	0.0	1.4	0.0	5.0	0.0	22.6	0.0
C*	3	0.0	15.4	0.0	1.4	0.0	5.0	0.0	22.6	0.0


RIGID FRAME: BASIC COLUMN REACTIONS (k)

Frame Line	Column Line	Dead	Coll	Live	Wind Left1	Wind Right1	Wind Left2	Wind Right2	Seismic Left	Seismic Right
C*	1	0.1	7.9	0.0	0.6	-0.1	1.6	0.2	11.3	-4.5
C*	4	-0.1	7.9	0.0	0.6	-0.1	1.6	0.2	11.3	-4.5
C*	2	0.0	15.4	0.0	1.4	0.0	5.0	0.0	22.6	0.0
C*	3	0.0	15.4	0.0	1.4	0.0	5.0	0.0	22.6	0.0

ENDWALL COLUMN: MAXIMUM REACTIONS

Frm Line	Col Line	Load Id	Hmax	Vmax	Hmin	Vmin
C	2 *	14	3.7	4.3	15	-3.4
C	3 *	16	3.7	4.3	17	-3.4
A	3 *	14	3.7	4.2	15	-3.4
A	2 *	16	3.7	4.2	17	-3.4

*See Rigid Frame Interior Column Reactions

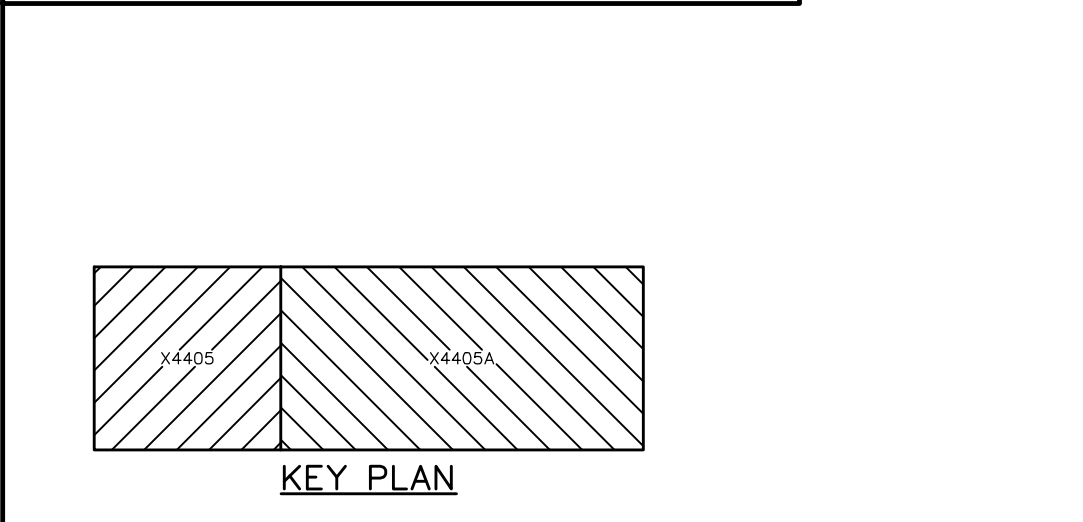

LOAD COMBINATIONS

ID	Description
1	Dead+Collateral+Floor_Live
2	Dead+Collateral+0.6Wind_Left1
3	Dead+Collateral+0.6Wind_Right1
4	Dead+Collateral+0.75Live+0.45Wind_Left1+0.75Floor_Live
5	Dead+Collateral+0.75Live+0.45Wind_Right1+0.75Floor_Live
6	Dead+Collateral+0.75Live+0.45Wind_Left2+0.75Floor_Live
7	Dead+Collateral+0.75Live+0.45Wind_Right2+0.75Floor_Live
8	0.6Dead+0.6Wind_Left1
9	0.6Dead+0.6Wind_Right1
10	0.6Dead+0.6Wind_Left2
11	0.6Dead+0.6Wind_Right2
12	1.0Dead+1.0Collateral+0.75Live+0.52Seismic_Left+0.75Floor_Live
13	1.0Dead+1.0Collateral+0.75Live+0.52Seismic_Right+0.75Floor_Live
14	0.6Dead+0.6Wind_Left1+0.6Wind_Suction
15	0.6Dead+0.6Wind_Pressure+0.6Wind_LongL
16	0.6Dead+0.6Wind_Right1+0.6Wind_Suction
17	0.6Dead+0.6Wind_Pressure+0.6Wind_LongL

BUILDING BRACING REACTIONS

Loc	Line	Col Line	Wind	Reactions(k)	Panel Shear (lb/ft)	Note
L_EW	C					(h)
F_SW	4	C,B				(a)
R_EW	A					(h)
B_SW	1	C,B				(a)

(a)Wind bent in bay
(h)Rigid frame at endwall

REACTION VALUES SHOWN ARE UNFACTORED.
MAXIMUM LOAD COMBINATION FACTORS ARE:
WIND : 0.60
SEISMIC : 0.70


WIND BENT REACTIONS

Loc	Line	Col Line	Wind	Reactions(k)	Bolt Qty	Bolt Dia	Base Plate Width	Base Plate Length	Thick
F_SW	4	C	3.7	7.7	0.2	0.4	2	0.750	8.000
F_SW	4	B	3.7	7.7	0.2	0.4	2	0.750	8.000
B_SW	1	C	3.7	7.7	0.2	0.4	2	0.750	8.000
B_SW	1	B	3.7	7.7	0.2	0.4	2	0.750	8.000

REACTION VALUES SHOWN ARE UNFACTORED.
MAXIMUM LOAD COMBINATION FACTORS ARE:
WIND : 0.60
SEISMIC : 0.70

FLOOR COLUMN REACTIONS

Frame Line	Col Line	Max_Vert Ld (k)	Dead Vert (k)	Coll Vert (k)	Live Vert (k)	Anc. Bolt Qty	Bolt Dia	Base Plate Width	Base Plate Length	Thick	Base Elev (in)
B	2	1	78.3	29.3	1.4	47.7	4	0.750	10.00	14.00	0.750
B	3	1	78.3	29.3	1.4	47.7	4	0.750	10.00	14.00	0.750

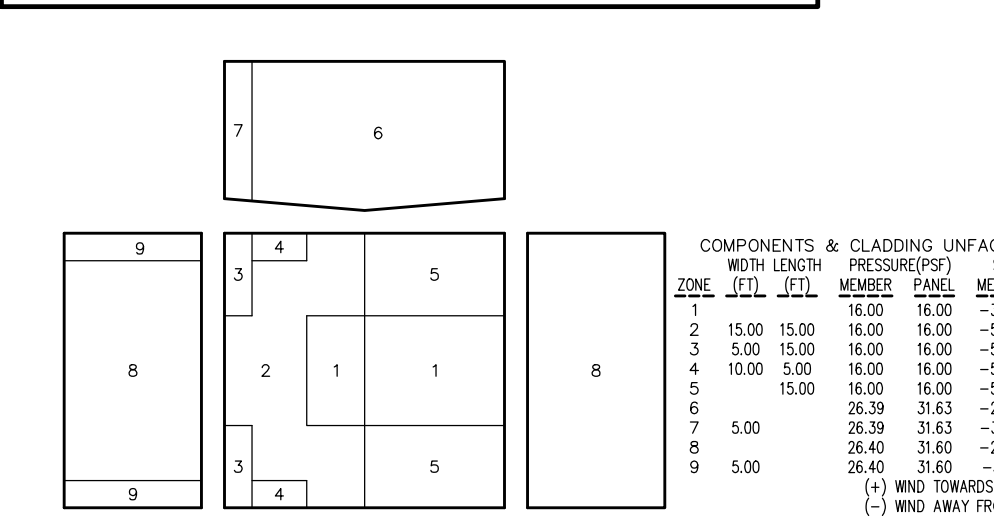

COMPONENTS & CLADDING UNFACTORED

ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

DESIGN CALCULATION WIND

ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

DESIGN CALCULATION WIND

ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

DESIGN CALCULATION WIND

ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

DESIGN CALCULATION WIND

ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

DESIGN CALCULATION WIND


ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

DESIGN CALCULATION WIND

ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

DESIGN CALCULATION WIND

ZONE	WIDTH (FT)	LENGTH (FT)	PRESSURE (PSF)	SUCTION (PSF)
1	15.00	15.00	16.00	16.00
2	15.00	15.00	16.00	16.00
3	15.00	15.00	16.00	16.00
4	15.00	15.00	16.00	16.00
5	15.00	15.00	16.00	16.00
6	15.00	15.00	16.00	16.00
7	15.00	15.00	16.00	16.00
8	15.00	15.00	16.00	16.00
9	15.00	15.00	16.00	16.00

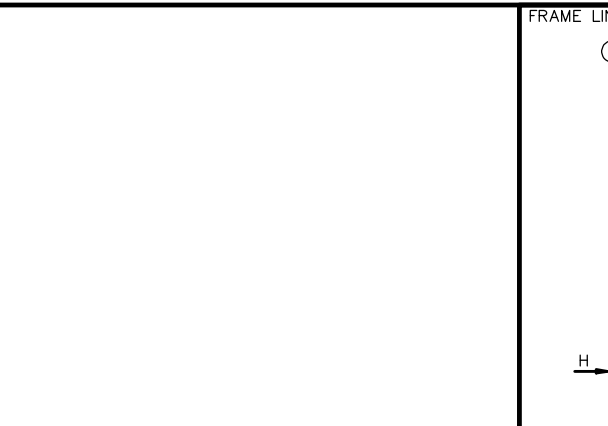

RIGID FRAME: MAXIMUM REACTIONS

Frm Line	Col Line	Load Id	Hmax	Vmax	Hmin	Vmin
4	A	3	1.6	2.3	6	-2.3
4	C	7	2.3	-2.8	2	-1.6
4	C	1	-1.6	5.4	5	2.3

RIGID FRAME: MAXIMUM REACTIONS

Frm Line	Col Line	Load Id	Hmax	Vmax	Hmin	Vmin
5*	A	1	3.6	9.3	4	-3.5
5*	C	5	3.5	-6.1	1	-3.6
5*	C	1	-3.6	9.3	5	3.5

5* Frame lines: 5 6 7 8

RIGID FRAME: BASIC COLUMN REACTIONS (k)

Frame Line	Column Line	Dead	Coll	Live	Wind Left1	Wind Right1	Wind Left2	Wind Right2	Seismic Left	Seismic Right
4	A	0.3	1.2	0.2	0.7	1.0	3.5	-4.1	-8.3	0.6
4	C	-0.3	1.2	-0.2	0.7	-1.0	3.5	-4.1	-8.3	0.6
4	A	0.6	1.8	0.6	1.5	2.4	6.0	-6.5	-12.0	0.0
4	C	-0.6	1.8	-0.6	1.5	-2.4	6.0	-6.5	-12.0	0.0

RIGID FRAME: BASIC COLUMN REACTIONS (k)

Frame Line	Column Line	Dead	Coll	Live	Wind Left1	Wind Right1	Wind Left2	Wind Right2	Seismic Left	Seismic Right
4	A	0.3	1.2	0.2	0.7	1.0	3.5	-4.1	-8.3	0.6
4	C	-0.3	1.2	-0.2	0.7	-1.0	3.5	-4.1	-8.3	0.6
4	A	0.6	1.8	0.6	1.5	2.4	6.0	-6.5	-12.0	0.0
4	C	-0.6	1.8	-0.6	1.5	-2.4	6.0	-6.5	-12.0	0.0

ENDWALL COLUMN: MAXIMUM REACTIONS

Frm Line	Col Line	Load Id	Hmax	Vmax	Hmin	Vmin
9	C	9	1.3	-1.9	10	-1.2
9	B	11	4.5	-5.8	12	-4.1
9	A	13	1.3	-3.4	12	-1.2
9	A	14	1.0	3.4	13	1.3

LOAD COMBINATIONS

ID	Description
1	Dead+Collateral+Live
2	Dead+Collateral+0.75Live+0.45Wind_Left1
3	Dead+Collateral+0.75Live+0.45Wind_Right1
4	0.6Dead+0.6Wind_Left1
5	0.6Dead+0.6Wind_Right1
6	0.6Dead+0.6Wind_Left2
7	0.6Dead+0.6Wind_Right2
8	0.6Dead+0.6Wind_LongL
9	0.6Dead+0.6Wind_Suction+0.6Wind_LongL
10	0.6Dead+0.6Wind_Pressure+0.6Wind_LongL
11	0.6Dead+0.6Wind_Left1+0.6Wind_Suction
12	0.6Dead+0.6Wind_Pressure+0.6Wind_Long2L
13	0.6Dead+0.6Wind_Right1+0.6Wind_Suction
14	Dead+Collateral+0.75Live+0.45Wind_Left2+0.45Wind_Suction

BUILDING BRACING REACTIONS

Loc	Line	Col Line	Wind	Reactions(k)	Panel Shear (lb/ft)	Note
L_EW	4					(h)
F_SW	9	B,A				(a)
B_SW	A	6,5				(a)

(a)Wind bent in bay
(h)Rigid frame at endwall

REACTION VALUES SHOWN ARE UNFACTORED.
MAXIMUM LOAD COMBINATION FACTORS ARE:
WIND : 0.60
SEISMIC : 0.70

WIND BENT REACTIONS

Loc	Line	Col Line	Wind	Reactions(k)	Bolt Qty	Bolt Dia	Base Plate Width	Base Plate Length	Thick
F_SW	C	5	2.5	4.5	0.3	0.6	2	0.750	6.000
F_SW	C	6	2.5	4.5	0.3	0.6	2	0.750	6.000

REACTION VALUES SHOWN ARE UNFACTORED.
MAXIMUM LOAD COMBINATION FACTORS ARE:
WIND : 0.60
SEISMIC : 0.70

WIND BENT REACTIONS

Loc	Line	Col Line	Wind	Reactions(k)	Bolt Qty	Bolt Dia	Base Plate Width	Base Plate Length	Thick
F_SW	C	5	2.5	4.5	0.3	0.6	2	0.750	6.000
F_SW	C	6	2.5	4.5	0.3	0.6	2	0.750	6.000

REACTION VALUES SHOWN ARE UNFACTORED.
MAXIMUM LOAD COMBINATION FACTORS ARE:
WIND : 0.60
SEISMIC : 0.70

WIND BENT REACTIONS

Loc	Line	Col Line	Wind	Reactions(k)	Bolt Qty	Bolt Dia	Base Plate Width	Base Plate Length	Thick
F_SW	C	5	2.5	4.5	0.3	0.6	2	0.750	6.000
F_SW	C	6	2.5	4.5	0.3	0.6	2	0.750	6.000

REACTION VALUES SHOWN ARE UNFACTORED.
MAXIMUM LOAD COMBINATION FACTORS ARE:
WIND : 0.60
SEISMIC : 0.70

WIND BENT REACTIONS

||
||
||

WALL FRAMED OPENINGS

* TYPE OF OPENING	
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15
16	16
17	17
18	18
19	19
20	20
21	21
22	22
23	23
24	24
25	25
26	26
27	27
28	28
29	29
30	30
31	31
32	32
33	33
34	34
35	35
36	36
37	37
38	38
39	39
40	40
41	41
42	42
43	43
44	44
45	45
46	46
47	47
48	48
49	49
50	50
51	51
52	52
53	53
54	54
55	55
56	56
57	57
58	58
59	59
60	60
61	61
62	62
63	63
64	64
65	65
66	66
67	67
68	68
69	69
70	70
71	71
72	72
73	73
74	74
75	75
76	76
77	77
78	78
79	79
80	80
81	81
82	82
83	83
84	84
85	85
86	86
87	87
88	88
89	89
90	90
91	91
92	92
93	93
94	94
95	95
96	96
97	97
98	98
99	99
100	100

OHD = OVERHEAD DOOR	SF = STORE FRONT
RU = ROLL-UP	BF = BI-FOLD/HYDRAULIC
OWS = ONE WAY SLIDE	WK = WALK DOOR
TWS = TWO WAY SLIDE	FOS = FRAMED OPENING W/ SILL

[illegible]

NOTES:

1. FOR BUILDINGS DESIGNED AS ENCLOSED, ALL WINDOWS, DOORS, AND LOUVERS SHALL BE RATED TO COMPLY WITH THE WIND DESIGN CRITERIA IDENTIFIED ON SHEET 1 OF THESE PLANS.
2. ALL FIELD LOCATED FRAMED OPENINGS WILL REQUIRE FIELD CUTTING OF GIRTS, PURLINS, AND SHEETING.


"X" DENOTES OPTION SUPPLIED BY BUILDING MANUFACTURER

SCALE : NONE

DRAWN BY	D. WURDINGER	DATE	4-30-24
CHECKED BY	DANA	DATE	4-30-24
APPROVED BY	SDC	DATE	5-1-24
REVIEWED BY		DATE	

BOONE OFFICE 2024
LAKE CITY, FLORIDA

BUILDING ACCESSORIES




BEHLEN MFG. CO.
COLUMBUS, NEBRASKA

JOB NO.	X4405	SHT. 4 OF 19
---------	-------	--------------

SPLICE PLATE & BOLT TABLE											
Mark	Qty	Top	Bot	Int	Type	Dia	Length	Width	Thick	Length	
SP-1	4	4	0		A325	0.750	2.50	5"	3/8"	1'-6"	3/4"
SP-2	4	4	0		A325	0.750	2.50	5"	1/2"	1'-6"	7/8"


▼ FLANGE BRACES: Both Sides(U.N.)
 A - L1.5x16G

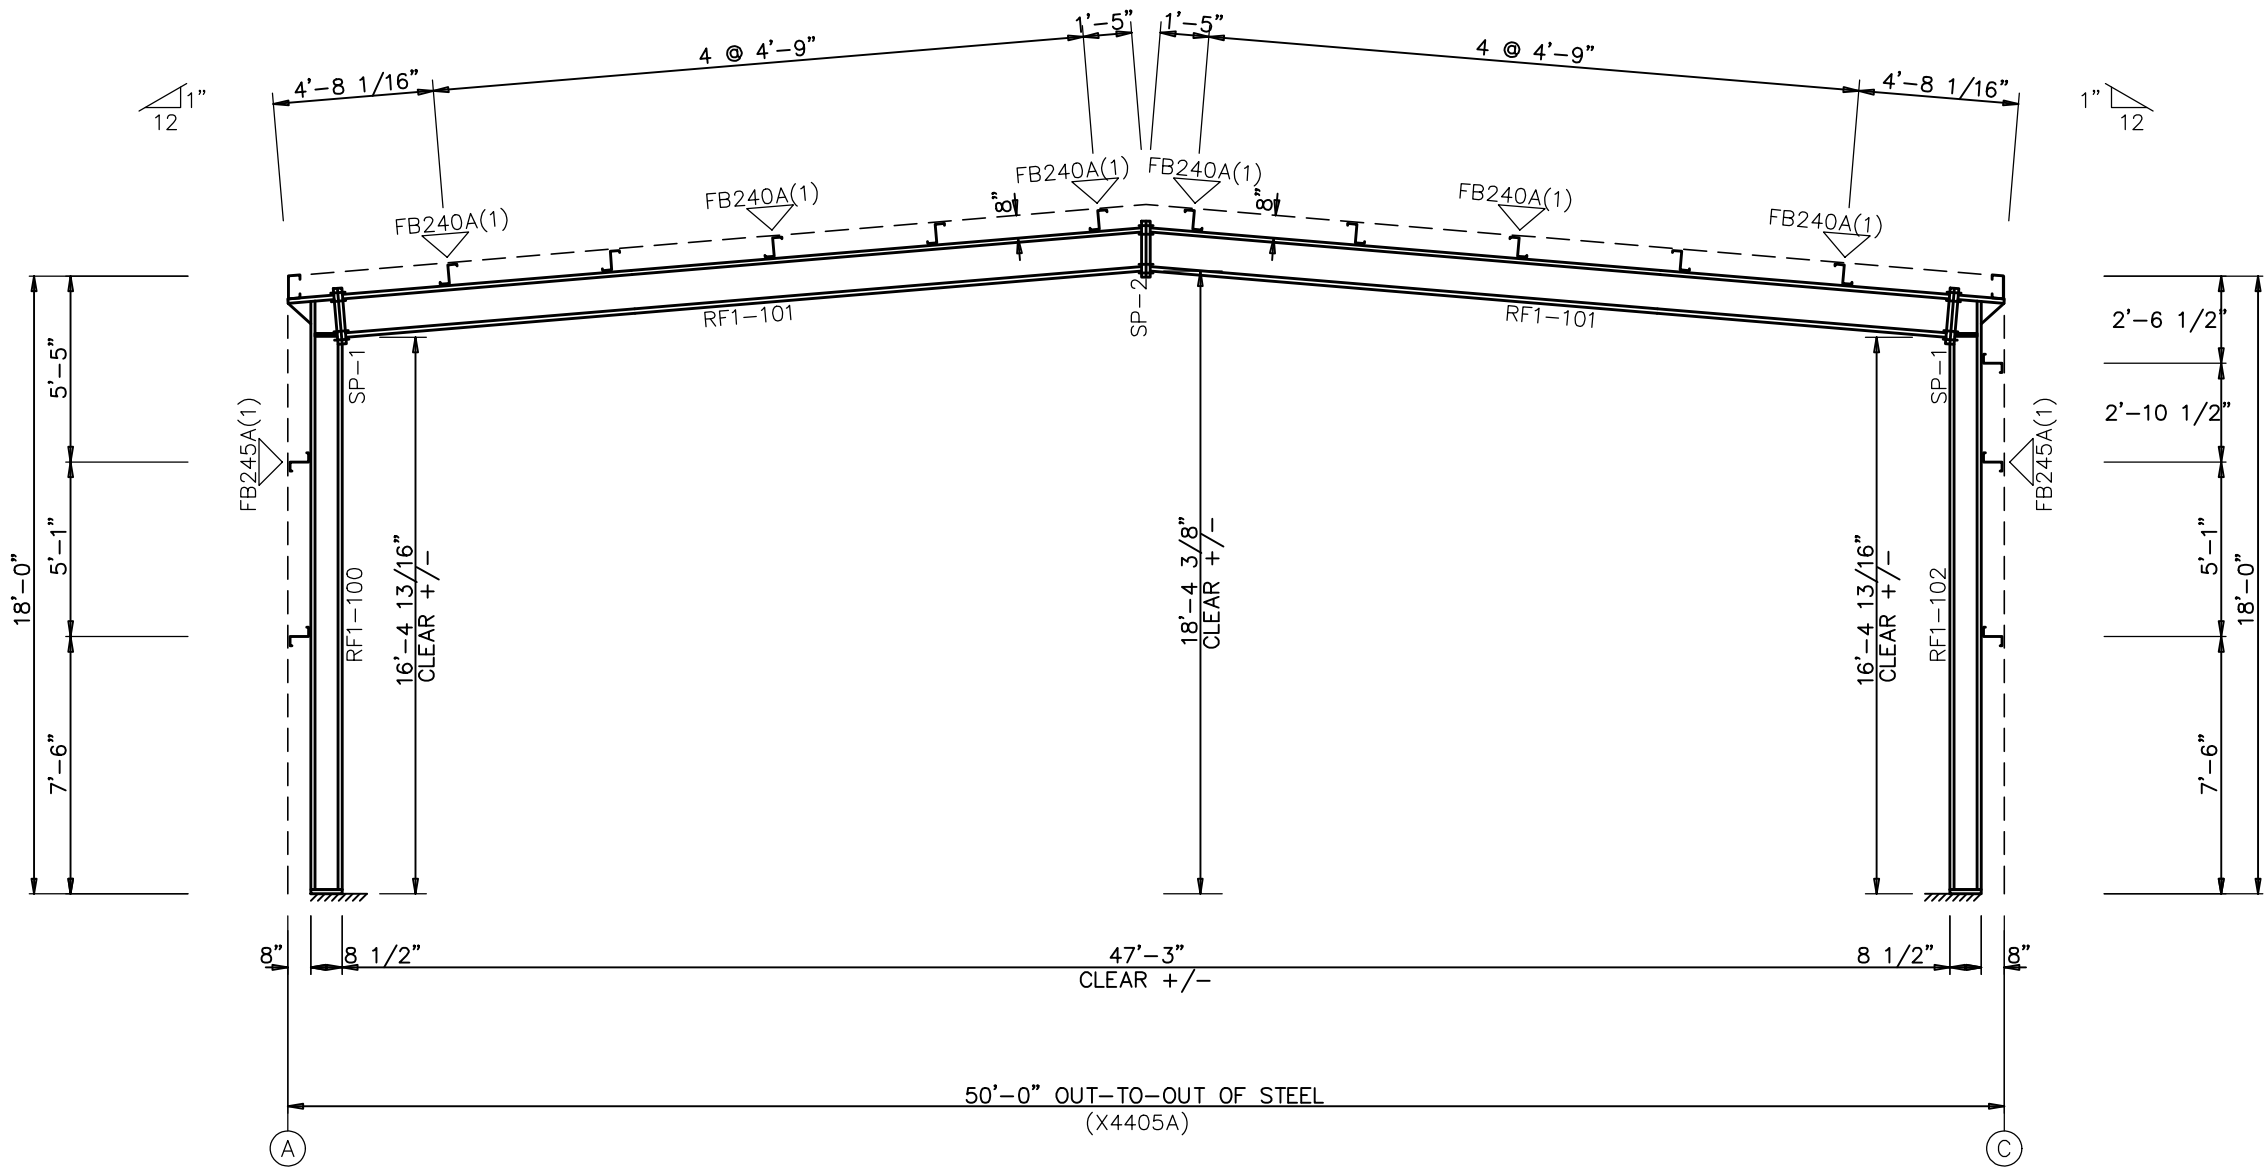

RIGID FRAME ELEVATION: FRAME LINE 4

- ERECTION NOTES:
1. THE "APPLICABLE WALL PANEL ERECTION GUIDE" IS TO BE USED IN CONJUNCTION WITH THESE DRAWINGS TO DETERMINE COMPLETE ERECTION REQUIREMENTS.
 2. ALL FLANGE BRACING MUST BE INSTALLED AT FRAME LINES AS SHOWN.

RIGID FRAMES BY THIS MANUFACTURER ARE DESIGNED TO BE FASTENED USING A-325 HIGH STRENGTH BOLTS BY THE "SNUG-TIGHTENED" METHOD, AS DEFINED AND DESCRIBED IN THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS SPECIFICATION (RCSC, 12-31-2009), SECTION 4.1, "SNUG-TIGHTENED JOINTS" (REFERENCE SECTION 8.1)

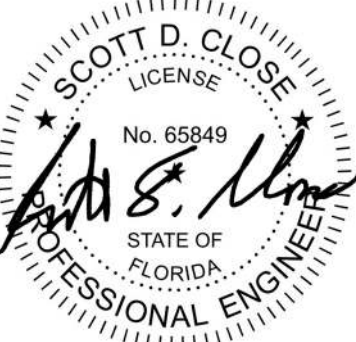


												SCALE : NONE				BOONE OFFICE 2024 LAKE CITY, FLORIDA		 BEHLEN MFG. CO. COLUMBUS, NEBRASKA					
												DRAWN BY D. WURDINGER DATE 4/24/24											
												CHECKED BY DANA DATE 4-30-24											
												APPROVED BY SDC DATE 5-1-24				RIGID FRAME ELEVATION		JOB NO. X4405					
LETTER	REVISIONS				DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE	REVIEWED BY	DATE	REVIEWED BY	DATE	REVIEWED BY	DATE	SHT. 5 OF 19		G:\JOBS\X4405\RFDWG1				

SPLICE PLATE & BOLT TABLE											CAP PLATE BOLTS				
Mark	Qty Top	Bot	Int	Type	Dia	Length	Width	Thick	Length	Mark	Qty	Type	Dia	Length	
SP-1	4	4	0	A325	0.750	2.50	6"	1/2"	1'-6 7/8"	EC-1	4	A325	0.500	1.50	
SP-2	4	4	0	A325	0.750	2.50	5"	3/8"	1'-6 7/8"	EC-2	4	A325	0.500	1.50	
											EC-3	4	A325	0.500	1.50
											EC-4	4	A325	0.500	1.50
ALTERNATE MEMBER															

SPLICE PLATE & BOLT TABLE										
Mark	Qty	Top	Bot	Int	Type	Dia	Length	Width	Thick	Length
SP-1	4	4	0	0	A325	0.750	2.50	6"	1/2"	2'-1 7/8"
SP-2	4	4	0	0	A325	0.750	2.50	6"	1/2"	2'-2 7/8"

SUPPORT COLUMN BOLT TABLE					
Mark	Qty	Type	Dia	Length	
C1	4	A325	0.500	2.00	


FLANGE BRACES: Both Sides(U.N.)
A - L1.5x16G

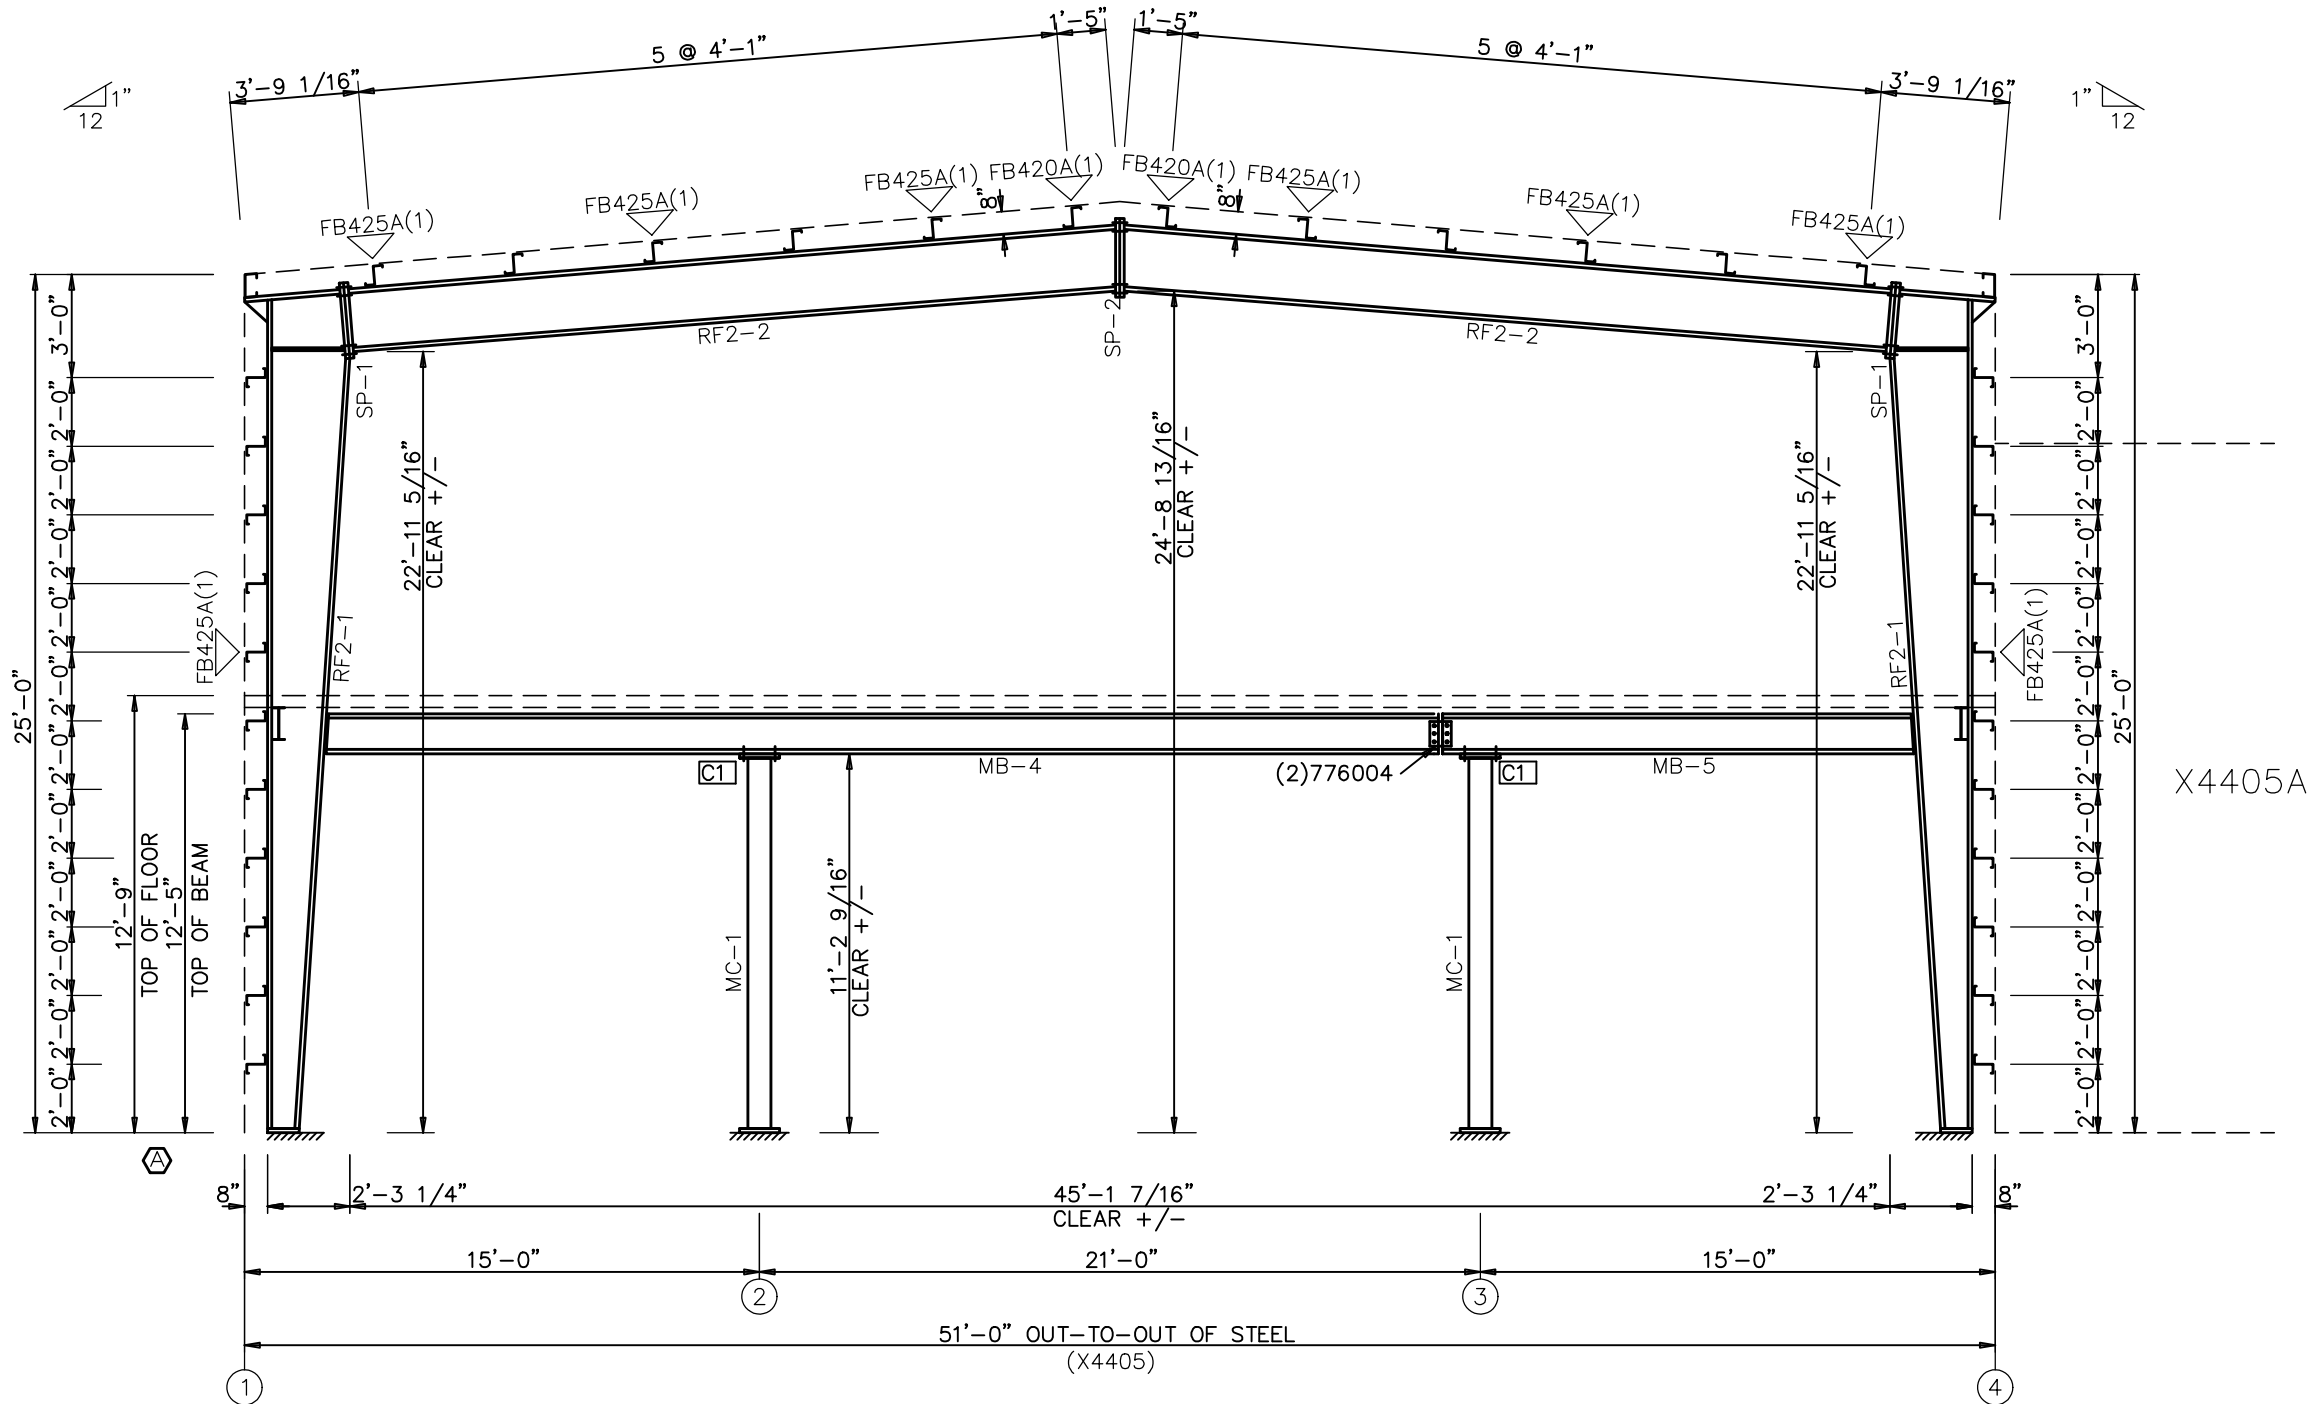

RIGID FRAME ELEVATION: FRAME LINE B


- ERECTION NOTES:
1. THE "APPLICABLE WALL PANEL ERECTION GUIDE" IS TO BE USED IN CONJUNCTION WITH THESE DRAWINGS TO DETERMINE COMPLETE ERECTION REQUIREMENTS.
 2. ALL FLANGE BRACING MUST BE INSTALLED AT FRAME LINES AS SHOWN.

RIGID FRAMES BY THIS MANUFACTURER ARE DESIGNED TO BE FASTENED USING A-325 HIGH STRENGTH BOLTS BY THE "SNUG-TIGHTENED" METHOD, AS DEFINED AND DESCRIBED IN THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS SPECIFICATION (RCSC, 12-31-2009), SECTION 4.1, "SNUG-TIGHTENED JOINTS" (REFERENCE SECTION 8.1)

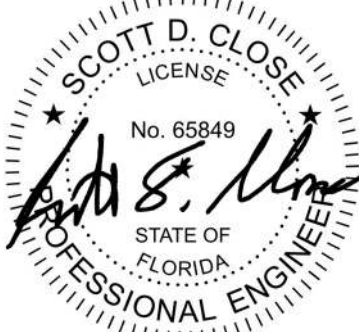

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--


P-100	8X25Z16	20'-1 5/8"
P-101	8X25Z16	22'-7 1/2"
P-102	8X25Z16	21'-3 5/8"
P-103	8X25Z16	21'-5 5/8"
P-104	8X25Z16	21'-5 5/8"
E-101	8E14	18'-9 3/4"
E-102	8E14	19'-11 3/4"
E-103	8E14	19'-11 3/4"
E-105	8E14	18'-9 3/4"
CB-103	WX4	21'-2"
CB-104	WX4	21'-5"

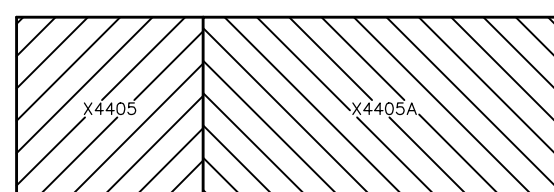


TO FACILITATE THE PROPER ORIENTATION OF PURLINS/BUNDLES WHEN UNLOADING OR PLACING ON THE ROOF, POSITION THE END OF THE PURLIN/BUNDLE THAT IS TAGGED WITH A BAR CODE LABEL TO THE LEFT WHEN STANDING ON THE OUTSIDE OF THE BUILDING LOOKING IN; THE TOP FLANGE OF ZEE PURLINS SHOULD FACE UPHILL UNLESS DETAILS INDICATE OTHERWISE.

THE ARROW ON THE BARCODE LABEL POINTS TO THE NARROWER FLANGE FOR 8" ZEES;
ON ALL OTHER PROFILES, THE ARROW TYPICALLY POINTS TO THE OUTSIDE FLANGE
UNLESS DETAILS INDICATE OTHERWISE.





														UNLESS DETAILS INDICATE OTHERWISE.														SCALE : NONE														BOONE OFFICE 2024 LAKE CITY, FLORIDA														 BEHLEN MFG. CO. COLUMBUS, NEBRASKA																																									
																												DRAWN BY D. WURDINGER DATE 4/24/24																																																																					
																												CHECKED BY DANA DATE 4-30-24																																																																					
																												APPROVED BY SDC DATE 5-1-24																																																																					
(A) UPDATED TABLE														LVY 6/25/24 BVS 6/25/24																																																																																			
LETTER REVISIONS														DRAWN BY DATE CHECKED BY DATE APPROVED BY DATE REVIEWED BY DATE														LETTER REVISIONS														DRAWN BY DATE CHECKED BY DATE APPROVED BY DATE REVIEWED BY DATE														REVIEWED BY DATE														ROOF FRAMING														JOB NO. X4405 SHT. 9 OF 19													

TRIM TABLE
ROOF PLAN
SID PART
1 RC1

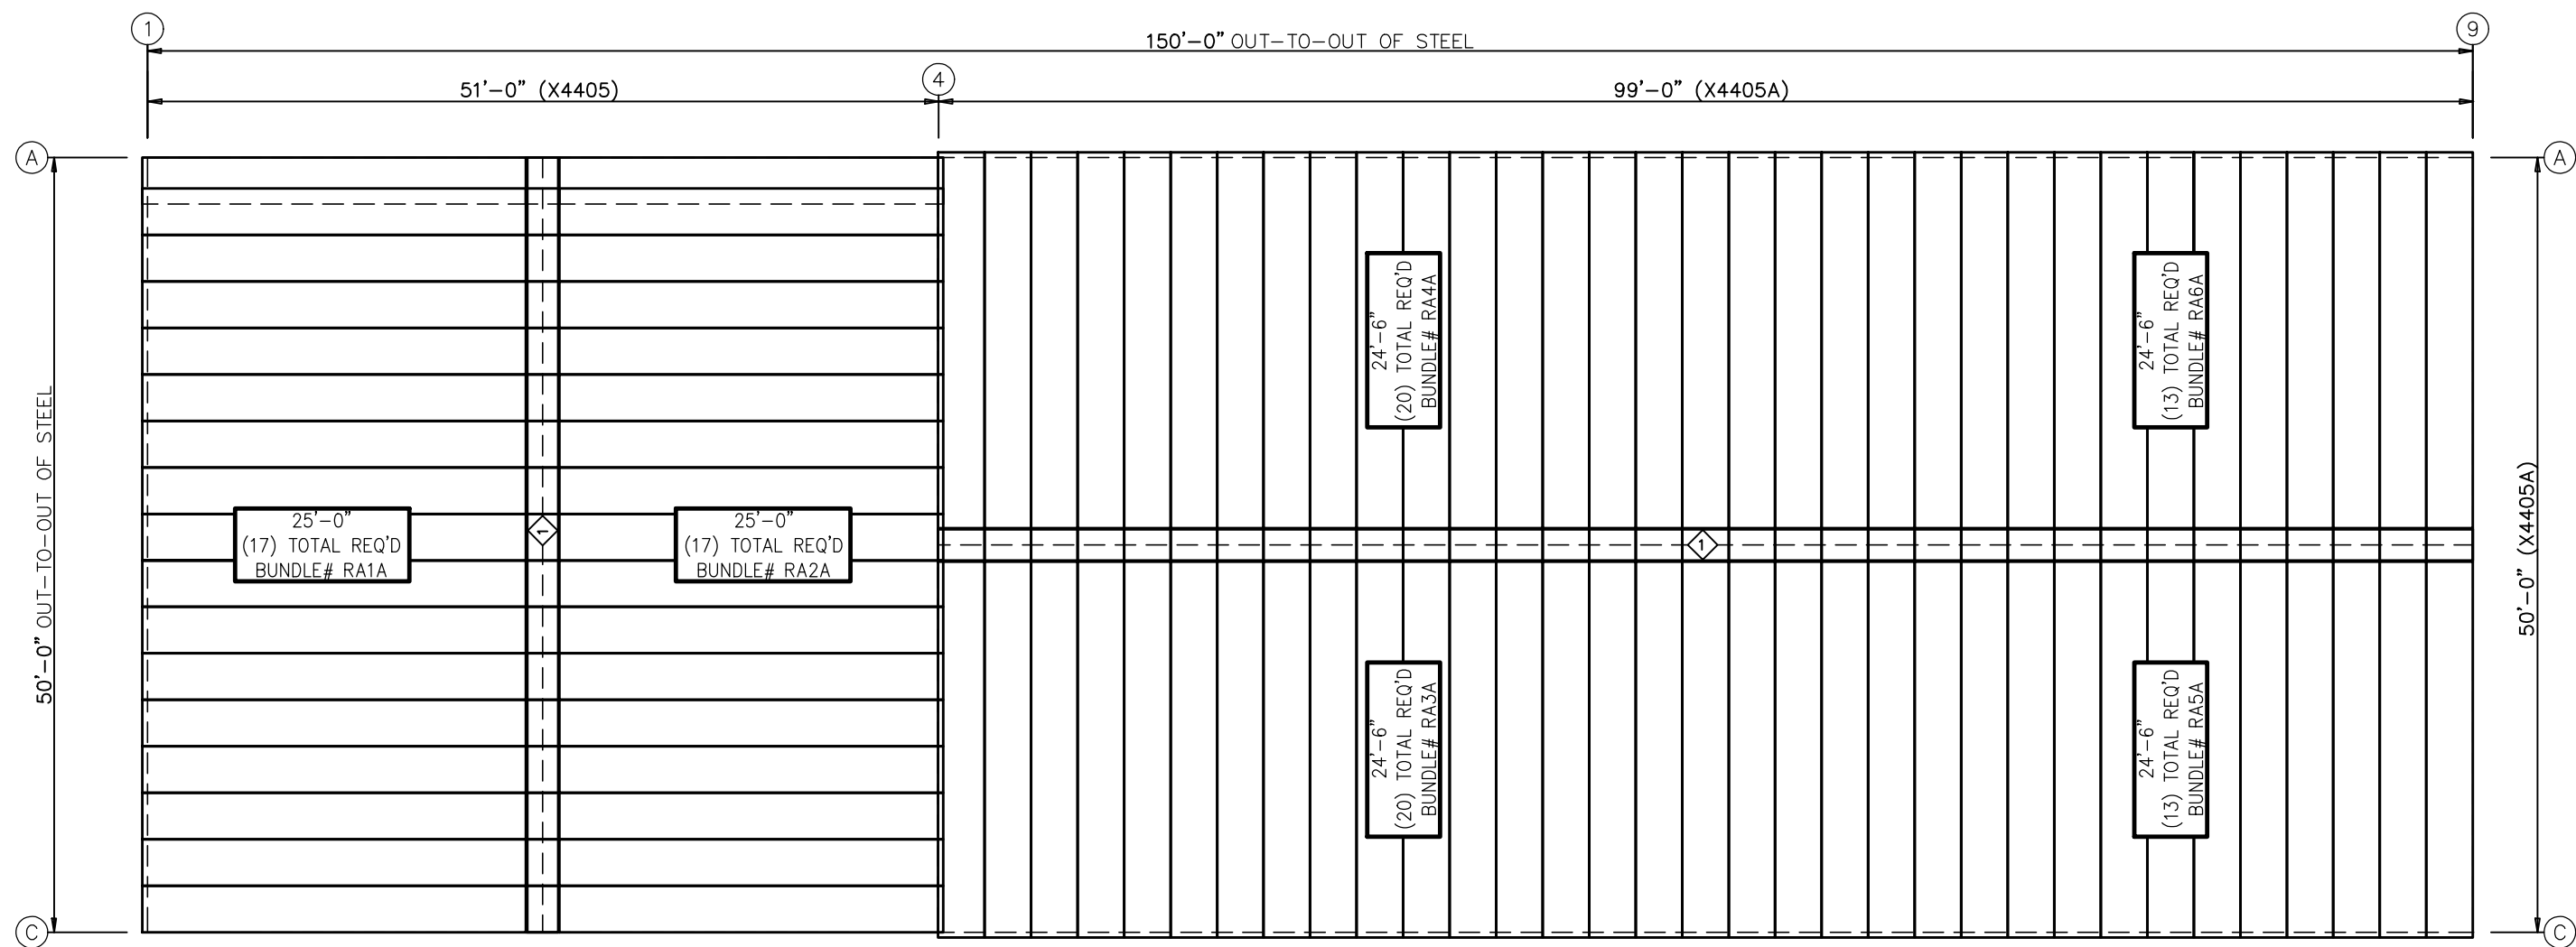



ROOF SHEETING PLAN
PANELS: 26 Ga. PBR - GALVALUME
FOR BUILDING X4405 BUNDLE # RA1A TO RA2A
FOR BUILDING X4405A BUNDLE # RA3A TO RA6A

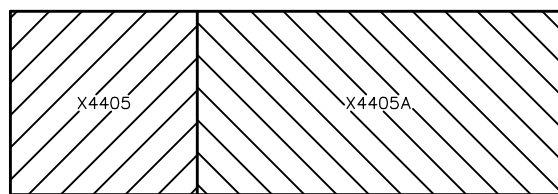

KEY PLAN

☐- DENOTES FIELD LOCATED ACCESSORY
(SEE ACCESSORY SHEET)

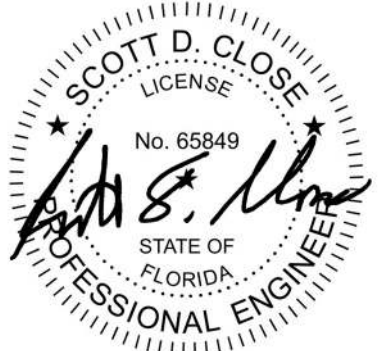

												SCALE : NONE												BOONE OFFICE 2024 LAKE CITY, FLORIDA		 BEHLEN MFG. CO. COLUMBUS, NEBRASKA																																															
												DRAWN BY D. WURDINGER				DATE 4/24/24																																																									
												CHECKED BY DANA				DATE 4-30-24																																																									
												APPROVED BY SDC				DATE 5-1-24																																																									
UPDATED BUNDLE#												AKG		06/25/24		YRS		06/25/24														ROOF SHEETING		JOB NO.	X4405	SHT. 10 OF 19																																					
LETTER												REVISIONS												DRAWN BY		DATE		CHECKED BY		DATE							APPROVED BY		DATE		REVIEWED BY		DATE		LETTER		REVISIONS												DRAWN BY		DATE		CHECKED BY		DATE		APPROVED BY		DATE		REVIEWED BY		DATE

G:\JOBS\X4405\ROOF.DWG

IS: \JOBS\X4405\ROOFDWG2

MEZZANINE INFORMATION:

MAIN FRAME COLUMNS, ENDWALL COLUMNS, AUXILIARY COLUMNS, BAR JOISTS, FLOOR BEAMS AND / OR DECKING ARE DESIGNED TO ADEQUATELY HANDLE A MEZZANINE IN THE AREA SHOWN ON THE PLANS, BASED ON THE MEZZANINE LOADS ON THE COVER PAGE.

JOIST ERECTION:

CARE SHALL BE EXERCISED AT ALL TIMES TO AVOID DAMAGE TO THE JOISTS AND ACCESSORIES THROUGH CARELESS HANDLING DURING UNLOADING, STORING, AND ERECTING.

** IMPORTANT ** UNDER NO CIRCUMSTANCES SHALL ANY PERSONNEL ATTEMPT TO WALK ON UNBRIDGED JOISTS. AS SOON AS THE JOISTS ARE ERECTED, ALL BRIDGING SHALL BE COMPLETELY INSTALLED AND ANCHORED, THEN THE JOIST SHOULD BE PERMANENTLY FASTENED INTO PLACE. UNTIL THIS IS DONE, NO CONSTRUCTION LOADS SHALL BE APPLIED TO THE JOISTS.

WHERE BOLTED DIAGONAL BRIDGING IS REQUIRED, THE HOISTING CABLES SHALL NOT BE RELEASED UNTIL THE DIAGONAL BRIDGING IS COMPLETELY INSTALLED. EACH JOIST SHALL BE STRAIGHTENED AND PLUMBED PRIOR TO CONNECTING THE BRIDGING TO THE JOIST. WHEN IT IS NECESSARY FOR THE ERECTOR TO CLIMB ON THE JOISTS TO INSTALL THE BRIDGING, EXTREME CAUTION MUST BE EXERCISED SINCE UNBRIDGED JOISTS MAY EXHIBIT SOME DEGREE OF INSTABILITY UNDER THE ERECTOR'S WEIGHT.

AFTER THE BRIDGING IS COMPLETELY INSTALLED AND ANCHORED, THE ENDS OF THE JOISTS SHALL BE FULLY CONNECTED TO THE SUPPORT. ALL FIELD WELDING SHALL BE PERFORMED IN A WORKMANLIKE MANNER TO INSURE THAT THE JOISTS ARE NOT DAMAGED BY SUCH WELDING.

ENDS OF K-SERIES JOISTS RESTING ON STEEL SHALL BE ATTACHED THERETO WITH A MINIMUM OF TWO 1/8 INCH FILLET WELDS 2 1/2 INCHES LONG, OR WITH A 1/2 INCH BOLT. IN STEEL FRAMES, WHERE COLUMNS ARE NOT FRAMED IN AT LEAST TWO DIRECTIONS WITH STRUCTURAL STEEL MEMBERS, JOISTS AT COLUMN LINES SHALL BE FIELD BOLTED AT THE COLUMNS TO PROVIDE LATERAL STABILITY DURING CONSTRUCTION.

ON COLD-FORMED MEMBERS WHOSE YIELD STRENGTH HAS BEEN ATTAINED BY COLD WORKING, AND WHOSE AS-FORMED STRENGTH IS USED IN THE DESIGN, THE TOTAL LENGTH OF WELD AT ANY ONE POINT SHALL NOT EXCEED 50 PERCENT OF THE OVERALL DEVELOPED WIDTH OF THE COLD-FORMED SECTION.

DECK ERECTION:

DECK : 0.6FD26

PLACE DECK SHEETS SIDE TO SIDE BEGINNING AT THE CORNER OF THE MEZZANINE, MAINTAINING ALIGNMENT. WHEN LAPPING, MAKE ALIGNMENT ADJUSTMENTS IF NECESSARY. PLACE SHEETS WITH EDGES UP, MAKE SIDE LAPS ONE-HALF CORRUGATION. DO NOT STAGGER 2" END LAPS. MINIMUM BEARING OF THE SHEETS SHALL BE 1 1/2".

SHEETS SHALL BE ATTACHED TO SUPPORTS WITH SCREWS. REQUIREMENTS ARE AS FOLLOWS:

A) SUPPORT CONNECTIONS: (35/4) PATTERN

B) SIDE LAPS: ONE BETWEEN JOISTS

SUPPORT SCREWS SHALL BE 12-5: #12-24 x 1 1/4" TYPE 5.

SIDELAP SCREWS SHALL BE 12-3: #12-14 x 3/4" Type 3 SIDE LAP.

GENERAL NOTES:

1. THIS BUILDING MANUFACTURER IS NOT RESPONSIBLE FOR ERRORS, OMISSIONS OR DAMAGES INCURRED IN THE ERECTION OF BUILDING COMPONENTS NOR FOR THE INSPECTION OF ERECTED COMPONENTS TO ASCERTAIN SAME.

2. TEMPORARY BRACING MUST BE INSTALLED BY ERECTOR TO PROVIDE ADEQUATE STABILITY DURING ERECTION. BRACING INDICATED ON THE ERECTION DRAWINGS IS FOR THE STABILITY OF THE COMPLETED STRUCTURE AND SHALL NOT BE REMOVED

3. TOP OF ALL BAR JOISTS @ ELEV. 112'-5"

4. TOP OF FLOOR ELEV. = 112'-9"

5. ① INDICATES TAGGED END OF BAR JOIST.

6. X INDICATES DIAGONAL 1X1X7/64" ANGLE BRIDGING LOCATIONS

7. - - - INDICATES TOP & BOTTOM 1X1X7/64" ANGLE BRIDGING LOCATIONS

8. ALL JOISTS ARE BOLTED

MEMBER TABLE

MARK	PART	LENGTH
MB-1	W14X22	13'-1"
MB-2	W12X14	21'-3"
MB-3	W12X14	23'-8 7/8"
MB-4	W12X40	32'-2 13/16"
MB-5	W12X40	13'-4 1/16"
MB-6	W14X30	20'-8 3/4"
MB-7	W14X22	13'-1"
MB-8	W12X14	23'-8 7/8"
MB-9	W10X22	23'-5 3/4"
MB-11	W10X22	20'-8 3/4"
MB-12	W12X26	23'-8 3/4"
MB-13	W12X26	9'-8 3/4"
MC-1	T8X4X3/16"	11'-2 9/16"
MJ-1	14K4	24'-11 1/2"
MJ-2	16K4	24'-11 1/2"
MJ-3	16K4	23'-7 3/8"
MJ-4	14K1	19'-3 1/2"
MJ-5	14K4	24'-11 1/2"
MJ-6	16K4	24'-11 1/2"
MJ-7	16K5	24'-11 1/2"
MJ-8	12K1	5'-3 1/2"

CONNECTION PLATES
MEZZANINE PLAN

ID	MARK/PART
1	(2)776001
2	(2)776002
3	(2)776003
4	(2)776004

SUPPORT COLUMN BOLT TABLE

LOCATION	QUAN	TYPE	DIA	LENGTH
MC-1 TO MB-4/MJ-5	4	A325	1 1/2"	2"

FIELD CUT DECKING AS REQUIRED.

51'-0" OUT-TO-OUT OF STEEL

15'-0"21'-0"15'-0"

3'-0"17 SPA @ 2'-0" = 34'-0"4 SPA @ 2'-0" = 8'-0"3'-0"

1'-0"14'-0"21'-0"4'-4"9'-8"1'-0"

1'-0"5'-0"19'-0"776600

25'-0"19'-0"25'-0"

1'-0"19'-0"1'-0"

15'-0"21'-0"15'-0"

MEZZANINE FRAMING PLAN

51'-0" OUT-TO-OUT OF STEEL

3" ENDLAP

10'-8"

5'-8"

25'-1 1/4"15'-5 1/4"15'-5 1/4"26'-1 1/4"26'-1 1/4"26'-1 1/4"26'-1 1/4"26'-1 1/4"26'-1 1/4"26'-1 1/4"26'-1 1/4"26'-1 1/4"15'-3 1/2"15'-3 1/2"15'-3 1/2"15'-3 1/2"15'-3 1/2"15'-3 1/2"15'-3 1/2"15'-3 1/2"15'-3 1/2"15'-4"20'-4"15'-4"

MEZZANINE DECKING PLAN

PANELS: 26 Ga. 0.6FD - G60 - 35" COVERAGE

SCOTT D. CLOSE
LICENSE
No. 65849
STATE OF FLORIDA
PROFESSIONAL ENGINEER

BEHLEN MFG. CO.
COLUMBUS, NEBRASKA

REVISIONS

REVISIONS	DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE	REVIEWED BY	DATE
UPDATED PART MARK & TABLE	RDP	06/25/24	ASK	06/25/24				

SCALE : NONE

DRAWN BY D. WURDINGER DATE 4/24/24

CHECKED BY DANA DATE 4-30-24

APPROVED BY SDC DATE 5-1-24

REVIEWED BY DATE


BOONE OFFICE 2024
LAKE CITY, FLORIDA

MEZZANINE FRAMING & DECKING


JOB NO. X4405

SHT. 11 OF 19

G:\JOBS\X4405\MEZZ

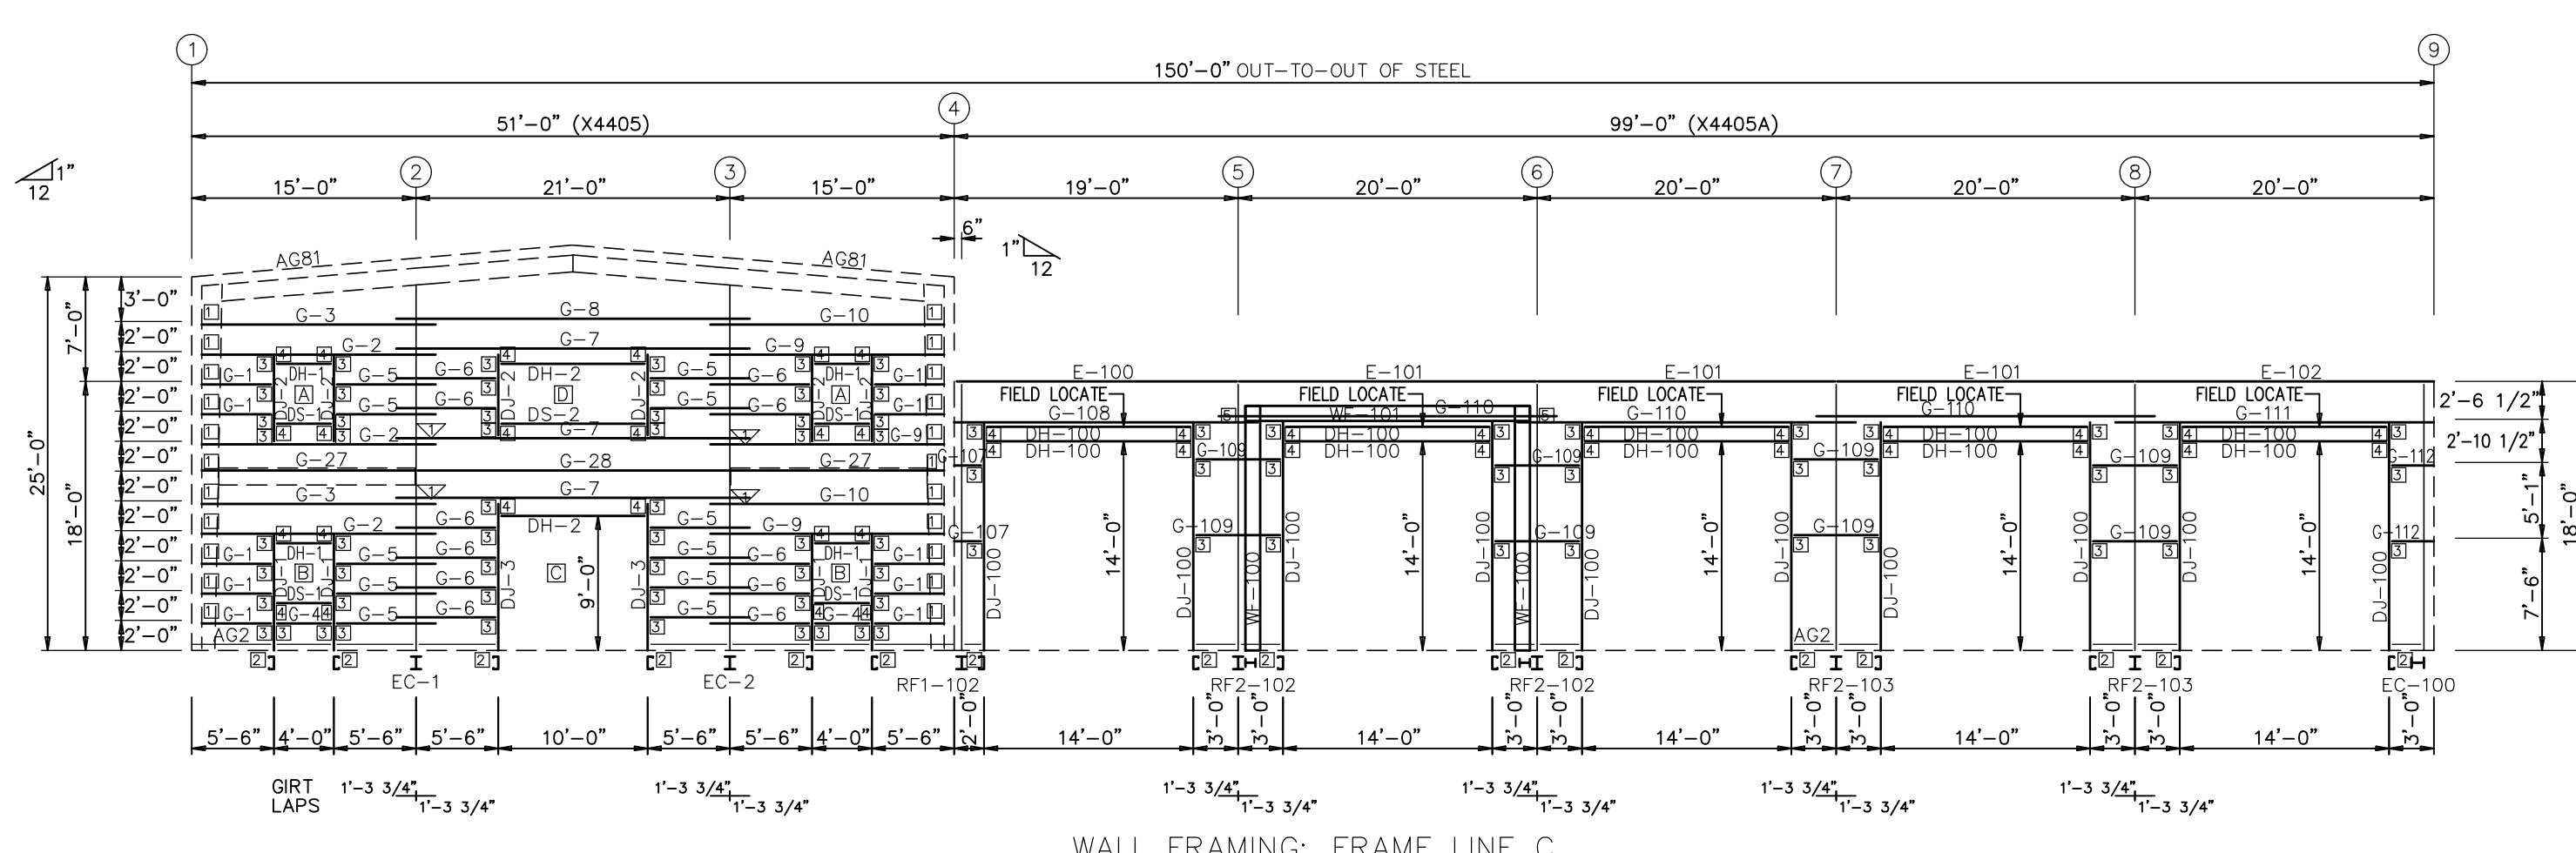

WALL FRAMING: FRAME LINE C

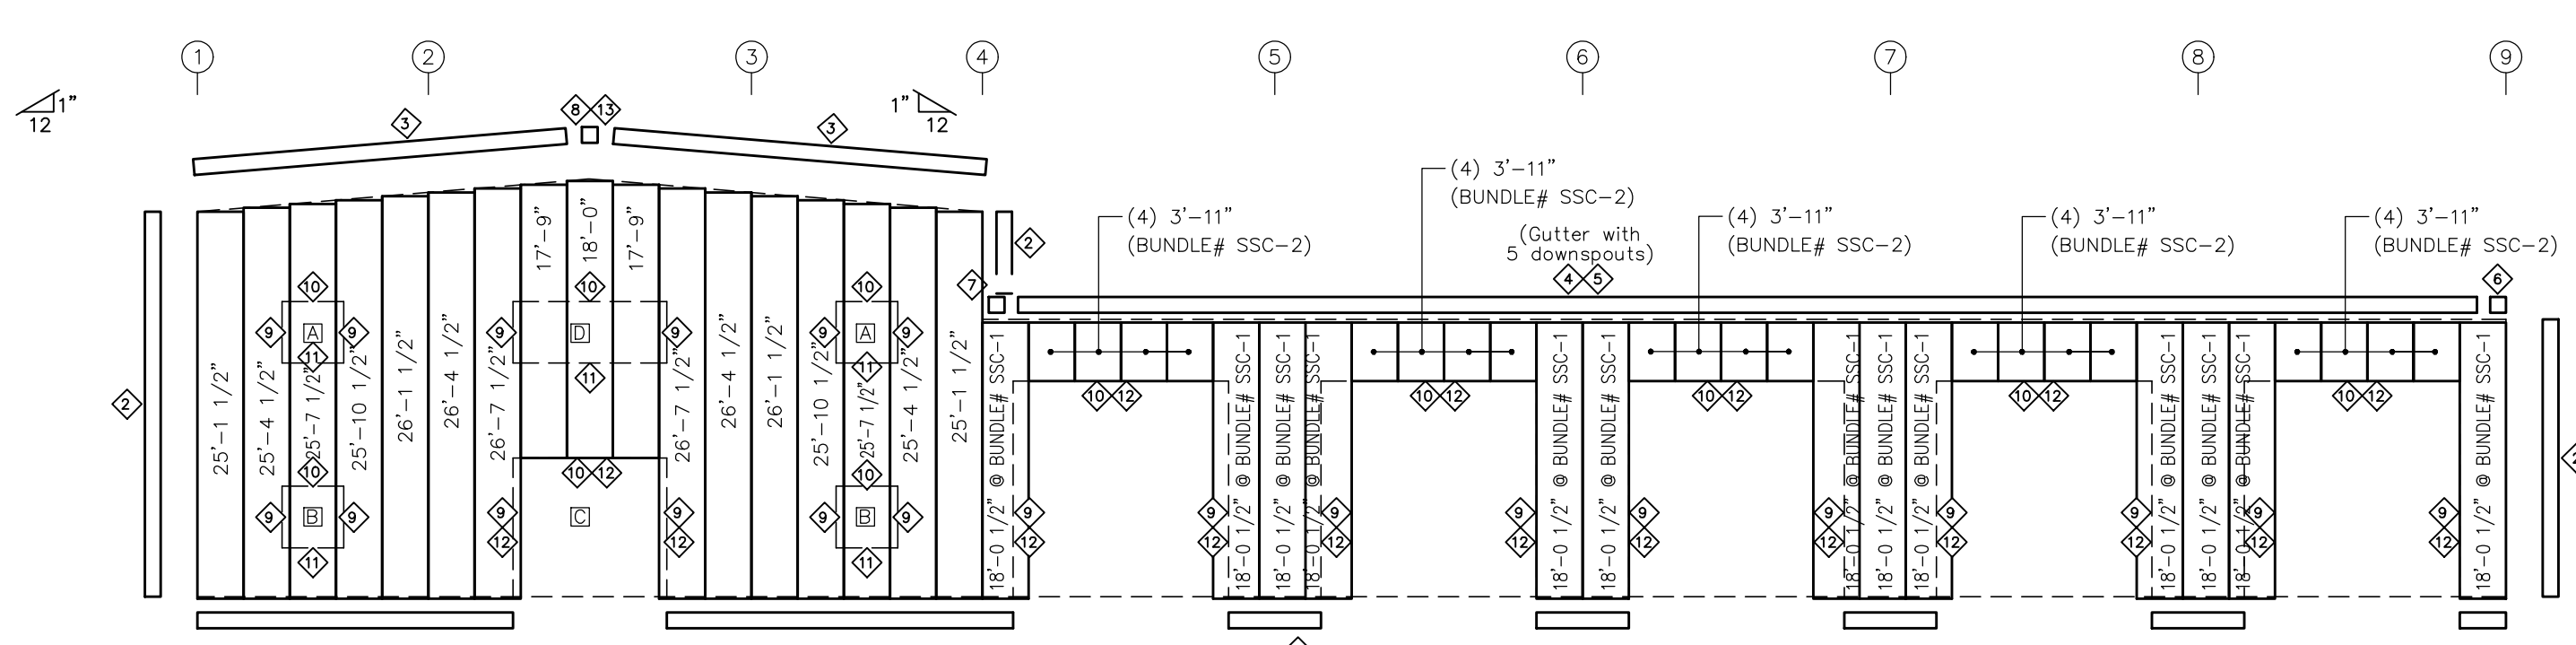

ENDWALL & SIDEWALL SHEETING & TRIM: FRAME LINE C

(K0726) PANELS: 26 Ga. PBR - ASH GRAY
(FOR BUILDING X4405 BUNDLE# ESC-1 TO ESC-9)
(FOR BUILDING X4405A BUNDLE# SSC-1 TO SSC-2)

BOLT TABLE				
FRAME LINE C				
LOCATION	QUAN	TYPE	DIA	LENGTH
X4405				
Columns/Rail	4	A325	1/2"	1 1/2"
X4405A				
WF-100 - WF-101	8	A325	3/4"	2 1/2"
WF-100 - RF2-102	4	A325	1/2"	1 1/2"

MEMBER TABLE		
FRAME LINE C		
MARK	PART	LENGTH
X4405		
EC-1	W8X15	24'-6 5/8"
EC-2	W8X15	24'-6 5/8"
DJ-1	8X35C16	7'-7 5/8"
DJ-2	8X35C16	5'-3 1/2"
DJ-3	8X35C16	9'-7 5/8"
DH-1	8X35C16	3'-11 3/4"
DH-2	8X35C16	9'-11 3/4"
DS-1	8X35C16	3'-11 3/4"
DS-2	8X35C16	9'-11 3/4"
C-1	8X25Z16	4'-5 1/4"
C-2	8X25Z16	15'-7 1/4"
C-3	8X25Z16	15'-7 1/4"
C-4	8X25Z16	3'-3 1/2"
G-5	8X25Z16	6'-5 1/2"
G-6	8X25Z16	6'-5 1/2"
G-7	8X25Z16	23'-7 1/2"
G-8	8X25Z16	23'-7 1/2"
G-9	8X25Z16	15'-7 1/4"
G-10	8X25Z16	15'-7 1/4"
C-27	8X25C16	14'-3 3/8"
C-28	8X25C16	20'-11 3/4"
X4405A		
WF-100	B1250413	16'-10"
WF-101	B1250413	16'-11 3/4"
DJ-100	8X35C16	15'-1 1/6"
DH-100	8X35C16	13'-11 3/4"
E-100	BE14	18'-9 3/4"
E-101	BE14	19'-11 3/4"
E-102	BE14	19'-11 3/4"
G-107	8X25Z16	1'-5 5/8"
G-108	8X25Z16	20'-1 5/8"
G-109	8X25Z16	5'-3 1/2"
G-110	8X25Z16	22'-7 1/2"
G-111	8X25Z16	21'-3 5/8"
G-112	8X25Z16	2'-7 5/8"

FLANGE BRACE TABLE		
FRAME LINE C		
WELD MARK	LENGTH	
1 FB225A	2'-0 1/2"	

CONNECTION PLATES	
FRAME LINE C	
MARK	PART
1	MP332
2	CP306
3	CP302
4	CP308
5	CP150

TRIM TABLE	
FRAME LINE C	
MARK	PART
1	B11
2	OCT1
3	JT1
4	ET1
5	GU1
6	GEC1R
7	GEC1L
8	PKB1
9	JT1
10	JT1
11	ST1
12	WT1
13	16881086

☐ - DENOTES FIELD OR FACTORY LOCATED ACCESSORY
(SEE ACCESSORY SHEET)

LETTER	REVISIONS	DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE	REVIEWED BY	DATE	LETTER	REVISIONS	DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE	REVIEWED BY	DATE

SCALE : NONE

DRAWN BY : D. WURDINGER DATE : 4/24/24

CHECKED BY : DANA DATE : 4-30-24

APPROVED BY : SDC DATE : 5-1-24

BOONE OFFICE 2024
LAKE CITY, FLORIDA

SIDEWALL FRAMING & SHEETING

BEHLEN MFG. CO.
COLUMBUS, NEBRASKA

JOB NO. X4405 SH. 12 OF 19

FILE: \JOBS\X4405\LINEC


BOLT TABLE			
FRAME LINE A			
LOCATION	QUANTITY	SIZE	LENGTH
X4405			
Columns/Row	4	A325	1/2" x 1 1/2"

MEMBER TABLE			
FRAME LINE A			
MARK	PART	LENGTH	
X4405			
EC-3	W8X15	24'-6 5/8"	
EC-4	W8X15	24'-6 5/8"	
DJ-1	8X35C16	7'-7 5/8"	
DJ-2	8X35C16	5'-3 1/2"	
DJ-4	8X35C16	8'-10 5/8"	
DH-1	8X35C16	3'-11 3/4"	
DH-3	8X35C16	3'-3 3/4"	
DS-1	8X35C16	3'-11 3/4"	
G-1	8X25Z16	4'-5 1/4"	
G-2	8X25Z16	15'-7 1/4"	
G-3	8X25Z16	15'-7 1/4"	
G-4	8X25Z16	8'-3 1/2"	
G-5	8X25Z16	6'-5 1/2"	
G-6	8X25Z16	6'-5 1/2"	
G-8	8X25Z16	23'-7 1/2"	
G-9	8X25Z16	15'-7 1/4"	
G-10	8X25Z16	15'-7 1/4"	
G-14	8X25Z16	15'-11 1/2"	
G-15	8X25Z16	23'-7 1/2"	
G-16	8X25Z16	6'-9 1/2"	
G-27	8X25C16	14'-3 5/8"	
G-28	8X25C16	20'-11 3/4"	
X4405A			
DJ-100	8X35C16	15'-1 7/8"	
DJ-103	8X35C16	12'-2 5/8"	
DH-100	8X35C16	13'-1 3/4"	
DH-101	8X35C16	3'-3 3/4"	
E-101	BE14	19'-11 3/4"	
E-103	BE14	19'-11 3/4"	
E-105	BE14	18'-9 3/4"	
G-113	8X25Z16	20'-1 7/8"	
G-114	8X25Z16	21'-3 5/8"	
G-115	8X25Z16	15'-11 1/2"	
G-116	8X25Z16	23'-11 1/2"	
G-117	8X25Z16	3'-11 1/2"	
G-118	8X25Z16	20'-4"	
G-119	8X25Z16	23'-11 1/2"	
G-120	8X25Z16	20'-1 5/8"	
CB-102	WX5	23'-11"	


FLANGE BRACE TABLE			
FRAME LINE A			
WH MARK	LENGTH		
1	FB245A	2'-0 1/2"	

CONNECTION PLATES			
FRAME LINE A			
WH MARK	LENGTH		
1	776500		
2	CP306		
3	CP302		
4	CP308		
7	MP332		

TRIM TABLE			
FRAME LINE A			
WH MARK	LENGTH		
2	OCT1		
3	RT1		
4	TT1		
5	GU1		
6	GEC1R		
7	GEC1L		
8	PKB1		
9	JT1		
10	HT1		
11	ST1		
12	WT1		
13	16881086		

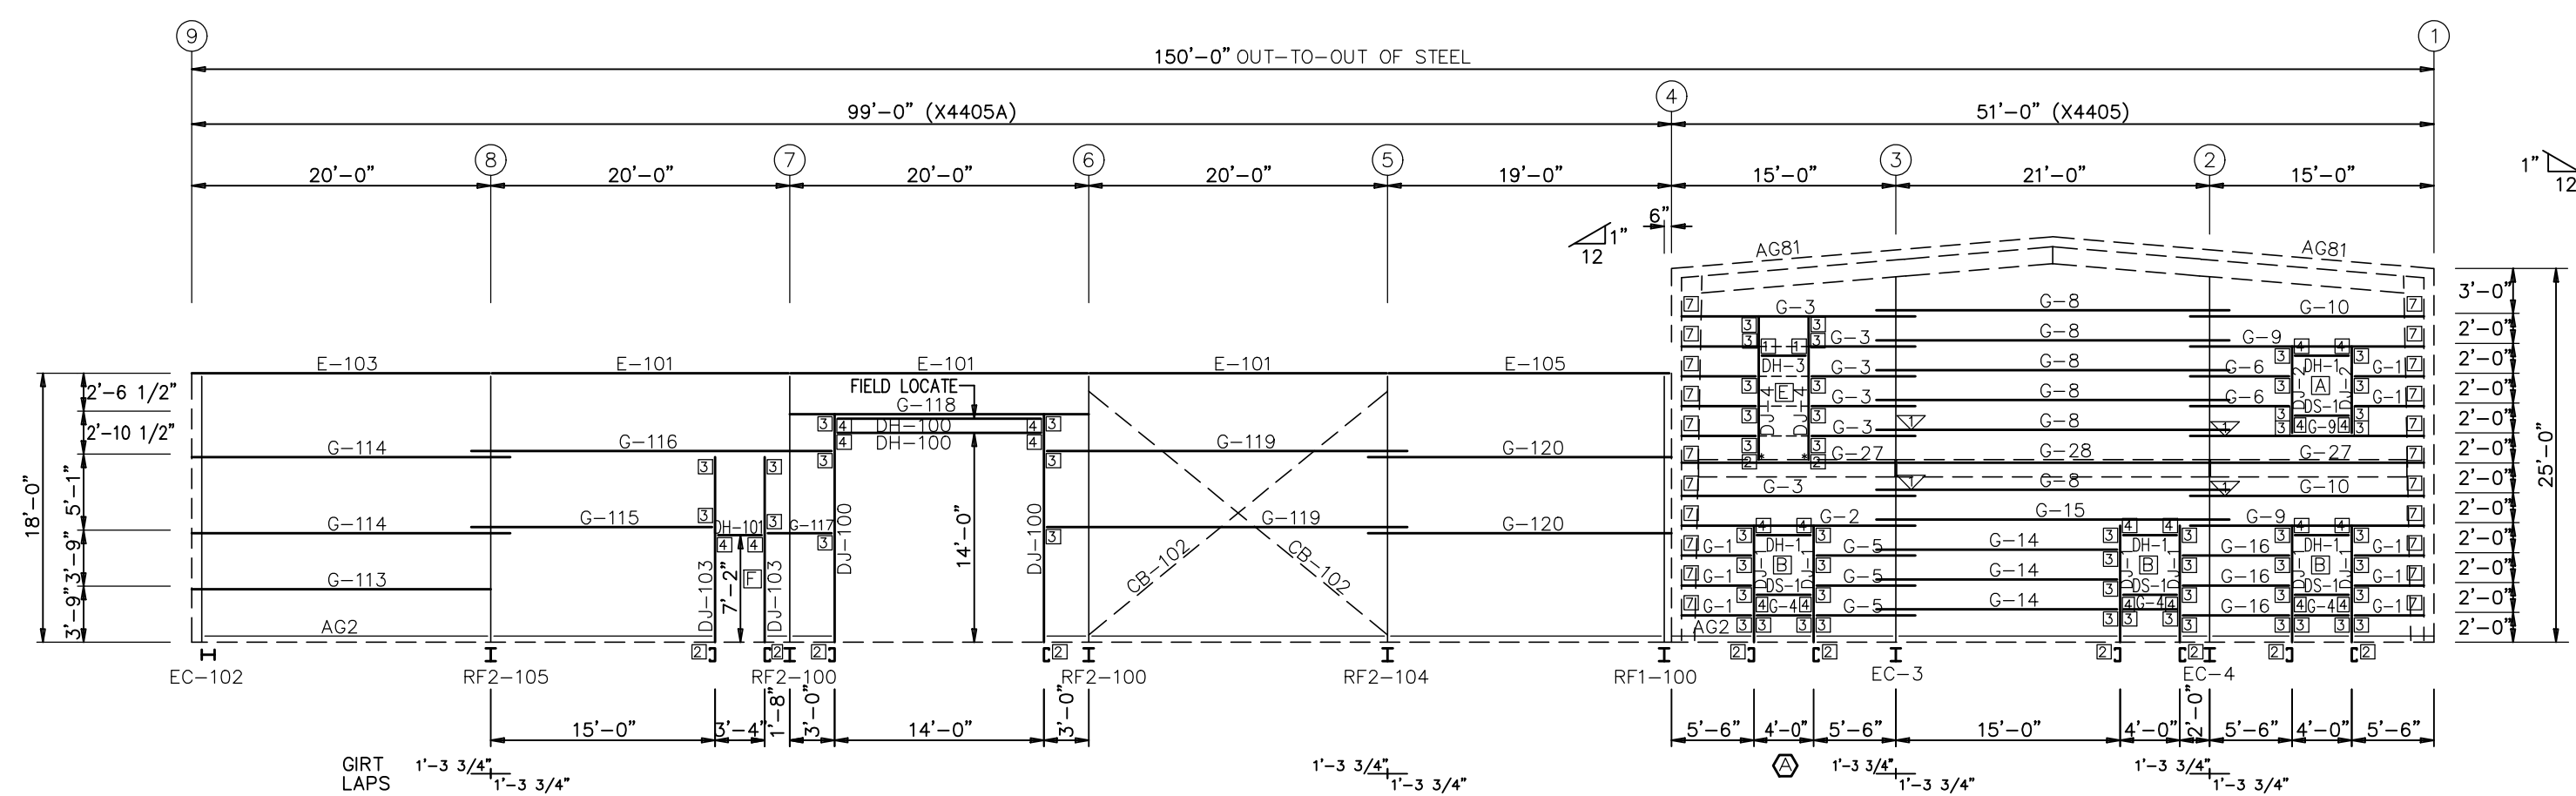

WALL FRAMING: FRAME LINE A

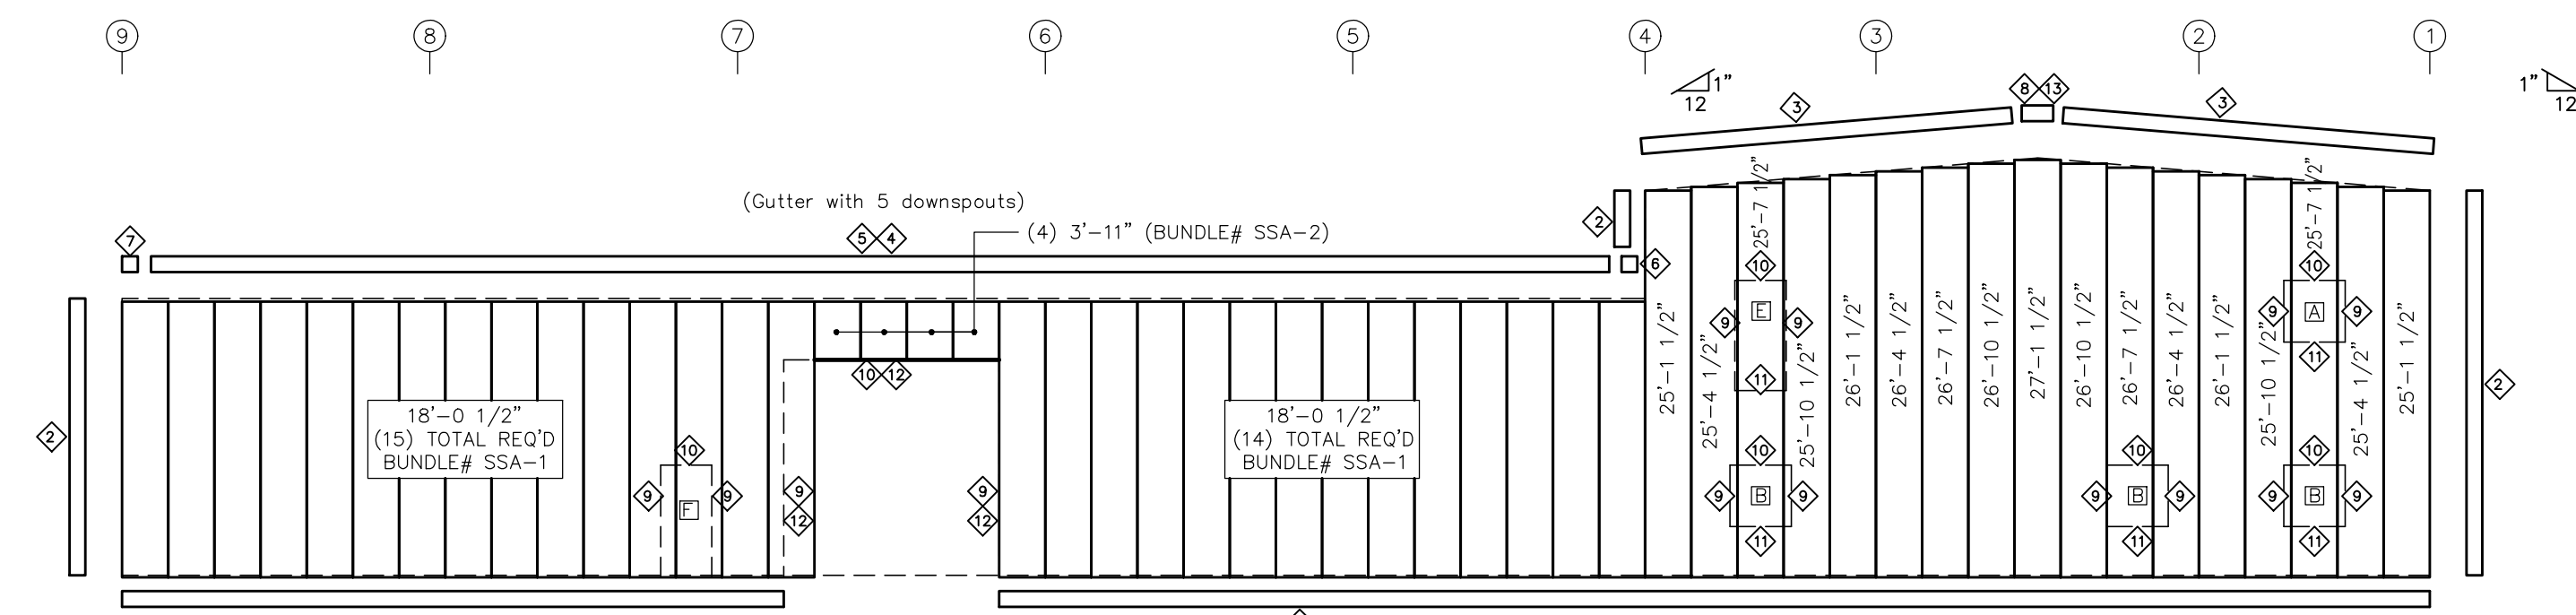

ENDWALL & SIDEWALL SHEETING & TRIM: FRAME LINE A


(K0726) PANELS: 26 Ga. PBR - ASH GRAY
(FOR BUILDING X4405 BUNDLE# ESA-1 TO ESA-9)
(FOR BUILDING X4405A BUNDLE# SSA-1 TO SSA-2)

□ - DENOTES FIELD OR FACTORY LOCATED ACCESSORY
(SEE ACCESSORY SHEET)



										SCALE : NONE		DRAWN BY : D. WURDINGER		DATE : 4/24/24		BOONE OFFICE 2024		BEHLEN MFG. CO.	
										CHECKED BY : DANA		DATE : 4-30-24		APPROVED BY : SDC		DATE : 5-1-24		LAKE CITY, FLORIDA	
										REVIEWED BY :		DATE :		DATE :		DATE :		COLUMBUS, NEBRASKA	
										REVISIONS		DRAWN BY		DATE		DATE		JOB NO.	
										REVISIONS		DRAWN BY		DATE		DATE		SHT. 13 OF 19	
										REVISIONS		DRAWN BY		DATE		DATE		SIDEWALL FRAMING & SHEETING	
										REVISIONS		DRAWN BY		DATE		DATE		X4405	
										REVISIONS		DRAWN BY		DATE		DATE		G:\JOBS\X4405\LINEA	

1	BT1
2	OCT1
3	ET1
4	GU1
5	GEC1R
6	GEC1L
7	JT1
8	HT1
9	ST1



SCOTT D. CLOSE
LICENSE
No. 65849
STATE OF
FLORIDA
PROFESSIONAL ENGINEER


[illegible]

BOLT TABLE				
FRAME LINE 9				
LOCATION	QUAN	TYPE	DIA	LENGTH
ER-100/ER-101	6	A325	5/8"	2 1/4"
Columns/Raf	8	A325	1/2"	1 1/2"
Jamb	4	A325	1/2"	1 1/2"


MEMBER TABLE		
FRAME LINE 9		
MARK	PART	LENGTH
EC-100	W8X10	16'-5 1/16"
EC-101	W10X12	18'-5 1/16"
EC-102	W8X10	16'-5 1/16"
ER-100	W10X12	25'-1 5/8"
ER-101	W10X12	25'-1 5/8"
DJ-101	8X35C14	18'-0 5/8"
DJ-102	8X35C14	18'-3 3/4"
OH-101	8X35C16	3'-3 3/4"
G-100	8X25Z16	10'-5 5/8"
G-101	8X25Z16	9'-9 1/4"
G-102	8X25Z16	2'-7 1/2"
G-103	8X25Z16	13'-0 1/2"
G-104	8X25Z16	26'-10 1/4"
G-105	8X25Z15	26'-10 1/4"
G-106	8X25Z13	26'-10 1/4"
CB-100	WX4	26'-10"
CB-101	WX4	27'-11"

CONNECTION PLATES	
FRAME LINE 9	
ID	MARK/PART
1	CP131
2	CP130
4	CP306
5	CP368
6	CP302
7	CP308

TRIM TABLE	
FRAME LINE 9	
ID	PART
1	BT1
2	OCT1
3	RT1
4	PKB1
7	JT1
8	HT1
9	16881086

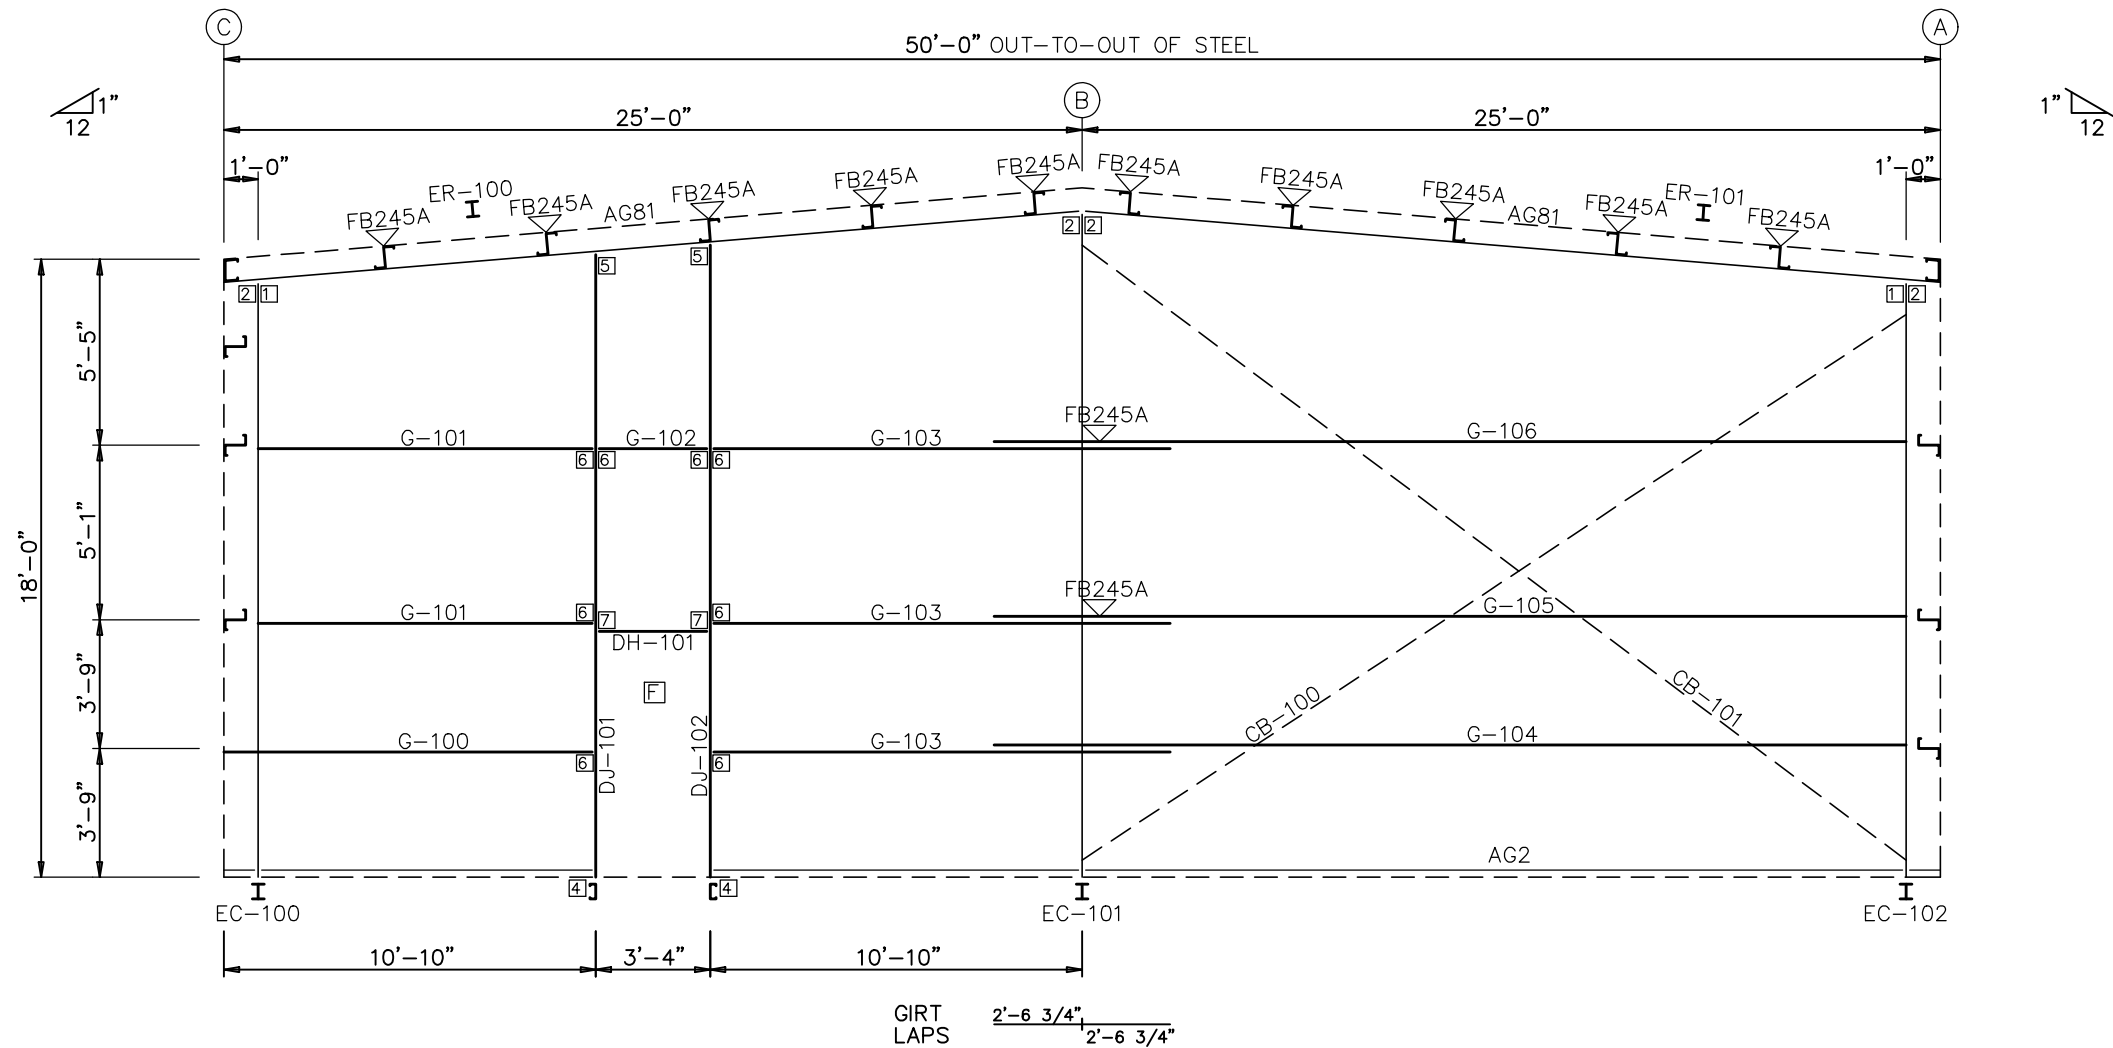

ENDWALL FRAMING: FRAME LINE 9

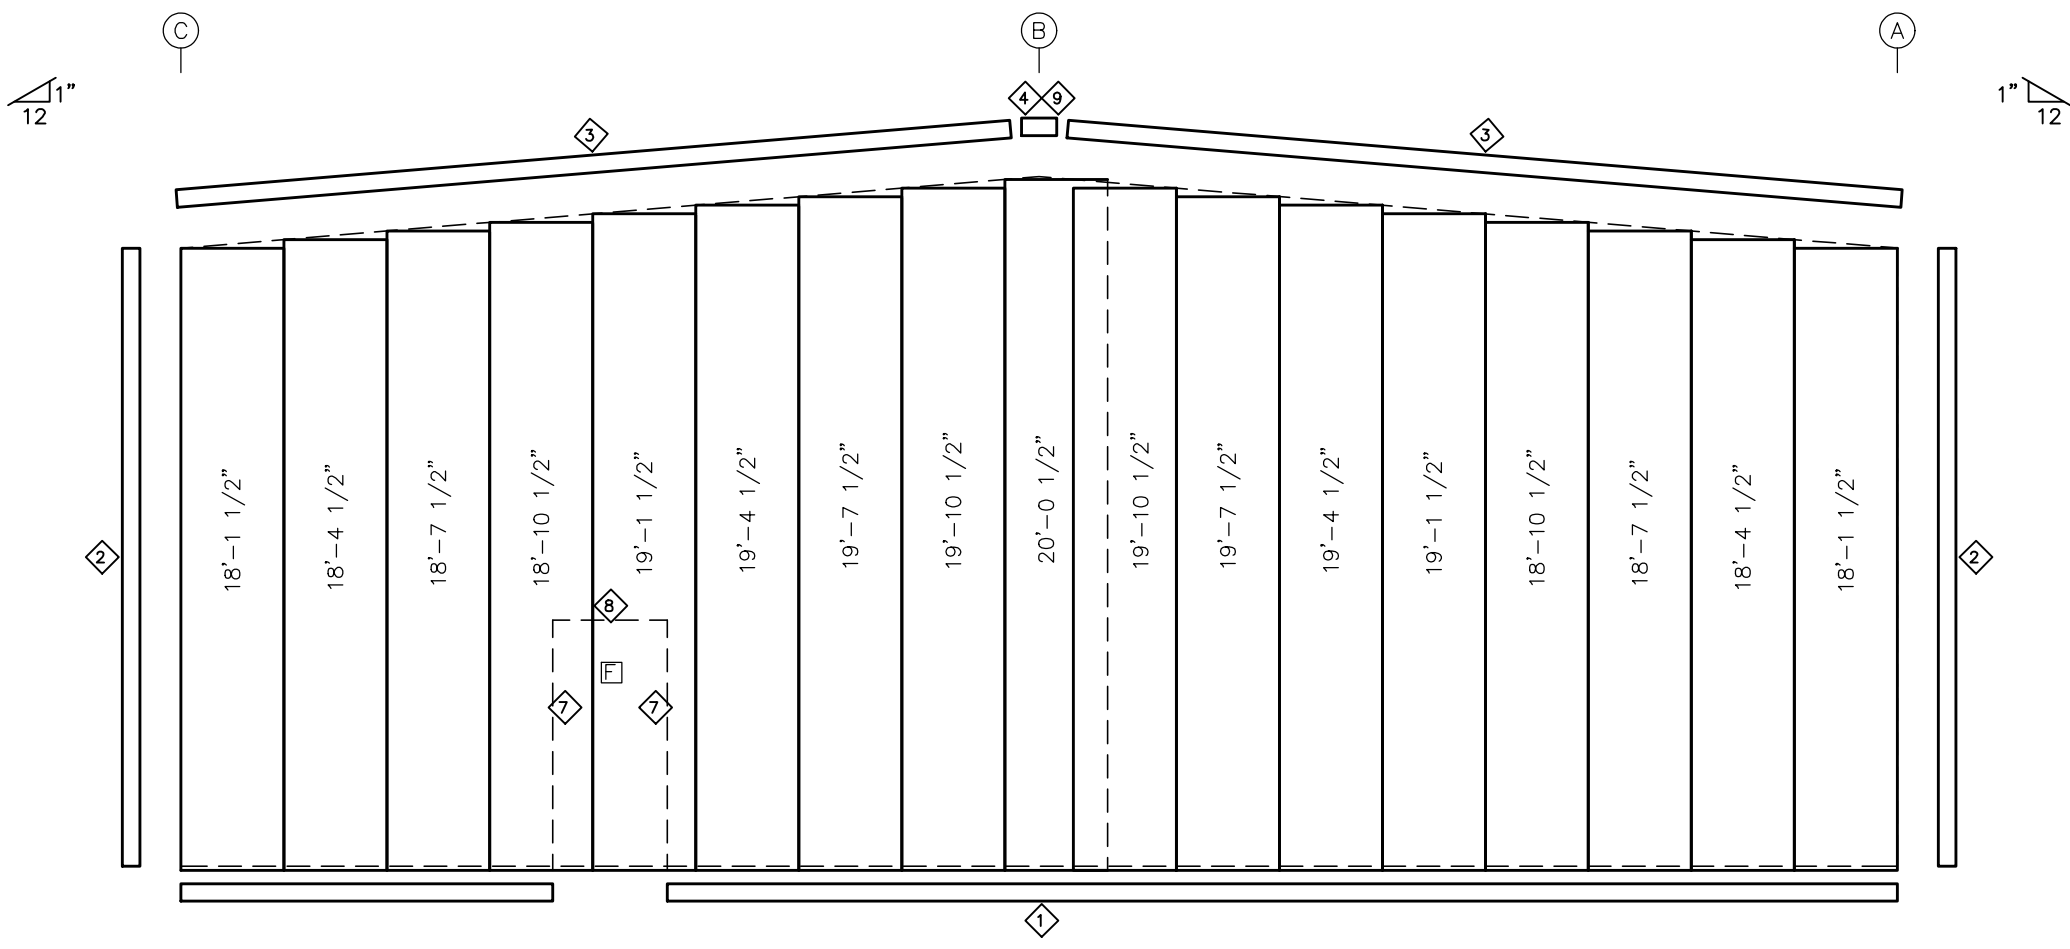


ENDWALL SHEETING & TRIM: FRAME LINE 9
(K0726) PANELS: 26 Ga. PBR - ASH GRAY
(BUNDAL# ES9-1 TO ES9-9)

⊠ - DENOTES FIELD OR FACTORY LOCATED ACCESSORY
(SEE ACCESSORY SHEET)



										SCALE : NONE										BOONE OFFICE 2024 LAKE CITY, FLORIDA		BEHLEN MFG. CO. COLUMBUS, NEBRASKA	
										DRAWN BY D. WURDINGER DATE 4/24/24													
										CHECKED BY DANA DATE 4-30-24													
										APPROVED BY SDC DATE 5-1-24													
LETTER	REVISED		DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE	REVIEWED BY	DATE	LETTER	REVISED		DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE	REVIEWED BY	DATE	ENDWALL FRAMING & SHEETING	
																						JOB NO. X4405	
																						SHT. 15 OF 19	
																						G:\JOBS\X4405\LINE9	

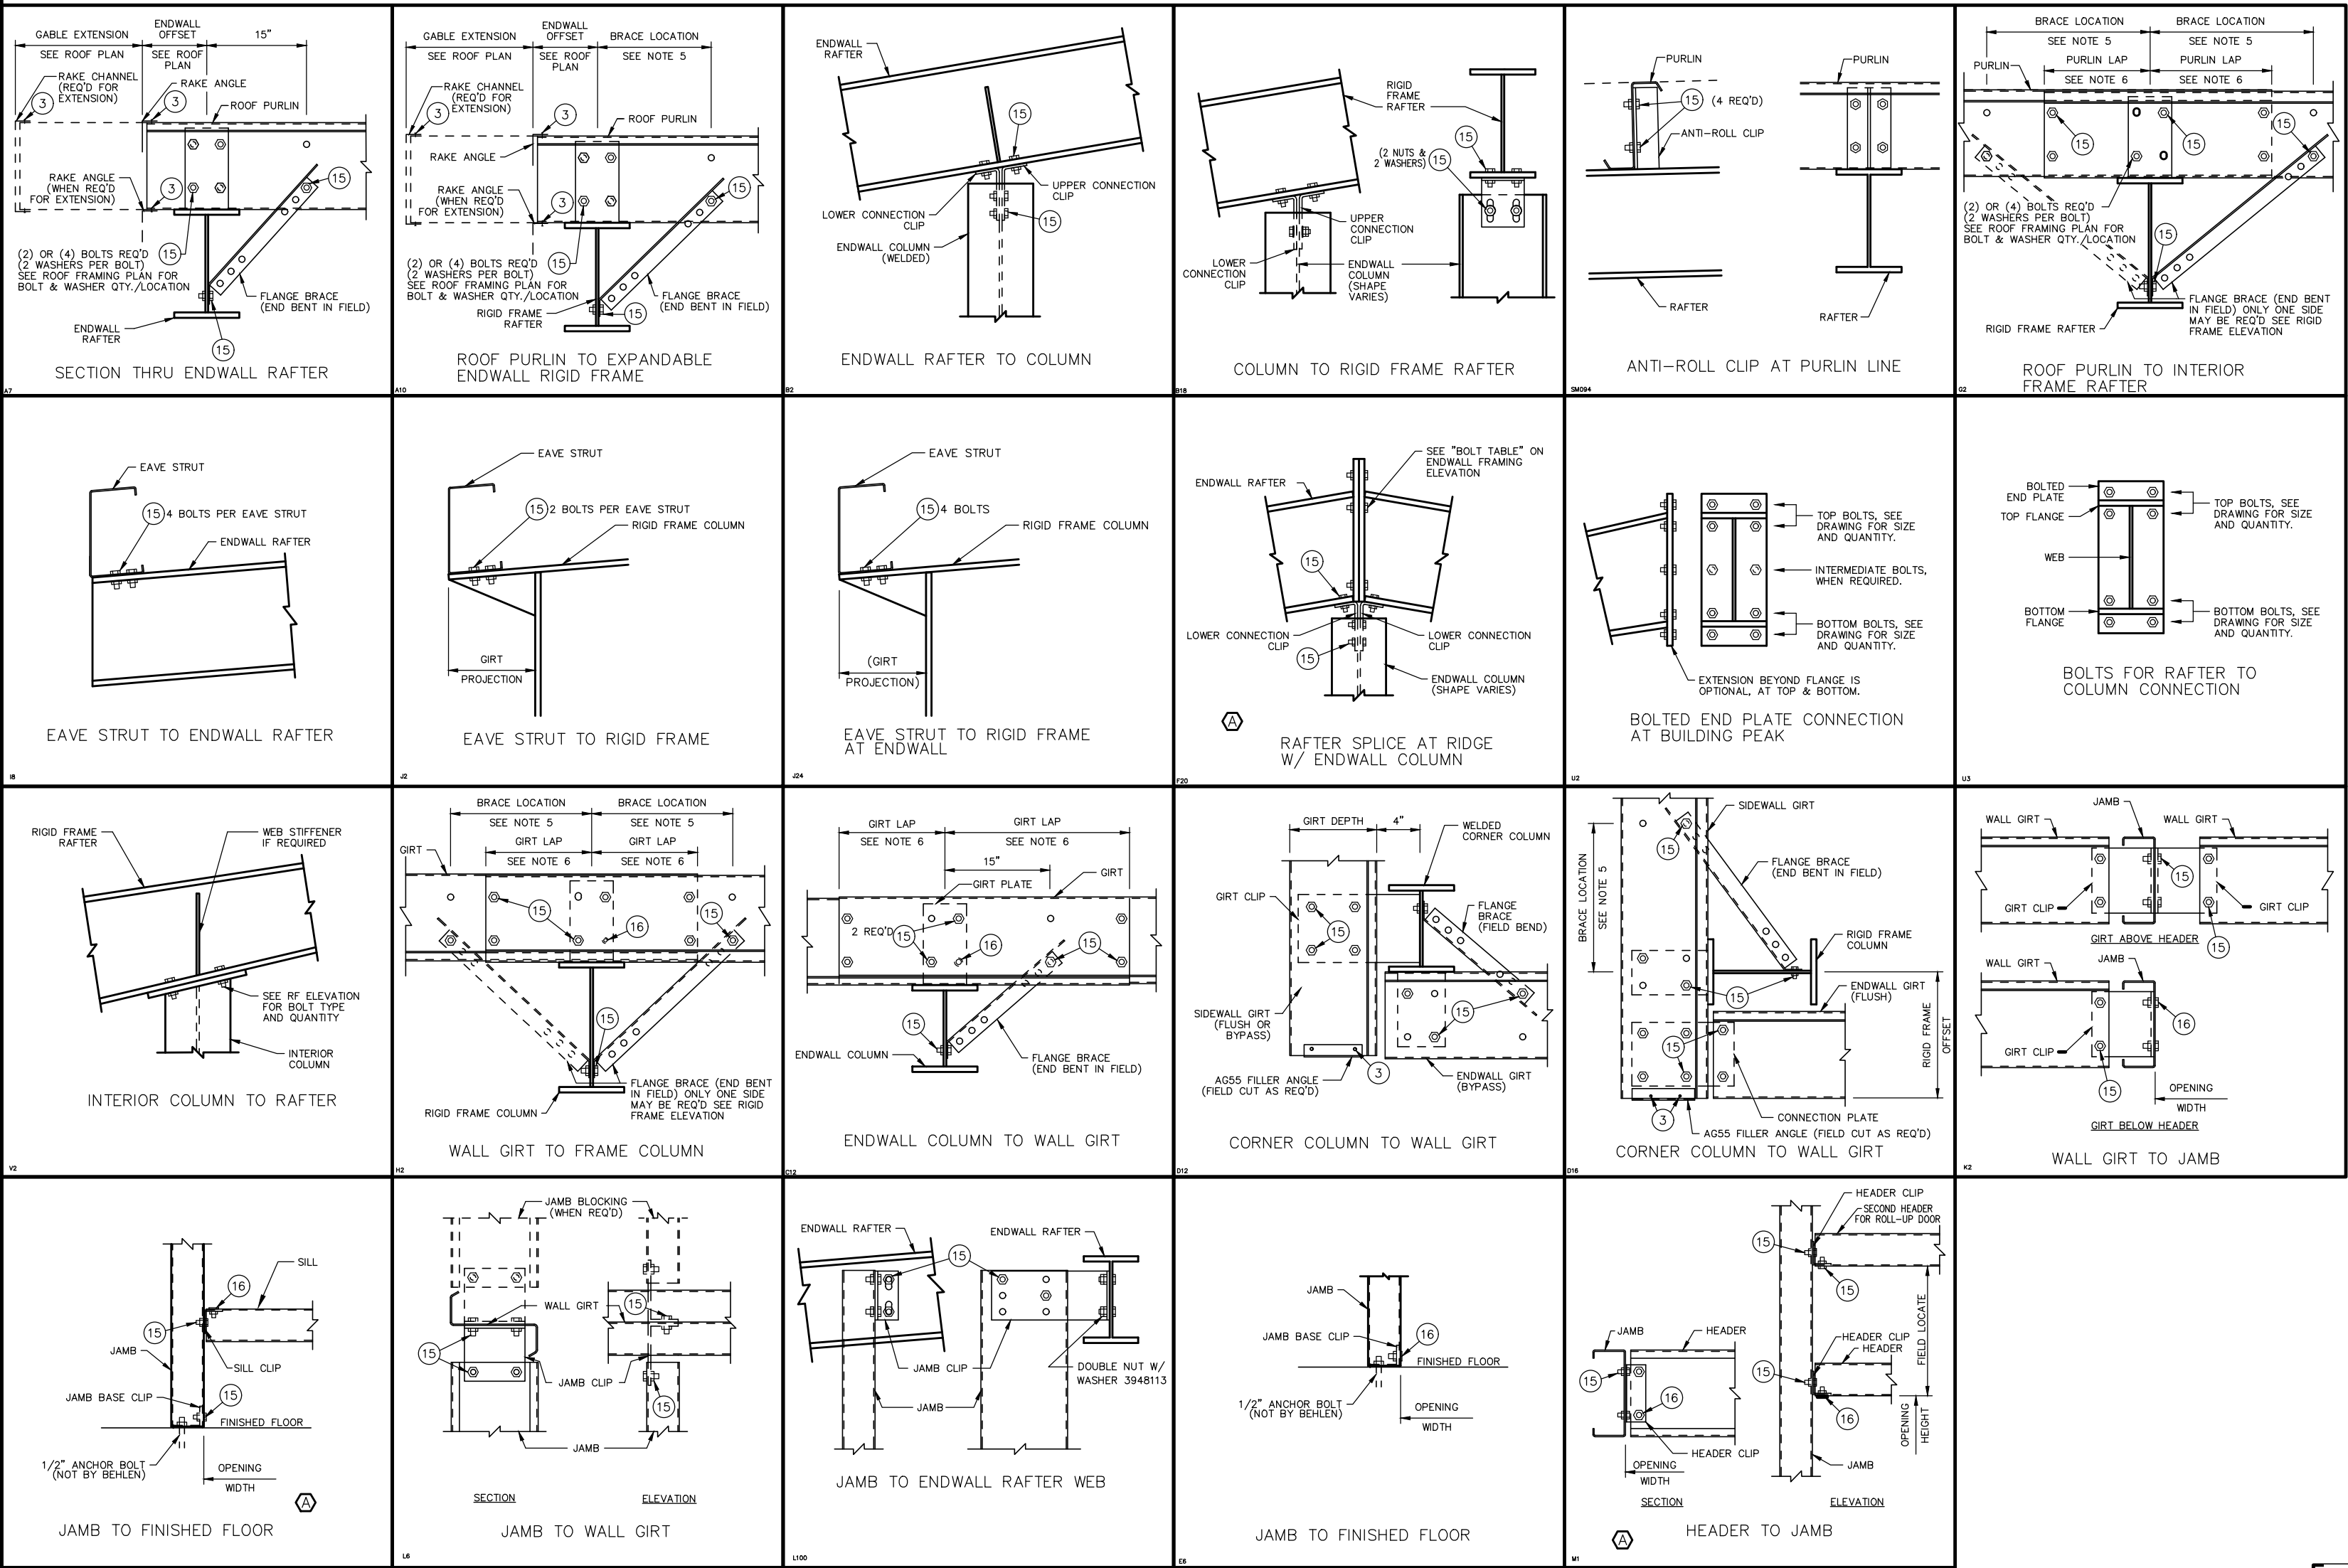

FASTENER SCHEDULE					
LOC.	PART NUMBER	DESCRIPTION	LOC.	PART NUMBER	DESCRIPTION
(1)		AS NOTED ON RIGID FRAME ELEVATION	(14)	3228087	SCREW 12 X 1 1/4 HWH SD #5 PT NW
(2)	3228100	SCREW 1/4 X 3/4 FL-TP SD WW	(15)	3228193	BOLT 1/2 X 1 1/2 HWH A325T GALV & NUT (1328191)
(3)	3228084	SCREW 12 X 1 HWH SD NW	(16)	3208170	BOLT 1/2 X 1 FLT RD HD A307 PLTD & NUT (2688007)
(4)	3228101	SCREW 12 X 1 1/4 FL-TP SD WW	(17)	3228102	SCREW 12 X 2 FL-TP SD WW
(5)	3228105	SCREW 1/4 X 1 1/4 LG-LF SD WW	(18)	996011	BOLT 3/8 X 7/8 PHPS HD (W/O WASHER) & NUT (2688008)
(6)	3228098	SCREW 1/2 X 1/2 HWH SD NW	(19)	3188003	BOLT 3/8 X 7/8 HEX HD (W/O WASHER) & NUT (2688008)
(7)	3188333	BOLT 1/2 X 2 HWH A325T GALV & NUT (1328191)	(20)	3228122	SCREW 1/4 X 1 1/2 HWH SD NW
(8)	1328199	BOLT 5/8 X 2 1/4 HWH A325T GALV & NUT (1328195)	(21)	3228124	SCREW 1/4 X 1 1/4 HWH SHOULDER SD NW
(9)	1328187	BOLT 3/4 X 1 1/2 HWH A325T GALV & NUT (1328192)	(22)	3228126	SCREW 17 X 1 LG-LF ST WW
(10)	1328190	BOLT 3/4 X 2 1/2 HWH A325T GALV & NUT (1328192)	(23)	3228138	SCREW 1/4 X 1 HWH SD NW
(11)	3228100	SCREW 1/4 X 3/4 FL-TP SD WW FOR ADP1 ROOF	(24)	3208084	SCREW 10 X 1 1/2 HWH WOODTITE WW
(12)	3228103	SCREW 1/4 X 3/4 LG-LF SD WW FOR SSR	(25)	3228132	SCREW 12 X 1 1/2 HWH SD #5 PT WW
(13)	3228101	SCREW 12 X 1 1/4 FL-TP SD WW FOR ADP1 ROOF	(26)		
	3228105	SCREW 1/4 X 1 1/4 LG-LF SD WW FOR SSR			

LOC.	PART NUMBER	DESCRIPTION	LOC.	PART NUMBER	DESCRIPTION
(1)	3228100	SCREW 1/4 X 3/4 FL-TP SD WW	(14)	3228087	SCREW 12 X 1 1/4 HWH SD #5 PT NW
(2)	3228084	SCREW 12 X 1 HWH SD NW	(15)	3228193	BOLT 1/2 X 1 1/2 HWH A325T GALV & NUT (1328191)
(3)	3228101	SCREW 12 X 1 1/4 FL-TP SD WW	(16)	3208170	BOLT 1/2 X 1 FLT RD HD A307 PLTD & NUT (2688007)
(4)	3228103	SCREW 1/4 X 1 1/4 LG-LF SD WW	(17)	3228102	SCREW 12 X 2 FL-TP SD WW
(5)	3228093	SCREW B X 1/2 HWH SD NW	(18)	3228011	BOLT 3/8 X 7/8 PHPS HD (W/O WASHER) & NUT (2688008)
(6)	3188333	BOLT 1/2 X 2 HWH A325T GALV & NUT (1328191)	(19)	3188003	BOLT 3/8 X 7/8 HEX HD (W/O WASHER) & NUT (2688008)
(7)	1328199	BOLT 5/8 X 2 1/4 HWH A325T GALV & NUT (1328195)	(20)	3228122	SCREW 1/4 X 1 1/2 HWH SD NW
(8)	1328187	BOLT 3/4 X 1 1/2 HWH A325T GALV & NUT (1328192)	(21)	3228124	SCREW 1/4 X 1 1/4 HWH SHOULDER SD NW
(9)	1328190	BOLT 3/4 X 2 1/2 HWH A325T GALV & NUT (1328192)	(22)	3228126	SCREW 17 X 1 LG-LF ST WW
(10)	3228100	SCREW 1/4 X 3/4 FL-TP SD WW FOR ADP1 ROOF	(23)	3228138	SCREW 1/4 X 1 HWH SD NW
(11)	3228101	SCREW 12 X 1 1/4 FL-TP SD WW FOR ADP1 ROOF	(24)	3208084	SCREW 10 X 1 1/2 HWH WOODTITE WW
(12)	3228103	SCREW 1/4 X 1 1/4 LG-LF SD WW FOR SSR	(25)	3228132	SCREW 12 X 1 1/2 HWH SD #5 PT WW
(13)	3228105	SCREW 1/4 X 1 1/4 LG-LF SD WW FOR SSR	(26)		

UNLESS OTHERWISE NOTED, CONNECTIONS BY THIS MANUFACTURER USING A-325 HIGH STRENGTH BOLTS ARE DESIGNED TO BE FASTENED USING THE "SNUG-TIGHTENED" METHOD, AS DEFINED AND DESCRIBED IN THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS SPECIFICATION (RSCC, 6-23-2000) SECTION 4.1 "SNUG-TIGHTENED JOINTS" (REFERENCE SECTION 8.1).




SCALE : NONE	DRAWN BY : D. WURDINGER	DATE : 4/8/24
CHECKED BY : DANA	DATE : 4-30-24	
APPROVED BY : SDC	DATE : 5-1-24	
REVIEWED BY :	DATE :	


BOONE OFFICE 2024
LAKE CITY, FL 32024

DETAIL DRAWINGS


BEHLEN MFG. CO. COLUMBUS, NEBRASKA	JOB NO. X4405	SH. 17 OF 19
	G:\JOBS\X4405\DTWGT	

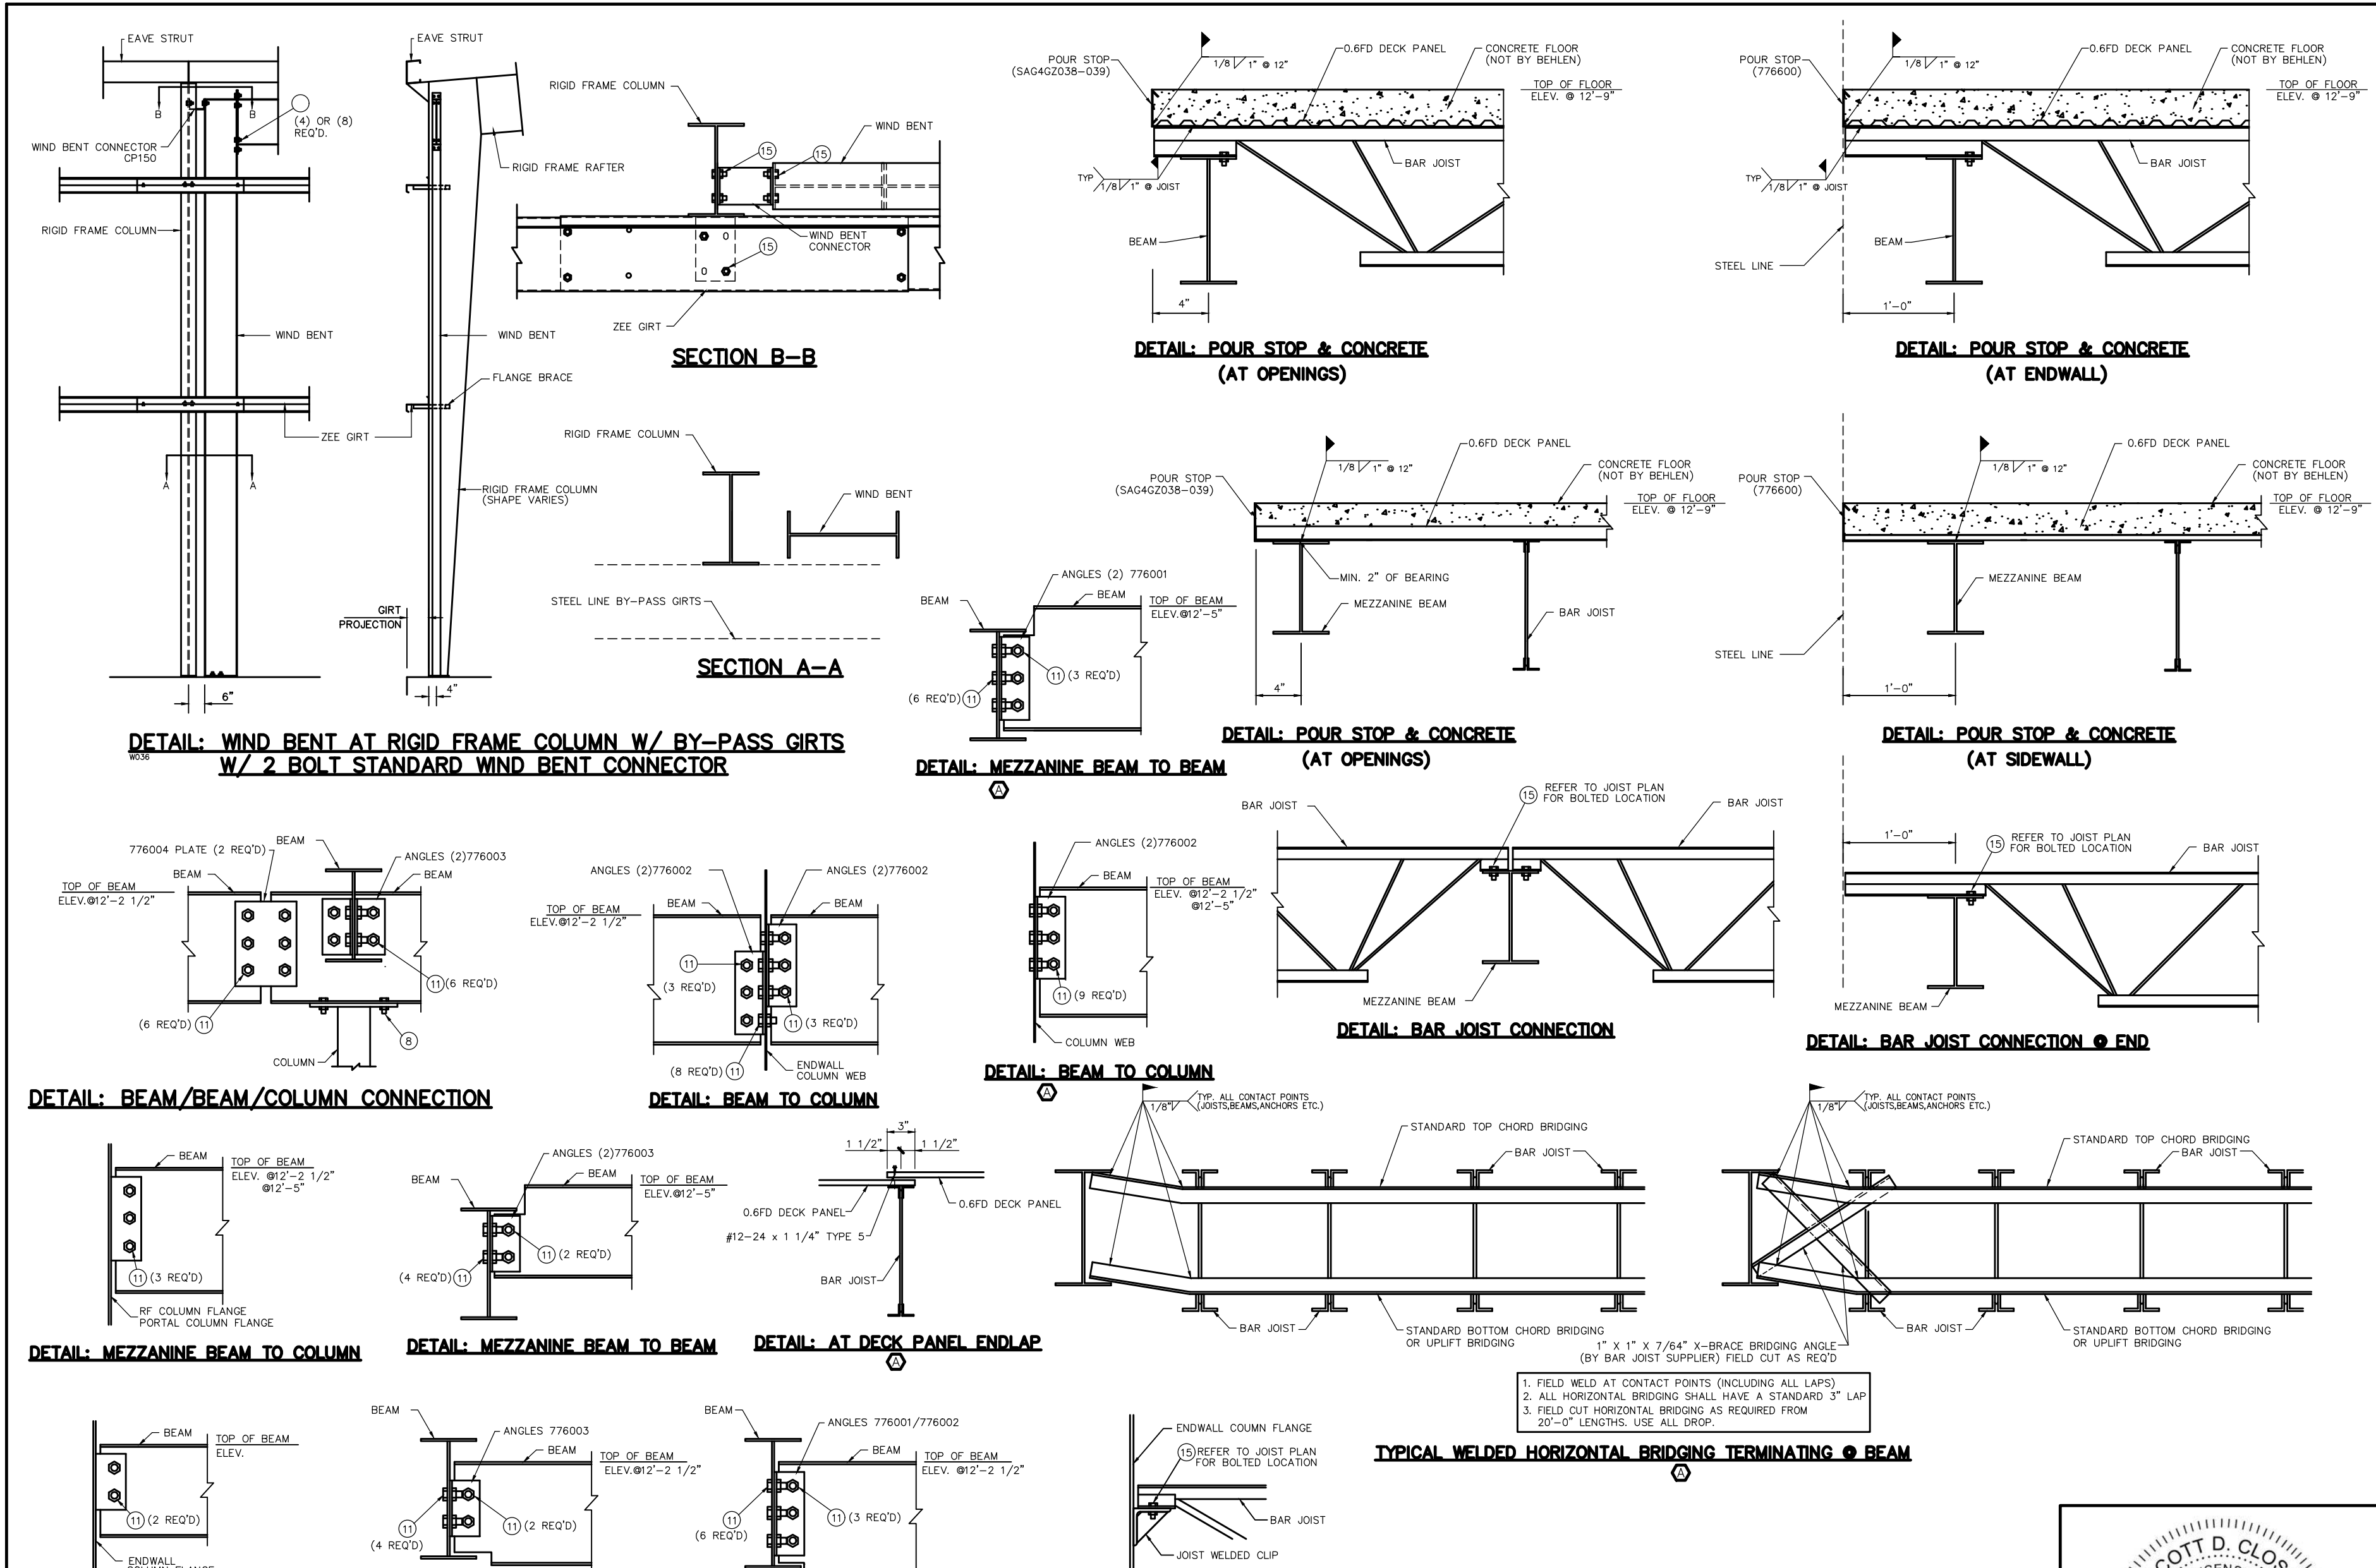




DETAIL: MEZZANINE BEAM TO FW COLUMN		DETAIL: MEZZANINE BEAM TO BEAM		DETAIL: MEZZANINE BEAM TO BEAM		DETAIL: JOIST CONNECTION	
FASTENER SCHEDULE							
LOC.	PART NUMBER	DESCRIPTION	LOC.	PART NUMBER	DESCRIPTION	ABBREVIATIONS	
(1)	AS NOTED ON RIGID FRAME ELEVATION	(14)	3228087	SCREW 12 X 1 1/4 HWH SD #5 PT NW	HD	= HEAD	
(2)	3228100	SCREW 1/4 X 3/4 FL-TP SD WW	(15)	1328193	BOLT 1/2 X 1 1/2 HWH A325 GALV & NUT (1328191)	SD	= SELF DRILLING
(3)	3228092	SCREW 12 X 1 HWH SD NW	(16)	3208170	BOLT 1/2 X 1 FLT RD HD A307 PLTD & NUT (2688007)	ST	= SELF TAPPING
(4)	3228101	SCREW 12 X 1 1/4 FL-TP SD WW	(17)	3228102	SCREW 12 X 2 FL-TP SD WW	SS	= STAINLESS STEEL
(5)	3228105	SCREW 1/4 X 1 1/4 LG-LF SD WW				RD	= ROUND
(6)	3228099	SCREW 8 X 1/2 HWH SD NW	(19)	996011	BOLT 3/8 X 7/8 PHPS HD (W/O WASHER) & NUT (2688008)	WW	= WITH WASHER
			(20)	3188003	BOLT 3/8 X 7/8 HEX HD (W/O WASHER) & NUT (2688008)	NW	= NO WASHER
(8)	3188333	BOLT 1/2 X 2 HWH A325 GALV & NUT (1328191)	(21)	3228122	SCREW 1/4 X 1 1/2 HWH SD NW	FLT	= FLAT
(9)	1328199	BOLT 5/8 X 2 1/4 HWH A325 GALV & NUT (1328195)	(22)	SEE WALL PANEL ERECTION GUIDE FOR SCREW & SPACING		HVHX	= HEAVY HEX
(10)	1328187	BOLT 3/4 X 1 1/2 HWH A325 GALV & NUT (1328192)	(23)	3228124	SCREW 1/4 X 1 1/4 HWH SHOULDER SD NW	UNPL	= UNPLATED
(11)	1328190	BOLT 3/4 X 2 1/2 HWH A325 GALV & NUT (1328192)				PLTD	= PLATED
(12)	3228100	SCREW 1/4 X 3/4 FL-TP SD WW FOR ADP1 ROOF	(25)	3228126	SCREW 17 X 1 LG-LF ST WW	LHW	= HEX WASHER HEAD
(13)	3228103	SCREW 1/4 X 3/4 LG-LF SD WW FOR SSR	(26)	3228138	SCREW 1/4 X 1 HWH SD NW	FL-TP	= FLAT TOP
(14)	3228101	SCREW 12 X 1 1/4 FL-TP SD WW FOR ADP1 ROOF	(27)	3208084	SCREW 10 X 1 1/2 HWH WOODTITE WW	LG-LF	= LONG LIFE
(15)	3228105	SCREW 1/4 X 1 1/4 LG-LF SD WW FOR SSR	(28)	3228132	SCREW 12 X 1 1/2 HWH SD #5 PT WW	PHPS	= PHILLIPS
NOTES:							
1. FOR SEQUENCE OF ERECTION - SEE APPLICABLE WALL PANEL ERECTION GUIDE.							
2. FOR FLANGE BRACE LOCATIONS - SEE FRAME CROSS SECTION AND ROOF FRAMING PLANS.							
3. SOME FIELD DRILLING AND/OR FIELD CUTTING OF STEEL COMPONENTS MAY BE REQUIRED DURING THE ERECTION OF THIS BUILDING.							
4. THE LENGTH OF THE FLANGE BRACE SUPPLIED AT EACH LOCATION WILL DETERMINE WHICH STANDARD LAP HOLE LOCATION (9, 1'-8, 2'-5 OR 3'-9) IS TO BE USED.							
5. ATTACH FLANGE BRACE TO HOLE IN GIRT WHICH BEST FITS THE FLANGE BRACE LENGTH SUPPLIED FOR THE LOCATION.							
UNLESS OTHERWISE NOTED, CONNECTIONS BY THIS MANUFACTURER USING A-325 HIGH STRENGTH BOLTS ARE DESIGNED TO BE FASTENED USING THE "SNUG TIGHTENED" METHOD, AS DEFINED AND DESCRIBED IN THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS SPECIFICATION (RSCC, 6-23-2000), SECTION 4.1 "SNUG-TIGHTENED JOINTS" (REFERENCE SECTION 8.1).							
SCALE : NONE							
DRAWN BY : D. WURDINGER DATE 4-30-24							
CHECKED BY : DANA DATE 4-30-24							
APPROVED BY : SDC DATE 5-1-24							
REVIEWED BY : DATE							
BOONE OFFICE 2024 LAKE CITY, FL 32024							
ERECTION DETAILS							
JOB NO. X4405 SHT. 18 OF 19							

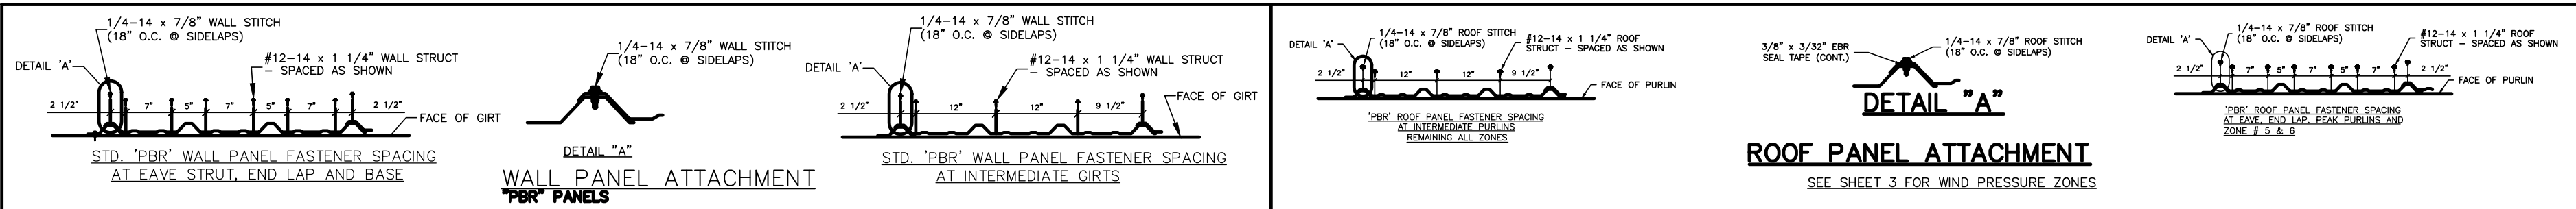


PANEL and TRIM FASTENERS		
Technical Data and Applications		
ITEM	T.B.S. FABTRON PART NAME (DESCRIPTION)	APPLICATIONS
	SCR #12-14 x 1 1/4" ROOF STRUCT.	1. 'PBR' Roof Panel to Purlins. 2. LOC-SEAM Panel @ Eave and End Laps.
	SCR 1/4-14 x 7/8" ROOF STITCH	1. 'PBR' Roof Panel Sidelaps. 2. Roof Trims to Panel.
	SCR #12-14 x 1 1/4" WALL STRUCT.	1. 'R' Wall Panel to Girts. 2. Wall Trims to Panel.
	SCR 1/4-14 x 7/8" WALL STITCH	1. 'R' Wall Panel Sidelaps. 2. Wall Trims to Panel.
	SCR #10-16 x 1" SD2 PPKH	1. Cleat to Panel.
	SCR #9-15 x 1 1/2" WOOD WALL	1. Wall Panels or Trim to Wood.
	1/4 x 1 1/4" MHD DRIVEPIN	1. Base Angle to Concrete. (*PROVIDED BY ERECTOR)
	1/8 x 1/4" ALUM. RIVET	1. All Trim and Gutter Laps.
	9/32 dia., 1/4" - 5/8" GRIP, LARGE FLANGE PROTRUDING CROWN HEAD, OLYMPIC BULB-TITE RIVET w/ NEOPRENE WASHER.	

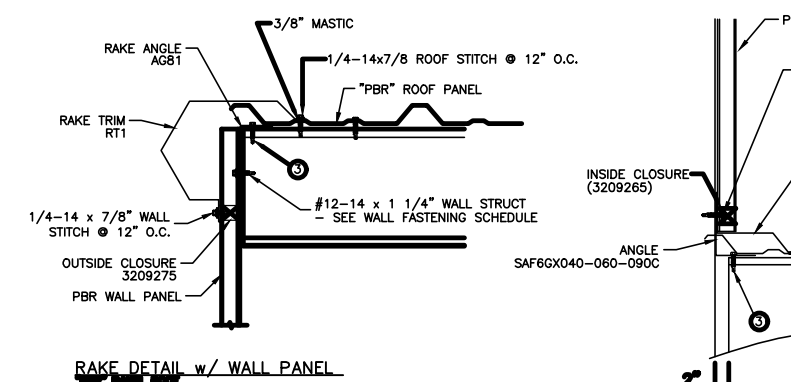





ROOF TO TALLER BUILDING

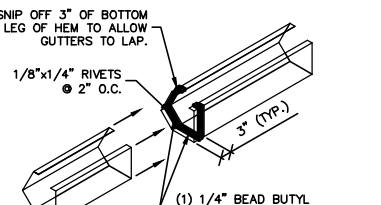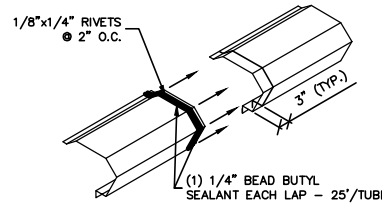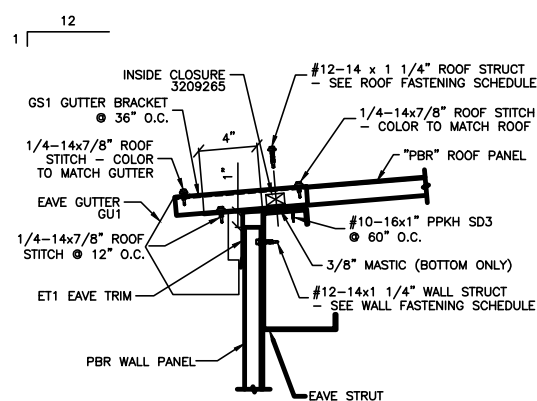





DOWNSPOUT ATTACHMENT DETAILS

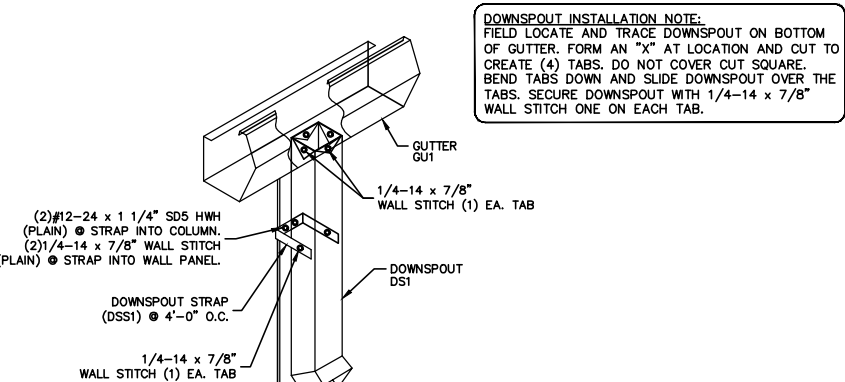

DOWNSPOUT INSTALLATION NOTE:
FIELD LOCATE AND TRACE DOWNSPOUT ON BOTTOM OF GUTTER. FORM AN "X" AT LOCATION AND CUT TO CREATE (4) TABS. DO NOT COVER CUT SQUARE. BEND TABS DOWN AND SLIDE DOWNSPOUT OVER THE TABS. SECURE DOWNSPOUT WITH 1/4-14 x 7/8" WALL STITCH ONE ON EACH TAB.

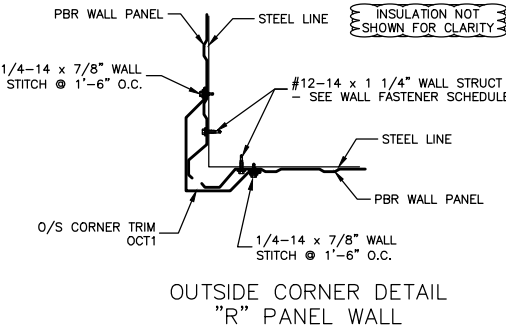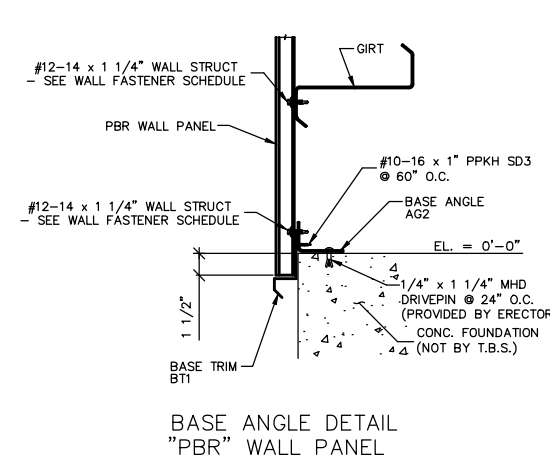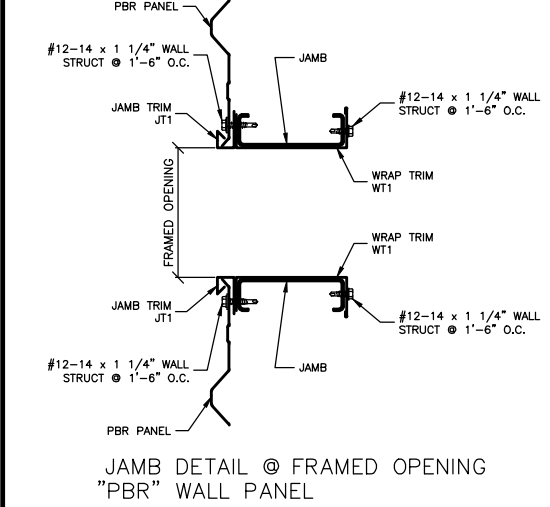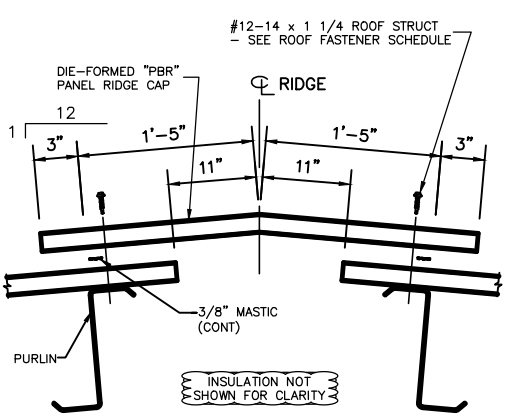

ERECTOR NOTE:
FIELD BEND UP BOTH ENDS OF SILL TRIM TO CREATE PAN.

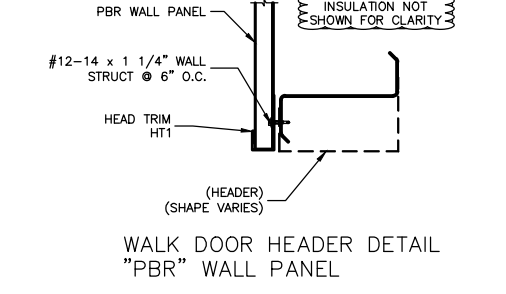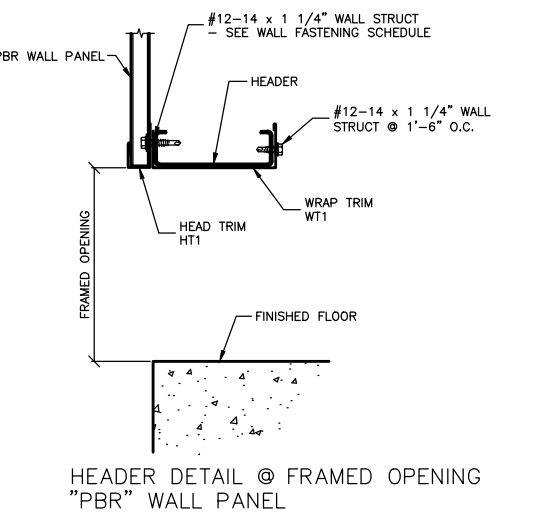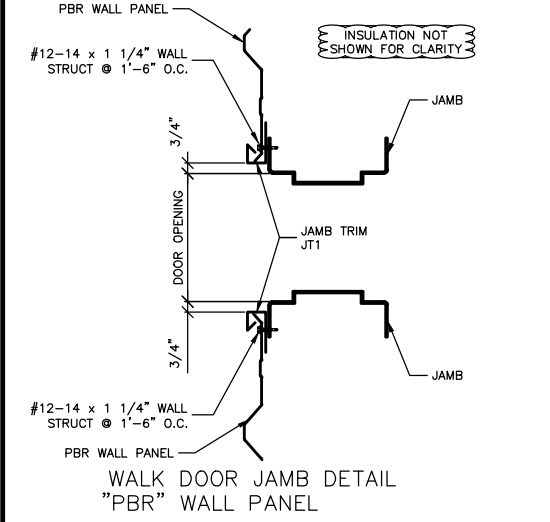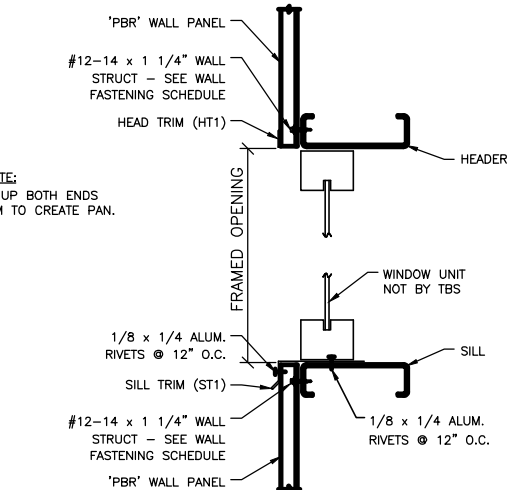

FASTENER SCHEDULE			
LOC. PART NUMBER	DESCRIPTION	LOC. PART NUMBER	DESCRIPTION
(1)	AS NOTED ON RIGID FRAME ELEVATION	(14)	3228087 SCREW 12 X 1 1/4 HWH SD #5 PT NW
(2)	3228100 SCREW 1/4 X 3/4 FL-TP SD WW	(15)	1328193 BOLT 1/2 X 1 1/2 HWH A325T GALV & NUT (1328191)
(3)	3228094 SCREW 12 X 1 HWH SD NW	(16)	3208170 BOLT 1 1/2 X 1 FLT RD HD A307 PLTD & NUT (2688007)
(4)	3228101 SCREW 12 X 1 1/4 FL-TP SD WW	(17)	3228102 SCREW 12 X 2 FL-TP SD WW
(5)	3228105 SCREW 1/4 X 1 1/4 LG-LF SD WW	(18)	996011 BOLT 3/8 X 7/8 PHPS HD (W/O WASHER) & NUT (2688008)
(6)	3228095 SCREW 8 X 1/2 HWH SD NW	(19)	3188003 BOLT 3/8 X 7/8 HEX HD (W/O WASHER) & NUT (2688008)
(8)	3188333 BOLT 1/2 X 2 HWH A325T GALV & NUT (1328191)	(20)	3228122 SCREW 1/4 X 1 1/2 HWH SD NW
(9)	1328199 BOLT 5/8 X 2 1/4 HWH A325T GALV & NUT (1328195)	(21)	SEE WALL PANEL ERECTION GUIDE FOR SCREW & SPACING
(10)	1328187 BOLT 3/4 X 1 1/2 HWH A325T GALV & NUT (1328192)	(22)	3228124 SCREW 1/4 X 1 1/4 HWH SHOULDER SD NW
(11)	1328190 BOLT 3/4 X 2 1/2 HWH A325T GALV & NUT (1328192)	(23)	3228126 SCREW 17 X 1 LG-LF ST WW
(12)	3228103 SCREW 1/4 X 3/4 FL-TP SD WW FOR ADP1 ROOF	(24)	3228138 SCREW 1/4 X 1 HWH SD NW
(13)	3228103 SCREW 1/4 X 3/4 LG-LF SD WW FOR SSR	(25)	3208084 SCREW 10 X 1 1/2 HWH WOODTITE WW
(14)	3228101 SCREW 12 X 1 1/4 FL-TP SD WW FOR ADP1 ROOF	(26)	3228132 SCREW 12 X 1 1/2 HWH SD #5 PT WW
(15)	3228103 SCREW 1/4 X 1 1/4 LG-LF SD WW FOR SSR	(27)	

ABBREVIATIONS
HD = HEAD
SD = SELF DRILLING
ST = SELF TAPPING
SS = STAINLESS STEEL
PT = POINT
RD = ROUND
WW = WITH WASHER
NW = NO WASHER
FLT = FLAT
HVHX = HEAVY HEX
UNPL = UNPLATED
PLTD = PLATED
HW = HEX WASHER HEAD
FL-TP = FLAT TOP
LG-LF = LONG LIFE
PHPS = PHILLIPS

- NOTES:**
- FOR SEQUENCE OF ERECTION - SEE APPLICABLE WALL PANEL ERECTION GUIDE.
 - FOR FLANGE BRACE LOCATIONS - SEE FRAME CROSS SECTION AND ROOF FRAMING PLANS.
 - SOME FIELD DRILLING AND/OR FIELD CUTTING OF STEEL COMPONENTS MAY BE REQUIRED DURING THE ERECTION OF THIS BUILDING.
 - THE LENGTH OF THE FLANGE BRACE SUPPLIED AT EACH LOCATION WILL DETERMINE WHICH STANDARD LAP HOLE LOCATION (9, 1'-8, 2'-5 OR 3'-9) IS TO BE USED.
 - ATTACH FLANGE BRACE TO HOLE IN GIRT WHICH BEST FITS THE FLANGE BRACE LENGTH SUPPLIED FOR THE LOCATION.

REVISIONS	DRAWN BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE	REVIEWED BY	DATE
(B) REMOVED DETAIL	AKG	06/26/24	YRS	06/26/24				
(A) UPDATED DETAIL	AKG	06/25/24	YRS	06/25/24				

UNLESS OTHERWISE NOTED, CONNECTIONS BY THIS MANUFACTURER USING A-325 HIGH STRENGTH BOLTS ARE DESIGNED TO BE FASTENED USING THE "SNUG TIGHTENED" METHOD, AS DEFINED AND DESCRIBED IN THE RESEARCH COUNCIL ON STRUCTURAL CONNECTIONS SPECIFICATION (RCSC, 6-23-2000) SECTION 4.1 "SNUG-TIGHTENED JOINTS" (REFERENCE SECTION 8.1).

SCALE : NONE	DRAWN BY D. WURDINGER	DATE 4-30-24
CHECKED BY DANA	DATE 4-30-24	
APPROVED BY SDC	DATE 5-1-24	
REVIEWED BY	DATE	

BOONE OFFICE 2024
LAKE CITY, FL 32024

ERECTION DETAILS

SCOTT D. CLOSE
LICENSE
No. 65849
STATE OF FLORIDA
PROFESSIONAL ENGINEER

BEHLEN MFG. CO.
COLUMBUS, NEBRASKA

JOB NO. X4405

SHT. 19 OF 19

GC: JOBS\X4405\DTDWDG