

EQUIPOTENTIAL BONDING GRID:

ALL METAL PARTS SPECIFIED IN 680.26(B) MUST BE BONDED TO AN EQUIPOTENTIAL BONDING GRID WITH A SOLID COPPER CONDUCTOR NOT SMALL THAN 8 AWG. THE TERMINATION OF THE BONDING CONDUCTOR MUST BE MADE BY EXOTHERMIC WELDING, LISTED PRESSURE CONNECTORS, OR LISTED CLAMPS THAT ARE LABELED AS SUITABLE FOR THE PURPOSE. THE QUIPOTENTIAL BONDING GRID MUST EXTEND UNDER PAVED WALKING SURFACES FOR 3 FEET HORIZONTALLY FROM THE WATER (680.26(C)).

THE EQUIPOTENTIAL BONDING GRID MUST BE FORMED FROM EITHER OR BOTH OF:

THE STRUCTURAL REINFORCING STEEL OF A CONCERTE PERMANENTLY INSTALLED POOL, OUTDOOR SPA, OR OUTDOOR HOT TUB, TIED TOGETHER BY THE USUAL STEEL TIE WIRES.

THE METAL WALLS OF A PERMANENTLY INSTALLED POOL, OUTDOOR SPA, OR OUTDOOR HOT TUB

THE EQUIPOTENTIAL BONDING GRID CAN BE CONSTRUCTED WITH 8 AWG BARE SOLID COPPER CONDUCTORS BONDED TO EA OTHER AT ALL POINTS OF CROSSING BY EXOTHERMIC WELDING, LISTED PRESSURE CONNECTORS OF THE SET SCREW OR COMPRESSION TYPE, LISTED CLAMPS, OR OTHER LISTED FITTINGS (250.8).

THE EQUIPOTENTIAL BONDING GRID MUST COVER THE CONTOUR OF THE PERMANENTLY INSTALLED POOL, OUTDOOR SPA OR HOT TUB AND DECK EXTENDING 3 FEET HORIZONTALLY FROM THE WATER. THE EQUIPOTENTIAL BONDING GRID MUST BE ARRANGED IN A 1-FOOT BY 1-FOOT NETWORK OF 8 AWG CONDUCTORS, WITH A TOLERANCE OF 4 INCHES.


EXCEPTION: THE EQUIPOTENTIAL BONDING GRID SHALL NOT BE REQ'D TO BE INSTALLED UNDER THE BOTTOM OR VERTICALLY ALONG THE WALLS OF VINYL LINED POLYMER WALL, FIBERGLASS COMPOSITE, OR OTHER POOLS CONSTRUCTED OF NON-CONDUCTIVE MATERIALS.

ANY METAL PARTS OF THE POOL, INCLUDING METAL STRUCTURAL SUPPORTS, SHALL BE BONDED IN ACCORDANCE WITH 680.26(B). POURED CONCRETE, PNEUMATICALLY-APPLIED CONCRETE, AND CONCRETE BLOCK SHALL BE CONSIDERED CONDUCTIVE MATERIAL

GENERAL NOTES:

- 1) Per UL listing, pool motors require GFCI protection
- 2) FSPA requires the motor controller to be capable of 2 speeds, a time clock will not satisfy this unless it has 2 trip settings.
- 3) If heater installed (other than solar), it must comply with FBC-EC403.9.1 & have a cover per 403.9.3 (this applies to mechanical (not solar) heaters---cover required)
- 4) Outdoor swimming pools shall be provided with a barrier complying with Sections R4501.17.1.1 through R4501.17.1.14.
- 5) NEC 680.26(C) requires a conductive metal part of 9 sq., in. in direct contact with the pool water.
- 6) R4501.17.1.9 All doors and windows providing direct access from the home to the pool shall be equipped with an exit alarm complying with UL 2017 that has a minimum sound pressure rating of 85 dB at 10 feet.

STEPS: MIN. TREAD 10" x 12", 7" MIN RISER, 12" MAX RISER. INTERMEDIATE TREADS AND RISERS TO BE UNIFORM.

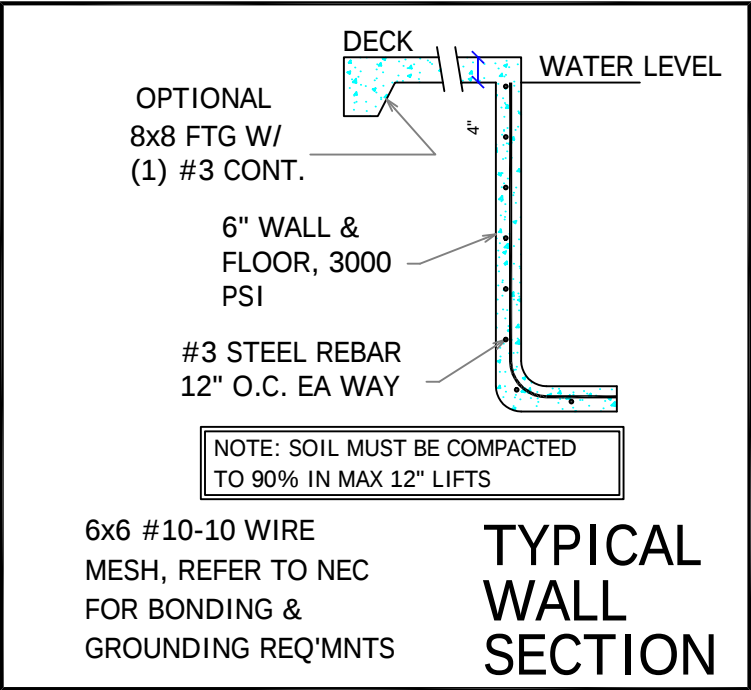


NOTE: IF ANY PART OF THE POOL ENCROACHES UPON THE ANGLE OF REPOSE, PLACE STEEL @ 6" o.c. EA WAY IN AREAS OF QUESTION

- ENGINEERING NOTES:
- 1. ALL WORK IS TO COMPLY WITH ALL APPLICABLE CODES & ORDINANCES.
 - 2. CONSTRUCTED OF 3000 PSI CONCRETE OR EQUAL WITH #3 REBAR 12" O.C. EACH WAY, TIED AT EVERY OTHER INTERSECTION. MIN COVER FOR REBAR IS 2.5" MIN OVERLAP IS 18".
 - 3.N/A
 - 4. ASSUMED SOIL BEARING = 2 KSF
 - 5. CIRCULATION SYSTEMS, COMPONENTS, & EQUIPMENT SHALL COMPLY W/ NSF 50.
 - 6. INSTALL CONTROL JOINTS @ 20'-0" ON CENTER IN POOL DECKING.
 - 7. PLANS TO CONFORM TO NEC 2020
 - 8. 2023 FBC RESIDENTIAL 8th EDITION APSP13
 - 9. CONCRETE STAIRS ARE 12" TREAD WIDTH AND 10" MAXIMUM HEIGHT
 - 10. ALL CONSTRUCTION SHALL COMPLY WITH ANSI 5-03, 2020 NEC ARTICLE 680, & ANSI-NSPI 3-99 IN-GROUND SPA CONSTR.



*11. ENGINEERS DESIGN IS FOR STRUCTURAL ONLY. DESIGN OF PIPING/EQUIPMENT ETC.

- BY POOL CONTRACTOR
- FENCE REQUIREMENTS:
- 1. MINIMUM 48" HEIGHT
 - 2. 2" MAX VERTICAL CLEARANCE BETWEEN GRADE & BARRIER BOTTOM.
 - 3. MAX OPENING SHALL NOT ALLOW PASSAGE OF 4" SPHERE.
 - 4. FENCE POSTS WILL BE LOCATED ON POOL-SIDE OF FENCE.
 - 5. GATE WILL BE SELF-LOCKING WITH APPROVED LOCKING DEVICE.

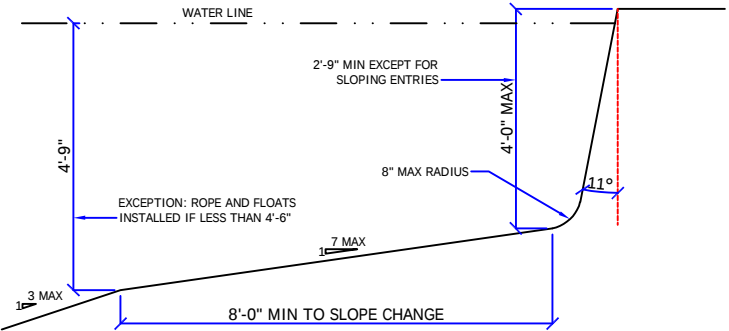

FLOOR SLOPE DETAIL NTS

MODEL
** CUSTOM MOLDED PRODUCTS : CMP# 25506-32X-000 32" CHANNEL DRAIN COVER
W/ CMP# 25506-320-010 SUMP -3 PORTS**
ONE PORT CENTER: 200 GPM- ON FLOOR & 168 GPM-ON WALL W/ 2 1/2" PLUMBING
OUTER 2 PORTS: 308 GPM- ON FLOOR & 212 GPM-ON WALL W/ 2 1/2" PLUMBING
OPEN AREA OF SUCTION COVER: 38.79 SQ. IN.

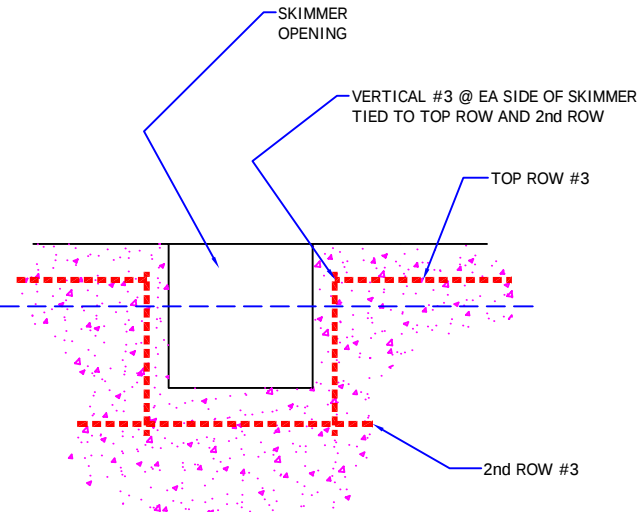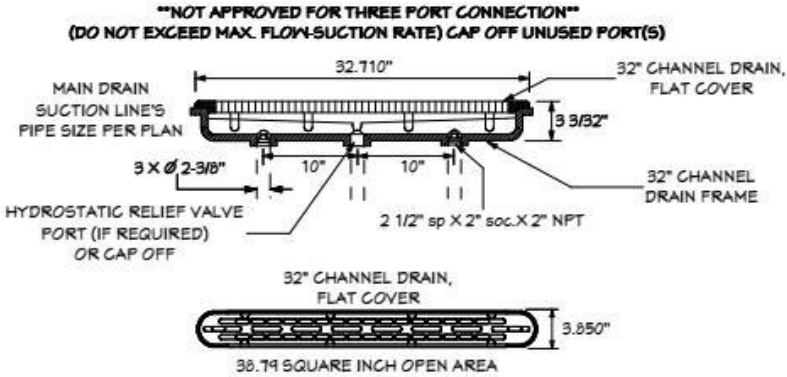

SKIMMER OPENING DETAIL


Riddle Consulting Engineers, Inc.

structural
civil
mechanical
Paul D. Riddle, P.E.
Senior Engineer
COA: 00004759

ADDRESS 1720 SE CTY HWY 484
BELLEVUE, FL 34420
PHONE (352) 245-7041
FAX (352) 245-5458
WEB: WWW.RIDDLEENGINEERING.COM

ENGINEER'S SEAL

PAUL D. RIDDLE, P.E.
P.E. 36989




THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY PAUL D. RIDDLE, PE ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

JOB No.: 2240370

DATE Jul. 31, 24

A CUSTOM DESIGN FOR
THE PAYNE RESIDENCE
AQUATIC ART

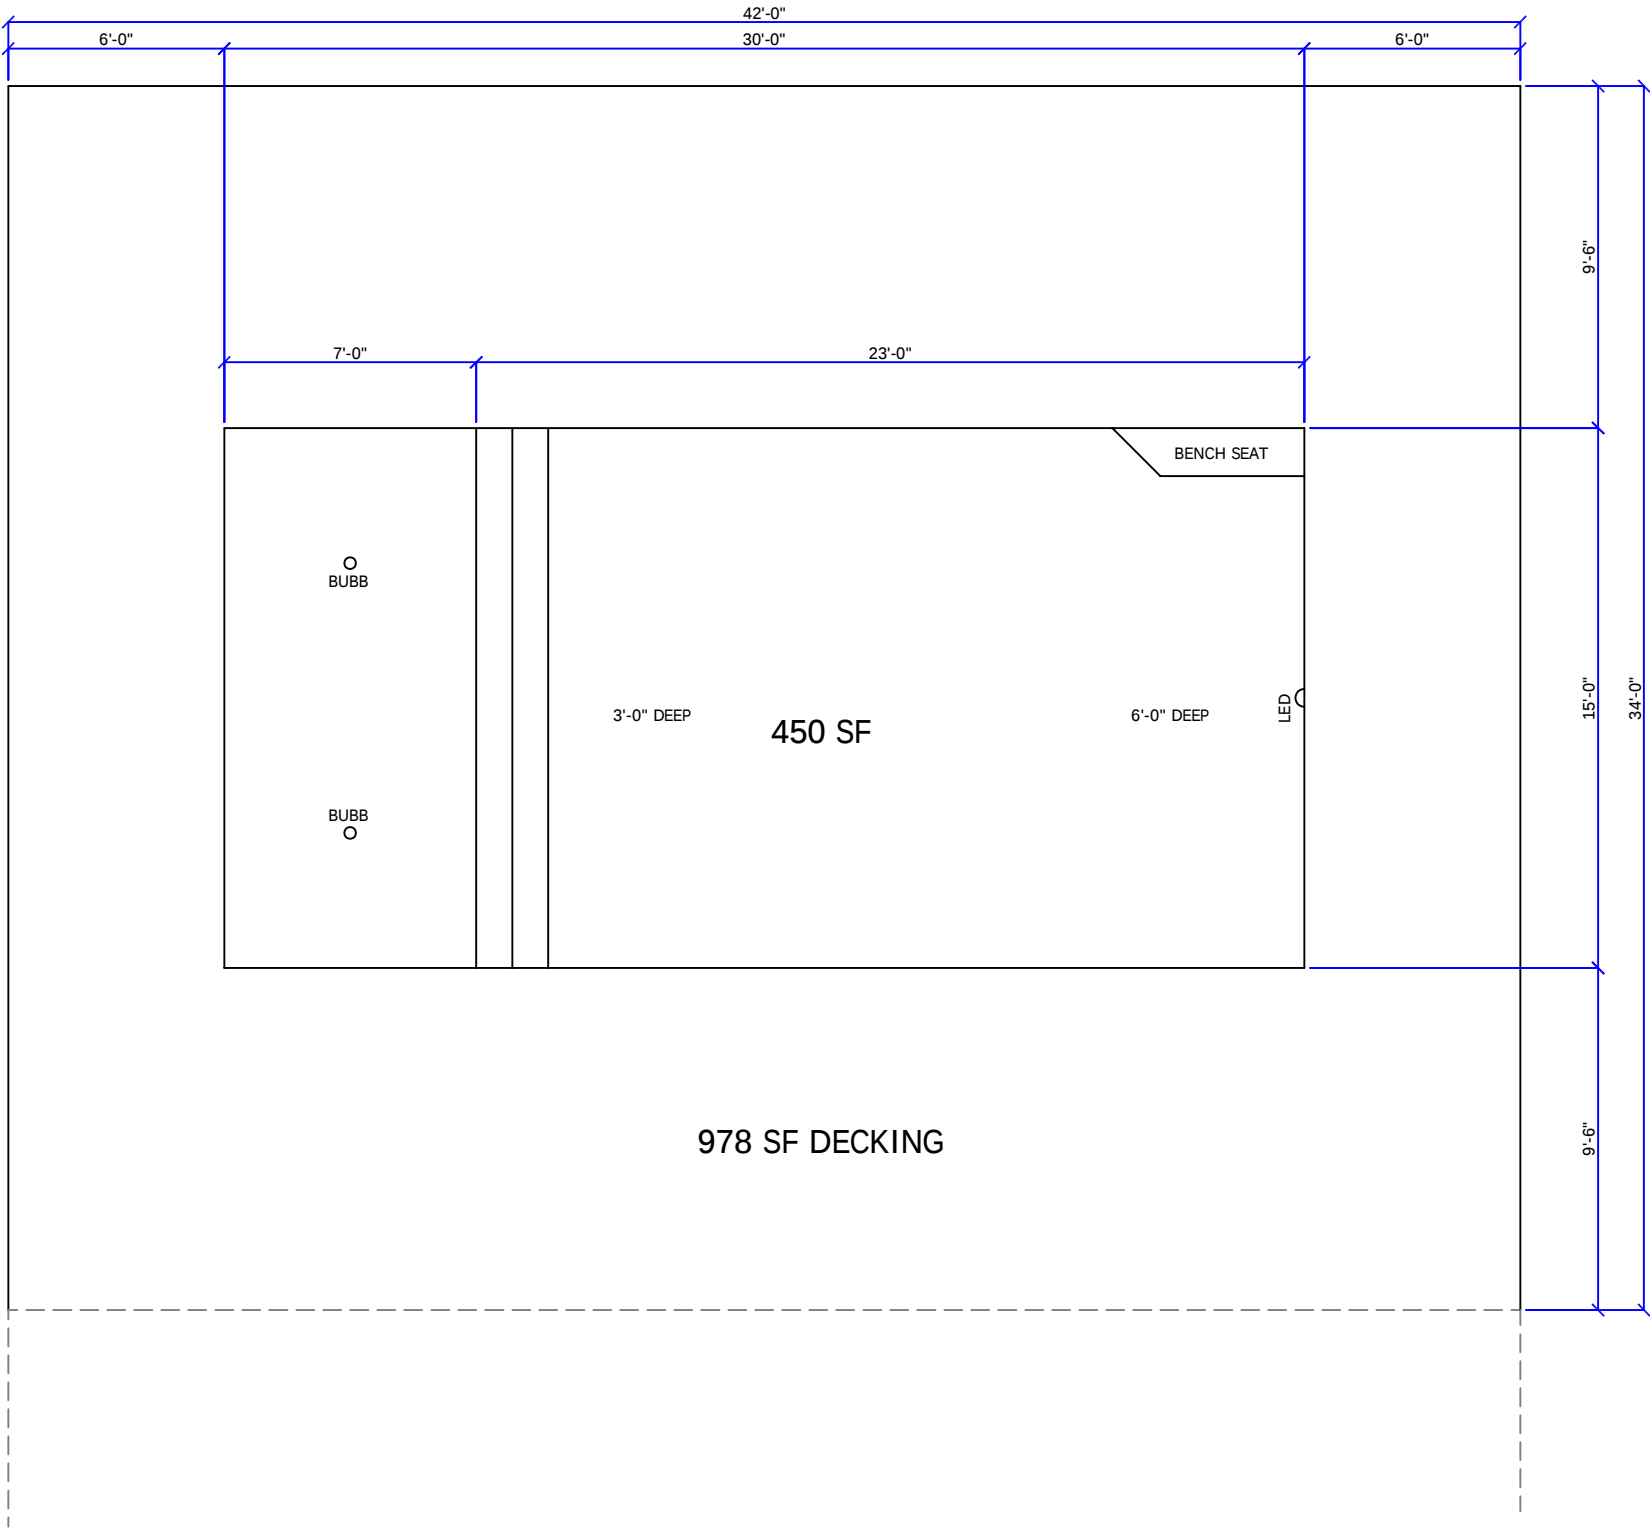

Riddle Consulting
Engineers, Inc.

structural
civil
mechanical

Paul D. Riddle, P.E.
Senior Engineer
COA: 00004759

ADDRESS1720 SE CTY HWY 484
BELLEVUE, FL 34420

PHONE(352) 245-7041

FAX(352) 245-5458

WEB:WWW.RIDDLEENGINEERING.COM

ENGINEER'S SEAL

PAUL D. RIDDLE, P.E.
P.E. 36989


PAUL D RIDDLE
LICENSE
No. 36989
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

THIS ITEM HAS BEEN DIGITALLY
SIGNED AND SEALED BY PAUL D.
RIDDLE, PE ON THE DATE ADJACENT TO
THE SEAL. PRINTED COPIES OF THIS
DOCUMENT ARE NOT CONSIDERED
SIGNED AND SEALED AND THE
SIGNATURE MUST BE VERIFIED ON ANY
ELECTRONIC COPIES.

JOB No.:	2240370
DATE	Jul. 31, 24

A CUSTOM DESIGN FOR
THE PAYNE RESIDENCE
AQUATIC ART

Page:
2 of 4
3/16" = 1'-0" SCALE

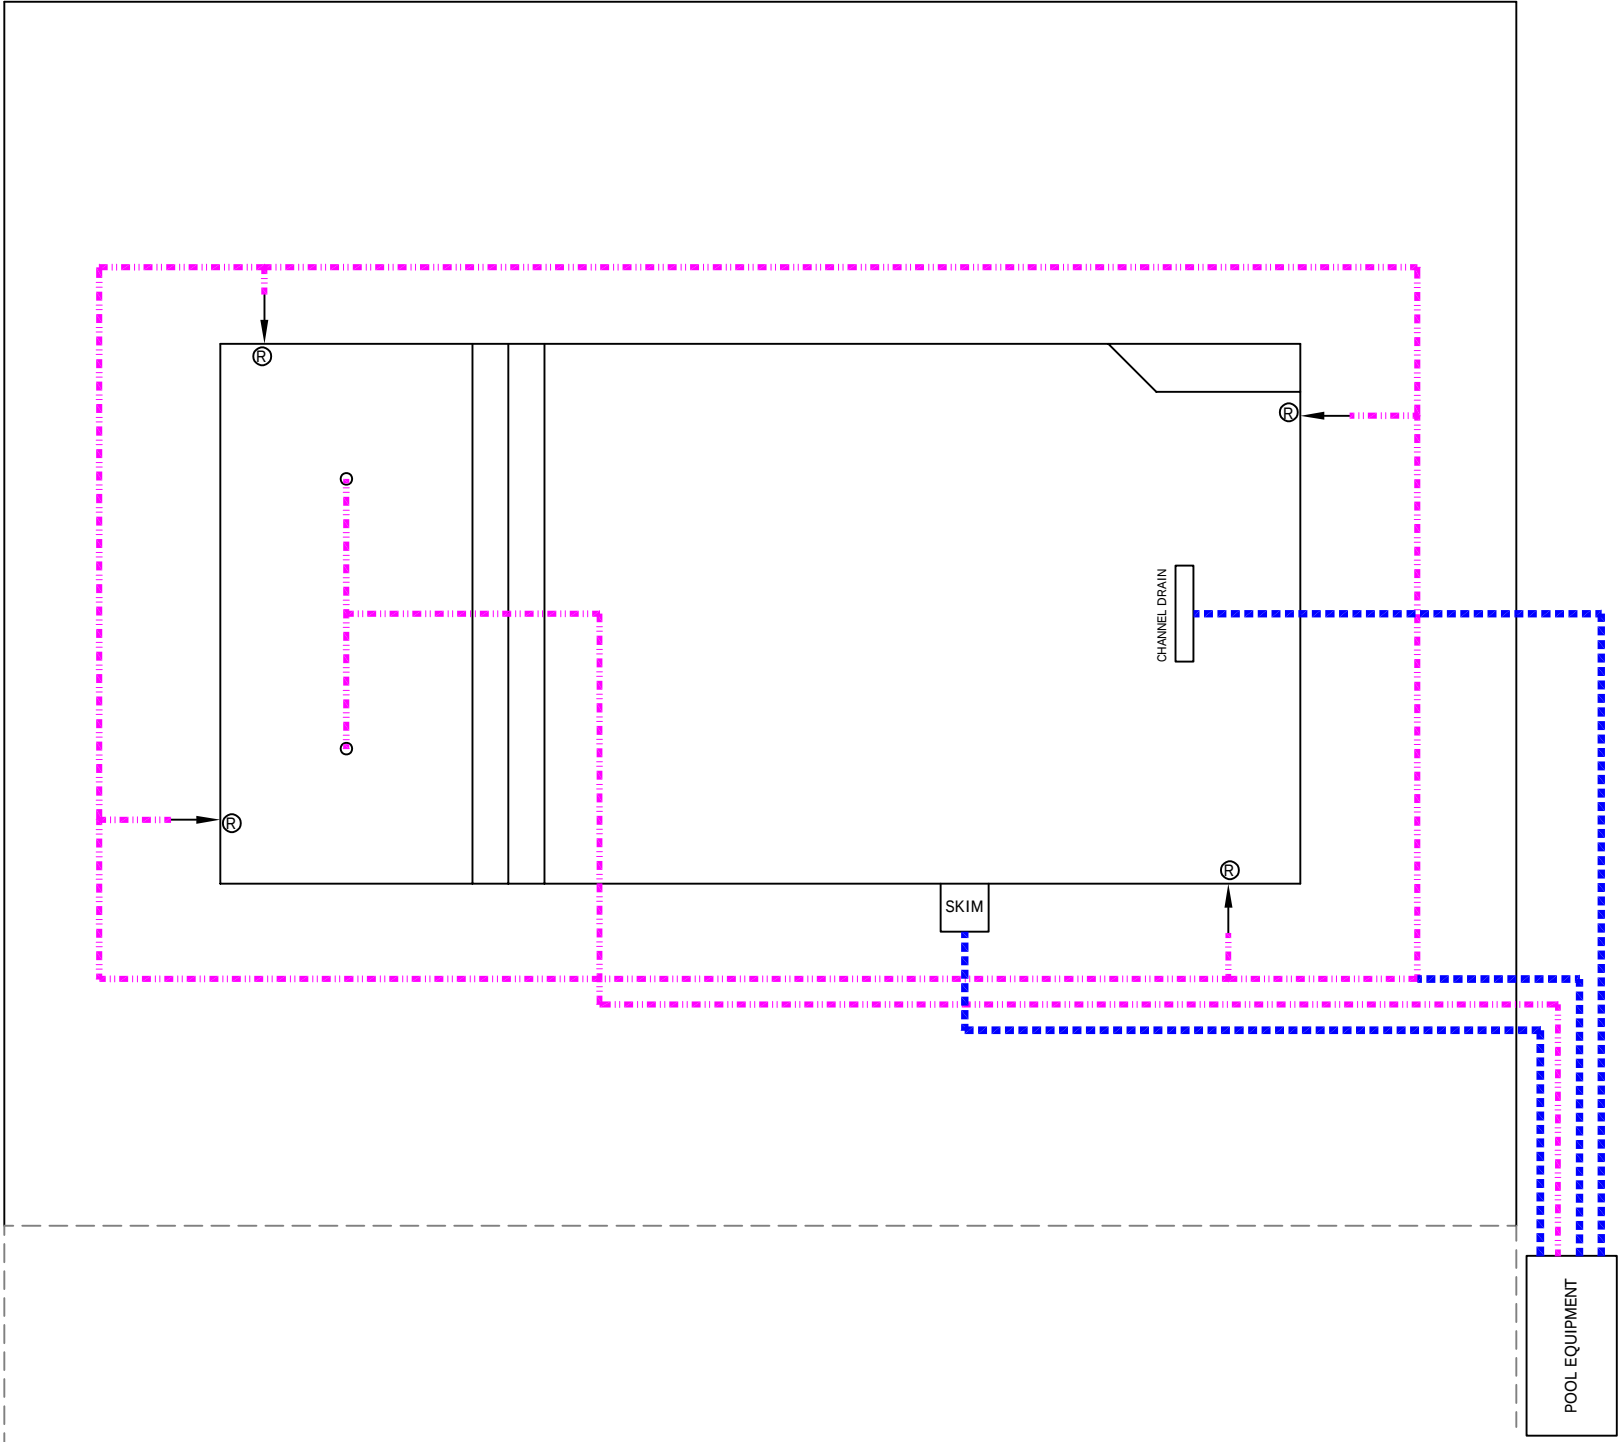

PIPING KEY

2" Ø LINE

2.5" Ø LINE

3" Ø LINE

Riddle Consulting Engineers, Inc.




Paul D. Riddle, P.E.
Senior Engineer
COA: 00004759

ADDRESS 1720 SE CTY HWY 484
BELLEVUE, FL 34420
PHONE (352) 245-7041
FAX (352) 245-5458
WEB: WWW.RIDDLEENGINEERING.COM

ENGINEER'S SEAL

PAUL D. RIDDLE, P.E.
P.E. 36989



THIS ITEM HAS BEEN DIGITALLY
SIGNED AND SEALED BY PAUL D.
RIDDLE, PE ON THE DATE ADJACENT TO
THE SEAL. PRINTED COPIES OF THIS
DOCUMENT ARE NOT CONSIDERED
SIGNED AND SEALED AND THE
SIGNATURE MUST BE VERIFIED ON ANY
ELECTRONIC COPIES.

JOB No.: 2240370

DATE Jul. 31, 24

A CUSTOM DESIGN FOR
THE PAYNE RESIDENCE
AQUATIC ART

Page:


3 of 4

3/16" = 1'-0" SCALE

SPECIFICATIONS

Model No.	THP	WEF ³	Voltage	Max Watts	Amps	Union Size	Rec. Pipe Size ⁴	Carton Weight	Overall Length
VSFHP165JEP VSFHP165AUT	1.65	9.118	230VAC	1,600 W	10.5	2" x 2"	1 1/2 - 2 1/2"	46 lbs	24"
VSFHP085JEP VSFHP085AUT	0.85	11.900	115VAC	975 W	10.0	2" x 2"	1 1/2 - 2"	46 lbs	24"

PERFORMANCE

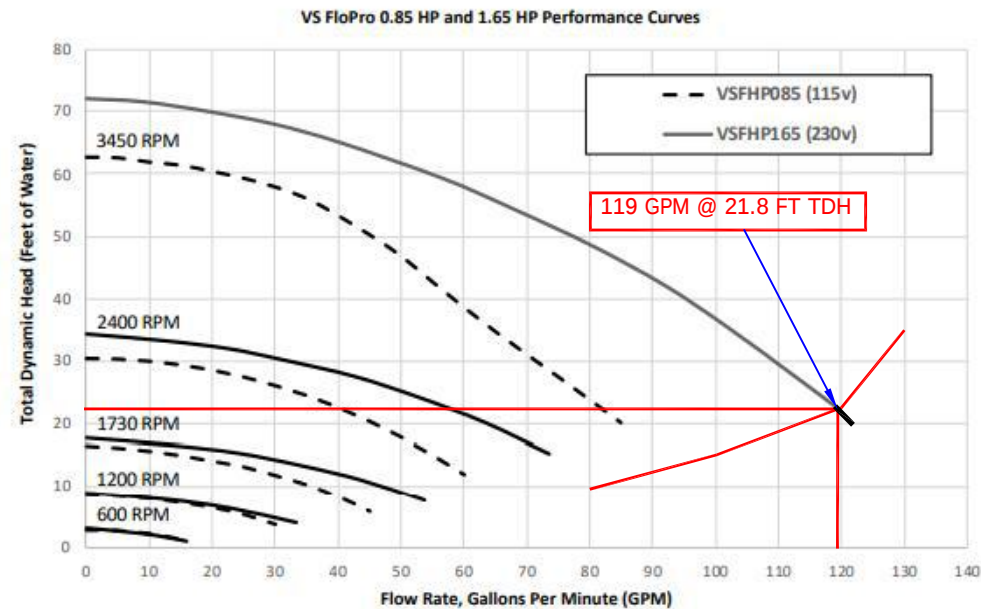

PUMP VS. SYSTEM CURVE

AQUATIC ART

7/31/2024

PAYNE

MINIMUM FLOW REQ'D = 42.08 GPM
POOL VOLUME : SURFACE AREA X AVG DEPTH X 7.48 GAL / CF
VOL = 450 SF X 4.5 FT DEEP = 15147 Gallons
TURNOVER TIME: No. Hours X 60 min / ho e
6 hours x 60 = 360 minutes
MAX POOL FLOW RATE: GALLONS / TURNOVER = FLOW RATE
15147 GAL / 360 minutes = 42.075 GPM

POOL FEATURES
JETS, SHEER DE 0 WATER FEATURE GPM EA = 0 GPM
TOTAL SUGGESTED POOL FLOW RATE: 42.08 GPM
V = 1.318 C R^{0.63} S^{1.48}

SUPPLY (RETURN) PIPING
2.5 in = NOMINAL DIAMETER
2.45 in = D ACTUAL diam
0.2038 ft = D diam
140 = C, coefficient of roughness
4.6951 in² = A pipe
0.0326 ft² = A pipe
119.00 gpm / line 0.2651615 cfs
119.00 gpm = TOTAL FLOW IN 1 LINES
0.2652 cfs = Q flow M
8.1322 f/sec = V = Velocity
0.0509 ft = R = Hydraulic Radius = A / P

SUCTION PIPING
2.5 in = NOMINAL DIAMETER
2.45 in = D ACTUAL diam
0.2038 ft = D diam
140 = C, coefficient of roughness
4.6951 in² = A pipe
0.0326 ft² = A pipe
59.50 gpm = 0.1325758 cfs
2 No. of Suction Pipes
0.1326 cfs = Q flow rate
4.0661 f/sec = V = Velocity
0.0509 ft = R = Hydraulic Radius = A / P

0.0995 ft/ft = S hydraulic gradient
12 ft = pipe length average
1.19 ft = hf = head loss due to friction
0.52 psi 0.0051668

0.0276 ft/ft = S hydraulic gradient
26 ft = pipe length average
0.72 ft = hf = head loss due to friction
0.31 psi 0.0031013

BRANCH P model
2 in @ 6 fps max BRANCH = 61.54 GPM
2 in @ 8 fps max TRUNK = 82.06 GPM
2 in @ 10 fps max RETURN = 102.57 GPM
3 in @ 3 fps max RETURN = 67.95 GPM MAIN
DRAIN 130.00
140.00

FLOW STR FT PSI
GPM
80.00 9.8 4.24
100.00 15.0 6.49
120.00 22.8 9.87
130.00 28.6 12.38
140.00 34.8 15.06

OTHER PRESSURE LOSSES per mntg
6.98 FT = FILTER TDH LOSS
0.00 FT = HEATER TDH LOSS
6.98 FT = TOTAL TDH LOSS

JANDY PRO SERIES CS150-250 CARTRIDGE FILTER
NA

MINOR LOSSES (SUPPLY & SUCTION COMBINED)
h (lost) = KL * V² / (2*g)
2 ea = # tees thru side outlet 1.75 3.59
2 ea = # gate valves 1 2.05
1 ea = # check valves 0.2 0.21
0 THERAPY JET 21.73 0.00
0 ea = # 45 deg ELL 0.4 0.00
6 ea = # 90 deg ELL 0.75 4.62
0 ea = Reducer D2= 0.5 0.0871791 0.00 D1/D2= 4.89

TOTAL = 10.47 ft

ELEVATION DIFFERENCE
0.00 ft = delta Z

model
2.41 FT = TOTAL FRICTION HEAD LOSS AFTER SPLIT @ LOOP
21.77 FT = TOTAL HEAD LOSS IN SYSTEM @ 119.00 GPM
9.42 PSI

PUMP SELECTION : JANDY VSFHP165JEP
model: VARIABLE SPEED

SUCTION OUTLET COVER: MUST EXCEED 119.00 GPM FLOW RATE
model: 32" CHANNEL DRAIN OR 2 OUTLET COVERS

SYSTEM FLOW RATE MUST NOT EXCEED APPROVED COVER FLOW RATE O.K.
PER FBC 2023 8TH EDITION ANSI / APSP 13
MOTOR TO BE GFCI PROTECTED PER NEC 680.21©

PAUL D. RIDDLE
P.E. No. 36989, FL
RIDDLE CONSULTING ENGINEERS
1720 SE COUNTY HWY 484
BELLEVIEW, FLORIDA 34420
CERT OF AUTH: 4759

Riddle Consulting
Engineers, Inc.




Paul D. Riddle, P.E.

Senior Engineer
COA: 00004759

ADDRESS 1720 SE CTY HWY 484
BELLEVIEW, FL 34420
PHONE (352) 245-7041
FAX (352) 245-5458
WEB: WWW.RIDDLEENGINEERING.COM

ENGINEER'S SEAL

PAUL D. RIDDLE, P.E.
P.E. 36989

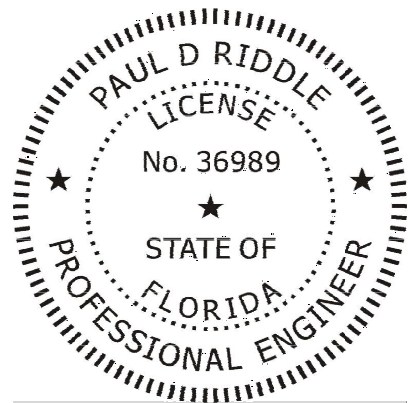

THIS ITEM HAS BEEN DIGITALLY
SIGNED AND SEALED BY PAUL D.
RIDDLE, PE ON THE DATE ADJACENT TO
THE SEAL. PRINTED COPIES OF THIS
DOCUMENT ARE NOT CONSIDERED
SIGNED AND SEALED AND THE
SIGNATURE MUST BE VERIFIED ON ANY
ELECTRONIC COPIES.

A CUSTOM DESIGN FOR
THE PAYNE
RESIDENCE
AQUATIC ART

Page:
4 of 4