


NOTE:

all 120 volt, single phase, 15 and 20 ampere branch circuits supplying outlets installed in dwelling unit family rooms, kitchens, dining rooms, living rooms, parlors, libraries, dens, bedrooms, sunrooms, recreation rooms, closets, hallways, laundry areas, or similar rooms or areas shall be protected by a listed arc-fault circuit interrupter, combination type, installed to provide protection of the branch circuits.

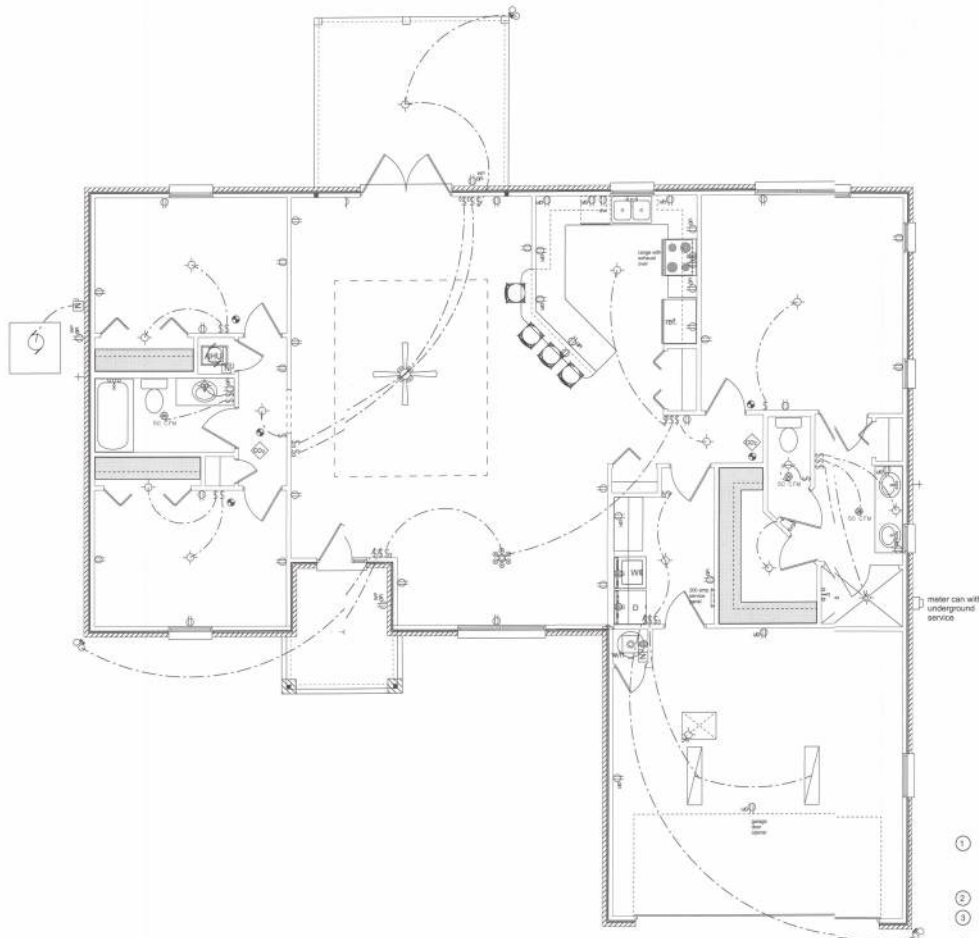

ELECTRICAL PLAN

SCALE 1/4"=1'-0"

ELECTRICAL LEGEND	
ELECTRICAL	SYMBOL
ceiling fan spotlights 1	
spotlight double	
chandelier	
fluorescent fixture	
electrical panel	
motor	
non fused disconnect	
ELEC METER	
WP GFI	
carbon monoxide detector	
fan 50 CFM	
light	
outlet	
outlet 220v	
outlet gfi	
pull chain light	
smoke detector	
switch	
switch 3 way	

- Service/feeder Entrance Conductors: 2 1/2" rigid conduit, min 18" deep, w/ continuous ground bonding conductor. Service/feeder Entrance Conductors shall not be spliced except that bonded connections at the Meter, Disconnecting Devices and Panel shall be allowed.
- Existing Meter Enclosure, weatherproof, U.L. Listed.
- Main Disconnect Switch: fused or Main Breaker, weatherproof, U.L. Listed.
- Service entrance ground: 5/8" diameter stainless steel rod x 8'-0", long and/or concrete encased foundation steel rebar x 20'-0" long. Grounding conductor shall be bonded to each piece of Service/Entrance Equipment, and shall be sized per Item #5 below.
- 200 Ampere Feeder: 3-20 THHN-Cu, 1-42-Cu-GND, 2 1/2" Conduit.
- House Panel (PML), U.L. Listed, sized per schedule.
- Equipment Disconnect Switch: non-fused, in weather proof enclosure, size according to Panel Schedule loads.
- Provide Ground Bond Wire to metal piping, size in accordance with the Service Ground Conductor.

ELECTRICAL PLAN NOTES

WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.

CONSULT THE OWNER FOR THE NUMBER OF SEPARATE TELEPHONE LINES TO BE INSTALLED.

INSTALLATION SHALL BE PER NAT'L. ELECTRIC CODE.

ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.

TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.

ELECTRICAL CONTR SHALL PREPARE "AS-BUILT" SHOP DWGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADDS TO THE ELEC. PLAN, RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS IDENTIFIED W/ CKT NO., DESCRIPTION & BRKR. SERVICE ENT. & ALL UNDERGROUND WIRE LOCATIONS/ROUTING/DEPTH. RISER DIA. SHALL INCLUDE WIRE SIZES/TYPE & EQUIPMENT TYPE W/ RATINGS & LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

WIRING NOTES:

WIRING, DISTRIBUTION EQUIPMENT AND DEVICES

A. CONDUCTORS: Copper, in accordance with ASTM Standards, size reference AWG. Conductors No. 10 and smaller size solid, No. 8 and Larger, Stranded. Insulation of conductor thermoplastic, type THHN (Min. size No. 12) any wire installed outside, underground, in ditches or exposed to moisture shall have THWN insulation.

B. RACEWAYS: RIGID STEEL CONDUIT, full weight pipe galvanized, threaded, and minimum 1/2 inch except as noted or required for wiring. ELECTRICAL METALLIC TUBING (EMT), thin wall pipe, galvanized, threaded, compression fittings, and minimum 1/2" size except as noted or required for wiring. FLEXIBLE STEEL CONDUIT, continuous slitting, galvanized, and minimum 1/2" size except as noted or required for wiring. PVC CONDUIT, heavy duty type, size as indicated. Spare raceways shall be used for each voltage system.

C. DISCONNECT SWITCHES: General Duty, horsepower rated for motor loads 250 volt rating, fused or non-fused as noted, number of poles as indicated. Enclosure NEMA 1 for indoor use and NEMA 3R for weatherproof applications. Switch to be Square "D" or equal.

D. CIRCUIT BREAKERS: molded case, thermal-magnetic, quick make, quick break, bolt-on type with manually operated insulated trip-free handle. Multi-pole types with internal common trip bar terminals suitable for copper or aluminum conductors. Interrupting capacity minimum 10,000 RMS symmetrical amperes circuit circuit breakers to be Square "D", Siemens or equal, type as required.

E. PANELBOARDS: Voltage, phase, and ampere ratings as indicated; circuit breaker type as indicated, bus bars of hard drawn copper, minimum 98% conductivity, galvanized steel back box, door and trim. All corners tapered and welded, hardware chrome plated with flush lock and catch. Hinges semi-convex, 3 brackets steel with nonmagnetic pins, 180 degree opening. Minimum gutter space 5-3/4" sides, top and bottom. Increase size where required by code. Directory holder compatible with cover electric transparent cover indicating bywritten list of feeder cables, conduit wires, circuit number, outlets of equipment supplied, and their location. Circuit breaker type perimeters to be Square "D" type MCCB or I-Line, or equal. A plastic label shall be located on exterior of panelboard identifying the system voltage, phase, and current rating.

F. WIRING DEVICES: All devices their product of the same manufacturer. Wall switches and receptacles to be 20 amp, 125 volt, unless noted otherwise. Color to be selected by Architect. G. DEVICE PLATES: provide for all outlets where devices are installed. Provide engraved marking for special outlets (where noted). Provide blank plates for empty or future outlet boxes. DEVICE AND DEVICE PLATE COLORS TO BE VERIFIED WITH ARCHITECT AND OWNER.

GROUNDING SYSTEM:

A. EQUIPMENT: Ground non-current carrying metal parts of panel board, raceways and all lighting fixtures. All conduit shall have equipment grounding conductors.

INSTALLATION:

A. Secure all supports to building structure as specified under raceways. Support horizontal runs of metallic conduit not more than 10 feet apart. Run exposed raceways parallel with or at right angles to walls.

B. Fast raceways over water, steam or other piping when pull boxes are not required. no raceway within 3 inches of steam or hot water pipes, or appliances. except crossing where the raceway shall be at least 2 inches from pipe cover.

C. Cut conduit ends square. ream smooth. Paint inside threads of field threaded conduit with Graphite based pipe compound. Draw up tight with conduit couplings.

D. Leave wire sufficiently long to permit making final connections. In raceway over 50 feet in which wiring is not installed, furnish pull wire.

E. Verify locations of outlets and switches.


F. Support panels, junction and pull boxes independently to building structure with no weight bearing on conduits.

G. Connect conduit to motor conduit terminal bases with flexible conduit, minimum 18 inches in length and 50% slack. Do not terminate in or faster raceways to motor function.

H. This contractor shall provide a temporary electrical distribution system as required. 120/208 volt, 1 phase, 100 amp, for new construction. All temporary work shall be installed in a neat and safe manner.

I. Contractor to remove and salvage all abandoned electrical equipment.

J. This contractor shall warrant all labor and materials for one year from date of final written acceptance.

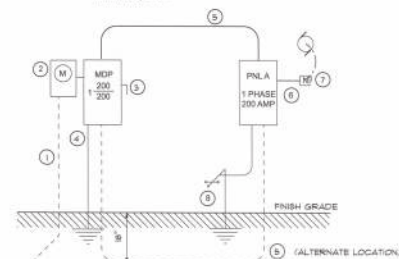


LOT 33 CROSSWINDS, PHASE 1
ELECTRICAL PLAN

P.O. BOX 860/25
ST. AUGUSTINE, FL 32086
(904) 286-1006
C.O.A. #000001

COASTAL ENGINEERING
REGISTERED PROFESSIONAL ENGINEER
FLORIDA #000001

DRAWN BY: W.H.F.
DATE: 2/19/02
APPROVED: W.H.F.
REVISIONS:
SHEET: A-9
OF: 9
PROJECT NO.: 22-1007

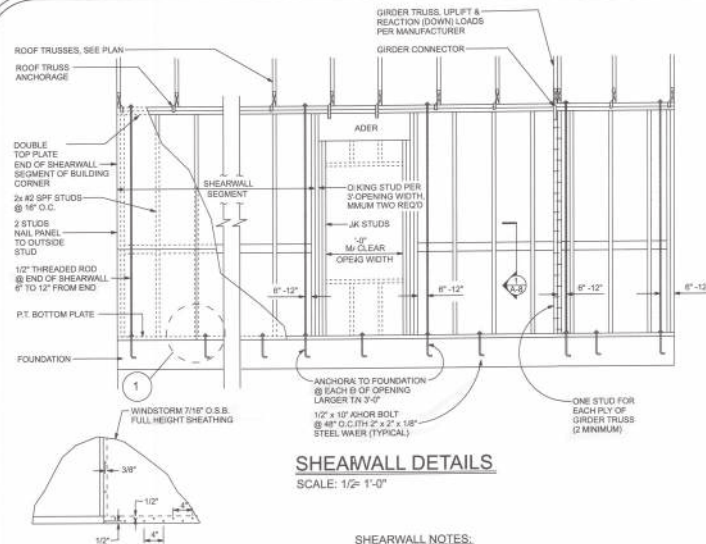

SHEARWALL DETAILS
SCALE: 1/2" = 1'-0"

DOUBLE NAIL EDGE SPACING TOP AND BOTTOM PLATE

1

UPLIFT CAPACITY = 474 plf (TABLE 3005.1 SST10-99)

RULES:

1. One all-thread rod at each corner.
2. One all-thread rod at each end of shearwall.
3. One all-thread rod at each end of opening (headers greater than 3'-0").
4. Check sub-sheathing to top plate connection for horizontal transfer capability.
5. If necessary, add all-thread rods to girders individually to exclude them from average uplift plf.
6. Check sole plate to slab connection, additional anchors may be required for lateral and shear load transfer.

Connection Type	Allowable Value
Foundation / S.Y.P. Top Plate	3840 lbs.
Foundation / Spruce-Pine-Fir Top Plate	3840 lbs.
Umbel or Bond Beam / S.Y.P. Top Plate	3840 lbs.
Umbel or Bond Beam / Spruce-Pine-Fir Top Plate	3840 lbs.

Placement at slab level:

Corners
When presetting the all-thread rod at a building corner, the rod should be placed 8 to 12 inches away from the corner so it does not rest under the corner framing members. When an all-thread rod is specified at a building corner, it may be placed on either side of the corner.

Header ends
When presetting the all-thread rod at a header end, the rod should be placed 8 to 12 inches away from the header end so it does not fall under the stud back framing members.

Top Connections
Top connections made at corners and header ends shall be made within 2 inches of the framing pack. A nut and 3X3 washer shall be applied to the top plates and tightened securely.

Intermediate Coupler Connections
When using the rod coupler, care should be taken to ensure full and equal thread engagement. This is easily achieved by threading the coupler all the way onto the rod, then standing the two rods end to end, then threading the coupler back over the rod joint so each rod is halfway into the coupler.

Retro-fits
In the case of an all thread rod misplacement, the rod may be epoxied into the concrete.

Sole plate to slab connection:


The slab level sole plate shall be connected to the slab with the connectors specified and at the spacing specified within the design documents. All-thread rods shall be placed as per the design specifications. All-thread rods with a nut and washer at the sole plate will qualify as a sole plate connection but may require other anchors intermediate of the all-thread rod locations to qualify the specified spacing requirements.

System Tightening
On multiple story applications, the all-thread rod system shall be rechecked for proper tension just before the walls are veneered. This will allow the all-thread rod system to compensate for the buildings dead load compression.

SHEARWALL NOTES:

1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-99 303.4.3.
2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS.
3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
4. NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD.
5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING (IT CONTAINS). MAXIMUM HEIGHT OF OPENING SHALL BE 50 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT (3). 6. FOR 8'-0" WALLS - (2'-3").

OPENING WIDTH	BILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3




GIRDER COLUMN DETAIL
SCALE: 1/2" = 1'-0"

OPENING CONNECTION REQUIREMENTS

CLEAR OPENING WIDTH	HEADER SIZE #2 GRADE OR BETTER	END BEARING	CONNECTOR AT EACH END OF OPENING	ANCHORAGE TO FOUNDATION @ EACH END OF OPENING
6' - 3"	(2) 2x6	1.5"	N/A	N/A
>3' - 6"	(2) 2x10	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>6' - 9"	(2) 2x12	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>9' - 12"	(2) 1 3/4" x 11 1/4" LVL - 2.0E	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>12' - 15"	(2) 1 3/4" x 11 1/4" LVL - 2.0E	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>15' - 18"	(2) 1 3/4" x 11 1/4" LVL - 2.0E	4.5"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD


BLOCKING SECTION
SCALE: 3/4" = 1'-0"




ALL THREAD @ PORCH BEAM
NTS

NOTE:
A SOLID MEMBER OF EQUAL OR GREATER SIZE THAN MULTIPLE MEMBERS MAY BE USED IF RATED SHEATHING IS APPLIED TO NARROW EDGES, NAILED TO EACH STUD AT 12" O.C. MAXIMUM. THE LAMINATION NAILING SHOWN HERE IS NOT REQUIRED.


NOTE:
SHEATHING ON BOTH SIDES OF WALL DOUBLES THE EFFECTIVE SHEARWALL LENGTH.



GARAGE ENDWALL DETAILS
SCALE: 1/2" = 1'-0"

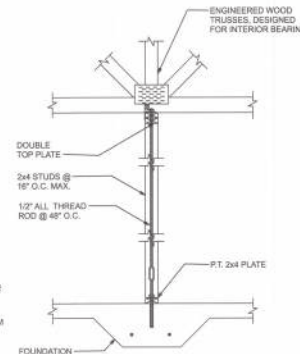

INTERIOR BRG. WALL DETAIL

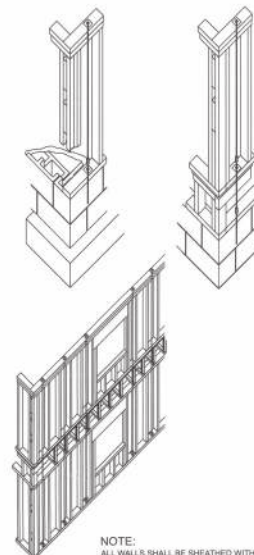

SHEARWALL LAYOUT
SCALE: 1/8" = 1'-0"



1 OF 33 CROSSWINDS, PHASE 1
SHEARWALL DETAILS

P.O. BOX 880125
ST. AUGUSTINE, FL 32086
(904) 429-7536
C.O.A. # 00049071

COASTAL ENGINEERING, INC.
A.S. & S. ENGINEERS


DATE: 2/1/09
DRAWN BY: W.H.T.
APPROVED: W.H.T.

REVISIONS:


SHEET: A-8

OF: 9

PROJECT NO.: 22.0007






ROOF JACKS AND VENTS

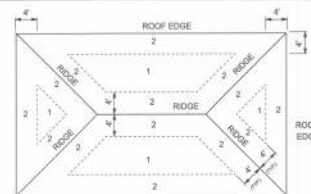

ROOF SHEATHING NAILING ZONES (HIP ROOF)

ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1			6 in. o.c. EDGE 6 in. o.c. FIELD
2	7/16 o.s.b.	1d ring shank galvanized	6 in. o.c. EDGE 6 in. o.c. FIELD
3			6 in. o.c. EDGE 6 in. o.c. FIELD

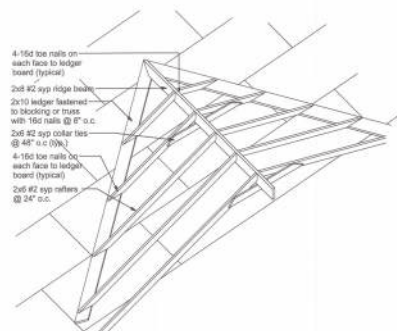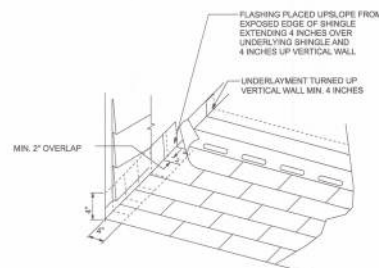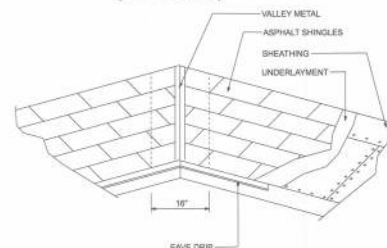

ROOF INTERSECTION DETAIL
NTS

DECK REQUIREMENTS:
ASPHALT SHINGLES SHALL BE FASTENED TO SOLIDLY SHEATHED DECKS.

SLOPE:
ASPHALT SHINGLES SHALL BE USED ONLY ON ROOF SLOPES OF 2:12 OR GREATER. FOR ROOF SLOPES FROM 2:12 TO 4:12, DOUBLE UNDERLAYMENT IS REQUIRED.

UNDERLAYMENT:
UNLESS OTHERWISE NOTED, UNDERLAYMENT SHALL CONFORM WITH ASTM D 228, TYPE 1, OR ASTM D 4889, TYPE 1.

SELF-ADHERING POLYMER MODIFIED BITUMEN SHEET:
SELF-ADHERING POLYMER MODIFIED BITUMEN SHALL COMPLY WITH ASTM D 1975.

ASPHALT SHINGLES:
ASPHALT SHINGLES SHALL HAVE SELF SEAL STRIPS OR BE INTERLOCKING, AND COMPLY WITH ASTM D 228 OR ASTM D 3462.

FASTENERS:
FASTENERS FOR ASPHALT SHINGLES SHALL BE GALVANIZED, STAINLESS STEEL, ALUMINUM OR COPPER ROOFING NAILS, MINIMUM 12 GAUGE SHANK WITH A MINIMUM 3/8 INCH DIAMETER HEAD, OF A LENGTH TO PENETRATE THROUGH THE ROOFING MATERIAL, AND A MINIMUM 3/4" INTO THE ROOF SHEATHING. WHERE ROOF SHEATHING IS LESS THAN 3/4" THICK, THE NAILS SHALL PENETRATE THROUGH THE SHEATHING.

ATTACHMENT:
ASPHALT SHINGLES SHALL BE SECURED TO THE ROOF WITH NOT LESS THAN FOUR FASTENERS PER STRIP SHINGLE OR TWO FASTENERS PER INDIVIDUAL SHINGLE. WHERE ROOFS LOCATED IN BASIC WIND SPEED OF 110 MPH OR GREATER, SPECIAL METHODS OF FASTENING ARE REQUIRED. UNLESS OTHERWISE NOTED, ATTACHMENT OF ASPHALT SHINGLES SHALL CONFORM WITH ASTM D 3385 OR IRC PA 107-95.

UNDERLAYMENT APPLICATION:
FOR ROOF SLOPES FROM 2:12 TO 4:12, UNDERLAYMENT SHALL BE A MINIMUM OF TWO LAYERS APPLIED AS FOLLOWS:
1. STARTING AT THE EAVE, A 19 INCH STRIP OF UNDERLAYMENT SHALL BE APPLIED PARALLEL WITH THE EAVE AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

2. STARTING AT THE EAVE, 36 INCH WIDE STRIPS OF UNDERLAYMENT FELT SHALL BE APPLIED OVERLAPPING SUCCESSIVE SHEETS 18 INCHES AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

FOR ROOF SLOPED 4:12 AND GREATER, UNDERLAYMENT SHALL BE A MINIMUM OF ONE LAYER OF UNDERLAYMENT FELT APPLIED AS FOLLOWS:
STARTING AT THE EAVE, UNDERLAYMENT SHALL BE APPLIED SHINGLE FASHION PARALLEL TO THE EAVE, LAPPED 2 INCHES, AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

BASE AND CAP FLASHINGS:
BASE AND CAP FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS. BASE FLASHING SHALL BE OF EITHER CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS 0.019 INCH OR MINERAL SURFACE ROLL ROOFING WEIGHING A MINIMUM OF 77 LBS PER 100 SQUARE FEET. CAP FLASHING SHALL BE CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS OF 0.019 INCH.

VALLEYS:
VALLEY LININGS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS BEFORE APPLYING ASPHALT SHINGLES. VALLEY LININGS OF THE FOLLOWING TYPES SHALL BE PERMITTED:

1. FOR OPEN VALLEYS LINED WITH METAL, THE VALLEY LINING SHALL BE AT LEAST 18 INCHES WIDE AND OF ANY OF THE CORROSION RESISTANT METALS IN TABLE 1507.3.3.2.
2. FOR OPEN VALLEYS, VALLEY LINING OF TWO PLYS OF MINERAL SURFACE ROLL ROOFING SHALL BE PERMITTED. THE BOTTOM LAYER SHALL BE 18 INCHES AND THE TOP LAYER A MINIMUM OF 36 INCHES WIDE.
3. FOR CLOSED VALLEYS VALLEY LINING SHALL BE ONE OF THE FOLLOWING:
1. BOTH TYPES 1 AND 2 ABOVE, COMBINED.
2. ONE PLY OF SMOOTH ROLL ROOFING AT LEAST 36 INCHES WIDE AND COMPLYING WITH ASTM D 224.
3. SPECIALTY UNDERLAYMENT AT LEAST 36 INCHES WIDE AND COMPLYING WITH ASTM D 1975.

MATERIAL	MINIMUM THICKNESS (in)	GAGE	WEIGHT (lb)
COPPER			1
ALUMINUM	0.024		
STAINLESS STEEL		2B	
GALVANIZED STEEL	0.0175	25 (zinc coated G90)	
ZINC ALLOY			2 1/2
LEAD			20
PAINTED TERNE	0.027		

ROOF PLAN
SCALE: 1/4"=1'-0"



LOT 33 CROSSWINDS, PHASE 1

ROOF PLAN

P.O. BOX 880125
ST. AUGUSTINE, FL 32086
COASTAL ENGINEERING, INC.
A PROFESSIONAL CORPORATION




DATE: 2/16/22
DRAWN BY: W.H.F.
APPROVED: W.H.F.

REVISIONS

SHEET: A-6


OF: 9

PROJECT NO. 22007




COVER OVER REINFORCING STEEL
FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE:
3 INCHES IN FOUNDATIONS WHERE THE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH THE EARTH OR EXPOSED TO THE EARTH SURFACE;
1 1/2 INCHES FOR ALL OTHER FOUNDATIONS;
IN GROUTED CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1/4 INCH FOR FINE GROUT OR 1/2 INCH FOR COARSE GROUT BETWEEN REINFORCING BARS, AND ANY FACE OF A CELL. REINFORCING BARS USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN:
2 INCHES FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER;
1 1/2 INCHES FOR MASONRY UNITS NOT EXPOSED TO EARTH OR WEATHER.


NOTE:
CONCRETE SLABS, WALKS, DRIVES AND PATIOS CAN DEVELOP HAIRLINE CRACKS THAT WILL NOT AFFECT THE STRUCTURAL INTEGRITY OF THE BUILDING. THERE IS NO KNOWN METHOD OF ELIMINATING THIS CONDITION, WHICH IS CAUSED BY THE CHARACTERISTICS OF EXPANSION AND CONTRACTION THAT OCCURS IN ALL CONCRETE APPLICATIONS. IT DOES NOT AFFECT THE STRENGTH OF THE BUILDING, AND IT IS NOT A CONDITION COVERED BY ANY WARRANTY.

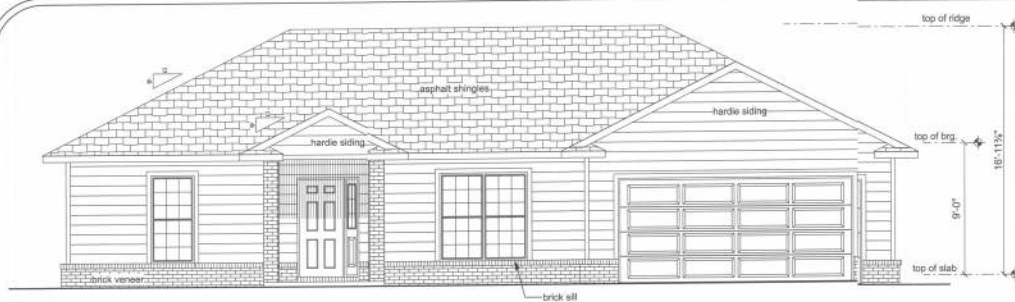


FRONT ELEVATION
SCALE: 1/4" = 1'-0"

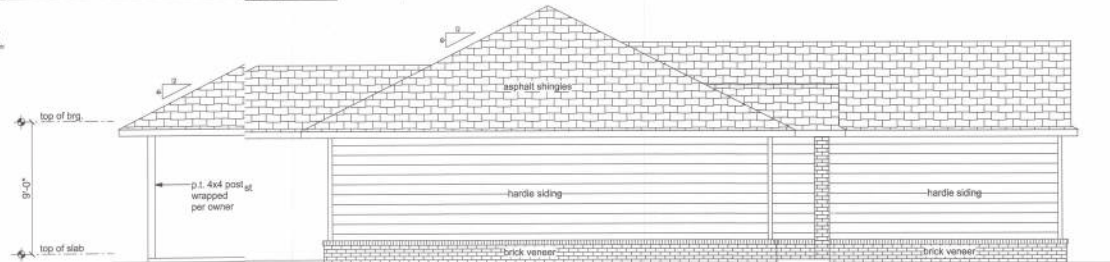

LEFT ELEVATION
SCALE: 1/4" = 1'-0"

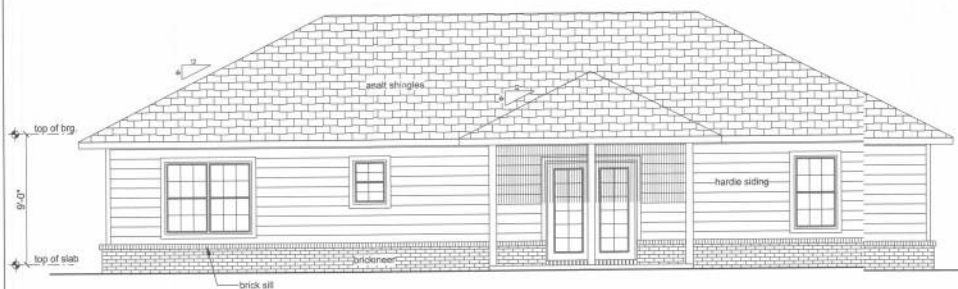



REAR ELEVATION
SCALE: 1/4" = 1'-0"

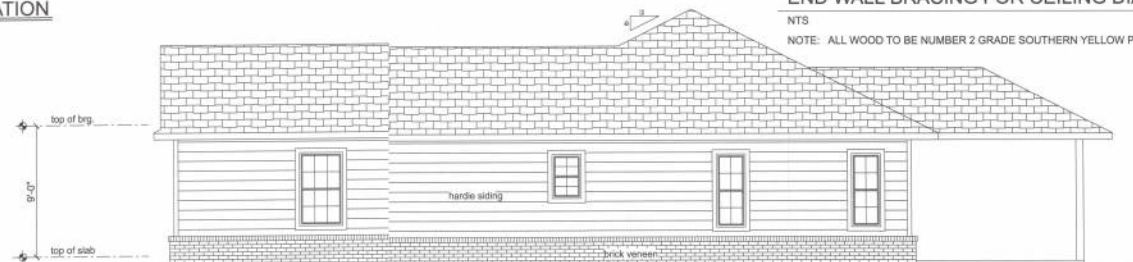

RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

VENTILATION REQUIREMENTS

Total Attic Square Footage	Recommended Length of Cobra Rigid Vent II (Feet)	Minimum Intake Ventilation (Net Free Area in Sq. In.)
1600	21	384
1900	25	456
2200	29	528
2500	33	600
2800	41	744
3100	41	820
3400	45	816

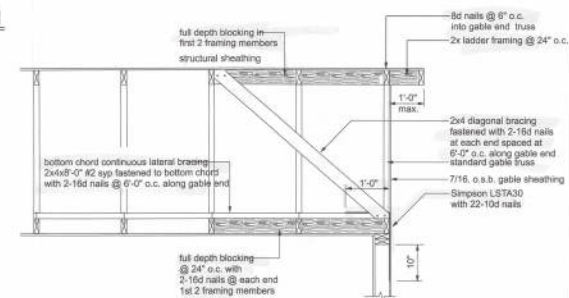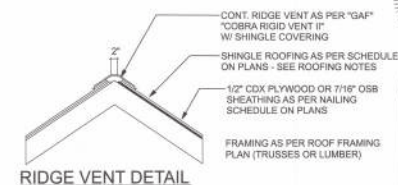

END WALL BRACING FOR CEILING DIAPHRAGM

NTS
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE



LOT 33 CROSSWINDS, PHASE 1
ELEVATIONS

P.O. BOX 660125
ST. AUGUSTINE, FL 32086
(904) 428-7536
COASTAL ENGINEERING, INC.



DATE: 2/10/02
DRAWN BY: W.H.F.
APPROVED: W.H.F.

REVISIONS:

SHEET: A-4

OF: 9

PROJECT NO.: 121807




SITE DATA

ZONING RSF-2
MINIMUM LOT SIZE: 20,000 sf
FRONT/SIDE/REAR SETBACKS: 25/10/15
FLOOD ZONE: ZONE "X"

DESCRIPTION

LOT 33 CROSSWINDS PHASE 1 SUBDIVISION
SECTION 24 TOWNSHIP 4 SOUTH, RANGE 16 EAST
COLUMBIA COUNTY FLORIDA

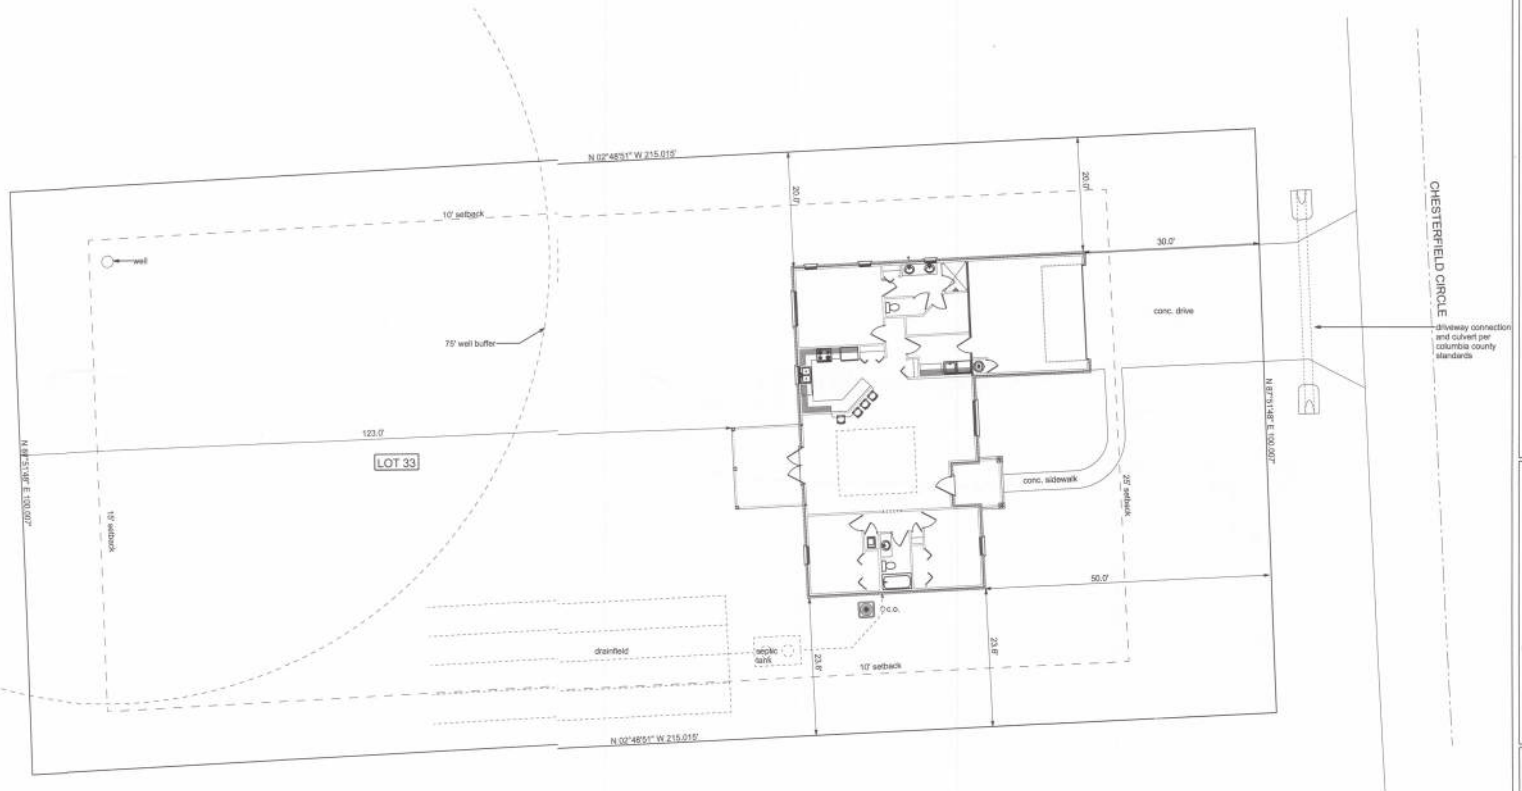

SITEPLAN
SCALE: 1" = 10'-0"



LOT 33 CROSSWINDS, PHASE 1 SITE PLAN

P.O. BOX 860125
ST. AUGUSTINE, FL 32086
(904) 429-7536
C.O.A. # 40000001



DATE: 4/21
DRAWN BY: W.J.F.
APPROVED: W.J.F.

REVISIONS

SHEET: A-2
OF: 9
PROJECT NO.: 221007

TERMITE SPECIFICATIONS:

- A permanent sign which identifies the termite treatment provider and need for reinspection and treatment contract renewal, shall be provided. The sign shall be posted near the water heater or electric panel. (FBC 190.3.4)
- CONDENSATE AND ROOF DOWNSPOUTS SHALL DISCHARGE AT LEAST 1'-0" AWAY FROM BUILDING SIDE WALLS. (FBC 190.3.4.1)
- IRRIGATION/SINKER SYSTEMS INCLUDING ALL RISERS AND SPRAY HEADS SHALL NOT BE INSTALLED WITHIN 1'-0" OF THE BUILDING SIDE WALLS. (FBC 190.4)
- TO PROVIDE FOR INSPECTION FOR TERMITE INFESTATION, BETWEEN WALL COVERING AND FINAL EARTH GRADE SHALL NOT BE LESS THAN 4" INCHES. EXCEPTION: PAINT OR DECORATIVE CEMENTITIOUS FINISH LESS THAN 5/8" THICK ADHERED DIRECTLY TO THE FOUNDATION. WALL. (FBC 190.3.1.1)
- INITIAL TREATMENT SHALL BE DONE AFTER EXCAVATION AND BACKFILL IS COMPLETE. (FBC 190.3.1.1)
- SOIL DISTURBED AFTER THE INITIAL TREATMENT SHALL BE RETREATED INCLUDING SPACES BOXED AND FORMED. (FBC 190.3.1.2)
- BOXED AREAS IN CONCRETE FLOORS FOR SUBSEQUENT INSTALLATION OF TIPS, ETC., SHALL BE MADE WITH PERMANENT METAL OR PLASTIC FORMS. PERMANENT FORMS MUST BE OF A SIZE AND DEPTH THAT WILL ELIMINATE THE DISTURBANCE OF SOIL AFTER THE INITIAL TREATMENT. (FBC 190.3.1.3)
- MINIMUM 6 MIL VAPOR BARRIER MUST BE INSTALLED TO PROTECT AGAINST WALL DILUTION. IF RAINFALL OCCURS BEFORE VAPOR BARRIER PLACEMENT, RETREATMENT IS REQUIRED. (FBC 190.3.1.4)
- CONCRETE OVERPOUR AND MORTAR ALONG THE FOUNDATION PERIMETER MUST BE REMOVED BEFORE EXTERIOR SOIL TREATMENT. (FBC 190.3.1.5)
- SOIL TREATMENT MUST BE APPLIED UNDER ALL EXTERIOR CONCRETE OR GRIE WITHIN 1'-0" OF THE STRUCTURE SIDEWALLS. (FBC 190.3.1.6)
- AN EXTERIOR VERTICAL CHEMICAL BARRIER MUST BE INSTALLED AFTER CONSTRUCTION IS COMPLETE INCLUDING LANDSCAPING AND IRRIGATION. ANY SOIL DISTURBED AFTER THE VERTICAL BARRIER IS APPLIED, SHALL BE RETREATED. (FBC 190.3.1.6)
- ALL BUILDINGS ARE REQUIRED TO HAVE PRE-CONSTRUCTION TREATMENT. (FBC 190.3.1.7)
- A CERTIFICATE OF COMPLIANCE MUST BE ISSUED TO THE BUILDING DEPARTMENT BY A LICENSED PEST CONTROL COMPANY BEFORE A CERTIFICATE OF OCCUPANCY WILL BE ISSUED. THE CERTIFICATE OF COMPLIANCE SHALL STATE: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERNEAN TERMITES. THE TREATMENT IS IN ACCORDANCE WITH THE RULES AND LAWS OF THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES. (FBC 190.3.1.7)
- AFTER ALL WORK IS COMPLETED, LOGS, WOOD AND FILL MUST BE REMOVED FROM BELOW AND WITHIN 1'-0" OF THE BUILDING. THIS INCLUDES ALL GRADE STAKE, TUB TRAY BOXES, FORMS, SHORING OR OTHER CELLULOSE CONTAINING MATERIAL. (FBC 290.3.1.3)
- NO WOOD, VEGETATION, STUMPS, CARBONADO, TRASH, ETC., SHALL BE BURNED WITHIN 15'-0" OF ANY BUILDING OR PROPOSED BUILDING. (FBC 290.3.1.4)

A.B. Anchor Bolt	F.B.C. Florida Bldg. Code	Oplg. Optional
Abv. Above	Fm. Fr. Finished Floor	P.C. Precast
Air. Air-Conditioner	F.G. Floor Glass	P.C. Precast
Adj. Adjustable	F.P. Foundation	P.C. Precast
A.F.F. Above Finished Floor	F.S. Foundation	P.C. Precast
A.H.U. Air Handler Unit	F.P. Floor System	P.C. Precast
ALT. Alternate	F.P. Fireplace	P.C. Precast
B.C. Base Cabinet	F.P. Floor	P.C. Precast
B.K. Bifold Door	F.P. Filing	P.C. Precast
B.N. Back Shelf	F.P. Filing	P.C. Precast
B.O.T. Bottom	F.P. Filing	P.C. Precast
B.P. Bayonet door	F.P. Filing	P.C. Precast
Brg. Bearing	F.P. Filing	P.C. Precast
Cf. Circle	F.P. Filing	P.C. Precast
Cg. Ceiling	F.P. Filing	P.C. Precast
Col. Column	F.P. Filing	P.C. Precast
Comp. A/C Compressor	F.P. Filing	P.C. Precast
C.T. Ceramic Tile	F.P. Filing	P.C. Precast
Dec. Decorative	F.P. Filing	P.C. Precast
Dec. Decorative Detail	F.P. Filing	P.C. Precast
Dis. Drain	F.P. Filing	P.C. Precast
Dis. Disposal	F.P. Filing	P.C. Precast
Dis. Distance	F.P. Filing	P.C. Precast
D.S. Drawer Stack	F.P. Filing	P.C. Precast
D.V. Dryer Vent	F.P. Filing	P.C. Precast
D.W. Dishwasher	F.P. Filing	P.C. Precast
E.W. Each Way	F.P. Filing	P.C. Precast
Ele. Electrical	F.P. Filing	P.C. Precast
Ele. Elevation	F.P. Filing	P.C. Precast
Ext. Exterior	F.P. Filing	P.C. Precast
Exp. Expansion	F.P. Filing	P.C. Precast

FOUNDATIONS

SOIL TO BE COMPACTED TO AT LEAST 95% OF MAX. DRY DENSITY AS DETERMINED BY ASTM - 1587 (MODIFIED PROCTOR)

FOUNDATION INSPECTIONS

A FOUNDATION SURVEY SHALL BE PERFORMED AND A COPY OF THE SURVEY SHALL BE ON SITE FOR THE BUILDING INSPECTOR TO VIEW. ALL PROPERTY MARKERS SHALL BE EXPOSED AND A STRING STRETCHED FROM MARKER TO MARKER TO VERIFY REQUIRED SETBACKS.

CAST IN PLACE CONCRETE

- ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS OF 3000 PSI. A SLUMP OF 4" PLUS OR MINUS 1" AND HAVE 2 TO 3% AIR ENTRAINMENT, AND A MAXIMUM WATER/CEMENT RATIO OF 0.63
- ALL REINFORCING STEEL SHALL BE NEW DOMESTIC DEFORMED BILLET STEEL CONFORMING TO ASTM A-618 (GRADE 60)
- WELDED WIRE FABRIC SHALL CONFORM TO ASTM A-185 (WIRE SHALL BE LAPPED AT LEAST 6" AND ON TIE AT LEAST ONE CROSS WIRE WITHIN THE 6")
- HOOKS SHALL BE PROVIDED AT DISCONTINUOUS ENDS OF ALL TOP BARS OF BEAMS
- HORIZONTAL FOOTING BARS SHALL BE BENT 1'-0" AROUND CORNERS OR CORNER BARS WITH A 4'-0" LAP REQUIRED
- MINIMUM LAP SPICES ON ALL REINFORCING BARS SHALL BE 48 BAR DIAMETERS TYP.
- CONCRETE COVER MIN. 3" WHEN EXPOSED TO EARTH OR 1 1/2" TO FORM

MASONRY WALL CONST.

- HOLLOW LOAD BEARING UNITS SHALL BE NORMAL WEIGHT, GRADE 2 TYPE 2 CONFORMING TO ASTM C-90, WITH A MINIMUM NET COMPRESSIVE STRENGTH OF 1000 PSI (711 + 158 PSI)
- MORTAR SHALL BE TYPE "S" OR "M" CONFORMING TO ASTM C-270
- CONCRETE GROUT SHALL CONFORM TO ASTM C-955 WITH A MAXIMUM AGGREGATE SIZE OF 3/8" AND A MAXIMUM COMPRESSIVE STRENGTH OF 3000 PSI SLUMP 7" TO 11"
- VERTICAL REINFORCEMENT SHALL BE AS NOTED ON THE DRAWINGS WITH THE CELLS FILLED WITH CONCRETE GROUT
- VERTICAL REINFORCEMENT SHALL BE USED IN POSITION AT THE TOP AND BOTTOM AND AT A MAXIMUM SPACING OF 16 BAR DIAMETERS. REINFORCEMENT SHALL BE PLACED IN THE CENTER OF THE MASONRY CELL. TYPICAL, UNLESS OTHERWISE NOTED.
- REINFORCING STEEL SHALL BE LAPPED A MINIMUM OF 48 BAR DIAMETERS, UNLESS OTHERWISE NOTED ON THE DRAWINGS
- GROUT STOPS SHALL BE PROVIDED BELOW BOND BEAM, PLASTIC SCREEN, METAL LATH STRIP OR CAVITY GAPS MAY BE USED TO PREVENT THE FLOW GROUT INTO CELLS BELOW. THE USE OF FELT PAPER AS A STOP IS PROHIBITED

WOOD CONSTRUCTION

- WOOD CONSTRUCTION SHALL CONFORM TO THE NFA NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION, LATEST EDITION
- ALL EXTERIOR WOOD STUD WALLS, SHIM WALLS AND MISC. STRUCTURAL WOOD FRAMING MEMBERS (I.E. BLOCKING OR BRACING) SHALL BE EITHER SOUTHERN PINE, OR S.P.F. NUMBER 1 GRADE SHALL BE USED REGARDLESS OF SPECIES
- ANY WOOD FRAMING MEMBER BEARING WALLS THAT HAVE HOLES IN THE CENTER OF THE STUD UP TO 3" DIA. SHALL HAVE STUD PROTECTION SHIELDS FOR ALL HOLES OVER 1" IN DIA.
- FOR PLUMBING LINES, ETC. SHALL BE REPAIRED WITH SIMPSON HES STUD JACKS TYP. U.S.A.O.

WOOD FRAMING INSPECTION

ALL PLUMBING, ELECTRICAL, AND MECHANICAL ROUGH-INS MUST BE COMPLETE, INSPECTED AND APPROVED BEFORE REQUESTING FRAMING INSPECTION.

STRUCTURAL NOTES:

PREFABRICATED WOOD TRUSSES

- ALL PREFABRICATED WOOD TRUSSES SHALL BE SECURELY FASTENED TO THEIR SUPPORT WALLS OR BEAMS WITH HURRICANE CLIPS OR ANCHORS
- PREFABRICATED WOOD TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL DESIGN SPECIFICATION FOR STRESS-GRADE LUMBER AND ITS FASTENERS AS RECOMMENDED BY THE NATIONAL FOREST PRODUCTS ASSOCIATION
- TRUSS MEMBERS AND CONNECTIONS SHALL BE PROPORTIONED (WITH A MAXIMUM ALLOWABLE) BY THE TRUSS MANUFACTURER FOR LOAD DURATION OF 25% TO WITHSTAND THE LIVE LOADS GIVEN IN THE NOTES AND TOTAL DEAD LOAD BRIDGING FOR PRE-ENGINEERED TRUSSES SHALL BE AS REQUIRED BY THE TRUSS MANUFACTURER UNLESS NOTED ON THE PLANS
- TRUSS ELEVATIONS AND SECTIONS ARE FOR GENERAL CONFIGURATION OF TRUSSES ONLY. MEMBER SIZES ARE NOT SHOWN, BUT SHALL BE DESIGNED BY THE TRUSS MANUFACTURER IN ACCORDANCE WITH THE FOLLOWING DESIGN LOADS
- DESIGN SPECIFICATIONS FOR LIGHT WOOD TRUSSES SHALL BE DESIGNED BY THE MANUFACTURER IN ACCORDANCE WITH THE FOLLOWING FRAMING PLANS AND DETAILS SHOWING MEMBER SIZES, BRACING, ANCHORAGE, CONNECTIONS, TRUSS LOCATIONS, AND PERMANENT BRACING AND/OR BRIDGING AS REQUIRED FOR ERECTION AND FOR THE PERMANENT STRUCTURE. EACH SUBMITTAL SHALL BE SIGNED AND SEALED BY A FLORIDA REGISTERED STRUCTURAL ENGINEER. 5 SUBMIT 3 COPIES FOR REVIEW AND APPROVAL PRIOR TO FABRICATION
- THE TRUSS MANUFACTURER SHALL DETERMINE ALL SPANS, WORKING POINTS, BEARING POINTS, AND SIMILAR CONDITIONS. TRUSS SHOP DRAWINGS SHALL SHOW ALL TRUSSES, ALL BRACING MEMBERS, AND ALL TRUSS TO TRUSS HANGERS.

UPLIFT CONNECTORS

- UPLIFT CONNECTORS SUCH AS HURRICANE CLIPS, TRUSS ANCHORS AND ANCHOR BOLTS ARE ONLY REQUIRED ON MEMBERS IN WALLS THAT ARE EXPOSED TO UPLIFT FORCES. INTERIOR LOAD BEARING WALLS ARE NOT ALWAYS EXPOSED TO UPLIFT FORCES. THE MEMBERS OF "T" THESE WALLS WOULD NOT NEED TO HAVE CONNECTORS APPLIED. PLEASE CONSULT THE TRUSS ENGINEERING FOR THE LOCATION OF THESE WALLS.


FIELD REPAIR NOTES

- MISSED LINTEL STRAPS FOR MASONRY CONSTRUCTION MAY BE SUBSTITUTED BY (1) SIMPSON HTS-3045 TWIST STRAP W/ 1/4" X 2 1/4" DIA. TITENS TO THE BOND AND BEAM BLOCK AND (2) 10 TO THE TRUSS FOR UPLIFT 775 OF 1000 LBS. OR LESS. USE (2) FOR 2000 LBS. OR LESS. 3 OTHERS MAY BE SUBSTITUTED ON A CASE BY CASE BASIS
- MISSED "J" BOLTS FOR WOOD BEARING WALLS MAY BE SUBSTITUTED BY 1/2" DIA. ANCHOR BOLTS "S" SET IN 3/4" DIA. X 1" DEEP LINTEL "BLOCK" 300 EXISTING BENDER FOLLOWING ALL MANUFACTURER'S RECOMMENDATIONS (1) OR 1/2" X 1"

- REBARING WOODEN BEAM IN VERTICAL FILLED CELLS SHALL BE 3/4" DIA. HOLE 6" DEEP AT THE LOCATION OF THE REBAR. THE REBAR AND HOLE SHALL BE 1/2" DIA. BAR INTO THE EPOXY FILLED JOINT. USE A TWO PART EPOXY RESIN (EPOXY "SIMPSON" "PROXY" SET, OR "HILTI" 2-PART "MIXED" EPOXY) AND FILL THE MANUFACTURER'S INSTRUCTIONS. ASSURE THAT ALL DUST AND DEBRIS FROM THE EPOXY IS REMOVED FROM THE JOINT BEFORE THE EPOXY AND USING COMPRESSED AIR PRIOR TO APPLYING THE EPOXY. ALLOW THE EPOXY TO CURE TO MANUFACTURER'S SPECIFICATIONS, THEN FILL THE CELLS IN THE NORMAL WAY CORING BOND BEAM POUR
- HURRICANE STRAPS MAY BE SUBSTITUTED WITH A STRAP OF GREATER KNOCKDOWN VALUE OR GREATER UPLIFT VALUE IF THE FIELD WITHOUT VENTILATION, PROVIDED ALL MANUFACTURER'S INSTALLATION INSTRUCTIONS ARE FOLLOWED
- FOR NOTER JOINTS LESS THAN 1/4" PROVIDE (1) "T" IN VERT. IN CONC. FILLED CELL EACH SIDE OF THE JOINT (1) BAR DOES NOT HAVE TO GO TO TOP OF JOINT

STRUCTURAL DESIGN CRITERIA

CODES:	FLORIDA BUILDING CODE, 2020 BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE (ACI 318-18) SPECIFICATIONS FOR STRUCTURAL CONCRETE BUILDINGS (ACI 301-16) BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES (ACI 530-18) NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION, 2018 EDITION APA PLYWOOD DESIGN SPECIFICATION
LIVE LOADS:	ROOF: 20 PSF (REDUCIBLE) RESIDENTIAL FLOOR, UNLESS OTHERWISE INDICATED: 40 PSF BALCONIES: 60 PSF STAIRS: 40 PSF LIGHT PARTITIONS (DEAD LOAD): 10 PSF
WIND LOADS: (F.B.C.)	WIND LOADS BASED ON F.B.C. SECTION 1609 WIND VELOCITY: 125 M.P.H., USE FACTOR: 1.0
CONCRETE STRENGTH @ 28 DAYS	ALL CONCRETE UNLESS OTHERWISE INDICATED PRE-CAST CONCRETE FOR MASONRY CELLS ONLY (DO NOT USE FOR CONCRETE COLUMNS OR TIE BEAMS) 3000 PSI 3000 PSI
REINFORCING: (F.B.C.)	WELDED WIRE FABRIC SHALL CONFORM TO ALL REINFORCING BARS ALL STIRRUPS AND TIES ASTM A185 ASTM A615-40 40,000 PSI ASTM A615-40 40,000 PSI
CONCRETE MASONRY UNITS:	ASTM C90-89, STANDARD WEIGHT UNITS, 80-1500 PSI MORTAR TYPE "S" - 1800 PSI CONCRETE GROUT - 3000 PSI CONTINUOUS MASONRY INSPECTION IS REQUIRED DURING CONSTRUCTION
STRUCTURAL STEEL:	ALL STRUCTURAL AND MISCELLANEOUS STEEL A36 36,000 PSI, U.S.A.O. SHOP AND FIELD WELDS: E70XX ELECTRODES ALL BOLTS CAST IN CONCRETE: ASTM A36 OR ASTM A-307
WOOD FRAMING:	BEAMS, RAFTERS, JOIST, PLATES, ETC. U.S.A.O. NO. 2 SOUTHERN YELLOW PINE (19% M.C.) ROOF DECK: PLYWOOD C-C OR EXTERIOR, OR OSB FLOOR SHEATHING: T&G A-C GROUP 1 APA RATED (4824) WALL SHEATHING: PLYWOOD C-C OR EXTERIOR OR OSB VERSO LAM BEAM F-2 2000 PSI (2.0E) WOOD COLS. PARALLAM 2.0E U.S.A.O.
WOOD ROOF TRUSSES:	TOP CHORD LIVE: 20 PSF TOP CHORD DEAD LOAD: 10 PSF BOTTOM CHORD DEAD LOAD: 10 PSF TOTAL: 40 PSF
WOOD FLOOR TRUSSES:	DESIGN LOADS: 15 PSF DEAD LOAD: 40 PSF LIVE LOAD: 55 PSF TOTAL:
SOIL BEARING VALUE:	ASSUMED ALLOWABLE SOIL BEARING PRESSURE AFTER COMPACTION: 2,000 PSF SEE SOILS REPORT AND SPECIFICATIONS FOR COMPACTION REQUIREMENTS IF SOIL CONDITIONS IN THE PROJECT DO NOT MEET OR EXCEED THE CAPACITY A MAXIMUM OF 5 P.S.F. DEAD LOAD, BUT NOT EXCEEDING ACTUAL DEAD LOAD.

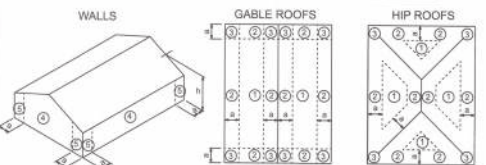

* 10% of least horizontal dim. or 0.4h, whichever is smaller, but not less than
n: mean roof height, in feet.

COMPONENTS AND CLADDING

INDEX OF SHEETS

SHEET NUMBER	DESCRIPTION
A-1	GENERAL NOTES SHEET
A-2	SITE PLAN
A-3	FLOOR PLAN
A-4	ELEVATIONS
A-5	FOUNDATION PLAN
A-6	ROOF PLAN
A-7	FRAMING DETAILS
A-8	SHEARWALL DETAILS
A-9	ELECTRICAL PLAN

LOT 33 CROSSWINDS, PHASE 1
GENERAL NOTES SHEET

P.O. BOX 860725
ST. AUGUSTINE, FL 32086
TEL: 904-839-7336
COASTAL ENGINEERING
A DIVISION OF

DRAWN BY: W.H.F.
APPROVED: W.H.F.
CHECKED: W.H.F.

DATE: 2/10/22

REVISIONS:

SHEET: A-1

OF: 9

PROJECT NO: 22-0007

PROJECT LOCATION

Lot 33

LOCATION MAP

