

ROOF PITCH: 3/12, 8/12

CLG PITCH: 12" STEP
TRAY FAMILY ROOM.
AND MASTER BR
HATCHED AREAS.

O.H.: 16" PLUMB CUT

WIND: 130 MPH

EXP: "B"


LOADING: 40 PSF

WALLS: 2 X 4

DATE: 4/25/2022

JENNA PAYNE

Client: BRUCE
SCHAFER
Date: 6/9/2022
Quote Date: 05/12/22
Seal Date: / /
Designer: Lynn Bell
Job Number: 0322-072



Ph. (386) 294-3988
Fax (386) 294-3981
mayotruss@windstream.net



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: JENNA_PAYNE - JENNA PAYNE

MiTek USA, Inc.

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:

Customer Info: BRUCE SHAFER Project Name: JENNA PAYNE Model: .

Lot/Block: . Subdivision: .

Address: ., .

City: ALACHUA State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:

Address:

City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2020/TPI2014

Design Program: MiTek 20/20 8.4

Wind Code: ASCE 7-16

Wind Speed: 130 mph

Roof Load: 40.0 psf

Floor Load: N/A psf

This package includes 28 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.


No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T27927582	A01	6/7/22	23	T27927604	V01	6/7/22
2	T27927583	A02	6/7/22	24	T27927605	V02	6/7/22
3	T27927584	A03	6/7/22	25	T27927606	V03	6/7/22
4	T27927585	B01	6/7/22	26	T27927607	V04	6/7/22
5	T27927586	B02	6/7/22	27	T27927608	V05	6/7/22
6	T27927587	C01	6/7/22	28	T27927609	V06	6/7/22
7	T27927588	C02	6/7/22				
8	T27927589	C03	6/7/22				
9	T27927590	C04	6/7/22				
10	T27927591	C05	6/7/22				
11	T27927592	C6GE	6/7/22				
12	T27927593	C7SR	6/7/22				
13	T27927594	C8GE	6/7/22				
14	T27927595	CJ01	6/7/22				
15	T27927596	D01	6/7/22				
16	T27927597	D02	6/7/22				
17	T27927598	D3GE	6/7/22				
18	T27927599	GDR1	6/7/22				
19	T27927600	J01	6/7/22				
20	T27927601	J02	6/7/22				
21	T27927602	J03	6/7/22				
22	T27927603	J04	6/7/22				

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc.
under my direct supervision based on the parameters
provided by Mayo Truss Company, Inc..

Truss Design Engineer's Name: Magid, Michael

My license renewal date for the state of Florida is February 28, 2023.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

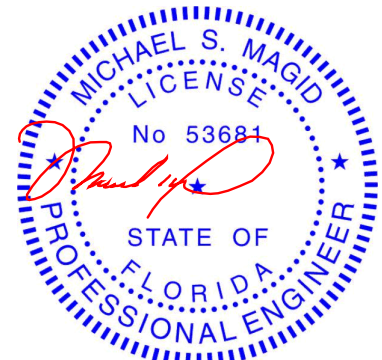

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

Magid, Michael

1 of 1




Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927584
JENNA_PAYNE	A03	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:08 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zlyaR-1nVo_mLlyhkZ_QUGQ3w11fGPddVFUbyu?mJDIRz8zGP



Scale = 1:81.3

5x5 =


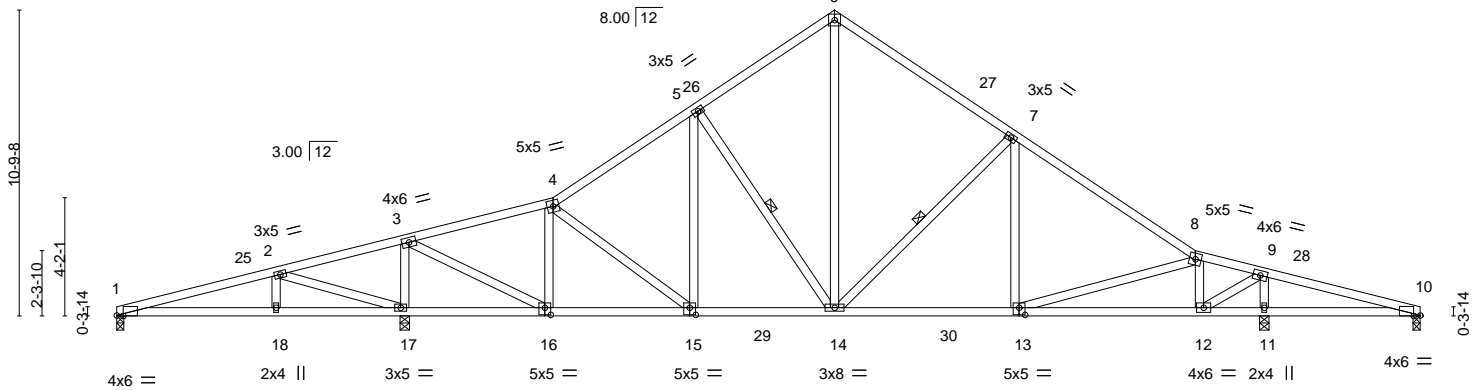


Plate Offsets (X,Y)-- [1:0-2-12,Edge], [10:0-2-12,Edge], [13:0-2-8,0-3-0], [15:0-2-8,0-3-0], [16:0-2-8,0-3-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.41	Vert(LL)	-0.12 13-14	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.59	Vert(CT)	-0.22 13-14	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.44	Horz(CT)	0.03 11	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS					Weight: 256 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-14, 7-14

REACTIONS.


- All bearings 0-3-0 except (jt=length) 17=0-4-0, 11=0-4-0.
(lb) - Max Horz 1=184(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 1, 10, 17, 11
Max Grav All reactions 250 lb or less at joint(s) 1, 10 except 17=2096(LC 17), 11=1825(LC 18)

FORCES.

- (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-78/1005, 3-4=-987/136, 4-5=-1310/205, 5-6=-1101/245, 6-7=-1103/235,
7-8=-1462/188, 8-9=-888/77, 9-10=-70/829
BOT CHORD 16-17=-899/132, 15-16=-35/1020, 14-15=-1/1097, 13-14=-21/1136, 12-13=-31/896,
11-12=-768/88, 10-11=-768/88
WEBS 2-17=-898/98, 3-17=-1638/203, 3-16=-155/2012, 4-16=-774/126, 5-14=-371/140,
6-14=-124/851, 7-14=-504/159, 8-13=0/302, 8-12=-830/150, 9-12=-127/1881,
9-11=-1644/157

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=46ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 4-7-3, Interior(1) 4-7-3 to 25-4-0, Exterior(2R) 25-4-0 to 29-11-3, Interior(1) 29-11-3 to 46-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 10, 17, 11.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

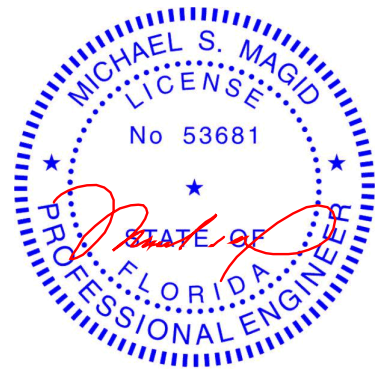

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Jan 6 2022 MiTek Industries, Inc. Tue Jun 7 16:07:08 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zIvaR-VA1 JeCCleAeDjE3pH8wmckrcNMhZsm2G J8oz8nt1

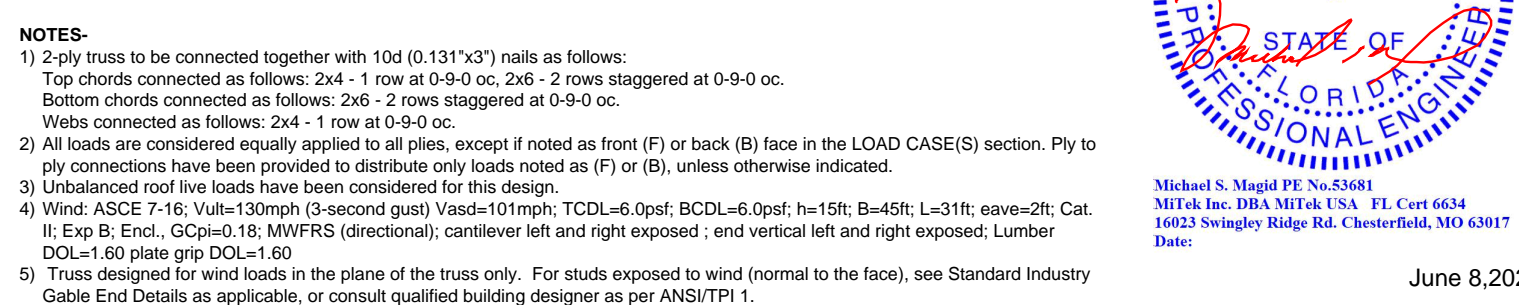

June 8, 2022

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE

Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component
dorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927585
JENNA_PAYNE	B01	GABLE	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Jan 6 2022 MiTek Industries, Inc. Tue Jun 7 16:07:08 2022 Page 2
ID:mN7D32tr4R4?GcknbogKq6zIyaR-VA1_JeCCleAeDjbE3pH8wmckrcNMhZsm2G_J8oz8nt1

- NOTES-**
- 6) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 7) Provide adequate drainage to prevent water ponding.
 - 8) All plates are 2x4 MT20 unless otherwise indicated.
 - 9) Gable studs spaced at 2-0-0 oc.
 - 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 12) Refer to girder(s) for truss to truss connections.
 - 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 96 lb uplift at joint 24 and 207 lb uplift at joint 2.
 - 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 15) Use MiTek HJC26 (With 16-16d nails into Girder & 10d nails into Truss) or equivalent at 6-2-6 from the left end to connect truss(es) J04 (1 ply 2x4 SP), CJ01 (1 ply 2x4 SP) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
 - 16) Fill all nail holes where hanger is in contact with lumber.
 - 17) "NAILED" indicates 3-10d Nails (0.148" x 3") toe-nails per NDS guidelines.
 - 18) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 248 lb down and 50 lb up at 6-2-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.


- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 - Uniform Loads (plf)
 - Vert: 1-4=-60, 22-24=-60, 2-24=-20, 4-5=-60, 21-22=-60, 5-13=-60, 13-21=-60
 - Concentrated Loads (lb)
 - Vert: 4=-174(F) 22=-101(F) 30=-350(F) 26=-54(F) 32=-120(F) 33=-54(F) 34=-54(F) 35=-54(F) 36=-54(F) 37=-54(F) 38=-54(F) 39=-54(F) 40=-54(F) 41=-54(F) 42=-54(F) 43=-61(F) 44=-101(F) 45=-101(F) 46=-101(F) 47=-101(F) 48=-101(F) 49=-101(F) 50=-101(F) 51=-101(F)

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927586
JENNA_PAYNE	B02	Common	2	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:14 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zlyaR-sxs3EpQWYXUiLyQnK0RGwWJl2VMuL0mOimXz5z8zGJ

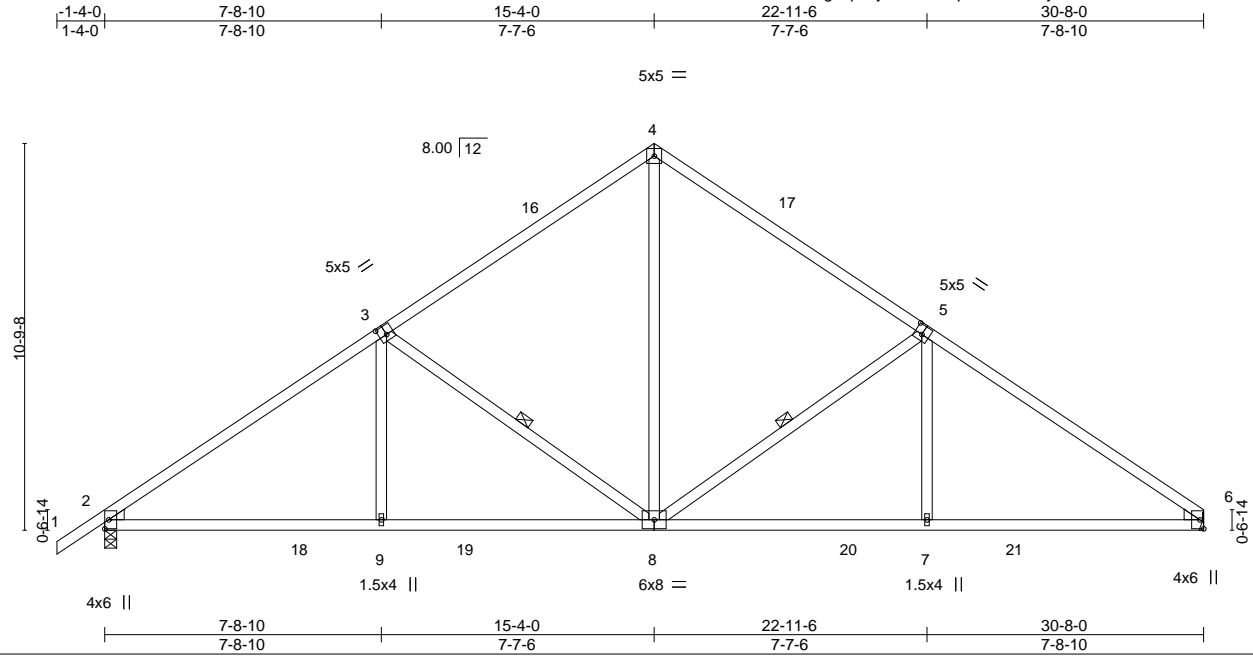

Scale: 3/16"=1'

Plate Offsets (X,Y)-- [3:0-2-8,0-3-0], [5:0-2-8,0-3-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.88	Vert(LL)	-0.16	8-9	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.80	Vert(CT)	-0.32	8-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.27	Horz(CT)	0.06	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TP12014		Matrix-AS						Weight: 162 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-8, 3-8

REACTIONS.


(size) 2=0-4-0, 6=Mechanical
Max Horz 2=205(LC 11)
Max Uplift 2=33(LC 12)
Max Grav 2=1489(LC 17), 6=1413(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1975/52, 3-4=-1335/139, 4-5=-1334/140, 5-6=-1981/56
BOT CHORD 2-9=0/1668, 8-9=0/1663, 7-8=0/1550, 6-7=0/1555
WEBS 4-8=0/935, 5-8=-696/61, 5-7=0/436, 3-8=-689/59, 3-9=0/435

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=31ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-13, Interior(1) 1-8-13 to 15-4-0, Exterior(2R) 15-4-0 to 18-4-13, Interior(1) 18-4-13 to 30-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

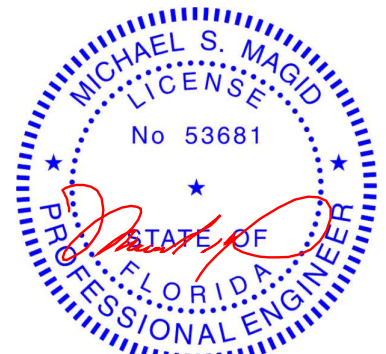

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TP1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927587
JENNA_PAYNE	C01	Common	12	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,


8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:15 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zIyaR-K7QSS9R8JrcZKVXcK1Ygp73dzRxwdn8vcMW5VXz8zGI



4x4 =

Scale: 1/4"=1'

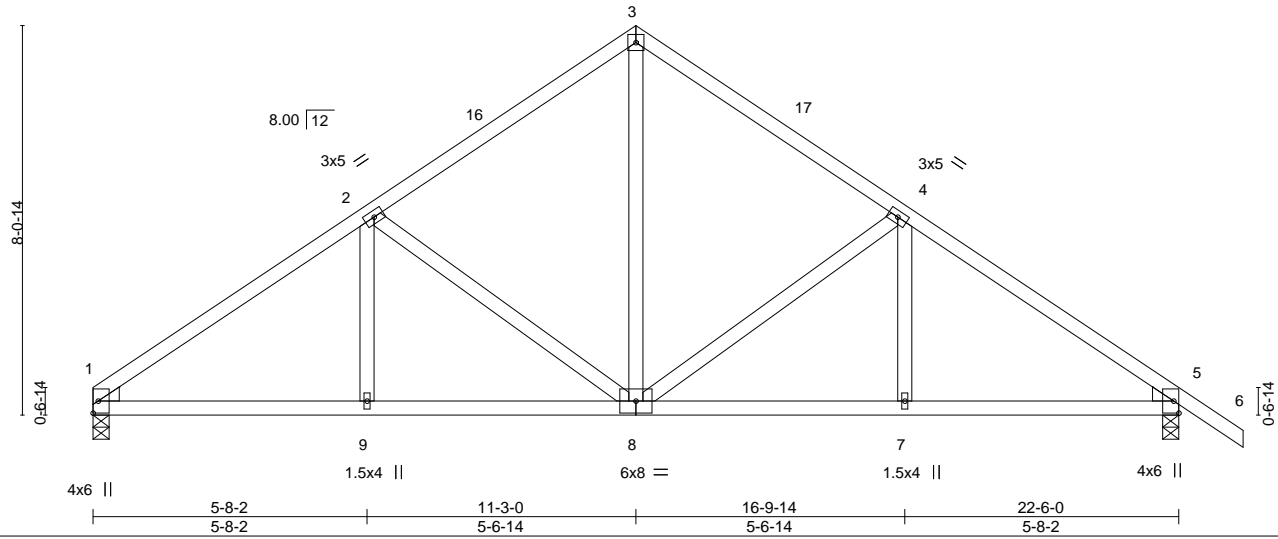

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.27	Vert(LL)	-0.05	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.40	Vert(CT)	-0.11	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.35	Horz(CT)	0.03	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 120 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE

Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 1=0-4-0, 5=0-4-0
Max Horz 1=150(LC 10)
Max Uplift 5=34(LC 12)
Max Grav 1=898(LC 1), 5=982(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1275/60, 2-3=-895/113, 3-4=-894/110, 4-5=-1266/53
BOT CHORD 1-9=0/994, 8-9=0/994, 7-8=0/984, 5-7=0/984
WEBS 3-8=-23/562, 4-8=-413/69, 2-8=-425/72

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl. GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-3-0, Exterior(2R) 11-3-0 to 14-3-0, Interior(1) 14-3-0 to 23-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

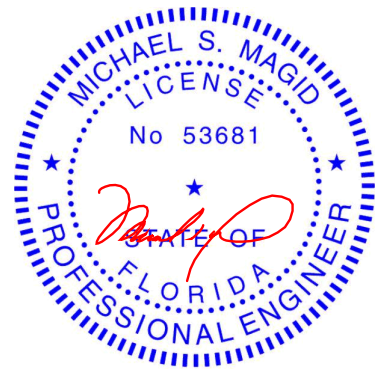

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927589
JENNA_PAYNE	C03	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:17 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zlyar-GWYCtrSorSstHap?SSa8uY8vQFW45g2C4g?BaQz8zGG

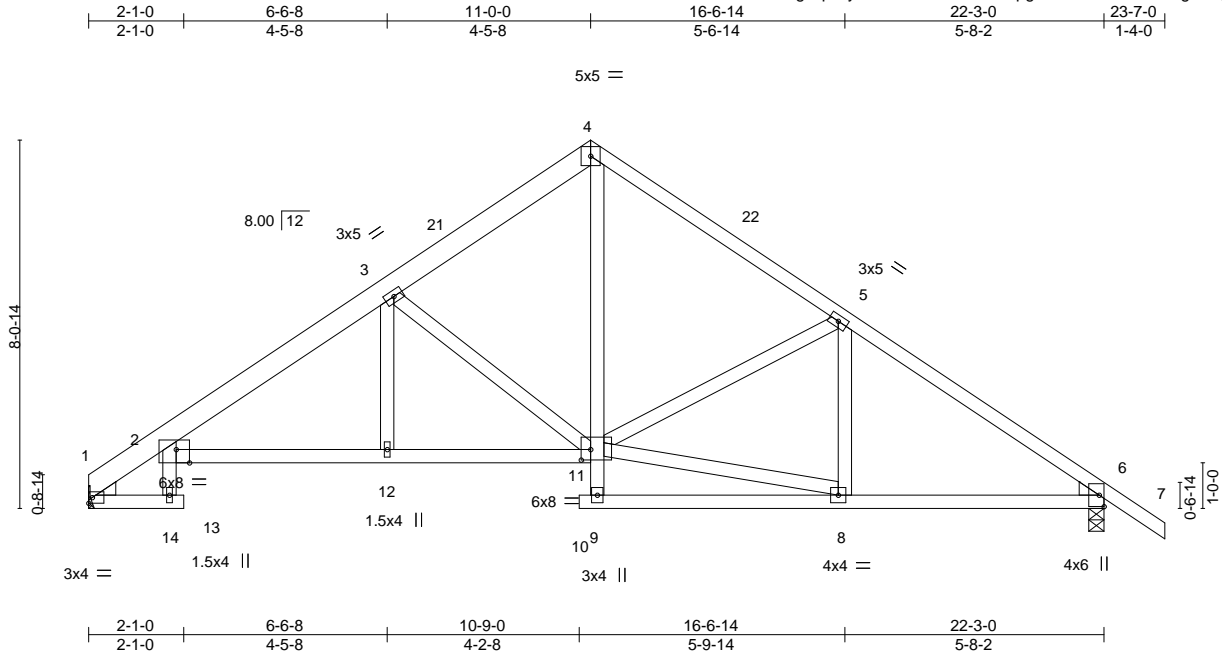

Scale = 1:50.5

Plate Offsets (X,Y)-- [2:0-3-8,Edge], [11:0-2-8,0-2-12]

LOADING (psf)	SPACING-	CSL.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.53	Vert(LL)	-0.14	2-12	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.80	Vert(CT)	-0.29	2-12	>922	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.38	Horz(CT)	0.22	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS						Weight: 137 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP SS *Except*
4-7: 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied. Except:
10-0-0 oc bracing: 9-11

REACTIONS.


(size) 1=Mechanical, 6=0-4-0
Max Horz 1=-148(LC 10)
Max Uplift 6=-31(LC 12)
Max Grav 1=901(LC 1), 6=977(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-16=-553/46, 2-3=-1424/44, 3-4=-1008/91, 4-5=-1006/84, 5-6=-1253/50
BOT CHORD 2-12=0/1254, 11-12=0/1252, 4-11=-3/774, 6-8=0/974
WEBS 8-11=0/890, 5-11=-282/82, 3-11=-668/55

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCp=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-0-0, Exterior(2R) 11-0-0 to 14-0-0, Interior(1) 14-0-0 to 23-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

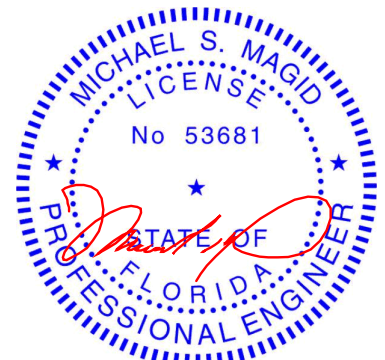

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927590
JENNA_PAYNE	C04	Common	4	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:18 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyaR-ki6a4BT0cm_8ByFB095NQmh8Jfyhq72MIKKi6sz8zGF

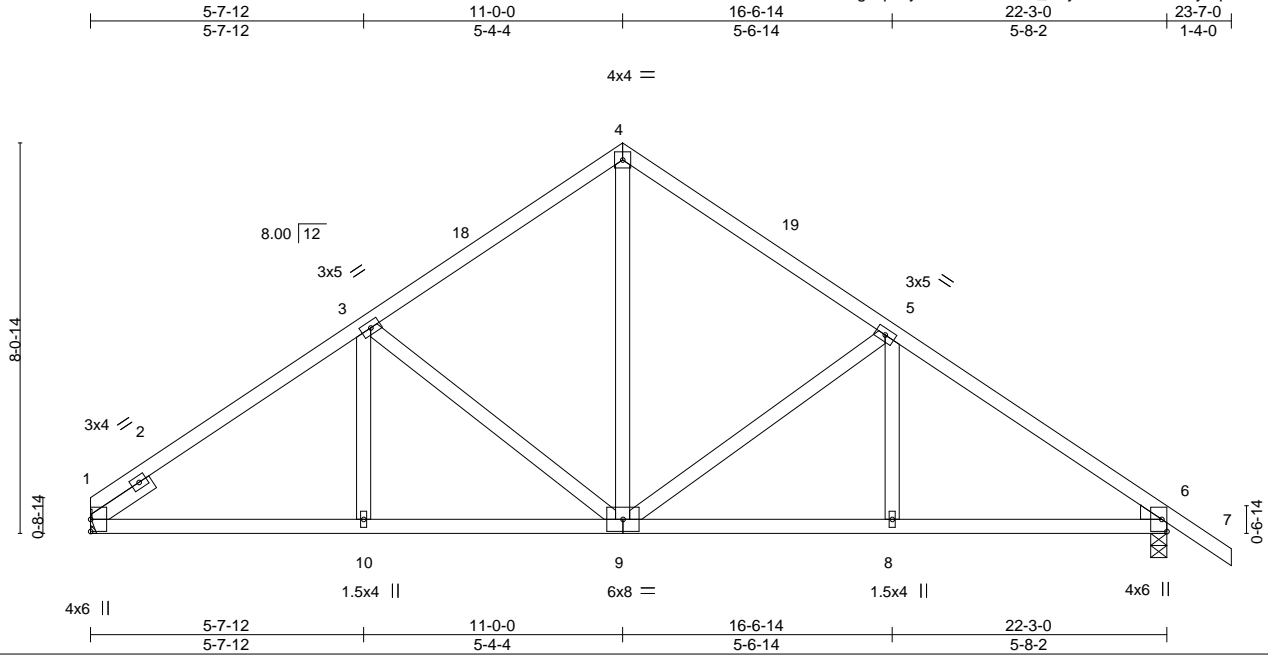

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.27	Vert(LL)	-0.05	8-9	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.40	Vert(CT)	-0.11	8-9	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.34	Horz(CT)	0.03	6	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS					Weight: 121 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Right: 2x4 SP No.2
SLIDER Left 2x4 SP No.2 1-6-0

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 1=Mechanical, 6=0-4-0
Max Horz 1=-148(LC 10)
Max Uplift 6=-34(LC 12)
Max Grav 1=888(LC 1), 6=972(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-1195/60, 3-4=-870/113, 4-5=-877/110, 5-6=-1249/53
BOT CHORD 1-10=0/930, 9-10=0/930, 8-9=0/970, 6-8=0/970
WEBS 3-9=-381/70, 4-9=-25/544, 5-9=-413/70

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-0-0, Exterior(2R) 11-0-0 to 14-0-0, Interior(1) 14-0-0 to 23-7-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

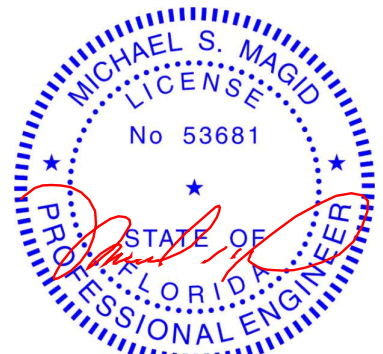

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927591
JENNA_PAYNE	C05	Common	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:20 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zIyaR-h5DLVtVH8NEsRGPa7a7rWBmRBSb1I0fmeDrAkz8zGD

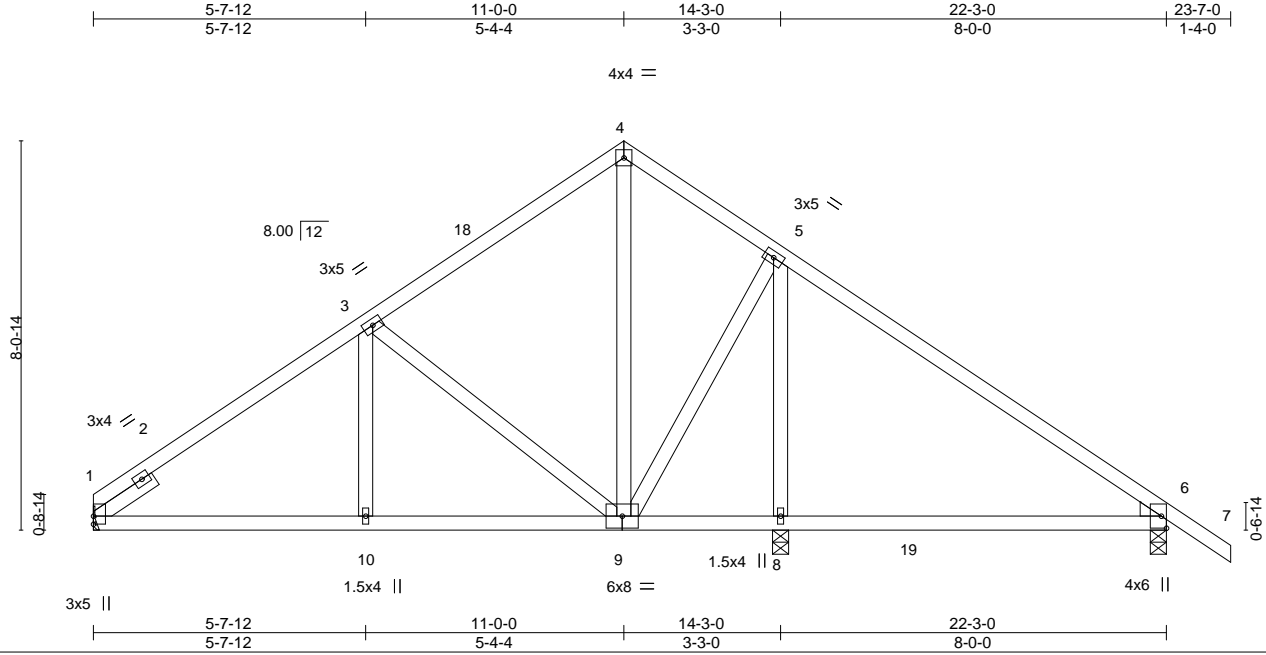

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.50	Vert(LL)	-0.12	8-17	>782	240	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.60	Vert(CT)	-0.24	8-17	>406	180		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.39	Horz(CT)	0.01	8	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS						Weight: 122 lb	FT = 20%
	Code FBC2020/TPI2014								

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2
 WEDGE
 Right: 2x4 SP No.2
 SLIDER Left 2x4 SP No.2 1-6-0

BRACING-

TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 1=Mechanical, 8=0-4-0, 6=0-4-0
 Max Horz 1=-148(LC 10)
 Max Uplift 1=-20(LC 12), 6=-73(LC 12)
 Max Grav 1=701(LC 17), 8=782(LC 17), 6=612(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-859/88, 3-4=-498/141, 4-5=-484/155, 5-6=-452/114
 BOT CHORD 1-10=0/756, 9-10=0/756, 8-9=0/299, 6-8=0/299
 WEBS 3-9=-498/73, 4-9=-105/337, 5-8=-479/26

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 11-0-0, Exterior(2R) 11-0-0 to 14-3-0, Interior(1) 14-3-0 to 23-7-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

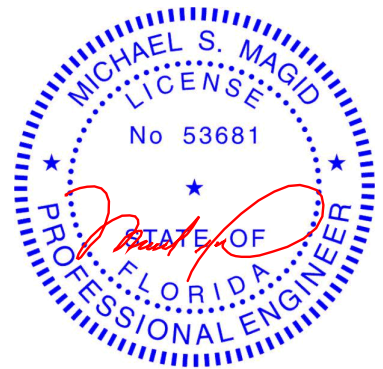

Michael S. Magid PE No.53681
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927592
JENNA_PAYNE	C6GE	Common Supported Gable	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

ID:mN7D32tr4R4?GcknbogKq6zlyar-wvxXUAuOOLgvOgiyiVGk24tUNeuBmQAE0O99WEz8nqs

8.530 s Jan 6 2022 MiTek Industries, Inc. Tue Jun 7 16:09:27 2022 Page 1



Scale = 1:50.7

Plate Offsets (X,Y)-- [1:0-3-12,Edge], [1:0-0-1,0-3-0], [14:0-3-3,0-1-14], [14:0-2-1,0-5-14]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.21	Vert(LL)	-0.01 15 n/r 120	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.05	Vert(CT)	-0.02 15 n/r 120		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.00 14 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-S				Weight: 140 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.2
 WEDGE
 Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.


REACTIONS.

All bearings 22-6-0.
 (lb) - Max Horz 1=146(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 14, 21, 22, 24, 25, 19, 18, 17, 16
 Max Grav All reactions 250 lb or less at joint(s) 1, 20, 21, 22, 24, 25, 19, 18, 17, 16 except 14=265(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) 0-8-6 to 3-8-6, Exterior(2N) 3-8-6 to 11-3-0, Corner(3R) 11-3-0 to 14-3-0, Exterior(2N) 14-3-0 to 23-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2'-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 21, 22, 24, 25, 19, 18, 17, 16.

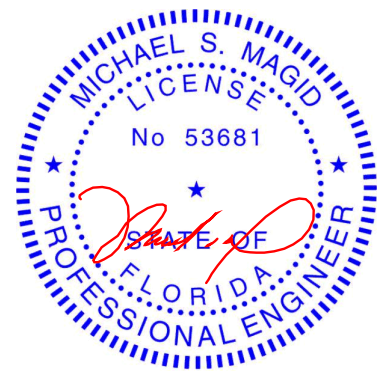

Michael S. Magid PE No.53681
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927593
JENNA_PAYNE	C7SR	GABLE	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:22 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyaR-dUL5wYWXf_UagaZyF?AJbcrctGOOm?PxDyiyFdz8zGB

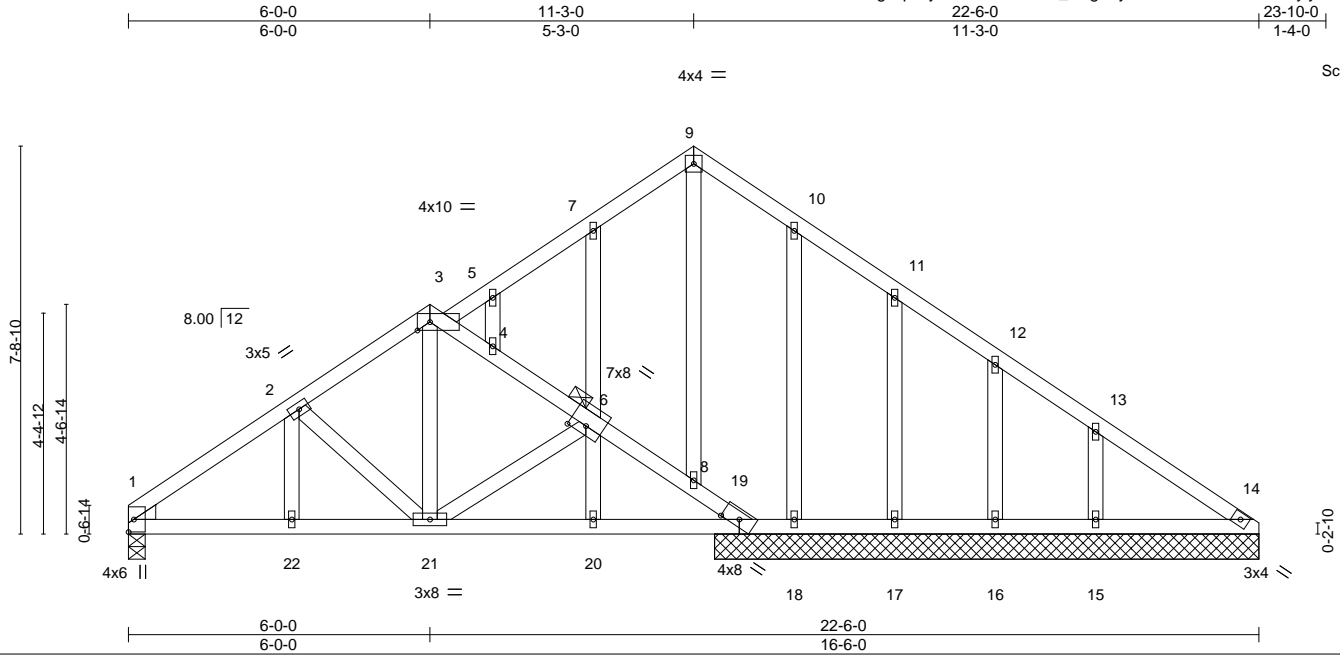


Plate Offsets (X,Y)-- [3:0-3-0,Edge], [6:0-4-0,0-2-0], [19:0-4-3,0-1-11]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.12	Vert(LL)	-0.01 21	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.15	Vert(CT)	-0.02 20-21	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.12	Horz(CT)	-0.01 1	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 147 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 6

REACTIONS.


- All bearings 10-10-0 except (jt=length) 1=0-4-0.
(lb) - Max Horz 19=-136(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 18, 17, 16, 15
Max Grav All reactions 250 lb or less at joint(s) 18, 17, 16, 14 except 1=451(LC 1),
15=257(LC 18), 19=598(LC 1)

FORCES.

- (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-600/40, 2-3=-422/58, 3-4=-420/100, 4-6=-432/111, 6-8=-635/142, 8-19=-726/123
BOT CHORD 1-22=0/443, 21-22=0/443, 20-21=0/485, 19-20=0/485
WEBS 3-21=-33/304

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) 0-2-0 to 3-3-0, Exterior(2N) 3-3-0 to 11-3-0, Corner(3R) 11-3-0 to 14-3-0, Exterior(2N) 14-3-0 to 22-4-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18, 17, 16, 15.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

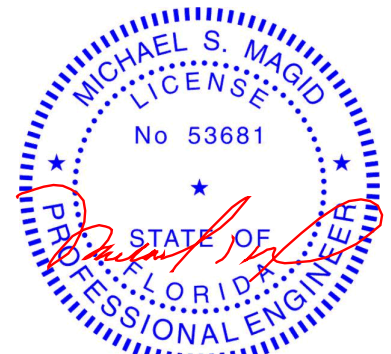

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927594
JENNA_PAYNE	C8GE	GABLE	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:24 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyaR-ZsTrLEynBclvtjLMQCng1xEf45nEwOEhGB3JWz8zG9

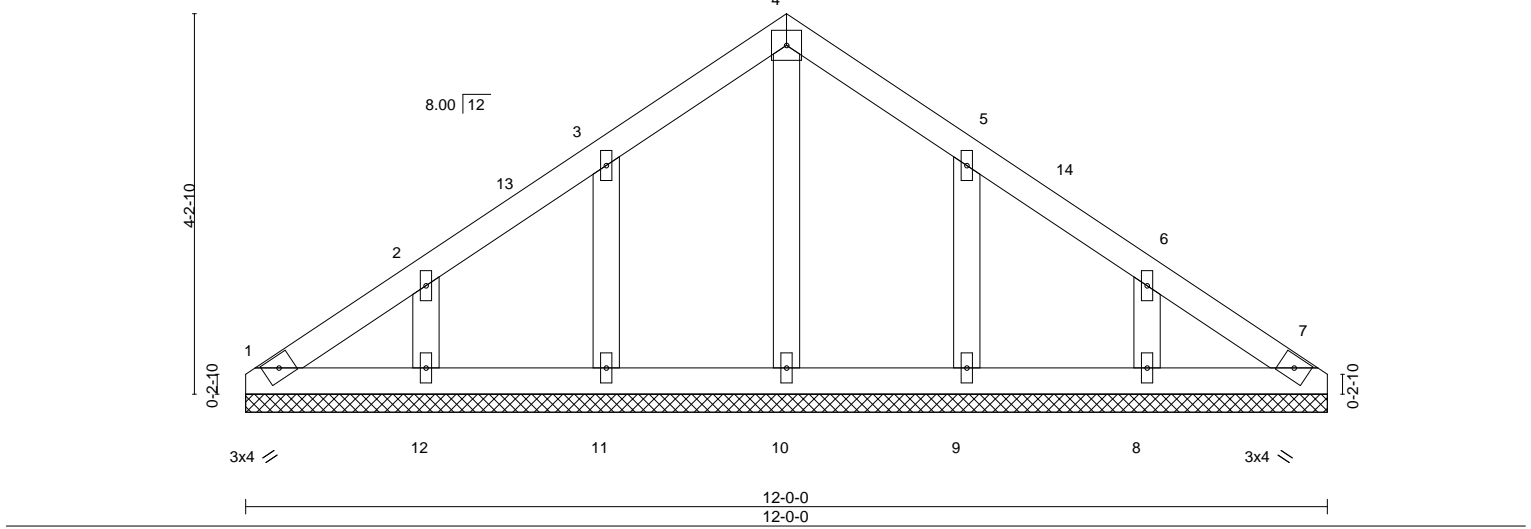

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.02	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 54 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 12-0-0.
(lb) - Max Horz 1=-72(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 11, 12, 9, 8
Max Grav All reactions 250 lb or less at joint(s) 1, 7, 10, 11, 12, 9, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) 0-1-13 to 3-1-13, Exterior(2N) 3-1-13 to 6-0-0, Corner(3R) 6-0-0 to 9-0-0, Exterior(2N) 9-0-0 to 11-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 12, 9, 8.

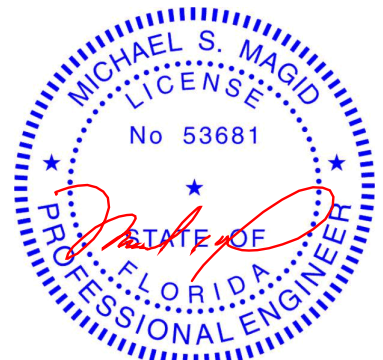

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927595
JENNA_PAYNE	CJ01	Diagonal Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:25 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyar-131EYaZPyvt9X1HXw7j0DETIWTKbzL9Ovwxcysz8zG8

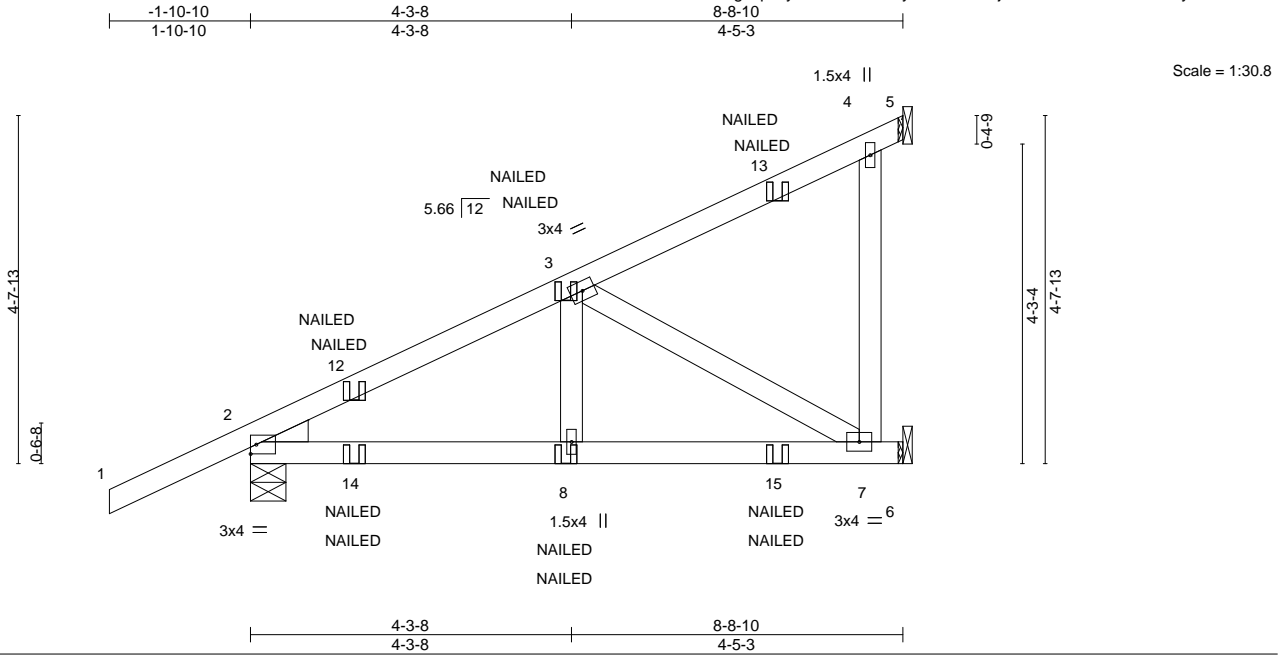

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.46	Vert(LL)	-0.03	7-8	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.51	Vert(CT)	-0.07	7-8	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.18	Horz(CT)	-0.01	5	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MP					Weight: 47 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=Mechanical, 2=0-5-11, 6=Mechanical
Max Horz 2=130(LC 8)
Max Uplift 2=-34(LC 8), 6=-112(LC 8)
Max Grav 5=189(LC 3), 2=505(LC 1), 6=324(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-547/0
BOT CHORD 2-8=-35/447, 7-8=-35/447
WEBS 3-7=-513/40

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 6=112.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 6-9=-20
Concentrated Loads (lb)
Vert: 8=-10(F=-5, B=-5) 13=-84(F=-42, B=-42) 15=-63(F=-32, B=-32)

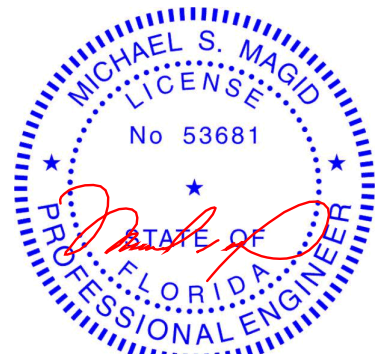

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927596
JENNA_PAYNE	D01	Common	3	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:26 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyaR-VFacmwZ1jD?09BsJUrEFIS0U3tiBiqKX8agAOOz8zG7

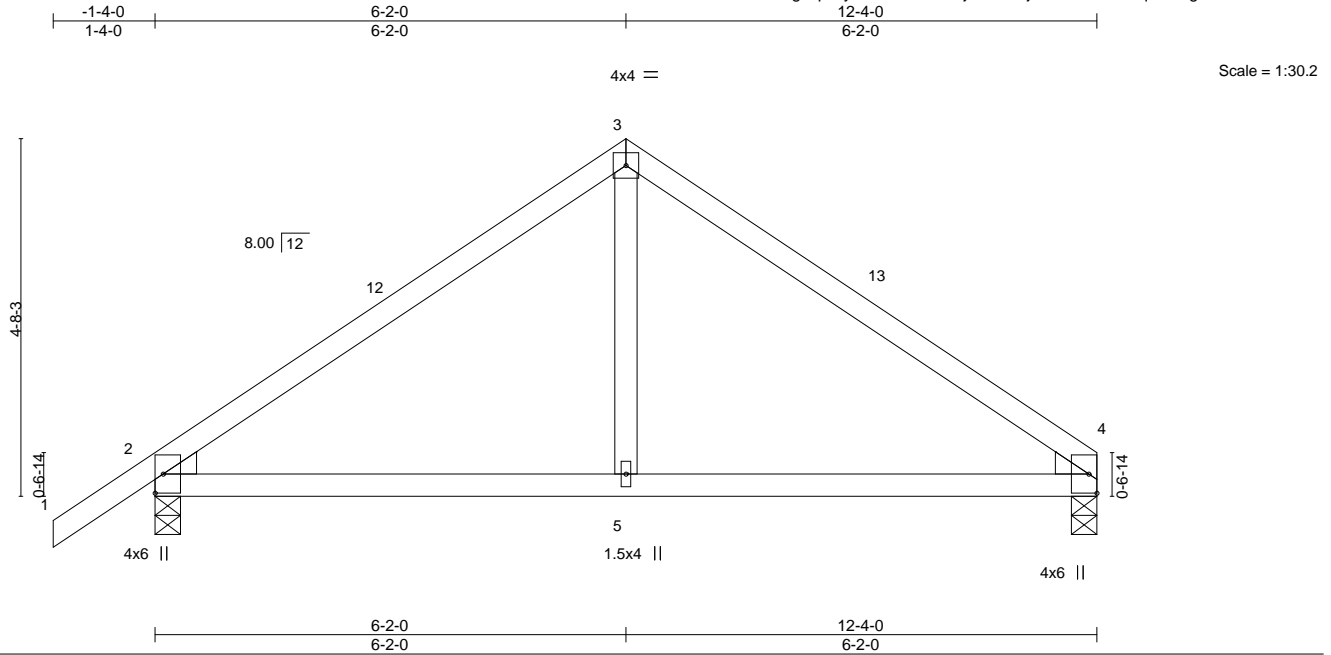

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.35	Vert(LL)	-0.04	5-11	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.36	Vert(CT)	-0.07	5-11	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.06	Horz(CT)	0.01	2	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS					Weight: 51 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 2=0-4-0, 4=0-4-0
Max Horz 2=87(LC 11)
Max Uplift 2=-35(LC 12)
Max Grav 2=578(LC 1), 4=489(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-571/94, 3-4=-568/96
BOT CHORD 2-5=0/402, 4-5=0/402
WEBS 3-5=0/270

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 6-2-0, Exterior(2R) 6-2-0 to 9-2-0, Interior(1) 9-2-0 to 12-4-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927597
JENNA_PAYNE	D02	Common Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:35 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zIyaR-I_d?e?ghc_7kka2SVEvMdLu4vVigJpgsDTM8CNz8zG_

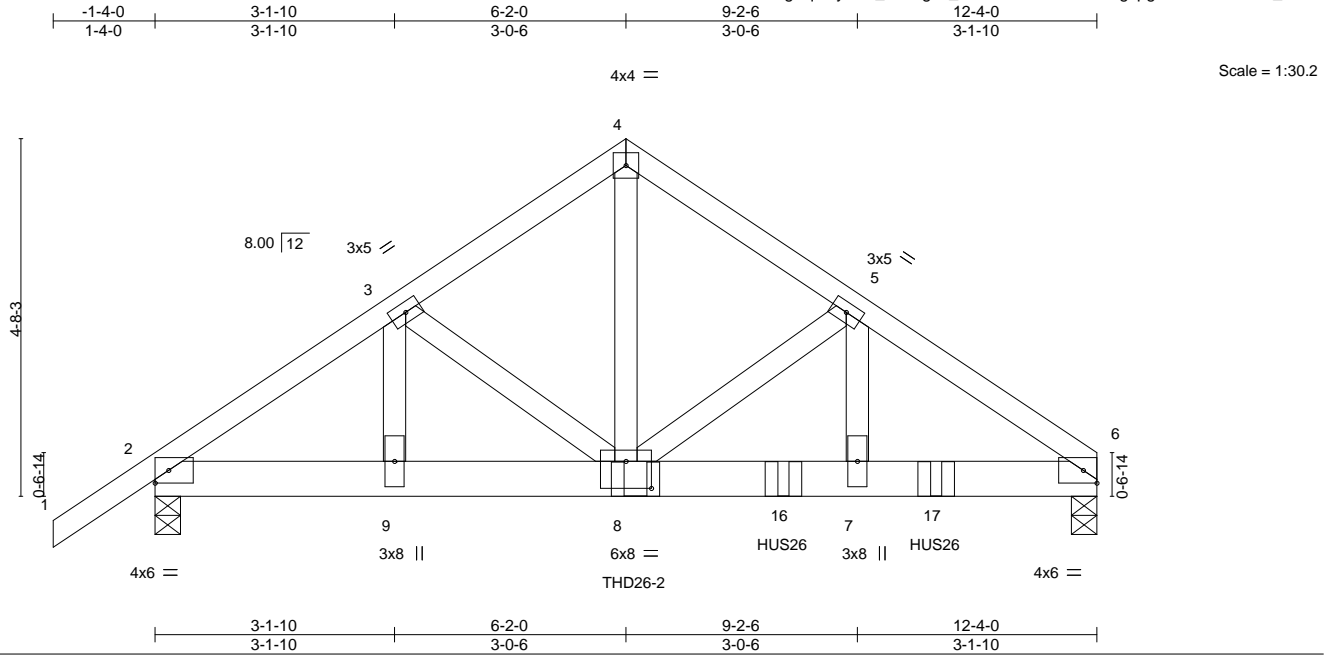


Plate Offsets (X,Y)-- [8:0-4-0,0-4-4]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.15	Vert(LL)	-0.03	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25		BC 0.65	Vert(CT)	-0.07	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr NO		WB 0.37	Horz(CT)	0.02	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TP12014		Matrix-MS						Weight: 151 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-9-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=0-4-0, 2=0-4-0
Max Horz 2=87(LC 24)
Max Grav 6=3295(LC 2), 2=2141(LC 1)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3136/0, 3-4=-3217/0, 4-5=-3215/0, 5-6=-4774/0
BOT CHORD 2-9=0/2551, 8-9=0/2551, 7-8=0/3924, 6-7=0/3924
WEBS 4-8=0/3304, 5-8=-1711/0, 5-7=0/1849, 3-9=-254/0

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Use MiTek THD26-2 (With 18-16d nails into Girder & 12-10d nails into Truss) or equivalent at 6-3-8 from the left end to connect truss(es) to back face of bottom chord.
- Use MiTek HUS26 (With 14-16d nails into Girder & 6-16d nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 8-2-12 from the left end to 10-2-12 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-60, 4-6=-60, 10-13=-20

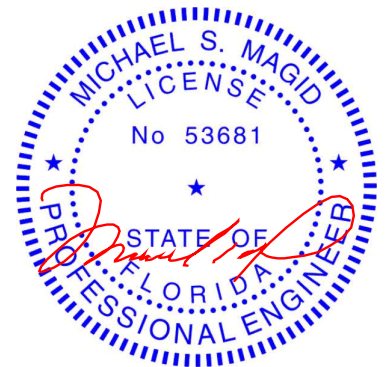

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927597
JENNA_PAYNE	D02	Common Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,



8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:35 2022 Page 2
ID:mN7D32tr4R4?GcknbogKq6zIyaR-I_d?e?ghc_7kka2SVEvMdLu4vVigJpgsDTM8CNz8zG_

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 8=-1914(B) 16=-1205(B) 17=-1205(B)

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927598
JENNA_PAYNE	D3GE	GABLE	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:36 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyar-DABOsLhJMIFbLkde3xQb9ZQHEvBX2LL?R75ikpz8zFz

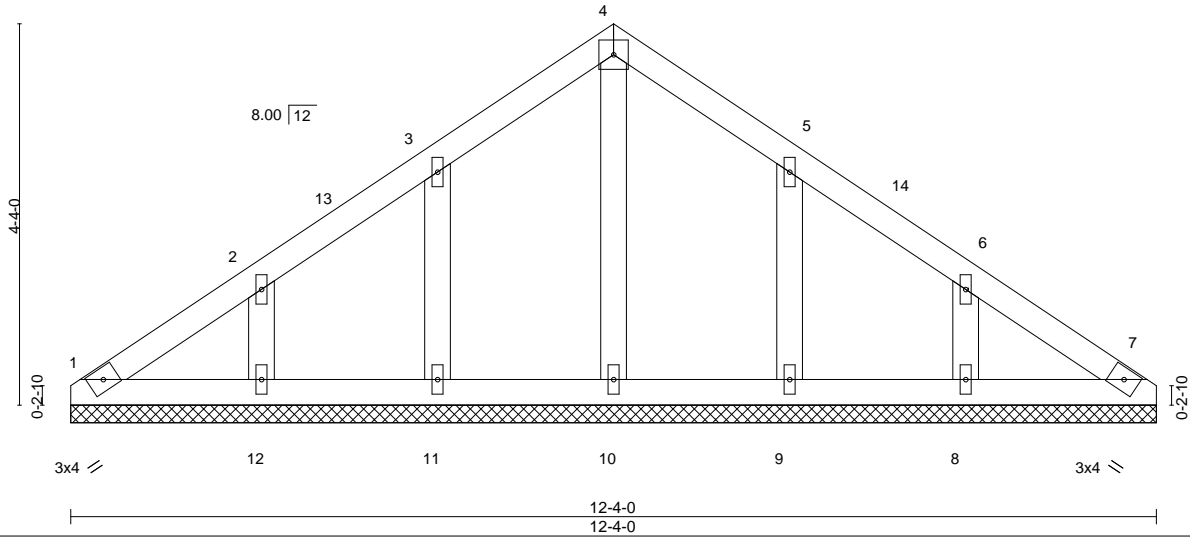

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 56 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.


REACTIONS.

All bearings 12'-4".
(lb) - Max Horz 1=-74(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 11, 12, 9, 8
Max Grav All reactions 250 lb or less at joint(s) 1, 7, 10, 11, 12, 9, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) 0-1-13 to 3-1-13, Exterior(2N) 3-1-13 to 6-2-0, Corner(3R) 6-2-0 to 9-2-0, Exterior(2N) 9-2-0 to 12-2-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2'-0" oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 12, 9, 8.

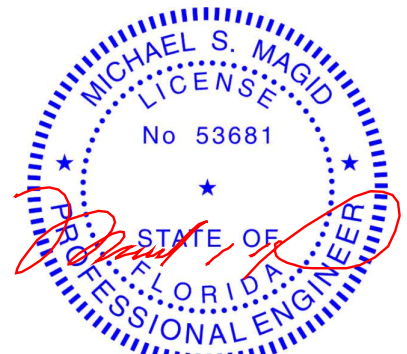

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE
JENNA_PAYNE	GDR1	Roof Special Girder	1	2	T27927599

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:37 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zlyar-hMlm3hix7bNSztCrdfxqimzOqJMGnfC9gnrFGFz8zFy

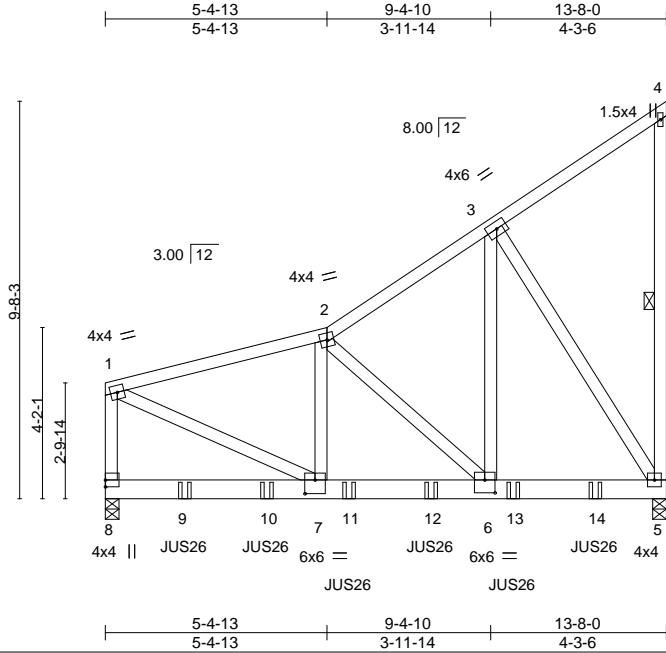

Scale = 1:56.1

Plate Offsets (X,Y)-- [6:0-3-0,0-3-12], [7:0-3-0,0-4-0]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.31	Vert(LL) -0.05	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.71	Vert(CT) -0.10	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.63	Horz(CT) 0.01	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TP12014	Matrix-MS					Weight: 224 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 5=0-4-0, 8=0-4-0
Max Horz 8=270(LC 5)
Max Grav 5=2969(LC 1), 8=3080(LC 1)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-3222/0, 2-3=-1953/0, 1-8=-2371/0
BOT CHORD 6-7=0/3052, 5-6=0/1582
WEBS 2-7=0/876, 2-6=-2028/0, 3-6=0/3208, 3-5=-2909/0, 1-7=0/3274

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Use MiTek JUS26 (With 4-10d nails into Girder & 4-10d nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-11-4 from the left end to 11-11-4 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-2=-60, 2-4=-60, 5-8=-20
Concentrated Loads (lb)
Vert: 9=-881(B) 10=-868(B) 11=-868(B) 12=-868(B) 13=-868(B) 14=-628(B)

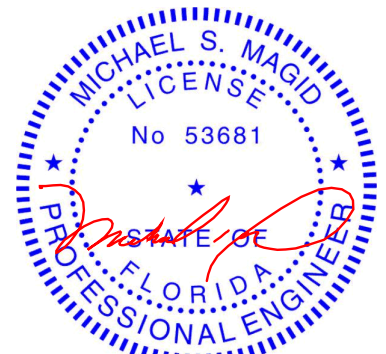

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:38 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyar-9ZJ8H0jZuvVJb1n1BMS3E_WbRjtIWFEIvRaooiz8zFx




LUMBER- TOP CHORD 2x4 SP No.2 BOT CHORD 2x4 SP No.2 WEDGE Left: 2x4 SP No.2	BRACING- TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
--	--

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl.; GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Leading Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.

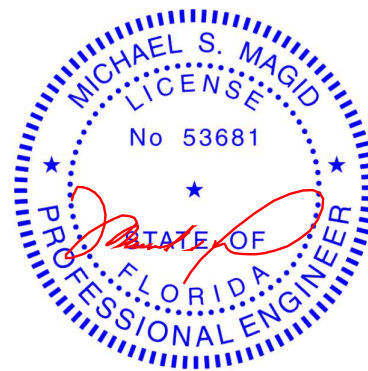

June 8, 2022



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE
JENNA_PAYNE	J02	Jack-Open	2	1	T27927601

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:39 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyaR-dltWUMjBfDe9CBMDk4zlnB2nP7CYFIUS75KMK8z8zFw

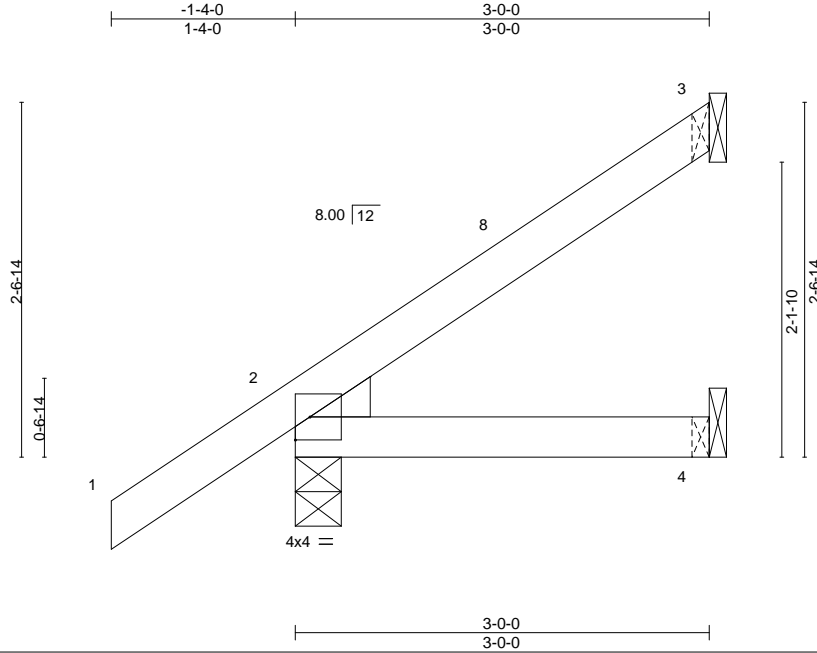

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.11	Vert(LL)	-0.00	4-7	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.08	Vert(CT)	-0.01	4-7	>999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=80(LC 12)
Max Uplift 3=-21(LC 12), 2=-23(LC 12)
Max Grav 3=69(LC 17), 2=216(LC 1), 4=52(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 2-11-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.

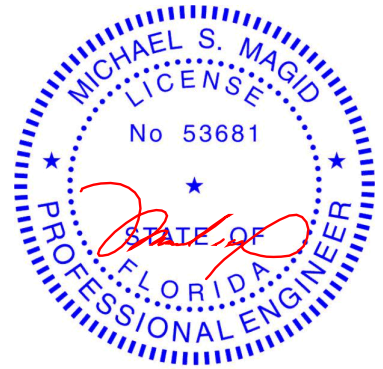

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927602
JENNA_PAYNE	J03	Jack-Open	2	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:40 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zIyaR-5xRuikqQWm0qLxQlnUXKPbvWWWD_9jbMI3vtaz8zFv

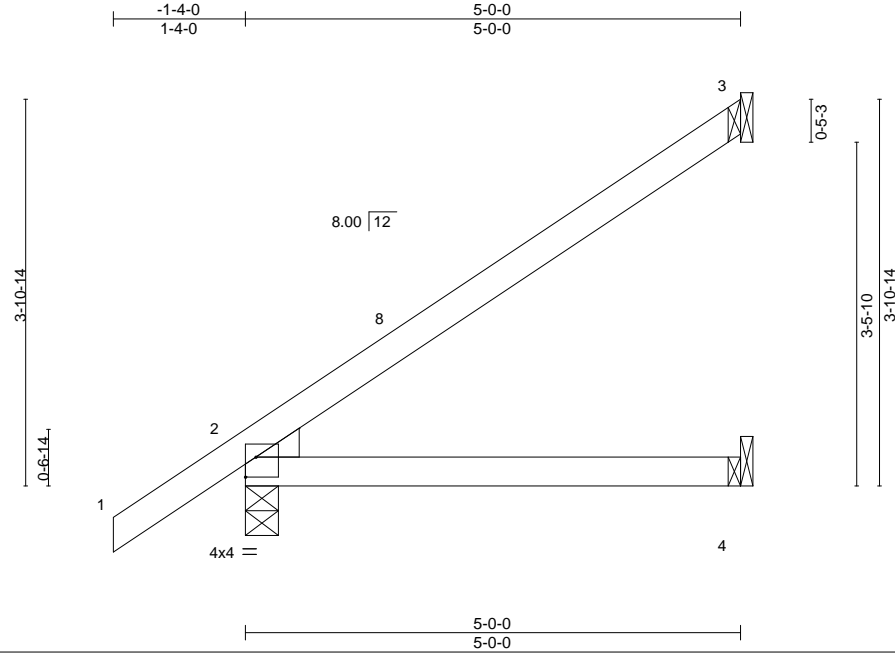

Scale = 1:23.3

Plate Offsets (X,Y)-- [2:Edge,0-2-7]

LOADING (psf)	SPACING-	CSL.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.28	Vert(LL)	0.03	4-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.24	Vert(CT)	-0.05	4-7	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT)	0.01	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS						Weight: 20 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=111(LC 12)
Max Uplift 3=41(LC 12), 2=-8(LC 12)
Max Grav 3=130(LC 17), 2=288(LC 1), 4=89(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 4-11-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

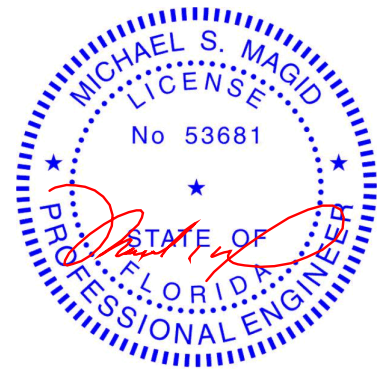

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927603
JENNA_PAYNE	J04	Jack-Open	13	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:41 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zlyaR-Z8_Hv2ISBqtSVWcsU?nsc81dwpCjczkbPpTP1z8zFu



Scale = 1:27.4

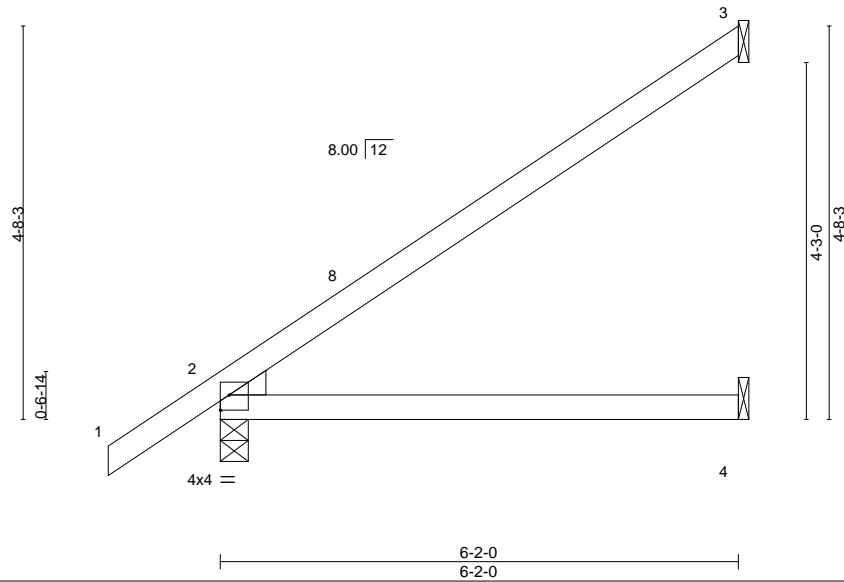


Plate Offsets (X,Y)-- [2:Edge,0-2-3]

LOADING (psf)	SPACING-	CSL.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.45	Vert(LL)	0.06	4-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.39	Vert(CT)	-0.13	4-7	>568	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT)	0.02	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS						Weight: 24 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=130(LC 12)
Max Uplift 3=-53(LC 12), 2=-1(LC 12)
Max Grav 3=165(LC 17), 2=333(LC 1), 4=110(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 6-1-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

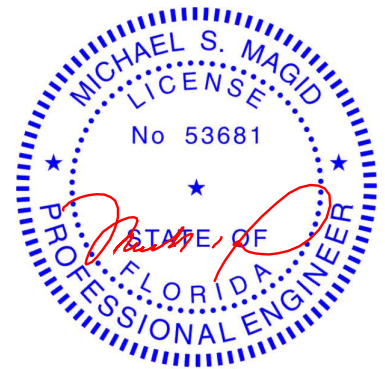

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927604
JENNA_PAYNE	V01	Valley	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Jan 6 2022 MiTek Industries, Inc. Tue Jun 7 16:11:02 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zlyaR-eBASQf2_eXeRIGUDmyT0P6lixxGNWOADsgghMEz8npN

9-7-7	19-6-11	33-1-2
9-7-7	9-11-3	13-6-8

Scale = 1:59.4

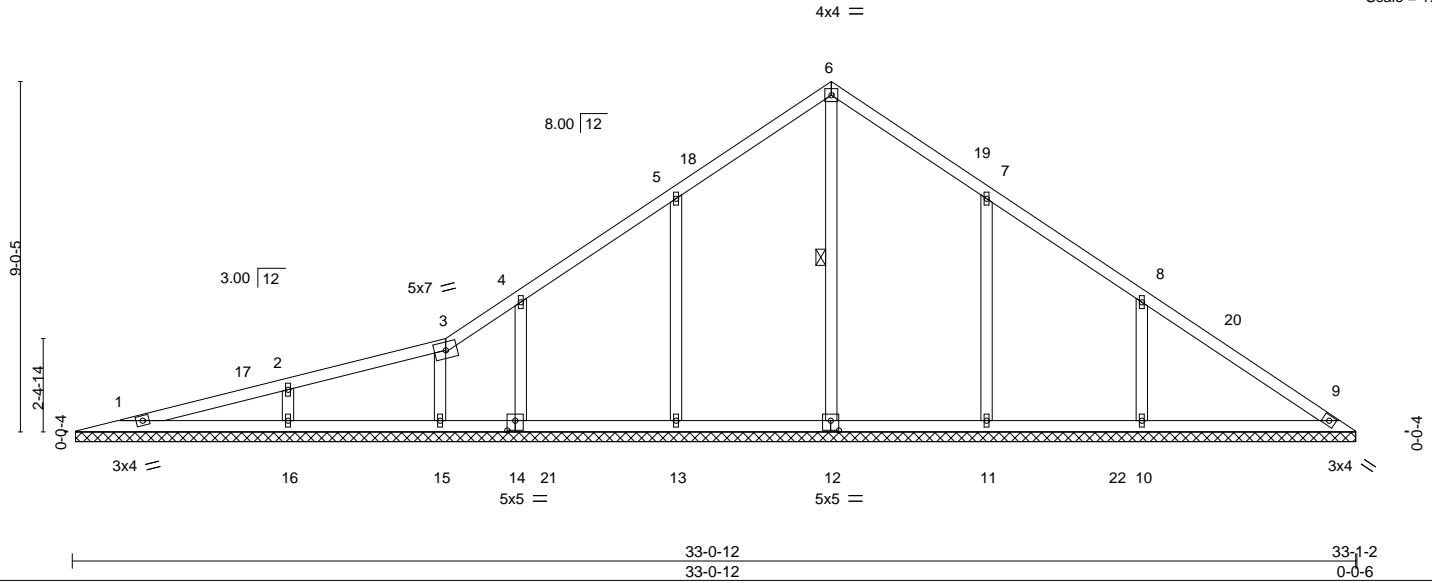


Plate Offsets (X,Y)-- [12:0-2-8,0-3-0], [14:0-2-8,0-3-0]		33-0-12		33-1-2	
		33-0-12		0-0-6	
LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.30	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.25	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.17	Vert(CT) n/a - n/a 999		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S	Horz(CT) 0.00 9 n/a n/a		
				Weight: 146 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-12

REACTIONS.


All bearings 32-11-12.
(lb) - Max Horz 1=163(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 14, 13, 11, 10, 16
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 15 except 14=284(LC 17), 12=327(LC 17), 13=526(LC 17), 11=455(LC 18), 10=526(LC 18), 16=430(LC 17)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 5-13=-274/154, 8-10=-319/162, 2-16=-300/101

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=33ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 1-3-0 to 4-6-10, Interior(1) 4-6-10 to 19-6-11, Exterior(2R) 19-6-11 to 22-10-4, Interior(1) 22-10-4 to 32-7-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 13, 11, 10, 16.

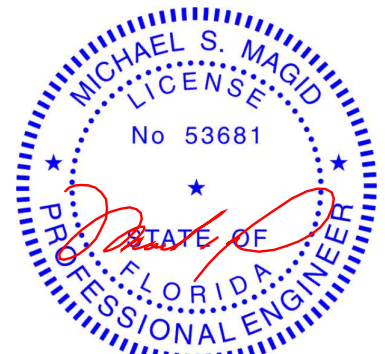

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927605
JENNA_PAYNE	V02	Valley	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:43 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zIyaR-VWW61KkmijR8bhog_zv2Fx1DREkXiBUu12jIZTvz8zFs

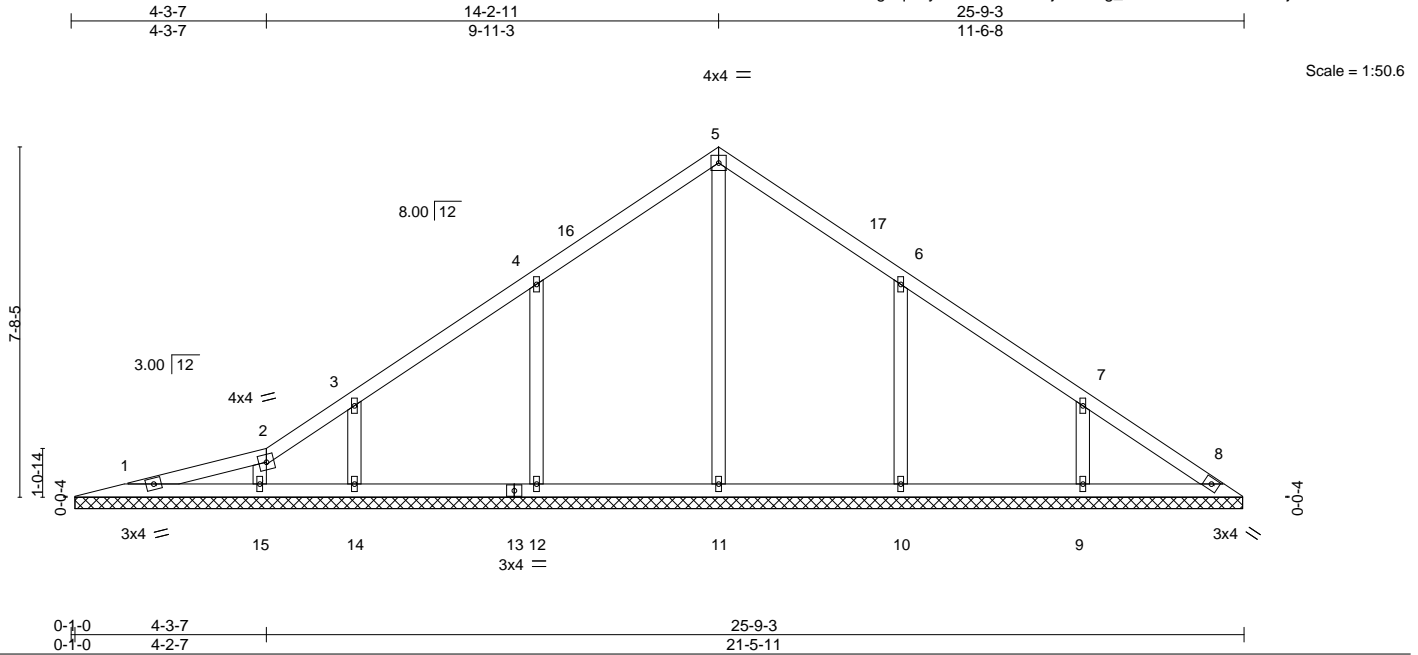

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.19	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.19	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.17	Horz(CT)	0.00	8	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 111 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
6-0-0 oc bracing: 1-15.

REACTIONS.


All bearings 25-7-13.
(lb) - Max Horz 1=136(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 12, 14, 10, 9
Max Grav All reactions 250 lb or less at joint(s) 1, 8, 15 except 11=384(LC 17), 12=427(LC 17), 14=301(LC 17), 10=431(LC 18), 9=368(LC 18)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 4-12=271/152, 6-10=264/149

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=26ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 1-3-0 to 4-3-7, Interior(1) 4-3-7 to 14-2-11, Exterior(2R) 14-2-11 to 17-2-11, Interior(1) 17-2-11 to 25-3-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 1.5x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 14, 10, 9.

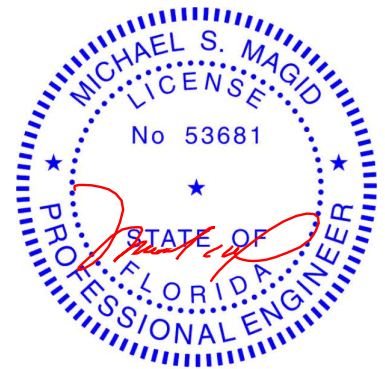

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:44 2022 Page 1
ID:mN7D32tr4R4?GcknbogKq6zIyaR_-igPX4nKUIGSJyEBXdZUUFmaM8stwyFBHN170Lz8zFr
9-6-8 19-1-0
9-6-8 9-6-8

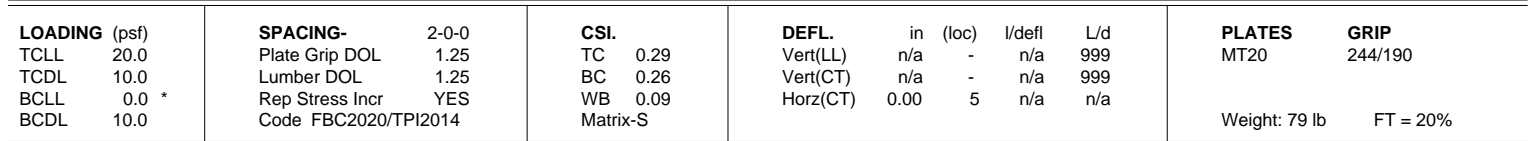

June 8, 2022




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927608
JENNA_PAYNE	V05	Valley	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:46 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zlyAR-w5oAypma0MWAYGOZf2byZgrv7xYPOtLUlhWE4Ez8zFp

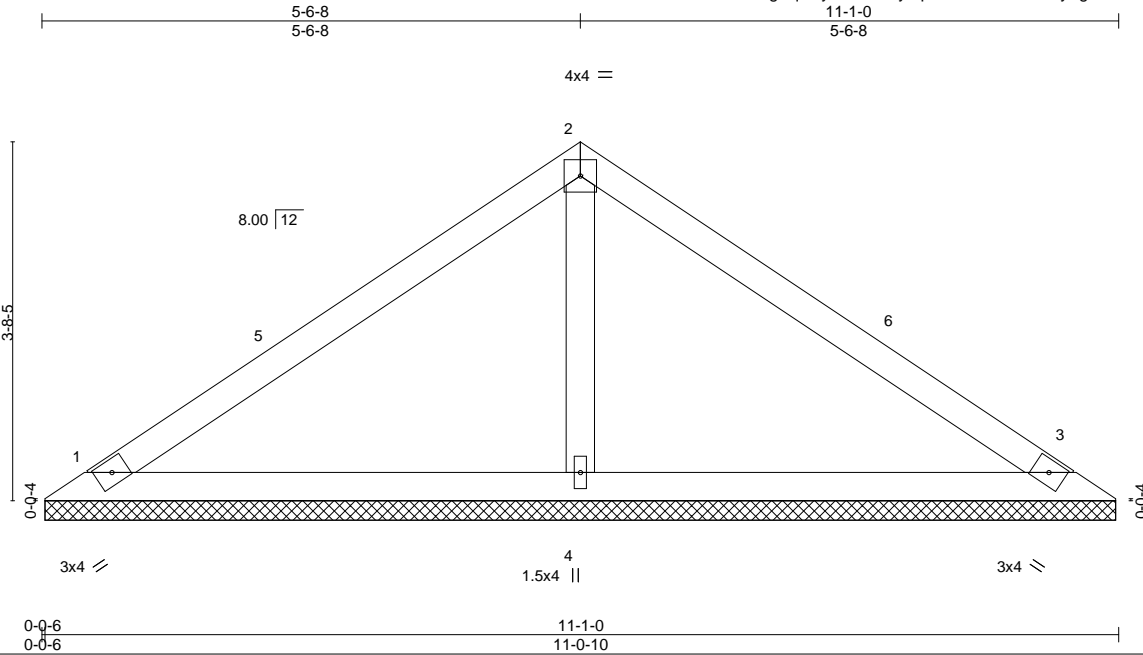

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.34	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.26	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.06	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S						Weight: 39 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=11-0-4, 3=11-0-4, 4=11-0-4
Max Horz 1=62(LC 11)
Max Uplift 1=-13(LC 12), 3=-13(LC 12)
Max Grav 1=197(LC 1), 3=197(LC 1), 4=415(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-265/80

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 5-6-8, Exterior(2R) 5-6-8 to 8-6-8, Interior(1) 8-6-8 to 10-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

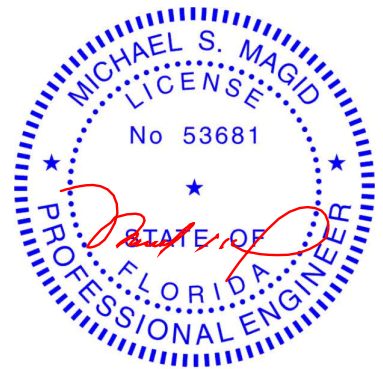

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	JENNA PAYNE	T27927609
JENNA_PAYNE	V06	GABLE	1	1	Job Reference (optional)	


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Mon Jun 6 15:09:47 2022 Page 1

ID:mN7D32tr4R4?GcknbogKq6zIyaR-OHMYA5qDnge1AQzmCl6B6tO7gLxE7KAdzLGncgz8zFo



Scale = 1:16.7

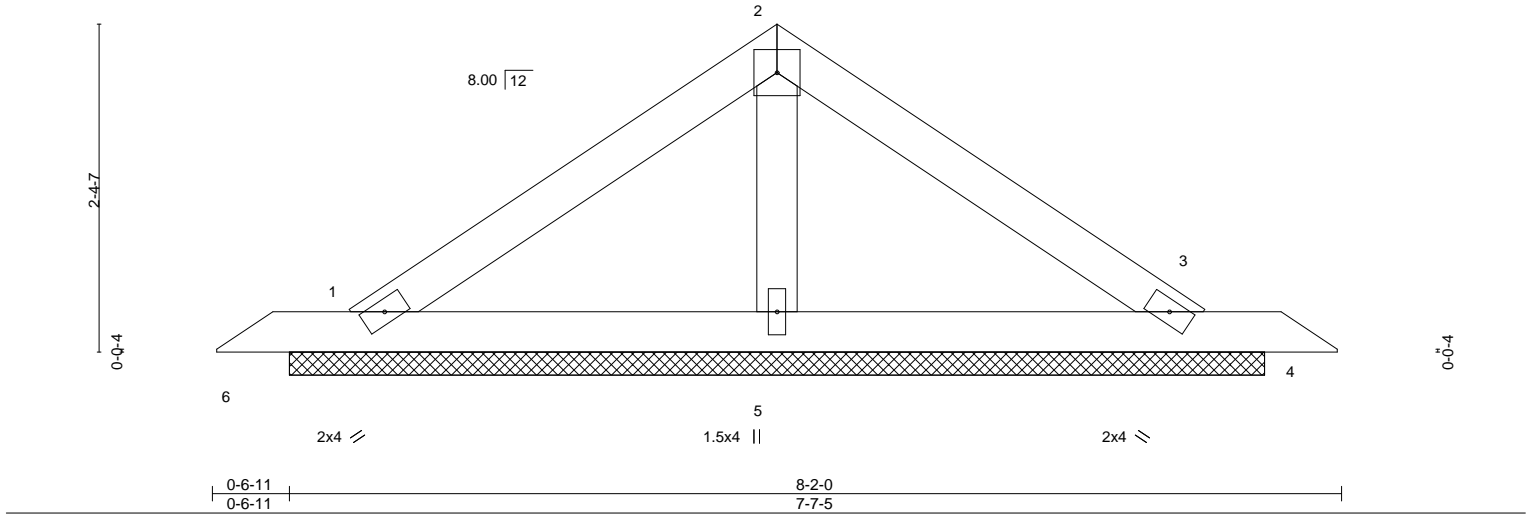

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	-0.00	4	n/r	120	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	-0.00	3	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-P						
								Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=7-0-10, 3=7-0-10, 5=7-0-10
Max Horz 1=-38(LC 10)
Max Uplift 1=-35(LC 12), 3=-20(LC 12)
Max Grav 1=187(LC 1), 3=187(LC 1), 5=211(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

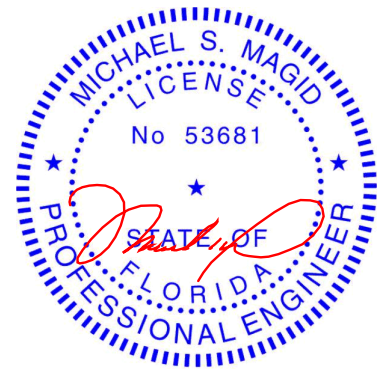

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 8,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

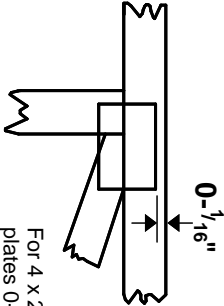

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

—
—
This symbol indicates the required direction of slots in connector plates.


* Plate location details available in **MiTek 20/20** software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

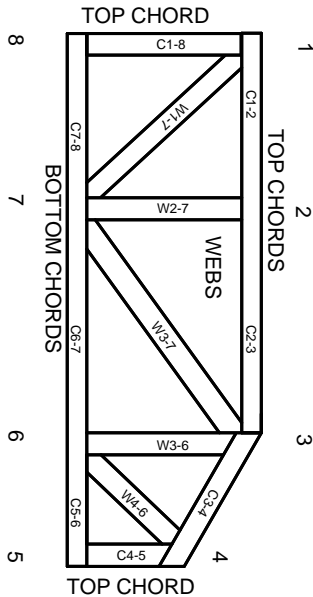

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.