

DATE 08/03/2006

Columbia County Building Permit

PERMIT
000024824

This Permit Expires One Year From the Date of Issue

APPLICANT TRENT GIEBEIG PHONE 397-0545
ADDRESS 562 SW FARLINGTON COURT LAKE CITY FL 32055
OWNER PETE GIEBEIG PHONE 397-0545
ADDRESS 313 SW MAYFAIR LANE LAKE CITY FL 32055
CONTRACTOR TRENT GIEBEIG PHONE 397-0545
LOCATION OF PROPERTY 247S, TR ON MAYFAIR LANE, CORNER OF VANN COURT AND
MAYFAIR LANE
TYPE DEVELOPMENT SFD,UTILITY ESTIMATED COST OF CONSTRUCTION 94350.00
HEATED FLOOR AREA 1887.00 TOTAL AREA 2642.00 HEIGHT 1 STORIES 1
FOUNDATION CONC WALLS FRAMED ROOF PITCH 6/12 FLOOR SLAB
LAND USE & ZONING RSF-2 MAX. HEIGHT 16
Minimum Set Back Requirments: STREET-FRONT 25.00 REAR 15.00 SIDE 10.00
NO. EX.D.U. 0 FLOOD ZONE X DEVELOPMENT PERMIT NO.

PARCEL ID 11-4S-16-02911-315 SUBDIVISION MAYFAIR
LOT 15 BLOCK PHASE 3 UNIT TOTAL ACRES

000001172 RR28281153
Culvert Permit No. Culvert Waiver Contractor's License Number Applicant/Owner/Contractor
CULVERT 06-0633-N BK JH Y
Driveway Connection Septic Tank Number LU & Zoning checked by Approved for Issuance New Resident

COMMENTS: ONE FOOT ABOVE THE ROAD, NOC ON FILE

Check # or Cash 1891

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power date/app. by Foundation date/app. by Monolithic date/app. by
Under slab rough-in plumbing date/app. by Slab date/app. by Sheathing/Nailing date/app. by
Framing date/app. by Rough-in plumbing above slab and below wood floor date/app. by
Electrical rough-in date/app. by Heat & Air Duct date/app. by Peri. beam (Lintel) date/app. by
Permanent power date/app. by C.O. Final date/app. by Culvert date/app. by
M/H tie downs, blocking, electricity and plumbing date/app. by Pool date/app. by
Reconnection date/app. by Pump pole date/app. by Utility Pole date/app. by
M/H Pole date/app. by Travel Trailer date/app. by Re-roof date/app. by

BUILDING PERMIT FEE \$ 475.00 CERTIFICATION FEE \$ 13.21 SURCHARGE FEE \$ 13.21
MISC. FEES \$ 0.00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ 0.00 WASTE FEE \$
FLOOD DEVELOPMENT FEE \$ FLOOD ZONE FEE \$ 25.00 CULVERT FEE \$ 25.00 TOTAL FEE 601.42
INSPECTORS OFFICE HALL 18/08/06 CLERKS OFFICE CH

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

This Permit Must Be Prominently Posted on Premises During Construction

PLEASE NOTIFY THE COLUMBIA COUNTY BUILDING DEPARTMENT AT LEAST 24 HOURS IN ADVANCE OF EACH INSPECTION, IN ORDER THAT IT MAY BE MADE WITHOUT DELAY OR INCONVENIENCE, PHONE 758-1008. THIS PERMIT IS NOT VALID UNLESS THE WORK AUTHORIZED BY IT IS COMMENCED WITHIN 6 MONTHS AFTER ISSUANCE.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

Columbia County Building Permit Application

Revised 9-23-04

For Office Use Only Application # 0607-25 Date Received 7/28/06 By GA Permit # 1172/24824
Application Approved by - Zoning Official B2K Date 03.08.06 Plans Examiner OK JTH Date 8-2-06
Flood Zone APX-1 Development Permit N/A Zoning RSF-2 Land Use Plan Map Category Res. L-Dev.
Comments SITE PLAN ON PLANS

Applicants Name Trent Gieberg Construction Inc Phone 397-0545
Address 462 SW Fairlington Ct Lake City
Owners Name Pete Gieberg Phone 397-0545
911 Address 313 SW Mayfair Lane Lake City FL
Contractors Name Trent Gieberg Phone 397-0545
Address 462 SW Fairlington Ct Lake City
Fee Simple Owner Name & Address _____
Bonding Co. Name & Address _____
Architect/Engineer Name & Address Freeman Design Group
Mortgage Lenders Name & Address _____
Circle the correct power company - FL Power & Light - Clay Elec. - Suwannee Valley Elec. - Progressive Energy
Property ID Number 11-45-16-02914-315 Estimated Cost of Construction 84,000
Subdivision Name Mayfair III Lot 15 Block _____ Unit _____ Phase III
Driving Directions 247 South Right into Mayfair
Stay on Mayfair lane house on corner of
Vann Ct + Mayfair lane
Type of Construction Frame Number of Existing Dwellings on Property _____
Total Acreage _____ Lot Size _____ Do you need a - Culvert Permit or Culvert Waiver or Have an Existing Drive
Actual Distance of Structure from Property Lines - Front 27' Side 40' Side 20' Rear 29'
Total Building Height 16'11" Number of Stories 1 Heated Floor Area 1887 Roof Pitch 6/12
Porch 293 GARAGE 462 TOTAL 2,642

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standards of all laws regulating construction in this jurisdiction.

OWNERS AFFIDAVIT: I hereby certify that all the foregoing information is accurate and all work will be done in compliance with all applicable laws and regulating construction and zoning.

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

Trent Gieberg Construction Inc
Owner Builder or Agent (Including Contractor)

STATE OF FLORIDA
COUNTY OF COLUMBIA

Sworn to (or affirmed) and subscribed before me
this 28 day of July 2006.
Personally known X or Produced Identification _____

Trent Gieberg
Contractor Signature
Contractors License Number BR282811523
Competency Card Number 5754
NOTARY STAMP

Elaine K. Tolar
Notary Signature ELAINE K. TOLAR
ELAINE K. TOLAR
MY COMMISSION # DD 436381
EXPIRES October 2, 2009
Bonded Thru Notary Public Underwriters

**Application for Onsite Sewage Disposal System
Construction Permit. Part II Site Plan**
Permit Application Number: 06-0633N


ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT

GIEBEIG/CR 05-3588



May-Fair unit 3, Lot 15

Vacant

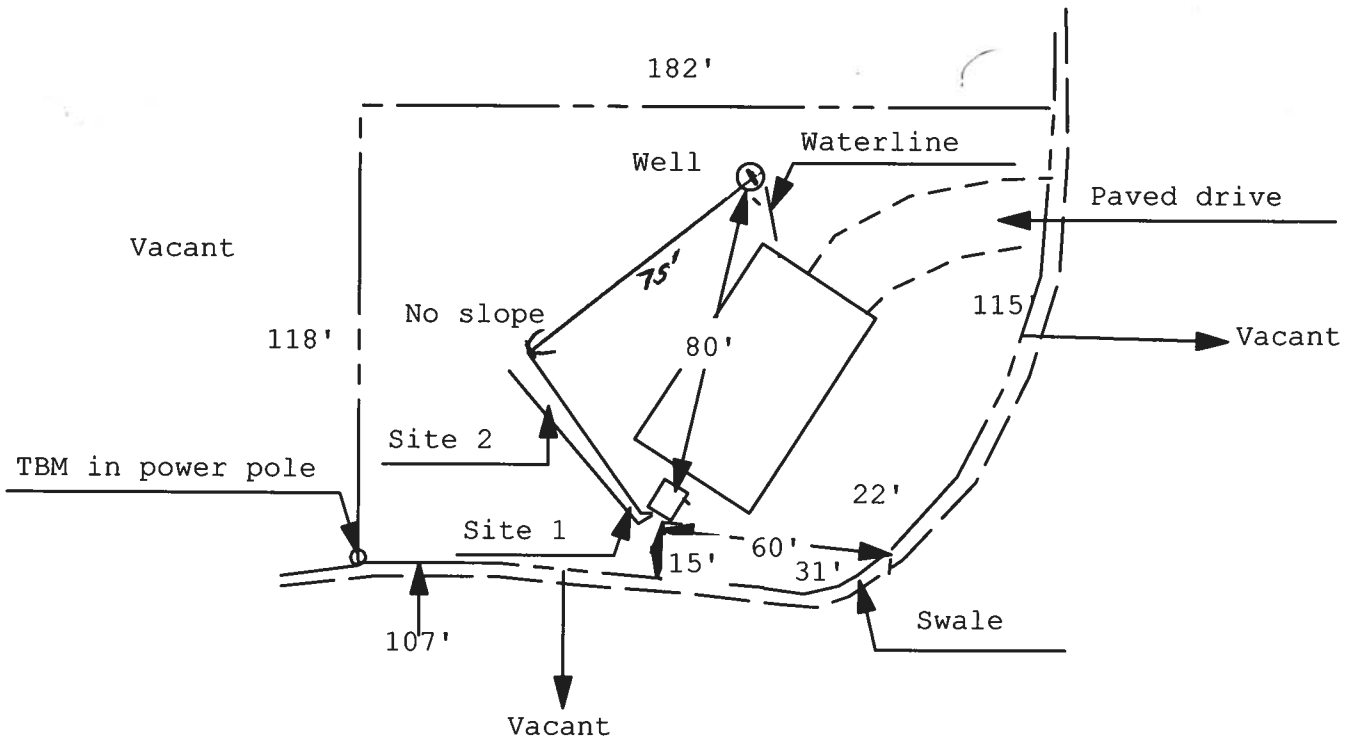

1 inch = 50 feet

Site Plan Submitted By Paul Lloyd Date 6/23/06
Plan Approved ☒ Not Approved ☐ Date 7/17/06

By Mr. S. Lantz Columbia CPHU

Notes: _____

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Community Affairs Residential Whole Building Performance Method A

Project Name: **May-Fair Lot 15**
Address: **Lot: 151, Sub: May Fair, Plat:**
City, State: **Lake City, FL 32055-**
Owner: **Giebeig, Trent**
Climate Zone: **North**

Builder: **Trent Giebeig**
Permitting Office: **Columbia**
Permit Number: **24824**
Jurisdiction Number: **221000**

- | | | |
|--|--------------------------------|-----------------------|
| 1. New construction or existing | New | ___ |
| 2. Single family or multi-family | Single family | ___ |
| 3. Number of units, if multi-family | 1 | ___ |
| 4. Number of Bedrooms | 4 | ___ |
| 5. Is this a worst case? | Yes | ___ |
| 6. Conditioned floor area (ft ²) | 1887 ft ² | ___ |
| 7. Glass area & type | Single Pane | Double Pane |
| a. Clear glass, default U-factor | 0.0 ft ² | 182.0 ft ² |
| b. Default tint | 0.0 ft ² | 0.0 ft ² |
| c. Labeled U or SHGC | 0.0 ft ² | 0.0 ft ² |
| 8. Floor types | | ___ |
| a. Slab-On-Grade Edge Insulation | R=0.0, 230.2(p) ft | ___ |
| b. N/A | | ___ |
| c. N/A | | ___ |
| 9. Wall types | | ___ |
| a. Frame, Wood, Exterior | R=13.0, 1846.4 ft ² | ___ |
| b. N/A | | ___ |
| c. N/A | | ___ |
| d. N/A | | ___ |
| e. N/A | | ___ |
| 10. Ceiling types | | ___ |
| a. Under Attic | R=30.0, 2075.7 ft ² | ___ |
| b. N/A | | ___ |
| c. N/A | | ___ |
| 11. Ducts | | ___ |
| a. Sup: Unc. Ret: Unc. AH: Interior | Sup. R=6.0, 61.7 ft | ___ |
| b. N/A | | ___ |

- | | |
|--|----------------------------------|
| 12. Cooling systems | |
| a. Central Unit | Cap: 36.0 kBtu/hr
SEER: 13.00 |
| b. N/A | ___ |
| c. N/A | ___ |
| 13. Heating systems | |
| a. Electric Heat Pump | Cap: 36.0 kBtu/hr
HSPF: 8.00 |
| b. N/A | ___ |
| c. N/A | ___ |
| 14. Hot water systems | |
| a. Electric Resistance | Cap: 50.0 gallons
EF: 0.90 |
| b. N/A | ___ |
| c. Conservation credits | ___ |
| (HR-Heat recovery, Solar | |
| DHP-Dedicated heat pump) | |
| 15. HVAC credits | MZ-C, PT, CF, ___ |
| (CF-Ceiling fan, CV-Cross ventilation, | |
| HF-Whole house fan, | |
| PT-Programmable Thermostat, | |
| MZ-C-Multizone cooling, | |
| MZ-H-Multizone heating) | |

Glass/Floor Area: 0.10

Total as-built points: 25027

Total base points: 31613

PASS

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.

PREPARED BY: _____

DATE: _____

I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.

OWNER/AGENT: _____

DATE: _____

Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.



BUILDING OFFICIAL: _____

DATE: _____

SUMMER CALCULATIONS

Residential Whole Building Performance Method A - Details

ADDRESS: Lot: 151, Sub: May Fair, Plat: , Lake City, FL, 32055-

PERMIT #:

BASE				AS-BUILT							
GLASS TYPES .18 X Conditioned X BSPM = Points Floor Area				Type/SC	Overhang Ornt Len Hgt			Area X SPM X SOF = Points			
.18	1887.0	20.04	6806.8	Double, Clear	E	1.5	6.0	30.0	42.06	0.91	1151.8
				Double, Clear	E	1.5	5.0	20.0	42.06	0.87	735.7
				Double, Clear	E	1.5	5.0	30.0	42.06	0.87	1103.6
				Double, Clear	S	1.5	4.0	6.0	35.87	0.74	159.4
				Double, Clear	S	1.5	2.0	5.0	35.87	0.57	101.4
				Double, Clear	W	1.5	6.0	60.0	38.52	0.91	2111.2
				Double, Clear	W	1.5	6.0	25.0	38.52	0.91	879.7
				Double, Clear	N	1.5	4.0	6.0	19.20	0.88	101.5
				As-Built Total:			182.0			6344.3	
WALL TYPES		Area X BSPM = Points		Type	R-Value			Area X SPM		= Points	
Adjacent	0.0	0.00	0.0	Frame, Wood, Exterior	13.0			1846.4	1.50	2769.6	
Exterior	1846.4	1.70	3138.9								
Base Total:		1846.4		3138.9		As-Built Total:			1846.4		2769.6
DOOR TYPES		Area X BSPM = Points		Type	R-Value			Area X SPM		= Points	
Adjacent	0.0	0.00	0.0	Exterior Wood				17.7	6.10	107.8	
Exterior	38.1	6.10	232.3	Exterior Wood				20.4	6.10	124.4	
Base Total:		38.1		232.3		As-Built Total:			38.1		232.3
CEILING TYPES		Area X BSPM = Points		Type	R-Value			Area X SPM X SCM		= Points	
Under Attic	1887.0	1.73	3264.5	Under Attic	30.0			2075.7	1.73 X 1.00	3591.0	
Base Total:		1887.0		3264.5		As-Built Total:			2075.7		3591.0
FLOOR TYPES		Area X BSPM = Points		Type	R-Value			Area X SPM		= Points	
Slab	230.2(p)	-37.0	-8517.4	Slab-On-Grade Edge Insulation	0.0			230.2(p)	-41.20	-9484.2	
Raised	0.0	0.00	0.0								
Base Total:		-8517.4		As-Built Total:		230.2			-9484.2		
INFILTRATION		Area X BSPM = Points					Area X SPM		= Points		
	1887.0	10.21	19266.3				1887.0	10.21	19266.3		

SUMMER CALCULATIONS**Residential Whole Building Performance Method A - Details**

ADDRESS: Lot: 151, Sub: May Fair, Plat: , Lake City, FL, 32055-

PERMIT #:

BASE				AS-BUILT											
Summer Base Points:		24191.3		Summer As-Built Points:				22719.2							
Total Summer Points	X	System Multiplier	=	Cooling Points	Total Component	X	Cap Ratio	X	Duct Multiplier	X	System Multiplier	X	Credit Multiplier	=	Cooling Points
							(DM x DSM x AHU)								
24191.3		0.4266		10320.0	22719.2		1.000		(1.090 x 1.147 x 0.91)		0.263		0.857		5818.2
					22719.2		1.00		1.138		0.263		0.857		5818.2

WINTER CALCULATIONS

Residential Whole Building Performance Method A - Details

ADDRESS: Lot: 151, Sub: May Fair, Plat: , Lake City, FL, 32055-

PERMIT #:

BASE				AS-BUILT							
GLASS TYPES											
.18 X Conditioned X BWPM = Points Floor Area				Type/SC	Overhang Ornt Len Hgt		Area X WPM X WOF = Points				
.18	1887.0	12.74	4327.3	Double, Clear	E	1.5	6.0	30.0	18.79	1.04	583.8
				Double, Clear	E	1.5	5.0	20.0	18.79	1.05	394.6
				Double, Clear	E	1.5	5.0	30.0	18.79	1.05	592.0
				Double, Clear	S	1.5	4.0	6.0	13.30	1.34	107.1
				Double, Clear	S	1.5	2.0	5.0	13.30	2.27	150.6
				Double, Clear	W	1.5	6.0	60.0	20.73	1.02	1272.9
				Double, Clear	W	1.5	6.0	25.0	20.73	1.02	530.4
				Double, Clear	N	1.5	4.0	6.0	24.58	1.01	148.3
				As-Built Total:							
WALL TYPES Area X BWPM = Points				Type	R-Value		Area X WPM		=	Points	
Adjacent	0.0	0.00	0.0	Frame, Wood, Exterior	13.0		1846.4	3.40	6277.8		
Exterior	1846.4	3.70	6831.7								
Base Total:				1846.4		6831.7		As-Built Total:		1846.4	6277.8
DOOR TYPES Area X BWPM = Points				Type			Area X WPM		=	Points	
Adjacent	0.0	0.00	0.0	Exterior Wood			17.7	12.30	217.5		
Exterior	38.1	12.30	468.4	Exterior Wood			20.4	12.30	250.9		
Base Total:				38.1		468.4		As-Built Total:		38.1	468.4
CEILING TYPES Area X BWPM = Points				Type	R-Value		Area X WPM X WCM		=	Points	
Under Attic	1887.0	2.05	3868.3	Under Attic	30.0		2075.7	2.05 X 1.00	4255.2		
Base Total:				1887.0		3868.3		As-Built Total:		2075.7	4255.2
FLOOR TYPES Area X BWPM = Points				Type	R-Value		Area X WPM		=	Points	
Slab	230.2(p)	8.9	2048.8	Slab-On-Grade Edge Insulation	0.0		230.2(p)	18.80	4327.8		
Raised	0.0	0.00	0.0								
Base Total:				2048.8		As-Built Total:		230.2	4327.8		
INFILTRATION Area X BWPM = Points								Area X WPM		=	Points
1887.0				-0.59		-1113.3		1887.0		-0.59 -1113.3	

WINTER CALCULATIONS

Residential Whole Building Performance Method A - Details

ADDRESS: Lot: 151, Sub: May Fair, Plat: , Lake City, FL, 32055-

PERMIT #:

BASE				AS-BUILT							
Winter Base Points: 16431.1				Winter As-Built Points: 17995.5							
Total Winter Points	X	System Multiplier	= Heating Points	Total Component	X	Cap Ratio	X Duct Multiplier (DM x DSM x AHU)	X System Multiplier	X Credit Multiplier	= Heating Points	
16431.1		0.6274	10308.9	17995.5 17995.5		1.000 1.00	(1.069 x 1.169 x 0.93)	0.426 1.162	0.950 0.950	8468.9 8468.9	

WATER HEATING & CODE COMPLIANCE STATUS

Residential Whole Building Performance Method A - Details

ADDRESS: Lot: 151, Sub: May Fair, Plat: , Lake City, FL, 32055-

PERMIT #:

BASE				AS-BUILT					
WATER HEATING				Tank	EF	Number of	X	Tank	X
Number of	X	Multiplier	=	Volume		Bedrooms		Ratio	Multiplier
Bedrooms			Total						= Total
4		2746.00	10984.0	50.0	0.90	4		1.00	2684.98
									1.00
									10739.9
				As-Built Total:					10739.9

CODE COMPLIANCE STATUS							
BASE				AS-BUILT			
Cooling	+	Heating	+	Cooling	+	Heating	+
Points		Points		Points		Points	
			=				=
10320		10309		5818		8469	
		10984				10740	
		31613				25027	

PASS

Code Compliance Checklist

Residential Whole Building Performance Method A - Details

ADDRESS: Lot: 151, Sub: May Fair, Plat: , Lake City, FL 32055-

PERMIT #:

6A-21 INFILTRATION REDUCTION COMPLIANCE CHECKLIST

COMPONENTS	SECTION	REQUIREMENTS FOR EACH PRACTICE	CHECK
Exterior Windows & Doors	606.1.ABC.1.1	Maximum: .3 cfm/sq.ft. window area; .5 cfm/sq.ft. door area.	
Exterior & Adjacent Walls	606.1.ABC.1.2.1	Caulk, gasket, weatherstrip or seal between: windows/doors & frames, surrounding wall; foundation & wall sole or sill plate; joints between exterior wall panels at corners; utility penetrations; between wall panels & top/bottom plates; between walls and floor. EXCEPTION: Frame walls where a continuous infiltration barrier is installed that extends from, and is sealed to, the foundation to the top plate.	
Floors	606.1.ABC.1.2.2	Penetrations/openings >1/8" sealed unless backed by truss or joint members. EXCEPTION: Frame floors where a continuous infiltration barrier is installed that is sealed to the perimeter, penetrations and seams.	
Ceilings	606.1.ABC.1.2.3	Between walls & ceilings; penetrations of ceiling plane of top floor; around shafts, chases, soffits, chimneys, cabinets sealed to continuous air barrier; gaps in gyp board & top plate; attic access. EXCEPTION: Frame ceilings where a continuous infiltration barrier is installed that is sealed at the perimeter, at penetrations and seams.	
Recessed Lighting Fixtures	606.1.ABC.1.2.4	Type IC rated with no penetrations, sealed; or Type IC or non-IC rated, installed inside a sealed box with 1/2" clearance & 3" from insulation; or Type IC rated with < 2.0 cfm from conditioned space, tested.	
Multi-story Houses	606.1.ABC.1.2.5	Air barrier on perimeter of floor cavity between floors.	
Additional Infiltration reqts	606.1.ABC.1.3	Exhaust fans vented to outdoors, dampers; combustion space heaters comply with NFPA, have combustion air.	

6A-22 OTHER PRESCRIPTIVE MEASURES (must be met or exceeded by all residences.)

COMPONENTS	SECTION	REQUIREMENTS	CHECK
Water Heaters	612.1	Comply with efficiency requirements in Table 6-12. Switch or clearly marked circuit breaker (electric) or cutoff (gas) must be provided. External or built-in heat trap required.	
Swimming Pools & Spas	612.1	Spas & heated pools must have covers (except solar heated). Non-commercial pools must have a pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%.	
Shower heads	612.1	Water flow must be restricted to no more than 2.5 gallons per minute at 80 PSIG.	
Air Distribution Systems	610.1	All ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated, and installed in accordance with the criteria of Section 610. Ducts in unconditioned attics: R-6 min. insulation.	
HVAC Controls	607.1	Separate readily accessible manual or automatic thermostat for each system.	
Insulation	604.1, 602.1	Ceilings-Min. R-19. Common walls-Frame R-11 or CBS R-3 both sides. Common ceiling & floors R-11.	

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE SCORE* = 87.2

The higher the score, the more efficient the home.

Giebeig, Trent, Lot: 151, Sub: May Fair, Plat: , Lake City, FL 32055-

1. New construction or existing	New	___	12. Cooling systems	
2. Single family or multi-family	Single family	___	a. Central Unit	Cap: 36.0 kBtu/hr
3. Number of units, if multi-family	1	___		SEER: 13.00
4. Number of Bedrooms	4	___	b. N/A	___
5. Is this a worst case?	Yes	___	c. N/A	___
6. Conditioned floor area (ft²)	1887 ft²	___		___
7. Glass area & type	Single Pane	Double Pane		___
a. Clear - single pane	0.0 ft²	182.0 ft²	13. Heating systems	
b. Clear - double pane	0.0 ft²	0.0 ft²	a. Electric Heat Pump	Cap: 36.0 kBtu/hr
c. Tint/other SHGC - single pane	0.0 ft²	0.0 ft²		HSPF: 8.00
d. Tint/other SHGC - double pane			b. N/A	___
8. Floor types			c. N/A	___
a. Slab-On-Grade Edge Insulation	R=0.0, 230.2(p) ft	___	14. Hot water systems	
b. N/A		___	a. Electric Resistance	Cap: 50.0 gallons
c. N/A		___		EF: 0.90
9. Wall types			b. N/A	___
a. Frame, Wood, Exterior	R=13.0, 1846.4 ft²	___	c. Conservation credits	
b. N/A		___	(HR-Heat recovery, Solar	
c. N/A		___	DHP-Dedicated heat pump)	
d. N/A		___	15. HVAC credits	MZ-C, PT, CF, ___
e. N/A		___	(CF-Ceiling fan, CV-Cross ventilation,	
10. Ceiling types			HF-Whole house fan,	
a. Under Attic	R=30.0, 2075.7 ft²	___	PT-Programmable Thermostat,	
b. N/A		___	MZ-C-Multizone cooling,	
c. N/A		___	MZ-H-Multizone heating)	
11. Ducts				
a. Sup: Unc. Ret: Unc. AH: Interior	Sup. R=6.0, 61.7 ft	___		
b. N/A		___		

I certify that this home has complied with the Florida Energy Efficiency Code For Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: _____ City/FL Zip: _____



**NOTE: The home's estimated energy performance score is only available through the FLA/RES computer program. This is not a Building Energy Rating. If your score is 80 or greater (or 86 for a US EPA/DOE EnergyStar™ designation), your home may qualify for energy efficiency mortgage (EEM) incentives if you obtain a Florida Energy Gauge Rating. Contact the Energy Gauge Hotline at 321/638-1492 or see the Energy Gauge web site at www.fsec.ucf.edu for information and a list of certified Raters. For information about Florida's Energy Efficiency Code For Building Construction, contact the Department of Community Affairs Energy Gauge Office.*

Version: FLRCPB v3.30)

Residential System Sizing Calculation

Summary

Giebeig, Trent

Project Title:
May-Fair Lot 15

Code Only
Professional Version
Climate: North


7/19/2006

Location for weather data: Gainesville - User customized: Latitude(29) Temp Range(M)			
Humidity data: Interior RH (50%) Outdoor wet bulb (78F) Humidity difference(51gr.)			
Winter design temperature	31 F	Summer design temperature	98 F
Winter setpoint	70 F	Summer setpoint	75 F
Winter temperature difference	39 F	Summer temperature difference	23 F
Total heating load calculation	26985 Btuh	Total cooling load calculation	26686 Btuh
Submitted heating capacity	% of calc Btuh	Submitted cooling capacity	% of calc Btuh
Total (Electric Heat Pump)	133.4 36000	Sensible (SHR = 0.5)	85.6 18000
Heat Pump + Auxiliary(0.0kW)	133.4 36000	Latent	317.7 18000
		Total (Electric Heat Pump)	134.9 36000

WINTER CALCULATIONS

Winter Heating Load (for 1887 sqft)


Load component		Load	
Window total	182 sqft	3913	Btuh
Wall total	1846 sqft	5724	Btuh
Door total	38 sqft	683	Btuh
Ceiling total	2076 sqft	2698	Btuh
Floor total	230 ft	7274	Btuh
Infiltration	126 cfm	5408	Btuh
Subtotal		25700	Btuh
Duct loss		1285	Btuh
TOTAL HEAT LOSS		26985	Btuh

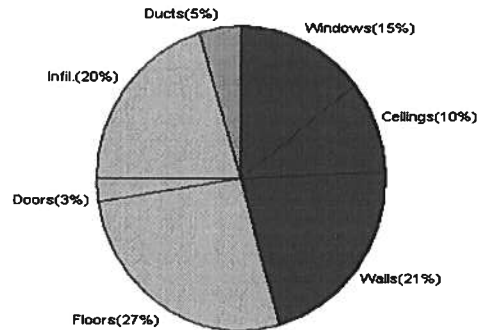

SUMMER CALCULATIONS

Summer Cooling Load (for 1887 sqft)

Load component		Load	
Window total	182 sqft	5062	Btuh
Wall total	1846 sqft	3951	Btuh
Door total	38 sqft	468	Btuh
Ceiling total	2076 sqft	3238	Btuh
Floor total		0	Btuh
Infiltration	110 cfm	2790	Btuh
Internal gain		3600	Btuh
Subtotal(sensible)		19110	Btuh
Duct gain		1911	Btuh
Total sensible gain		21021	Btuh
Latent gain(infiltration)		3825	Btuh
Latent gain(internal)		1840	Btuh
Total latent gain		5665	Btuh
TOTAL HEAT GAIN		26686	Btuh

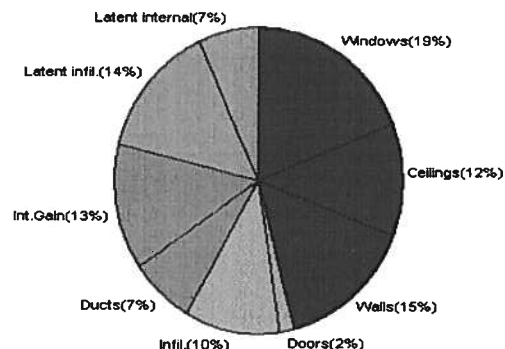

EnergyGauge® System Sizing based on ACCA Manual J.

PREPARED BY: _____

DATE: _____

System Sizing Calculations - Winter

Residential Load - Component Details

Giebeig, Trent

Project Title:
May-Fair Lot 15

Code Only
Professional Version
Climate: North

Lake City, FL 32055-

Reference City: Gainesville (User customized) Winter Temperature Difference: 39.0 F

7/19/2006

Window	Panes/SHGC/Frame/U	Orientation	Area X	HTM=	Load
1	2, Clear, Wood, DEF	N	30.0	21.5	645 Btuh
2	2, Clear, Wood, DEF	N	20.0	21.5	430 Btuh
3	2, Clear, Wood, DEF	N	30.0	21.5	645 Btuh
4	2, Clear, Wood, DEF	E	6.0	21.5	129 Btuh
5	2, Clear, Wood, DEF	E	5.0	21.5	108 Btuh
6	2, Clear, Wood, DEF	S	60.0	21.5	1290 Btuh
7	2, Clear, Wood, DEF	S	25.0	21.5	538 Btuh
8	2, Clear, Wood, DEF	W	6.0	21.5	129 Btuh
Window Total			182		3913 Btuh
Walls	Type	R-Value	Area X	HTM=	Load
1	Frame - Exterior	13.0	1846	3.1	5724 Btuh
Wall Total			1846		5724 Btuh
Doors	Type		Area X	HTM=	Load
1	Wood - Exter		18	17.9	317 Btuh
2	Wood - Exter		20	17.9	366 Btuh
Door Total			38		683Btuh
Ceilings	Type	R-Value	Area X	HTM=	Load
1	Under Attic	30.0	2076	1.3	2698 Btuh
Ceiling Total			2076		2698Btuh
Floors	Type	R-Value	Size X	HTM=	Load
1	Slab-On-Grade Edge Insul	0	230.2 ft(p)	31.6	7274 Btuh
Floor Total			230		7274 Btuh
Infiltration	Type	ACH X	Building Volume	CFM=	Load
	Natural	0.40	18870(sqft)	126	5408 Btuh
	Mechanical			0	0 Btuh
Infiltration Total				126	5408 Btuh

Totals for Heating	Subtotal	25700 Btuh
	Duct Loss(using duct multiplier of 0.05)	1285 Btuh
	Total Btuh Loss	26985 Btuh

Key: Window types (SHGC - Shading coefficient of glass as SHGC numerical value or as clear or tint)

(Frame types - metal, wood or insulated metal)

(U - Window U-Factor or 'DEF' for default)

(HTM - ManualJ Heat Transfer Multiplier)

Key: Floor size (perimeter(p) for slab-on-grade or area for all other floor types)

System Sizing Calculations - Summer

Residential Load - Component Details

Giebeig, Trent

Project Title:
May-Fair Lot 15

Code Only
Professional Version
Climate: North

Lake City, FL 32055-

Reference City: Gainesville (User customized) Summer Temperature Difference: 23.0 F 7/19/2006

Window	Type	Overhang		Window Area(sqft)			HTM		Load		
	Panes/SHGC/U/InSh/ExSh Ornt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded			
1	2, Clear, DEF, N, N	N	1.5	6	30.0	0.0	30.0	24	24	720	Btuh
2	2, Clear, DEF, N, N	N	1.5	5	20.0	0.0	20.0	24	24	480	Btuh
3	2, Clear, DEF, N, N	N	1.5	5	30.0	0.0	30.0	24	24	720	Btuh
4	2, Clear, DEF, N, N	E	1.5	4	6.0	0.0	6.0	24	74	444	Btuh
5	2, Clear, DEF, N, N	E	1.5	2	5.0	3.1	1.9	24	74	214	Btuh
6	2, Clear, DEF, N, N	S	1.5	6	60.0	60.0	0.0	24	39	1440	Btuh
7	2, Clear, DEF, N, N	S	1.5	6	25.0	25.0	0.0	24	39	600	Btuh
8	2, Clear, DEF, N, N	W	1.5	4	6.0	0.0	6.0	24	74	444	Btuh
Window Total					182					5062	Btuh
Walls	Type	R-Value			Area		HTM		Load		
	Frame - Exterior	13.0			1846.4		2.1		3951 Btuh		
	Wall Total				1846.4				3951 Btuh		
Doors	Type				Area		HTM		Load		
	Wood - Exter				17.7		12.3		217 Btuh		
	Wood - Exter				20.4		12.3		251 Btuh		
	Door Total				38.1				468 Btuh		
Ceilings	Type/Color	R-Value			Area		HTM		Load		
	Under Attic/Dark	30.0			2075.7		1.6		3238 Btuh		
	Ceiling Total				2075.7				3238 Btuh		
Floors	Type	R-Value			Size		HTM		Load		
	Slab-On-Grade Edge Insulation	0.0			230.2 ft(p)		0.0		0 Btuh		
	Floor Total				230.2				0 Btuh		
Infiltration	Type	ACH			Volume		CFM=		Load		
	Natural	0.35			18870		110.3		2790 Btuh		
	Mechanical						0		0 Btuh		
	Infiltration Total						110		2790 Btuh		

Internal gain	Occupants	Btuh/occupant		Appliance	Load	
	8	X 300 +	1200		3600 Btuh	

Totals for Cooling	Subtotal	19110 Btuh
	Duct gain(using duct multiplier of 0.10)	1911 Btuh
	Total sensible gain	21021 Btuh
	Latent infiltration gain (for 51 gr. humidity difference)	3825 Btuh
	Latent occupant gain (8 people @ 230 Btuh per person)	1840 Btuh
	Latent other gain	0 Btuh
TOTAL GAIN		26686 Btuh

Manual J Summer Calculations

Residential Load - Component Details (continued)

Giebeig, Trent

Project Title:
May-Fair Lot 15

Code Only
Professional Version
Climate: North

Lake City, FL 32055-

7/19/2006

Key: Window types (SHGC - Shading coefficient of glass as SHGC numerical value or as clear or tint)
(U - Window U-Factor or 'DEF' for default)
(InSh - Interior shading device: none(N), Blinds/Daperies(B) or Roller Shades(R))
(ExSh - Exterior shading device: none(N) or numerical value)
(Ornt - compass orientation)

Columbia County Building Department Culvert Permit

Culvert Permit No.
000001172

DATE 08/03/2006 PARCEL ID # 11-4S-16-02914-315
APPLICANT TRENT GIEBEIG PHONE 397-0545
ADDRESS 462 SW FAIRLINGTON COURT LAKE CITY FL 32055
OWNER PETE GIEBEIG PHONE 397-0545
ADDRESS 313 SW MAYFAIR LANE LAKE CITY FL 32055
CONTRACTOR TRENT GIEBEIG PHONE 397-0545
LOCATION OF PROPERTY 247S, TR ON MAYFAIR LANE, HOUSE ON CORNER OF VANN COURT
AND MAYFAIR LANE

SUBDIVISION/LOT/BLOCK/PHASE/UNIT MAYFAIR 15 3

SIGNATURE

INSTALLATION REQUIREMENTS



Culvert size will be 18 inches in diameter with a total length of 32 feet, leaving 24 feet of driving surface. Both ends will be mitered 4 foot with a 4 : 1 slope and poured with a 4 inch thick reinforced concrete slab.

INSTALLATION NOTE: Turnouts will be required as follows:

- a) a majority of the current and existing driveway turnouts are paved, or;
- b) the driveway to be served will be paved or formed with concrete.

Turnouts shall be concrete or paved a minimum of 12 feet wide or the width of the concrete or paved driveway, whichever is greater. The width shall conform to the current and existing paved or concreted turnouts.



Culvert installation shall conform to the approved site plan standards.



Department of Transportation Permit installation approved standards.



Other _____

ALL PROPER SAFETY REQUIREMENTS SHOULD BE FOLLOWED
DURING THE INSTALLATION OF THE CULVERT.

135 NE Hernando Ave., Suite B-21
Lake City, FL 32055
Phone: 386-758-1008 Fax: 386-758-2160

Amount Paid 25.00



New Construction Subterranean Termite Soil Treatment Record

OMB Approval No. 2502-0525

This form is completed by the licensed Pest Control Company.

Public reporting burden for this collection of information is estimated to average 15 minutes per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. This information is mandatory and is required to obtain benefits. HUD may not collect this information, and you are not required to complete this form, unless it displays a currently valid OMB control number.

Section 24 CFR 200.926d(b)(3) requires that the sites for HUD insured structures must be free of termite hazards. This information collection requires the builder to certify that an authorized Pest Control company performed all required treatment for termites, and that the builder guarantees the treated area against infestation for one year. Builders, pest control companies, mortgage lenders, homebuyers, and HUD as a record of treatment for specific homes will use the information collected. The information is not considered confidential.

This report is submitted for informational purposes to the builder on proposed (new) construction cases when soil treatment for prevention of subterranean termite infestation is specified by the builder, architect, or required by the lender, architect, FHA, or VA.

All contracts for services are between the Pest Control Operator and builder, unless stated otherwise.

24824

Section 1: General Information (Treating Company Information)

Company Name: Aspen Pest Control, Inc.
Company Address: 301 NW Cole Terrace City Lake City State FL Zip 32055
Company Business License No. JB103473 Company Phone No. 386-755-3611
FHA/VA Case No. (if any) _____

Section 2: Builder Information

Company Name: Trent Gregory Construction Company Phone No. _____

Section 3: Property Information

Location of Structure(s) Treated (Street Address or Legal Description, City, State and Zip) 313 SW Mayfair Lane Lake City, FL
Type of Construction (More than one box may be checked) ☒ Slab ☐ Basement ☐ Crawl ☐ Other _____
Approximate Depth of Footing: Outside 12 Inside 12 Type of Fill Dirt

Section 4: Treatment Information

Date(s) of Treatment(s) 8-25-06
Brand Name of Product(s) Used Termidor GT
EPA Registration No. 7969-210
Approximate Final Mix Solution % 0.06%
Approximate Size of Treatment Area: Sq. ft. 2642 Linear ft. 287 Linear ft. of Masonry Voids 287
Approximate Total Gallons of Solution Applied 552
Was treatment completed on exterior? ☐ Yes ☒ No
Service Agreement Available? ☒ Yes ☐ No
Note: Some state laws require service agreements to be issued. This form does not preempt state law.

Attachments (List) _____

Comments _____

Name of Applicator(s) Steve Brannon Certification No. (if required by State law) JF104376

The applicator has used a product in accordance with the product label and state requirements. All treatment materials and methods used comply with state and federal regulations.

Authorized Signature [Signature] Date 8-25-06

Warning: HUD will prosecute false claims and statements. Conviction may result in criminal and/or civil penalties. (18 U.S.C. 1001, 1010, 1012; 31 U.S.C. 3729, 3802)

Form NPCA-99-B may still be used

form HUD-NPCA-99-B (04/2003)

COLUMBIA COUNTY OFFICE OCCUPANCY

COLUMBIA COUNTY, FLORIDA

Department of Building and Zoning Inspection

This Certificate of Occupancy is issued to the below named permit holder for the building and premises at the below named location, and certifies that the work has been completed in accordance with the Columbia County Building Code.

Parcel Number 11-4S-16-02914-315

Building permit No. 000024824

Use Classification SFD, UTILITY

Fire: 16.74

Permit Holder TRENT GIEBEIG

Waste: 50.25

Owner of Building PETE GIEBEIG

Total: 66.99

Location: 313 SW MAYFAIR LANE, LAKE CITY, FL

Date: 07/26/2007

Harry Bieker

Building Inspector



POST IN A CONSPICUOUS PLACE
(Business Places Only)



BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION

MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

NOTICE OF ACCEPTANCE (NOA)

Ceco Door Products
9159 Telecom Drive
Milan, TN 38358

In Swing

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: The Ceco Series Single Flush / Embossed Inswing Commercial Steel Doors - Impact

APPROVAL DOCUMENT: Drawing No RD0728, titled "3-0 x 7-0, Series Regent, Omega, Imperial, Versa door", prepared by manufacturer, sheets 1 through 9 of 9 dated 05/22/02 and latest revised on 10-10-02, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.


INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by Ishaq I. Chanda, P.E.




NOA No 02-0807.04
Expiration Date: October 31, 2007
Approval Date: October 31, 2002
Page 1




Masonry 'T' Anchor

Min. 3500 PSI

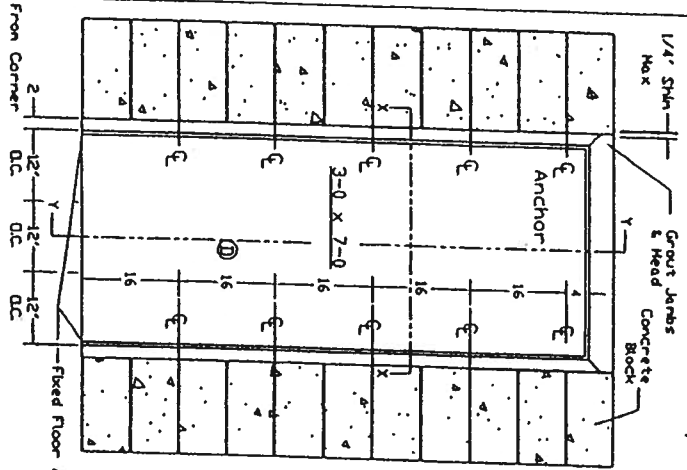


Masonry Wire Anchor

Min. 3500 PSI

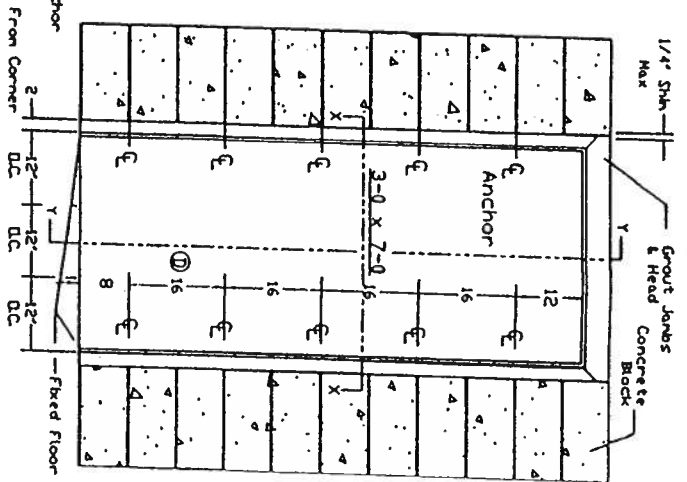


Existing Opening V/Lockbolt or Sleeve Anchor Into Block


Min. 3500 PSI

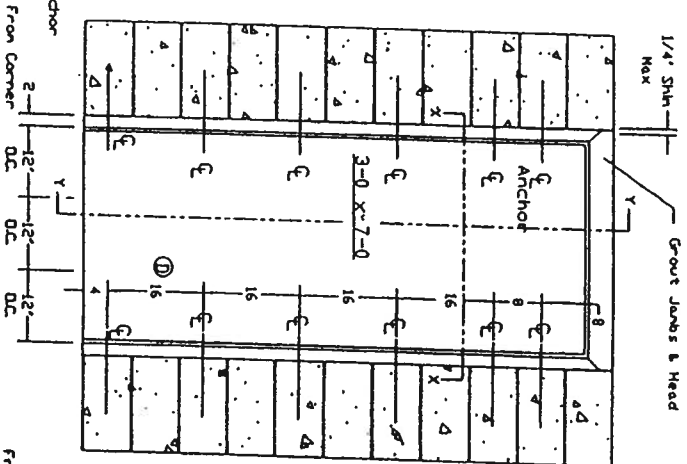



Existing Opening Anchor Into Wood Stud

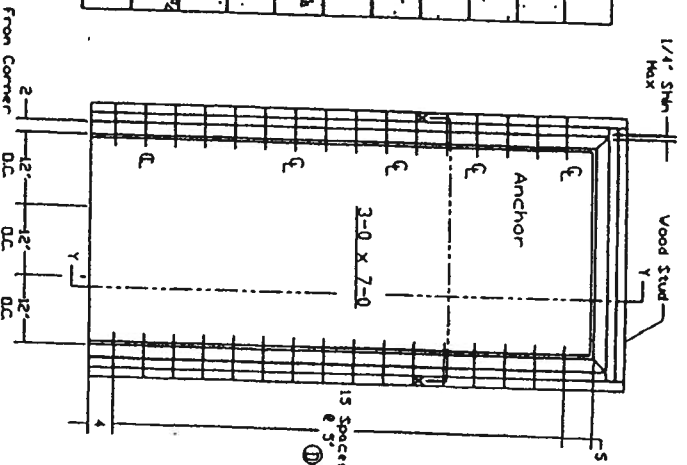

ALL Dimensions Are Inches

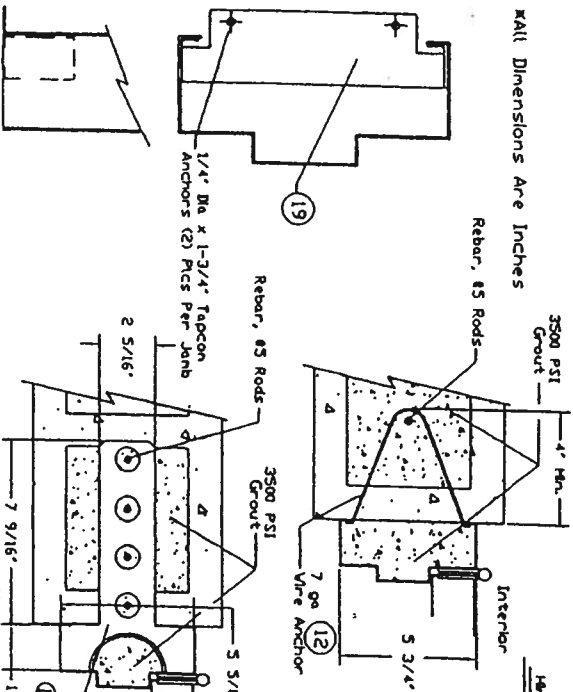

Installation Details
Hinge Jamb / Lock Jamb

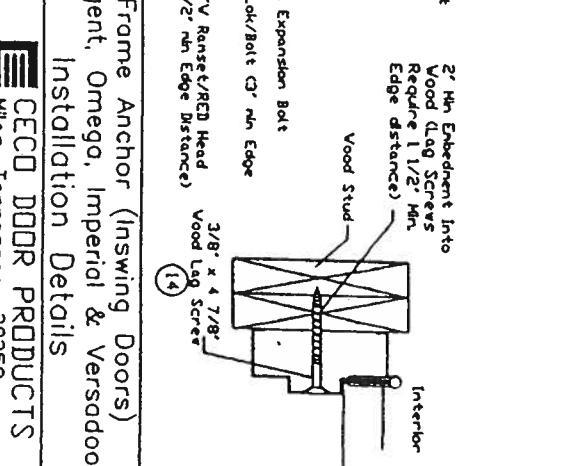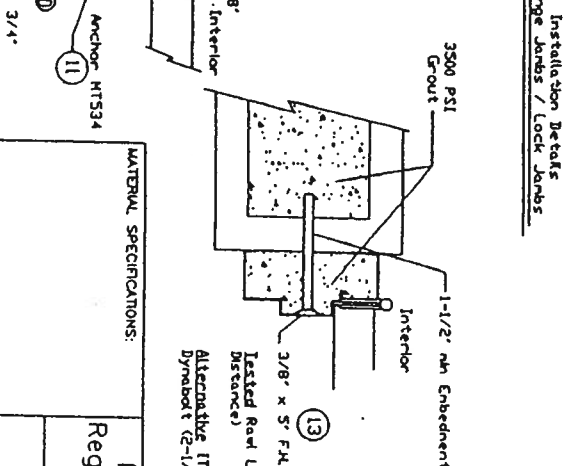

MATERIAL SPECIFICATIONS:

Frame Anchor (Inswing Doors)
Regent, Omega, Imperial & Versadoor
Installation Details


CECD DOOR PRODUCTS
Milan, Tennessee 38358

ISSUE	REVISIONS
DRAWN BY: LT	DATE: 5/22/02
REVIEWED BY: A	REVISIONS
UP-DOWN DRAWINGS FROM	ISHAQ CHANDRA

Approved as complying with the
Florida Building Code
Date: OCT 11/2002
MOA 10-0-0-07-04
Miami-Dade Building Control
Division
By: [Signature] Claude

RD0728
Sheet 2 of 9

Inswing
(Not Approved For Water)

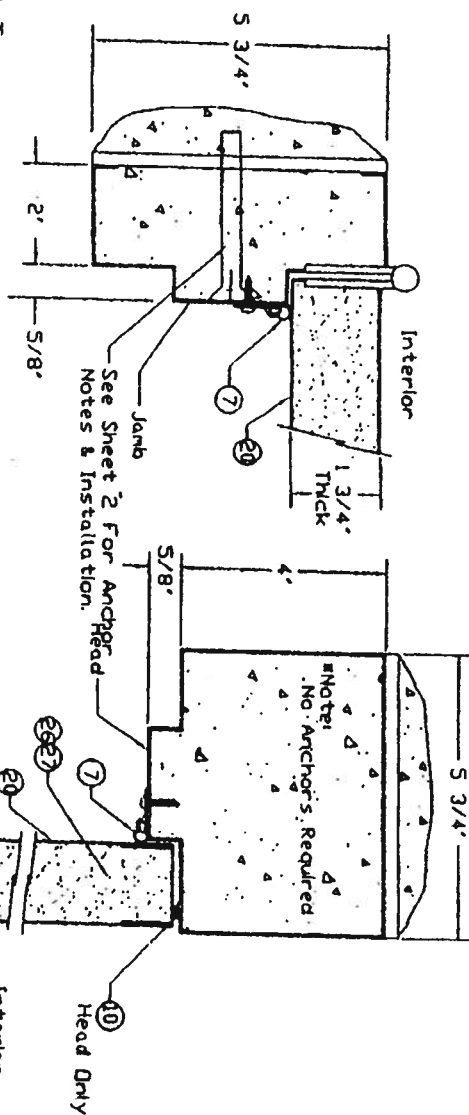

Section Y-Y

Approved as complying with the
Florida Building Code
Date 07/31/2001
NOA# 02-080704
Johnai Duke, President, Camacho
Division
By Charles J. Lounds

B LT	Revised Per Marked-Up Drawings From Isthm Oranda
C LT	Revised Per Marked-Up Drawings From Isthm Oranda


MATERIAL SPECIFICATIONS:

**Threshold & Weatherstrip (Inswing Doors,
Regent, Omega, Imperial, Versadoor
Installation Details**

CECD DOOR PRODUCTS
Milan, Tennessee 38358

RD0728
Sheet 3 of 9

*Note: Structural Member At Head Must Be Designed To Carry 58.3 #/ft. Load Imposed And Must Be Reviewed By Building Official.

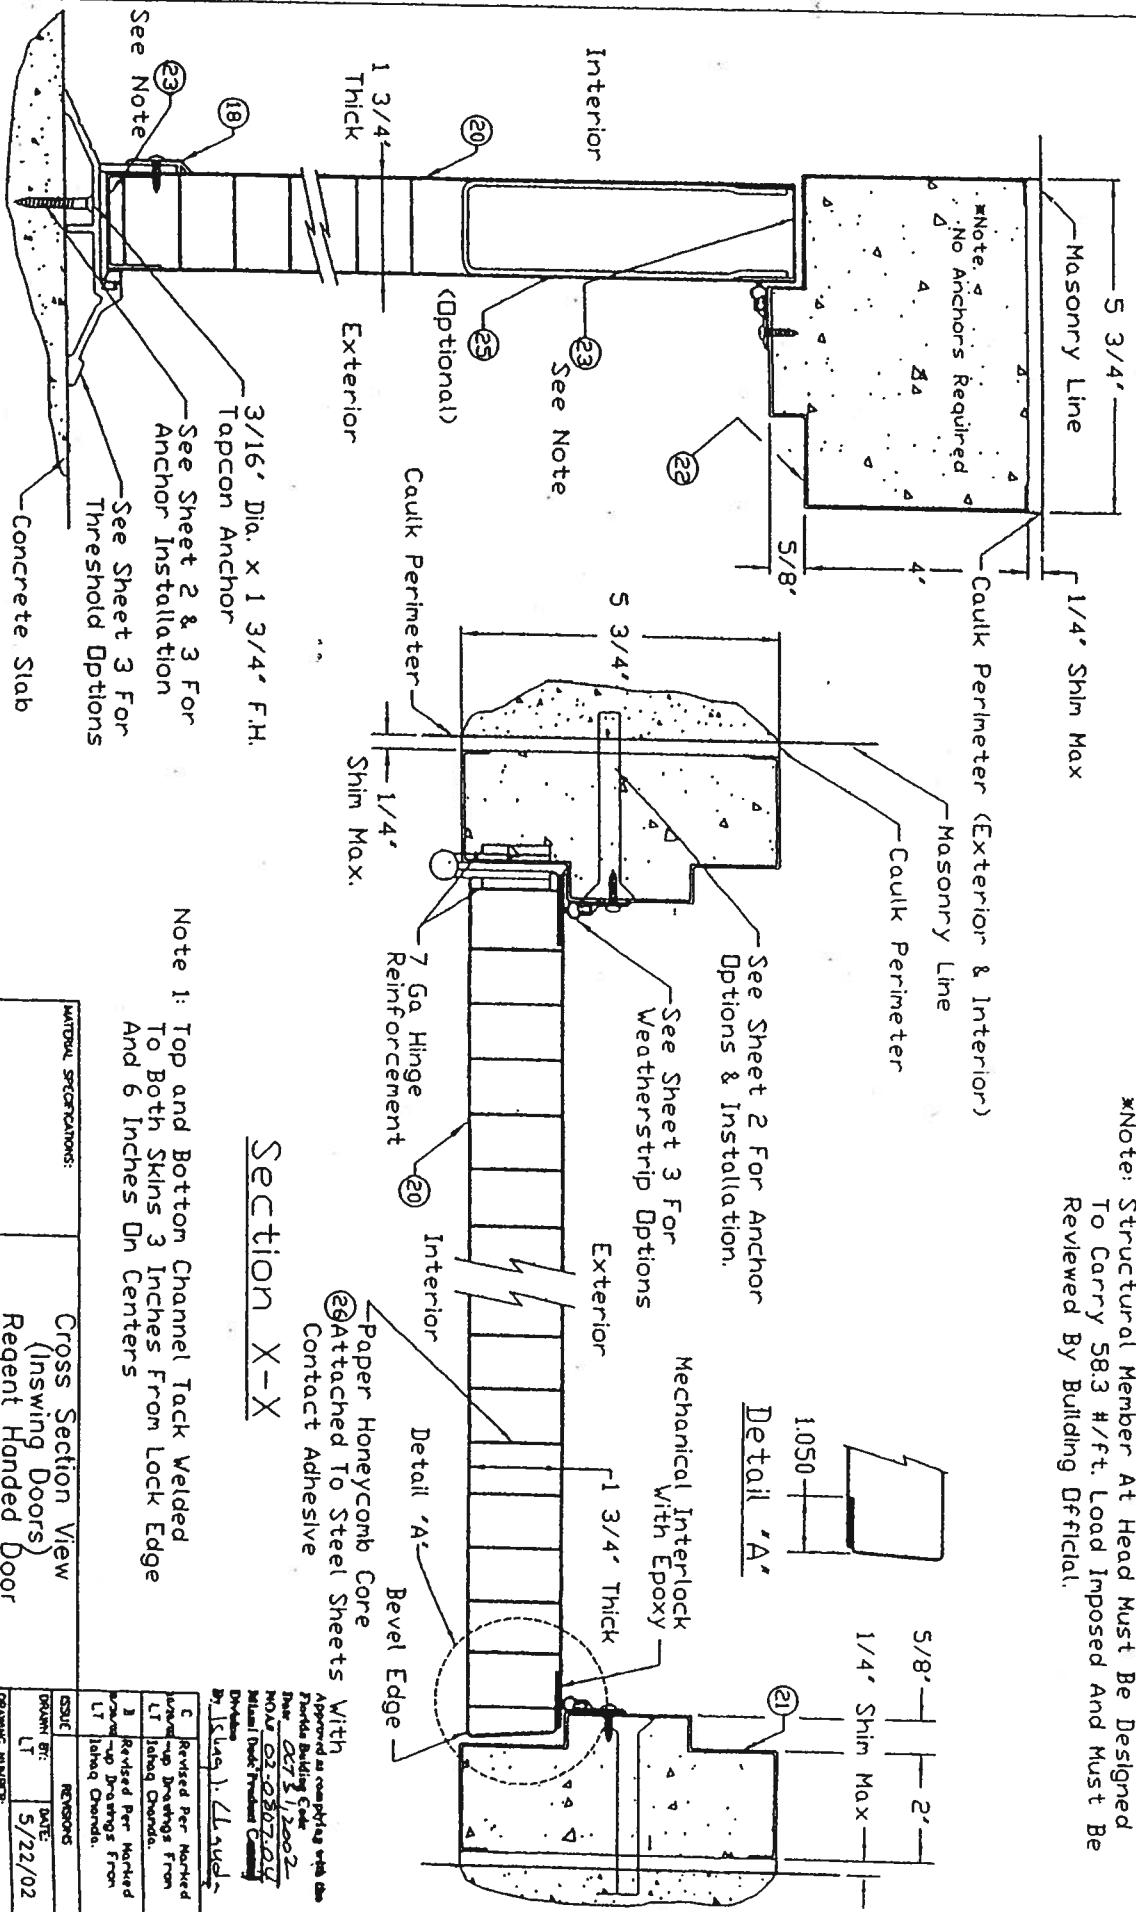


Note 1: Top and Bottom Channel Track Welded To Both Skins 3 Inches From Lock Edge And 6 Inches On Centers

Section X-X

Paper Honeycomb Core Attached To Steel Sheets With Contact Adhesive

Detail 'A'

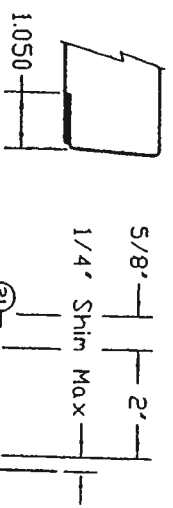

MAINTAIN SPECIFICATIONS:

Cross Section View (Inswing Doors)

Regent Handed Door

CECO DOOR PRODUCTS

Milan, Tennessee 38358

DRAWN BY: DATE:

LT 5/22/02

REVISIONS:

1 Revised Per Noted

2 Revised Per Noted

3 Revised Per Noted

4 Revised Per Noted

5 Revised Per Noted

6 Revised Per Noted

7 Revised Per Noted

8 Revised Per Noted

9 Revised Per Noted

10 Revised Per Noted

11 Revised Per Noted

12 Revised Per Noted

13 Revised Per Noted

14 Revised Per Noted

15 Revised Per Noted

16 Revised Per Noted

17 Revised Per Noted

18 Revised Per Noted

19 Revised Per Noted

20 Revised Per Noted

21 Revised Per Noted

22 Revised Per Noted

23 Revised Per Noted

24 Revised Per Noted

25 Revised Per Noted

26 Revised Per Noted

27 Revised Per Noted

28 Revised Per Noted

29 Revised Per Noted

30 Revised Per Noted

31 Revised Per Noted

32 Revised Per Noted

33 Revised Per Noted

34 Revised Per Noted

35 Revised Per Noted

36 Revised Per Noted

37 Revised Per Noted

38 Revised Per Noted

39 Revised Per Noted

40 Revised Per Noted

41 Revised Per Noted

42 Revised Per Noted

43 Revised Per Noted

44 Revised Per Noted

45 Revised Per Noted

46 Revised Per Noted

47 Revised Per Noted

48 Revised Per Noted

49 Revised Per Noted

50 Revised Per Noted

51 Revised Per Noted

52 Revised Per Noted

53 Revised Per Noted

54 Revised Per Noted

55 Revised Per Noted

56 Revised Per Noted

57 Revised Per Noted

58 Revised Per Noted

59 Revised Per Noted

60 Revised Per Noted

61 Revised Per Noted

62 Revised Per Noted

63 Revised Per Noted

64 Revised Per Noted

65 Revised Per Noted

66 Revised Per Noted

67 Revised Per Noted

68 Revised Per Noted

69 Revised Per Noted

70 Revised Per Noted

71 Revised Per Noted

72 Revised Per Noted

73 Revised Per Noted

74 Revised Per Noted

75 Revised Per Noted

76 Revised Per Noted

77 Revised Per Noted

78 Revised Per Noted

79 Revised Per Noted

80 Revised Per Noted

81 Revised Per Noted

82 Revised Per Noted

83 Revised Per Noted

84 Revised Per Noted

85 Revised Per Noted

86 Revised Per Noted

87 Revised Per Noted

88 Revised Per Noted

89 Revised Per Noted

90 Revised Per Noted

91 Revised Per Noted

92 Revised Per Noted

93 Revised Per Noted

94 Revised Per Noted

95 Revised Per Noted

96 Revised Per Noted

97 Revised Per Noted

98 Revised Per Noted

99 Revised Per Noted

100 Revised Per Noted

101 Revised Per Noted

102 Revised Per Noted

103 Revised Per Noted

104 Revised Per Noted

105 Revised Per Noted

106 Revised Per Noted

107 Revised Per Noted

108 Revised Per Noted

109 Revised Per Noted

110 Revised Per Noted

111 Revised Per Noted

112 Revised Per Noted

113 Revised Per Noted

114 Revised Per Noted

115 Revised Per Noted

116 Revised Per Noted

117 Revised Per Noted

118 Revised Per Noted

119 Revised Per Noted

120 Revised Per Noted

121 Revised Per Noted

122 Revised Per Noted

123 Revised Per Noted

124 Revised Per Noted

125 Revised Per Noted

126 Revised Per Noted

127 Revised Per Noted

128 Revised Per Noted

129 Revised Per Noted

130 Revised Per Noted

131 Revised Per Noted

132 Revised Per Noted

133 Revised Per Noted

134 Revised Per Noted

135 Revised Per Noted

136 Revised Per Noted

137 Revised Per Noted

138 Revised Per Noted

139 Revised Per Noted

140 Revised Per Noted

141 Revised Per Noted

142 Revised Per Noted

143 Revised Per Noted

144 Revised Per Noted

145 Revised Per Noted

146 Revised Per Noted

147 Revised Per Noted

148 Revised Per Noted

149 Revised Per Noted

150 Revised Per Noted

151 Revised Per Noted

152 Revised Per Noted

153 Revised Per Noted

154 Revised Per Noted

155 Revised Per Noted

156 Revised Per Noted

157 Revised Per Noted

158 Revised Per Noted

159 Revised Per Noted

160 Revised Per Noted

161 Revised Per Noted

162 Revised Per Noted

163 Revised Per Noted

164 Revised Per Noted

165 Revised Per Noted

166 Revised Per Noted

167 Revised Per Noted

168 Revised Per Noted

169 Revised Per Noted

170 Revised Per Noted

171 Revised Per Noted

172 Revised Per Noted

173 Revised Per Noted

174 Revised Per Noted

175 Revised Per Noted

176 Revised Per Noted

177 Revised Per Noted

178 Revised Per Noted

179 Revised Per Noted

180 Revised Per Noted

181 Revised Per Noted

182 Revised Per Noted

183 Revised Per Noted

184 Revised Per Noted

185 Revised Per Noted

186 Revised Per Noted

187 Revised Per Noted

188 Revised Per Noted

189 Revised Per Noted

190 Revised Per Noted

191 Revised Per Noted

192 Revised Per Noted

193 Revised Per Noted

194 Revised Per Noted

195 Revised Per Noted

196 Revised Per Noted

197 Revised Per Noted

198 Revised Per Noted

199 Revised Per Noted

200 Revised Per Noted

201 Revised Per Noted

202 Revised Per Noted

203 Revised Per Noted

204 Revised Per Noted

205 Revised Per Noted

206 Revised Per Noted

207 Revised Per Noted

208 Revised Per Noted

209 Revised Per Noted

210 Revised Per Noted

211 Revised Per Noted

212 Revised Per Noted

213 Revised Per Noted

214 Revised Per Noted

215 Revised Per Noted

216 Revised Per Noted

217 Revised Per Noted

218 Revised Per Noted

219 Revised Per Noted

220 Revised Per Noted

221 Revised Per Noted

222 Revised Per Noted

223 Revised Per Noted

224 Revised Per Noted

225 Revised Per Noted

226 Revised Per Noted

227 Revised Per Noted

228 Revised Per Noted

229 Revised Per Noted

230 Revised Per Noted

231 Revised Per Noted

232 Revised Per Noted

233 Revised Per Noted

234 Revised Per Noted

235 Revised Per Noted

236 Revised Per Noted

237 Revised Per Noted

238 Revised Per Noted

239 Revised Per Noted

240 Revised Per Noted

241 Revised Per Noted

242 Revised Per Noted

243 Revised Per Noted

244 Revised Per Noted

245 Revised Per Noted

246 Revised Per Noted

247 Revised Per Noted

248 Revised Per Noted

249 Revised Per Noted

250 Revised Per Noted

251 Revised Per Noted

252 Revised Per Noted

253 Revised Per Noted

254 Revised Per Noted


255 Revised Per Noted

256 Revised Per Noted

257 Revised Per Noted

258 Revised Per Not

Note: Structural member at Head Must Be Designed To carry 58.3 #/ft. Load Imposed and Must Be Reviewed By Building Official.

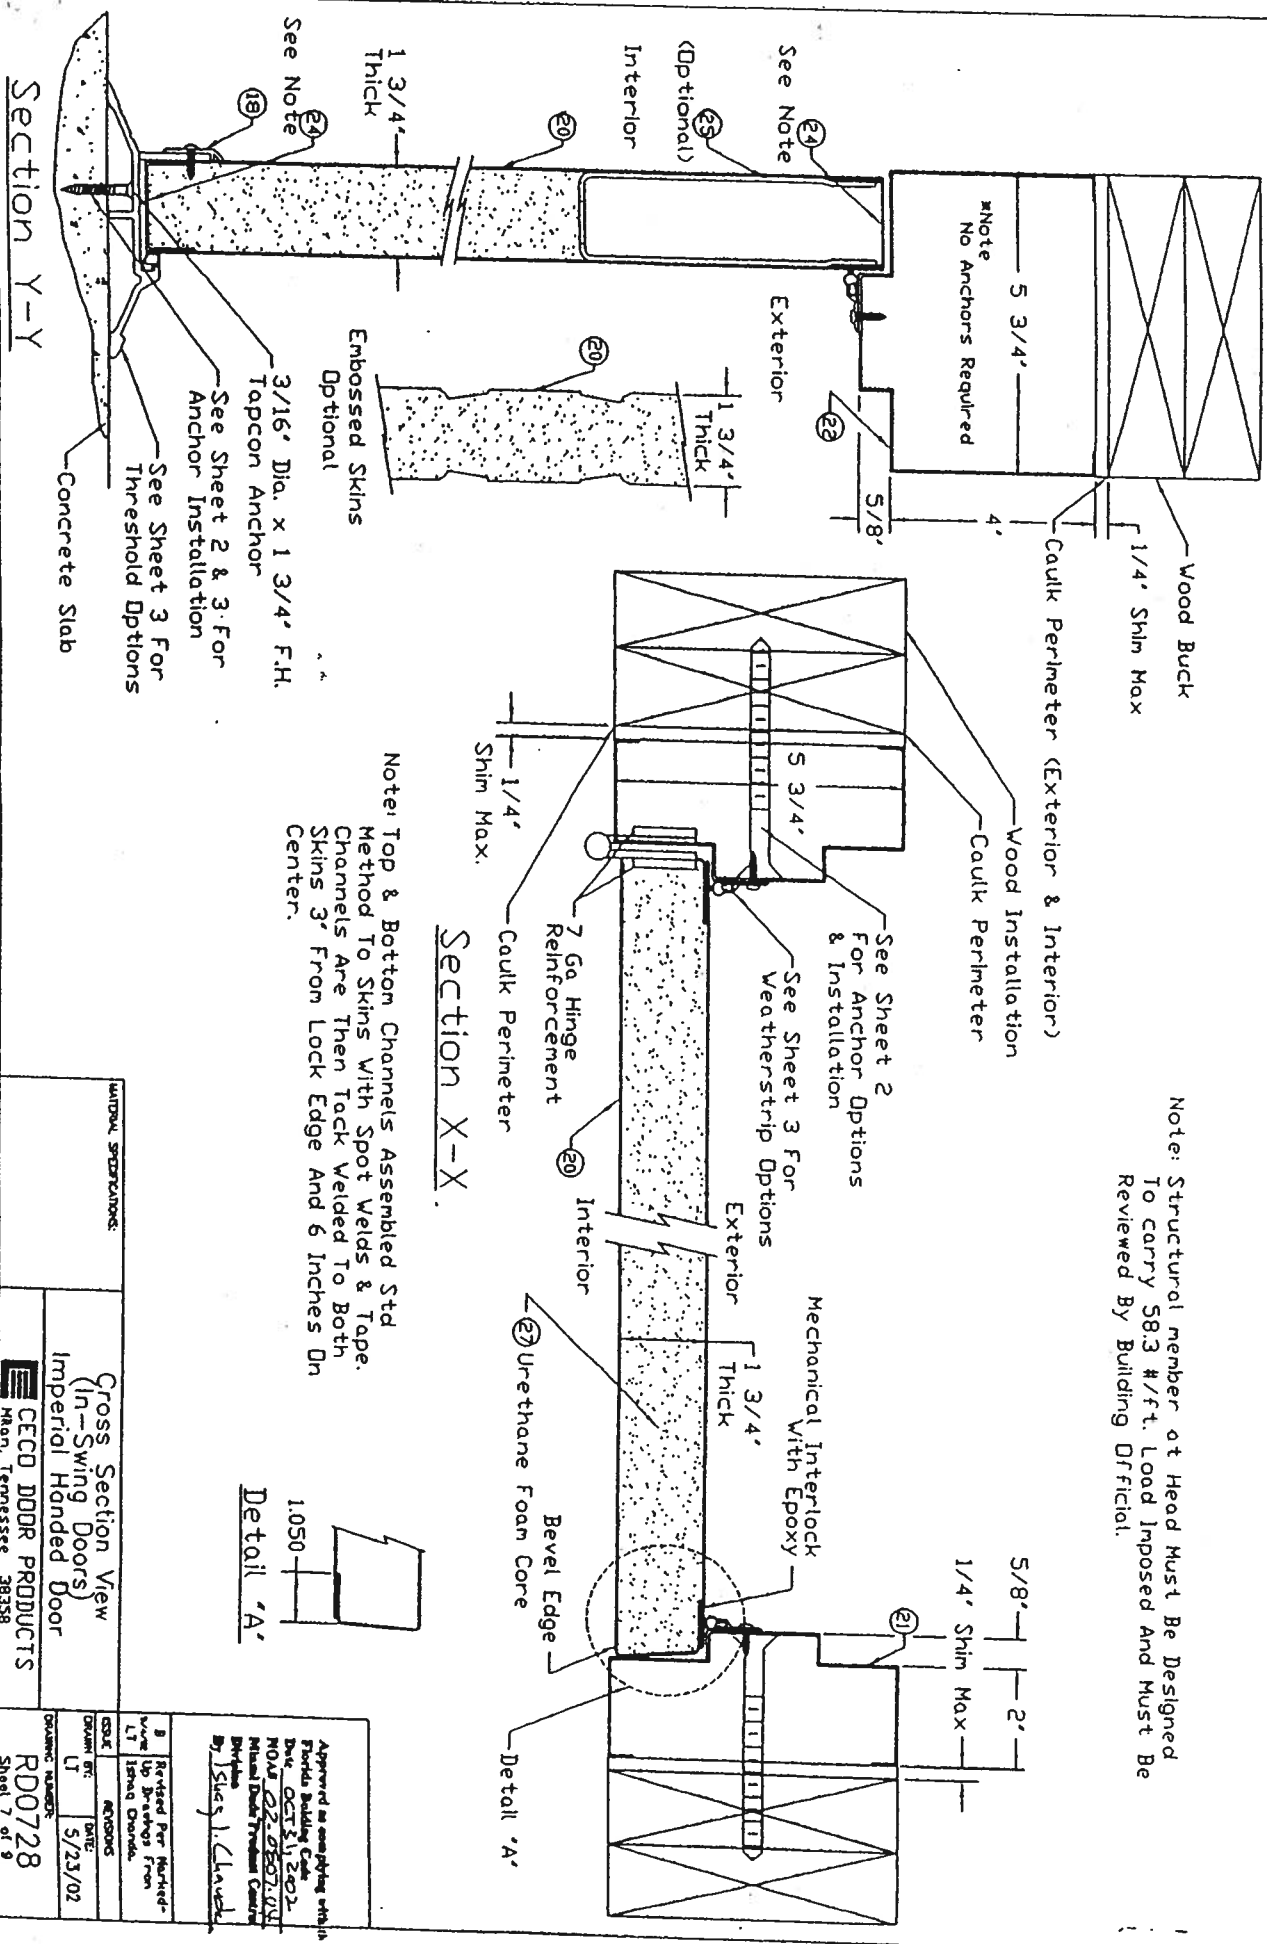

Section X-X

Note: Top & Bottom Channels Assembled Std Method To Skins With Spot Welds & Tape. Channels Are Then Tack Welded To Both Skins 3" From Lock Edge And 6 Inches On Center.


Detail 'A'



DRAWING INFORMATION:		Cross Section View (In-Swing Doors) Imperial Handed Door	
		CECD DOOR PRODUCTS Man, Tennessee 38338	
DESIGN	REVISIONS	DATE	REVISIONS
LT	1	5/23/02	Revised Per Market- wide Up Drawings from Ismael Channel.
DRAWING NUMBER		RD0728	
		Sheet 7 of 9	

Approved as complying with
Florida Building Code
Date: OCT 31, 2002
MOA 02-0807-001
Michael D. Dwyer, County
By: [Signature] (Clerk)

Note: Structural member at Head Must Be Designed To Carry 58.3 #/ft. Load Imposed And Must Be Reviewed By Building Official.

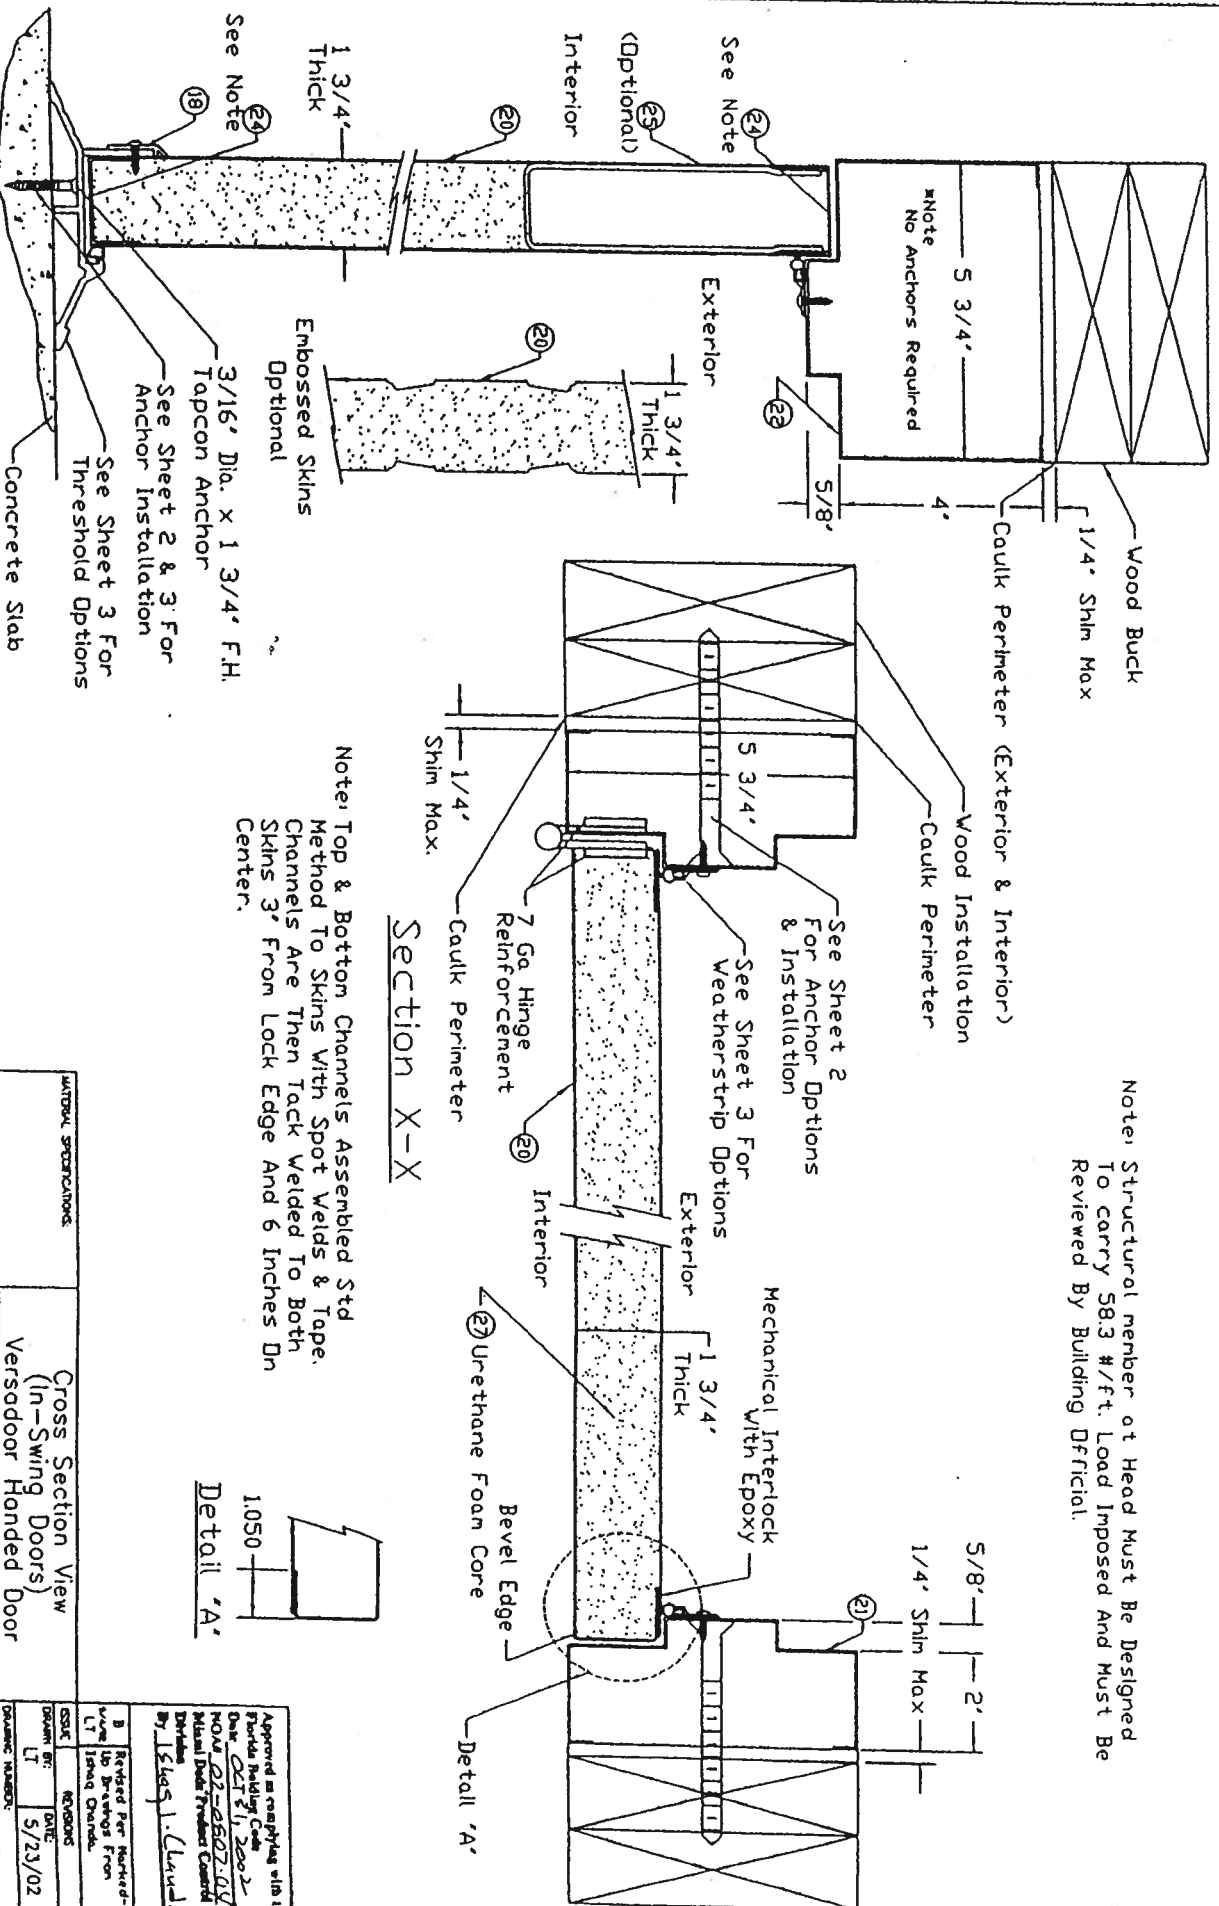

Note: Top & Bottom Channels Assembled Std Method To Skins With Spot Welds & Tape. Channels Are Then Tack Welded To Both Skins 3' from Lock Edge And 6 Inches On Center.

Detail 'A'

MANUFACTURER'S SPECIFICATIONS:		Cross Section View (In-Swing Doors)	
		Versadoor Handed Door	
		CECD DOOR PRODUCTS	
		Mid., Tennessee 38338	
DATE:	5/23/02	DESIGNER:	RD0728
BY:	LT	REVISIONS:	Sheet 8 of 9
Revised Per Manufacturer's Drawing From Issued Channels.			

Approved as meeting with the Florida Building Code
Date: 02/21/2002
MOA 02-6607-02
Metal Door Products Council
Division
By: [Signature] - Cleveland

RD0728
Sheet 8 of 9

1	Cylindrical Lock & Lock Reinforcement (RD0528)	Schlage	AL53PD
1A	Deadbolt (Optional) (D)	Schlage	B100
2	Dr Cylindrical Lock & Lock Reinforcement	Saflok	Premier SL2500
3	Dr Mortise Lock	Saflok	MT
4	Coil	Dow Corning	899 Silicone Glazing Sealant
5	Threshold	Penko	2005AV36
6	Dr	Penko	181AV36
7	Weatherstrip	Penko	303AV3684
8	Hinge (Ball Bearing)	Hager or Equal (Attached w/ (8) #12-24 x 1/2 HS Per Hinge)	4-1/2 x 4-1/2 x .134 (Std Weight)
9	Dr (Spring)	Hager or Equal (Attached w/ (8) #12-24 x 1/2 HS Per Hinge)	4-1/2 x 4-1/2 x .134 (Std Weight)
10	Weatherstrip	Penko	S88
11	Frame Anchor	Masonry Tee (RD0057)	16 ga (.053" min) Galv Steel Fymin = 30ksi
12	Dr	Wire, Relaxed Dimension 9' x 8'	#7 (.167" min) Galv Steel Wire (70,000 - 90,000 psi Tensile Strength)
13	Dr	Expansion Bolt	3/8" x 5" F.H. Rawl Lok/Bolt
14	Dr	Wood Lag Screw	Dr 3/8" x 5" F.H. Ramset/RED Head
15	Viewer	Hager	3/8" x 4-5/8"
16	Dr	MAG Security	1755
17	Drip Cap Top	Penko	8724-C
18	Sweep	Penko	346
19	Floor Anchor	Fixed Floor Anchor	315 N
20	Face Sheet A60 Galv Conforming To ASTM A653	Commercial Steel Type B (Minimum Yield Strength 30,000psi)	16 ga (.053" min) galvanized Steel
21	Series SF, Frame Jamb, Double Rabbit Profile, A60 Galv Conforming To ASTM A653	16 Ga (.053" min)	16 Ga (.053" min)
22	Series SF, Frame Head, Double Rabbit, Profile A60 Galv Conforming To ASTM A653	Commercial Steel Type B (Minimum Yield Strength 30,000psi)	2" Face, 5-3/4" Depth Min. (RD0033)
23	Door Channels Spot Welded To Bottom Skin	16 Ga (.053" min)	4" Face, 5-3/4" Depth Min. (RD0033)
24	Door Channels Spot Welded To Bottom Skin	16 Ga (.053" min) A60 Galv Conforming To ASTM A653	16 ga (.053" min) x 1" x 1-3/4" x 1"
25	Taped To Top Skin Jack Welded To Bottom Skin	16 Ga (.053" min) A60 Galv Conforming To ASTM A653	16 ga (.053" min) x 1" x 1-3/4" x 1"
26	Closer Reinforcement (Optional)	Commercial Steel Type B (Minimum Yield Strength 30,000psi)	12 ga (.093" min) x 5-3/8" x 16"
27	Honeycomb Core	Non-impregnated Kraft Paper (E)	12" Nominal Cell Size
28	Urethane Core	Foam Enterprises	2 lb/ft ³ Density

MATERIAL SPECIFICATIONS:

3-0 x 7-0 Series

In-Swing Bill Of Materials


 **CECO DOOR PRODUCTS**
Millon, Tennessee 38358

ISSUE REVISIONS

DRAWN BY: DATE: 5/28/02

LT

DRAWING NUMBER: **RD0728**
Sheet 9 of 9

Approved as applying with the
Florida Building Code
Doc. 06-3112002
NOAR 02-0507.00
Millon Lock Products Certified
By:  1/1/02

B Revised Per Marked-
10/10/02 Up Drawings From
LT Ishod Chanda.
A Revised Per Marked-
9/4/02 Up Drawings From
LT Ishod Chanda.



Architectural Testing

**ANSI/AAMA/NWDA 101/I.S.2-97
TEST REPORT**

Rendered to:

MI HOME PRODUCTS, INC.

**SERIES/MODEL: 480/680/880 Drop-in
PRODUCT TYPE: Aluminum Horizontal
Sliding Window (XO-Fin)**

Title	Results	
	Test Specimen #1	Test Specimen #2
Rating	HS-C30 71 x 71	HS-C40 71 x 59
Operating Force	11 lbf max.	14 lbf max.
Air Infiltration	0.11 cfm/ft ²	0.09 cfm/ft ²
Water Resistance Test Pressure	5.3 psf	6.0 psf
Uniform Load Deflection Test Pressure	± 30.0 psf	+ 45.0 psf -47.2 psf
Uniform Structural Load Test Pressure	± 45.0 psf	+ 67.5 psf -70.8 psf
Forced Entry Resistance	Grade 10	Grade 10

Reference should be made to ATI Report Identification No. 01-47320.03 for complete test specimen description and data.

130 Derry Court
York, PA 17402-9405
phone: 717.764.7700
fax: 717.764.4129
www.archtest.com



Architectural Testing

ANSI/AAMA/NWWDA 101/I.S.2-97 TEST REPORT

Rendered to:

MI HOME PRODUCTS, INC.
P.O. Box 370
650 West Market Street
Gratz, Pennsylvania 17030-0370

ATI Report Identification No.: 01-47320.03

Test Dates: 10/07/03
Through: 10/08/03
And: 12/01/03
And: 12/15/03
And: 03/17/04
Report Date: 04/16/04
Expiration Date: 10/07/07

Project Summary: Architectural Testing, Inc. (ATI) was contracted by MI Home Products, Inc. to witness testing on two Series/Model 480/680/880 Drop-in, aluminum horizontal sliding windows at MI Home Products, Inc. test facility in Elizabethville, Pennsylvania. The samples tested successfully met the performance requirements for the following ratings: Test Specimen #1: HS-C30 71 x 71; Test Specimen #2: HS-C40 71 x 59. Test specimen description and results are reported herein.

Test Specification: The test specimens were evaluated in accordance with ANSI/AAMA/NWWDA 101/I.S.2-97, *Voluntary Specifications for Aluminum, Vinyl (PVC) and Wood Windows and Glass Doors*.

Test Specimen Description:

Series/Model: 480/680/880 Drop-in

Product Type: Aluminum Horizontal Sliding Window (XO Fin)

Test Specimen #1: HS-C30 71 x 71

Overall Size: 5' 11-7/16" wide by 5' 11" high

Active Sash Size: 2' 11-5/8" wide by 5' 8-3/8" high

Fixed Daylight Opening Size: 2' 8-3/16" wide by 5' 5-5/8" high

Screen Size: 2' 10" wide by 5' 6-1/2" high



Architectural Testing

Test Specimen Description: (Continued)

Weatherstripping:

<u>Description</u>	<u>Quantity</u>	<u>Location</u>
0.250" high by 0.187" backed polypile with center fin	1 Row	Active sash top and bottom rails and fixed meeting rail interlock
0.250" high by 0.187" backed polypile with center fin	2 Rows	Jamb stile

Test Specimen #2: HS-C40 71 x 59

Overall Size: 5' 11-3/8" wide by 4' 11-1/8" high

Active Sash Size: 2' 11-5/8" wide by 4' 8-1/4" high

Fixed Daylight Opening Size: 2' 8-1/4" wide by 4' 5-7/8" high

Screen Size: 2' 10-1/4" wide by 4' 7-1/8" high

Weatherstripping:

<u>Description</u>	<u>Quantity</u>	<u>Location</u>
0.310" high by 0.187" backed polypile with center fin	1 Row	Active sash top and bottom rails
0.250" high by 0.187" backed polypile with center fin	1 Rows	Fixed meeting rail interlock
0.310" high by 0.187" backed polypile with center fin	2 Rows	Jamb stile
0.550" high by 1" by 1" backed polypile pad	1 Pad	Corner of bottom rail and locking stile



Architectural Testing

Test Specimen Description: (Continued)

The following descriptions apply to all specimens.

Finish: All aluminum was white.

Glazing Details: The window utilized 5/8" thick sealed insulating glass constructed from two sheets of 1/8" thick clear annealed glass and a Swiggle spacer system. The lites were interior glazed onto double-sided adhesive foam tape and secured with PVC snap-in glazing beads.

Frame Construction: The frame was constructed of thermally broken extruded aluminum. The corners were secured utilizing three #8 x 1" screws per corner through the jambs into the head and sill screw bosses. End caps were utilized on the ends of the fixed meeting rails and secured with two #8 x 3/4" screws per cap. The meeting rails were then secured to the frame with two #8 x 3/4" screws.

Sash Construction: The sash was constructed of thermally broken extruded aluminum. The corners were secured utilizing one #8 x 1" screw per corner through the head and sill into the jambs screw boss.

Screen Construction: The screen was constructed from roll-formed aluminum with keyed corners. The fiberglass mesh was secured with a flexible vinyl spline.

Hardware:

<u>Description</u>	<u>Quantity</u>	<u>Location</u>
Cam lock	1	One midspan of active panel with integral lock keeper on fixed meeting stile
Roller assembly	2	One each end of bottom rail
Screen constant force spring	2	5" from rails on screen stiles
Screen lift handles	2	5" from rails on screen stiles

Drainage:

<u>Description</u>	<u>Quantity</u>	<u>Location</u>
1-1/4" long by 1/4" wide weepslot with cover	2	3-1/2" from jambs on sill face
1/2" long by 1/8" wide weepslot	2	2" from jambs on sill track

Reinforcement: No reinforcement was utilized.

Installation: The window was installed into a #2 Spruce-Pine-Fir wood buck. The window was secured utilizing #8 x 1-5/8" drywall screws located in corners and 12" on center around nail-fin perimeter. Silicone was utilized around the exterior perimeter.



Architectural Testing

Test Results:

The results are tabulated as follows:

<u>Paragraph</u>	<u>Title of Test - Test Method</u>	<u>Results</u>	<u>Allowed</u>
<u>Test Specimen #1:</u> HS-C30 71 x 71			
2.2.2.5.1	Operating Force	11 lbf	25 lbf max.
2.1.2	Air Infiltration per ASTM E 283 1.57 psf (25 mph)	0.11 cfm/ft ²	0.3 cfm/ft ² max.

Note #1: The tested specimen meets the performance levels specified in ANSI/AAMA/NWDA 101/I.S. 2-97 for air infiltration.

2.1.3	Water Resistance per ASTM E 547-00 (with and without screen) 4.50 psf	No leakage	No leakage
2.1.4.1	Uniform Load Deflection per ASTM E 330 (Deflections reported were taken on the meeting stile) (Loads were held for 52 seconds) 30.0 psf (positive) 30.0 psf (negative)	0.75" 0.71"	See Note #2 See Note #2

Note #2: The Uniform Load Deflection test is not requirement of ANSI/AAMA/NWDA 101/I.S.2-97 for this product designation. The deflection data is recorded in this report for special code compliance and information only.

2.1.4.2	Uniform Load Structural per ASTM E 330 (Permanent sets reported were taken on the meeting stile) (Loads were held for 10 seconds) 45.0 psf (positive) 45.0 psf (negative)	0.13" <0.01"	0.26" max. 0.26" max.
2.2.2.5.2	Deglazing Test per ASTM E 987 In operating direction - 70 lbs Handle stile Lock stile	0.13"/25% 0.19"/38%	0.50"/100% 0.50"/100%
	In remaining direction - 50 lbs Top rail Bottom rail	0.09"/19% 0.06"/13%	0.50"/100% 0.50"/100%



Architectural Testing

Test Results: (Continued)

<u>Paragraph</u>	<u>Title of Test - Test Method</u>	<u>Results</u>	<u>Allowed</u>
------------------	------------------------------------	----------------	----------------

Test Specimen #1: HS-C30 71 x 71 (Continued)

2.1.8	Forced Entry Resistance per ASTM F 588		
-------	--	--	--

Type: A	Grade: 10		
---------	-----------	--	--

	Lock Manipulation Test	No entry	No entry
--	------------------------	----------	----------

	Test A1 thru A5	No entry	No entry
--	-----------------	----------	----------

	Test A7	No entry	No entry
--	---------	----------	----------

	Lock Manipulation Test	No entry	No entry
--	------------------------	----------	----------

Optional Performance

4.3	Water Resistance per ASTM E 547-00 (with and without screen) 5.3 psf	No leakage	No leakage
-----	--	------------	------------

Test Specimen #2: HS-C40 71 x 59

2.2.2.5.1	Operating Force	14 lbf	25 lbf max.
-----------	-----------------	--------	-------------

2.1.2	Air Infiltration per ASTM E 283 1.57 psf (25 mph)	0.09 cfm/ft ²	0.3 cfm/ft ² max.
-------	--	--------------------------	------------------------------

***Note #1:** The tested specimen meets the performance levels specified in ANSI/AAMA/NWDA 101/I.S. 2-97 for air infiltration.*

2.1.3	Water Resistance per ASTM E 547-00 (with and without screen) 4.50 psf	No leakage	No leakage
-------	---	------------	------------

2.1.4.1	Uniform Load Deflection per ASTM E 330 (Deflections reported were taken on the meeting stile) (Loads were held for 52 seconds) 30.0 psf (positive) 30.0 psf (negative)	0.62" 0.51"	See Note #2 See Note #2
---------	--	----------------	----------------------------

2.1.4.2	Uniform Load Structural per ASTM E 330 (Permanent sets reported were taken on the meeting stile) (Loads were held for 10 seconds) 45.0 psf (positive) 45.0 psf (negative)	0.03" 0.04"	0.21" max. 0.21" max.
---------	---	----------------	--------------------------



Architectural Testing

Test Results: (Continued)

<u>Paragraph</u>	<u>Title of Test - Test Method</u>	<u>Results</u>	<u>Allowed</u>
<u>Test Specimen #2:</u> HS-C40 71 x 59 (Continued)			
2.2.2.5.2	Deglazing Test per ASTM E 987 In operating direction - 70 lbs		
	Handle stile	0.13"/25%	0.50"/100%
	Lock stile	0.13"/25%	0.50"/100%
	In remaining direction - 50 lbs		
	Top rail	0.03"/6%	0.50"/100%
	Bottom rail	0.03"/6%	0.50"/100%
2.1.8	Forced Entry Resistance per ASTM F 588		
	Type: A	Grade: 10	
	Lock Manipulation Test	No entry	No entry
	Test A1 thru A5	No entry	No entry
	Test A7	No entry	No entry
	Lock Manipulation Test	No entry	No entry
<u>Optional Performance</u>			
4.3	Water Resistance per ASTM E 547-00 (with and without screen) 6.0 psf	No leakage	No leakage
4.4.1	Uniform Load Deflection per ASTM E 330 (Deflections reported were taken on the meeting stile) (Loads were held for 52 seconds)		
	45.0 psf (positive)	0.62"	See Note #2
	47.2 psf (negative)	0.54"	See Note #2
4.4.2	Uniform Load Structural per ASTM E 330 (Permanent sets reported were taken on the meeting stile) (Loads were held for 10 seconds)		
	67.5 psf (positive)	0.04"	0.21" max.
	70.8 psf (negative)	0.08"	0.21" max.

Detailed drawings, representative samples of the test specimen, and a copy of this report will be retained by ATI for a period of four years from the original test date. The above results were secured by using the designated test methods and they indicate compliance with the performance requirements of the above referenced specification. This report does not constitute certification of this product, which may only be granted by the certification program administrator. This report may not be reproduced except in full without approval of Architectural Testing.

For ARCHITECTURAL TESTING, INC.



Digitally Signed by: Eric Westphal


Eric Westphal
Technician

EW:dme
01-47320.03



Digitally Signed by: Steven M. Urich

Steven M. Urich, P. E.
Senior Project Engineer


APRIL 20, 2004



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Ceco Door Products
9159 Telecom Drive
Milan, TN 38358**

out swing

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "Regent" & "Omega" 18 ga. 3⁰-7⁰ Outswing Commercial Steel Door

APPROVAL DOCUMENT: Drawing No. RD0087, titled "3-0 x 7-0 Series", sheets 1 through 7 of 7, dated 5/30/97 with revision C dated 2/24/00, prepared by the manufacturer, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 00-0315.03 and consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 03-0411.01
Expiration Date August 14, 2008
Approval Date: May 15, 2003
Page 1**

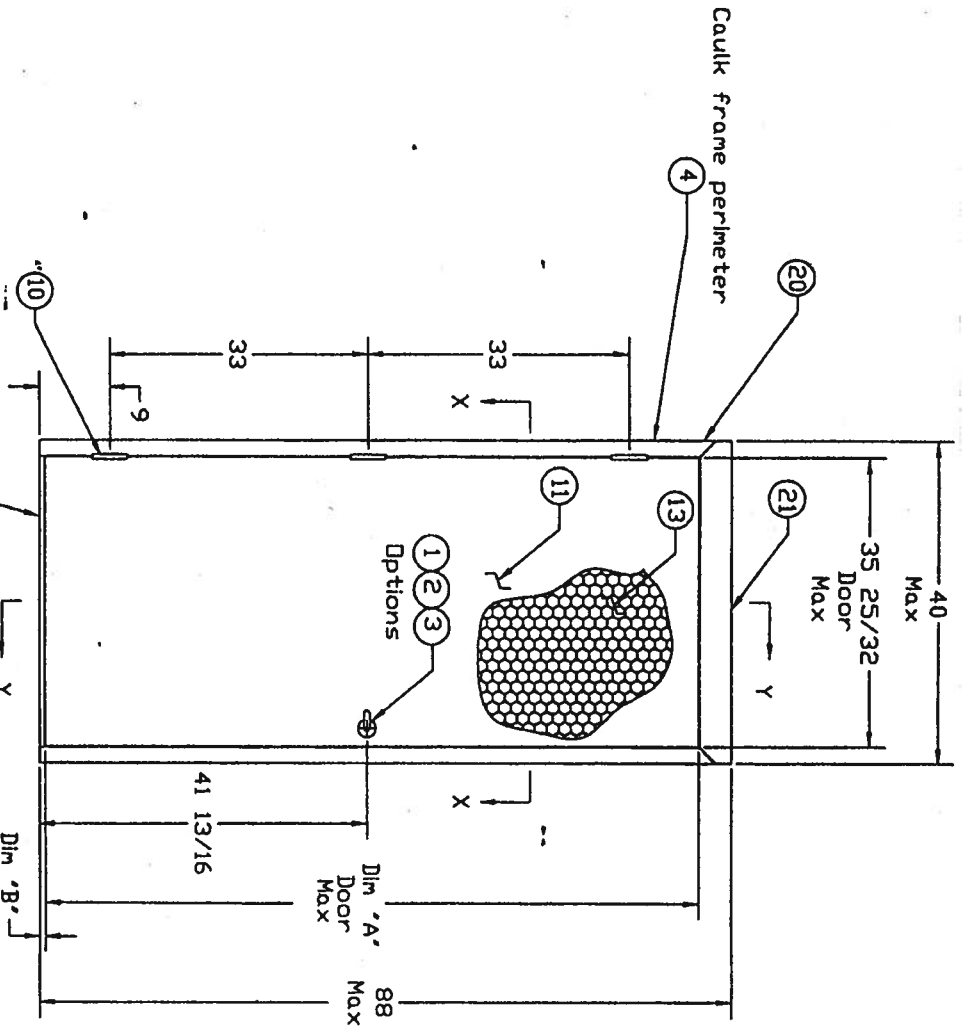

Design Pressure	
Tested for Water Penetration	
With Overhang	+85 psf -60 psf
Without Overhang	+60 psf -60 psf

	Dim 'A'	Dim 'B'
3/4" Undercut	83 1/8	3/4
3/8" Undercut	83 1/2	3/8

4 Caulk Underneath Threshold

Sheet 2	Frame Anchor Installation
Sheet 3	Threshold Installation
Sheet 3	Weatherstrip Installation
Sheet 4	Door Latch Reinforcement
Sheet 5-6	Cross Section View
Sheet 7	Bill Of Material


PRODUCT REVIEWED
AS COMPLIANT WITH THE FLORIDA
BUILDING CODE
ACCEPTANCE NO. 03-041-01
EXPIRATION DATE 03/14/2008
BY: *[Signature]*
Village of Product Control
Division

MATERIAL SPECIFICATIONS:
Finish: Rust Inhibitive Primer


3-0 x 7-0 Series
Elevation Drawing

CECD DOOR PRODUCTS
Millon, Tennessee 38358


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE 08/2008 BY: <i>[Signature]</i> PRODUCED CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. 03-0315-03	
5/03/08 Revised Form, Transferred Information from NOA	7/22/97 Revised 02 Drawings Revised Sheet Numbers
ISSUE	REVISIONS
DRAWN BY: GWS	DATE: 5/30/97
DRAWING NUMBER: RD0087	Sheet 1 of 7

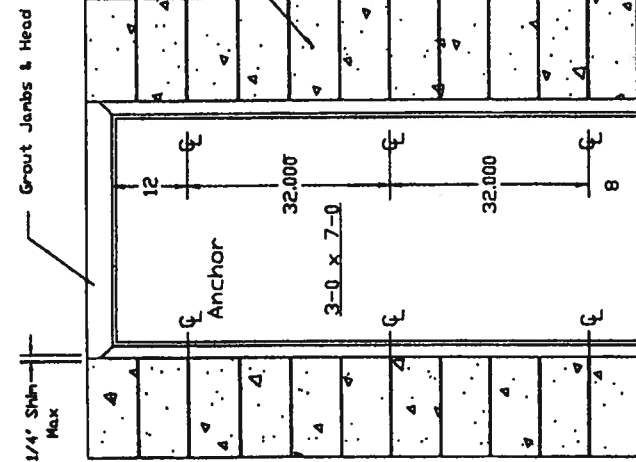




Masonry 'T' Anchor

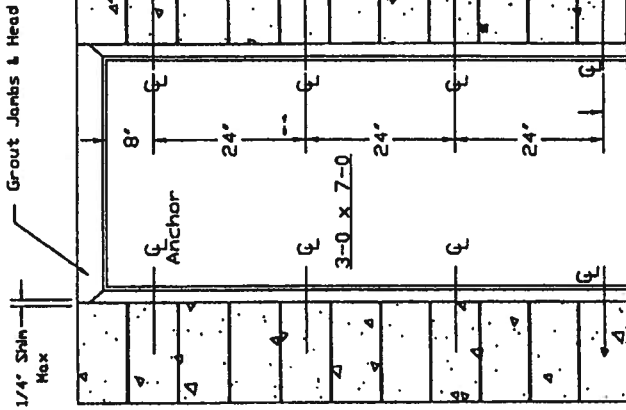

Existing Opening Anchor Into Block

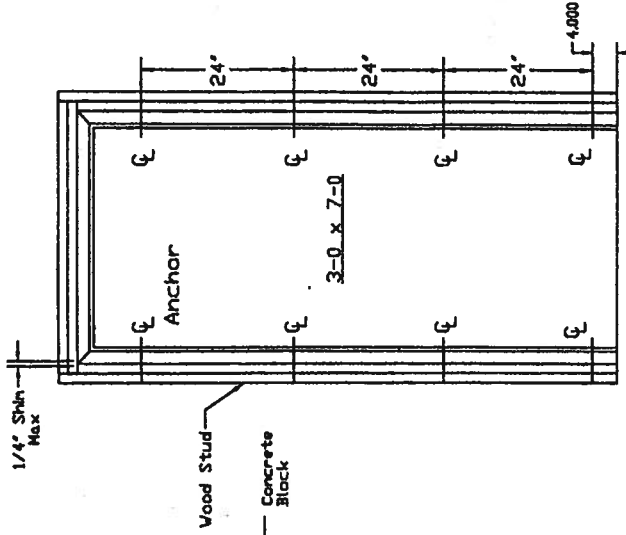

Existing Opening Anchor Into Wood Stud

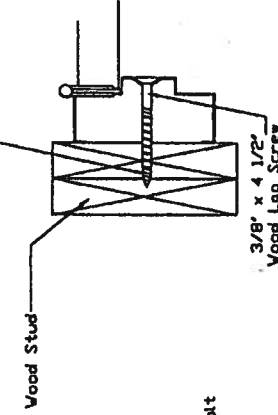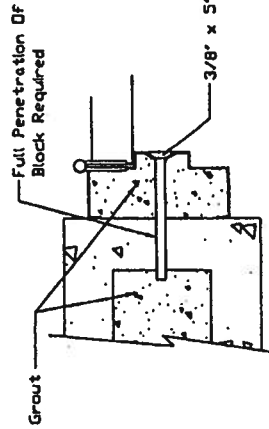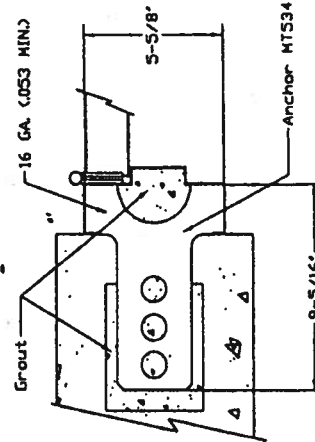







NOTES:
1. SEE SHEET 7 FOR BILL OF MATERIALS

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 03-0411.01
Expiration Date 06/16/2008
By *Manuel Diaz*
Miami/Dade Product Control
Division


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *June 08, 2000*
BY *Manuel Diaz*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0315-03

2/2/00 GWS	Revised Format, Transferred Information from NOA
7/22/07 GWS	Revised Sheet Number
ISSUE	REVISIONS
DRAWN BY: GWS	DATE: 5/30/97
DRAWING NUMBER: RD0087	Sheet 2 of 7


Frame Anchor
Installation Details
CECO DOOR PRODUCTS
Milan, Tennessee 38358

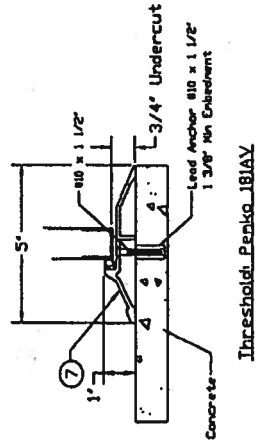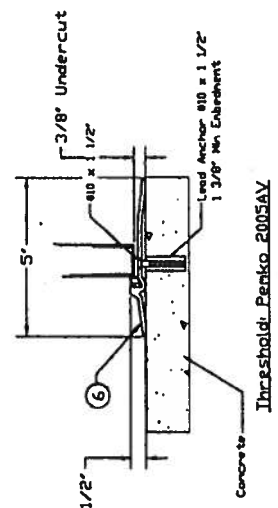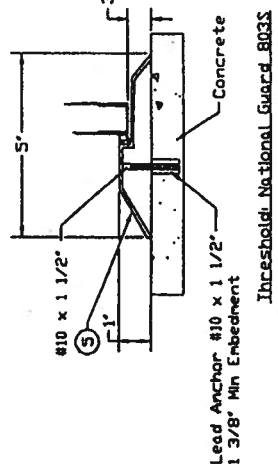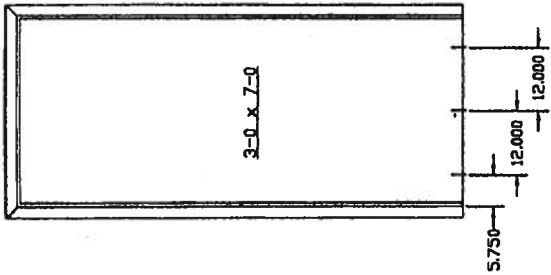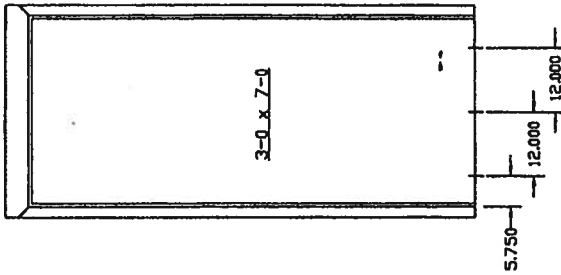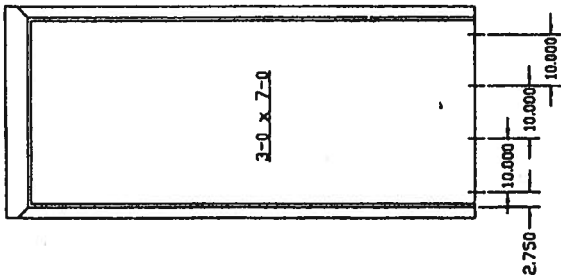

NOTE: 1. All thresholds shown are made from extruded aluminum with slide-in vinyl weatherstrip insert.

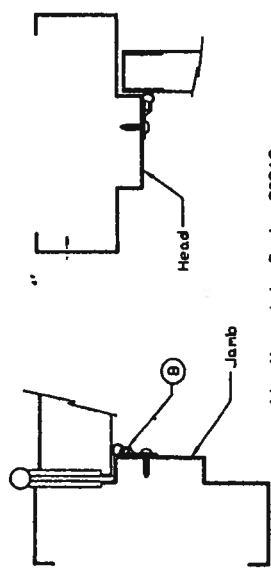

NOTE:
2. LOCATION: ALONG THE ENTIRE HEAD AND JAMB PERIMETER. ATTACHED WITH THIRTY FOUR (34) #8 X 3/4" PPH SMS SPACED AT 6" O/C.



NOTE:
3. LOCATION: ALONG THE ENTIRE HEAD AND JAMB PERIMETER. ATTACHED WITH THIRTY FOUR (34) #8 X 3/4" PPH SMS SPACED AT 6" O/C.

MATERIAL SPECIFICATIONS:

Threshold & Weatherstrip Installation details


CECO DOOR PRODUCTS
Milan, Tennessee 38358

NOTE: 4. See Sheet 7 For Bill of Material

PRODUCT REVIEWED
as complying with the Florida
Building Code
Acceptance No. 03-041-01
Expiration Date 06/16/2008
By: [Signature]
Miami-Pada Product Control
Division


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE: June 08 2000
BY: [Signature]
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0315-03

2/24/00	Revised Format, Transferred
JAN	Information from NDA
7/22/97	Revised Sheet Number
005	
ISSUE	REVISIONS
DRAWN BY: GWS	DATE: 5/30/97
RD0087	
Sheet 3 of 7	

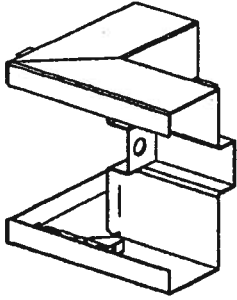


Interlocking Fold Over Tab

Frame Head

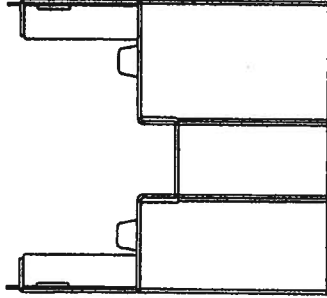


Frame Jamb

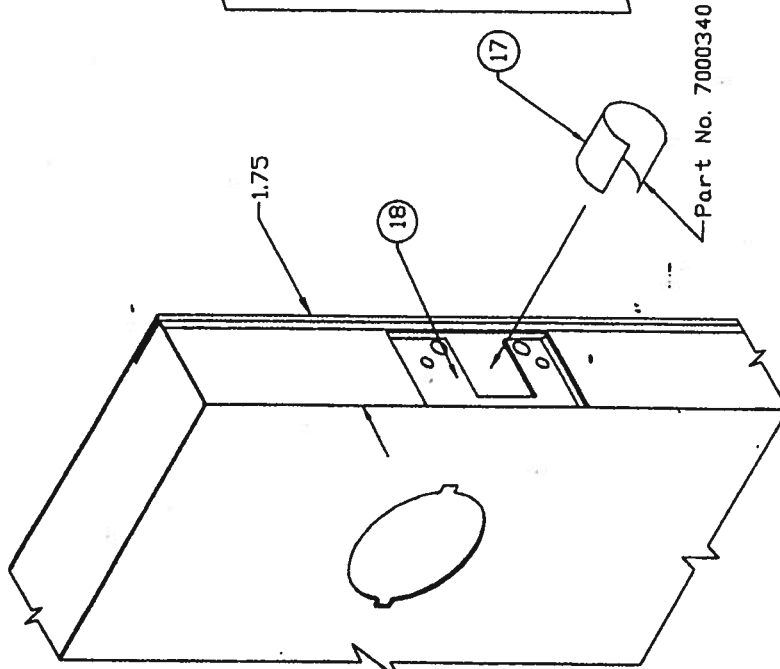

1.75

Part No. 7000340

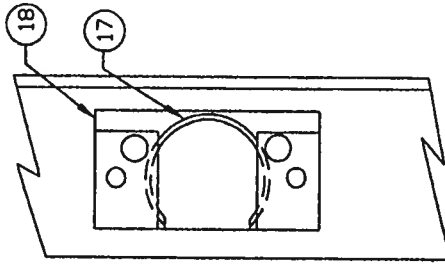

Note: 1. For Cylindrical Lock Only
2. See Sheet 7 For Bill Of Material

MATERIAL SPECIFICATIONS:


Cylindrical Lock Reinforcement
and "SF" Series Frame Corner
Installation Details

 CECD DOOR PRODUCTS
Milan, Tennessee 38358

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 03-041-01
Expiration Date 01/16/2008
By *Manuel Diaz*
Miami Dade Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *June 08/2000*
BY *Manuel Diaz*
PRODUCTION CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-034-03

Revised Format, Transferred 2/7/01 GWS	Revised Sheet Number	ISSUE	REVISIONS
DATE	DRAWN BY:	DATE:	
	GWS	6/06/97	
DRAWING NUMBER:			
RD00087			
Sheet 4 of 7			

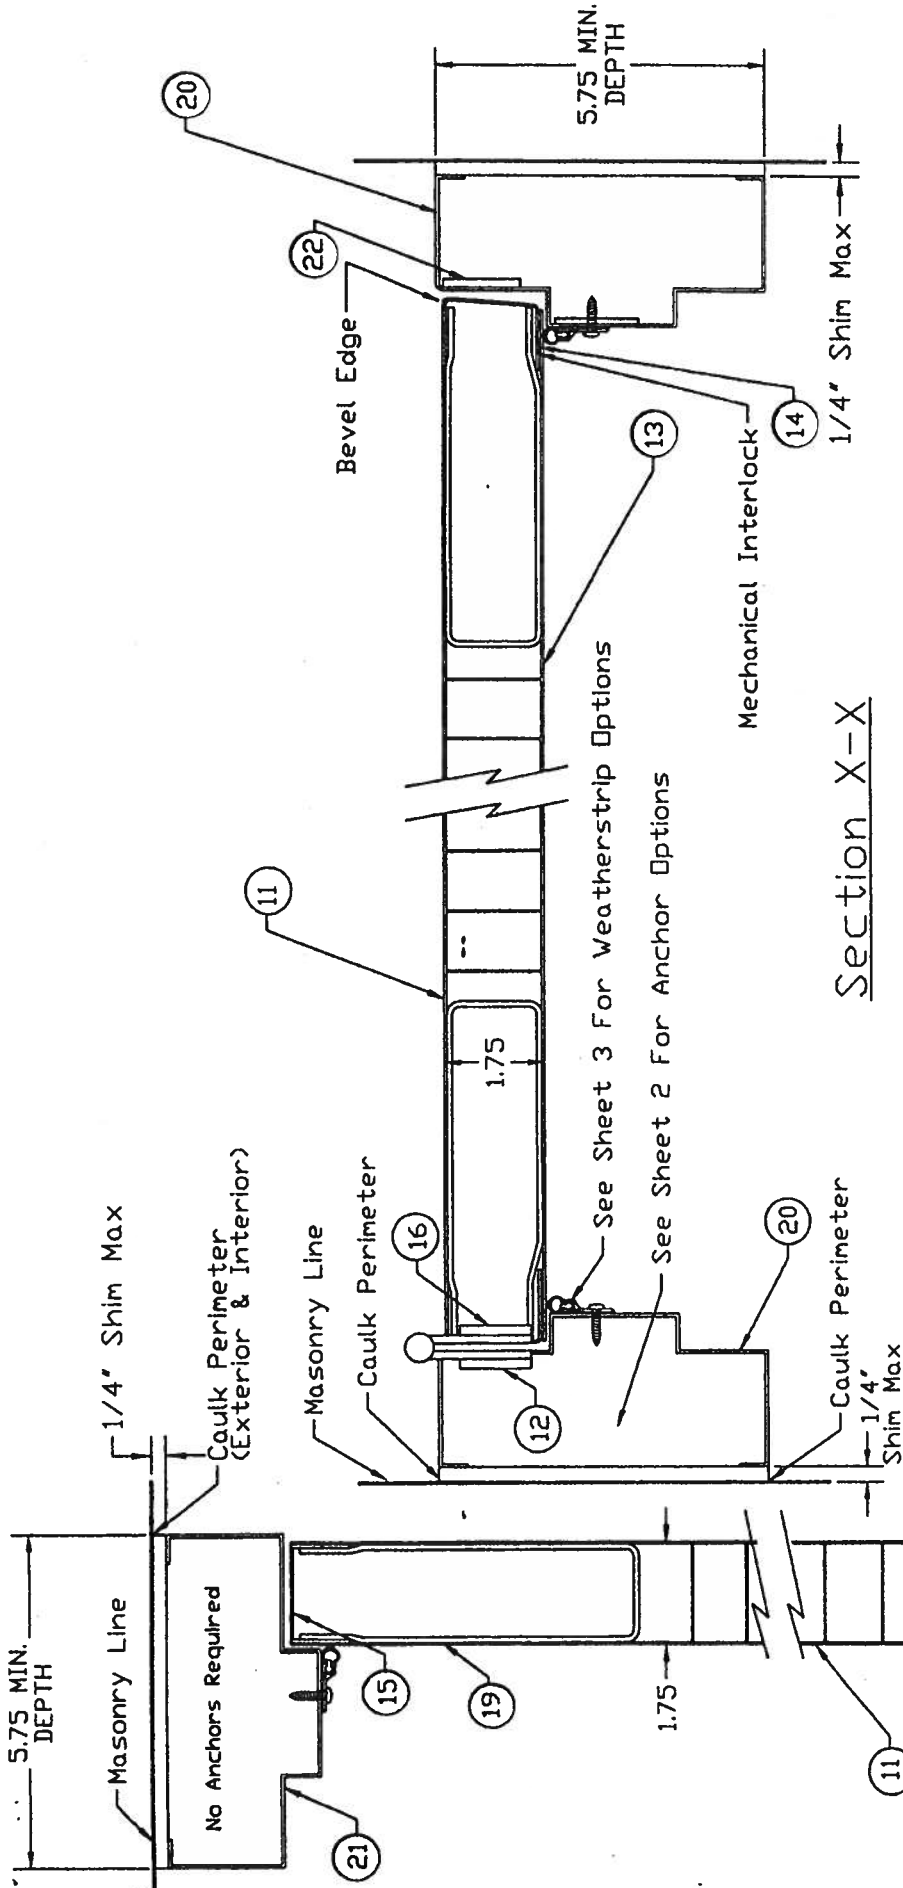

Section X-X

Note: See Sheet 7 For Bill Of Material

PRODUCT REVIEWED
as complying with the Florida
Building Code
Acceptance No. 03-0411-01
Expiration Date 12/15/2008
By: *Manuel Diaz*
Title: Product Control
Division

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE: *June 08 2000*
BY: *Manuel Diaz*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-03151.03

2/28/00	Revised Formlet, Transferred Information from NDA
7/22/97	Revised Sheet Number

MATERIAL SPECIFICATIONS:

Cross Section View

Regent Door

CECO DOOR PRODUCTS
Milan, Tennessee 38358

ISSUE	REVISIONS
DRAWN BY: GWS	DATE: 5/30/97

DRAWING NUMBER:
RD00087
Sheet 5 of 7

Section Y-Y

See Sheet 3 For Threshold Options

Concrete Slab

ITEM QTY	DESCRIPTION	MATERIAL	SIZE
1	SCHLAGE SERIES A50PD GRADE 2, LATCH LOCK, SINGLE LEVER OR KNOB OPERATED		
2	MARKS SERIES 1700AB GRADE 2, LATCH LOCK, INSIDE/OUTSIDE LEVER OPERATED		
3	YALE SERIES A185070 GRADE 2 LATCH LOCK, SINGLE LEVER OR KNOB OPERATED		
4	CAULK FOR INSTALLATION AND WEATHERSTRIP ADAPTER SCREWS FRAME PERIMETER (INSIDE & OUT) AND FRAME SILL CORNERS	GE SILICONE HOUSEHOLD SEALANT	
5	NATIONAL GUARD #803S		
6	PEMKO #2005AV		
7	PEMKO #181AV		
8	PEMKO #303AS HIGH SURFACE APPLIED EXTRUDED ALUMINUM WEATHERSTRIP ADAPTER WITH A SILICON (TND) BULB INSERT		
9	NATIONAL GUARD #130NA 1-1/4" WIDE X 0.188" SURFACE APPLIED EXTRUDED ALUMINUM WEATHERSTRIP ADAPT. WITH A FOAM INSERT		
10	HAGAR BB1279, 4-1/2" X 4-1/2" X .0134" THICK STEEL HINGE		
11	FACE SHEET CONFORMING TO ASTM A366 AND ASTM-A568	COMMERCIAL QUALITY COLD ROLLED STEEL (MINIMUM YIELD STR. OF Fy=36,000 PSI)	1/4" GAUGE (0.042" MIN. THICK)
12	HINGE REINFORCING PLATE PLATE SPOT WELDED TO FRAME JAMB AT EACH HINGE LOCATION	STEEL	1-1/4" X 9" X 7 GA.
13	CORE FULL HONEYCOMB CORE PERMANENTLY BONDED TO THE INSIDE OF EACH FACE SKIN WITH NON-FLAMMABLE ADHESIVE	PHENOLIC RESIN-IMPREGNATED KRAFT PAPER	1-1/8" CELL
14	DENFLEX 3500 STRUCTURAL ADHESIVE EPOXY		
15	ROLL FORMED STEEL CHANNEL ON THE TOP AND BOTTOM OF THE DOOR SPOT WELDED TO EXTERIOR AND GLUED TO INTERIOR SKIN		1" X 1-3/4" X 1" X 16 GA. C053" MINO
16	DOOR HINGE REINFORCEMENT		1-1/4" X 9" X 7 GA.
17	DOOR LATCH REINFORCEMENT	28 GA. GALV.	.015" THICK X 1.313 INSIDE DIAMETER
18	DOOR LOCK REINFORCEMENT	STEEL	16 GA.
19	DOOR CLOSER REINFORCEMENT, ROLLED FORM CHANNELS TACK WELDED TO DOOR END CHANNELS	STEEL	12 GA. C093"
20	SERIES "SF", FRAME JAMB, DOUBLE RABBIT PROFILE	16 GA. (C053" MIN.) STEEL	2" FACE, 5-3/4" DEPTH MIN.
21	FACE SHEET CONFORMING TO ASTM A366 AND ASTM-A653	COMMERCIAL QUALITY COLD ROLLED STEEL (MINIMUM YIELD STR. OF Fy=40,000 PSI)	2" FACE, 5-3/4" DEPTH MIN.
22	SERIES "SF", FRAME HEAD, DOUBLE RABBIT PROFILE	16 GA. (C053" MIN.) STEEL	2" FACE, 5-3/4" DEPTH MIN.
23	FACE SHEET CONFORMING TO ASTM A366 AND ASTM-A653	COMMERCIAL QUALITY COLD ROLLED STEEL (MINIMUM YIELD STR. OF Fy=40,000 PSI)	2" FACE, 5-3/4" DEPTH MIN.
24	JAMB LOCK STRIKE REINFORCING PLATE	STEEL	1-1/8" X 2-1/2" X 12 GA.

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE

DATE June 08, 2000 BY Shawn M. M...

PRODUCED FOR DIVISION OF BUILDING CODE COMPLIANCE OFFICE

ACCEPTANCE NO. 00-03-15-03

Revised Form, Transferred Information from NOA

7/22/97

Revised Sheet Number

ISSUE

REVISIONS

DRAWN BY: GWS

DATE: 6/02/97

DRAWING NUMBER: RD0087

Sheet 7 of 7

PRODUCT REVIEWED by Shawn M. M... as complying with the Florida Building Code

Acceptance No. 020411.01

Expiration Date 06/08/2008

Shawn M. M... Building Code Compliance Officer

MATERIAL SPECIFICATIONS:

3-0 x 7-0 Series

Bill of Materials

CECO DOOR PRODUCTS

Miln. Tennessee 38358

Date: 6/28/2006
Start Number: 1102
SEI Ref: L200433

Truss Design Load Information (UNO)

Design Program: MiTek 5.2 / 6.2

Gravity

Wind

Building Code:

FBC2004

Roof (psf):	42	Wind Standard:	ASCE 7-02
Floor (psf):	55	Wind Speed (mph):	110

Note: See individual truss drawings for special loading conditions

Building Designer, responsible for Structural Engineering: (See attached)

NORRIS, JOHN DAVID RG 0066597

Address: 351 NW CORWIN GLN
LAKE CITY, FL. 32025

Designer: 107

Truss Design Engineer: Thomas, E. Miller, P.E., 56877 - Byron K. Anderson, PE FL 60987

Company: Structural Engineering and Inspections, Inc. EB 9196

Address 16105 N. Florida Ave, Ste B, Lutz, FL 33549 **Phone:** 813-849-5769

Notes:

1. Truss Design Engineer is responsible for the individual trusses as components only.
2. Determination as to the suitability and use of these truss components for the structure is the responsibility of the Building Designer of Record, as defined in ANSI/TPI
3. The seal date shown on the individual truss component drawings must match the seal date on this index sheet.
4. Trusses designed for vertical loads only, unless noted otherwise.
5. Where hangers are shown, Carried Member hanger capacity per Simpson C-2006 (SYP/Full Nailing Value) as an individual component. Building Designer shall verify the suitability and use of Carrying Member hanger capacity.

[illegible]

JUN 28 2006


[Log On](#)

[DBPR Home](#) | [Online Services Home](#) | [Help](#) | [Site Map](#)

07:05:33 AM

Public Services

[Search for a Licensee](#)
[Apply for a License](#)
[View Application Status](#)
[Apply to Retake Exam](#)
[Find Exam Information](#)
[Find a CE Course](#)
[File a Complaint](#)
[AB&T Delinquent Invoice & Activity List Search](#)

User Services

[Renew a License](#)
[Change License Status](#)
[Maintain Account](#)
[Change My Address](#)
[View Messages](#)
[Change My PIN](#)
[View Continuing Ed](#)

Licensee Details

Licensee Information

Name: **NORRIS, JOHN DAVID** (Primary Name)
INDIVIDUAL (Alternate Name)
Main Address: **351 NW CORWIN GLN**
LAKE CITY, Florida 32055
Lic. Location: **WOODGLEN DRIVE**
LAKE CITY, FL 32055
Columbia

License Information

License Type: **Registered General Contractor**
Rank: **Reg General**
License Number: **RG0066597**
Status: **Current, Active**
Licensure Date: **06/20/1996**
Expires: **08/31/2005**


[Term Glossary](#)
[Online Help](#)


Special Qualifications **Effective Date**

Bldg Code Core Course Credit

No Qualified Business License Required **02/20/2004**

[View Related License Information](#)
[View License Complaint](#)
[New Search](#)
[E](#)
[Terms of Use](#) | [Privacy Statement](#)

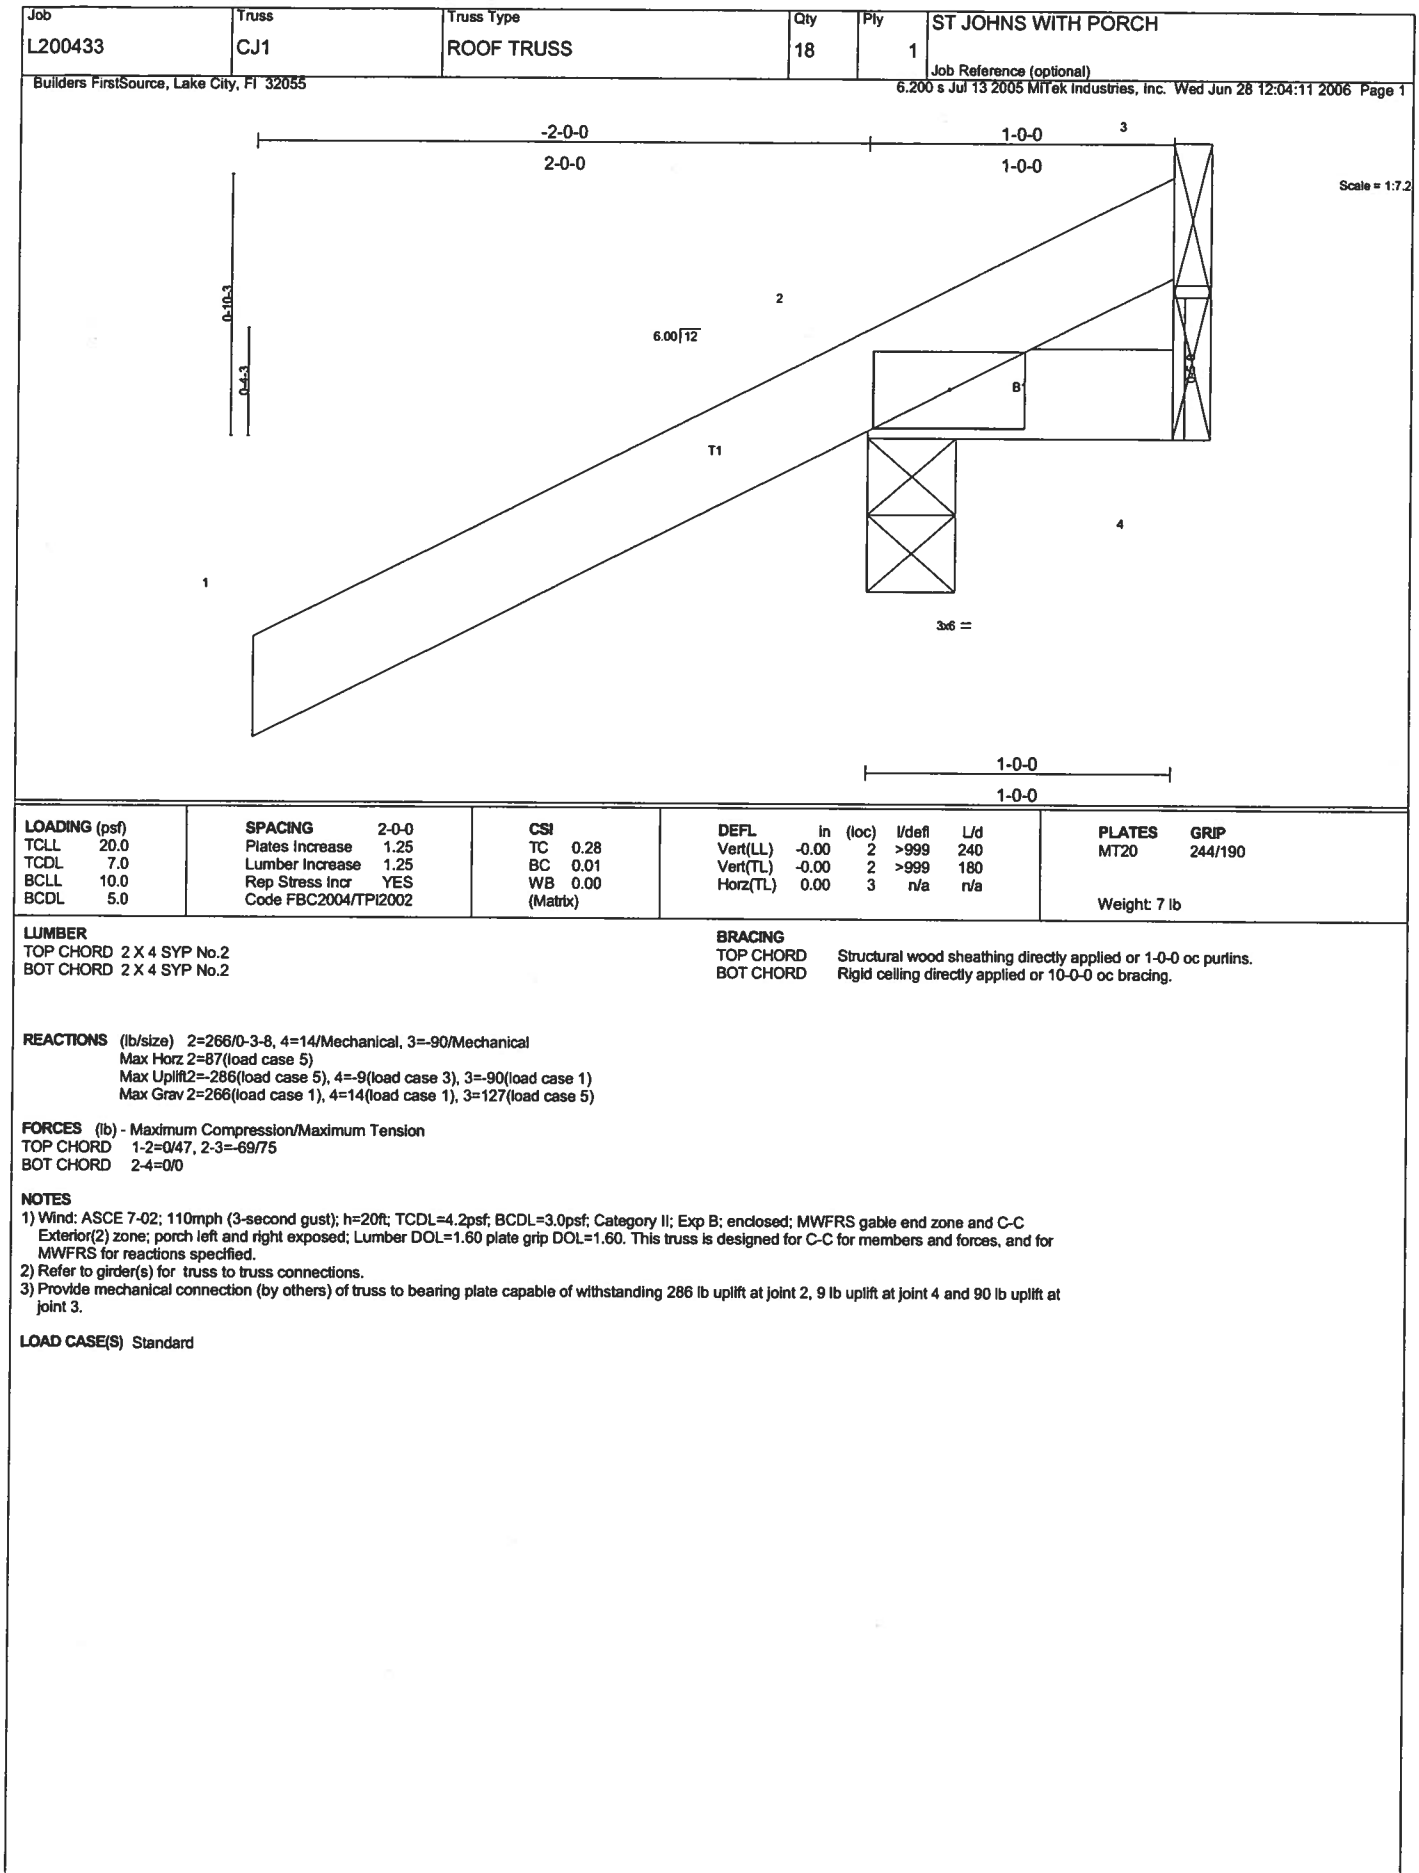

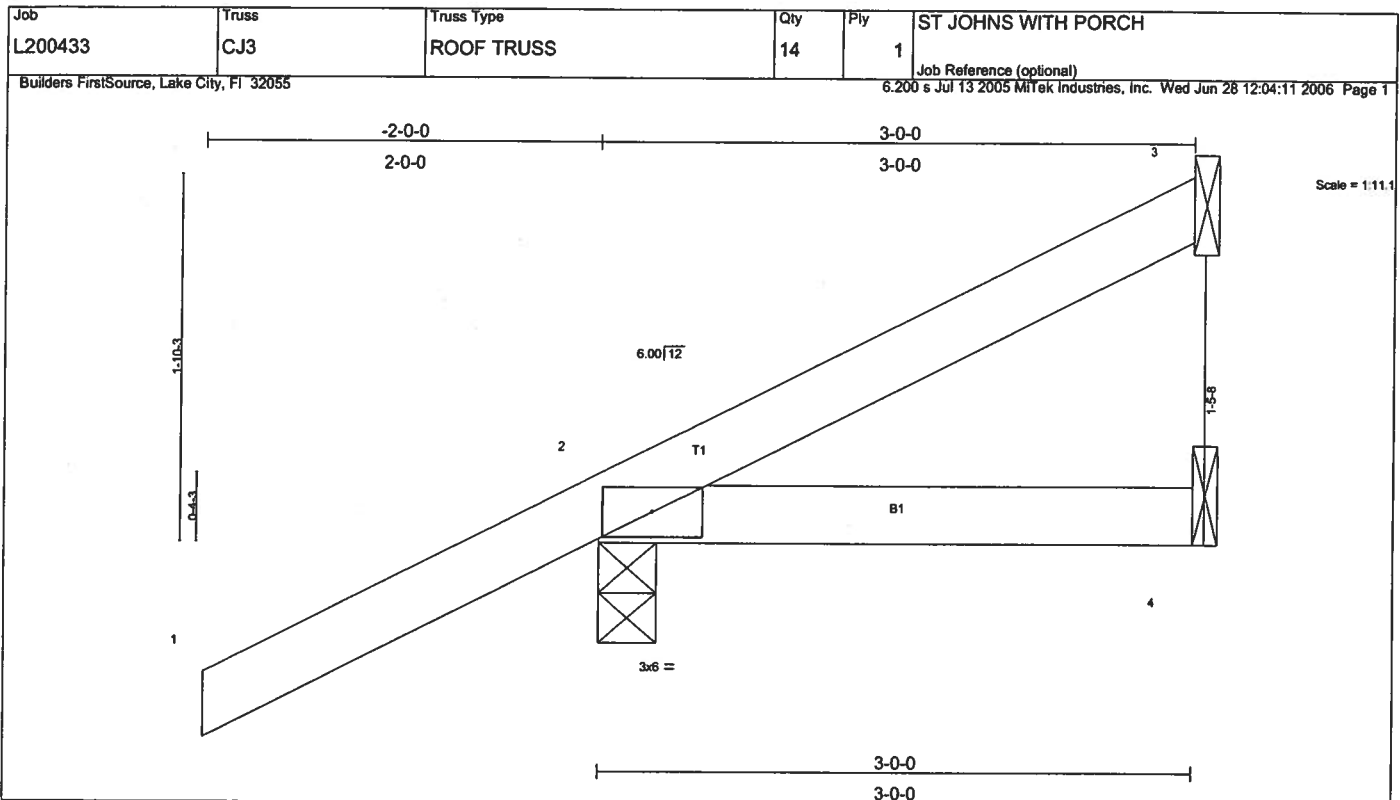

LOADING (psf)	SPACING	2'-0"	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.29	Vert(LL)	0.01	2-4	>999	240	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.08	Vert(TL)	0.01	2-4	>999	180		
BCCL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(TL)	-0.00	3	n/a	n/a		
BCDL 5.0	Code FBC2004/TPI2002		(Matrix)							
									Weight: 13 lb	

LUMBER
 TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3'-0" oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS (lb/size) 3=31/Mechanical, 2=278/0-3-8, 4=42/Mechanical
 Max Horz 2=132(load case 5)
 Max Uplift 3=28(load case 6), 2=238(load case 5), 4=27(load case 3)


FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/47, 2-3=57/7
 BOT CHORD 2-4=0/0

NOTES

- 1) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 3, 238 lb uplift at joint 2 and 27 lb uplift at joint 4.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ST JOHNS WITH PORCH
L200433	CJ5	ROOF TRUSS	14	1	
Builders FirstSource, Lake City, FL 32055			Job Reference (optional)		
6.200 s Jul 13 2005 MITek Industries, Inc. Wed Jun 28 12:04:12 2006 Page 1					

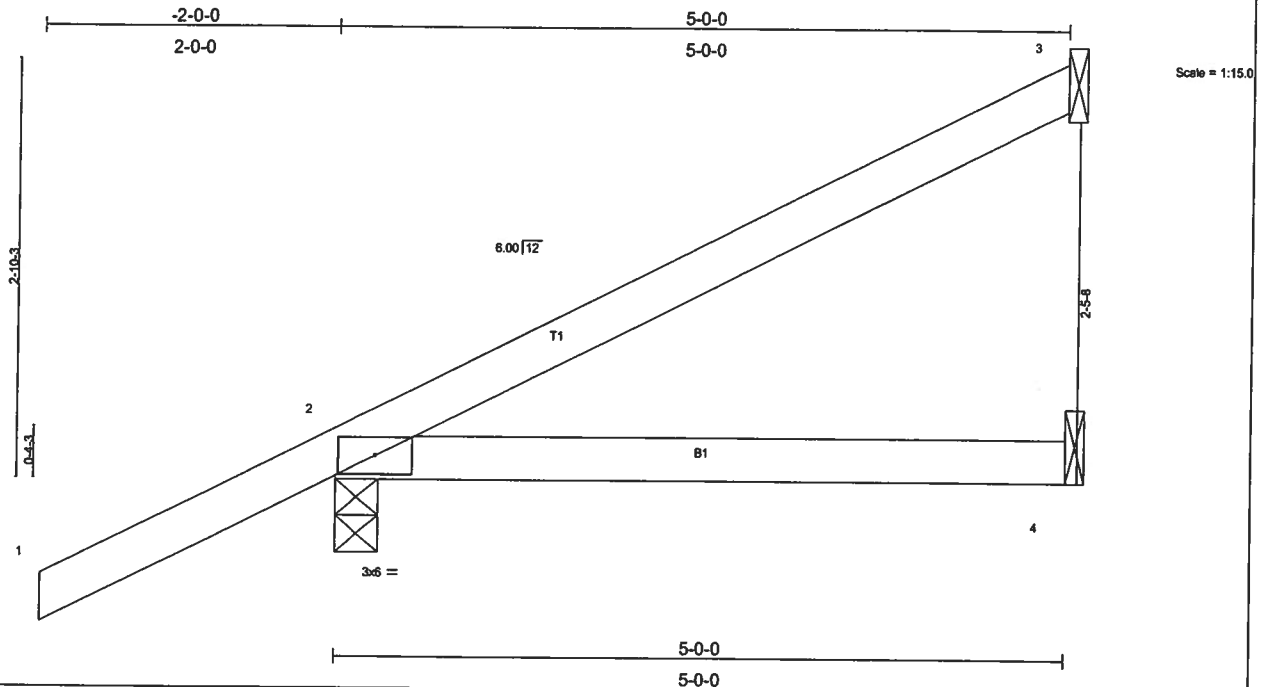

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.29	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.24	Vert(LL) 0.09 2-4 >663 240		
BCLL 10.0	Lumber Increase 1.25	WB 0.00	Vert(TL) 0.07 2-4 >774 180		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) -0.00 3 n/a n/a		
	Code FBC2004/TPI2002				Weight: 19 lb

LUMBER
 TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=103/Mechanical, 2=343/0-3-8, 4=72/Mechanical
 Max Horz 2=178(load case 5)
 Max Uplift 3=87(load case 5), 2=260(load case 5), 4=46(load case 3)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/47, 2-3=-88/36
 BOT CHORD 2-4=0/0


NOTES

- 1) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 3, 260 lb uplift at joint 2 and 46 lb uplift at joint 4.

LOAD CASE(S) Standard

Job L200433	Truss EJ3	Truss Type ROOF TRUSS	Qty 3	Ply 1	ST JOHNS WITH PORCH
----------------	--------------	--------------------------	----------	----------	---------------------

Builders FirstSource, Lake City, FL 32055

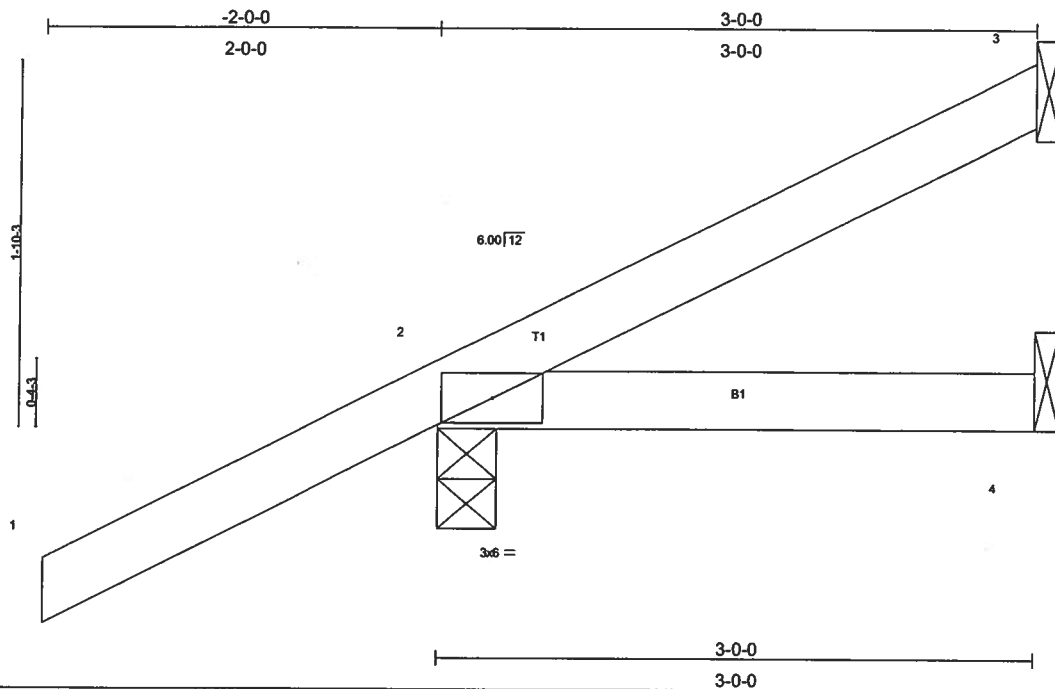Job Reference (optional)
6.200 s Jul 13 2005 MiTek Industries, Inc. Wed Jun 28 12:04:12 2006 Page 1

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.29	in (loc) l/def L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.08	Vert(LL) 0.01 2-4 >999 240		
BCCL 10.0	Lumber Increase 1.25	WB 0.00	Vert(TL) 0.01 2-4 >999 180		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) -0.00 3 n/a n/a		
	Code FBC2004/TP12002				
				Weight: 13 lb	

LUMBERTOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2**BRACING**TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.**REACTIONS** (lb/size) 3=31/Mechanical, 2=278/0-3-8, 4=42/Mechanical

Max Horz 2=132(load case 5)

Max Uplift 3=28(load case 6), 2=238(load case 5), 4=27(load case 3)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/47, 2-3=57/7


BOT CHORD 2-4=0/0

NOTES

- 1) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 3, 238 lb uplift at joint 2 and 27 lb uplift at joint 4.

LOAD CASE(S) Standard

Job L200433	Truss EJ7	Truss Type MONO TRUSS	Qty 30	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:13 2006 Page 1		

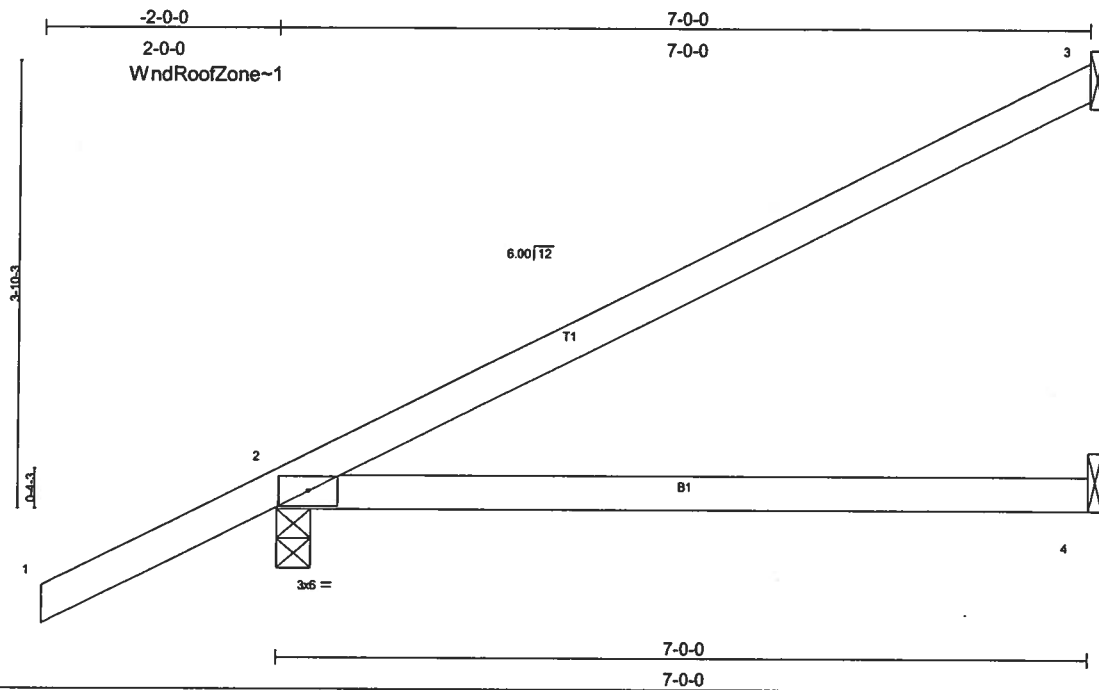

LOADING (psf)	SPACING 2-0-0	CSI	DEFL	PLATES	GRIP
TCLL 20.0	Plates Increase 1.25	TC 0.50	In (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.45	Vert(LL) 0.33 2-4 >250 240		
BCLL 10.0	Rep Stress Incr YES	WB 0.00	Vert(TL) 0.28 2-4 >295 180		
BCDL 5.0	Code FBC2004/TPI2002	(Matrix)	Horz(TL) -0.00 3 n/a n/a		
Weight: 26 lb					

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=162/Mechanical, 2=419/0-3-8, 4=104/Mechanical

Max Horz 2=224(load case 5)

Max Uplift 3=144(load case 5), 2=295(load case 5), 4=68(load case 6)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/47, 2-3=-131/58


BOT CHORD 2-4=0/0

NOTES

- 1) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 144 lb uplift at joint 3, 295 lb uplift at joint 2 and 68 lb uplift at joint 4.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	ST JOHNS WITH PORCH
L200433	HJ4	ROOF TRUSS	2	1	Job Reference (optional)
Builders FirstSource, Lake City, FL 32055			6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:13 2006 Page 1		

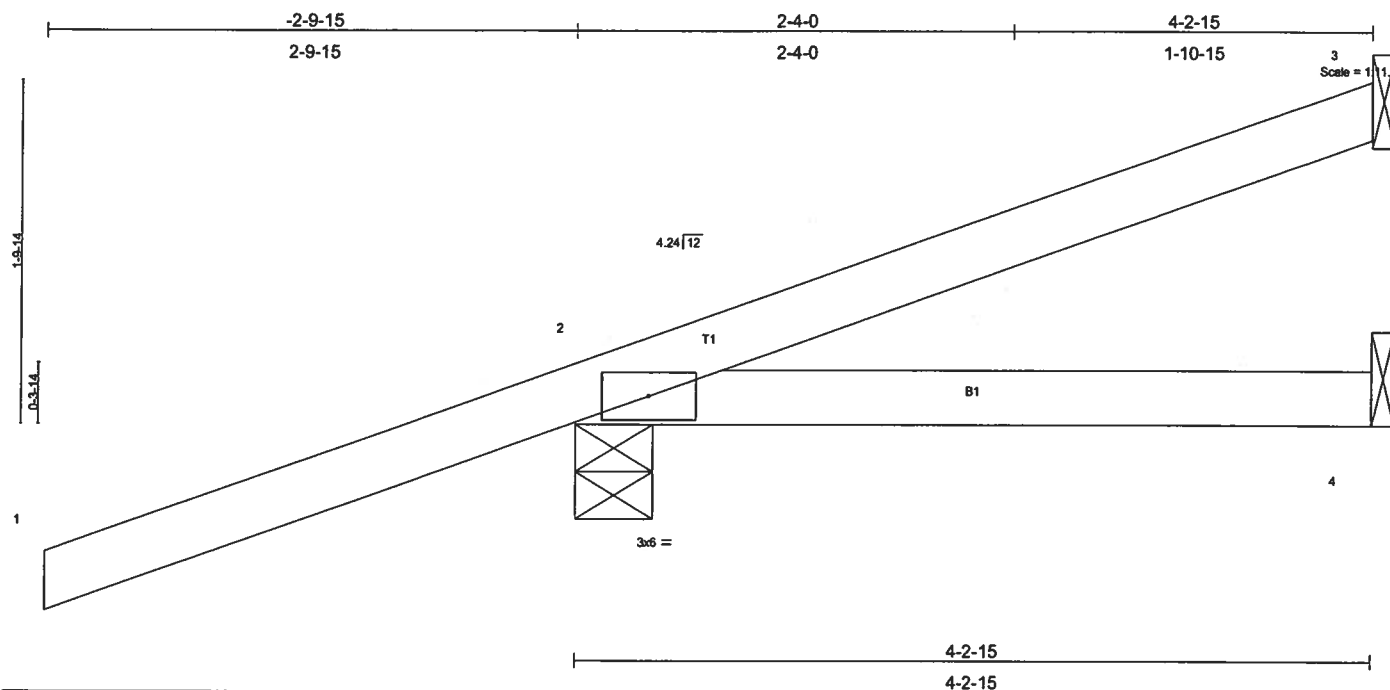

LOADING (psf)	SPACING	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.53	Vert(LL)	0.02	2-4	>999	240	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.07	Vert(TL)	0.01	2-4	>999	180		
BCLL 10.0	Rep Stress Incr	NO	WB 0.00	Horz(TL)	-0.00	3	n/a	n/a		
BCDL 5.0	Code FBC2004/TPI2002		(Matrix)							Weight: 18 lb

LUMBER
TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-2-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 3=15/Mechanical, 2=289/0-4-15, 4=42/Mechanical
Max Horz 2=98(load case 2)
Max Uplift 3=6(load case 5), 2=302(load case 2), 4=41(load case 2)
Max Grav 3=32(load case 6), 2=289(load case 1), 4=42(load case 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/50, 2-3=37/10
BOT CHORD 2-4=0/0

NOTES

- 1) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 6 lb uplift at joint 3, 302 lb uplift at joint 2 and 41 lb uplift at joint 4.
- 4) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Regular: Lumber Increase=1.25, Plate Increase=1.25


Uniform Loads (plf)

Vert: 1-2=54

Trapezoidal Loads (plf)

Vert: 2=3(F=26, B=26)-to-3=-57(F=-2, B=-2), 2=0(F=15, B=15)-to-4=-32(F=-1, B=-1)

Job L200433	Truss HJ9	Truss Type ROOF TRUSS	Qty 7	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:14 2006 Page 1		

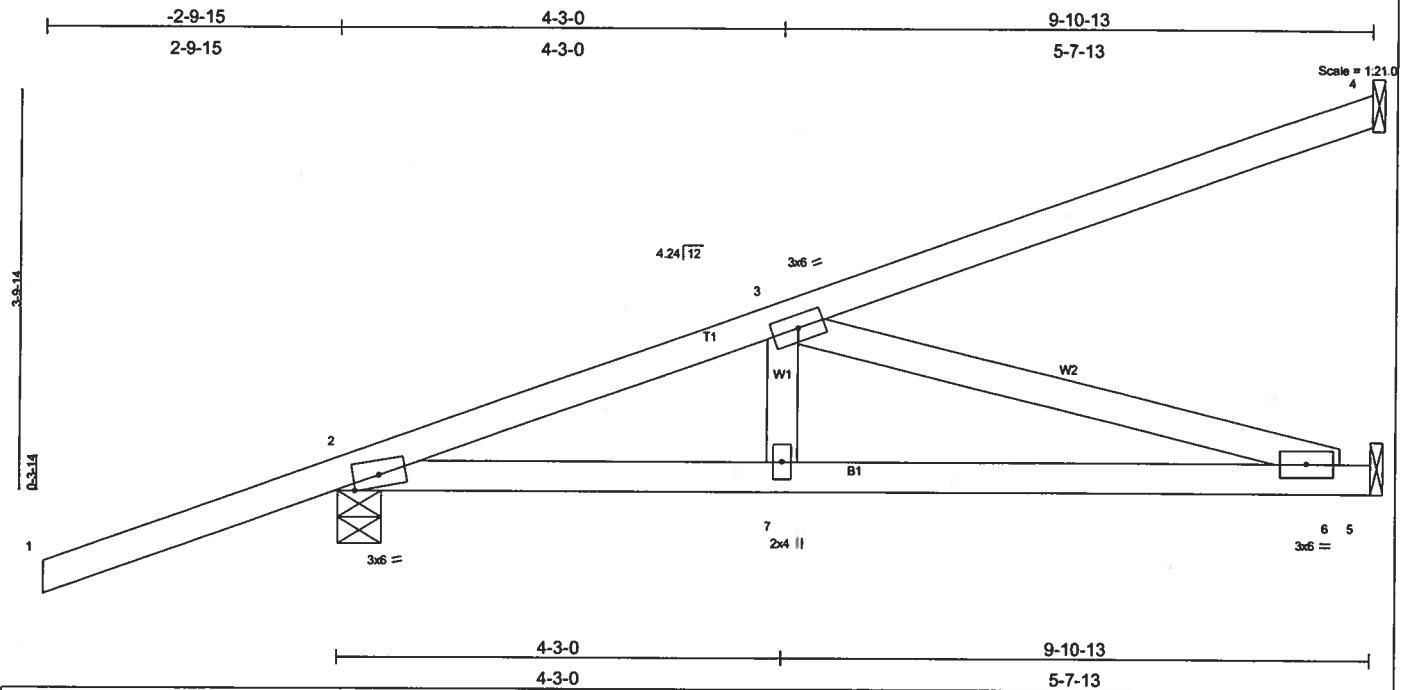

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.61	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.57	Vert(LL) -0.10 6-7 >999 240		
BCLL 10.0	Lumber Increase 1.25	WB 0.49	Vert(TL) -0.17 6-7 >685 180		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Horz(TL) 0.01 5 n/a n/a		
	Code FBC2004/TPI2002			Weight: 45 lb	

LUMBER
 TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2
 WEBS 2 X 4 SYP No.3

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 7-11-7 oc bracing.

REACTIONS (lb/size) 4=269/Mechanical, 2=532/0-4-15, 5=377/Mechanical
 Max Horz 2=269(load case 2)
 Max Uplift 4=233(load case 2), 2=399(load case 2), 5=183(load case 2)


FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/50, 2-3=889/365, 3-4=105/66
 BOT CHORD 2-7=-538/824, 6-7=-538/824, 5-6=0/0
 WEBS 3-7=89/180, 3-6=857/559


NOTES

- 1) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60.
- 2) Refer to girder(s) for truss to truss connections.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 233 lb uplift at joint 4, 399 lb uplift at joint 2 and 183 lb uplift at joint 5.
- 4) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Regular: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-2=-54
 Trapezoidal Loads (plf)
 Vert: 2=-3(F=26, B=26)-to-4=-134(F=-40, B=-40), 2=-0(F=15, B=15)-to-5=-74(F=-22, B=-22)

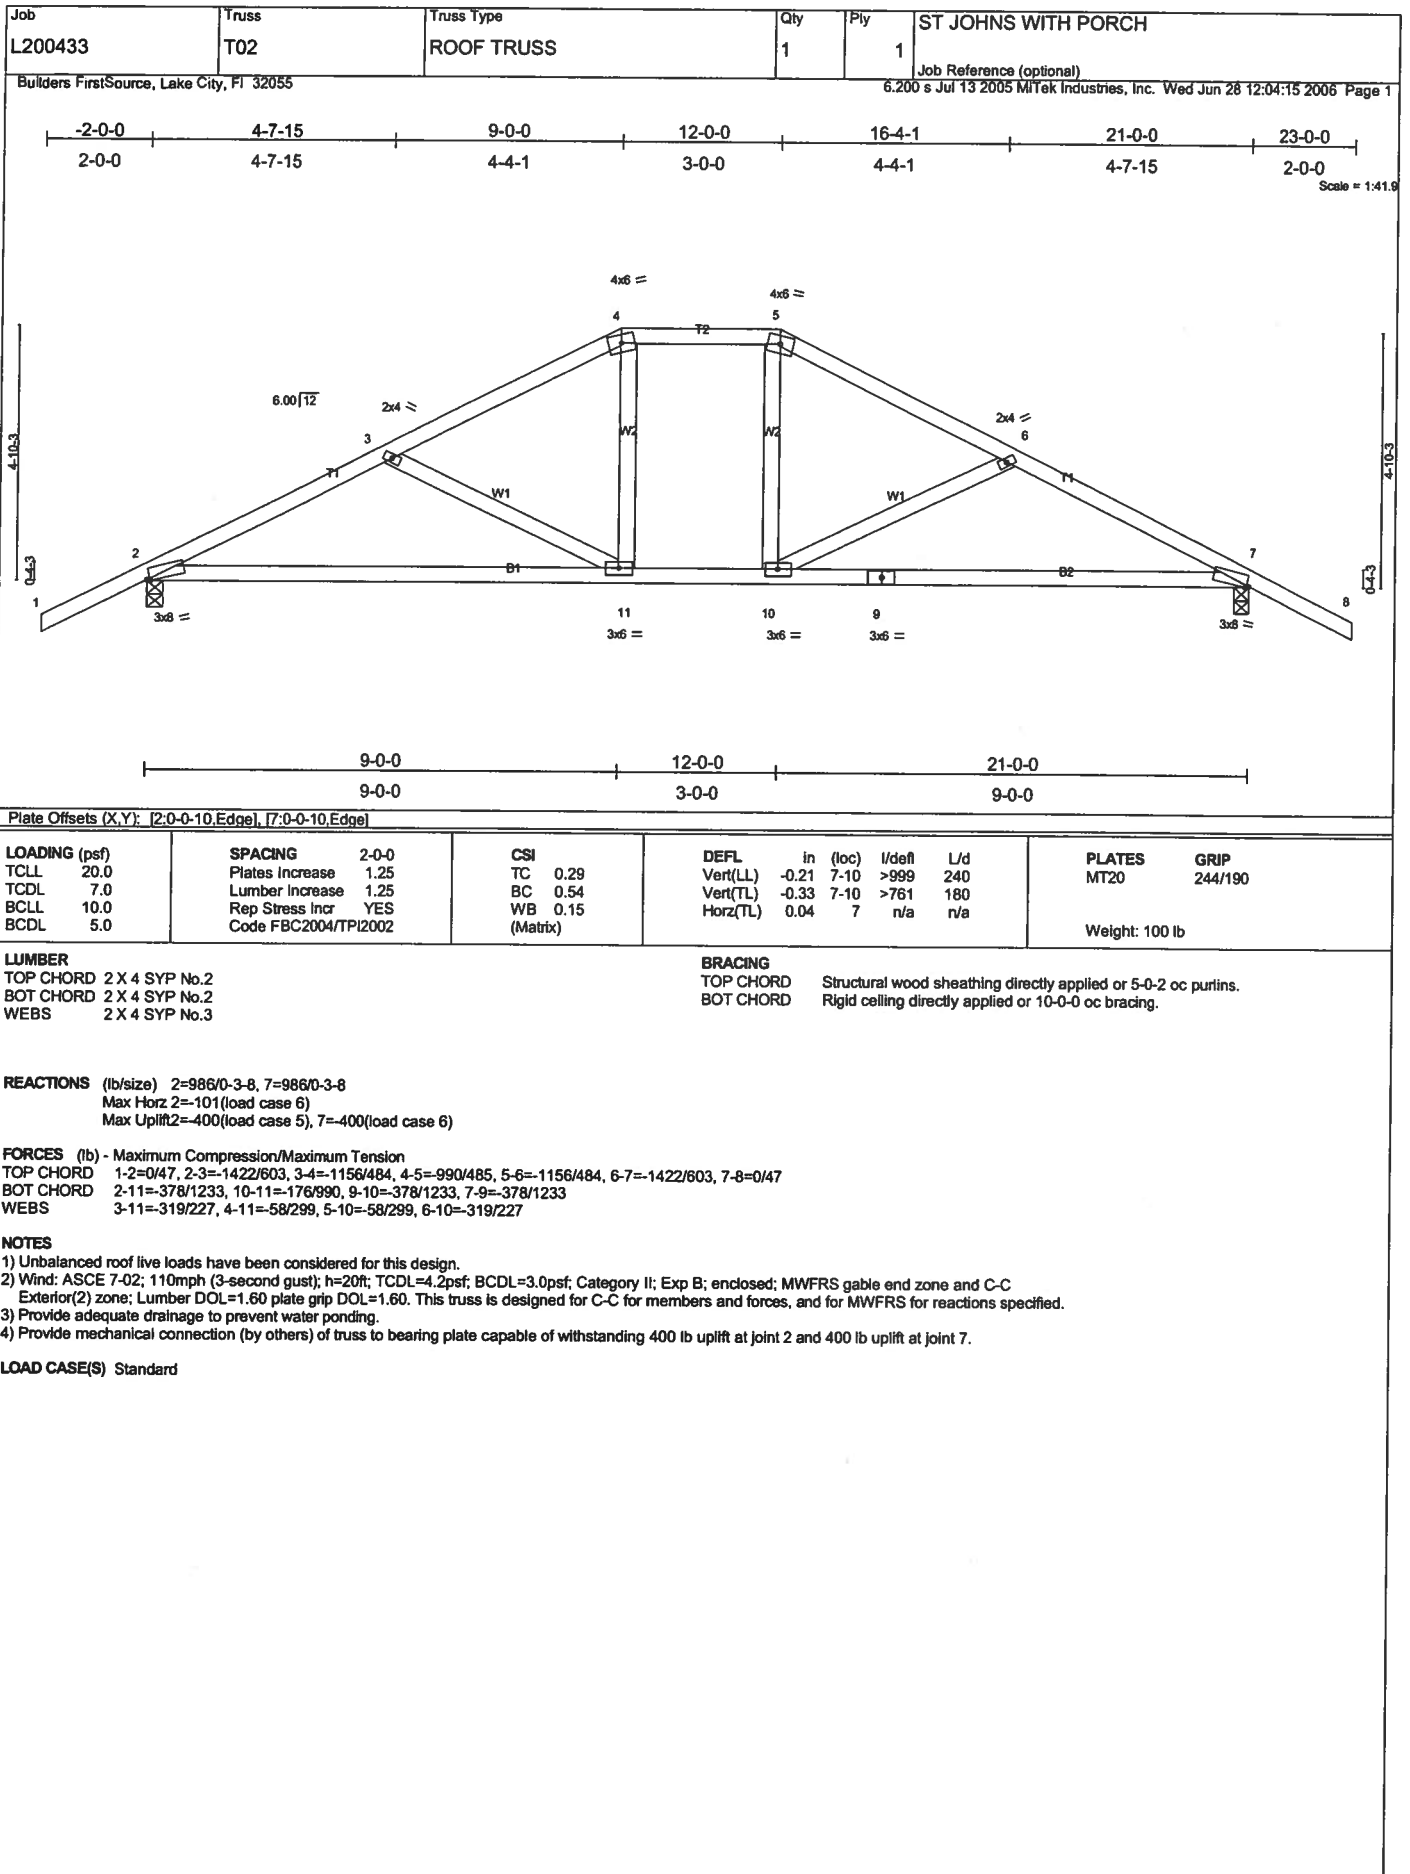

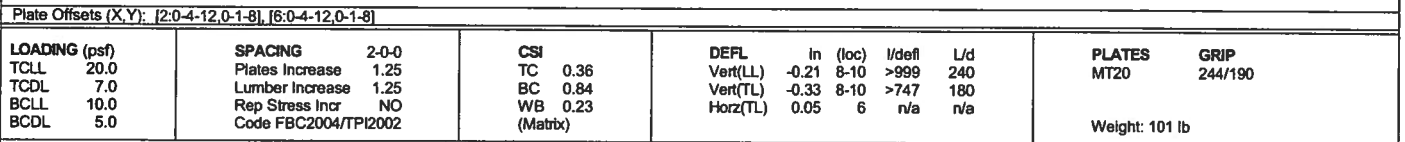

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 4-4-15 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 7-9-0 oc bracing.

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDF=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 493 lb uplift at joint 2 and 493 lb uplift at joint 6.
- 4) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-7=-54, 2-10=-30, 8-10=-100(F=70), 6-8=30

Job L200433	Truss T04	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			6.200 s Jul 13 2005 MiTek Industries, Inc. Wed Jun 28 12:04:17 2006 Page 1		

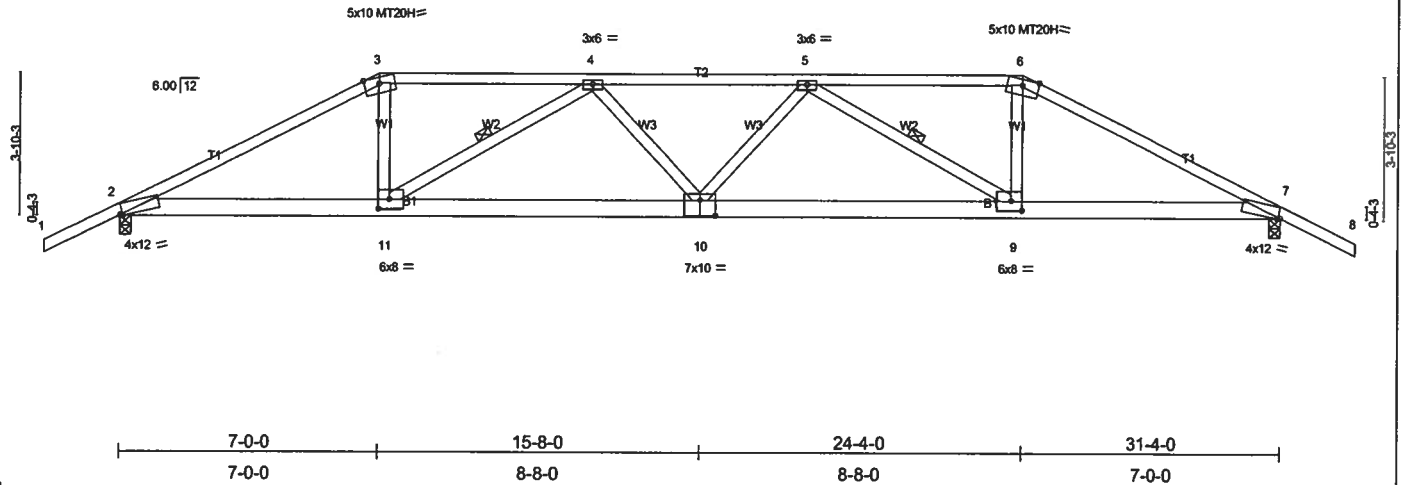



Plate Offsets (X,Y): [2-0-0-13,Edge], [7-0-0-13,Edge], [9-0-3-8,0-3-0], [10-0-5-0,0-5-0], [11-0-3-8,0-3-0]					
LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.82	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.85	Vert(TL) -0.43 9-10 >863 240	MT20H	187/143
BCCL 10.0	Lumber Increase 1.25	WB 0.62	Vert(TL) -0.70 9-10 >536 180		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Horz(TL) 0.17 7 n/a n/a		
	Code FBC2004/TPI2002				
				Weight: 170 lb	

LUMBER	BRACING
TOP CHORD 2 X 4 SYP No.2 *Except*	TOP CHORD Structural wood sheathing directly applied or 2-1-14 oc purlins.
T2 2 X 4 SYP No.1D	BOT CHORD Rigid ceiling directly applied or 4-11-13 oc bracing.
BOT CHORD 2 X 6 SYP No.1D	WEBS 1 Row at midpt 4-11, 5-9
WEBS 2 X 4 SYP No.3	

REACTIONS (lb/size) 2=2810/0-3-8, 7=2810/0-3-8
 Max Horz 2=-89(load case 5)
 Max Uplift 2=-1201(load case 4), 7=-1201(load case 5)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/51, 2-3=-5499/2292, 3-4=-4920/2118, 4-5=-6766/2861, 5-6=-4920/2119, 6-7=-5499/2292, 7-8=0/51
 BOT CHORD 2-11=-2008/4839, 10-11=-2837/6515, 9-10=-2815/6515, 7-9=-1969/4839
 WEBS 3-11=-709/1946, 4-11=-1969/1021, 4-10=0/423, 5-10=0/423, 5-9=-1969/1021, 6-9=-709/1946

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone; Lumber DOL=1.60 plate grip DOL=1.60.
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1201 lb uplift at joint 2 and 1201 lb uplift at joint 7.
- 6) Girder carries hip end with 7-0-0 end setback.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 539 lb down and 277 lb up at 24-4-0, and 539 lb down and 277 lb up at 7-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Regular: Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
 Vert: 1-3=-54, 3-6=-118(F=-64), 6-8=-54, 2-11=-30, 9-11=-65(F=-35), 7-9=-30
 Concentrated Loads (lb)
 Vert: 11=-539(F) 9=-539(F)

Job L200433	Truss T06	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 MiTek Industries, Inc. Wed Jun 28 12:04:18 2006 Page 1		

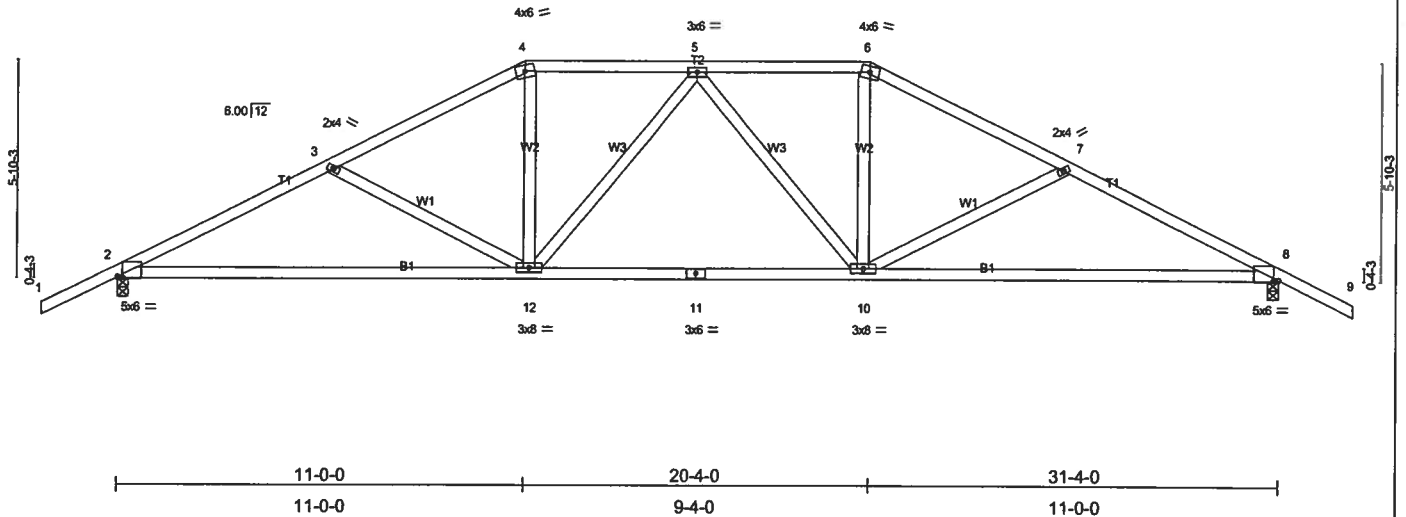



Plate Offsets (X,Y): [2:0-1-11,Edge], [8:0-1-11,Edge]					
LOADING (psf)	SPACING	2-0-0	CSI	DEFL	PLATES
TCLL 20.0	Plates Increase	1.25	TC 0.43	In (loc) l/def	L/d
TCCL 7.0	Lumber Increase	1.25	BC 0.80	Vert(LL) -0.37 8-10 >999	240
BCCL 10.0	Rep Stress Incr	YES	WB 0.24	Vert(TL) -0.63 8-10 >587	180
BCDL 5.0	Code FBC2004/TPI2002		(Matrix)	Horz(TL) 0.10 8 n/a	n/a
					Weight: 158 lb

LUMBER	BRACING
TOP CHORD 2 X 4 SYP No.2	TOP CHORD Structural wood sheathing directly applied or 3-7-6 oc purlins.
BOT CHORD 2 X 4 SYP No.2	BOT CHORD Rigid ceiling directly applied or 7-6-2 oc bracing.
WEBS 2 X 4 SYP No.3	

REACTIONS (lb/size) 2=1420/0-3-8, 8=1420/0-3-8
 Max Horz 2=115(load case 6)
 Max Uplift 2=517(load case 5), 8=517(load case 6)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/47, 2-3=-2287/974, 3-4=-1965/827, 4-5=-1710/803, 5-6=-1710/803, 6-7=-1965/827, 7-8=-2287/974, 8-9=0/47
 BOT CHORD 2-12=-694/1998, 11-12=-502/1805, 10-11=-502/1805, 8-10=-694/1998
 WEBS 3-12=-348/289, 4-12=-144/583, 5-12=-265/166, 5-10=-265/166, 6-10=-144/583, 7-10=-348/289

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCCL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- Provide adequate drainage to prevent water ponding.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 517 lb uplift at joint 2 and 517 lb uplift at joint 8.

LOAD CASE(S) Standard

Job L200433	Truss T07	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 Mittek Industries, Inc. Wed Jun 28 12:04:19 2006 Page 1		


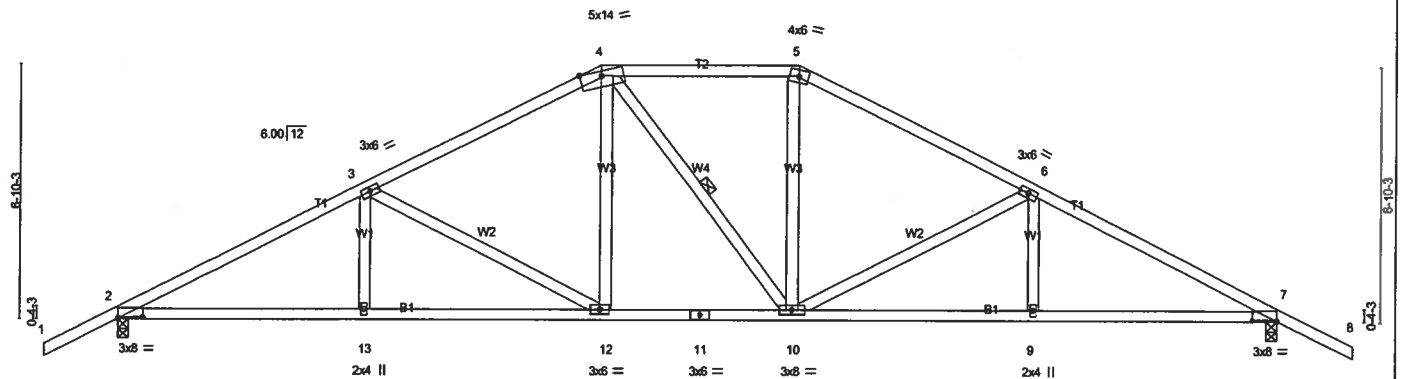



Plate Offsets (X,Y): [2:0-8-0,0-0-6], [7:0-8-0,0-0-6]

LOADING (psf)	SPACING	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.33	Vert(LL)	-0.16	12-13	>999	240	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.49	Vert(TL)	-0.25	12-13	>999	180		
BCLL 10.0	Rep Stress Incr	YES	WB 0.56	Horz(TL)	0.10	7	n/a	n/a		
BCDL 5.0	Code FBC2004/TPI2002		(Matrix)							
									Weight: 165 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2
 WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-9-10 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 7-8-11 oc bracing.
 WEBS 1 Row at midpt 4-10

REACTIONS

(lb/size) 2=1420/0-3-8, 7=1420/0-3-8
 Max Horz 2=129(load case 5)
 Max Uplift 2=532(load case 5), 7=532(load case 6)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/47, 2-3=-2375/950, 3-4=-1765/802, 4-5=-1517/786, 5-6=-1766/802, 6-7=-2375/950, 7-8=0/47
 BOT CHORD 2-13=-668/2043, 12-13=-668/2043, 11-12=-374/1516, 10-11=-374/1516, 9-10=-668/2043, 7-9=-668/2043
 WEBS 3-13=0/216, 3-12=-607/335, 4-12=-124/448, 4-10=-151/154, 5-10=-124/448, 6-10=-606/335, 6-9=0/216

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- 3) Provide adequate drainage to prevent water ponding.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 532 lb uplift at joint 2 and 532 lb uplift at joint 7.

LOAD CASE(S) Standard

Job L200433	Truss T09	Truss Type ROOF TRUSS	Qty 3	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:20 2006 Page 1		

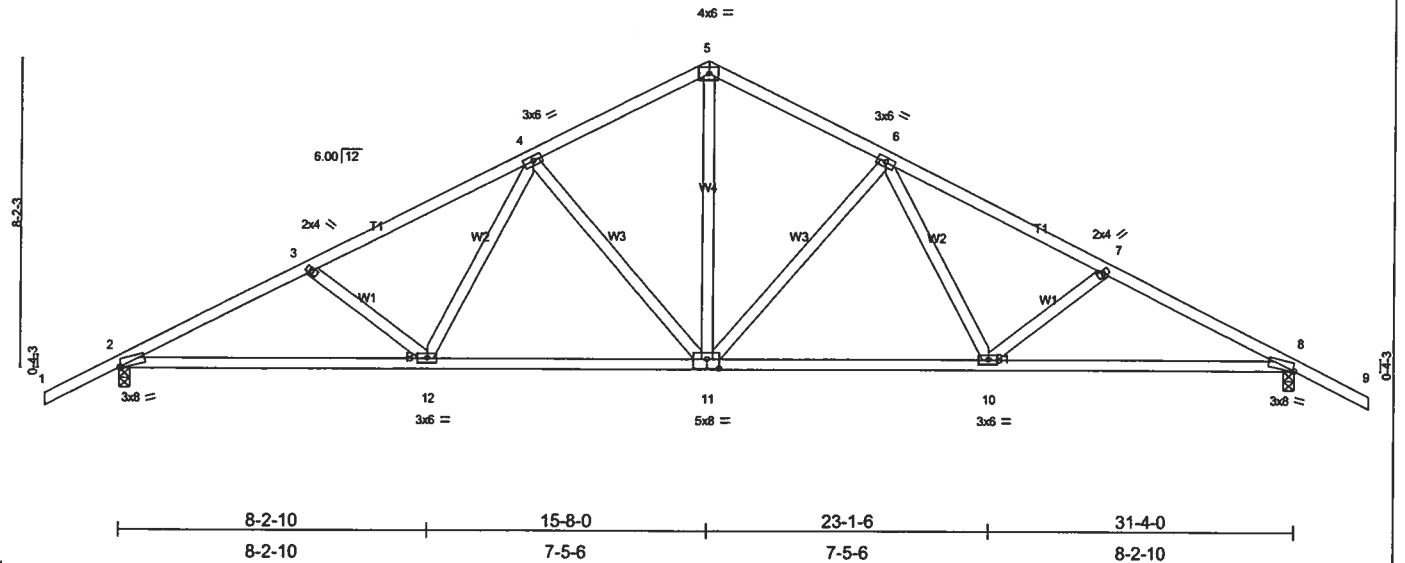



Plate Offsets (X,Y): [2:0-0-10,Edge], [8:0-0-10,Edge], [11:0-4-0-0-3-0]					
LOADING (psf)	SPACING 2-0-0	CSI	DEFL	In (loc)	L/defl
TCLL 20.0	Plates Increase 1.25	TC 0.31	Vert(LL)	-0.17 11-12	>999 240
TCDL 7.0	Lumber Increase 1.25	BC 0.55	Vert(TL)	-0.28 11-12	>999 180
BCLL 10.0	Rep Stress Incr YES	WB 0.56	Horz(TL)	0.09 8	n/a n/a
BCDL 5.0	Code FBC2004/TPI2002	(Matrix)			
					PLATES MT20
					GRIP 244/190
Weight: 167 lb					

LUMBER	BRACING
TOP CHORD 2 X 4 SYP No.2	TOP CHORD Structural wood sheathing directly applied or 3-11-8 oc purlins.
BOT CHORD 2 X 4 SYP No.2	BOT CHORD Rigid ceiling directly applied or 7-2-13 oc bracing.
WEBS 2 X 4 SYP No.3	


REACTIONS (lb/size) 2=1420/0-3-8, 8=1420/0-3-8
 Max Horz 2=148(load case 6)
 Max Uplift 2=548(load case 5), 8=548(load case 6)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/47, 2-3=2372/1019, 3-4=2150/933, 4-5=1511/778, 5-6=1511/778, 6-7=2150/933, 7-8=2372/1019, 8-9=0/47
 BOT CHORD 2-12=746/2069, 11-12=493/1654, 10-11=493/1654, 8-10=746/2069
 WEBS 3-12=275/260, 4-12=111/461, 4-11=564/357, 5-11=512/1062, 6-11=564/357, 6-10=111/461, 7-10=275/260

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 548 lb uplift at joint 2 and 548 lb uplift at joint 8.

LOAD CASE(S) Standard

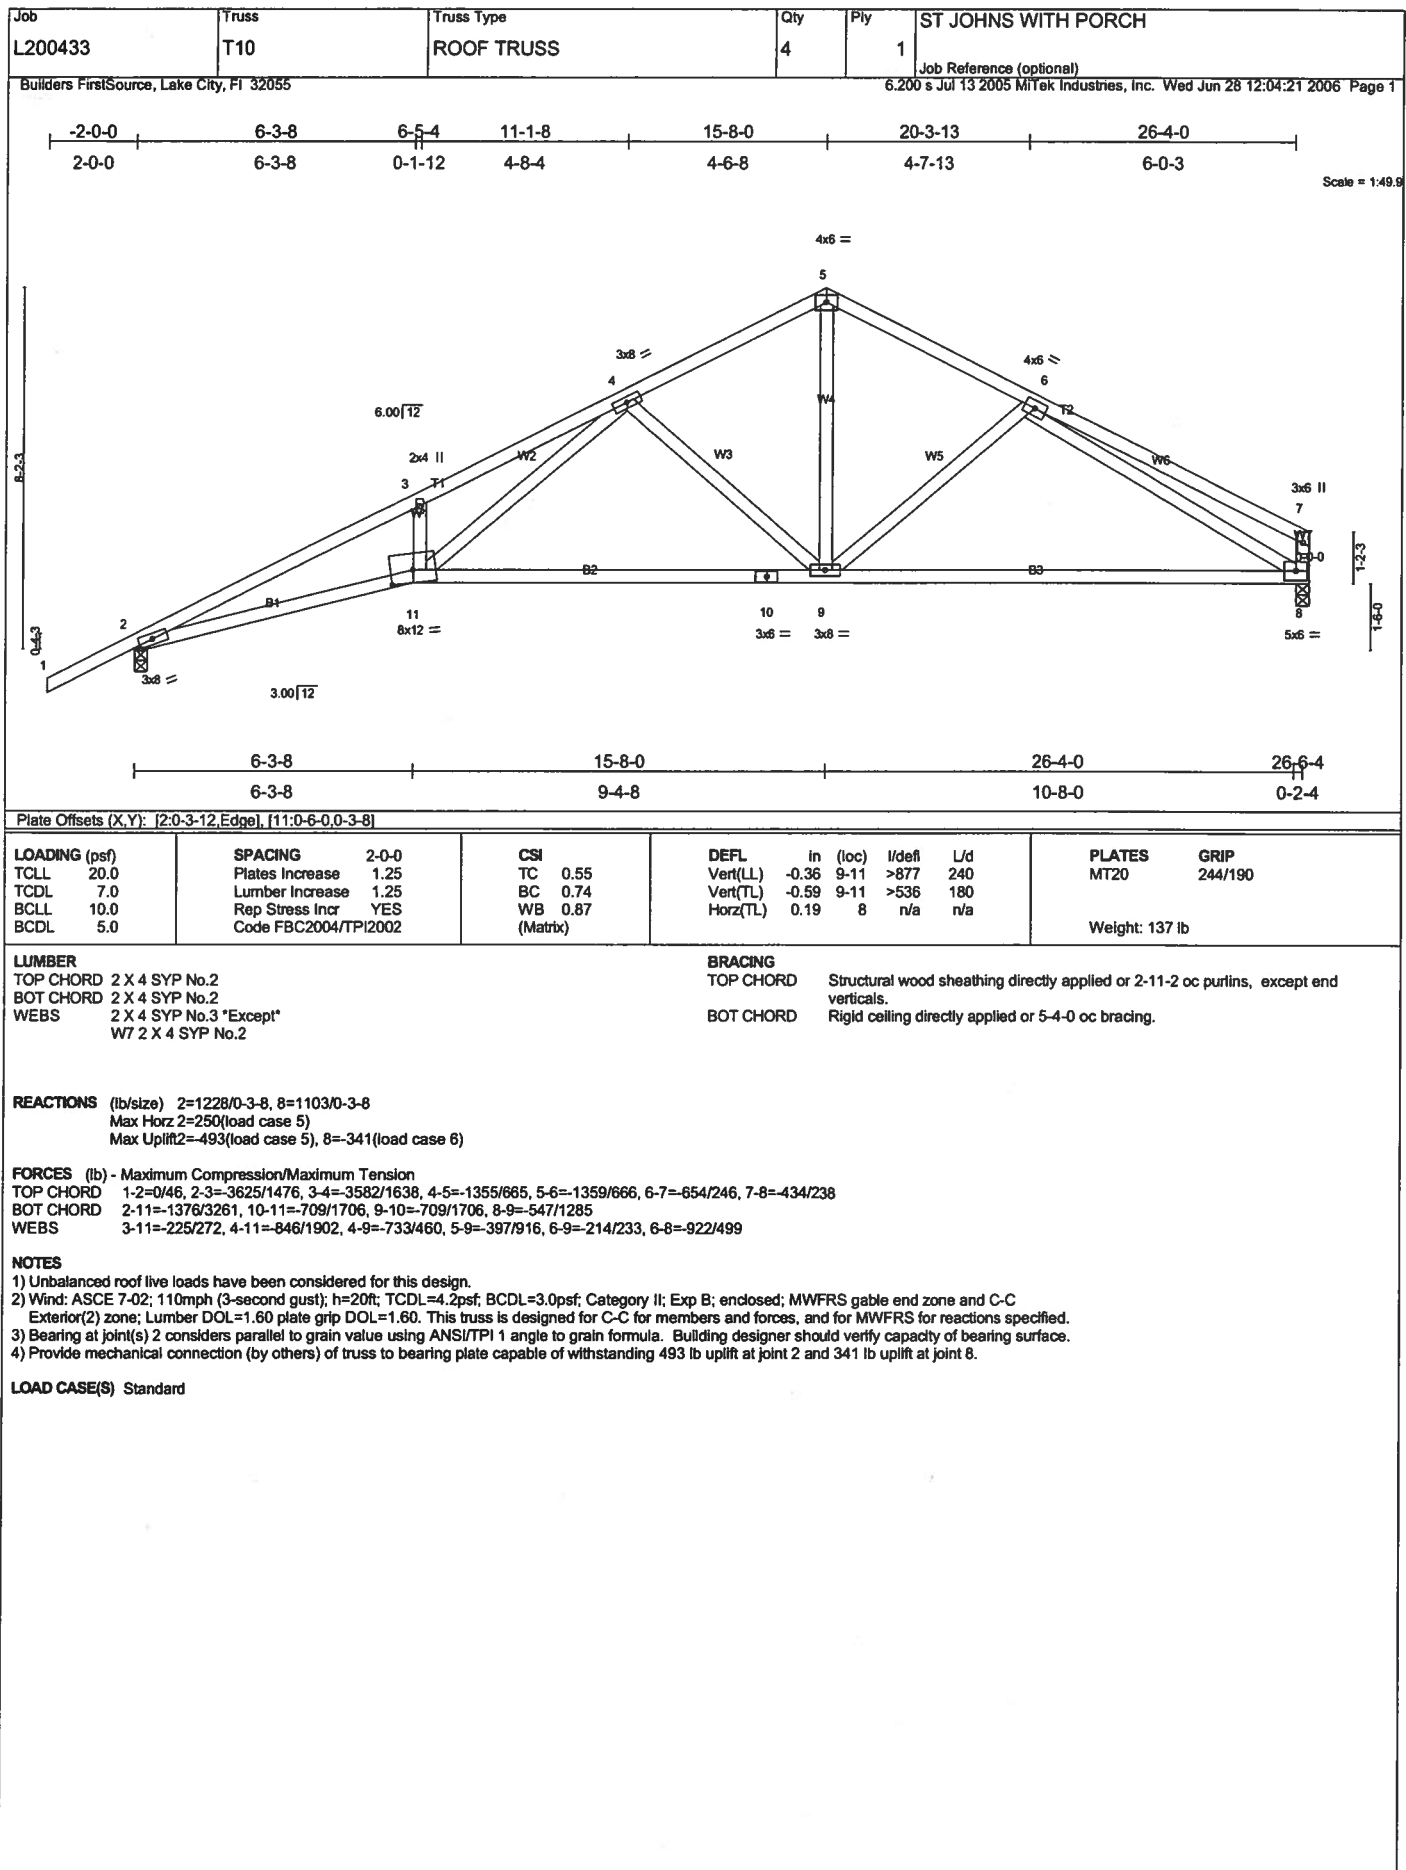

Job L200433	Truss T11	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 MiTek Industries, Inc. Wed Jun 28 12:04:21 2006 Page 1		

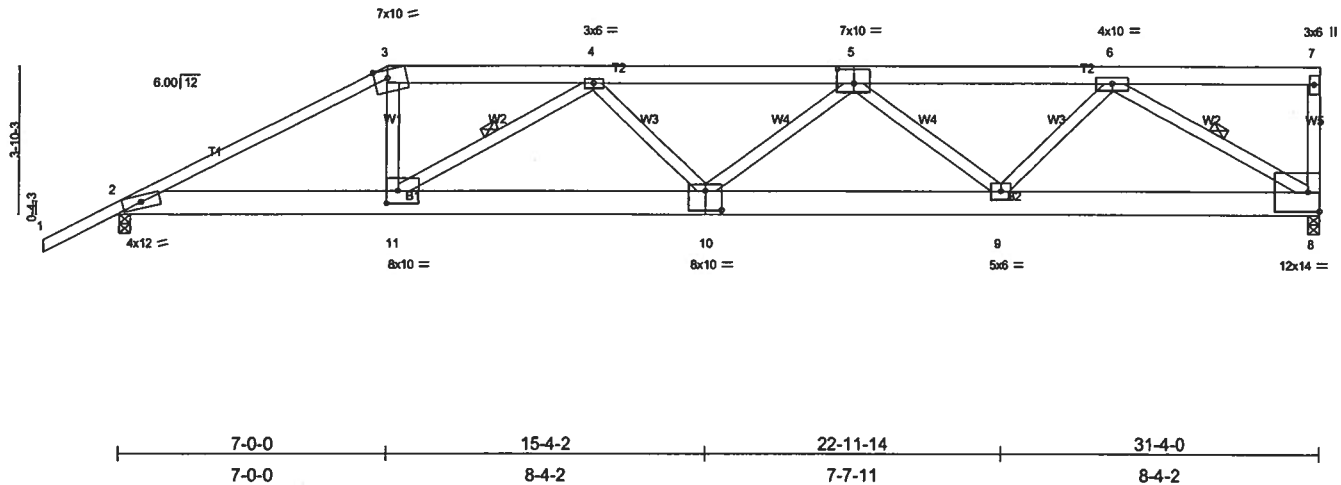



Plate Offsets (X,Y): [3:0-4-2,Edge], [5:0-5-0,0-4-8], [10:0-5-0,0-6-0], [11:0-3-8,0-4-0]

LOADING (psf)	SPACING	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.74	Vert(LL)	-0.32 10-11	>999	240	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.39	Vert(TL)	-0.51 10-11	>727	180		
BCLL 10.0	Rep Stress Incr	NO	WB 0.99	Horz(TL)	0.11 8	n/a	n/a		
BCDL 5.0	Code FBC2004/TP12002		(Matrix)						
									Weight: 220 lb

LUMBER
 TOP CHORD 2 X 6 SYP No.1D *Except*
 T1 2 X 4 SYP No.2
 BOT CHORD 2 X 8 SYP 2400F 2.0E
 WEBS 2 X 4 SYP No.3 *Except*
 W5 2 X 4 SYP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-3-1 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-10-5 oc bracing.
 WEBS 1 Row at midpt 4-11, 6-8

REACTIONS (lb/size) 8=2880/0-3-8, 2=2769/0-3-8
 Max Horz 2=223(load case 4)
 Max Uplift 8=1300(load case 5), 2=1174(load case 4)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/54, 2-3=5492/2346, 3-4=4948/2181, 4-5=6793/2969, 5-6=5222/2250, 6-7=-121/45, 7-8=293/218
 BOT CHORD 2-11=-2148/4863, 10-11=-3033/6554, 9-10=-2995/6487, 8-9=-1806/3809
 WEBS 3-11=-726/1960, 4-11=-2003/1021, 4-10=0/390, 5-10=0/446, 5-9=-1675/986, 6-9=-673/2140, 6-8=-4353/2079

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone; Lumber DOL=1.60 plate grip DOL=1.60.
- Provide adequate drainage to prevent water ponding.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1300 lb uplift at joint 8 and 1174 lb uplift at joint 2.
- Girder carries hip end with 0-0-0 right side setback, 7-0-0 left side setback, and 7-0-0 end setback.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 539 lb down and 277 lb up at 7-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-3=-54, 3-7=-118(F=-64), 2-11=-30, 8-11=-65(F=-35)
 Concentrated Loads (lb)
 Vert: 11=-539(F)

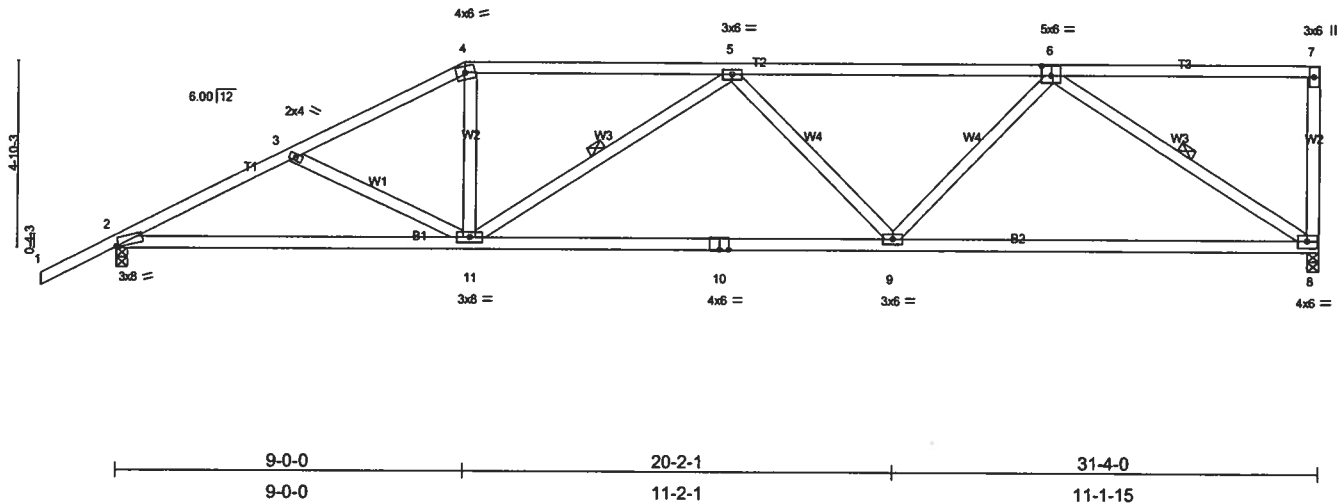


Plate Offsets (X,Y): [2:0-0-10,Edge], [6:0-3-0,0-3-0]												
LOADING (psf)		SPACING		2-0-0		CSI		DEFL			PLATES	GRIP
TCLL 20.0		Plates Increase		1.25		TC 0.85		in (loc) l/defl L/d			MT20	244/190
BCDL 7.0		Lumber Increase		1.25		BC 0.81		Vert(LL) -0.32 9-11 >989 240				
BCLL 10.0		Rep Stress Incr		YES		WB 0.60		Vert(TL) -0.54 9-11 >667 180				
BCDL 5.0		Code FBC2004/TP12002				(Matrix)		Horz(TL) 0.10 8 n/a n/a				
											Weight: 160 lb	

LUMBER
TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 3-10-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-4-5 oc bracing.
WEBS	1 Row at midpt 5-11, 6-8

REACTIONS (lb/size) 8=1300/0-3-8, 2=1424/0-3-8
Max Horz 2=272(load case 5)
Max Uplift 8=478(load case 4), 2=491(load case 5)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/47, 2-3=-2366/924, 3-4=-2146/824, 4-5=-1897/798, 5-6=-2052/785, 6-7=-84/9, 7-8=-166/110
 BOT CHORD 2-11=-969/2061, 10-11=-965/2240, 9-10=-965/2240, 8-9=-671/1546
 WEBS 3-11=205/195, 4-11=-130/631, 5-11=-413/301, 5-9=-278/265, 8-9=-168/747, 6-8=-1758/797

NOTES

- 1) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDF=4.2psf; BCDF=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- 2) Provide adequate drainage to prevent water ponding.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 478 lb uplift at joint 8 and 491 lb uplift at joint 2.

LOAD CASE(S) Standard

Job L200433	Truss T13	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:23 2006 Page 1		

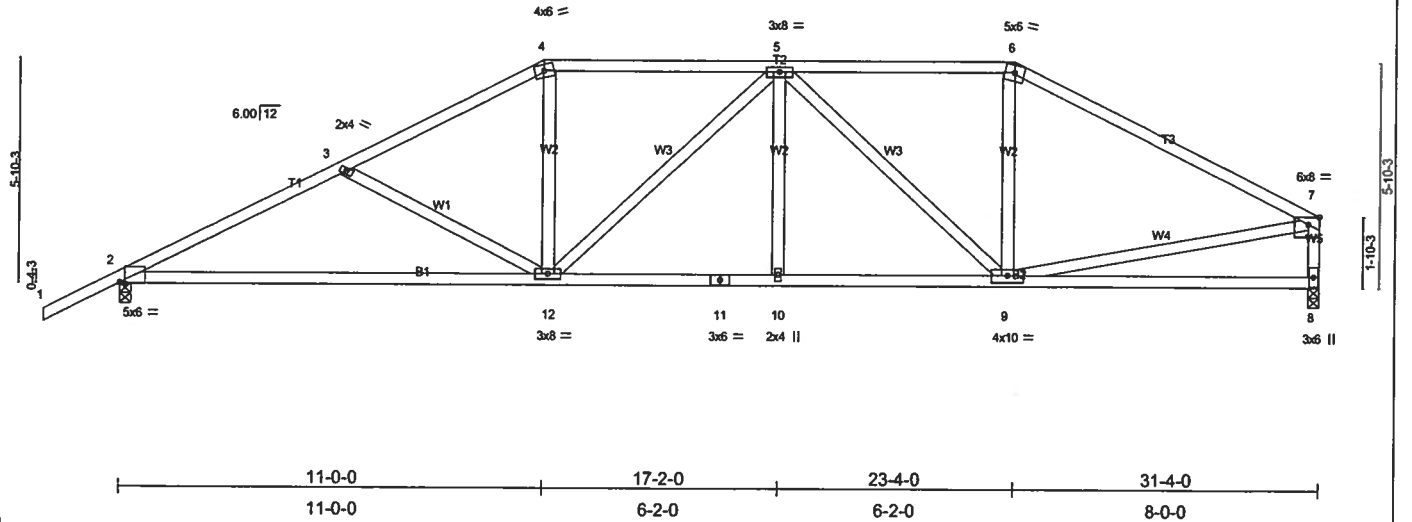



Plate Offsets (X,Y): [2:0-1-11,Edge], [7:0-3-8,Edge]

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.54	In (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.80	Vert(LL) -0.37 2-12 >999 240		
BCLL 10.0	Lumber Increase 1.25	WB 0.70	Vert(TL) -0.63 2-12 >592 180		
BCDL 5.0	Rep Stress Incr YES	(Matrix)	Horz(TL) 0.08 8 n/a n/a		
	Code FBC2004/TPI2002				Weight: 169 lb

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3 *Except*
W5 2 X 4 SYP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-7-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-9-7 oc bracing.

REACTIONS

(lb/size) 2=1424/0-3-8, 8=1300/0-3-8
Max Horz 2=192(load case 5)
Max Uplift 2=518(load case 5), 8=364(load case 6)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/47, 2-3=-2292/973, 3-4=-1978/831, 4-5=-1724/809, 5-6=-1451/723, 6-7=-1710/714, 7-8=-1173/556
BOT CHORD 2-12=-853/2002, 11-12=-667/1827, 10-11=-667/1827, 9-10=-667/1827, 8-9=-167/285
WEBS 3-12=-336/280, 4-12=-119/548, 5-12=-263/174, 5-10=0/126, 5-9=-607/241, 6-9=-48/413, 7-9=-362/1180

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- Provide adequate drainage to prevent water ponding.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 518 lb uplift at joint 2 and 364 lb uplift at joint 8.

LOAD CASE(S) Standard

Job L200433	Truss T15	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional)		
			6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:24 2006 Page 1		

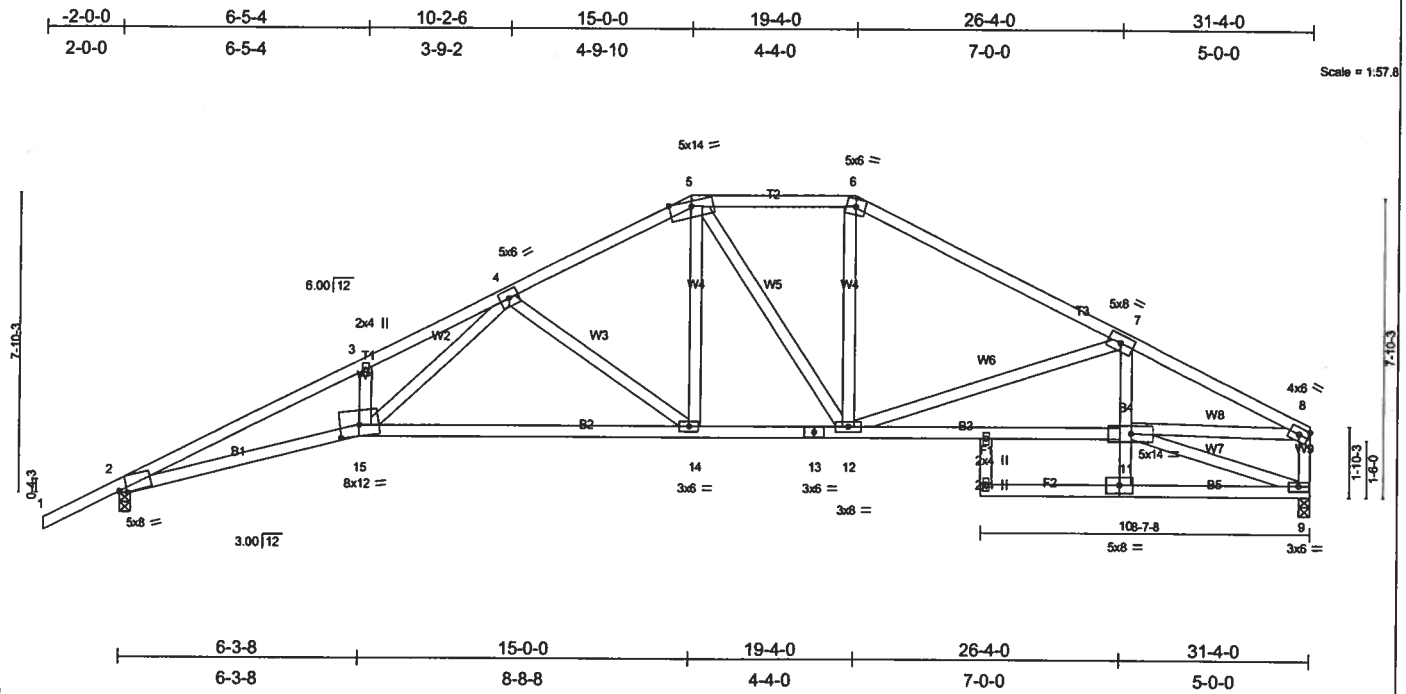

Job	Truss	Truss Type	Qty	Ply	ST JOHNS WITH PORCH
L200433	T17	ROOF TRUSS	1	1	
Builders FirstSource, Lake City, FL 32055			Job Reference (optional)		
			6.200 s Jul 13 2005 MiTek Industries, Inc. Wed Jun 28 12:04:26 2006 Page 1		

-2-0-0	6-3-8	6-5-4	10-2-7	15-8-0	19-0-8	22-0-8	26-3-9	31-4-0	33-4-0
2-0-0	6-3-8	0-1-12	3-9-3	5-5-9	3-4-8	3-0-0	4-3-1	5-0-7	2-0-0

Scale = 1/61.6

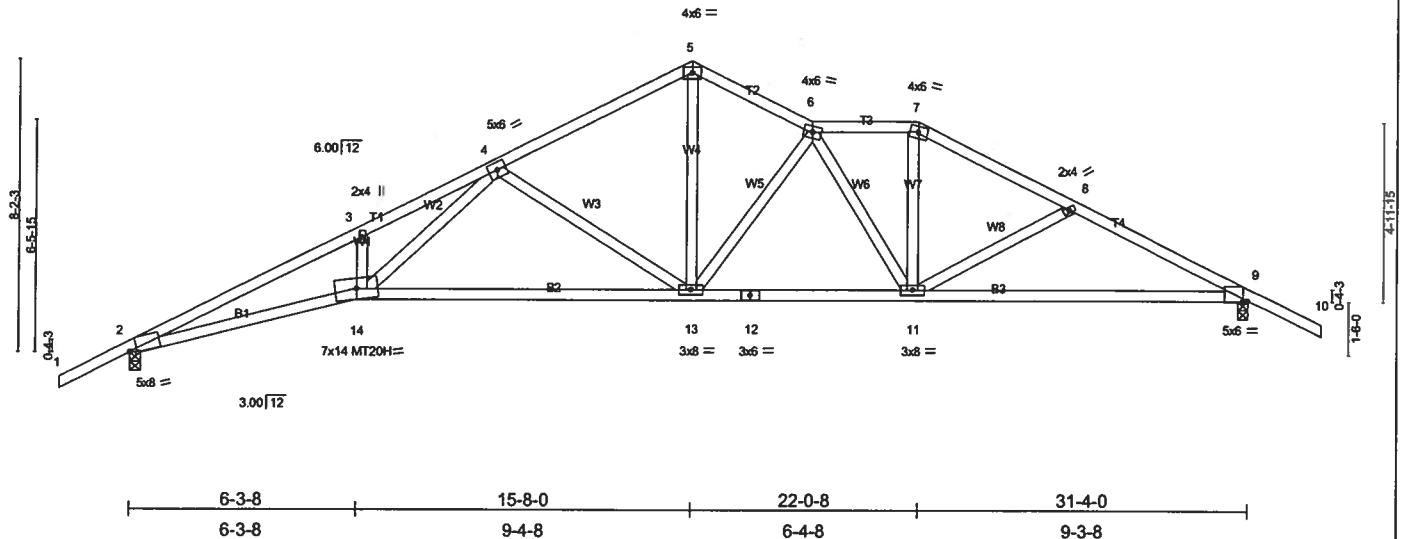


Plate Offsets (X,Y): [2:0-2-7,Edge], [9:0-1-11,Edge]					
LOADING (psf)	SPACING	2-0-0	CSI	DEFL	PLATES
TCLL 20.0	Plates Increase	1.25	TC 0.71	in (loc) l/defl L/d	GRIP
TCDL 7.0	Lumber Increase	1.25	BC 0.90	Vert(LL) -0.51 13-14 >735 240	MT20 244/190
BCLL 10.0	Rep Stress Incr	YES	WB 0.71	Vert(TL) -0.83 13-14 >447 180	MT20H 187/143
BCDL 5.0	Code FBC2004/TPI2002		(Matrix)	Horz(TL) 0.27 9 n/a n/a	Weight: 163 lb

LUMBER
 TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2
 WEBS 2 X 4 SYP No.3

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-2-11 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 5-2-13 oc bracing.

REACTIONS (lb/size) 2=1420/0-3-8, 9=1420/0-3-8
 Max Horz 2=196(load case 5)
 Max Uplift 2=548(load case 5), 9=546(load case 6)


FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/46, 2-3=-4411/1665, 3-4=-4334/1801, 4-5=-1873/851, 5-6=-1820/861, 6-7=-1828/846, 7-8=-2077/884, 8-9=-2330/991, 9-10=0/47
 BOT CHORD 2-14=-1416/3977, 13-14=-843/2384, 12-13=-628/2028, 11-12=-628/2028, 9-11=-717/2034
 WEBS 3-14=-169/230, 4-14=-749/1994, 4-13=-920/506, 5-13=-532/1325, 6-13=-703/355, 6-11=-386/188, 7-11=-208/681, 8-11=-271/219

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 548 lb uplift at joint 2 and 546 lb uplift at joint 9.

LOAD CASE(S) Standard

Job L200433	Truss T18	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional)		
			6.200 s Jul 13 2005 MiTek Industries, Inc. Wed Jun 28 12:04:26 2006 Page 1		



Scale = 1:61.6

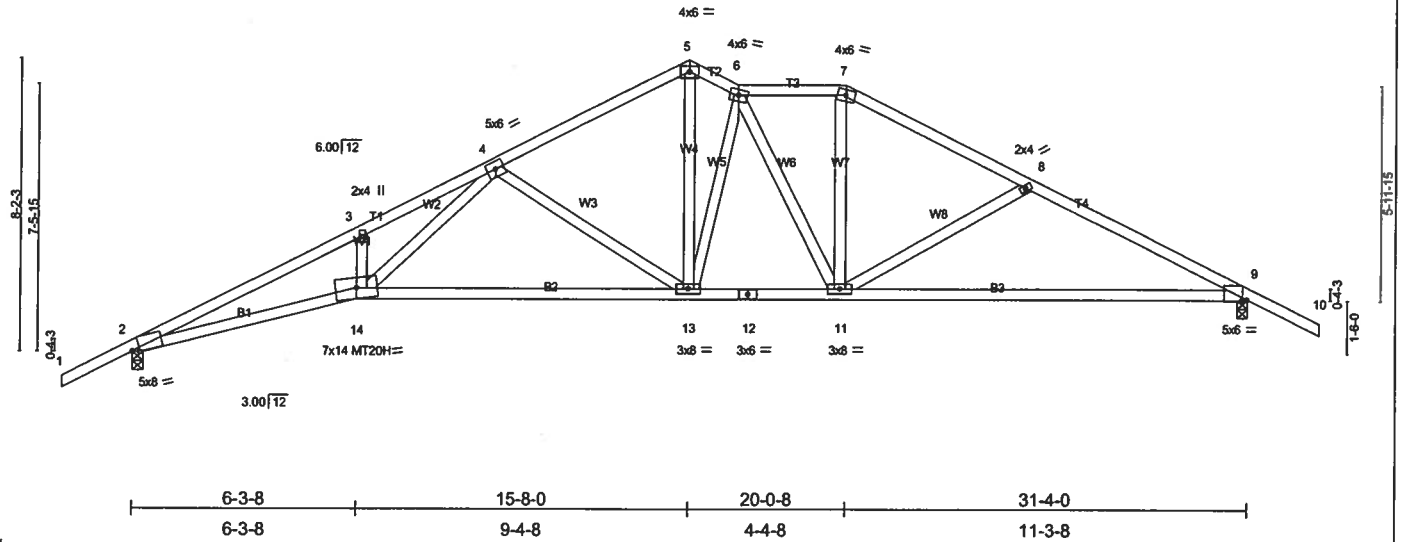


Plate Offsets (X,Y): [2-0-2-7,Edge], [9-0-1-11,Edge]

LOADING (psf)	SPACING	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase 1.25	TC 0.71	Vert(TL)	-0.51 13-14	>725	240	MT20	244/190
TCDL 7.0	Lumber Increase 1.25	BC 0.91	Vert(TL)	-0.85 13-14	>440	180	MT20H	187/143
BCLL 10.0	Rep Stress Incr YES	WB 0.70	Horz(TL)	0.26 9	n/a	n/a		
BCDL 5.0	Code FBC2004/TPI2002	(Matrix)						
							Weight: 168 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2
 WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-12 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS

(lb/size) 2=1420/0-3-8, 9=1420/0-3-8
 Max Horz 2=196(load case 5)
 Max Uplift 2=548(load case 5), 9=546(load case 6)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/46, 2-3=4416/1661, 3-4=4340/1798, 4-5=1870/851, 5-6=1745/840, 6-7=1681/813, 7-8=1936/841, 8-9=2263/984, 9-10=0/47
 BOT CHORD 2-14=1413/3982, 13-14=840/2380, 12-13=477/1751, 11-12=477/1751, 9-11=699/1975
 WEBS 3-14=172/232, 4-14=749/2006, 4-13=915/502, 5-13=481/1241, 6-13=620/239, 6-11=227/105, 7-11=151/575, 8-11=365/297

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 548 lb uplift at joint 2 and 546 lb uplift at joint 9.

LOAD CASE(S) Standard

Job L200433	Truss T20	Truss Type ROOF TRUSS	Qty 3	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			Job Reference (optional) 6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:28 2006 Page 1		

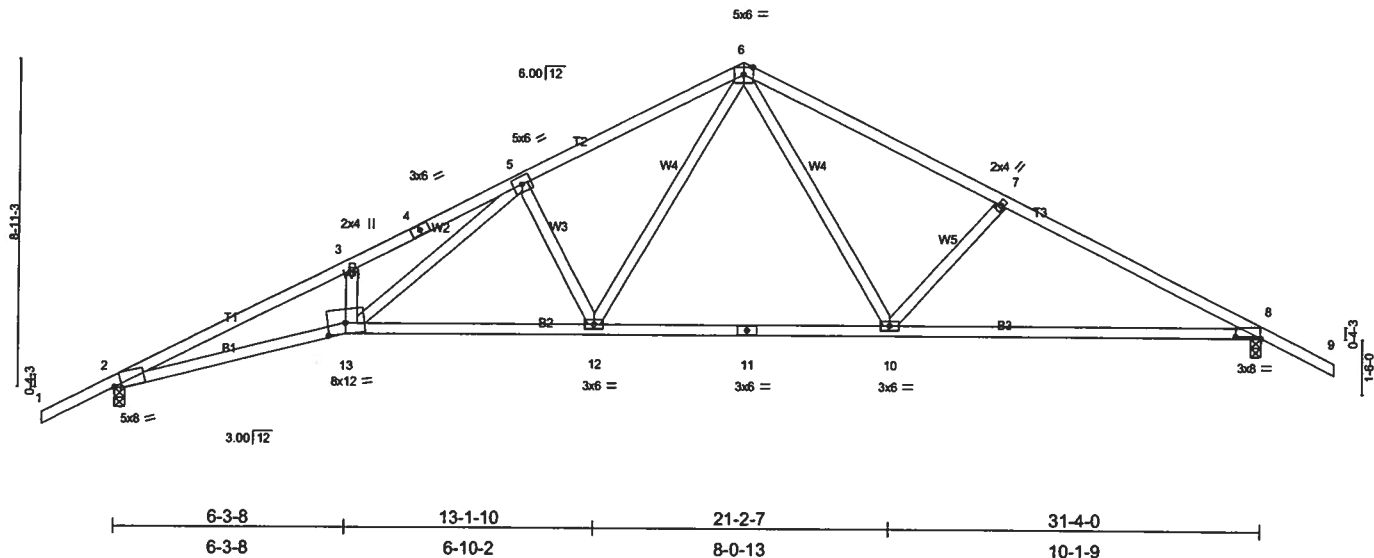



Plate Offsets (X,Y): [2-0-2-7 Edge], [8-0-8-4,0-0-10], [13-0-6-0,0-3-8]

LOADING (psf)	SPACING	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.57	Vert(LL)	-0.39 12-13	>949	240	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.90	Vert(TL)	-0.63 12-13	>589	180		
BCLL 10.0	Rep Stress Incr	YES	WB 0.65	Horz(TL)	0.26 8	n/a	n/a		
BCDL 5.0	Code FBC2004/TPI2002		(Matrix)						
									Weight: 154 lb

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-6-6 oc purlins.
BOT CHORD Rigid ceiling directly applied or 5-2-7 oc bracing.

REACTIONS (lb/size) 2=1420/0-3-8, 8=1420/0-3-8

Max Horz 2=206(load case 5)

Max Uplift 2=555(load case 5), 8=533(load case 6)

FORCES (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/46, 2-3=4352/1692, 3-4=4295/1830, 4-5=4193/1845, 5-6=2213/1045, 6-7=2027/924, 7-8=2268/981, 8-9=0/47
BOT CHORD 2-13=-1442/3917, 12-13=-769/2248, 11-12=-353/1410, 10-11=-353/1410, 8-10=-690/1970
WEBS 3-13=-196/258, 5-13=-851/2033, 5-12=-748/459, 6-12=-436/1032, 6-10=-227/671, 7-10=-380/343

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 555 lb uplift at joint 2 and 533 lb uplift at joint 8.

LOAD CASE(S) Standard

Job L200433	Truss T21	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			6.200 s Jul 13 2005 Mitek Industries, Inc. Wed Jun 28 12:04:29 2006 Page 1		

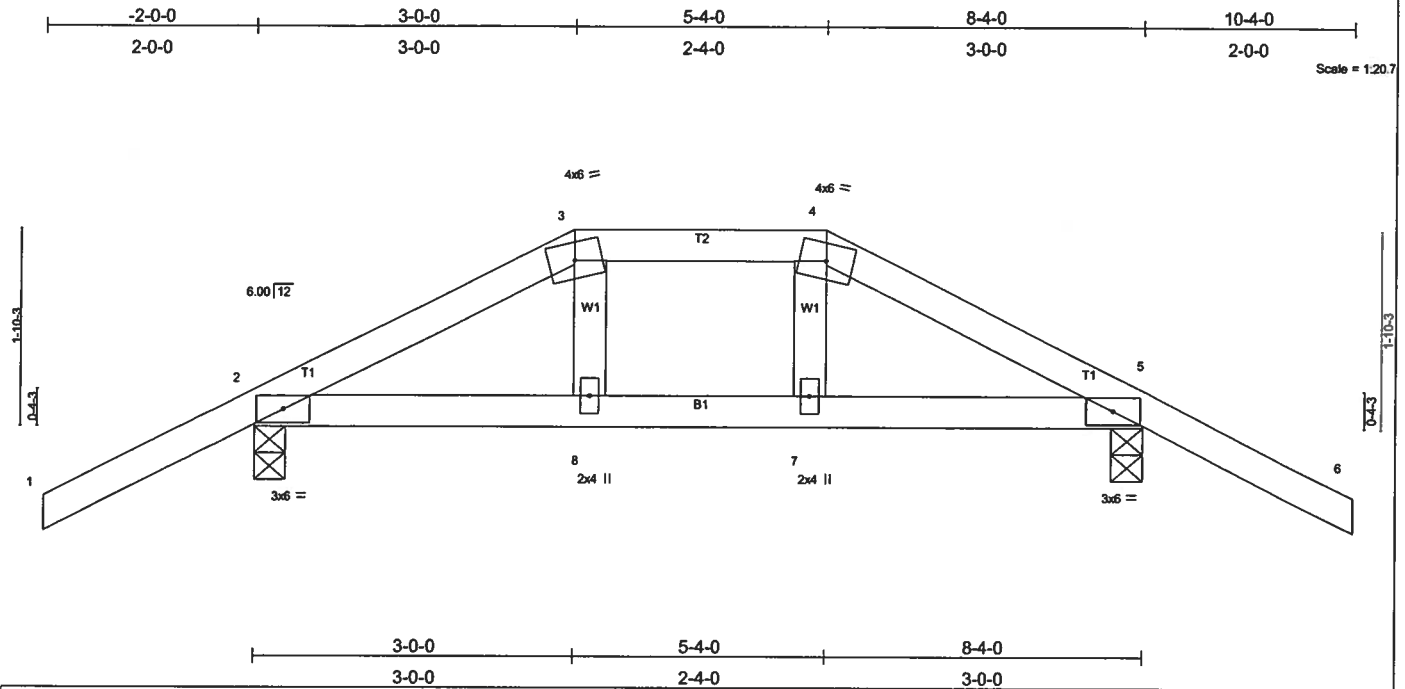

LOADING (psf)	SPACING	CSI	DEFL	PLATES	GRIP
TCLL 20.0	2'-0"	TC 0.27	In (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Plates Increase 1.25	BC 0.17	Vert(LL) 0.01 8 >999 240		
BCLL 10.0	Lumber Increase 1.25	WB 0.05	Vert(TL) -0.02 7-8 >999 180		
BCDL 5.0	Rep Stress Incr NO	(Matrix)	Horz(TL) 0.01 5 n/a n/a		
	Code FBC2004/TPI2002			Weight: 37 lb	

LUMBER
 TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2
 WEBS 2 X 4 SYP No.3

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS (lb/size) 2=533/0-3-8, 5=533/0-3-8
 Max Horz 2=59(load case 4)
 Max Uplift 2=378(load case 4), 5=378(load case 5)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/47, 2-3=-587/300, 3-4=-488/275, 4-5=-587/300, 5-6=0/47
 BOT CHORD 2-8=-217/476, 7-8=-223/488, 5-7=-216/476
 WEBS 3-8=-80/149, 4-7=-80/149

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60.
- 3) Provide adequate drainage to prevent water ponding.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 378 lb uplift at joint 2 and 378 lb uplift at joint 5.
- 5) Girder carries hip end with 3'-0" end setback.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 63 lb down and 32 lb up at 5'-4"-0, and 63 lb down and 32 lb up at 3'-0"-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Regular: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-3=-54, 3-4=-64(F=-10), 4-6=-54, 2-8=-30, 7-8=-35(F=-5), 5-7=-30
 Concentrated Loads (lb)
 Vert: 8=-63(F) 7=-63(F)

Job L200433	Truss T23	Truss Type ROOF TRUSS	Qty 1	Ply 1	ST JOHNS WITH PORCH
Builders FirstSource, Lake City, FL 32055			6.200 s Jul 13 2005 MiTek Industries, Inc. Wed Jun 28 12:04:30 2006 Page 1		

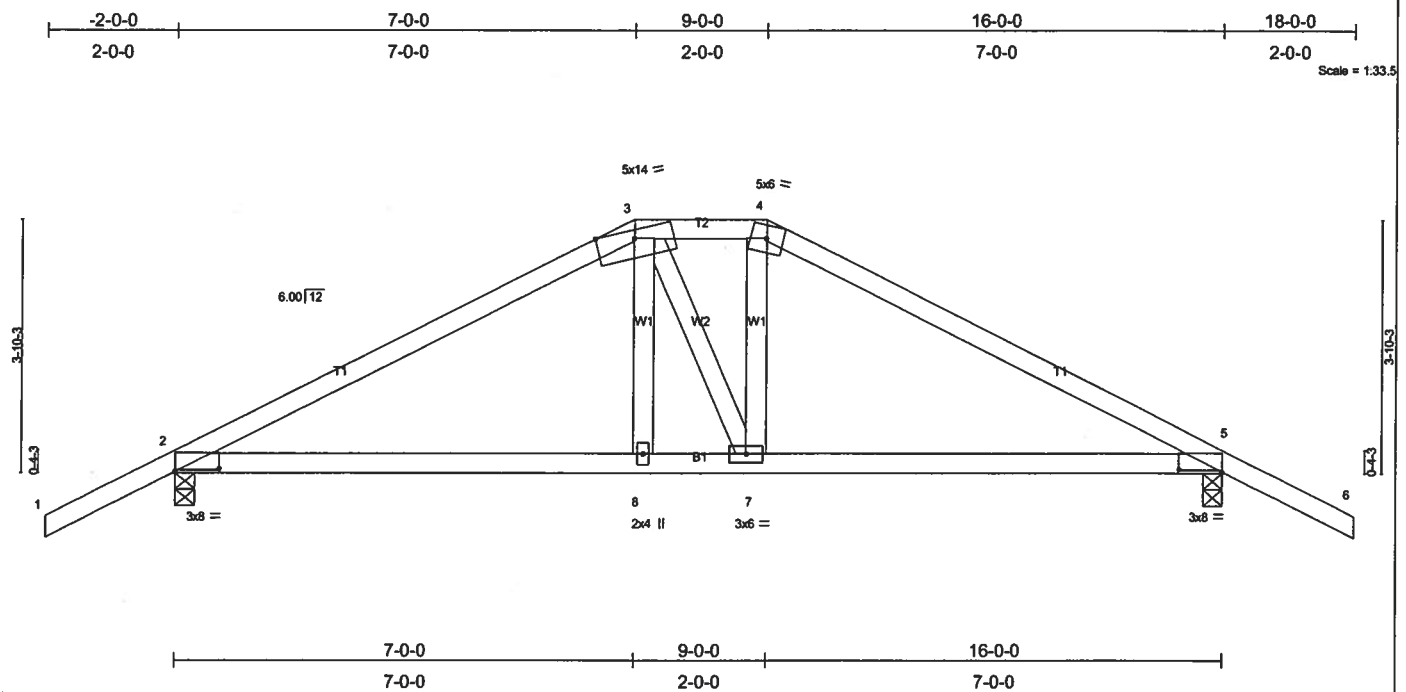


Plate Offsets (X,Y): [2-0-8-0,0-0-6], [5-0-8-0,0-0-6]										
LOADING (psf)		SPACING 2-0-0		CSI		DEFL in (loc) l/defl L/d		PLATES GRIP		
TCLL	20.0	Plates Increase	1.25	TC	0.44	Vert(LL)	0.14 2-8 >999	240	MT20 244/190	
TCDL	7.0	Lumber Increase	1.25	BC	0.61	Vert(TL)	-0.20 2-8 >945	180		
BCLL	10.0	Rep Stress Incr	NO	WB	0.27	Horz(TL)	0.05 5 n/a	n/a		
BCDL	5.0	Code FBC2004/TPI2002		(Matrix)						
						Weight: 72 lb				

LUMBER
 TOP CHORD 2 X 4 SYP No.2
 BOT CHORD 2 X 4 SYP No.2
 WEBS 2 X 4 SYP No.3

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-9-1 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 6-0-15 oc bracing.

REACTIONS (lb/size) 2=1408/0-3-8, 5=1408/0-3-8
 Max Horz 2=87(load case 4)
 Max Uplift 2=862(load case 4), 5=862(load case 5)


FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/47, 2-3=-2312/1221, 3-4=-2015/1170, 4-5=-2317/1223, 5-6=0/47
 BOT CHORD 2-8=-1017/1981, 7-8=-1031/2011, 5-7=-995/1986
 WEBS 3-8=-375/717, 3-7=-143/162, 4-7=-423/831

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60.
- 3) Provide adequate drainage to prevent water ponding.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 862 lb uplift at joint 2 and 862 lb uplift at joint 5.
- 5) Girder carries hip end with 7-0-0 end setback.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 539 lb down and 277 lb up at 9-0-0, and 539 lb down and 277 lb up at 7-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).




LOAD CASE(S) Standard

- 1) Regular: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-3=-54, 3-4=-118(F=-64), 4-6=-54, 2-8=-30, 7-8=-65(F=-35), 5-7=-30
 Concentrated Loads (lb)
 Vert: 8=-539(F) 7=-539(F)

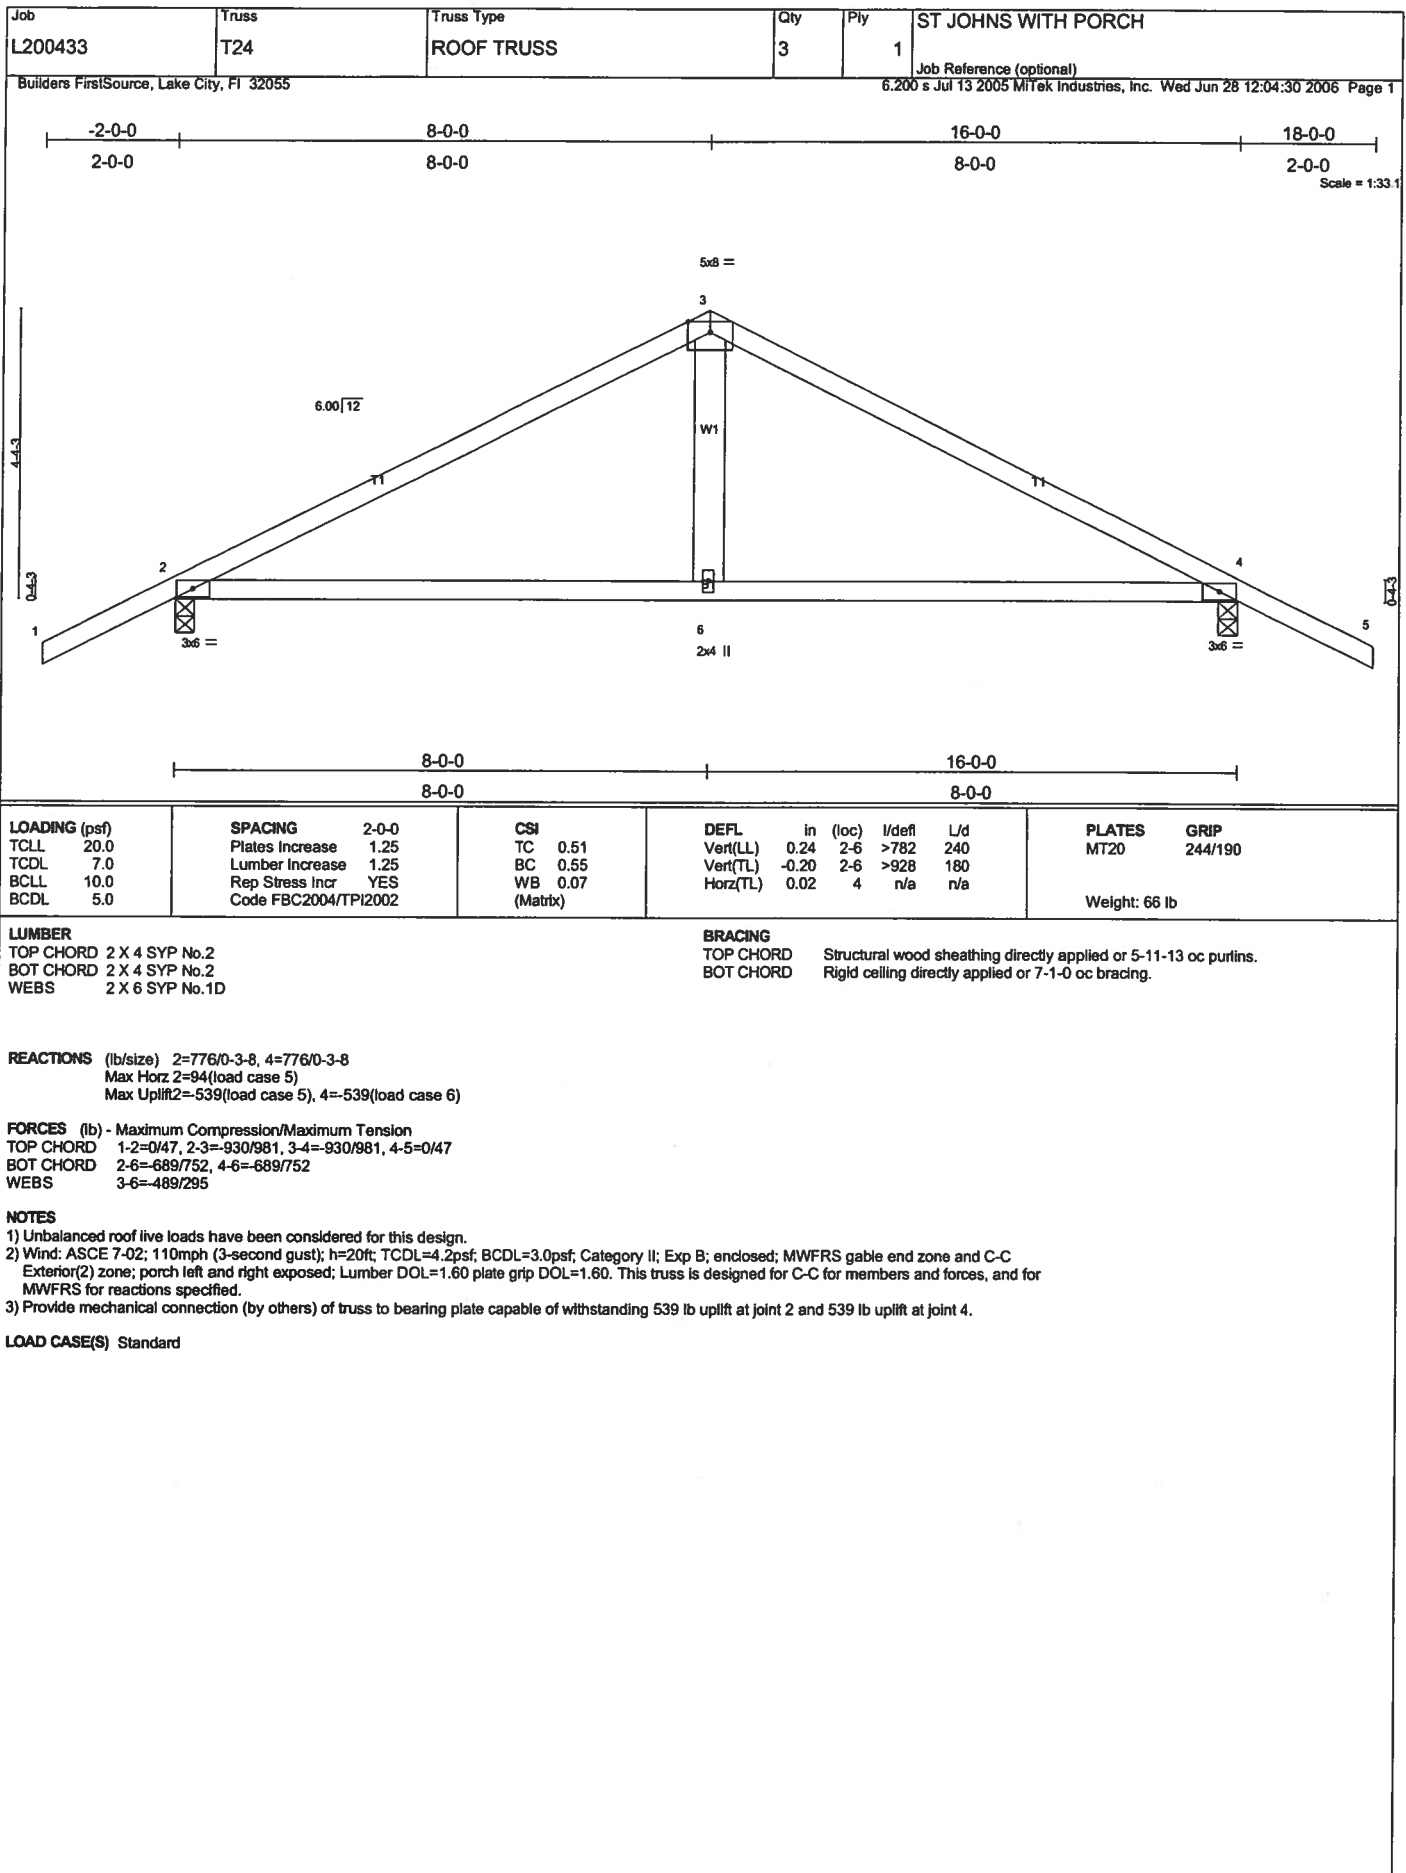

Symbols

PLATE LOCATION AND ORIENTATION

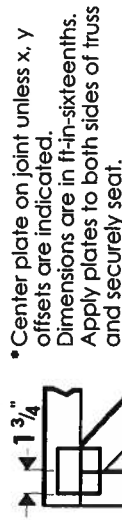

* Plate location details available in Mitek 20/20 software or upon request.

PLATE SIZE


4 X 4

The first dimension is the width perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING




BEARING



Industry Standards:

ANSI/TPI1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCS11: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

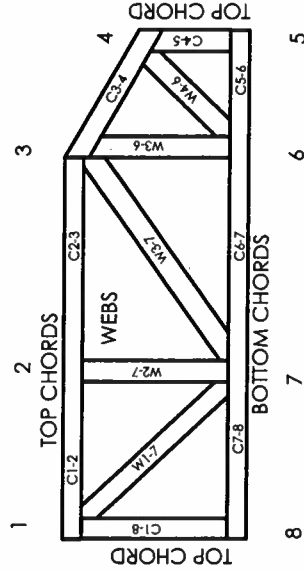

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.


CONNECTOR PLATE CODE APPROVALS

BOCA	96-31, 95-43, 96-20-1, 96-67, 84-32
ICBO	4922, 5243, 5363, 3907
SBCCI	9667, 9730, 9604B, 9511, 9432A

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCS11.
2. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
3. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
4. Cut members to bear tightly against each other.
5. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI1.
6. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI1.
7. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
8. Unless expressly noted, this design is not applicable for use with fire retardant or preservative treated lumber.
9. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
10. Plate type, size, orientation and location dimensions shown indicate minimum plating requirements.
11. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
12. Top chords must be sheathed or purlins provided at spacing shown on design.
13. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
14. Connections not shown are the responsibility of others.
15. Do not cut or alter truss member or plate without prior approval of a professional engineer.
16. Install and load vertically unless indicated otherwise.



Mitek Engineering Reference Sheet: MI-7473

© 2004 Mitek®

BEARING HEIGHT SCHEDULE

	8'-0"
	9'-6"

NOTES:

- REFER TO HB 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING) REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.
- ALL TRUSSSES (INCLUDING TRUSSSES UNDER VALLEY FRAMING) MUST BE COMPLETELY DECKED OR REFER TO DETAIL V05 FOR ALTERNATE BRACING REQUIREMENTS.
- ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER.
- ALL TRUSSSES ARE DESIGNED FOR 2' o.c. MAXIMUM SPACING, UNLESS OTHERWISE NOTED.
- ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.
- 5/42 TRUSSSES MUST BE INSTALLED WITH THE TOP BEING UP.
- ALL ROOF TRUSS HANGERS TO BE SAMPSON HUS26 UNLESS OTHERWISE NOTED. ALL FLOOR TRUSS HANGERS TO BE SAMPSON TH4422 UNLESS OTHERWISE NOTED.
- BEAM/HEADER/INTEL (HDS) TO BE FURNISHED BY BUILDER.

SHOP DRAWING APPROVAL

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSSES AND WALLS. ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS, REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Expend Bearing Note : _____

Approved By: _____ Date: _____



Bunnell
PHONE: 904-437-3349 FAX: 904-437-3994

Jacksonville
PHONE: 904-772-6100 FAX: 904-772-1973

Lake City
PHONE: 904-755-6844 FAX: 904-755-7973

Sanford
PHONE: 407-322-0094 FAX: 407-322-5953

BUILDER:

GIEBELG HOMES

MASTER

DATE:	DATE:	DATE:
MASTER	K.L.H.	MASTER

6/12 PITCH - 2'0" O/H

