

DESIGN SPECIFICATIONS

DESIGN CODE:
2017 FLORIDA BUILDING CODE – RESIDENTIAL
DESIGN IS VOID ONE YEAR AFTER THE DATE OF THE ORIGINAL PLANS.
UNLESS PLANS HAVE BEEN REVIEWED FOR CODE COMPLIANCE.

DESIGN LOADS: ACTUAL AND UNIFORM

	ROOF	FLOOR
ROOF LOADING:	(cd=1.25)	(cd=1.00)
TOP CHORD LIVE LOAD	20 psf	40 psf
TOP CHORD DEAD LOAD	7 psf (ARCH SHINGLES)	10 psf
TOP CHORD DEAD LOAD	20 psf (TILE SHINGLES)	10 psf
BOTTOM CHORD LIVE LOAD	10 psf	0 psf
BOTTOM CHORD DEAD LOAD	5 psf	0 psf

DEFLECTION CRITERIA:

ROOF FRAMING: LIVE LOAD L/240 TOTAL LOAD L/180
FLOOR FRAMING: LIVE LOAD L/360 & TOTAL LOAD L/240
0.75" MAX ANY CASE

WIND LOADING:

ASCE 7-10 FOR WIND UPLIFT, TRUSSES SHALL BE DESIGNED WITH A MIN. DEAD LOAD CONDITION OF 5 PSF TOP CHORD AND 5 PSF BOTTOM CHORD. REACTIONS CALCULATED FOR THE BEARING POINTS OF ROOF TRUSSES SHALL BE REDUCED. SPECIFICALLY, ATTIC FLOOR LIVE LOADS COMBINED WITH ROOF LIVE LOADS SHALL BE MULTIPLIED BY 0.75 WHEN COMBINED W/ DEAD LOAD.

BASIC WIND SPEED (ASCE 7-10)	130 MPH
IMPORTANCE FACTOR	1.00
MEAN ROOF HEIGHT	20.0 FT
ROOF PITCH	7/12
BUILDING CATEGORY	II
EXPOSURE CATEGORY	C
ENCLOSURE CLASSIFICATION	ENCLOSED
INTERNAL PRESSURE COEFFICIENT	± .18

MATERIAL SPECIFICATIONS

HARDWARE AND ANCHORS:
ANCHOR BOLTS & THREADED ROD: SHALL BE IN ACCORDANCE WITH ASTM A 307 OR ASTM F 1554, GRADE 60.
WASHERS: SHALL BE IN ACCORDANCE WITH ASTM A500 (GRADE B).
NUTS: SHALL BE IN ACCORDANCE WITH ASTM A 563 GRADE A HEX.
METAL CONNECTORS: ALL METAL CONNECTORS WHICH ARE EXPOSED TO EXTERIOR SHALL BE GALVANIZED.
REINFORCED REBAR/ROD INSTALLATION: EMBEDMENT OF RODS OR REBAR DETAILS SHALL BE 12 BAR DIAMETER MINIMUM. HOLES SHALL BE 1/4" LARGER THAN REBAR SIX AND 1/4" LARGER THAN THREADED ROD SIZE.
ANCHORING ADHESIVE: SHALL BE ONE OF THE FOLLOWING PRODUCTS (DUAL CARTRIDGE INSTALLATION ONLY):
EPOXY: ITW RED HEAD A7
REINFORCING STEEL: SHALL BE ASTM A615, GRADE 60.
STRUCTURAL STEEL: SHALL BE ASTM A992, GRADE 50.
WELDED WIRE FABRIC (WVF): SHALL BE ASTM A185.
LAMINATED VENEER LUMBER (LVL): ALL LAMINATED VENEER LUMBER SHALL MEET OR EXCEED THE FOLLOWING DESIGN PROPERTIES – ELASTIC MODULUS (E) 900ksi, BENDING STRESS (Fb) 2600psi

TRIIBUTARY AREA (sf)	COMPONENTS & CLADDING ALLOWABLE DESIGN PRESSURES		GARAGE DOOR PRESSURES (PSF)	
	INTERIOR	EDGE STRIP (PSF):		
	ZONE (PSF)	'a' = 4'-6"		
10	+25.1 – -27.7	+25.6 – -34.2	1 GARAGE DOOR (8'x7')	+22.9
50	+22.1 – -25.0	+22.9 – -28.8	2 GAR GARAGE DOOR (16'x7')	+21.8
100	+21.1 – -23.9	+21.8 – -28.6		-23.9

- THE VALUES ABOVE ARE ALLOWABLE WIND PRESSURE VALUES (ASD). THE ABOVE WIND PRESSURES HAVE BEEN REDUCED BY 0.60 AS PERMITTED BY THE ALLOWABLE STRESS DESIGN METHODOLOGY, NO FURTHER REDUCTION SHALL BE PERMITTED
- COMPONENT & CLADDING WALL ELEMENTS SHALL BE DESIGNED FOR BOTH POSITIVE AND NEGATIVE PRESSURES SHOWN IN TABLE ABOVE.
- LINEAR INTERPOLATION IS PERMISSIBLE.
- PLUS = PRESSURE MINUS = SUCTION.
- DESIGN OF WINDOWS/DOORS FASTENING TO THE WALL FRAMING IS THE RESPONSIBILITY OF THE WINDOW/DOOR MANUF./SUPPLIER & SHALL MEET THE ABOVE NOTED POSITIVE AND NEGATIVE PRESSURES.

[NOT ACTUAL PLAN]

SCOPE OF SERVICE

MEANS AND METHODS
THE STRUCTURAL ENGINEER SHALL HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE FOR ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

LIMITS OF STRUCTURAL ENGINEERING DESIGN RESPONSIBILITIES:
THE ITEMS SPECIFICALLY DESIGNED BY THE STRUCTURAL ENGINEER ARE LIMITED TO THE FOLLOWING: CONTINUOUS LOAD FRAMING FROM WIND UPLIFT, WOOD PAINT, SHAWLS, WALL FRAMING AND REINFORCED CONCRETE AND HEADERS DIRECTLY SUPPORTING ROOF PLATH. ITEMS NOT DESIGNED PER-ENGINEERED WOOD FLOOR AND ROOF TRUSSES, FLOOR FRAMING NOT SPECIFICALLY ADDRESSED TO INCLUDE CONNECTION, AND ANY ARCHITECTURAL, MECHANICAL OR ELECTRICAL SYSTEM.

COMPONENTS & CLADDING ALLOWABLE DESIGN PRESSURES			
TRIBUTARY AREA (sf)	INTERIOR ZONE (PSF)	EDGE STRIP (PSF): "a" = 4'-8"	
10	+25.1 –27.7	+25.6 –34.2	
50	+22.1 –25.0	+22.9 –28.8	
100	+21.1 –23.9	+21.8 –26.6	


THE VALUES ABOVE ARE ALLOWABLE WIND PRESSURE VALUES (ASD). THE ABOVE WIND PRESSURES HAVE BEEN REDUCED BY 0.60 AS PERMITTED BY THE ALLOWABLE STRESS DESIGN METHODOLOGY. NO FURTHER REDUCTION SHALL BE PERMITTED

COMPONENT & CLADDING WALL ELEMENTS SHALL BE DESIGNED FOR BOTH POSITIVE AND NEGATIVE PRESSURES SHOWN IN TABLE ABOVE.

LINEAR INTERPOLATION IS PERMISSIBLE.

PLUS = PRESSURE AND MINUS = SUCTION.

DESIGN OF WINDOW/DOORS FASTENING TO THE WALL FRAMING IS THE RESPONSIBILITY OF THE WINDOW/DOOR MANUF./SUPPLIER & SHALL MEET THE ABOVE NOTED POSITIVE AND NEGATIVE PRESSURES.

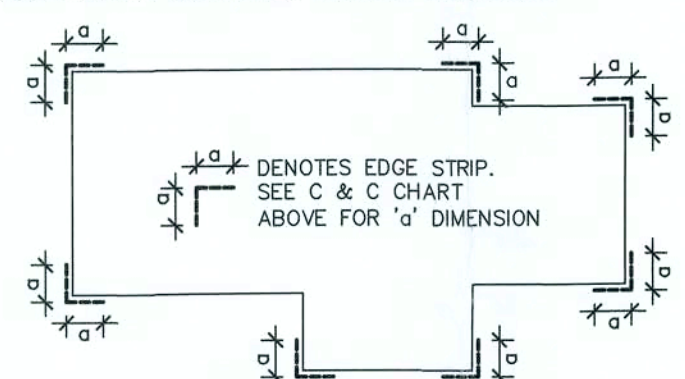

SCOPE OF SERVICE

MEANS AND METHODS:
THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES; FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE FOR ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

LIMITS OF STRUCTURAL ENGINEERING DESIGN RESPONSIBILITIES:
THE ITEMS SPECIFICALLY DESIGNED BY THE STRUCTURAL ENGINEER ARE LIMITED TO THE FOLLOWING: CONTINUOUS LOAD PATH FOR WIND UPLIFT; WOOD PANEL SHEARWALLS, WALL FRAMING AND REQUIRED SHEATHING AND HEADERS DIRECTLY SUPPORTING ROOF FRAMING. ITEMS NOT DESIGNED PRE-ENGINEERED WOOD FLOOR AND ROOF TRUSSES, FLOOR FRAMING NOT SPECIFICALLY ADDRESSED, TRUSS-TO-TRUSS CONNECTION, AND ANY ARCHITECTURAL, MECHANICAL OR ELECTRICAL SYSTEM.

GENERAL NOTES & CONSTRUCTION SPECIFICATIONS

FLOOR SHEATHING SPECIFICATIONS
23/32" T&G OSB OR PLYWOOD SHEATHING, GLUE AND NAIL WITH 10d COMMON @ 6" O.C. EDGE & FIELD

ROOF SHEATHING SPECIFICATIONS
SHINGLE – MIN. 7/16", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, NAILED W/ 0.113x2" RINI SHANK NAILS @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE).

TILE – MIN. 15/32", 32/16, APA RATED PLYWOOD SHEATHING, NAILED W/ 0.113x2" RING SHANK @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE).

METAL – MIN. 1/2", 24/16, APA RATED PLYWOOD SHEATHING, NAILED W/ 0.113x2" RING SHANK NAILS @ 6" O.C. EDGE & 6" O.C. FIELD (AT GABLE ENDS DECREASE EDGE NAIL SPACING TO 4" O.C. WITHIN 4'-0" OF ROOF EDGE).

WALL SHEATHING SPECIFICATIONS
FLEXIBLE FINISH – MIN. 7/16", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, FASTENED W/ 8d @ 6" O.C. EDGE AND 6" O.C. FIELD. SHEATHING SHALL EXTEND FULL HEIGHT FROM BOTTOM PLATE TO UPPER TOP PLATE. FLEXIBLE FINISH WALLS INCLUDE: WOOD, CEMENT, OR VINYL SIDING, HARDI PANEL & BRICK. ALL OTHER WALL SHALL BE CONSIDERED BRITTLE FINISH.

STUCCO FINISH – MIN. 7/16", 24/16, APA RATED OSB OR PLYWOOD SHEATHING, FASTENED W/ 8d @ 6" O.C. EDGE AND 6" O.C. FIELD. SHEATHING SHALL ORIENTED WITH THE LONG DIMENSION PERPENDICULAR TO THE STUDS. CONTRACTOR MAY USE 1/2" STRUCTURAL 1 GRADE SHEATHING OR 1/2" OSB SHEATHING AND ORIENT THE PANELS VERTICALLY.

MASONRY SPECIFICATIONS
MASONRY HAS BEEN DESIGNED IN ACCORDANCE WITH ACI 530-05, AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 530.1-05. GROUT SHALL BE IN ACCORDANCE WITH ASTM C476 WITH A MINIMUM OF 28 DAY COMPRESSIVE STRENGTH OF 2000 PSI PER ASTM C1019. GROUT SHALL HAVE A MAXIMUM AGGREGATE SIZE #4 PLACED AT AN 8" TO 11" SLUMP. MORTAR SHALL CONFORM TO ASTM C270 AND TYPE M OR S. TYPE N MORTAR MAY BE USED IN BRICK VENEER. CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF ALL FLASHING.

CONCRETE MASONRY UNITS (CMU):
CMU SHALL BE IN ACCORDANCE WITH ASTM C90-75, HOLLOW LOAD-BEARING (CMU), TYPE 1, GRADE N-1, NORMAL WEIGHT, WITH A MINIMUM COMPRESSIVE STRENGTH OF 1900 psi (f'm=1500 psi). GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT IN 5'-0" MAXIMUM LIFTS PROVIDE CLEANOUTS PER ACI 530.1-02 IN THE BOTTOM OF COURSE OF MASONRY WHEN THE WALL HEIGHT EXCEEDS 5'-0".

MASONRY STEMWALLS:
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, E GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. WALL COURSEING SHALL BE RUNNING BONDS, STACK BOND SHALL NOT BE USED. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA GRADE CONCRETE GROUT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT WITH #4 @ 4'-0" O.C. MAX. AND AT EACH CORNER, WALL INTERSECTION, PROVIDE CONTINUITY OF REINFORCING AT INTERSECTIONS OF PERPENDICULAR MASONRY ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. AT STEMWALL CONSTRUCTED OF 5 OR MORE COURSES, PROVIDE HORIZONTAL JOINT REINFORCEMENT AT 16" O.C. VERTICALLY, (EVERY OTHER COURSE), AND VERTICAL REINFORCING SHALL BE INCREASED AS NOTED ON 1/S1.0. UNLESS NOTED OTHERWISE, LAP JOINT REINFORCING SHALL BE A MINIMUM OF 6".

CONCRETE SPECIFICATIONS
ALL CONCRETE HAS BEEN DESIGNED IN ACCORDANCE WITH ACI 318-08, AND SHALL BE CONSTRUCTED IN ACCORDANCE WITH ACI 301. ALL CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS CONCRETE AT GARAGE AND PORCH SLABS SHALL HAVE A COMPRESSIVE STRENGTH OF 3000 PSI.

GENERAL NOTES:

FOOTING AND FOUNDATIONS:
FOOTINGS AND FOUNDATIONS SHALL BE IN ACCORDANCE WITH LOCAL BUILDING CODES. FOOTING HAVE BEEN DESIGNED WITH A SOIL BEARING (DESIGN MAXIMUM) OF 2000 PSF. A SOILS INVESTIGATION REPORT IS RECOMMENDED TO VERIFY SUITABLE SUBSURFACE CONDITIONS. IF THE FOOTING ELEVATIONS SHOWN OCCUR IN A DISTURBED OR UNSTABLE SOIL, THE ENGINEER SHALL BE NOTIFIED. SOIL SHALL BE FREE OF ORGANIC MATERIAL AND COHESIVE (CLAY) SOILS. SOIL COMPACTION AND FILL SHALL BE COMPACTED TO A MIN. OF 95% MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557.

FOUNDATION PLAN ONLY CONVEYS STRUCTURAL INFORMATION. FOR GENERAL FEATURES, CONDUIT, ELECTRICAL EMBEDS, STEP HEIGHTS, ETC., SEE ARCHITECTURAL PLANS. DO NOT SCALE FOOTING DIMENSIONS AND LOCATION FROM THE FOUNDATION PLAN SHOWN ON S1.0. DO NOT DETERMINE FOOTING LOCATION BASED ON EITHER THE ARCHITECTURAL PLAN OR FRAMING PLAN, BUT BY DIMENSIONS PROVIDED ON FOUNDATION PLAN. IF FOOTING SIZE OR LOCATION IS NOT DETERMINED ON PLAN THEN CONTACT ENGINEER OF RECORD (EOR)

UNLESS OTHERWISE NOTED ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE 3" IN FOOTINGS AND MESH SHALL BE CENTERED IN SLAB ON GRADE. IN ALL CONTINUOUS FOOTINGS PROVIDE #3 @ 48" O.C. OR ROD CHAIRS. PROVIDE CONTINUITY OF REINFORCING AT INTERSECTIONS OF PERPENDICULAR CONCRETE ELEMENTS BY INSTALLING CORNER BARS, MINIMUM OF 40 BAR DIAMETERS INTO EACH ELEMENT. SPLICES IN REINFORCING, WHERE PERMITTED, SHALL BE 48 BAR DIAMETERS

CONCRETE SLABS ON GRADE:
SHALL BE INSTALLED OVER MINIMUM 6 MIL POLYETHYLENE VAPOR RETARDER WITH JOINTS LAPPEL 6" AND SEALED OVER CLEAN, COMPACTED EARTH OR FILL WITH APPROVED CHEMICAL SOIL TREATMENT FOR PREVENTION OF SUBTERRANEAN TERMITES. SAWCUTS FOR CONTROLLED CRACKING OUT A 1" SAWCUT INTO SLAB IN A 12"x12" GRID WITHIN 12 HOURS OF CONCRETE PLACEMENT, PROVIDE SAWCUTS THROUGH OUT SLAB CALL EOR FOR ALTERNATIVE METHODS.

WOOD FRAMING SPECIFICATIONS
ALL WOOD FRAMING HAS BEEN DESIGNED IN ACCORDANCE WITH NATIONAL DESIGN SPECIFICATION (NDS) FOR WOOD CONSTRUCTION, LATEST EDITION. ALL WOOD MEMBERS EXPOSED TO WEATHER OR IN CONTACT WITH MASONRY, CONCRETE OR SOIL SHALL BE PRESURE-TREATED, IF, ACQ OR NON-ROT BORATE PRESERVATIVE TREATMENT IS USED, ALL ATTACHED FASTENERS SHALL BE HOT DIPPED GALVANIZED, IF ACZA PRESERVATIVE IS USED, ALL ATTACHED FASTENERS SHALL BE STAINLESS STEEL.

PRE-ENGINEERED WOOD TRUSSES:
SHALL BEAR THE SEAL OF AN ENGINEER. BE IN THE STATE WHERE PROJECT IS BEING BUILT AND SHALL COMPLY WITH NPFA, TPI, AND ATC 100. CONTRACTOR SHALL VERIFY THAT ADEQUATE TRUSS BEARING IS INSTALLED AT ALL TRUSSES AS INDICATED IN THE TRUSS SHOP DRAWINGS. ALL TRUSS-TO-TRUSS CONNECTIONS AND TRUSS PROFILES ARE THE RESPONSIBILITY OF THE DELEGATED TRUSS ENGINEER. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY" AND RECOMMENDATION FOR HANDLING, INSTALLING & BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." AT MULTIPLE STRAP CONNECTIONS, SPREAD STRAPS TO AVOID NAILING CONFLICTS THROUGH TRUSSES. WHEN USING (2) STRAPS ON SINGLE PLY TRUSSES, PLACE STRAPS DIAGONALLY ACROSS DBL. TOP PLATE FROM EA. OTHER.

ROOF COVERING SPECIFICATIONS:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF THE ROOF COVERING SYSTEM. ASPHALT SHINGS SHALL COMPLY WITH ASTM D3161 AND BE INSTALLED ACCORDING TO THE MANUFACTURER'S REQUIREMENTS. CLAY AND TILE ROOFS SHALL BE INSTALLED PER THE "CONCRETE AND CLAY ROOF TILE INSTALLATION MANUAL" AND THE MANUFACTURER'S REQUIREMENTS. STANDING SEAM METAL ROOFS SHALL COMPLY WITH ASTM E514 AND BE INSTALLED ACCORDING TO THE MANUFACTURER'S REQUIREMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF ALL METAL FLASHING AND VALLEY MATERIALS.

WATERPROOFING:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN/INSTALLATION OF ALL WATER PROOFING.

WOOD FASTENING SCHEDULE			BRICK NOTES / LINTEL SCHED		
MEMBERS	CONNECTION TYPE	FASTENER	LINTEL DIMENSION	MIN. BRG.	MAX. SPAN
TOP PLATE TO TOP PLATE	FACE NAIL	2-GUN NAILS @ 12" STAG.	L3 1/2"x3 1/2"x1/4"	4"	6'-0"
TOP PLATE, LAPS/INTERSECTION	FACE NAIL	(2-16d) 3-GUN NAILS	L4 3/4"x1/4"	6"	8'-0"
DBL. TOP PLATE TO STUD	FACE NAIL	(2-16d) 3-GUN NAILS	L5 3/4"x1/4"	6"	10'-0"
RIM JOIST TO TOP PLATE	TOE NAIL	(8d @ 6") GUN NAIL @ 6"	L6 3/4"x1/4"	6"	12'-0"
CEILING JOIST TO TOP PLATE	TOE NAIL	(3-8d) 5-GUN NAILS	L7 3/4"x1/4"	6"	16'-0"
CEILING JOIST, OVER PARTITIONS	FACE NAIL	(3-16d) 4-GUN NAILS			
CEILING JOIST TO ROOF RAFTER	FACE NAIL	(6-16d) 8-GUN NAILS			
JOIST/TRUSS TO PLATE	TOE NAIL	(2-16d) 3-GUN NAILS			
RAFTER TO PLATE	TOE NAIL	(3-8d) 3-GUN NAILS			
JACK RAFTER TO HIP	TOE NAIL	(3-10d) 4-GUN NAILS			
ROOF RAFTER TO 2x... RIDGE BM.	TOE NAIL	(2-16d) 3-GUN NAILS			
CONT. HEADER, TWO PIECES	FACE NAIL	16d @ 16" O.C. @ EDGE			
CONT. HEADER TO STUD	TOE NAIL	(3-16d) 4-GUN NAILS			
STUD TO SOLE PLATE	TOE NAIL	(3-16d) 4-GUN NAILS			
SOLE PLATE TO JOIST/BLOCKING	FACE NAIL	(16d @ 16") GUN NAIL @ 8"			
NAIL SPECIFICATIONS			1. STEEL LINTELS TO BE MINIMAL 36" LINTEL MUST HAV. CORROSION RESISTANT COATING OF EPOXY BASED PAINT.		
3"x0.131" = GUN NAILS	2"x0.113" = RINK SHANK		2. LINTEL MORE THAN 8'-0" SHOULD BE LATERALLY SUPPORTED NOT TO EXCEED 6 FT. O.C W/ 2-1/4"x3" WD. SCREWS INTO HEADER PROVIDE A 1/2" VERTICAL SLOTTED HOLE FOR SCREW.		
2"x0.113" = 6d	2 1/2"x0.131" = 8d		3. BRICK VENEER ATTACHMENT: HORIZONTAL TIES @ 24" O.C., VERT. TIES @ 12" O.C. FOR 10'0" MIN. WIND-ZONE, VERT. TIES @ 16" O.C. AT ALL OPENINGS SPACES. TIES WITHIN 12" OF OPENINGS, PROVIDE 1/4" WEEP HOLES @ 33" O.C. IMMEDIATELY ABOVE FLASHING.		
3"x0.148" = 10d	3 1/2"x0.162" = 16d				
1 1/2"x0.148" = 10d1/2"	1 1/2"x0.131" = 8d1 1/2"				

PLAN LEGEND AND ABBREVIATIONS	
	INTERIOR LOAD BEARING WALL
	GABLE X-BRACE, SEE DETAIL 10/S0.1
	DESIGNATES SHEARWALL, THE HIDDEN LINE DESIGNATES SIDE OF WALL. THE SHEARWALL SHEATHING TO BE APPLIED. 8d @ 3/6" O.C. EDGE & 6" O.C. 7/8" THE FIELD
	BUILT-UP POST IN THE WALL
	(2)2x8-1/2 HEADER SIZE, JACK AND KING STUD QUANTITY.
	ADJ - ADJACENT
	BM - BEAM
	BOT - BOTTOM
	MO - Monolithic
	OC - On Center
	OSB - Oriented Strand Board
	PERP - Perpendicular
	DBL - DOUBLE
	PRE ENG - Pre Engineered
	PSF - Pounds per Square Foot
	PSI - Pounds per Square Inch
	PT - PRESSURE TREATED
	QT - Quick Tie
	EXT - EXTERIOR
	EQ - EQUAL
	FBC - FLORIDA BUILDING CODE
	FN - FOUNDATION
	SF - Square Foot
	SY - Southern Yellow Pine
	THRU - Through
	TYP - Typical
	UOW - Unless Otherwise Noted
	VERT - Vertical
	WVF - Welded Wire Fabric

TYPICAL WALL FRAMING NOTES:

- USE SYP#2 OR BETTER FOR ALL WALL STUDS.
- USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.
- USE SYP#2 FOR ALL HEADERS.
- ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.
- FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.

2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.

4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.

TYPICAL WALL FRAMING:

1. USE SYP#2 OR BETTER FOR ALL WALL STUDS.






2. USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.

3. USE SYP#2 FOR ALL HEADERS.


4. ALL WALLS SHALL BE BALLOON FRAMED FULL HEIGHT TO ROOF OR FLOOR BEARING ELEVATION, U.O.N. ON PLAN.

5. FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB W/ 10d MASONRY COT NAILS @ 48" O.C. MINIMUM. SEE FOUNDATION PLAN ADDITIONAL ANCHORS AT SHEARWALLS.


TYPICAL

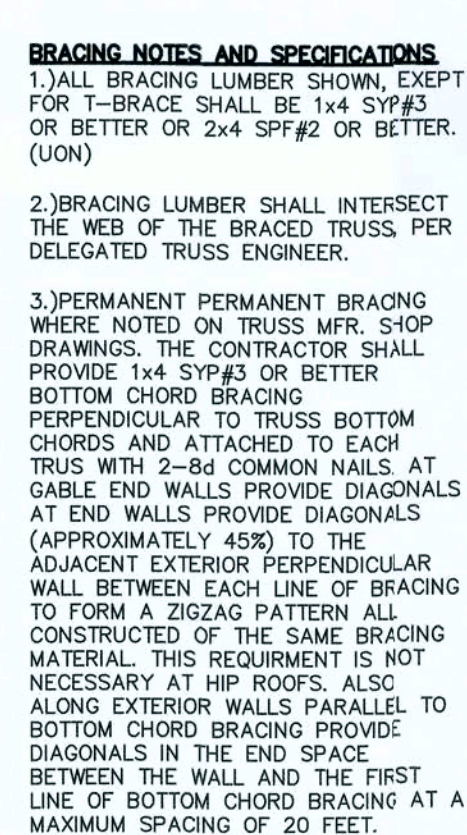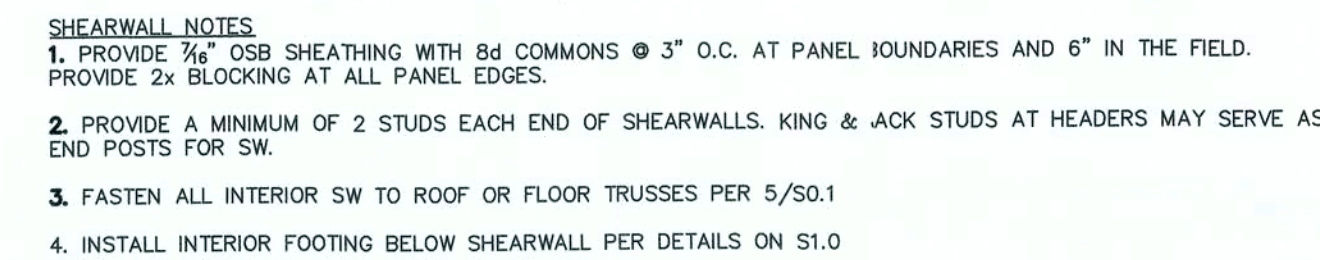


SYMBOLS LEGEND	
	DESIGNATES FOOTING LINE
	DESIGNATES SAWCUT LINE
	INTERIOR LOAD BEARING WALL
	DESIGNATES SLAB RECESS

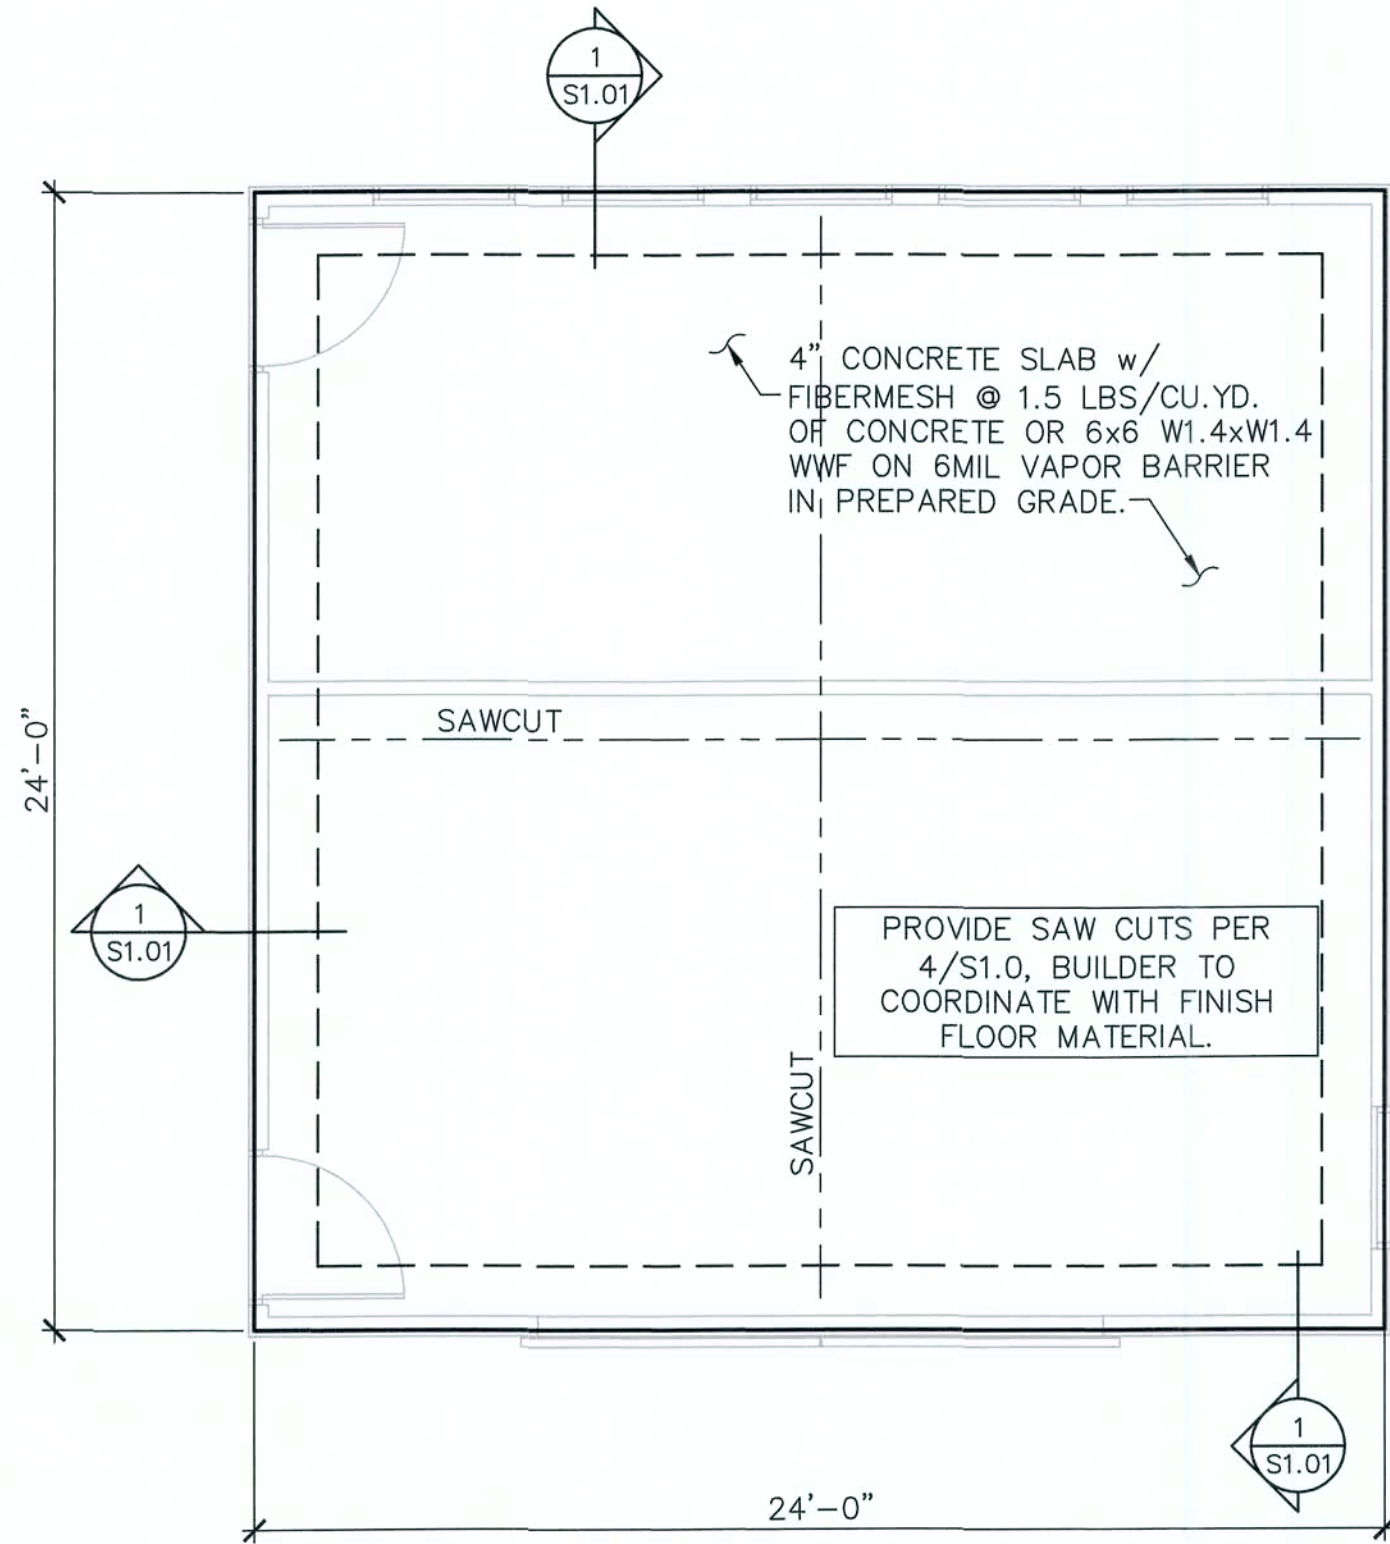


FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

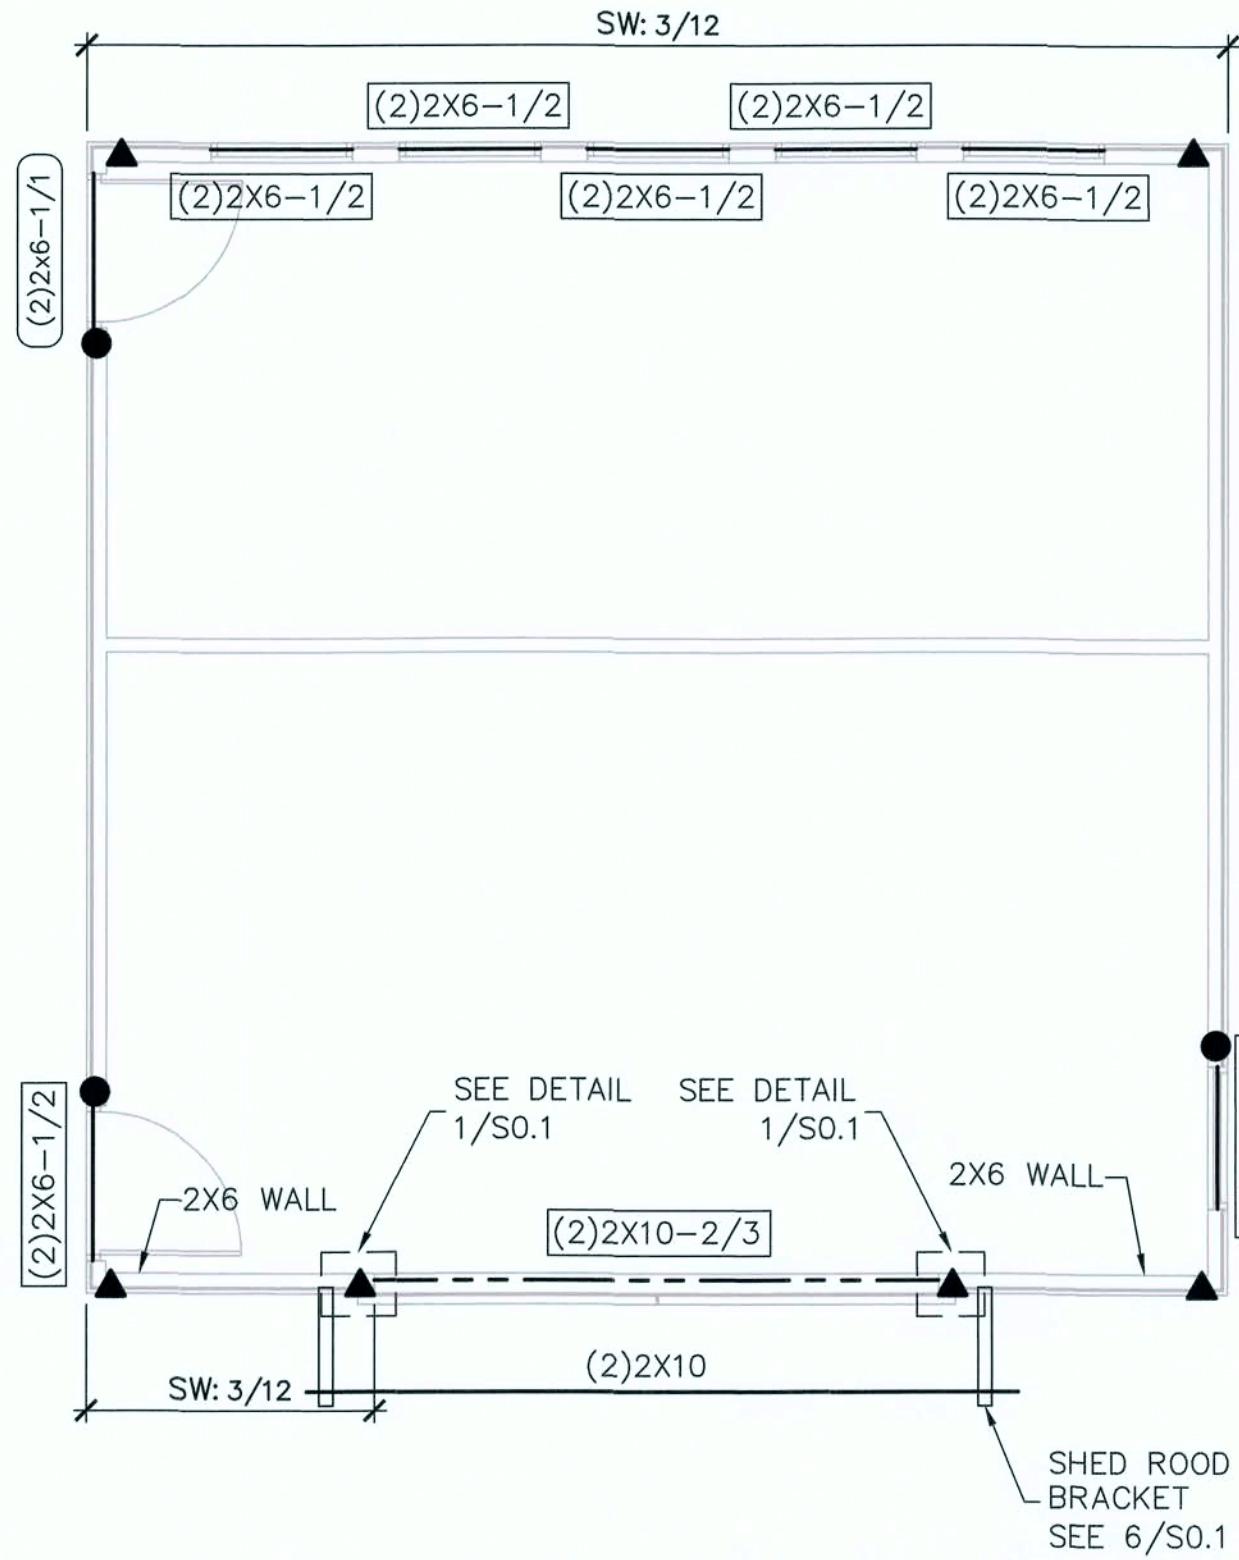


1ST LEVEL FRAMING PLAN
SCALE: 1/4" = 1'-0"

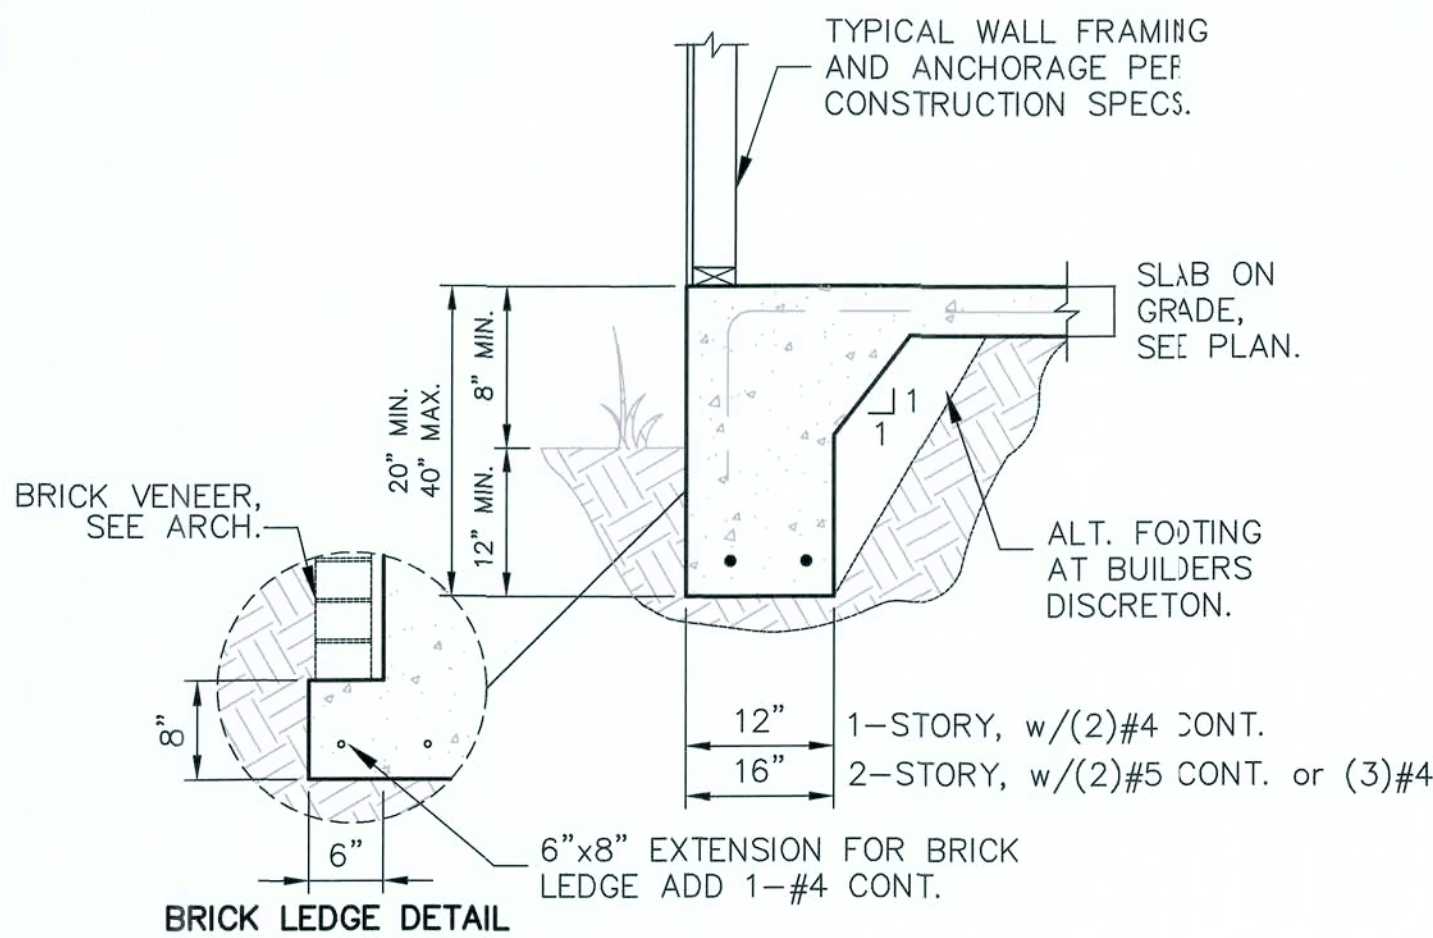


1 MONOLITHIC EDGE FOOTING
S1.0

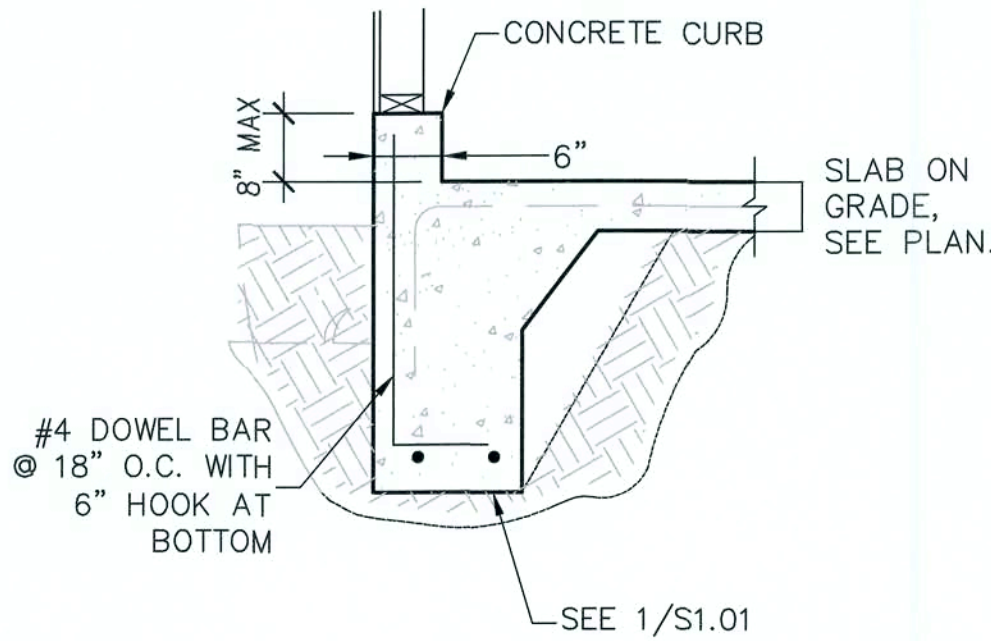

2 MONO FOOTING WITH CURB DETAILS
S1.0

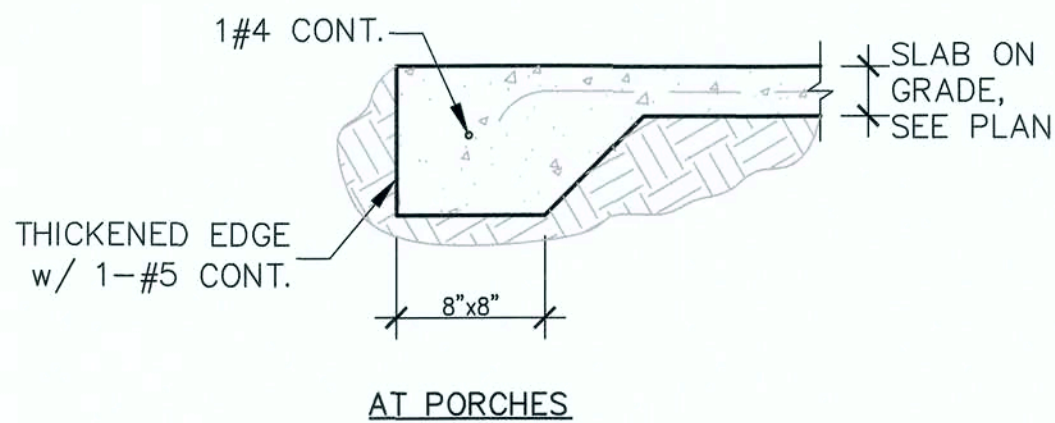

3 THICKENED SLAB
S1.0

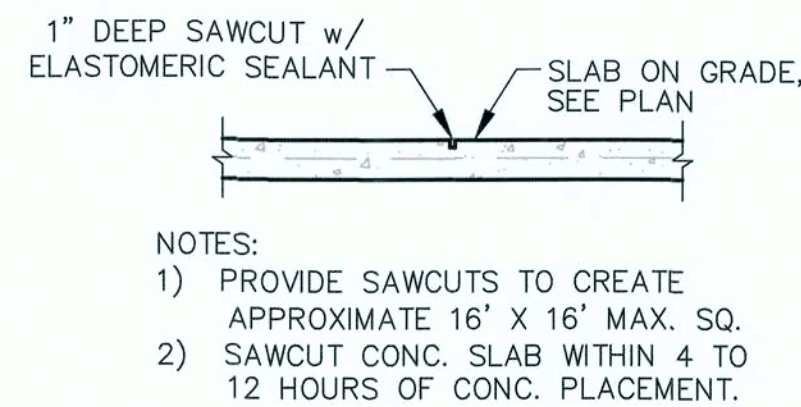

4 SAW CUT DETAIL
S1.0

SYMBOLS LEGEND		
	DESIGNATES OSB SHEARWALL. THE HIDDEN LINE DESIGNATES SIDE OF WALL. THE SHEARWALL SHEATHING TO BE APPLIED. 8d @ 8" DESIGNATES 8d COMMONS @ 3" O.C. EDGE & 6" O.C. "IN THE FIELD"	
(2)2x8-1/2	DESIGNATES THE HEADER SIZE, NUMBER OF PLY'S & JACKING STUDS NEEDED FOR SUPPORT HEADER.	
----	BEAM OR TRUSS, SEE PLAN	
ANCHOR LEGEND		
	SIMPSON HTTS SEE DETAIL 15/S0.1	
	SIMPSON DTT22 SEE DETAIL 15/S0.1	
	SIMPSON LTT20B SEE DETAIL 15/S0.1	
WALL STUD SCHEDULE		
LOCATION	PLATE HEIGHT	STUD SIZE & SPACING
EXTERIOR	9'-1" MAX	2x4 SPF#2 @ 16" O.C.
EXTERIOR	10'-1" MAX	2x6 SPF#2 @ 16" O.C. OR 2x4 SPF#2 @ 12" O.C.
EXTERIOR	10'-1" TO 14'-0"	2x6 SPF#2 @ 16" O.C.
INTERIOR	10'-0" MAX	2x4 SPF#2 @ 16" O.C.
INTERIOR	12'-0" MAX	2x6 SPF#2 @ 16" O.C. OR 2x4 SPF#2 @ 12" O.C.
STUD NOTES:		
1.) WALL STUDS SPECIFIED ON PLAN SUPERSEDE THIS TABLE		
2.) MINIMUM STUD SIZE AND SPACING ARE SHOWN. CONTRACTOR MAY INCREASE STUD SIZE TO MEET ARCHITECTURAL REQUIREMENTS.		
3.) SPF DENOTES SPRUCE PINE FIR. SYP DENOTES SOUTHERN YELLOW PINE.		
4.) USE SYP#2 FOR ALL TOP PLATES AND SOLE PLATES.		
5.) FASTEN BOTTOM PLATE OF INTERIOR LOAD BEARING WALLS TO CONCRETE SLAB w/16d MASONRY CUT NAILS @ 16" O.C. MINIMUM. SEE 3/S0.0 FOR ADDITIONAL ANCHORS AT SHEARWALLS		
COMBINED USE PANEL NOTES		
1. EXTERIOR WALL SHEATHING SHALL BE CONTINUOUS FROM BOTTOM PLATE TO UPPER MOST TOP PLATE. SEE DETAIL 1/S0.1 FOR SHEATHING SPLICE LOCATIONS FOR MULTI STORY CONDITIONS		
2. SEE SHEET S0.0 FOR WALL SHEATHING SPECIFICATIONS.		
3. UPPER MOST TOP PLATE SUPPORTING ROOF MEMBERS SHALL BE STRAPPED AS SHOWN IN DETAIL 1/S0.0		
4. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/S0.0		
GENERAL NOTES		
1. SEE DETAIL 2/S0.0 FOR WALL FRAMING DETAIL. SEE WALL STUD SCHEDULE THIS SHEET FOR STUD SIZES AND SPACING. AT GIRDERS AND BEAMS, PROVIDE STUDS BELOW TO MATCH BEAM/GIRDER PLYS.		
2. SEE SHEET S0.0 FOR ROOF AND FLOOR SHEATHING SPECIFICATIONS.		
3. WHERE FRAMING MEMBERS CONSIST OF MULTIPLE PLYS (BEAMS, HEADER, AND STUDS) FASTEN PLYS TOGETHER PER DETAIL 6/S0.0		
4. INSTALL SOLE PLATE ANCHORS PER DETAIL 3/S0.0		
5. AT SHEARWALLS, PROVIDE DIAPHRAGM ATTACHMENT PER DETAIL 5/S0.1		
6. FOR ATTACHMENT OF EXTERIOR WALLS THAT TERMINATE BETWEEN TRUSSES, SEE 5A/S0.1		
7. AT PORCHES, SEE DETAIL 2/S0.1 FOR FRAMING AND HOLD DOWNS		
SOLE PLATE ANCHOR SPACING SCHEDULE		
ALL EXTERIOR WALL UNLESS OTHER NOTED	42" O.C.	
SHEARWALLS (SW 8d@3"/6")	24" O.C.	
	WHEN NOTED ON PLAN SEE NOTE 2	
1. INSTALL SOLE PLATE ANCHORS PER DETAIL 8/S0.1		
2. ANCHOR SPACING SHALL BE AS NOTED. FOR EXAMPLE - SOLE PLT @ 36" = 36" ON-CENTER SPACING		

FOOTING SCHEDULE AND NOTES				
TYPE	LENGTH	WIDTH	DEPTH	BOTTOM BARS
F2.0	2'-0"	2'-0"	1'-0"	3-#5 EA. WAY BOT.
F2.5	2'-6"	2'-6"	1'-0"	3-#5 EA. WAY BOT.
F3.0	3'-0"	3'-0"	1'-0"	3-#5 EA. WAY BOT.
F3.5	3'-6"	3'-6"	1'-0"	4-#5 EA. WAY BOT.
F4.0	4'-0"	4'-0"	1'-0"	4-#5 EA. WAY BOT.
F4.5	4'-6"	4'-6"	1'-0"	4-#5 EA. WAY BOT.
1. THIS FOUNDATION PLAN ONLY CONVEYS STRUCTURAL INFO. RELATED TO THE FOUNDATION. FOR GENERAL FEATURES, DIMENSIONS, CONDUITS, ELECTRICAL EMBEDS, STEP HEIGHTS, ECT., SEE ARCH. PLAN. ARCHITECTURAL PLAN SHOWN HERE IN FOR REFERENCE ONLY.				
2. FTGS. & FND. SHALL BE IN ACCORDANCE w/ LOCAL BUILDING CODES.				
3. SOIL COMPACTION AND FILL SHALL BE COMPACTED TO A MIN. OF 95% MODIFIED PROCTOR IN ACCORDANCE WITH ASTM D 1557.				

SABO
STRUCTURAL
ENGINEERING
CA 93529
1205 BEACH BLVD
JAX BEACH, FL
CHRS@SABOENG.COM

CHRISTOPHER J. SABOURN
LICENSE
No. 7461
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
04.30.19
Christopher J Sabourin PE
FL P.E.#71461

PLAN NAME
TOM BARN
SSE No.
19-0149

ISSUE	DATE
PERMIT	04.30.19


REVISIONS	DATE
-----------	------

STRUCTURAL ENGINEERING FOR
TOM BARN

FIELD ALTERATION
CONTRACTOR SHALL CONTACT
CHRISTOPHER SABOURN RE PRIOR TO
MAKING ANY STRUCTURAL FIELD
MODIFICATIONS WHICH MAY VARY
FROM THE INTENT OF THE ORIGINAL
CONSTRUCTION DOCUMENTS. ANY
FIELD ALTERATIONS MADE PRIOR TO
BEING APPROVED BY CHRISTOPHER
SABOURN MAY RESULT IN ADDITIONAL
ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM
THESE DRAWINGS IF A DIMENSION IS
UNCLEAR REFER TO THE
ARCHITECTURAL DRAWINGS OR
CONTACT THE EDR.

FOUNDATION
PLAN AND
1ST LEVEL
FRAMING
PLAN
SHEET
S1.0
SHEET 3 OF 5

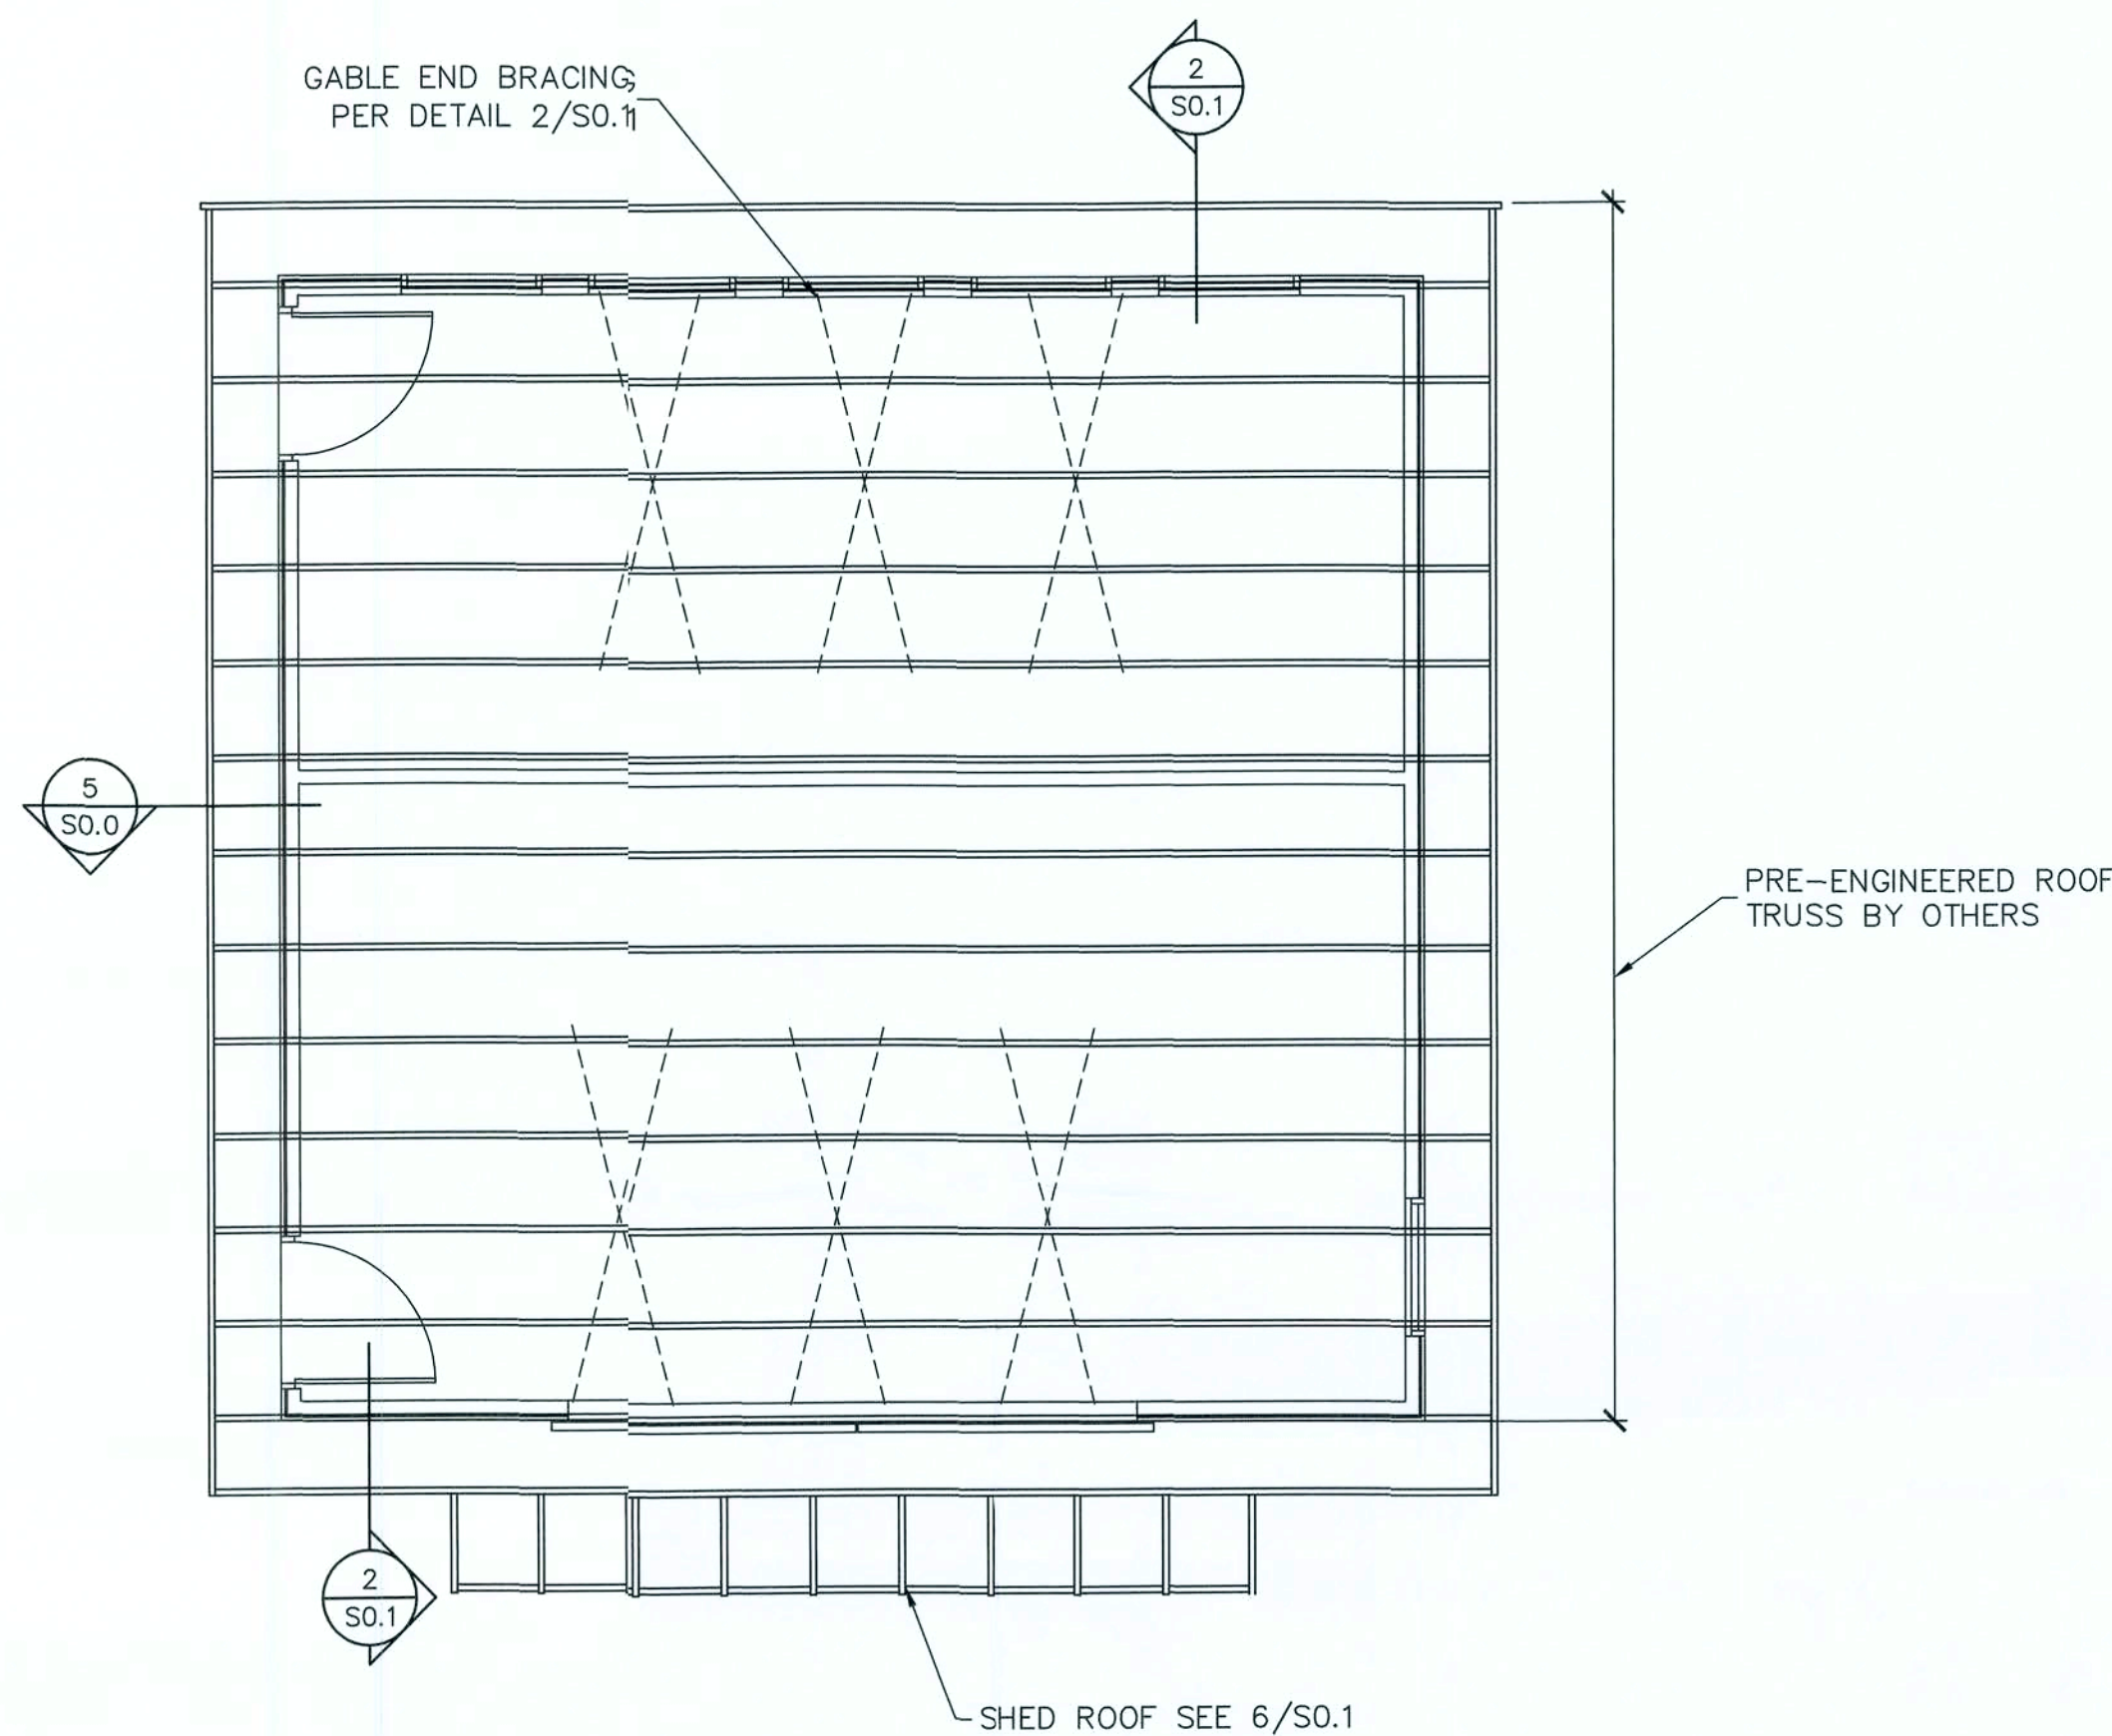

- TRUSS / ROOF RAFTER NOTES: STRAPPING NOTES
1. FASTEN TRUSSES AND ROOF RAFTERS TO BEARING WITH 2-12D TOENAILS & 1-SIMPSON SDWC15600 SCREW UNLESS OTHERWISE NOTED
 2. A SIMPSON H2.5 UPLIFT STRAP MAY BE USED AS AN ALTERNATE TO THE SDWC15600 SCREW. SEE NOTE 2 ON DETAIL 5/S0.0

ROOF TRUSS PLACEMENT PLAN
SCALE: 1/4" = 1'-0"

SYMBOLS LEGEND

HTS16

DESIGNATES UPLIFT CONNECTION.

FRAMING PLAN NOTES:
1. FOR TYPICAL ROOF SHEATHING AND FRAMING, SEE SHEET S0.0.
2. FOR SPECIFIC UPLIFT CONNECTORS, SEE PLAN MIN. (1)SDWC CONNECTOR.
3. FOR GENERAL DESIGN SPECIFICATIONS SEE SHEET S0.0.
4. WHEN USING (2)H2.5T CLIPS ON 1 1/2" WIDE LUMBER, PLACE CLIPS DIAGONALLY ACROSS DOUBLE TOP PLATE FROM EACH OTHER.

TRUSS FASTENING DETAILS

TRUSS TIE DOWN WITH SIMPSON SDWC

Note: 1. Sloped-roof rafters may be sloped up to and including a 12:12 pitch and must be "birdsmouth" cut.
2. Reference detail 4 for installation instructions.

SIMPSON SDWC INSTALLATION RANGE

SDWC INSTALLATION

SDWC INSTALLATION RANGE

SDWC AT TOP PLATE SPLICE

SABO STRUCTURAL ENGINEERING
CA#93599
12026 BEACH BLVD
JAX BEACH, FL
CHRIS@SABOENG.COM

04.30.19
Christopher J Sabourin PE
FL PE #71461

PLAN NAME
TOM BARN

SSE No.
19-0149

ISSUE	DATE
PERMIT	04.30.19
REVISIONS	DATE

STRUCTURAL ENGINEERING FOR
TOM BARN

FIELD ALTERATION
CONTRACTOR SHALL CONTACT CHRISTOPHER SABOURIN PE PRIOR TO MAKING ANY STRUCTURAL FIELD MODIFICATIONS WHICH MAY VARY FROM THE INTENT OF THE ORIGINAL CONSTRUCTION DOCUMENTS. ANY FIELD ALTERATIONS MADE PRIOR TO BEING APPROVED BY CHRISTOPHER SABOURIN MAY RESULT IN ADDITIONAL ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM THESE DRAWINGS. IF A DIMENSION IS UNCLEAR REFER TO THE ARCHITECTURAL DRAWINGS OR CONTACT THE E.O.R.

ROOF TRUSS PLACEMENT PLAN

SHEET
S1.1

SHEET 4 OF 5



04.30.19
Christopher J Sabourin PE
FL PE #71461

PLAN NAME
TOM BARN
SSE No.
19-0149

ISSUE	DATE
PERMIT	04.30.19


REVISIONS	DATE
-----------	------

STRUCTURAL ENGINEERING FOR
TOM BARN


FIELD ALTERATION
CONTRACTOR SHALL CONTACT
CHRISTOPHER SABOURIN PE PRIOR TO
MAKING ANY STRUCTURAL FIELD
MODIFICATIONS WHICH MAY VARY
FROM THE INTENT OF THE ORIGINAL
CONSTRUCTION DOCUMENTS. ANY
FIELD ALTERATIONS MADE PRIOR TO
BEING APPROVED BY CHRISTOPHER
SABOURIN MAY RESULT IN ADDITIONAL
ENGINEERING OR INSPECTION FEES.

SCALING
DO NOT SCALE DIMENSIONS FROM
THESE DRAWINGS. IF A DIMENSION IS
UNCLEAR, REFER TO THE
ARCHITECTURAL DRAWINGS OR
CONTACT THE EDR.

FLOOR PLAN
AND
ELEVATIONS

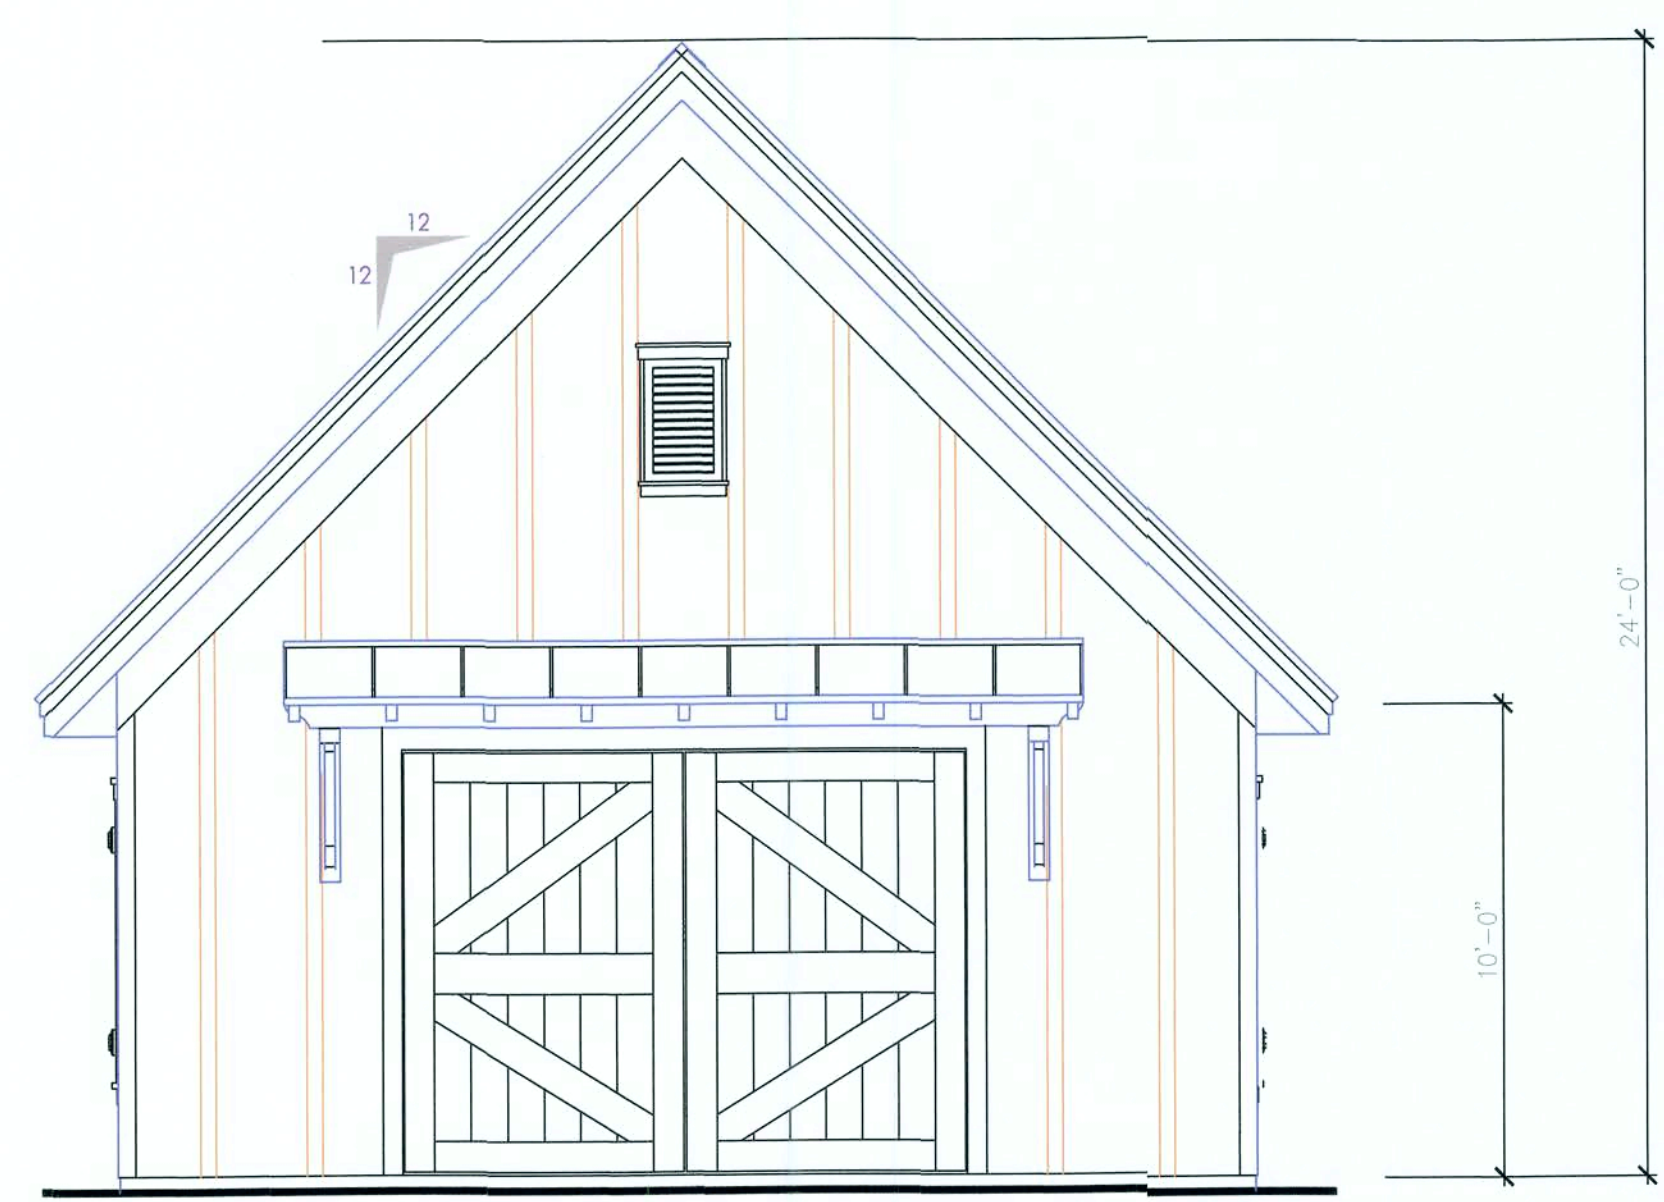

FRONT ELEVATION
SCALE: 1/4" = 1'
0 1 2 4

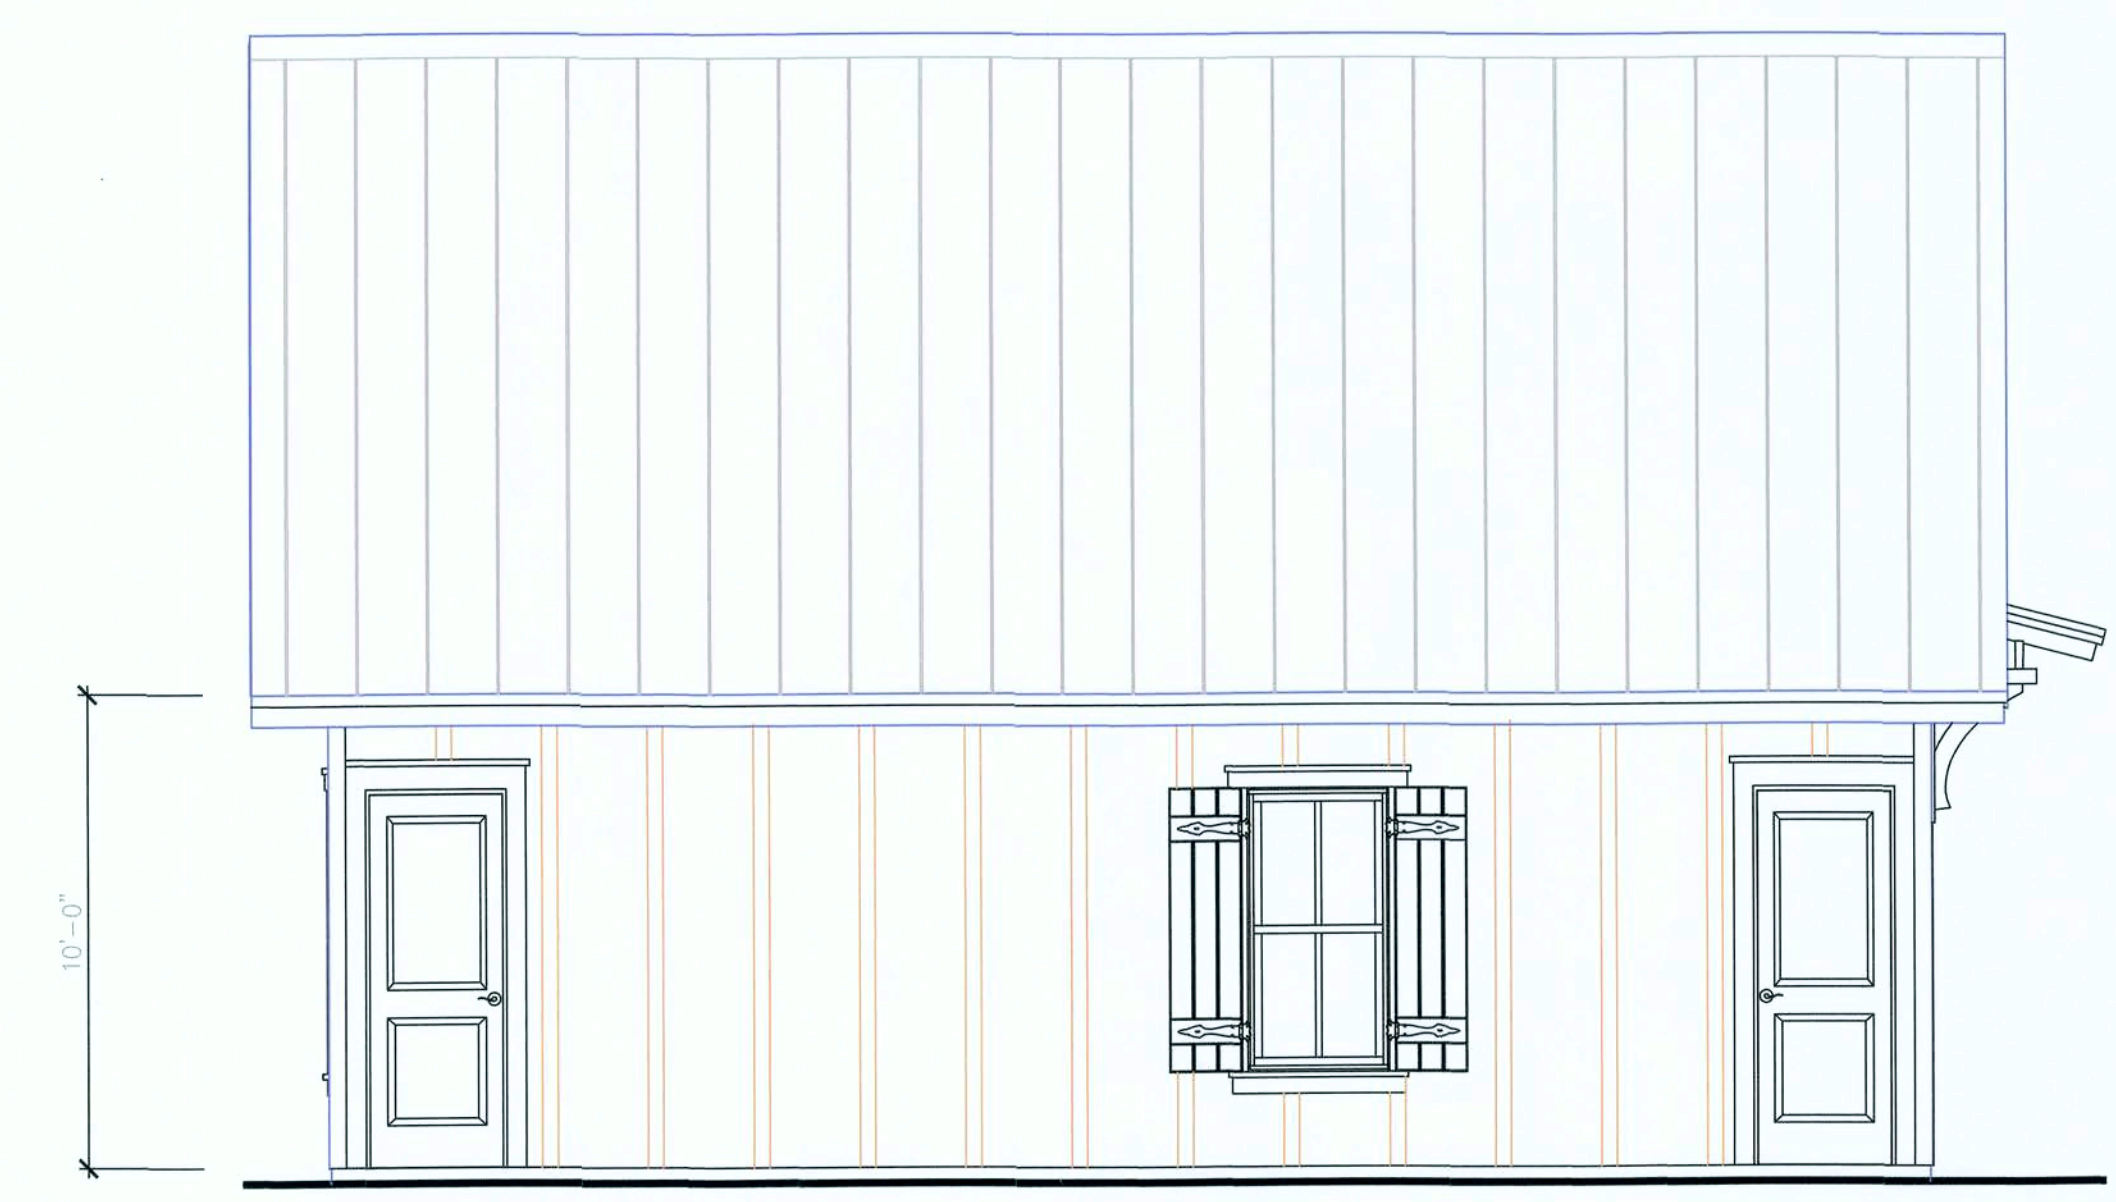


LEFT ELEVATION
SCALE: 1/4" = 1'
0 1 2 4



RIGHT ELEVATION
SCALE: 1/4" = 1'
0 1 2 4



REAR ELEVATION
SCALE: 1/4" = 1'
0 1 2 4

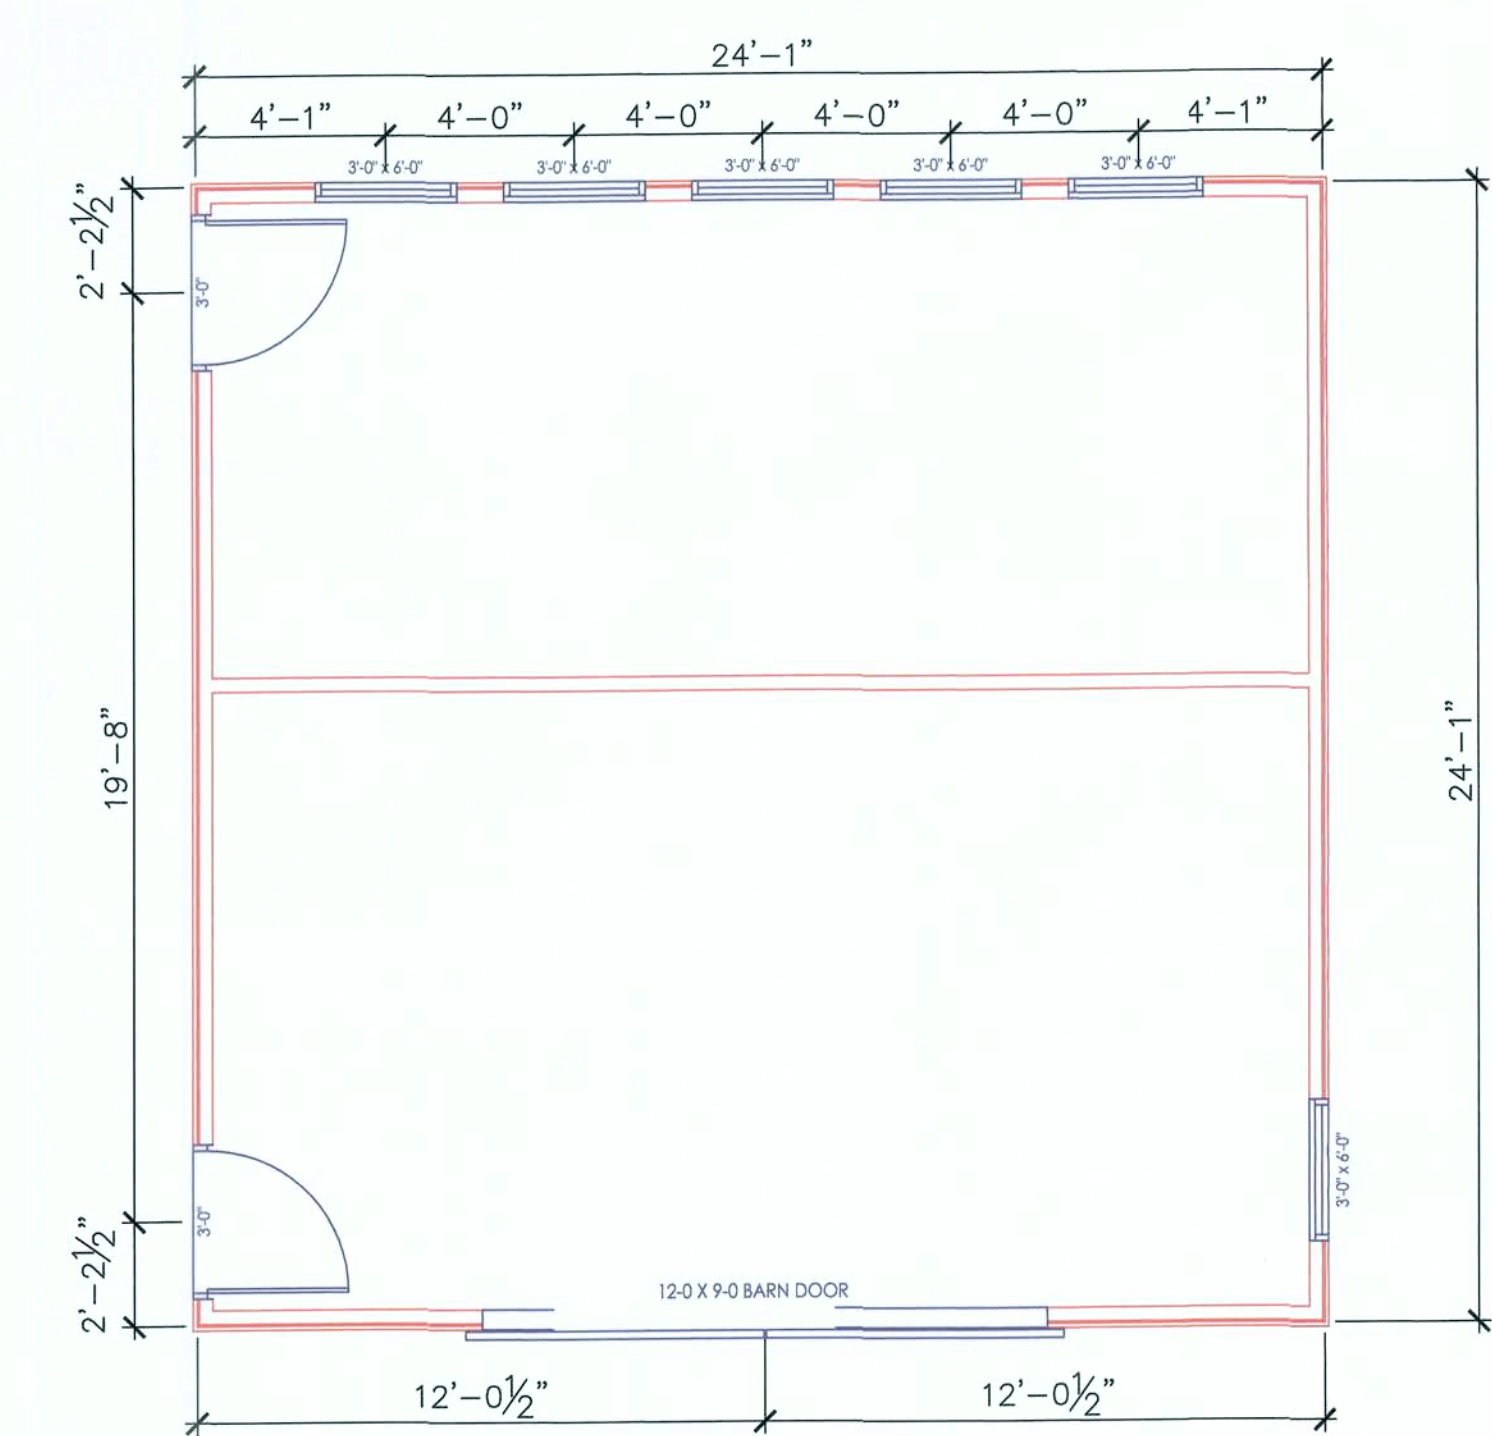

FLOOR PLAN
SCALE: 1/4" = 1'
0 1 2 4