


DIMENSION PLAN



PIPING PLAN

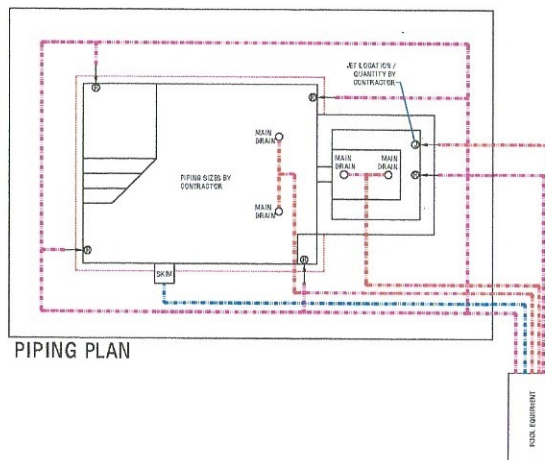

### EQUIPOTENTIAL BONDING GRID:

ALL METAL PARTS SPECIFIED IN 606.26(9) MUST BE BONDED TO AN EQUIPOTENTIAL BONDING GRID WITH A SOLID COPPER CONDUCTOR NOT SMALLER THAN 8 AWG. THE TERMINATION OF THE BONDING CONDUCTOR MUST BE MADE BY BUTT WELDING, LISTED PRESSURE CONNECTORS, OR LISTED CLAMPS THAT ARE LABELED AS SUITABLE FOR THE PURPOSE. THE EQUIPOTENTIAL BONDING GRID MUST EXTEND UNDER PAVED WALKING SURFACES FOR 3 FEET HORIZONTALLY FROM THE WATER (606.26(10)).

THE EQUIPOTENTIAL BONDING GRID MUST BE FORMED FROM EITHER OR BOTH OF:

THE STRUCTURAL REINFORCING STEEL OF A CONCRETE PERMANENTLY INSTALLED POOL, OUTDOOR SPA, OR OUTDOOR HOT TUB, TIED TOGETHER BY THE USUAL STEEL TIE WIRDS.

THE METAL WALLS OF A PERMANENTLY INSTALLED POOL, OUTDOOR SPA, OR OUTDOOR HOT TUB

THE EQUIPOTENTIAL BONDING GRID CAN BE CONSTRUCTED WITH 8 AWG BARE SOLID COPPER CONDUCTORS BONDED TO EACH OTHER AT ALL POINTS OF CROSSING BY BUTT WELDING, LISTED PRESSURE CONNECTORS OF THE SET SCREW OR COMPRESSION TYPE, LISTED CLAMPS, OR OTHER LISTED FITTINGS (250.8).

THE EQUIPOTENTIAL BONDING GRID MUST COVER THE ENTIRE PERMANENTLY INSTALLED POOL, OUTDOOR SPA OR HOT TUB AND DECK EXTENDING 3 FEET HORIZONTALLY FROM THE WATER. THE EQUIPOTENTIAL BONDING GRID MUST BE ARRANGED IN A 1-FOOT BY 1-FOOT NETWORK OF 8 AWG CONDUCTORS, WITH A TOLERANCE OF 4 INCHES.

EXCEPTION: THE EQUIPOTENTIAL BONDING GRID SHALL NOT BE REQUIRED TO BE INSTALLED UNDER THE BOTTOM OR VERTICALLY ALONG THE WALLS OF VINYL LINED POLYMER WALL, FIBERGLASS COMPOSITE, OR OTHER POOLS CONSTRUCTED OF NON-CONDUCTIVE MATERIALS.

ANY METAL PARTS OF THE POOL, INCLUDING METAL STRUCTURAL SUPPORTS, SHALL BE BONDED IN ACCORDANCE WITH 606.26(9). FOUNDED CONCRETE, FIBERGLASS-APPLIED CONCRETE, AND CONCRETE BLOCK SHALL BE CONSIDERED CONDUCTIVE MATERIAL.

### NOTES:

1. ALL WORK IS TO COMPLY WITH ALL APPLICABLE CODES & ORDINANCES.
2. CONSTRUCTED OF 3000 PSI CONCRETE OR EQUAL WITH #3 REBAR 12" O.C. EACH WAY, TIED AT EVERY OTHER INTERSECTION. MIN COVER FOR REBAR IS 2.5". MIN OVERLAP IS 18".
3. N/A

4. ASSUMED SOIL BEARING = 2 KSF
5. CIRCULATION SYSTEMS, COMPONENTS, & EQUIPMENT SHALL COMPLY W/ NSF 50.
6. INSTALL CONTROL JOINTS @ 20'-0" ON CENTER IN POOL DECKING.
7. PLANS TO CONFORM TO NEC 2014
8. FBC RESIDENTIAL 2017 6th EDITION APSP10
9. CONCRETE STAIRS ARE 12" TREAD WIDTH AND 10" MAXIMUM HEIGHT
10. ALL CONSTRUCTION SHALL COMPLY WITH ANSI 5-03, 2014 NEC ARTICLE 680, & ANSI-NSPI 3-99 IN-GROUND SPA CONSTR.


\*11. ENGINEERS DESIGN IS FOR STRUCTURAL ONLY. DESIGN OF PIPING/EQUIPMENT ETC.

POOLS MUST COMPLY W/ R4001.5.1 CONFORMANCE STANDARD DESIGN CONSTRUCTION AND WORKMANSHIP SHALL BE IN CONFORMANCE W/ THE REQUIREMENTS OF ANSI / NSPI 3; ANSI / NSPI 4; ANSI / NSPI 5; ANSI / NSPI 6; ANSI / NSPI 7; ANSI / APSP 15 2010

### BY POOL CONTRACTOR

- FENCE REQUIREMENTS:
1. MINIMUM 48" HEIGHT
  2. 2" MAX VERTICAL CLEARANCE BETWEEN GRADE & BARRIER BOTTOM
  3. MAX OPENING SHALL NOT ALLOW PASSAGE OF 4" SPHERE
  4. FENCE POSTS WILL BE LOCATED ON POOL-SIDE OF FENCE.
  5. GATE WILL BE SELF-LOCKING WITH APPROVED LOCKING DEVICE.

NOTE: IF ANY PART OF THE POOL ENCLOSED UPON THE ANGLE OF REPOSE, PLACE STEEL @ 6" o.c. EA WAY IN AREAS OF QUESTION

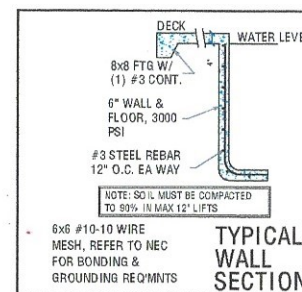

<b>Riddle Consulting Engineers, Inc.</b> structural civil mechanical Paul D. Riddle, P.E. Senior Engineer SEA 0004733 Paul A. Riddle, Jr. Structural Engineer SEA 0004733 EMAIL: paul.d.riddle@riddle-engineers.com PHONE: 720.507.8474 FAX: 720.507.8440 WEBSITE: www.riddle-engineers.com		 <b>PAUL D. RIDDLE</b> May 12 2020 8:55 AM PAUL D. RIDDLE, P.E. P.E. 20097	
A CUSTOM POOL DESIGN FOR <b>THE SPARKS-WOODS RESIDENCE</b> AQUATIC ART			
DRAWN: JASON R. RIDDLE DATE: 5/12/2020 SCALE: 1/4" = 1'-0" 1 OF 1 JOB NUMBER: 2200283		COPYRIGHT © 2013 THESE PLANS ARE PROTECTED BY COPYRIGHT LAW. ANY UNAUTHORIZED REPRODUCTION OR ALTERATION OF THESE PLANS IS PROHIBITED.	