

1	Pr0Z01Rf1	Shngl/1/2"WD Deck/WD Truss/9"	22.33	35.33	1	788.9	27.00	0.0320	1.50	8.22	31.24	<input type="checkbox"/>
2	Pr0Z01Rf2	Batt/Gyp Brid Shngl/1/2"WD Deck/WD Truss/9" Batt/Gyp Brid	22.33	35.33	1	788.9	27.00	0.0320	1.50	8.22	31.24	<input type="checkbox"/>

Skylights

No	Description	Type	U [Btu/hr sf F]	SHGC	Vis. Tran	W [ft]	H (Effec) [ft]	Multiplier	Area [Sq]	Total Area [Sq]
----	-------------	------	--------------------	------	-----------	-----------	-------------------	------------	--------------	--------------------

In Zone:
In Roof:

☐

Floors

No	Description	Type	Width [ft]	H (Effec) [ft]	Multi plier	Area [sf]	Cond. [Btu/hr. sf. F]	Heat Cap. [Btu/sf. F]	Dens. [lb/cf]	R-Value [h.s.f.F/Btu]
----	-------------	------	---------------	-------------------	----------------	--------------	--------------------------	--------------------------	------------------	--------------------------

In Zone: Pr0Z01										
1	Pr0Z01F11	Concrete floor, carpet and rubber pad	40.58	35.33	1	1433.7	0.5987	9.33	140.00	1.67
2	Pr0Z01F12	Concrete floor, carpet and rubber pad	30.08	12.00	1	361.0	0.5987	9.33	140.00	1.67

Systems

Pr0Syl		System 1		Constant Volume Air Cooled Split System < 65000 Btu/hr			No. Of Units 2	
Component	Category	Capacity	Efficiency	IPLV				
1	Cooling System (Air Cooled < 65000 Btu/h Cooling Capacity)	47000.00	14.00	8.00	<input type="checkbox"/>			
2	Heating System (Air Cooled HP < 65000 Btu/h Cooling Capacity)	47000.00	8.00		<input type="checkbox"/>			
3	Air Handling System -Supply (Air Handler (Supply) - Constant Volume)	1600.00	0.80		<input type="checkbox"/>			
4	Air Handling System - Return (Air Handler (Return) - Constant Volume)	1600.00	0.80		<input type="checkbox"/>			
5	Air Distribution System (ADS System)		6.00		<input type="checkbox"/>			

Plant						
Equipment	Category	Size	Inst.No	Eff.	IPLV	
<input type="checkbox"/>						

Water Heaters						
W-Heater Description	Capacit Cap.Unit	I/P Rt.	Efficienc	Loss		
1 Electric water heater	50 [Gal]	5 [kW]	0.8800 [Ef]		[Btu/h]	<input type="checkbox"/>

Ext-Lighting						
Description	Category	No. of Luminaires	Watts per Luminaire	Area/Len/No. of units [sf/ft/No]	Control Type	Wattage [W]
1 Ext Light 1	Building entrance without canopy	2	60	6.00	Photo Sensor control	120.00 <input type="checkbox"/>
2 Ext Light 2	Building exit	2	60	3.00	Photo Sensor control	120.00 <input type="checkbox"/>

Piping

No	Type	Operating Temperature [F]	Insulation Conductivity [Btu-in/h.sf.F]	Nomonal pipe Diameter [in]	Insulation Thickness [in]	Is Runout?
1	Domestic and Service Hot Water Systems	125.00	0.28	0.75	0.75	No <input type="checkbox"/>

Fenestration Used

Name	Glass Type	No. of Panes	Glass Conductance [Btu/h.sf.F]	SHGC	VLT
<input type="checkbox"/>					

Materials Used

Mat No	Acronym	Description	Only R-Value Used	RValue [h.sf.F/Btu]	Thickness [ft]	Conductivity [Btu/h.ft.F]	Density [lb/cf]	SpecificHea t
187	Mat1187	GYP OR PLAS BOARD, 1/2IN	No	0.4533	0.0417	0.0920	50.00	0.2000 <input type="checkbox"/>
151	Mat1151	CONC HW, DRD, 140LB, 4IN	No	0.4403	0.3333	0.7570	140.00	0.2000 <input type="checkbox"/>
178	Mat1178	CARPET W/RUBBER PAD	Yes	1.2300				<input type="checkbox"/>
267	Mat1267	0.75" stucco	No	0.1563	0.0625	0.4000	16.00	0.2000 <input type="checkbox"/>
266	Mat1266	2x4@16" oc + R11 Batt	No	8.3343	0.2917	0.0350	9.70	0.2000 <input type="checkbox"/>
12	Mat112	3 in. Insulation	No	10.0000	0.2500	0.0250	2.00	0.2000 <input type="checkbox"/>
23	Mat123	6 in. Insulation	No	20.0000	0.5000	0.0250	5.70	0.2000 <input type="checkbox"/>
81	Mat181	ASPHALT-ROOFING, ROLL	Yes	0.1500				<input type="checkbox"/>
244	Mat1244	PLYWOOD, 1/2IN	No	0.6318	0.0417	0.0660	34.00	0.2900 <input type="checkbox"/>

Constructs Used

No	Name	Simple Construct	Massless Construct	Conductance [Btu/h.sf.F]	Heat Capacity [Btu/sf.F]	Density [lb/cf]	RValue [h.sf.F/Btu]	
1004	Concrete floor, carpet and rubber pad	No	No	0.60	9.33	140.00	1.6703	<input type="checkbox"/>
Layer Material No. Material Thickness [ft] Framing Factor								
1	151	CONC HW, DRD, 140LB, 4IN	0.3333	0.00				<input type="checkbox"/>
2	178	CARPET W/RUBBER PAD		0.00				<input type="checkbox"/>
No	Name	Simple Construct	Massless Construct	Conductance [Btu/h.sf.F]	Heat Capacity [Btu/sf.F]	Density [lb/cf]	RValue [h.sf.F/Btu]	
1009	0.75 in. stucco, 2x4x16" oc, R11 Batt, 0.5 in. gyp	No	No	0.11	1.18	14.94	8.9438	<input type="checkbox"/>
Layer Material No. Material Thickness [ft] Framing Factor								
1	267	0.75" stucco	0.0625	0.00				<input type="checkbox"/>
2	266	2x4@16" oc + R11 Batt	0.2917	0.00				<input type="checkbox"/>
3	187	GYP OR PLAS BOARD, 1/2IN	0.0417	0.00				<input type="checkbox"/>
No	Name	Simple Construct	Massless Construct	Conductance [Btu/h.sf.F]	Heat Capacity [Btu/sf.F]	Density [lb/cf]	RValue [h.sf.F/Btu]	
1023	Solid core flush	No	Yes	0.58			1.7141	<input type="checkbox"/>
Layer Material No. Material Thickness [ft] Framing Factor								
1	274	Solid core flush (1.375")					0.00	<input type="checkbox"/>

No	Name	Simple Construct	Massless Construct	Conductance [Btu/h.s.f.]	Heat Capacity [Btu/sf.F]	Density [lb/cf]	RValue [h.s.f./Btu]	
1038	Shngl/1/2"WD Deck/WD Truss/9" Batt/Gyp Brd	No	No	0.03	1.50	8.22	31.2351	<input type="checkbox"/>
Layer	Material No.	Material	Thickness [ft]	Framing Factor				
1	81	ASPHALT-ROOFING, ROLL		0.00				<input type="checkbox"/>
2	244	PLYWOOD, 1/2IN	0.0417	0.00				<input type="checkbox"/>
3	12	3 in. Insulation	0.2500	0.00				<input type="checkbox"/>
4	23	6 in. Insulation	0.5000	0.00				<input type="checkbox"/>
5	187	GYP OR PLAS BOARD, 1/2IN	0.0417	0.00				<input type="checkbox"/>



0801-182



Project Information for: L276217

Address : 343 SW FORREST LAWN
LAKE CITY, FL
County: COLUMBIA
Truss Count: 4
Design Program: MiTek 20/20 6.3
Building Code: FBC2004/TPI2002

Truss Design Load Information:

Gravity: **Wind:**

Roof (psf): 42.0 Wind Standard: ASCE 7-02 Wind Exposure: B
Floor (psf): N/A Wind Speed (mph): 110

Note: See the individual truss drawings for special loading conditions.

Owner/Builder of Record, responsible for structural engineering:

Unknown at time of seal date Florida P.E. License No. N/A
Address: N/A

Truss Design Engineer: Julius Lee, PE Florida P.E. License No. 34869
Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

Notes:

1. Determination as to the suitability of these truss components for the structure is the responsibility of the building designer/engineer of record, as defined in ANSI/TPI 1-2002 Section 2.2
2. The seal date shown on the individual truss component drawings must match the seal date on this index sheet.
3. The Truss Design Engineer's responsibility relative to this structure consists solely of the design of the individual truss components and does not include the design of any additional structural elements including but not limited to continuous lateral bracing elements in the web and chord planes. See Florida Administrative Code 61G15-31.003 sections 3 c) & 5 and Chapter 2 of the National Design Standard for Metal Plate Connected Wood Truss Construction ANSI/TPI 1-2002 for additional information on the responsibilities of the delegated "Truss Design Engineer". Builders FirstSource and Julius Lee, PE do not accept any additional delegations beyond the scope of work described in the referenced documents above.

No.	Drwg. #	Truss ID	Date
1	J1962409	T01	5/5/08
2	J1962410	T01G	5/5/08
3	J1962411	T02	5/5/08
4	J1962412	T03	5/5/08

Job	Truss	Truss Type	Qty	Ply	VFW ADDITION
L276217	T01	COMMON	2	1	J1962409
Job Reference (optional)					

Builders FirstSource, Lake City, FL 32055

6.300 s Feb 15 2006 MiTek Industries, Inc. Mon May 05 15:54:47 2008 Page 1

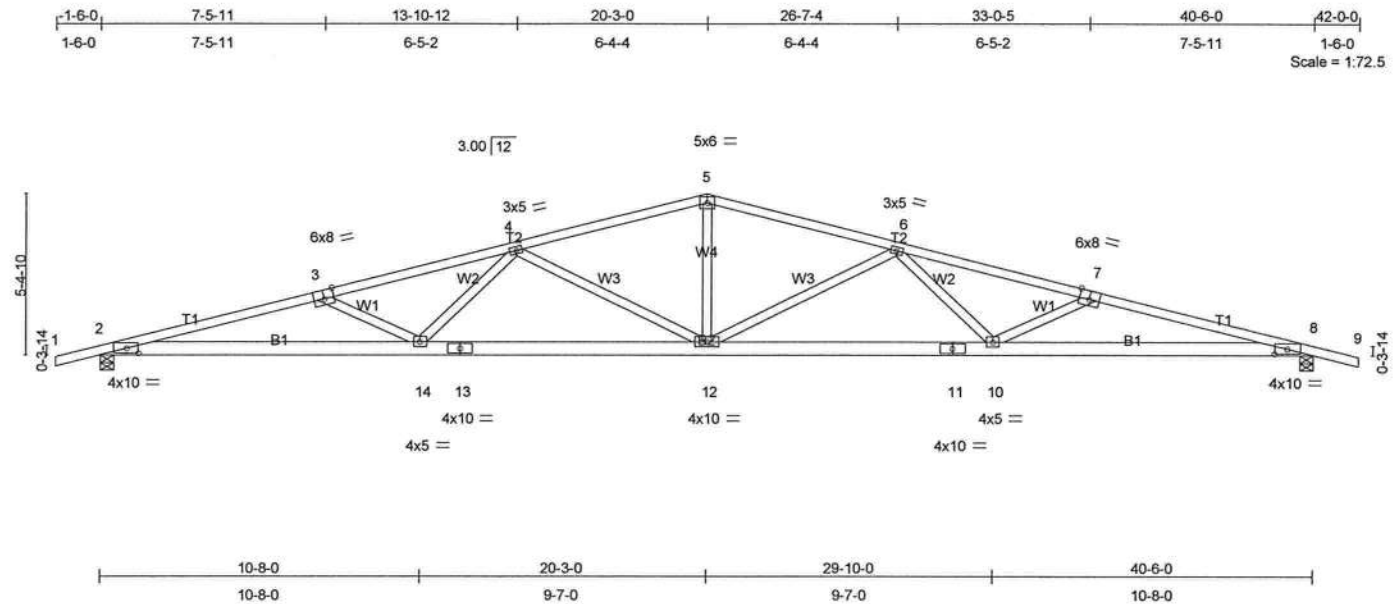


Plate Offsets (X,Y): [2:0-4-12,0-2-0], [3:0-4-0,Edge], [7:0-4-0,Edge], [8:0-4-12,0-2-0]

LOADING (psf)	SPACING	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plates Increase	1.25	TC 0.83	Vert(LL)	1.02 10-12	>472	360	MT20	244/190
TCDL 7.0	Lumber Increase	1.25	BC 0.53	Vert(TL)	-0.83 10-12	>576	240		
BCLL 10.0	* Rep Stress Incr	YES	WB 0.84	Horz(TL)	-0.17 8	n/a	n/a		
BCDL 5.0	Code FBC2004/TPI2002		(Matrix)					Weight: 213 lb	

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 6 SYP No.1D
WEBS 2 X 4 SYP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-7-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 3-6-8 oc bracing.

REACTIONS (lb/size) 2=1375/0-5-8, 8=1375/0-5-8
Max Horz 2=75(load case 6)
Max Uplift 2=-881(load case 4), 8=-881(load case 5)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/23, 2-3=-4324/5069, 3-4=-3855/4761, 4-5=-2722/3342, 5-6=-2722/3341, 6-7=-3855/4761, 7-8=-4324/5069, 8-9=0/23
BOT CHORD 2-14=-4830/4148, 13-14=-3906/3372, 12-13=-3906/3372, 11-12=-3906/3372, 10-11=-3906/3372, 8-10=-4830/4148
WEBS 3-14=-515/442, 4-14=-783/530, 4-12=-906/1044, 5-12=-1341/952, 6-12=-906/1044, 6-10=-783/530, 7-10=-515/442

JOINT STRESS INDEX

2 = 0.86, 3 = 0.96, 4 = 0.50, 5 = 0.79, 6 = 0.50, 7 = 0.96, 8 = 0.86, 10 = 0.31, 11 = 0.87, 12 = 0.37, 13 = 0.87 and 14 = 0.31

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS and C-C Exterior(2) zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.

Continued on page 2.

Julius Lee
Truss Design Engineer
Florida PE No. 34808
1409 Coastal Bay Blvd.
Boynton Beach, FL 33435

May 5, 2008

Warning - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE
This design is based only upon the parameters shown for an individual building component that is installed and loaded vertically and fabricated with MiTek connectors. Applicability of design parameters and proper incorporation of component into the overall building structure, including all temporary and permanent bracing, is the responsibility of building designer and / or contractor per ANSI / TPI 1 as referenced by the building code. For general guidance regarding storage, delivery, erection and bracing, consult BCSI-1 or HIB-91 Handling Installing and Bracing Recommendation available from the Wood Truss Council of America, 1 WTCA Center, 6300 Enterprise Lane, Madison, WI 53719 or the Truss Plate Institute, 563 D'Onofrio Drive, Madison, WI 53719



Job	Truss	Truss Type	Qty	Ply	VFW ADDITION
L276217	T01	COMMON	2	1	J1962409 Job Reference (optional)

Builders FirstSource, Lake City, FL 32055

6.300 s Feb 15 2006 MiTek Industries, Inc. Mon May 05 15:54:47 2008 Page 2

NOTES

- 3) *This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) All bearings are assumed to be SYP No.2 crushing capacity of 565.00 psi
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 881 lb uplift at joint 2 and 881 lb uplift at joint 8.

LOAD CASE(S) Standard

Julius Lee
Truss Design Engineer
Florida PE No. 34868
1409 Coastal Bay Blvd
Boynton Beach, FL 33435


May 5, 2008

Warning - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE

This design is based only upon the parameters shown for an individual building component that is installed and loaded vertically and fabricated with MiTek connectors. Applicability of design parameters and proper incorporation of component into the overall building structure, including all temporary and permanent bracing, is the responsibility of building designer and / or contractor per ANSI / TPI 1 as referenced by the building code. For general guidance regarding storage, delivery, erection and bracing, consult BCSI-1 or HIB-91 Handling Installing and Bracing Recommendation available from the Wood Truss Council of America, 1 WTCA Center, 6300 Enterprise Lane, Madison, WI 53719 or the Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719



6.300 s Feb 15 2006 MiTek Industries, Inc. Mon May 05 15:54:49 2008 Page 1



LUMBER

TOP CHORD	2 X 4 SYP No.2
BOT CHORD	2 X 6 SYP No.1D
WEBS	2 X 4 SYP No.3
OTHERS	2 X 4 SYP No.3

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 4-1-7 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-8-4 oc bracing.

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=-2/27, 2-3=-5870/6922, 3-4=-5835/6922, 4-5=-5008/6134, 5-6=-3320/4044, 6-7=-3320/4044, 7-8=-5008/6134, 8-9=-5835/6922, 9-10=-5870/6922, 10-11=-2/27
BOT CHORD	2-16=-6703/5704, 15-16=-4941/4230, 14-15=-4941/4230, 13-14=-4941/4230, 12-13=-4941/4230, 10-12=-6703/5704
WEBS	4-16=-993/1010, 5-16=-1177/797, 5-14=-1181/1393, 6-14=-1583/1156, 7-14=-1181/1393, 7-12=-1177/797, 8-12=-993/1010

Julius Lee
Truss Design Engineer
Florida PE No. 34889
1400 Coastal Bay Blvd.
Boynton Beach, FL 33435

Continued on page 2



Job	Truss	Truss Type	Qty	Ply	VFW ADDITION
L276217	T01G	GABLE	1	2	J1962410 Job Reference (optional)

Builders FirstSource, Lake City, FL 32055

6.300 s Feb 15 2006 MiTek Industries, Inc. Mon May 05 15:54:49 2008 Page 2

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2 X 4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2 X 6 - 2 rows at 0-9-0 oc.
Webs connected as follows: 2 X 4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section.
Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-02; 110mph (3-second gust); h=20ft; TCDL=4.2psf; BCDL=3.0psf; Category II; Exp B; enclosed; MWFRS gable end zone and C-C Exterior(2) zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60. This truss is designed for C-C for members and forces, and for MWFRS for reactions specified.
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see MiTek "Standard Gable End Detail"
- *This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- All bearings are assumed to be SYP No.2 crushing capacity of 565.00 psi
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1355 lb uplift at joint 2 and 1355 lb uplift at joint 10.
- Gable truss supports 12" max. rake gable overhang.

LOAD CASE(S) Standard

- Regular: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-64(F=-10), 6-11=-64(F=-10), 2-10=-10

Julius Lee
Truss Design Engineer
Florida PE No. 21808
1100 Coastal Bay Blvd.
Boynton Beach, FL 33426

May 5, 2008

Warning - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE

This design is based only upon the parameters shown for an individual building component that is installed and loaded vertically and fabricated with MiTek connectors. Applicability of design parameters and proper incorporation of component into the overall building structure, including all temporary and permanent bracing, is the responsibility of building designer and / or contractor per ANSI / TPI 1 as referenced by the building code. For general guidance regarding storage, delivery, erection and bracing, consult BCSI-1 or HIB-91 Handling, Installing and Bracing Recommendation available from the Wood Truss Council of America, 1 WTCA Center, 6300 Enterprise Lane, Madison, WI 53719 or the Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719



Job	Truss	Truss Type	Qty	Ply	VFW ADDITION
L276217	T02	COMMON	15	1	J1962411
					Job Reference (optional)

Builders FirstSource, Lake City, FL 32055

6.300 s Feb 15 2006 MiTek Industries, Inc. Mon May 05 15:54:50 2008 Page 2

NOTES

- 3) *This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) All bearings are assumed to be SYP No.2 crushing capacity of 565.00 psi
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 379 lb uplift at joint 2 and 376 lb uplift at joint 8.

LOAD CASE(S) Standard

Julius Lee
Truss Design Engineer
Florida PE No. 34888
1400 Coastal Bay Blvd
Boynton Beach, FL 33435

May 5, 2008

Warning - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE

This design is based only upon the parameters shown for an individual building component that is installed and loaded vertically and fabricated with MiTek connectors. Applicability of design parameters and proper incorporation of component into the overall building structure, including all temporary and permanent bracing, is the responsibility of building designer and / or contractor per ANSI / TPI 1 as referenced by the building code. For general guidance regarding storage, delivery, erection and bracing, consult BCSI-1 or HIB-91 Handling Installing and Bracing Recommendation available from the Wood Truss Council of America, 1 WTCA Center, 6300 Enterprise Lane, Madison, WI 53719 or the Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719



6.300 s Feb 15 2006 MiTek Industries, Inc. Mon May 05 15:54:51 2008 Page 1



Job	Truss	Truss Type	Qty	Ply	VFW ADDITION
L276217	T03	COMMON	3	1	J1962412
Job Reference (optional)					

Builders FirstSource, Lake City, FL 32055

6.300 s Feb 15 2006 MiTek Industries, Inc. Mon May 05 15:54:51 2008 Page 2

NOTES

- 3) *This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) All bearings are assumed to be SYP No.2 crushing capacity of 565.00 psi
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 379 lb uplift at joint 2 and 379 lb uplift at joint 8.

LOAD CASE(S) Standard

Julius Lee
Truss Design Engineer
Florida PE No. 34869
1100 Coastal Bay Blvd.
Boynton Beach, FL 33435

May 5, 2008


Warning - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE

This design is based only upon the parameters shown for an individual building component that is installed and loaded vertically and fabricated with MiTek connectors. Applicability of design parameters and proper incorporation of component into the overall building structure, including all temporary and permanent bracing, is the responsibility of building designer and / or contractor per ANSI / TPI 1 as referenced by the building code. For general guidance regarding storage, delivery, erection and bracing, consult BCSI-1 or HIB-91 Handling Installing and Bracing Recommendation available from the Wood Truss Council of America, 1 WTCA Center, 6300 Enterprise Lane, Madison, WI 53719 or the Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719




Symbols

PLATE LOCATION AND ORIENTATION



*Center plate on joint unless dimensions indicate otherwise. Dimensions are in inches. Apply plates to both sides of truss and securely seat.



*For 4 x 2 orientation, locate plates 1/8" from outside edge of truss and vertical web.



*This symbol indicates the required direction of slots in connector plates.

PLATE SIZE

4 X 4


The first dimension is the width perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING




Indicates location of required continuous lateral bracing.

BEARING



Indicates location of joints at which bearings (supports) occur.

Numbering System

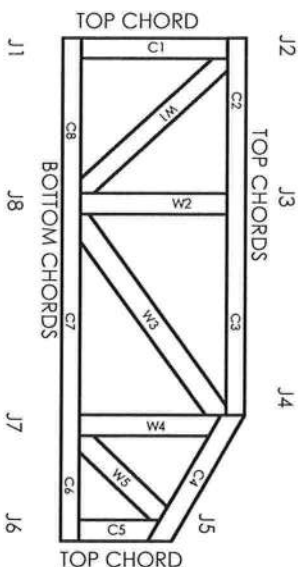

JOINTS AND CHORDS ARE NUMBERED CLOCKWISE AROUND THE TRUSS STARTING AT THE LOWEST JOINT FARTHEST TO THE LEFT.

WEBS ARE NUMBERED FROM LEFT TO RIGHT

CONNECTOR PLATE CODE APPROVALS

BOCA	96-31, 96-67
ICBO	3907, 4922
SBCCI	9667, 9432A
WISC/DILHR	960022-W, 970036-N
NER	561



MITek Engineering Reference Sheet: MIT-7473



General Safety Notes


Failure to Follow Could Cause Property Damage or Personal Injury

1. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
2. Cut members to bear tightly against each other.
3. Place plates on each face of truss at each joint and embed fully. Avoid knots and wane at joint locations.
4. Unless otherwise noted, locate chord splices at 1/4 panel length (± 6" from adjacent joint.)
5. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
6. Unless expressly noted, this design is not applicable for use with fire retardant or preservative treated lumber.
7. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
8. Plate type, size and location dimensions shown indicate minimum plating requirements.
9. Lumber shall be of the species and size, and in all respects, equal to or better than the grade specified.
10. Top chords must be sheathed or purlins provided at spacing shown on design.
11. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
12. Anchorage and / or load transferring connections to trusses are the responsibility of others unless shown.
13. Do not overload roof or floor trusses with stacks of construction materials.
14. Do not cut or alter truss member or plate without prior approval of a professional engineer.
15. Care should be exercised in handling, erection and installation of trusses.

© 1993 MITek® Holdings, Inc.

ASCE 7-02: 130 MPH WIND SPEED, 15' MEAN HEIGHT, ENCLOSED, I = 1.00, EXPOSURE C

MAX GABLE VERTICAL LENGTH		2x4 CABLE VERTICAL SPECIES		BRACE		NO BRACES		(1) 1x4 "L" BRACE *		(1) 2x4 "L" BRACE *		(2) 2x4 "L" BRACE **		(1) 2x6 "L" BRACE *		(2) 2x6 "L" BRACE **	
SPACING	GRADE	SPECIES	GRADE	BRACE	NO BRACES	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
12" O.C.	D.FL	SPF	#1 / #2	STUD	3' 4"	6' 10"	6' 0"	6' 11"	7' 1"	8' 3"	8' 6"	10' 10"	11' 2"	12' 11"	13' 3"	12' 11"	13' 3"
						4' 11"	4' 11"	6' 6"	6' 6"	8' 3"	8' 3"	10' 1"	10' 1"	12' 11"	12' 11"	12' 11"	12' 11"
						3' 3"	3' 3"	4' 11"	4' 11"	6' 5"	6' 5"	8' 3"	8' 3"	10' 0"	10' 0"	12' 11"	12' 11"
						3' 3"	3' 3"	4' 2"	4' 2"	5' 6"	5' 6"	7' 5"	7' 5"	8' 8"	8' 8"	11' 5"	11' 5"
16" O.C.	D.FL	SPF	#1 / #2	STUD	3' 10"	6' 8"	6' 0"	6' 11"	7' 1"	8' 3"	8' 6"	10' 10"	11' 2"	12' 11"	13' 3"	12' 11"	13' 3"
						4' 3"	4' 3"	6' 10"	6' 10"	8' 3"	8' 3"	10' 3"	10' 3"	12' 11"	12' 11"	12' 11"	12' 11"
						3' 10"	3' 10"	6' 8"	6' 8"	8' 3"	8' 3"	10' 3"	10' 3"	12' 11"	12' 11"	12' 11"	12' 11"
						3' 10"	3' 10"	6' 8"	6' 8"	8' 3"	8' 3"	10' 3"	10' 3"	12' 11"	12' 11"	12' 11"	12' 11"
24" O.C.	D.FL	SPF	#1 / #2	STUD	3' 10"	6' 8"	6' 0"	6' 11"	7' 1"	8' 3"	8' 6"	10' 10"	11' 2"	12' 11"	13' 3"	12' 11"	13' 3"
						4' 3"	4' 3"	6' 10"	6' 10"	8' 3"	8' 3"	10' 3"	10' 3"	12' 11"	12' 11"	12' 11"	12' 11"
						3' 10"	3' 10"	6' 8"	6' 8"	8' 3"	8' 3"	10' 3"	10' 3"	12' 11"	12' 11"	12' 11"	12' 11"
						3' 10"	3' 10"	6' 8"	6' 8"	8' 3"	8' 3"	10' 3"	10' 3"	12' 11"	12' 11"	12' 11"	12' 11"

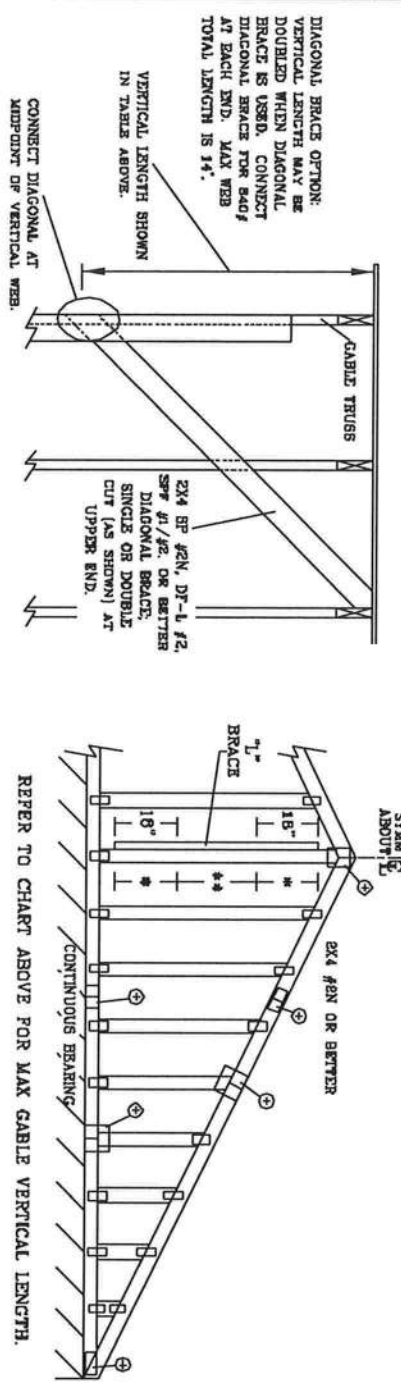

BRACING GROUP SPECIES AND GRADES:	
GROUP A:	
SPRUCE-PINE-FIR	HEM-FIR
#1 / #2 STANDARD	#2 STUD
#3 STUD	#3 STANDARD
DOUGLAS FIR-LARCH	
#3 STUD	#3 STANDARD
SOUTHERN PINE	
#3 STUD	#3 STANDARD
GROUP B:	
HEM-FIR	DOUGLAS FIR-LARCH
#1 & BTR	#1
SOUTHERN PINE	#2

CABLE TRUSS DETAIL NOTES:

LIVE LOAD DEPLETION CRITERIA IS 1/240.

PROVIDE UPLIFT CONNECTIONS FOR 136 PSF OVER CONTINUOUS BEARING (6 PSF TC DEAD LOAD).

CABLE END SUPPORTS LOAD FROM 4' 0" OUTLOOKERS WITH 2' 0" OVERHANG, OR 12" PLYWOOD OVERHANG.

ATTACH EACH "L" BRACE WITH 10d NAILS.

* FOR (1) "L" BRACE: SPACE NAILS AT 8" O.C. IN 18" END ZONES AND 4" O.C. BETWEEN ZONES.

** FOR (2) "L" BRACES: SPACE NAILS AT 8" O.C. IN 18" END ZONES AND 8" O.C. BETWEEN ZONES.

"L" BRACING MUST BE A MINIMUM OF 80% OF WEB MEMBER LENGTH.

CABLE VERTICAL PLATE SIZES	
VERTICAL LENGTH	NO SPLICE
LESS THAN 4' 0"	1x4 OR 2x3
GREATER THAN 4' 0", BUT LESS THAN 11' 8"	2x4
GREATER THAN 11' 8"	2.5x4

* REFER TO COMMON TRUSS DESIGN FOR PEAK, SPLICE, AND HEEL PLATES.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING, AND BRACING. REFER TO BIDS 1-40 BUILDING COMPONENT SAFETY INFORMATION PUBLISHED BY THE NATIONAL INSTITUTE OF STANDARDS AND TECHNOLOGY, 100 BUREAU DRIVE, SUITE 300, MARYLAND, MD 20833-1000. TRUSS CONSTRUCTION PRACTICES, 6300 ENTERPRISE LN, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CLING.

JULIUS LEE'S
CONS. ENGINEERS P.A.
1465 ST 4th AVENUE
DELRAY BEACH, FL 33444-2161


No. 34889
STATE OF FLORIDA

MAX. TOT. LD. 60 PSF
MAX. SPACING 24.0"

REF ASCE7-02-CAB12015
DATE 11/26/03
DRWG MTKA STD CABLE 16 E HT
-ENG

ASCE 7-02: 130 MPH WIND SPEED, 30' MEAN HEIGHT, ENCLOSED, I = 1.00, EXPOSURE C

MAX GABLE VERTICAL LENGTH									
CABLE VERTICAL SPACING	2X4 BRACE SPECIES	GRADE	NO BRACES	(1) 1X4 "L" BRACE *		(1) 2X4 "L" BRACE *		(2) 2X4 "L" BRACE **	
				GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
12" O.C.	SPF	#1 / #2	3' 2"	5' 6"	6' 8"	6' 6"	6' 9"	7' 10"	8' 0"
		#3	3' 1"	4' 5"	4' 5"	5' 10"	5' 10"	7' 10"	7' 10"
		STUD	3' 1"	4' 5"	4' 5"	5' 10"	5' 10"	7' 10"	7' 10"
		STANDARD	2' 11"	3' 9"	3' 9"	6' 0"	6' 0"	8' 5"	8' 5"
		#1	3' 6"	5' 6"	5' 11"	6' 8"	7' 0"	7' 10"	8' 5"
	DFL	#2	3' 6"	5' 6"	5' 11"	6' 8"	7' 0"	7' 10"	8' 5"
		#3	3' 3"	4' 6"	4' 6"	5' 11"	5' 11"	8' 1"	8' 1"
		STUD	3' 3"	4' 6"	4' 6"	5' 11"	5' 11"	8' 1"	8' 1"
		STANDARD	3' 0"	3' 10"	3' 10"	5' 1"	5' 1"	8' 11"	8' 11"
		#1 / #2	3' 8"	6' 4"	6' 6"	7' 6"	7' 8"	8' 11"	9' 2"
16" O.C.	SPF	#3	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"
		STUD	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"
		STANDARD	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"
	DFL	#1	4' 0"	8' 4"	8' 10"	7' 6"	8' 1"	8' 11"	9' 7"
		#2	3' 9"	5' 7"	6' 7"	7' 4"	8' 1"	8' 11"	9' 7"
	SPF	#3	3' 8"	5' 6"	5' 6"	7' 2"	7' 2"	8' 11"	8' 11"
		STUD	3' 8"	5' 6"	5' 6"	7' 2"	7' 2"	8' 11"	8' 11"
		STANDARD	3' 8"	5' 6"	5' 6"	7' 2"	7' 2"	8' 11"	8' 11"
24" O.C.	SPF	#1 / #2	3' 8"	6' 4"	6' 6"	7' 6"	7' 8"	8' 11"	9' 2"
		#3	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"
		STUD	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"
		STANDARD	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"
	DFL	#1	4' 0"	8' 4"	8' 10"	7' 6"	8' 1"	8' 11"	9' 7"
		#2	3' 9"	5' 7"	6' 7"	7' 4"	8' 1"	8' 11"	9' 7"
	SPF	#3	3' 8"	5' 6"	5' 6"	7' 2"	7' 2"	8' 11"	8' 11"
		STUD	3' 8"	5' 6"	5' 6"	7' 2"	7' 2"	8' 11"	8' 11"
		STANDARD	3' 8"	5' 6"	5' 6"	7' 2"	7' 2"	8' 11"	8' 11"

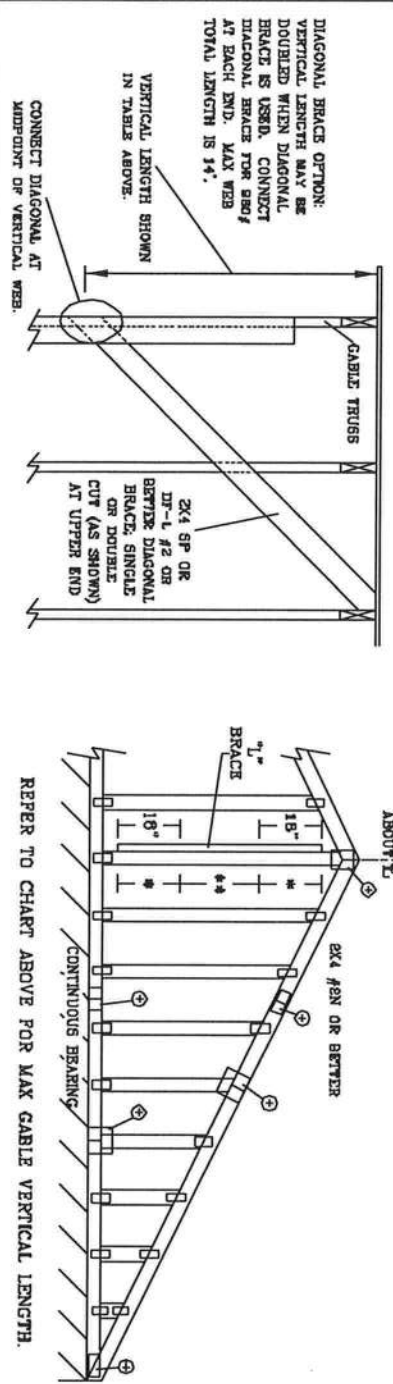

REFER TO CHART ABOVE FOR MAX GABLE VERTICAL LENGTH.

BRACING GROUP SPECIES AND GRADES:			
GROUP A:		GROUP B:	
SPRUCE-PINE-FIR	HEM-FIR	SPRUCE-PINE-FIR	HEM-FIR
#1 / #2 STANDARD	#1 / #2 STANDARD	#1 / #2 STANDARD	#1 / #2 STANDARD
#3 STUD	#3 STUD	#3 STUD	#3 STUD
STANDARD	STANDARD	STANDARD	STANDARD

CABLE TRUSS DETAIL NOTES:

LIVE LOAD DEFLECTION CRITERIA IS $L/240$.
PROVIDE UP/LIFT CONNECTIONS FOR 180 PSF OVER CONTINUOUS BEARING (6 PSF TC DEAD LOAD).
CABLE END SUPPORTS LOAD FROM 4' 0" OUTLINE WITH 8' 0" OVERHANG, OR 12" PLYWOOD OVERHANG.
ATTACH EACH "L" BRACE WITH 10d NAILS.
* FOR (1) "L" BRACE: SPACE NAILS AT 8" O.C. IN 18" END ZONES AND 4" O.C. BETWEEN ZONES.
** FOR (2) "L" BRACES: SPACE NAILS AT 3" O.C. IN 18" END ZONES AND 6" O.C. BETWEEN ZONES.
"L" BRACING MUST BE A MINIMUM OF 80% OF WEB MEMBER LENGTH.

CABLE VERTICAL PLATE SIZES			
VERTICAL LENGTH	NO SPLICE	LESS THAN 4' 0"	1X4 OR 2X3
GREATER THAN 4' 0", BUT LESS THAN 11' 6"	2X4		
GREATER THAN 11' 6"	2X4		

+ REFER TO COMMON TRUSS DESIGN FOR TRAIL, SPLICE, AND HEEL PLATES.

MEMORANDUM TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING, AND BRACING. REFER TO BCST-1-03 BUILDING COMPONENT SAFETY INFORMATION, PUBLISHED BY THE TRUSS COUNCIL OF AMERICA, 6800 ENTERPRISE LANE, SUITE 200, MADISON, WI 53719, AND VITA (WOOD TRUSS COUNCIL) FOR THE LATEST REVISIONS. UNLESS OTHERWISE INDICATED, 100% GRADE STEEL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.


JULIUS LEE'S
CONS. ENGINEERS P.A.
1456 SW 4TH AVENUE
DELRAY BEACH, FL 33444-2161

No. 34868
STATE OF FLORIDA


MAX. TOT. LD. 60 PSF
MAX. SPACING 24' 0"

REF ASCE 7-02-CAB10030
DATE 11/26/03
DWG WEEK STD GABLE 30' x 17'
-ENG


TYPICAL ATTIC TRUSS BRACING

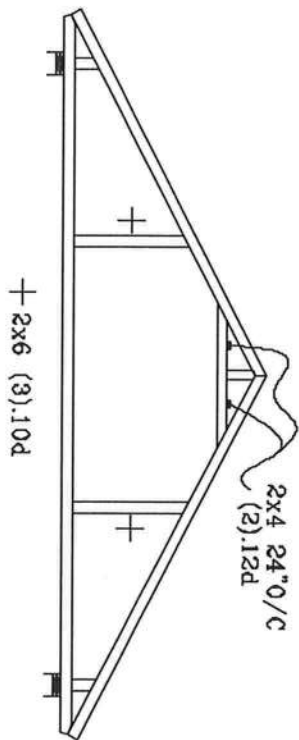

TYPICAL ALTERNATE BRACING DETAIL FOR EXTERIOR FLAT GIRDER TRUSS

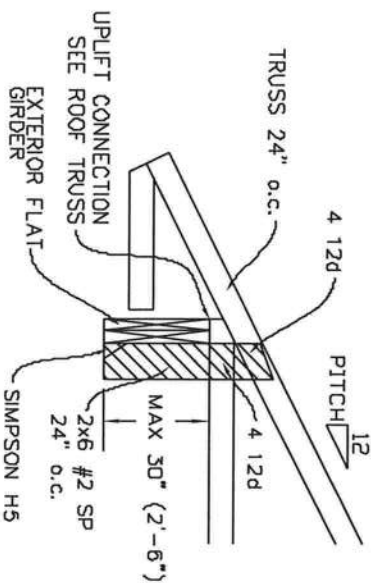


GABLE END TRUSS DETAIL

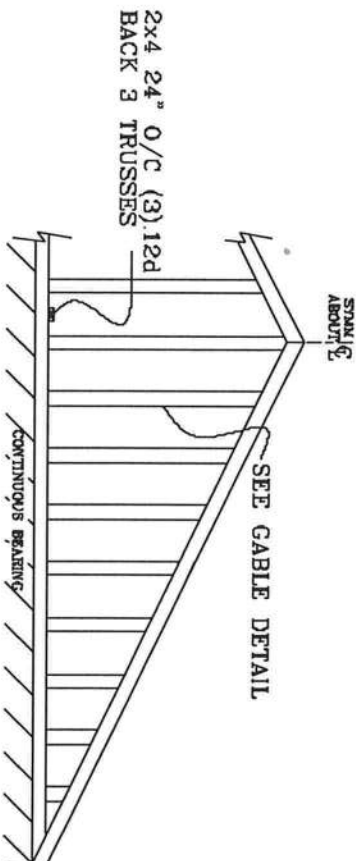


MINIMUM BC BRACING ON GABLE TRUSS. OTHER PERMANENT BRACING DESIGNS BY ARCHITECT OR EOR

TYPICAL WALL GIRDER VERTICAL WEB BRACING DETAIL

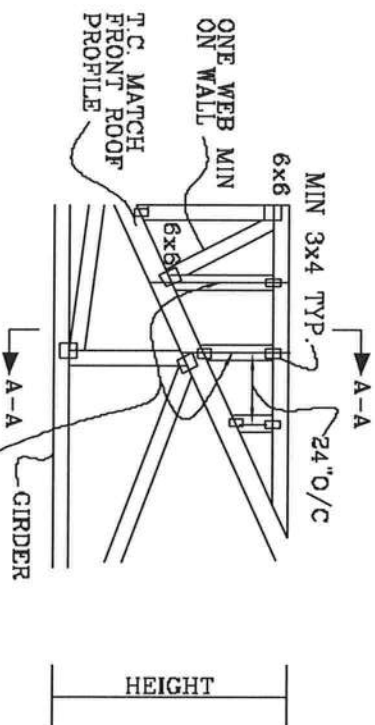

SEE ROOF TRUSSES FOR UPLIFT
ROOF 24" O/C

SEE GABLE END DETAIL FOR T-BRACE BEHIND EACH VERTICAL

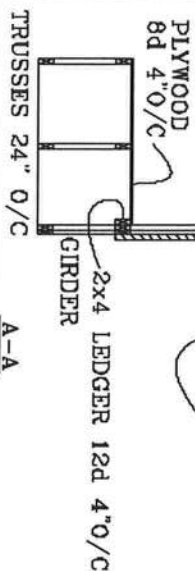

JULIUS LEE'S
CONS. ENGINEERS P.A.
1455 SW 41st AVENUE
DELRAY BEACH, FL 33444-2161

No: 34869
STATE OF FLORIDA

TOP CHORD 2X4 #2 OR BETTER
BOT CHORD 2X4 #2 OR BETTER
WEBS 2X4 #3 OR BETTER

PIGGYBACK DETAIL

REFER TO SEALED DESIGN FOR DASHED PLATES.

SPACE PIGGYBACK VERTICALS AT 4' OC MAX.

TOP AND BOTTOM CHORD SPLICES MUST BE STAGGERED SO THAT ONE SPLICE IS NOT DIRECTLY OVER ANOTHER.

PIGGYBACK BOTTOM CHORD MAY BE OMITTED. ATTACH VERTICAL WEBS TO TRUSS TOP CHORD WITH 1.5X3 PLATE.

ATTACH PURLINS TO TOP OF FLAT TOP CHORD. IF PIGGYBACK IS SOLID LUMBER OR THE BOTTOM CHORD IS OMITTED, PURLINS MAY BE APPLIED BENEATH THE TOP CHORD OF SUPPORTING TRUSS.

REFER TO ENGINEER'S SEALED DESIGN FOR REQUIRED PURLIN SPACING.

THIS DETAIL IS APPLICABLE FOR THE FOLLOWING WIND CONDITIONS:

110 MPH WIND, 30' MEAN HGT, ASCE 7-02, CLOSED BLDG. LOCATED ANYWHERE IN ROOF, 1 MI FROM COAST

CAT I, EXP C, WIND TC DL=5 PSF, WIND BC DL=5 PSF




110 MPH WIND, 30' MEAN HGT, FBC ENCLOSED BLDG, LOCATED ANYWHERE IN ROOF

WIND TC DL=5 PSF, WIND BC DL=5 PSF

FRONT FACE (B,*) PLATES MAY BE OFFSET FROM BACK FACE

PLATES AS LONG AS BOTH FACES ARE SPACED 4' OC MAX.

130 MPH WIND, 30' MEAN HGT, ASCE 7-02, CLOSED BLDG, LOCATED ANYWHERE IN ROOF, CAT II, EXP. C, WIND TC DL=6 PSF, WIND BC DL=6 PSF

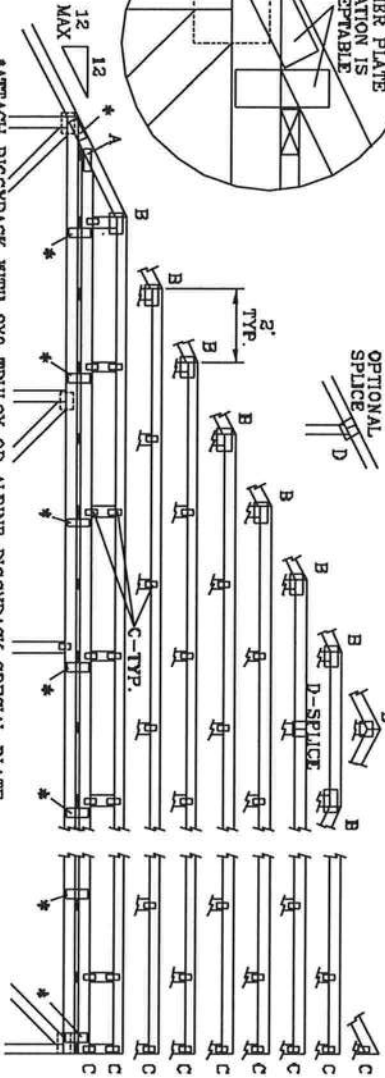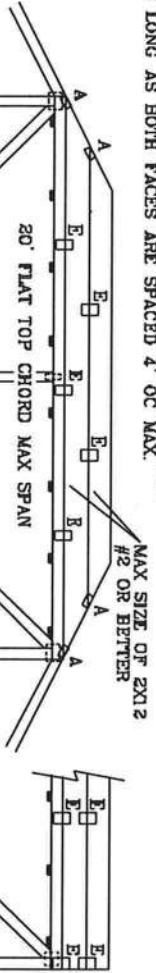


*ATTACH PIGGYBACK WITH 3X6 TRUSS OR ALPINE PIGGYBACK SPECIAL PLATE.

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST PRACTICES (BUILDING CONVENTIONAL SAFETY INFORMATION), PUBLISHED BY THE TRUSS MANUFACTURERS ASSOCIATION (TMA), 15179 AND VITA CROD TRUSS COUNCIL OF AMERICA, 11000 3RD AVENUE, SUITE 200, MINNETONKA, MN 55345-4400. THESE TRUSSES ARE DESIGNED FOR THE FUNCTIONS AND LOADS INDICATED. TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JOINT TYPE	SPANS UP TO			
	30'	34'	38'	62'
A	2X4	2.5X4	2.5X4	3X5
B	4X6	6X6	6X6	5X6
C	1.5X3	1.5X4	1.5X4	1.5X4
D	5X4	6X5	6X5	5X6
E	4X6 OR 3X6 TRUSS AT 4' OC, ROTATED VERTICALLY			

ATTACH TRUSS PLATES WITH (8) 0.120" X 1.375" NAILS, OR EQUAL, PER FACE PER PLY. (4) NAILS IN EACH MEMBER TO BE CONNECTED. REFER TO DRAWING 160 TL FOR TRUSS INFORMATION.

WEB LENGTH	REQUIRED BRACING
0' TO 7'9"	NO BRACING
7'9" TO 10'	1X4 "B" BRACE, SAME GRADE, SPECIES AS WEB MEMBER OR BETTER AND 80% LENGTH OF WEB MEMBER. ATTACH WITH 8d NAILS AT 4" OC.
10' TO 14'	2X4 "B" BRACE, SAME GRADE, SPECIES AS WEB MEMBER OR BETTER AND 80% LENGTH OF WEB MEMBER. ATTACH WITH 16d NAILS AT 4" OC.

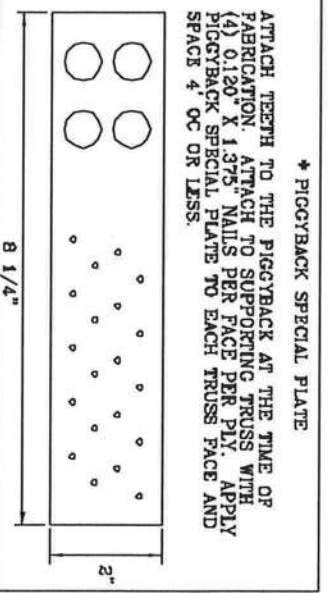

* PIGGYBACK SPECIAL PLATE
ATTACH TEETH TO THE PIGGYBACK AT THE TIME OF FABRICATION. ATTACH TO SUPPORTING TRUSS WITH (4) 0.120" X 1.375" NAILS PER FACE PER PLY. APPLY PIGGYBACK SPECIAL PLATE TO EACH TRUSS FACE AND SPACE 4' OC OR LESS.

THIS DRAWING REPLACES DRAWINGS 634.016 634.017 & 847.045

JULIUS LEE'S
CONS. ENGINEERS P.A.
1455 SW 4TH AVENUE
DIKART BLDG. FL. 3044-261




No. 34868
STATE OF FLORIDA

MAX LOADING	55 PSF AT 1.33 DUR. FAC. 60 PSF AT 1.25 DUR. FAC. 47 PSF AT 1.15 DUR. FAC.	SPACING	24.0"
REF	PIGGYBACK	DATE	09/12/07
DATE	09/12/07	DRWG/ITEK	STD PIGGY
ENG	JL		


VALLEY TRUSS DETAIL

TOP CHORD 2X4 SP #2 OR SPF #1/#2 OR BETTER.
BOT CHORD 2X3(*) OR 2X4 SP #2N OR SPF #1/#2 OR BETTER.
WEBS 2X4 SP #3 OR BETTER.

- * 2X3 MAY BE RIPPED FROM A 2X6 (PITCHED OR SQUARE).
- ** ATTACH EACH VALLEY TO EVERY SUPPORTING TRUSS WITH:
(2) 16d BOX (0.135" X 3.5") NAILS TOE-NAILED FOR
FBC 2004 110 MPH, ASCE 7-02 110 MPH WIND OR (3) 16d FOR
ASCE 7-02 130 MPH WIND. 15' MEAN HEIGHT, ENCLOSED
BUILDING, EXP. C. RESIDENTIAL, WIND TC DL=5 PSF.

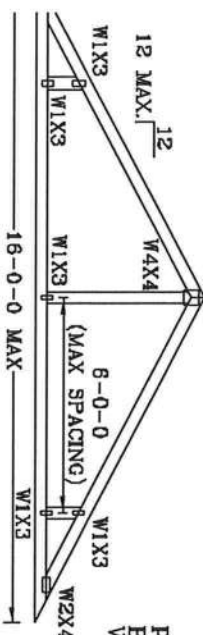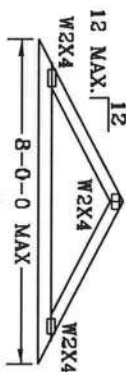

SUPPORTING TRUSSES AT 24" OC MAXIMUM SPACING.

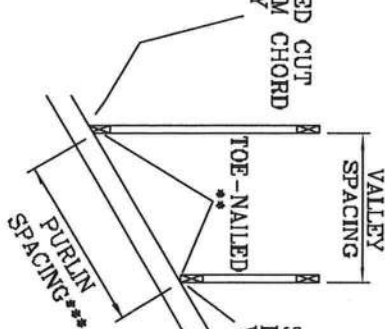

SQUARE CUT
BOTTOM CHORD
VALLEY



- *** NOTE THAT THE PURLIN SPACING FOR BRACING THE TOP CHORD OF THE TRUSS
BENEATH THE VALLEY IS MEASURED ALONG THE SLOPE OF THE TOP CHORD.
- ++ LARGER SPANS MAY BE BUILT AS LONG AS THE VERTICAL HEIGHT DOES
NOT EXCEED 12'0".
- BOTTOM CHORD MAY BE SQUARE OR PITCHED CUT AS SHOWN.

UNLESS SPECIFIED ON ENGINEER'S SEALED DESIGN, APPLY 1X4 "I"-BRACE, 80%
LENGTH OF WEB, VALLEY WEB, SAME SPECIES AND GRADE OR BETTER, ATTACHED
WITH 8d BOX (0.135" X 2.5") NAILS AT 6" OC, OR CONTINUOUS LATERAL BRACING,
EQUALLY SPACED, FOR VERTICAL VALLEY WEBS GREATER THAN 7'9".

MAXIMUM VALLEY VERTICAL HEIGHT MAY NOT EXCEED 12'0".

TOP CHORD OF TRUSS BENEATH VALLEY SET MUST BE BRACED WITH:
PROPERLY ATTACHED, RATED SHEATHING APPLIED PRIOR TO VALLEY TRUSS
INSTALLATION

OR
PURLINS AT 24" OC OR AS OTHERWISE SPECIFIED ON ENGINEERS' SEALED DESIGN
OR
BY VALLEY TRUSSES USED IN LIEU OF PURLIN SPACING AS SPECIFIED ON
ENGINEERS' SEALED DESIGN.

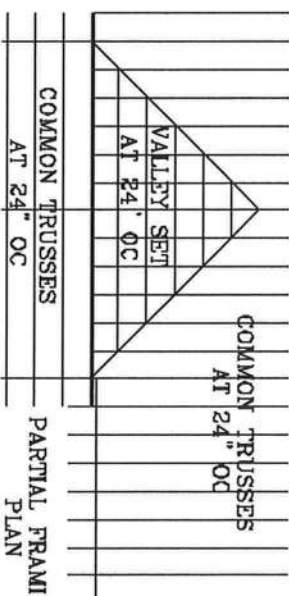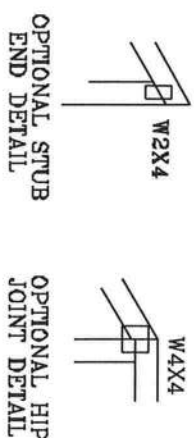

COMMON TRUSSES
AT 24" OC
PARTIAL FRAMING
PLAN

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND
BRACING. REFER TO BEST PRACTICES (BUILDING CONSTRUCTION SAFETY INFORMATION), PUBLISHED BY THE TRUSS
AND JOINT COMMITTEE TO THE BUILDING INDUSTRY, 1455 SW 4th AVENUE, SUITE 100, MIAMI, FL 33135.
OF AMERICA AND ENCLOSED TO THE USER. THESE TRUSSES ARE NOT TO BE USED FOR ANY OTHER PURPOSES
THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED
STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.

1455 SW 4th AVENUE
DELRAY BEACH, FL 33444-2101

No. 34868
STATE OF FLORIDA

TC LL	20	PSF	REF	VALLEY DETAIL
TC DL	7	15	PSF	DATE 11/26/03
BC DL	5	5	PSF	DRWG VALTRUSS1103
BC LL	0	0	PSF	-ENG JL
TOT. LD.	32	40	PSF	
DUR.FAC.	1.25	1.25		
SPACING	24"			

THIS DRAWING REPLACES DRAWING A105

TOE-NAIL DETAIL

TOE-NAILS TO BE DRIVEN AT AN ANGLE OF APPROXIMATELY THIRTY DEGREES WITH THE PIECE AND STARTED APPROXIMATELY ONE-THIRD THE LENGTH OF THE NAIL FROM THE END OF THE MEMBER.

PER ANSI/AF&PA NDS-2001 SECTION 12.4.1 - EDGE DISTANCE, END DISTANCE, SPACING, EDGE DISTANCES, END DISTANCES AND SPACINGS FOR NAILS AND SPIKES SHALL BE SUFFICIENT TO PREVENT SPLITTING OF THE WOOD.



THE NUMBER OF TOE-NAILS TO BE USED IN A SPECIFIC APPLICATION IS DEPENDENT UPON PROPERTIES FOR THE CHORD SIZE, LUMBER SPECIES, AND NAIL TYPE. PROPER CONSTRUCTION PRACTICES AS WELL AS GOOD JUDGEMENT SHOULD DETERMINE THE NUMBER OF NAILS TO BE USED.

THIS DETAIL DISPLAYS A TOE-NAILED CONNECTION FOR JACK FRAMING INTO A SINGLE OR DOUBLE PLY SUPPORTING GIRDER.

MAXIMUM VERTICAL RESISTANCE OF 16d (0.162"x3.5") COMMON TOE-NAILS

NUMBER OF TOE-NAILS	SOUTHERN PINE		DOUGLAS FIR-LARCH		HEM-FIR		SPRUCE PINE FIR	
	1 PLY	2 PLYS	1 PLY	2 PLYS	1 PLY	2 PLYS	1 PLY	2 PLYS
2	197#	256#	181#	234#	156#	203#	154#	199#
3	298#	383#	271#	351#	234#	304#	230#	298#
4	394#	511#	361#	468#	312#	406#	307#	397#
5	493#	639#	452#	585#	390#	507#	384#	496#

ALL VALUES MAY BE MULTIPLIED BY APPROPRIATE DURATION OF LOAD FACTOR.

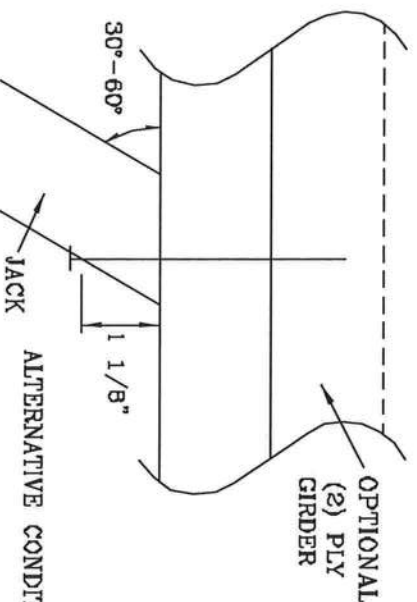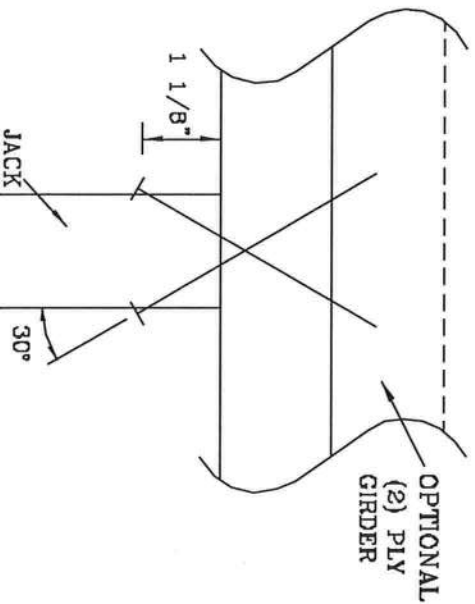

ALTERNATIVE CONDITION

THIS DRAWING REPLACES DRAWING 784040

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST PRACTICES FOR SAFETY. SEE THE LATEST EDITIONS OF THE NATIONAL BUILDING CODE OF AMERICA, 6900 ENTERPRISE L.N., MARIETTA, GA 30067 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.

1450 ST 4TH AVENUE
DELRAY BEACH, FL 33444-2161

No. 34868
STATE OF FLORIDA

TC LL PSF REF TOE-NAIL

TC DL PSF DATE 09/12/07

BC DL PSF DRWG CTONAIL1103

BC LL PSF -ENG JL

TOT. LD. PSF


DUR. FAC. 1.00

SPACING

1/2" DIAMETER BOLT SPACING FOR LOAD APPLIED PARALLEL TO GRAIN.

* GRADE AND SPECIES AS SPECIFIED ON THE ALPINE DESIGN.
BOLT HOLES SHALL BE A MINIMUM OF 1/32" TO A MAXIMUM OF 1/16" LARGER THAN BOLT DIAMETER.

TYPICAL LOCATION OF 1/2" DIAMETER THRU BOLTS. BOLT QUANTITIES AS NOTED ON SEALED DESIGN MUST BE APPLIED IN ONE OF THE PATTERNS SHOWN BELOW.
WASHERS REQUIRED UNDER BOLT HEAD AND NUT

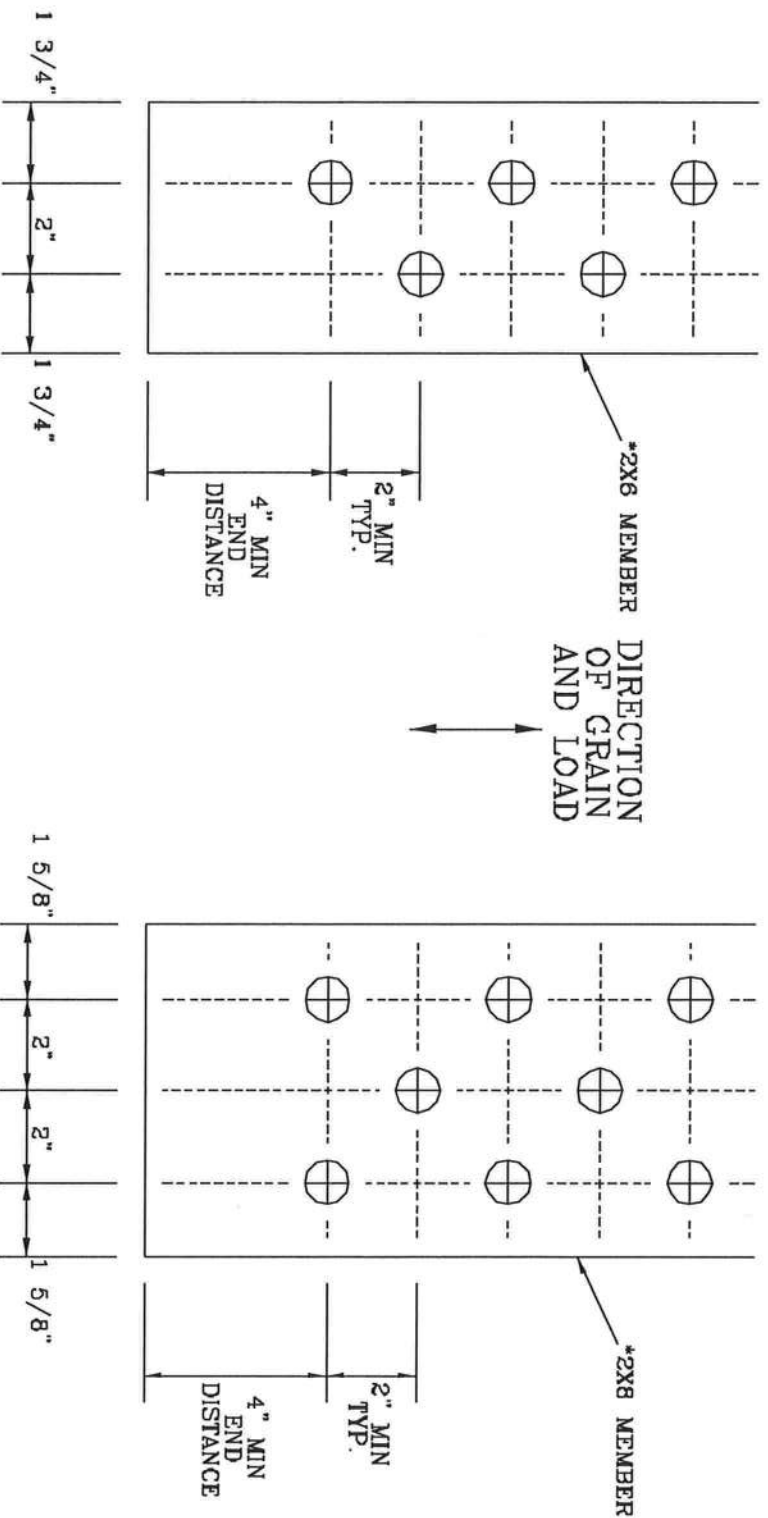

2X6 DETAIL

2X8 DETAIL

THIS DRAWING REPLACES DRAWING A828.016

VARIES TRUSSES REQUIRE EXTERIOR CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO 2021 I-10 BUILDING CONSTRUCTION SAFETY INFORMATION, PUBLISHED BY THE TRUSS PLATE INSTITUTE, 380 OGDON DR., SUITE 200, MADISON, WI 53719 AND AICA CROD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LN, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.
1455 EY 4TH AVENUE
DELRAY BEACH, FL 33411-2161

No. 34669
STATE OF FLORIDA

TC LL	PSF	REF	BOLT SPACING
TC DL	PSF	DATE	11/26/03
BC DL	PSF	DRWG	CNBOLTSPI103
BC LL	PSF	-ENG	JL
TOT. LD.	PSF		
DUR. FAC.			
SPACING			

TRULOX CONNECTION DETAIL




11 GAUGE (0.120" X 1.375") NAILS REQUIRED FOR TRULOX PLATE ATTACHMENT. FILL ROWS COMPLETELY WHERE SHOWN (Φ).

* NAILS MAY BE OMITTED FROM THESE ROWS.

THIS DETAIL MAY BE USED WITH SO. PINE, DOUGLAS-FIR OR HEM-FIR CHORDS WITH A MINIMUM 1.00 DURATION OF LOAD OR SPRUCE-PINE-FIR CHORDS WITH A MINIMUM 1.15 DURATION OF LOAD. CHORD SIZE OF BOTH TRUSSES MUST EXCEED THE TRULOX PLATE WIDTH.

TRULOX PLATE IS CENTERED ON THE CHORDS AND BENT BETWEEN NAIL ROWS.

REFER TO ENGINEER'S SEALED DESIGN REFERENCING THIS DETAIL FOR LUMBER, PLATES, AND OTHER INFORMATION NOT SHOWN.

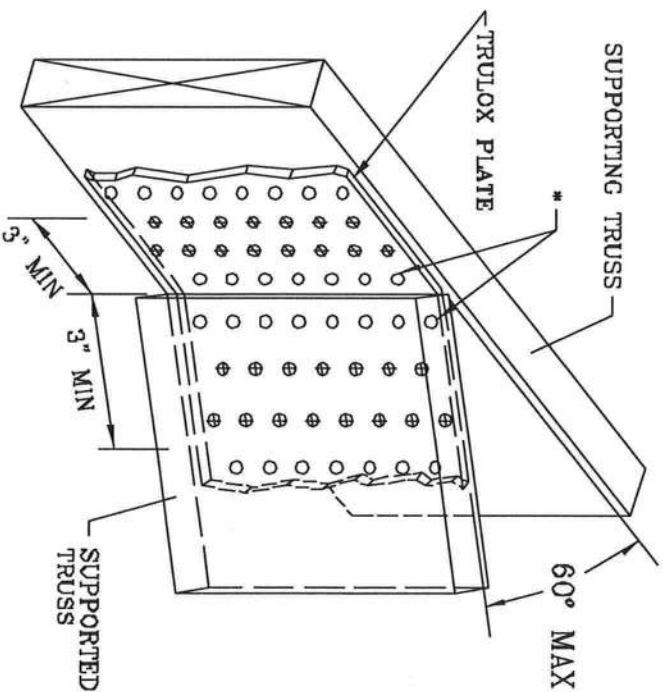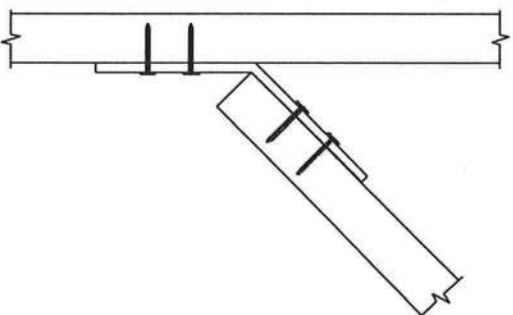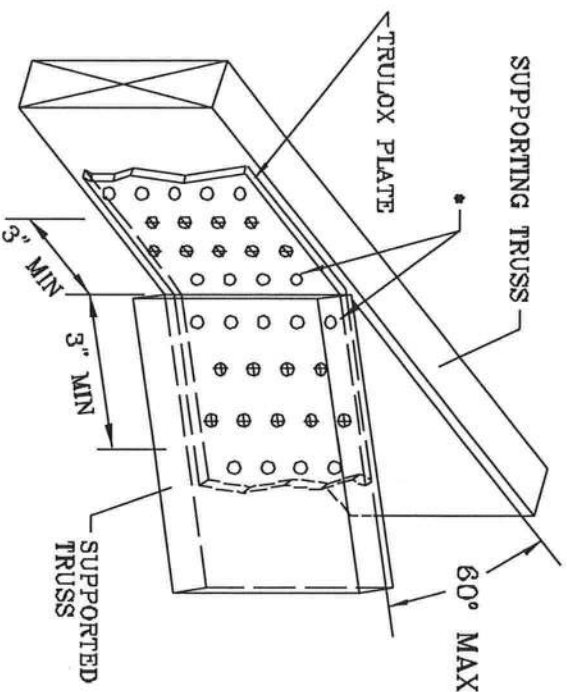

TRULOX PLATE SIZE	REQUIRED NAILS PER TRUSS	MAXIMUM LOAD UP OR DOWN
3X6	9	350#
6X6	15	990#

THIS DRAWING REPLACES DRAWINGS 1.158.988 1.158.989/R 1.154.944 1.152.217 1.152.017 1.159.154 & 1.151.524

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SUPPORTING, INSTALLING AND BRACING. REFER TO ACES 1-00 (BUILDING COMPONENT SAFETY INFORMATION, PUBLISHED BY THE FINISHES OF AMERICA, 6300 OUTCROOK LN, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.

1455 SW 4th AVENUE
DELRAY BEACH, FL 33444-2101

No: 34869
STATE OF FLORIDA


REF TRULOX

DATE 11/26/03


DRWG CNTRULOX1103

-ENG JL

**STRONG BACK DETAIL
SYSTEM-42 OR FLAT TRUSS**

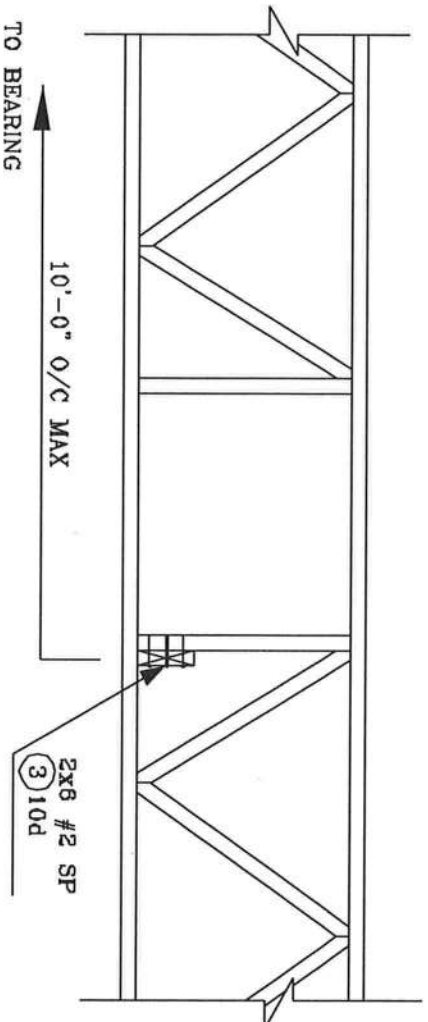


**ALTERNATE DETAIL FOR
STRONG BACK WITH VERTICAL
NOT LINING UP**

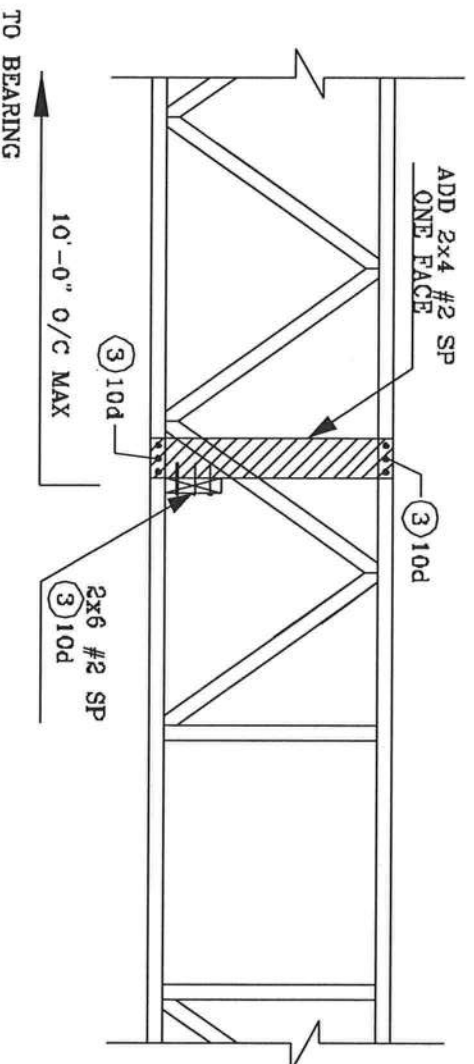




JULIUS LEE'S
CONS. ENGINEERS P.A.
1456 SW 4TH AVENUE
DEER BEACH, FL 33444-2661

No: 34869
STATE OF FLORIDA

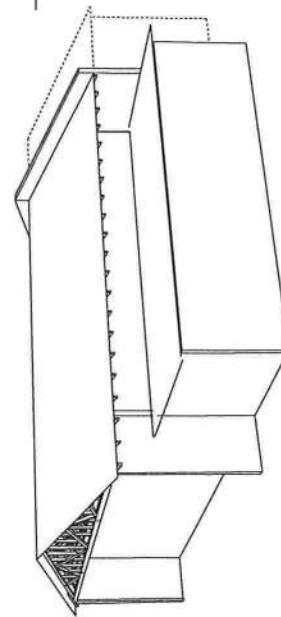

8'-0"

RAFTER FRAMED BY OTHERS

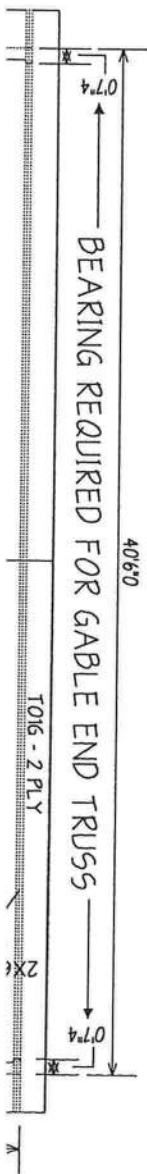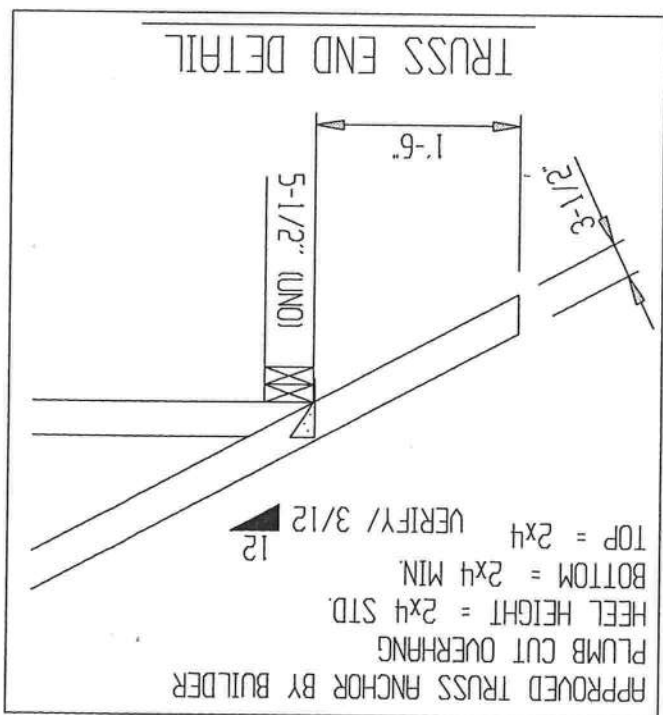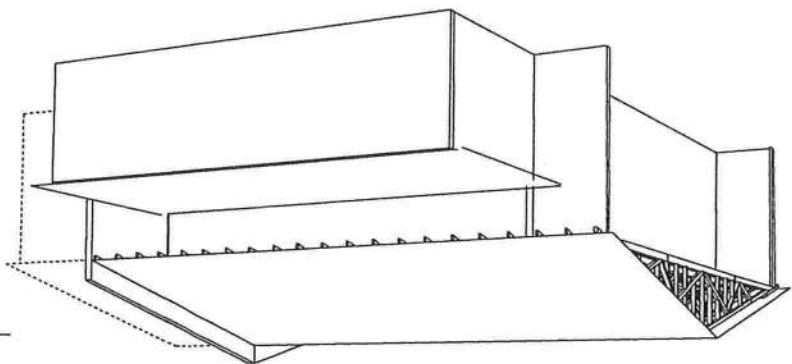

COLUMBIA COUNTY FLORIDA

OCCUPANCY

COLUMBIA COUNTY, FLORIDA

Department of Building and Zoning Inspection

This Certificate of Occupancy is issued to the below named permit holder for the building and premises at the below named location, and certifies that the work has been completed in accordance with the Columbia County Building Code.

Parcel Number 17-4S-17-08421-000

Building permit No. 000026984

Use Classification ADD. TO BUILDING

Fire: 0.00

Permit Holder CHUCK WOODS

Waste:

Owner of Building VETERANS OF FOREIGN WARS

Total: 0.00

Location: 343 SW FORREST LAWN, LAKE CITY, FL

Date: 08/07/2008

Tony Decker ✓

Building Inspector

POST IN A CONSPICUOUS PLACE
(Business Places Only)



COLUMBIA COUNTY FIRE DEPARTMENT



P. O. BOX 1529
LAKE CITY, FL 32056
PHONE (386) 754-7071
FAX (386) 754-7064

David L. Boozer
Division Chief

07 Aug 2008

TO: Columbia County Bldg. and Zoning Department
Randy Jones, Assistant Bldg. and Zoning Coordinator



FROM: David L. Boozer, Division Chief / Fire Marshal
Florida State Fire Inspector #146595

RE: Final Inspection, Permit #26984
Veterans of Foreign War, 343 SW Forest Lawn Way, Lake City, Fl. 32025

A Final Fire Safety Inspection was performed today of the above listed property. This building meets the requirements as set forth in Chapter 12, of the Florida Fire Prevention Code, 2004 Edition. I recommend approval.

Sincerely,

David L. Boozer

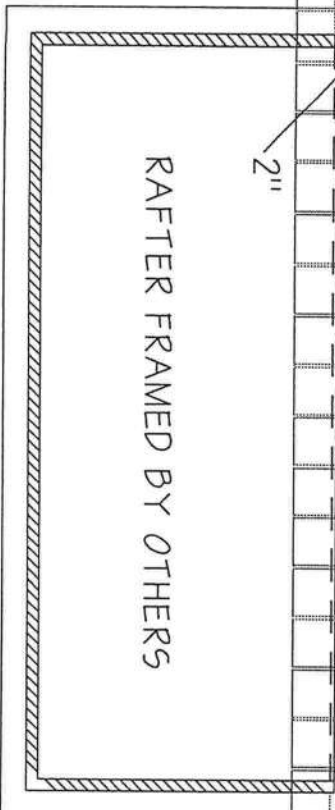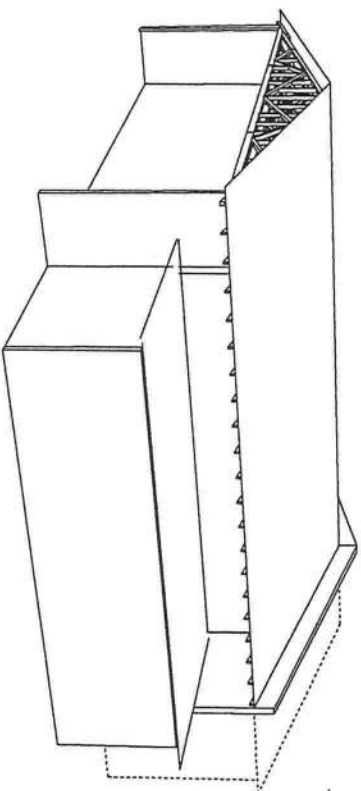

BEARING HEIGHT SCHEDULE	
12'-0"	
8'-0"	
<p>NOTES:</p> <p>1) REFER TO SD 90, RECOMMENDATIONS FOR HOODING INSTALLATION AND TEMPERATURE BRACING. REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.</p> <p>2) ALL TD0565 (INCLUDING TD0565 UNDER VALLEY TRUSS) MUST BE CORRECTLY DETECTED PER REFER TO DETAIL, V03 FOR ALL TENSILE BRACING RECOMMENDATIONS.</p> <p>3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BRIDGE.</p> <p>4) ALL TD0565 ARE DESIGNED FOR 2 O₂, MAXIMUM SPACING, UNLESS OTHERWISE NOTED.</p> <p>5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.</p> <p>6) 5"X42 TD0565 MUST BE INSTALLED WITH THE TOP BEARING UP.</p> <p>7) ALL ROOF TD0565 HANGERS TO BE SUSPENSION HITCHES UNLESS OTHERWISE NOTED. ALL FLOOR TD0565 HANGERS TO BE SHAPEDON TH442Z UNLESS OTHERWISE NOTED.</p> <p>8) BEARING/DETAILING, REQUIRED TO BE FURNISHED BY CLIENT.</p>	
<p>SHOP DRAWING APPROVAL</p> <p>THIS DRAWING IS THE SOLE SOURCE FOR FABRICATION OF TD0565 AND V03S. ALL TENSILE MEMBER/BEAM OR OTHER TENSILE MEMBERS, EITHER AND OTHERWISE, OF THIS FABRIC MUST BE DETECTED BEFORE ANY TD0565 WILL BE BUILT. VERIFY ALL CONDITIONS TO MAKE ADAPTS CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.</p> <p>IN EXTRA CHARGES TO YOU.</p> <p>Approved by: _____ DATE: _____</p>	
<p>Builders FirstSource Bunnell</p> <p>PHONE: 904-431-5349 FAX: 904-431-5984 PHONE: 904-772-6100 FAX: 904-772-1073</p> <p>Jack O'Connell Lake City Stardford</p> <p>PHONE: 386-755-6844 FAX: 386-755-7473 PHONE: 407-322-0094 FAX: 407-322-7933</p> <p>CASH SALES</p>	
<p>HEAD OFFICE: CR BL LAKE CITY, FL - COLUMBIA CITY</p> <p>DATE: _____ TIME: _____</p> <p>FWF ADDITION DATE: _____ TIME: _____</p> <p>5-1-08 BANNARDY L276217</p>	



46 26984

Overhead Door Company of Gainesville

POST OFFICE BOX 568 • GAINESVILLE, FL 32602 • OFFICE (352) 468-2733 •
A DIVISION OF FLORIDA OVERHEAD DOOR & SPECIALTIES, INC.

7/29/08


To Whom It May Concern:

This is to inform you that the fire door installed at VFW in Lake City Florida on 6/11/08 was installed properly per Manufactures Instructions.

Sincerely,

Robert Hartman
President, Overhead Door Gainesville, Florida 32602

26984



**NICHOLAS
PAUL
GEISLER**
ARCHITECT
N.C.A.R.B. Certified

1758 NW Brown Road
Lake City, FL 32055
386/755-9021

25 JUNE 2008

JOHNNY KEARSE, BUILDING OFFICIAL
COLUMBIA COUNTY, BUILDING DEPT.
COLUMBIA COUNTY COURTHOUSE ANNEX
LAKE CITY, FLORIDA 32055

RE: ADDITION TO LAKE CITY VFW
PERMIT Nr.: _____

DEAR SIR:

PLEASE BE ADVISED OF THE FOLLOWING CHANGE TO THE CONSTRUCTION
DOCUMENTS FOR THE ABOVE REFERENCED PROJECT:

IN LIEU OF THE TRUSS ANCHORS AS INDICATED IN THE PLANS, IT IS
PERMISSIBLE TO SUBSTITUTE "SIMPSON" HIGS ANCHORS AS A MEANS OF
ANCHORING THE TRUSSES TO THE WALL FRAMING.

SHOULD YOU HAVE ANY FURTHER QUESTIONS WITH THIS, PLEASE CALL FOR
ASSISTANCE.

YOURS TRULY,
NICHOLAS PAUL GEISLER, ARCHITECT AR0007005


District No. 1 - Ronald Williams
District No. 2 - Dewey Weaver
District No. 3 - George Skinner
District No. 4 - Stephen E. Bailey
District No. 5 - Elizabeth Porter

0801-182

RECEIVED

APR 30 2008

GTC DESIGN GROUP

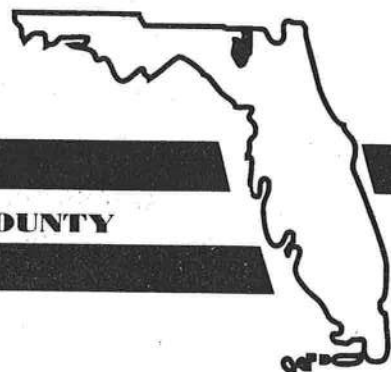

BOARD OF COUNTY COMMISSIONERS • COLUMBIA COUNTY

April 28, 2008

SCANNED

4-30-08

Mr. Chad Williams
GTC Design Group, LLC
176 NW Lake Jeffery Rd.
Lake City, FL 32055

Re: SDP# 08-04 (VFW)

Dear Chad:

This letter is to inform you that your application for a Site and Development Plan was approved by the Columbia County Planning & Zoning Board at the meeting on April 24, 2008.

Any necessary permits required by the County's Building Department can be obtained at this time.

If you have any questions concerning this matter, please feel free to contact me at (386) 754-7053.

Sincerely,

Connie F. Scott
Planning Technician



RECEIVED

APR 10 2008

GTC DESIGN GROUP

SCANNED

4-10-08

**SUWANNEE
RIVER
WATER
MANAGEMENT
DISTRICT**

9225 CR 49
LIVE OAK, FLORIDA 32060
TELEPHONE: (386) 362-1001
TELEPHONE: 800-226-1066
FAX (386) 362-1056

NOTICED GENERAL PERMIT

PERMITTEE:

VETERANS OF FOREIGN WARS
PO BOX 276
LAKE CITY, FL 32056

PERMIT NUMBER: ERP99-0529M

DATE ISSUED: 04/08/2008

DATE EXPIRES: 04/08/2011

COUNTY: COLUMBIA

TRS: S17/T4S/R17E

PROJECT: VETERANS OF FOREIGN WARS ADDITION

Approved entity to whom operation and maintenance may be transferred pursuant to rule 40B-4.1130, Florida Administrative Code (F.A.C.):

ROGER FORMOSA
VETERANS OF FOREIGN WARS
PO BOX 276
LAKE CITY, FL 32056

Based on information provided, the Suwannee River Water Management District's (District) rules have been adhered to and an environmental resource noticed general permit is in effect for the permitted activity description below:

This permit authorizes an 1818 square-foot (0.04-acre) impervious addition to the existing Veterans of Foreign Wars (VFW) Lodge on an upland site. The project will be completed in a manner consistent with the application package received by the District from GTC Design Group, for the VFW on April 4, 2008, in accordance with District rule 40B-4.2010(2)(a) 2.a., F.A.C.

It is your responsibility to ensure that adverse off-site impacts do not occur either during or after construction. Any additional construction or alterations not authorized by this permit may result in flood control or water quality problems both on and off site and will be a violation of District rule.

You or any other substantially affected persons are entitled to request an administrative hearing or mediation. Please refer to enclosed notice of rights.

Permit No.: ERP99-0529M

Project: VETERANS OF FOREIGN WARS ADDITION

Page 2 of 7

This permit is issued under the provisions of chapter 373, F.S., chapter 40B-4, and chapter 40B-400, F.A.C. A noticed general permit authorizes the construction, operation, maintenance, alteration, abandonment, or removal of certain minor surface water management systems. This permit authorizes the permittee to perform the work necessary to construct, operate, and maintain the surface water management system shown on the application and other documents included in the application. This is to notify you of District's agency action concerning Notice Of Intent. This action is taken pursuant to rule 40B-4 and 40B-400, F.A.C.

General Conditions for All Noticed General Permits:

1. The terms, conditions, requirements, limitations, and restrictions set forth in this section are general permit conditions and are binding upon the permittee for all noticed general permits in Part II of this chapter. These conditions are enforceable under Part IV of chapter 373, F.S.
2. The general permit is valid only for the specific activity indicated. Any deviation from the specified activity and the conditions for undertaking that activity shall constitute a violation of the permit. A violation of the permit is a violation of Part IV of chapter 373, F.S., and may result in suspension or revocation of the permittee's right to conduct such activity under the general permit. The District may also begin legal proceedings seeking penalties or other remedies as provided by law for any violation of these conditions.
3. This general permit does not eliminate the necessity to obtain any required federal, state, local and special District authorizations prior to the start of any construction, alteration, operation, maintenance, removal or abandonment authorized by this permit.
4. This general permit does not convey to the permittee or create in the permittee any property right, or any interest in real property, nor does it authorize any entrance upon or activities on property which is not owned or controlled by the permittee, or convey any rights or privileges other than those specified in the general permit and Part II of this chapter.
5. This general permit does not relieve the permittee from liability and penalties when the permitted activity causes harm or injury to human health or welfare, animal, plant or aquatic life, or property. It does not allow the permittee to cause pollution in contravention of Florida Statutes and District rules.
6. The permittee is hereby advised that s.253.77, F.S., states that a person may not commence any excavation, construction or other activity involving the use of sovereign or other lands of the state, the title to which is vested in the Board of Trustees of the Internal Improvement Trust Fund without obtaining the required lease, license, easement, or other form of consent authorizing the proposed use. Therefore, the permittee is responsible for obtaining any necessary authorizations from the

Permit No.: ERP99-0529M

Project: VETERANS OF FOREIGN WARS ADDITION

Page 3 of 7

Board of Trustees prior to commencing activity on sovereignty lands or other state-owned lands.

7. The authorization to conduct activities pursuant to general permit may be modified, suspended or revoked in accordance with chapter 120, and s.373.429, F.S.

8. This permit shall not be transferred to a third party except pursuant to s.40B-4.1130, F.A.C. The permittee transferring the general permit shall remain liable for any corrective actions that may be required as a result of any permit violations prior to sale, conveyance, or other transfer of ownership or control of the permitted system or the real property at which the permitted system is located.

9. Upon reasonable notice to the permittee, District staff with proper identification shall have permission to enter, inspect, sample and test the permitted system to insure conformity with the plans and specifications approved by the permit.

10. The permittee shall maintain any permitted system in accordance with the plans submitted to the District and authorized by this general permit.

11. A permittee's right to conduct a specific noticed activity under this noticed general permit is authorized for the duration on the front of this permit.

12. Construction, alteration, operation, maintenance, removal and abandonment approved by this general permit shall be conducted in a manner which does not cause violations of state water quality standards, including any antidegradation provisions of s.62-4.242(1)(a) and (b), 62-4.242(2) and (3), and 62-302.300, F.A.C., and any special standards for Outstanding Florida Waters and Outstanding National Resource Waters. The permittee shall implement best management practices for erosion, turbidity and other pollution control to prevent violation of state water quality standards. Temporary erosion control measures such as sodding, mulching, and seeding shall be implemented and shall be maintained on all erodible ground areas prior to and during construction. Permanent erosion control measures such as sodding and planting of wetland species shall be completed within seven days of any construction activity. Turbidity barriers shall be installed and maintained at all locations where the possibility of transferring suspended solids into wetlands or other surface waters exists due to the permitted activity. Turbidity barriers shall remain in place and shall be maintained in a functional condition at all locations until construction is completed and soils are stabilized and vegetation has been established. Thereafter the permittee shall be responsible for the removal of the barriers. The permittee shall correct any erosion or shoaling that causes adverse impacts to the water resources.

13. The permittee shall hold and save the District harmless from any and all damages, claims or liabilities which may arise by reason of the construction, alteration, operation, maintenance, removal, abandonment or use of any system authorized by the general permit.

Permit No.: ERP99-0529M

Project: VETERANS OF FOREIGN WARS ADDITION

Page 4 of 7

14. The permittee shall immediately notify the District in writing of any previously submitted information that is later discovered to be inaccurate.

15. The permittee shall perform all construction authorized in a manner so as to minimize adverse impacts to fish, wildlife, natural environmental values, and water quality. The permittee shall institute necessary measures during construction including riprap, reinforcement, or compaction of any fill materials placed around newly installed structures, to minimize erosion, turbidity, nutrient loading, and sedimentation in the receiving waters.

16. The permit is issued based on the information submitted by the applicant which reasonably demonstrates that adverse off-site water resource impacts will not be caused by the permitted activity. It is the responsibility of the permittee to insure that such adverse impacts do not in fact occur either during or after construction.

WITHIN 30 DAYS AFTER COMPLETION OF THE PROJECT, THE PERMITTEE SHALL NOTIFY THE DISTRICT, IN WRITING, THAT THE FACILITIES ARE COMPLETE.

Approved by Loni Mander Date Approved 4/8/08
District Staff

NOTICE OF RIGHTS

1. A person whose substantial interests are or may be determined has the right to request an administrative hearing by filing a written petition with the Suwannee River Water Management District (District), or may choose to pursue mediation as an alternative remedy under Section 120.569 and 120.573, Florida Statutes, before the deadline for filing a petition. Choosing mediation will not adversely affect the right to a hearing if mediation does not result in a settlement. The procedures for pursuing mediation are set forth in Sections 120.569 and 120.57 Florida Statutes. Pursuant to Rule 28-106.111, Florida Administrative Code, the petition must be filed at the office of the District Clerk at District Headquarters, 9225 C.R. 49, Live Oak, Florida 32060 within twenty-one (21) days of receipt of written notice of the decision or within twenty-one (21) days of newspaper publication of the notice of District decision (for those persons to whom the District does not mail actual notice). A petition must comply with Chapter 28-106, Florida Administrative Code.
2. If the Governing Board takes action which substantially differs from the notice of District decision to grant or deny the permit application, a person whose substantial interests are or may be determined has the right to request an administrative hearing or may chose to pursue mediation as an alternative remedy as described above. Pursuant to Rule 28-106.111, Florida Administrative Code, the petition must be filed at the office of the District Clerk at District Headquarters, 9225 C.R. 49, Live Oak, Florida 32060 within twenty-one (21) days of receipt of written notice of the decision or within twenty-one (21) days of newspaper publication of the notice of District decision (for those persons to whom the District does not mail actual notice). Such a petition must comply with Chapter 28-106, Florida Administrative Code.
3. A substantially interested person has the right to a formal administrative hearing pursuant to Section 120.569 and 120.57(1), Florida Statutes, where there is a dispute between the District and the party regarding an issue of material fact. A petition for formal hearing must comply with the requirements set forth in Rule 28-106.201, Florida Administrative Code.
4. A substantially interested person has the right to an informal hearing pursuant to Section 120.569 and 120.57(2), Florida Statutes, where no material facts are in dispute. A petition for an informal hearing must comply with the requirements set forth in Rule 28-106.301, Florida Administrative Code.
5. A petition for an administrative hearing is deemed filed upon receipt of the petition by the Office of the District Clerk at the District Headquarters in Live Oak, Florida.
6. Failure to file a petition for an administrative hearing within the requisite time frame shall constitute a waiver of the right to an administrative hearing pursuant to Rule 28-106.111, Florida Administrative Code.

Permit No.: ERP99-0529M

Project: VETERANS OF FOREIGN WARS ADDITION

Page 6 of 7

7. The right to an administrative hearing and the relevant procedures to be followed is governed by Chapter 120, Florida Statutes, and Chapter 28-106, Florida Administrative Code.

8. Pursuant to Section 120.68, Florida Statutes, a person who is adversely affected by final District action may seek review of the action in the District Court of Appeal by filing a notice of appeal pursuant to the Florida Rules of Appellate Procedure, within 30 days of the rendering of the final District action.

9. A party to the proceeding before the District who claims that a District order is inconsistent with the provisions and purposes of Chapter 373, Florida Statutes, may seek review of the order pursuant to Section 373.114, Florida Statutes, by the Florida Land and Water Adjudicatory Commission, by filing a request for review with the Commission and serving a copy of the Department of Environmental Protection and any person named in the order within 20 days of adoption of a rule or the rendering of the District order.

10. For appeals to the District Courts of Appeal, a District action is considered rendered after it is signed on behalf of the District, and is filed by the District Clerk.

11. Failure to observe the relevant time frames for filing a petition for judicial review, or for Commission review, will result in waiver of the right to review.

CERTIFICATE OF SERVICE

I hereby certify that a copy of the foregoing Notice of Rights has been sent by U.S. Mail to:

VETERANS OF FOREIGN WARS
PO BOX 276
LAKE CITY, FL 32056

At 4:00 p.m. this 9 day of April, 2008.



Jon M. Dinges
Deputy Clerk
Suwannee River Water Management District
9225 C.R. 49

Permit No.: ERP99-0529M

Project: VETERANS OF FOREIGN WARS ADDITION

Page 7 of 7

Live Oak, Florida 32060

386.362.1001 or 800.226.1066 (Florida only)

cc: File Number: ERP99-0529M

SECTION C

**AS-BUILT CERTIFICATION
(TO BE COMPLETED BY A PROFESSIONAL ENGINEER)**

I hereby certify that all components of the surfacewater management system authorized under permit number _____, issued _____, for _____ in _____ County have been built in substantial conformance with the permitted plans and design.

It is further stated that the permittee has been furnished with instructions as to how the system is to be operated and maintained.

Signature of Engineer

**Name and Florida Registration Number
(Please print or type)**

Date Certification Made

Company Name

Mailing Address

City, State, Zip Code

Phone Number

Project visited for final (As-built) inspection on: _____

Minor Field Changes: _____

[AFFIX SEAL]