

Zone 1		Zone 1 +/- 19.47
Zone 2		Zone 2 +/- 29.96
Zone 3		Zone 3 +/- 41.63
WIND PRESSURE ON COMPONENTS AND CLADDING		
Zone 1		Zone 1 +/- 19.47
Zone 2		Zone 2 +/- 29.96
Zone 3		Zone 3 +/- 41.63

ULTIMATE & NOMINAL WIND SPEEDS	
ULTIMATE	NOMINAL SUSTAINED
120	93
130	101
140	108
150	116

WIND EXPOSURE CATEGORY			
B	C	D	

BUILDING DIMENSIONS			D-1
BARN WIDTH (FT)	INSIDE POST DIMENSION	OUTSIDE 6" X 6" POST DIMENSION	OUTSIDE 8" X 8" POST DIMENSION
40	39'-1"	40	40'-4"
36	35'-1"	36	36'-4"
30	29'-1"	30	30'-4"
24	23'-1"	24	24'-4"
20	19'-1"	20	20'-4"
BARN LENGTH (FT)	D-2	INSIDE DIMENSION FOR ROUND POST SEE D-1	
84'			
72'			
60'			
50'			
48'			
40'			
36'			
30'			
24'			

CONCRETE INFORMATION	
CONCRETE SLAB	
NO CONCRETE SLAB	
4" THICK 3000 PSI CONCRETE SLAB W/ 6X6-8/6 WWF OR FIBERMESH CONCRETE DESIGN LIVE LOAD 40 PSF	
6" THICK 3000 PSI CONCRETE SLAB W/ 6X6 4/4 WWF CONCRETE DESIGN LIVE LOAD 200 PSF	
8" THICK 3000 PSI CONCRETE SLAB W/ 2 MATS OF BARS TOP & BOTTOM EACH #4 BARS @ 12" C/C EACH WAY CONCRETE DESIGN LIVE LOAD 400 PSF	
THICKENED EDGE SLAB	
NO THICKENED EDGE SLAB	
12" W X 12" D W/ 2 #5 BAR CONT	
12" W X 20" D W/ 2 #5 BAR CONT	
RIBBON FOOTING	
NO RIBBON FOOTING	
12" W X 12" D W/ 2 #5 BAR CONT	
12" W X 20" D W/ 2 #5 BAR CONT	

POST SIZE	
6"X 6"	8"X 8"
10" X 10"	
ROUND MIN. DIA.	

ROOF PITCH	
3/12	4/12
5/12	6/12

POST HEIGHT		OTHER
SIZE CIRCLED OR LESS (D-3)		
10'	12'	14'
		16'

POST FOOTING SIZE	
F-1	24" DIA. X 48" DEEP
ALL POST REQUIRE CONCRETE FOOTINGS	

PROFESSIONAL SERVICES BY
DRISCOLL ENGINEERING, INC.
PO BOX 357577,
GAINESVILLE, FL 32635
PH (352) 331-1513
CA 8690

PLANS AND SPECIFICATIONS

The plans and specifications presented herein are applicable only for the anticipated construction at the locations shown. If construction plans change, the Design Professional should be notified so the plans and specifications can be re-evaluated. The Design Professional should be given the opportunity to review final plans and specifications to see if the intent of the plans and specifications has been followed and/or if supplemental details and recommendations are needed. The Design Professional warrants that the plans and specifications contained herein, have been prepared in accordance with generally accepted professional engineering practices. No other warranties are implied or expressed.

CORPORATE PROTECTION

It is understood and agreed that the Design Professional's Basic Services under this Agreement do not include project observation or review of the Contractor's performance or any other construction phase services, and that such services will be provided by the Client. The Client assumes all responsibility for interpretation of the contractor Documents and for construction observation and supervision and waives any claims against the Design Professional that may be in any way connected thereto.

In addition, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any loss, claim or cost, including reasonable attorney's fees and costs of defense, arising or resulting from the performance of such services by other person or entities and from any and all claims arising from modifications, clarifications, interpretations, adjustments or changes made to Contract Documents to reflect changed field or other conditions, except for claims arising from the sole negligence or willful misconduct to the Design Professional.

OWNERSHIP OF INSTRUMENTS OF SERVICE

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Design Professional as instruments of service shall remain the property of the Design Professional. The Design Professional shall retain all common law, statutory and other reserved rights, including the copyright thereto.

DEFECTS IN SERVICE

The Client shall promptly report to the Design Professional any defects or suspected defects in the Design Professional's work or services of which the Client becomes aware, so that the Design Professional may take measures to minimize the consequences of such a defect. The Client warrants that he or she will impose a similar notification requirement on all contractors in his or her Client/Contractor contract and shall require all subcontractors at any level to contain a like requirement. Failure by the Client, and the Client's contractors or subcontractors to notify the Design Professional, shall relieve the Design Professional of the costs of remedying the defects above the sum such remedy would have cost had prompt notification been given.

VERIFICATION OF EXISTING CONDITIONS

Inasmuch as the remodeling and/or rehabilitation of an existing building requires that certain assumptions be made regarding existing conditions, and because some of these assumptions may not be verifiable without expending additional sums of money or destroying otherwise adequate or serviceable portions of the building, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any claim, liability or cost (including reasonable attorney's fees and costs of defense) for injury or economic loss arising or allegedly arising out of the professional services provided under this Agreement, excepting only those damages, liabilities, or costs attributable to the sole negligence or willful misconduct of the Design Professional.

All the plans in this building plan set are protected under the Federal Copyright Act, Title XVII of the U.S. Code and Chapter 37 of the Code of Federal Regulations. The owner of the copyright retains title and ownership of the original documents. The plan set licensed to you cannot be used by or resold to any other individual.

Reproduction of these plans, either in whole or in part, including any form of copying and/or preparation of derivative works thereof, for any reason without prior written permission, is strictly prohibited. The purchase of a set of building plans in no way transfers any copyright or other ownership interest in it to the buyer. The purchase of additional sets of that plan set at a reduced price from the original set or as part of a multiple set package does not convey to the buyer a license to construct more than one structure as shown. Similarly, the purchase of reproducible sets entitles the buyer a license to produce any plans more than once, and to avoid any copyright/licence infringement, it is necessary to contact the plan set designer to receive a release and license for any extended usage. Whereas a purchaser of PDFs, CAD and Reproducibles is granted a license to make copies, it should be noted that any copyrighted material, making photocopies from the plan set, is illegal.

Copyright licensing of plans for construction exists to protect all parties. It respects and supports the intellectual property of the original architect or designer. Copyright law has been reinforced over the past few years. Willful infringement could cause settlements for statutory damages up to \$150,000 plus attorney fees, damages, and loss of profits.

POST SPACING D-4 (FT)		METAL ROOF	
8	10	26 GA	29 GA
			FL 42382.09-R0

OPEN POLE STORAGE STRUCTURE

1-All construction shall comply with Florida Building Code 8th edition 2023.

ULTIMATE WIND SPEED: SEE TABLE THIS SHEET
NOMINAL WIND SPEED: SEE TABLE THIS SHEET
WIND EXPOSURE CATEGORY: SEE TABLE THIS SHEET
RISK CATEGORY I
INTERNAL PRESSURE COEFFICIENT G_o= +/- 0.0
DESIGN PRESSURE PER FBC CHAPTER 16, INCLUDING ASCE 7-22 LOAD CALCULATIONS
ROOF LIVE LOAD =12.5 PSF
ROOF DEAD LOAD = 2.5 PSF
MIN SOIL BEARING 2000 PSF
MAX TRUSS BEARING LOAD EACH END 5200LB
MAX TRUSS UPLIFT @ POST 3400LBS
TERMITE TREATMENT SHALL BE APPLIED IN ACCORD WITH THE FLORIDA BUILDING CODE & LOCAL CODES

Wood framing and fasteners to meet NDS-2018 requirements.

Fastener requirements: (1) all nails are common galvanized; (2) all bolts are to be galvanized steel and include nuts and washers; (3) all other hardware (Simpson or equal) is to be installed according to manufacturer's specifications and recommendations; (4) nailing (size and number) shall satisfy Tables 2306.2.(1), 2306.3.(1), and 2306.3.(#) FBC unless otherwise indicated; (5) Fasteners exposed to the weather are to be treated for weather resistance and compatible with the type of pressure treated wood use (connectors, nails, bolts, nuts, & washers).

- Wood Pole Concrete Footings
 - Minimum Ultimate Compressive Strength @ 28 days = 3,000 PSI
 - Bag concrete mix allowed for wood pole footings when mixed in accord with manufactures requirements for a minimum ultimate compressive strength of 3,000 PSI.
- Building Concrete Wall Footings & Slabs
 - Concrete wall shall conform to "Building Code Requirements for Reinforced Concrete" (ACI-318) and "Specifications for Structural Concrete" (ACI-301), Latest Edition
 - Minimum Ultimate Compressive Strength @ 28 days = 3,000 PSI
 - All slabs on grade shall have construction or control joints not to exceed 10'-0" spacing, unless otherwise noted.
 - Electrical conduit and other pipes to be embedded in structural concrete floor slabs or walls shall be placed in accordance with the requirements of ACI-318, Paragraph 6.3
- Reinforcing Steel
 - Reinforcing steel shall conform to ASTM A615, Grade 40 (F_y 40 ksi). Lap continuous bars for tension lap splice per ACI-318, unless otherwise noted. Provide corner bars of the same size and spacing as horizontal wall reinforcement. Cover for concrete reinforcing steel shall be in accordance with ACI-318, Paragraph 7.7
 - Welded wire fabric (WWF) shall conform to ASTM A185. Lap sheets two mesh spaces and wire tie adjacent sheets together securely. Cut alternate reinforcement at control joints.

The Structural Design Work in This Set of Engineering Plans is Subject to But Not Limited to The Following Exclusions:

- Architectural Design Services
- Civil Engineering and Site Plan Design Services
- Electrical and Lighting Design Services
- HVAC Design Services
- Plumbing Design Services
- Geotechnical Engineering Services
- Life Safety Plan Design Services
- Flood Resistant Design Per Asce24-14
- Any and All Local Code Requirements and Comments Made by The Authority Having Jurisdiction with The Regard To The Plans And Specifications

These Exclusions Are All the Owner's Responsibility

Digitally

signed by

Michael E.

Driscoll PE

Date:

2024.03.27

11:59:04


-04'00'

OWNER /CONTRACTOR SHALL VERIFY ALL DIMENSIONS OF THIS STRUCTURE BEFORE BEGINNING CONSTRUCTION

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY MICHAEL E. DRISCOLL, P.E. USING A SHA AUTHENTICATION CODE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SHA AUTHENTICATION CODE MUST BE VERIFIED ON ANY ELECTRONIC COPIES ON 3-27-24

Michael E Driscoll PE


FL Reg # 43922

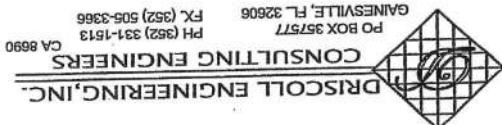

AIDA WHITEHOUSE
339 NW DAVID DRIVE
LAKE CITY, FL 32055

3-27-24
DB24-245
40x60x14 C&C


1 OF 3

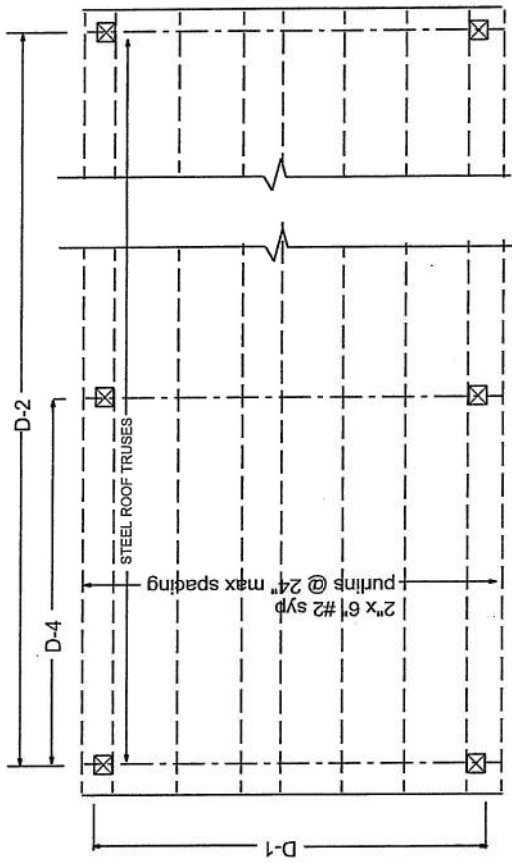


PLAN VIEW POST SPACING

Drip edge attach
in accord w/ mfr specifications


14 Ga purlin
connector

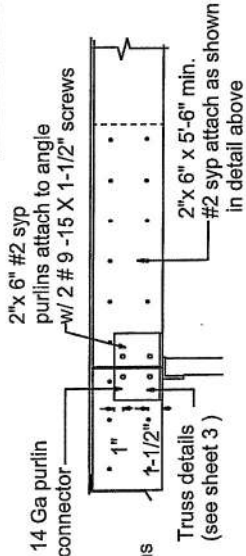

PURLIN CONNECTION TOP VIEW DETAIL

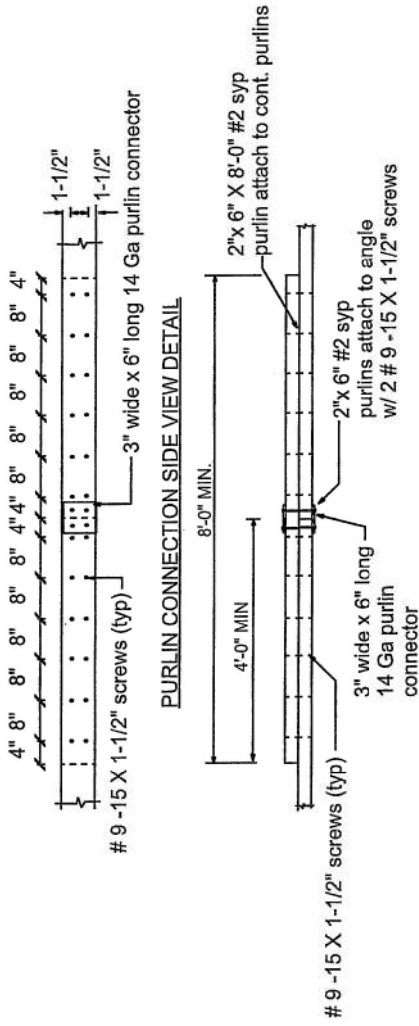

PURLIN CONNECTION SIDE VIEW DETAIL

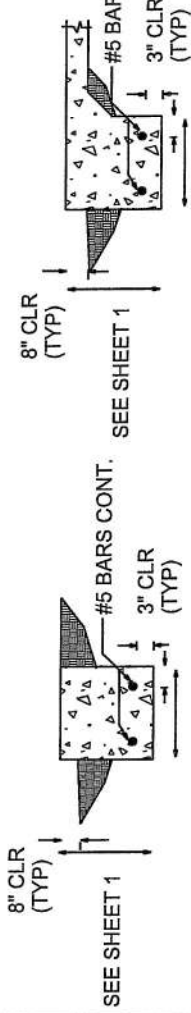


SEE SHEET 1

RIBBON FOOTING

SEE SHEET 1

THICKENED EDGE

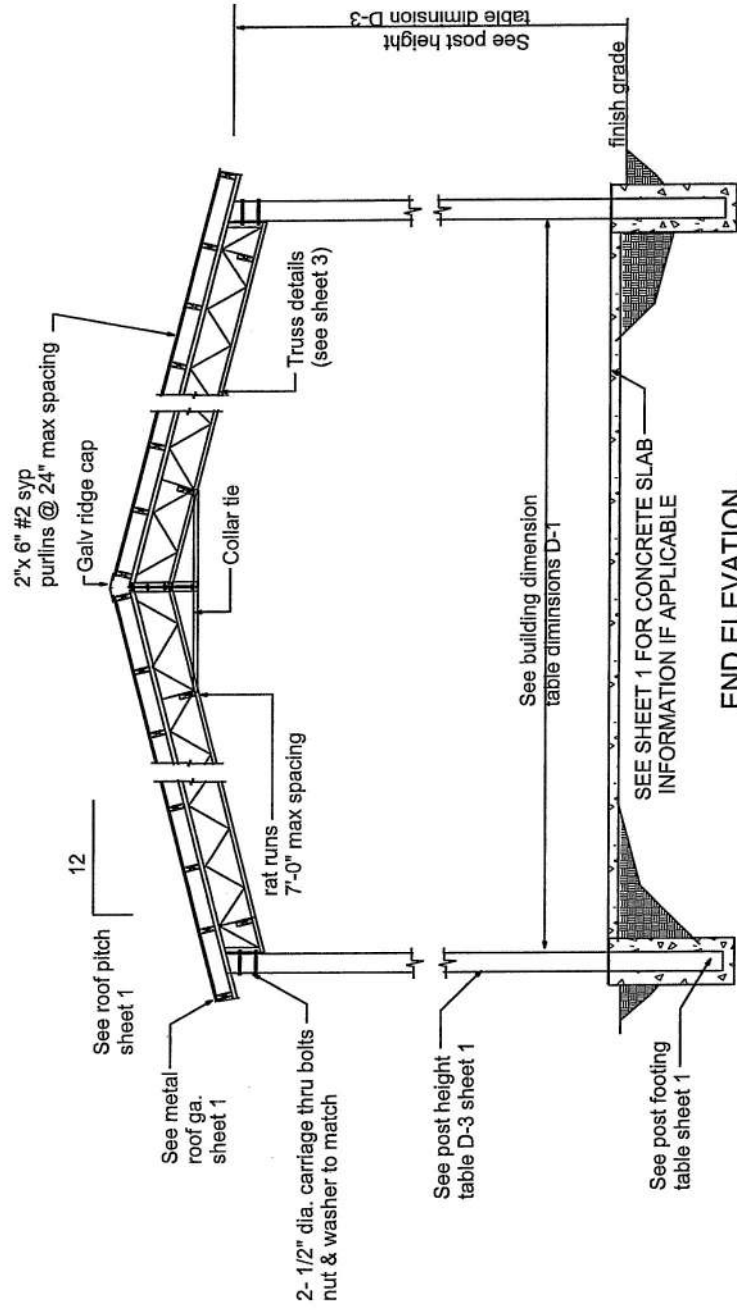

END ELEVATION

NTS

See post footing
table sheet 1

See building dimension
table dimensions D-1

See post height
table D-3 sheet 1

2- 1/2" dia. carriage thru bolts
nut & washer to match

See metal
roof ga.
sheet 1

See roof pitch
sheet 1

rat runs
7'-0" max spacing

Truss details
(see sheet 3)

Galv ridge cap

2" x 6" #2 syp
purlins @ 24" max spacing

See post height
table dimension D-3



Digitally
signed by

Michael E.

Driscoll PE


Date:

2024.03.27

11:59:24

-04'00'

POST FOOTING TO TRUSS DETAIL 1

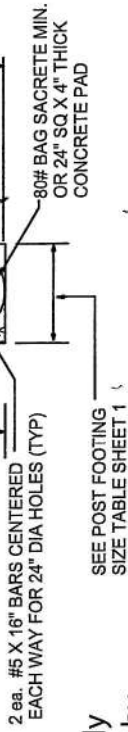

See post footing
size table sheet 1

SEE SHEET 1 FOR
CONCRETE
FOOTING INFORMATION
IF APPLICABLE

See post size
table sheet 1

See post height
table dimension D-3

2- 1/2" DIA. CARRIAGE BOLTS
NUT & WASHERS

2" x 6" #2 SYP PURLINS
@ 24" MAX SPACING

SEE METAL ROOFING
TABLE SHEET 1

TRUSS DETAILS
SEE SHEET 3

40x60x14 C&C

DB24-245

AIDA WHITEHOUSE
339 NW DAVID DRIVE
LAKE CITY, FL 32055


3-27-24

DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 357577
GAINESVILLE, FL 32606
PH (352) 331-1513
FX (352) 505-3366
CA 8690

Michael E Driscoll PE
FL Reg # 43922

THIS ITEM HAS BEEN ELECTRONICALLY
SIGNED AND SEALED BY MICHAEL E.
DRISCOLL, P.E. USING A SHA AUTHENTICATION
CODE. PRINTED COPIES OF THIS DOCUMENT ARE
NOT CONSIDERED SIGNED AND SEALED AND
THE SHA AUTHENTICATION CODE MUST BE
VERIFIED ON ANY ELECTRONIC COPIES ON 3-27-24


THIS ITEM HAS BEEN ELECTRONICALLY
SIGNED AND SEALED BY MICHAEL E.
DRISCOLL, P.E. USING A SHA AUTHENTICATION
CODE. PRINTED COPIES OF THIS DOCUMENT ARE
NOT CONSIDERED SIGNED AND SEALED AND
THE SHA AUTHENTICATION CODE MUST BE
VERIFIED ON ANY ELECTRONIC COPIES ON 3-27-24

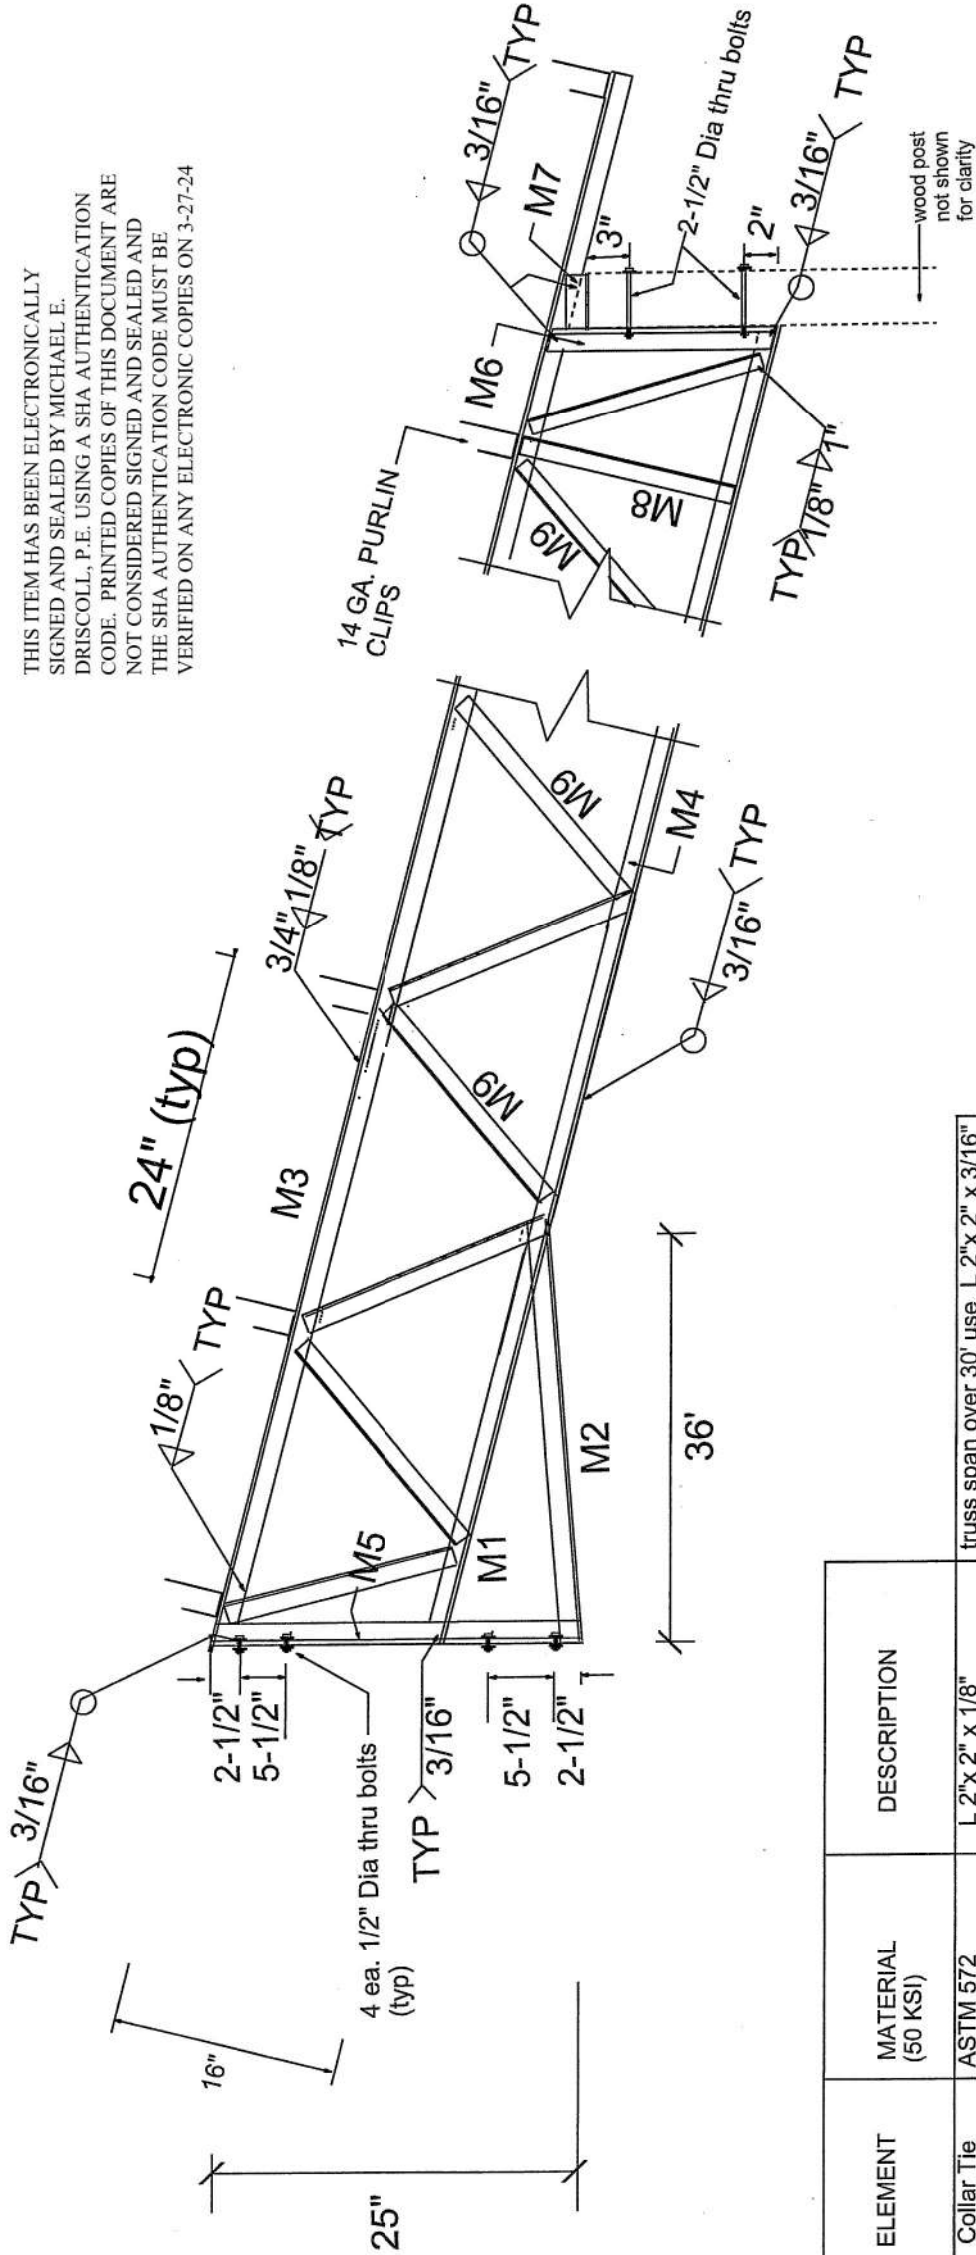

No.	ELEMENT	MATERIAL (50 KSI)	DESCRIPTION
M1	Collar Tie	ASTM 572	L 2"x 2" x 1/8"
M2	Collar Tie	ASTM 572	L 2"x 2" x 1/8"
M3	Top Chord	ASTM 572	L 2"x 2" x 1/8"
M4	Bottom Chord	ASTM 572	L 2"x 2" x 1/8"
M5	Center vertical	ASTM 572	L 2" x 2" x 3/16"
M6	End Vertical	ASTM 572	L 2" x 2" x 3/16"
M7	Bearing angle	ASTM 572	L 2" x 2" x 3/16"
M8	Inside vertical	ASTM 572	L 1-1/2" x 1-1/2" x 3/16"
M9	Diagonal web	ASTM 572	L 1-1/2" x 1-1/2" x 3/16"

NOTES:

- 1-MATERIALS SHALL CONFORM TO STEEL ASTM 572.
- 2- ALL STEEL SHALL BE 50ksi IN ACCORD WITH CURRENT AISC MANUAL.
- 3- WELDING ELECTRODES TYPE E70XX
- 4- ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWS REQUIREMENTS.
- 5-ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
- 6-BOLTS SHALL BE ASTM A325, w/ NUTS & WASHERS. (TYP)
- 7- WELD STRENGTH 70 KSI MIN.
- 8- ALL POST SHALL BE MIN. 1500lb PRESSURE TREATED GROUND CONTACT.
- 9- PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
- 10- MIN EDGE DISTANCE FOR BOLTS HOLES SHALL BE 3/4" MIN
- 11-MAX TRUSS SPACING SHALL NOT EXCEED 12'-0" UNO.
- 12-THE DESIGNER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF
POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBILITY OR
EXERCISES NO CONTROL WITH REGARD TO FABRICATION, HANDLING, AND INSTALLATION
OF TRUSSES.

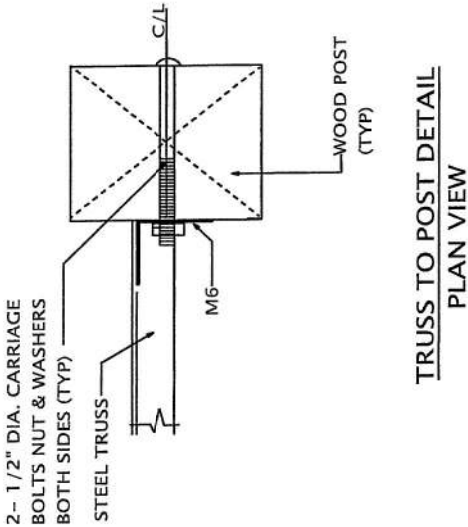

Digitally signed by
Michael E. Driscoll PE
Date: 2024.03.27
11:59:39 -04'00'

TRUSS DETAILS