

Freedom Forever Planset Revision Letter

7/6/2023 REV #3

Attn. Columbia County (FL):

The changes outlined in Revision Details have been applied to the plans corresponding to the following customer:

ROLANDO MUSTAFA 437 SW ROSEMARY DRIVE, LAKE CITY, FL 32024

Revision Details:

- 1. Module Swap from (64) CANADIAN SOLAR 395 to (64) FREEDOM FOREVER 400
- 2. Layout Changed

All corresponding changes are notated on the plans by revision clouds.

Thank you for your time in reviewing these plans. Please reach out if you have any additional questions or concerns.

Construction Engineering
Freedom Forever
engineering@freedomforever.com

ROOF MOUNT PHOTOVOLTAIC SYSTEM

CODES:

THIS PROJECT COMPLIES WITH THE FOLLOWING:

2020 7TH EDITION FLORIDA BUILDING CODE: BUILDING

2020 7TH EDITION FLORIDA BUILDING CODE: RESIDENTIAL

2020 7TH EDITION FLORIDA BUILDING CODE: MECHANICAL

2020 7TH EDITION FLORIDA BUILDING CODE: PLUMBING

2020 7TH EDITION FLORIDA BUILDING CODE: FUEL GAS

2020 7TH EDITION FLORIDA BUILDING CODE: ENERGY CONSERVATION

2020 7TH EDITION FLORIDA BUILDING CODE: EXISTING BUILDING

2020 7TH EDITION FLORIDA BUILDING CODE: ACCESSIBILITY

2020 7TH EDITION FLORIDA FIRE PREVENTION CODE

2017 NATIONAL ELECTRIC CODE

AS ADOPTED BY COLUMBIA COUNTY (FL)

VICINITY MAP:



TABLE OF CONTENTS:

PV-1 SITE LOCATION PV-2 SITE PLAN PV-2A ROOF PLAN WITH MODULES LAYOUT PV-2B ROOF AND STRUCTURAL TABLES PV-3 MOUNTING DETAILS PV-4 THREE LINE DIAGRAM PV-5 CONDUCTOR CALCULATIONS PV-6 EQUIPMENT & SERVICE LIST PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN APPENDIX MANUFACTURER SPECIFICATION SHEETS		
PV-2A ROOF PLAN WITH MODULES LAYOUT PV-2B ROOF AND STRUCTURAL TABLES PV-3 MOUNTING DETAILS PV-4 THREE LINE DIAGRAM PV-5 CONDUCTOR CALCULATIONS PV-6 EQUIPMENT & SERVICE LIST PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-1	SITE LOCATION
PV-2B ROOF AND STRUCTURAL TABLES PV-3 MOUNTING DETAILS PV-4 THREE LINE DIAGRAM PV-5 CONDUCTOR CALCULATIONS PV-6 EQUIPMENT & SERVICE LIST PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-2	SITE PLAN
PV-3 MOUNTING DETAILS PV-4 THREE LINE DIAGRAM PV-5 CONDUCTOR CALCULATIONS PV-6 EQUIPMENT & SERVICE LIST PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-2A	ROOF PLAN WITH MODULES LAYOUT
PV-4 THREE LINE DIAGRAM PV-5 CONDUCTOR CALCULATIONS PV-6 EQUIPMENT & SERVICE LIST PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-2B	ROOF AND STRUCTURAL TABLES
PV-5 CONDUCTOR CALCULATIONS PV-6 EQUIPMENT & SERVICE LIST PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-3	MOUNTING DETAILS
PV-6 EQUIPMENT & SERVICE LIST PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-4	THREE LINE DIAGRAM
PV-7 LABELS PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-5	CONDUCTOR CALCULATIONS
PV-7A SITE PLACARD PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-6	EQUIPMENT & SERVICE LIST
PV-8 OPTIMIZER CHART PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-7	LABELS
PV-9 SAFETY PLAN PV-10 SAFETY PLAN	PV-7A	SITE PLACARD
PV-10 SAFETY PLAN	PV-8	OPTIMIZER CHART
	PV-9	SAFETY PLAN
APPENDIX MANUFACTURER SPECIFICATION SHEETS	PV-10	SAFETY PLAN
	APPENDIX	MANUFACTURER SPECIFICATION SHEETS

CONSTRUCTION NOTES:

CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.

ALL SOLAR ENERGY SYSTEM EQUIPMENT SHALL BE SCREENED TO THE MAXIMUM EXTENT POSSIBLE AND SHALL BE PAINTED A COLOR SIMILAR TO THE SURFACE UPON WHICH THEY ARE MOUNTED.

MODULES SHALL BE TESTED, LISTED AND INDENTIFIED WITH FIRE CLASSIFICATION IN ACCORDANCE WITH UL 2703. SMOKE AND CARBON MONOXIDE ALARMS ARE REQUIRED PER SECTION R314 AND 315 TO BE VERIFIED AND INSPECTED BY INSPECTOR IN THE FIELD.

DIG ALERT (811) TO BE CONTACTED AND COMPLIANCE WITH EXCAVATION SAFETY PRIOR TO ANY EXCAVATION TAKING PLACE

PHOTOVOLTAIC SYSTEM GROUND WILL BE TIED INTO EXISTING GROUND AT MAIN SERVICE FROM DC DISCONNECT/INVERTER AS PER 2017 NEC SEC 250.166(A).

SOLAR PHOTOVOLTAIC SYSTEM EQUIPMENT WILL BE INSTALLED IN ACCORDANCE WITH REQUIREMENTS OF ART. 690 OF THE 2017 NEC

THE MAIN SERVICE PANEL WILL BE EQUIPPED WITH A GROUND ROD OR UFER

UTILITY COMPANY WILL BE NOTIFIED PRIOR TO ACTIVATION OF THE SOLAR PV SYSTEM

SOLAREDGE OPTIMIZERS ARE LISTED TO IEC 62109-1 (CLASS II SAFETY) AND UL 1741 STANDARDS

INSTALL CREW TO VERIFY ROOF STRUCTURE PRIOR TO COMMENCING WORK. EMT CONDUIT ATTACHED TO THE ROOF USING CONDUIT MOUNT.

THIS SYSTEM DESIGNED WITH:

WIND SPEED: 119 WIND EXPOSURE: C SNOW LOAD: 0



his item has been digitally signed and sealed by Michael Rieth on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



CLIENT: ROLANDO MUSTAFA 437 SW ROSEMARY DRIVE, LAKE CITY, FL

32024 AHJ: COLUMBIA COUNTY (FL)

UTILITY: FPL - FLORIDA PÒWÉR & LIGHT METER: ACD0676 PHONE: (973) 610-6389

EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM FINANCE: SUNRUN

VOTEM

SYSTEM:
SYSTEM SIZE (DC): 64 X 400 = 25.600 kW
SYSTEM SIZE (AC): 17.600 kW @ 240V
MODULES: 64 X FREEDOM FOREVER:
FF-MP-BBB-400

OPTIMIZERS: 64 X SOLAREDGE S440 INVERTER 1: SOLAREDGE SE10000H-USRGM [SI1]

INVERTER 2: SOLAREDGE SE7600H-USRGM [SI1]



	REVISIONS	
NO.	REVISED BY	DATE
1	S.G.	6/10/2023
2	A.S.	6/16/2023
3	A.G.	7/6/2023




FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO
FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT


CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

SITE LOCATION

JOB NO: DATE: DESIGNED BY: SI 341599 7/6/2023 A.G.



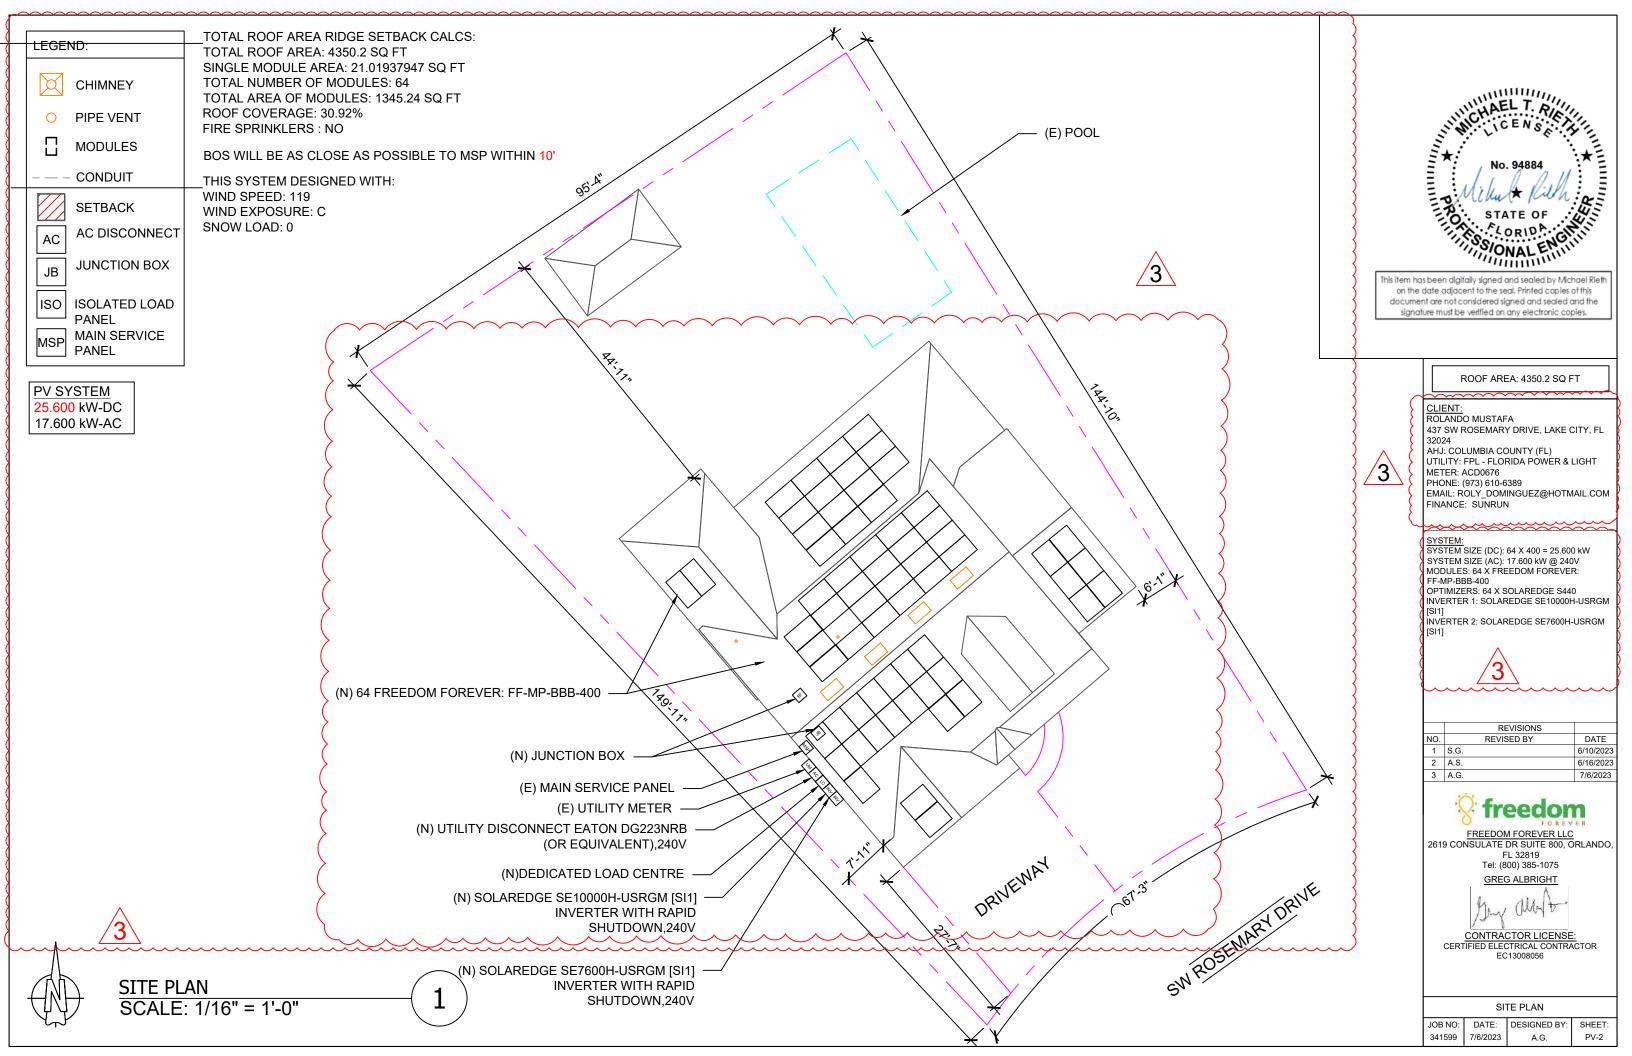

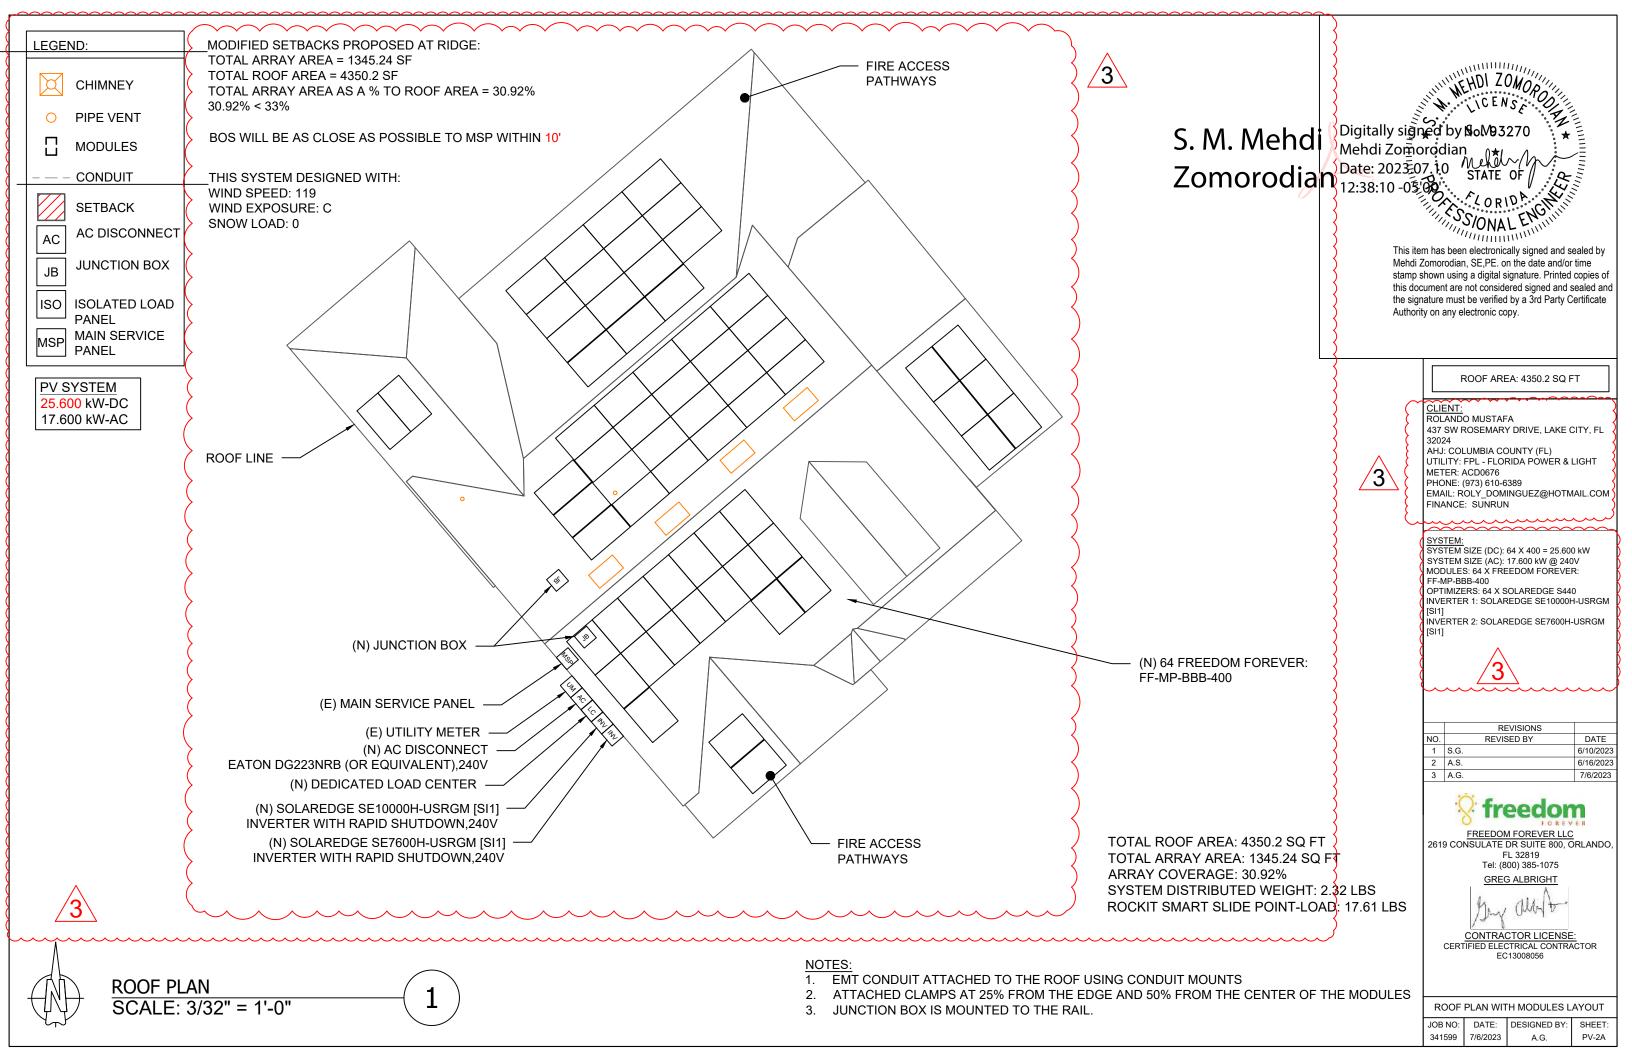


ROOF DETAILS:

TOTAL ROOF AREA: 4350.2 SQ FT TOTAL ARRAY AREA: 1345.24 SQFT

ARRAY COVERAGE: 30.92%

SYSTEM DISTRIBUTED WEIGHT: 2.32 LBS ROCKIT SMART SLIDE POINT-LOAD: 17.61 LBS

ROOF AREA STATEMENT									
ROOF	MODULE QUANTITY	ROOF PITCH	ARRAY PITCH	AZIMUTH	ROOF AREA	ARRAY AREA			
ROOF 1	19	30	30	140	937.67 SQ FT	399.37 SQ FT			
ROOF 2	1	30	30	230	137.66 SQ FT	21.02 SQ FT			
ROOF 3	22	30	30	320	974.82 SQ FT	462.43 SQ FT			
ROOF 4	15	20	20	320	697.53 SQ FT	315.29 SQ FT			
ROOF 5	5	30	30	141	246.37 SQ FT	105.1 SQ FT			
ROOF 6	2	35	35	230	221.37 SQ FT	42.04 SQ FT			
					SQ FT	SQ FT			
					SQ FT	SQ FT			
					SQ FT	SQ FT			
					SQ FT	SQ FT			



This item has been electronically signed and sealed by Mehdi Zomorodian, SE,PE. on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.



CLIENT: ROLANDO MUSTAFA 437 SW ROSEMARY DRIVE, LAKE CITY, FL 32024

AHJ: COLUMBIA COUNTY (FL)
UTILITY: FPL - FLORIDA POWER & LIGHT METER: ACD0676

PHONE: (973) 610-6389 EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM

FINANCE: SUNRUN

SYSTEM: SYSTEM SIZE (DC): 64 X 400 = 25.600 kW SYSTEM SIZE (AC): 17.600 kW @ 240V MODULES: 64 X FREEDOM FOREVER: FF-MP-BBB-400 OPTIMIZERS: 64 X SOLAREDGE S440
INVERTER 1: SOLAREDGE SE10000H-USRGM

INVERTER 2: SOLAREDGE SE7600H-USRGM



	REVISIONS	
NO.	REVISED BY	DATE
1	S.G.	6/10/2023
2	A.S.	6/16/2023
3	A.G.	7/6/2023



FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO FL 32819 Tel: (800) 385-1075 **GREG ALBRIGHT**

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR EC13008056

PV-2B


B NO:	DATE:	DESIGNED BY:
1599	7/6/2023	A.G.

				TABLE 1 - ARRAY INST	FALLATION				
	ROOF PITCH	ROOFING TYPE	ATTACHMENT TYPE	FRAMING TYPE1	MAX UNBRACED LENGTH(FT.)1	RAFTER/TRUSS SISTERING	PENETRATION PATTERN2	MAX ATTACHMENT SPACING (IN.)2	MAX RAIL OVERHANG(N.)3
ROOF 1	30	COMP SHINGLE	ECOFASTEN ROCKIT SMART SLIDE	2X4 TRUSS @ 24" OC	8.00'	NOT REQ'D	STAGGERED	48" OC	16"
ROOF 2	30	COMP SHINGLE	ECOFASTEN ROCKIT SMART SLIDE	2X4 TRUSS @ 24" OC	8.00'	NOT REQ'D	STAGGERED	48" OC	16"
ROOF 3	30	COMP SHINGLE	ECOFASTEN ROCKIT SMART SLIDE	2X4 TRUSS @ 24" OC	8.00'	NOT REQ'D	STAGGERED	48" OC	16"
ROOF 4	20	COMP SHINGLE	ECOFASTEN ROCKIT SMART SLIDE	2X4 TRUSS @ 24" OC	8.00'	NOT REQ'D	STAGGERED	48" OC	16"
ROOF 5	30	COMP SHINGLE	ECOFASTEN ROCKIT SMART SLIDE	2X4 TRUSS @ 24" OC	8.00'	NOT REQ'D	STAGGERED	48" OC	16"
ROOF 6	35	COMP SHINGLE	ECOFASTEN ROCKIT SMART SLIDE	2X4 TRUSS @ 24" OC	8.00'	NOT REQ'D	STAGGERED	48" OC	16"
			<u> </u>						
		<u> </u>				<u> </u>			



^{2.} WHERE COLLAR TIES OR RAFTER SUPPORTS EXIST, CONTRACTOR SHALL USE RAFTERS WITH COLLAR TIES AS ATTACHMENT POINTS.



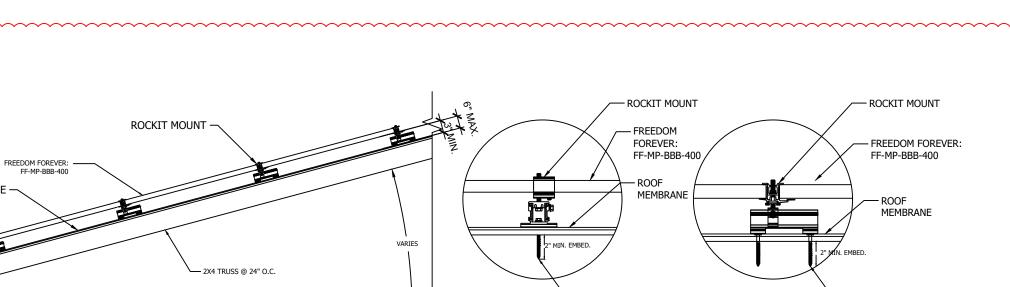

SOLAR PV ARRAY SECTION VIEW

- 2 x #12 WOOD SCREW WITH 2" MIN. EMBEDMENT AND FLAT WASHER

- SKIRT


ROOF SURFACE


Scale: NTS

ATTACHMENT DETAIL

Scale: NTS

2 x #12 WOOD SCREW WITH 2" MIN. EMBEDMENT AND FLAT WASHER

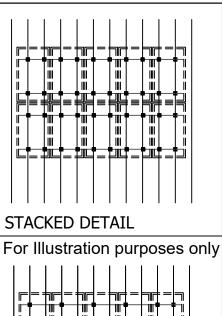



STAGGERED DETAIL

2 x #12 WOOD SCREW WITH 2" MIN. EMBEDMENT AND FLAT WASHER

For Illustration purposes only



CLIENT: ROLANDO MUSTAFA 437 SW ROSEMARY DRIVE, LAKE CITY, FL

LICENS OF

This item has been electronically signed and sealed by

Mehdi Zomorodian, SE,PE. on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate

Authority on any electronic copy.

AHJ: COLUMBIA COUNTY (FL)
UTILITY: FPL - FLORIDA POWER & LIGHT METER: ACD0676

PHONE: (973) 610-6389 EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM

FINANCE: SUNRUN

SYSTEM:
SYSTEM SIZE (DC): 64 X 400 = 25.600 kW
SYSTEM SIZE (AC): 17.600 kW @ 240V
MODULES: 64 X FREEDOM FOREVER:

OPTIMIZERS: 64 X SOLAREDGE S440 INVERTER 1: SOLAREDGE SE10000H-USRGM

INVERTER 2: SOLAREDGE SE7600H-USRGM



	REVISIONS	
NO.	REVISED BY	DATE
1	S.G.	6/10/2023
2	A.S.	6/16/2023
3	A.G.	7/6/2023




2619 CONSULATE DR SUITE 800, ORLANDO FL 32819 Tel: (800) 385-1075 GREG ALBRIGHT

CONTRACTOR LICENSE: CERTIFIED ELECTRICAL CONTRACTOR EC13008056

MOUNTING DETAILS

341599 PV-3 7/6/2023 A.G.

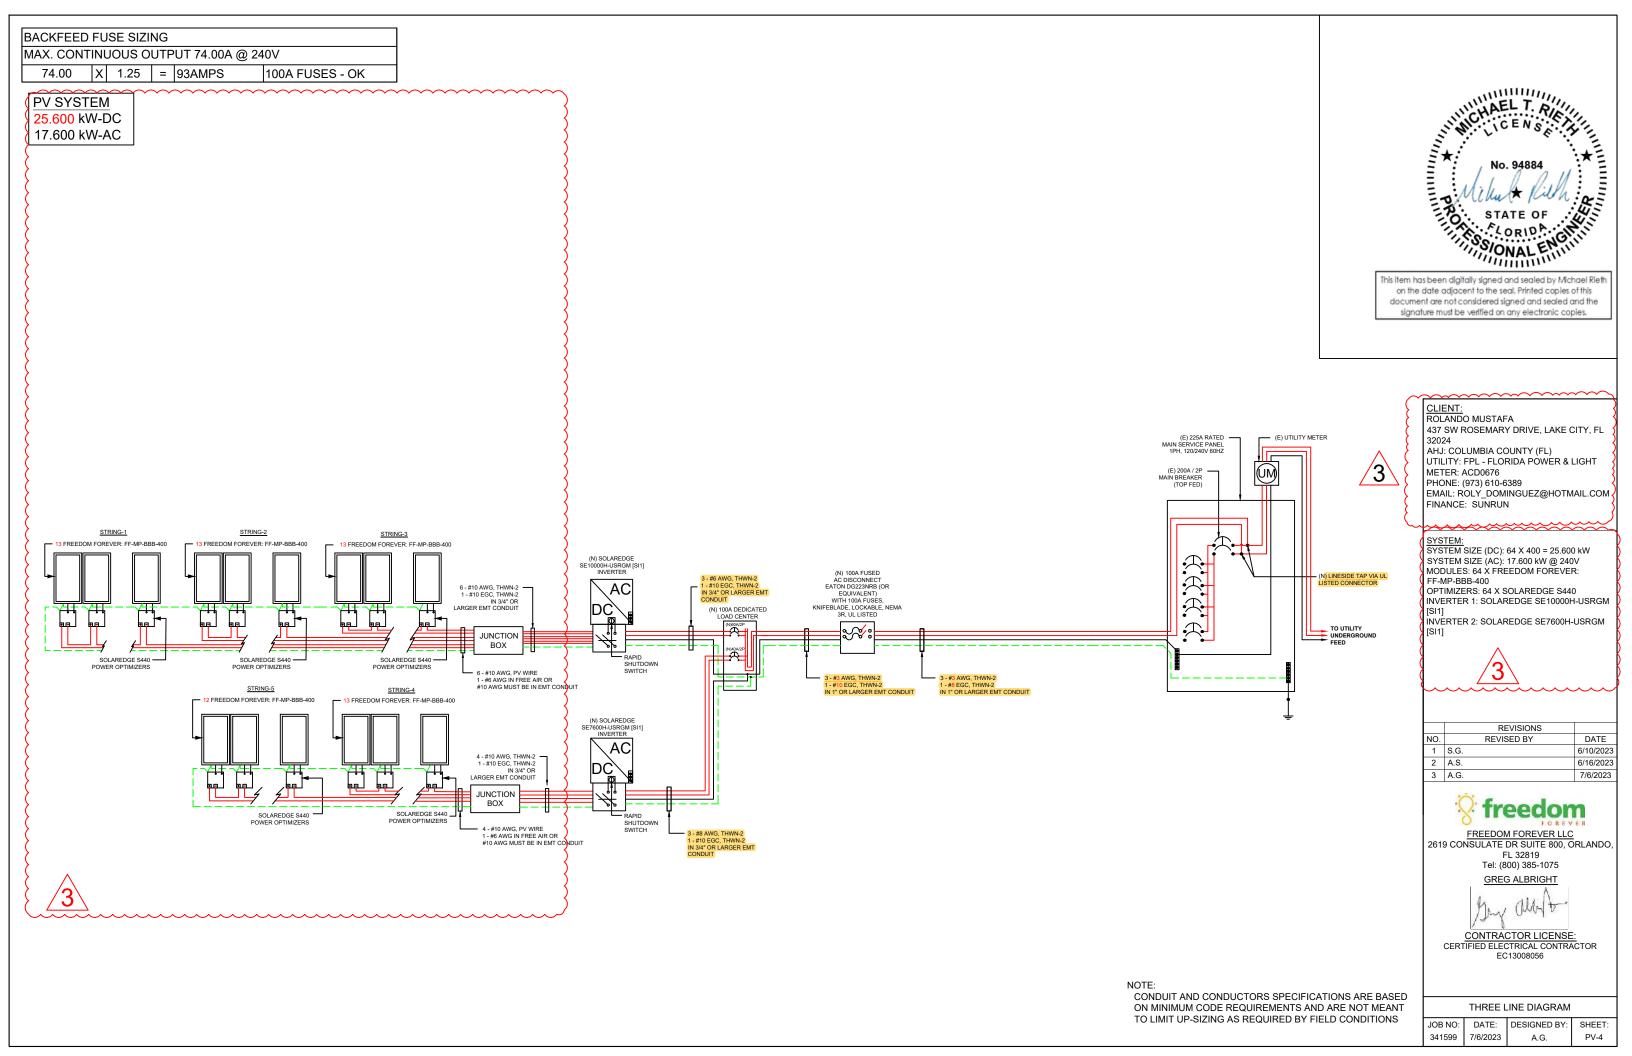

This item has been digitally signed and sealed by Michael Rieth on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

	/	\
/		•
_/	.1	5
/	•	

					WIRE	SCHEDU	JLE					
RACEWAY #		EQUIF	PMENT		CONDUCTOR QTY.	AWG WIRE SIZE	STARTING ALLOWABLE AMPACITY @ 90°C 310.15(B)(16)	STARTING CURRENT APPLIED TO CONDUCTORS IN RACEWAY	TEMPERATURE CORRECTION FACTOR 310.15(B)(2)(a)	ADJUSTMENT FACTOR FOR MORE THAN 3 CONDUCTORS 310.15(B)(3)(a)	ADJUSTED CONDUCTOR AMPACITY @ 90°C	MAXIMUM CURRENT APPLIED TO CONDUCTORS IN RACEWAY
1	DC	MODULE	ТО	OPTIMIZER	2	10	40	17.24	0.96	1	38.40	21.55
2	DC	OPTIMIZER	ТО	JUNCTION BOX	2	10	40	15.00	0.96	1	38.40	18.75
3	DC	JUNCTION BOX	ТО	INVERTER 1	6	10	40	15.00	0.96	0.8	30.72	18.75
4	DC	JUNCTION BOX	ТО	INVERTER 2	4	10	40	15.00	0.96	0.8	30.72	18.75
5	AC	INVERTER 1	ТО	DEDICATED LOAD CENTER	3	6	75	42.00	0.96	1	72.00	52.50
6	AC	INVERTER 2	ТО	DEDICATED LOAD CENTER	3	8	55	32.00	0.96	1	52.80	40.00
7	AC	DEDICATED LOAD CENTER	ТО	AC DISCONNECT	3	3	115	74.00	0.96	1	110.40	92.50
8	AC	AC DISCONNECT	то	POI	3	3	115	74.00	0.96	1	110.40	92.50
			$\overline{}$									

CONDUCTOR AMPACITY CALCULATIONS IN ACCORDANCE WITH NEC 690.8.



CLIENT: ROLANDO MUSTAFA 437 SW ROSEMARY DRIVE, LAKE CITY, FL AHJ: COLUMBIA COUNTY (FL)
UTILITY: FPL - FLORIDA POWER & LIGHT METER: ACD0676

PHONE: (973) 610-6389
EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM

FINANCE: SUNRUN

SYSTEM: SYSTEM SIZE (DC): 64 X 400 = 25.600 kW SYSTEM SIZE (AC): 17.600 kW @ 240V MODULES: 64 X FREEDOM FOREVER: FF-MP-BBB-400
OPTIMIZERS: 64 X SOLAREDGE S440
INVERTER 1: SOLAREDGE SE10000H-USRGM

INVERTER 2: SOLAREDGE SE7600H-USRGM



	REVISIONS	
NO.	REVISED BY	DATE
1	S.G.	6/10/2023
2	A.S.	6/16/2023
3	A.G.	7/6/2023



FREEDOM FOREVER LLC 2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819 Tel: (800) 385-1075 **GREG ALBRIGHT**

CONTRACTOR LICENSE: CERTIFIED ELECTRICAL CONTRACTOR EC13008056

CONDUCTOR CALCULATIONS							
		DESIGNED BY:	SHE				
11599	7/6/2023	A.G.	PV-				

OCPD SIZES:		SERVICE LIST:				
100A FUSES		NONE				
100/11 0020		THORE .				
MATERIAL LIST:	/3					
~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~		<del>7</del> 000000000000000000000000000000000000				
QTY. PART	PART #	DESCRIPTION				
64 MODULES	PV-110-400	FREEDOM FOREVER: FF-MP-BBB-400				
64 OPTIMIZERS	OPT-130-440-2	SOLAREDGE S440 POWER OPTIMIZER - FRAME MOUNTED MODULE ADD-ON				
1 FITTINGS/ANCHORS	RAC-260-049	600VDC NEMA 3R UL LISTED JUNCTION BOX				
2 ELECTRICAL ACCESSORIES	EA-350-326	STAUBLI / MULTI-CONTACT MC4 CONNECTORS (FEMALE)				
2 EQUIPMENT ACCESSORIES	EA-350-320 EA-350-327	STAUBLI / MULTI-CONTACT MC4 CONNECTORS (MALE)				
		SE10000H-US [SI1] RGM 240V INVERTER UL1741 SA CERTIFIED INTEGRATED ARC FAULT PROTECTION AND RAPID SHUTDOWN				
1 INVERTERS	INV-120-108					
1 INVERTERS	INV-120-768	SE7600H-US [SI1] RGM 240V INVERTER UL1741 SA CERTIFIED INTEGRATED ARC FAULT PROTECTION AND RAPID SHUTDOWN				
1 LOAD CENTERS/MAIN PANELS	EE-151-100-NA	100A DEDICATED LOAD CENTER				
1 DISCONNECTS	EE-321-101	100A RATED 240VAC NEMA 3R UL LISTED				
2 FUSES	BR-330-100	100A FUSE 1 PH 240VAC				
3 ELECTRICAL ACCESSORIES	EA-350-113	IDEAL B-TAP 4/0-10 AWG				
177 FITTINGS/ANCHORS	RAC-265-034	ROCKIT SMART SLIDE				
46 FOOTINGS	RAC-241-253-NS	ROCKIT TRIM COMP DARK				
120 FITTINGS/ANCHORS	RAC-261-603-NS	ROCKIT KLIDER COMP DARK				
36 ENDS/MIDS	RAC-221-100-NS	N/S BONDING CLAMP				
14 FOOTINGS	RAC-241-404-NS	TRIM BONDING CLAMP				
68 FOOTINGS	RAC-241-405-NS	MLPE MOUNT ASSY				
38 FITTINGS/ANCHORS	RAC-261-604-NS	ROCKIT SPLICE				
9 RAILS	RAC-211-101-NS	ATTACHED SPLICE 8 INCH				
53 FITTINGS/ANCHORS	RAC-261-606-NS	TRIMRAIL UNIV CLIP W/ HDW				
16 FITTINGS/ANCHORS	RAC-261-605-NS	TRIM SPLICE DRK				
28 RAILS	RAC-211-116-NS	TRIMRAIL UNIV DRK				
64 FITTINGS/ANCHORS	RAC-260-587	ILSCO GROUND LUG				
64 ENDS/MIDS	RAC-221-200-NS	ROCKIT TRIM END CAPS				
354 SCREW	RAC-265-035	ROCKIT SCREW #12X3				
***************************************	1110 200 000	The state of the s				
		+				
1	•					



This item has been digitally signed and sealed by Michael Rieth on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



CLIENT: ROLANDO MUSTAFA 437 SW ROSEMARY DRIVE, LAKE CITY, FL 32024

AHJ: COLUMBIA COUNTY (FL)
UTILITY: FPL - FLORIDA POWER & LIGHT METER: ACD0676 PHONE: (973) 610-6389

EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM FINANCE: SUNRUN

| SYSTEM: | SYSTEM SIZE (DC): 64 X 400 = 25.600 kW | SYSTEM SIZE (AC): 17.600 kW @ 240V | MODULES: 64 X FREEDOM FOREVER: FF-MP-BBB-400 OPTIMIZERS: 64 X SOLAREDGE S440 INVERTER 1: SOLAREDGE SE10000H-USRGM

INVERTER 2: SOLAREDGE SE7600H-USRGM



	REVISIONS					
NO.	REVISED BY	DATE				
1	S.G.	6/10/2023				
2	A.S.	6/16/2023				
3	A.G.	7/6/2023				



FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819

Tel: (800) 385-1075 **GREG ALBRIGHT** 


CONTRACTOR LICENSE: CERTIFIED ELECTRICAL CONTRACTOR EC13008056


**EQUIPMENT & SERVICE LIST** JOB NO: DATE: DESIGNED BY:

341599 7/6/2023

A.G.

PV-6

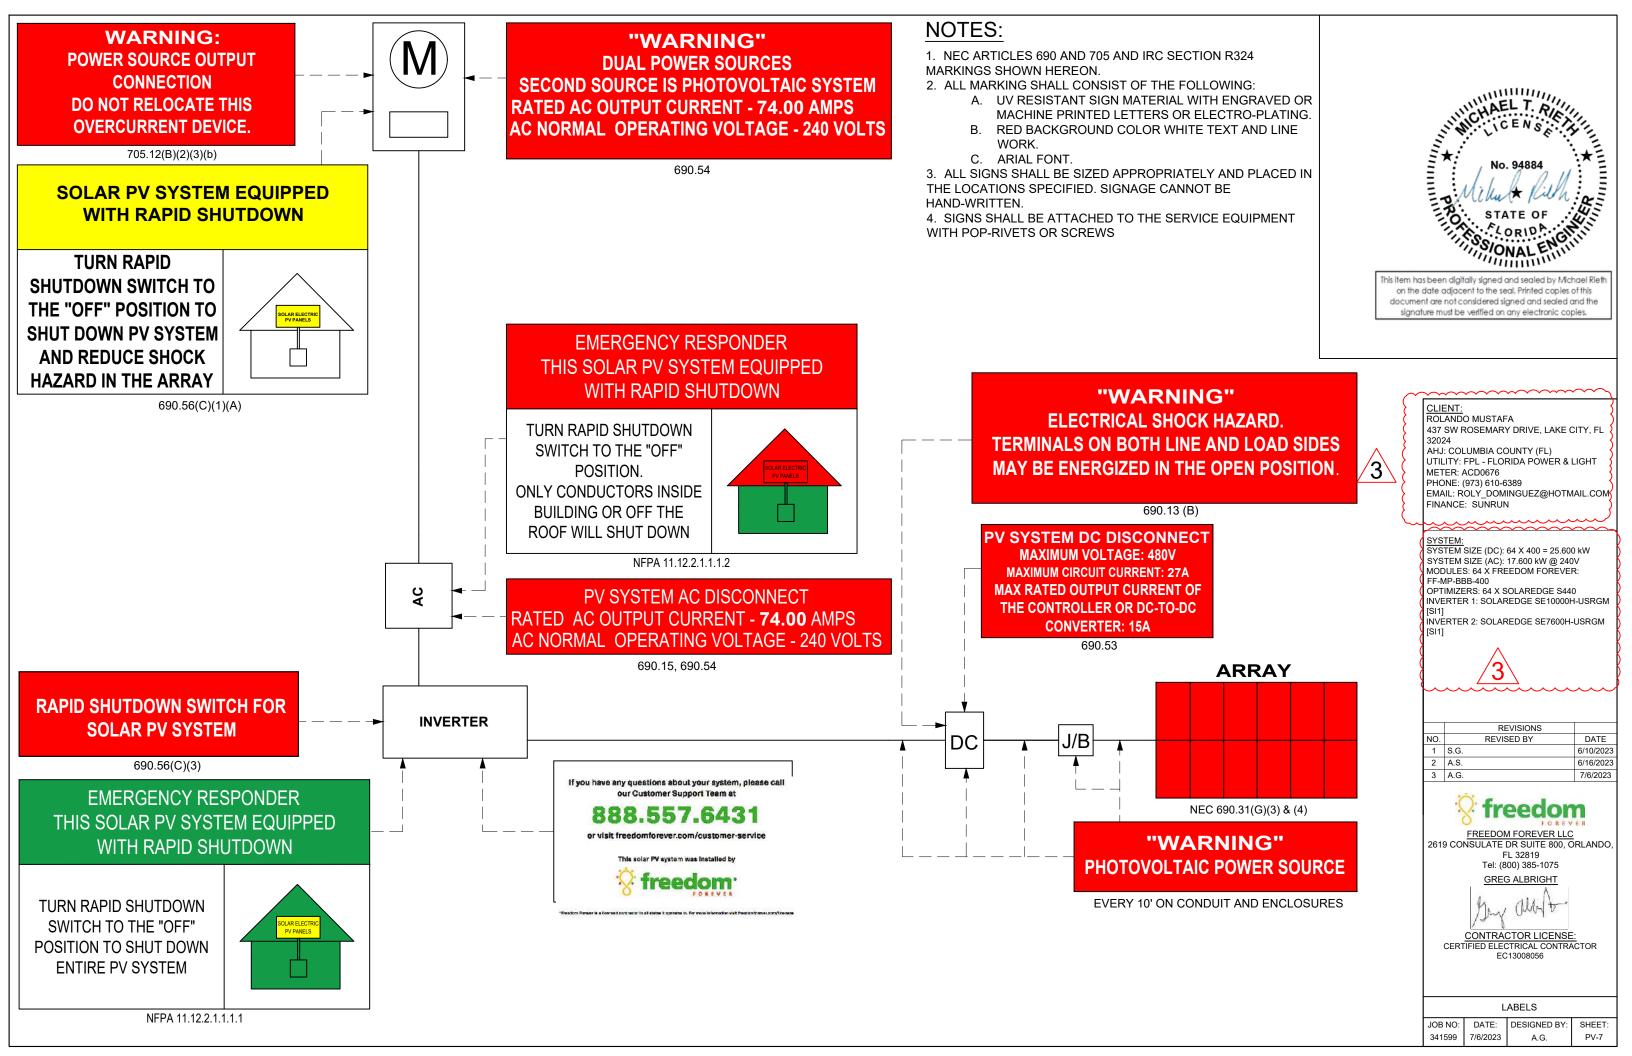

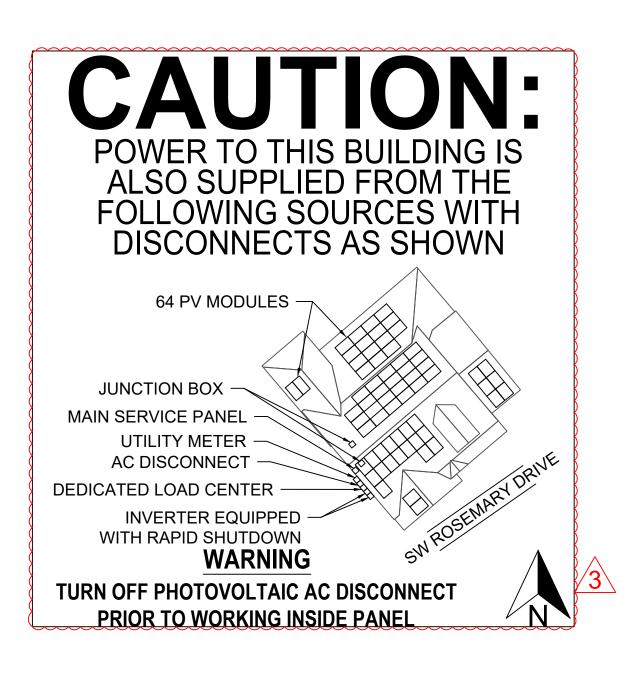

## **NOTES:**

- 1. NEC ARTICLES 690 AND 705 AND IRC SECTION R324 MARKINGS SHOWN HEREON.
- 2. ALL MARKING SHALL CONSIST OF THE FOLLOWING:
  - A. UV RESISTANT SIGN MATERIAL WITH ENGRAVED OR MACHINE PRINTED LETTERS OR ELECTRO-PLATING.
  - B. RED BACKGROUND COLOR WHITE TEXT AND LINE WORK.
  - C. AERIAL FONT.
- 3. ALL SIGNS SHALL BE SIZED APPROPRIATELY AND PLACED IN THE LOCATIONS SPECIFIED. SIGNAGE CANNOT BE HAND-WRITTEN.
- 4. SIGNS SHALL BE ATTACHED TO THE SERVICE EQUIPMENT WITH POP-RIVETS OR SCREWS.



on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



ROLANDO MUSTAFA

437 SW ROSEMARY DRIVE, LAKE CITY, FL

AHJ: COLUMBIA COUNTY (FL) UTILITY: FPL - FLORIDA POWER & LIGHT

METER: ACD0676 PHONE: (973) 610-6389

EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM

SYSTEM SIZE (DC): 64 X 400 = 25.600 kW SYSTEM SIZE (AC): 17.600 kW @ 240V MODULES: 64 X FREEDOM FOREVER:

OPTIMIZERS: 64 X SOLAREDGE S440 INVERTER 1: SOLAREDGE SE10000H-USRGM

INVERTER 2: SOLAREDGE SE7600H-USRGM



	REVISIONS	
NO.	REVISED BY	DATE
1	S.G.	6/10/2023
2	A.S.	6/16/2023
3	A.G.	7/6/2023




FL 32819 Tel: (800) 385-1075

CERTIFIED ELECTRICAL CONTRACTOR EC13008056

SITE PLACARD

341599 7/6/2023

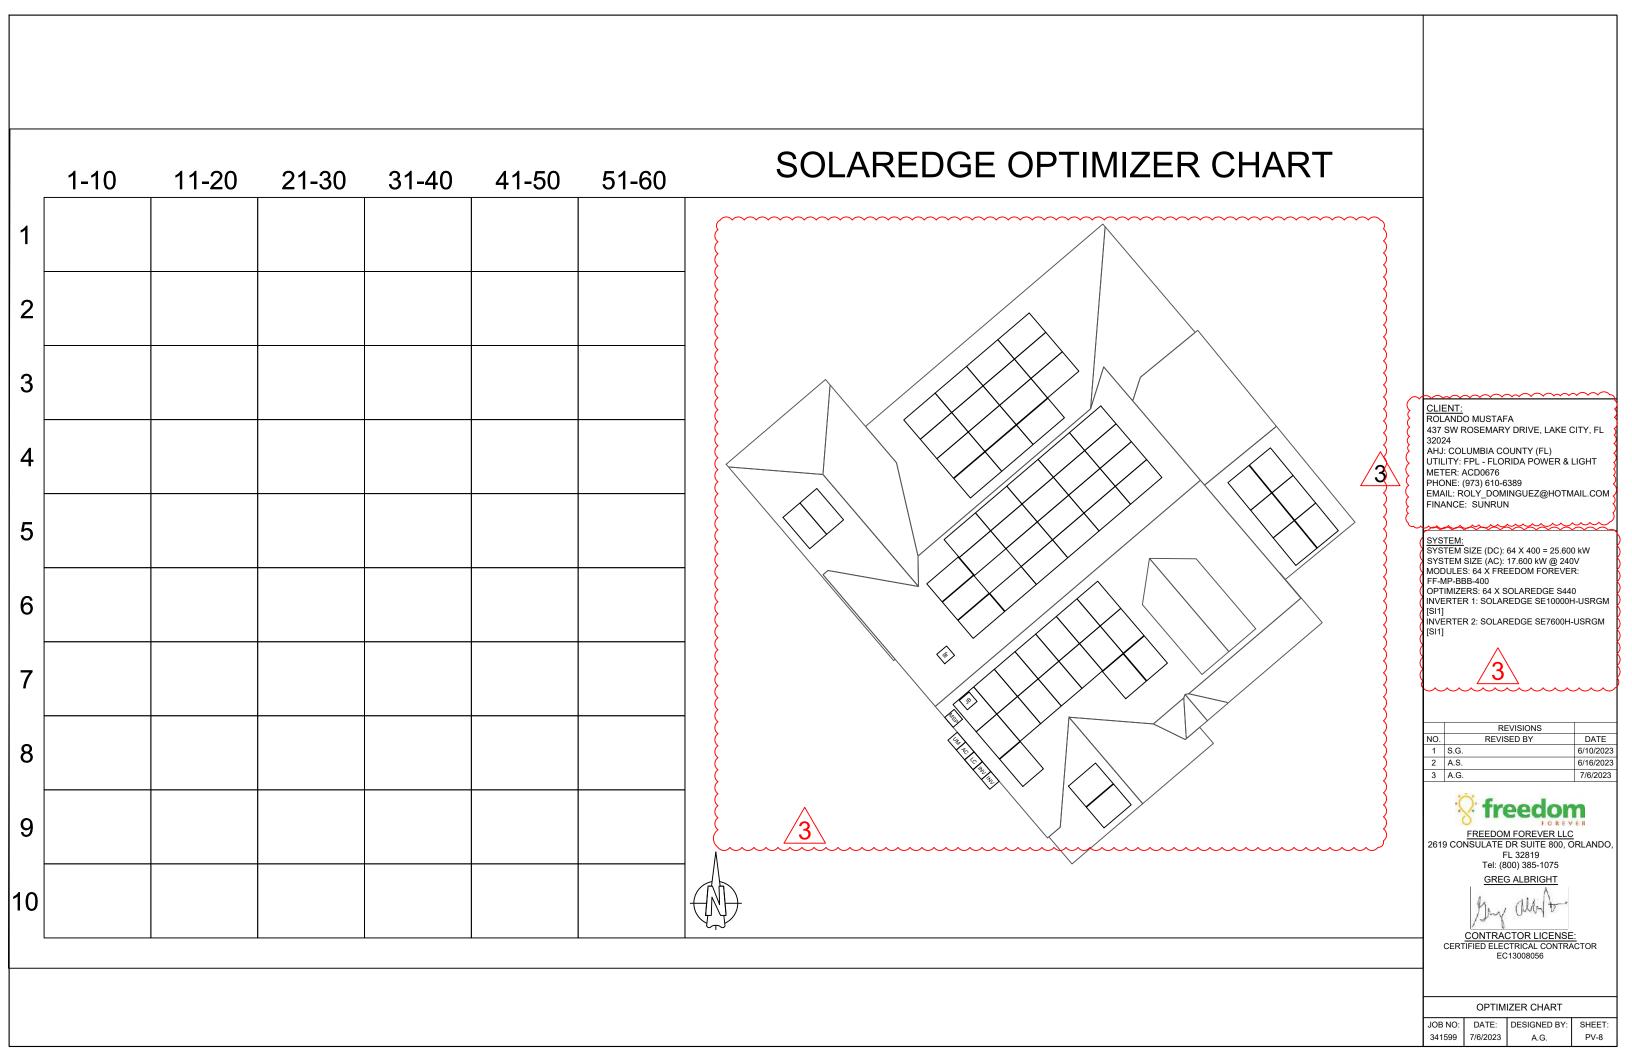

# SAFETY PLAN

#### INSTRUCTIONS:

- USE SYMBOLS IN KEY TO MARK UP THIS SHEET.
- SAFETY PLAN MUST BE MARKED BEFORE JOB STARTS AS PART OF THE
- DOCUMENT ALL ADDITIONAL HAZARDS ON THIS PAGE & MAKE NOTES ON THE JHA SHEET

## **INCIDENT REPORTING:**

**INJURIES - CALL INJURY HOTLINE** 

## (855) 400-7233

*If injury is life threatening, call 911 first THEN the Injury Hotline

NON-INJURIES - USE MOBILE INCIDENT REPORTING (Auto, Property Damage, Near Miss)

**NEAREST OCCUPATIONAL/INDUSTRIAL CLINIC:** 




NAME

DATE:

NAME:
ADDRESS:
NEAREST HOSPITAL:
NAME:
ADDRESS:
SAFETY COACH CONTACT INFORMATION:
NAME:
PHONE NUMBER:
ALL EMPLOYEES ON SITE SHALL BE MADE AWARE OF THE SAFETY PLAN AND SIGN INDICATING THAT THEY ARE AWARE OF THE HAZARDS ON-SITE AND THE PLAN FOR WORKING SAFELY.

TIME:

**SIGNATURE** 

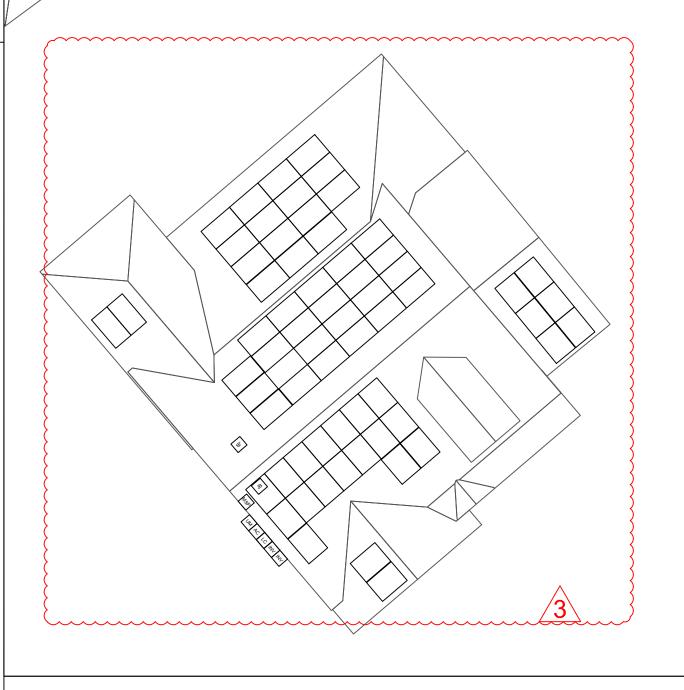

## MARK UP KEY

- PERMANENT ANCHOR
- **TEMPORARY ANCHOR**
- **INSTALLER LADDER**
- JUNCTION / COMBINER BOX В
- S STUB-OUT
- SKYLIGHT
  - NO LADDER ACCESS (STEEP **GRADE OR GROUND LEVEL OBSTRUCTIONS**)
- **RESTRICTED ACCESS**
- **GAS SHUT OFF** (GAS)

CONDUIT

- WATER SHUT OFF
- SERVICE DROP
- **POWER LINES**

CLIENT:

ROLANDO MUSTAFA

437 SW ROSEMARY DRIVE, LAKE CITY, FL

AHJ: COLUMBIA COUNTY (FL) UTILITY: FPL - FLORIDA POWER & LIGHT

METER: ACD0676 PHONE: (973) 610-6389

EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM FINANCE: SUNRUN

SYSTEM: SYSTEM SIZE (DC): 64 X 400 = 25.600 kW SYSTEM SIZE (AC): 17.600 kW @ 240V MODULES: 64 X FREEDOM FOREVER:

OPTIMIZERS: 64 X SOLAREDGE S440 INVERTER 1: SOLAREDGE SE10000H-USRGM


INVERTER 2: SOLAREDGE SE7600H-USRGM



## **BREAK AND WATER LOG**

THIS LOG IS TO BE FILLED OUT ANY TIME THE TEMP EXCEEDS 90 DEGREES. THE CREW LEAD AND ROOF LEAD ARE RESPONSIBLE FOR ENSURING THIS IS COMPLETED AND UPLOADED AT THE END OF EVERYDAY WHEN TEMPS EXCEED 90 DEGREES

										1
NAME	0800HRS	0900HRS	1000HRS	1100HRS	1200HRS	1300HRS	1400HRS	1500HRS	1600HRS	
										2
	I	I	I	I	I	I				1 1/



REVISIONS

2619 CONSULATE DR SUITE 800, ORLANDO FL 32819 Tel: (800) 385-1075

GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR EC13008056

SAFETY PLAN

341599

DATE: DESIGNED BY: 7/6/2023

## **JOB HAZARD ANALYSIS**

Crew leader to fill out all sections below, hold a pre-job safety meeting with all personnel, and upload this completed document and the Safety Plan to Site Capture

#### Ladder Access

- Ladders must be inspected before each use.
- Extension ladders must be set up on a firm and level surface at a 4-to-1 rise to run angle (or 75 degrees) and the top must be secured to the structure. Extension style ladders placed on uneven, loose or slippery surfaces must additionally have the base firmly anchored or lashed so the base will not slip out.
- Extension ladders must be used with walk-through devices or the ladder must extend 36" above the stepping off point.
- A-frame ladders must only be climbed with the ladder spreader bars locked in the open position; A-frame ladders shall not be climbed while in the closed position (ex, closed and used while leaned against a structure).
- Additional notes:

## Mobile Equipment

- Only Qualified operators will operate equipment; operators must maintain a certification on their person for the equipment being operated
- Type(s) of mobile equipment (Type/Make/Model):
- Qualified operator(s):

#### Material Handling and Storage

 Materials will be staged/stored in a way that does not present a hazard to client, personnel or public. Materials stored on the roof will be physically protect from failing or sliding off.

#### Fall Protection

- A site-specific plan for fall prevention and protection is required prior to starting work and must remain onsite at all times until work is complete; a fall rescue plan must be outlined and discussed among the crew prior to work start.
- First-person-Up (FPU) must install their anchor and connect before any other task, including installing other anchors. The Last-Person-Down (LPD) must be the only person on a roof uninstalling fall protection.
- FPCP (name and title):
- FPU and LPD (name and title):

## **Electrical Safety**

- The Electrical Qualified Person (EQP) is required onsite to perform electrical work.
- All electrical work will be performed with equipment in an electrically safe condition (de-energized) unless approval has been granted prior to work.
- Service drops and overhead electrical hazards will be indentified and protected from contact, as neccessary.
- EQP (name and tile):

#### **Public Protection**

- The safety of the Client and Public must be maintained at all times.
- The Client and the Public shall be prevented from entering the work zone through the use of barriers and/or signage, as required.
- Company, Client and Public property shall be protected from falling objects.
- Pets (including dogs) shall be secured by their owners prior to work start.
- The Client should not leave pets, family members, or others in charge or care of Employees, Contractors, or Temporary Workers.

- Crew leader responsible for communication with the client:
- Client and public is excluded from work area by barricades (N/A, Yes, No):

## Training and Pre-Job Safety Briefing

- All employees onsite shall be made aware of the specific hazards
  of this project and review this HJA during a pre-job briefing, and
  their signature indicates awareness of site conditions and the
  plan to eliminate any hazards identified prior to and during the
  project.
- Crew leader (name/title):
- Crew member (name/title):

## Airborne Contaminants:

- Asbestos-containing (Transite) piping (ACP) Do not disturb (move, drill, cut fracture, etc.)
- Asbestos-containing thermal insulation (ACI) and Asbestos-containing duct wrapping (ACW) - do not disturb, no attic or crawlspace access is allowed if work to be performed could cause exposure to personnel, client or public.
- If yes, list specific tasks and protection in place:

#### Weather and Environment

- The site supervisor shall forecast the weather conditions at the job site, prior to crew arrival, in order to mitigate any hazards associated with inclement weather (heat, cold, wind, rain, etc.)
- The site supervisor will utilized a portable wind meter (anemometer) to verify actual onsite wind conditions, by checking at the ground and on any elevated work surface (ex, rooftop) prior to work start, at midday and prior to solar panel staging on a roof.
- Elevated work involving the moving or maneuvering of solar panels shall cease at 25mph (sustained wind) until wind subsides
- Forecasted weather maximum temp (degrees f):

#### Heat Related Illness Prevention

- Employees shall have access to potable drinking water that is fresh, pure, and suitably cool. The water shall be located as close as practicable to the areas where employees are working. Water shall be supplied in sufficient quantity at the beginning of the work shift to provide at least one quart per employee per hour for drinking for the entire shift. Employees may begin the shift with smaller quantities of water if they identify the location and have effective means for replenishment during the shift to allow employees to drink on quart or more per hour. The frequent drinking of water shall be encouraged.
- Shade shall be present when temperature exceeds 80 degrees Fahrenheit. When the outdoor temperature in the work exceeds 80 degrees Fahrenheit, employees shall have and maintain one or more areas with shade at all times.
- New employees must be acclimatized. New employees will be monitored by their Crew Leader (site supervisor) for the first two (2) weeks of employment or longer when necessary.
- Employees will be allowed and encouraged to implement scheduled breaks during each shift. Employees must take cool-down breaks in the shade any time they feel the need to do so to protect them from overheating. Supervisors are REQUIRED to allow employees any break period they need during high heat conditions.
- Cool Vests are encouraged for all employees at all times during periods of high heat.
- Identify the location of the closet Occupational/Industrial Clinic or Hospital in case a crew member becomes ill.

What is the specific plan to provide and replenish sufficient water for all employees on site?

- If offsite replenish is necessary, where will you go to replenish water (location/address):
- Who will replenish the drinking water (name):

#### Restroom facilities

- Employees shall have access to restroom facilities with hand-washing stations. Use of onsite restroom is at the client's discretion (location is annotated below). If client does not give permission, location of suitable restroom facilities with hand-washing stations offsite will be provided. The onsite supervisor will identify location and make arrangements to ensure all employees have access at any point.
- Restroom facilities will be (circle one): Onsite Offsite
   If Offsite. add location name and address:

#### Incident Reporting Procedure

Contact your Site Supervisor

Name:

Phone:

Contact your Manager

Name:

Contact your Site Supervisor
 Name:

Phone:

With: Your full name, phone number, office location, brief description of what happen and when.

## NOTE ADDITIONAL HAZARDS NOT ADDRESSED ABOVE

(add as many as necessary by using additional sheets)

Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:



CLIENT: ROLANDO MUSTAFA 437 SW ROSEMARY DRIVE, LAKE CITY, FL 32024

AHJ: COLUMBIA COUNTY (FL)
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD0676

PHONE: (973) 610-6389 EMAIL: ROLY_DOMINGUEZ@HOTMAIL.COM

FINANCE: SUNRUN

#### SYSTEM: SYSTEM SIZE (DC): 64 X 400 = 25.600 kW SYSTEM SIZE (AC): 17.600 kW @ 240V MODULES: 64 X FREEDOM FOREVER:

FF-MP-BBB-400
OPTIMIZERS: 64 X SOLAREDGE S440
INVERTER 1: SOLAREDGE SE10000H-USRGM

INVERTER 2: SOLAREDGE SE7600H-USRGM [SI1]



	REVISIONS						
٥.	REVISED BY	DATE					
1	S.G.	6/10/2023					
2	A.S.	6/16/2023					
3	A.G.	7/6/2023					
	·						



2619 CONSULATE DR SUITE 800, ÖRLANDO FL 32819 Tel: (800) 385-1075 GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056


SAFETY PLAN


JOB NO: DATE: DESIGNED BY: 341599 7/6/2023 A.G.


## FOR INSTALLATION REFERENCE ONLY


## SCAN QR CODE TO ACCESS REFERENCE LINK




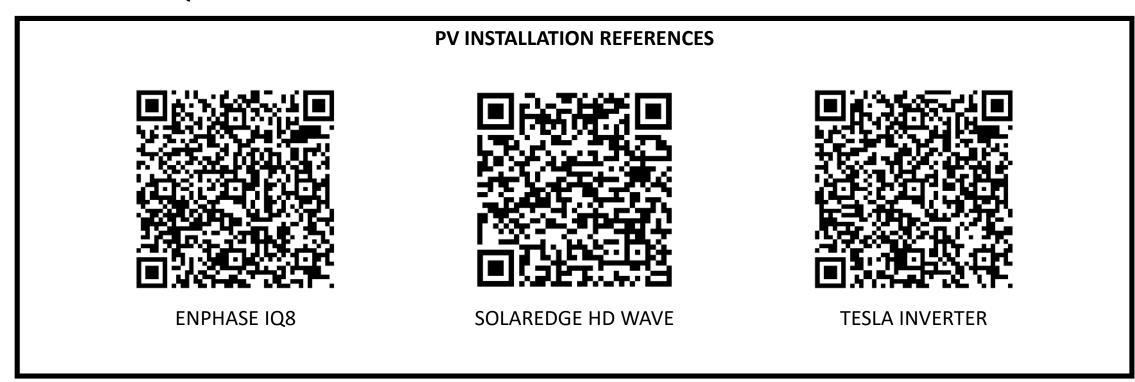

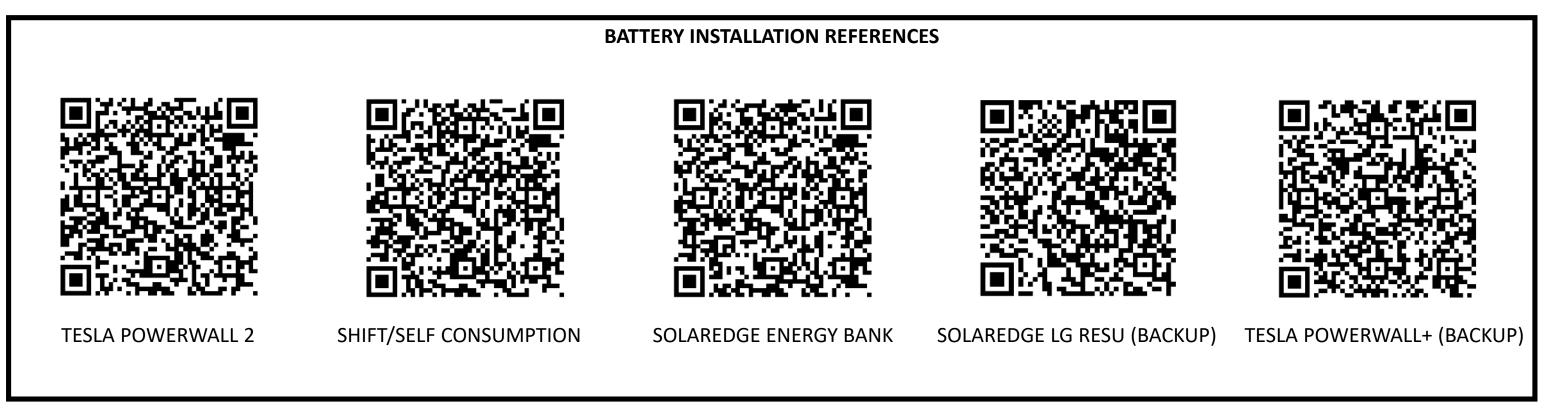



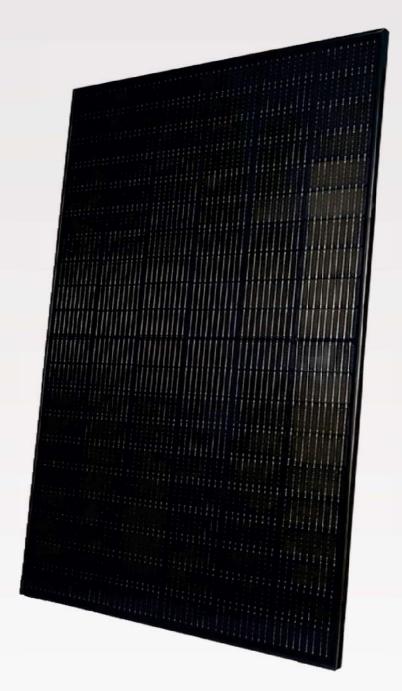

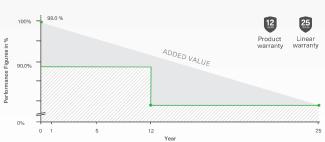

## MODULE SPECIFICATIONS

#### **ELECTRICAL CHARACTERISTICS**

Characteristics	FF-MP-BBB-400	
Maximum Power (Pmax)	400W	
Maximum Power Voltage (Vmp)	31.01V	
Maximum Power Current (Imp)[A]	12.90A	
Open Circuit Voltage (Voc)[V]	37.04V	
Short Circuit Current (Isc)[A]	13.79A	
Module Efficiency	20.48%	
Power Tolerance	0/+5W	
STC	Irradiance of 1000W/m², AM1.5, Cell Temperature 25°C	

## MECHANICAL CHARACTERISTICS

Cell Type	Mono perc, 182 mm-half cells, 108 (6x9+6x9)
Weight	22.1 kgs (48.7 lbs)
Dimension	1722 x 1134 x 35 mm (67.80 x 44.65 x 1.38 in)
Front Glass	3.2 mm (.13 in)
Junction Box	IP68 (3 Bypass Diodes)
Output Cables	1200 mm (47.24 in)
Connector	Staubli MC4
Frame & Installation	Anodized aluminum profile

## OPERATIONS CHARACTERISTICS

Operational Temperature	-40°C~+85°
Max System Voltage	1500V
Max Series Fuse Rating	25A
Safety Class	Class II
Fire Rating	Type 1

#### MECHANICAL LOADING

Snow Load	5,400Pa (113lb/ft2)
Rear Side Design Load	2,400Pa (50lb/ft2)

## PACKAGING INFORMATION

Container	20' GP	40' HC	
Pallets per Container	6	26	
Panels per Container	186	806	
Panels per Pallet	31	31	
Packaging Bon Weight	679 kg (1497 lbs)		
Panels per Pallet	1785 x 1130 x 118 ( 70.28 x 44.49 x 4		

## TEMPERATURE RATINGS

Temperature Coefficient of P _{max}	-0.350%/°C
Temperature Coefficient of $V_{\circ\circ}$	-0.275%/°C
Temperature Coefficient of I _{sc}	+0.045%/°C
Nominal Operating cell Temperature (NOCT)	42°C±2°C







UL 61730 | UL 61215 | ISO 9001 | ISO 14001










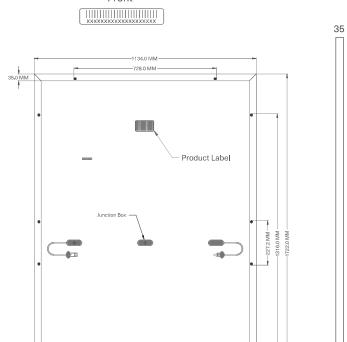


1134±2





Back



Side

Freedom 400W Module Datasheet | Version No: FF-MP-BBB-400



# CERTIFICATE **OF COMPLIANCE**

CERTIFICATE

**OF COMPLIANCE** 

This certificate confirms the model(s) for the product listed are in compliance and authorized to bear the Certification Mark(s) shown below when made in accordance with the conditions set forth in the Certification Agreement and Listing Report. This document is for use with the Design Light Consortium or California Energy Commission application only.

**Basic Listee:** PT IDN SOLAR TECH Freedom Forever Procurement LLC Multiple Listee:

KOMPLEK KABIL INDONUSA ESTATE,

43445 Business Park Drive, Suite 110, BLOK A NOMOR 19B, BATU BESAR, Address:

Temecula, CA 92590

Indonesia Country: USA Country:

Party Authorized to Apply Label: PT IDN SOLAR TECH

Batam

Address:

Standard(s):

**Report Issuing Office:** Intertek Testing Services Shanghai Limited

Authorized by: **Control Number:** *5019087* 

for L. Matthew Snyder, Certification Manager

VALID LISTING MARKS



This Certificate of Compliance is for the exclusive use of Intertek's Client and is provided pursuant to the Certification Agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the Agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the Agreement, for any loss, expense or damage occasioned by the use of this Certificate. Only the Client is authorized to permit copying or distribution of this Certificate and then only in its entirety. Use of Intertek's Certification mark is restricted to the conditions laid out in the Agreement and in this Certificate. Any further use of the Intertek name for the sale or advertisement of the tested material, product or  $service must first be approved in writing by Intertek.\ Initial Factory Assessments and Follow up Services are for the purpose of assuring appropriate usage of the Certification mark in accordance and appropriate usage of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the Certification mark in accordance and the contract of the contract of the Certification mark in accordance and the contract of t$ with the Agreement, they are not for the purposes of production quality control and do not relieve the Client of their obligations in this respect.

> Intertek Testing Services NA Inc. 545 East Algonquin Road, Arlington Heights, IL 60005 Telephone 800-345-3851 or 847-439-5667

Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements for Construction [UL 61730-1:2017 Ed.1+R:30Apr2020]

Photovoltaic (PV) Module Safety Qualification - Part 1: Requirements for Construction [CSA C22.2#61730-1:2019 Ed.2]

Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements for Testing [UL 61730-2:2017

Ed.1+R:30Apr2020]

Certificate for Report: 200900855SHA-001 Page **1** of **2** Certificate Issued: June 16, 2022

	Photovoltaic (PV) Module Safety Qualification - Part 2: Requirements for Testing [CSA C22.2#6173 2:2019 Ed.2]									
	Terrestrial Photovoltaic (Pv) Modules - Design Qualification And Type Approval - Part 1: Test Requirements [UL 61215-1:2017 Ed.1]									
	Terrestrial Photovoltaic (PV) Modules - Design Qualification And Type Approval - Part 1-1: Special Requirements For Testing of Crystalline Silicon Photovoltaic (PV) Modules [UL 61215-1-1:2017 Ed.1]									
	Terrestrial Photovoltaic (Pv) Modules - Design ( Procedures[UL 61215-2:2017 Ed.1]	Qualification And Type Approval - Part 2: Test								
Product:	Crystalline Silicon Photovoltaic (PV) Modules									
Brand Name:	Freedom Forever									
	MULTIPLE LISTEE 12 MODELS	BASIC LISTEE MODELS								
Models:	FF-MP-BBB- followed by 365, 370, 375 or 380.	NUSA120H- followed by 365, 370, 375 or 380; followed by MB.								
	FF-MP-BBB- followed by 395, 400, 405 or 410.	NUSA108H- followed by 395, 400, 405 or 410; followed by MB.								

Certificate for Report: 200900855SHA-001 Page 2 of 2 Certificate Issued: June 16, 2022

# **Power Optimizer** For North America

S440, S500



## PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Detects abnormal PV connector behavior, preventing potential safety issues*
- Module-level voltage shutdown for installer and firefighter safety
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading

- Faster installations with simplified cable management and easy assembly using a single bolt
- Flexible system design for maximum space utilization
- Compatible with bifacial PV modules
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)



# / Power Optimizer For North America

S440, S500

	S440	S500	Unit
INPUT			
Rated Input DC Power ⁽¹⁾	440	500	W
Absolute Maximum Input Voltage (Voc)	(	60	Vdc
MPPT Operating Range	8 -	- 60	Vdc
Maximum Short Circuit Current (Isc) of Connected PV Module	14.5	15	Adc
Maximum Efficiency	9	9.5	%
Weighted Efficiency	9	8.6	%
Overvoltage Category		II	
OUTPUT DURING OPERATION			
Maximum Output Current		15	Adc
Maximum Output Voltage	(	60	Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISC	ONNECTED FROM INVERTER O	R INVERTER OFF)	
Safety Output Voltage per Power Optimizer	1+	/-0.1	Vdc
STANDARD COMPLIANCE			
Photovoltaic Rapid Shutdown System	NEC 2014, 2	2017 & 2020	
EMC	FCC Part 15 Class B, IEC	61000-6-2, IEC61000-6-3	
Safety	IEC62109-1 (clas:	s II safety), UL1741	
Material	UL94 V-0,	UV Resistant	
RoHS	Υ	'es	
Fire Safety	VDE-AR-E 210	00-712:2013-05	
INSTALLATION SPECIFICATIONS			
Maximum Allowed System Voltage	10	000	Vdc
Dimensions (W x L x H)	129 x 153 x 30 /	5.07 x 6.02 x 1.18	mm / in
Weight (including cables)	655	5 / 1.5	gr/lb
Input Connector	M	C4 ⁽²⁾	
Input Wire Length	0.1,	/ 0.32	m/ft
Output Connector	N	IC4	
Output Wire Length	(+) 2.3, (-) 0.10 /	′ (+) 7.54, (-) 0.32	m/ft
Operating Temperature Range ⁽³⁾	-40 t	0 +85	°C
Protection Rating	IP68 / ⁻	Туре6В	
Relative Humidity	0 -	100	%

⁽¹⁾ Rated power of the module at STC will not exceed the power optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed


⁽³⁾ For ambient temperature above +70°C / +158°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details

PV System Design Using a SolarEdge Inverter		Single Phase HD-Wave	Three Phase for 208V grid	Three Phase for 277/480V grid		
Minimum String Length (Power Optimizers) S440, S500		8	14	18		
Maximum String Length (Powe	er Optimizers)	25	25			
Maximum Nominal Power per	String	5700 (6000 with SE7600-US-SE11400-U)	6000	12750	W	
Maximum Allowed Connected Power per String ⁽⁵⁾ (Permitted only when the difference in connected power between strings is 1,000W or less)		Refer to Footnote 5	One String 7200W	15.000W		
		Reier to Foothote 5	Two strings or more 7800W			
Parallel Strings of Different Lengths or Orientations		Υ				

⁽⁴⁾ A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement
(5) If the inverters rated AC power < maximum nominal power per string, then the maximum power per string will be able to reach up to the inverters maximum input DC power. Refer to: https://www.solaredge.com/
sites/default/files/se-power-optimizer-single-string-design-application-note.pdf
(6) It is not allowed to mix S-series and P-series Power Optimizers in new installations





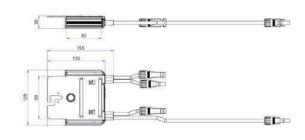

© SolarEdge Technologies, Inc. All rights reserved. SOLAREDGE, the SolarEdge logo, OPTIMIZED BY SOLAREDGE are trademarks or registered trademarks of SolarEdge Technologies Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: February 8, 2022 DS-000018-NA. Subject to change without notice.



solaredge.com

^{*} Expected availability in 2022

# Single Phase Inverter with HD-Wave Technology

## for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE7600H-US / SE10000H-US / SE11400H-US





## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12

- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)



solaredge.com

# Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US	
APPLICABLE TO INVERTERS WITH PART NUMBER			SE	ххххн-ххххх	BXX4			
OUTPUT								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
AC Output Voltage MinNomMax. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	✓	Vac
AC Output Voltage MinNomMax. (183 - 208 - 229)	-	<b>✓</b>	=	<b>✓</b>	-	-	<b>✓</b>	Vac
AC Frequency (Nominal)				59.3 - 60 - 60.5 ⁽¹⁾				Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	А
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	А
Power Factor			1	, Adjustable - 0.85 tc	0.85			
GFDI Threshold				1				Α
Utility Monitoring, Islanding Protection, Country Configurable Thresholds				Yes				
INPUT								
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W
Transformer-less, Ungrounded				Yes			1	
Maximum Input Voltage				480				Vdc
Nominal DC Input Voltage		3	880			400		Vdc
Maximum Input Current @240V ⁽²⁾	8.5	10.5	13.5	16.5	20	27	30.5	Adc
Maximum Input Current @208V ⁽²⁾	-	9	-	13.5	-	-	27	Adc
Max. Input Short Circuit Current				45				Adc
Reverse-Polarity Protection				Yes				
Ground-Fault Isolation Detection				600kΩ Sensitivity				
Maximum Inverter Efficiency	99			Ğ	9.2			%
CEC Weighted Efficiency				99			99 @ 240V 98.5 @ 208V	%
Nighttime Power Consumption				< 2.5				W

⁽¹⁾ For other regional settings please contact SolarEdge support

⁽²⁾ A higher current source may be used; the inverter will limit its input current to the values stated

# / Single Phase Inverter with HD-Wave Technology for North America


SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US SE11400H-US	;
ADDITIONAL FEATURES	1			•			
Supported Communication Interfaces			RS485, Ethernet,	ZigBee (optional), C	ellular (optional)		
Revenue Grade Metering, ANSI C12.20				Ontinual(3)			
Consumption metering				Optional ⁽³⁾			
Inverter Commissioning		With the SetAp	op mobile application	n using Built-in Wi-Fi	Access Point for Lo	ocal Connection	
Rapid Shutdown - NEC 2014, NEC 2017 and NEC 2020, 690.12			Automatic Rapid	Shutdown upon AC	Grid Disconnect		
STANDARD COMPLIANCE							
Safety		UL1741, U	L1741 SA, UL1699B, (	CSA C22.2, Canadian	AFCI according to	T.I.L. M-07	
Grid Connection Standards			IEEE,		(HI)	-	
Emissions				FCC Part 15 Class B			
INSTALLATION SPECIFICAT	IONS						
AC Output Conduit Size / AWG Range		1"	Maximum / 14-6 AV	VG		1" Maximum /14-4 AWG	
DC Input Conduit Size / # of Strings / AWG Range		1" Maxir	num / 1-2 strings / 14	1-6 AWG		1" Maximum / 1-3 strings / 14-6 AWG	
Dimensions with Safety Switch (HxWxD)		17.7 x	14.6 x 6.8 / 450 x 37	0 x 174		21.3 x 14.6 x 7.3 / 540 x 370 x 185	in / mm
Weight with Safety Switch	22	/ 10	25.1 / 11.4	26.2 ,	/ 11.9	38.8 / 17.6	lb/kg
Noise		<	25			<50	dBA
Cooling				Natural Convection			
Operating Temperature Range			-40	to +140 / -40 to +6	0(4)		°F/°C
Protection Rating			NEMA 42	K (Inverter with Safet	/ Switch)		

⁽³⁾ Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BNI4 . For consumption metering, current transformers should be ordered separately. SEACT0750-200NA-20 or SEACT0750-400NA-20. 20 units per box

## **How to Enable Consumption Monitoring**

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

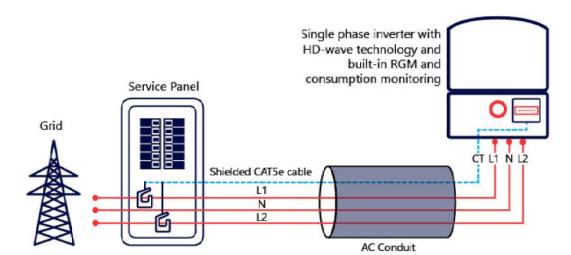



⁽⁴⁾ Full power up to at least 50°C / 122°F; for power de-rating information refer to: https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf

# Single Phase Inverter with HD-Wave Technology

## for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US





## Optimized installation with HD-Wave technology

- Specifically designed to work with power optimizers
- Record-breaking 99% weighted efficiency
- Quick and easy inverter commissioning directly from a smartphone using the SolarEdge SetApp
- Fixed voltage inverter for longer strings
- Integrated arc fault protection and rapid shutdown for NEC 2014, NEC 2017 and NEC 2020 per article 690.11 and 690.12

- UL1741 SA certified, for CPUC Rule 21 grid compliance
- Small, lightweight, and easy to install both outdoors or indoors
- Built-in module-level monitoring
- Optional: Faster installations with built-in consumption metering (1% accuracy) and production revenue grade metering (0.5% accuracy, ANSI C12.20)



solaredge.com

# Single Phase Inverter with HD-Wave Technology for North America

SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US	SE11400H-US	
APPLICABLE TO INVERTERS WITH PART NUMBER			SE	ххххн-ххххх	BXX4			
OUTPUT								
Rated AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
Maximum AC Power Output	3000	3800 @ 240V 3300 @ 208V	5000	6000 @ 240V 5000 @ 208V	7600	10000	11400 @ 240V 10000 @ 208V	VA
AC Output Voltage MinNomMax. (211 - 240 - 264)	✓	✓	✓	✓	✓	✓	<b>✓</b>	Vac
AC Output Voltage MinNomMax. (183 - 208 - 229)	-	<b>✓</b>	-	<b>✓</b>	-	-	<b>✓</b>	Vac
AC Frequency (Nominal)				59.3 - 60 - 60.5 ⁽¹⁾				Hz
Maximum Continuous Output Current @240V	12.5	16	21	25	32	42	47.5	А
Maximum Continuous Output Current @208V	-	16	-	24	-	-	48.5	А
Power Factor			1	, Adjustable - 0.85 tc	0.85			
GFDI Threshold				1				Α
Utility Monitoring, Islanding Protection, Country Configurable Thresholds				Yes				
INPUT								
Maximum DC Power @240V	4650	5900	7750	9300	11800	15500	17650	W
Maximum DC Power @208V	-	5100	-	7750	-	-	15500	W
Transformer-less, Ungrounded				Yes				
Maximum Input Voltage				480				Vdc
Nominal DC Input Voltage		3	380			400		Vdc
Maximum Input Current @240V ⁽²⁾	8.5	10.5	13.5	16.5	20	27	30.5	Adc
Maximum Input Current @208V ⁽²⁾	-	9	-	13.5	-	-	27	Adc
Max. Input Short Circuit Current				45				Adc
Reverse-Polarity Protection				Yes				
Ground-Fault Isolation Detection				600kΩ Sensitivity				
Maximum Inverter Efficiency	99			Ğ	99.2			%
CEC Weighted Efficiency				99			99 @ 240V 98.5 @ 208V	%
Nighttime Power Consumption				< 2.5				W

⁽¹⁾ For other regional settings please contact SolarEdge support

⁽²⁾ A higher current source may be used; the inverter will limit its input current to the values stated

# / Single Phase Inverter with HD-Wave Technology for North America


SE3000H-US / SE3800H-US / SE5000H-US / SE6000H-US / SE7600H-US / SE10000H-US / SE11400H-US

MODEL NUMBER	SE3000H-US	SE3800H-US	SE5000H-US	SE6000H-US	SE7600H-US	SE10000H-US SE11400H-US	3		
ADDITIONAL FEATURES	1	•	1	1		'			
Supported Communication Interfaces			RS485, Ethernet,	ZigBee (optional), C	ellular (optional)				
Revenue Grade Metering, ANSI C12.20				O - 41 1/2)					
Consumption metering		Optional ⁽³⁾							
Inverter Commissioning		With the SetAp	op mobile applicatio	n using Built-in Wi-Fi	Access Point for Lo	ocal Connection			
Rapid Shutdown - NEC 2014, NEC 2017 and NEC 2020, 690.12			Automatic Rapid	Shutdown upon AC	Grid Disconnect				
STANDARD COMPLIANCE									
Safety		UL1741, U	L1741 SA, UL1699B, (	CSA C22.2, Canadian	AFCI according to	T.I.L. M-07			
Grid Connection Standards			IEEE,	1547, Rule 21, Rule 14	(HI)				
Emissions				FCC Part 15 Class B					
INSTALLATION SPECIFICAT	IONS								
AC Output Conduit Size / AWG Range		1"	Maximum / 14-6 AV	VG		1" Maximum /14-4 AWG			
DC Input Conduit Size / # of Strings / AWG Range		1" Maxir	mum / 1-2 strings / 14	4-6 AWG		1" Maximum / 1-3 strings / 14-6 AWG			
Dimensions with Safety Switch (HxWxD)		17.7 x	14.6 x 6.8 / 450 x 37	0 x 174		21.3 x 14.6 x 7.3 / 540 x 370 x 185	in / mm		
Weight with Safety Switch	22	/ 10	25.1 / 11.4	26.2	/ 11.9	38.8 / 17.6	lb/kg		
Noise		<	25			<50	dBA		
Cooling				Natural Convection					
Operating Temperature Range			-40	) to +140 / -40 to +6	0(4)		°F/°C		
Protection Rating			NEMA 42	X (Inverter with Safet	y Switch)				

⁽³⁾ Inverter with Revenue Grade Meter P/N: SExxxxH-US000BNC4; Inverter with Revenue Grade Production and Consumption Meter P/N: SExxxxH-US000BNI4 . For consumption metering, current transformers should be ordered separately. SEACT0750-200NA-20 or SEACT0750-400NA-20. 20 units per box

## **How to Enable Consumption Monitoring**

By simply wiring current transformers through the inverter's existing AC conduits and connecting them to the service panel, homeowners will gain full insight into their household energy usage helping them to avoid high electricity bills

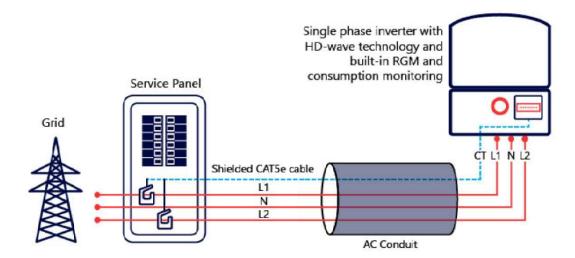



⁽⁴⁾ Full power up to at least 50°C / 122°F; for power de-rating information refer to: https://www.solaredge.com/sites/default/files/se-temperature-derating-note-na.pdf

## **Product specifications**

# Eaton DG223NRB

## Catalog Number: DG223NRB

Eaton General duty cartridge fuse safety switch, 100 A, NEMA 3R, Painted galvanized steel, Class H fuses, Fusible with neutral, Two-pole, Three-wire, Category: general duty safety switch, 240 V

## General specifications

Product Name Catalog Number Eaton general duty cartridge fuse safety DG223NRB

switch

UPC

782113144252

Product Height Product Length/Depth 7.38 in 19.25 in

Product Width **Product Weight** 

9.13 in 14 lb

Warranty Certifications

Eaton Selling Policy 25-000, one (1) year UL Listed

from the date of installation of the

Product or eighteen (18) months from the

date of shipment of the Product,

whichever occurs first.

Catalog Notes

Maximum hp ratings apply only when dual element fuses are used. 3-Phase hp rating shown is a grounded B phase

rating, UL listed.

## Physical Attributes

Enclosure

NEMA 3R

**Enclosure material** 

Painted galvanized steel

Fuse configuration

Fusible with neutral

Number Of Poles

Two-pole

Number of wires

3 Type

General duty, cartridge fused

## Performance Ratings

Amperage Rating

100A

Fuse class provision

Class H fuses

Voltage rating

240V

## Miscellaneous

**Product Category** 

General duty safety switch

#### Resources

Catalogs

Eaton's Volume 2—Commercial Distribution

Multimedia

Double Up on Safety

Switching Devices Flex Center

Specifications and datasheets

Eaton Specification Sheet - DG223NRB



Eaton Corporation plc Eaton House 30 Pembroke Road Dublin 4, Ireland Eaton.com

Reserved.

Eaton is a registered trademark.

All other trademarks are © 2023 Eaton. All Rights property of their respective









**Pressure Cable Connectors** File No. E-5238 Suitable for use on the line side of the service equipment.

## INSULATION-PIERCING TAP CONNECTORS CONECTORES DE DERIVACIÓN OUE PERFORAN EL AISLAMIENTO

## **Installation Instructions:**



## **Marning**

Improperly installed electrical wiring can be dangerous and cause electrical fires. The connector chosen must be sized to the wires being used. Consult local building code before doing any electrical work. For assistance, refer to an instructional book or consult a qualified electrician.



#### **♠** Warning


Contact with electricity can cause serious injury or death. Use on insulated cable only. [RHH, RHW(-2), THHN, THHW. THW. THWN. USE. XHHW(-2). Consult factory for other insulation types]. If the installation is to be made on an energized run, the tap conductor must be under no load and must not be grounded. Use electrically insulated gloves. De-energize the run cable if there are any questions of these conditions being met.


- 1. Determine the direction for the tap conductor to exit and discard one end cap. See figure 1.
- 2. Position the main (or feeder) side of the connector around the run cable and tighten the bolt finger tight. **See** figure 2. If required, loosen the bolt slightly to allow the connector to open completely. **DISASSEMBLY NOT RECOMMENDED.** The plastic "Turbo" spacer holds the connector open which eases installation and ensures proper
- 3. Cut the end of the tap cable squarely. **DO NOT STRIP CABLE INSULATION.**
- 4. Insert the tap cable into the tap side of the connector until it is seated in the remaining end cap. See figure 3.
- 5. Continue tightening the torque regulating bolt with a standard box or socket wrench until the torque regulating piece breaks away. If the connector has two (2) assembly bolts, alternately tighten until the hexagonal torque devices break away. **See figures 4a & 4b.** Note that the plastic "turbo" spacer on the side will also break. To make the installation even easier and to relieve torque from the cables, a second wrench can be used on the hexagonal piece on the bottom of the connector.


DO NOT use gripping type pliers, pipe, open ended or adjustable wrenches as these may damage the hexagonal torque regulating device. A torque wrench is not


MAKE SURE ONLY THE TOP HEXAGONAL TORQUE DEVICE OF THE BOLT HEAD IS USED FOR ASSEMBLY. THE SECOND HEX PIECE [CLOSER TO THE BODY OF THE CONNECTOR] IS USED FOR DISASSEMBLY.

Note: The torque regulating bolt ensures the correct torque is applied to the conductors without using a torque wrench. Important information such as run and tap ranges, voltage ratings and material/temperature ratings is marked on the connector.









## Instalación Instrucciones:

## **A** Advertencia



Los cables eléctricos mal instalados pueden ser peligrosos y provocar incendios. El conector escogido debe ser de un tamaño adecuado para los cables que se utilicen. Consulte los códigos de construcción locales antes de efectuar trabajos eléctricos. Si necesita ayuda, consulte un libro de instrucciones o consulte con un electricista capacitado.

#### ♠ Advertencia



Use sólo en cable aislado. [RHH, RHW(-2), THHN, THHW, THW, THWN, USE, XHHW(-2). Consulte con la fábrica para obtener información sobre otros tipos de aislamientol. Si se va a hacer la instalación sobre un cable con corriente el conductor derivado debe estar libre de carga y no debe estar aterado. Use quantes con aislamiento eléctrico. Quite le la corriente al cable del cual se hace la derivación si no se pueden cumplir estas condiciones. El contacto con electricidad puede producir lesiones graves o mortales.

- 1. Determine la dirección en la que el conductor derivado saldrá y deseche la tapa terminal sobrante. Vea la ilustración 1.
- 2. Coloque el lado principal (o de alimentación) del conector alrededor del cual se hace la derivación y apriete firmemente el dedo del perno. Vea la ilustración 2. Si hace falta, afloje el perno ligeramente para permitir que el conector se abra completamente. NO ES RECOMENDABLE DESARMAR EL **CONECTOR.** El espaciador "Turbo" de plástico mantiene al conector abierto. lo cual facilita la instalación y asegura que las conexiones se hagan correctamente.
- 3. Corte el extremo del cable de derivación perpendicularmente a su eje. NO PELE EL AISLAMIENTO DEL CABLE.
- 4. Inserte el cable de derivación en el lado de derivación del conector hasta que tope contra la tapa terminal que queda. Vea la
- 5. Continué apretando este perno que regula la torsión con una llave estándar o de cubo hasta que la pieza que regula la torsión se parta y se separe. Si el conector tiene dos (2) pernos de ensamblaie, apriételos alternativamente hasta que el dispositivo de regulación de torció se parta. Vea la ilustración 4a y 4b. Observe que el espaciador "turbo" de plástico en el costado también se fracturará. Para hacer esta instalación aún más fácil y para aliviar la torsión de los cables, se puede usar una segunda llave sobre la pieza hexagonal al fondo del conector.

NO USE alicates de presión. Haves de turbo. Haves **comunes o ajustables** ya que éstas pueden dañar el dispositivo hexagonal que regula la torsión. No se requiere una llave de torsión.

ASEGÚRESE QUE SE USE. PARA EL ENSAMBLADO. SÓLO EL DISPOSITIVO SUPERIOR DE REGULACIÓN DE TORSIÓN DE LA CABEZA DEL PERNO. LA SEGUNDA PIEZA HEXAGONAL (LA MÁS CERCANA AL CUERPO DEL CONECTOR) SE USA SÓLO PARA DESARMAR EL CONECTOR.

Nota: El perno regulador de torsión garantiza la aplicación de la torsión correcta a los conductores sin usar una llave de torsión. La información importante de longitud de cable pelado y de toma, las clasificaciones de materiales y temperatura está marcada en el

## B-TAP® INSULATION PIERCING TAP CONNECTORS TOROUE AND **CURRENT RATINGS**

(Solid and/or Stranded)

CATALOG#	MAIN	TAP	NOMINAL Torque	TAP CURRENT RATIING (IN AMPS)*
BTC2/0-14	2/0-4	10-14 ⁺	80 IN. LBS.	40
BTC1/0-10	1/0-8	2-10++	80 IN. LBS.	130
BTC4/0-10	4/0-3	2-10+++	125 IN. LBS.	130
BTC4/0-6	4/0-2	1/0-6	160 IN. LBS.	170
BTC4/0-2	4/0-2	4/0-2	160 IN. LBS.	260
BTC250-6	250-4	4/0-6	160 IN. LBS.	260
BTC250-4	250-1	3/0-4	160 IN. LBS.	225
BTC250-2	250-1/0	4/0-2	160 IN. LBS.	260
BTC350-1/0	350-1/0	350-1/0	330 IN. LBS.	350
BTC500-4	500-2/0	4/0-4	330 IN. LBS.	260
BTC500-1/0	500-4/0	350-1/0	330 IN. LBS.	350
BTC500-14	750-3/0	10-14 ****	80 IN. LBS.	40
BTC750-250	750-250	500-250	330 IN. LBS.	430

+10-14 Cu SOLID/STRANDED: 10-12 AI SOLID/STRANDED

++2-10 Cu SOLID/STRANDED; 2-10 AI STRANDED

+++2-10 Cu SOLID/STRANDED: 2-8 AI STRANDED

++++10-14 Cu SOLID/STRANDED: 10-12 AI STRANDED

Full line is 600V dual-rated, 194°F(90°C)

* Based on NEC Table 310-16 1996 (Not more than 3 insulated conductors in a raceway at ambient temperature of 30° C) for the largest tap wire size.

**WARNING:** Cancer and Reproductive Harm - www.P65Warnings.ca.gov.



ADVERTENCIA: Cáncer y Daño Reproductivo - www.P65Warnings.ca.gov.

One year limited warranty. See idealind.com for more information.

Garantía limitada de un año. Visite www.idealind.com para obtener detalles de la garantía.



1800 S. Prairie Drive Sycamore, IL, U.S.A. 800-435-0705 • www.idealind.com

> ND 9053-2 1839420



## IDEAL INDUSTRIES, INC.

1375 Park Avenue • Sycamore, Illinois 60178 • 815.895.5181 • www.idealind.com

2/9/23

ALL IDEAL Customers

Subject: The Buchanan B-TAP® splice/tap connectors meet the 2020 NEC

article 230.46 requirement for "line side applications"

The Buchanan B-TAP® brand of insulation piercing connectors which correspond to part numbers beginning with "BTC" meet the requirements of article 230.46 of the 2020 NEC. These products have already been tested to the newer requirements. The installation instructions are in the process of being updated to show the required notation: "suitable for use on the line side of the service equipment". This change will take a few weeks to get into our production.

In addition, the marking "SR" will be added to the product. That addition is in process and will take a few months to complete.

This notice will provide confirmation to the inspectors that B-TAP® products meet the requirements of the 2020 and 2023 NEC article 230.46 "Spliced and Tapped Conductors".

Sushil Keswani

Director of Engineering IDEAL Industries, Inc.,

Sull Hon

## UL Product iQ®



# ZMVV.E5238 - Wire Connectors and Soldering Lugs

Note: We are enhancing our systems and you may notice duplicate entries/missing/outdated data. During this interim period, please contact our Customer Service at <a href="https://www.ul.com/about/locations">https://www.ul.com/about/locations</a>.

## Wire Connectors and Soldering Lugs

IDEAL INDUSTRIES INC E5238

1375 Park Ave

SYCAMORE, IL 60178 United States

View model for additional information

Insulated butt splice crimp type connectors, Model(s): BVS1, BVS2, BVS5

Insulated flange spade type crimp cconnectors, Model(s): <u>SV5-3.7</u>, <u>SVL5-4</u>, <u>SVL5-6</u>

Insulated flange spade type crimp connectors, Model(s): <u>FSNYD1-3.7</u>, <u>FSNYD1-4</u>, <u>FSNYD1-5</u>, <u>FSNYD2-3.7</u>, <u>FSNYD2-3.7</u>, <u>FSNYD5-4</u>, <u>FSNYD5-5</u>

Insulated hook type crimp connectors, Model(s): <u>HNYD1-3.7</u>, <u>HNYD1-4</u>, <u>HNYD1-5</u>, <u>HNYD2-3.7</u>, <u>HNYD2-4</u>, <u>HNYD2-5</u>, <u>HNYD5-3.7</u>, HNYD5-4, HNYD5-5, HVY1-3.7, HVY1-4, HVY1-5, HVY2-4, HVY2-5, HVY5-3.7, HVY5-4, HVY5-5

Insulated locking spade crimp connectors, Model(s): <u>LSNYD1-3.7</u>, <u>LSNYD2-3.7</u>, <u>LSNYD5-3.7</u>, <u>LSNYD5-4</u>, <u>LSNYD5-5</u>, <u>LSNYD1-4</u>, LSNYDL2-5

Insulated multiple stud ring type crimp connectors, Model(s): MSRNYD1-3753, MSRNYD2-3753, MSRNYD5-3753

Insulated parallel connectors, Model(s): PVT1, PVT14, PVT2, PVT22, PVT5, PVT8

Insulated pin type connectors, Model(s): PTNYD1-12, PTNYD2-12, PTNYD5-13

Insulated ring type crimp connectors, Model(s): RNYB14-11, RNYB22-11, RNYD1-10, RNYD1-3.2, RNYD1-5, RNYD1-6, RNYD1-8, RNYD2-10, RNYD2-10, RNYD2-2, RNYD2-3.2, RNYD2-6, RNYD2-8, RNYD5-10, RNYD5-12, RNYD5-3.2, RNYD5-3.7, RNYD5-5, RNYD5-6, RNYD5-8, RNYDL1-3.7, RNYDL1-4, RNYDL2-3.7, RNYDL2-4, RNYDL5-3.7, RNYDL5-4, RNYDM2-3.7, RNYDS1-3.7, RNYDS1-4, RNYDS2-4, RNYDS2-5, RNYDS5-4, RV1-3.2, RV1-5, RV1-6, RV2-3.2, RV5-10, RV5-3.7, RV5-5, RV5-6, RV5-8, RVL1-4, RVL2-4, RVL5-4, RVM1-3.7, RVM2-3.7, RVY1-3.2

Insulated spade type crimp connectors, Model(s): SNYD1-3.2, SNYD5-3.7, SNYD5-5, SNYDL1-3.7, SNYDL1-4, SNYDL2-3.7, SNYDL2-4, SNYDL2-5, SNYDL1-4, SNYDL2-5, SNYDL2-4, SNYDL1-3.7, SNYDL1-3.7, SNYDL1-3.7, SNYDL2-3.7, SNYDL2-3.7

Insulated splice connectors, Model(s): PB1-, PB2-, PB5-

Insulating caps or covers, for use on manufacturer's splice caps, for 2006-S, 2008-S connectors, Model(s): 2007

Insulating caps or covers, for use on manufacturer's splice caps, for 2011-S connector, Model(s): 2014

Listed pressure cable connectors, Model(s): <u>BHT1</u>, <u>BHT2</u>, <u>BHT5</u>, <u>BN1</u>, <u>BN2</u>, <u>BN5</u>, <u>BNT1-16</u>, <u>BNT14</u>, <u>BNT2-16</u>, <u>BNT2-16</u>, <u>BNT22</u>, <u>BNT5-20</u>, <u>BNT8</u>, <u>BNYDF1</u>, BNYDF2, BNYDF5, BNYT1, BNYT2, BNYT5, BV1, BV2, BV5, BVT14, BVT22, BVT8

Listed pressure ring terminal connectors, Model(s): RNYB14-8, RNYB8-11, RNYBL22-5, RNYBL22-6

**Listed splicing wire connectors,** Model(s): <u>L12</u>, <u>L13</u>, <u>L15</u>

**Non-insulated flange spade crimp connectors,** Model(s): <u>FSN1-3.7, FSN1-4, FSN1-5, FSN2-3.7, FSN2-4, FSN2-5, FSNB1-3.7, FSNB1-4, FSNB1-5, FSNB1-3.7, FSNB1-4, FSNB1-5, FSNB2-3.7, FSNB2-4, FSNB2-5, FSNB5-3.7, FSNB5-4, FSNB5-5, FSNL1-3.7, FSNL2-5</u>

Non-insulated hook crimp connectors, Model(s): HN1-4, HN1-5, HN2-3.7, HN2-4, HN2-5, HN5-3.7, HN5-4, HN5-5

Non-insulated locking type crimp connectors, Model(s): LSN1-3.7, LSN2-3.7, LSN5-3.7, LSN5-4, LSN5-5, LSN5-6, LSNL1-4, LSNL1-5, LSNL2-5

Non-insulated multiple stud ring type crimp connectors, Model(s): MSRNB1-3753

Non-insulated parallel crimp connectors, Model(s): PNT 1, PNT 14, PNT 2, PNT 22, PNT 5, PNT 8, PNT 1, PNT2, PNT5

Non-insulated pin type crimp connectors, Model(s): PTN1-12, PTN2-12, PTN5-13

Non-insulated ring type crimp connector, Model(s): <u>RNB1-10</u>, <u>RNB1-3.2</u>, <u>RNB14-11</u>, <u>RNB14-12</u>, <u>RNB14-16</u>, <u>RNB1-6</u>, <u>RNB1-8</u>, <u>RNB1-8</u>, <u>RNB2-10</u>, <u>RNB2-2</u>, <u>RNB2-6</u>, <u>RNB5-12</u>, <u>RNB8-12</u>, <u>RNB8-12</u>, <u>RNB8-14</u>

Non-insulated ring type crimp connectors, Model(s): RNB1-3.2, RNB14-10, RNB14-5, RNB14-8, RNB1-5, RNB2-10, RNB22-10, RNB22-12, RNB22-8, RNB2-3.2, RNB5-10, RNB5-3.2, RNB5-3.7, RNB5-3.7, RNB5-5, RNB5-6, RNB5-8, RNB8-10, RNB8-11, RNB8-16, RNB8-8, RNBL1-3.7, RNBL2-5, RNBL2-6, RNBL2-3.7, RNBL2-5, RNBL38-10, RNBL5-3.7, RNBL5-3.7, RNBM1-3.7, RNBM2-3.7, RNBM2-3.7, RNBM2-3.7, RNBM2-3.7, RNBM8-5, RNBS1-4, RNBS1-4, RNBS1-4, RNBS2-4, RNBS2-4, RNBS2-5, RNBS5-4, RNBS8-6

Non-insulated spade type crimp connectors, Model(s): <u>SN1-3.2</u>, <u>SN2-3.2</u>, <u>SN5-3.7</u>, <u>SN5-5</u>, <u>SNB1-3.2</u>, <u>SNB5-3.7</u>, <u>SNB5-5</u>, <u>SNBL1-3.7</u>, <u>SNBL1-4</u>, <u>SNBL2-4</u>, <u>SNBL2-5</u>, <u>SNBL5-4</u>, <u>SNBL5-6</u>, <u>SNBLL1-3.7</u>, <u>SNBLL1-3.7</u>, <u>SNBM1-4</u>, <u>SNBS1-5</u>, <u>SNBS5-4</u>, <u>SNL1-3.7</u>, <u>SNL1-4</u>, <u>SNL2-3.7</u>, <u>SNL2-4</u>, <u>SNL2-3.7</u>, <u>SNL2-3.7</u>, <u>SNL2-3.7</u>, <u>SNS5-4</u>, <u>SNL2-3.7</u>, <u>SNL1-3.7</u>, <u>SNL1-3.7</u>, <u>SNL1-4</u>, <u>SNM2-4</u>, <u>SNS1-5</u>, <u>SNS5-4</u>

**Pressure cable connectors,** Model(s): <u>KB - 1000</u>, <u>KB - 2/0</u>, <u>KB - 350</u>, <u>KB - 4/0</u>, <u>KB - 500</u>, <u>KB - 800</u>, <u>KS - 1000</u>, <u>KS - 2/0</u>, <u>KS - 350</u>, <u>KS - 4/0</u>, <u>KS - 500</u>, <u>KS - 800</u>

Pressure terminal connectors, Model(s): FSVY1-3.7, FSVY1-4, FSVY1-5, FSVY2-3.7, FSVY2-4, FSVY2-5, FSVY5-3.7, FSVY5-4, FSVY5-5, K-5655, K-5656, LSV1-3.7, LSV5-3.7, LSV5-4, LSV5-5, LSV5-6, LSVL2-4, LSVS1-4, LSVS1-5, LSVS2-5, LSVY1-3.7, LSVY5-3.7, LSVY5-4, LSVY5-5, LSVY5-6, LSVYL1-4, LSVYL1-5, LSVYL2-4, LSVYL2-5, MSRNB2-3753, MSRVY1-3753, MSRVY2-3753, MSRVY5-3753, PTVY1-12, PTVY2-12, PTVY5-13, RVY1-10, RVY1-5, RVY1-6, RVY1-8, RVY2-10, RVY2-2, RVY2-3.2, RVY2-6, RVY2-8, RVY5-10, RVY5-12, RVY5-3.2, RVY5-3.7, RVY5-3.7, RVY5-3.7, RVY5-3.7, RVY5-4, RVY52-4, RVY52-4, RVY52-4, RVYS2-4, RVYS2-4, RVYS2-4, RVYS2-4, RVYS2-4, RVYS2-3.7, RVYS1-4, RVYS2-3.7, RVYS1-4, RVYS2-3.7, RVYS2-4, RVYS2-4, RVYS2-5, RVYS5-4, SNBM2-4, SNYD2-3.2, TLK16-6, TLK25-10

Pressure Terminal Connectors, Model(s): RNYB14-10, RNYB14-12, RNYB14-5, RNYB22-12, RNYB22-8, RNYB8-10, RNYB8-12, RNYB8-8, RNYBM8-5, RNYBS14-6

Slicing wire connectors, Model(s): OK-2 (Pkg. cat No. 84), OK-3 (Pkg. cat No. 85), OK-4 (Pkg. cat No. 86), OK-5 (Pkg. cat No. 87), OK-6W (Pkg. cat No. 88), OK-8 (Pkg. cat No. 90), OK-8W (NA)

Splicing wire connectors, Model(s): 12, 13, 14, 14-6, 15, 199, 1995, 200, 2002, 2006-S, 2008-S, 2011-S, 22-10, 22-12, 29, 299, 2995, 30, 300, 32, 33, 34, 340, 36, 37, 38, 39, 399, 400, 400AL, 42, 50, 615069, 66, 70, 800, AS-1/0, AS-2, AS-2/0, AS-350, AS-4, AS-4/0, AS-500, AS-6, B1, B2, B4, BT-2, BTC 1/0-10, BTC 1/0-14, BTC 2/0-14, BTC 250-4, BTC 350-1/0, BTC 4/0-10, BTC 4/0-2, BTC 4/0-6, BTC 500-1/0, BTC

**Splicing Wire Connectors,** Model(s): <u>BNT1</u>, <u>BNT2</u>

Splicing Wire Connectors:, Model(s): 46-404, 46-405

**Splicinig wire connectors,** Model(s): <u>H-1566</u>, <u>H-1567</u>, <u>H-1570</u>, <u>H-1571</u>, <u>H-1572</u>, <u>H-1591</u>, <u>H-1592</u>, <u>H-1594</u>

**Terminal connectors,** Model(s): 10, 11, 22, 250, 300, 341, 342, 410 with insulating cap No. 415, 411 with insulating cap No. 417, 412 with insulating cap No. 417, 451, 452, 454, 48, 49, 49 Black, 53-B, 59B, 600, 71B#, 72B#, 73B#, 73B+, 74B, 76B, 76B+, 78B+, 82, K-5504, LSNL2-4, M-3, PV3-750, PV3-750, PV3-750, PV4-750, PV4-750, RNBL2-4, RNBS14-6, RNBS38-6, RNBS38-8, RNYB22-10, RNYBS8-6, RV2-6, RVL2-5, SV5-5, WT1, WT2, WT3, WT4, WT41, WT51, WT52, WT53, WT54, WT6

Terminal Connectors, Model(s): RNB22-11

Wire Connectors, Model(s): 65, 653

Wire Connectors and Soldering Lugs, Model(s): <u>L22</u>, <u>L23</u>, <u>L25</u>, <u>PS10</u>, <u>PS12</u>, <u>PS2</u>, <u>PS3</u>, <u>PS4</u>, <u>PS4S</u>, <u>PS5</u>, <u>PS6</u>, <u>PS8</u>

- # The equipment (71B, 72B and 73B) were also evaluated to the requirements of UL 2043 and are suitable for use in air handling spaces.
- * May be followed by suffix B, J, T or X.

NOTE - All models may be provided with or without prefix "V" or suffix "MP" or "V" and prefix "BP". All models may be followed by suffixes BT, UB or UF with or without a two or four digit number, with or without suffixes B, LP, NP, PF, PH, SP and/or T. Die Series terminals may be followed by Suffixes UI, UT, UF, US, or UB, with or without a two to four digit number, with or without Suffix T or B, followed by Suffixes SP, LP, NP, PF, or and/or NM, by PH or BE, with or without Suffixes NT, BS, and /or G.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL Solutions' Follow - Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL Solutions' Follow - Up Service. Always look for the Mark on the product.

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from Product iQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2023 UL LLC."

Feedback



## INTRODUCING ROCKIT SMART SLIDE!

Introducing EcoFasten's patent pending RockIt Smart Slide, our simple solution for quickly installing the popular RockIt rail-less racking system to composition shingle roofs.

## **Features & Benefits**

- Eliminates the need to pry up shingle courses and install a metal flashing
- Multiple opportunities to find the rafter
- No need for additional material when architectural shingles are not level
- Longer 6.75" slide avoids overlaps in shingle courses
- Integrated flashing utilizes
   UltraGrip Technology™ to create
   a watertight seal



## **Required Components:**

Part Number:	Description:
2011024	RI SMART SLIDE BLK 6.75"
2011025	RI SMART SCRW #12X3" W/BW

ECOFASTENSOLAR.COM


# **ROCKIT SMART SLIDE**

## Integrated UltraGrip Technology™

Pre-installed sealing pads are compatible with all composition shingle roofs. The compression achieved when fastened to the roof creates a super strong watertight seal. In most cases, the slide can be mounted to the deck without the need for sealant. A layer of flexible foam provides cushioning, which allows the waterproofing sealant to embed deep into the granules of the shingle as well as to flexibly conform over the steps found on architectural-style shingles.







## **Testing & Documentation**

- UL441 Rain Report
- TAS 100 (A)-95 Wind and Wind Driven Rain Resistance
- Mechanical Load Test/Structural Capacity Certification
- Florida Product Approval
- RockIt Installation Manual
- Rocklt CutSheets






**4141 W. VAN BUREN ST, SUITE 2, PHOENIX AZ 85009** 1 - 8 7 7 - 8 5 9 - 3 9 4 7 | INFO@ECOFASTENSOLAR.COM






# RI SMART SLIDE BLK 6.75"

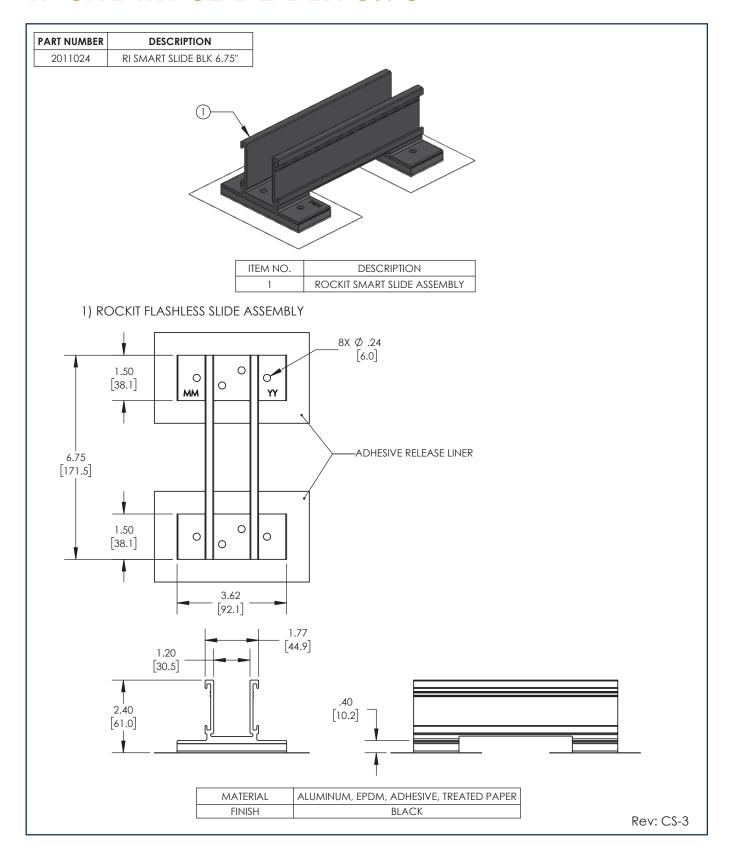

# RI SMART SCREW #12X3" W/BW

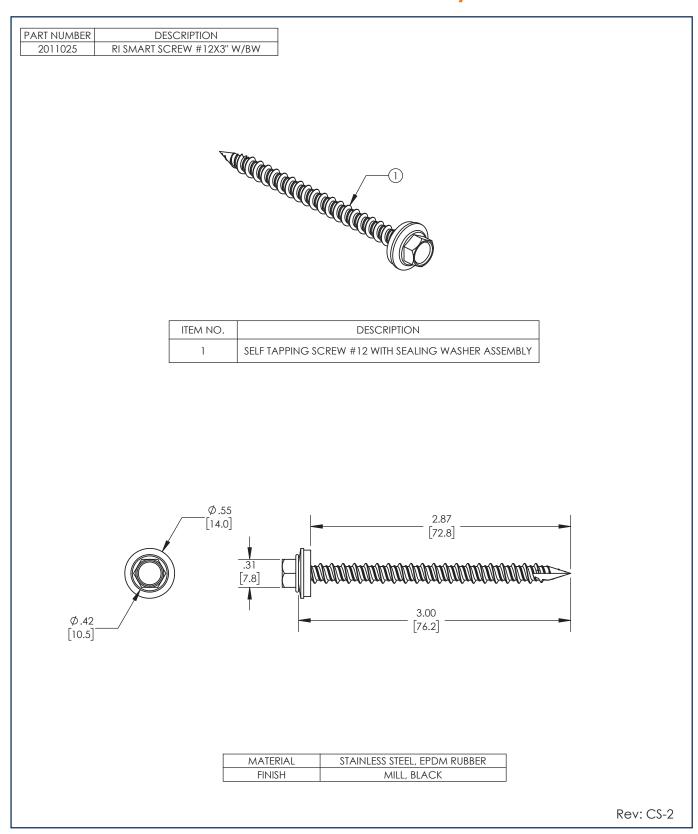



US Headquarters | 4141 W. Van Buren St., Ste. 2 | Phoenix, AZ 85009 US Branch | 976 Brady Ave., Ste. 100 | Atlanta, GA 30318

June 09, 2023

EcoFasten 4141 West Van Buren St. Phoenix, AZ 85009

Attn.: EcoFasten Solar Engineering Department

Re: EcoFasten Rocklt System, with Comp Slide or Smart Slide, Engineering Certification for Gable and Hip roofs.

This letter addresses the structural performance and code compliance of EcoFasten's Rocklt Flush Mount System. The contents of the letter shall be reviewed in its entirety before application to any project design. The Rocklt System is a proprietary rooftop mounting system used to support photovoltaic (PV) modules installed in portrait or landscape orientation and set parallel to the underlying roof surface. PV modules are supported by extruded aluminum Rocklt Mount assemblies which are connected to a Rocklt roof attachment, either the Rocklt Comp Slide or Rocklt Smart Slide, which is attached directly to the roof structure. Assembly details of a typical Rocklt system and its core components are shown in Exhibit ECO 1.0. The Rocklt Comp Slide assembly is shown in drawing EX-1 and the Rocklt Smart Slide assembly is shown in drawing 850076. The EcoFasten Rocklt System is designed and certified to the structural requirements of the reference standards listed below, for the load conditions and configurations tabulated in the attached span tables.

- Minimum Design Loads for Buildings and Other Structures, ASCE/SEI 7-16
- 2018 International Building Code, by the International Code Council, Inc.
- 2020 Florida Building Code
- SEAOC (Structural Engineer Association of California) report PV2-2017 Wind Design for Solar Arrays
- Aluminum Design Manual 2015, by The Aluminum Association, Inc.
- NDS-2018, National Design Specification for Wood Construction, by the American Wood Council

The span tables provided in this letter are certified based on the structural performance of EcoFasten Rocklt System in conjunction with Rocklt Comp Slide or Smart Slide only, with no consideration of the structural adequacy of the PV modules, or the underlying roof supporting members. These tables are intended to be used under the responsible charge of a registered design professional where required by the authority having jurisdiction. It is the responsibility of the installer or system designer to verify the structural capacity and adequacy of the system components regarding the applied or resultant loads of any chosen array configuration.

Sincerely,



THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY MATTHEW S. KUZILA, PE ON THE DATE BELOW THE SEAL.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

Matthew S Kuzila, PE

06/09/2023



US Headquarters | 4141 W. Van Buren St., Ste. 2 | Phoenix, AZ 85009 US Branch | 976 Brady Ave., Ste. 100 | Atlanta, GA 30318

The tables included in this letter provide the maximum allowable spans of the RockIt System, when used in conjunction with one of the available roof mounts, as a Flush Mount System for the respective loads and configurations listed, covering wind exposure categories B, C, & D, roof zones provided in ASCE 7-16 for enclosed and partially enclosed gable roofs with slopes less than or equal to 7° & enclosed and partially enclosed gable or hip roofs with slopes of 8° to 60°. The tabulated spans are applicable when the following conditions are met:

- 1. *Span* is the distance between two adjacent roof attachment points (measured at the center of the attachment fasteners).
- 2. The underlying roof slope, measured between the roof surface and horizontal plane, is 0° to 60°.
- 3. The *mean roof height*, defined as the average of the roof eave height and the roof ridge height measured from grade for roofs with pitches above 10 degrees and defined as the eave height for roofs with pitches less than or equal to 10 degrees, does not exceed 30 feet.
- 4. A clearance from the module top surface to the roof surface of 2" minimum shall be provided and the height of the array, the distance from the module top surface to the roof surface (defined as h2), shall not exceed 6".
- 5. Module length and area shall not exceed the maximum values listed on the respective span tables
- 6. All Flush Mount components shall be installed in a professional workmanlike manner per EcoFasten's Rocklt Installation Manual and the requirements specified for the underlying roof supporting members in the certification letter of the selected roof attachment, Rocklt Comp Slide or Rocklt Smart Slide, are confirmed to be met.

## The parameters and adjustments allowed in the span tables are defined as the following:

- 1. The Flush Mount System is designed as a Risk Category II structure as defined by ASCE 7-16 Table 1.5-1.
- 2. Wind speed shall conform to ASCE 7-16 Fig. 26.5-1B (for Risk Category II) and applicable state & local county/city amendments to the IBC. No special wind topographic features are included and both topographic coefficient (Kzt) and wind ground elevation factor (Ke) are taken as 1.0.
- 3. Snow load used in the span tables is the ground snow and shall conform to ASCE 7-16 Fig. 7.2-1 and applicable state & local county/city amendments to the IBC. If the local jurisdiction specified snow load is in the format of a flat roof snow, it shall first be converted to a ground snow following the local building code/amendments before the application of the attached span tables. No special snow conditions are considered including unbalanced, drifting, sliding, retention, or ponding snow. No rain-on-snow surcharge load is considered. The span tables do not apply to buildings which are intentionally kept below freezing, kept just above freezing, or unheated.



US Headquarters | 4141 W. Van Buren St., Ste. 2 | Phoenix, AZ 85009 US Branch | 976 Brady Ave., Ste. 100 | Atlanta, GA 30318

- 4. The span tables reflect the ASCE 7 prescribed earthquake loads with the maximum magnitudes being:
  - (a) For ground snow no greater than 42psf: Ss ≤ 2.0g for Site Class A, B, C, & D.
  - (b) For ground snow greater than 65psf: Ss ≤ 1.0g for Site Class A, B, C, & D.
  - (c) For ground snow between 42 and 65psf: Ss ≤ 1.5g for Site Class A, B, C, & D.
- 5. Roof zones are defined by ASCE 7-16 Figure 30.3-2A to Figure 30.3-2I and are organized into three groups in which the zones share the same External Pressure Coefficients (GCp). Roof zones comprising each group along with each roof zone's size and location are depicted in Figures 1 and 2.
- 6. The maximum module cantilever length, measured from the module end to the nearest attachment point, shall be 1/3rd of the allowable span. For the Rocklt mounting system, a cantilever is defined as the distance from the end of a module free edge to a Rocklt Mount roof attachment. A module edge is not free if there is a Rocklt Coupling connection to an adjacent module on that edge.
- 7. A 1.0" Tolerance for any specified dimension in this report is allowed for installation.

## **Components and Cladding Roof Zones Figures:**

Per ASCE 7-16:

a = 10 % of least horizontal dimension of 0.4h, whichever is smaller, but not less than either 4% of least horizontal dimension or 3 ft (0.9m). If an overhang exists, the edge distance shall be measured from the outside edge of the overhang. The horizontal dimensions used to compute the edge distance shall not include any overhang distances.

B=Horizontal dimension of building measure normal to wind direction in ft (m)

h=Mean roof height, in ft (m), except that eave height shall be used for  $\Theta \le 10^{\circ}$   $\Theta = \text{Angle of plane of roof from horizontal, in degrees.}$ 


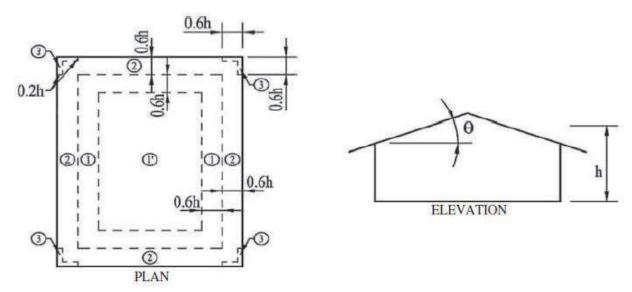


Figure 1: ASCE 7 Roof Zones for Gable Roofs  $\Theta \le 7^{\circ}$ 



US Headquarters | 4141 W. Van Buren St., Ste. 2 | Phoenix, AZ 85009 US Branch | 976 Brady Ave., Ste. 100 | Atlanta, GA 30318






Figure 2: ASCE 7 Roof Zones for Gable Roofs  $8^{\circ} \le \Theta \le 60^{\circ}$ 

	Grouping of ASCE 7-16 Roof Zones (Gable)												
Roof Slope	0°-7°				8°-27°			28°-60°					
Group	Group 1	Group 2	Group 3	Group 1	Group 2	Group 3	Group 1	Group 2	Group 3				
ASCE 7-16 Roof Zones	1 ' 1	2	3	1 2e	2n 2r 3e	3r	1 2e 2r	2n 3r	3e				
		Group	ing of A	SCE 7-1	L6 Roof	Zones	(Hip)						
Roof Slope		8°-20°			21°-27°			28°-60°					
Group	Group 1	Group 2	Group 3	Group 1	Group 2	Group 3	Group 1	Group 2	Group 3				
ASCE 7-16 Roof Zones	1	2r	2e 3	1	2r 2e	3	1	2e	2r 3				



US Headquarters | 4141 W. Van Buren St., Ste. 2 | Phoenix, AZ 85009 US Branch | 976 Brady Ave., Ste. 100 | Atlanta, GA 30318

## Spans for Array Edge

A module is defined as Exposed (per Section 29.4.4 of ASCE 7-16) if the distance from any of its free edges (an edge with no connectivity to other modules) to its facing roof edge (such as eave, ridge, rake, or hip) is greater than 0.5h (h is ASCE defined building height) AND if the distance from the same free edge to any other adjacent array or panel is greater than 4 feet. The maximum allowable span for Exposed Modules shall be the lesser of the following two: (1) The span value for the exposed module condition. (2) The span value determined by the site wind and ground snow load.

ecofastensolar.com | info@ecofastensolar.com | 877.859.3947



# RockIt with GF1 Comp Slide Span Tables