

BEARING HEIGHT SCHEDULE

	9' 1-1/8"
	- 1' - 9"

NOTES:

- 1) REFER TO HB 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING.) REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.
- 2) ALL TRUSSES (INCLUDING TRUSSES UNDER VALLEY FRAMING) MUST BE COMPLETELY DECKED OR REFER TO DETAIL V105 FOR ALTERNATE BRACING REQUIREMENTS.
- 3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER.
- 4) ALL TRUSSES ARE DESIGNED FOR 2' o.c. MAXIMUM SPACING, UNLESS OTHERWISE NOTED.
- 5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.
- 6) SY42 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP.
- 7) BEAM/HEADER/LINTEL (HDR) TO BE FURNISHED BY BUILDER.



Jacksonville
PHONE: 904-772-6100 FAX: 904-772-1973

Tampa
PHONE: 813-621-9831 FAX: 813-628-8956

Lake City
PHONE: 386-755-6894 FAX: 386-755-7973

BUILDER:
BLAKE CONST.

LEGAL ADDRESS:

MODEL: Revision:
Rev. By:

DATE: 9-23-20 DRAWN BY: KLH Original Reference #: 2478882

1st Level Job #: 2nd Level Job #: Roof Job #: 2478882

FL Approval Codes - Mitek Plates #'s 2197.2 - 2197.4, Versa-Lam #1644-R4 & BCI Joists #1392-R4



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 2478882 - BLAKE CONST. - DAUGHTERS HSE

MiTek USA, Inc.
6904 Parke East Blvd.
Tampa, FL 33610-4115

Site Information:

Customer Info: Blake Const. Project Name: Lunde-Nickodam Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: 525 SW Hunter Rd, N/A
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2020/TPI2014 Design Program: MiTek 20/20 8.4
Wind Code: N/A Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 46 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T22700766	CJ01	2/3/21	23	T22700788	T06	2/3/21
2	T22700767	CJ03	2/3/21	24	T22700789	T06G	2/3/21
3	T22700768	EJ01	2/3/21	25	T22700790	T07	2/3/21
4	T22700769	EJ02	2/3/21	26	T22700791	T08	2/3/21
5	T22700770	EJ03	2/3/21	27	T22700792	T09	2/3/21
6	T22700771	HJ08	2/3/21	28	T22700793	T09G	2/3/21
7	T22700772	PB01	2/3/21	29	T22700794	T10	2/3/21
8	T22700773	PB01G	2/3/21	30	T22700795	T11	2/3/21
9	T22700774	PB02	2/3/21	31	T22700796	T11G	2/3/21
10	T22700775	PB02G	2/3/21	32	T22700797	T12	2/3/21
11	T22700776	PB03	2/3/21	33	T22700798	T13	2/3/21
12	T22700777	PB04	2/3/21	34	T22700799	T14	2/3/21
13	T22700778	PB04G	2/3/21	35	T22700800	T15	2/3/21
14	T22700779	PB05	2/3/21	36	T22700801	T16	2/3/21
15	T22700780	PB06	2/3/21	37	T22700802	T16G	2/3/21
16	T22700781	T01	2/3/21	38	T22700803	T17	2/3/21
17	T22700782	T01G	2/3/21	39	T22700804	T18	2/3/21
18	T22700783	T02	2/3/21	40	T22700805	T18A	2/3/21
19	T22700784	T02G	2/3/21	41	T22700806	T19	2/3/21
20	T22700785	T03	2/3/21	42	T22700807	T20	2/3/21
21	T22700786	T04	2/3/21	43	T22700808	T21	2/3/21
22	T22700787	T05	2/3/21	44	T22700809	T22	2/3/21




The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource-Jacksonville.

Truss Design Engineer's Name: Velez, Joaquin

My license renewal date for the state of Florida is February 28, 2023.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

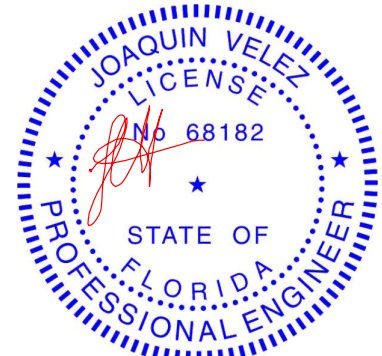

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021



RE: 2478882 - BLAKE CONST. - DAUGHTERS HSE

MiTek USA, Inc.
6904 Parke East Blvd.
Tampa, FL 33610-4115


Site Information:

Customer Info: Blake Const. Project Name: Lunde-Nickodam Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: 525 SW Hunter Rd, N/A
City: Columbia Cty State: FL

No.	Seal#	Truss Name	Date
45	T22700810	T22G	2/3/21
46	T22700811	TG01	2/3/21

Job 2478882	Truss CJ01	Truss Type Jack-Open	Qty 4	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700766
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:10 2021 Page 1
ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-VnCF2hGSAygT_qJenD8iYks14I89JHP9rtzmRzp8t3

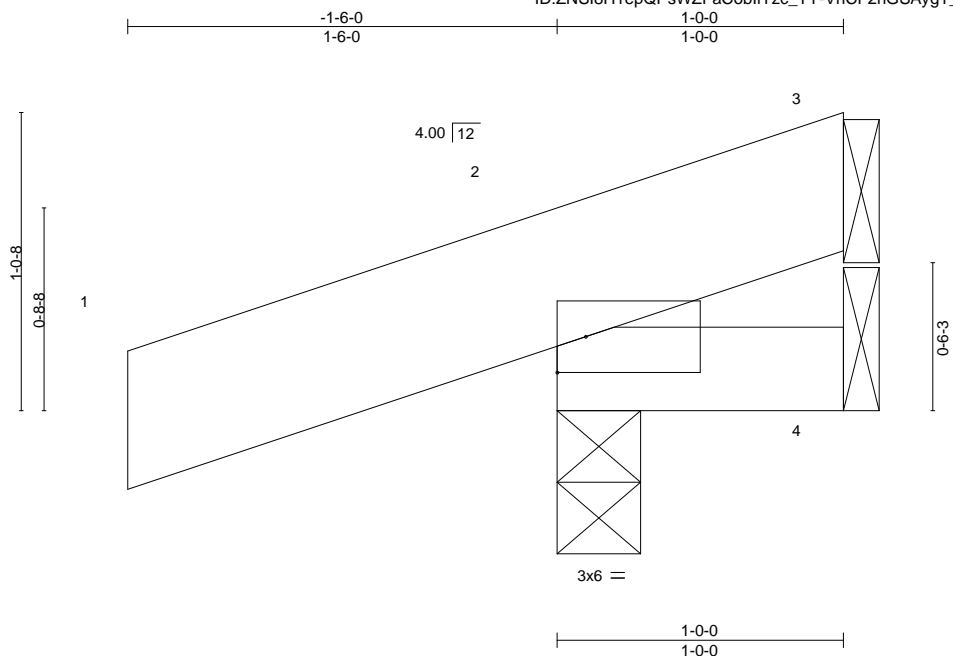

Scale: 1.5"=1'

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.07	Vert(LL)	0.00	7	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.02	Vert(CT)	0.00	7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
									Weight: 8 lb FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=48(LC 8)
Max Uplift 3=23(LC 1), 2=167(LC 8), 4=5(LC 9)
Max Grav 3=24(LC 8), 2=179(LC 1), 4=12(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 3, 167 lb uplift at joint 2 and 5 lb uplift at joint 4.

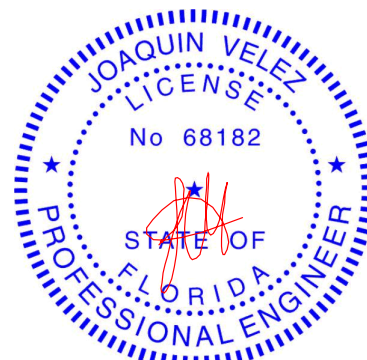

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 36610

Job 2478882	Truss CJ03	Truss Type Jack-Open	Qty 4	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700767
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					Job Reference (optional)

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:11 2021 Page 1
ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-zzmdF1H5xFoKb_uqLxfx5yOCq9Tj2kel4Xjltzp8t2

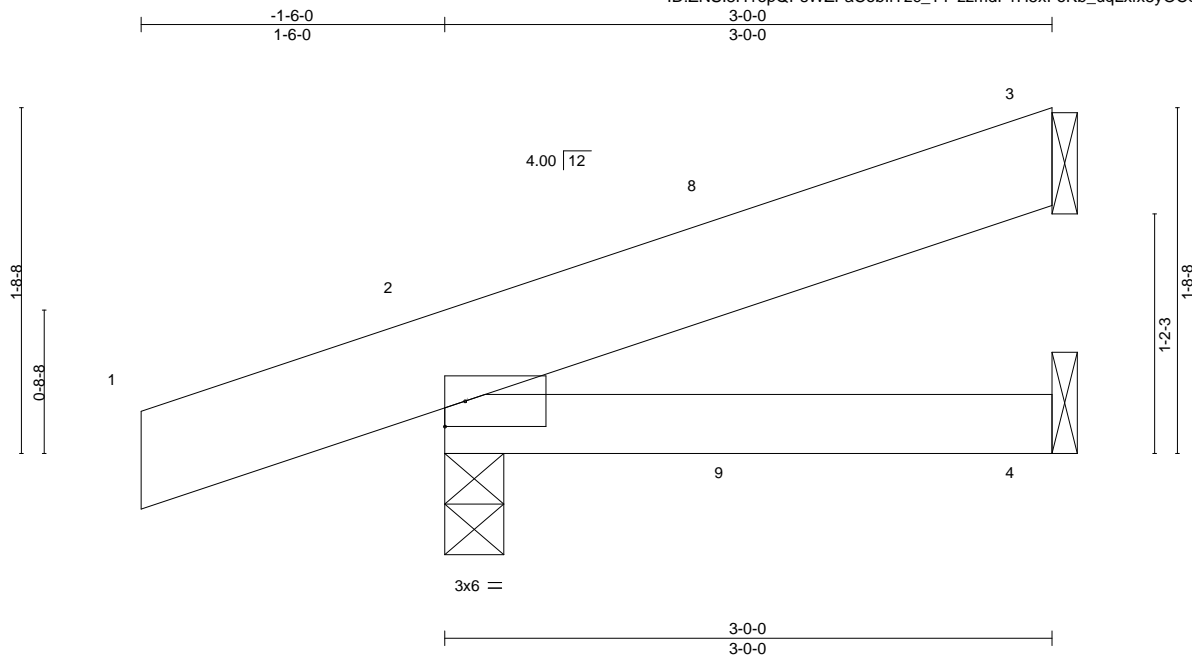

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.07	Vert(LL)	0.00	4-7	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.06	Vert(CT)	-0.00	4-7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
									Weight: 16 lb FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=80(LC 8)
Max Uplift 3=-56(LC 8), 2=-177(LC 8), 4=-22(LC 9)
Max Grav 3=65(LC 1), 2=210(LC 1), 4=46(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 2-11-4 zone; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 56 lb uplift at joint 3, 177 lb uplift at joint 2 and 22 lb uplift at joint 4.

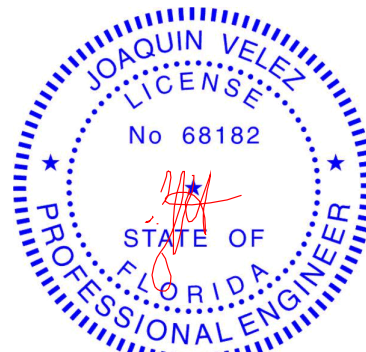

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700768
2478882	EJ01	Jack-Closed	12	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:12 2021 Page 1

ID:ZNSI8H1epQP5WZFaCobIIYzc_TY-SAK?TNljiZwBD8T0ueAA9xCbZkenBuSJBSSqJzp8t1

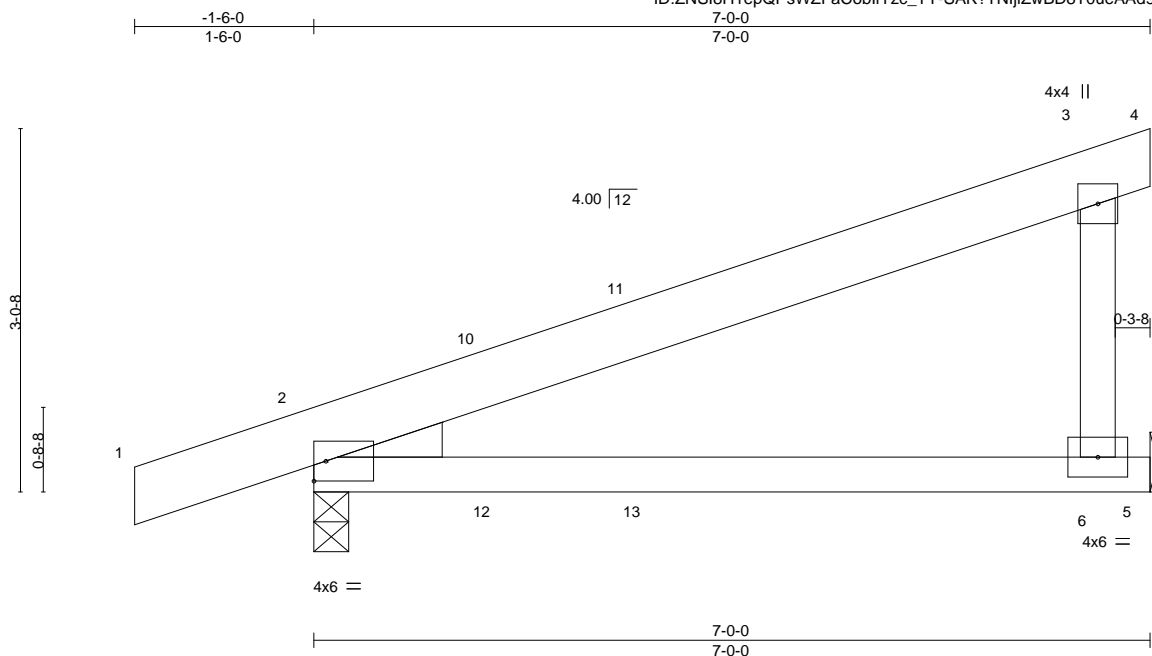

Scale = 1:19.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.77	Vert(LL)	0.12	6-9	>705	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.34	Vert(CT)	0.10	6-9	>831	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 36 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 5=Mechanical
Max Horz 2=145(LC 8)
Max Uplift 2=269(LC 8), 5=214(LC 8)
Max Grav 2=346(LC 1), 5=251(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-6=-181/314

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 7-0-0 zone; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 269 lb uplift at joint 2 and 214 lb uplift at joint 5.

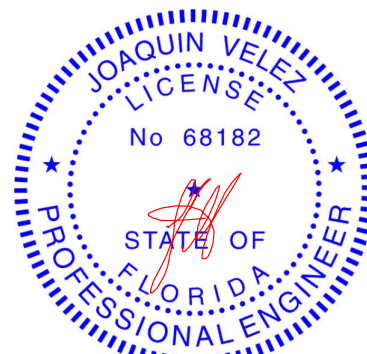

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700769
2478882	EJ02	Monopitch	3	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:13 2021 Page 1

ID:ZNSI8H1epQP5WZFaCoblIYzc_TY-wMuNgjILt1rH2DSMhPANUWAY6GWc3bYrCPNmzp8t0

Job Reference (optional)

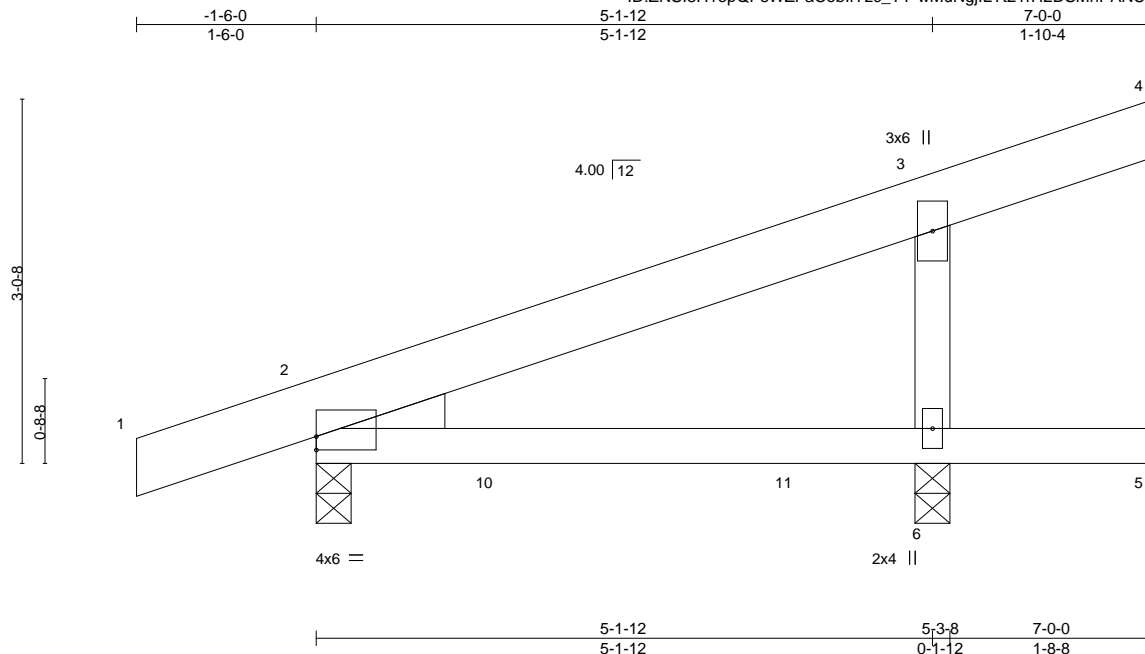


Plate Offsets (X,Y)-- [2:0-0-0,0-1-6]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.21	Vert(LL)	0.05	6-9	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.25	Vert(CT)	0.05	6-9	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.13	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							Weight: 36 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 6=0-3-8
Max Horz 2=142(LC 8)
Max Uplift 2=204(LC 8), 6=226(LC 8)
Max Grav 2=258(LC 1), 6=341(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-6=-250/449

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 7-0-0 zone; end vertical left exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 204 lb uplift at joint 2 and 226 lb uplift at joint 6.

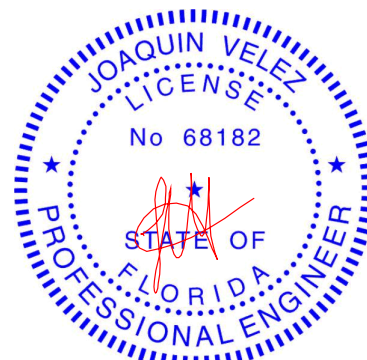

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700770
2478882	EJ03	Jack-Open	2	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:13 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-wMuNgjILt21rH2DSMhPANUW6y6eWe8bYrCPNmzp8t0

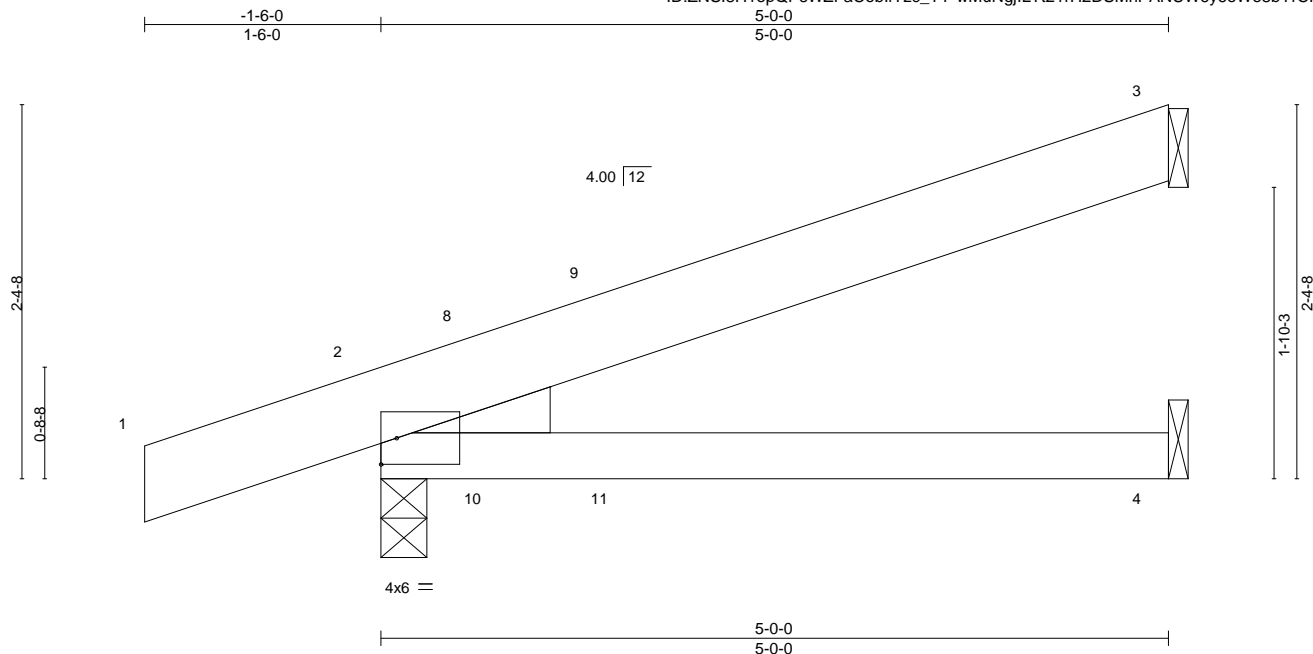

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.21	Vert(LL)	0.04	4-7	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.22	Vert(CT)	-0.04	4-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						Weight: 25 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2

BOT CHORD 2x4 SP No.2

WEDGE

Left: 2x4 SP No.3

BRACING-

TOP CHORD

Structural wood sheathing directly applied or 5-0-0 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical

Max Horz 2=112(LC 8)


Max Uplift 3=-109(LC 8), 2=-220(LC 8), 4=-38(LC 8)

Max Grav 3=126(LC 1), 2=276(LC 1), 4=79(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 4-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 109 lb uplift at joint 3, 220 lb uplift at joint 2 and 38 lb uplift at joint 4.

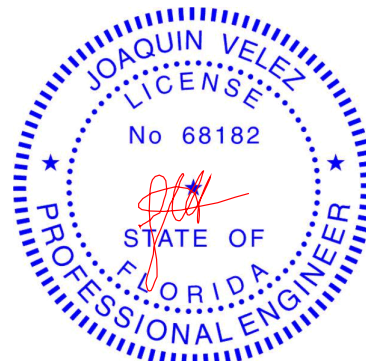

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700771
2478882	HJ08	Diagonal Hip Girder	2	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:14 2021 Page 1

ID:ZNSI8H1epQP5WZFaCobIIYzc_TY-OYSlt3JzEAAuSRcP03Ceia0f8MPZF5OkmVxzvCzp8t?



Scale = 1:17.0

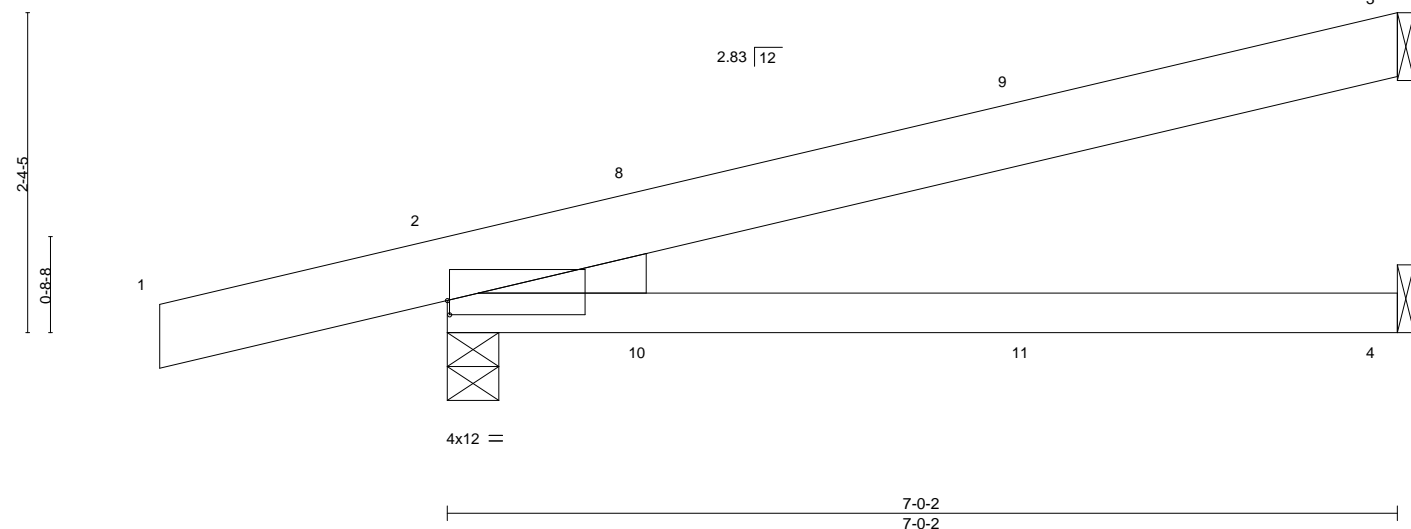


Plate Offsets (X,Y)--		[2:0-0-3,0-1-4]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/def	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.32		Vert(LL)	0.11 4-7	>786	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.43		Vert(CT)	-0.14 4-7	>577	180		
BCLL 0.0 *		Rep Stress Incr	NO	WB 0.00		Horz(CT)	-0.01 3	n/a	n/a		
BCDL 10.0		Code FBC2020/TPI2014		Matrix-MS						Weight: 34 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-9, 4=Mechanical
Max Horz 2=112(LC 4)
Max Uplift 3=131(LC 4), 2=255(LC 4), 4=53(LC 5)
Max Grav 3=171(LC 1), 2=353(LC 1), 4=110(LC 3)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 131 lb uplift at joint 3, 255 lb uplift at joint 2 and 53 lb uplift at joint 4.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 89 lb down and 99 lb up at 1-6-1, 89 lb down and 99 lb up at 1-6-1, and 31 lb down and 55 lb up at 4-4-0, and 31 lb down and 55 lb up at 4-4-0 on top chord, and 39 lb down and 8 lb up at 1-6-1, 39 lb down and 8 lb up at 1-6-1, and 15 lb down and 29 lb up at 4-4-0, and 15 lb down and 29 lb up at 4-4-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-5=-20
Concentrated Loads (lb)
Vert: 8=48(F=24, B=24) 9=-3(F=-2, B=-2) 11=-1(F=-0, B=-0)

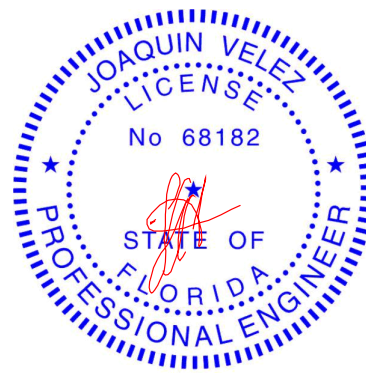

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610


Job 2478882	Truss PB01	Truss Type Piggyback	Qty 1	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700772
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:15 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-sk085PKb?UII4bBbamktFoZuVmrF_YRu?8hWRzpz8t_

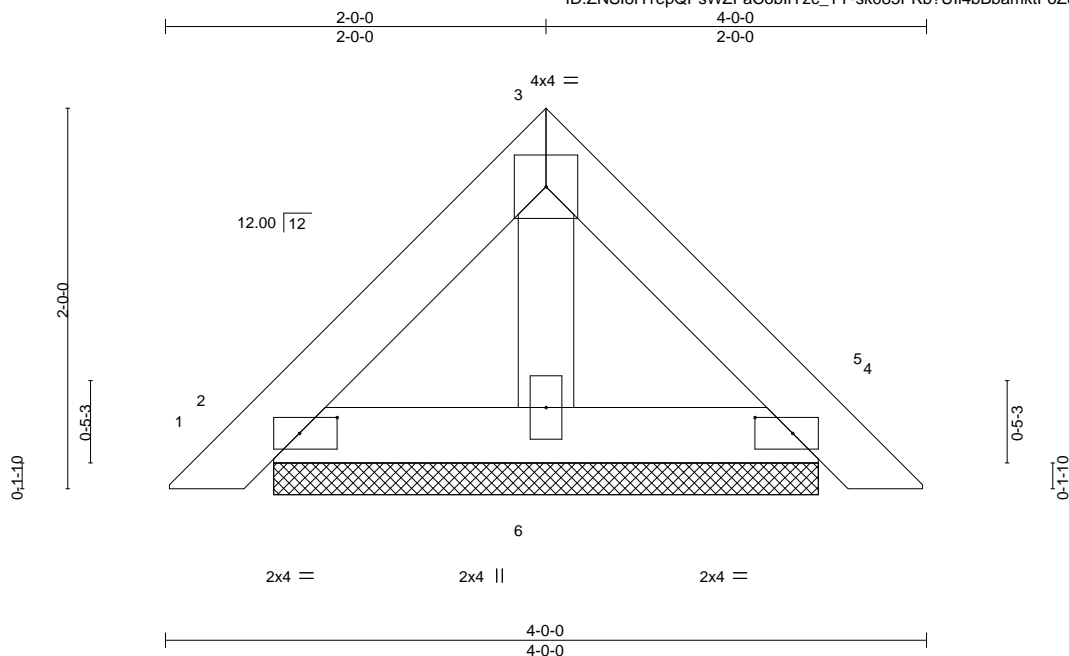

Scale: 1"=1'

Plate Offsets (X,Y)--		[2:0-2-6,0-1-0], [4:0-2-6,0-1-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES
TCLL 20.0	Plate Grip DOL	1.25	TC 0.09	Vert(LL)	0.00	4	n/r	120	GRIP
TCDL 7.0	Lumber DOL	1.25	BC 0.02	Vert(CT)	0.00	4	n/r	120	MT20
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.01	Horz(CT)	0.00	4	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-P						
									Weight: 14 lb
									FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 2=2-10-6, 4=2-10-6, 6=2-10-6
Max Horz 2=56(LC 11)
Max Uplift 2=-41(LC 12), 4=-47(LC 13), 6=-8(LC 12)
Max Grav 2=84(LC 1), 4=84(LC 1), 6=83(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 41 lb uplift at joint 2, 47 lb uplift at joint 4 and 8 lb uplift at joint 6.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

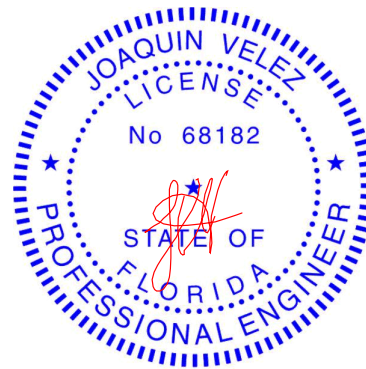

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700773
2478882	PB01G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:16 2021 Page 1

ID:ZNSI8H1epQPswZFaCobllYzc_TY-KxZWllLDmoQcilmn7UF6o?54sAB6j?u1EoQ3y5zp8sz

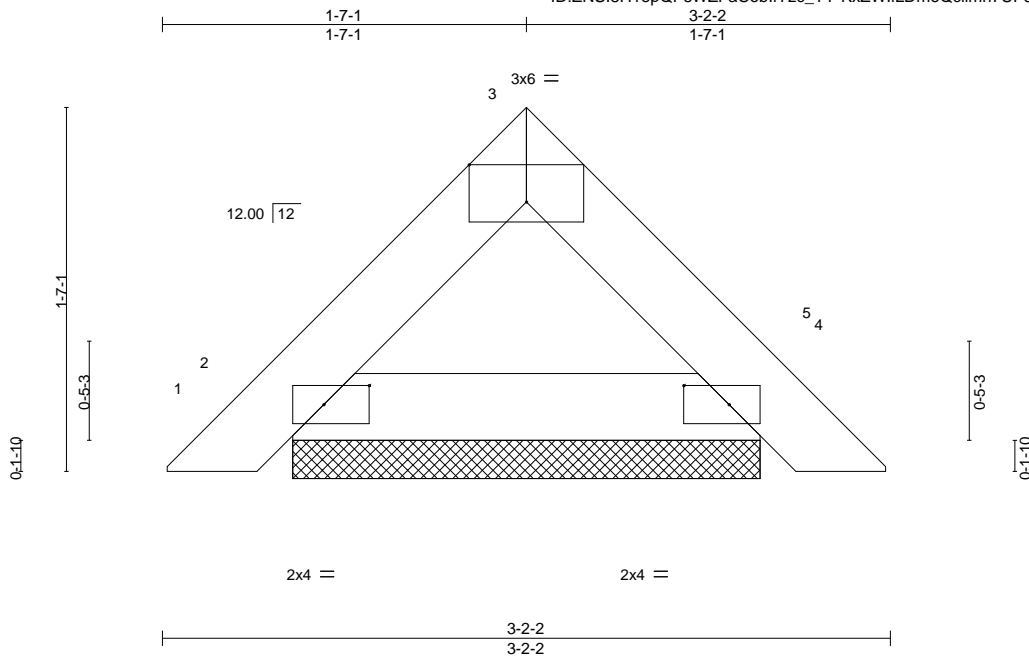

Scale = 1:10.1

Plate Offsets (X,Y)--		[2:0-2-6,0-1-0], [3:0-3-0,Edge], [4:0-2-6,0-1-0]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.25	TC 0.05	Vert(LL)	0.00	4	n/r	120	MT20	244/190	
TCDL 7.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	0.00	4	n/r	120			
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014		Matrix-P								
									Weight: 10 lb	FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-2-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 2=2-0-8, 4=2-0-8
Max Horz 2=43(LC 10)
Max Uplift 2=36(LC 12), 4=36(LC 13)
Max Grav 2=94(LC 1), 4=94(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 36 lb uplift at joint 2 and 36 lb uplift at joint 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

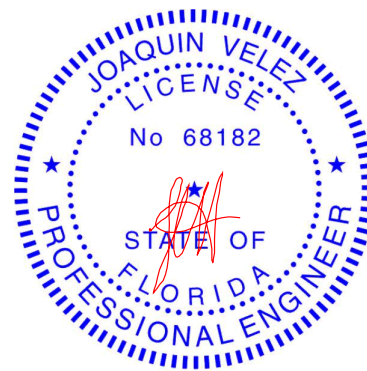

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610


Job 2478882	Truss PB02	Truss Type Piggyback	Qty 7	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700774
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:17 2021 Page 1

ID:ZNSI8H1epQPpsWZFaCobIIYzc_TY-o77uW5LrX5YTJvL_hBmLKDe9aaTiSR_BSSAdVXzp8sy

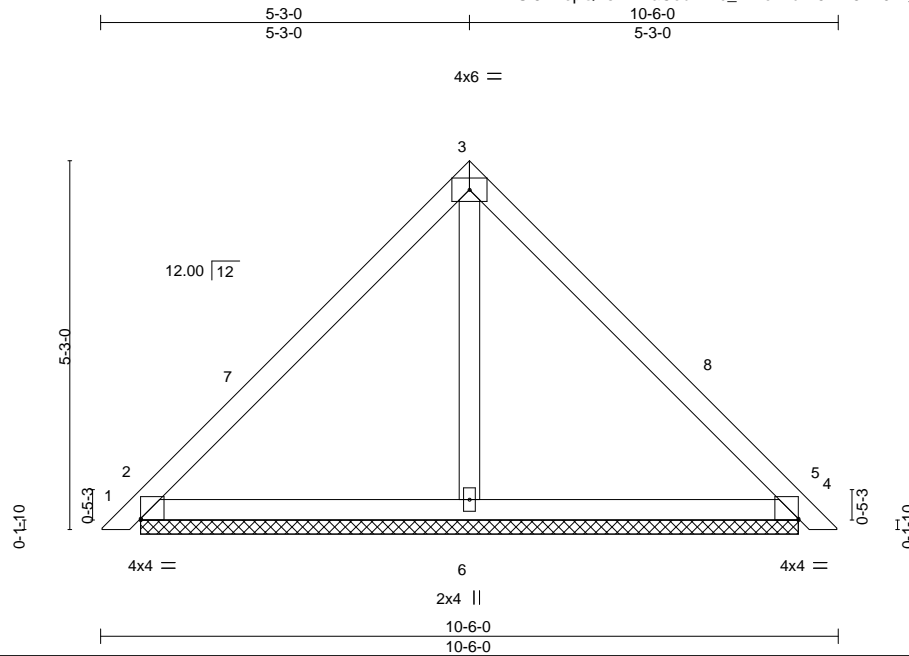

Scale = 1:32.8

Plate Offsets (X,Y)--		[2:Edge,0-0-4], [4:0-0-0,0-0-4]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.44
TCDL 7.0	Lumber DOL	1.25	BC 0.28
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.01 5 n/r 120
			Vert(CT) 0.01 5 n/r 120
			Horz(CT) 0.00 4 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 43 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.


REACTIONS.

(size) 2=9-4-6, 4=9-4-6, 6=9-4-6
Max Horz 2=157(LC 10)
Max Uplift 2=90(LC 13), 4=97(LC 13), 6=86(LC 12)
Max Grav 2=211(LC 1), 4=211(LC 1), 6=309(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-2-10 to 3-2-10, Interior(1) 3-2-10 to 5-3-0, Exterior(2R) 5-3-0 to 8-3-0, Interior(1) 8-3-0 to 10-3-6 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 90 lb uplift at joint 2, 97 lb uplift at joint 4 and 86 lb uplift at joint 6.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

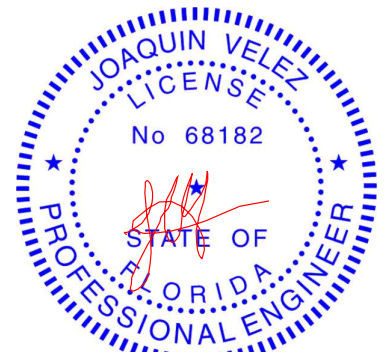

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 36610


Job 2478882	Truss PB02G	Truss Type GABLE	Qty 1	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700775
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:18 2021 Page 1

ID:ZNSI8H1epQPpWZFaCobIIYzc_TY-GJhGjQMUIPgKx3wAFvHatQBN6zrsBucKh6vA1zzp8sx

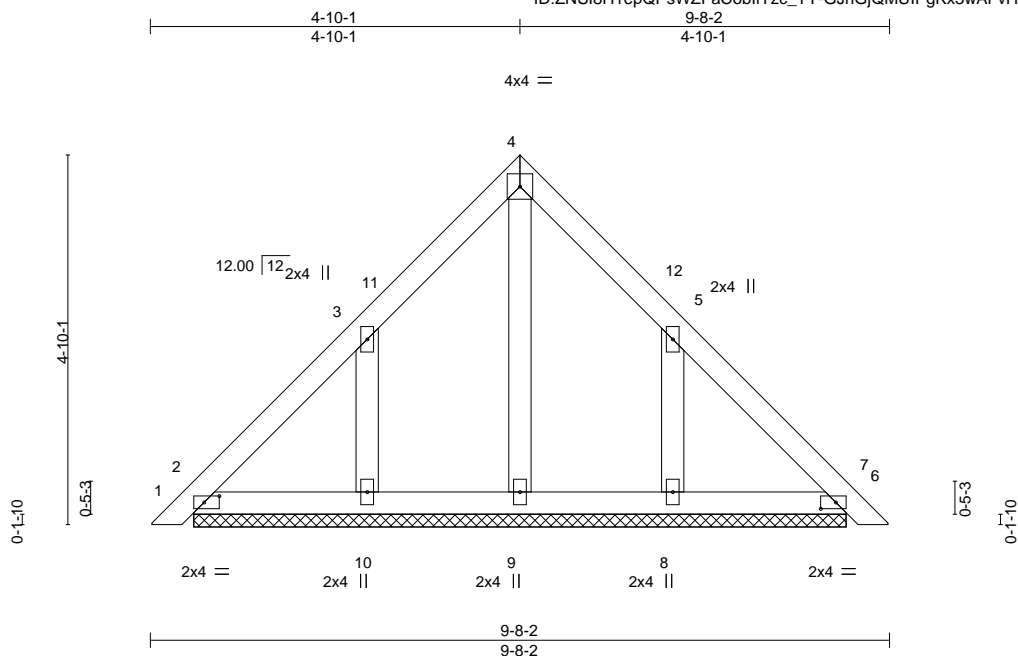

Scale = 1:30.2

Plate Offsets (X,Y)--		[2:0-2-6,0-1-0], [6:0-2-6,0-1-0]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.25	TC 0.13	Vert(LL)	0.00	6	n/r	120	MT20	244/190	
TCDL 7.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	0.00	6	n/r	120			
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.00	6	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S								
										Weight: 45 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


- All bearings 8-6-8.
(lb) - Max Horz 2=144(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 6 except 10=216(LC 12), 8=215(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 6, 9, 10, 8

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-10=210/382, 5-8=211/381

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-2-10 to 3-2-10, Exterior(2N) 3-2-10 to 4-10-1, Corner(3R) 4-10-1 to 7-10-1, Exterior(2N) 7-10-1 to 9-5-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6 except (jt=lb) 10=216, 8=215.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

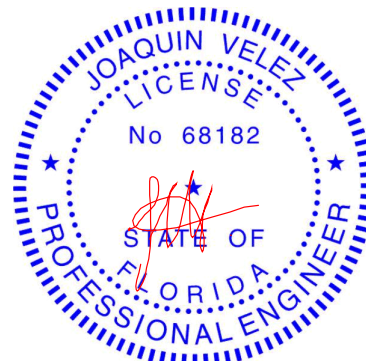

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 36610


Job 2478882	Truss PB04	Truss Type GABLE	Qty 16	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700777
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:21 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-huNPLSPMbK3voWflw1qHV3ptuBt4OFBmN48qelzp8su

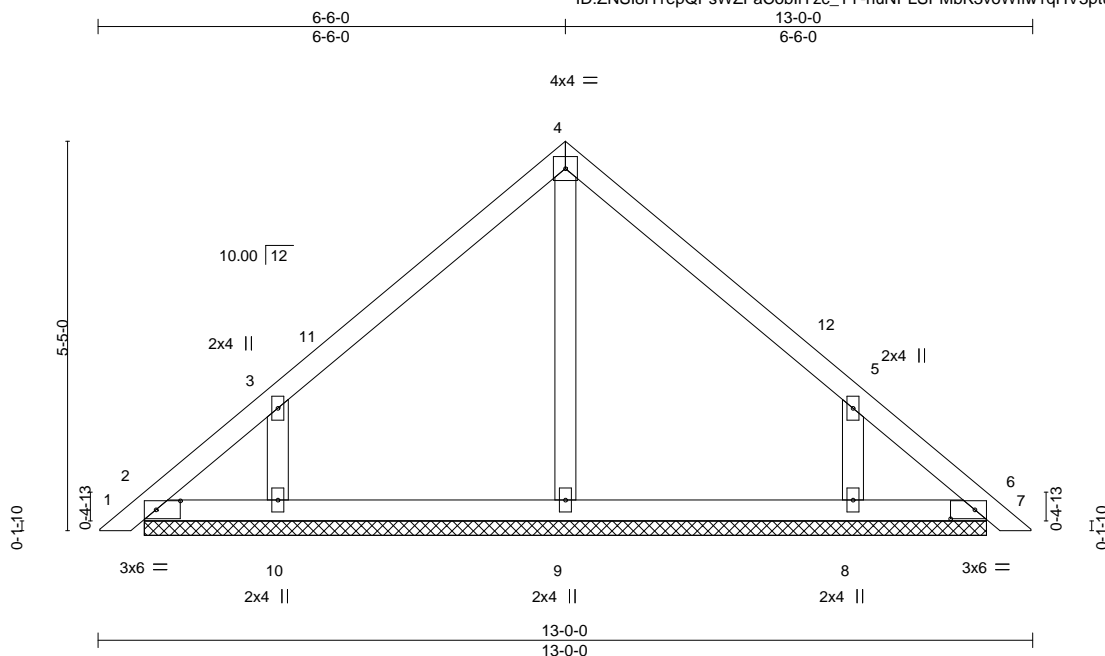

Scale: 3/8"=1'

Plate Offsets (X,Y)-- [2:0-4-1,0-1-8], [6:0-4-1,0-1-8]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.23	Vert(LL)	-0.00 6	n/r	120
TCDL 7.0	Lumber DOL	1.25	BC 0.12	Vert(CT)	-0.00 6	n/r	120
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	0.00 6	n/a	n/a
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S				
				PLATES	GRIP		
				MT20	244/190		
				Weight: 54 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.

All bearings 11-8-9.

(lb) - Max Horz 2=-162(LC 10)

Max Uplift All uplift 100 lb or less at joint(s) 2, 6 except 10=-261(LC 12), 8=-260(LC 13)


Max Grav All reactions 250 lb or less at joint(s) 2, 6, 9 except 10=318(LC 19), 8=317(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-10=-256/417, 5-8=-255/416

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-2-14 to 3-2-14, Exterior(2N) 3-2-14 to 6-6-0, Corner(3R) 6-6-0 to 9-6-0, Exterior(2N) 9-6-0 to 12-9-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4'-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6 except (jt=lb) 10=261, 8=260.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

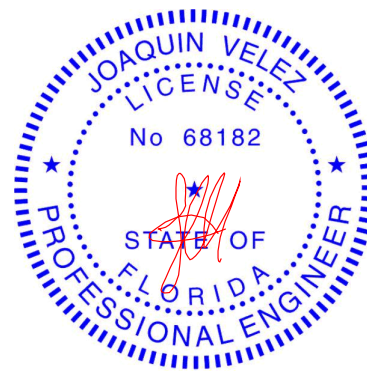

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2478882	Truss PB04G	Truss Type GABLE	Qty 2	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700778
----------------	----------------	---------------------	----------	----------	---

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:22 2021 Page 1

ID:ZNSI8H1epQPswZFaCobIIYzc_TY-95xnZoP_MeBmQgExUIMW1GL4rbEh7ilwcktOAKzp8st

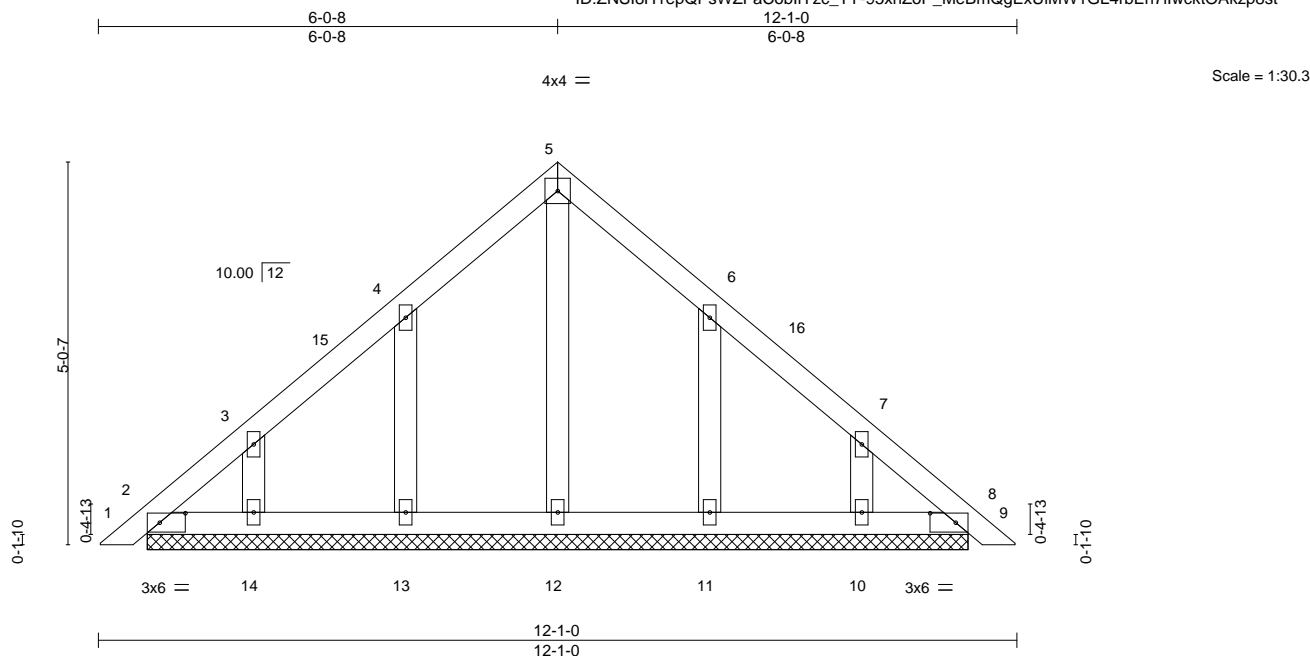


Plate Offsets (X,Y)--		[2:0-4-1,0-1-8], [8:0-4-1,0-1-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.08
TCDL 7.0	Lumber DOL	1.25	BC 0.03
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.00 8 n/r 120
			Vert(CT) 0.00 8 n/r 120
			Horz(CT) 0.00 8 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 57 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

- All bearings 10-9-9.
(lb) - Max Horz 2=151(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8 except 13=146(LC 12), 14=130(LC 12), 11=145(LC 13),
10=129(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-2-14 to 3-2-14, Exterior(2N) 3-2-14 to 6-0-8, Corner(3R) 6-0-8 to 9-0-8, Exterior(2N) 9-0-8 to 11-10-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8 except (jt=lb) 13=146, 14=130, 11=145, 10=129.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

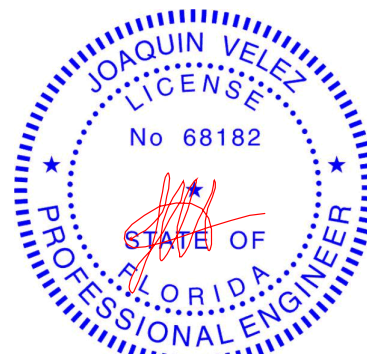

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700779
2478882	PB05	GABLE	2	2	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:23 2021 Page 1

ID:ZNSI8H1epQPswZFaCobIIYzc_TY-dHU9m8Qc6xJd1qo82StlaUuF9_aVsAe3rOdxIBzp8ss

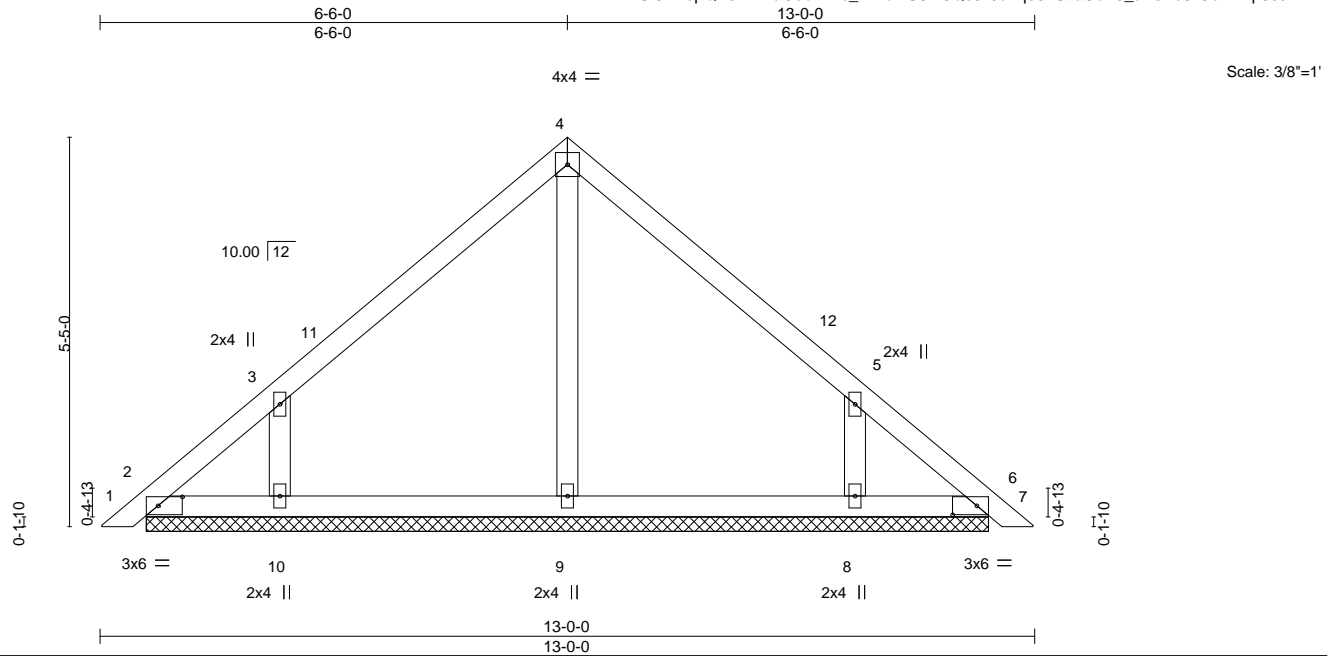


Plate Offsets (X,Y)-- [2:0-4-1,0-1-8], [6:0-4-1,0-1-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.11	Vert(LL)	-0.00	6	n/r	120	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.06	Vert(CT)	-0.00	6	n/r	120		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-S							Weight: 107 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.


- All bearings 11-8-9.
(lb) - Max Horz 2=-162(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 6 except 10=-261(LC 12), 8=-260(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 6, 9 except 10=318(LC 19), 8=317(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-10=-256/417, 5-8=-255/416

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-2-14 to 3-2-14, Exterior(2N) 3-2-14 to 6-6-0, Corner(3R) 6-6-0 to 9-6-0, Exterior(2N) 9-6-0 to 12-9-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4'-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6 except (jt=lb) 10=261, 8=260.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

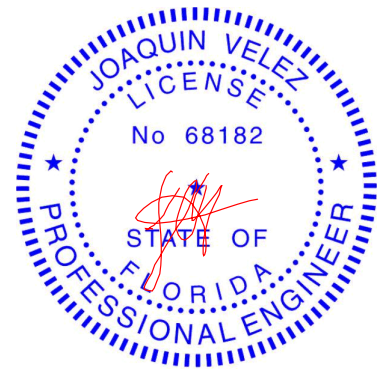

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2478882	Truss PB06	Truss Type GABLE	Qty 2	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700780 Job Reference (optional)
----------------	---------------	---------------------	----------	----------	---

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:24 2021 Page 1

ID:ZNSI8H1epQP5WZFaCobIIYzc_TY-5T2X_URetFRUF_NKb9O_6hROEOuUbbQD32MUEdZp8sr

Scale = 1:30.2

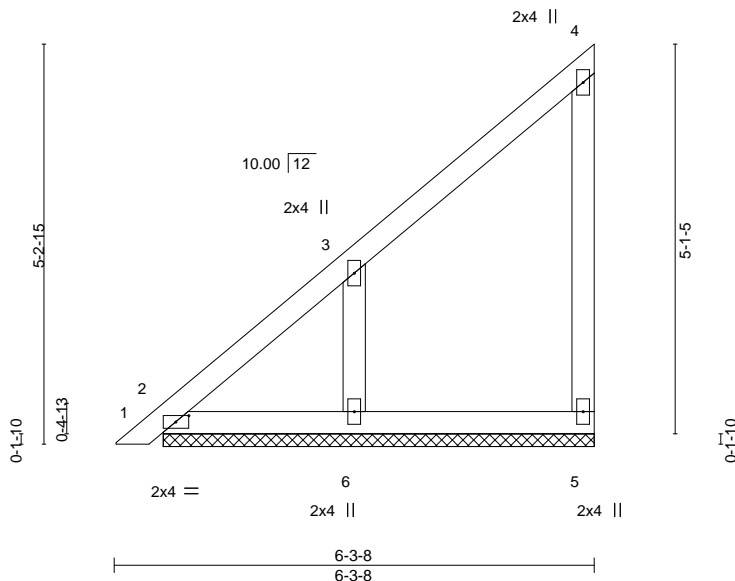


Plate Offsets (X,Y)--		[2:0-2-1,0-1-0]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d
TCLL 20.0		Plate Grip DOL	1.25	TC 0.22		Vert(LL)	-0.00 1	n/r	120
TCDL 7.0		Lumber DOL	1.25	BC 0.08		Vert(CT)	-0.00 1	n/r	120
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.16		Horz(CT)	0.00	n/a	n/a
BCDL 10.0		Code FBC2020/TPI2014		Matrix-P					
						PLATES	GRIP		
						MT20	244/190		
						Weight: 30 lb	FT = 20%		

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=5-7-13, 2=5-7-13, 6=5-7-13
Max Horz 2=238(LC 12)
Max Uplift 5=81(LC 12), 2=3(LC 10), 6=239(LC 12)
Max Grav 5=102(LC 19), 2=125(LC 21), 6=297(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-495/228
WEBS 3-6=-296/527

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-2-14 to 3-1-12, Exterior(2N) 3-1-12 to 6-1-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2 except (jt=lb) 6=239.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

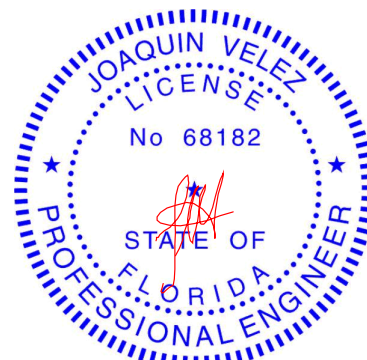

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700781
2478882	T01	Attic	1	1		


Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:25 2021 Page 1

ID:ZNSI8H1epQP5WZFaCobllYzc_TY-ZgcwBqSteZZKH7yW9tvDfuzOAo7hK_qMli62n3zp8sq

Job Reference (optional)

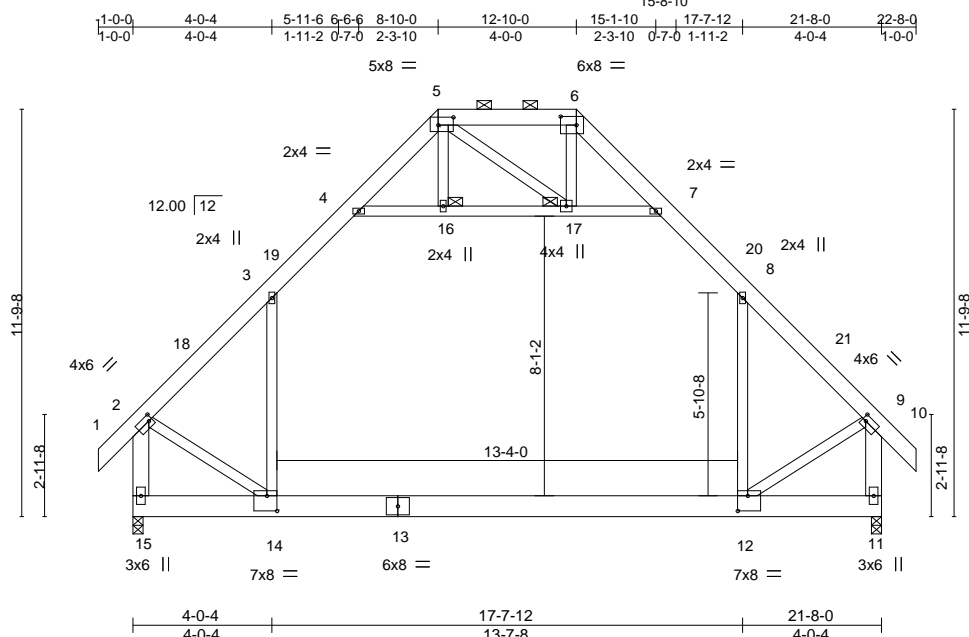

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700782
2478882	T01G	GABLE	1	1		


Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:27 2021 Page 1

ID:ZNSI8H1epQPswZFaCoblYzc_TY-V2kgcVT7AAp2WR6vHlxhkJ3secp?ot6fm0b9ryzp8so

Job Reference (optional)

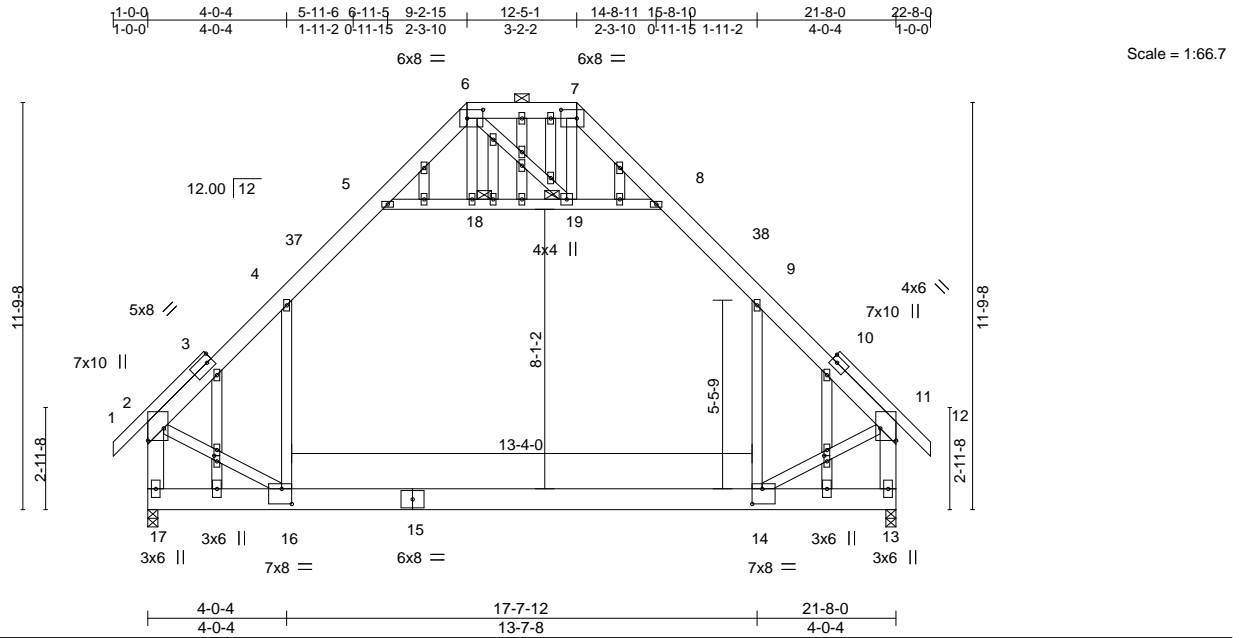

Scale = 1:66.7

Plate Offsets (X,Y)--	[2:Edge,0-5-8], [6:0-5-8,0-3-0], [7:0-5-8,0-3-0], [11:Edge,0-5-8], [14:0-3-8,0-5-4], [16:0-3-8,0-5-4], [25:0-1-15,0-1-0], [30:0-1-15,0-1-0]					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl
TCLL 20.0	Plate Grip DOL	1.25	TC 0.40	Vert(LL)	-0.35 14-16	>725 240
TCDL 7.0	Lumber DOL	1.25	BC 0.54	Vert(CT)	-0.54 14-16	>468 180
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.42	Horz(CT)	0.01 13	n/a n/a
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS	Attic	-0.27 14-16	603 360
						Weight: 231 lb FT = 20%

LUMBER-

TOP CHORD 2x6 SP M 26 *Except*
6-7: 2x6 SP No.2, 1-3,10-12: 2x4 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
2-17,11-13: 2x6 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 18, 19

REACTIONS.


(size) 17=0-3-8, 13=0-3-8
Max Horz 17=-414(LC 10)
Max Uplift 17=-95(LC 12), 13=-95(LC 13)
Max Grav 17=1405(LC 2), 13=1405(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1433/109, 4-5=-862/232, 8-9=-862/247, 9-11=-1432/109, 2-17=-1739/134, 11-13=-1739/146
BOT CHORD 16-17=-413/435, 14-16=-64/959
WEBS 4-16=0/814, 5-18=-1040/226, 18-19=-1038/227, 8-19=-1045/228, 9-14=0/814, 2-16=-98/1100, 11-14=-101/1102

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 9-2-15, Exterior(2E) 9-2-15 to 12-5-1, Exterior(2R) 12-5-1 to 16-8-0, Interior(1) 16-8-0 to 22-8-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 8-9, 5-18, 18-19, 8-19; Wall dead load (5.0psf) on member(s).4-16, 9-14
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 14-16
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17, 13.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

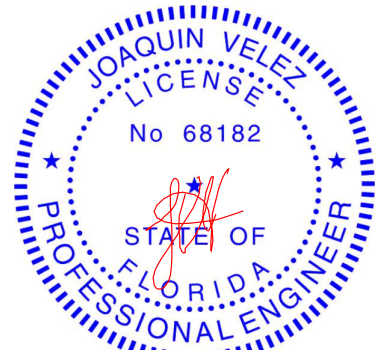

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700782
2478882	T01G	GABLE	1	1	Job Reference (optional)	

- NOTES-**
- 14) NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS. TRUSS DESIGN SHALL BE REVIEWED AND APPROVED PRIOR TO MANUFACTURING.
- 15) Attic room checked for L/360 deflection.



Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700783
2478882	T02	Attic	1	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:28 2021 Page 1
ID:ZNSI8H1epQPsWZFaCobIIYzc_TY_-FI2prUlxUxv8bh5q?TwHXby8?8BFXZo_gKINOzp8sn

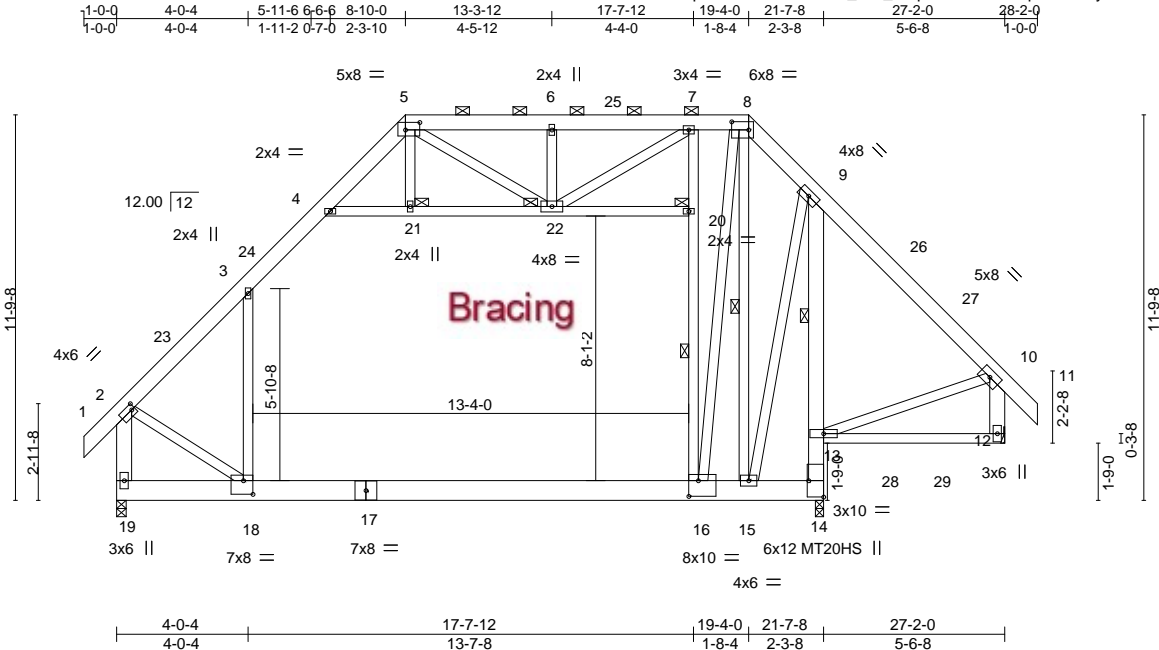



Plate Offsets (X,Y)-- [2:0-1-4,0-2-0], [5:0-5-4,0-2-12], [8:0-6-4,0-3-0], [14:Edge,0-5-8], [16:0-3-8,0-5-12], [18:0-3-8,0-5-0]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.74	Vert(LL)	-0.31 16-18	>820	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.60	Vert(CT)	-0.49 16-18	>522	180	MT20HS	187/143
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.72	Horz(CT)	0.09 12	n/a	n/a		
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS		Attic	-0.26 16-18	641	360	Weight: 314 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-4-9 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8. Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 13-14.
BOT CHORD	2x8 SP 2400F 2.0E *Except* 9-14: 2x6 SP No.2, 12-13: 2x4 SP No.2	BOT CHORD	
WEBS	2x4 SP No.3 *Except* 2-19,10-12: 2x6 SP No.2	WEBS	1 Row at midpt 9-13
		JOINTS	1 Row at midpt 16-20, 8-15 1 Brace at Jt(s): 20, 21, 22

REACTIONS. (size) 19=0-3-8, 14=0-3-0, 12=Mechanical
Max Horz 19=-405(LC 10)
Max Uplift 19=-187(LC 12), 14=-523(LC 8), 12=-461(LC 12)
Max Grav 19=1661(LC 2), 14=604(LC 22), 12=1337(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1502/68, 3-4=-1139/271, 4-5=-659/254, 5-6=-861/333, 6-7=-861/333, 7-8=-977/340, 8-9=-1122/432, 9-10=-1312/498, 2-19=-1832/103, 10-12=-1307/472
BOT CHORD 18-19=-364/421, 16-18=-218/1097, 15-16=-205/888, 14-15=-239/846, 13-14=-722/573, 9-13=-835/373
WEBS 3-18=-91/600, 16-20=-357/289, 7-20=-261/299, 8-16=-45/1520, 8-15=-923/0, 9-15=-73/632, 4-21=-693/120, 21-22=-690/121, 2-18=0/1059, 10-13=-256/923, 6-22=-266/226, 5-22=-115/576, 7-22=-309/194

- NOTES-
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 8-10-0, Exterior(2R) 8-10-0 to 13-3-12, Interior(1) 13-3-12 to 19-4-0, Exterior(2R) 19-4-0 to 23-6-15, Interior(1) 23-6-15 to 28-2-0 zone; end vertical left and right exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are MT20 plates unless otherwise indicated.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 8) Ceiling dead load (5.0 psf) on member(s). 3-4, 4-21, 21-22, 20-22; Wall dead load (5.0psf) on member(s).3-18, 16-20
 - 9) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 16-18
 - 10) Refer to girder(s) for truss to truss connections.
 - 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=187, 14=523, 12=461.
 - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

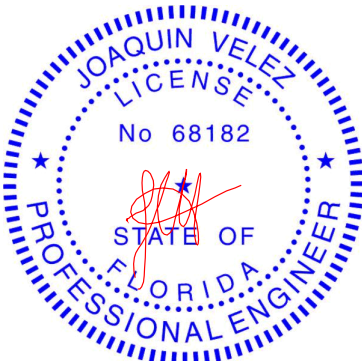

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700783
2478882	T02	Attic	1	1	Job Reference (optional)	

- NOTES-**
- 13) NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS. TRUSS DESIGN SHALL BE REVIEWED AND APPROVED PRIOR TO MANUFACTURING.
- 14) Attic room checked for L/360 deflection.



Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700784
2478882	T02G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:30 2021 Page 1

ID:ZNSi8H1epQP5WZFaCobIIYzc_TY-wdQpEXW?T5BdNvrUyQVOMyhlYpos?Al5S_ppSHzp8sl

1-0-0 4-0-4 5-11-6 6-6-6 8-10-0 13-3-12 17-7-12 18-11-1 21-7-8 27-2-0 28-2-0
1-0-0 4-0-4 1-11-2 0-7-0 2-3-10 4-5-12 4-4-0 1-3-5 2-8-7 5-6-8 1-0-0

Scale = 1:70.5

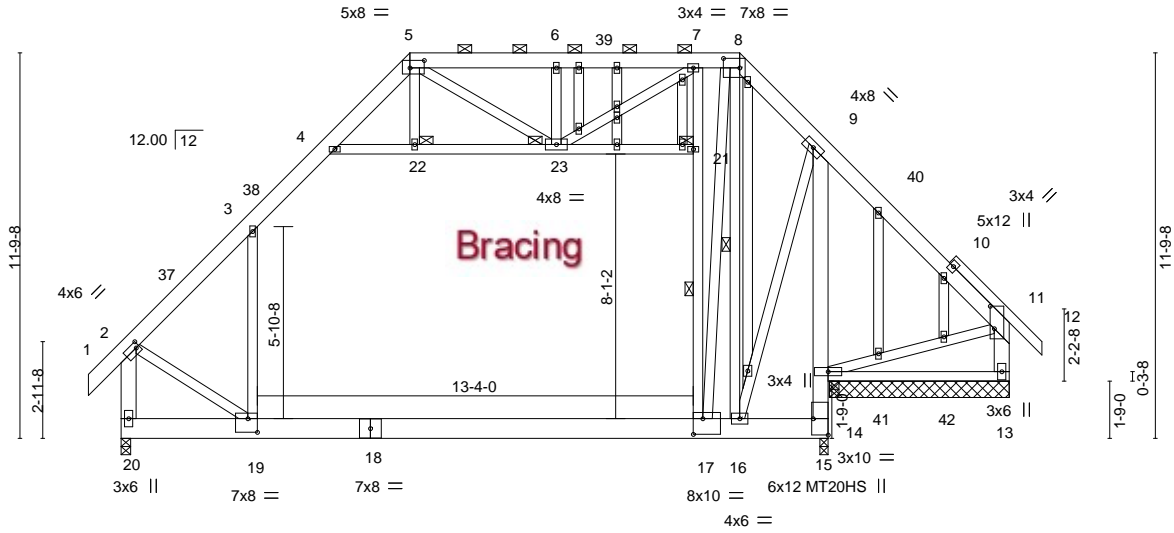


Plate Offsets (X,Y)--	[2:0-1-4,0-2-0], [5:0-5-4,0-2-12], [8:0-6-0,0-3-8], [11:0-8-4,0-1-8], [15:Edge,0-5-8], [17:0-3-8,0-5-12], [19:0-3-8,0-5-0]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.74	Vert(LL)	-0.31 17-19	>810	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.72	Vert(CT)	-0.49 17-19	>515	180	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.64	Horz(CT)	0.10 13	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS	Attic	-0.26 17-19	631	360		
								Weight: 347 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 10-12: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-4-9 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8.
BOT CHORD 2x8 SP 2400F 2.0E *Except* 9-15: 2x6 SP No.2, 13-14: 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 2-20,11-13: 2x6 SP No.2	WEBS 1 Row at midpt 17-21, 8-16
OTHERS 2x4 SP No.3	JOINTS 1 Brace at Jt(s): 21, 22, 23


REACTIONS. All bearings 5-6-0 except (jt=length) 20=0-3-8, 15=0-3-0.
(lb) - Max Horz 20=-399(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) except 20=-185(LC 12), 15=-296(LC 18), 14=-529(LC 8), 13=-457(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 15 except 20=1648(LC 2), 14=906(LC 22), 14=480(LC 1), 13=1294(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1480/64, 3-4=-1122/269, 4-5=-657/253, 5-6=-850/330, 6-7=-850/330, 7-8=-963/337, 8-9=-1203/418, 9-11=-1311/504, 2-20=-1805/98, 11-13=-1256/465
BOT CHORD 19-20=-365/416, 17-19=-216/1079, 16-17=-202/935, 15-16=-252/847, 9-14=-995/339
WEBS 3-19=-97/594, 17-21=-341/297, 7-21=-245/306, 8-17=-84/1385, 8-16=-749/0, 9-16=-51/746, 4-22=-676/117, 22-23=-673/118, 2-19=0/1037, 11-14=-268/916, 6-23=-263/226, 5-23=-112/560, 7-23=-307/201

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 8-10-0, Exterior(2R) 8-10-0 to 13-3-12, Interior(1) 13-3-12 to 18-11-1, Exterior(2R) 18-11-1 to 23-2-0, Interior(1) 23-2-0 to 28-2-0 zone; end vertical left and right exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- na
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide

Continued on page 2

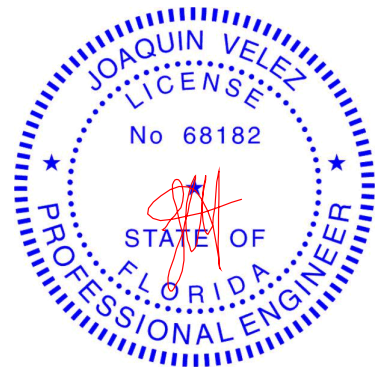

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700784
2478882	T02G	GABLE	1	1	Job Reference (optional)	

- NOTES-**
- 12) Ceiling dead load (5.0 psf) on member(s). 3-4, 4-22, 22-23, 21-23; Wall dead load (5.0psf) on member(s).3-19, 17-21
 - 13) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 17-19
 - 14) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 185 lb uplift at joint 20, 296 lb uplift at joint 15, 529 lb uplift at joint 14 and 457 lb uplift at joint 13.
 - 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 16) NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS. TRUSS DESIGN SHALL BE REVIEWED AND APPROVED PRIOR TO MANUFACTURING.
 - 17) Attic room checked for L/360 deflection.



Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700785
2478882	T03	Attic	4	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:32 2021 Page 1
ID:ZNSI8H1epQPpWZFaCobllYzc_TY-s0XZfDXG7iRLdC_s3rXsRNme8dV7T3XOvllwX9zp8sj

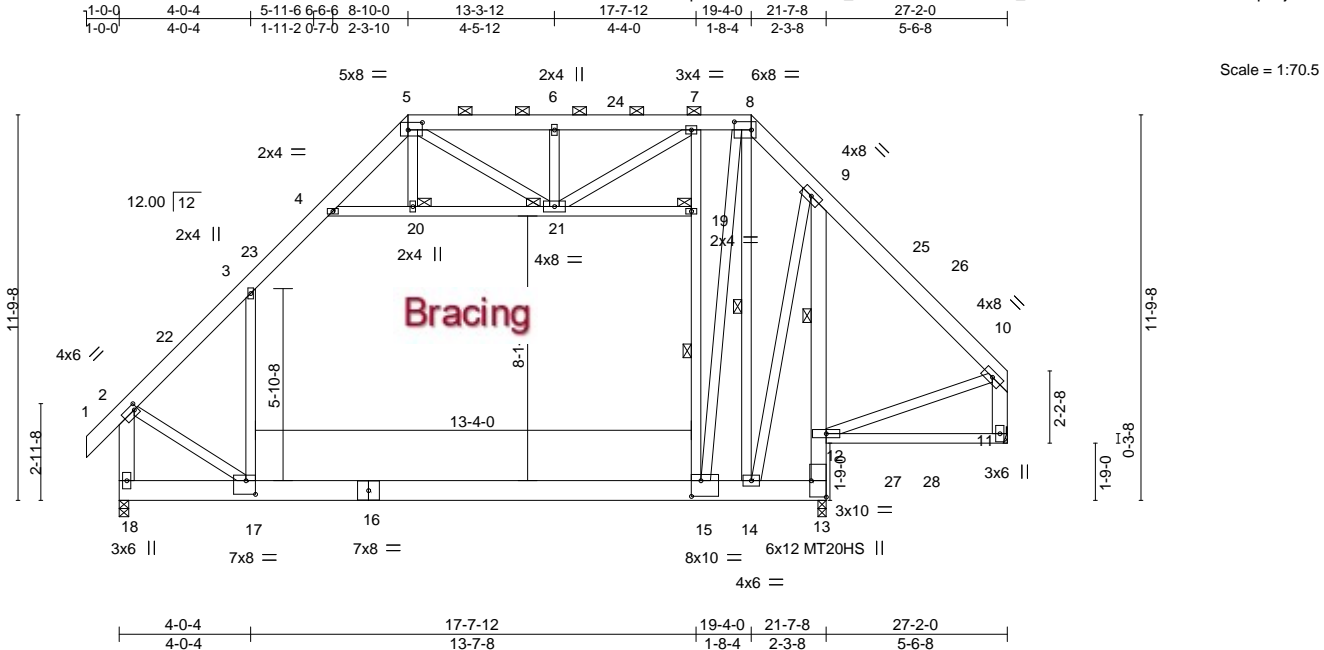

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.74	Vert(LL)	-0.31 15-17	>820	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.60	Vert(CT)	-0.49 15-17	>522	180	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.72	Horz(CT)	0.09 11	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS	Attic	-0.26 15-17	641	360	Weight: 311 lb	FT = 20%


LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-4-9 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8. Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 12-13.
BOT CHORD	2x8 SP 2400F 2.0E *Except* 9-13: 2x6 SP No.2, 11-12: 2x4 SP No.2	BOT CHORD	
WEBS	2x4 SP No.3 *Except* 2-18,10-11: 2x6 SP No.2	WEBS	1 Row at midpt 9-12
		JOINTS	1 Row at midpt 15-19, 8-14
			1 Brace at Jt(s): 19, 20, 21

REACTIONS.	(size) 18=0-3-8, 13=0-3-0, 11=Mechanical
	Max Horz 18=398(LC 9)
	Max Uplift 18=-184(LC 12), 13=-526(LC 8), 11=-446(LC 12)
	Max Grav 18=1661(LC 2), 13=608(LC 22), 11=1296(LC 20)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1502/62, 3-4=-1139/263, 4-5=-659/252, 5-6=-861/328, 6-7=-861/328, 7-8=-980/336, 8-9=-1130/429, 9-10=-1311/488, 2-18=-1832/95, 10-11=-1266/457
BOT CHORD	17-18=-380/395, 15-17=-232/1080, 14-15=-218/871, 13-14=-252/832, 12-13=-730/568, 9-12=-839/379
WEBS	3-17=-91/600, 15-19=-357/292, 7-19=-262/301, 8-15=-49/1521, 8-14=-921/0, 9-14=-74/626, 4-20=-693/116, 20-21=-690/117, 2-17=0/1059, 10-12=-263/917, 6-21=-266/224, 5-21=-110/576, 7-21=-309/194

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 8-10-0, Exterior(2R) 8-10-0 to 13-3-12, Interior(1) 13-3-12 to 19-4-0, Exterior(2R) 19-4-0 to 23-6-15, Interior(1) 23-6-15 to 26-11-4 zone; end vertical left and right exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (5.0 psf) on member(s). 3-4, 4-20, 20-21, 19-21; Wall dead load (5.0psf) on member(s). 3-17, 15-19
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 15-17
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 184 lb uplift at joint 18, 526 lb uplift at joint 13 and 446 lb uplift at joint 11.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Continued on page 2

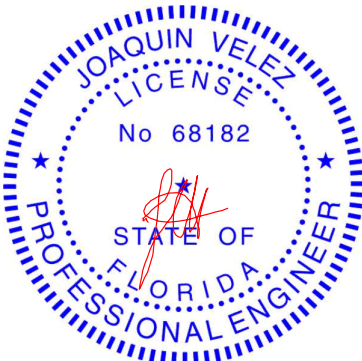

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


February 3, 2021

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700785
2478882	T03	Attic	4	1	Job Reference (optional)	

- NOTES-**
- 13) NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS. TRUSS DESIGN SHALL BE REVIEWED AND APPROVED PRIOR TO MANUFACTURING.
- 14) Attic room checked for L/360 deflection.

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700786
2478882	T04	Attic	2	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:34 2021 Page 1
ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-oOfJ4vZWKh3sW8FBGZKWoryoQAUXvnhNcn0b2zp8sh

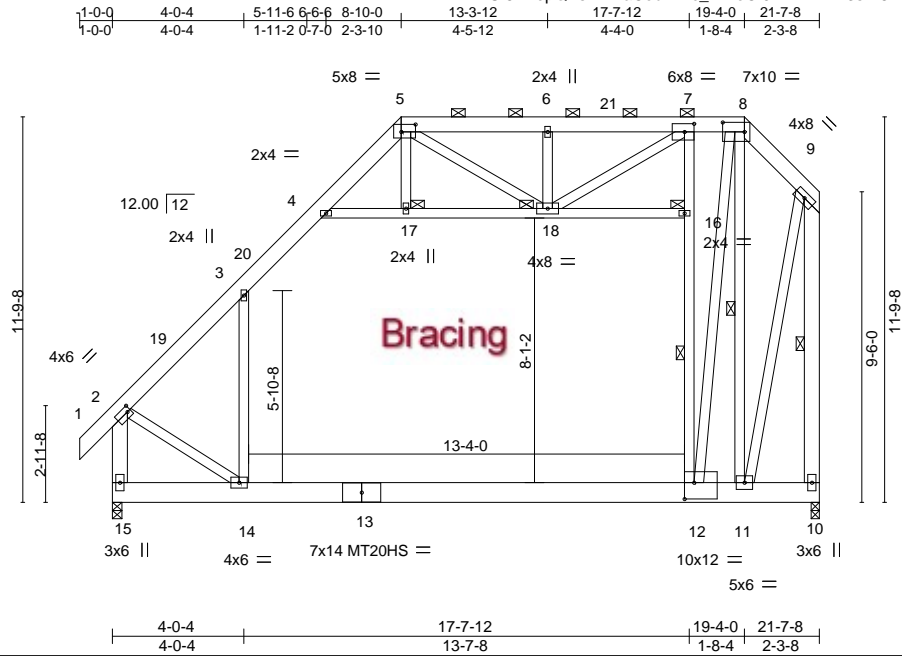

Scale = 1:70.5

Plate Offsets (X,Y)-- [2:0-1-4,0-2-0], [5:0-5-4,0-2-12], [7:0-3-8,0-3-0], [8:0-8-0,0-3-8], [12:0-3-8,0-6-0]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.79	Vert(LL)	-0.37 12-14	>686	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.68	Vert(CT)	-0.61 12-14	>415	180	MT20HS	187/143
BCLL	0.0 *	Rep Stress Incr	YES	WB	1.00	Horz(CT)	0.01 10	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS		Attic	-0.29 12-14	569	360	Weight: 272 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
2-15,9-10: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-11 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8.
BOT CHORD Rigid ceiling directly applied or 9-6-8 oc bracing.
WEBS 1 Row at midpt 12-16, 8-11, 9-10
JOINTS 1 Brace at Jt(s): 16, 17, 18

REACTIONS.


(size) 15=0-3-8, 10=0-3-0
Max Horz 15=372(LC 12)
Max Uplift 15=-25(LC 12), 10=-105(LC 9)
Max Grav 15=1414(LC 2), 10=1382(LC 2)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1123/0, 3-4=-836/123, 4-5=-589/216, 5-6=-591/219, 6-7=-591/219, 7-8=-633/168,
8-9=-588/120, 2-15=-1351/0, 9-10=-1915/260
BOT CHORD 14-15=-452/319, 12-14=-99/666, 11-12=-36/347
WEBS 3-14=-183/490, 12-16=-659/424, 7-16=-563/434, 8-12=-420/2276, 8-11=-1581/157,
4-17=-426/0, 17-18=-423/0, 2-14=-64/827, 9-11=-154/1494, 6-18=-194/252,
5-18=-142/310, 7-18=-276/228

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 8-10-0, Exterior(2R) 8-10-0 to 13-3-12, Interior(1) 13-3-12 to 19-4-0, Exterior(2E) 19-4-0 to 21-4-12 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 3-4, 4-17, 17-18, 16-18; Wall dead load (5.0psf) on member(s).3-14, 12-16
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 15 and 105 lb uplift at joint 10.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS. TRUSS DESIGN SHALL BE REVIEWED AND APPROVED PRIOR TO MANUFACTURING.
- Attic room checked for L/360 deflection.

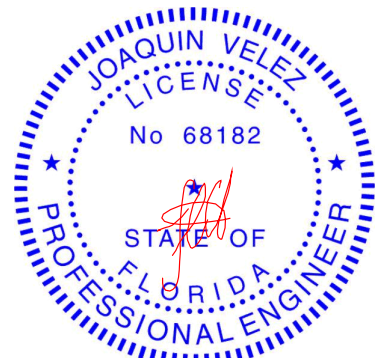

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700787
2478882	T05	ATTIC GIRDER	1	2	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:36 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobllYzc_TY-Inn4Vaam2xyn5qldlhcobDwGPErvPpH_qwG7gwzp8sf



Scale = 1:70.5

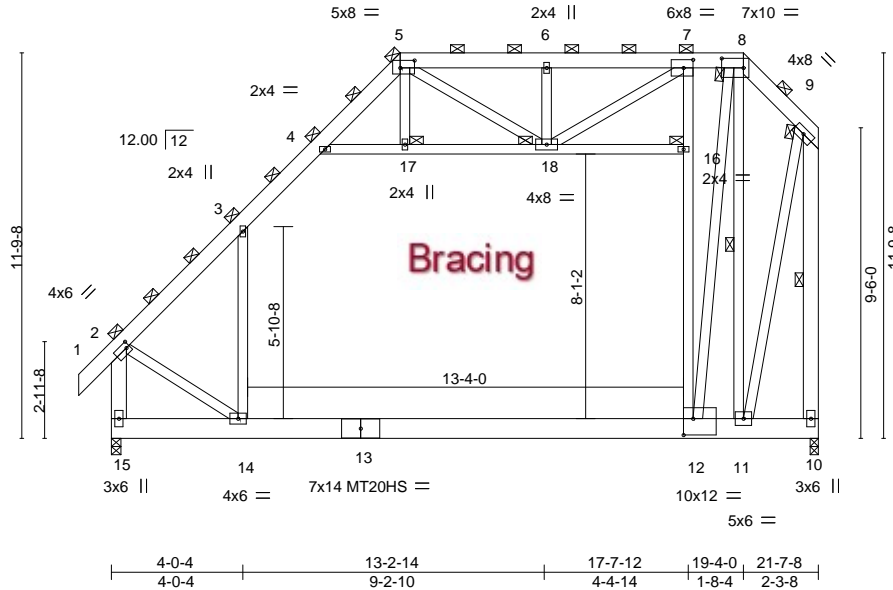


Plate Offsets (X,Y)--	[2:0-1-4,0-2-0], [5:0-5-4,0-2-12], [7:0-3-8,0-3-0], [8:0-8-0,0-3-8], [12:0-3-8,0-6-0]						
LOADING (psf)	SPACING-	4-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.91	Vert(LL)	-0.37 12-14	>686	240
TCDL 7.0	Lumber DOL	1.25	BC 0.74	Vert(CT)	-0.61 12-14	>415	180
BCLL 0.0 *	Rep Stress Incr	NO	WB 1.00	Horz(CT)	0.01 10	n/a	n/a
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS	Attic	-0.29 12-14	569	360
						Weight: 545 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3 *Except*
2-15,9-10: 2x6 SP No.2

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals
(Switched from sheathed: Spacing > 2-0-0).
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 8-11, 9-10
JOINTS 1 Brace at Jt(s): 5, 8, 9, 16, 2, 17, 18

REACTIONS.

(size) 15=0-3-8, 10=0-3-0
Max Horz 15=744(LC 8)
Max Uplift 15=50(LC 8), 10=210(LC 5)
Max Grav 15=2828(LC 2), 10=2763(LC 2)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2245/0, 3-4=-1671/148, 4-5=-1178/415, 5-6=-1182/438, 6-7=-1182/438,
7-8=-1267/285, 8-9=-1175/183, 2-15=-2701/0, 9-10=-3829/386
BOT CHORD 14-15=-903/639, 12-14=-193/1333, 11-12=-72/694
WEBS 3-14=-366/981, 12-16=-1317/848, 7-16=-1127/867, 8-12=-840/4551, 8-11=-3162/315,
4-17=-851/0, 17-18=-847/0, 2-14=-128/1655, 9-11=-308/2989, 6-18=-388/505,
5-18=-284/619, 7-18=-552/456

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; end vertical left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 3-4, 4-17, 17-18, 16-18; Wall dead load (5.0psf) on member(s). 3-14, 12-16
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 15 and 210 lb uplift at joint 10.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Continued on page 2

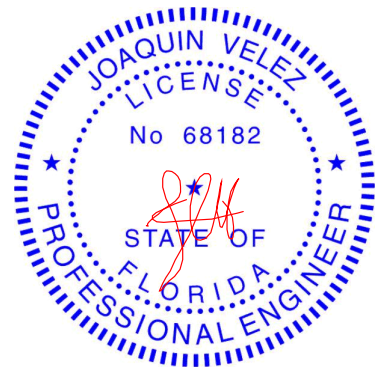

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700787
2478882	T05	ATTIC GIRDER	1	2	Job Reference (optional)	

- NOTES-**
- 14) NOTE: DUE TO THE OVERALL LENGTH TO DEPTH RATIO OF THE ROOM, THE FLOOR MAY EXHIBIT OBJECTIONABLE VIBRATION AND OR BOUNCE. BUILDING DESIGNER TO CONSIDER PROVIDING MEANS TO DAMPEN THESE EFFECTS. TRUSS DESIGN SHALL BE REVIEWED AND APPROVED PRIOR TO MANUFACTURING.
- 15) Attic room checked for L/360 deflection.



Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700788
2478882	T06	Roof Special	4	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:38 2021 Page 1

ID:ZNSI8H1epQPswZFaCoblYzc_TY-hAugwGc1aYCUL7S0Q6eGhe0hS1b3tmYHHDIEkpzp8sd

-1-0-0 7-4-0 10-10-0 14-4-4 17-10-0 21-8-0 22-8-0
1-0-0 7-4-0 3-6-0 3-6-4 3-5-12 3-10-0 1-0-0

4x4 =

Scale = 1:71.7

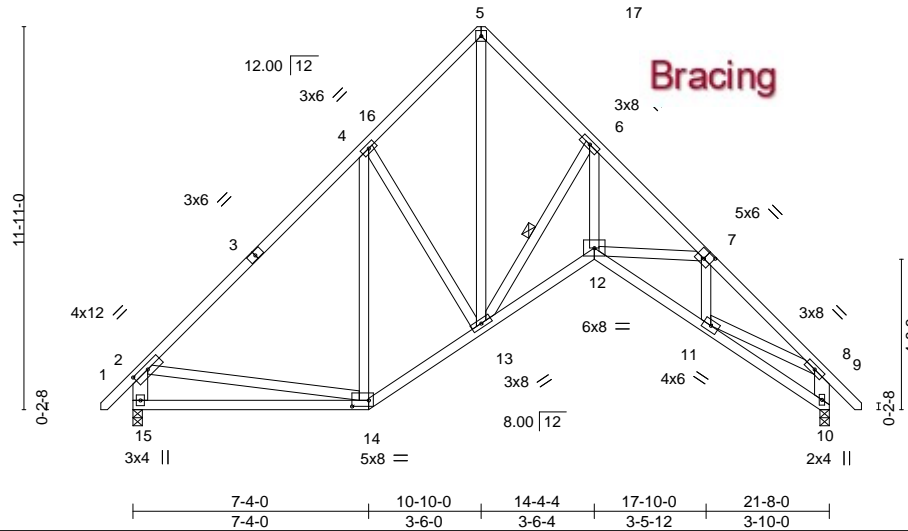


Plate Offsets (X,Y)-- [2:0-6-0,0-1-12], [7:0-3-0,0-3-0], [14:0-6-4,0-2-4]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.62	Vert(LL)	-0.09 14-15 >999 240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.44	Vert(CT)	-0.20 14-15 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.82	Horz(CT)	0.17 10 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS				Weight: 164 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
2-15,8-10: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-12 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
8-3-10 oc bracing: 14-15.
WEBS 1 Row at midpt 6-13

REACTIONS.


(size) 15=0-3-8, 10=0-3-8
Max Horz 15=413(LC 11)
Max Uplift 15=-280(LC 12), 10=-280(LC 13)
Max Grav 15=846(LC 1), 10=846(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-813/335, 4-5=-727/408, 5-6=-702/419, 6-7=-1603/485, 7-8=-1542/461,
2-15=-771/358, 8-10=-846/354
BOT CHORD 14-15=-504/609, 13-14=-240/758, 12-13=-184/1433, 11-12=-263/1249
WEBS 4-14=-312/114, 4-13=-225/310, 5-13=-497/812, 6-13=-1193/280, 6-12=-216/1531,
7-12=-160/263, 2-14=-119/368, 8-11=-216/1045

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-12 to 2-1-4, Interior(1) 2-1-4 to 10-10-0, Exterior(2R) 10-10-0 to 13-10-0, Interior(1) 13-10-0 to 22-6-12 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 280 lb uplift at joint 15 and 280 lb uplift at joint 10.

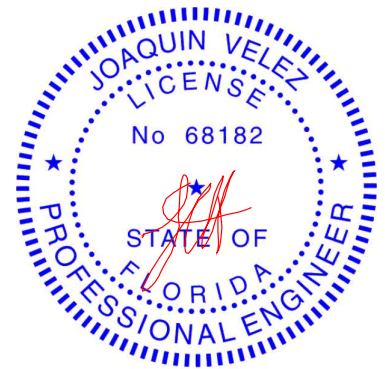

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700789
2478882	T06G	GABLE	1	1		

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:40 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-dY0bLydH6ASCaRcPXWgkm355_rHVLkgZIXELpizp8sb

1-0-0 7-4-0 10-10-0 14-4-4 17-10-6 21-8-0 22-8-0
1-0-0 7-4-0 3-6-0 3-6-4 3-6-2 3-9-10 1-0-0

4x4 =

Scale = 1:72.2

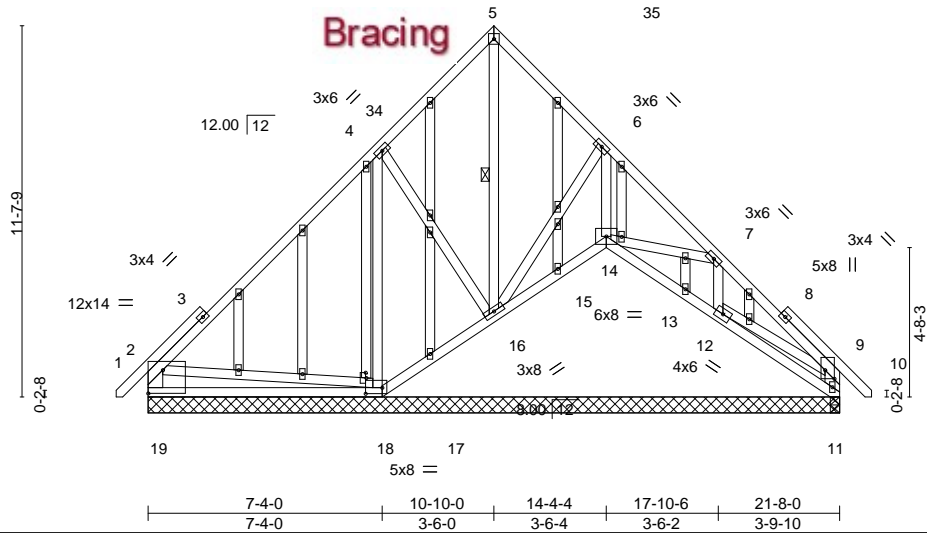


Plate Offsets (X,Y)--											
[2:Edge,0-8-12], [9:0-3-4,0-3-8], [18:0-6-4,0-2-4], [22:0-2-0,0-0-4]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.36	Vert(LL)	-0.08 18-19	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.44	Vert(CT)	-0.16 18-19	>534	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.52	Horz(CT)	0.01 11	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 214 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
2-19,9-11: 2x6 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 5-16

REACTIONS.


All bearings 21-8-0.
(lb) - Max Horz 19=393(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 19, 14, 17 except 18=263(LC 13), 11=137(LC 13), 16=311(LC 12), 12=162(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 11, 11, 17, 15, 13 except 19=349(LC 1), 18=316(LC 20), 16=371(LC 19), 14=275(LC 22), 12=272(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-259/126, 2-19=-278/118
BOT CHORD 18-19=-665/732, 17-18=-286/370, 16-17=-262/374, 15-16=-215/336, 14-15=-210/335
WEBS 4-16=-181/264, 2-18=-574/737

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-13 to 2-1-4, Interior(1) 2-1-4 to 10-10-0, Exterior(2R) 10-10-0 to 13-10-0, Interior(1) 13-10-0 to 22-6-12 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 19, 14, 17 except (jt=lb) 18=263, 11=137, 16=311, 12=162.

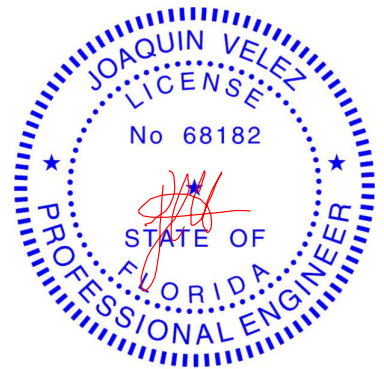

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700790
2478882	T07	Roof Special	3	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:41 2021 Page 1
ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-5IazYlevITa3CbBb5EBzIGeChFdm461j_B_uL8zp8sa

-1-0-0 7-4-0 10-10-0 14-4-4 17-10-0 21-8-0
1-0-0 7-4-0 3-6-0 3-6-4 3-5-12 3-10-0

4x4 =

Scale = 1:71.7

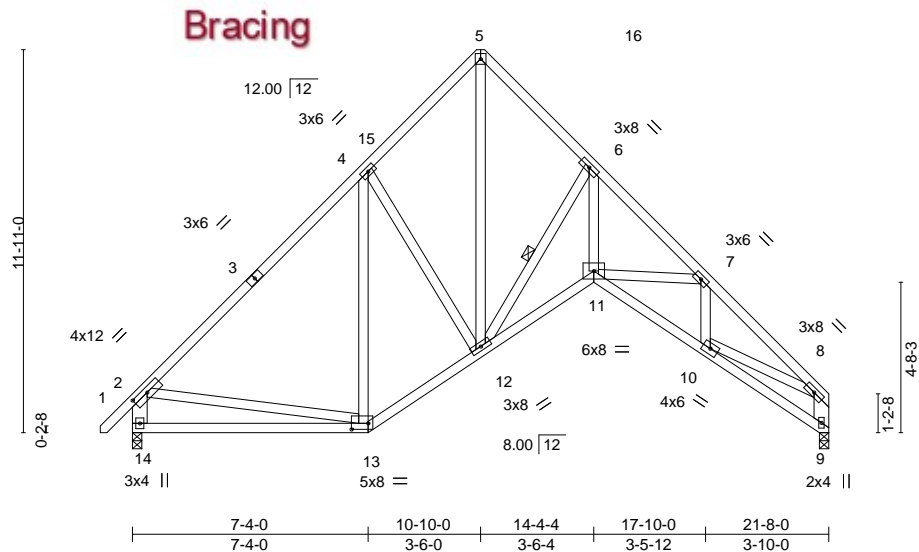


Plate Offsets (X,Y)--		[2:0-6-0,0-1-12], [13:0-6-4,0-2-4]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.62	Vert(LL)	-0.09 13-14	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.44	Vert(CT)	-0.20 13-14	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.84	Horz(CT)	0.17 9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 162 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
2-14,8-9: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-13 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-2-4 oc bracing.
WEBS 1 Row at midpt 6-12

REACTIONS.


(size) 14=0-3-8, 9=0-3-8
Max Horz 14=401(LC 11)
Max Uplift 14=-280(LC 12), 9=-262(LC 12)
Max Grav 14=847(LC 1), 9=783(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-815/334, 4-5=-729/424, 5-6=-704/426, 6-7=-1588/529, 7-8=-1556/535,
2-14=-773/357, 8-9=-783/316
BOT CHORD 13-14=-518/586, 12-13=-257/739, 11-12=-237/1390, 10-11=-400/1263
WEBS 4-13=-301/124, 4-12=-214/299, 5-12=-507/801, 6-12=-1200/411, 6-11=-323/1492,
7-11=-160/252, 2-13=-120/368, 8-10=-299/1053

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-12 to 2-1-4, Interior(1) 2-1-4 to 10-10-0, Exterior(2R) 10-10-0 to 13-10-0, Interior(1) 13-10-0 to 21-5-4 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=280, 9=262.

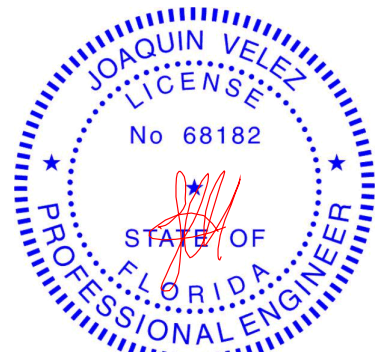

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job 2478882	Truss T08	Truss Type Common Girder	Qty 1	Ply 2	BLAKE CONST. - DAUGHTERS HSE T22700791
----------------	--------------	-----------------------------	----------	----------	---

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:44 2021 Page 1

ID:ZNSI8H1epQPpWZFaCobIIYzc_TY-WKG5AJgnAOye32vAmMlgwvGnTShWHUig9CYyTzp8sX



5x6 ||

Scale = 1:72.8

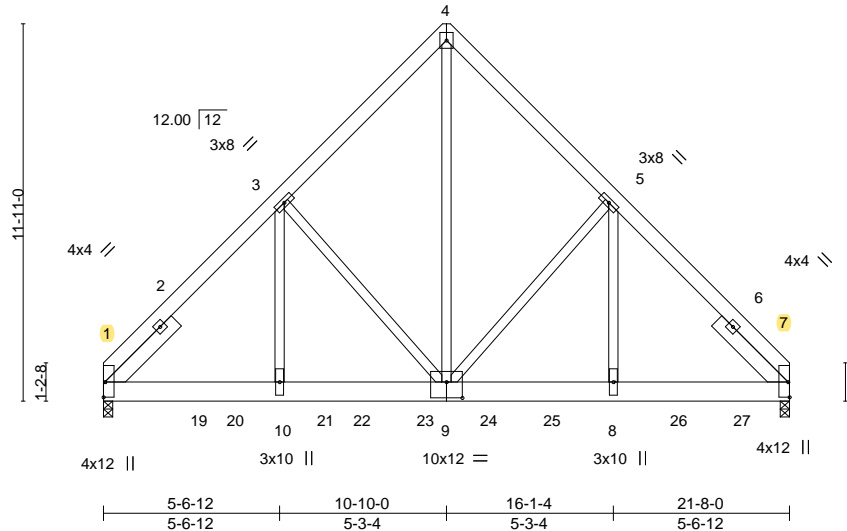


Plate Offsets (X,Y)-- [1:Edge,0-0-8], [7:Edge,0-0-8], [9:0-6-0,0-6-0]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.33	Vert(LL)	-0.08 9-10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.25	Vert(CT)	-0.14 9-10	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.71	Horz(CT)	0.03 7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 418 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x8 SP 2400F 2.0E
 WEBS 2x4 SP No.3 *Except*
 4-9: 2x4 SP No.2
 SLIDER Left 2x6 SP No.2 -t 2-11-8, Right 2x6 SP No.2 -t 2-11-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-14 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 1=0-3-8, 7=0-3-8 (req. 0-3-9)
 Max Horz 1=331(LC 6)
 Max Uplift 1=1545(LC 9), 7=1536(LC 8)
 Max Grav 1=5907(LC 2), 7=5986(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-6113/1660, 3-4=-4219/1260, 4-5=-4223/1262, 5-7=-5864/1548
 BOT CHORD 1-10=-1195/4192, 9-10=-1195/4192, 8-9=-985/4030, 7-8=-985/4030
 WEBS 4-9=-1546/5525, 5-9=-1602/691, 5-8=-536/2313, 3-9=-1851/802, 3-10=-706/2699

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- WARNING: Required bearing size at joint(s) 7 greater than input bearing size.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=1545, 7=1536.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1133 lb down and 305 lb up at 2-0-12, 1133 lb down and 305 lb up at 4-0-12, 1133 lb down and 305 lb up at 6-0-12, 1133 lb down and 305 lb up at 8-0-12, 1133 lb down and 305 lb up at 10-0-12, 730 lb down and 132 lb up at 12-0-12, 730 lb down and 132 lb up at 14-0-12, 1133 lb down and 305 lb up at 16-0-12, and 1133 lb down and 305 lb up at 18-0-12, and 1133 lb down and 305 lb up at 20-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

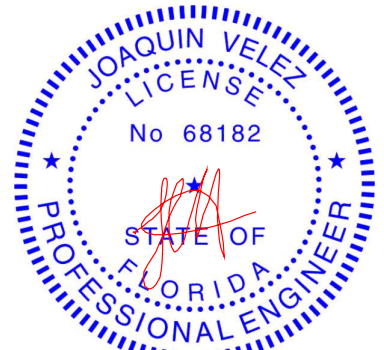

Joaquin Velez PE No.68182
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

February 3, 2021

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700791
2478882	T08	Common Girder	1	2	Job Reference (optional)	

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-7=-54, 11-15=-20

Concentrated Loads (lb)

Vert: 8=-996(B) 19=-996(B) 20=-996(B) 21=-996(B) 22=-996(B) 23=-996(B) 24=-649(B) 25=-649(B) 26=-996(B) 27=-996(B)

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:45 2021 Page 1
ID:ZNSI8H1epQPSWZFaGobIIYzc TY- WaUQfhQxi4VqCIUMK4GvT6owV/szt0zWlupv6Ujvz8sW

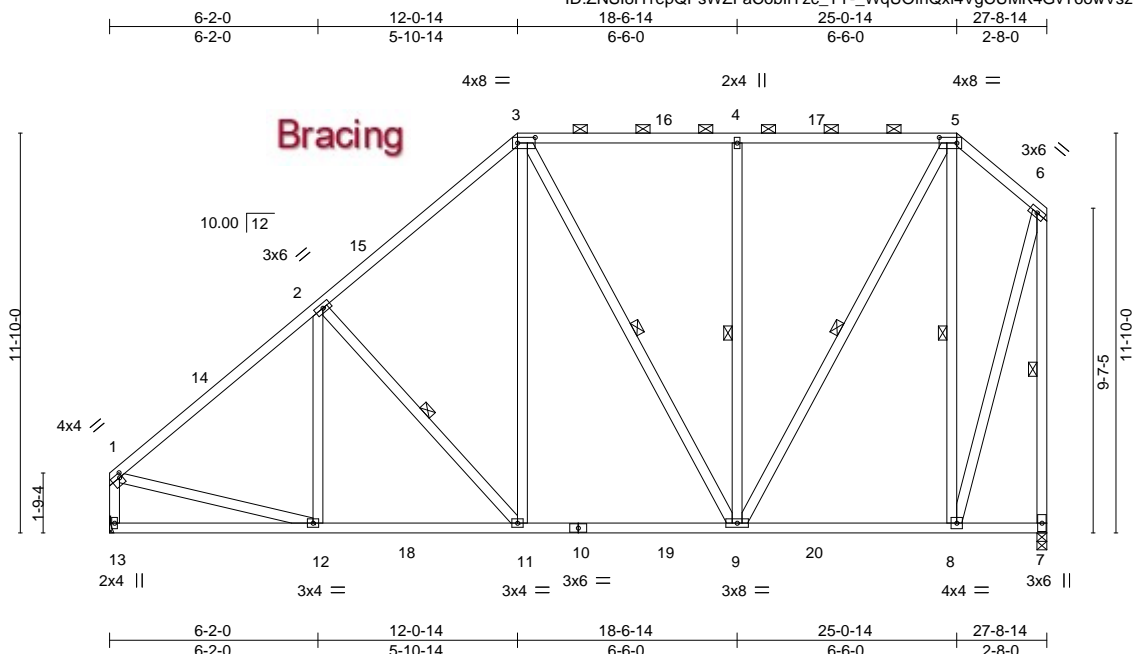


Plate Offsets (X,Y)-- [1:0-1-0,0-1-8], [3:0-6-4,0-2-0], [5:0-6-4,0-2-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.50	Vert(LL)	-0.08	9-11	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.50	Vert(CT)	-0.13	9-11	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.61	Horz(CT)	0.02	7	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							Weight: 239 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
3-9.5-9: 2x4 SP No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 4-11-7 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
BOT CHORD	Rigid ceiling directly applied or 8-0-12 oc bracing.
WEBS	1 Row at midpt 2-11 3-9 4-9 5-9 5-8 6-7

REACTIONS.

(size) 13=Mechanical, 7=0-3-8
 Max Horz 13=426(LC 12)
 Max Uplift 13=-285(LC 12), 7=-359(LC 9)
 Max Grav 13=1153(LC 2), 7=1178(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-2=-1220/301, 2-3=-1012/352, 3-4=-650/289, 4-5=-650/289, 5-6=-366/149,
1-13=-1059/299, 6-7=-1169/386

BOT CHORD 12-13=-481/257, 11-12=-539/959, 9-11=-304/709, 8-9=-86/251

WEBS 2-11=-402/352, 3-11=-223/560, 3-9=-258/192, 4-9=-409/310, 5-9=-360/818,
5-8=-681/351, 1-12=-103/831, 6-8=-331/945

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCp=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 12-0-14, Exterior(2R) 12-0-14 to 16-3-13, Interior(1) 16-3-13 to 25-0-14, Exterior(2E) 25-0-14 to 27-7-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 13=285, 7=359.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

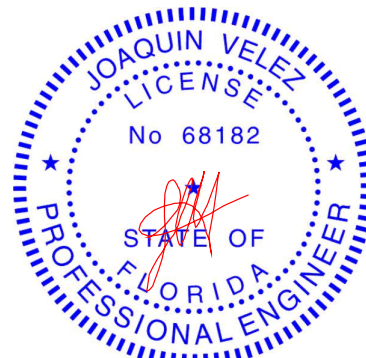

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700793
2478882	T09G	GABLE	1	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:47 2021 Page 1
ID:ZNSI8H1epQPswZFaCoblYzc_TY-wuxEpLjgTJKDwWelRVINYXuMmgmKU_BbM7RCYozp8sU

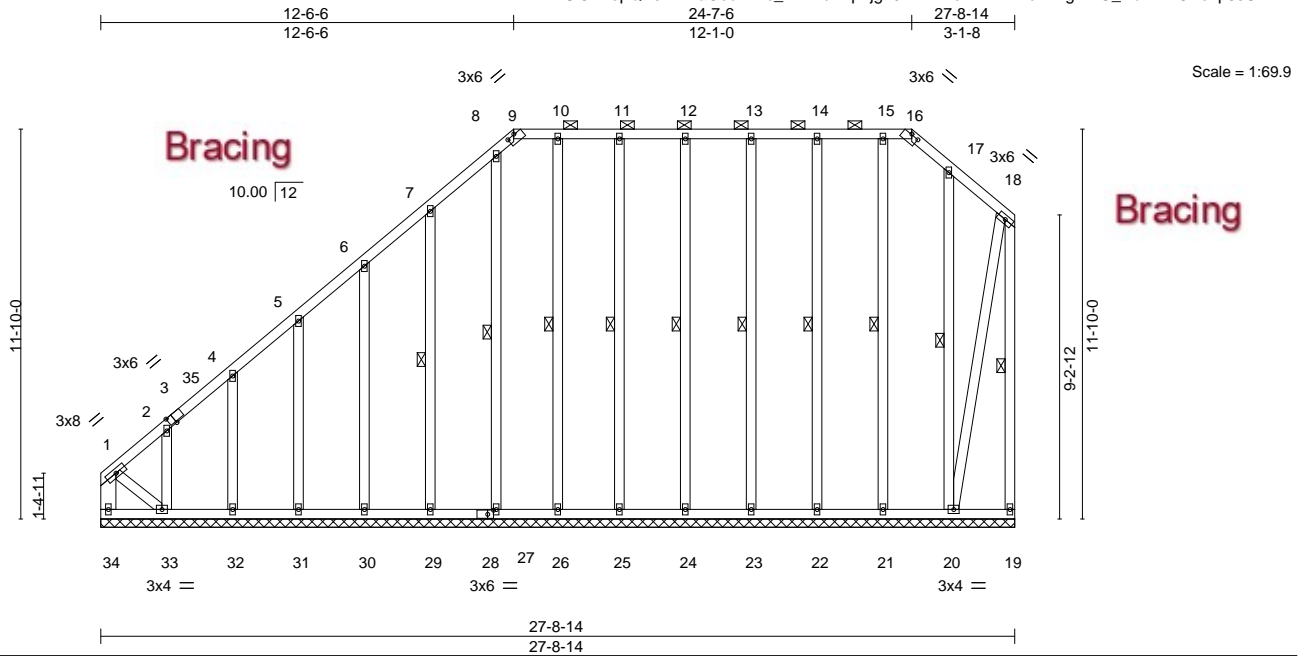


Plate Offsets (X,Y)--	[3:0-2-4,Edge], [9:0-3-0,0-0-4], [16:0-3-0,0-0-4], [28:0-2-2,0-1-8]					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/def
TCLL 20.0	Plate Grip DOL	1.25	TC 0.07	Vert(LL)	n/a	999
TCDL 7.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	n/a	999
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT)	-0.00	19
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S			
					PLATES	GRIP
					MT20	244/190
					Weight: 297 lb	FT = 20%

LUMBER-

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3 *Except*
	1-34: 2x6 SP No.2
OTHERS	2x4 SP No.3

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 9-16.
BOT CHORD	Rigid ceiling directly applied or 9-1-5 oc bracing.
WEBS	1 Row at midpt 18-19, 10-26, 17-20, 15-21, 14-22, 13-23, 12-24, 11-25, 7-29, 8-27

REACTIONS.


All bearings	27-8-14.
(lb) - Max Horz	34=431(LC 12)
Max Uplift	All uplift 100 lb or less at joint(s) 19, 26, 21, 22, 23, 24, 25, 27 except 34=272(LC 10), 20=137(LC 13), 33=444(LC 12), 32=134(LC 12), 31=137(LC 12), 30=135(LC 12), 29=148(LC 12)
Max Grav	All reactions 250 lb or less at joint(s) 19, 26, 20, 21, 22, 23, 24, 25, 32, 31, 30, 29, 27 except 34=609(LC 12), 33=287(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-34=-596/283, 1-2=-520/262, 2-4=-414/224, 4-5=-308/185
BOT CHORD	33-34=-423/214
WEBS	1-33=-253/511

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-2-12 to 3-2-12, Exterior(2N) 3-2-12 to 12-6-6, Corner(3R) 12-6-6 to 15-8-14, Exterior(2N) 15-8-14 to 24-7-6, Corner(3E) 24-7-6 to 27-7-2 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 19, 26, 21, 22, 23, 24, 25, 27 except (jt=lb) 34=272, 20=137, 33=444, 32=134, 31=137, 30=135, 29=148.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

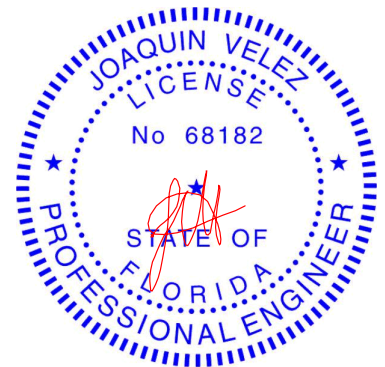

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700794
2478882	T10	Piggyback Base	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL),
Jacksonville, FL - 32244,
8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:49 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-sH3_D1kw?xax9po7ZvLrdyzcMTMdynJupRwJdgzp8sS

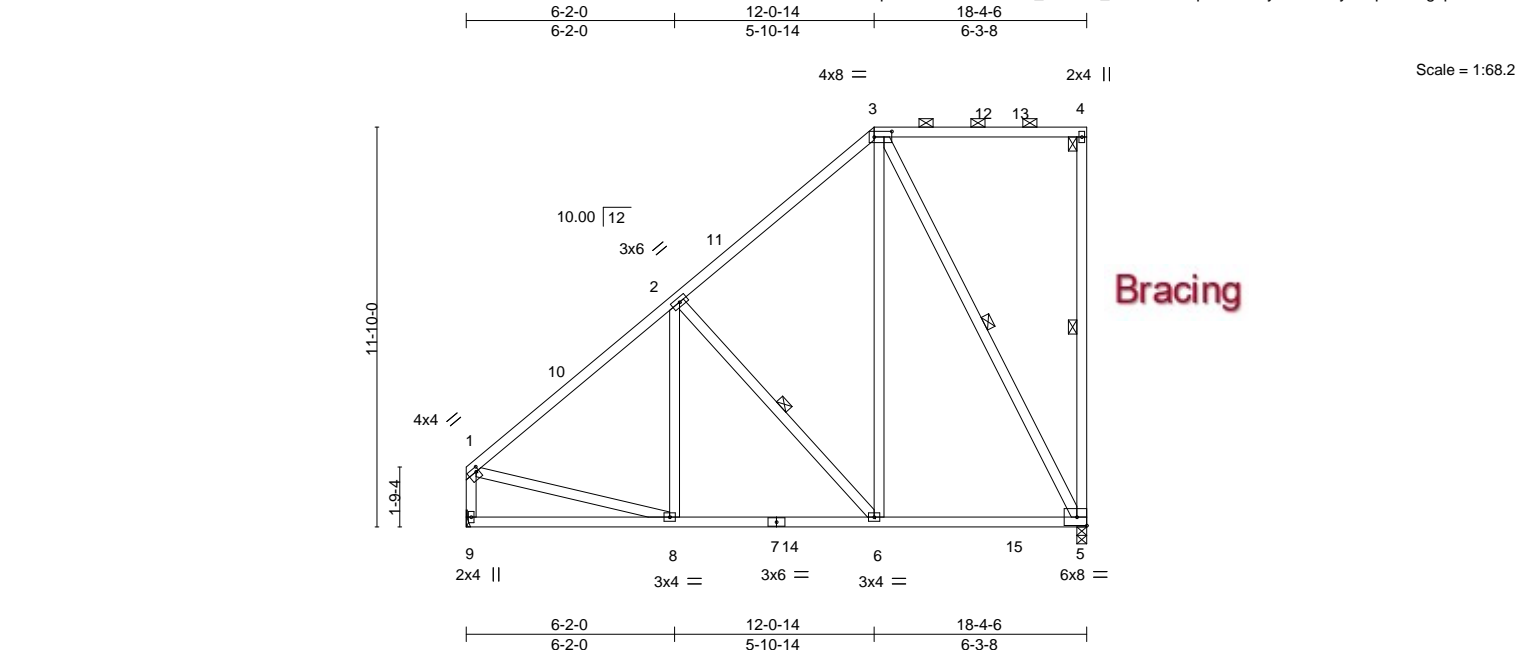



Plate Offsets (X,Y)--		[1:0-1-0,0-1-8], [3:0-6-4,0-2-0]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.51	in	(loc)	I/defl	L/d	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.44	Vert(LL)	-0.07	5-6	>999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.62	Vert(CT)	-0.11	5-6	>999		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS		Horz(CT)	-0.01	5	n/a		
								Weight: 146 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 8-0-13 oc bracing.
WEBS	2x4 SP No.3 *Except*	WEBS	1 Row at midpt
	3-5: 2x4 SP No.2		4-5, 2-6, 3-5

REACTIONS.		(size)	5=0-3-8, 9=Mechanical
		Max Horz	9=486(LC 12)
		Max Uplift	5=-378(LC 12), 9=-112(LC 12)
		Max Grav	5=775(LC 2), 9=780(LC 19)

FORCES.		(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-749/95, 2-3=-468/118, 1-9=-685/127	
BOT CHORD	8-9=-538/243, 6-8=-441/622, 5-6=-184/319	
WEBS	2-6=-459/383, 3-6=-241/623, 3-5=-671/390, 1-8=0/469	

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 12-0-14, Exterior(2R) 12-0-14 to 16-3-13, Interior(1) 16-3-13 to 18-2-10 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 5=378, 9=112.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

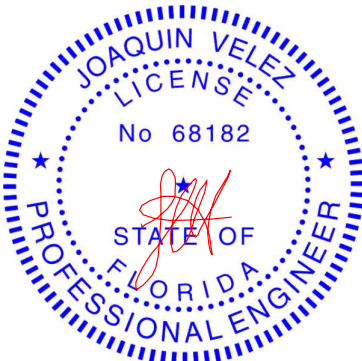

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3,2021


Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700795
2478882	T11	Piggyback Base	2	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:50 2021 Page 1

ID:ZNSI8H1epQPsWZFACobllYzc_TY-KTdMRNIYIEinnzNK7ds4AAWgxtbqh9N225f196zp8sR

Job Reference (optional)

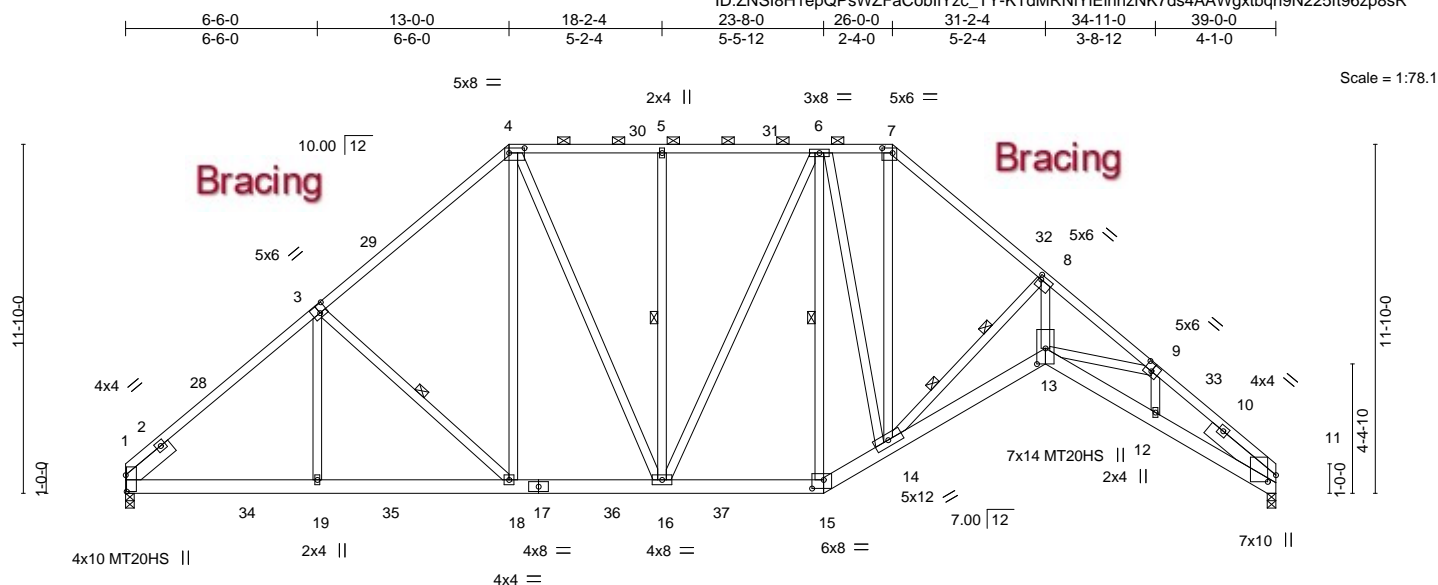

	6-6-0	13-0-0	18-2-4	23-8-0	26-0-0	31-2-4	34-11-0	39-0-0
	6-6-0	6-6-0	5-2-4	5-5-12	2-4-0	5-2-4	3-8-12	4-1-0
Plate Offsets (X,Y)--	[1:0-6-11,0-0-6], [3:0-3-0,0-3-4], [4:0-6-4,0-2-0], [7:0-4-4,0-2-0], [8:0-1-0,0-1-12], [9:0-3-0,0-3-0], [11:0-2-12,0-3-5], [13:0-6-6,0-3-8], [15:0-4-12,0-3-8]							

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.84	Vert(LL)	-0.36 13-14	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.83	Vert(CT)	-0.61 13-14	>765	180	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.96	Horz(CT)	0.48 11	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 338 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x6 SP No.2 *Except*
 11-13: 2x6 SP M 26
 WEBS 2x4 SP No.3 *Except*
 4-16,6-16,8-13: 2x4 SP No.2
 SLIDER Left 2x6 SP No.2 -t 1-11-8, Right 2x6 SP No.2 -t 2-11-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-11-12 oc purlins, except
 2-0-0 oc purlins (4-9-5 max.): 4-7.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 9-11-14 oc bracing: 1-19
 8-0-10 oc bracing: 13-14.
 WEBS 1 Row at midpt 5-16, 6-15, 3-18
 2 Rows at 1/3 pts 8-14

REACTIONS.


(size) 11=0-3-8, 1=0-3-8
 Max Horz 1=-339(LC 8)
 Max Uplift 11=-451(LC 13), 1=-451(LC 12)
 Max Grav 11=1601(LC 2), 1=1655(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-2066/577, 3-4=-1754/590, 4-5=-1414/562, 5-6=-1414/562, 6-7=-1420/556,
 7-8=-1909/630, 8-9=-4887/1157, 9-11=-4073/1064
 BOT CHORD 1-19=-543/1631, 18-19=-543/1631, 16-18=-414/1278, 15-16=-346/1348, 14-15=-401/1592,
 13-14=-845/4348, 12-13=-812/3582, 11-12=-766/3296
 WEBS 3-19=0/260, 4-16=-296/414, 5-16=-316/246, 6-15=-651/217, 6-14=-42/425,
 7-14=-295/1013, 8-14=-3452/842, 8-13=-804/4234, 9-13=-228/749, 9-12=-432/110,
 3-18=-503/386, 4-18=-216/606

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-0-0, Exterior(2R) 13-0-0 to 17-2-15, Interior(1) 17-2-15 to 26-0-0, Exterior(2R) 26-0-0 to 30-2-15, Interior(1) 30-2-15 to 39-0-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=451, 1=451.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

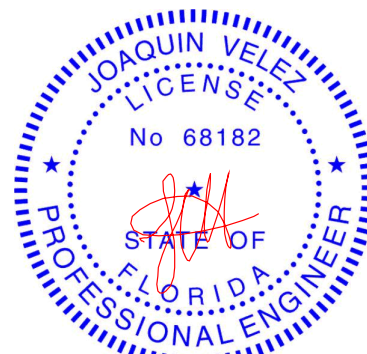

Joaquin Velez PE No.68182
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700796
2478882	T11G	GABLE	1	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:55 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobliYzc_TY-hRQFU4phanL4tkFHvASFtDDbFuTdmUwnCNNdrKzp8sM



Scale = 1:85.4

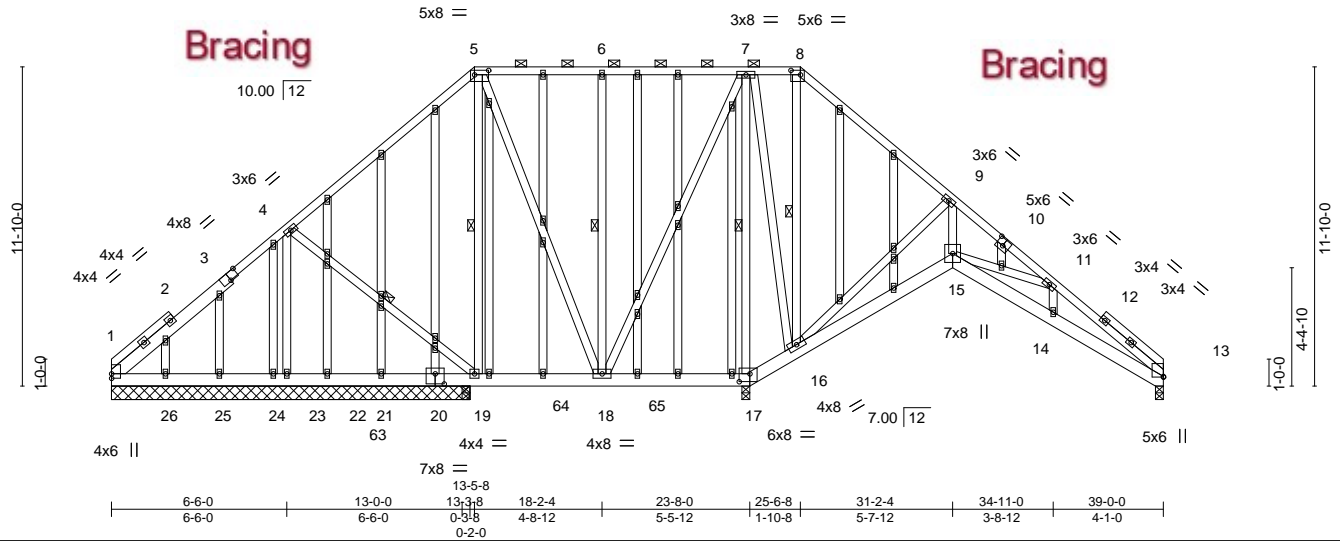


Plate Offsets (X,Y)-- [3:0-4-0,Edge], [5:0-6-4,0-2-0], [8:0-4-4,0-2-0], [10:0-3-0,0-3-0], [17:0-4-12,0-3-8], [20:0-4-0,0-4-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.61	Vert(LL)	-0.04 15-16 >999	240	MT20 244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.15	Vert(CT)	-0.07 15-16 >999	180	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.68	Horz(CT)	0.05 13 n/a	n/a	
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 489 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
1-3: 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except*
5-18,7-18: 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (10-0-0 max.): 5-8.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 14-15,13-14.
WEBS 1 Row at midpt 4-19, 5-19, 6-18, 7-17, 8-16

REACTIONS.


All bearings 13-3-8 except (jt=length) 17=0-3-8, 13=0-3-8.
(lb) - Max Horz 1=339(LC 4)
Max Uplift All uplift 100 lb or less at joint(s) except 1=333(LC 6), 17=401(LC 28), 13=377(LC 9), 23=268(LC 8), 19=394(LC 8), 26=395(LC 8), 25=231(LC 6), 24=221(LC 8), 22=145(LC 5), 21=359(LC 9)
Max Grav All reactions 250 lb or less at joint(s) 22 except 1=341(LC 19), 17=1543(LC 2), 13=513(LC 20), 23=282(LC 19), 19=946(LC 2), 19=885(LC 1), 26=398(LC 1), 25=257(LC 20), 24=261(LC 1), 21=432(LC 19), 1=262(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-4=126/310, 4-5=17/456, 5-6=0/288, 6-7=0/288, 7-8=0/375, 8-9=0/492, 11-13=590/251
BOT CHORD 1-26=276/253, 25-26=276/253, 24-25=276/253, 23-24=276/253, 22-23=276/253, 21-22=276/253, 19-21=276/253, 18-19=408/384, 17-18=532/386, 16-17=692/470, 15-16=150/279, 14-15=143/524, 13-14=142/487
WEBS 4-19=256/236, 5-19=500/201, 6-18=295/236, 7-18=105/377, 7-17=1020/199, 7-16=87/567, 8-16=447/106, 9-16=509/187, 9-15=0/403, 11-15=496/362

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify connection on bearing surface.

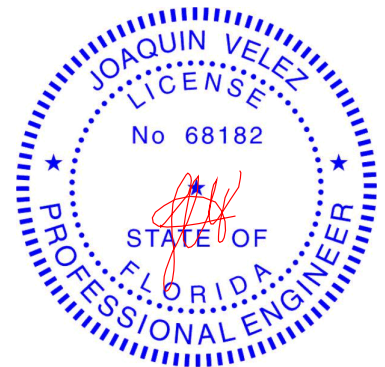

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700796
2478882	T11G	GABLE	1	1	Job Reference (optional)	

- NOTES-**
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 333 lb uplift at joint 1, 401 lb uplift at joint 17, 377 lb uplift at joint 13, 268 lb uplift at joint 23, 394 lb uplift at joint 19, 395 lb uplift at joint 26, 231 lb uplift at joint 25, 221 lb uplift at joint 24, 145 lb uplift at joint 22, 359 lb uplift at joint 21 and 333 lb uplift at joint 1.
 - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 241 lb down and 228 lb up at 0-0-0, 231 lb down and 237 lb up at 2-0-12, 231 lb down and 237 lb up at 4-0-12, 231 lb down and 237 lb up at 6-0-12, 231 lb down and 237 lb up at 8-0-12, 231 lb down and 237 lb up at 10-0-12, and 231 lb down and 237 lb up at 12-0-12, and 241 lb down and 228 lb up at 39-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 14) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 - Uniform Loads (plf)
 - Vert: 1-5=-54, 5-8=-54, 8-13=-54, 17-55=-20, 15-17=-20, 15-59=-20
 - Concentrated Loads (lb)
 - Vert: 26=-231(B) 25=-231(B) 24=-231(B) 22=-231(B) 21=-231(B) 20=-231(B) 55=-241(B) 59=-241(B)



Job 2478882	Truss T12	Truss Type Piggyback Base Girder	Qty 1	Ply 2	BLAKE CONST. - DAUGHTERS HSE T22700797
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					Job Reference (optional)

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:57 2021 Page 1

ID:ZNSI8H1epQPpSWZFaCobllYzc_TY-dqY0vmqx6Obo62Pg1bUjyelxFi2pqOC4fhskvDzp8sK

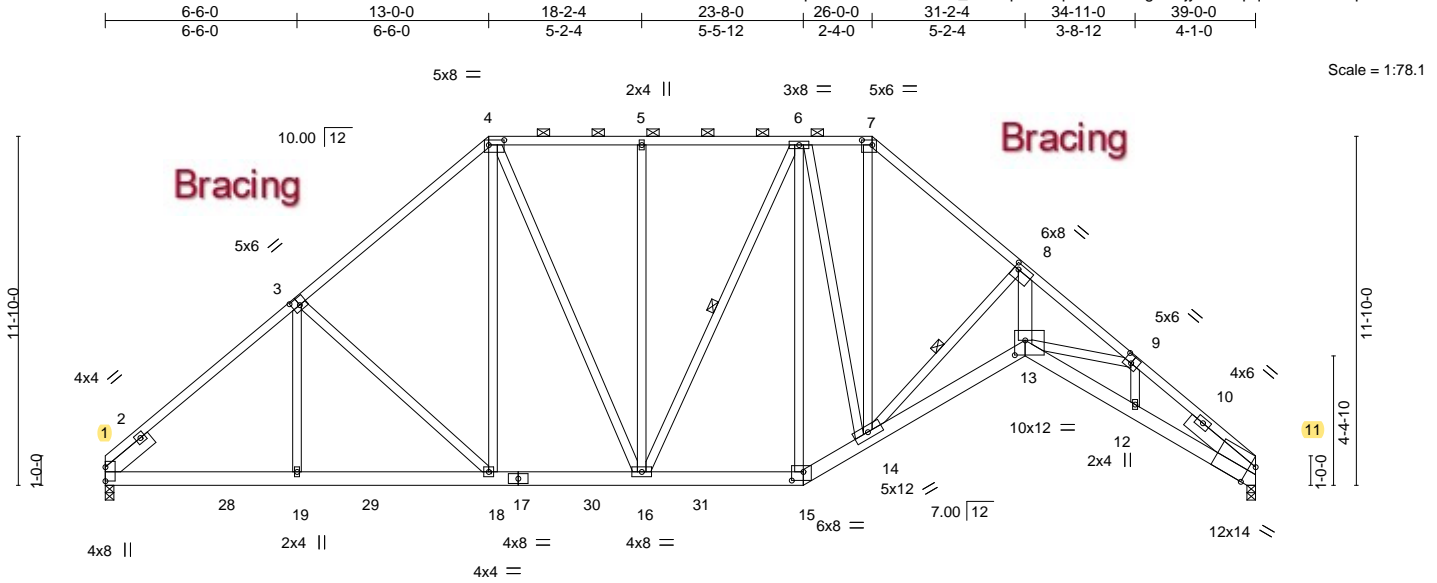


Plate Offsets (X,Y)--		[3:0-3-0,0-3-0], [4:0-6-4,0-2-0], [7:0-4-4,0-2-0], [8:0-1-12,0-2-4], [9:0-3-0,0-3-0], [11:0-2-4,Edge], [13:0-4-4,0-6-0], [15:0-4-12,0-3-8]
LOADING (psf)	SPACING-	2-0-0
TCLL 20.0	Plate Grip DOL	1.25
TCDL 7.0	Lumber DOL	1.25
BCLL 0.0 *	Rep Stress Incr	NO
BCDL 10.0	Code FBC2020/TPI2014	
	CSI.	
	TC 0.58	
	BC 0.55	
	WB 0.69	
	Matrix-MS	
	DEFL.	
	Vert(LL) -0.37 13	>999 240
	Vert(CT) -0.64 13	>732 180
	Horz(CT) 0.51 11	n/a n/a
	PLATES	GRIP
	MT20	244/190
	Weight: 680 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
7-9,9-11: 2x4 SP M 31
BOT CHORD 2x6 SP No.2 *Except*
13-15,11-13: 2x6 SP M 26
WEBS 2x4 SP No.3 *Except*
6-16,4-16: 2x4 SP No.2, 8-14: 2x4 SP M 31, 8-13: 2x6 SP M 26
SLIDER Left 2x6 SP No.2 -t 1-11-8, Right 2x6 SP No.2 -t 2-11-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-13 oc purlins, except
2-0-0 oc purlins (6-0-0 max.): 4-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-16, 8-14

REACTIONS.

(size) 1=0-3-8, 11=0-3-8
Max Horz 1=-339(LC 4)
Max Uplift 1=-643(LC 8), 11=-1597(LC 9)
Max Grav 1=2192(LC 2), 11=4452(LC 2)


FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-2807/842, 3-4=-2551/854, 4-5=-2261/828, 5-6=-2261/828, 6-7=-2786/1035,
7-8=-3676/1229, 8-9=-13072/4006, 9-11=-11080/3758
BOT CHORD 1-19=-744/2088, 18-19=-744/2088, 16-18=-634/1889, 15-16=-742/2455, 14-15=-856/2855,
13-14=-3302/11513, 12-13=-3151/9668, 11-12=-2934/8898
WEBS 3-18=-491/393, 5-16=-316/245, 6-16=-573/294, 6-15=-1251/440, 6-14=-473/1564,
7-14=-683/2149, 8-14=-10602/3405, 8-13=-3871/13191, 9-13=-690/1757, 9-12=-1348/441,
4-18=-218/605, 4-16=-500/983

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

Continued on page 2

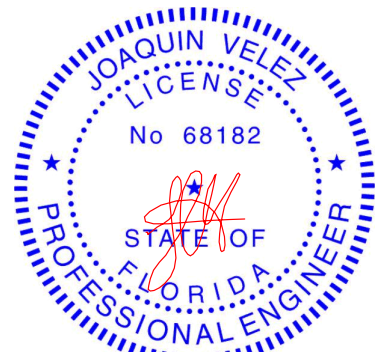

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700797
2478882	T12	Piggyback Base Girder	1	2	Job Reference (optional)	

- NOTES-**
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 643 lb uplift at joint 1 and 1597 lb uplift at joint 11.
 - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 12) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2053 lb down and 639 lb up at 31'-2"-4" on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 - Uniform Loads (plf)
 - Vert: 1-4=-54, 4-7=-54, 7-8=-54, 15-20=-20, 13-15=-20, 13-24=-20
 - Concentrated Loads (lb)
 - Vert: 13=-1874(F)
 - Trapezoidal Loads (plf)
 - Vert: 8=-214-to-11=-289



Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700798
2478882	T13	Piggyback Base	3	1		
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:36:59 2021 Page 1
ID:ZNSI8H1epQPpWZFaCobllYzc_TY-ZCgmKSsCe?rVMMZ280WB13NIWVmwllTM6?Lr_5zp8sl

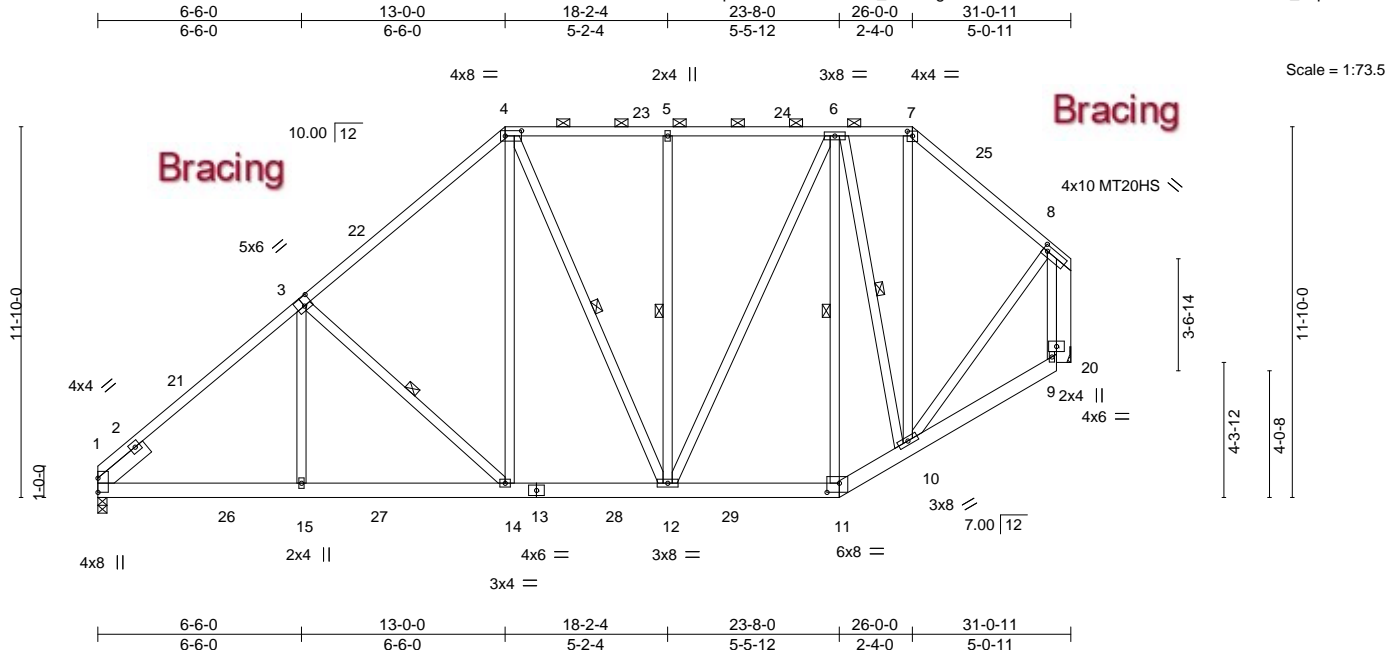



Plate Offsets (X,Y)-- [3:0-3-0,0-3-4], [4:0-6-4,0-2-0], [7:0-2-0,0-1-13], [8:0-1-12,0-2-0], [11:0-4-12,0-3-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.53	Vert(LL)	-0.07	14-15	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.45	Vert(CT)	-0.11	14-15	>999	180	MT20HS	187/143
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.64	Horz(CT)	-0.01	1	n/a	n/a		
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							Weight: 294 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-2-12 oc purlins, except
BOT CHORD 2x6 SP No.2	2-0-0 oc purlins (6-0-0 max.): 4-7.
WEBS 2x4 SP No.3 *Except*	Rigid ceiling directly applied or 9-1-12 oc bracing.
4-12,6-12: 2x4 SP No.2	1 Row at midpt 3-14, 4-12, 5-12, 6-11, 6-10
OTHERS 2x6 SP No.2	
SLIDER Left 2x6 SP No.2 -t 1-11-8	

REACTIONS. (size) 1=0-3-8, 20=Mechanical
Max Horz 1=425(LC 12)
Max Uplift 1=350(LC 12), 20=-326(LC 12)
Max Grav 1=1323(LC 2), 20=1258(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-1606/438, 3-4=-1260/419, 4-5=-888/384, 5-6=-888/384, 6-7=-563/283, 7-8=-795/297
BOT CHORD 1-15=-617/1266, 14-15=-617/1266, 12-14=-340/897, 11-12=-232/664, 10-11=-268/790, 9-10=-94/262
WEBS 3-15=0/292, 3-14=-538/398, 5-12=-316/245, 6-12=-232/544, 6-11=-264/151, 6-10=-472/251, 7-10=-148/380, 8-10=-222/613, 4-14=-219/611, 8-20=-1274/392

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 13-0-0, Exterior(2R) 13-0-0 to 17-2-15, Interior(1) 17-2-15 to 26-0-0, Exterior(2E) 26-0-0 to 30-5-7 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are MT20 plates unless otherwise indicated.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 8) Refer to girder(s) for truss to truss connections.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 350 lb uplift at joint 1 and 326 lb uplift at joint 20.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

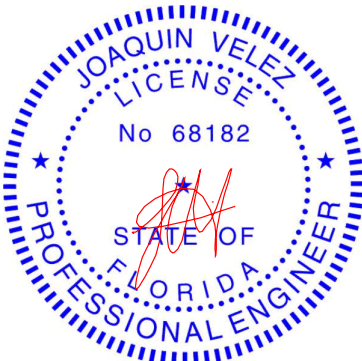

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700799
2478882	T14	Piggyback Base Girder	1	2	Job Reference (optional)	

- NOTES-**
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 602 lb uplift at joint 19 and 1555 lb uplift at joint 10.
 - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 2030 lb down and 632 lb up at 28-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
 - Vert: 1-3=-54, 3-6=-54, 6-7=-54, 14-19=-20, 12-14=-20, 12-20=-20
- Concentrated Loads (lb)
 - Vert: 12=-1854(B)
- Trapezoidal Loads (plf)
 - Vert: 7=-214-to-10=-289



Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700800
2478882	T15	Piggyback Base	2	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:03 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-SzvHApviiELxrsqNsb7BvYw8672E2fy1cj37szp8sE

Job Reference (optional)

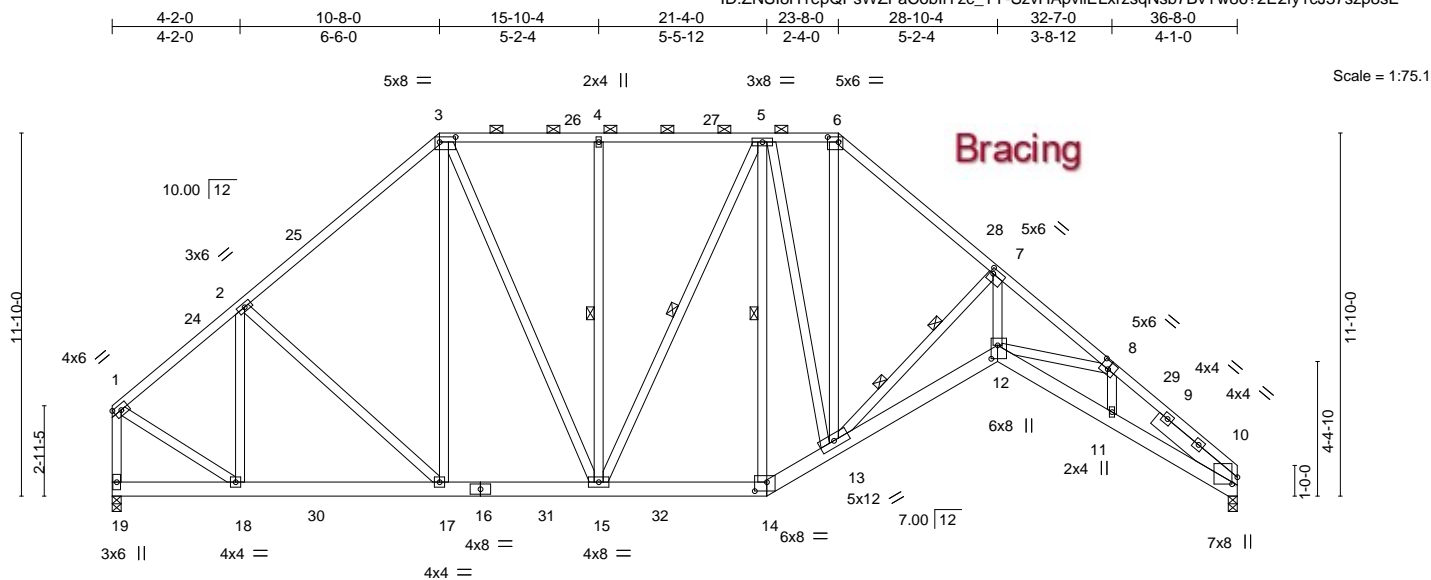


Plate Offsets (X,Y)--	[3:0-6-4,0-2-0], [6:0-4-4,0-2-0], [7:0-1-4,0-2-0], [8:0-3-0,0-3-0], [10:0-2-12,0-2-1], [12:0-5-4,0-2-8], [14:0-4-12,0-3-8]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.81	Vert(LL)	-0.33	12	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.95	Vert(CT)	-0.55	12	>790	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.89	Horz(CT)	0.45	10	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
								Weight: 335 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.3 *Except*
 3-15,5-15,7-12: 2x4 SP No.2
 SLIDER Right 2x6 SP No.2 - t 3-5-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-1-8 oc purlins, except end verticals, and 2-0-0 oc purlins (5-1-6 max.): 3-6.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 WEBS 1 Row at midpt 4-15, 5-15, 5-14
 2 Rows at 1/3 pts 7-13

REACTIONS.


(size) 19=0-3-8, 10=0-3-8
 Max Horz 19=-331(LC 8)
 Max Uplift 19=-398(LC 12), 10=-426(LC 13)
 Max Grav 19=1531(LC 2), 10=1493(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1285/366, 2-3=-1437/509, 3-4=-1217/512, 4-5=-1217/512, 5-6=-1277/520,
 6-7=-1727/583, 7-8=-4493/1055, 8-10=-3874/1020, 1-19=-1480/409
 BOT CHORD 18-19=-308/330, 17-18=-431/1086, 15-17=-369/1070, 14-15=-319/1201, 13-14=-369/1420,
 12-13=-757/4007, 11-12=-757/3363, 10-11=-734/3158
 WEBS 2-18=-440/193, 3-17=-123/308, 3-15=-309/520, 4-15=-318/246, 5-14=-562/200,
 5-13=-46/439, 6-13=-265/900, 7-13=-3219/787, 7-12=-723/3920, 8-12=-210/646,
 8-11=-283/80, 1-18=-275/1136

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 10-8-0, Exterior(2R) 10-8-0 to 14-10-15, Interior(1) 14-10-15 to 23-8-0, Exterior(2R) 23-8-0 to 27-10-15, Interior(1) 27-10-15 to 36-8-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 398 lb uplift at joint 19 and 426 lb uplift at joint 10.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

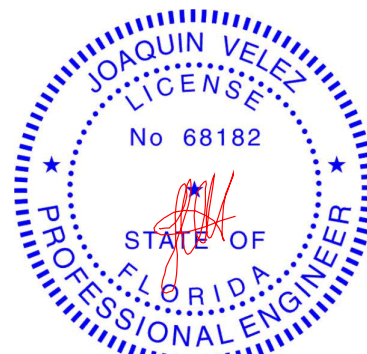

Joaquin Velez PE No.68182
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
 Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700801
2478882	T16	Common	1	1		

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:05 2021 Page 1

ID:ZNSI8H1epQPpWZFaCobIIYzc_TY-OM11aVxyDrbf4H0CVGdbHKdL?wsmi8ZFVwo9Blzp8sC



4x6 =

Scale = 1:39.6

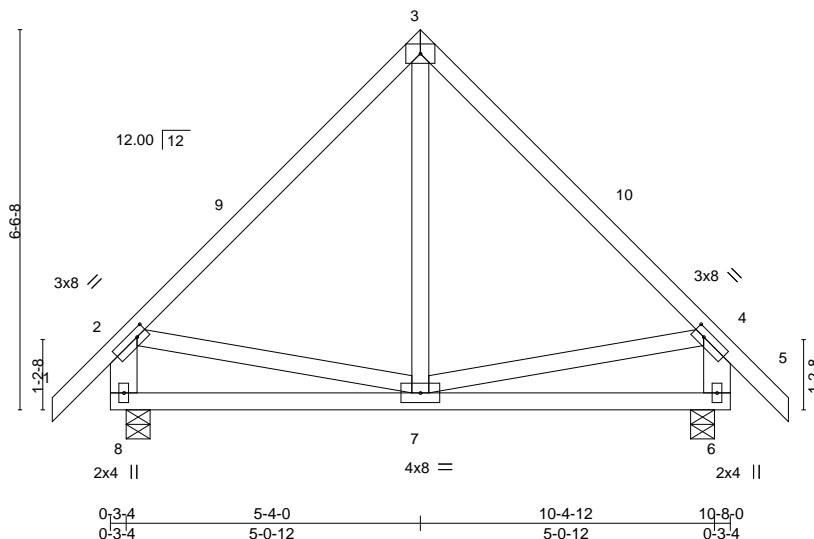


Plate Offsets (X,Y)-- [2:0-2-4,0-1-8], [4:0-2-4,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.47	Vert(LL)	-0.01	7-8	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.23	Vert(CT)	-0.03	7-8	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	6	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
								Weight: 71 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3 *Except*
 2-8,4-6: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 8=0-4-15, 6=0-4-15
 Max Horz 8=247(LC 11)
 Max Uplift 8=-153(LC 12), 6=-153(LC 13)
 Max Grav 8=444(LC 1), 6=444(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-345/248, 3-4=-345/248, 2-8=-399/341, 4-6=-399/341
 BOT CHORD 7-8=-290/344
 WEBS 2-7=-146/311, 4-7=-153/313

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 5-4-0, Exterior(2R) 5-4-0 to 8-4-0, Interior(1) 8-4-0 to 11-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 153 lb uplift at joint 8 and 153 lb uplift at joint 6.

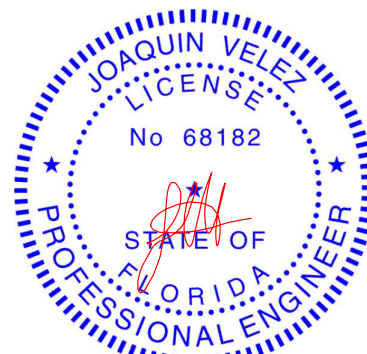

Joaquin Velez PE No.68182
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

February 3,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.
 Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700802
2478882	T16G	Common Structural Gable	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:07 2021 Page 1
ID:ZNSl8H1epQP5WZFaCobllYzc_TY-Kl9o?ByDITsNJAbchf3Mijlekb1A12YyEHGGdzp8sA



4x4 =

Scale = 1:39.6


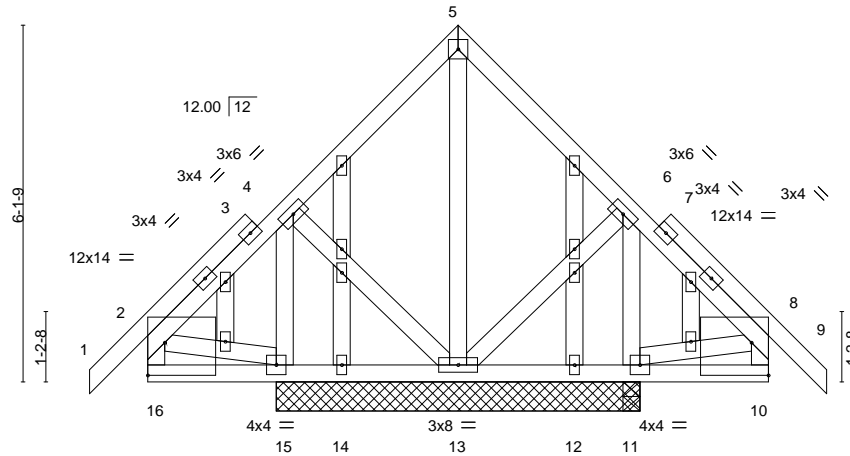


Plate Offsets (X,Y)--		[2:Edge,0-6-12], [8:Edge,0-6-12]									
LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES	
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.14	Vert(LL)	-0.00	in (loc)	14	I/defl	L/d
TCDL	7.0	Lumber DOL	1.25	BC	0.05	Vert(CT)	-0.00	14	>999	180	240
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.16	Horz(CT)	0.00	11	n/a	n/a	
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
										Weight: 99 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 6-3-0.

(lb) - Max Horz 15=-218(LC 10)

Max Uplift All uplift 100 lb or less at joint(s) except 13=-128(LC 13), 11=-111(LC 13), 15=-111(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 13, 14, 12 except 11=373(LC 24), 11=338(LC 1), 15=373(LC 23)


FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 6-11=-287/203, 4-15=-287/203

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 5-4-0, Exterior(2R) 5-4-0 to 8-3-12, Interior(1) 8-3-12 to 11-8-0 zone; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 128 lb uplift at joint 13, 111 lb uplift at joint 11 and 111 lb uplift at joint 15.

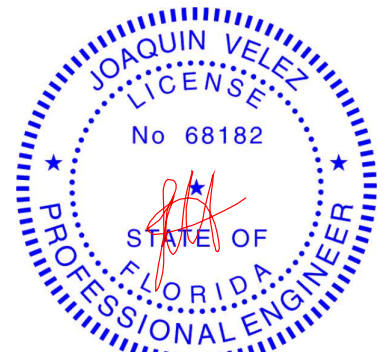

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job 2478882	Truss T17	Truss Type Common	Qty 3	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700803
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:09 2021 Page 1

ID:ZNSI8H1epQPswZFaCobIIYzc_TY-H7GYQs_TH465ZuKzk6iXRAo0xDkeyrrQYmNKWzp8s8

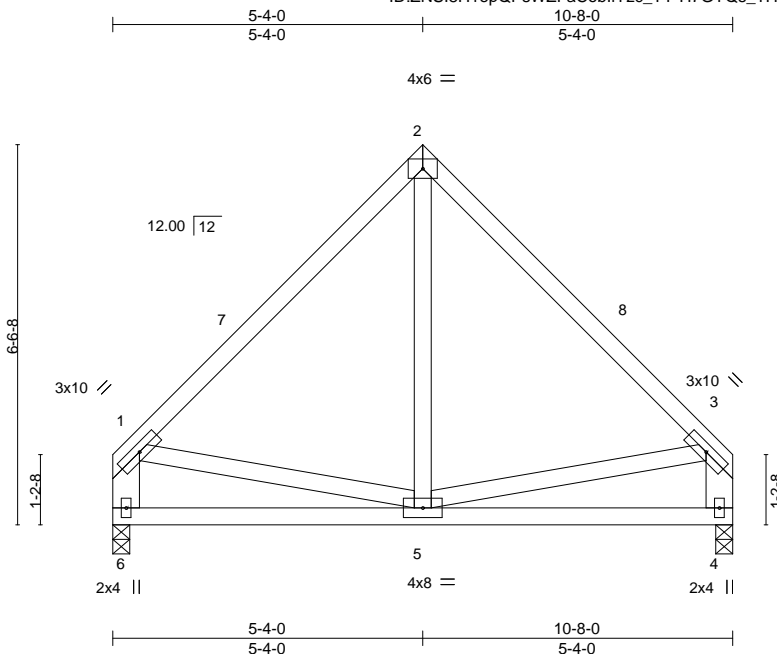

Scale = 1:39.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.47	Vert(LL)	-0.01	4-5	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.22	Vert(CT)	-0.03	4-5	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00	4	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
									Weight: 67 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
1-6,3-4: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.


(size) 6=0-3-8, 4=0-3-8
Max Horz 6=208(LC 8)
Max Uplift 6=130(LC 13), 4=130(LC 12)
Max Grav 6=378(LC 1), 4=378(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-347/236, 2-3=-347/236, 1-6=-332/253, 3-4=-332/254
BOT CHORD 5-6=-253/278

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-2-12 to 3-2-12, Interior(1) 3-2-12 to 5-4-0, Exterior(2R) 5-4-0 to 8-4-0, Interior(1) 8-4-0 to 10-5-4 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 130 lb uplift at joint 6 and 130 lb uplift at joint 4.

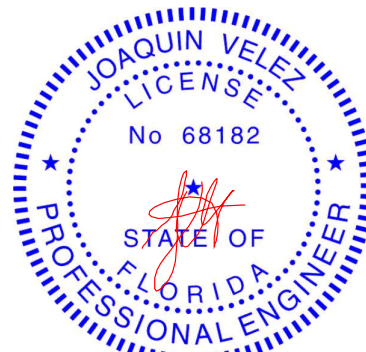

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700804
2478882	T18	Monopitch	9	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:10 2021 Page 1
ID:ZNSI8H1epQP5WZFaCobIIYzc_TY-IKqweC752NEyA2uAlqDm_OL9dxWjNQF_eCVwsyzp8s7

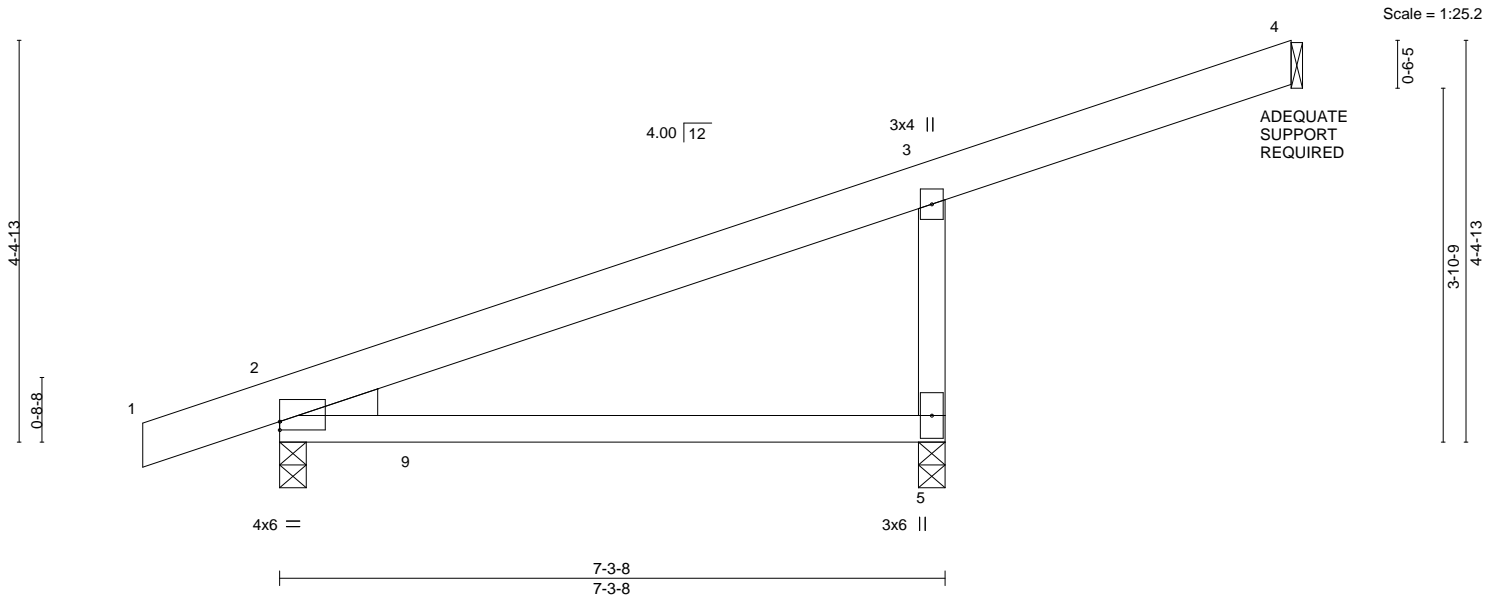



Plate Offsets (X,Y)-- [2:0-0-0,0-1-2]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.60	Vert(LL)	0.17 5-8 >514	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.43	Vert(CT)	0.15 5-8 >589	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.02 4 n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 47 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 4=Mechanical, 5=0-3-8, 2=0-3-8
Max Horz 2=211(LC 8)
Max Uplift 4=43(LC 12), 5=389(LC 8), 2=223(LC 8)
Max Grav 4=48(LC 1), 5=448(LC 1), 2=323(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-5=-377/640

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 11-0-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 4, 389 lb uplift at joint 5 and 223 lb uplift at joint 2.

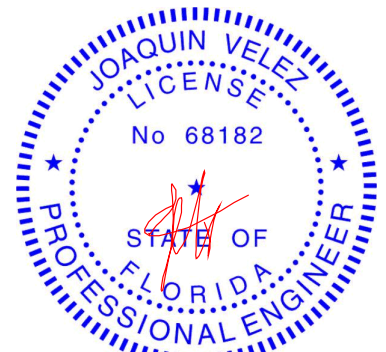

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610

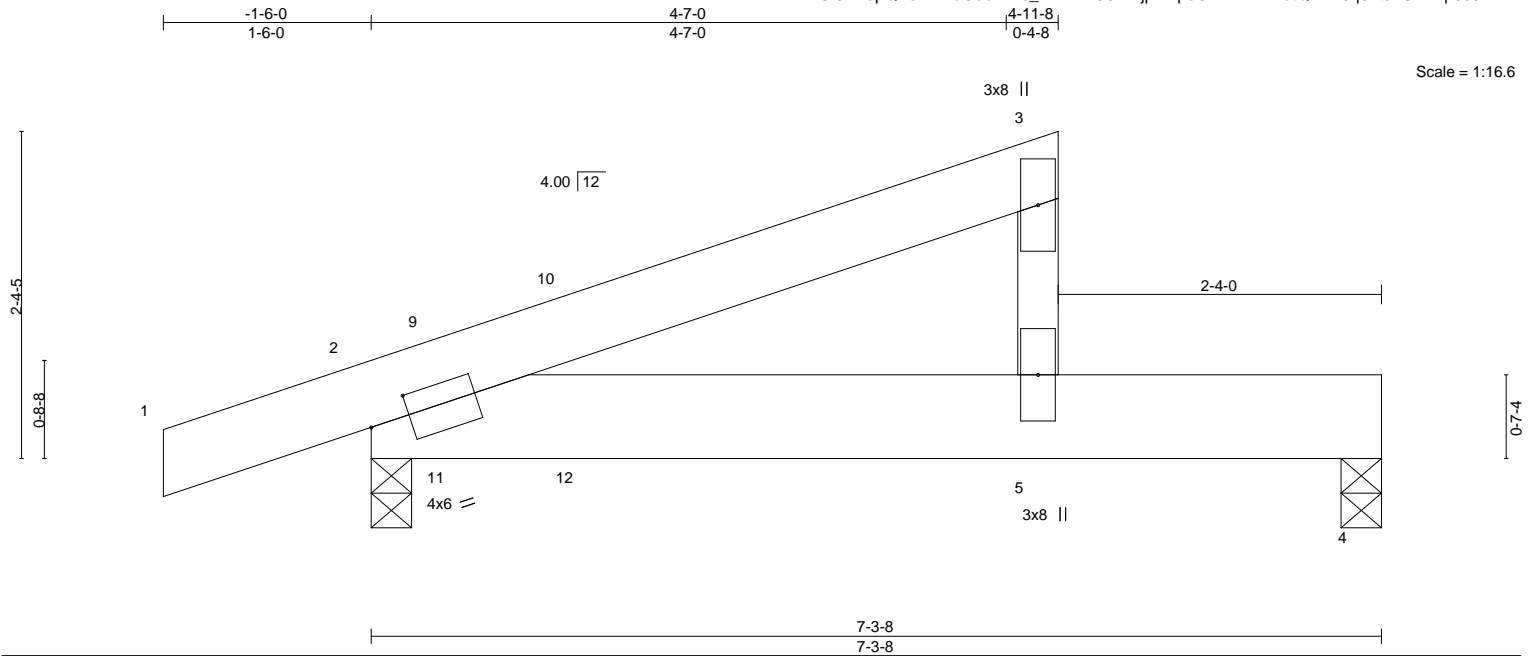


Plate Offsets (X,Y)-- [2:0-3-7,0-1-12]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.19	Vert(LL)	0.09	5-8	>959	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.22	Vert(CT)	0.08	5-8	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.22	Horz(CT)	-0.01	2	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MP							Weight: 41 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-7-0 oc purlins.
BOT CHORD	2x8 SP 2400F 2.0E	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS. (size) 2=0-3-8, 4=0-3-8
 Max Horz 2=110(LC 8)
 Max Uplift 2=-336(LC 8), 4=-258(LC 8)
 Max Grav 2=415(LC 1), 4=319(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-5=-370/731

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 1-6-0 to 1-6-0, Interior(1) 1-6-0 to 4-9-12 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 336 lb uplift at joint 2 and 258 lb uplift at joint 4.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 250 lb down and 514 lb up at 4-9-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-6=-20
Concentrated Loads (lb)
Vert: 3=-250(F)

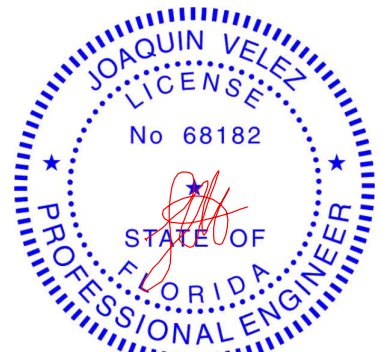

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 36610

Job 2478882	Truss T19	Truss Type Monopitch Girder	Qty 1	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700806
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:13 2021 Page 1 ID:ZNSI8H1epQPsWZFaCobIIYzc_TY-9vW3GE1_LlcX1VdlzymTb0zkN8ZLaaHQLAkaTHzp8s4					
Job Reference (optional)					

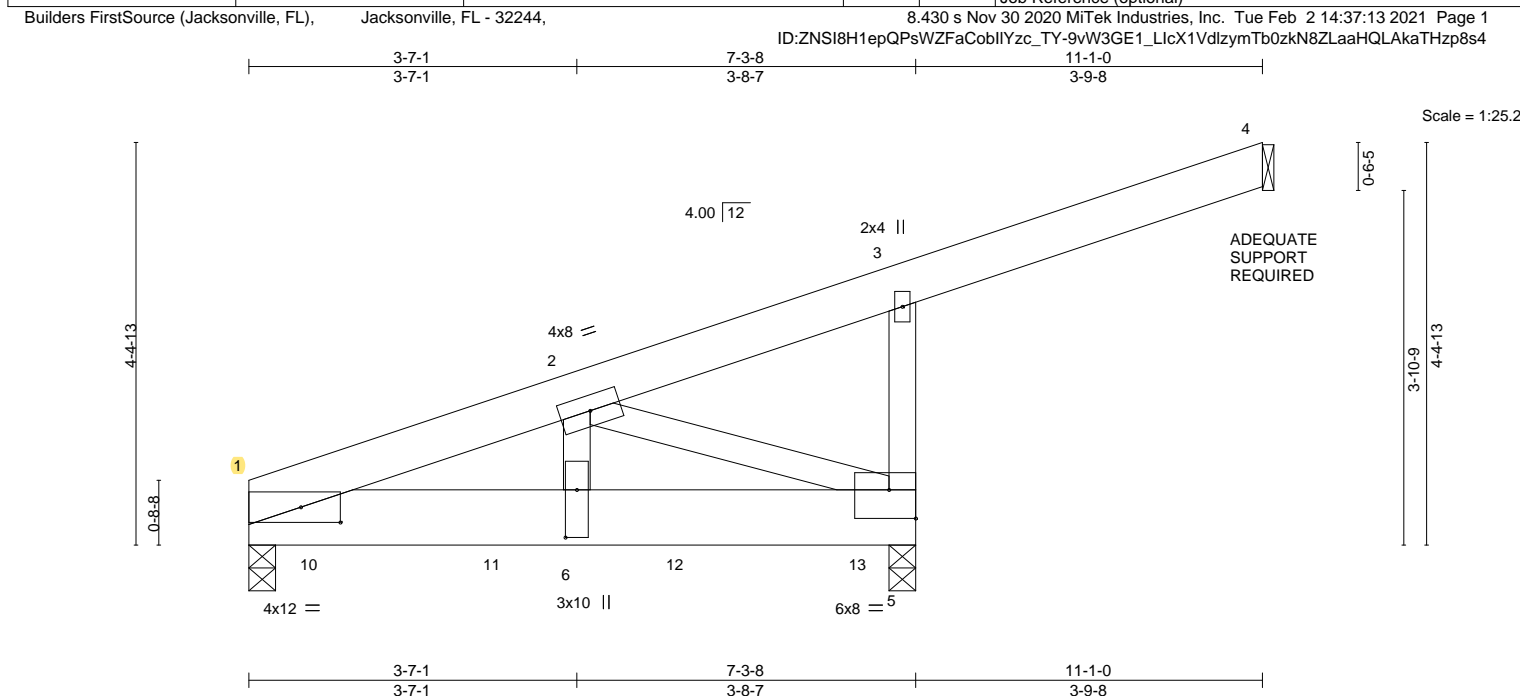


Plate Offsets (X,Y)-- [1:0-5-3,0-2-0], [5:Edge,0-3-12], [6:0-6-4,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.38	Vert(LL)	0.04 6 >999 240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.37	Vert(CT)	-0.06 6 >999 180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.88	Horz(CT)	0.01 5 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS				Weight: 59 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 4=Mechanical, 5=0-3-8
Max Horz 1=179(LC 23)
Max Uplift 1=980(LC 4), 4=-88(LC 23), 5=-1267(LC 4)
Max Grav 1=2365(LC 2), 4=57(LC 1), 5=2699(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-2=-2968/1175, 3-5=-326/245
BOT CHORD 1-6=-1257/2783, 5-6=-1257/2783
WEBS 2-6=-785/1950, 2-5=-2933/1326

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 980 lb uplift at joint 1, 88 lb uplift at joint 4 and 1267 lb uplift at joint 5.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1172 lb down and 478 lb up at 0-8-12, 1141 lb down and 466 lb up at 2-8-12, and 1141 lb down and 466 lb up at 4-8-12, and 1141 lb down and 460 lb up at 6-8-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-4=-54, 5-7=-20
Concentrated Loads (lb)
Vert: 10=-962(F) 11=-885(F) 12=-885(F) 13=-891(F)

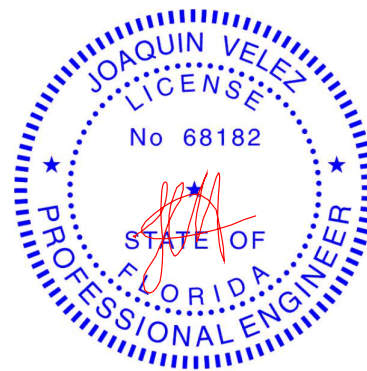

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610


Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700807
2478882	T20	Monopitch Girder	2	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,


8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:15 2021 Page 1

ID:ZNSI8H1epQPswZFaCobIIYzc_TY-5Hephw2EtwsEHpn74NoxhR27PyEu2fcjoUDhYAzp8s2

Job Reference (optional)



Scale = 1:19.0

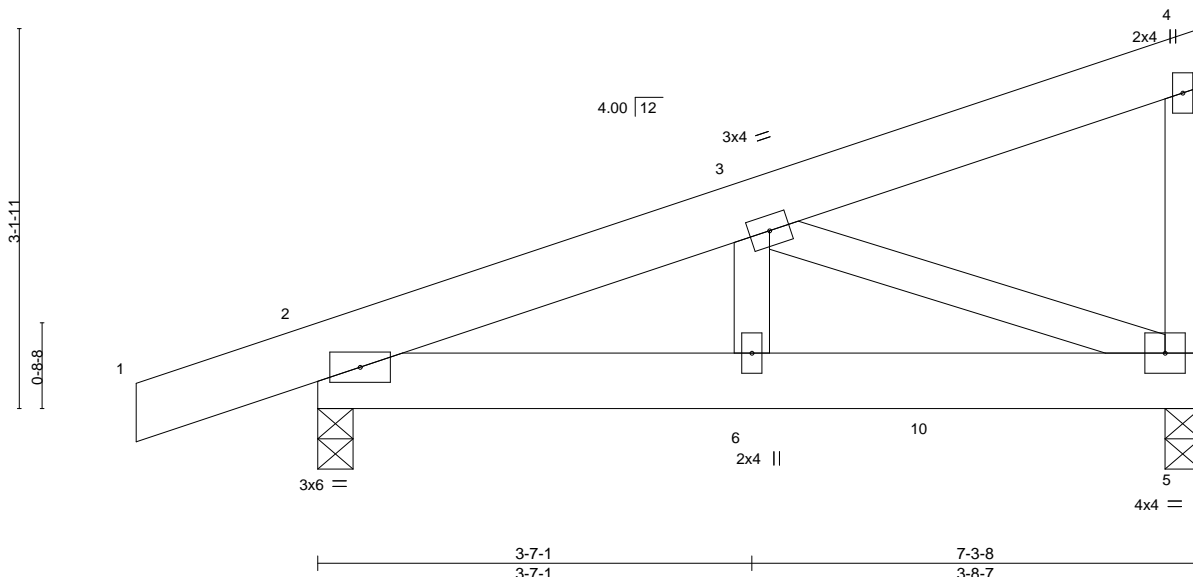

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.15	Vert(LL)	0.02	5-6	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.37	Vert(CT)	-0.02	5-6	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.18	Horz(CT)	-0.00	5	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
								Weight: 49 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 9-7-6 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=148(LC 4)
Max Uplift 2=358(LC 4), 5=420(LC 4)
Max Grav 2=448(LC 1), 5=485(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-650/465
BOT CHORD 2-6=-512/585, 5-6=-512/585
WEBS 3-6=-256/308, 3-5=-606/531

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 358 lb uplift at joint 2 and 420 lb uplift at joint 5.
- 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 323 lb down and 320 lb up at 5-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 5-7=-20
Concentrated Loads (lb)
Vert: 10=-323(B)

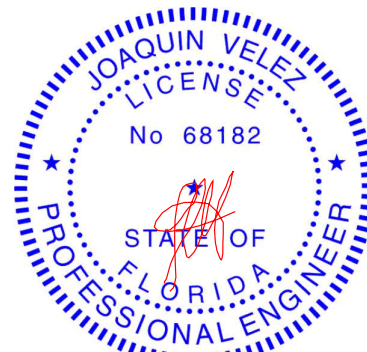

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700808
2478882	T21	Half Hip Girder	2	1		

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:16 2021 Page 1

ID:ZNSI8H1epQPsWZFaCoblIYzc_TY-aUBCuG3seD_5uzMJ4KADfaJhMcPn72s18yF4czp8s1



Scale = 1:17.1

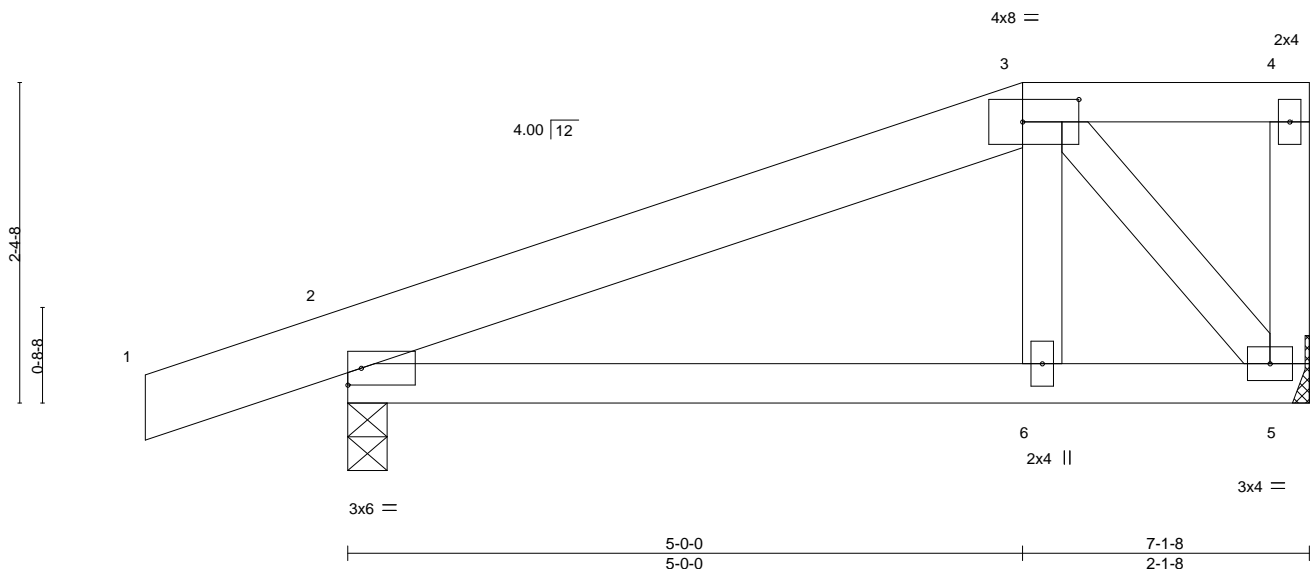


Plate Offsets (X,Y)--		[3:0-5-0,0-2-0]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.12		Vert(LL)	0.02 6-9	>999	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.22		Vert(CT)	-0.03 6-9	>999	180		
BCLL 0.0 *		Rep Stress Incr	NO	WB 0.11		Horz(CT)	-0.00 5	n/a	n/a		
BCDL 10.0		Code FBC2020/TPI2014		Matrix-MS						Weight: 39 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2 *Except*
3-4: 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=Mechanical
Max Horz 2=118(LC 4)
Max Uplift 2=313(LC 4), 5=296(LC 4)
Max Grav 2=383(LC 1), 5=343(LC 1)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-340/226
BOT CHORD 2-6=-246/277, 5-6=-255/286
WEBS 3-6=-124/258, 3-5=-410/366

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 313 lb uplift at joint 2 and 296 lb uplift at joint 5.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 72 lb down and 114 lb up at 5-0-0 on top chord, and 119 lb down and 121 lb up at 5-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-4=-54, 5-7=-20
Concentrated Loads (lb)
Vert: 6=-56(F) 3=-72(F)

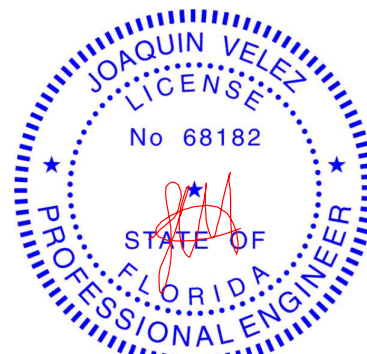

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job 2478882	Truss T22	Truss Type Common	Qty 4	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700809
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					

0-8-0 3-10-0 7-8-0 8-4-0
0-8-0 3-10-0 3-10-0 0-8-0

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:17 2021 Page 1
ID:ZNSI8H1epQPpSWZFaCobIIYzc_TY-2gla6c4UPX6yW7xWCorPms7RfmxrWax0Foic2zp8s0

Scale = 1:29.8

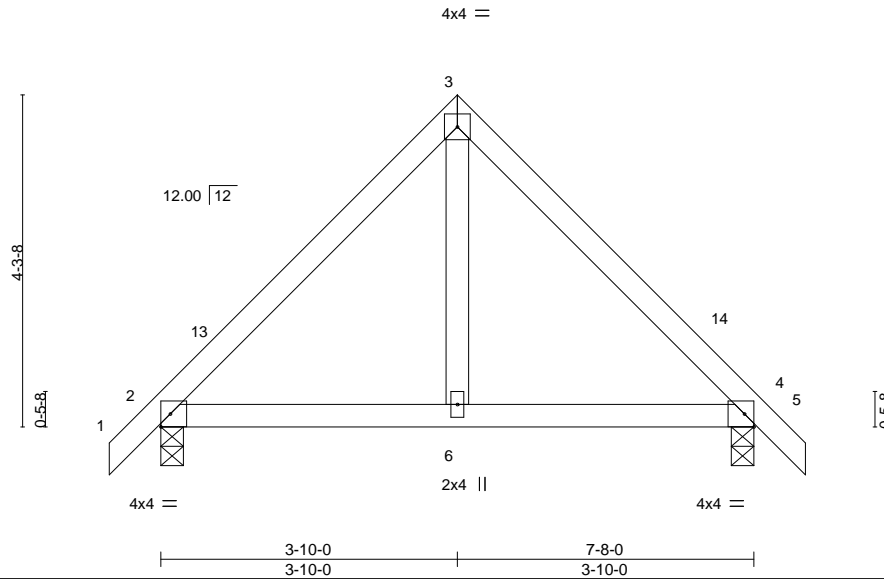

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.30	Vert(LL)	0.02	6-9	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.27	Vert(CT)	-0.02	6-9	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	4	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
									Weight: 37 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 4=0-3-8
Max Horz 2=-140(LC 10)
Max Uplift 2=-113(LC 12), 4=-113(LC 13)
Max Grav 2=320(LC 1), 4=320(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-290/250, 3-4=-290/250

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-8-0 to 2-4-0, Interior(1) 2-4-0 to 3-10-0, Exterior(2R) 3-10-0 to 6-10-0, Interior(1) 6-10-0 to 8-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 2 and 113 lb uplift at joint 4.

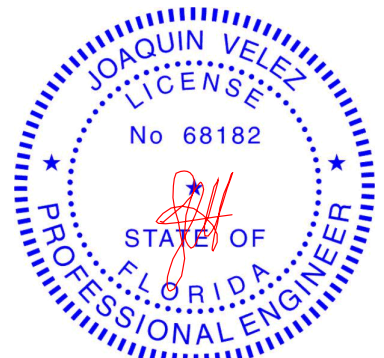

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 36610


Job 2478882	Truss T22G	Truss Type GABLE	Qty 1	Ply 1	BLAKE CONST. - DAUGHTERS HSE T22700810
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,


8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:20 2021 Page 1

ID:ZNSI8H1epQP5WZFaCobIIYzc_TY-SFRikd6NhSUXNaf5twO6OVlyuzzYjxhSymwSCNzp8rz



4x4 =

Scale = 1:28.5

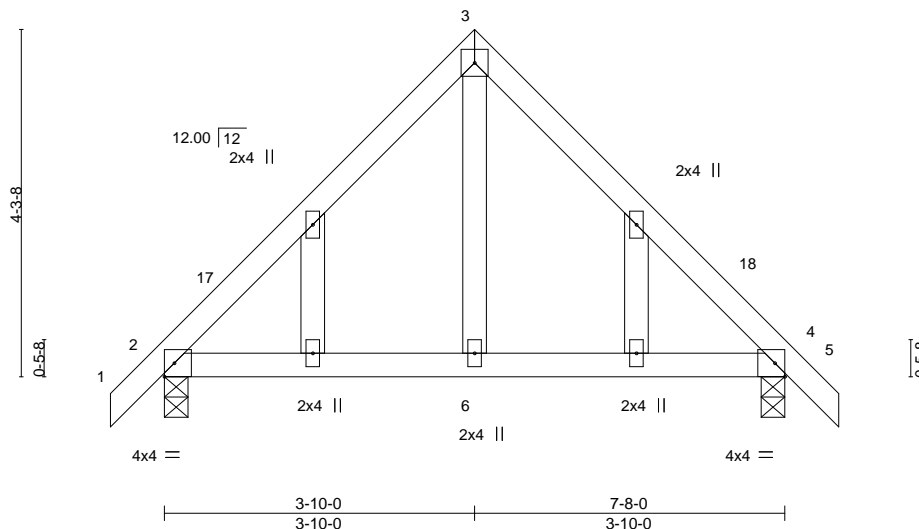

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.30	Vert(LL)	0.02 6-13	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.27	Vert(CT)	-0.02 6-13	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00 4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 42 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 4=0-3-8
Max Horz 2=-140(LC 10)
Max Uplift 2=-113(LC 12), 4=-113(LC 13)
Max Grav 2=320(LC 1), 4=320(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-290/250, 3-4=-290/250

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-8-0 to 2-4-0, Interior(1) 2-4-0 to 3-10-0, Exterior(2R) 3-10-0 to 6-10-0, Interior(1) 6-10-0 to 8-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 2 and 113 lb uplift at joint 4.

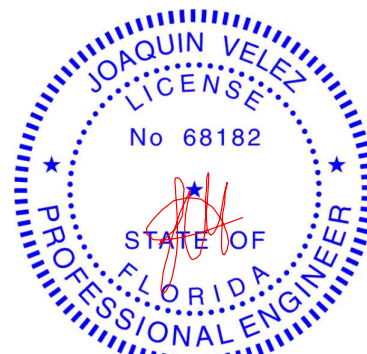

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610

Job 2478882	Truss TG01	Truss Type FLAT GIRDER	Qty 1	Ply 2	BLAKE CONST. - DAUGHTERS HSE T22700811
----------------	---------------	---------------------------	----------	----------	---

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Nov 30 2020 MiTek Industries, Inc. Tue Feb 2 14:37:21 2021 Page 1

ID:ZNSI8H1epQPsWZFaCobllYzc_TY-wR?5xz7?SmcO?kEHRevLwil7FNHSSHkcAQg0kpzp8ry

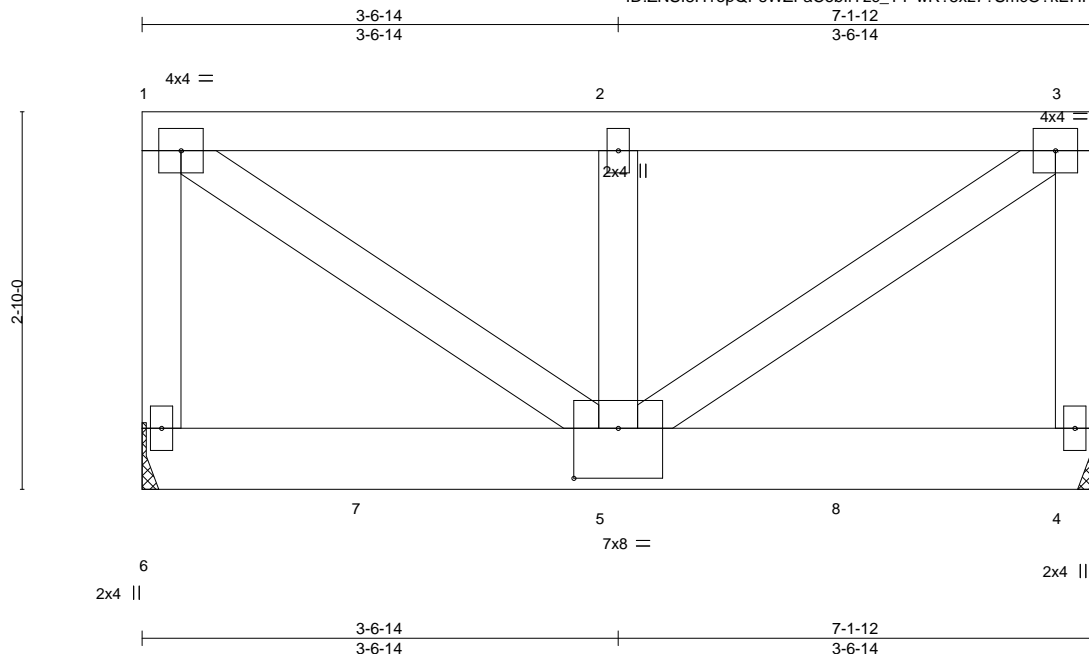


Plate Offsets (X,Y)-- [5:0-4-0,0-4-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.26	Vert(LL)	-0.02 4-5	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.42	Vert(CT)	-0.03 4-5	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.46	Horz(CT)	0.00 4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 96 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=Mechanical, 4=Mechanical
Max Uplift 6=618(LC 4), 4=613(LC 4)
Max Grav 6=2088(LC 2), 4=2065(LC 2)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-6=-1510/476, 1-2=-2042/594, 2-3=-2042/594, 3-4=-1510/476
WEBS 1-5=-704/2430, 3-5=-704/2431

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 618 lb uplift at joint 6 and 613 lb uplift at joint 4.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1238 lb down and 346 lb up at 1-8-14, and 1238 lb down and 346 lb up at 3-6-14, and 1238 lb down and 346 lb up at 5-4-2 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-6=-20

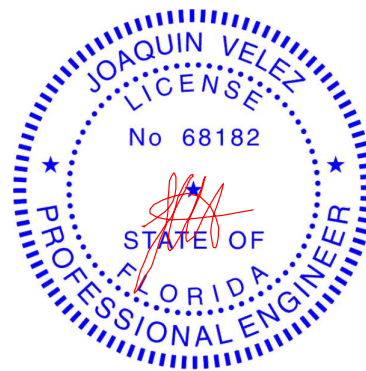

Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 3, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	BLAKE CONST. - DAUGHTERS HSE	T22700811
2478882	TG01	FLAT GIRDER	1	2	Job Reference (optional)	


LOAD CASE(S) Standard
 Concentrated Loads (lb)
 Vert: 5=-1087(F) 7=-1087(F) 8=-1087(F)

Symbols

PLATE LOCATION AND ORIENTATION



0-¹/₁₆"

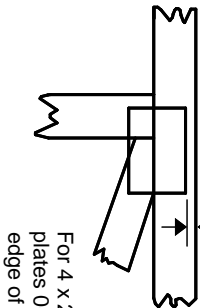

For 4 x 2 orientation, locate plates 0- ¹/₁₆" from outside edge of truss.

—
—
This symbol indicates the required direction of slots in connector plates.


* Plate location details available in **MiTek 20/20** software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

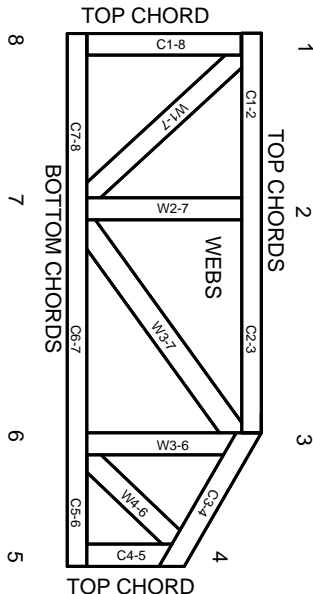

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.