


12

PAGE: 2

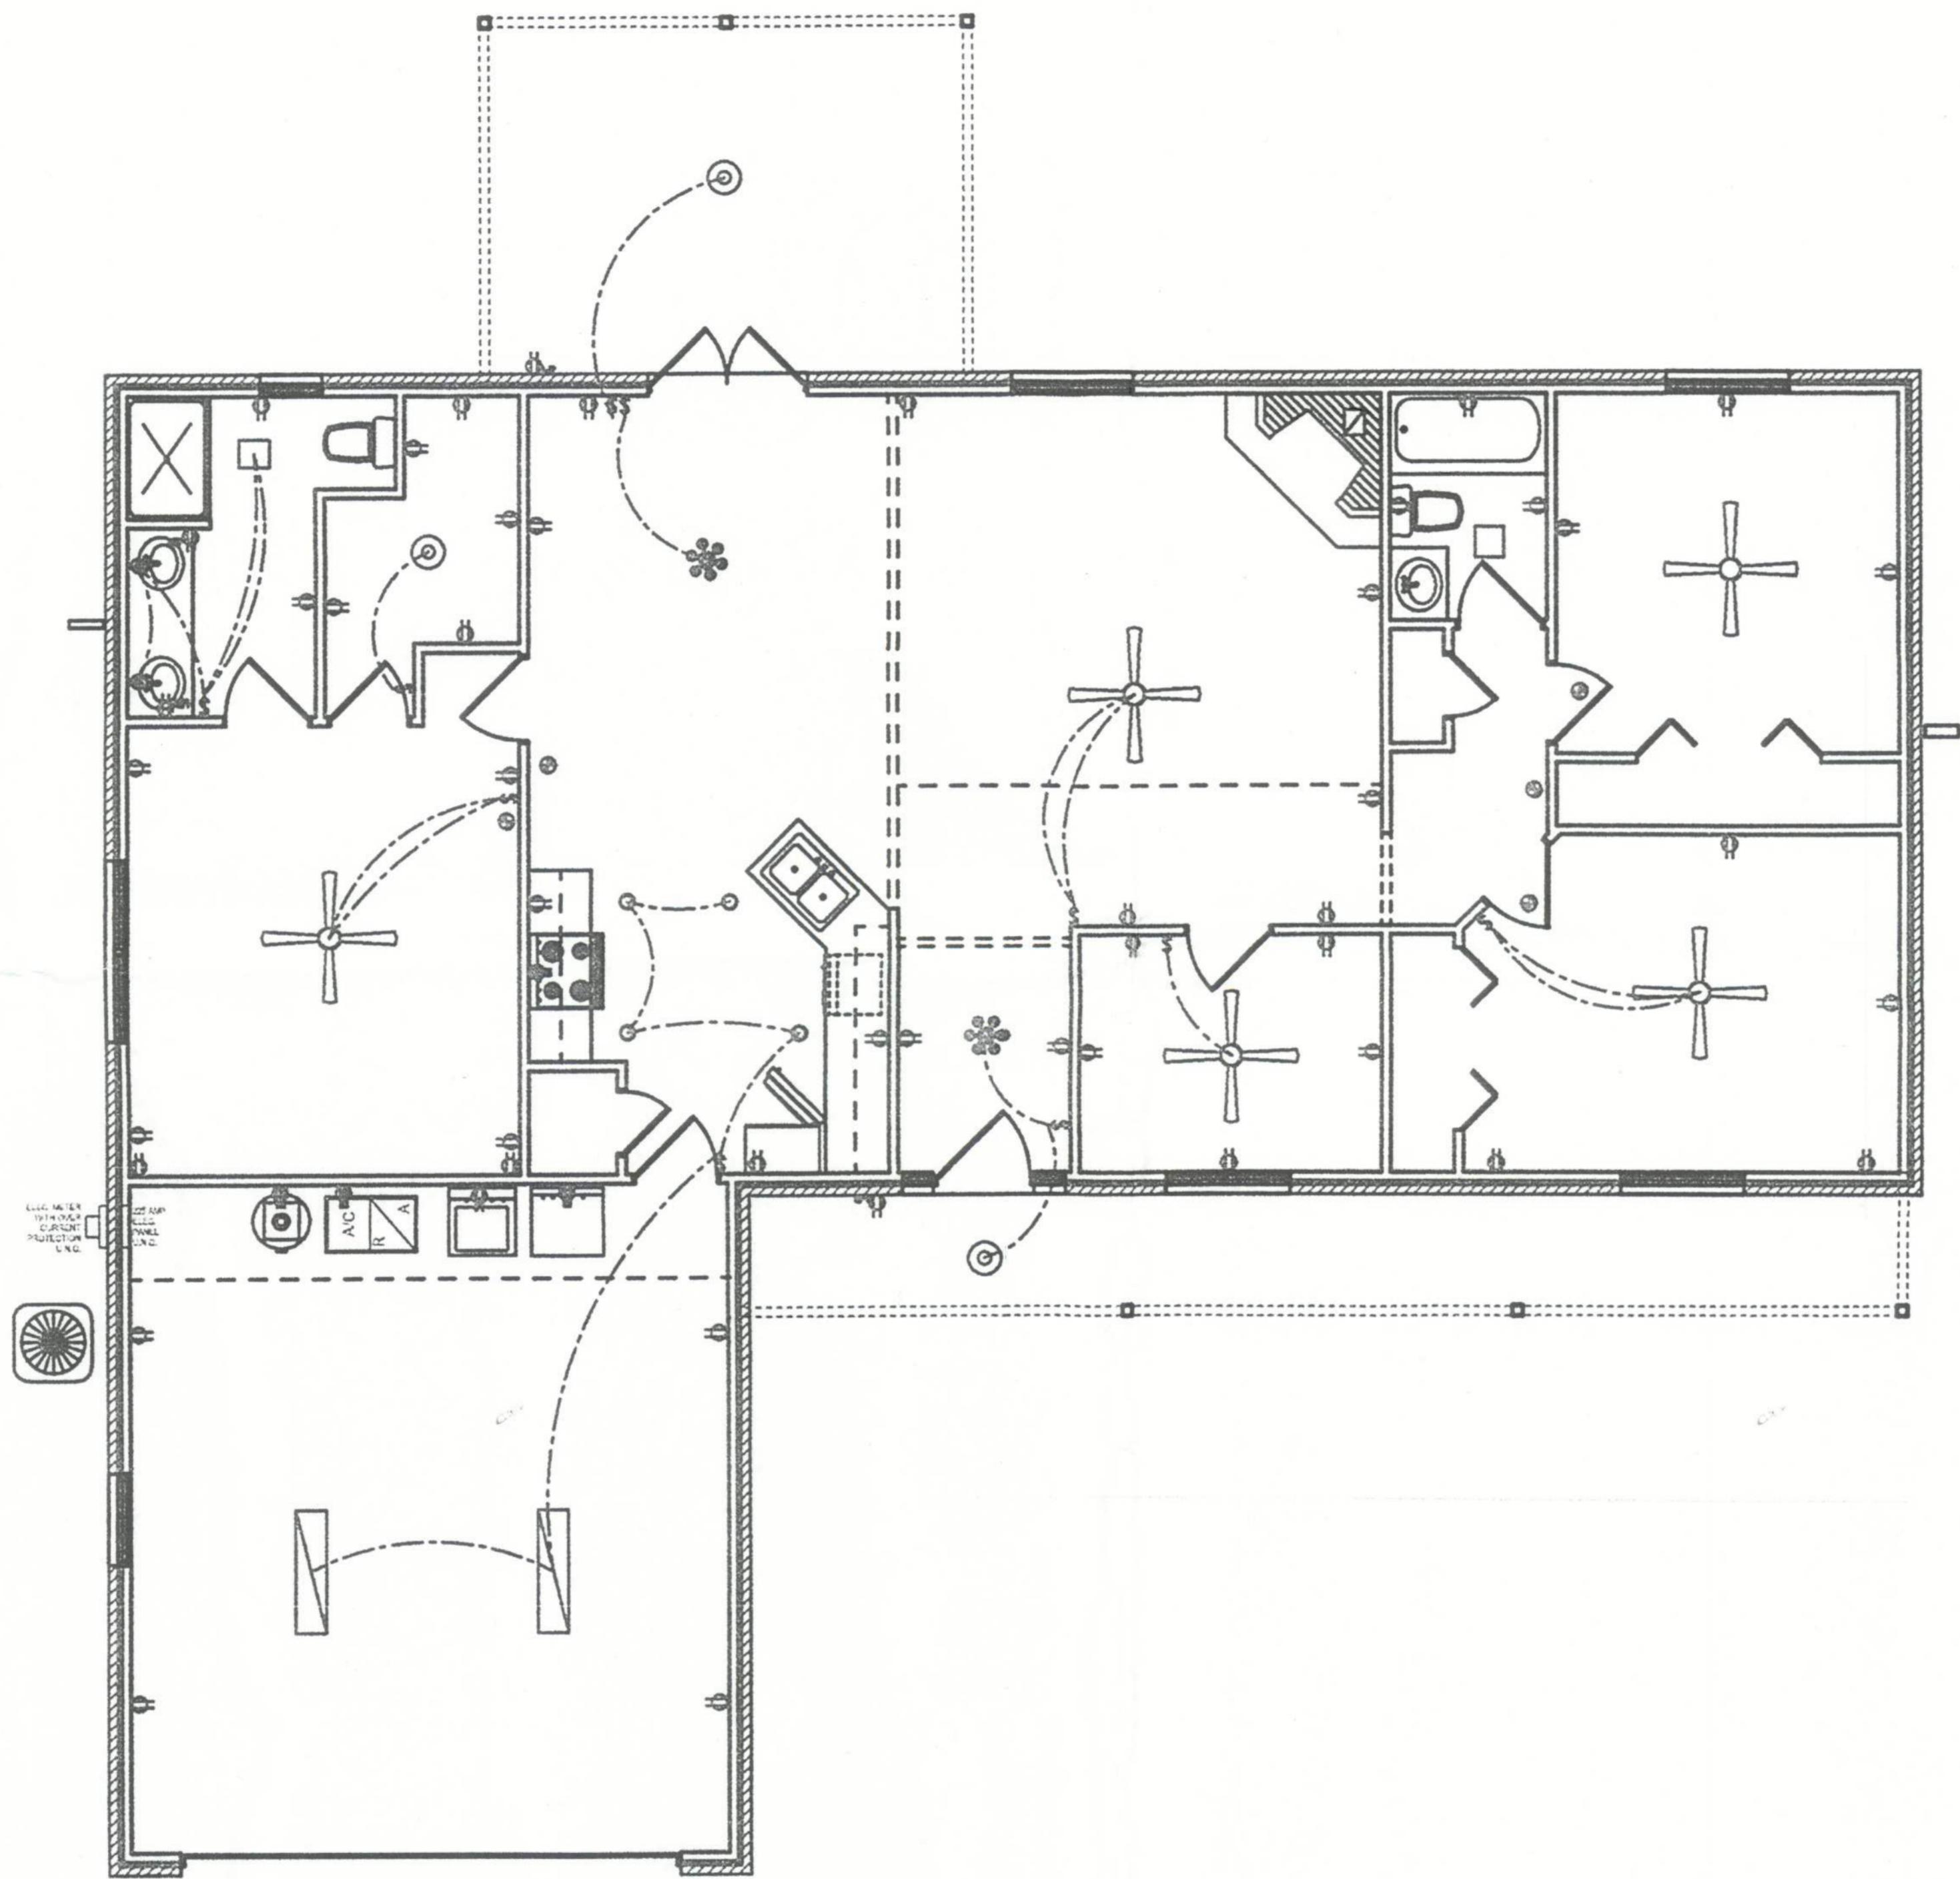

Area	
Heated	1508
Porch	357
Garage	440
Total	2305

Garage fire separations shall comply with the following:  
1. The private garage shall be separated from the dwelling unit and its attic area by means of a minimum 5/8-inch (19.7 mm) gypsum board applied to the garage side. Garages shall have no openings shall be separated from the dwelling unit by a minimum 5/8-inch (19.7 mm) gypsum board or equivalent. Door openings between a private garage and the dwelling unit shall be equipped with either solid wood doors, or core or honeycomb core steel doors not less than 13/8 inches (35.0 mm) thick, or core or honeycomb core steel doors not less than 13/8 inches (35.0 mm) thick. Garage doors used for parking purposes shall not be permitted.  
2. Doors in a private garage are built beneath the floor joists separating the dwelling unit and garage shall be constructed of a minimum 5/16-inch (0.48 mm) thick closed and shall have no openings into the garage.  
3. A separation is not required between a Group R-3 and U carpet provided the carpet is entirely open on two or more sides and there are not enclosed areas above.

Drawn By: John Thomas Jr.

SCALE: 1/4

DATE: 10/30/11

**SOFTPIAN**  
ARCHITECTURAL DESIGN SOFTWARE

Thomas Construction of Lake City Inc  
547 SW Dyal Ave.  
Lake City Florida 32024  
PHONE: (386) 823-5004