

G-N Construction
Spec House - Lot 32 Fort White Park
PROJECT ADDRESS:
Lot 32 Fort White Park
Fort White, FL


DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.
COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyright and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without the express written permission and consent of Mark Disoway.
CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.
LIMITATION: This design is valid for one building, at specified location.

MARK DISOWAY, P.E. 53915
FLORIDA PROFESSIONAL ENGINEER
Friday, February 12, 2021

Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
210183
1
OF 5 SHEETS

48587

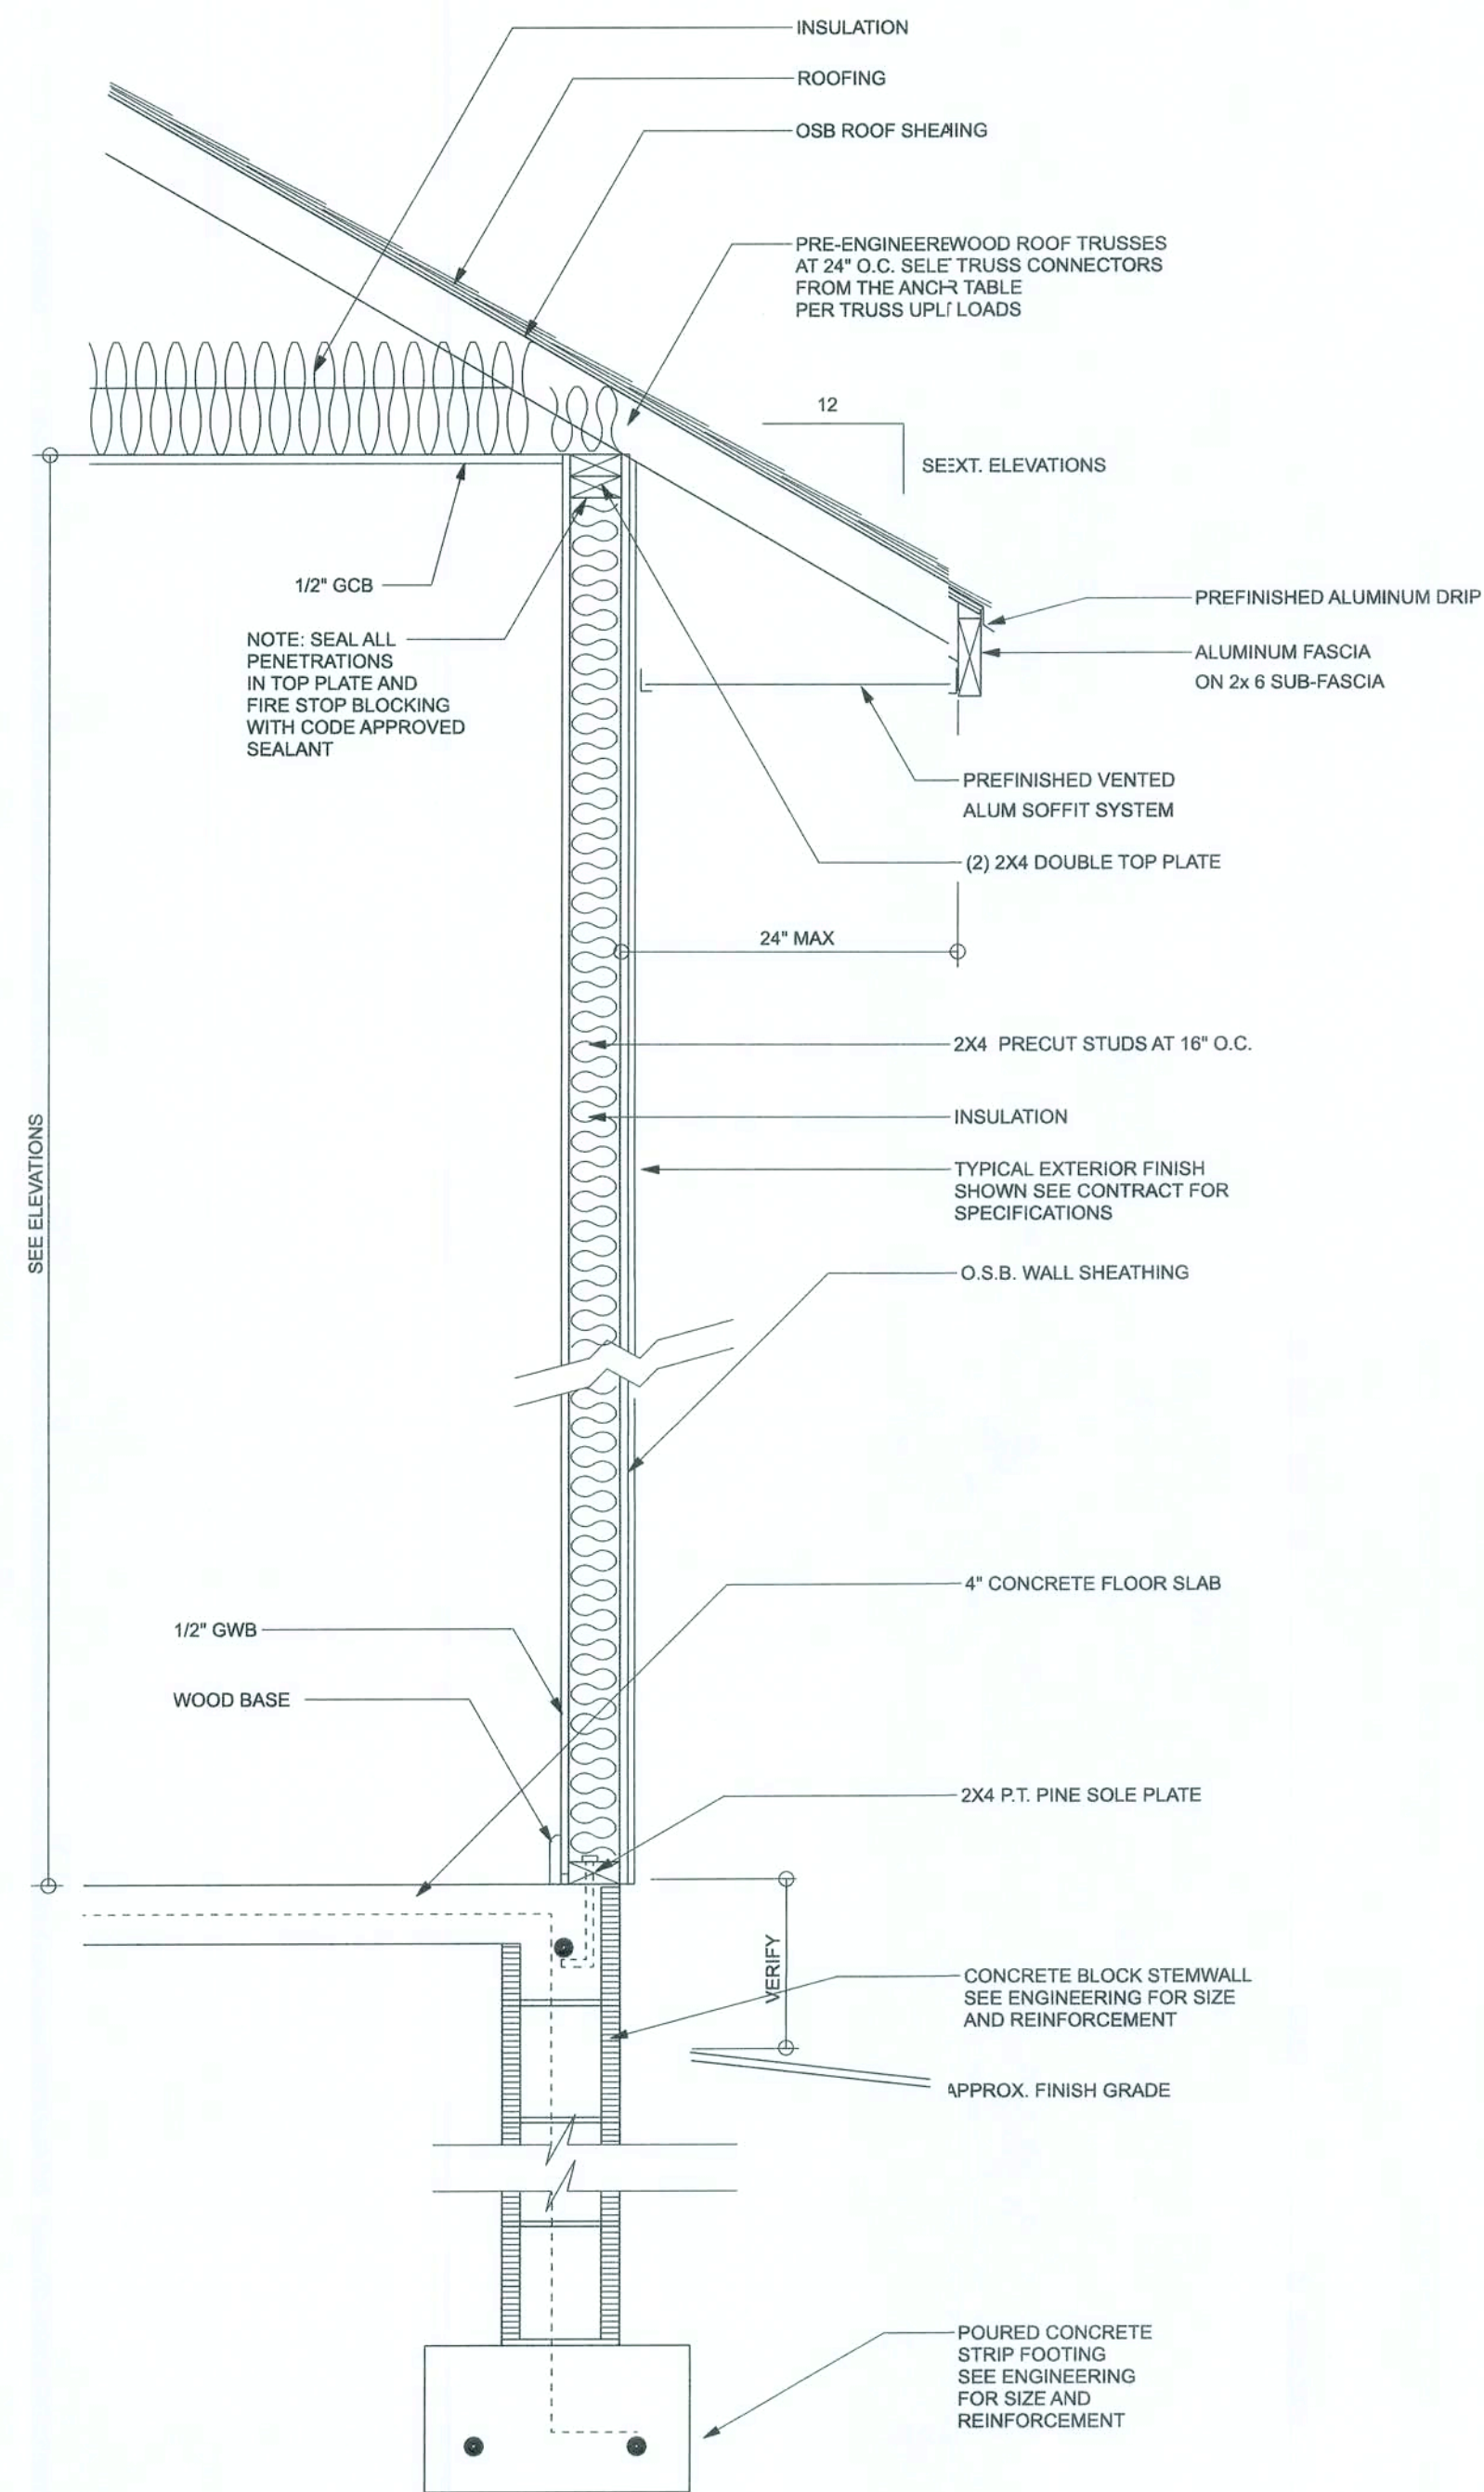


TYPICAL DESIGN WALL SECTION
NON - STRUCTURAL DATA

SCALE: 1" = 1'-0"

- ELECTRICAL PLAN NOTES:**
- E - 1 WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.
 - E - 2 CONSULT THE OWNER FOR THE NUMBER OF SEPARATE TELEPHONE LINES TO BE INSTALLED.
 - E - 3 ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.
 - E - 4 ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.
 - E - 5 TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.
 - E - 6 ELECTRICAL CONTR SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
 - E - 7 ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY.
 - E - 8 ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DEN, BEDROOMS, SUN ROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT.
 - E - 9 ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION.
 - E - 10 A SERVICE DISCONNECT WITH OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER, AT THE PLACE ELECTRIC CONDUCTORS ENTER THE BUILDING. SERVICE ENTRANCE CONDUCTORS MAY NOT BE LOCATED INSIDE OF THE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFICIAL.
 - E - 11 CARBON MONOXIDE ALARMS SHALL BE REQUIRED WITHIN 10' OF ALL ROOMS FOR SLEEPING PURPOSES IN BUILDINGS HAVING A FOSSIL-FUEL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR ATTACHED GARAGE.
 - E - 12 ALL OUTLETS LOCATED IN RESIDENTIAL TO BE TAMPER-RESISTANT PER NEC.
 - E - 13 A MINIMUM OF 75% OF PERMANENTLY INSTALLED LAMPS OR LIGHTING FIXTURES SHALL BE HIGH EFFICACY FBC EC SEC. R404.1

| ELECTRICAL LEGEND | |
|-------------------|--------------------------------------|
| | CEILING FAN (PRE-WIRE FOR LIGHT KIT) |
| | DOUBLE SECURITY LIGHT |
| | 2x4 FLUORESCENT LIGHT FIXTURE |
| | RECESSED CAN LIGHT |
| | BATH EXHAUST FAN WITH LIGHT |
| | BATH EXHAUST FAN |
| | LIGHT FIXTURE |
| | DUPLEX OUTLET |
| | 220v OUTLET |
| | GFI DUPLEX OUTLET |
| | SMOKE DETECTOR |
| | WALL SWITCH |
| | 3 WAY WALL SWITCH |
| | 4 WAY WALL SWITCH |
| | WATER PROOF GFI OUTLET |
| | PHONE JACK |
| | TELEVISION JACK |
| | GARAGE DOOR OPENER |
| | CARBON MONOXIDE ALARM |

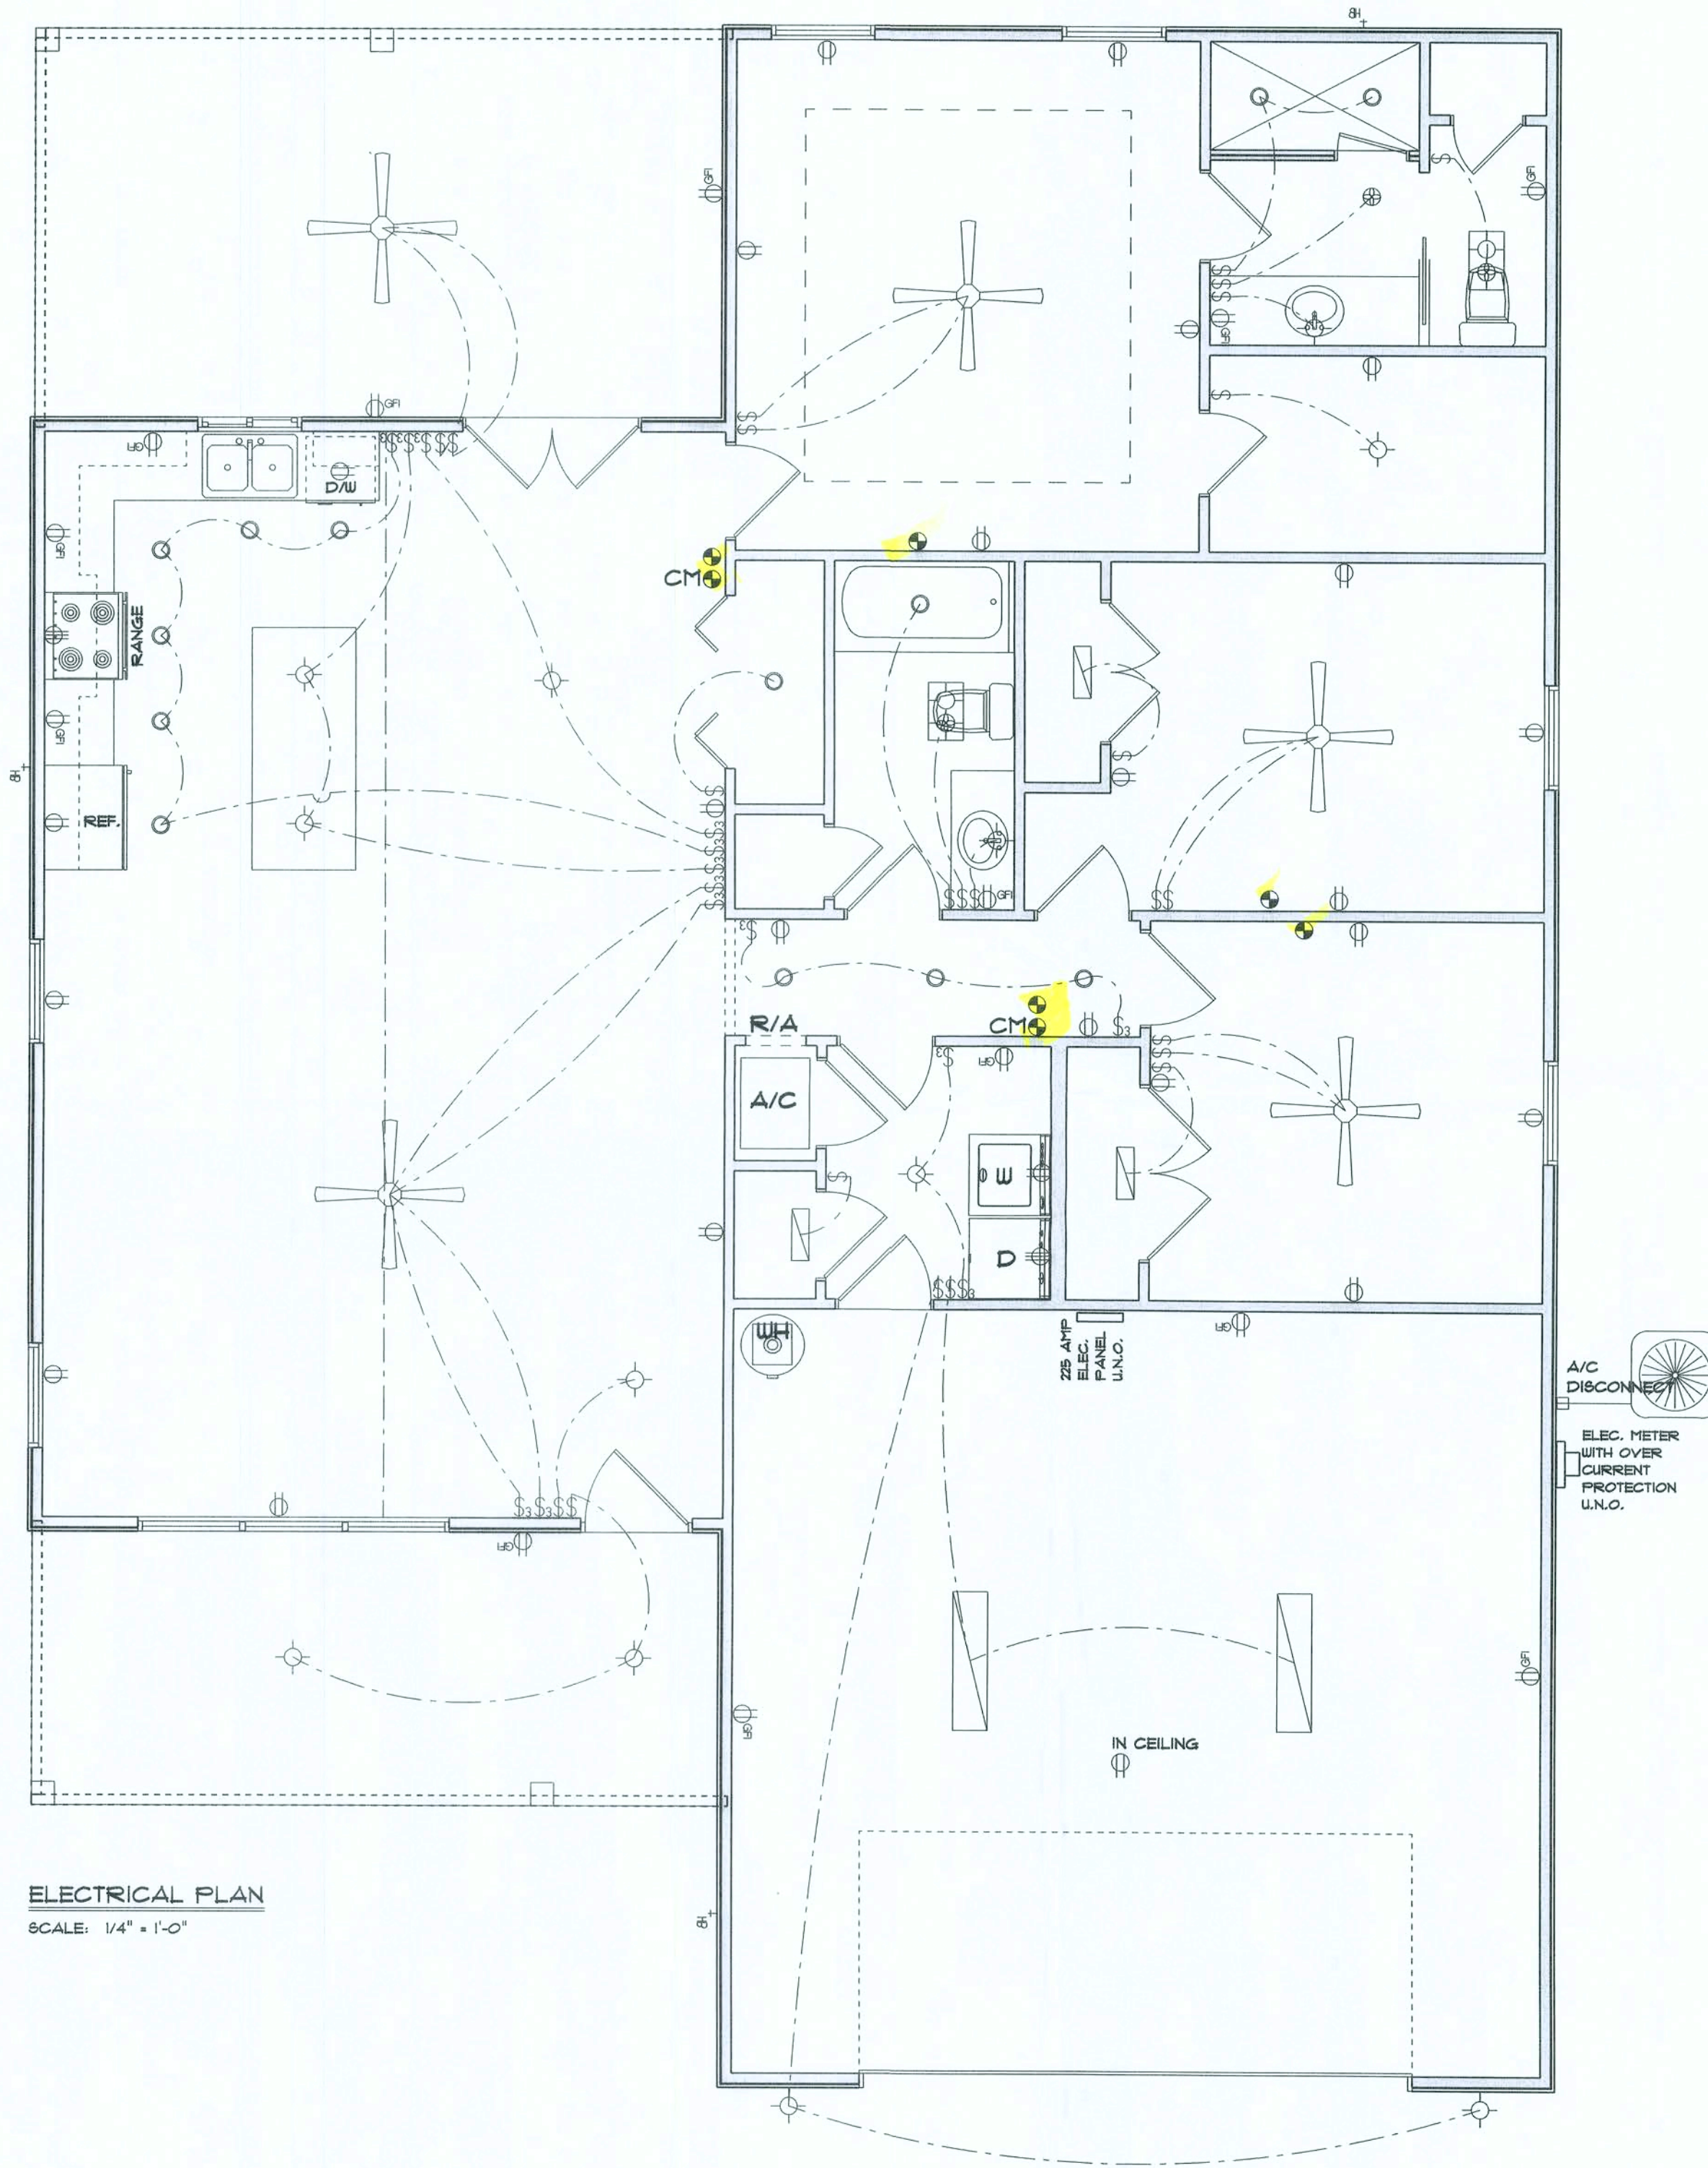

ELECTRICAL PLAN
SCALE: 1/4" = 1'-0"

G-N Construction

Spec House - Lot 32 Fort White Park

PROJECT ADDRESS:
Lot 32 Fort White Park
Fort White, FL


DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without certification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOWAY P.E. 53915

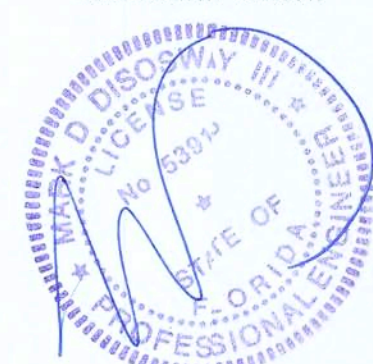


Friday, February 12, 2021


Mark Disoway P.E.
163 SW Midown Place
Suite 103
Lake City, Florida 32025
386.751.5419
disowaydesign@gmail.com

JOB NUMBER:
210'83


2
OF 5 SHEETS

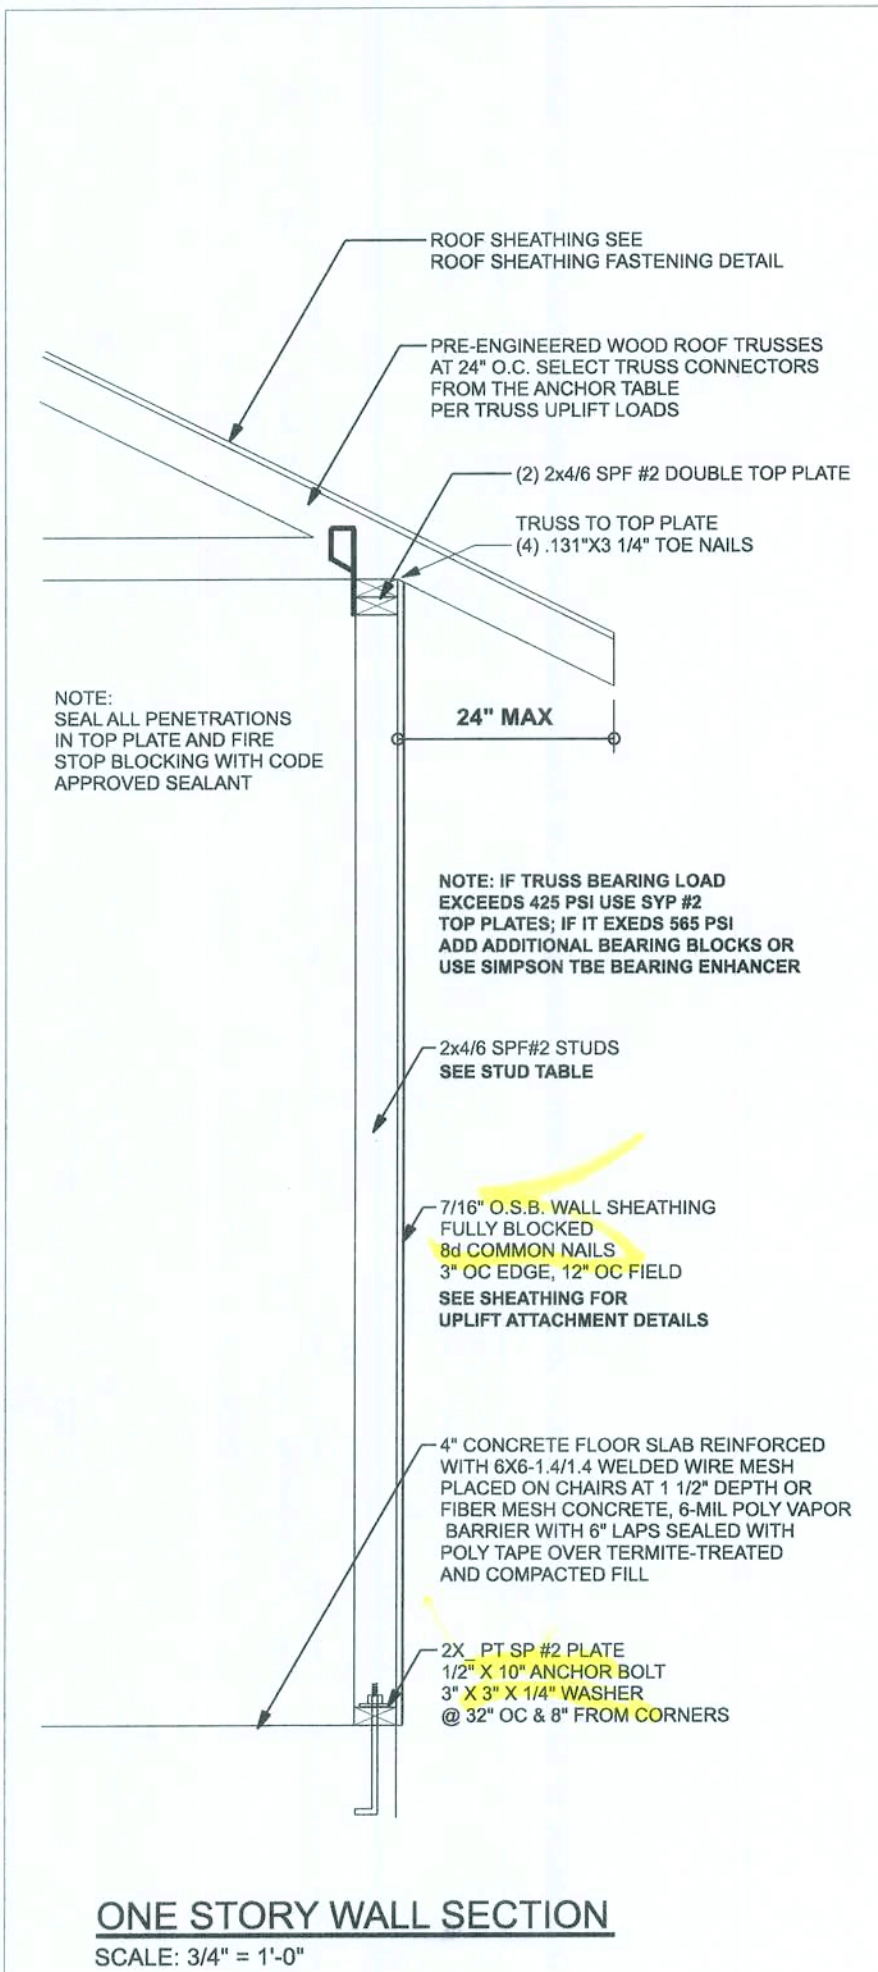

ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"

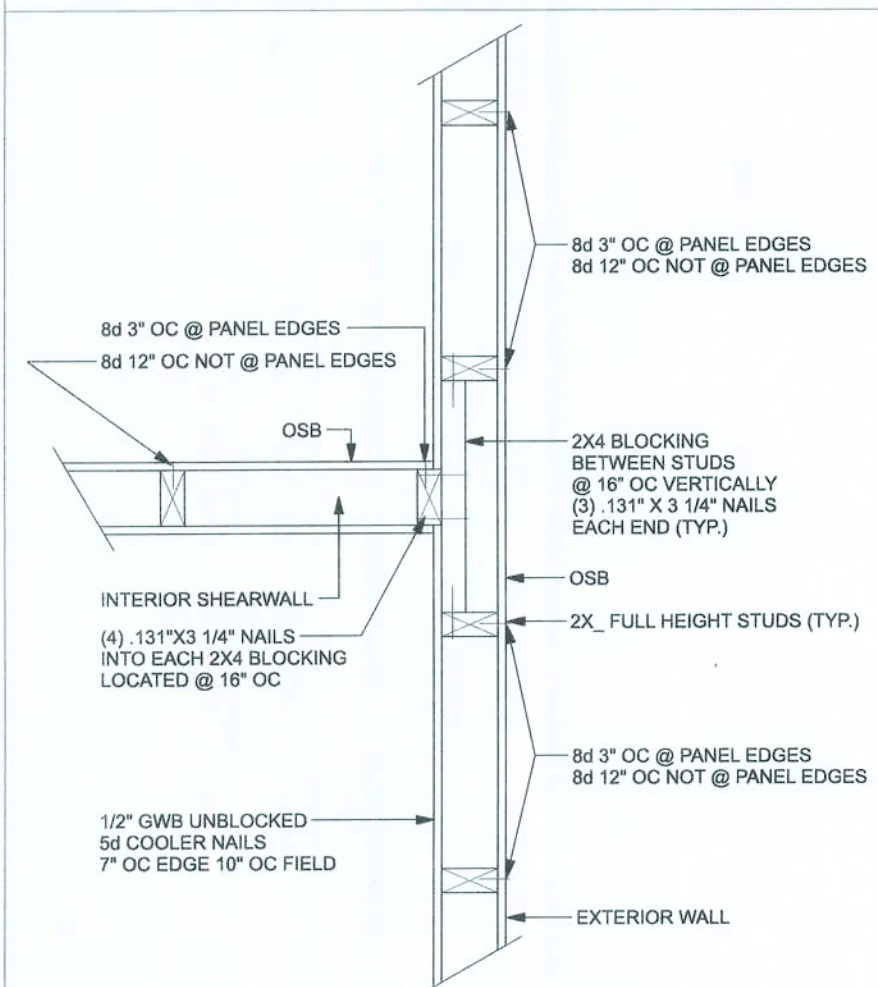


(TYP.) INTERSECTING WALL FRAMING
WOOD FRAME

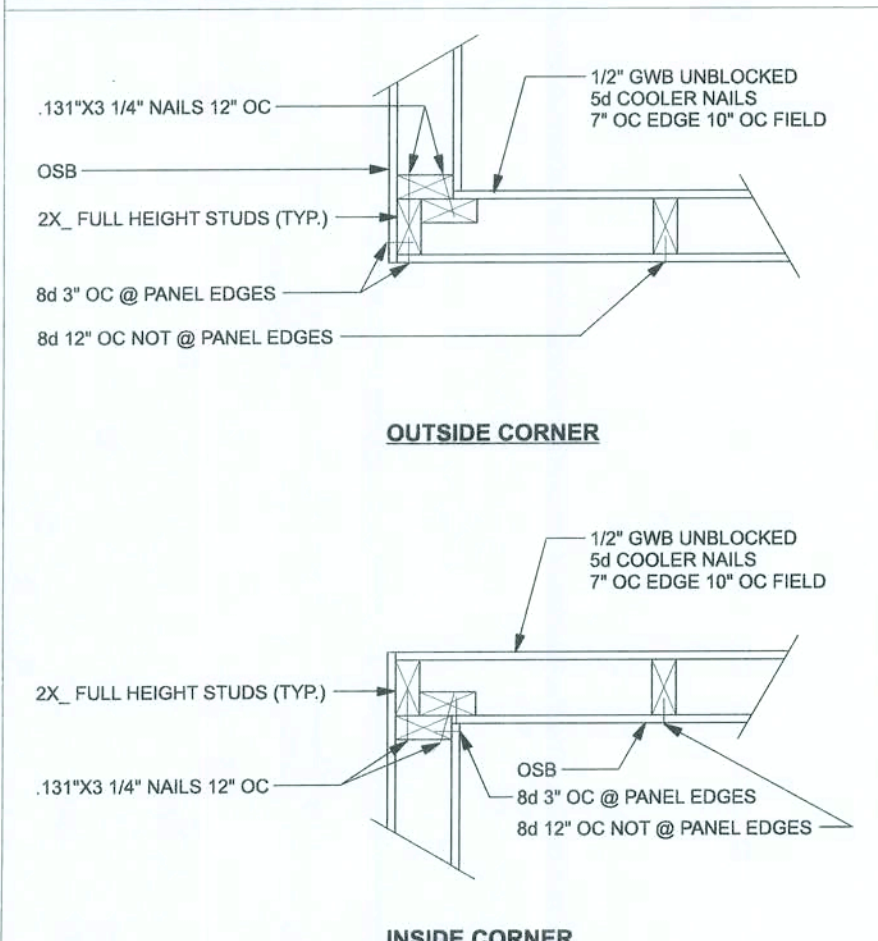

(TYP.) CORNER FRAMING
WOOD FRAME


| ROOF SHEATHING FASTENING TABLE (RAFTER / U.S.S. SG = 0.49) | | | | |
|--|------------------------------------|--|--------------------------------|---|
| Wind Speed | Sheathing Thickness Plywood Or OSB | Required Nail | Nail spacing along panel edges | Nail spacing along intermediate supports in the panel field |
| 120 mph Exp. B | 7/16" | ASTM F1667 RSRS-01 (2 3/8" x 0.131") | 6" oc | 12" oc |
| 120 mph Exp. C | 7/16" | ASTM F1667 RSRS-01 (2 3/8" x 0.131") | 6" oc | 3" oc |
| 120 mph Exp. D | 19/32" | ASTM F1667 RSRS-03 (2 1/2" x 0.131") or ASTM F1667 RSRS-04 (3" x 0.120") | 6" oc | 3" oc |
| 130 mph Exp. B | 7/16" | ASTM F1667 RSRS-01 (2 3/8" x 0.131") | 6" oc | 3" oc |
| 130 mph Exp. C | 15/32" | ASTM F1667 RSRS-01 (2 3/8" x 0.131") or ASTM F1667 RSRS-04 (3" x 0.120") | 6" oc | 3" oc |
| 130 mph Exp. D | 19/32" | ASTM F1667 RSRS-03 (2 1/2" x 0.131") or ASTM F1667 RSRS-04 (3" x 0.120") | 6" oc | 3" oc |
| 140 mph Exp. B | 7/16" | ASTM F1667 RSRS-01 (2 3/8" x 0.131") | 6" oc | 3" oc |
| 140 mph Exp. C | 19/32" | ASTM F1667 RSRS-03 (2 1/2" x 0.131") or ASTM F1667 RSRS-04 (3" x 0.120") | 6" oc | 3" oc |
| 140 mph Exp. D | 19/32" | ASTM F1667 RSRS-03 (2 1/2" x 0.131") or ASTM F1667 RSRS-04 (3" x 0.120") | 6" oc | 3" oc |
| 150 mph Exp. C | 19/32" | ASTM F1667 RSRS-03 (2 1/2" x 0.131") or ASTM F1667 RSRS-04 (3" x 0.120") | 6" oc | 3" oc |

Note: For sheathing located a minimum of 4 feet from perimeter edge of the roof, including 4 feet on each side of ridges and ts, nail spacing is permitted to be 6 inches on center along panel edges 6 inches on center along intermediate supports in the panel field.
Note: This table specifies the code minimum thickness roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

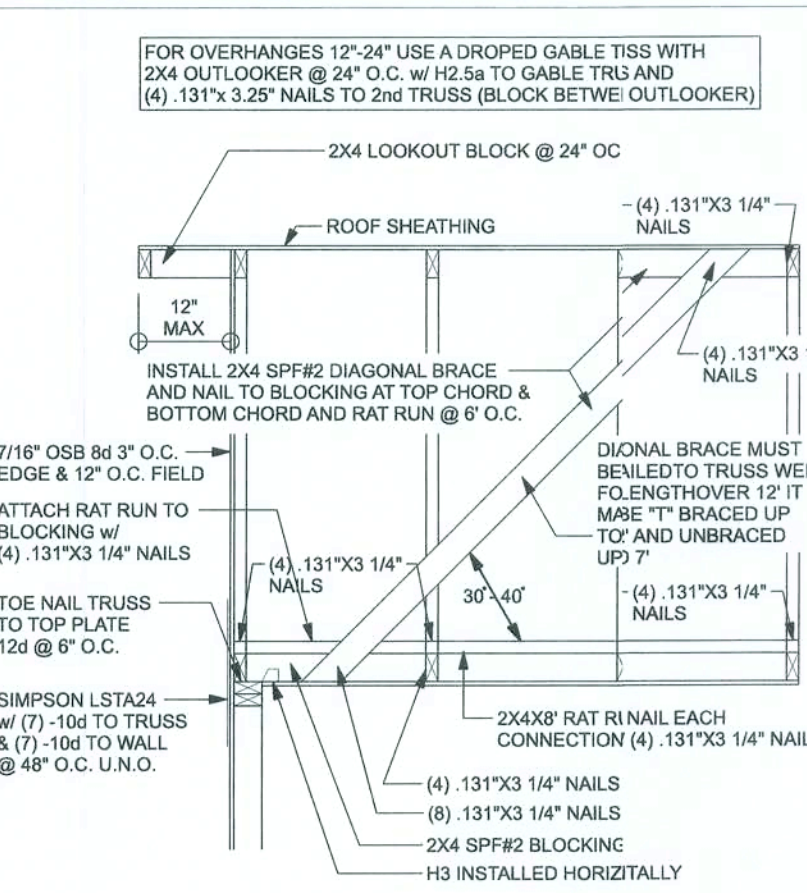


SPACE RAT RUN & DIAGONAL BRACE 6'-0" O.C.
FOR GABLE HEIGHT UP TO 25'-0" 130 MPH, EXP. C, ICLOSED


(TYP.) GABLE BRACING DETAIL
WOOD FRAME

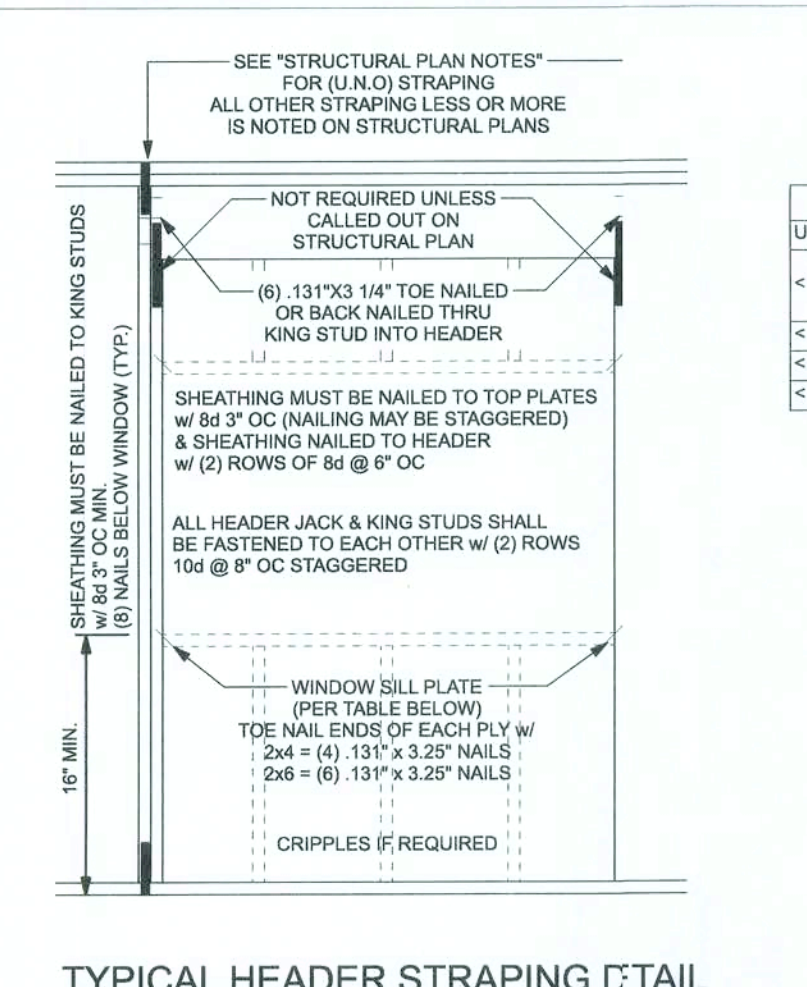


TYPICAL HEADER STRAPPING DETAIL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

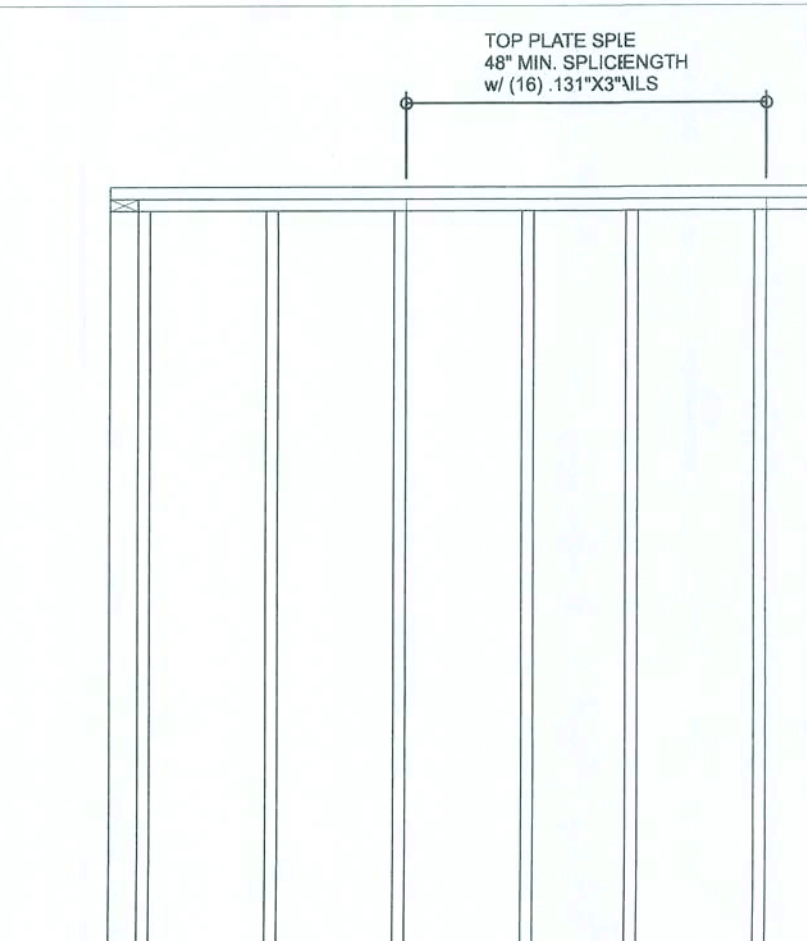

(TYP.) WALL CONNECTIONS
ONE STORY WOOD FRAME

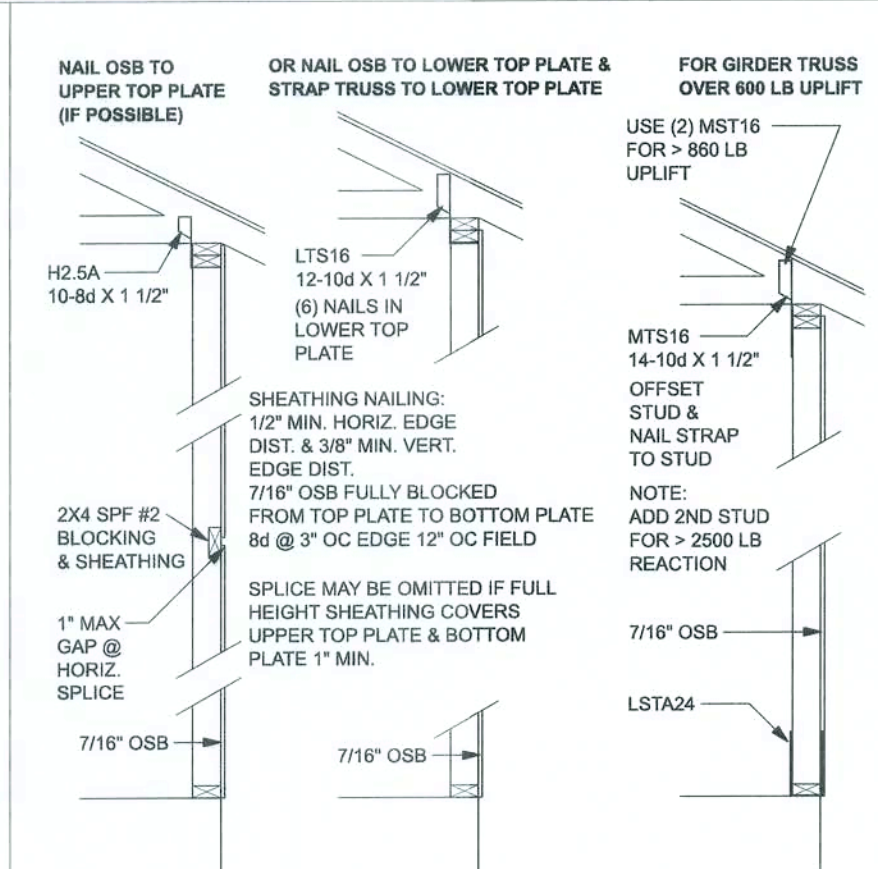

SHEATHING FOR UPLIFT ATTACHMENT DETAILS
ONE STORY WOOD FRAME

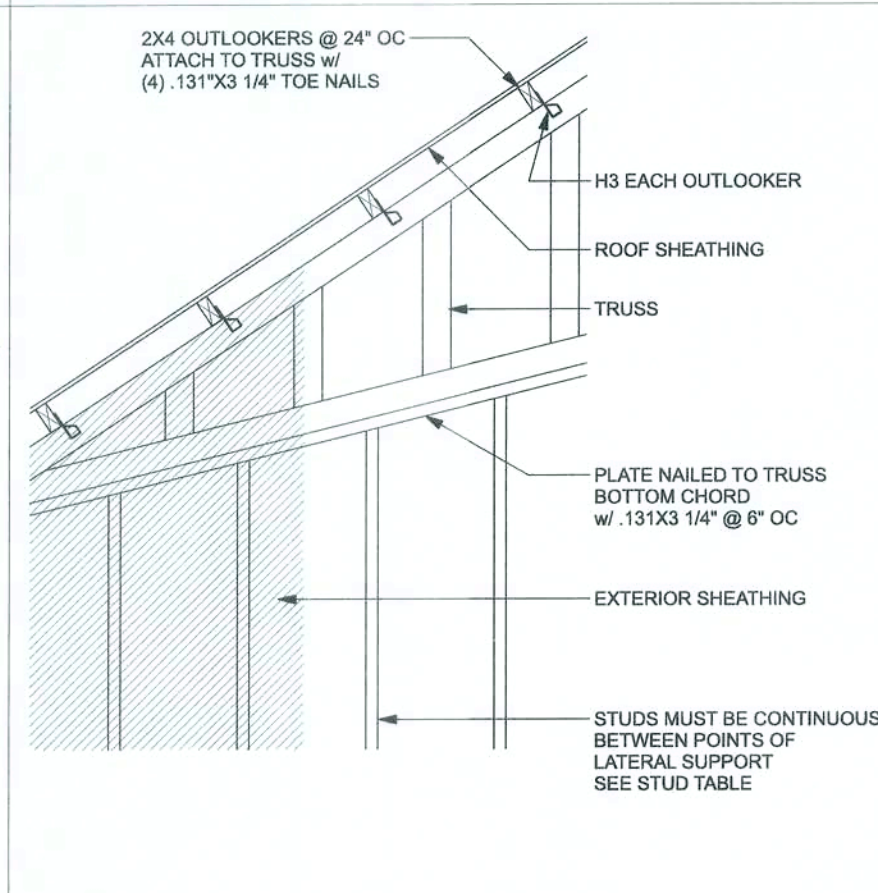


(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

| HEADER STRAP TABLE | | | | |
|--------------------|------------------------------------|---------------------------------|---|-------------------|
| Uplift | Top Connection | Bottom Connection | Bottom Connection | Bottom Connection |
| < 1235 | LSTA24, 14-10d wrap under plate | LSTA24, 14-10d wrap under plate | 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer | 18-16d TO FACE |
| < 1455 | MSTA24, 18-10d header to jacks | DTT22 | 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer | 18-10d TO JOIST |
| < 1800 | (2) MSTA24, 18-10d header to jacks | DTT22 | 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer | 3" NOTCH |
| < 2810 | (2) MSTA24, 18-10d header to jacks | HTT4 | 1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer | 3" NOTCH |


HEADER STRAP TABLE

| SILL PLATE SPANS FOR 10'-0" WALL HEIGHT | | | | |
|---|-----------------------|-----------------------|-----------------------|-----------------------|
| DESIGN WIND SPEED | MAX. SPANS FOR SPF #2 | MAX. SPANS FOR SPF #2 | MAX. SPANS FOR SPF #2 | MAX. SPANS FOR SPF #2 |
| 130 MPH EXP. C | (1) 2x4 | (2) 2x4 | (1) 2x6 | (2) 2x6 |
| 130 MPH EXP. C | 5'-2" | 7'-6" | 7'-7" | 11'-3" |


SILL PLATE SPANS FOR 10'-0" WALL HEIGHT

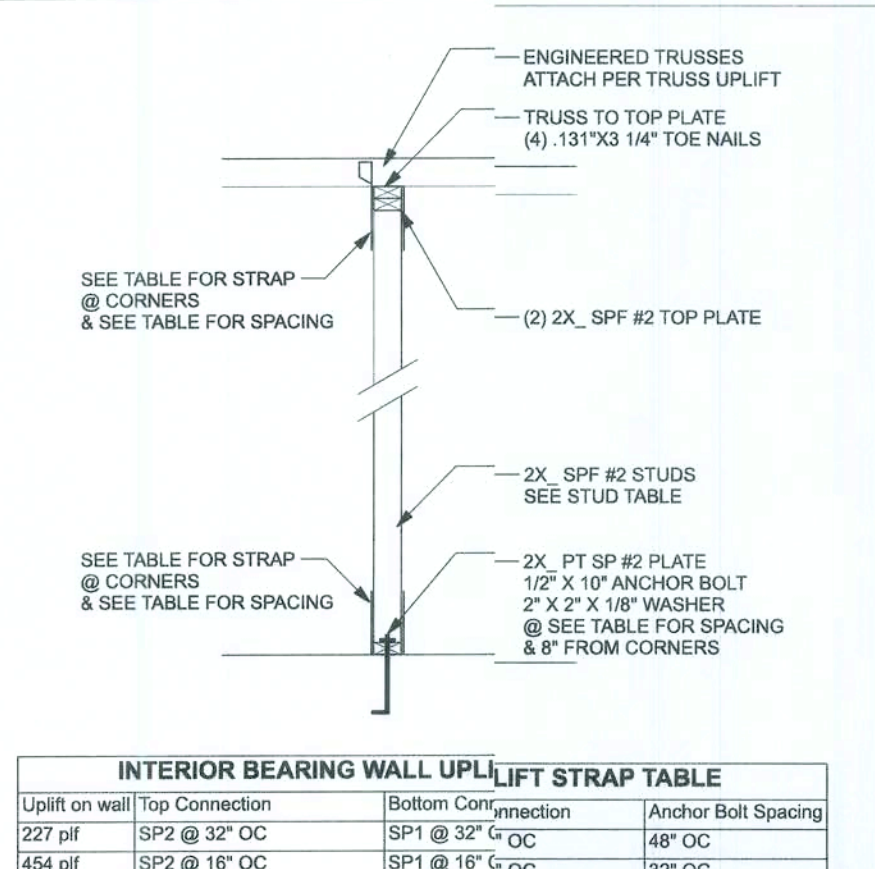


INTERIOR BEARING WALL UPLIFT STRAP TABLE

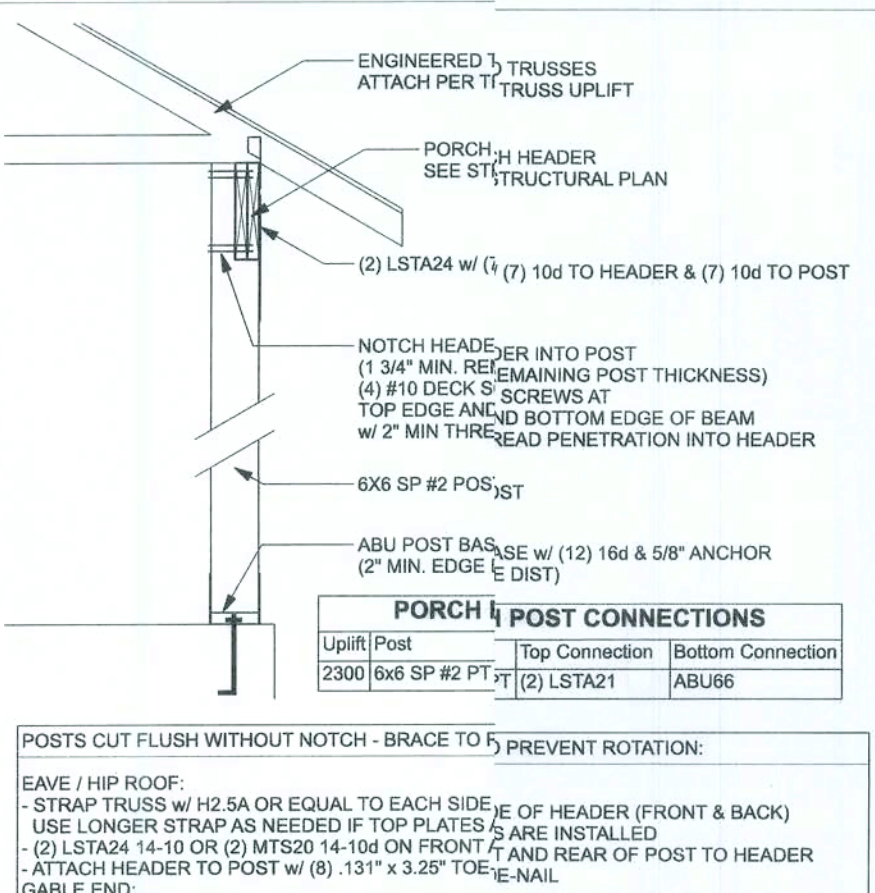

(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

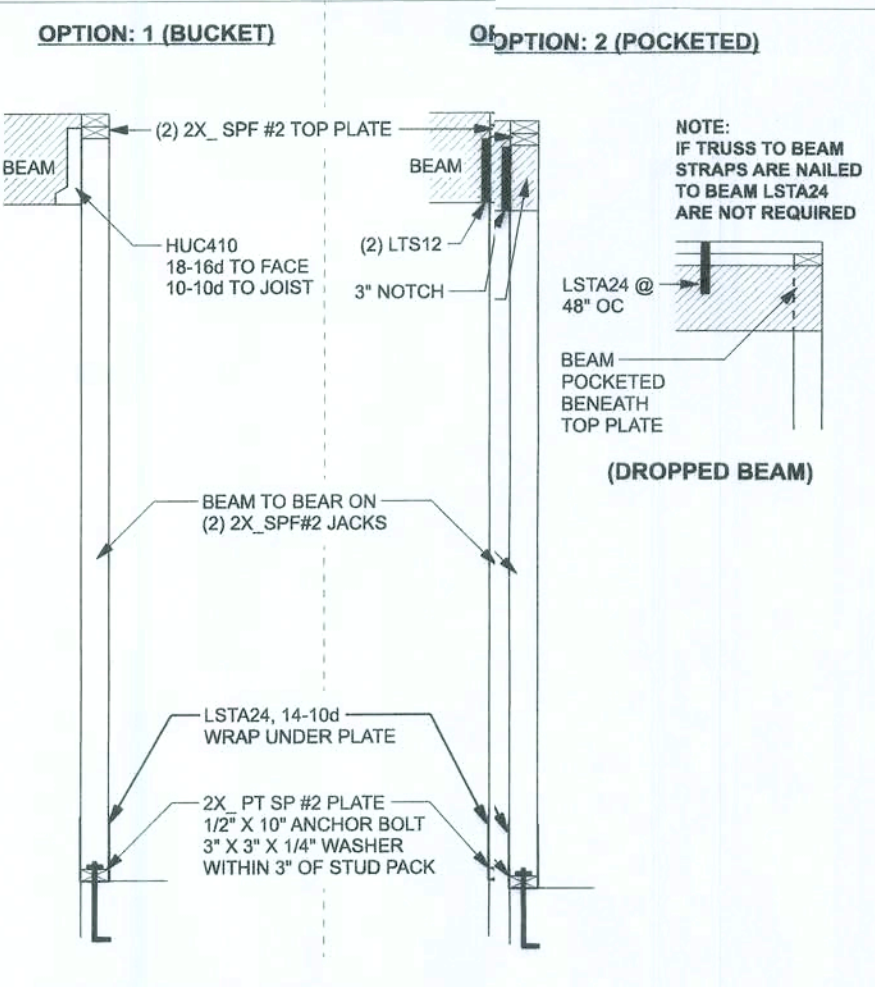

(TYP.) PORCH POST
ONE STORY WOOD

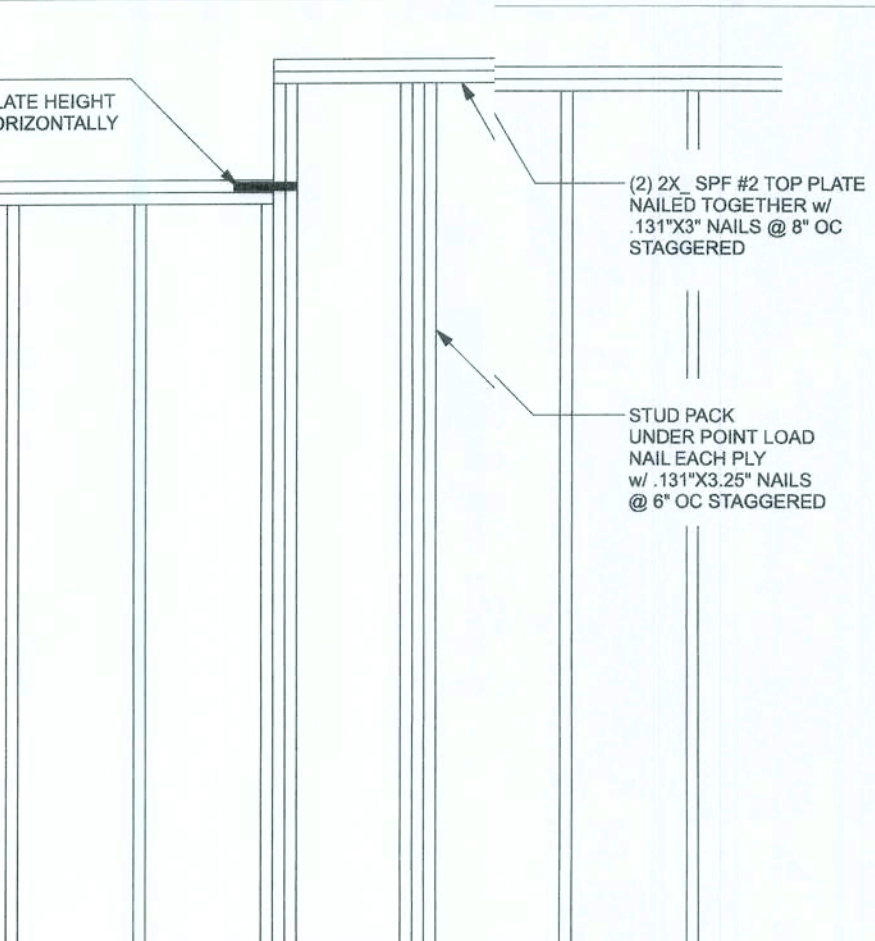

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

| CONNECTOR TABLE | | | | |
|-----------------|-----------|----------------------|------------------------|--------------------------|
| Uplift SP | Uplift SP | Truss Connector | To Plate | To Truss/Rafter |
| 615 | 485 | SDWC15600 | 4-8d x 1 1/2" | 4-8d x 1 1/2" |
| 415 | 290 | H3 | 5-8d x 1 1/2" | 5-8d x 1 1/2" |
| 575 | 485 | H2&A | 9-10d x 1 1/2" | 9-10d x 1 1/2" |
| 1300 | 1015 | H10A | 9-10d x 1 1/2" | 9-10d x 1 1/2" |
| 720 | 820 | LTS12-30 | 6-10d x 1 1/2" | 6-10d x 1 1/2" |
| 1000 | 860 | MTS12-20 | 7-10d x 1 1/2" | 7-10d x 1 1/2" |
| 1450 | 1245 | HTS20-30 | 12-10d x 1 1/2" | 12-10d x 1 1/2" |
| Uplift SP | Uplift SP | Strap Ties | To One Member | To Other Member |
| 1235 | 1235 | LSTA21 | 8-10d | 8-10d |
| 1640 | 1455 | MSTA24 | 9-10d | 9-10d |
| 1030 | 1030 | CS20 | 7-10d | 7-10d |
| Uplift SP | Uplift SP | Strap Plate Ties | To Stud | To Plate |
| 585 | 535 | SP1 | 6-10d | 4-10d |
| 1065 | 805 | SP2 | 6-10d | 6-10d |
| 771 | 771 | LSTA24 | 10-10d | wrap under or over plate |
| 1235 | 1235 | LSTA24 | 14-10d | wrap under or over plate |
| Uplift SP | Uplift SP | Holdowns @ Stairwell | To Stud / Post | Anchor |
| 1625 | 1600 | DTT22 | 8-SDS 1/4"x1 1/2" | 1/2"x12" Titan HD |
| 4235 | 3640 | HTT4 | 18-16d x 12" | 1/2"x12" Titan HD |
| Uplift SP | Uplift SP | Holdowns @ Mono | To Stud / Post | Anchor |
| 1825 | 1800 | DTT22 | 8-SDS 1/4"x1 1/2" | 1/2"x8" Titan HD |
| 2200 | ABU44 | ABU44 | 5/8"x12" Drill & Epoxy | 5/8"x12" Drill & Epoxy |
| 2300 | ABU66 | ABU66 | 5/8"x12" Drill & Epoxy | 5/8"x12" Drill & Epoxy |
| Uplift SP | Uplift SP | Strap Bases @ Mono | To Post | Anchor |
| 2200 | ABU44 | ABU44 | 5/8"x12" Drill & Epoxy | 5/8"x12" Drill & Epoxy |
| 2300 | ABU66 | ABU66 | 5/8"x12" Drill & Epoxy | 5/8"x12" Drill & Epoxy |

CONNECTOR TABLE

EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS:
THIS STUD HEIGHT TABLE IS PER 2012 WFCM, TABLE 3.20B5, EXTERIOR LOAD BEARING & NON LOAD BEARING STUD LENGTHS FOR WALLS WITH OSB EXTERIOR AND 1/2" GYP INTERIOR RESISTING INTERIOR ZONE WINDLOADS, 130 MPH, EXPOSURE C, STUD DEFLECTION LIMIT H/240 (NOT OK FOR BRITTLE FINISH). STUD SPACINGS SHALL BE MULTIPLIED BY 0.8 FOR FRAMING LOCATED WITHIN 4 FEET OF CORNERS FOR END ZONE LOADING. (END ZONE EXAMPLE 16" O.C. x 0.8 = 12.8" O.C.)

| (1) 2x4 @ 16" OC | (2) 2x4 @ 12" OC | (3) 2x4 @ 12" OC | (4) 2x4 @ 12" OC |
|-----------------------|-----------------------|-----------------------|-----------------------|
| TO 10'-1" STUD HEIGHT | TO 11'-2" STUD HEIGHT | TO 11'-2" STUD HEIGHT | TO 17'-3" STUD HEIGHT |

| GRADE & SPECIES TABLE | Fb | E |
|-----------------------|--------------|----------|
| 2x8 | SP #2 | 925 1.4 |
| 2x10 | SP #2 | 800 1.4 |
| 2x12 | SP #2 | 750 1.4 |
| GLB | 24F-V3 SP | 2600 1.9 |
| LSL | TIMBERSTRAND | 1700 1.7 |
| LVL | MICROLAM | 2950 2.0 |
| PSL | PARALAM | 2900 2.0 |

GRADE & SPECIES TABLE



2x6 SP #2 GARAGE DOOR BUCK ATTACHMENT

| DOOR WIDTH | 3/8"x4" LAG | 16d STAGGER | (2) ROWS OF 131"x3 1/4" NAILS |
|------------|-------------|-------------|-------------------------------|
| 8'-10" | 24" OC | 5" OC | 5" OC |
| 11'-15" | 18" OC | 4" OC | 4" OC |
| 16'-18" | 16" OC | 3" OC | 3" OC |

(TYP.) GARAGE DOOR BUCK INSTALLATION
WOOD FRAME

GENERAL NOTES:
TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR GRAVITY LOAD REQUIREMENTS (ASSUME 1500 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOIL TEST PROVIDES OTHERWISE).
FOUNDATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN. FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1500 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOIL TEST PROVIDES OTHERWISE).
CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, Fc = 2500 PSI.
WELDED WIRE REINFORCED SLAB: 6" x 6" W1 x 4" W1 x 4" FB = 85KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.M.) CONFORMING TO ASTM A186, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.
FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT FIBER LENGTH 1 1/2 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.
CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 12FT. DO NOT CUT WMM OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A LINE.)
REBAR: ASTM A 615, GRADE 40, DEFORMED BARS, FY = 40 KSI, ALL LAP SPACES 40" DB (20" FOR BARS), UNO. ALL REINFORCEMENT SHALL BE DETAIL AND PLACED IN ACCORDANCE WITH ACI 315-86, U.N.O.
ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS; SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.
STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.
ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CMU.
BUILDER'S RESPONSIBILITY:
THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.
CONFIRM SITE CONDITIONS: FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE.
PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCR REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.
PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMTS A LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.
VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.
ROOF SYSTEM DESIGN:
THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR, IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBCR REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

| DESIGN CRITERIA & LOADS: | |
|--|--|
| BUILDING CODE | 7TH EDITION FLORIDA BUILDING CODE RESIDENTIAL (2003) |
| CODE FOR DESIGN LOADS | ASCE 7-16 |
| WINDLOADS | |
| BASIC WIND SPEED (ASCE 7-16, 3S GUST) | 120 MPH |
| WIND EXPOSURE (BUILDER MUST FIELD VERIFY) | C |
| TOPOGRAPHIC FACTOR (BUILDER MUST FIELD VERIFY) | 1 |
| RISK CATEGORY | II |
| ENCLOSURE CLASSIFICATION | ENCLOSED |
| INTERNAL PRESSURE COEFFICIENT | 0.18 |
| ROOF ANGLE | 7.45 DEGREES |
| MEAN ROOF HEIGHT | 30 FT |
| C&C DESIGN PRESSURES | |
| SEE TABLE | |
| FLOOR LOADING | |
| ROOMS OTHER THAN SLEEPING ROOM | 40 PSF LIVE LOAD |
| SLEEPING ROOMS | 30 PSF LIVE LOAD |
| ROOF LOADING | |
| FLAT OR < 4:12 | 20 PSF LIVE LOAD |
| 4:12 TO < 12:12 | 16 PSF LIVE LOAD |
| 12:12 & GREATER | 12 PSF LIVE LOAD |
| SOIL BEARING CAPACITY | |
| 1500 PSF | |
| FLOOD ZONE | |
| THIS BUILDING IS NOT IN THE FLOOD ZONE | |

| COMPONENT & CLADDING DESIGN PRESSURES 130 MPH (EXP C) | |
|---|-------------------------|
| EFFECTIVE WIND AREA (FT ²) | ZONE 4 INTERIOR |
| 0 - 20 | +25.6(Vasd) -27.8(Vasd) |
| 0 - 20 | +42.6(Vult) -46.2(Vult) |

| GARAGE DOOR DESIGN PRESSURES 130 MPH (EXP C) | |
|--|-------------------------|
| 8x7 GARAGE DOOR | +22.8(Vasd) -25.5(Vasd) |
| 16x7 GARAGE DOOR | +21.7(Vasd) -24.1(Vasd) |

G-N Construction

Spec House - Lot 32 Fort White Park

PROJECT ADDRESS:
Lot 32 Fort White Park
Fort White, FL

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, IE, for resolution. Do not proceed without clarification.

COPYRIGHTS / AID PROPERTY RIGHTS:
Mark Disosway, IE, hereby expressly reserves its common law copyright and property right in these instrumented services. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 55615

Friday, February 12, 2021


Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
385.754.5419
disoswayesign@gmail.com

JOBNUMBER:
210183

S-1
OF 5 SHEETS

LUMBER SIZE & GRADE MINIMUM REQUIREMENTS

| | |
|-------------------------------|--|
| ROOF BOARD | 2X6 SYP #2 |
| RAFTER SPANS 24" P.C. OR LESS | 2X4 SYP #2 |
| PURLIN (LATERAL BRACING) | 2X4 SYP #2 |
| SLEEPERS | 2X (WIDTH OF RAFTER SEAT CUT) SYP #3 OR 2X PARALLEL 2X4 SYP #3 |
| CRIPPLES & BLOCKING | 2X4 SYP #2 OR BETTER |
| TRUSS BELOW | SEE TRUSS DESIGN - SOUTHERN PINE MATERIAL |

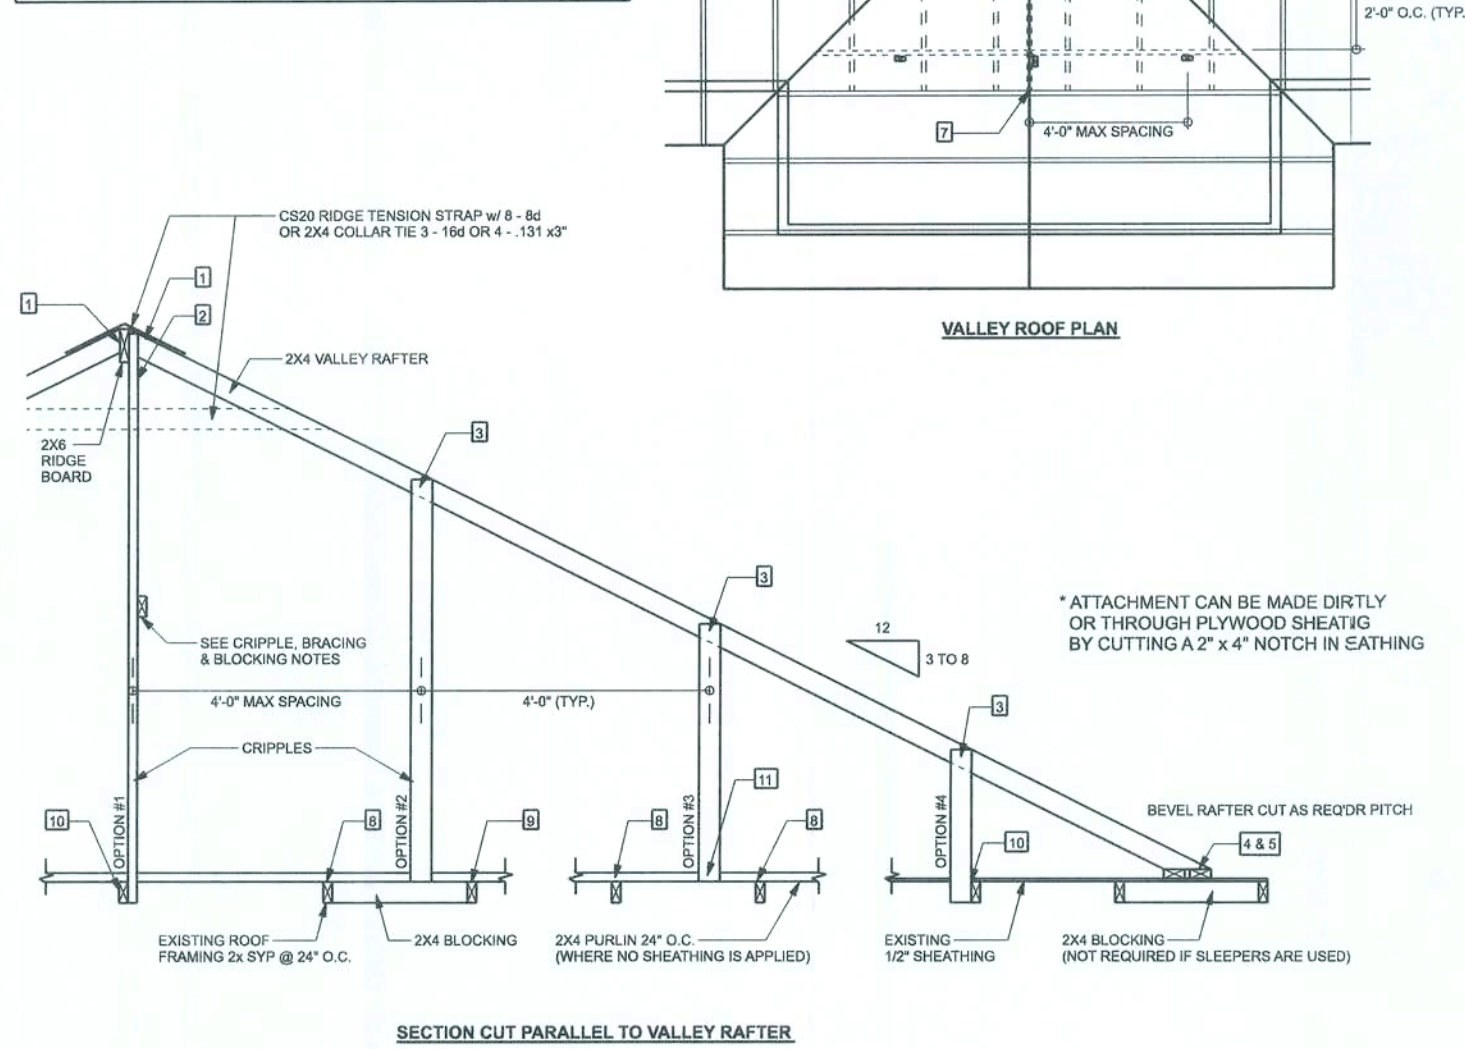

ROOF OVER FRAMING & BRACING DETAIL
SCALE: N.T.S.

VALLEY ROOF PLAN MEMBER LEGEND

| | |
|---|----------------------------|
| — | TRUSS |
| — | TRUSS UNDER VALLEY FRAMING |
| — | VALLEY RAFTER OR RIDGE |
| — | CRIPPLE |

CRIPPLES: 4" O.C. FOR 20 psf (TL) AND 10 psf (TD) (TYP. SHINGLE ROOF) MAX.


| | | |
|----|--|---|
| 1 | 2X4 RAFTERS TO RIDGE | 3-16d OR 6-131 x 3" TOE NAILS |
| 2 | CRIPPLE TO RIDGE | 3-16d OR 6-131 x 3" FACE NAILS |
| 3 | CRIPPLE TO RAFTERS | 3-16d OR 6-131 x 3" FACE NAILS |
| 4 | RAFTER TO SLEEPER OR BLOCKING | 6-16d OR 12-131 x 3" TOE NAILS |
| 5 | SLEEPER TO TRUSS | 4-16d OR 6-131 x 3" FACE NAILS EACH TRUSS |
| 6 | RIDGE BOARD TO ROOF BLOCK | 3-16d OR 6-131 x 3" TOE NAILS |
| 7 | RIDGE BOARD TO TRUSS | 3-16d OR 6-131 x 3" TOE NAILS |
| 8 | PURLIN TO TRUSS (TYP) | 3-16d OR 6-131 x 3" NAILS |
| 9 | PURLIN TO TRUSS IF CRIPPLE IS ATTACHED TO PURLIN | 4-16d OR 6-131 x 3" NAILS |
| 10 | TRUSS TO BLOCKING | 3-16d OR 6-131 x 3" TOE NAILS |
| 11 | CRIPPLE TO TRUSS | 3-16d OR 6-131 x 3" FACE NAILS |

GENERAL NOTES

MAXIMUM RAFTER SPANS:
6' 0" FOR 2X4, 8' 0" FOR 2X6 SYP #2 OR SYP #2.
MAXIMUM ROOF AREA PER SUPPORT: (EXAMPLE: 4" O.C. 2X4 @ 8' SPAN)
HERE R: CROWN 2 X 3, AND R: CROWN 2 X 3.
HERE ON 2" X 6" X 6" SPAN + 16d.
PURLIN REQUIRED 2" O.C. IF EXISTING SHEATHING IS REMOVED.
PURLIN SHOULD OVERLAP SHEATHING ONE TRUSS SPACING MINIMUM.
IN CASES THAT THIS IS IMPRACTICAL, OVERLAP SHEATHING MINIMUM OF 6" AND NAIL UPWARDS THROUGH SHEATHING INTO PURLIN WITH A MINIMUM OF 1-16d COMMON WIRE NAILS.
THIS DRAWING APPLIES TO VALLEYS WITH THE FOLLOWING CONDITIONS:
- SPAN DISTANCES BETWEEN LESS THAN 10' OR LESS
- MAXIMUM WIND SPEED 130 MPH
- MAXIMUM MEAN ROOF HEIGHT 30 FEET
- MAXIMUM TOTAL LOADING 40 psf
- MEETS FBC (ASCE 7-16) WIND REQUIREMENTS
- EXPOSURE CATEGORY "C" (1 = 1.5, 2 = 1.0, 3 = 1.0)
- ENCLOSED BUILDING

CRIPPLE, BRACING, & BLOCKING NOTES

2X4 CONTINUOUS LATERAL BRACE (CLB) MIN. IS REQUIRED FOR CRIPPLES 8' 0" TO 10' 0" LONG MAILED W/ 2-16d NAILS @ 24" TYP. OR CLB BRACE MAILED TO PLATE EDGE OF CRIPPLE WITH 8d NAILS @ 8" O.C. 1" OR SCAB MUST BE 80% OF CRIPPLE LENGTH. CRIPPLES OVER 10' LONG REQUIRE TWO CLBs ON BOTH SIDES W/ 1" OR SCAB. USE STEEL BRACKET LUMBER BLOCK OR COMMON NAIL. NARROW EDGE OF CRIPPLE CAN FACE RIDGE OR RAFTER. AS LONG AS THE PROPER NUMBER OF NAILS ARE INSTALLED INTO RIDGE BOARD. INSTALL BLOCKING UNDER RAFTER IF SLEEPERS ARE NOT USED. LOWER TRUSS TOP CHORDS AND LATERAL BRACING IS NOT USED. APPLY ALL NAILING IN ACCORDANCE TO NDS-197 SECTION 12. NAILS ARE COMMON WIRE NAILS UNLESS NOTED OTHERWISE.

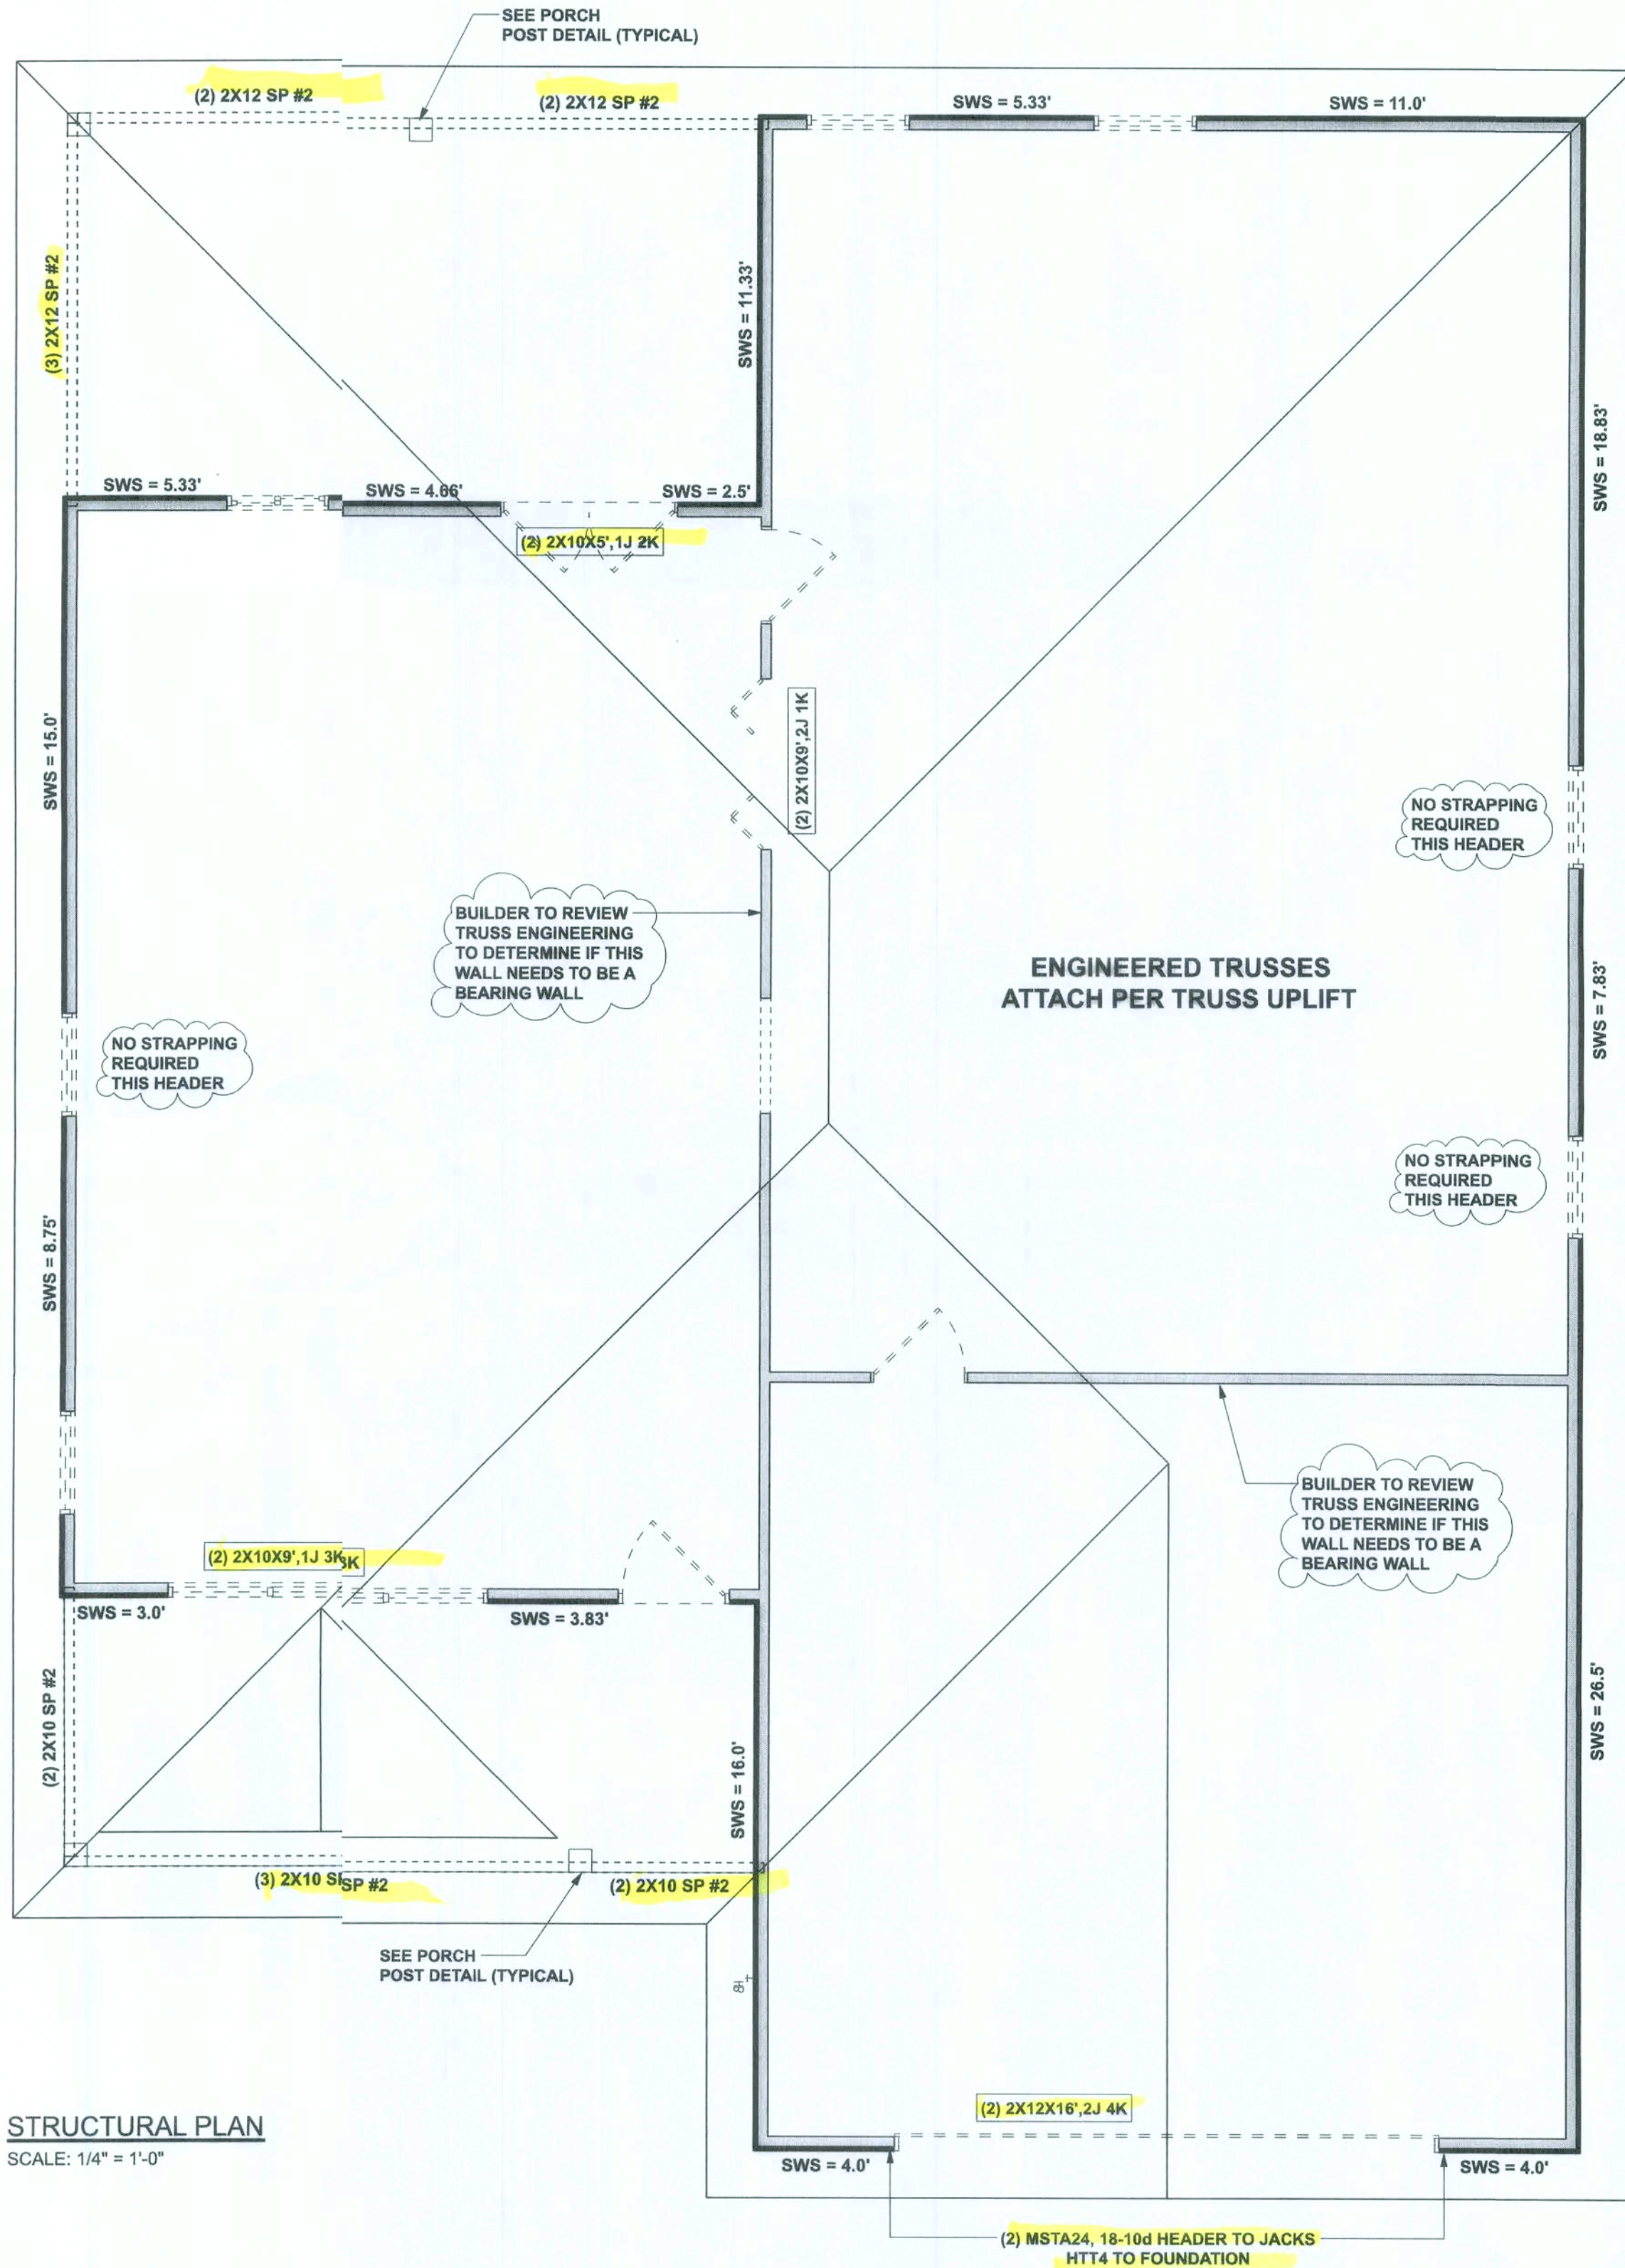

STRUCTURAL PLAN
SCALE: 1/4" = 1'-0"

STRUCTURAL PLAN NOTES

- SN-1 ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X10 SP #2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 ALL HEADERS w/ UPLIFT TO BE STRAPPED DOWN @ EACH SIDE WITH (1) LSTA24, 14-10d @ TOP & BOTTOM OF WALL. WRAP UNDER BOTTOM PLATE & OVER TOP PLATE 1/2" X 10" ANCHOR BOLT w/ 3" X 3" X 1/4" WASHER MUST BE LOCATED WITHIN 6" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.)
- SN-4 USE ONE JACK STUD GIRDER SUPPORT PER 2500 LB LOAD
- SN-5 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-6 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCS11-03, BCS1-B1, BCS1-B2, & BCS1-B3. BCS1-B1, BCS1-B2, & BCS1-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

HEADER LEGEND

| | |
|--------------------|-------------------------------------|
| (2) 2X10X0', 1J 1K | HEADER/BEAM CALL-OUT (U.N.O.) |
| ↑ | NUMBER OF KING STUDS (FULL LENGTH) |
| ↑ | NUMBER OF JACK STUDS (UNDER HEADER) |
| ↑ | SPAN OF HEADER |
| ↑ | SIZE OF HEADER MATERIAL |
| ↑ | NUMBER OF PLIES IN HEADER |

ACTUAL vs REQUIRED SHEARWALL

| | TRANSVERSE | LONGITUDINAL |
|----------|------------|--------------|
| ACTUAL | 17460 LBF | 25017 LBF |
| REQUIRED | 12962 LBF | 8693 LBF |

G-N Construction

Spec House - Lot 32 Fort White Park

PROJECT ADDRESS:
Lot 32 Fort White Park
Fort White, FL

DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyright and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and test the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOWAY P.E. 53915



Friday, February 12, 2021

Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.755.5419
disowaydesign@gmail.com

JOB NUMBER:
210183

S-3
OF 5 SHEETS