
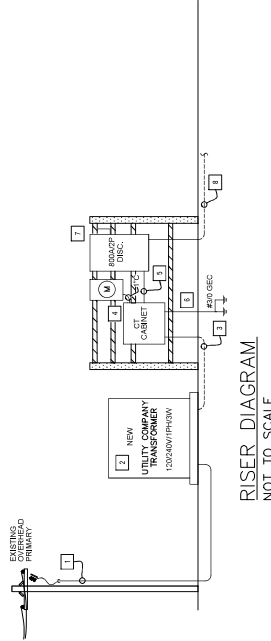
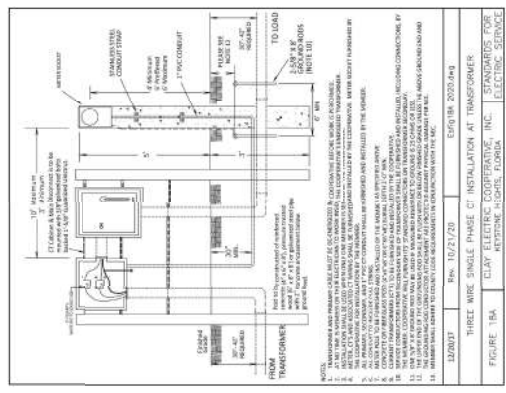


1. CONTRACTOR SHALL VERIFY EXISTING JOB SITE CONDITIONS DURING THE BIDDING PERIOD TO OBTAIN THE SCOPE OF ELECTRICAL WORK INVOLVED AS A RESULT OF ARCHITECTURAL MODIFICATIONS TO THE EXISTING STRUCTURE. THE SCOPE OF WORK SHALL INCLUDE MATERIALS AND OUTLETS CONSISTING OF FIXTURES, DEVICES, EQUIPMENT OR APPARATUS WHICH ARE TO BE INSTALLED, RELOCATED, OR REMOVED EITHER TEMPORARILY OR PERMANENTLY, OR WHICH MUST BE PROVIDED SO THAT THE INDICATED REMODELING MAY BE ACCOMPLISHED.

- [illegible]

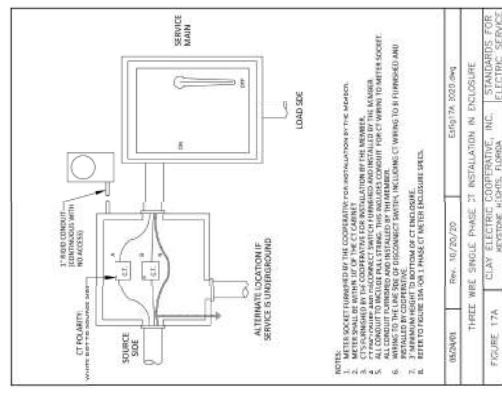

## RISE NOTES

1. PROVIDE 2 CONDUIT WITH PULL STRING FOR PRIMARY CONDUCTORS, COORDINATE WITH LOCAL UTILITY FOR EXACT INSTALLATION REQUIREMENTS AND MATERIAL APPROVAL.
2. DIG UNDISTURBED UTILITY TRANSDUCER (TODAY/ISOW) PROVIDED BY UTILITY COMPANY. COORDINATE WITH LOCAL UTILITY COMPANY FOR EXACT LOCATION.
3. 800A SERVICE LATERAL PROVIDE (2) SETS OF 3/4" 6000CM CU IN 3" CONDUIT.
4. NEW 24"x24" CT CABINET AND METER, COORDINATE WITH LOCAL UTILITY, GROUND PER LOCAL REQUIREMENTS.
5. 800A FEEDER, PROVIDE (2) SETS OF 3/4" 6000CM x 800 SEC IN 3" CONDUIT.
6. PROVIDE 800A GFCI, PROVIDE (2) SETS OF 3/4" 6000CM x 800 SEC IN 3" CONDUIT.
7. PROVIDE 800A 3P, NEARBY CONDUIT 3P X 1/2" COPPER GROUND RODS REFER TO GROUNDING DETAIL ON THIS SHEET FOR MORE DETAILS.
8. PROVIDE 800A 3P, NEARBY CONDUIT PROVIDE 800A TIME DELAY, 40A ELEMENT FUSES, BOND NEUTRAL AND GROUND IN DISCONNECT.
9. COORDINATE WITH LOCAL UTILITY OWNERS, NEW CONDUIT SHALL BE INSTALLED UNDER SEPARATE PERMIT. COORDINATE EXACT LOCATION WITH OWNERS PRIOR TO POUGH.

[illegible][illegible]

|                       |                         |     |
|-----------------------|-------------------------|-----|
| SHEET #               | DRAWN BY:               | XXX |
| ELECTRICAL RISER      | CHECKED BY:             | XXX |
| PROJECT TITLE         | BOX #                   | XXX |
| ROMERO FARM           | DATE                    |     |
| 1617 PINE AVE. S.W.   | ISSUED FOR CONSTRUCTION |     |
| ALBUQUERQUE, NM 87104 | PERMISSION NO.          |     |