

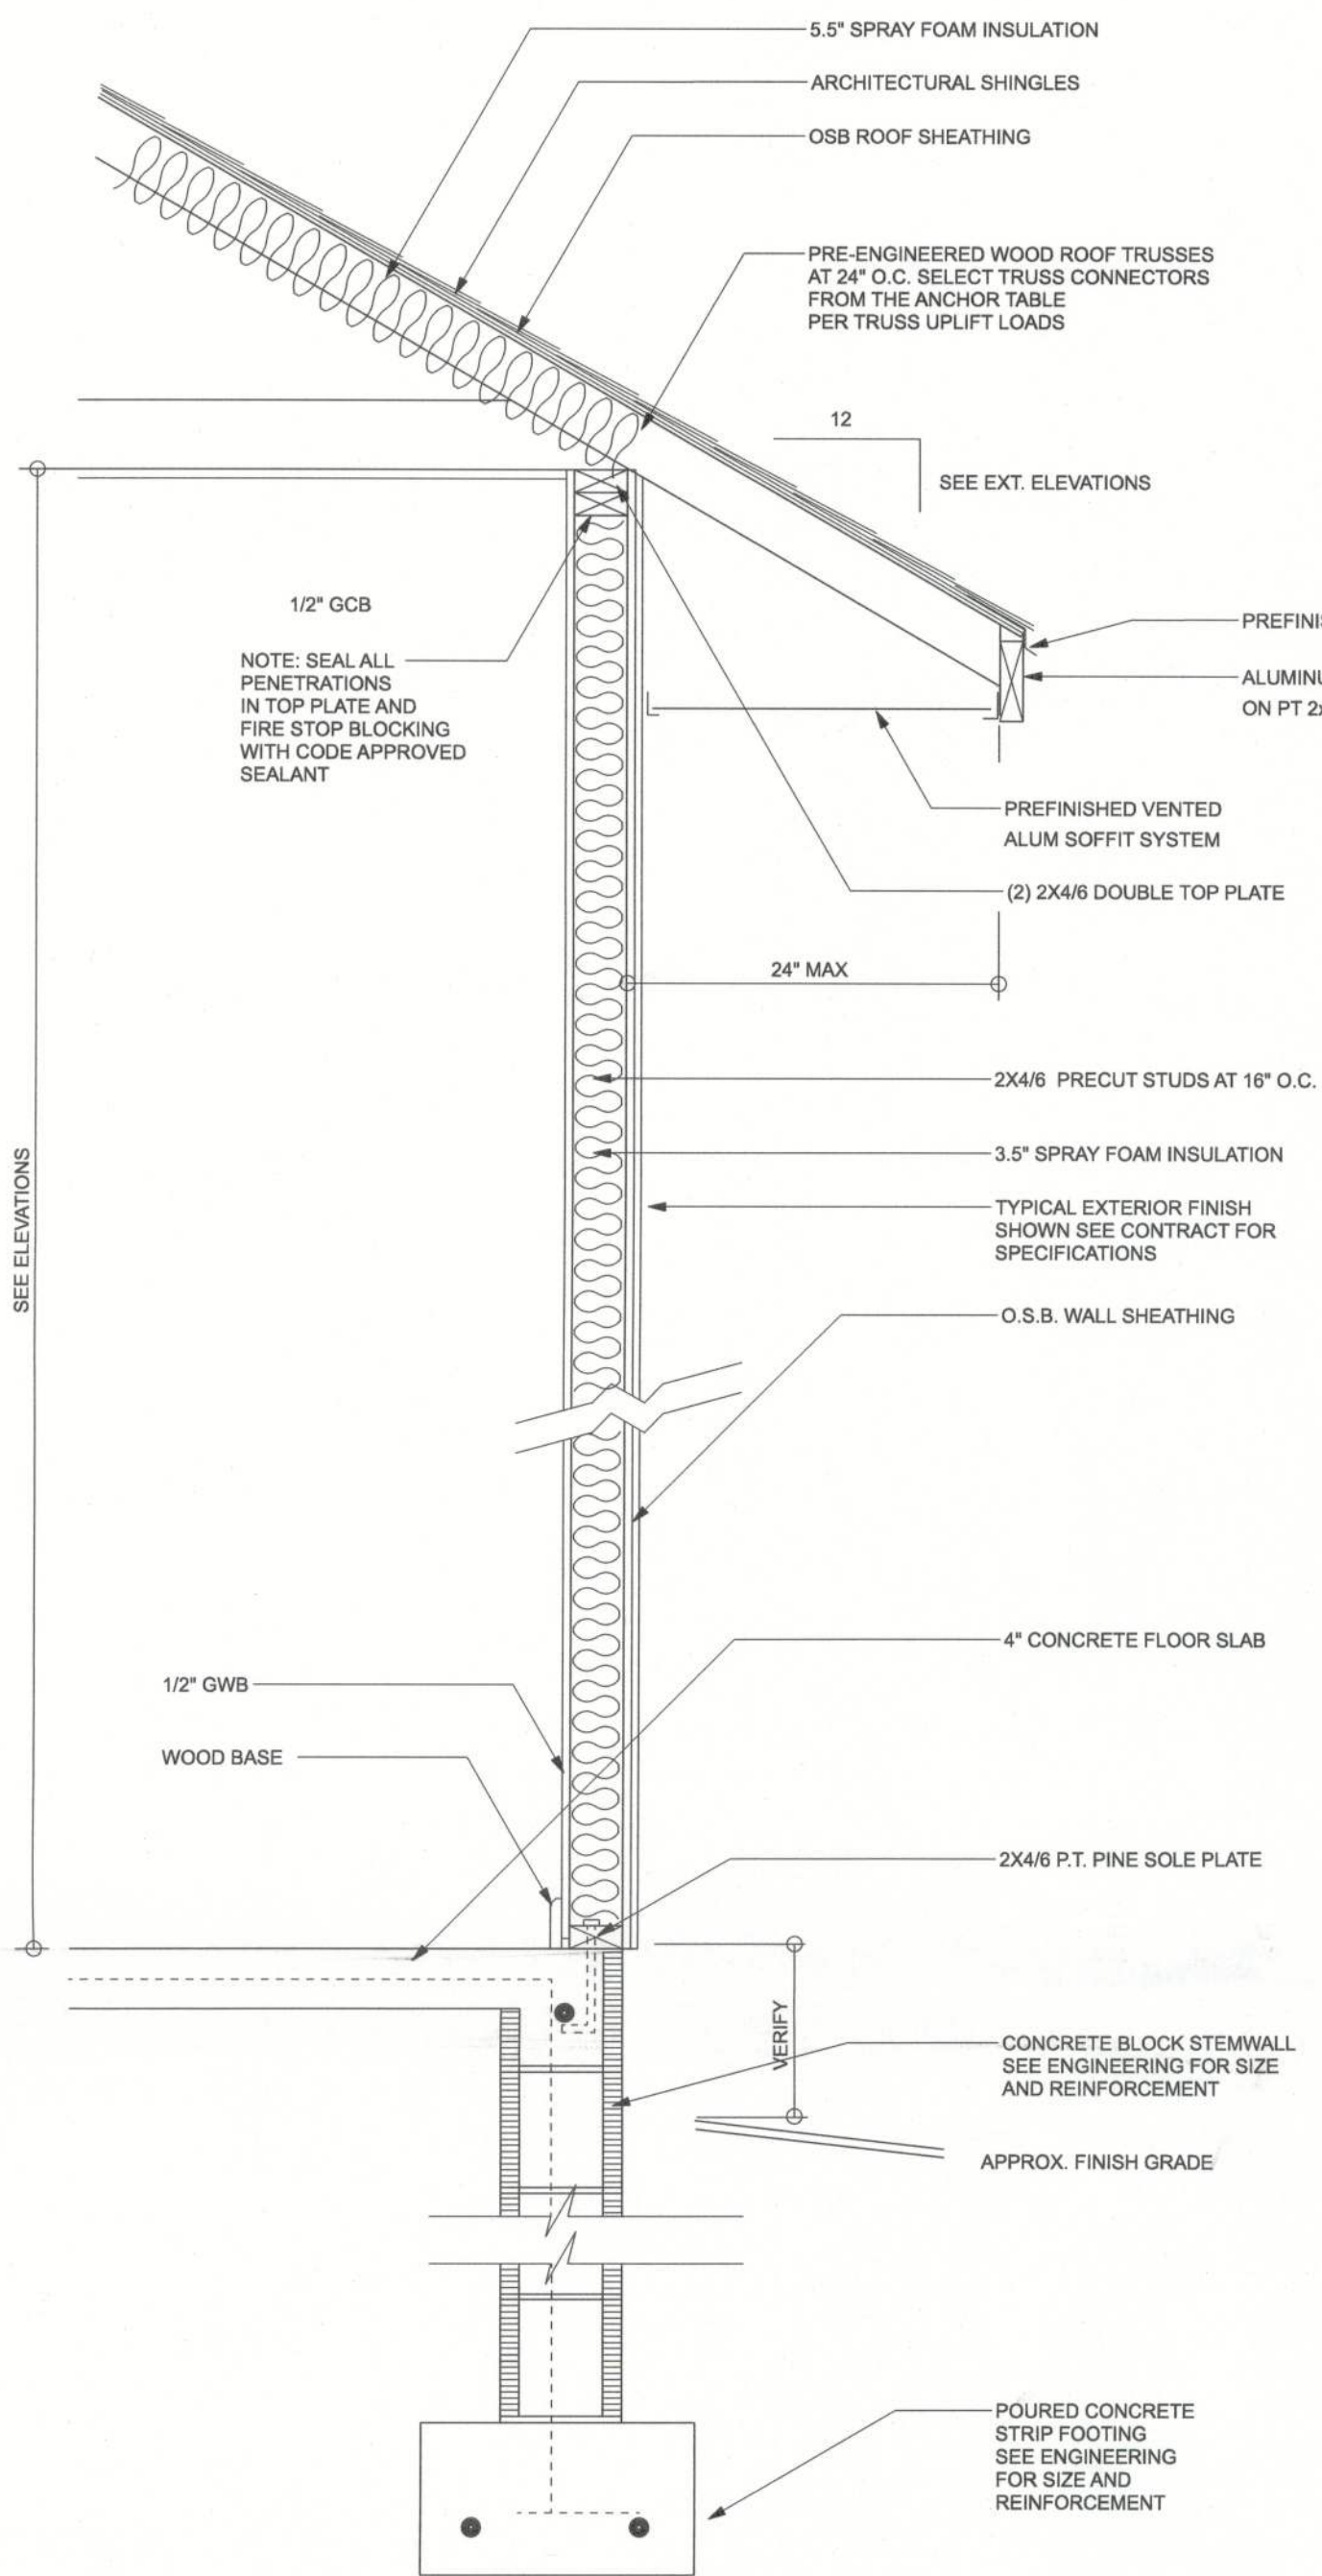
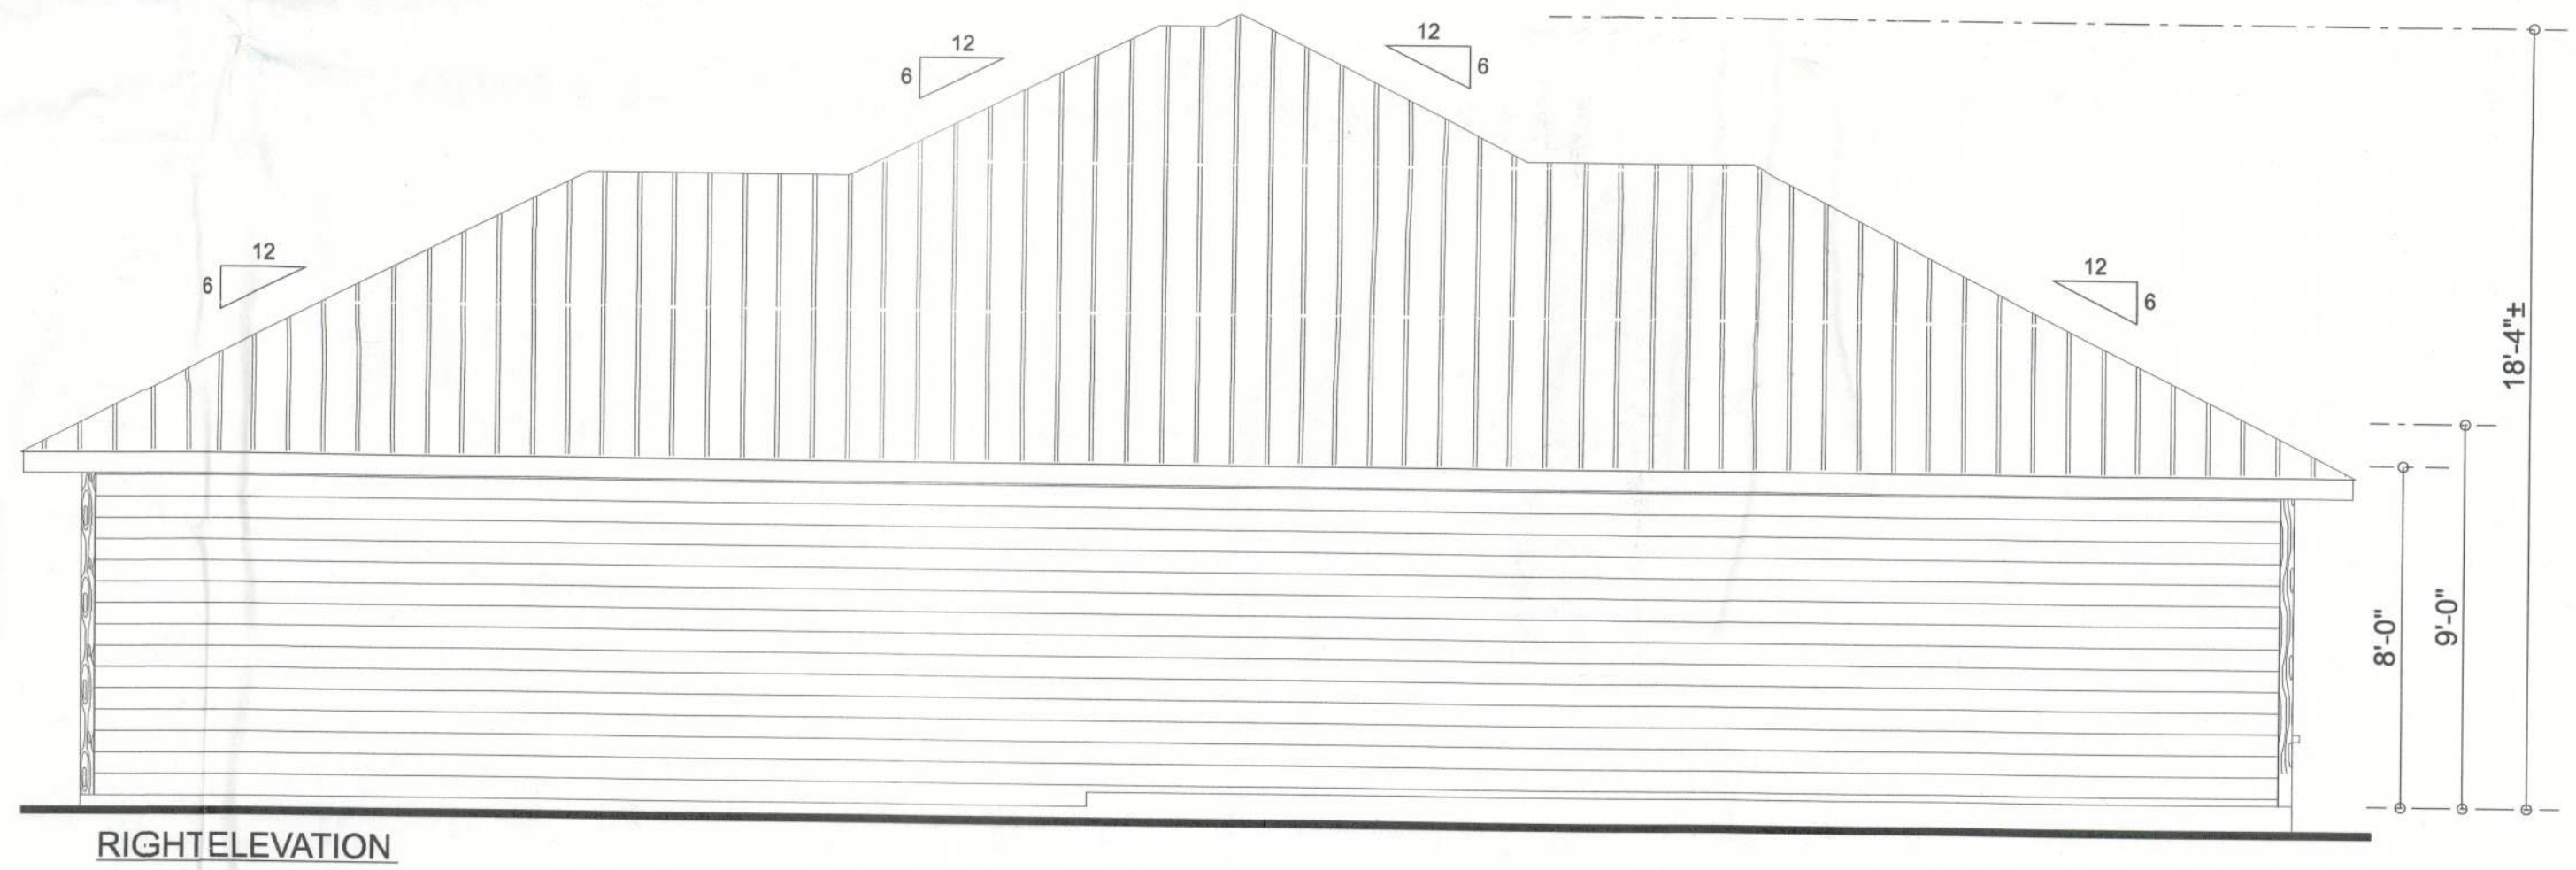


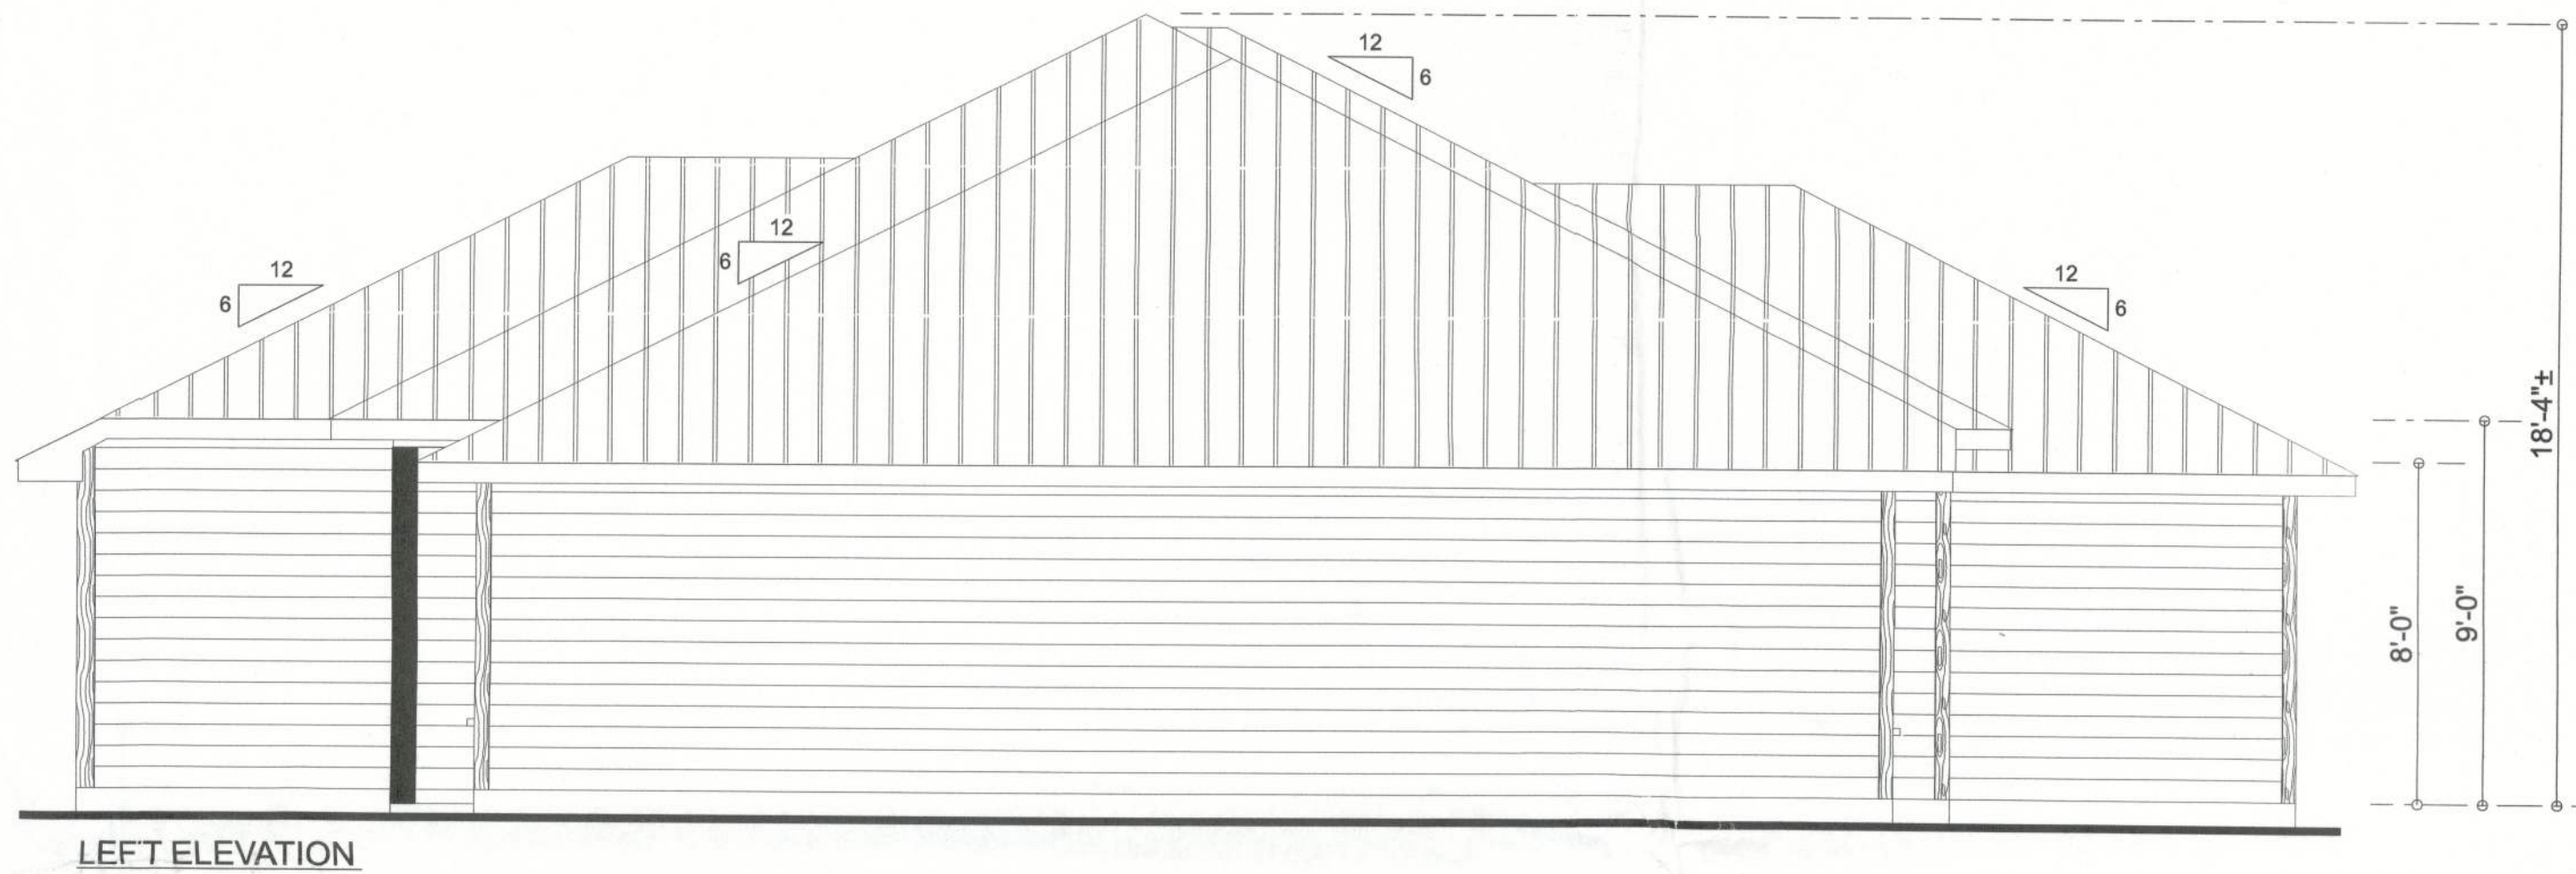

TYPICAL DESIGN WALL SECTION
NON - STRUCTURAL DATA

SCALE: 1" = 1'-0"

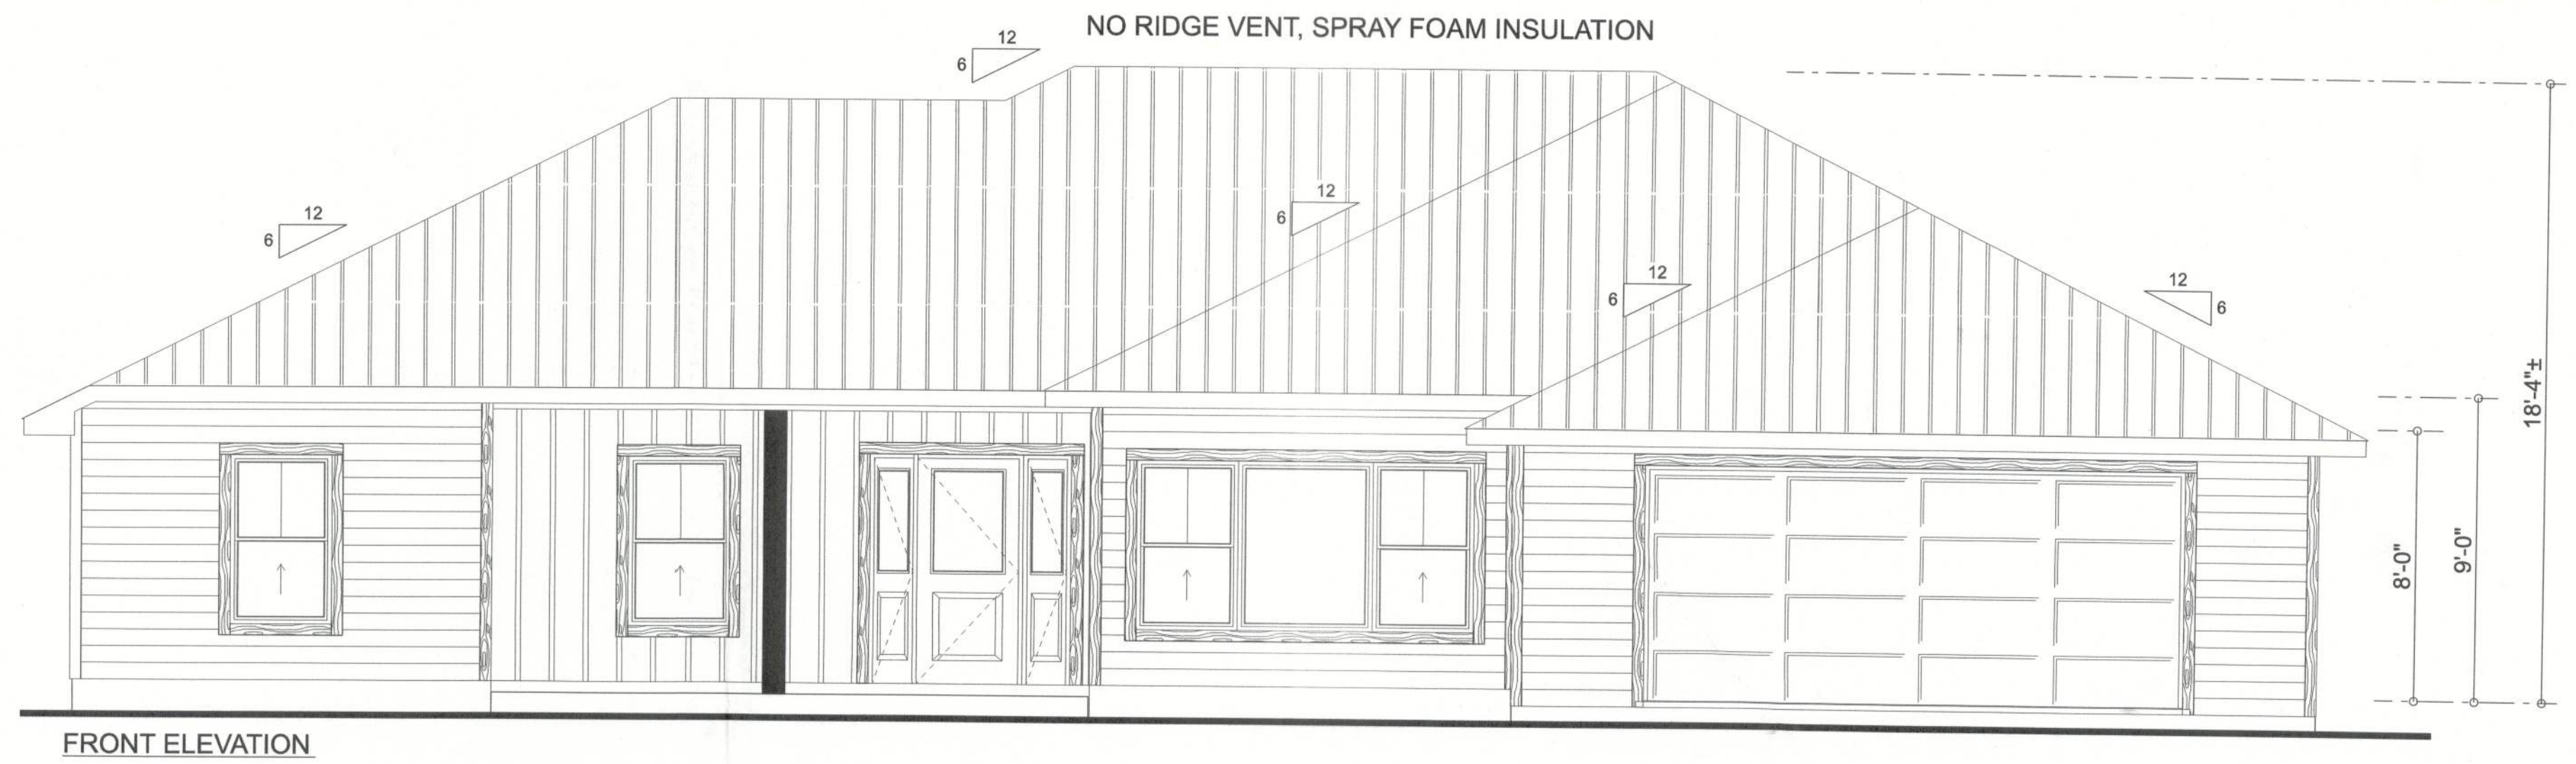

Erkinger Construction Group

William and Deborah Perri Residence

PARCEL ID# 01-75-16-04104-131
ADDRESS: 119 SW Hawk Lane Fort White, FL 32038 Columbia County

PRINTED DATE: Wednesday, September 18, 2024

DRAWN BY: Matthew A. Erkinger Sr.

DRAWING NUMBER **#1**

OF 3 SHEETS

51169



ROOF PLAN NOTES:

REQUIRED ATTIC ACCESS:
BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION SHALL HAVE ATTIC ACCESS OPENING TO ATTIC AREAS THAT EXCEED 30 SQUARE FEET HAVE A VERTICAL HEIGHT OF 30" OR GREATER. THE VERTICAL HEIGHT SHALL BE MEASURED FROM THE TOP OF THE CEILING FINISHING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS. THE ROUGH-FRAMED OPENING SHALL NOT BE LESS THAN 22" X 22" AND SHALL BE WHEN THE ACCESS IS LOCATED
EASILY REACHABLE ACCESSIBLE LOCATION. WHEN LOCATED IN A WALL, THE OPENING SHALL BE A MIN. OF 22" WIDE X 30" HIGH. THE MINIMUM CLEARANCE FROM THE TOP OF THE ROOF FRAMING MEMBER SHALL BE 30" AT SOME POINT ABOVE THE ACCESS MEASURED VERTICALLY FROM THE BOTTOM OF CEILING FRAMING MEMBERS.

REQUIRED ATTIC VENTILATION:
ATTIC VENTILATION SHALL BE PROVIDED WHERE MECHANICAL EQUIPMENT IS LOCATED IN ATTICS

REQUIRED ROOF VENTILATION:
ENCLOSED ATTIC AND ENCLOSED RAFTERS SPACES FORMED WHERE CEILING ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS SHALL HAVE CROSS VENTILATION FOR EACH SPACED SPACE BY VENTILATING OPENINGS PROTECTED AGAINST THE ENTRANCE OF VENTILATING OPENINGS SHALL HAVE A LEAST DIMENSION OF 1/16" MIN. AND 1/4" MAX. VENTILATING OPENINGS HAVE A LEAST DIMENSION LARGER THAN 1/4" MIN. AND 1/2" MAX. VENTILATING OPENINGS INCLUDING CORRUGATED METAL, CORRUGATED PLASTIC OR SIMILAR MATERIAL WITH OPENINGS HAVING A LEAST DIMENSION OF 1/16" MIN. AND 1/4" MAX. OPENINGS IN ROOF FRAMING MEMBERS SHALL CONFORM TO THE REQUIREMENTS OF SEC. R902.1.2.4.

REQUIRED VENTILATION FREE VENTILATION SHALL OPEN DIRECTLY TO OUTSIDE AIR

MINIMUM NET FREE VENTILATING AREA SHALL BE 1/150 OF THE AREA OF THE VENTED SPACE.
EXCEPTION: THE MINIMUM NET FREE VENTILATION AREA SHALL BE 1/300 OF THE VENTED SPACE PROVIDED ONE OR MORE OF THE FOLLOWING
MINIMUM ROOF VENT:

- 1. IN CLIMATE ZONES 6, 7 AND 8 A CLASS OR 1/4" VAPOR RETARDER IS INSTALLED ON THE WARM-IN-WINTER SIDE OF THE CEILING.
- 2. IN CLIMATE ZONES 6, 7 AND 8 THE VENTILATING OPENING IS PROVIDED IN THE ENTRANCE PLACED IN THE ENTRANCE PLACED IN THE UPPER PORTION OF THE ATTIC OR RAFTER SPACE. UPPER VENTILATORS SHALL BE LOCATED NO MORE THAN 3 FEET BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY, WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS. WHEN THE RIDGE OR HIGHEST POINT OF THE SPACE IS NOT LOCATED IN THE UPPER PORTION OF THE SPACE, THE LOCATION OF UPPER VENTILATORS, INSTALLATION MORE THAN 3 FEET BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE SHALL BE PERMITTED.

ATTIC VENTILATION NOT REQUIRED WITH SPRAY FOAM / SEALED ATTIC



AREA TABLE:	
LIVING AREA =	1820 SQ. FT.
GARAGE AREA =	554 SQ. FT.
PORCH AREA =	385 SQ. FT.
TOTAL AREA =	2759 SQ. FT.

GARAGE EQUIPMENT NOTES:
- VEHICLE IMPACT PROTECTION
REQUIRED FOR ALL APPLIANCES
IN GARAGE PER FBCR M1307.3.1.
- WATER HEATERS HAVING AN
IGNITION SOURCE SHALL BE
ELEVATED SUCH THAT THE
SOURCE OF IGNITION IS NOT LESS
18" ABOVE THE GARAGE FLOOR
PER FBC P2801.6

R302.5.1 Opening protection:

Openings from a private garage directly into a room used for sleeping purposes shall not be permitted. Other openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches in thickness, solid or honeycomb-core steel doors not less than 1 3/8 inches thick, or 20-minute fire-rated doors, equipped with a self-closing device.

SEPARATION	MATERIAL
From the residence and attics	Not less than 1/2-inch gypsum board or equivalent applied to the garage side
From all habitable rooms above the garage	Not less than 5/8-inch Type X gypsum board or equivalent
Structure(s) supporting floor/ceiling assemblies used for separation required by this section	Not less than 1/2-inch gypsum board or equivalent
Garages located less than 3 feet from a dwelling unit on the same lot	Not less than 1/2-inch gypsum board or equivalent applied to the interior side of exterior walls that are within this area

Erkinger Construction
Group

William and Deborah
Perri
Residence

PARCEL ID#
01-7S-16-04104-131
ADDRESS:
119 SW Hawk Lane
Fort White, FL 32037
Columbia County

PRINTED DATE:
Wednesday, September 18, 2024

DRAWN BY:
Matthew A. Erkinger Sr.


DRAWING NUMBER

#2

OF 3 SHEETS

ELECTRICAL PLAN NOTES:	
E-1	WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.
E-2	CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.
E-3	ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.
E-4	ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.
E-5	TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC LATEST EDITION.
E-6	ELECTRICAL CONTR' SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
E-7	ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY.
E-8	ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DINES, BEDROOMS, SUN ROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULTY CIRCUIT INTERRUPTER, COMBINATION-TYPE INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT.
E-9	ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOD ELEVATION.
E-10	A SERVICE DISCONNECT WITH OVER CURRENT PROTECTION SHALL BE INSTALLED OUTSIDE OF THE BUILDING, ON THE LOAD SIDE OF THE METER, AT THE PLACE ELECTRIC CONDUCTORS ENTER THE BUILDING.
E-11	SERVICE ENTRANCE CONDUCTORS MAY NOT BE LOCATED INSIDE OF THE OF THE BUILDING WITHOUT SPECIAL APPROVAL OF THE BUILDING OFFICIAL.
E-12	CARBON MONOXIDE ALARMS SHALL BE REQUIRED WITHIN 10' OF ALL ROOMS FOR SLEEPING PURPOSES IN BUILDINGS HAVING A FOSSIL-FUEL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR ATTACHED GARAGE.
E-13	ALL OUTLETS LOCATED IN RESIDENTIAL TO BE TAMPER-RESISTANT PER NEC.
E-14	A MINIMUM OF 75% OF PERMANENTLY INSTALLED LAMPS OR LIGHTING FIXTURES SHALL BE HIGH EFFICACY FBC EC SEC. R404.1

ELECTRICAL LEGEND	
ELECTRICAL	SYMBOL
fan - Bath fan light	
light - can light	
light - exterior spotlights	
light - fluorescent 1 x 4	
outlet	
outlet - 220v	
outlet - WP	
outlet - gfi	
switch	
switch - 3 way	
switch - 4 way	
ceiling fan 5 bladed 02	
ceiling fan 5 bladed 04	
chandelier 01	
fluorescent light 1 x 4	
pendant large	
exterior light 03	
generator power	
cable tv outlet	
central vacuum outlet	
wall mounted 01 3 lights	
A/C Disconnect	
electrical panel	
detector - CO	
detector - smoke	
light	

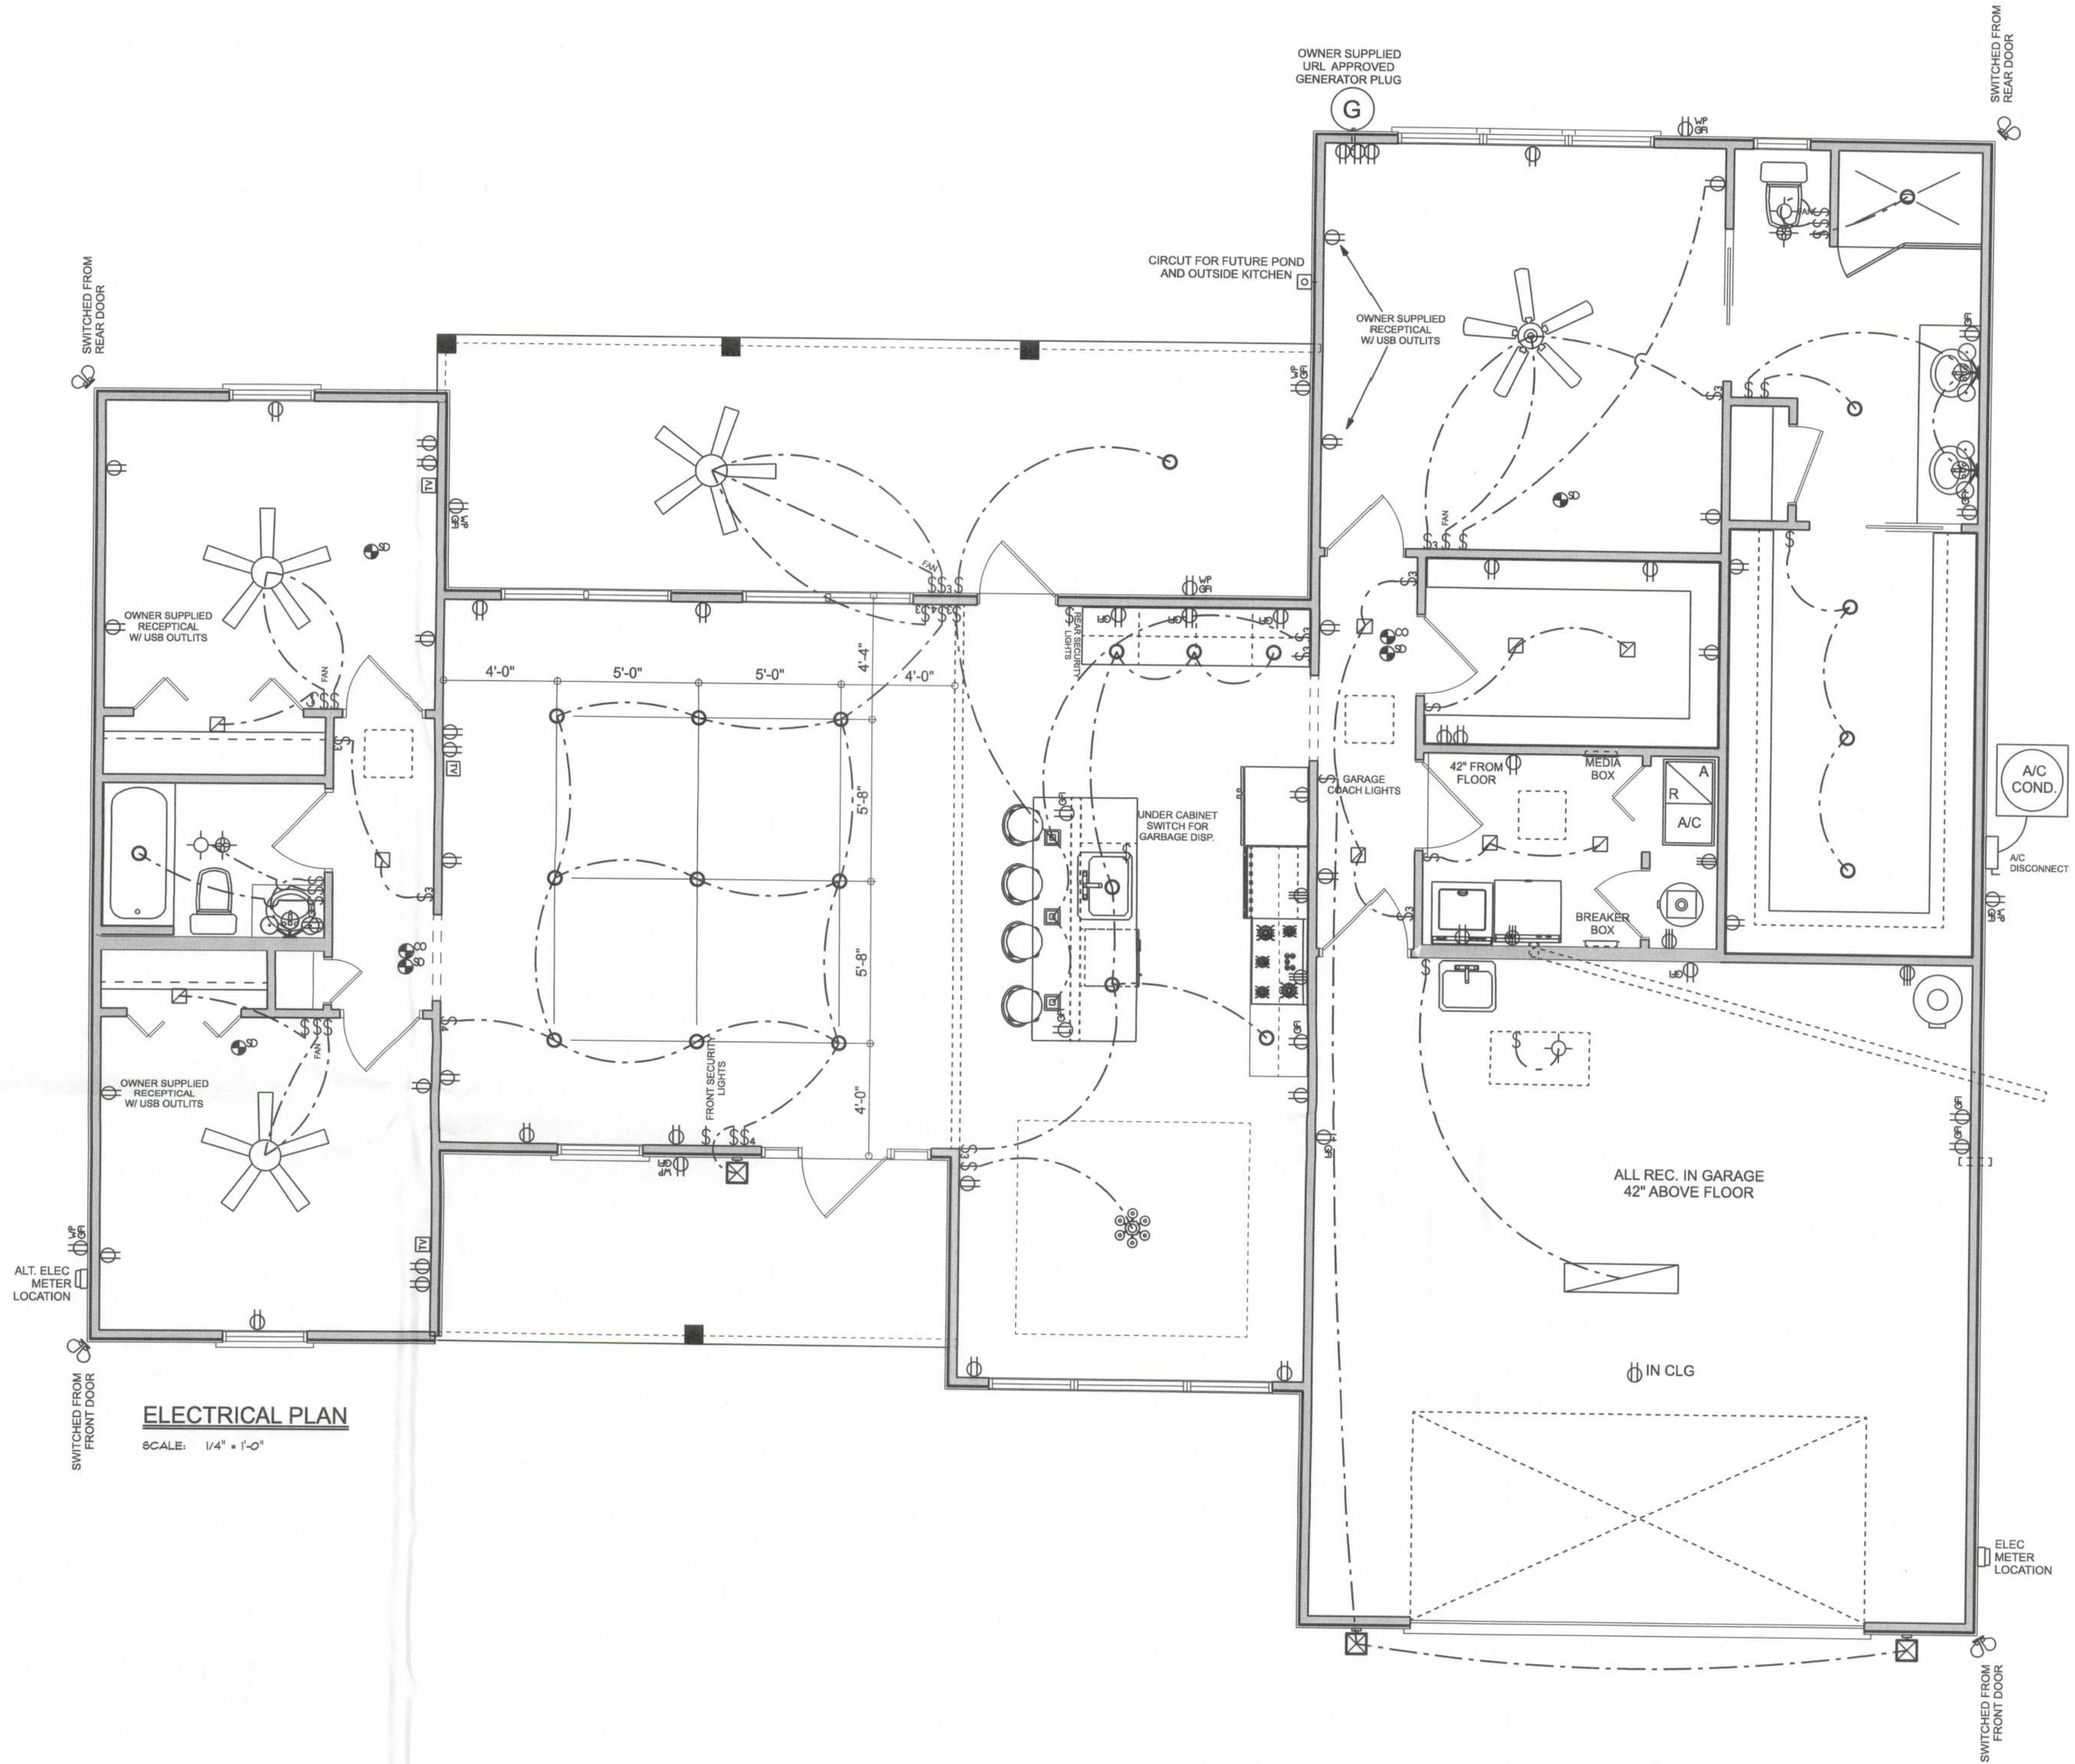


Erkinger Construction
Group

William and Deborah
Perri
Residence


PARCEL ID#
01-75-16-04104-131
ADDRESS:
119 SW Hawk Lane
Fort White, FL 32038
Columbia County

PRINTED DATE:
Wednesday, September 18, 2024
DRAWN BY:
Matthew A. Erkinger Sr.



DRAWING NUMBER
#3
OF 3 SHEETS

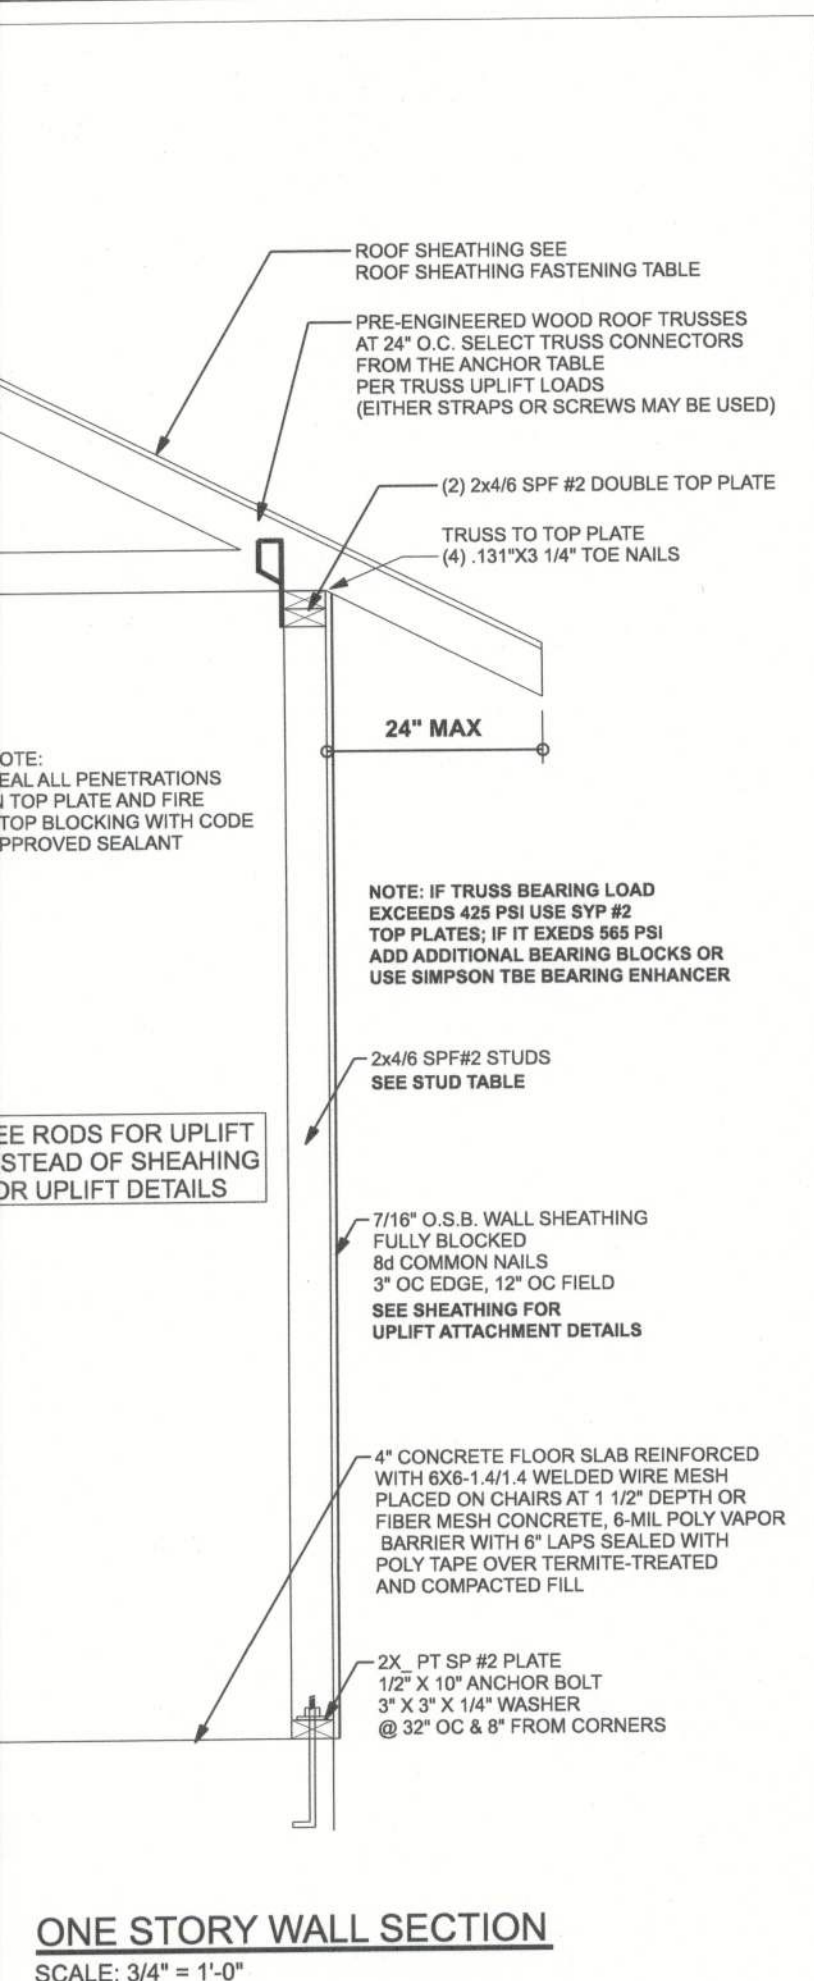


ONE STORY WALL SECTION SCALE: 3/4" = 1'-0"

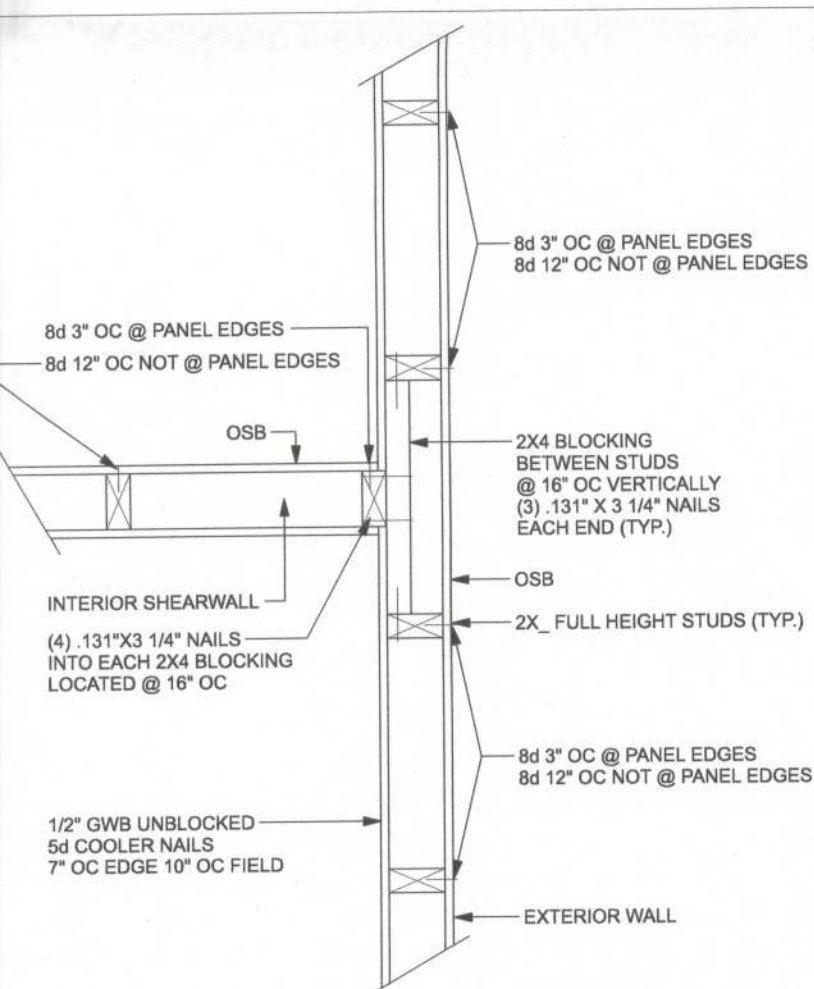



(TYP.) INTERSECTING WALL FRAMING WOOD FRAME

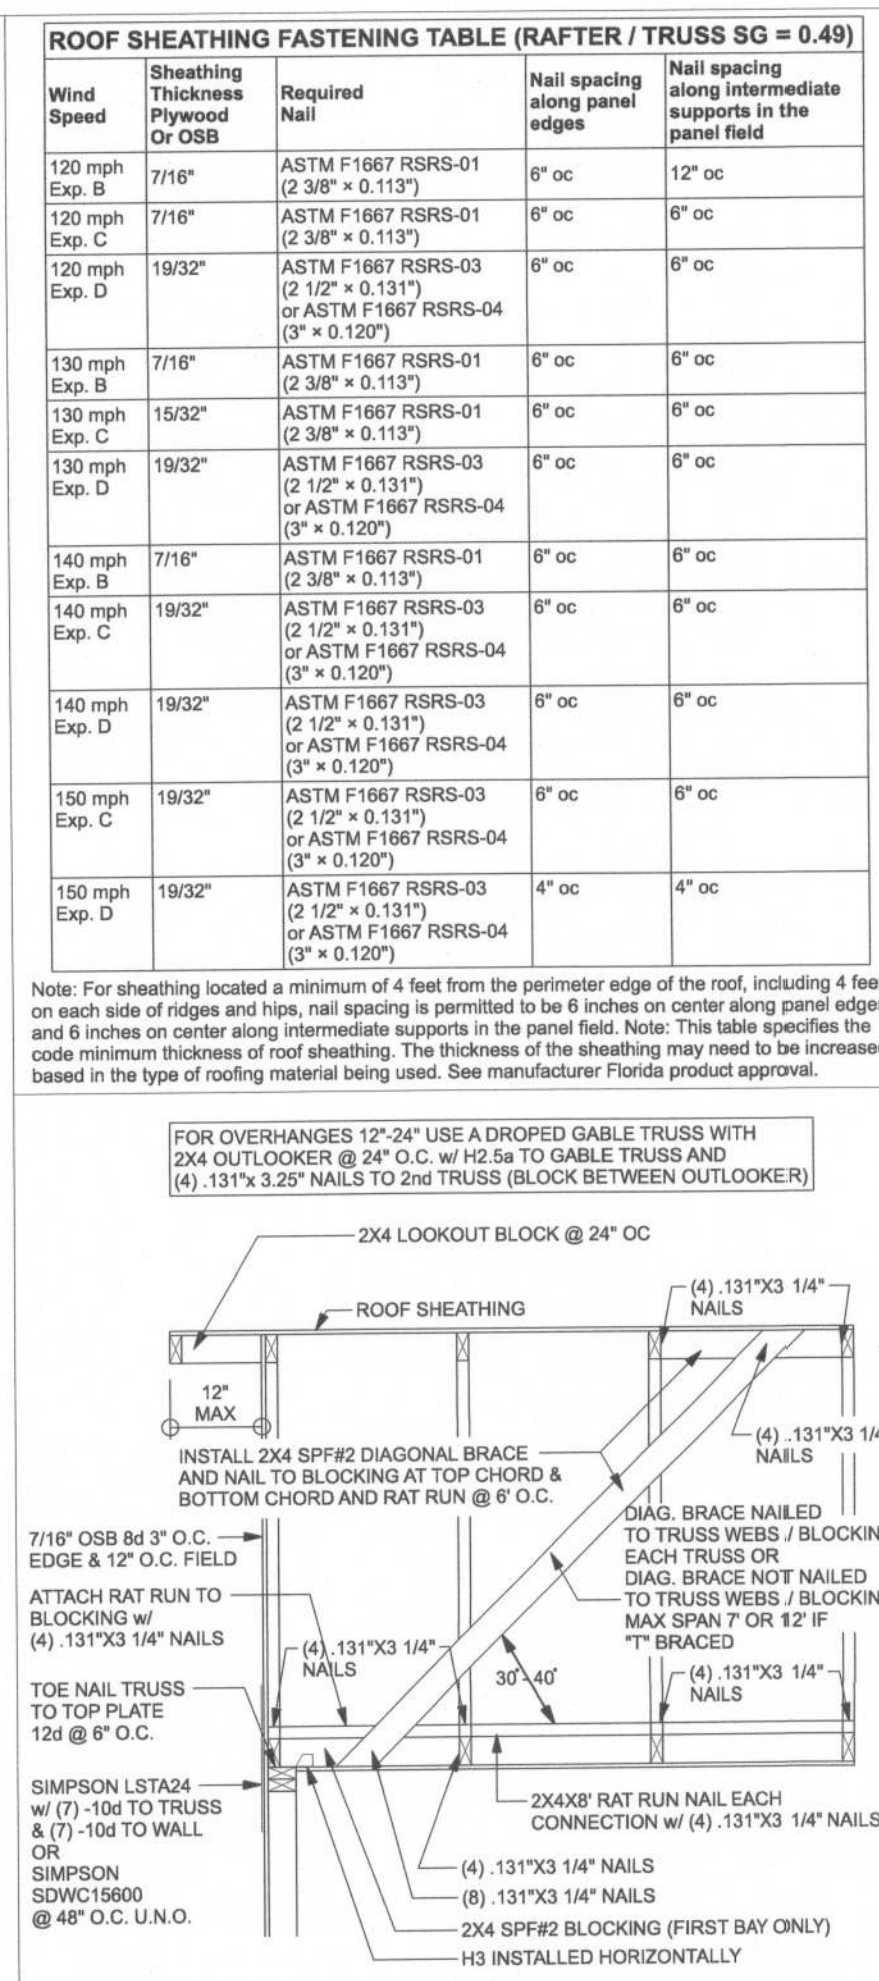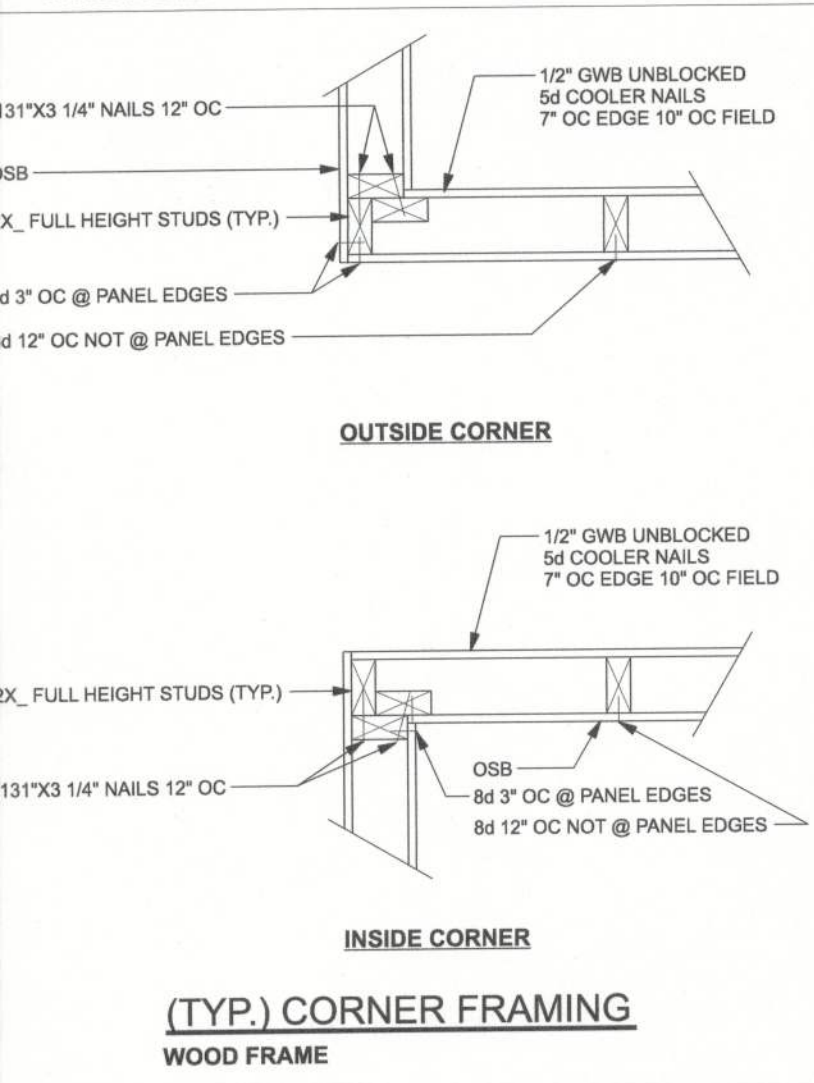


(TYP.) GABLE BRACING DETAIL WOOD FRAME

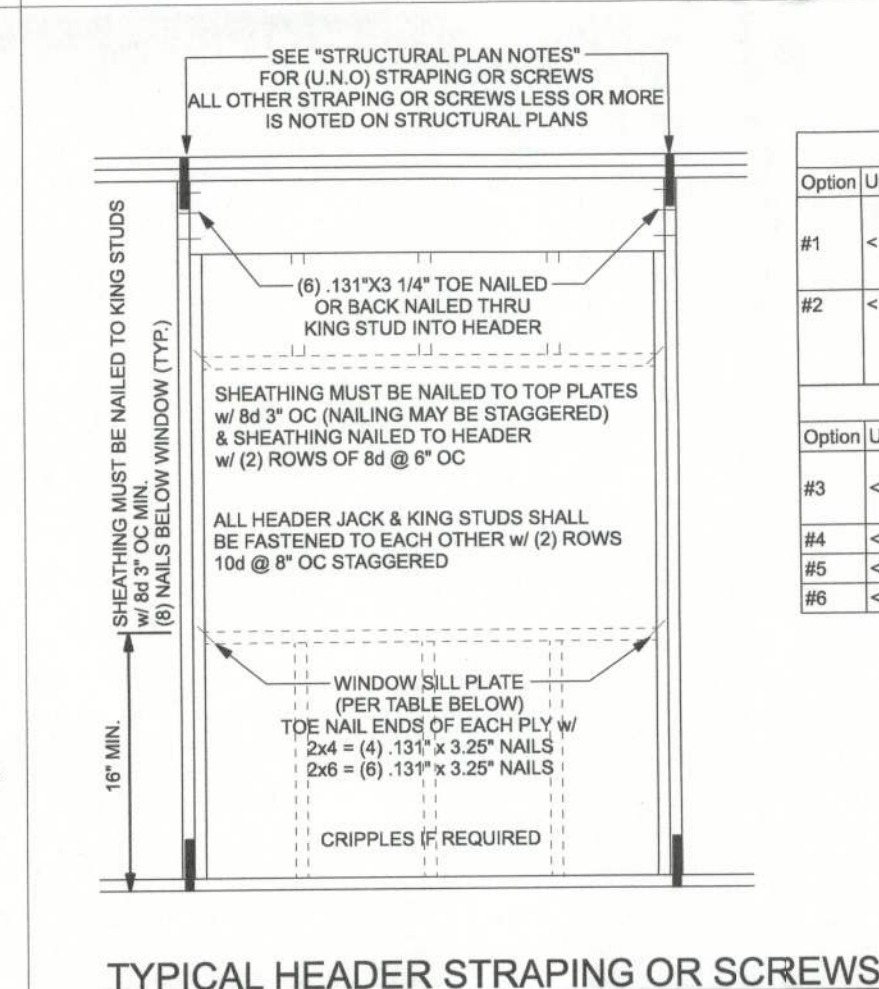



(TYP.) INTERSECTING WALL FRAMING WOOD FRAME

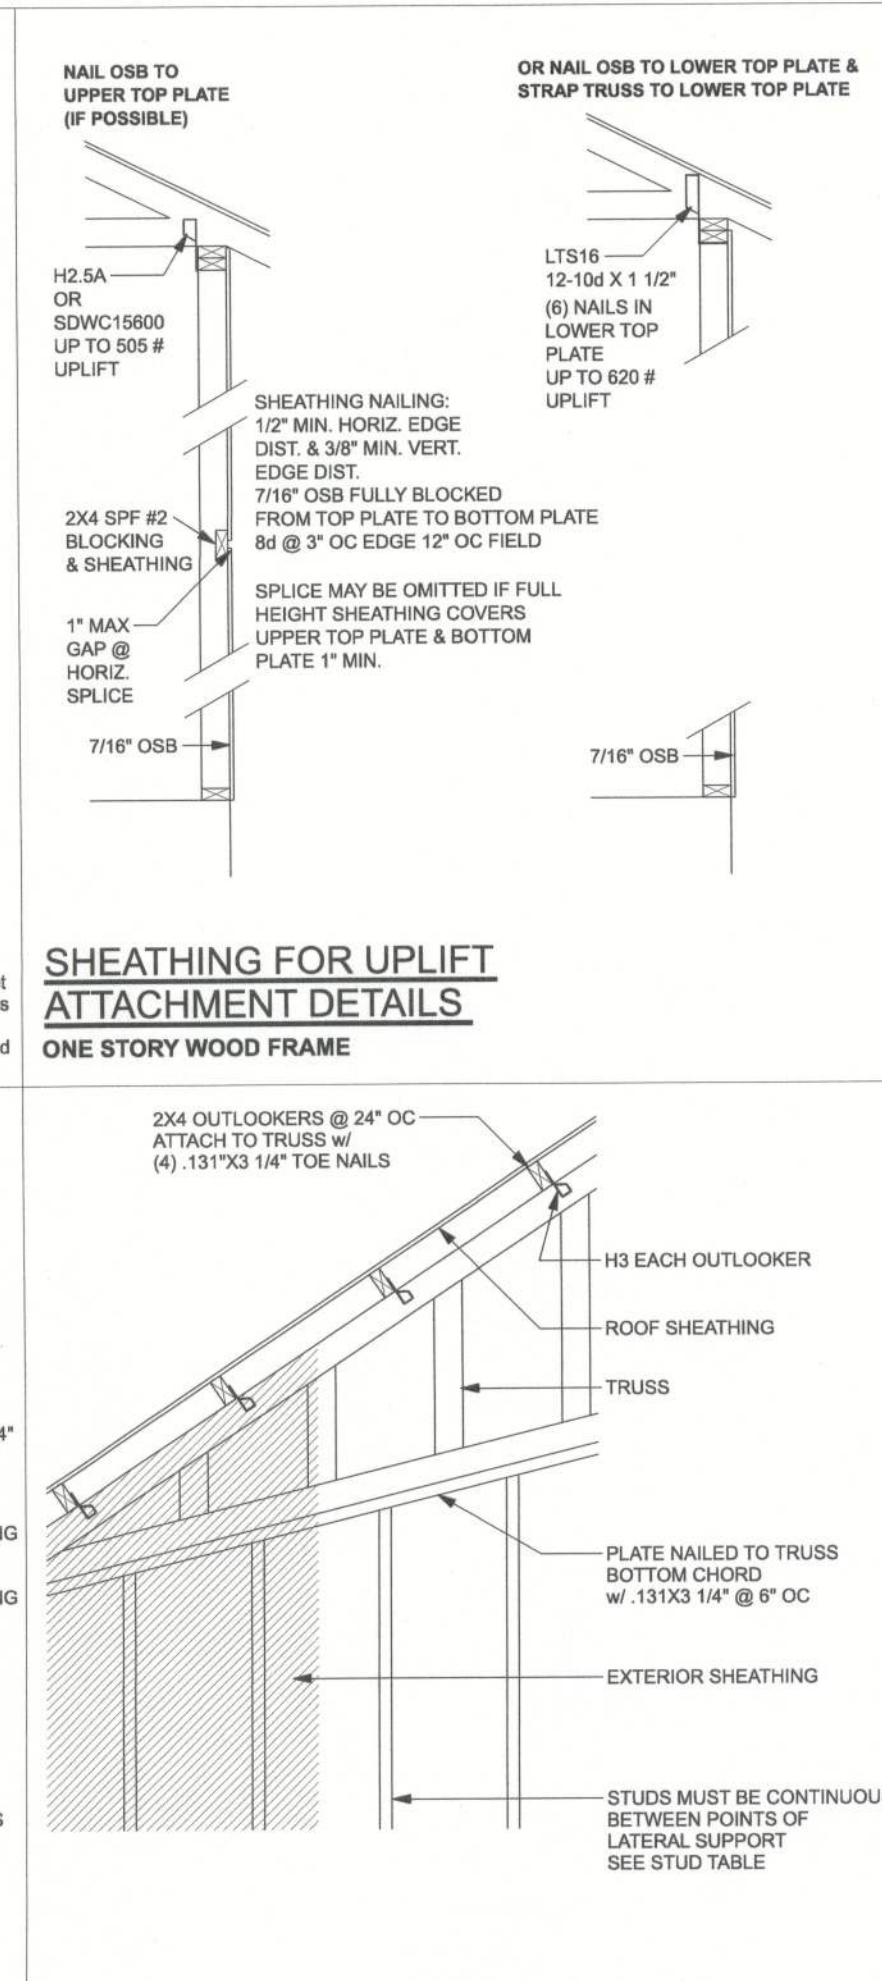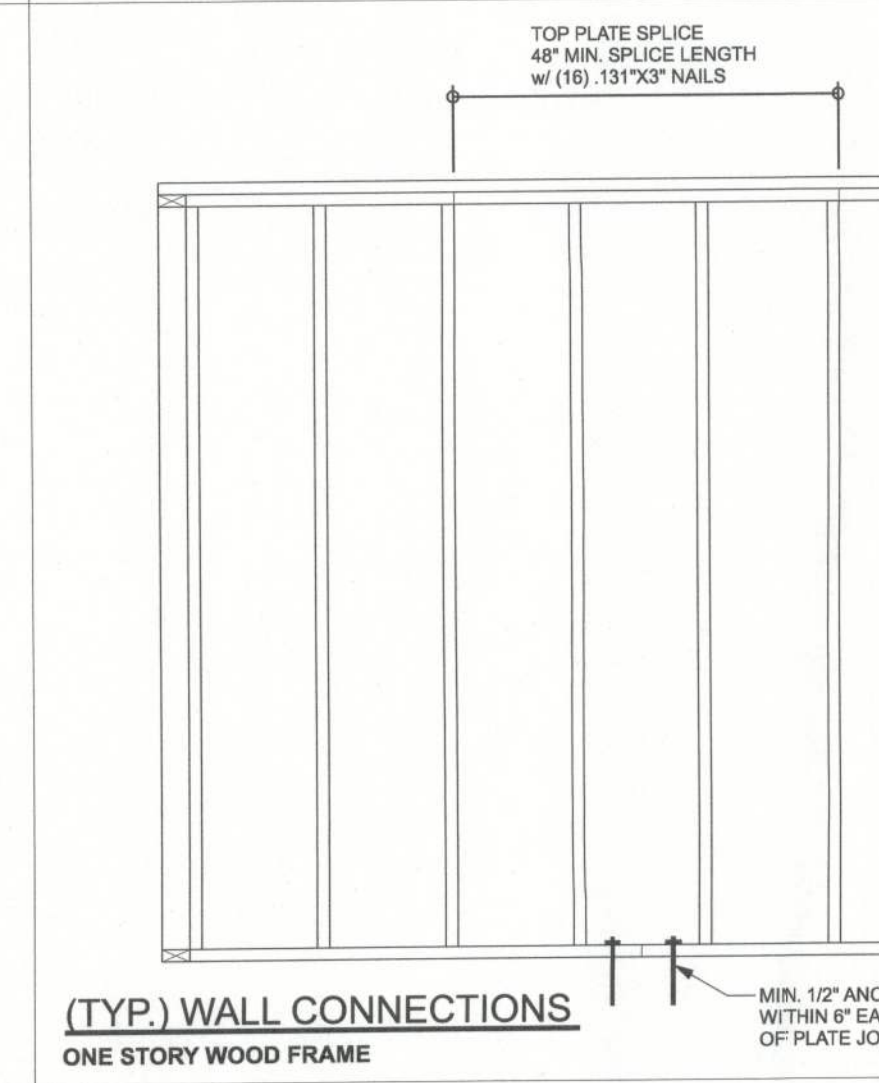


(TYP.) GABLE BRACING DETAIL WOOD FRAME

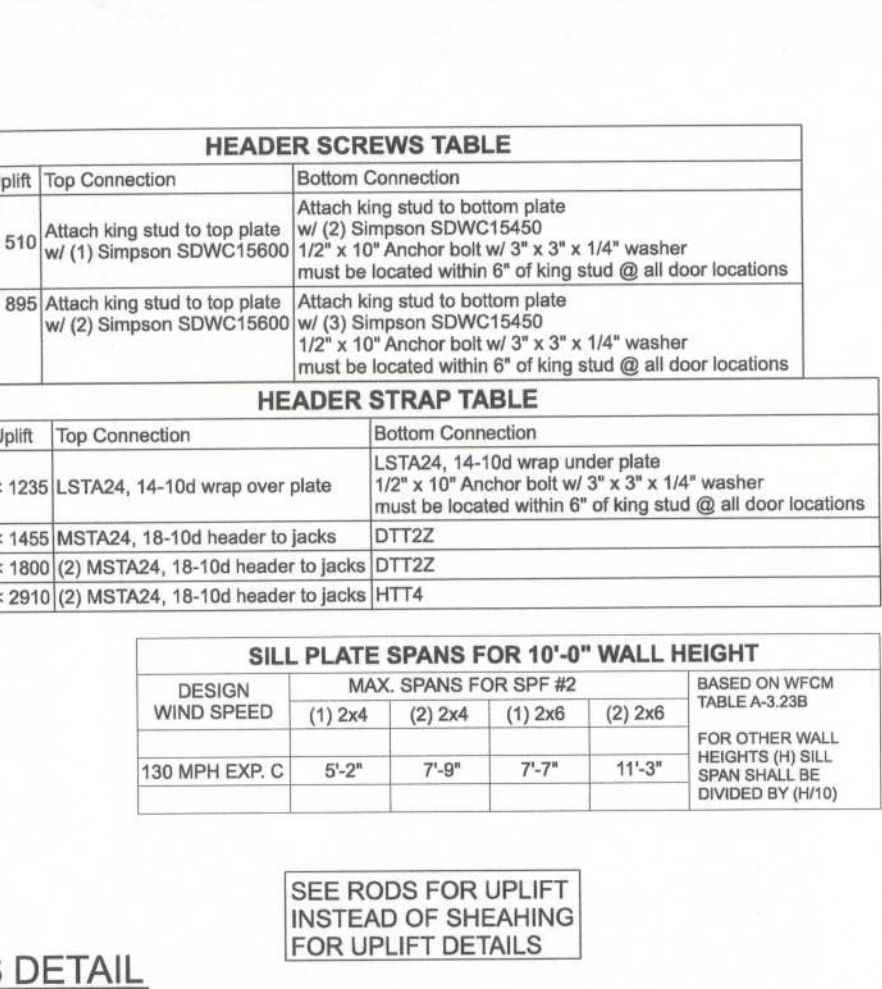



(TYP.) INTERSECTING WALL FRAMING WOOD FRAME

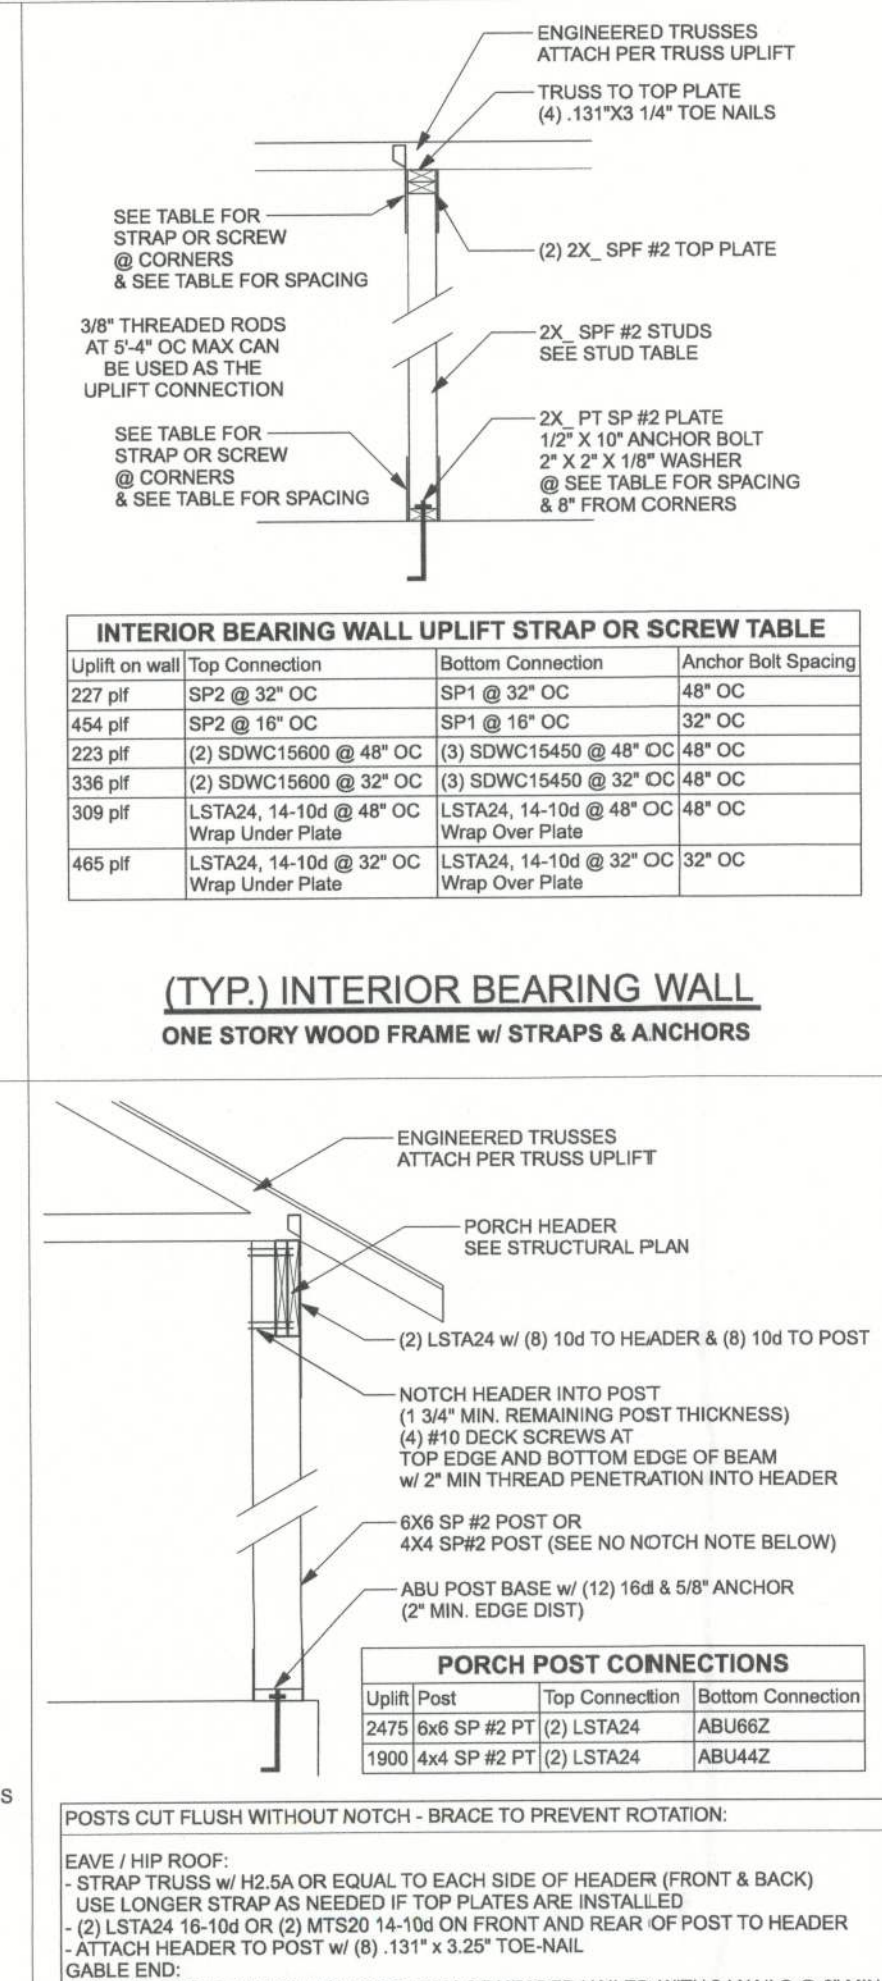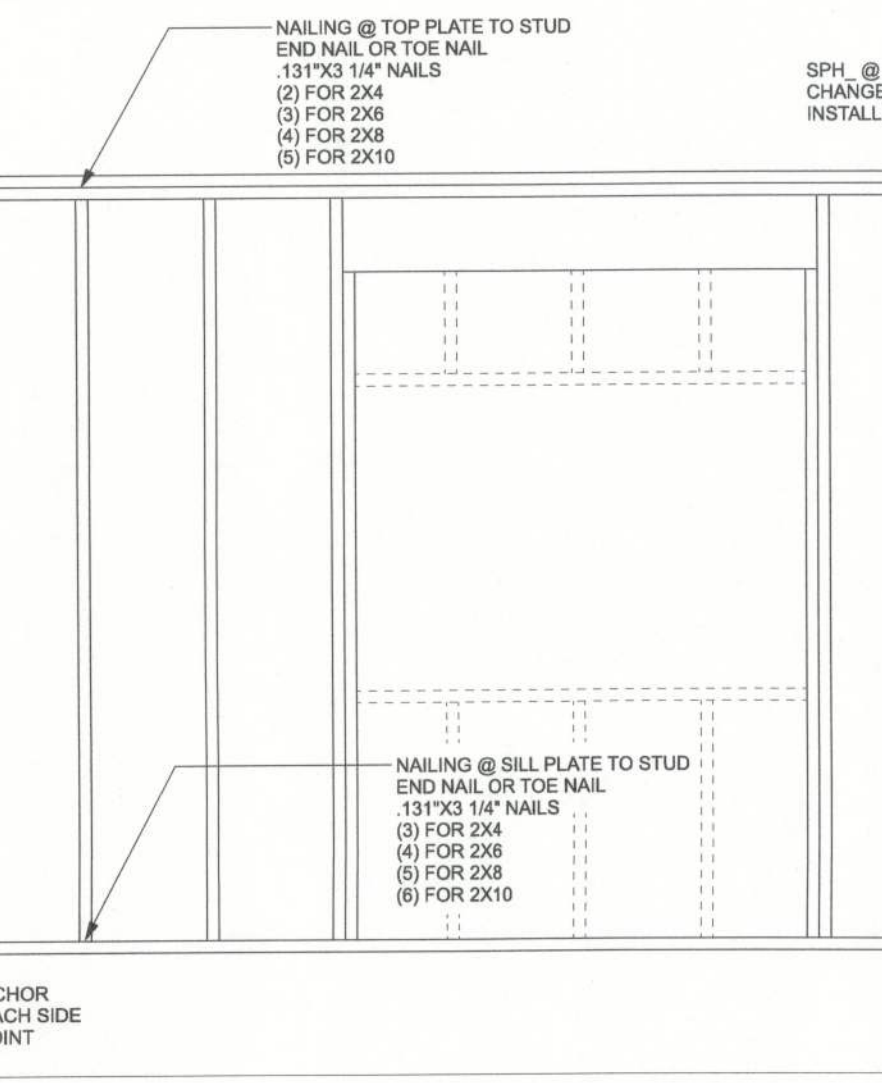


(TYP.) GABLE BRACING DETAIL WOOD FRAME

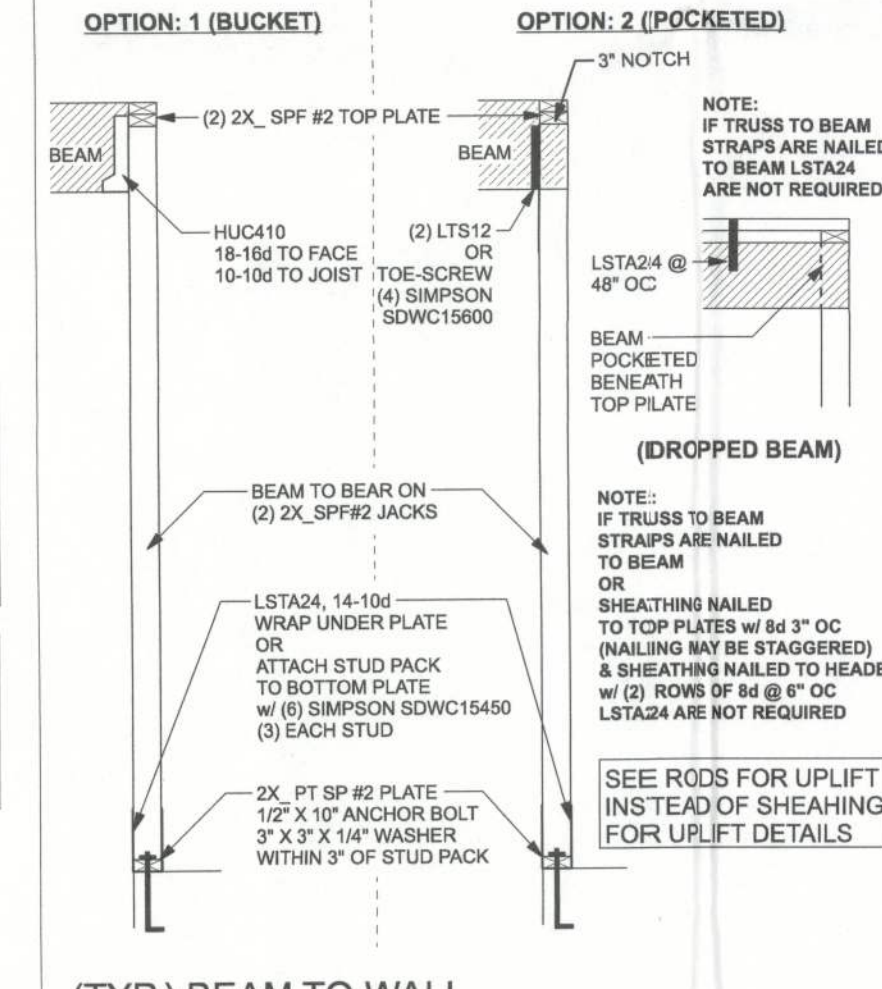



(TYP.) INTERSECTING WALL FRAMING WOOD FRAME

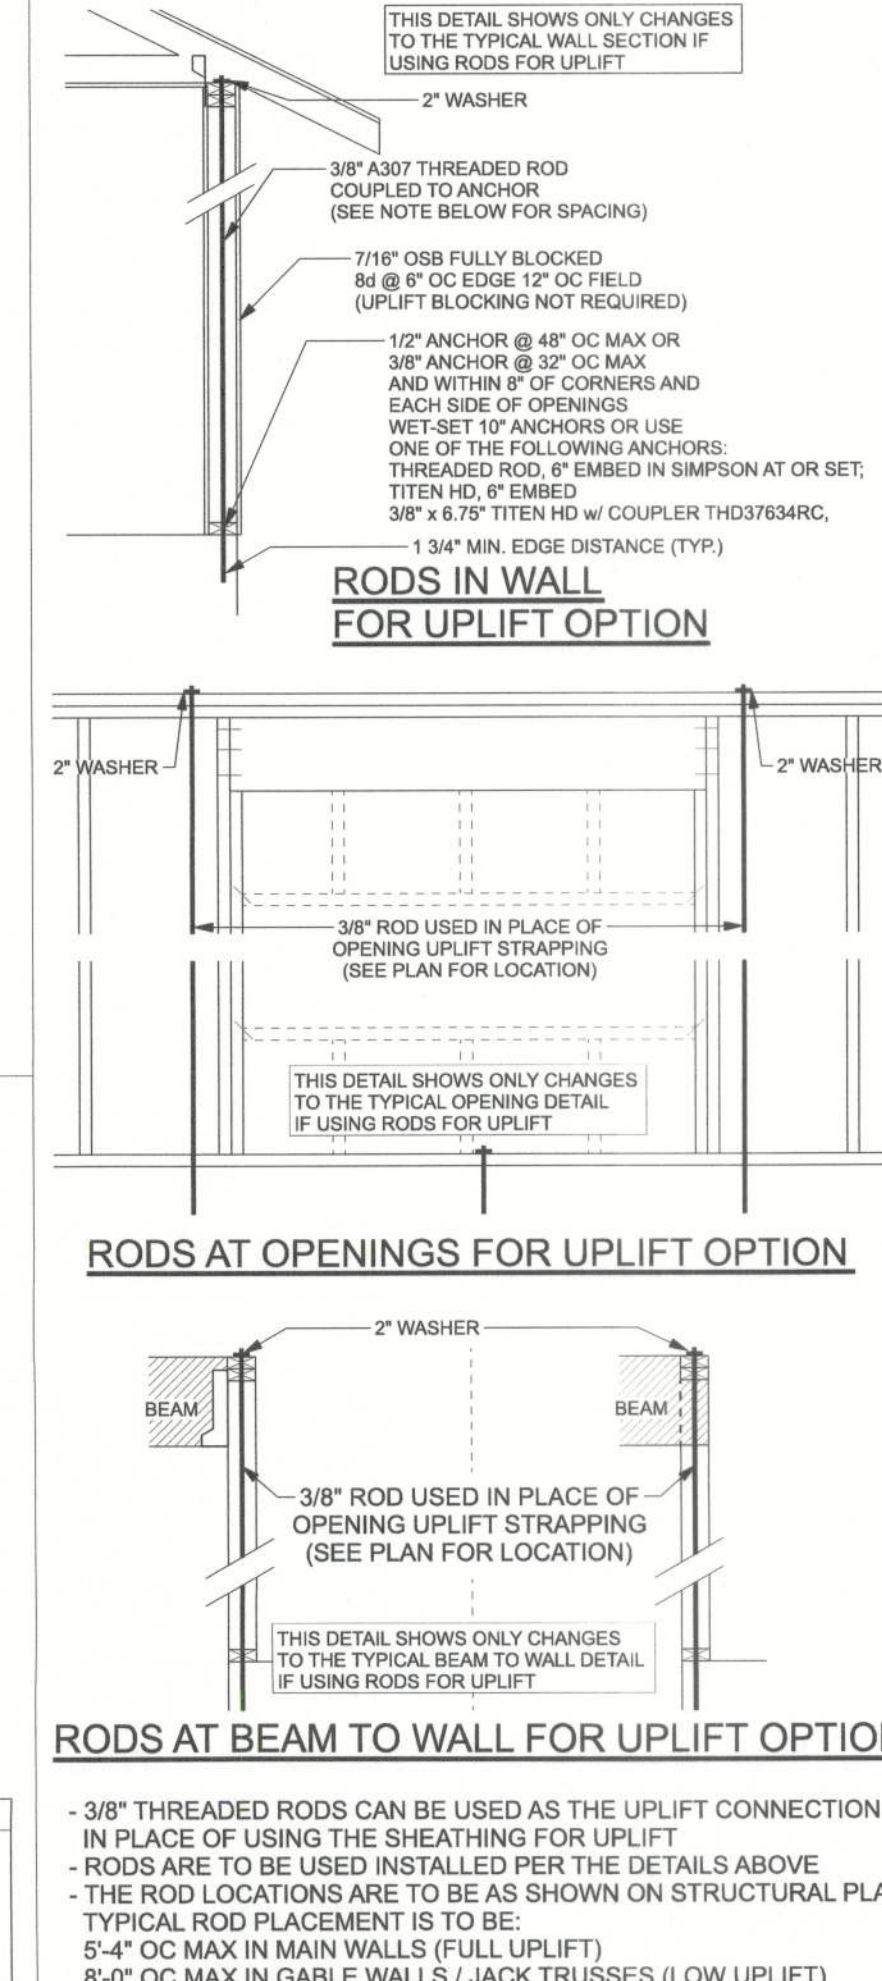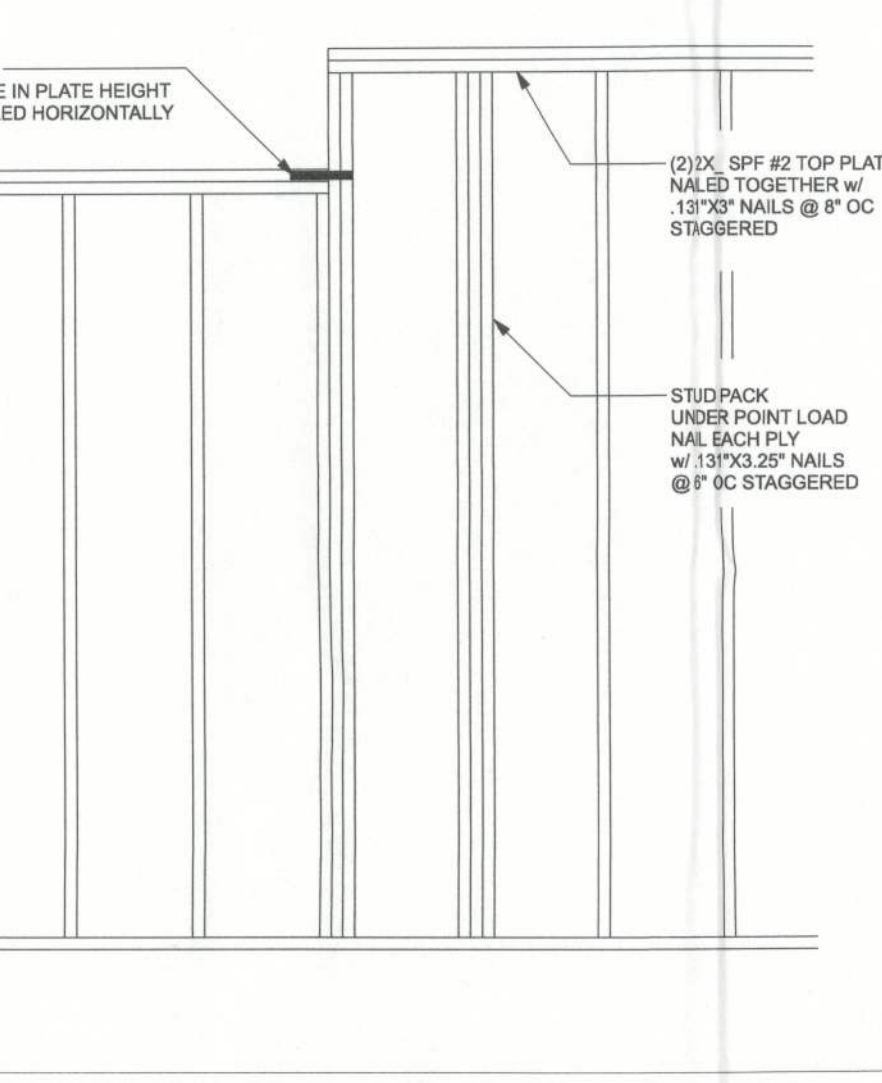

(TYP.) GABLE BRACING DETAIL WOOD FRAME

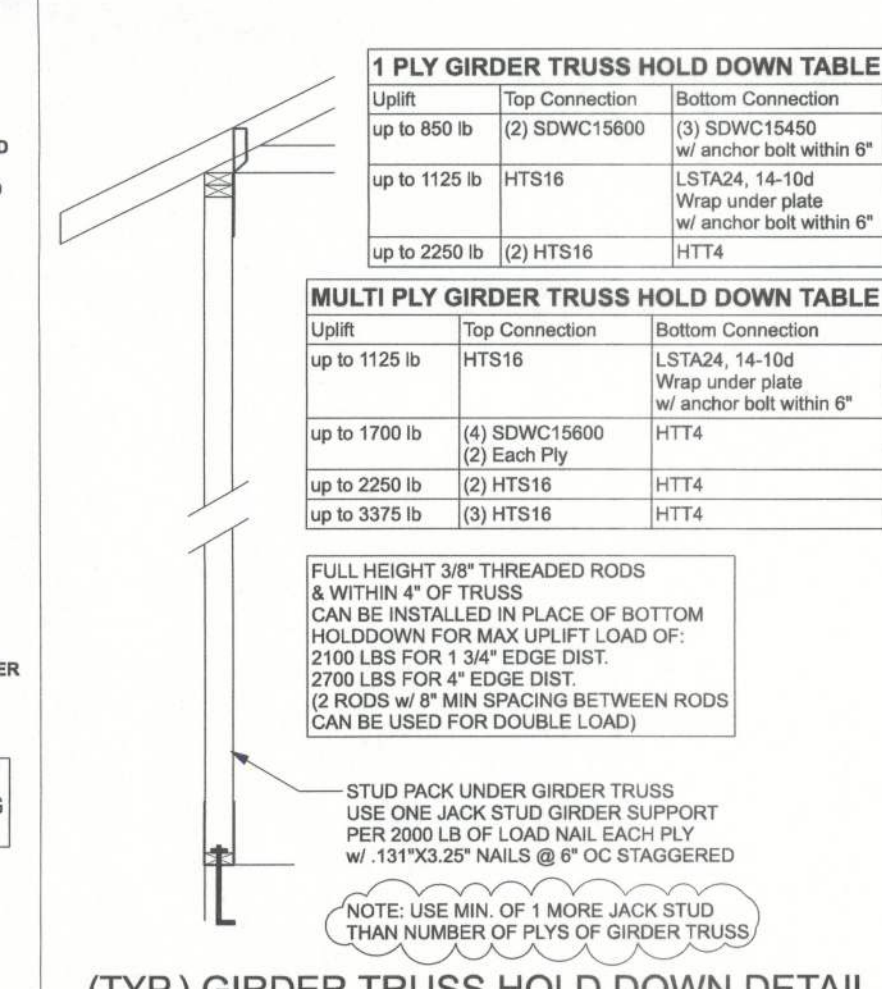



(TYP.) INTERSECTING WALL FRAMING WOOD FRAME

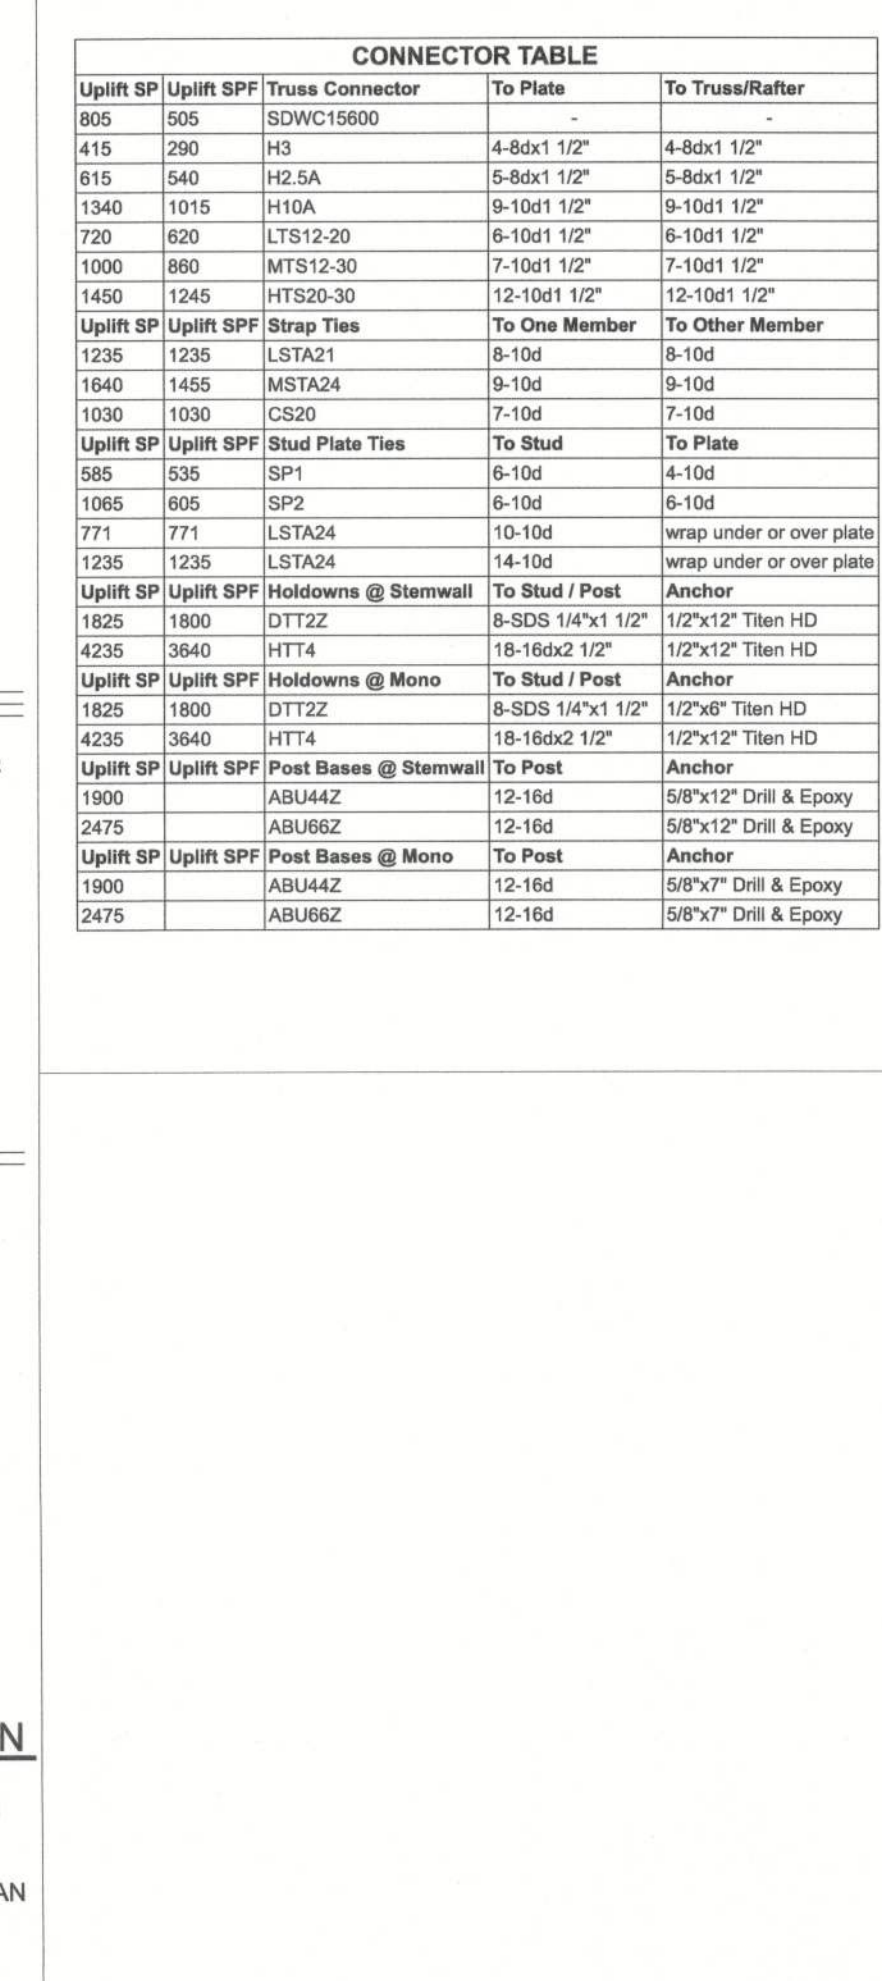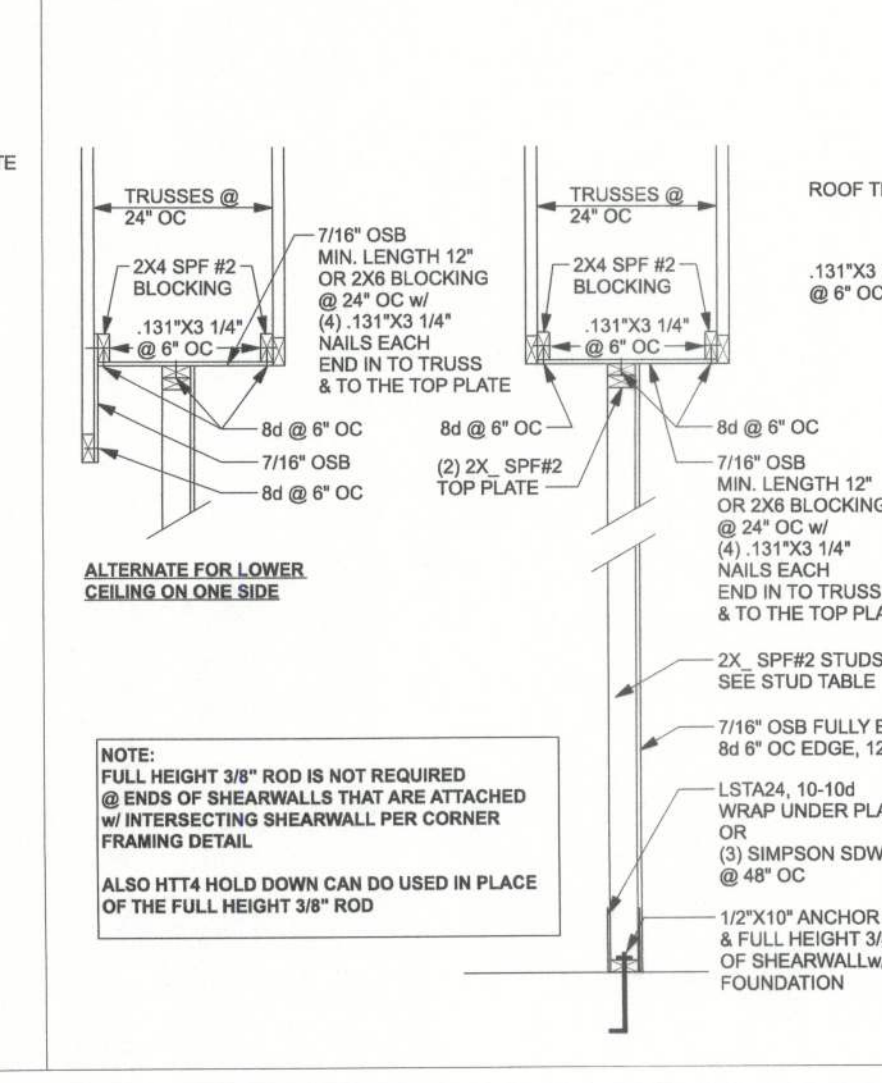


(TYP.) GABLE BRACING DETAIL WOOD FRAME





(TYP.) INTERSECTING WALL FRAMING WOOD FRAME

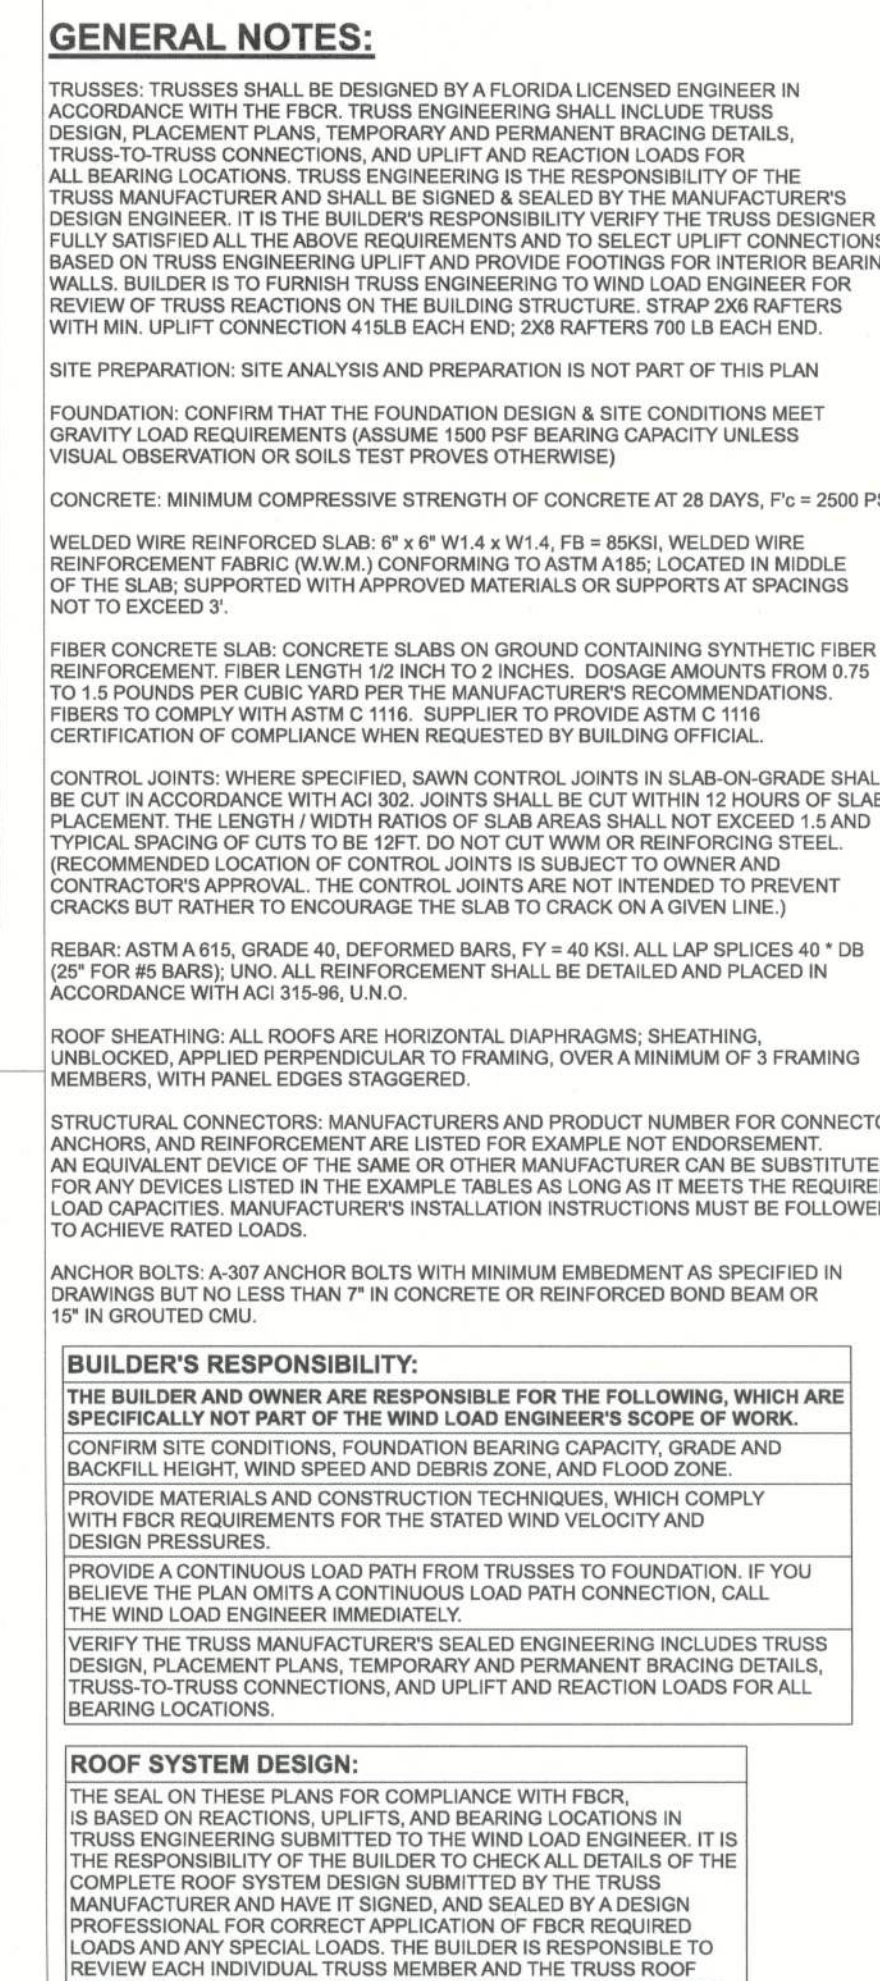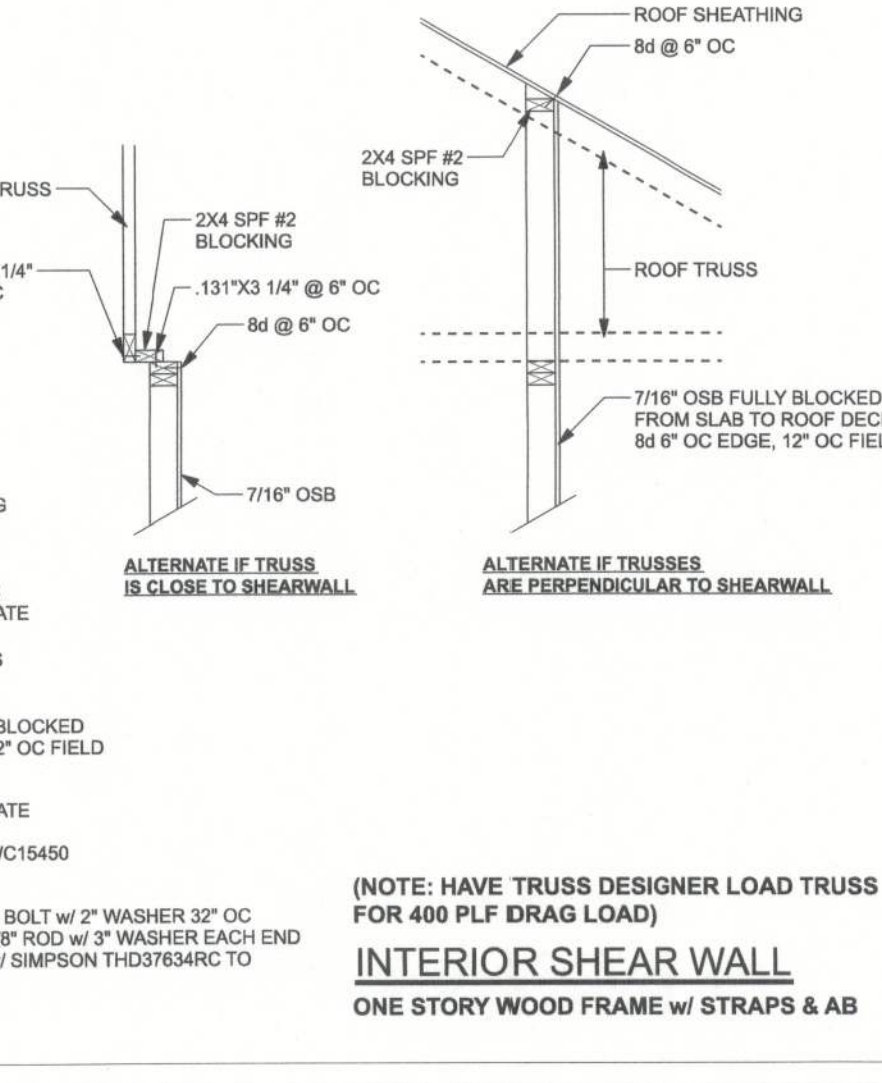


(TYP.) GABLE BRACING DETAIL WOOD FRAME

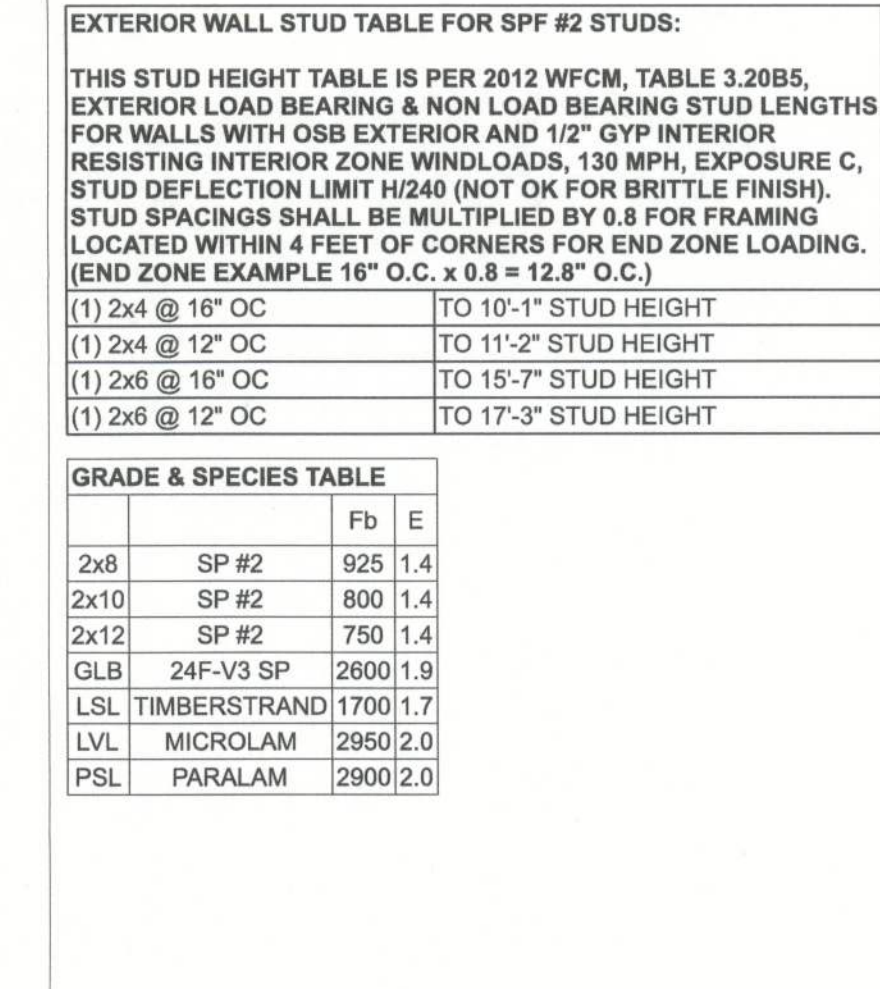

(TYP.) INTERSECTING WALL FRAMING WOOD FRAME

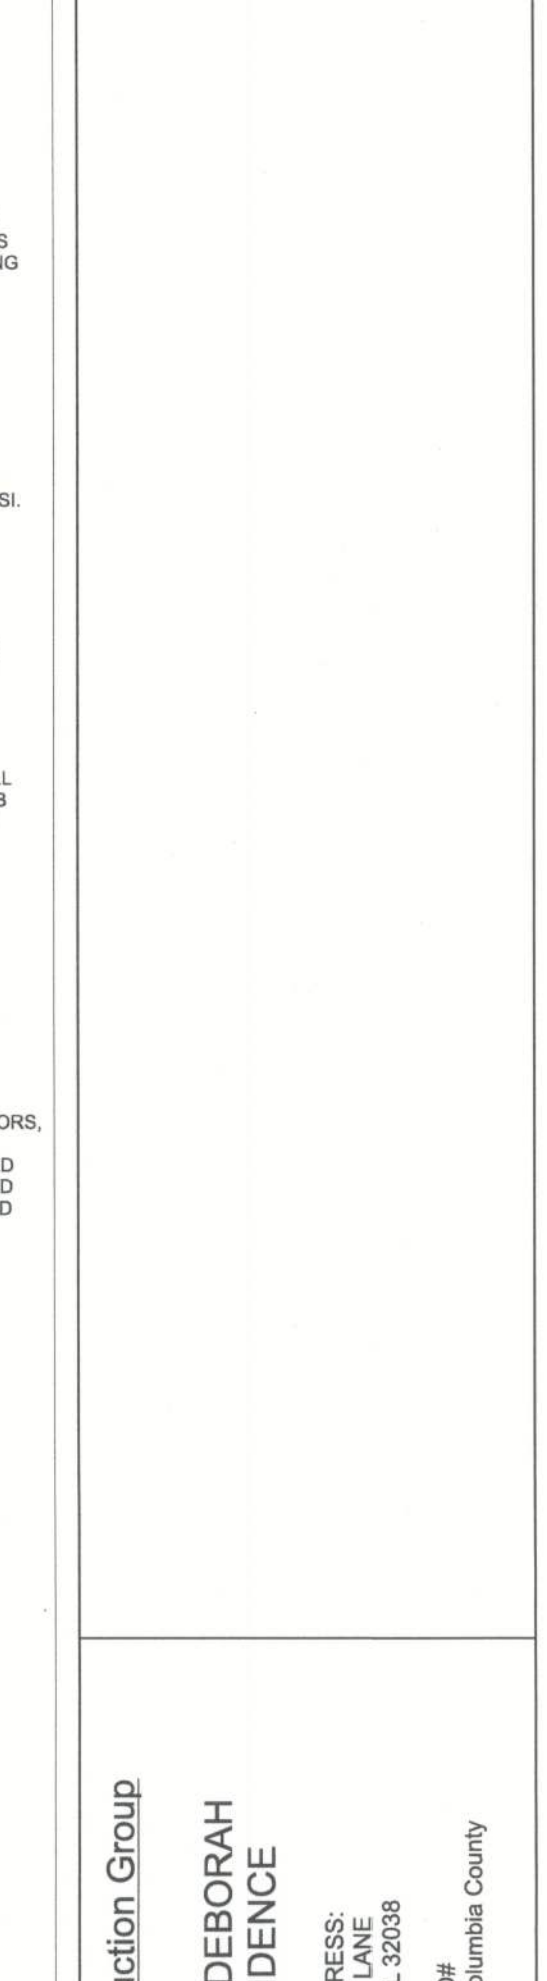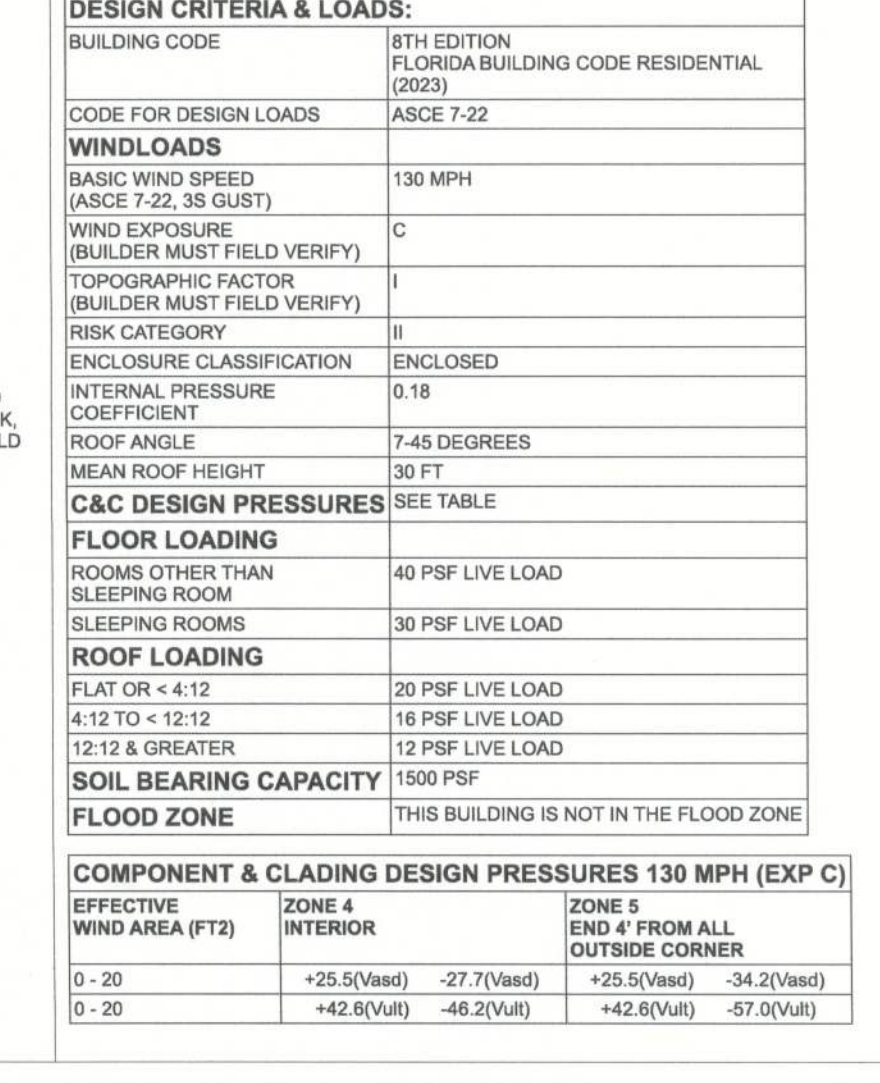

(TYP.) GABLE BRACING DETAIL WOOD FRAME

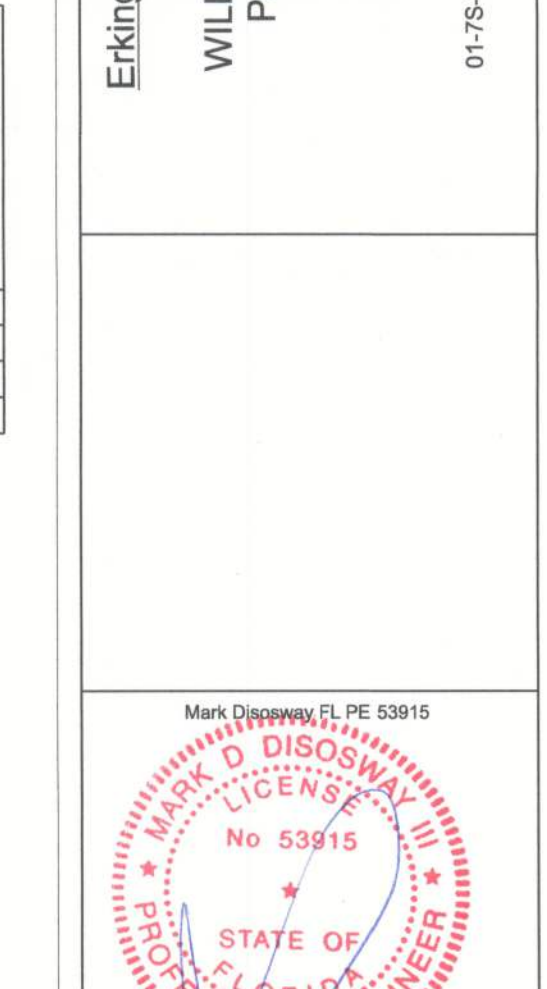

(TYP.) INTERSECTING WALL FRAMING WOOD FRAME




TALL STEM WALL TABLE:							
The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16"OC vertically or a horizontal bond beam with #5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.							
STEM WALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 8" CMU STEM WALL (INCHES O.C.)		VERTICAL REINFORCEMENT FOR 12" CMU STEM WALL (INCHES O.C.)			
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48


MASONRY NOTE:
MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.

ACI 530.1-02 Section	Specific Requirements
1.4A Compressive strength	8" block bearing walls F _m = 1500 psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, admixtures require approval
2.3 CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"
2.4 Reinforcing bars, #3 - #11	ASTM 615, Grade 40, F _y = 40 ksi, Lap splices min 40 bar dia. (25" for #5)
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A525, Class C60, 0.60 oz/R ² or 30MSS
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class B2, 1.50 oz/R ² or 30MSS
3.3.E.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.

BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL

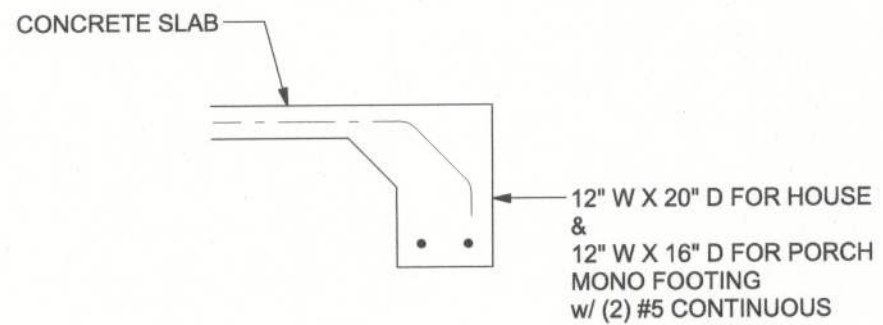

F1 S-2 OPTIONAL MONOLITHIC FOOTING
SCALE: 1/2" = 1'-0"

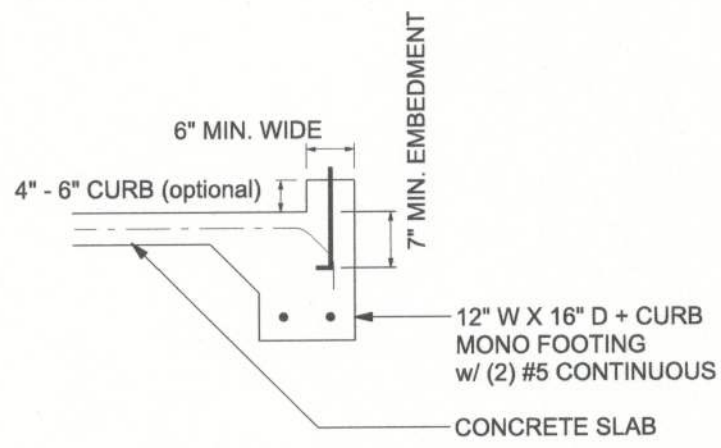


F4 S-2 OPTIONAL MONOLITHIC CURB FOOTING
SCALE: 1/2" = 1'-0"

FOUNDATION PLAN


SCALE: 1/4" = 1'-0"

FOUNDATION NOTES


- FN - 1 DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, STEP DOWNS, ETC. DISOWAY DESIGN GROUP OR MARK DISOWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
- FN - 2 CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING WALLS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN.
- FN - 3 THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ 6X6-1.41-A WELDED WIRE MESH PLACED ON CHAIRS @ 1 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLY TAPE OVER TERMITES-TREATED & COMPACTED FILL (ALSO, ANY OTHER CODE APPROVED TERMITES-TREATMENT METHOD CAN BE USED INSTEAD)

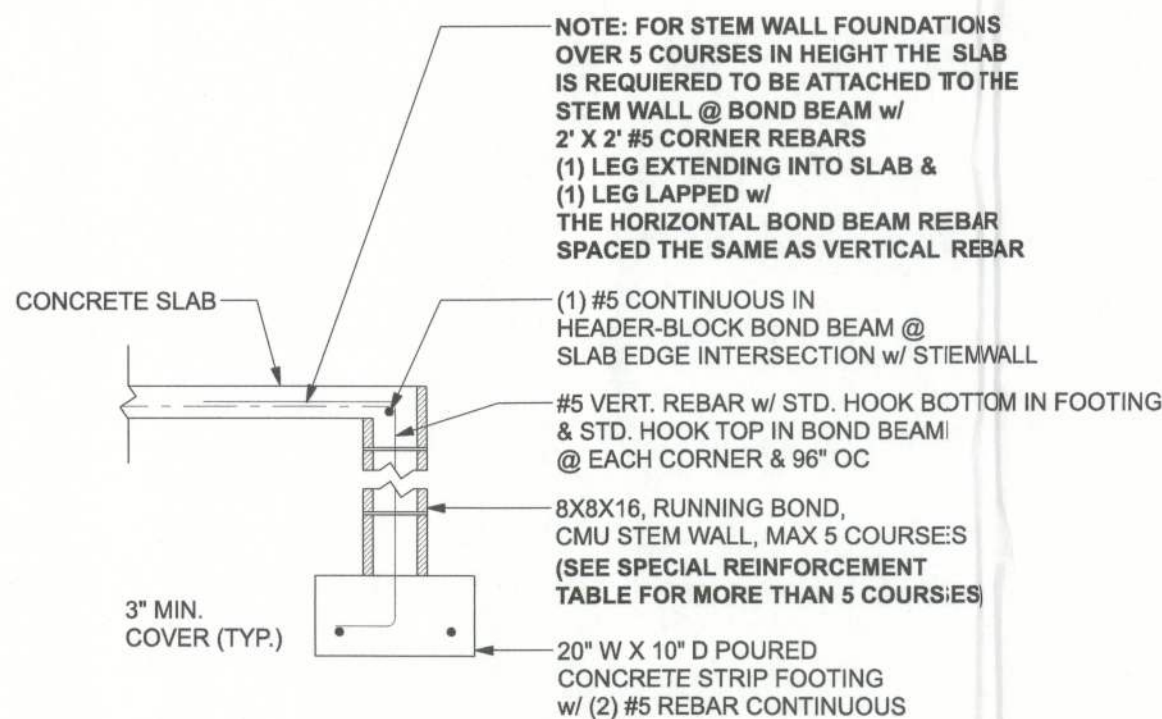

F1 S-2 STEM WALL FOOTING
SCALE: 1/2" = 1'-0"

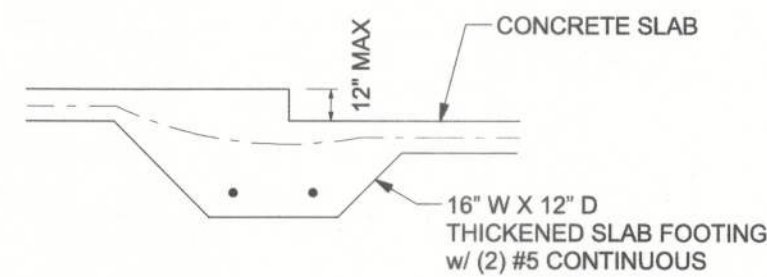


F3 S-2 INTERIOR BEARING STEP FOOTING
SCALE: 1/2" = 1'-0"

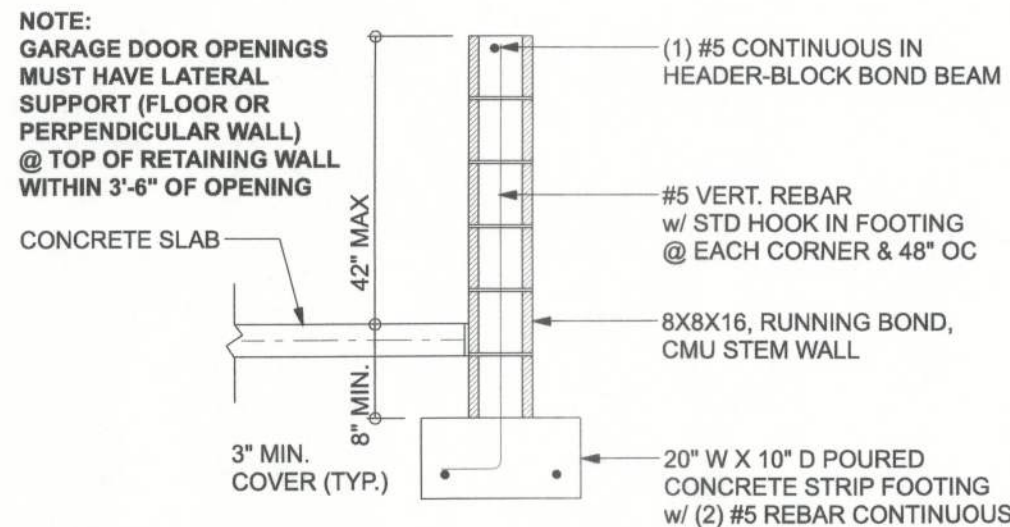


F4 S-2 STEM WALL CURB FOOTING
SCALE: 1/2" = 1'-0"

CAN USE FOUNDATION DETAIL F1 IN PLACE OF F4

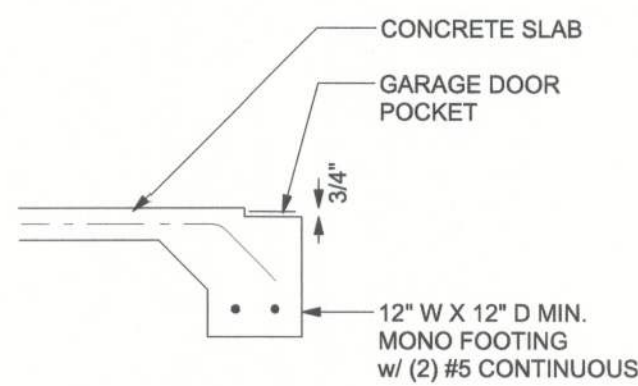

F5 S-2 GARAGE DOOR POCKET FOOTING
SCALE: 1/2" = 1'-0"

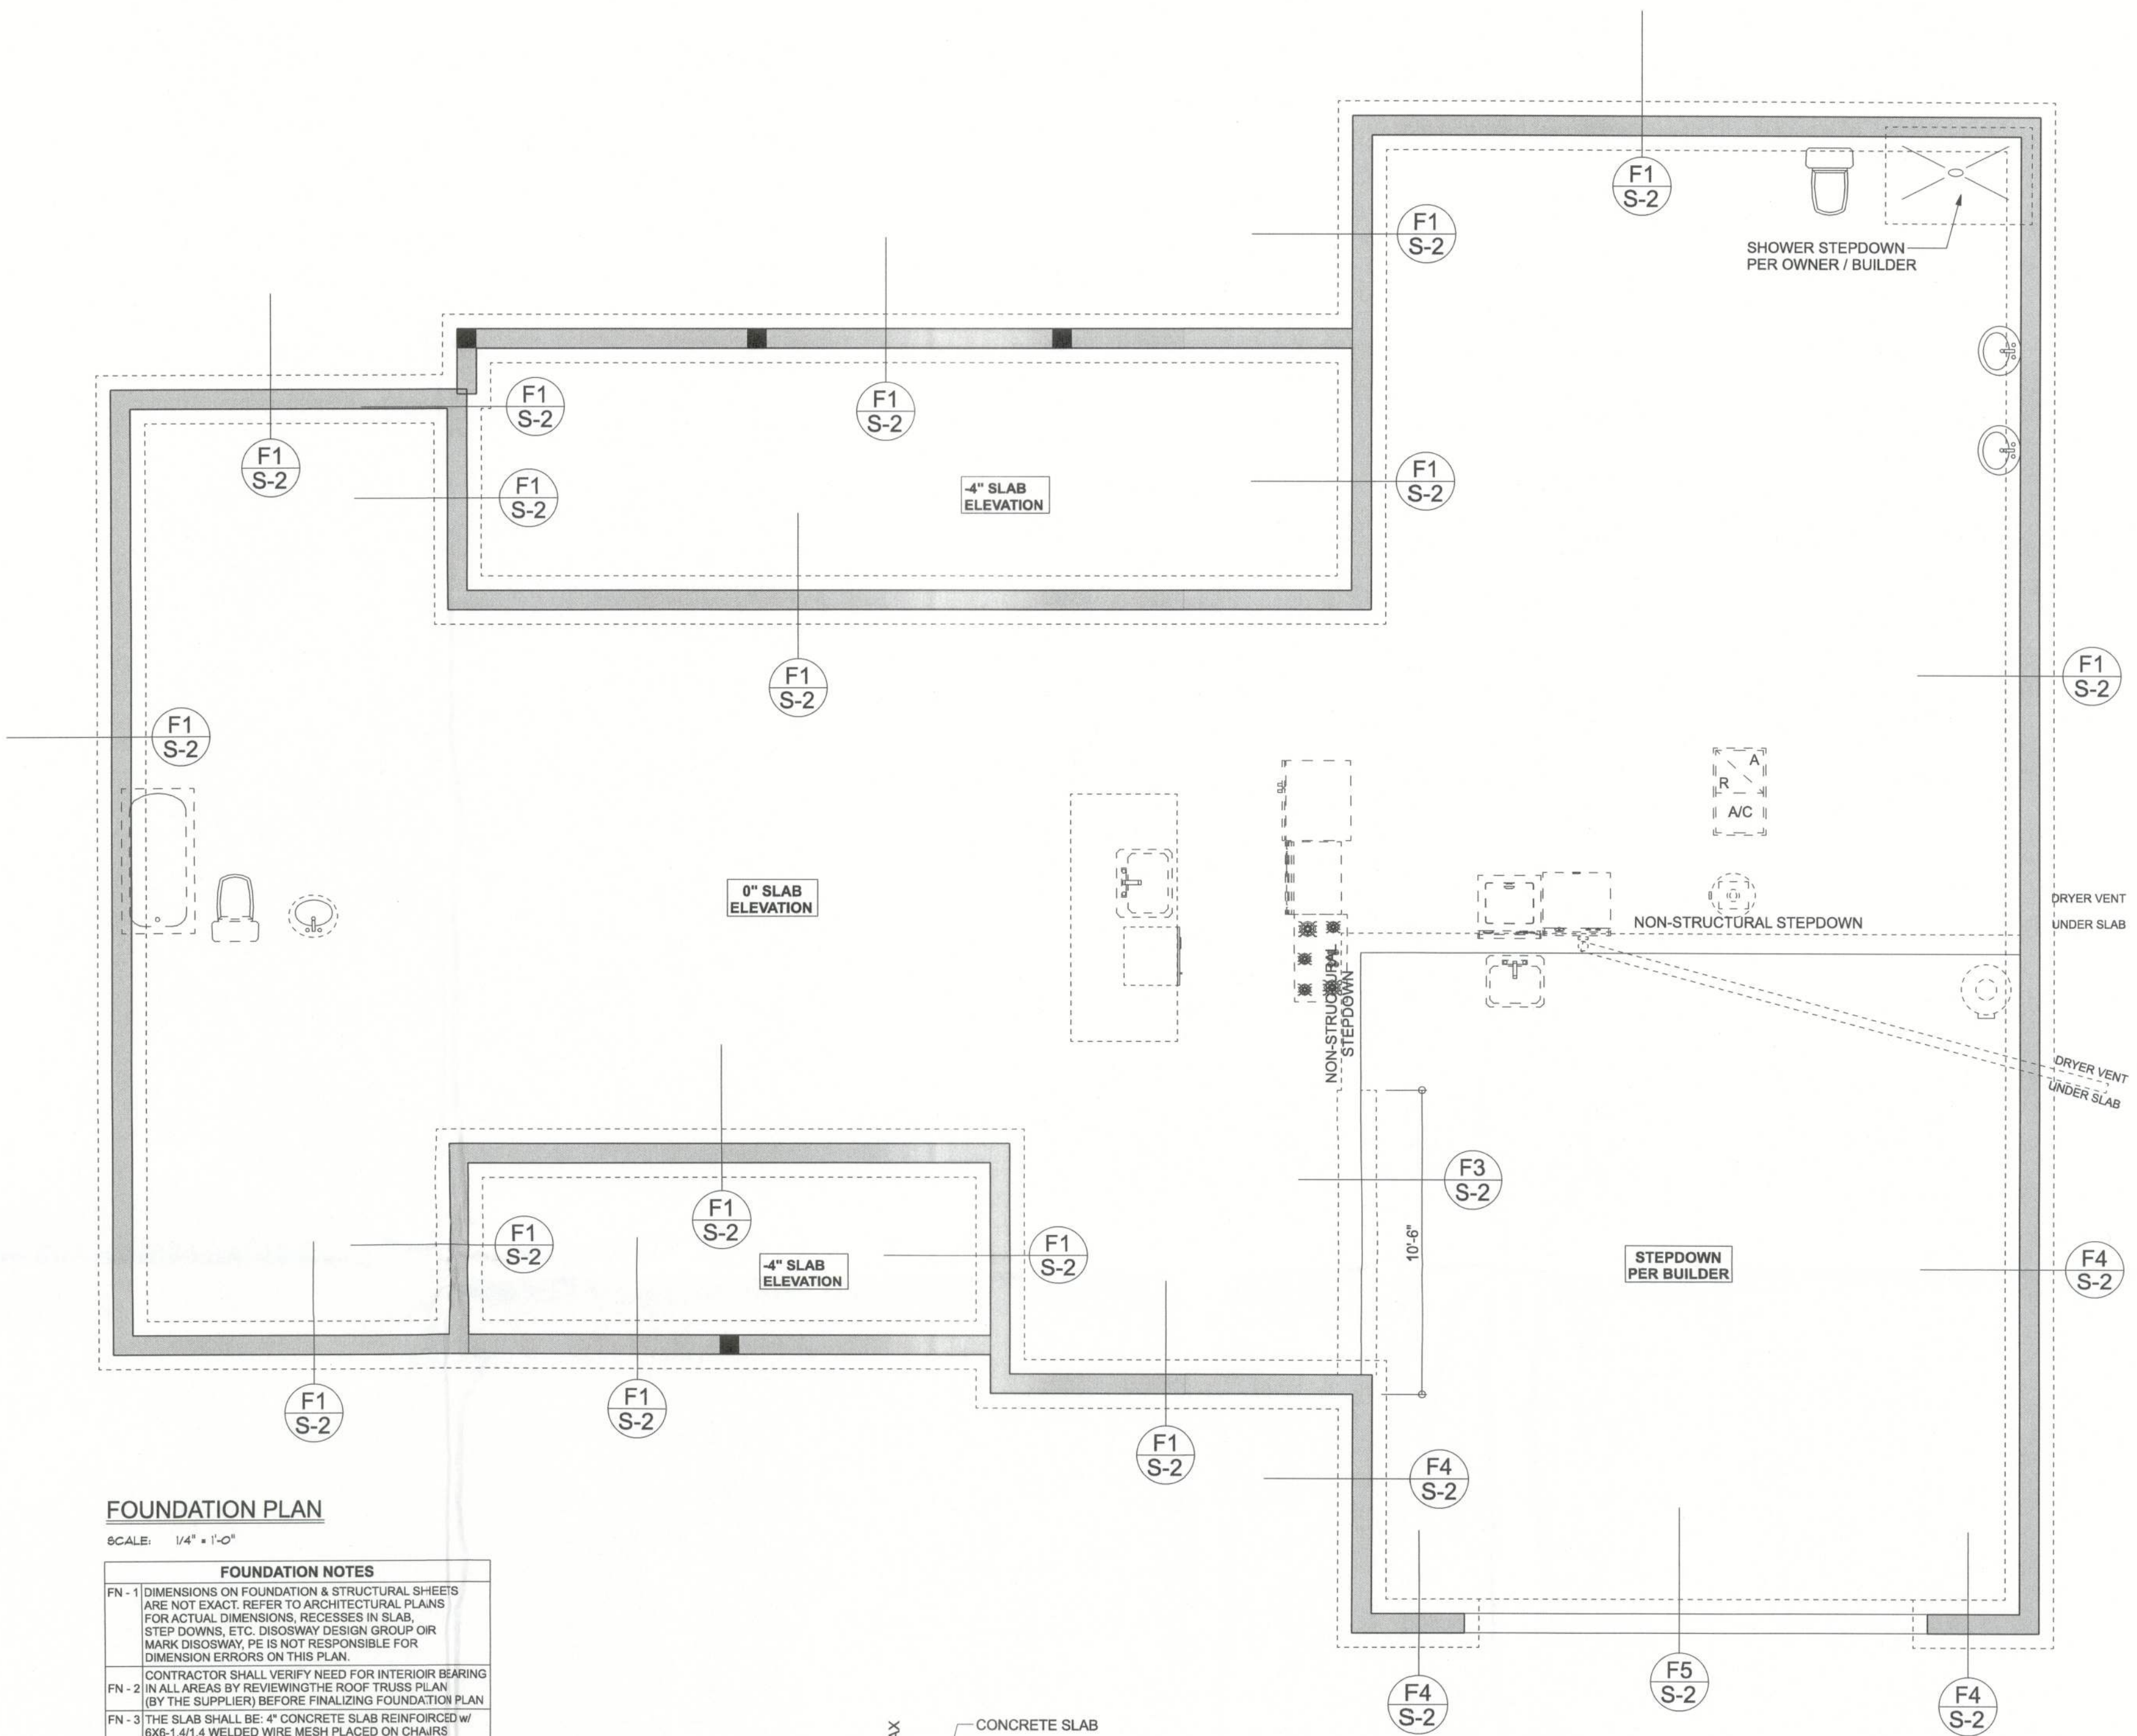

Erkinger Construction Group

WILLIAM AND DEBORAH
PERRI RESIDENCE

PROJECT ADDRESS:
115 SW HAWK LANE
FORT WHITE, FL 32038

PARCEL ID#

01-7S-16-0104-131, Columbia County

Mark Disoway FL PE 53915



Wednesday, September 18, 2024

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 8th Edition Florida Building Code Residential (2023) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
240961

S-2
OF 3 SHEETS

