




NOTE:
IT IS THE RESPONSIBILITY OF THE STATE LICENSED CONTRACTORS TO VERIFY ALL DIMENSIONS, CODES AND REGULATIONS WITH THE LOCAL AND STATE AUTHORITIES HAVING JURISDICTIONS.

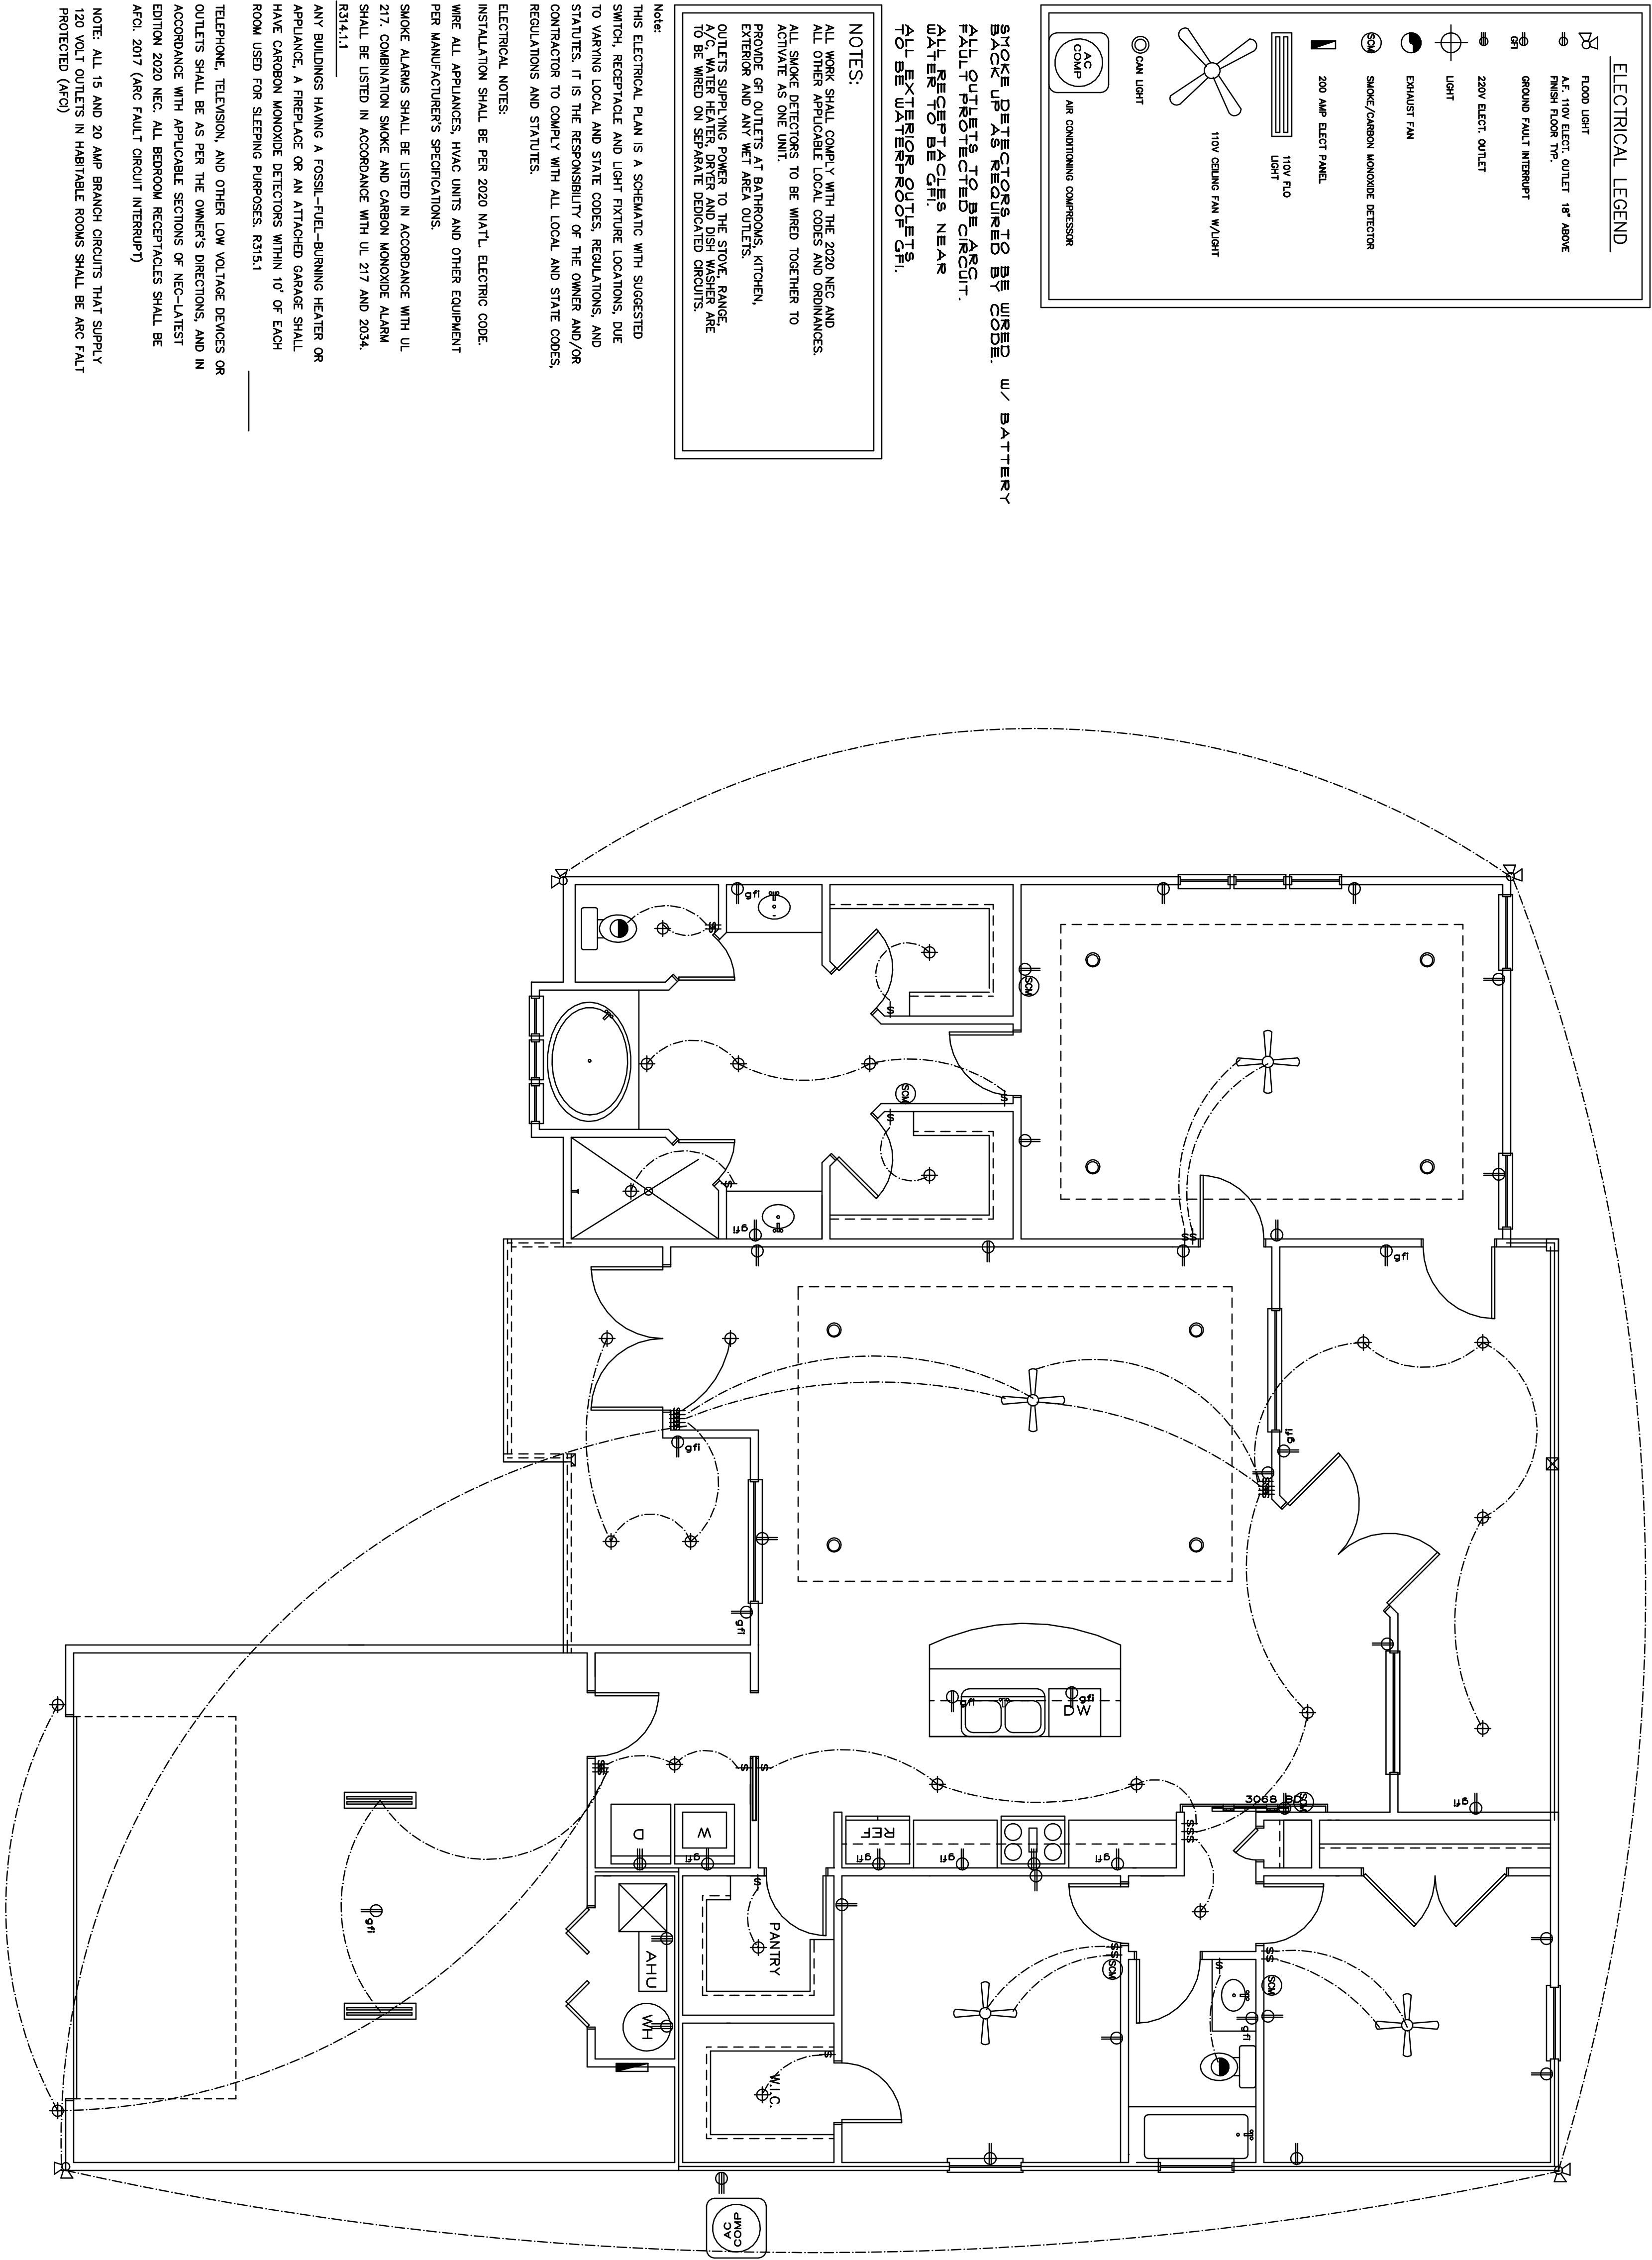


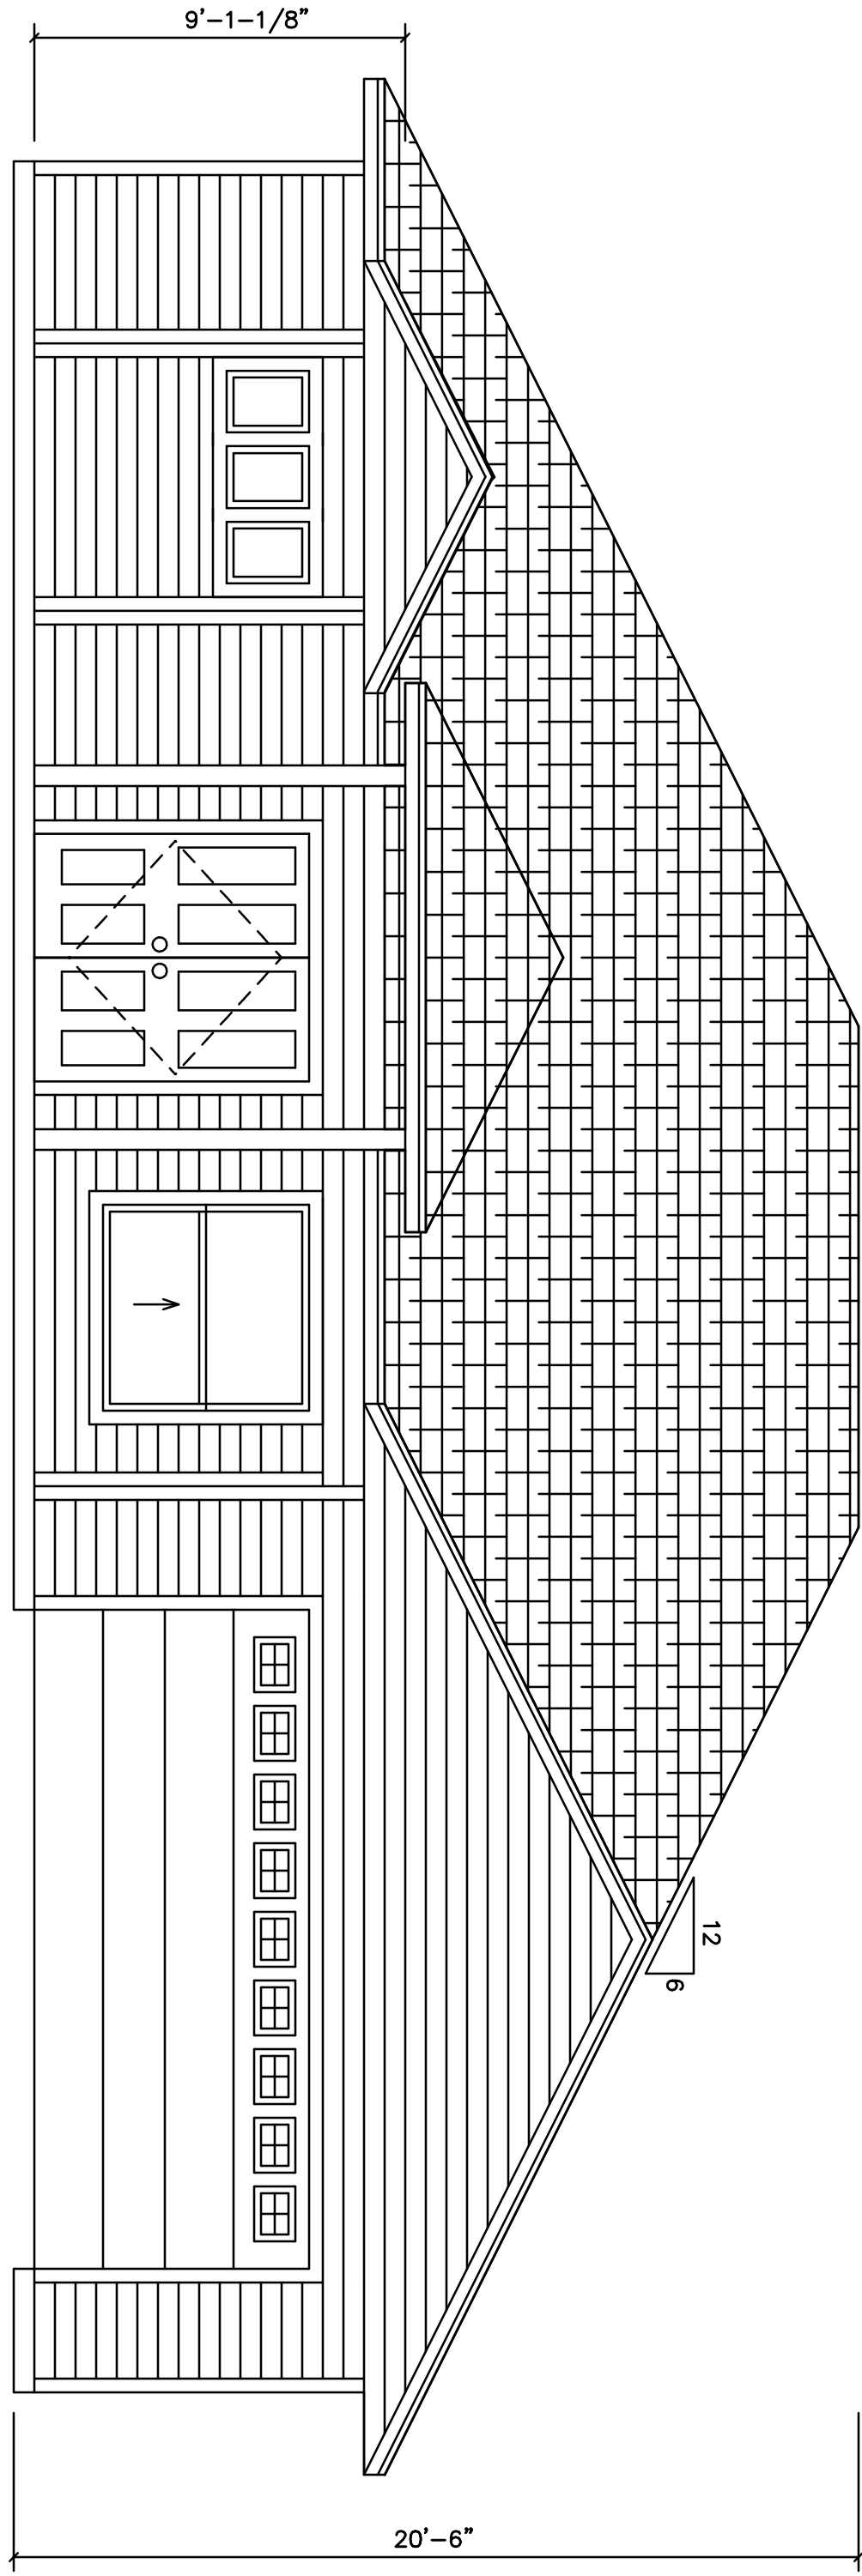


FRONT ELEVATION

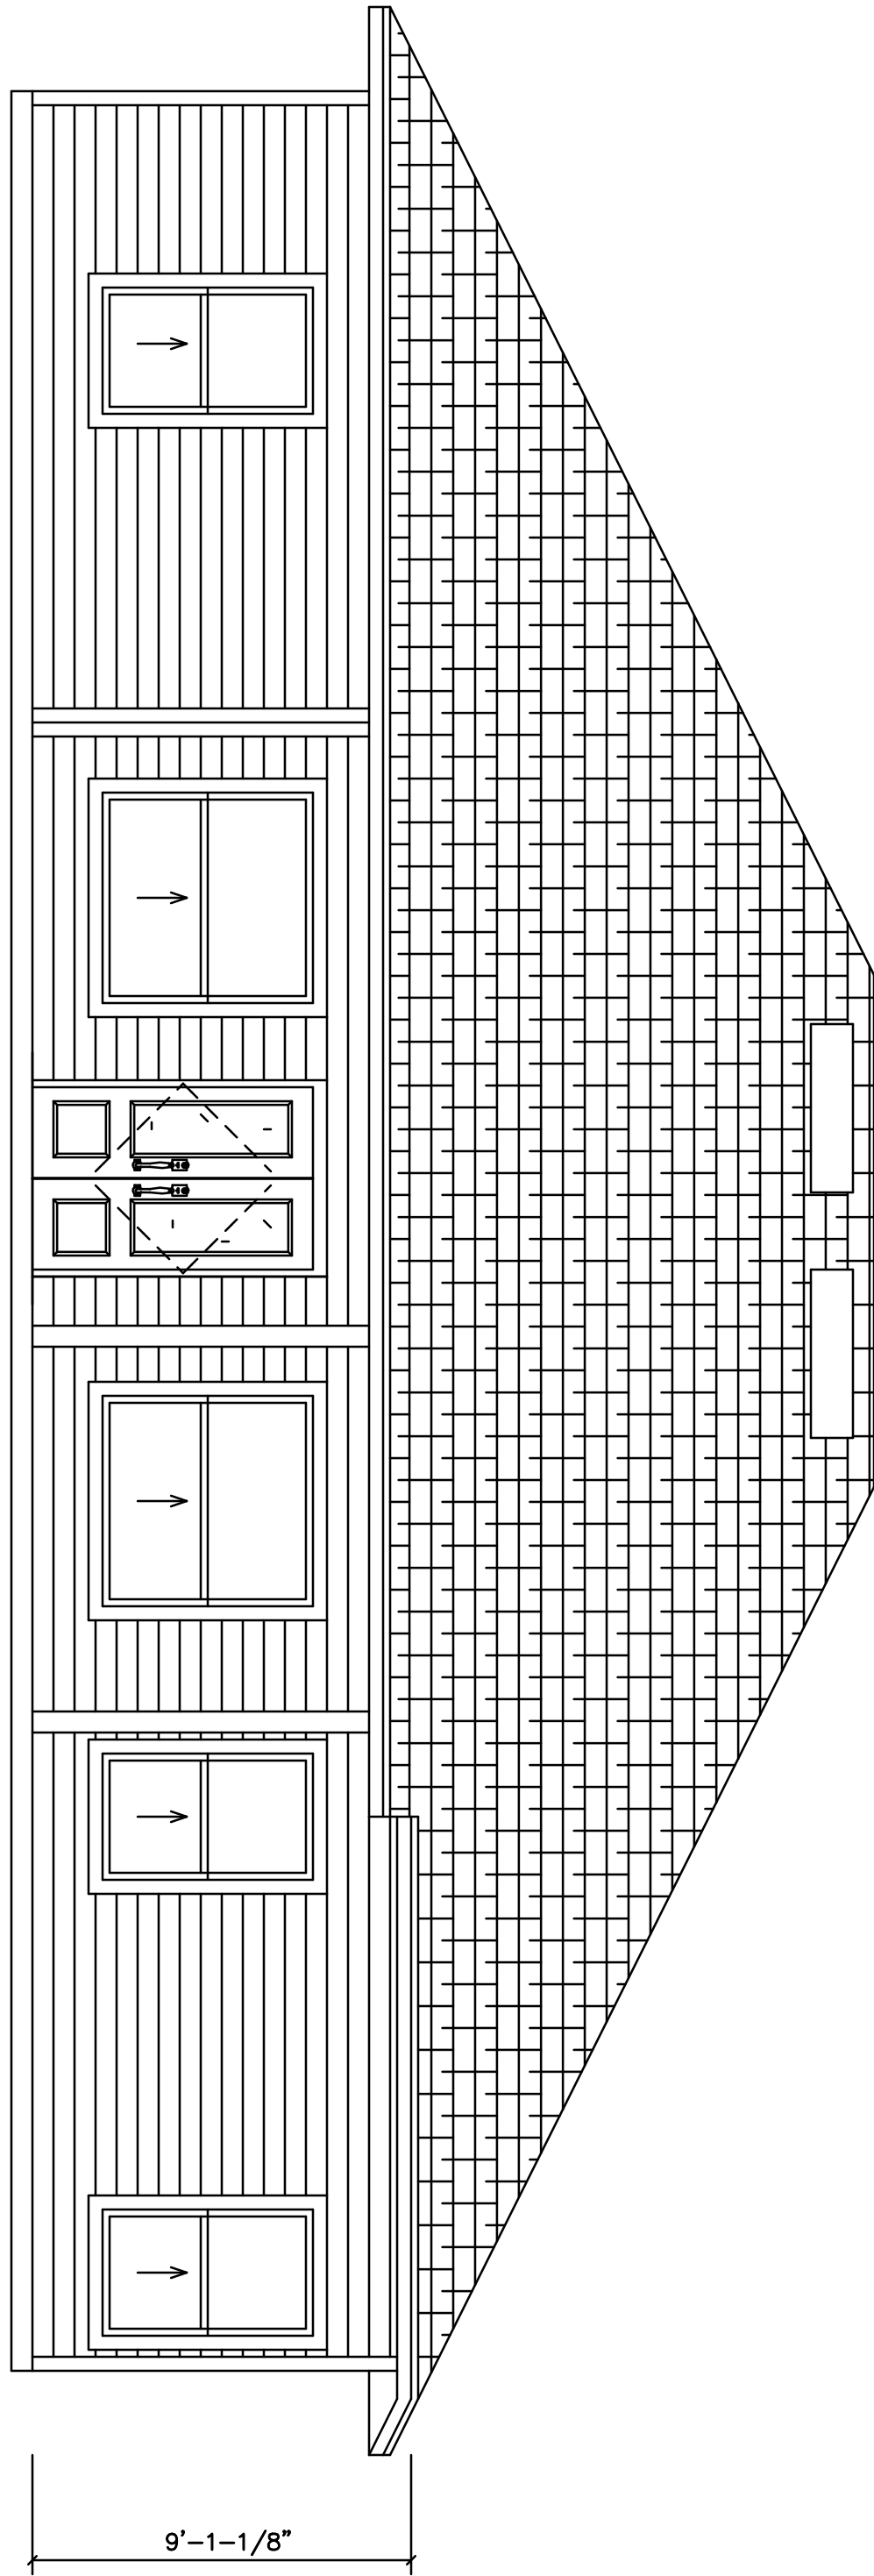

REAR ELEVATION

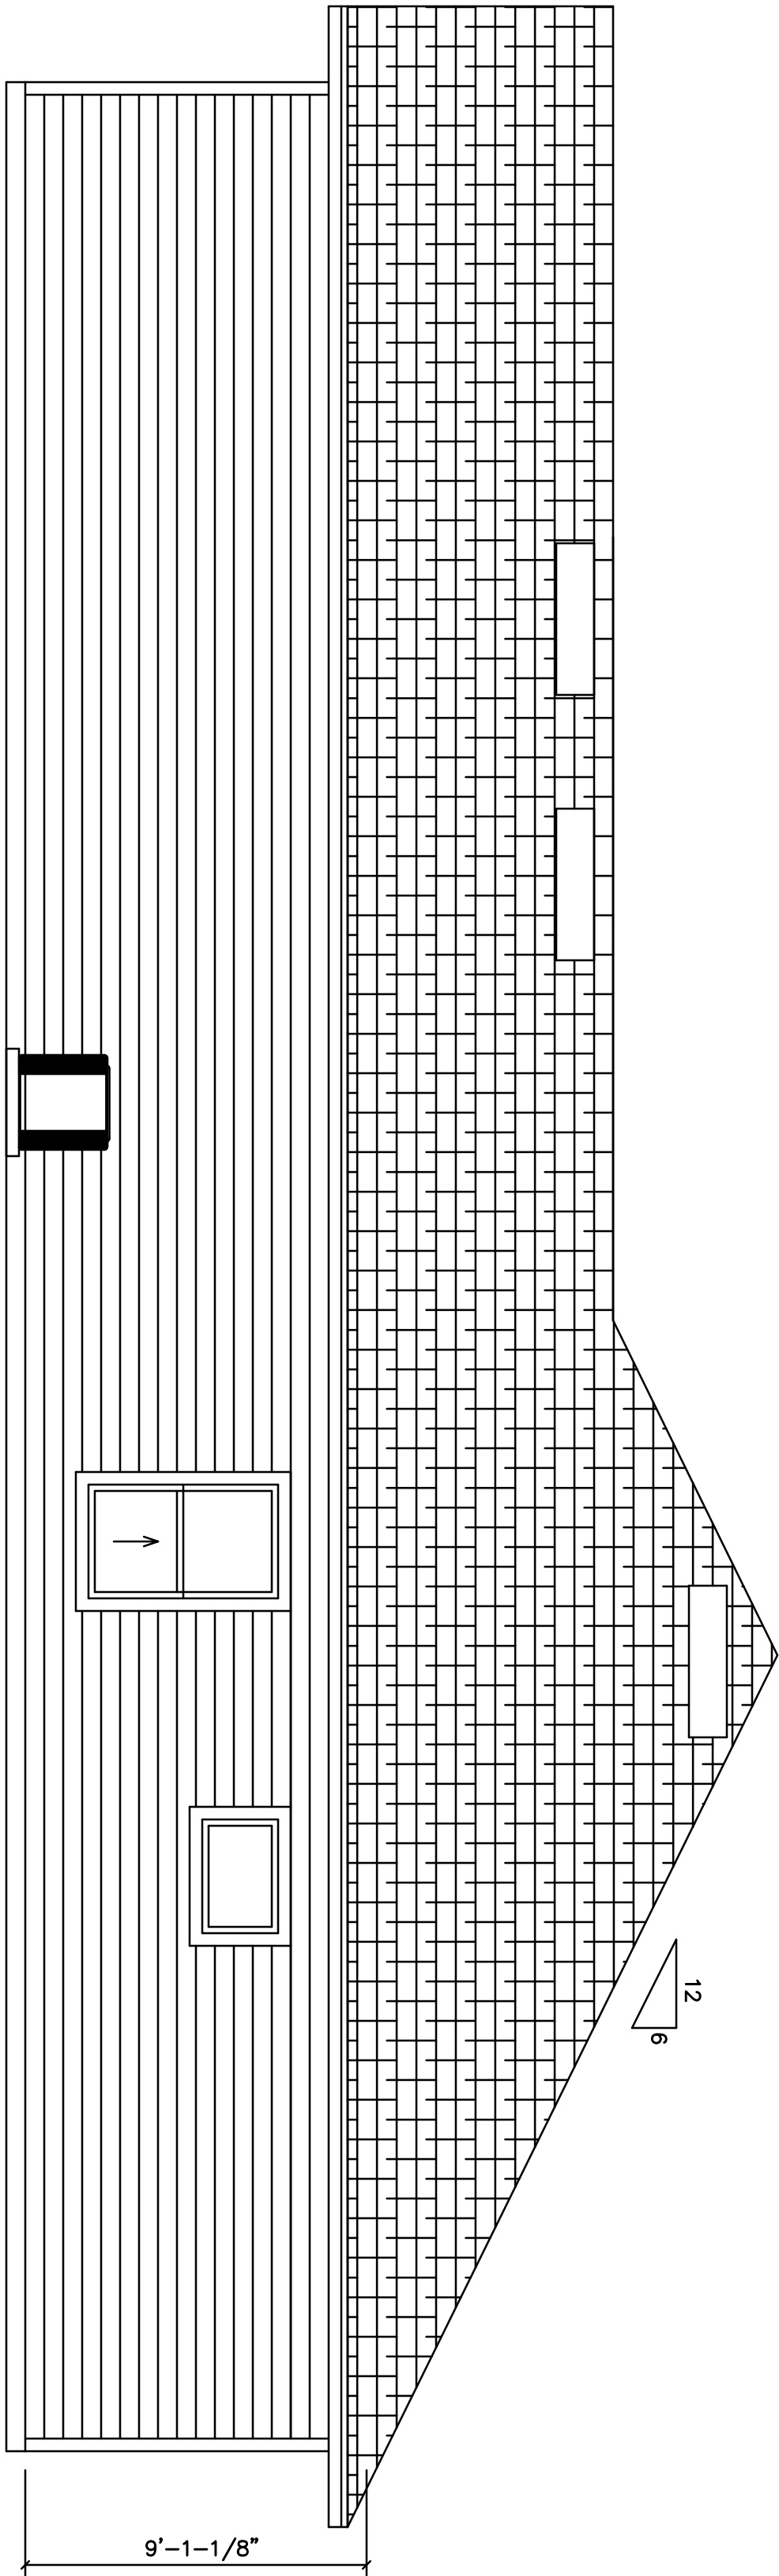

RIGHT ELEVATION

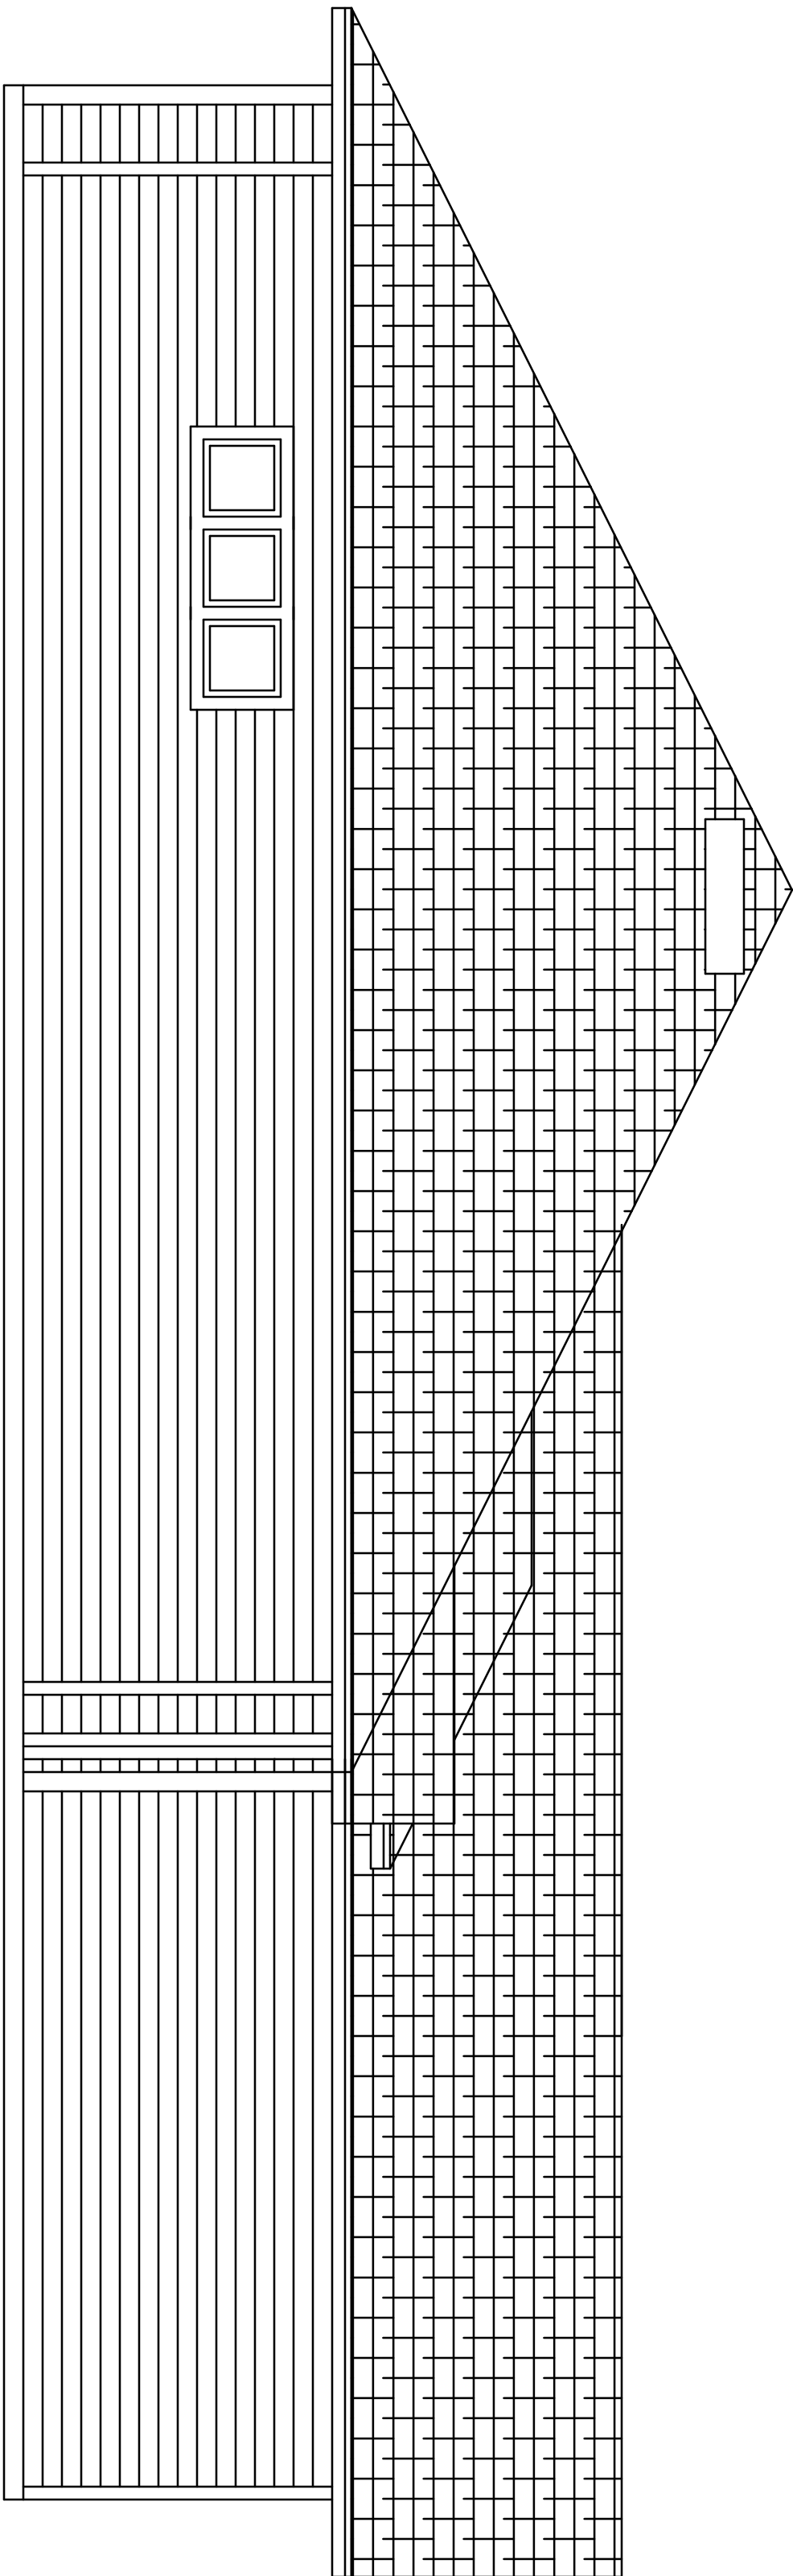

LEFT ELEVATION

NOTE:
IT IS THE RESPONSIBILITY OF THE STATE LICENSED
CONTRACTORS TO VERIFY ALL DIMENSIONS, CODES
AND/ORIES HAVING JURISDICTIONS.



ELEVATIONS


SCALE: 1/4"=1'-0"

LOT 23 \ THORNWOOD
284 S.W. THISTLEWOOD LANE
FORT WHITE, FLORIDA


DWC CONTRACTING
30 NE SANTA FE BLVD
HIGH SPRINGS FLORIDA
(386) 454-1730

ALL DOORS AND WINDOWS TO BE
INSTALLED WITH MANUFACTURERS
ATTACHED WORKSHEETS AND MUST
BE SUBMITTED WITH PERMITS AND
SUBMIT PRODUCT APPROVALS WITH
PERMIT DOCUMENTS.

WALL SECTION

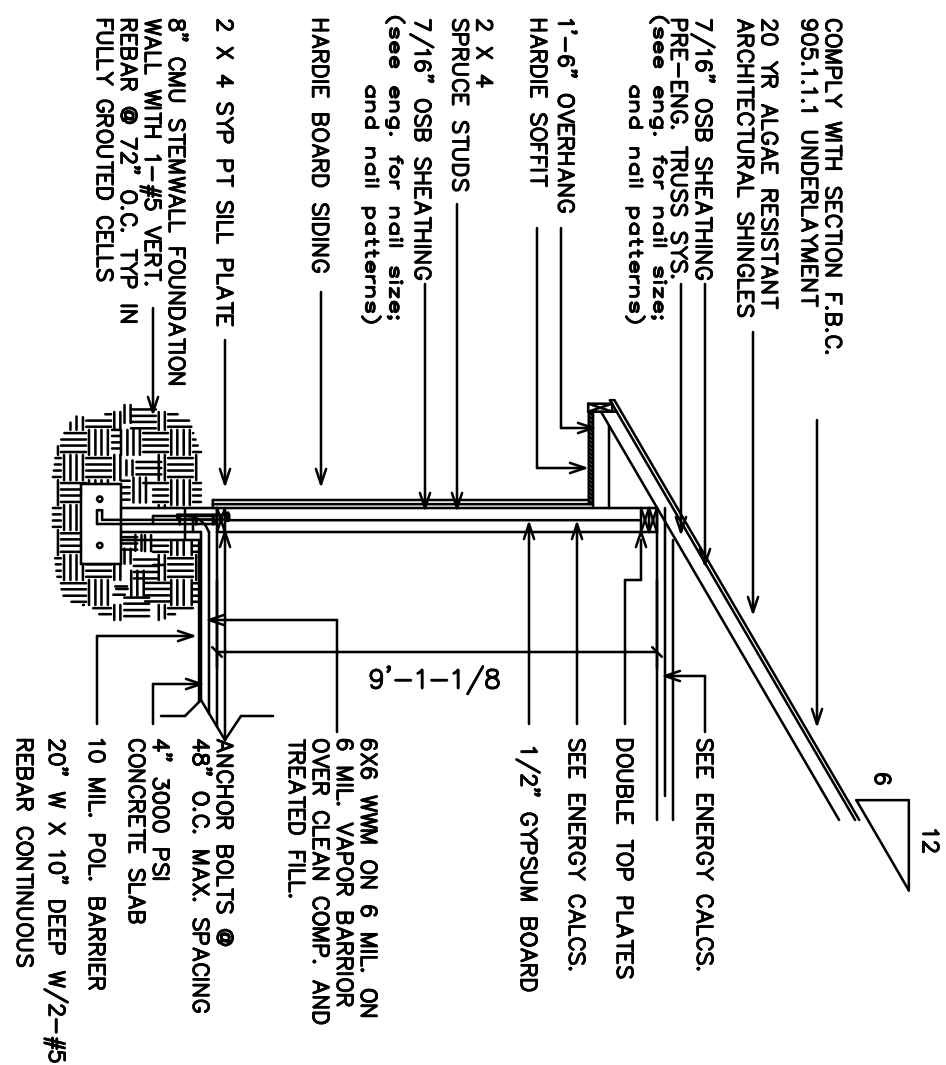

SEE SIGNED AND SEALED TRUSS ENGINEERING FOR
REQUIRED ANCHORAGES FROM TRUSS TO TOP PLATE
AND BRACING SYSTEM TO BE INSTALLED

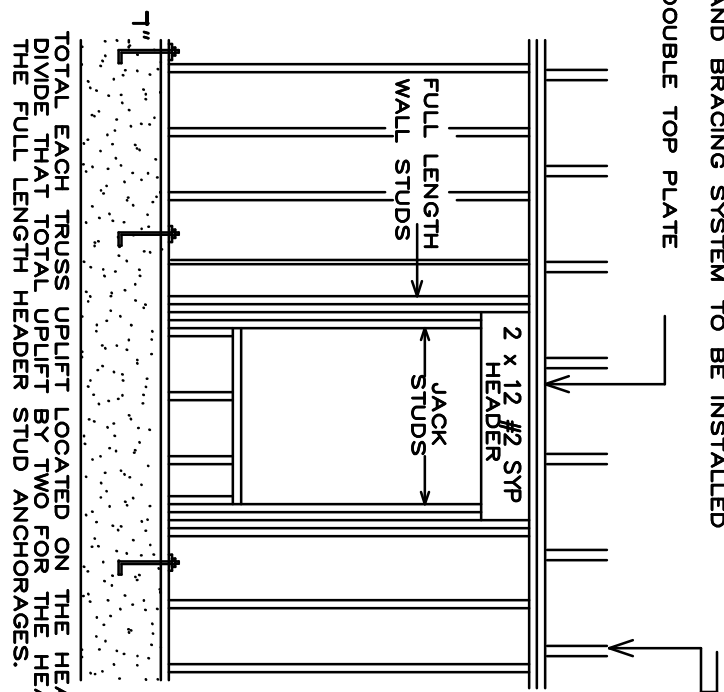

ALL HEADERS TO BE (2) PLY 2 X 12 #2 SYP
SCHEDULE #1'S OR WINDCO. IN THE HEADER
IN A STAGGERED PATTERN


HEADER SPAN (Feet)	MAXIMUM STUD SPACING (Inches) (per Table R602.3(3))
14	24
16	1
18	2
20	3
22	4

CODE STATEMENT:
CODE REQUIREMENTS IN EFFECT AT THE TIME OF DESIGN:
2023 FLORIDA RESIDENTIAL BUILDING CODE(6TH EDITION)

HEADER SCHEDULE

HEADER I.D.	HEADER SIZE	QTY
H-1	(2) PLY 2 X 12 #2 SYP HEADER	1
H-2	(2) PLY 2 X 12 #2 SYP HEADER	12
H-3	(2) PLY 2 X 12 #2 SYP HEADER	2
H-4	(2) PLY 2 X 12 #2 SYP HEADER	2
H-5	(2) PLY 2 X 12 #2 SYP HEADER	4
H-6	(2) PLY 2 X 12 #2 SYP HEADER	2
H-7	(2) PLY 2 X 12 #2 SYP HEADER	2
H-8	(2) PLY 2 X 12 #2 SYP HEADER	1
H-9	(2) PLY 2 X 12 #2 SYP HEADER	1
H-10	SYP = 750 F.B. / 1,400,000 M.E.	

NOTE:
THE RESPONSIBILITY OF THE STATE LICENSED
DESIGN PROFESSIONAL ENGINEER AND ARCHITECT
AND STRUCTURAL DESIGNERS TO COMPLY WITH ALL
APPLICABLE BUILDING DEPARTMENT AND
ADHERES TO ALL APPLICABLE BUILDING DEPARTMENT

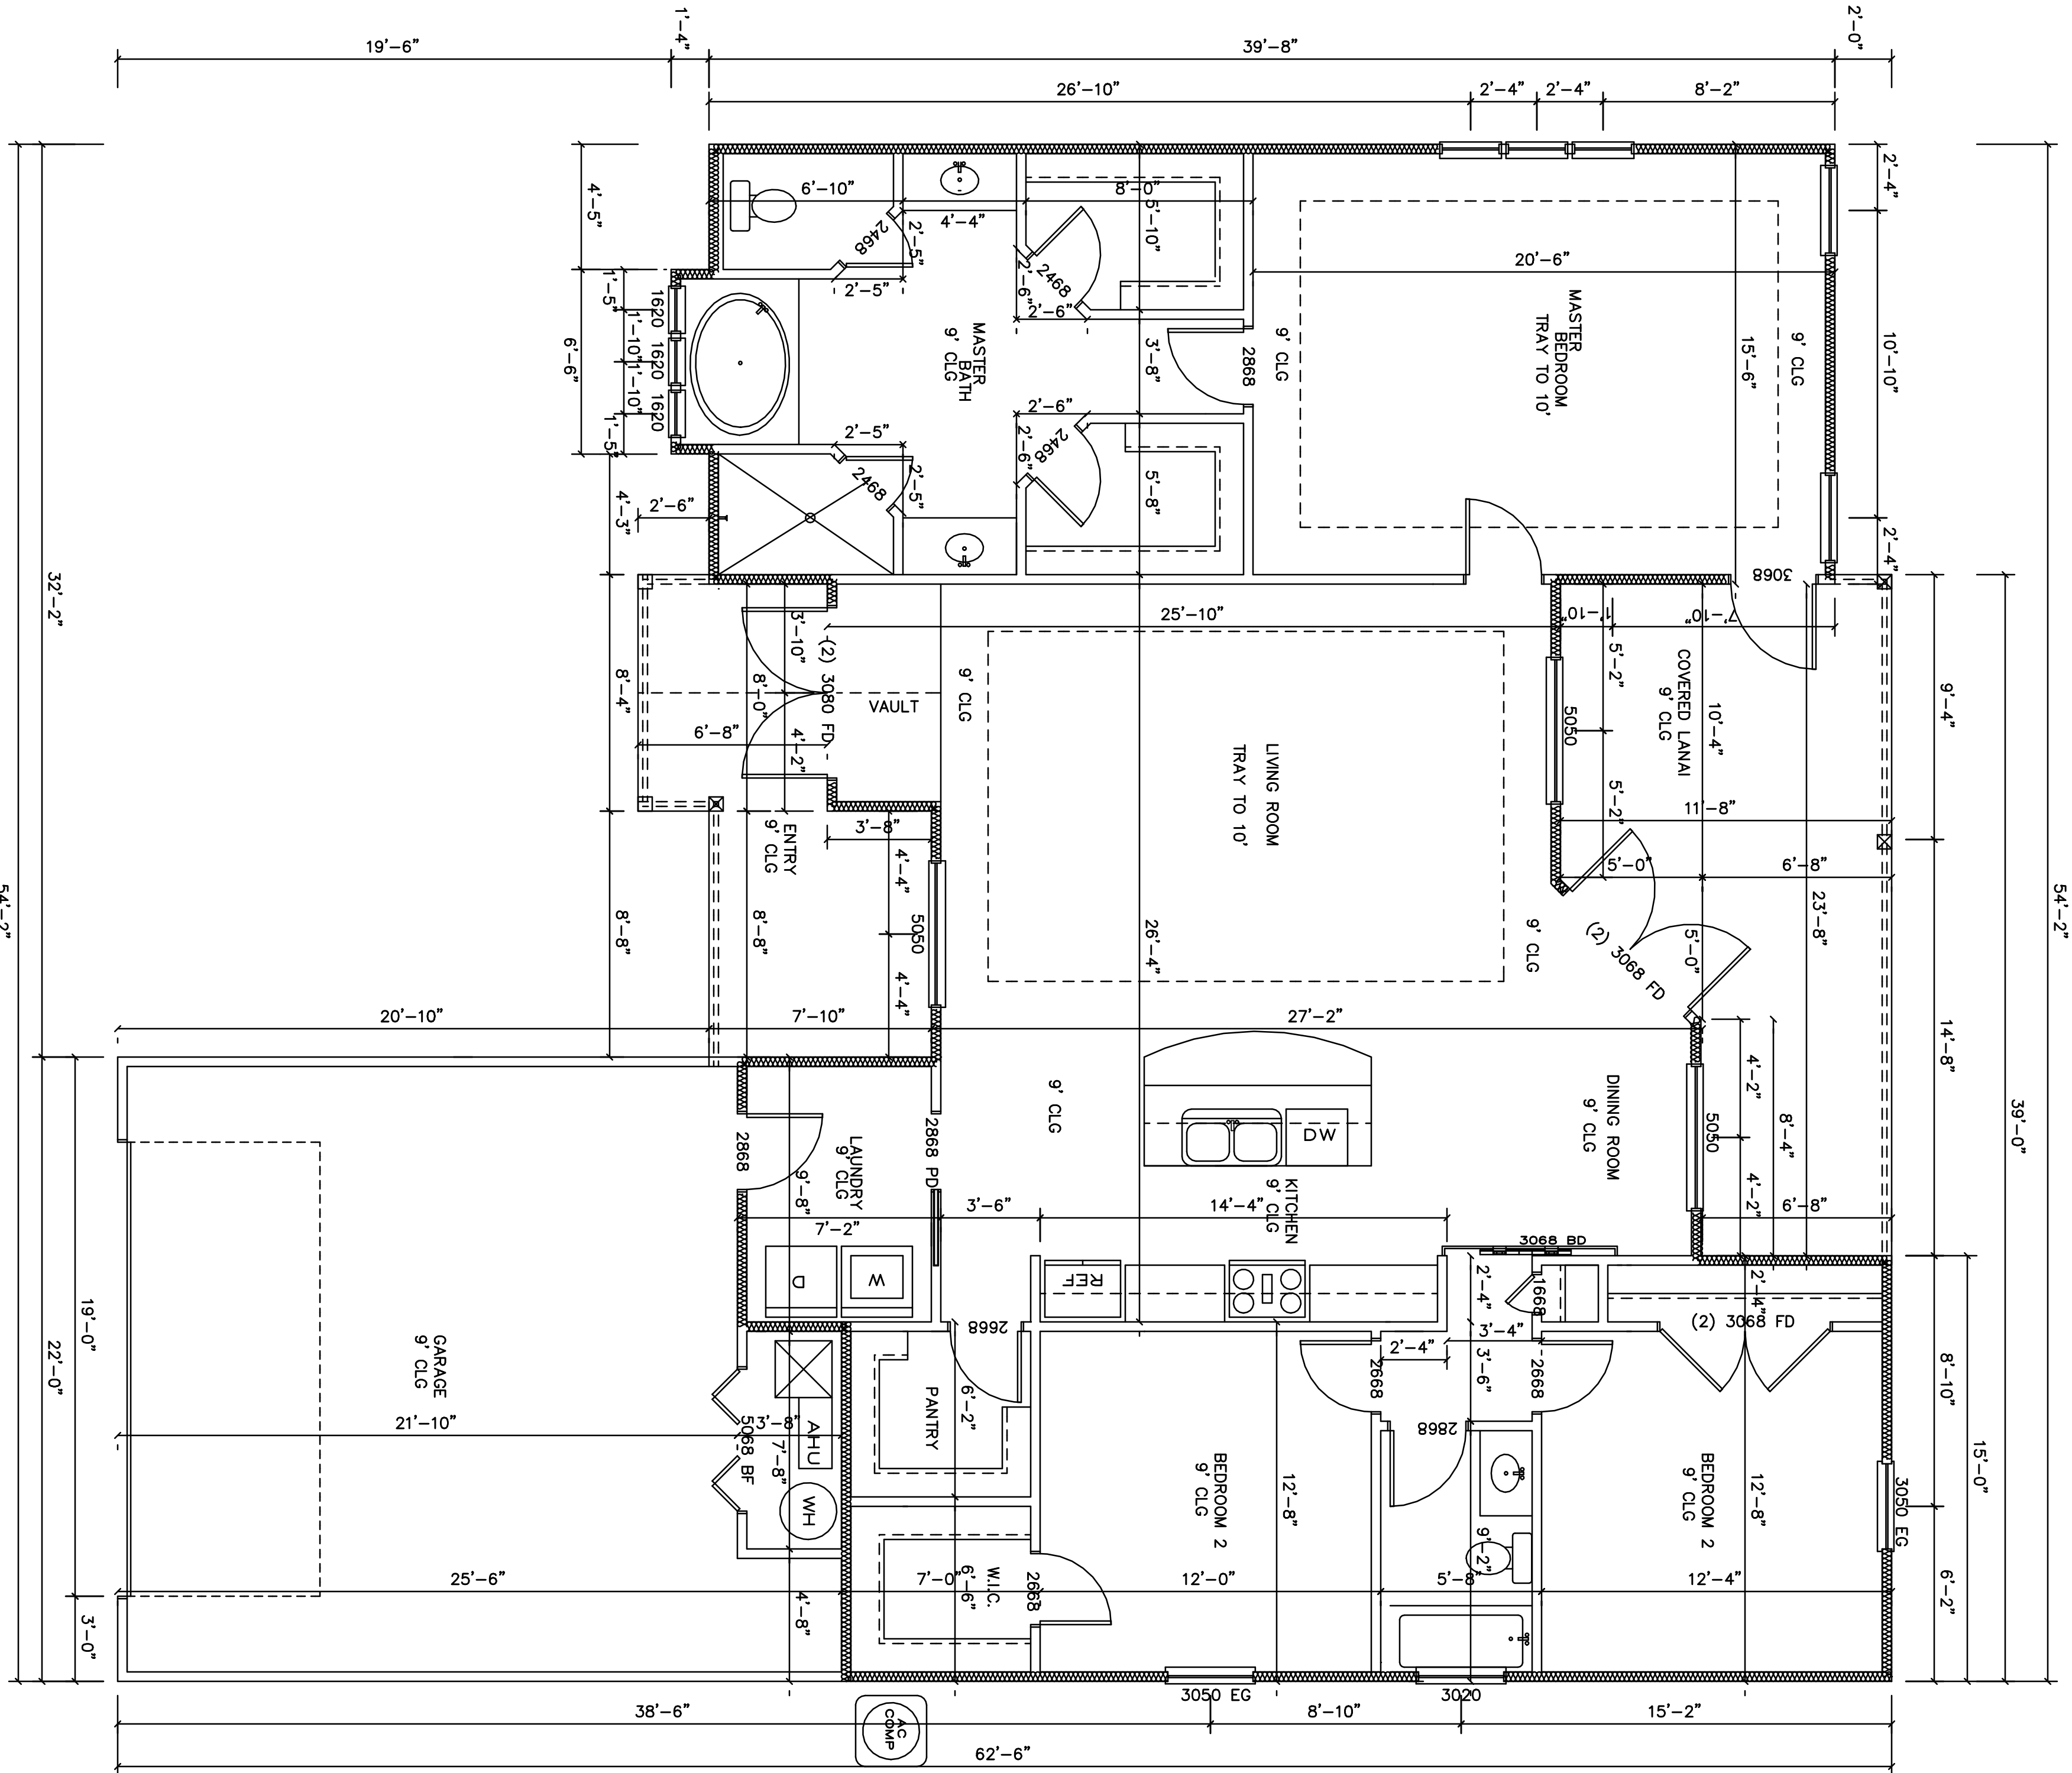


FLOOR PLAN

SCALE: 1/4"=1'-0"
11/9/17
2/17/20
09/09/2024

LIVING AREA	1843
FRONT ENTRY	125
COVERED LANAI	222
GARAGE	526
TOTAL AREA	2716

LOT 23 \ THORNWOOD
284 S.W. THISTLEWOOD LANE
FORT WHITE, FLORIDA

DWC CONTRACTING
30 NE SANTA FE BLVD
HIGH SPRINGS FLORIDA
(386) 454-1730



10" DEEP MIN. #5 REBAR CONTINUOUS.


4" 3000 PSI CONCRETE SLAB WITH 6" X 8" WWM OR FIBER MESH

6 MIL VAPOR BARRIER


CLEAN COMPACTED TERMITES TREATED FILL

1500 SOIL BEARING PRESSURE MINIMUM

TYPICAL CMU STEMWALL FOOTING

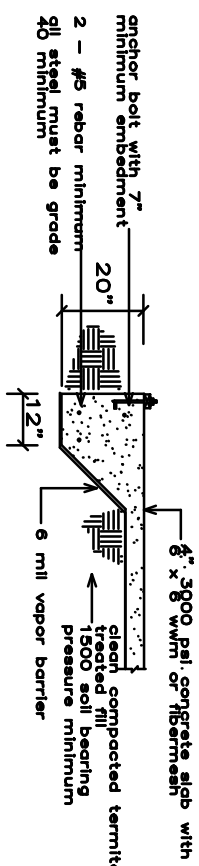

typical monolithic footing

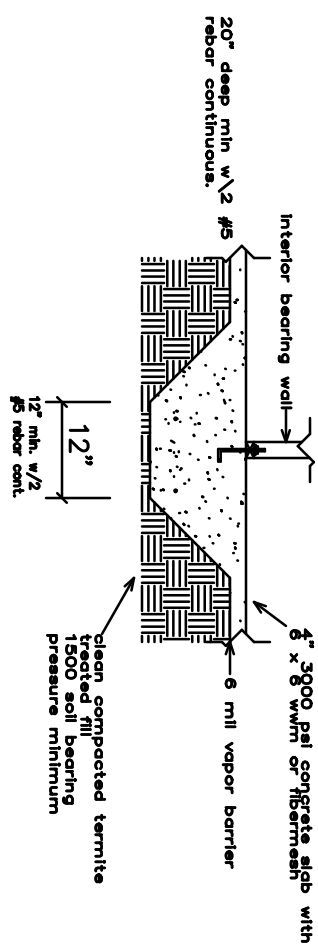


1/2" X 8" ANCHOR BOLTS WITH 2 X 2 X .140" STEEL WASHER AT EACH END OF SEGMENT AND AT 48" O.C.


REFER TO WINDLOAD ANALYSIS FOR ANCHOR BOLT SPECIFICATION


2 X 4 P.T. SYP #2 SILL PLATE

(2) #5 REBAR CONTINUOUS

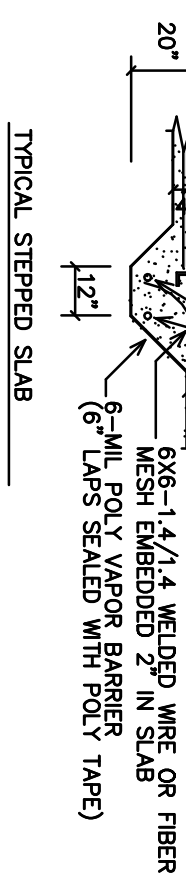

DESIGN CRITERIA		
F.B.C.	RESIDENTIAL	2023
WIND LOAD DESIGN	ASCE T14	2023
PL. PLUMBING	F.B.C.	2023
FLOOR LIVE LOAD	40 P.S.F.	2023
ROOF LIVE LOAD	20 P.S.F.	2023
PL. ELECTRICAL	NAT'L ELECT. CODE	2020
MECHANICAL	F.B.C.	2023

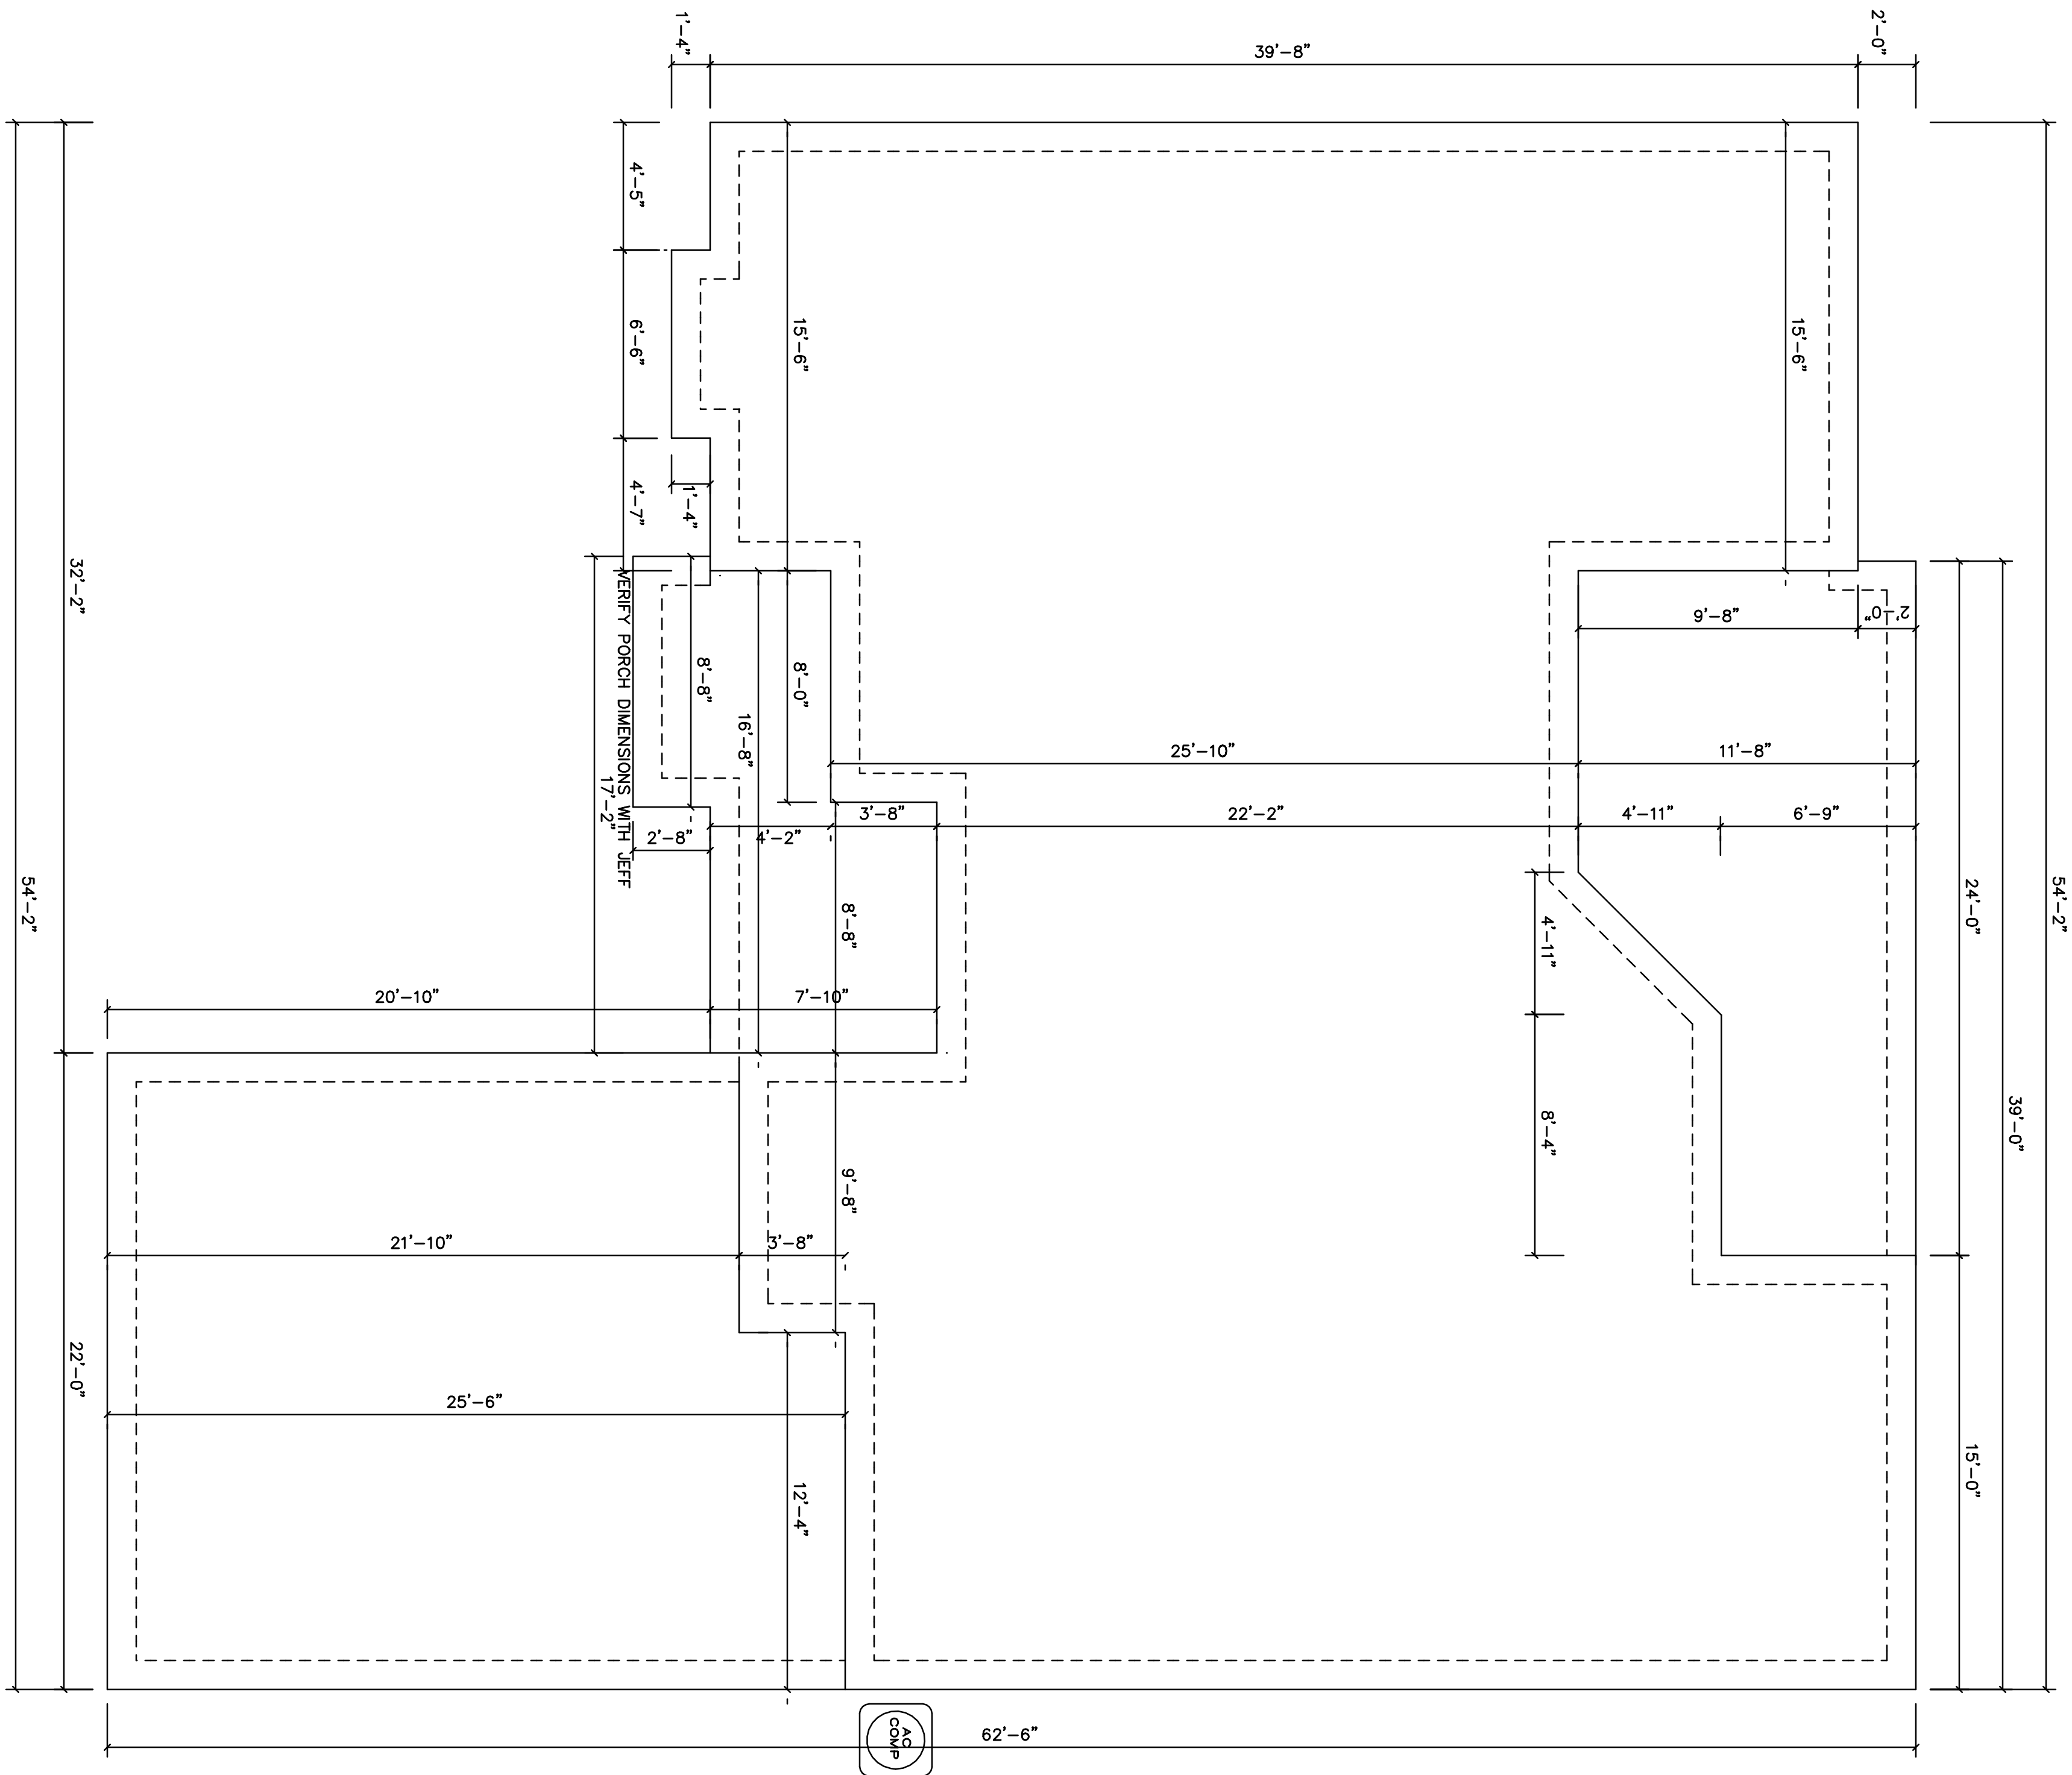

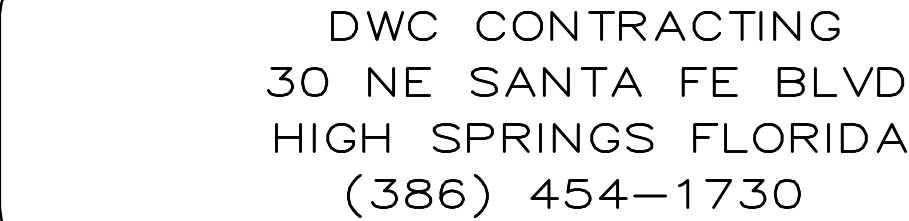

LOT 23 \ THORNWOOD
284 S.W. THISTLEWOOD LANE
FORT WHITE, FLORIDA

SCALE: 1/4"=1'-0"

