



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: WESTON_OAKS_LOT_53 - PAYNE

MiTek USA, Inc.

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:

Customer Info: BRUCE SCHAFER Project Name: PAYNE Model: .
Lot/Block: . Subdivision: .
Address: ., .
City: GAINESVILLE State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2020/TPI2014 Design Program: MiTek 20/20 8.4
Wind Code: ASCE 7-16 Wind Speed: 130 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 59 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T27911803	A01	6/3/22	23	T27911825	CJ04	6/3/22
2	T27911804	A02	6/3/22	24	T27911826	CJ05	6/3/22
3	T27911805	A03	6/3/22	25	T27911827	D01	6/3/22
4	T27911806	A04	6/3/22	26	T27911828	D02	6/3/22
5	T27911807	A05	6/3/22	27	T27911829	D03	6/3/22
6	T27911808	A06	6/3/22	28	T27911830	D3A	6/3/22
7	T27911809	A07	6/3/22	29	T27911831	G01	6/3/22
8	T27911810	A08	6/3/22	30	T27911832	G02	6/3/22
9	T27911811	A09	6/3/22	31	T27911833	G03	6/3/22
10	T27911812	B01	6/3/22	32	T27911834	G04	6/3/22
11	T27911813	B02	6/3/22	33	T27911835	G05	6/3/22
12	T27911814	B03	6/3/22	34	T27911836	H01	6/3/22
13	T27911815	B004	6/3/22	35	T27911837	H02	6/3/22
14	T27911816	B05	6/3/22	36	T27911838	J01	6/3/22
15	T27911817	C01	6/3/22	37	T27911839	J02	6/3/22
16	T27911818	C02	6/3/22	38	T27911840	J03	6/3/22
17	T27911819	C03	6/3/22	39	T27911841	J04	6/3/22
18	T27911820	C04	6/3/22	40	T27911842	J05	6/3/22
19	T27911821	C05	6/3/22	41	T27911843	J06	6/3/22
20	T27911822	CJ01	6/3/22	42	T27911844	J07	6/3/22
21	T27911823	CJ02	6/3/22	43	T27911845	J08	6/3/22
22	T27911824	CJ03	6/3/22	44	T27911846	J09	6/3/22




The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Mayo Truss Company, Inc..

Truss Design Engineer's Name: Magid, Michael

My license renewal date for the state of Florida is February 28, 2023.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

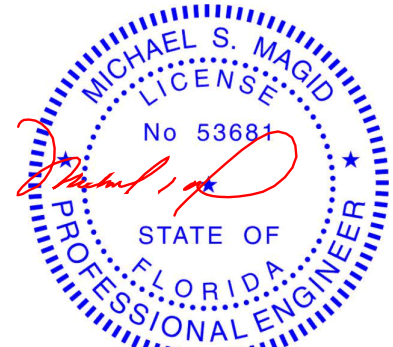

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

Magid, Michael

1 of 2



RE: WESTON_OAKS_LOT_53 - PAYNE

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:

Customer Info: BRUCE SCHAFFER Project Name: PAYNE Model: .
 Lot/Block: . Subdivision: .
 Address: ., .
 City: GAINESVILLE State: FL

No.	Seal#	Truss Name	Date
45	T27911847	J10	6/3/22
46	T27911848	J11	6/3/22
47	T27911849	J12	6/3/22
48	T27911850	J13	6/3/22
49	T27911851	J14	6/3/22
50	T27911852	M01	6/3/22
51	T27911853	PB01	6/3/22
52	T27911854	PB02	6/3/22
53	T27911855	PB03	6/3/22
54	T27911856	PB04	6/3/22
55	T27911857	PB05	6/3/22
56	T27911858	PB06	6/3/22
57	T27911859	PB07	6/3/22
58	T27911860	PB08	6/3/22
59	T27911861	PB09	6/3/22

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911803
WESTON_OAKS_LOT_53	A01	Roof Special	1	1		
Job Reference (optional)						


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:22 2022 Page 1

ID:8Ek8XYpfa3J_9f2X4psRyDI5m-yGpPMCKdkeLfK7myttvm7qLptK43qGslX5DMmsz9znt

1-4-0	7-5-13	14-10-0	16-6-8	22-10-0	29-1-8	31-5-8	35-9-8	40-7-12	45-6-0	50-0-0
1-4-0	7-5-13	7-4-3	1-8-8	6-3-8	6-3-8	2-4-0	4-4-0	4-10-4	4-10-4	4-6-0

Scale = 1:88.6

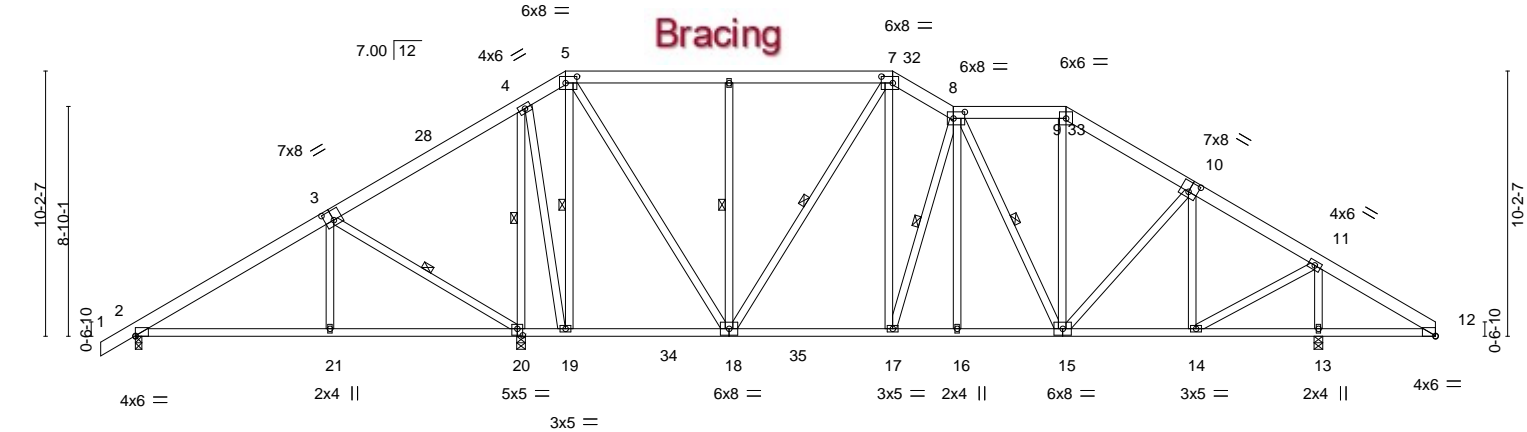

	7-5-13	14-10-0	16-6-8	22-10-0	29-1-8	31-5-8	35-9-8	40-7-12	45-6-0	45-8-0	50-0-0
	7-5-13	7-4-3	1-8-8	6-3-8	6-3-8	2-4-0	4-4-0	4-10-4	4-10-4	0-2-0	4-4-0
Plate Offsets (X,Y)--	[2:0-0-0,0-0-4], [3:0-4-0,0-4-8], [5:0-5-4,0-3-0], [7:0-5-4,0-3-0], [8:0-5-4,0-3-0], [10:0-4-0,0-4-8], [12:0-0-0,0-0-4], [20:0-2-8,0-3-0]										

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.34	Vert(LL)	-0.11 17-18	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.57	Vert(CT)	-0.20 17-18	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.59	Horz(CT)	0.04 13	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						
									Weight: 407 lb FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 3-20, 4-20, 5-19, 6-18, 7-18, 8-17, 8-15

REACTIONS. (size) 2=0-3-0, 20=0-4-0, 13=0-4-0
Max Horz 2=195(LC 11)
Max Uplift 2=-38(LC 12), 13=-1(LC 12)
Max Grav 2=707(LC 17), 20=2105(LC 17), 13=1797(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-724/30, 4-5=-450/172, 5-6=-884/151, 6-7=-884/151, 7-8=-1277/149,
8-9=-1089/118, 9-10=-1281/105, 10-11=-1160/50, 11-12=-159/333
BOT CHORD 2-21=0/632, 20-21=0/630, 18-19=0/280, 17-18=0/1068, 16-17=0/1177, 15-16=0/1179,
14-15=0/900
WEBS 3-21=0/339, 3-20=-677/42, 4-20=-1700/52, 4-19=0/1083, 5-19=-771/0, 5-18=-35/1115,
6-18=-430/100, 7-18=-448/0, 7-17=0/737, 8-17=-486/63, 8-15=-365/25, 9-15=0/329,
10-14=-460/102, 11-14=-48/1265, 11-13=-1645/201

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=50ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-8-0, Interior(1) 3-8-0 to 16-6-8, Exterior(2R) 16-6-8 to 21-6-8, Interior(1) 21-6-8 to 29-1-8, Exterior(2E) 29-1-8 to 31-5-8, Interior(1) 31-5-8 to 35-9-8, Exterior(2R) 35-9-8 to 40-7-6, Interior(1) 40-7-6 to 50-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 13.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

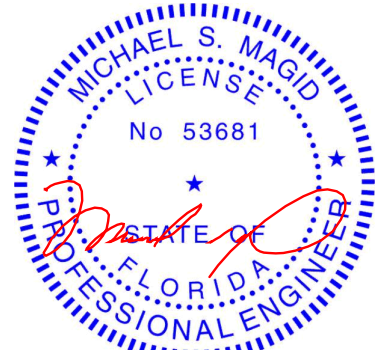

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911804
WESTON_OAKS_LOT_53	A02	PIGGYBACK BASE	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:24 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-ufwAntMtGGcMaRwL_lxEcfQ9m8I7I9Ob_OiSrKz9znr

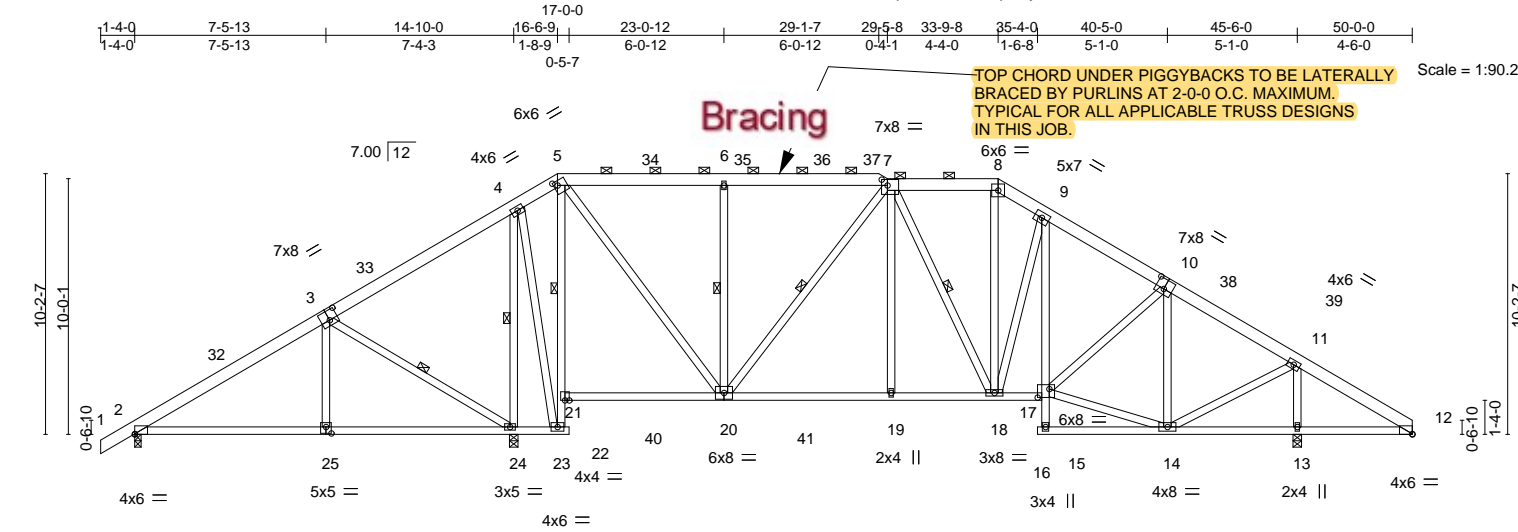

	7-5-13	14-10-0	17-0-0	23-0-12	29-1-7	29-5-8	33-9-8	35-4-0	40-5-0	45-6-0	45-8-0	50-0-0
	7-5-13	7-4-3	2-2-0	6-0-12	6-0-12	0-4-1	4-4-0	1-6-8	5-1-0	5-1-0	0-2-0	4-4-0
Plate Offsets (X,Y)--	[2:0-0-0,0-0-4], [3:0-4-0,0-4-8], [5:0-1-12,0-2-0], [7:0-2-12,0-2-12], [10:0-4-0,0-4-8], [12:0-0-0,0-0-4], [17:0-5-8,0-4-0], [25:0-2-8,0-3-0]											
LOADING (psf)	SPACING- 2-0-0		CSI.		DEFL. in (loc)		l/defl		PLATES		GRIP	
TCLL 20.0	Plate Grip DOL 1.25		TC 0.38		Vert(LL) -0.13 19-20		>999		MT20		244/190	
TCDL 10.0	Lumber DOL 1.25		BC 0.59		Vert(CT) -0.24 19-20		>999					
BCLL 0.0 *	Rep Stress Incr YES		WB 0.65		Horz(CT) 0.09 13		n/a					
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 404 lb		FT = 20%	

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except
2-0-0 oc purlins: 5-8.
BOT CHORD Rigid ceiling directly applied. Except:
1 Row at midpt 5-21
5-4-0 oc bracing: 21-23
10-0-0 oc bracing: 15-17
WEBS 1 Row at midpt 3-24, 4-24, 6-20, 7-20, 7-18

REACTIONS.


(size) 2=0-3-0, 24=0-4-0, 13=0-4-0
Max Horz 2=193(LC 11)
Max Uplift 2=113(LC 12), 13=35(LC 12)
Max Grav 2=490(LC 21), 24=2518(LC 17), 13=1685(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-277/177, 3-4=0/637, 4-5=-111/267, 5-6=-712/204, 6-7=-714/203, 7-8=-1050/151,
8-9=-1221/167, 9-10=-1342/128, 10-11=-1065/86, 11-12=-164/327
BOT CHORD 23-24=-384/0, 21-23=-1239/0, 5-21=-1063/0, 19-20=0/986, 18-19=0/991, 17-18=0/1071
WEBS 3-24=-595/53, 4-24=-1874/0, 4-23=0/1169, 5-20=0/1331, 6-20=-465/84, 7-20=-570/0,
7-19=0/341, 8-18=-50/391, 9-18=-381/63, 14-17=0/785, 10-17=-8/362, 10-14=-617/67,
11-14=-31/1147, 11-13=-1522/150

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=50ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-8-0, Interior(1) 3-8-0 to 16-6-9, Exterior(2R) 16-6-9 to 23-7-6, Interior(1) 23-7-6 to 33-9-8, Exterior(2R) 33-9-8 to 40-10-6, Interior(1) 40-10-6 to 50-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13 except (jt=lb) 2=113.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

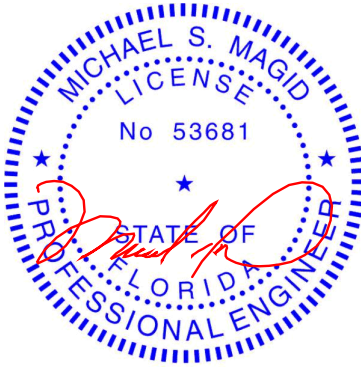

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911805
WESTON_OAKS_LOT_53	A03	PIGGYBACK BASE	2	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:26 2022 Page 1
ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-r12wCZN7ots4pk3j6ziHgWVGxScm2tuSiBZvdz9znp

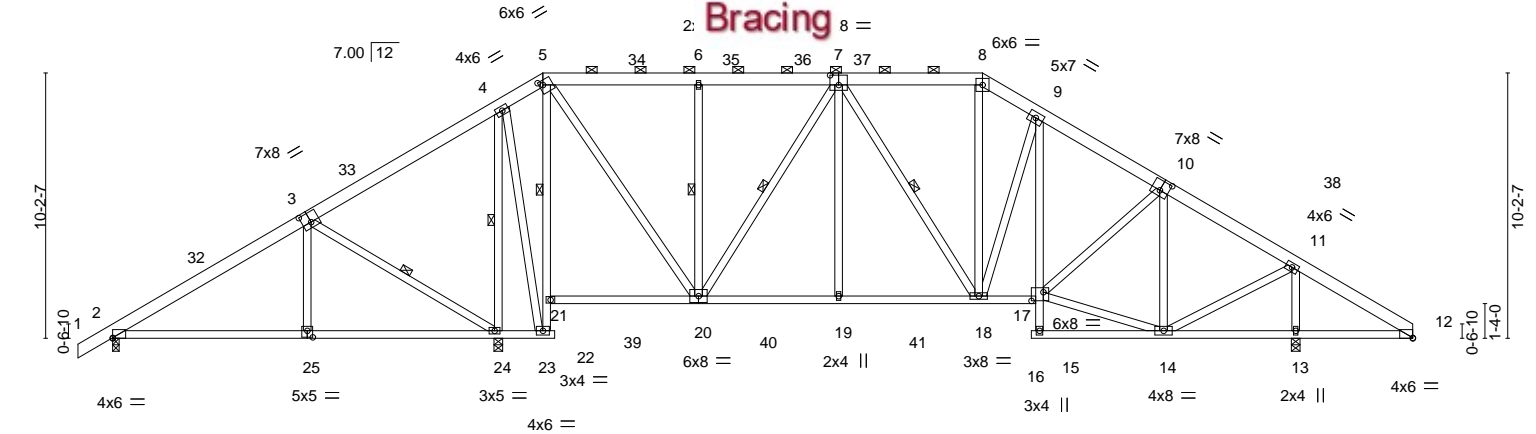

7-5-13	14-10-0	17-0-0	22-6-6	27-11-1	33-5-7	35-4-0	40-5-0	45-6-0	45-8-0	50-0-0
7-5-13	7-4-3	2-2-0	5-6-6	5-4-10	5-6-6	1-10-9	5-1-0	5-1-0	0-2-0	4-4-0
Plate Offsets (X,Y)-- [2:0-0-0,0-0-4], [3:0-4-0,0-4-8], [5:0-1-12,0-2-0], [7:0-4-0,0-4-8], [10:0-4-0,0-4-8], [12:0-0-0,0-0-4], [17:0-5-8,0-4-0], [25:0-2-8,0-3-0]										
LOADING (psf)		SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.38	Vert(LL)	-0.10 20-21	>999	240	MT20
TCDL	10.0	Lumber DOL	1.25	BC	0.53	Vert(CT)	-0.21 25-28	>865	180	244/190
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.65	Horz(CT)	0.09 13	n/a	n/a	
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-AS						
									Weight: 404 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied, except
2-0-0 oc purlins (6-0-0 max.): 5-8.
BOT CHORD Rigid ceiling directly applied. Except:
1 Row at midpt 5-21
5-4-0 oc bracing: 21-23
10-0-0 oc bracing: 15-17
WEBS 1 Row at midpt 3-24, 4-24, 6-20, 7-20, 7-18

REACTIONS. (size) 2=0-3-0, 24=0-4-0, 13=0-4-0
Max Horz 2=195(LC 11)
Max Uplift 2=110(LC 12), 13=33(LC 12)
Max Grav 2=496(LC 21), 24=2521(LC 17), 13=1704(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-288/171, 3-4=0/622, 4-5=-119/264, 5-6=-685/201, 6-7=-685/201, 7-8=-1070/149,
8-9=-1245/163, 9-10=-1371/127, 10-11=-1084/85, 11-12=-164/327
BOT CHORD 23-24=-371/0, 21-23=-1235/0, 5-21=-1075/0, 19-20=0/966, 18-19=0/966, 17-18=0/1094
WEBS 3-24=-594/53, 4-24=-1876/0, 4-23=0/1164, 5-20=0/1338, 6-20=-421/84, 7-20=-658/0,
7-19=0/344, 8-18=-39/377, 9-18=-343/65, 14-17=0/798, 10-17=-7/372, 10-14=-630/65,
11-14=-27/1166, 11-13=-1540/148

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=50ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-8-0, Interior(1) 3-8-0 to 16-6-9, Exterior(2R) 16-6-9 to 23-7-6, Interior(1) 23-7-6 to 33-5-7, Exterior(2R) 33-5-7 to 40-4-10, Interior(1) 40-4-10 to 50-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13 except (jt=lb) 2=110.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

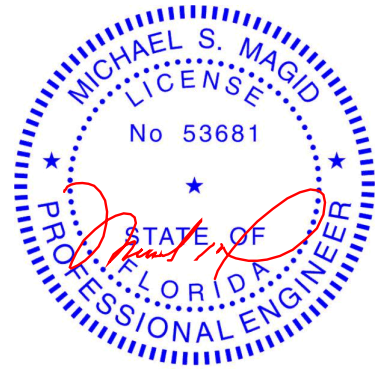

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911806
WESTON_OAKS_LOT_53	A04	PIGGYBACK BASE	3	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:28 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-nQAhdFPOJU6o32D6D80AN5bqE15HEuVBv0gg_Vz9znn



Scale = 1:88.2

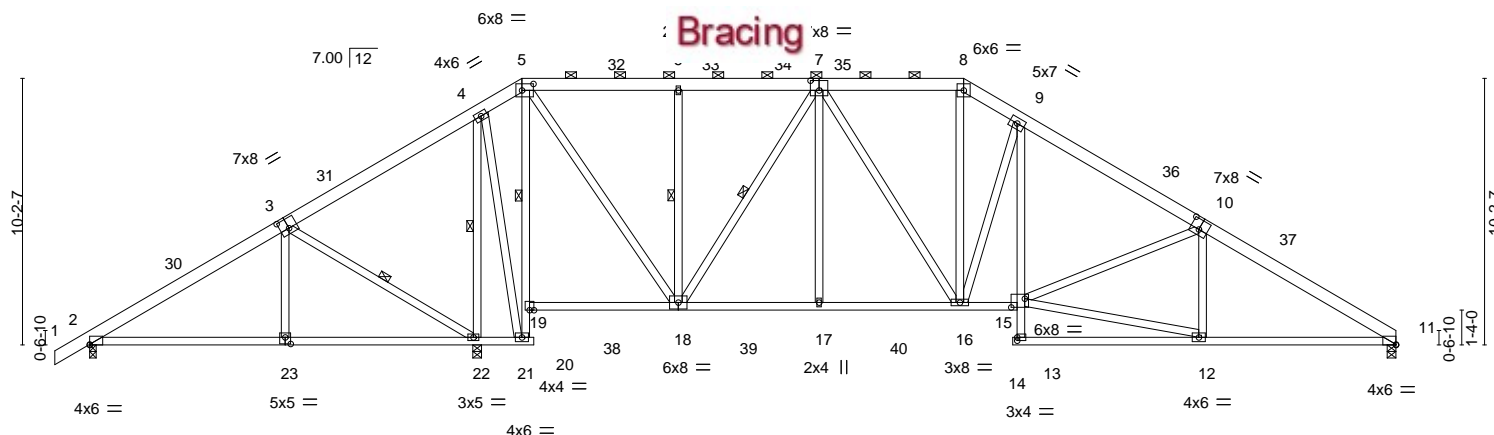


Plate Offsets (X,Y)--	[2:0-0-0,0-0-4], [3:0-4-0,0-4-8], [5:0-5-4,0-3-0], [7:0-4-0,0-4-8], [10:0-4-0,0-4-8], [11:0-0-0,0-0-4], [13:0-0-0,0-1-8], [15:0-6-4,0-4-0], [23:0-2-8,0-3-0]
-----------------------	--


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.41	Vert(LL)	-0.12 17-18	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.64	Vert(CT)	-0.22 12-13	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.90	Horz(CT)	0.11 11	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 396 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied, except
BOT CHORD 2x4 SP No.2	2-0-0 oc purlins (5-11-5 max.): 5-8.
WEBS 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied. Except:
	1 Row at midpt 5-19
	4-8-0 oc bracing: 19-21
	10-0-0 oc bracing: 13-15
	WEBS 1 Row at midpt 3-22, 4-22, 6-18, 7-18
REACTIONS.	
(size) 2=0-3-0, 11=0-4-0, 22=0-4-0	
Max Horz 2=195(LC 11)	
Max Uplift 2=110(LC 12), 11=29(LC 12)	
Max Grav 2=437(LC 21), 11=1498(LC 18), 22=2847(LC 17)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-175/315, 3-4=0/795, 4-5=-52/265, 5-6=-751/205, 6-7=-751/205, 7-8=-1472/158, 8-9=-1735/182, 9-10=-2052/137, 10-11=-2332/70
BOT CHORD	21-22=-533/0, 19-21=-1540/0, 5-19=-1367/0, 18-19=-284/6, 17-18=0/1192, 16-17=0/1192, 15-16=0/1671, 9-15=0/704, 11-12=0/1932
WEBS	3-22=-592/53, 4-22=-2160/0, 4-21=0/1421, 5-18=0/1659, 6-18=-423/84, 7-18=-969/0, 7-17=0/341, 7-16=0/378, 8-16=-74/665, 9-16=-928/113, 12-15=-20/1812, 10-15=-282/38

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=50ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-8-0, Interior(1) 3-8-0 to 16-6-9, Exterior(2R) 16-6-9 to 23-7-6, Interior(1) 23-7-6 to 33-5-7, Exterior(2R) 33-5-7 to 40-6-5, Interior(1) 40-6-5 to 50-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11 except (jt=lb) 2=110.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911807
WESTON_OAKS_LOT_53	A05	PIGGYBACK BASE	2	1	Job Reference (optional)	


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:30 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-jolR2xRer6MWIMNULY2eSWgDQZm_iwqTNK9n2Oz9znI

1-4-0	4-11-13	9-10-0	16-6-9	22-2-12	27-9-4	33-5-7	38-11-2	44-4-12	50-0-0
1-4-0	4-11-13	4-10-3	6-8-9	5-8-3	5-6-7	5-8-3	5-5-10	5-5-10	5-7-4

Scale = 1:86.7

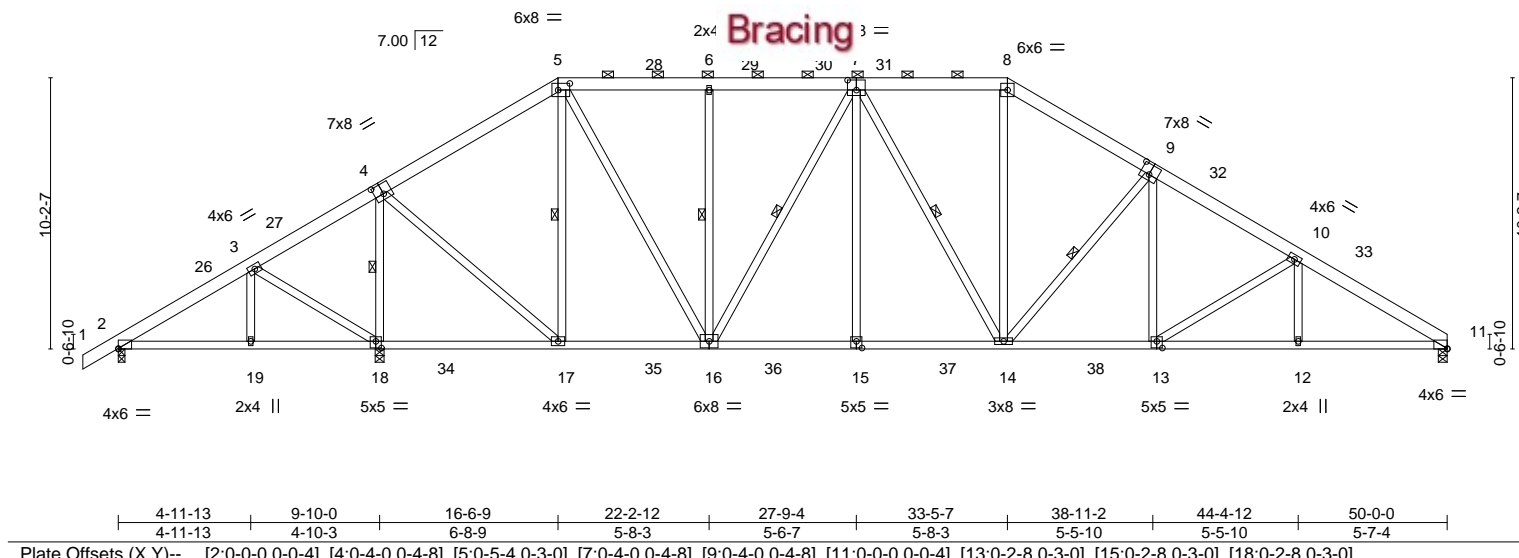

LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL 20.0		Plate Grip DOL 1.25		TC 0.24		Vert(LL) -0.17 15-16	>999 240	MT20	244/190
TCDL 10.0		Lumber DOL 1.25		BC 0.76		Vert(CT) -0.31 15-16	>999 180		
BCLL 0.0 *		Rep Stress Incr YES		WB 0.40		Horz(CT) 0.09 11	n/a n/a		
BCDL 10.0		Code FBC2020/TPI2014		Matrix-AS				Weight: 381 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except
2-0-0 oc purlins (5-4-13 max.): 5-8.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-18, 5-17, 6-16, 7-16, 7-14, 9-14

REACTIONS.


(size) 2=0-3-0, 18=0-4-0, 11=0-4-0
Max Horz 2=195(LC 11)
Max Uplift 2=44(LC 12), 11=1(LC 12)
Max Grav 2=258(LC 21), 18=2768(LC 17), 11=1815(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-61/308, 3-4=0/725, 4-5=-1090/105, 5-6=-1465/126, 6-7=-1465/126, 7-8=-1818/120,
8-9=-2123/107, 9-10=-2625/70, 10-11=-3081/30
BOT CHORD 17-18=-534/52, 16-17=0/906, 15-16=0/1726, 14-15=0/1726, 13-14=0/2150, 12-13=0/2585,
11-12=0/2585
WEBS 3-18=-566/42, 4-18=-2275/18, 4-17=0/1779, 5-17=-840/47, 5-16=-5/1198, 6-16=-386/86,
7-16=-624/0, 7-15=0/279, 8-14=0/695, 9-14=-652/61, 9-13=0/452, 10-13=-502/57

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=50ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-8-0, Interior(1) 3-8-0 to 16-6-9, Exterior(2R) 16-6-9 to 23-7-6, Interior(1) 23-7-6 to 33-5-7, Exterior(2R) 33-5-7 to 40-6-5, Interior(1) 40-6-5 to 50-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 11.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911808
WESTON_OAKS_LOT_53	A06	PIGGYBACK BASE GIRDE	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:32 2022 Page 1

ID:8Ek8XYpfa3J_9f2X4psRyDI5m-fBPBTcSuNjcEXgXtSz46XxlV1MP0Aqzmqeeu7Hz9znj

1-4-0	4-11-13	9-10-0	16-6-9	22-2-12	27-9-4	33-5-7	38-11-2	44-4-12	45-11-4	50-0-0
1-4-0	4-11-13	4-10-3	6-8-9	5-8-3	5-6-7	5-8-3	5-5-10	5-5-10	1-6-8	4-0-12

Scale = 1:86.5

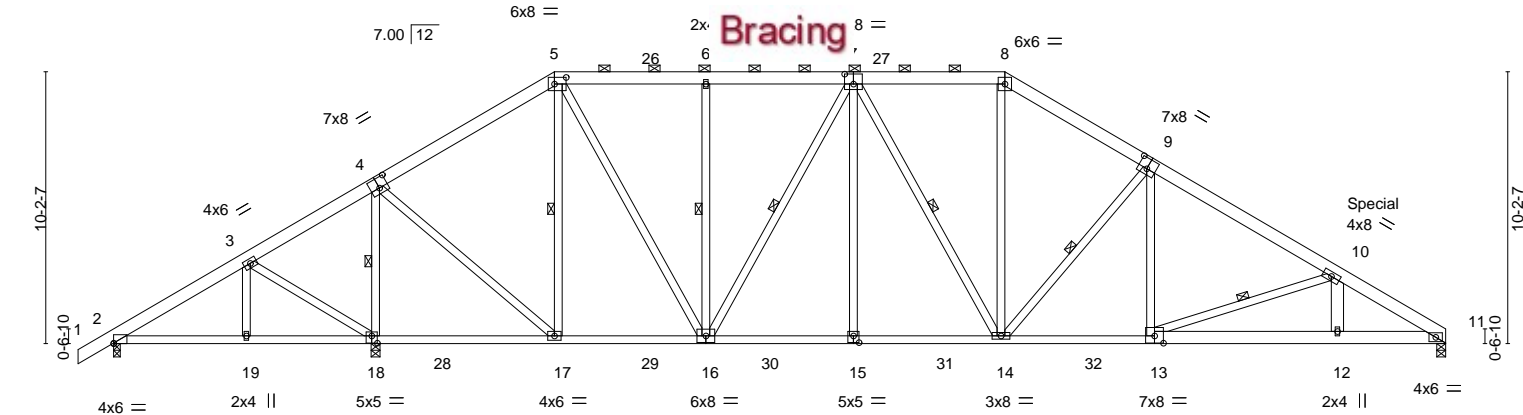



Plate Offsets (X,Y)-- [2:0-0-0,0-0-4], [4:0-4-0,0-4-8], [5:0-5-4,0-3-0], [7:0-4-0,0-4-8], [9:0-4-0,0-4-8], [13:0-4-0,0-3-4], [15:0-2-8,0-3-0], [18:0-2-8,0-3-4]										
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.25	TC 0.49	Vert(LL)	-0.18 15-16	>999	240	MT20	244/190	
TCDL 10.0	Lumber DOL	1.25	BC 0.91	Vert(CT)	-0.33 15-16	>999	180			
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.42	Horz(CT)	0.09 11	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS							
								Weight: 392 lb	FT = 20%	

LUMBER-	BRACING-	
TOP CHORD 2x6 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-5-10 oc purlins, except
BOT CHORD 2x4 SP No.2 *Except* 11-13: 2x6 SP No.2		2-0-0 oc purlins (5-1-7 max.): 5-8.
WEBS 2x4 SP No.2 *Except* 10-12: 2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
	WEBS	1 Row at midpt 4-18, 5-17, 6-16, 7-14, 9-14, 10-13
REACTIONS.		"Special" indicates special hanger(s) or other connection device(s) required at location(s) shown. The design/selection of such special connection device(s) is the responsibility of others. This applies to all applicable truss designs in this job.
(size) 2=0-3-0, 18=0-4-0, 11=0-4-0		
Max Horz 2=195(LC 7)		
Max Uplift 2=82(LC 25)		
Max Grav 2=206(LC 17), 18=2874(LC 29), 11=2443(LC 30)		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=0/372, 3-4=0/774, 4-5=-1124/100, 5-6=-1540/104, 6-7=-1540/104, 7-8=-1975/60, 8-9=-2307/40, 9-10=-3001/0, 10-11=-4448/0	
BOT CHORD 2-19=-287/71, 18-19=-287/71, 17-18=-572/21, 16-17=0/931, 15-16=0/1844, 14-15=0/1844, 13-14=0/2454, 12-13=0/3813, 11-12=0/3811	
WEBS 3-18=-569/40, 4-18=-2380/0, 4-17=0/1868, 5-17=-919/16, 5-16=0/1295, 6-16=-392/71, 7-16=-711/0, 7-15=0/279, 8-14=0/802, 9-14=-882/0, 9-13=0/669, 10-13=-1512/0, 10-12=0/251	

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=50ft; eave=6ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 932 lb down at 45-11-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

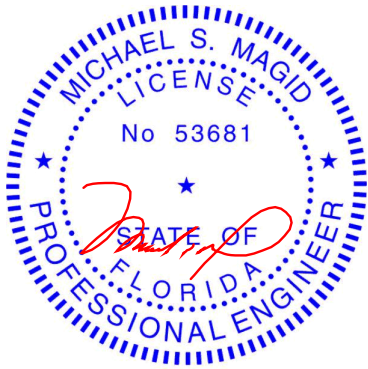

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911808
WESTON_OAKS_LOT_53	A06	PIGGYBACK BASE GIRDE	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:32 2022 Page 2
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-fBPBTcSuNjcEXgXtSz46XxlV1MP0Aqzmqeeu7Hz9znj

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 - Uniform Loads (plf)
 - Vert: 1-5=-60, 5-8=-60, 8-11=-60, 20-23=-20
 - Concentrated Loads (lb)
 - Vert: 10=-892(B)



Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911809
WESTON_OAKS_LOT_53	A07	PIGGYBACK BASE	2	1		
Job Reference (optional)						


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:34 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-caXytlU8vKsynzhGaO6acMrpWA9MeIW3ly7_B9z9znh

1-4-0	4-11-13	9-10-0	16-6-9	22-2-12	27-9-4	33-5-7	38-11-0	44-8-0
1-4-0	4-11-13	4-10-3	6-8-9	5-8-3	5-6-7	5-8-3	5-5-8	5-9-0

Scale = 1:78.2

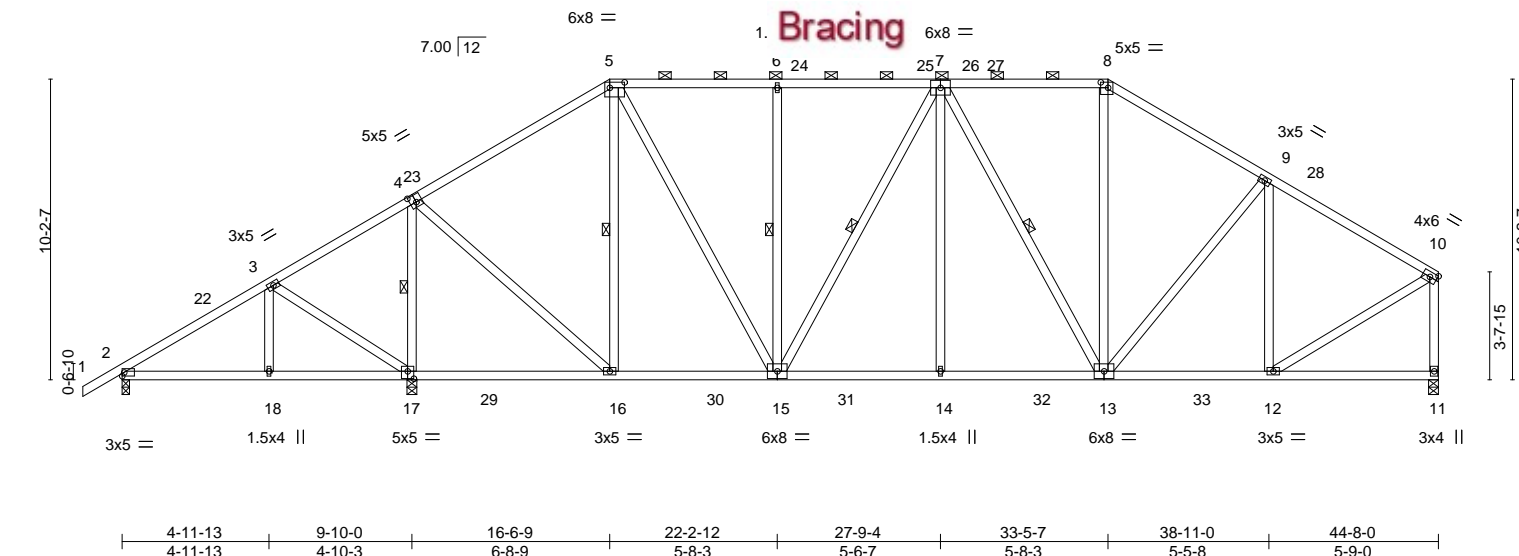

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.62	Vert(LL)	-0.10 16-17	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.60	Vert(CT)	-0.19 16-17	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.35	Horz(CT)	0.04 11	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 318 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-7-1 max.): 5-8.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-17, 5-16, 6-15, 7-15, 7-13

REACTIONS.


(size) 2=0-3-0, 17=0-4-0, 11=0-4-0
Max Horz 2=233(LC 11)
Max Uplift 2=32(LC 12), 17=1(LC 12)
Max Grav 2=350(LC 21), 17=2333(LC 17), 11=1593(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-253/39, 3-4=-30/402, 4-5=-1041/94, 5-6=-1252/118, 6-7=-1252/118, 7-8=-1252/118, 8-9=-1504/112, 9-10=-1430/60, 10-11=-1510/28
BOT CHORD 16-17=-283/82, 15-16=0/867, 14-15=0/1391, 13-14=0/1391, 12-13=0/1145
WEBS 3-17=-542/45, 4-17=-1846/32, 4-16=0/1377, 5-16=-619/54, 5-15=-9/866, 6-15=-394/78, 7-15=-319/0, 7-14=0/387, 7-13=-415/0, 8-13=0/406, 9-12=-451/63, 10-12=0/1290

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=45ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-1-10, Interior(1) 3-1-10 to 16-6-9, Exterior(2R) 16-6-9 to 22-10-6, Interior(1) 22-10-6 to 33-5-7, Exterior(2R) 33-5-7 to 39-9-4, Interior(1) 39-9-4 to 44-6-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 17.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911810
WESTON_OAKS_LOT_53	A08	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:35 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-4m5K5eUnge_p07GS76ep9ZN0MaSJNCrCWcsYjbz9zng

1-4-0	4-11-13	9-10-0	13-11-0	18-0-0	25-0-0	32-0-0	38-2-4	44-8-0
1-4-0	4-11-13	4-10-3	4-1-0	4-1-0	7-0-0	7-0-0	6-2-4	6-5-12

Scale = 1:78.2

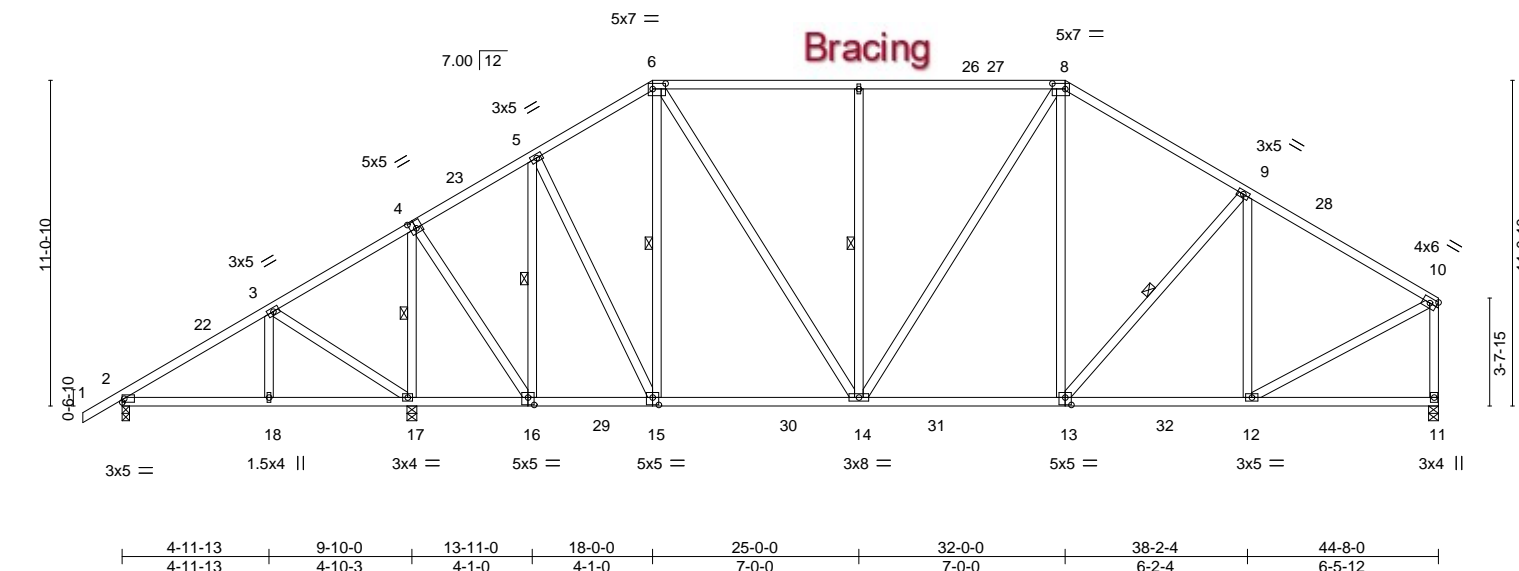


Plate Offsets (X,Y)--										[4:0-2-8,0-3-0], [6:0-5-4,0-2-4], [8:0-5-4,0-2-4], [13:0-2-8,0-3-0], [15:0-2-8,0-3-0], [16:0-2-8,0-3-0]									
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc)		l/defl		L/d		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL		1.25		TC	0.49	Vert(LL)	-0.15	13-14	>999		240		MT20		244/190		
TCDL	10.0	Lumber DOL		1.25		BC	0.81	Vert(CT)	-0.25	13-14	>999		180						
BCLL	0.0 *	Rep Stress Incr		YES		WB	0.35	Horz(CT)	0.04	11	n/a		n/a						
BCDL	10.0	Code FBC2020/TPI2014				Matrix-AS										Weight: 322 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-17, 5-16, 6-15, 7-14, 9-13

REACTIONS.


(size) 2=0-3-0, 17=0-4-0, 11=0-4-0
Max Horz 2=249(LC 11)
Max Uplift 2=25(LC 12), 17=9(LC 12)
Max Grav 2=405(LC 21), 17=2245(LC 17), 11=1610(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-369/28, 3-4=-56/272, 4-5=-746/89, 5-6=-1092/123, 6-7=-1311/120, 7-8=-1311/120, 8-9=-1504/119, 9-10=-1512/60, 10-11=-1516/30
BOT CHORD 2-18=-65/336, 17-18=-65/336, 15-16=-22/672, 14-15=0/942, 13-14=0/1197, 12-13=0/1208
WEBS 3-17=-516/52, 4-17=-1786/40, 4-16=0/1350, 5-16=-989/40, 5-15=0/647, 6-15=-402/18, 6-14=0/765, 7-14=-475/90, 8-14=-1/267, 8-13=0/280, 9-12=-392/71, 10-12=0/1313

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=45ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-1-10, Interior(1) 3-1-10 to 18-0-0, Exterior(2R) 18-0-0 to 24-3-13, Interior(1) 24-3-13 to 32-0-0, Exterior(2R) 32-0-0 to 38-2-4, Interior(1) 38-2-4 to 44-6-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 17.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911811
WESTON_OAKS_LOT_53	A09	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:37 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-09D4WKW1CFEWeRPgFWgHE_TKDN90r6GV_wLeoUz9zne

1-4-0	4-11-13	9-10-0	16-0-0	22-0-9	27-11-7	34-0-0	39-2-4	44-8-0
1-4-0	4-11-13	4-10-3	6-2-0	6-0-9	5-10-13	6-0-9	5-2-4	5-5-12

Scale = 1:78.4

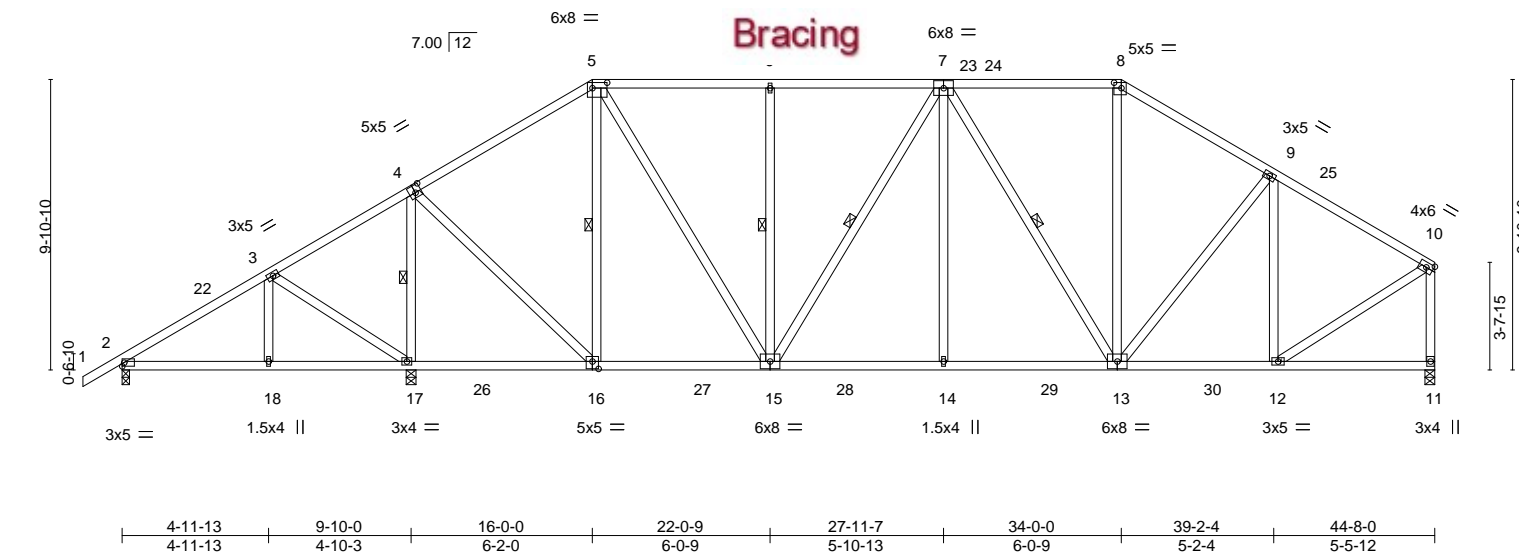


Plate Offsets (X,Y)-- [4:0-2-8,0-3-0], [5:0-6-0,0-2-4], [8:0-3-0,0-2-4], [16:0-2-8,0-3-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.53	Vert(LL)	-0.16 15-16 >999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.73	Vert(CT)	-0.28 15-16 >999	180	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.35	Horz(CT)	0.04 11 n/a	n/a	
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 314 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-17, 5-16, 6-15, 7-15, 7-13

REACTIONS.


(size) 2=0-3-0, 17=0-4-0, 11=0-4-0
Max Horz 2=227(LC 11)
Max Uplift 2=31(LC 12), 17=1(LC 12)
Max Grav 2=349(LC 21), 17=2340(LC 17), 11=1584(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-37/379, 4-5=-920/99, 5-6=-1265/115, 6-7=-1265/115, 7-8=-1250/114,
8-9=-1496/108, 9-10=-1393/59, 10-11=-1505/27
BOT CHORD 16-17=-306/88, 15-16=0/780, 14-15=0/1421, 13-14=0/1421, 12-13=0/1116
WEBS 3-17=-505/56, 4-17=-1800/48, 4-16=0/1355, 5-16=-719/38, 5-15=0/988, 6-15=-422/77,
7-15=-334/0, 7-14=0/411, 7-13=-452/0, 8-13=0/402, 9-12=-473/57, 10-12=0/1278

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=45ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 3-1-10, Interior(1) 3-1-10 to 16-0-0, Exterior(2R) 16-0-0 to 22-0-9, Interior(1) 22-0-9 to 34-0-0, Exterior(2R) 34-0-0 to 40-3-13, Interior(1) 40-3-13 to 44-6-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 17.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911812
WESTON_OAKS_LOT_53	B01	Roof Special Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:42 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-N60zZ1aA0otpkClo24GSx2AFXOsLWEmE7C3PTiz9znZ

1-4-0	4-2-8	8-6-8	10-10-8	16-11-0	22-11-8	29-0-0	35-4-0
1-4-0	4-2-8	4-4-0	2-4-0	6-0-8	6-0-8	6-0-8	6-4-0

Scale = 1:62.8

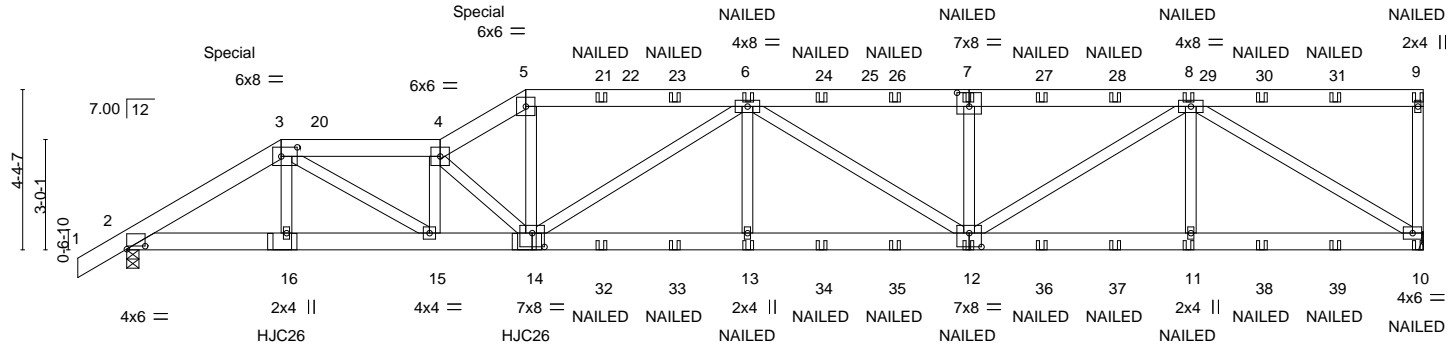


Plate Offsets (X, Y)--		[2:0-6-0,0-1-0], [3:0-5-4,0-3-0], [7:0-4-0,0-4-8], [12:0-4-0,0-4-8], [14:0-4-0,0-4-8]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.30	in (loc)	L/defl	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.72	Vert(LL)	>999				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.91	Vert(CT)	>999				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS		Horz(CT)	0.10				
								Weight: 510 lb FT = 20%			

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-8-12 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 10=Mechanical, 2=0-4-0
Max Horz 2=128(LC 7)
Max Uplift 10=154(LC 8), 2=214(LC 8)
Max Grav 10=3055(LC 1), 2=2844(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-5042/350, 3-4=-7260/492, 4-5=-6742/481, 5-6=-5982/440, 6-7=-6098/372, 7-8=-6098/372, 9-10=-378/101
BOT CHORD 2-16=-271/4289, 15-16=-273/4317, 14-15=-457/7367, 13-14=-362/6877, 12-13=-362/6877, 11-12=-195/4005, 10-11=-195/4005
WEBS 3-16=-31/495, 3-15=-205/3444, 4-15=-1880/160, 4-14=-2148/143, 5-14=-160/2733, 6-14=-1076/0, 6-13=0/550, 6-12=-929/80, 7-12=-591/152, 8-12=-150/2493, 8-11=0/557, 8-10=-4690/244

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=154, 2=214.
- Use MiTek HJC26 (With 16-16d nails into Girder & 10d nails into Truss) or equivalent spaced at 6-8-0 oc max. starting at 4-2-14 from the left end to 10-10-14 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

Continued on page 2

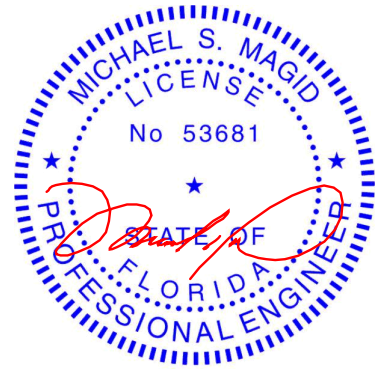

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911812
WESTON_OAKS_LOT_53	B01	Roof Special Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:42 2022 Page 2
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-N60zZ1aA0otpkClo24GSx2AFXOsLWEmE7C3PTiz9znZ

NOTES-

13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 153 lb down and 64 lb up at 4-2-8, and 276 lb down and 41 lb up at 10-10-8 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-60, 3-4=-60, 4-5=-60, 5-9=-60, 10-17=-20

Concentrated Loads (lb)

Vert: 3=25(B) 5=-194(B) 9=-138(B) 10=-63(B) 16=-372(B) 14=-382(B) 6=-116(B) 13=-55(B) 12=-55(B) 7=-116(B) 11=-55(B) 21=-116(B) 23=-116(B) 24=-116(B) 26=-116(B) 27=-116(B) 28=-116(B) 29=-116(B) 30=-116(B) 31=-116(B) 32=-55(B) 33=-55(B) 34=-55(B) 35=-55(B) 36=-55(B) 37=-55(B) 38=-55(B) 39=-55(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:43 2022 Page 1
ID:i8Ek8XYofa3J 9f2X4psRvDI5m-rlaMmNbon5?oMMT bnnhTFiGaoAmFpXOMsoz?8z9znY

Scale = 1:61.1

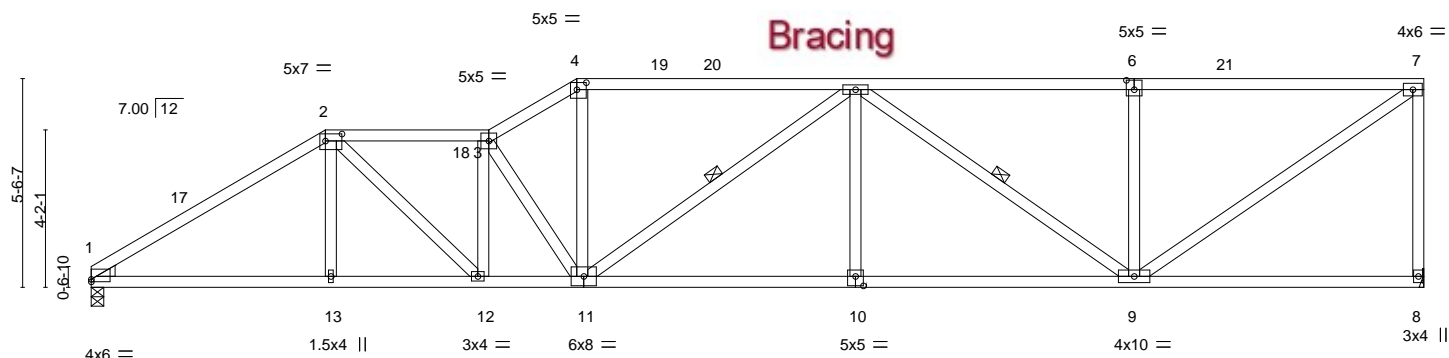


Plate Offsets (X,Y)--

Offset	Duration
6-2-8	6-2-8
10-6-8	4-4-0
12-10-8	2-4-0
20-3-3	7-4-11
27-7-13	7-4-11
35-4-0	7-8-3

Timeline: [1:0-0-0-0-13], [2:0-5-4-0-2-4], [4:0-3-0-0-2-4], [6:0-2-8-0-3-0], [10:0-2-8-0-3-0]

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.90	Vert(LL) -0.22 10-11 >999 240	MT20	244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.84	Vert(CT) -0.51 10-11 >824 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.43	Horz(CT) 0.10 8 n/a n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-AS		Weight: 201 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
6-7: 2x4 SP No.1

BOT CHORD 2x4 SP No.2 *Except*
10-11: 2x4 SP No.1

WEBS 2x4 SP No.2

WEDGE

Left: 2x4 SP No.3

BRACING-

TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 5-11, 5-9

REACTIONS.

(size) 1=0-4-0, 8=Mechanical
Max Horz 1=156(LC 11)
Max Uplift 8=-1(LC 12)
Max Grav 1=1408(LC 1), 8=1408(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 1-2=-2288/99, 2-3=-2654/128, 3-4=-2543/141, 4-5=-2222/137, 5-6=-1611/85,
6-7=-1611/85, 7-8=-1337/73

BOT CHORD 1-13=-198/1880, 12-13=-196/1883, 11-12=-185/2678, 10-11=-141/2376, 9-10=-141/2376

WEBS 2-12=-25/1051, 3-12=-650/59, 3-11=-901/51, 4-11=0/967, 5-10=0/258, 5-9=-939/87,
6-9=-376/83, 7-9=-39/1905

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=35ft; eave=5ft; Cat. II; Exp B; Encl.; GC_{pi}=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-6-6, Interior(1) 3-6-6 to 6-2-8, Exterior(2R) 6-2-8 to 9-8-14, Interior(1) 9-8-14 to 12-10-8, Exterior(2R) 12-10-8 to 16-4-14, Interior(1) 16-4-14 to 35-2-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

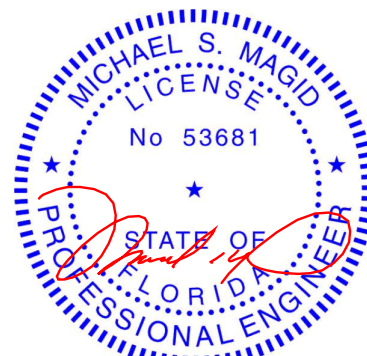

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiteK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911814
WESTON_OAKS_LOT_53	B03	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:44 2022 Page 1

ID:8Ek8XYpfa3J_9f2X4psRyDI5m-JV8k_jbQYP7XzWSB9Vlw0TFTVCVI_EbXbWYWYaz9znX



Scale = 1:61.1


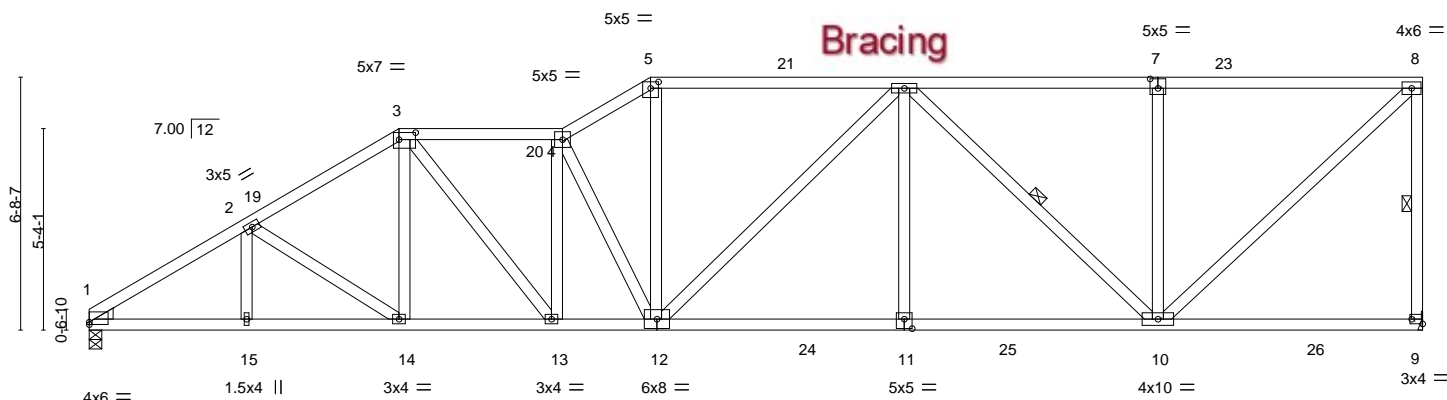


Plate Offsets (X,Y)--		[1:0-0-0,0-0-13], [3:0-5-4,0-2-4], [5:0-2-8,0-2-1], [7:0-2-8,0-3-0], [9:Edge,0-1-8], [11:0-2-8,0-3-0]					
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc) l/defl L/d
TCLL	20.0	Plate Grip DOL	1.25	TC	0.78	Vert(LL)	-0.26 11-12 >999 240
TCDL	10.0	Lumber DOL	1.25	BC	0.94	Vert(CT)	-0.49 11-12 >863 180
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.51	Horz(CT)	0.10 9 n/a n/a
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-AS			
						PLATES	GRIP
						MT20	244/190
						Weight: 226 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 8-9, 6-10

REACTIONS.


(size) 1=0-4-0, 9=Mechanical
Max Horz 1=191(LC 11)
Max Uplift 9=2(LC 12)
Max Grav 1=1588(LC 17), 9=1613(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2589/86, 2-3=-2354/117, 3-4=-2527/132, 4-5=-2462/148, 5-6=-2155/142,
6-7=-1414/99, 7-8=-1414/99, 8-9=-1474/77
BOT CHORD 1-15=-254/2231, 14-15=-254/2231, 13-14=-207/2060, 12-13=-194/2581, 11-12=-142/2154,
10-11=-142/2154
WEBS 3-14=0/301, 3-13=-21/815, 4-13=-519/61, 4-12=-950/58, 5-12=-1/985, 6-11=0/315,
6-10=-1009/86, 7-10=-343/77, 8-10=-47/1882

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-6-6, Interior(1) 3-6-6 to 8-2-8, Exterior(2R) 8-2-8 to 11-8-14, Interior(1) 11-8-14 to 14-10-8, Exterior(2R) 14-10-8 to 18-4-14, Interior(1) 18-4-14 to 35-2-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

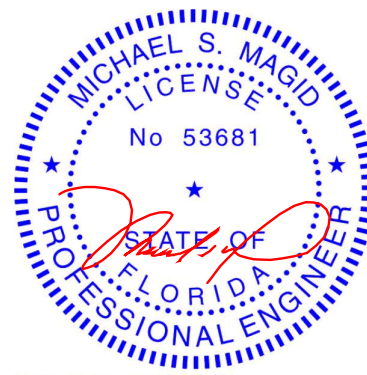

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911815
WESTON_OAKS_LOT_53	B004	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:38 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-ULnTjgXfzZNNFb_1pEBWmC?UunU_aULfDa5CKwz9znd



Scale = 1:61.6


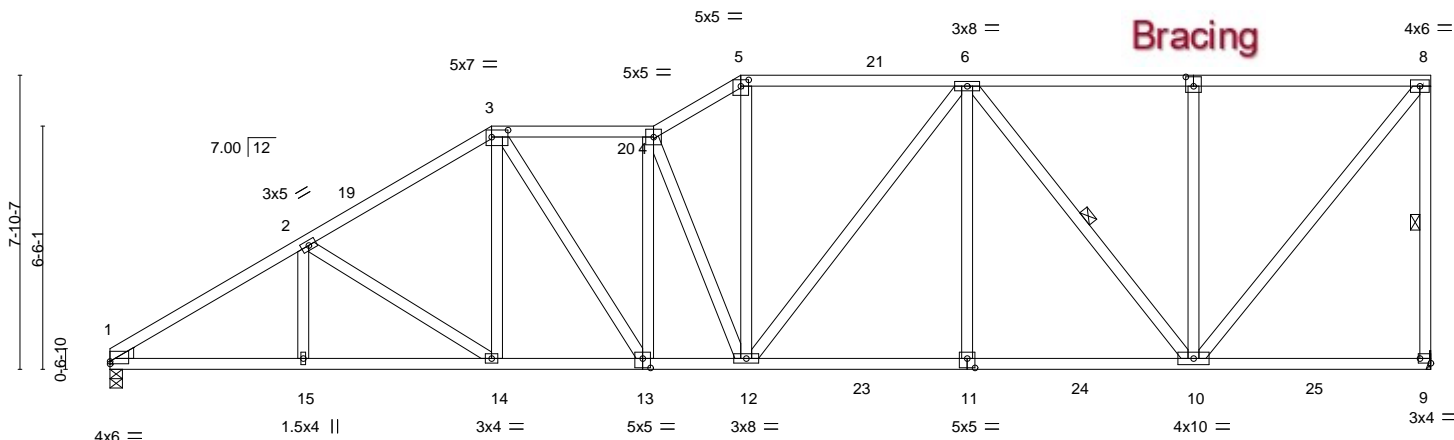


Plate Offsets (X,Y)-- [1:0-0,0-0-13], [3:0-5-4,0-2-4], [5:0-2-8,0-2-1], [7:0-2-8,0-3-0], [9:Edge,0-1-8], [11:0-2-8,0-3-0], [13:0-2-8,0-3-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.60	Vert(LL)	-0.17	11-12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.81	Vert(CT)	-0.31	11-12	>999	180		
BCLL	0.0 *	Rep Stress Incr YES		WB	0.68	Horz(CT)	0.09	9	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							Weight: 245 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 8-9, 6-10

REACTIONS.


(size) 1=0-4-0, 9=Mechanical
Max Horz 1=227(LC 11)
Max Uplift 9=3(LC 12)
Max Grav 1=1594(LC 17), 9=1632(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2605/88, 2-3=-2242/125, 3-4=-2177/139, 4-5=-2175/150, 5-6=-1889/143,
6-7=-1125/113, 7-8=-1125/113, 8-9=-1503/81
BOT CHORD 1-15=-276/2255, 14-15=-276/2255, 13-14=-219/1946, 12-13=-201/2240, 11-12=-145/1763,
10-11=-145/1763
WEBS 2-14=-376/67, 3-14=0/397, 3-13=-19/548, 4-13=-412/35, 4-12=-896/85, 5-12=-7/856,
6-12=-41/262, 6-11=0/268, 6-10=-1014/90, 7-10=-311/73, 8-10=-57/1723

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-6-6, Interior(1) 3-6-6 to 10-2-8, Exterior(2R) 10-2-8 to 13-8-14, Interior(1) 13-8-14 to 16-10-8, Exterior(2R) 16-10-8 to 20-4-14, Interior(1) 20-4-14 to 35-2-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

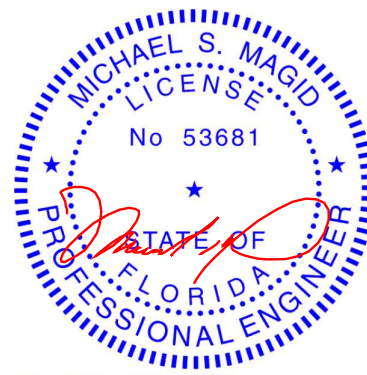

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911816
WESTON_OAKS_LOT_53	B05	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:46 2022 Page 1

ID: i8Ek8XYpfa3J_9f2X4psRyDI5m-FtGUPPDg40NFDpbZHVkO5uLt7?CPS0iq2q1dcTz9znV

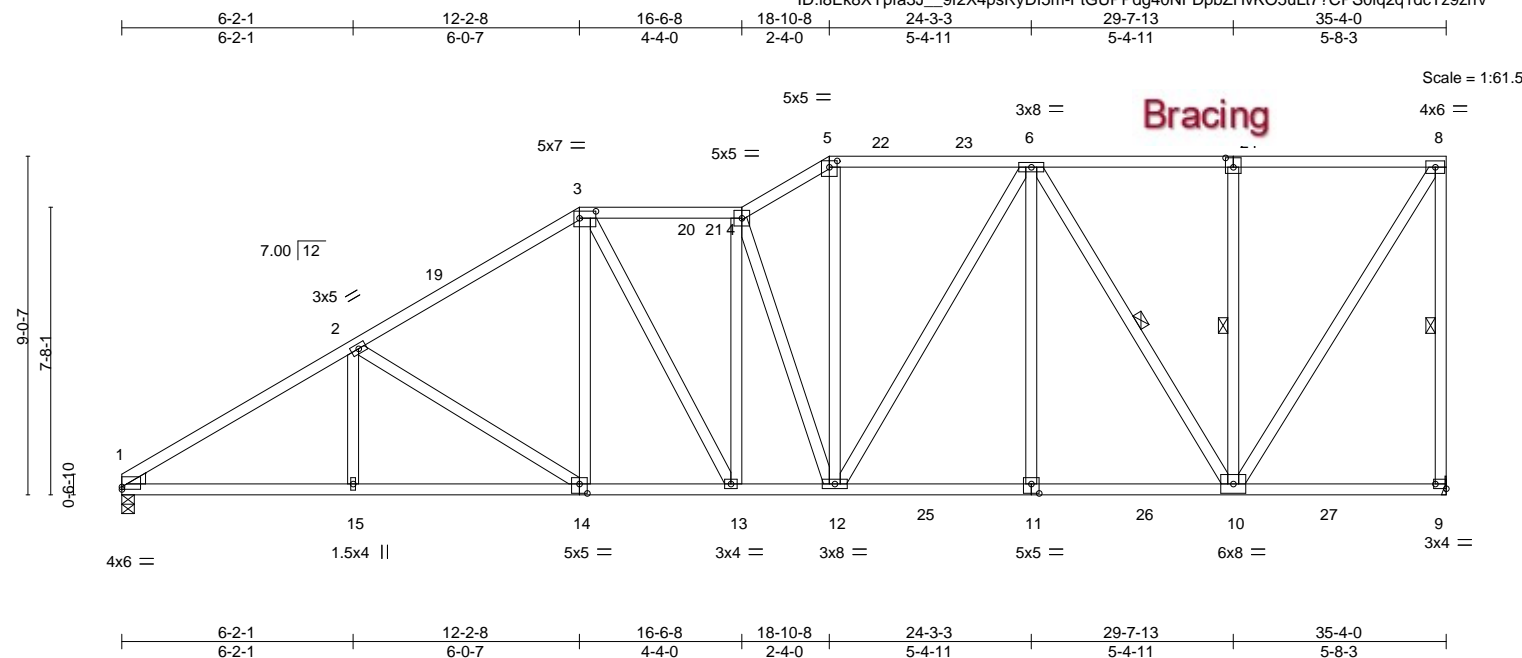


Plate Offsets (X,Y)-- [1:0-0-0,0-0-13], [3:0-5-4,0-2-4], [5:0-2-8,0-2-1], [7:0-2-8,0-3-0], [9:Edge,0-1-8], [11:0-2-8,0-3-0], [14:0-2-8,0-3-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.52	Vert(LL)	-0.15 14-15 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.78	Vert(CT)	-0.30 14-15 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.98	Horz(CT)	0.08 9 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS				Weight: 264 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 8-9, 6-10, 7-10

REACTIONS.


(size) 1=0-4-0, 9=Mechanical
Max Horz 1=262(LC 11)
Max Uplift 9=4(LC 12)
Max Grav 1=1596(LC 17), 9=1644(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2599/88, 2-3=-2095/137, 3-4=-1903/144, 4-5=-1876/161, 5-6=-1629/152,
6-7=-907/127, 7-8=-907/127, 8-9=-1525/86
BOT CHORD 1-15=-294/2259, 14-15=-294/2259, 13-14=-233/1802, 12-13=-202/1957, 11-12=-148/1452,
10-11=-148/1452
WEBS 2-15=0/252, 2-14=-541/72, 3-14=0/449, 3-13=0/371, 4-12=-940/83, 5-12=-18/725,
6-12=-57/424, 6-10=-1041/97, 7-10=-279/69, 8-10=-68/1629

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=5ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-6-6, Interior(1) 3-6-6 to 12-2-8, Exterior(2R) 12-2-8 to 15-8-14, Interior(1) 15-8-14 to 18-10-8, Exterior(2R) 18-10-8 to 22-4-14, Interior(1) 22-4-14 to 35-2-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

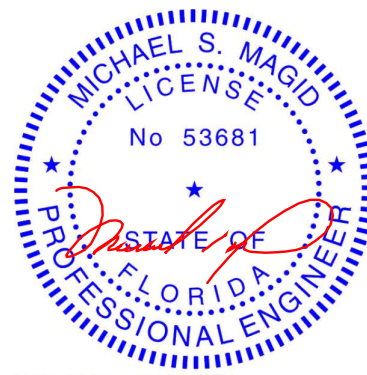

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MITek Industries, Inc. Fri Jun 3 13:44:50 2022 Page 1
ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-8fV?EmgB8fTghRvKWlPLGkVZ6ddvOvrQzR?rIEz9znR
1-4-8 2-3-8 8-6-8 14-9-8 21-6-12 28-2-4 34-11-8
1-4-8 2-3-8 6-3-0 6-3-0 6-9-4 6-7-8 6-9-4
Scale: 3/16"=1'

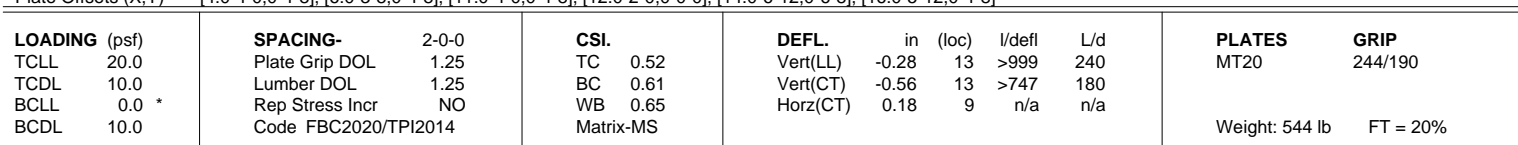

BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 4-5-5 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 10-0-0 oc bracing: 16-18, 12-14


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD
2-19=3005/176, 2-3=2229/192, 3-4=6846/177, 4-5=6846/177, 5-6=9904/377,
6-7=4074/193, 7-8=4074/193, 8-9=2885/185

BOT CHORD
3-16=2706/236, 15-16=253/2377, 14-15=290/10027, 12-14=0/334, 5-14=0/651,
11-12=0/510, 10-11=186/5964


WEBS
2-16=239/3743, 3-15=20/4884, 4-15=634/141, 5-15=3454/208, 11-14=199/5604,
6-14=169/4272, 6-11=1110/190, 6-10=2228/69, 7-10=986/278, 8-10=176/4763

- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) Provide adequate drainage to prevent water ponding.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=210, 9=117.
- 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 200 lb down and 165 lb up at 1-9-8 on top chord, and 94 lb down and 60 lb up at 1-11-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiteTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.



Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911817
WESTON_OAKS_LOT_53	C01	Roof Special Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:50 2022 Page 2
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-8fV?EmgB8FtghRvKWIPLGkVZ6ddvOvrQzR?rlEz9znR

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-2=-60, 2-8=-60, 18-19=-20, 17-18=-20, 14-16=-20, 12-13=-20, 9-12=-20

Concentrated Loads (lb)

Vert: 18=-28(B) 3=-138(B) 20=-114(B) 22=-114(B) 23=-114(B) 24=-114(B) 25=-114(B) 26=-114(B) 27=-129(B) 28=-129(B) 29=-129(B) 30=-129(B) 31=-129(B) 32=-129(B) 33=-129(B) 35=-129(B) 36=-129(B) 37=-130(B) 38=-77(B) 39=-77(B) 40=-77(B) 41=-77(B) 42=-77(B) 43=-77(B) 44=-61(B) 45=-61(B) 46=-61(B) 47=-61(B) 48=-61(B) 49=-61(B) 50=-61(B) 51=-61(B) 52=-61(B) 53=-61(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911818
WESTON_OAKS_LOT_53	C02	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:52 2022 Page 1
ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-41dlfSiRgs7Oxk3jdARpL9ap?QG7sl4jRIUxq6z9znP

2-3-8	8-6-8	14-9-8	21-6-12	28-2-4	34-11-8
2-3-8	6-3-0	6-3-0	6-9-4	6-7-8	6-9-4

Scale = 1:60.4

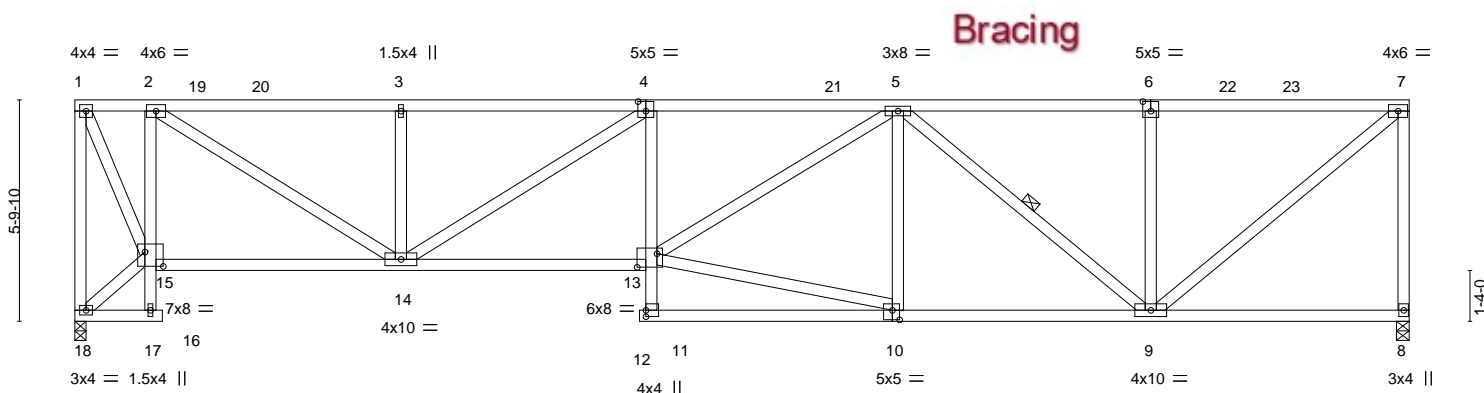

2-3-8	8-6-8	14-9-8	21-6-12	28-2-4	34-11-8
2-3-8	6-3-0	6-3-0	6-9-4	6-7-8	6-9-4

Plate Offsets (X,Y)-- [4:0-2-8,0-3-0], [6:0-2-8,0-3-0], [10:0-2-4,0-3-0], [11:0-2-0,0-0-0], [13:0-6-4,0-4-4], [15:0-5-12,0-4-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.87	Vert(LL)	-0.18 12	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.76	Vert(CT)	-0.38 13-14	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.92	Horz(CT)	0.15 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 232 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied. Except:
10-0-0 oc bracing: 15-17, 11-13
WEBS 1 Row at midpt 5-9

REACTIONS.


(size) 18=0-3-8, 8=0-4-0
Max Horz 18=154(LC 8)
Max Grav 18=1396(LC 1), 8=1390(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-18=1359/416, 1-2=635/251, 2-3=2203/552, 3-4=2203/552, 4-5=2937/677,
5-6=1368/328, 6-7=1368/328, 7-8=1328/345
BOT CHORD 2-15=1249/396, 14-15=340/691, 13-14=756/2951, 4-13=0/273, 9-10=549/2123
WEBS 1-15=426/1483, 2-14=433/1812, 3-14=444/220, 4-14=891/202, 10-13=558/2050,
5-13=245/969, 5-10=375/192, 5-9=982/279, 6-9=330/165, 7-9=373/1735

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3) 0-1-12 to 3-1-12, Exterior(2) 3-1-12 to 31-9-12, Corner(3) 31-9-12 to 34-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingle Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingle Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911819
WESTON_OAKS_LOT_53	C03	Half Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:53 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-YEB8toi3RAFFYuevBuy2tM70Nqa9bGxsfPDVMZ9znO

1-4-8	1-3-8	2-3-8	8-6-8	14-9-8	21-6-12	28-2-4	34-11-8
1-4-8	1-3-8	1-0-0	6-3-0	6-3-0	6-9-4	6-7-8	6-9-4

Scale = 1:62.2

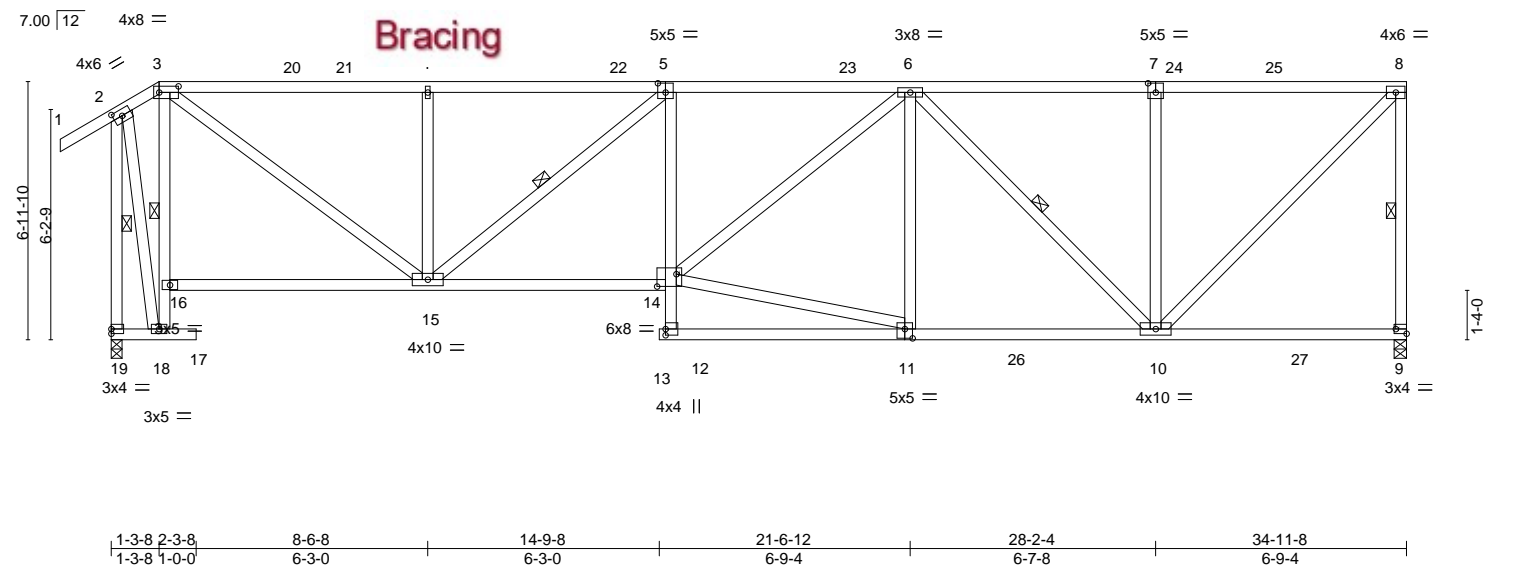


Plate Offsets (X,Y)-- [2:0-2-14,0-2-0], [3:0-6-4,0-2-0], [5:0-2-8,0-3-0], [7:0-2-8,0-3-0], [9:Edge,0-1-8], [11:0-2-8,0-3-0], [12:0-2-0,0-0-0], [14:0-6-4,0-4-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.71	Vert(LL)	-0.19 10-11 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.83	Vert(CT)	-0.36 11-12 >999 180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.69	Horz(CT)	0.37 9 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS				Weight: 253 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2 *Except*
3-18,6-11,7-10: 2x4 SP SS

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied. Except:
10-0-0 oc bracing: 12-14
WEBS 1 Row at midpt 8-9, 3-18, 5-15, 6-10, 2-19

REACTIONS.


(size) 9=0-4-0, 19=0-3-8
Max Horz 19=200(LC 9)
Max Uplift 9=-2(LC 12), 19=-20(LC 12)
Max Grav 9=1569(LC 17), 19=1612(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-445/117, 3-4=-1941/66, 4-5=-1941/66, 5-6=-2531/54, 6-7=-1300/59, 7-8=-1300/59,
8-9=-1436/40, 2-19=-1588/63
BOT CHORD 15-16=-186/411, 14-15=0/2570, 5-14=0/275, 10-11=0/1959
WEBS 16-18=-1225/53, 3-16=-1147/74, 3-15=0/1971, 4-15=-502/95, 5-15=-814/0,
11-14=-9/1875, 6-14=-2/780, 6-11=-292/63, 6-10=-953/31, 7-10=-331/73, 8-10=0/1766,
2-18=0/1284

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-8 to 6-2-13, Interior(1) 6-2-13 to 34-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 19.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

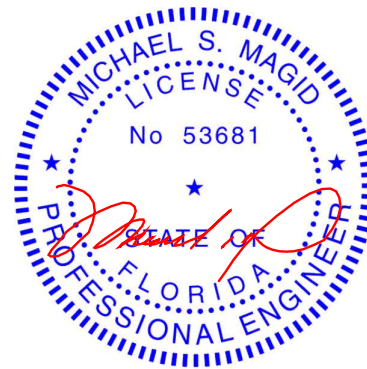

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911820
WESTON_OAKS_LOT_53	C04	Hip	1	1	Job Reference (optional)	


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:54 2022 Page 1

ID: i8Ek8XYpfa3J_9f2X4psRyDI5m-0QkW48jhCUO6A2C6lbTHQagChEvsKk4?u3z2u?z9znN

-1-4-8	2-3-8	3-3-8	9-0-8	14-9-8	21-0-8	27-3-8	34-11-8
1-4-8	2-3-8	1-0-0	5-9-0	5-9-0	6-3-0	6-3-0	7-8-0

Scale: 3/16"=1'

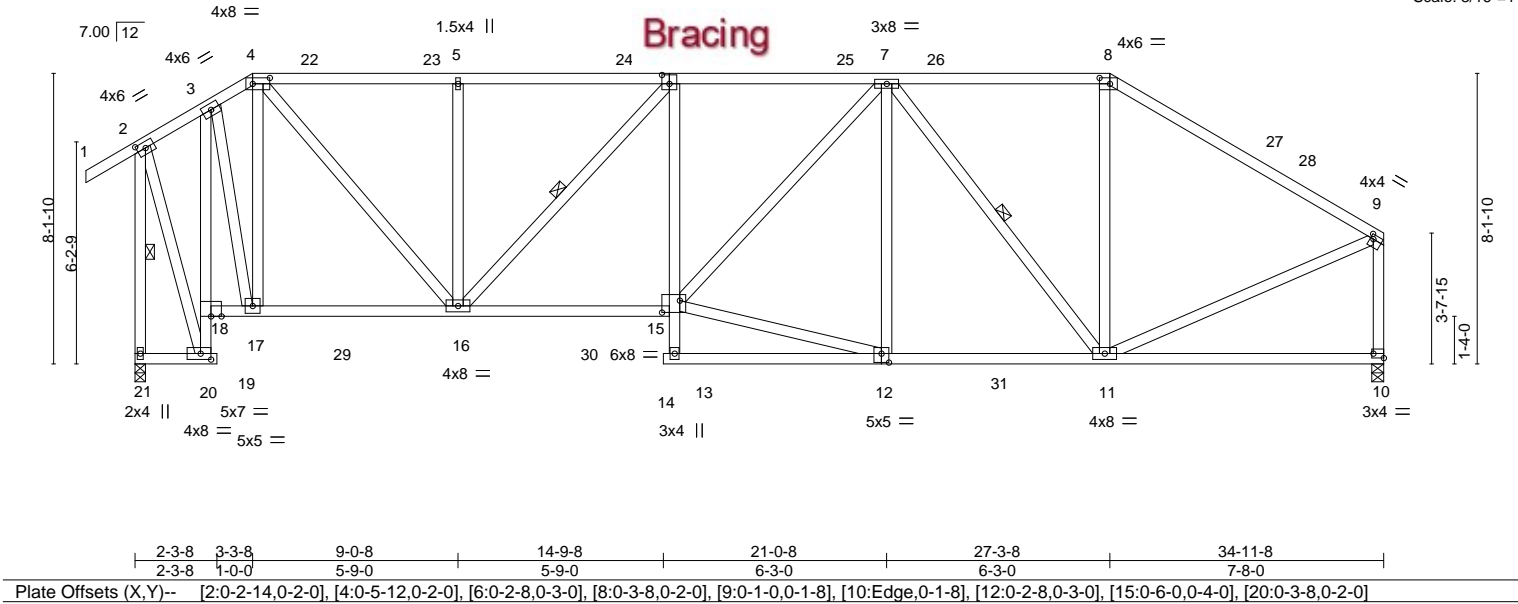


LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.67	Vert(LL)	-0.15	15-16	>999	240	MT20	244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.93	Vert(CT)	-0.27	15-16	>999	180			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.63	Horz(CT)	0.17	10	n/a	n/a			
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							Weight: 275 lb	FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied. Except:
WEBS 2x4 SP No.2	4-5-0 oc bracing: 18-20
	10-0-0 oc bracing: 13-15
	WEBS 1 Row at midpt 6-16, 7-11, 2-21

REACTIONS.	(size) 21=0-3-8, 10=0-4-0
	Max Horz 21=-211(LC 10)
	Max Uplift 21=-28(LC 12)
	Max Grav 21=1654(LC 17), 10=1568(LC 18)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-603/117, 3-4=-884/88, 4-5=-1679/81, 5-6=-1679/81, 6-7=-2130/71, 7-8=-1268/89, 8-9=-1539/66, 2-21=-1778/43, 9-10=-1447/42
BOT CHORD	18-20=-1176/3, 3-18=-1358/0, 17-18=-70/558, 16-17=-48/815, 15-16=0/2180, 6-15=0/297, 11-12=0/1718
WEBS	3-17=0/1224, 4-17=-861/56, 4-16=0/1434, 5-16=-418/82, 6-16=-725/0, 12-15=0/1683, 7-15=0/673, 7-12=-281/51, 7-11=-783/14, 8-11=0/440, 2-20=0/1360, 9-11=0/1274

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-8 to 2-0-9, Interior(1) 2-0-9 to 3-3-8, Exterior(2R) 3-3-8 to 8-2-13, Interior(1) 8-2-13 to 27-3-8, Exterior(2R) 27-3-8 to 32-2-13, Interior(1) 32-2-13 to 34-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 21.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

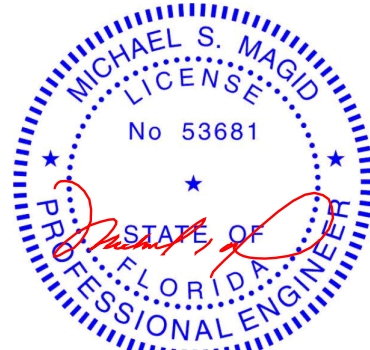

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911821
WESTON_OAKS_LOT_53	C05	Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:56 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-ypsGVqlyj5eqQMMUs0WIV?IWg1blohILNS9zuz9znL

1-4-8	4-3-8	11-8-1	18-10-15	26-3-8	30-5-12	34-11-8
1-4-8	4-3-8	7-4-9	7-2-13	7-4-9	4-2-4	4-5-12

Scale = 1:60.7

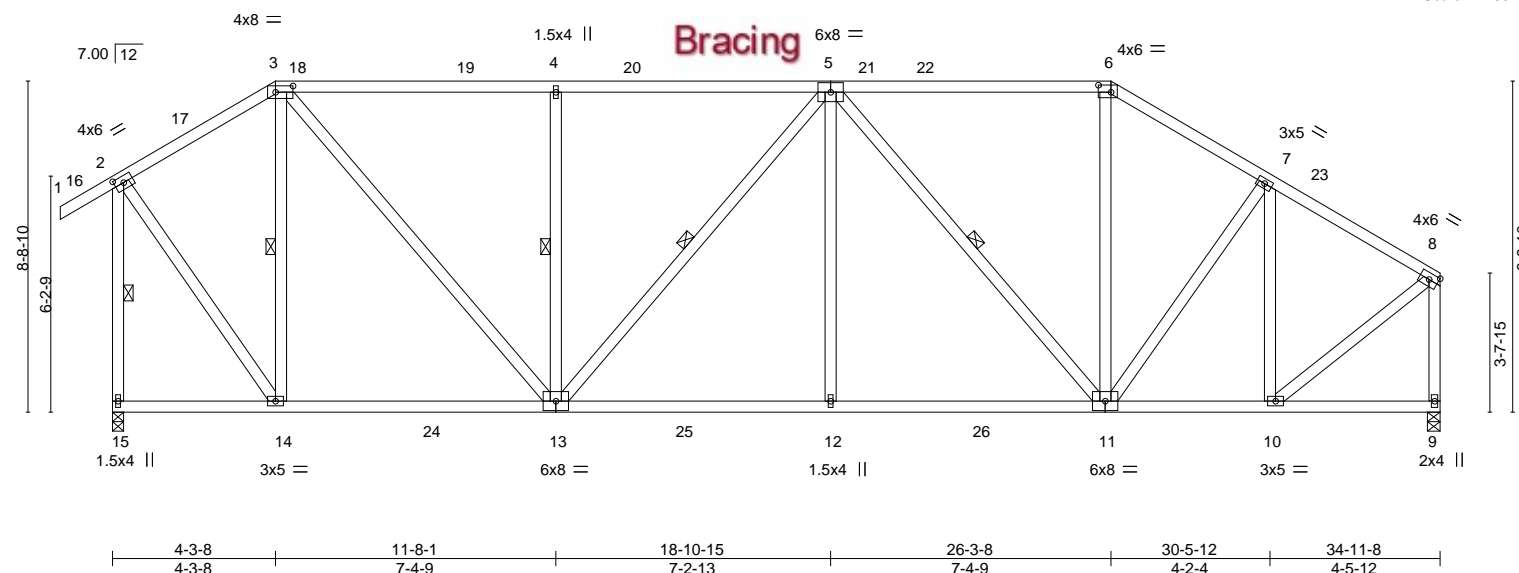


Plate Offsets (X,Y)-- [2:0-2-14,0-2-0], [3:0-5-8,0-2-0], [6:0-4-0,0-2-4]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.83	Vert(LL)	-0.17	13-14	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.90	Vert(CT)	-0.31	13-14	>999	180		
BCLL	0.0 *	Rep Stress Incr YES		WB	0.40	Horz(CT)	0.06	9	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							Weight: 256 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 3-14, 4-13, 5-13, 5-11, 2-15

REACTIONS.


(size) 15=0-3-8, 9=0-4-0
Max Horz 15=-222(LC 10)
Max Uplift 15=-34(LC 12), 9=-2(LC 12)
Max Grav 15=1668(LC 17), 9=1587(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-952/106, 3-4=-1508/114, 4-5=-1508/114, 5-6=-1276/105, 6-7=-1502/99,
7-8=-1273/58, 2-15=-1648/55, 8-9=-1520/26
BOT CHORD 13-14=-30/819, 12-13=0/1715, 11-12=0/1715, 10-11=0/1032
WEBS 3-14=-731/67, 3-13=-16/1188, 4-13=-525/105, 5-13=-313/0, 5-12=0/496, 5-11=-709/0,
6-11=0/394, 7-11=-8/406, 7-10=-614/43, 2-14=0/1292, 8-10=0/1266

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=35ft; eave=4ft; Cat. II; Exp B; Encl.; GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-8 to 2-1-7, Interior(1) 2-1-7 to 4-3-8, Exterior(2R) 4-3-8 to 9-2-13, Interior(1) 9-2-13 to 26-3-8, Exterior(2R) 26-3-8 to 31-2-13, Interior(1) 31-2-13 to 34-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 9.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911822
WESTON_OAKS_LOT_53	CJ01	Diagonal Hip Girder	3	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:57 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-Q?Qei9laUPmh1VxgQj1_2ClpJR8MXEcSa1BiVKz9znK

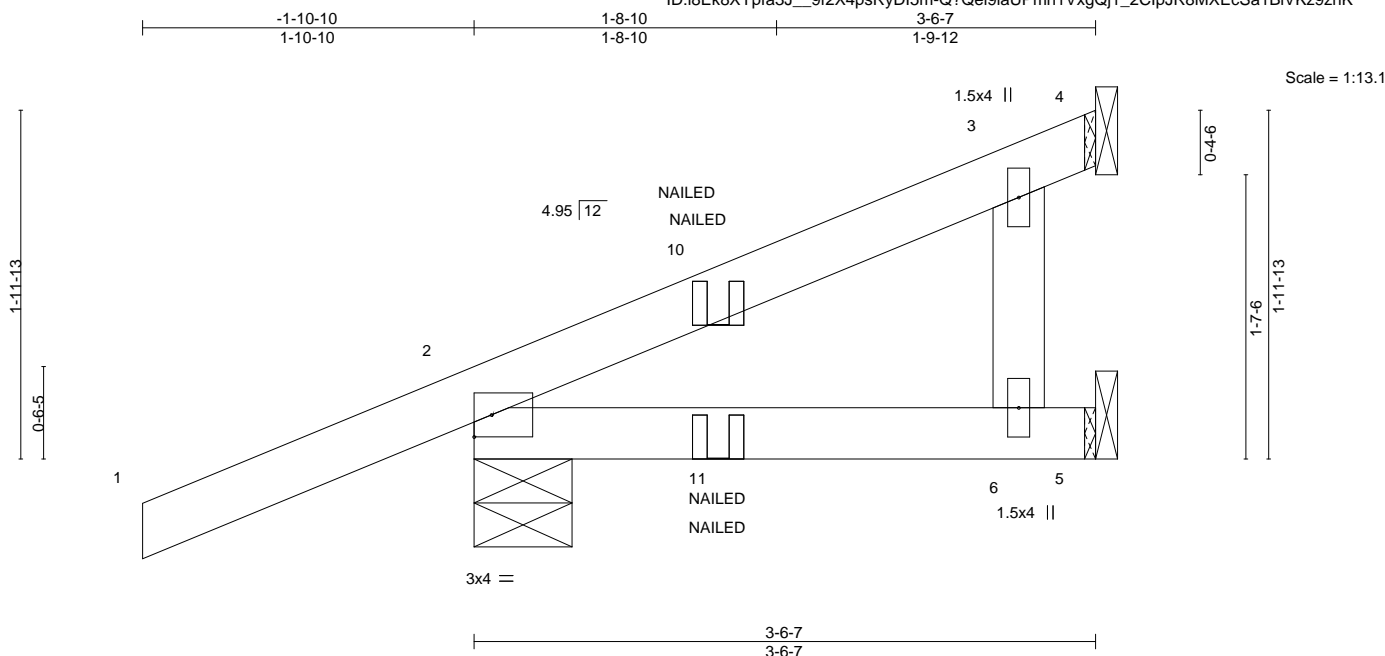

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.26	Vert(LL)	0.01	6-9	>999	240	MT20
TCCL 10.0	Lumber DOL	1.25	BC 0.11	Vert(CT)	-0.01	6-9	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.01	Horz(CT)	0.00	2	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 16 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-7 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-6-11, 5=Mechanical
Max Horz 2=63(LC 24)
Max Uplift 2=52(LC 8), 5=16(LC 8)
Max Grav 4=57(LC 3), 2=283(LC 1), 5=84(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
Vert: 1-4=60, 5-7=20



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911823
WESTON_OAKS_LOT_53	CJ02	Diagonal Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:58 2022 Page 1

ID:8Ek8XYpfa3J_9f2X4psRyDI5m-vB_0wVmCFiuYffWt_RYDaQq_3rUbGhsbphxG1mz9znJ

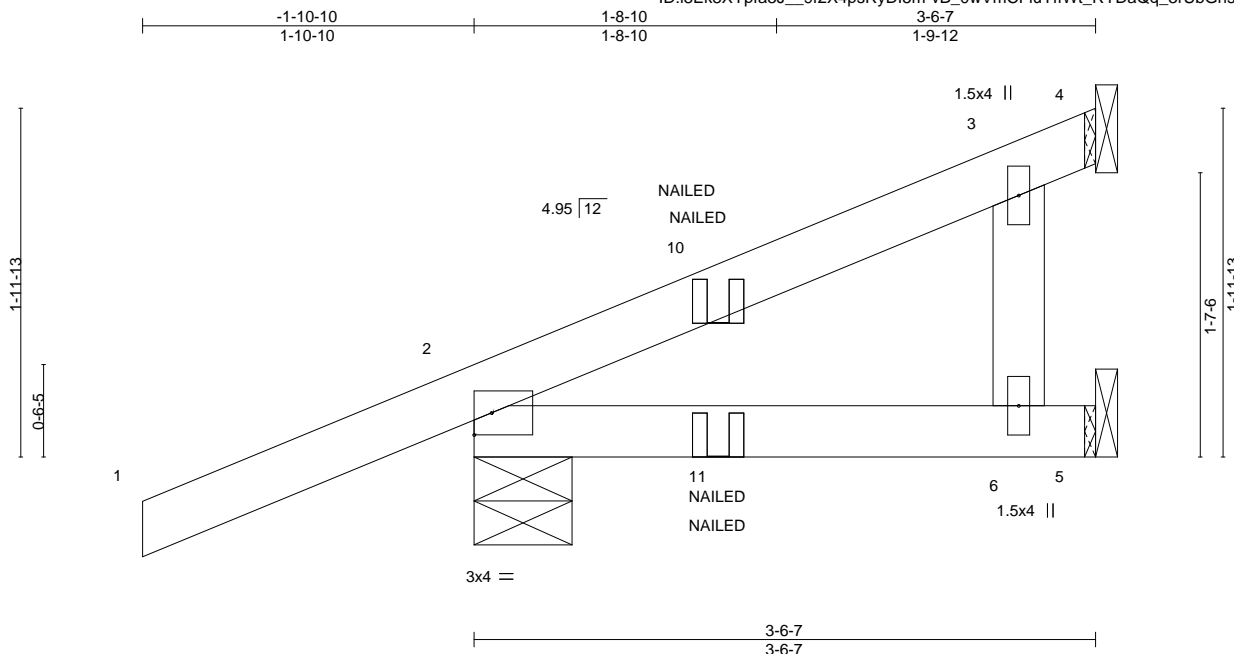

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.26	Vert(LL)	0.01	6-9	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.11	Vert(CT)	-0.01	6-9	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.01	Horz(CT)	0.00	2	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 16 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-7 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-6-11, 5=Mechanical
Max Horz 2=63(LC 8)
Max Uplift 2=52(LC 8), 5=16(LC 8)
Max Grav 4=57(LC 3), 2=283(LC 1), 5=84(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
Vert: 1-4=-60, 5-7=-20

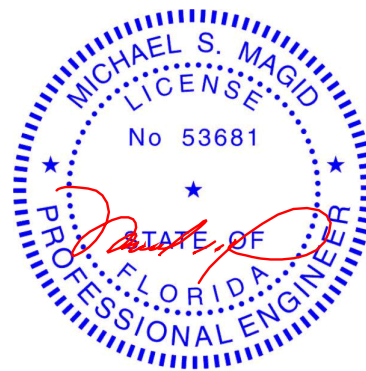

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911824
WESTON_OAKS_LOT_53	CJ03	Diagonal Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:44:59 2022 Page 1
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-NNYP7mq000PHp53X83S7dN5VF3?5T12LgpaCz9znI

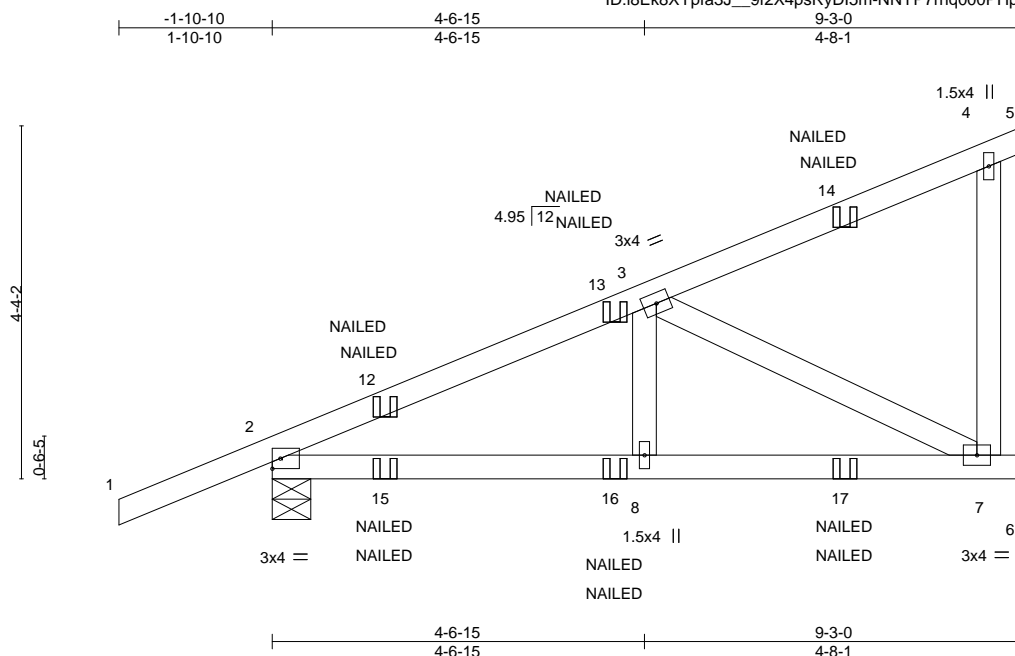

Scale = 1:28.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.54	Vert(LL)	-0.04	7-8	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.54	Vert(CT)	-0.09	7-8	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.24	Horz(CT)	-0.01	5	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
								Weight: 46 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=Mechanical, 2=0-5-11, 6=Mechanical
Max Horz 2=119(LC 8)
Max Uplift 2=41(LC 8), 6=114(LC 8)
Max Grav 5=206(LC 3), 2=536(LC 1), 6=355(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-659/0
BOT CHORD 2-8=-39/564, 7-8=-39/564
WEBS 3-7=-631/43

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 6=114.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 6-9=-20
Concentrated Loads (lb)
Vert: 13=-0(F) 14=-96(F=-51, B=-45) 16=-12(F=-10, B=-2) 17=-62(F=-33, B=-28)



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911825
WESTON_OAKS_LOT_53	CJ04	Diagonal Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:00 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDl5m-ra6nLBoSnK8GuzgF5sahgrwKZf8zkbouG?QM6fz9znH

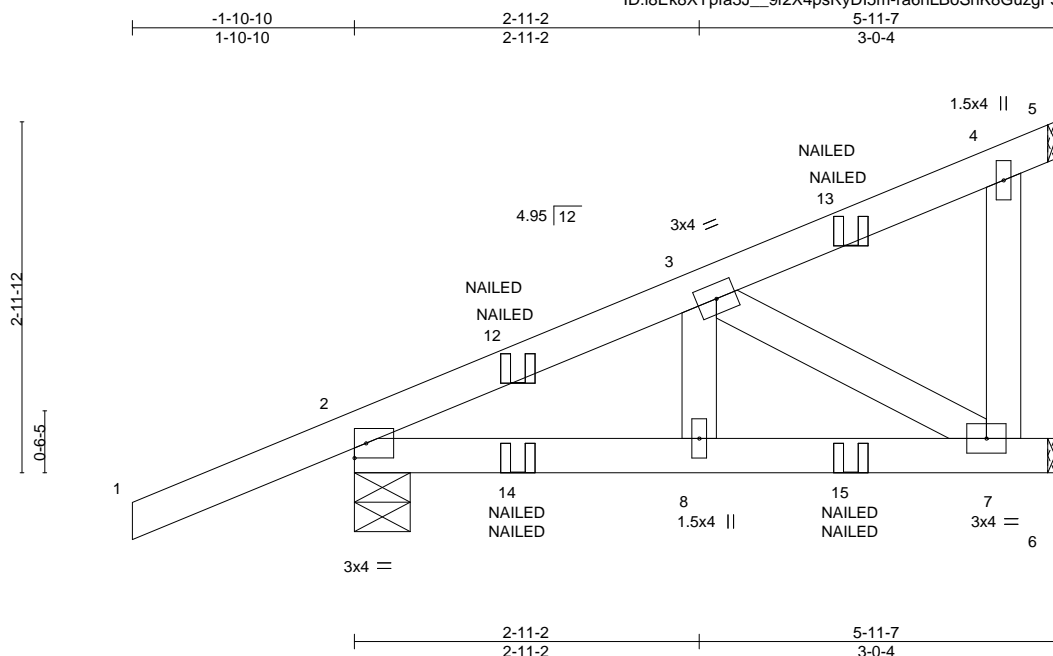

Scale = 1:19.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.26	Vert(LL)	-0.01	7-8	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.18	Vert(CT)	-0.02	7-8	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.04	Horz(CT)	-0.00	5	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 31 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-7 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=Mechanical, 2=0-5-11, 6=Mechanical
Max Horz 2=87(LC 8)
Max Uplift 2=42(LC 8), 6=22(LC 5)
Max Grav 5=86(LC 3), 2=368(LC 1), 6=138(LC 29)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-287/0
WEBS 3-7=-264/9

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 6-9=-20
Concentrated Loads (lb)
Vert: 15=-4(F=-2, B=-2)



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911826
WESTON_OAKS_LOT_53	CJ05	Diagonal Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:02 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-nyDXltpjJxOz8HqeDHd9IG?cvSkiCRHBKJvTAXz9znF

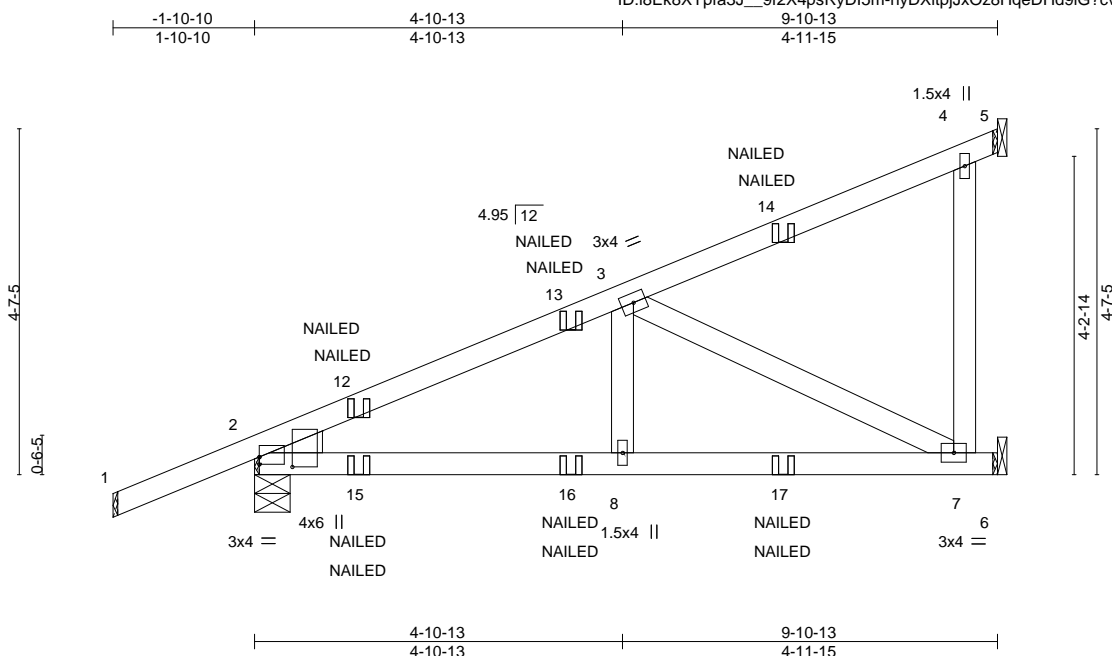


Plate Offsets (X,Y)--		[2:Edge,0-1-3], [2:0-1-9,0-5-4]							
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.53	Vert(LL)	-0.05 7-8 >999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.55	Vert(CT)	-0.10 7-8 >999	180	
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.30	Horz(CT)	0.01 6 n/a	n/a	
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 51 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=Mechanical, 2=0-5-11, 6=Mechanical
Max Horz 2=126(LC 24)
Max Uplift 2=38(LC 8), 6=120(LC 8)
Max Grav 5=218(LC 3), 2=562(LC 1), 6=374(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-699/0
BOT CHORD 2-8=-39/612, 7-8=-39/612
WEBS 3-8=0/268, 3-7=-682/43

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 6=120.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-60, 6-9=-20
Concentrated Loads (lb)
Vert: 14=-91(F=-45, B=-45) 16=-4(F=-2, B=-2) 17=-56(F=-28, B=-28)



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911827
WESTON_OAKS_LOT_53	D01	Hip Girder	1	1	Job Reference (optional)	

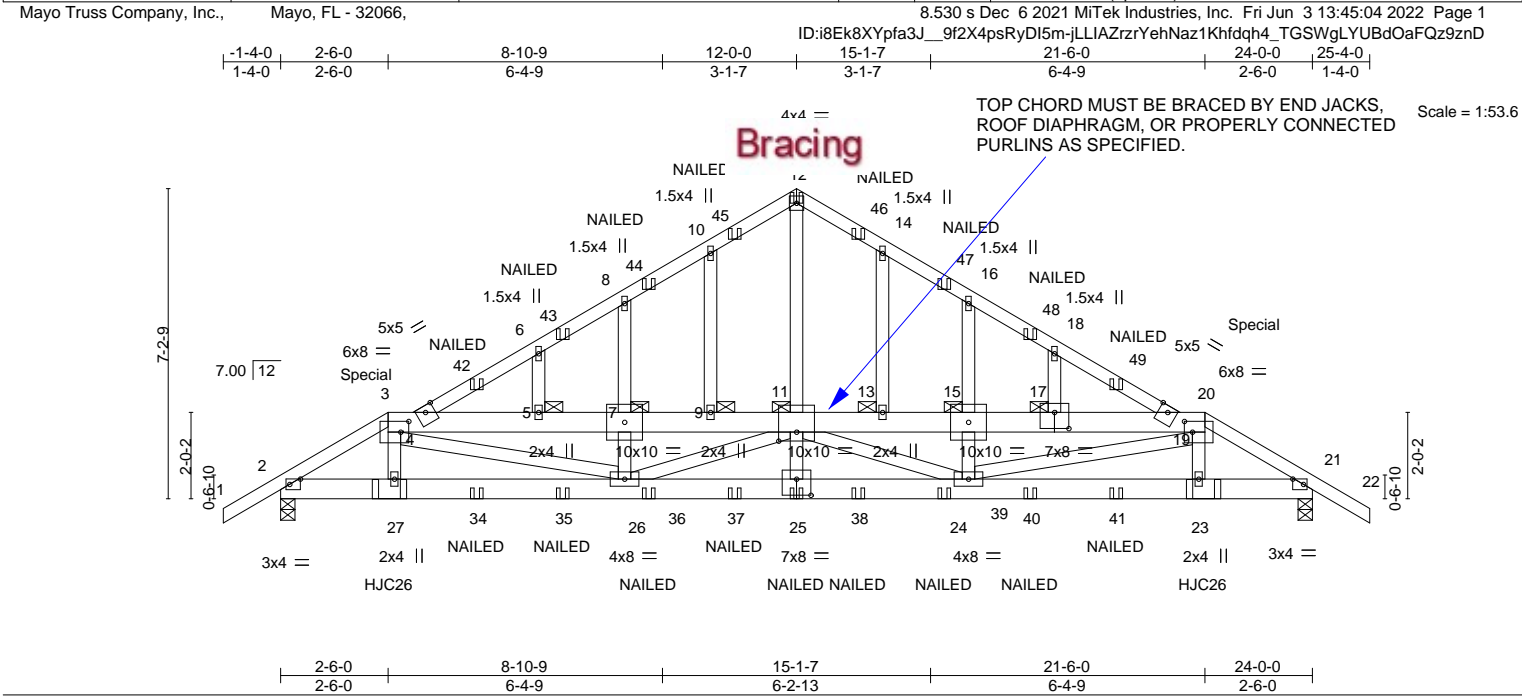



Plate Offsets (X,Y)-- [2:0-3-0,Edge], [3:0-2-4,0-3-0], [11:0-5-0,0-2-8], [17:0-4-0,0-4-8], [20:0-2-4,0-3-0], [21:0-3-0,Edge], [25:0-4-0,0-4-8]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.		in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.39	Vert(LL)	-0.06	24	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.40	Vert(CT)	-0.12	24	>999	180	
BCLL	0.0 **	Rep Stress Incr	NO	WB	0.25	Horz(CT)	0.03	21	n/a	n/a	
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							Weight: 210 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except*	TOP CHORD Structural wood sheathing directly applied or 4-5-8 oc purlins.
3-17,17-20: 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD 2x6 SP No.2	JOINTS 1 Brace at Jt(s): 11, 9, 7, 5, 13, 15, 17
WEBS 2x4 SP No.2	

REACTIONS.	(size) 2=0-4-0, 21=0-4-0	TRUSS DESIGNED FOR WIND LOADS IN THE PLANE OF THE TRUSS ONLY. FOR STUDS EXPOSED TO WIND (NORMAL TO THE FACE), SEE STANDARD INDUSTRY GABLE END DETAILS AS APPLICABLE, OR CONSULT QUALIFIED BUILDING DESIGNER AS PER ANSI/TPI 1.
	Max Horz 2=130(LC 23)	
	Max Uplift 2=70(LC 8), 21=70(LC 8)	
	Max Grav 2=1057(LC 29), 21=1057(LC 30)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1647/51, 3-4=-1661/83, 4-5=-879/109, 5-7=-879/109, 7-9=-814/90, 9-11=-814/90, 11-13=-915/110, 13-15=-915/110, 15-17=-990/131, 17-19=-990/131, 19-20=-1769/106, 20-21=-1649/54, 4-6=-1092/7, 6-8=-1050/42, 8-10=-1073/79, 10-12=-1048/108, 12-14=-1056/109, 14-16=-1088/82, 16-18=-1030/34, 18-19=-1118/10
BOT CHORD	2-27=0/1480, 26-27=0/1484, 25-26=0/764, 24-25=0/764, 23-24=0/1439, 21-23=0/1436
WEBS	11-12=-72/891, 7-26=-396/116, 15-16=-266/74, 15-24=-461/131, 3-26=-36/375, 11-26=-91/1066, 11-24=-112/1148, 20-24=-55/459

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 21.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Use MiTek HJC26 (With 16-16d nails into Girder & 10d nails into Truss) or equivalent spaced at 18-11-4 oc max. starting at 2-6-6 from the left end to 21-5-10 to connect truss(es) to front face of bottom chord.
 - Fill all nail holes where hanger is in contact with lumber.
 - "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 108 lb down and 58 lb up at 2-6-0, and 108 lb down and 58 lb up at 21-5-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

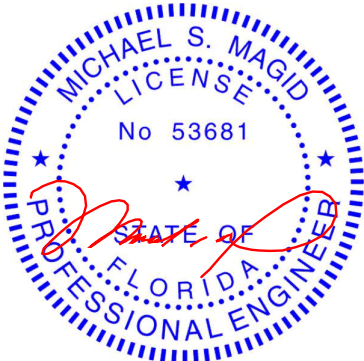

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911827
WESTON_OAKS_LOT_53	D01	Hip Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:04 2022 Page 2
ID:i8Ek8Xypfa3J__9f2X4psRyDI5m-jLLIAZrZrYehNaz1Khfdqh4_TGSWgLYUBdOaFQz9znD

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-60, 3-4=-60, 19-20=-60, 20-22=-60, 28-31=-20, 4-12=-60, 12-19=-60

Concentrated Loads (lb)

Vert: 3=58(F) 20=58(F) 27=-57(F) 23=-57(F) 12=-0(F) 25=-1(F) 34=-1(F) 35=-1(F) 36=-1(F) 37=-1(F) 38=-1(F) 39=-1(F) 40=-1(F) 41=-1(F) 42=-0(F) 43=-0(F) 44=-0(F) 45=-0(F) 46=-0(F) 47=-0(F) 48=-0(F) 49=-0(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911828
WESTON_OAKS_LOT_53	D02	Common	6	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:05 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-CXvgOvsbcsmyY?kYDuPAsNudAxxgmhPIJdQH77nsz9znC



Scale = 1:46.5

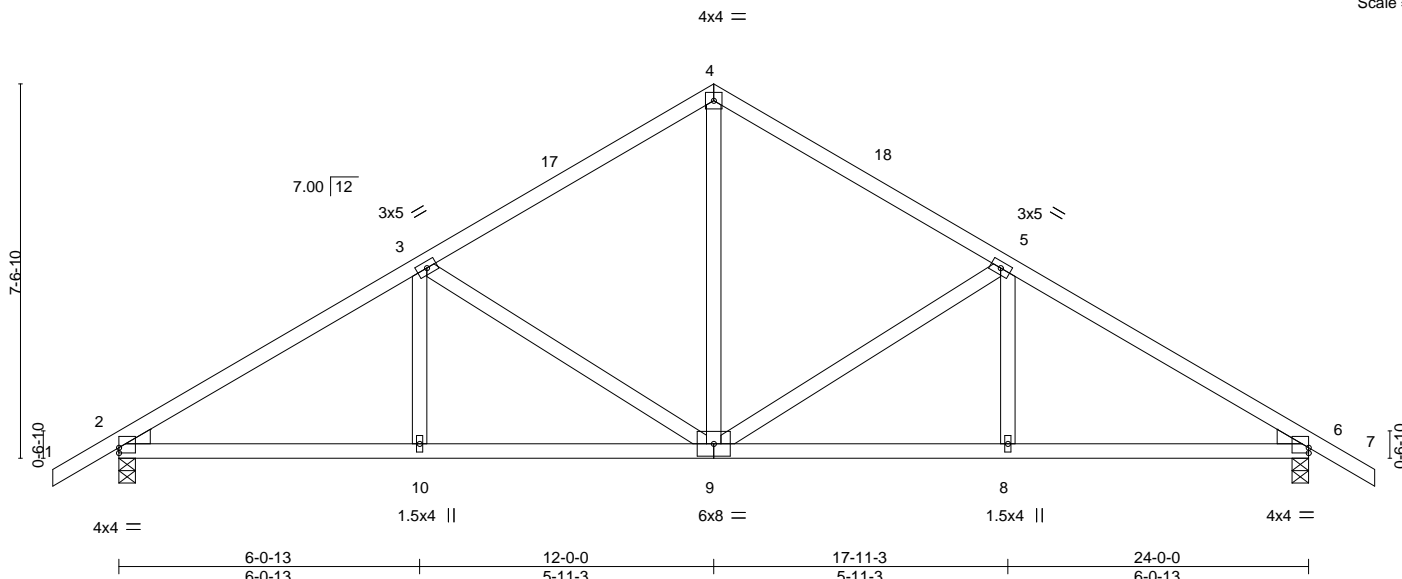


Plate Offsets (X,Y)-- [2:0-0-0,0-1-5], [6:Edge,0-1-5]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.35	Vert(LL)	-0.06 9-10	>999	240
TCDL 10.0	Lumber DOL	1.25	BC 0.47	Vert(CT)	-0.15 9-10	>999	180
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.41	Horz(CT)	0.05 6	n/a	n/a
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS				
				PLATES	GRIP		
				MT20	244/190		
				Weight: 124 lb	FT = 20%		

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 2=0-4-0, 6=0-4-0
 Max Horz 2=135(LC 11)
 Max Uplift 2=-32(LC 12), 6=-32(LC 12)
 Max Grav 2=1040(LC 1), 6=1040(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1476/52, 3-4=-1026/105, 4-5=-1026/105, 5-6=-1476/52
 BOT CHORD 2-10=0/1194, 9-10=0/1194, 8-9=0/1194, 6-8=0/1194
 WEBS 4-9=-4/595, 5-9=-482/62, 5-8=0/261, 3-9=-482/62, 3-10=0/261

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 25-4-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

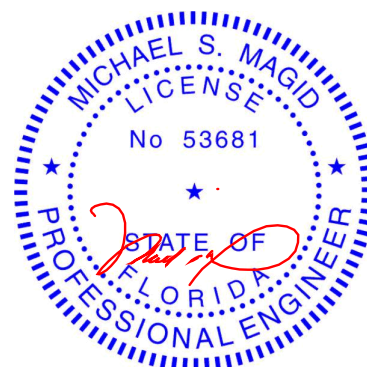

Michael S. Magid PE No.53681
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job WESTON_OAKS_LOT_53	Truss D03	Truss Type Common	Qty 3	Ply 1	PAYNE	T27911829
Job Reference (optional)						

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:06 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-gkT2bEsDNAuPcu7PS6h5v6ALh36v8C0mfxthKlz9znB

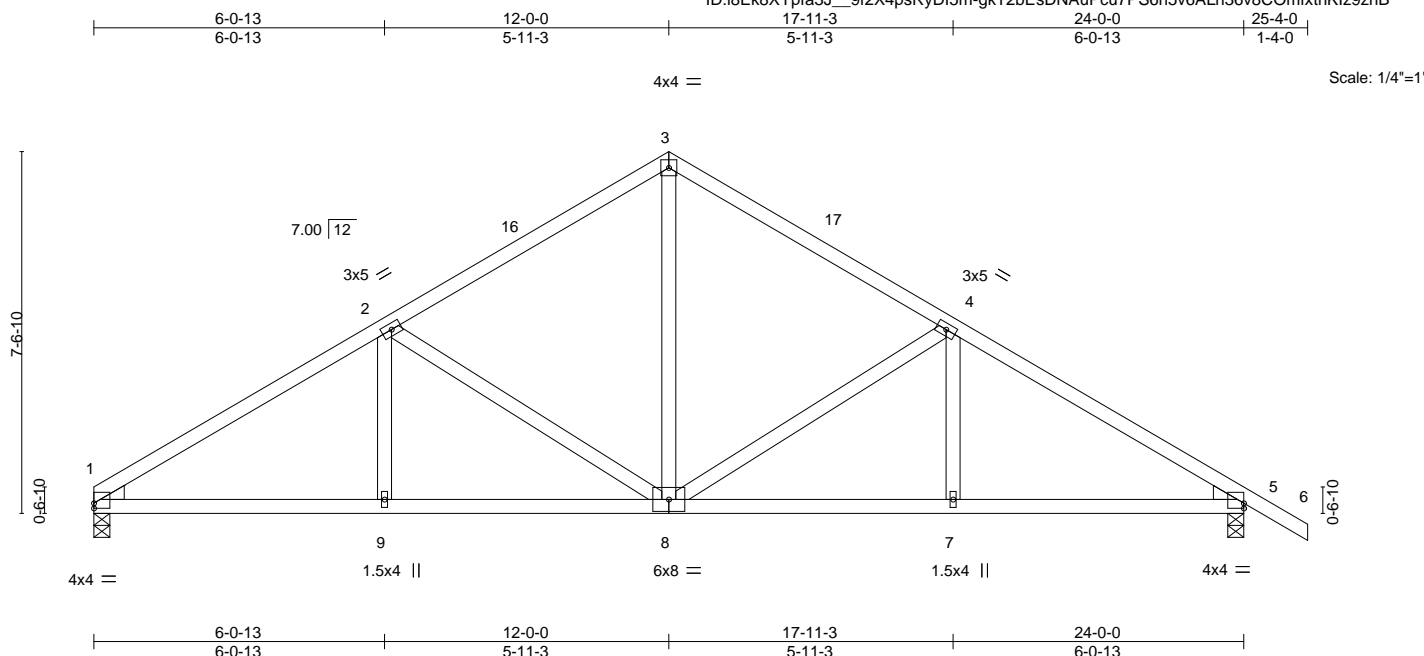


Plate Offsets (X,Y)--		[1:0-0-0,0-1-5], [5:Edge,0-1-5]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.35	Vert(LL)	-0.06	8-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.47	Vert(CT)	-0.15	7-8	>999	180		
BCLL	0.0 *	Rep Stress Incr YES		WB	0.42	Horz(CT)	0.05	5	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS							Weight: 122 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE

Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 1=0-4-0, 5=0-4-0
Max Horz 1=131(LC 10)
Max Uplift 5=34(LC 12)
Max Grav 1=958(LC 1), 5=1042(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1490/59, 2-3=-1031/108, 3-4=-1030/106, 4-5=-1481/54
BOT CHORD 1-9=0/1209, 8-9=0/1209, 7-8=0/1198, 5-7=0/1198
WEBS 3-8=-7/601, 4-8=-482/62, 4-7=0/261, 2-8=-494/64, 2-9=0/263

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 25-4-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911830
WESTON_OAKS_LOT_53	D3A	Roof Special	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:08 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-c6bo0wuTvn87sCHoZXkZ_XFZLthGc4O36FMnOBz9zn9



Scale = 1:46.7

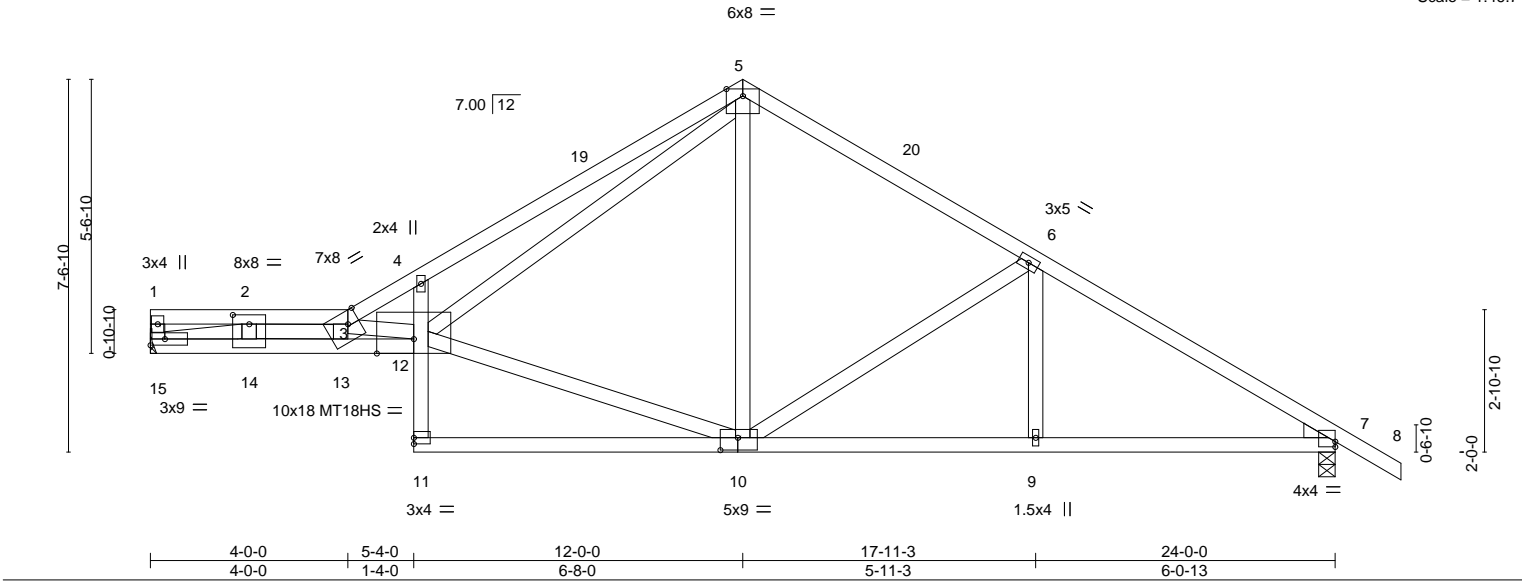


Plate Offsets (X,Y)-- [2:0-4-0,0-2-4], [3:0-2-12,Edge], [7:0-0-0,0-1-5], [10:0-4-4,0-3-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.79	Vert(LL)	-0.24 11	>999	240
TCDL 10.0	Lumber DOL	1.25	BC 0.92	Vert(CT)	-0.48 11	>598	180
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.52	Horz(CT)	0.10 7	n/a	n/a
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS				
				PLATES	GRIP		
				MT20	244/190		
				MT18HS	244/190		
				Weight: 139 lb	FT = 20%		

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2 *Except*
 12-15: 2x4 SP No.1
 WEBS 2x4 SP No.2
 WEDGE
 Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 15=Mechanical, 7=0-4-0
 Max Horz 15=123(LC 10)
 Max Uplift 7=37(LC 12)
 Max Grav 15=952(LC 1), 7=1036(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-284/9, 2-3=-4394/66, 3-4=-3124/76, 4-5=-3087/204, 5-6=-1017/113, 6-7=-1469/59
 BOT CHORD 14-15=0/2561, 13-14=0/2561, 12-13=0/4565, 4-12=-395/145, 9-10=0/1187, 7-9=0/1187
 WEBS 3-13=-717/27, 3-12=-1911/7, 10-12=0/634, 5-12=-113/2285, 5-10=0/270, 6-10=-481/59,
 6-9=0/265, 2-15=-2390/51, 2-13=-20/1925

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 25-4-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

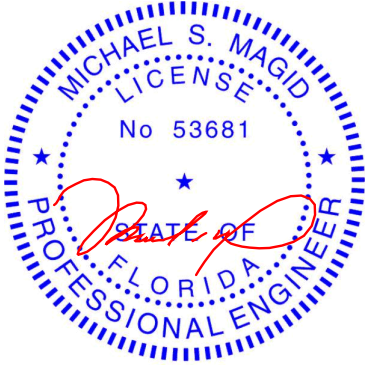

Michael S. Magid PE No.53681
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911831
WESTON_OAKS_LOT_53	G01	Half Hip Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:09 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-4J8BEGv6f5G_TLs_7FFoXknsBHD2Ld6DLv5Lwdz9zn8

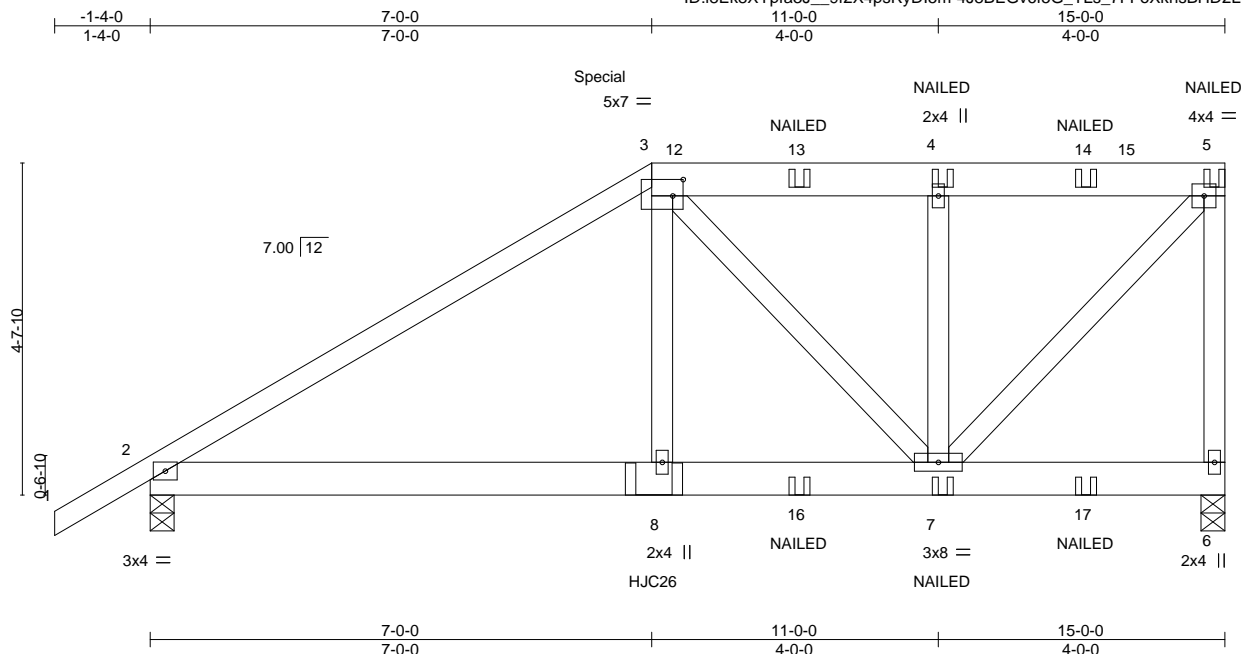


Plate Offsets (X,Y)--	[3:0-1-12,0-2-12]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.27	Vert(LL)	-0.01 8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.18	Vert(CT)	-0.03 8-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.17	Horz(CT)	0.01 6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 200 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
3-5: 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 6=0-4-0, 2=0-4-0
Max Horz 2=135(LC 7)
Max Uplift 6=148(LC 5), 2=98(LC 8)
Max Grav 6=1470(LC 1), 2=1146(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1644/146, 3-4=-1008/113, 4-5=-1005/112, 5-6=-1396/174
BOT CHORD 2-8=-149/1327, 7-8=-150/1347
WEBS 3-8=-33/583, 3-7=-498/59, 4-7=-563/159, 5-7=-122/1463

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 6=148.
- Use MiTek HJC26 (With 16-16d nails into Girder & 10d nails into Truss) or equivalent at 7-0-6 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 283 lb down and 43 lb up at 7-0-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

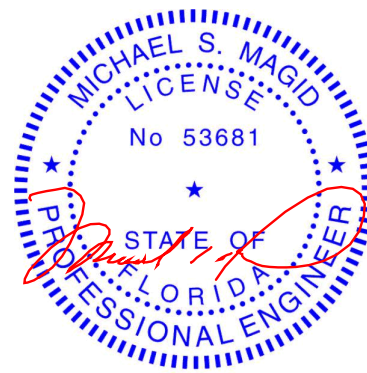

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911831
WESTON_OAKS_LOT_53	G01	Half Hip Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:10 2022 Page 2
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-YViZRcvkQOPr5VRAhym13yK1xhZH44MMZYruT4z9zn7

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 - Uniform Loads (plf)
 - Vert: 1-3=-60, 3-5=-60, 6-9=-20
 - Concentrated Loads (lb)
 - Vert: 3=-210(B) 8=-407(B) 4=-129(B) 7=-61(B) 5=-162(B) 13=-129(B) 14=-129(B) 16=-61(B) 17=-61(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911832
WESTON_OAKS_LOT_53	G02	Half Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:11 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-0hGxeywMBiXijf0NEfHGc9tBb4sWpQBWoCaS?Wz9zn6



Scale = 1:36.5

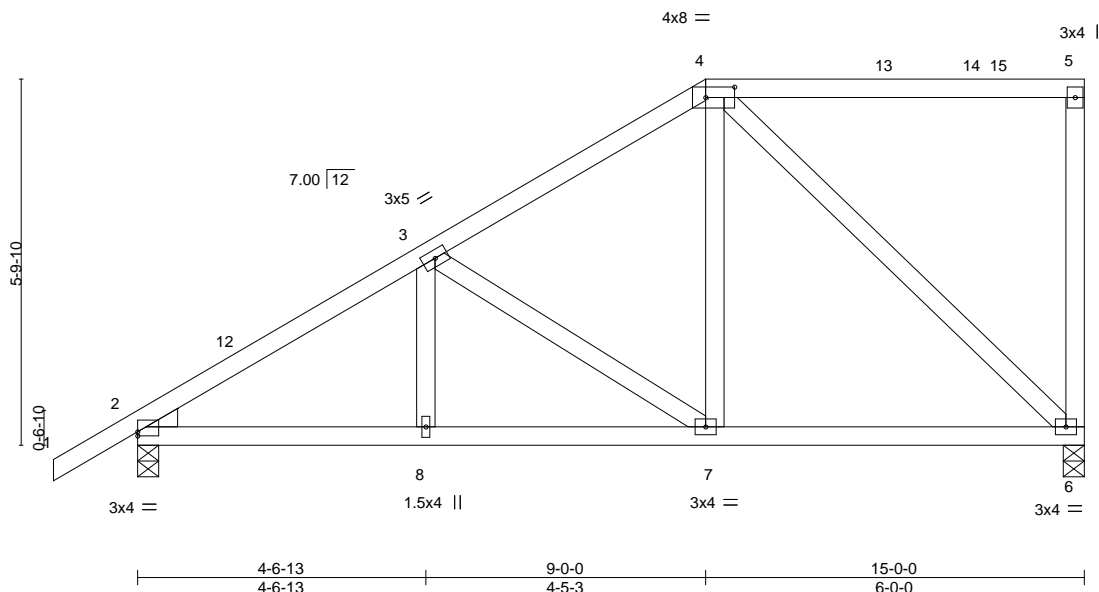


Plate Offsets (X,Y)--		[2:0-0,0-0-13], [4:0-5-8,0-2-0]							
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL 1.25		TC	0.34	Vert(LL)	-0.03 6-7 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.31	Vert(CT)	-0.06 6-7 >999 180		
BCLL	0.0 *	Rep Stress Incr YES		WB	0.58	Horz(CT)	0.01 6 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS				Weight: 88 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 2=0-4-0, 6=0-4-0
Max Horz 2=174(LC 11)
Max Uplift 2=-30(LC 12), 6=-23(LC 9)
Max Grav 2=678(LC 1), 6=591(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-842/34, 3-4=-531/75
BOT CHORD 2-8=-169/665, 7-8=-169/665, 6-7=-111/411
WEBS 3-7=-315/68, 4-7=0/356, 4-6=-536/87

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 9-0-0, Exterior(2R) 9-0-0 to 13-2-15, Interior(1) 13-2-15 to 14-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

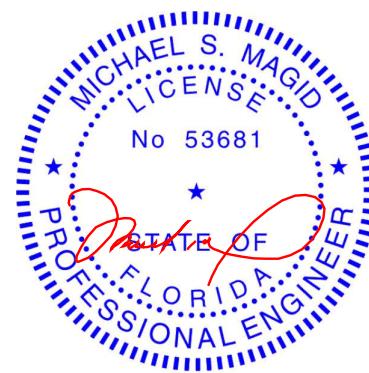

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911833
WESTON_OAKS_LOT_53	G03	Common	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:12 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-UuqJslx_y0fZKpbZoNoV9NPJnU8GY?Gf1sK?Xyz9zn5

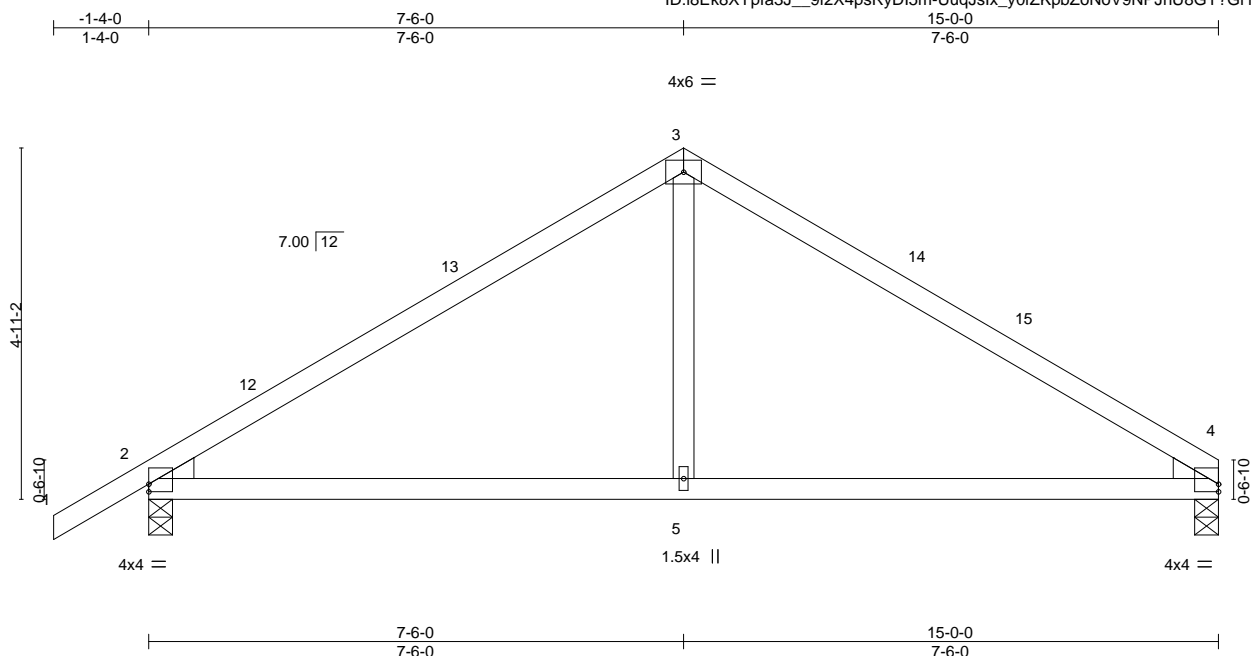

Scale: 3/8"=1'

Plate Offsets (X,Y)-- [2:Edge,0-1-5], [4:0-0-0,0-1-5]																
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc) l/defl L/d		PLATES		GRIP		
TCLL	20.0	Plate Grip DOL		1.25		TC	0.57	Vert(LL)	-0.07	5-8	>999	240	MT20	244/190		
TCDL	10.0	Lumber DOL		1.25		BC	0.53	Vert(CT)	-0.14	5-8	>999	180				
BCLL	0.0 *	Rep Stress Incr		YES		WB	0.08	Horz(CT)	0.02	2	n/a	n/a				
BCDL	10.0	Code FBC2020/TPI2014				Matrix-AS							Weight: 59 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE

Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 4=0-4-0, 2=0-4-0
Max Horz 2=86(LC 11)
Max Uplift 2=34(LC 12)
Max Grav 4=596(LC 1), 2=684(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-762/76, 3-4=-760/79
BOT CHORD 2-5=0/564, 4-5=0/564
WEBS 3-5=0/333

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 7-6-0, Exterior(2R) 7-6-0 to 10-6-0, Interior(1) 10-6-0 to 15-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

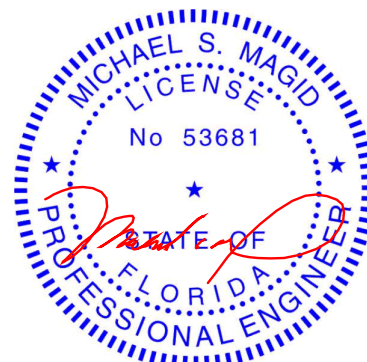

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911834
WESTON_OAKS_LOT_53	G04	Half Hip	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:13 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-z4Oh3eycjJnQyz9IM4JkhayVTuWHLHleoGW3Y3Pz9zn4

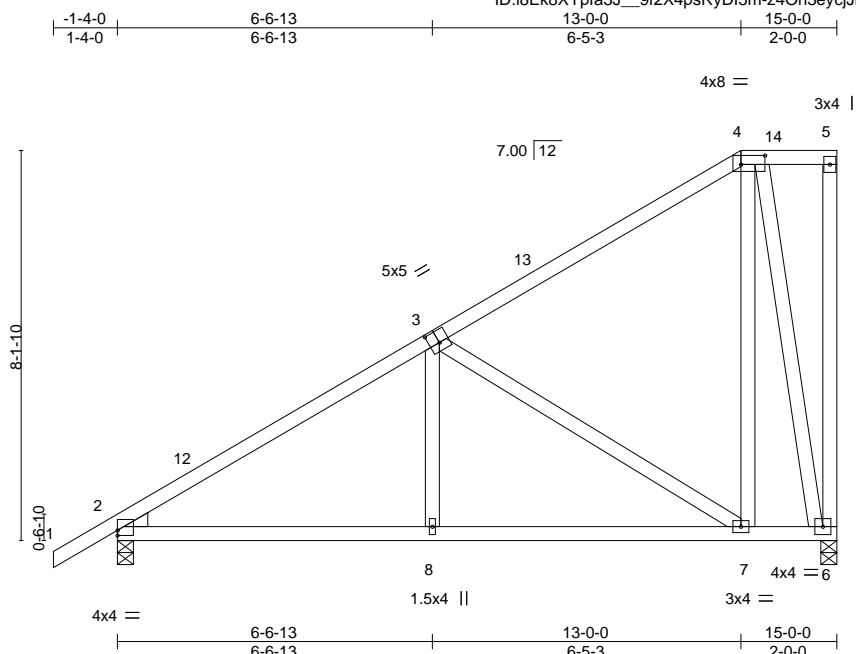

Scale: 1/4"=1'

Plate Offsets (X,Y)-- [2:0-0-0,0-1-5], [3:0-2-8,0-3-0], [4:0-6-0,0-2-4]															
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.		in (loc) l/defl L/d		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL		1.25		TC 0.51		Vert(LL)		-0.04 7-8 >999 240		MT20		244/190	
TCDL	10.0	Lumber DOL		1.25		BC 0.42		Vert(CT)		-0.08 8-11 >999 180					
BCLL	0.0 *	Rep Stress Incr		YES		WB 0.71		Horz(CT)		0.01 2 n/a n/a					
BCDL	10.0	Code FBC2020/TPI2014				Matrix-AS						Weight: 101 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 6=0-4-0, 2=0-4-0
Max Horz 2=245(LC 11)
Max Uplift 6=29(LC 9), 2=26(LC 12)
Max Grav 6=591(LC 1), 2=678(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-751/26, 3-4=-263/95
BOT CHORD 2-8=-141/567, 7-8=-142/564
WEBS 3-8=0/288, 3-7=-481/52, 4-7=-13/418, 4-6=-639/131

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 13-0-0, Exterior(2E) 13-0-0 to 14-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911835
WESTON_OAKS_LOT_53	G05	Half Hip Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:15 2022 Page 1

ID:8Ek8XYpfa3J_9f2X4psRyDI5m-vSWSUJzsfX17BGJ8TVMcm?1vhi4jIEB5jqYf8Hz9zn2

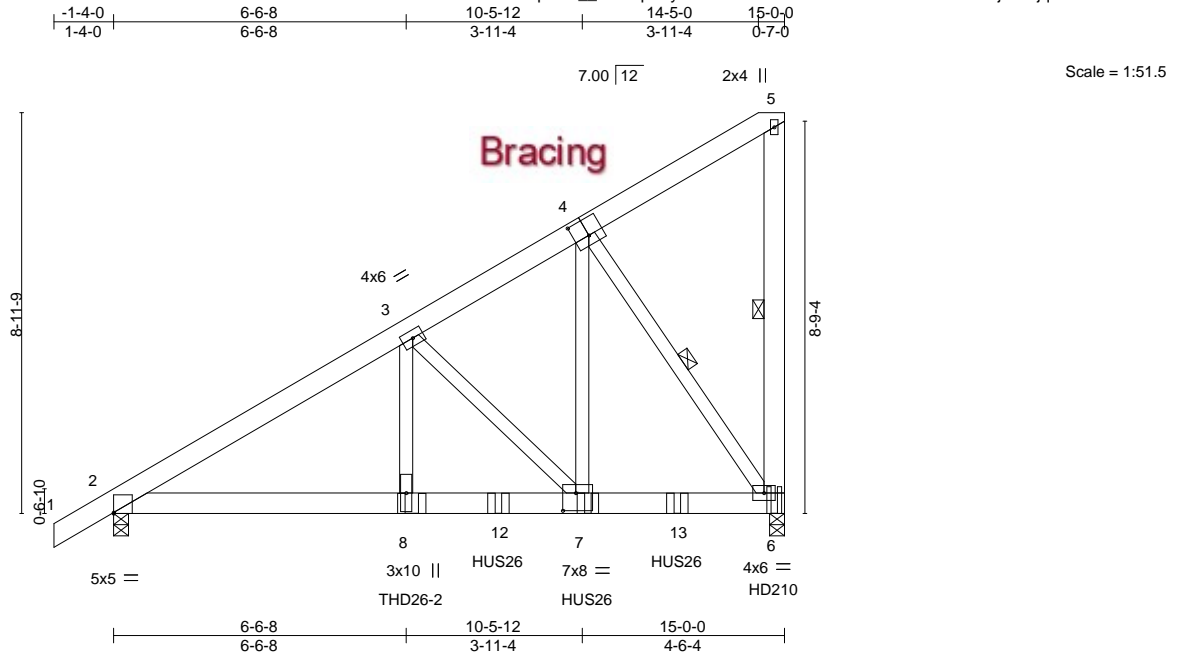


Plate Offsets (X,Y)-- [2:0-0,0,0-0-4], [4:0-4,0,0-4-8], [7:0-3-8,0-4-12]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES	GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.20	Vert(LL)	-0.07	7-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.93	Vert(CT)	-0.13	7-8	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.64	Horz(CT)	0.04	6	n/a	n/a		
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							Weight: 261 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2 *Except*
5-6: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 5-6, 4-6

REACTIONS.


(size) 6=0-4-0, 2=0-4-0
Max Horz 2=271(LC 20)
Max Uplift 6=143(LC 5), 2=128(LC 8)
Max Grav 6=6438(LC 2), 2=3551(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-6361/204, 3-4=-3463/124
BOT CHORD 2-8=-226/5401, 7-8=-226/5401, 6-7=-117/2931
WEBS 3-8=-111/3594, 3-7=-3426/189, 4-7=-137/5665, 4-6=-5105/167

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-4-0 oc, Except member 7-3 2x4 - 1 row at 0-9-0 oc, member 4-7 2x4 - 1 row at 0-9-0 oc, member 6-4 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=143, 2=128.
- Use MiTek THD26-2 (With 18-16d nails into Girder & 12-10d nails into Truss) or equivalent at 6-8-0 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- Use MiTek HUS26 (With 14-16d nails into Girder & 6-16d nails into Truss) or equivalent spaced at 2-0-0 oc max. starting at 8-7-4 from the left end to 12-7-4 to connect truss(es) to front face of bottom chord.
- Use MiTek HD210 (With 10-16d nails into Girder & 4-10d x 1-1/2 nails into Truss) or equivalent at 14-9-4 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.

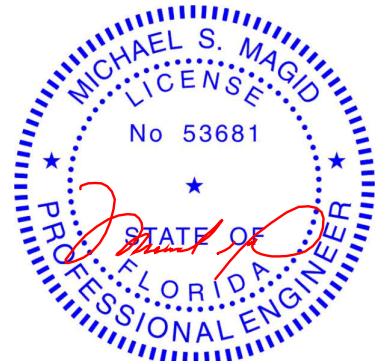

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911835
WESTON_OAKS_LOT_53	G05	Half Hip Girder	1	2	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:15 2022 Page 2
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-vSWSUJzsFx17BGJ8TVMCm?1vhi4jIEB5jqYf8Hz9zn2

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
 - Uniform Loads (plf)
 - Vert: 1-5=-60, 6-9=-20
 - Concentrated Loads (lb)
 - Vert: 6=-1396(F) 8=-3035(F) 7=-1388(F) 12=-1388(F) 13=-1388(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911836
WESTON_OAKS_LOT_53	H01	Common Girder	1	1		

Mayo Truss, Mayo, FL

8.530 s Feb 23 2022 MiTek Industries, Inc. Fri Jun 3 16:03:15 2022 Page 1
ID: i8Ek8XYpfa3J_9f2X4psRyDI5m-foP38Rpl6Z5s3?Z3Gn?ETgtgAEWiHyTyuyEJO0z9ydw

-1-4-0	2-6-0	5-1-13	6-2-0	10-2-0	14-2-0	15-2-3	17-10-0	20-4-0	21-8-0
1-4-0	2-6-0	2-7-13	1-0-3	4-0-0	4-0-0	1-0-3	2-7-13	2-6-0	1-4-0

Scale = 1:42.9

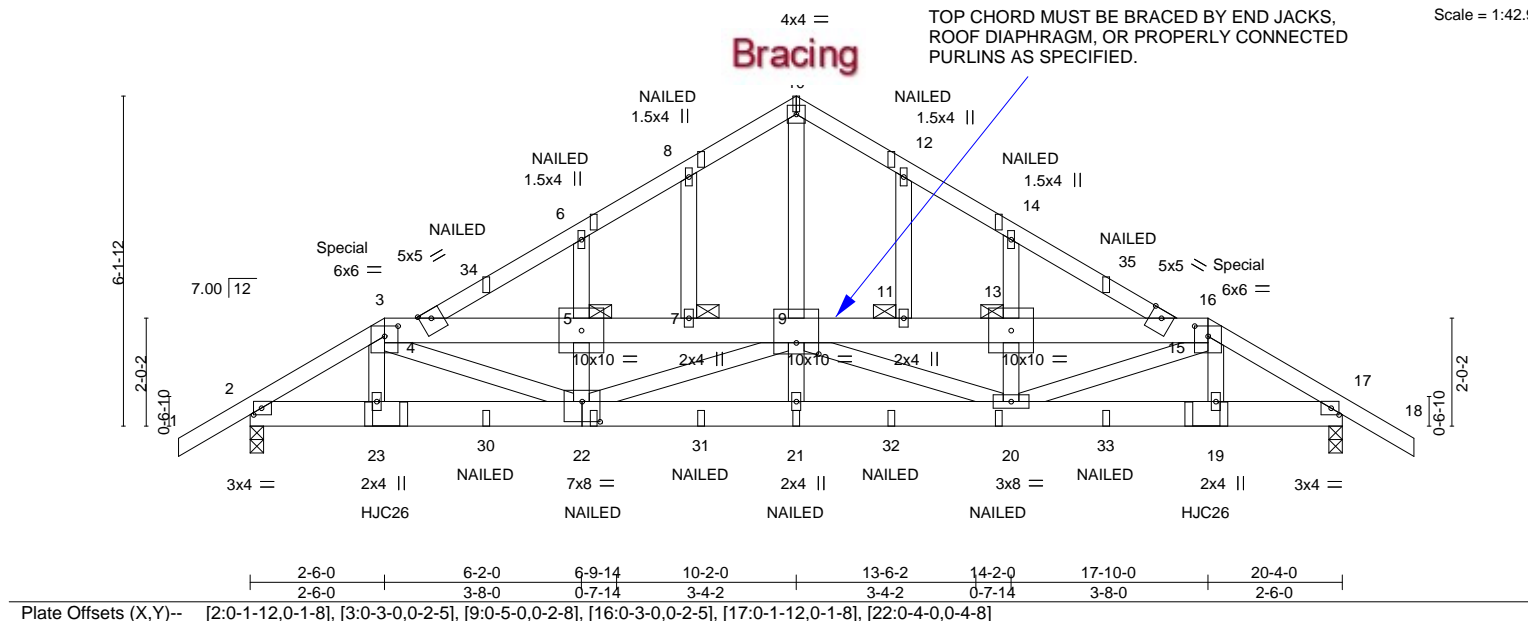

LOADING (psf)	SPACING-	2-0-0	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.30	Vert(LL)	-0.03	20	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.29	Vert(CT)	-0.07	20-21	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.15	Horz(CT)	0.02	17	n/a		
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-MS						

Weight: 171 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
3-16: 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

REACTIONS.

(size) 2=0-3-0, 17=0-3-0
Max Horz 2=-111(LC 23)
Max Uplift 2=-102(LC 8), 17=-102(LC 8)
Max Grav 2=896(LC 1), 17=896(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1260/102, 16-17=-1265/108, 3-4=-1395/154, 4-5=-754/156, 5-7=-752/156,
7-9=-752/156, 9-11=-739/141, 11-13=-739/141, 13-15=-739/141, 15-16=-1380/139,
4-34=-836/30, 6-34=-804/40, 6-8=-839/92, 8-10=-815/124, 10-12=-815/124,
12-14=-839/92, 14-35=-804/40, 15-35=-836/30
BOT CHORD 2-23=-43/1066, 23-30=-44/1065, 22-30=-44/1065, 22-31=0/869, 21-31=0/869,
21-32=0/869, 20-32=0/869, 20-33=-40/1067, 19-33=-40/1067, 17-19=-38/1069
WEBS 9-10=-77/653, 5-22=-319/103, 13-20=-318/104, 16-20=-44/411, 9-20=-88/601,
9-22=-104/626, 3-22=-64/425


NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 102 lb uplift at joint 2 and 102 lb uplift at joint 17.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use MiTek HJC26 (With 16-16d nails into Girder & 10d nails into Truss) or equivalent spaced at 15-3-4 oc max. starting at 2-6-6 from the left end to 17-9-10 to connect truss(es) J03 (1 ply 2x4 SP), CJ02 (1 ply 2x4 SP), J01 (1 ply 2x4 SP), CJ01 (1 ply 2x4 SP) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d Nails (0.148" x 3") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 33 lb down and 58 lb up at 2-6-0, and 33 lb down and 58 lb up at 17-10-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-2-8 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 7, 5, 11, 13

TRUSS DESIGNED FOR WIND LOADS IN THE PLANE OF THE TRUSS ONLY. FOR STUDS EXPOSED TO WIND (NORMAL TO THE FACE), SEE STANDARD INDUSTRY GABLE END DETAILS AS APPLICABLE, OR CONSULT QUALIFIED BUILDING DESIGNER AS PER ANSI/TPI 1.

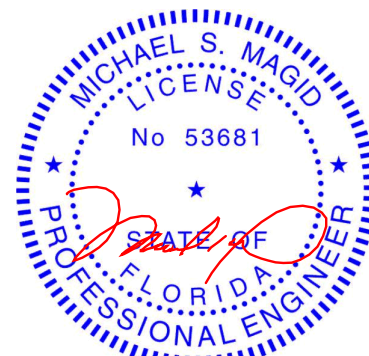

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911836
WESTON_OAKS_LOT_53	H01	Common Girder	1	1	Job Reference (optional)	

Mayo Truss, Mayo, FL

8.530 s Feb 23 2022 MiTek Industries, Inc. Fri Jun 3 16:03:15 2022 Page 2
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-foP38Rpl6Z5s3?Z3Gn?ETgtgAEWiHyTyuyEJO0z9ydw

NOTES-
13) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-60, 16-18=-60, 24-27=-20, 3-4=-60, 15-16=-60, 4-10=-60, 10-15=-60
Concentrated Loads (lb)
Vert: 3=58(F) 16=58(F) 10=-0(F) 23=-57(F) 19=-57(F) 8=-0(F) 6=-0(F) 12=-0(F) 14=-0(F) 21=-1(F) 22=-1(F) 20=-1(F) 30=-1(F) 31=-1(F) 32=-1(F) 33=-1(F) 34=-0(F)
35=-0(F)

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911837
WESTON_OAKS_LOT_53	H02	Common	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:18 2022 Page 1
ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-J1Ba6L0lYsPi2k2j9evvOefPevEJyh8YPonJlcZ9zn?

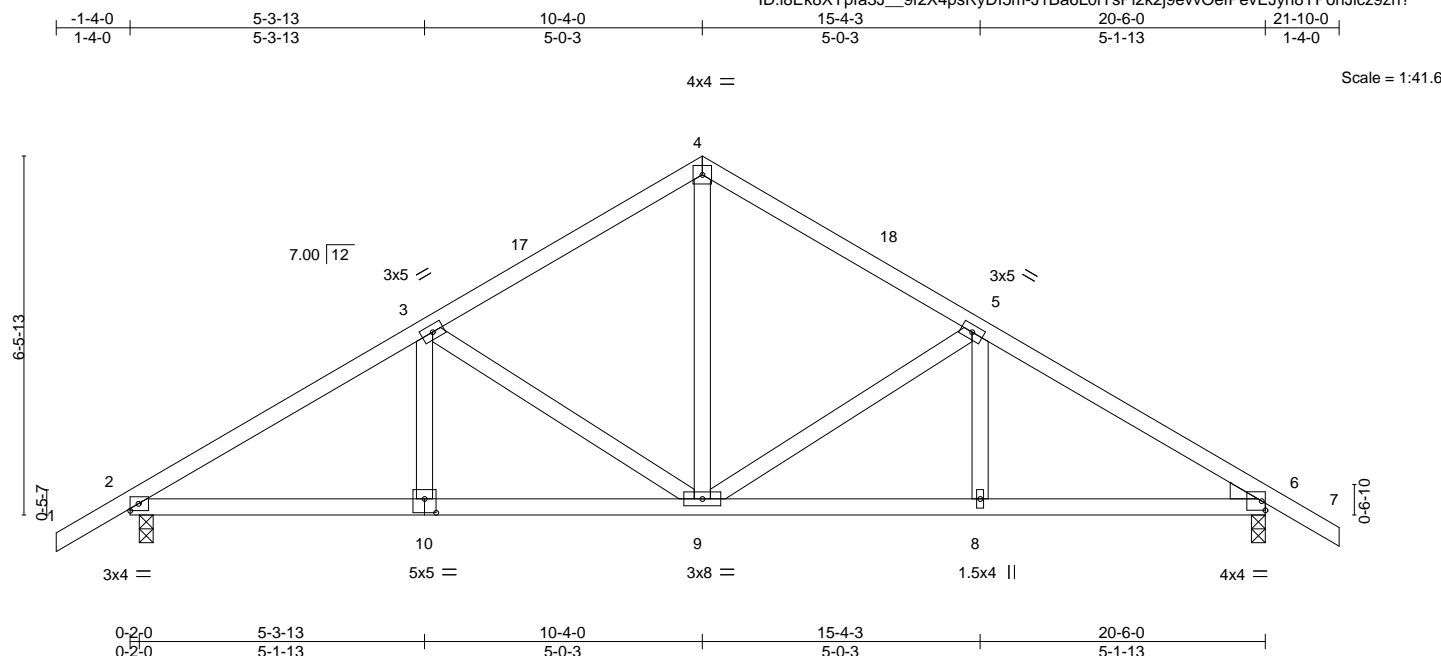


Plate Offsets (X,Y)-- [10:0-2-8,0-3-0]													
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP	
TCLL	20.0	Plate Grip DOL 1.25		TC	0.29	Vert(LL)		-0.04	8-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.37	Vert(CT)		-0.09	9-10	>999	180		
BCLL	0.0 *	Rep Stress Incr YES		WB	0.24	Horz(CT)		0.03	6	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-AS								Weight: 106 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
WEDGE
Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.


(size) 2=0-3-0, 6=0-3-0
Max Horz 2=-117(LC 10)
Max Uplift 2=-33(LC 12), 6=-32(LC 12)
Max Grav 2=900(LC 1), 6=900(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1252/56, 3-4=-886/85, 4-5=-884/85, 5-6=-1234/48
BOT CHORD 2-10=0/1019, 9-10=0/1019, 8-9=0/995, 6-8=0/995
WEBS 3-9=-399/70, 4-9=0/522, 5-9=-376/62

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 10-4-0, Exterior(2R) 10-4-0 to 13-4-0, Interior(1) 13-4-0 to 21-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911838
WESTON_OAKS_LOT_53	J01	Jack-Open	19	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:19 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-nElzKh0NJ9XZgudvilQ8xrCd5JfThBAheSWtH2z9zn_

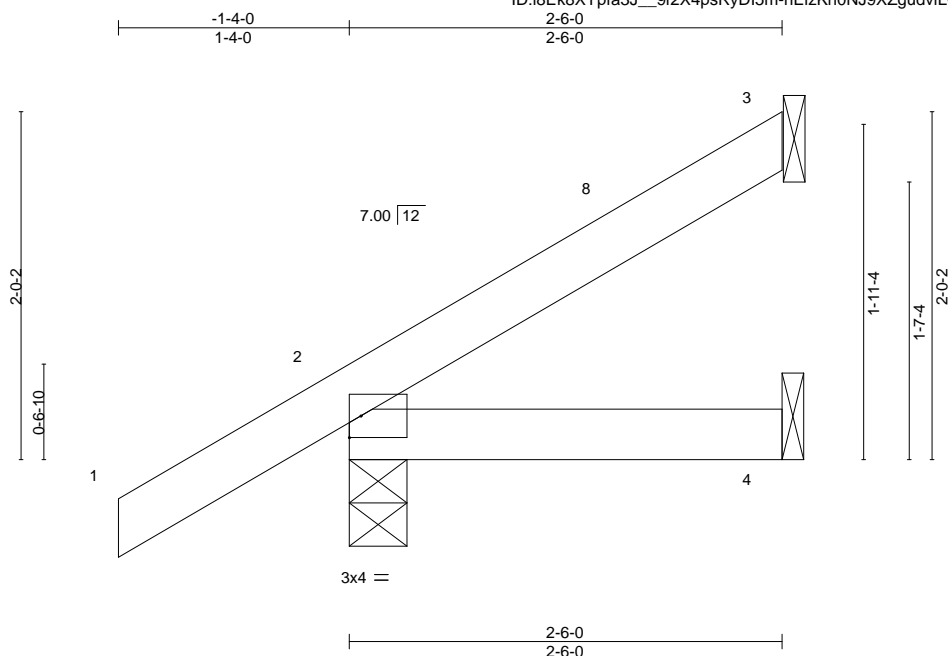

Scale = 1:13.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.11	Vert(LL)	-0.00	4-7	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	-0.00	4-7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 11 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=63(LC 12)
Max Uplift 3=-15(LC 12), 2=-30(LC 12)
Max Grav 3=56(LC 17), 2=199(LC 1), 4=42(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 2-5-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911840
WESTON_OAKS_LOT_53	J03	Jack-Open	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:20 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-FQJLX11?4TfQI2C5G2xNT3lori?iQePqt6GQoVz9zmz

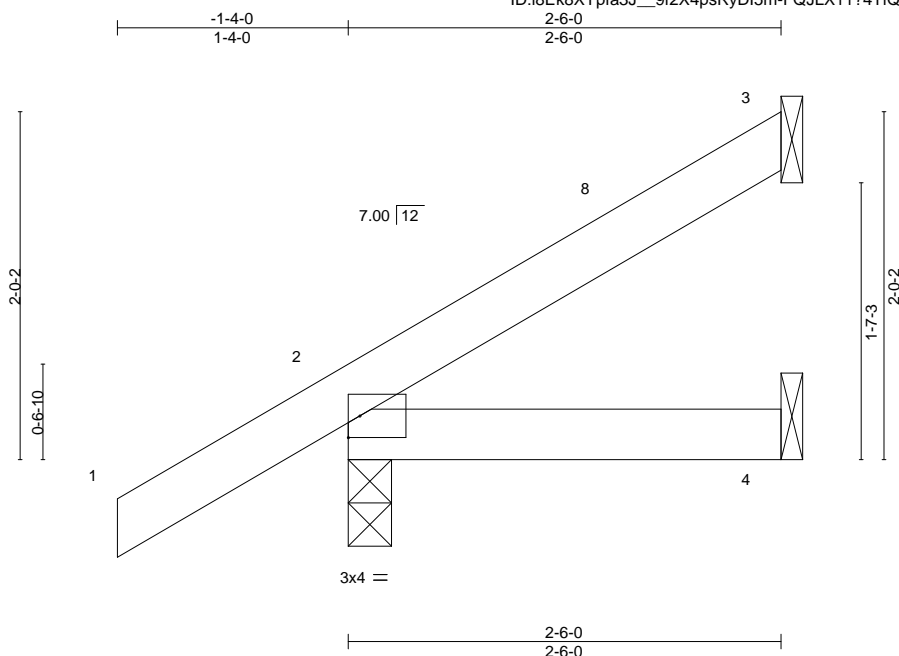

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.11	Vert(LL)	-0.00	4-7	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.05	Vert(CT)	-0.00	4-7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 11 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-0, 4=Mechanical
Max Horz 2=63(LC 12)
Max Uplift 3=-15(LC 12), 2=-30(LC 12)
Max Grav 3=56(LC 17), 2=199(LC 1), 4=42(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 2-5-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911841
WESTON_OAKS_LOT_53	J04	Jack-Open	5	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:21 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-kctjIN2drnnHvBnlqmSc0GHza6KV94f_5m?_Kxz9zmy

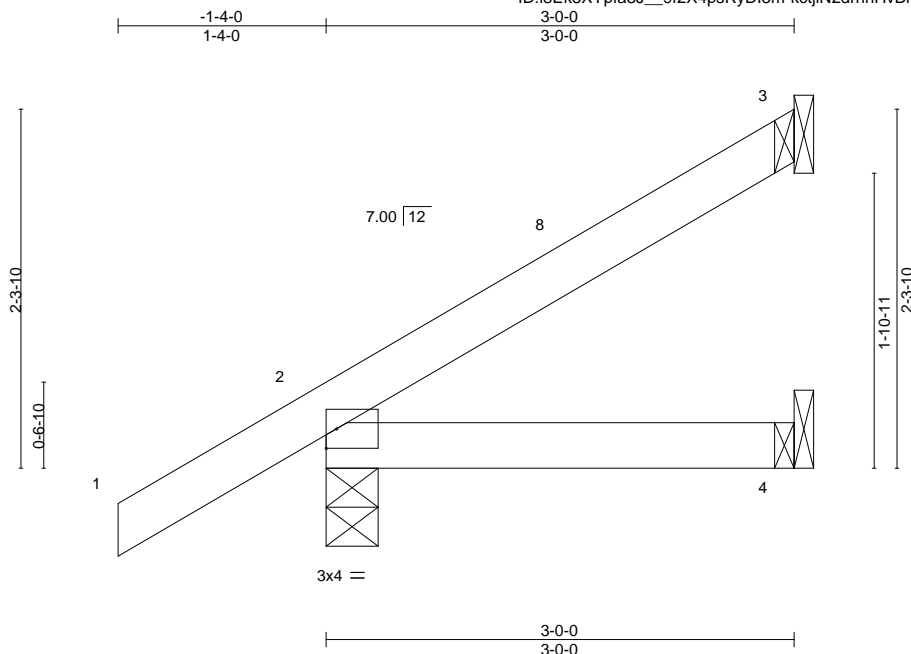

Scale = 1:14.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.11	Vert(LL)	-0.00	4-7	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.08	Vert(CT)	-0.01	4-7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 12 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=70(LC 12)
Max Uplift 3=20(LC 12), 2=26(LC 12)
Max Grav 3=70(LC 17), 2=216(LC 1), 4=52(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 2-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911842
WESTON_OAKS_LOT_53	J05	Jack-Open	3	1		
Job Reference (optional)						

Mayo Truss Company, Inc.,


Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:22 2022 Page 1

ID: i8Ek8XYpfa3J__9f2X4psRyDI5m-CpR5yj3Fc4v8XLLUOT_rZUq5QWe0uXv7KQIXtNz9zmx

-1-4-0
1-4-0
5-0-0
5-0-0

Scale = 1:21.1

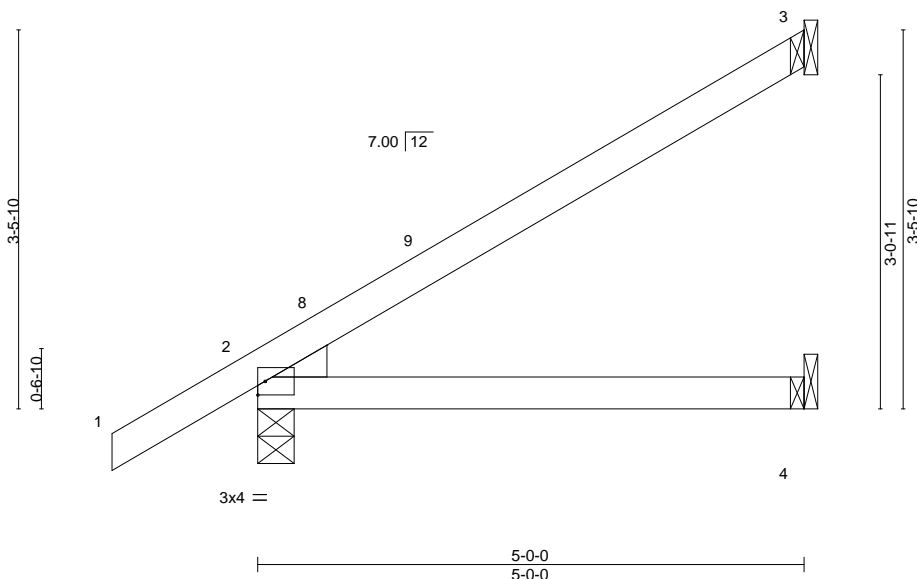

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.30	Vert(LL)	-0.02	4-7	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.25	Vert(CT)	-0.06	4-7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	2	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						
									Weight: 19 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

WEDGE

Left: 2x4 SP No.3

BRACING-

TOP CHORD

Structural wood sheathing directly applied.

BOT CHORD

Rigid ceiling directly applied.

REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical

Max Horz 2=98(LC 12)


Max Uplift 3=-38(LC 12), 2=-15(LC 12)

Max Grav 3=130(LC 1), 2=288(LC 1), 4=90(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 4-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911843
WESTON_OAKS_LOT_53	J06	Jack-Open	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:22 2022 Page 1
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-CpR5yj3Fc4v8XLLUOT_rZUq8HWgauXv7KQIXtNz9zmx

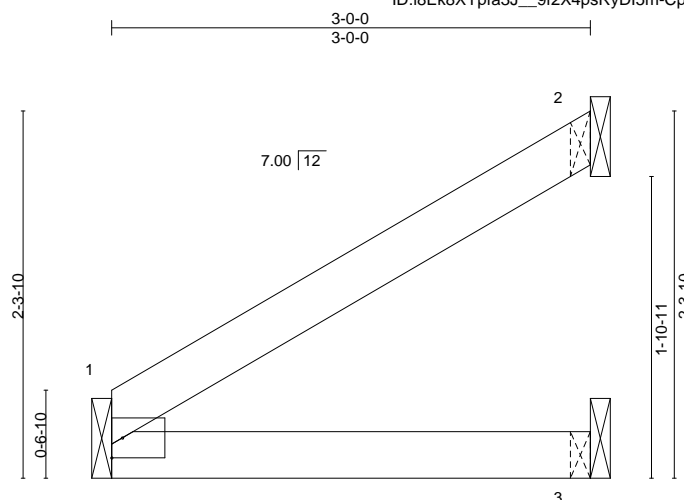

Scale = 1:14.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.12	Vert(LL)	-0.00 3-6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	-0.01 3-6	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 1	n/a	n/a		
BCDL 10.0	Code FBC2020/TP12014		Matrix-MP					Weight: 10 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=Mechanical, 2=Mechanical, 3=Mechanical
Max Horz 1=41(LC 12)
Max Uplift 2=25(LC 12)
Max Grav 1=118(LC 1), 2=79(LC 1), 3=56(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911844
WESTON_OAKS_LOT_53	J07	Jack-Open	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:23 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-g??TA24uMO1?9VwgxBV45hNEmwz5d_9HZ4U4Ppz9znmw

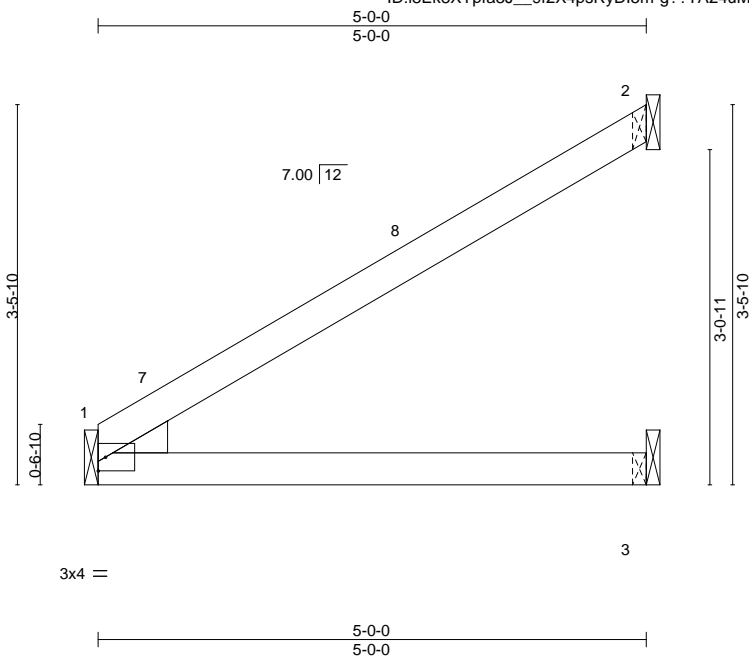

Scale = 1:21.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	-0.02 3-6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.26	Vert(CT)	-0.06 3-6	>996	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01 1	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS					Weight: 17 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEDGE
Left: 2x4 SP No.3

BRACING-


TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 1=Mechanical, 2=Mechanical, 3=Mechanical
Max Horz 1=69(LC 12)
Max Uplift 2=41(LC 12)
Max Grav 1=198(LC 1), 2=136(LC 1), 3=92(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 4-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911845
WESTON_OAKS_LOT_53	J08	Jack-Open	13	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:24 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-8BYsNO4W7i9snfVtVu0JevvMGKFLMRPQnkEexGz9zmv

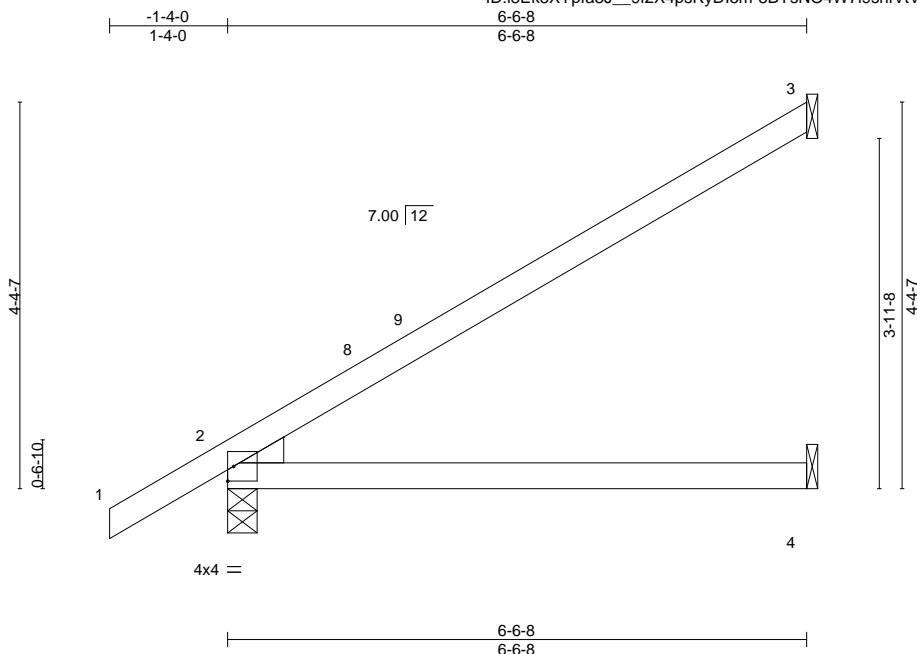

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.53	Vert(LL)	-0.07	4-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.45	Vert(CT)	-0.17	4-7	>466	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.02	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 24 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

WEDGE

Left: 2x4 SP No.3

BRACING-

TOP CHORD

Structural wood sheathing directly applied.

BOT CHORD

Rigid ceiling directly applied.


REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical
Max Horz 2=119(LC 12)
Max Uplift 3=52(LC 12), 2=7(LC 12)
Max Grav 3=176(LC 1), 2=347(LC 1), 4=118(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 6-5-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911846
WESTON_OAKS_LOT_53	J09	Jack-Open Girder	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:25 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-cO6Eak58u?HjOp433cXYA6Sc9je15uOZ0OzBTiz9zmu

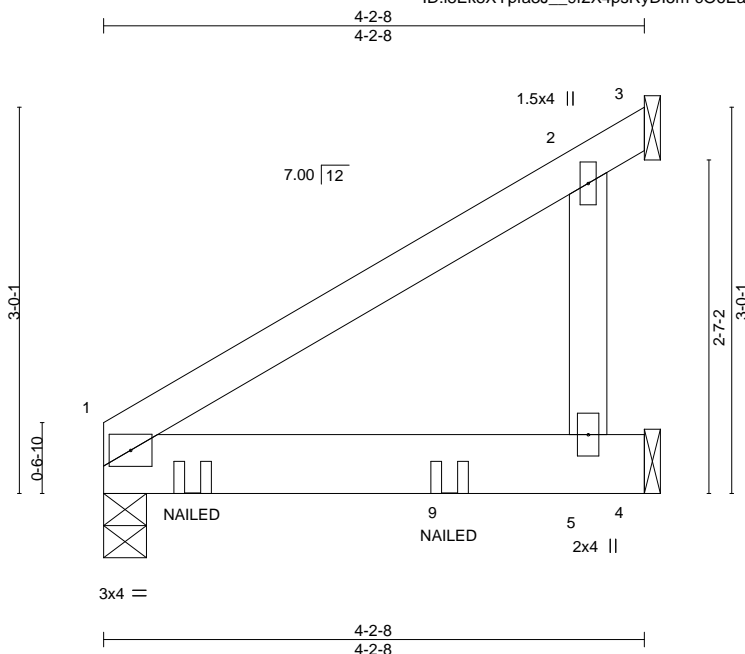

Scale = 1:17.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.20	Vert(LL)	-0.01 5-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.30	Vert(CT)	-0.03 5-8	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.02	Horz(CT)	0.00 1	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP					Weight: 20 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-8 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-4-0, 3=Mechanical, 4=Mechanical
Max Horz 1=58(LC 21)
Max Uplift 3=35(LC 13), 4=29(LC 8)
Max Grav 1=318(LC 1), 3=60(LC 21), 4=285(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
Vert: 1-3=60, 4-6=20
- Concentrated Loads (lb)
Vert: 8=101(B) 9=178(B)



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE
WESTON_OAKS_LOT_53	J10	Jack-Partial Girder	1	1	T27911847
Mayo Truss Company, Inc., Mayo, FL - 32066,					Job Reference (optional)

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:26 2022 Page 1

ID: i8Ek8XYpfa3J_9f2X4psRyDI5m-4agco46mfJQZ0zfFdJ2njK?m572EqLRjF2jk08z9zmt

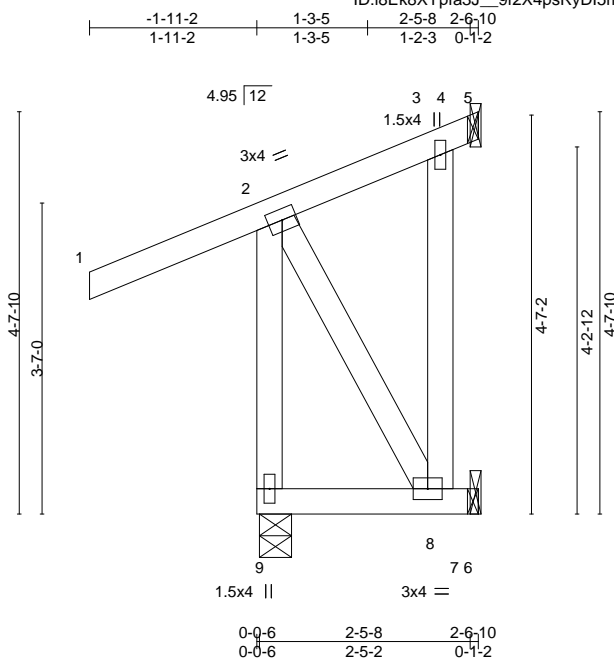

Scale = 1:26.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	-0.00 8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.04	Vert(CT)	-0.00 8-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.03	Horz(CT)	-0.00 4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP					Weight: 27 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 9=0-4-7, 4=Mechanical, 7=Mechanical
Max Horz 9=120(LC 8)
Max Uplift 9=13(LC 4), 4=66(LC 21), 7=47(LC 5)
Max Grav 9=271(LC 1), 4=81(LC 13), 7=38(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-9=-257/27

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to bearing connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 4, 7.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 53 lb down and 27 lb up at -0-0-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-2=-60, 2-4=-60, 4-5=-20, 6-9=-20



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911848
WESTON_OAKS_LOT_53	J11	Jack-Open Supported Gable	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:26 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-4agco46mfJQZ0zfFdJ2njK?pl72LqLQjF2jk08z9zmt



Scale = 1:20.1

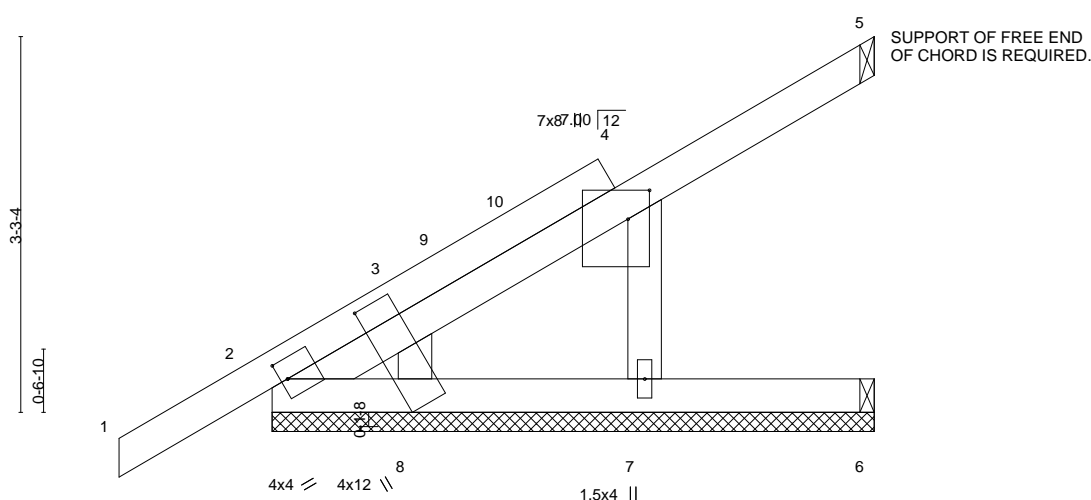


Plate Offsets (X,Y)--		[2:0-0-11,0-2-0], [4:0-3-0,0-2-4], [8:0-2-6,0-9-8]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d
TCLL 20.0		Plate Grip DOL	1.25	TC 0.11		Vert(LL)	0.00 1	n/r	120
TCDL 10.0		Lumber DOL	1.25	BC 0.03		Vert(CT)	-0.00 1	n/r	120
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.03		Horz(CT)	-0.00 5	n/a	n/a
BCDL 10.0		Code FBC2020/TPI2014		Matrix-P					
						PLATES	GRIP		
						MT20	244/190		
						Weight: 27 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-2-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 5-2-15.

(lb) - Max Horz 2=91(LC 12)


Max Uplift All uplift 100 lb or less at joint(s) 2, 5, 7

Max Grav All reactions 250 lb or less at joint(s) 2, 5, 6, 7, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) -1-4-0 to 1-8-0, Exterior(2N) 1-8-0 to 5-2-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5, 7.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911849
WESTON_OAKS_LOT_53	J12	Jack-Open	15	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:27 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-YmE_?Q7OQdYQe6ESA1Z0GXXsFXGxZo8sUiSiYbz9zms

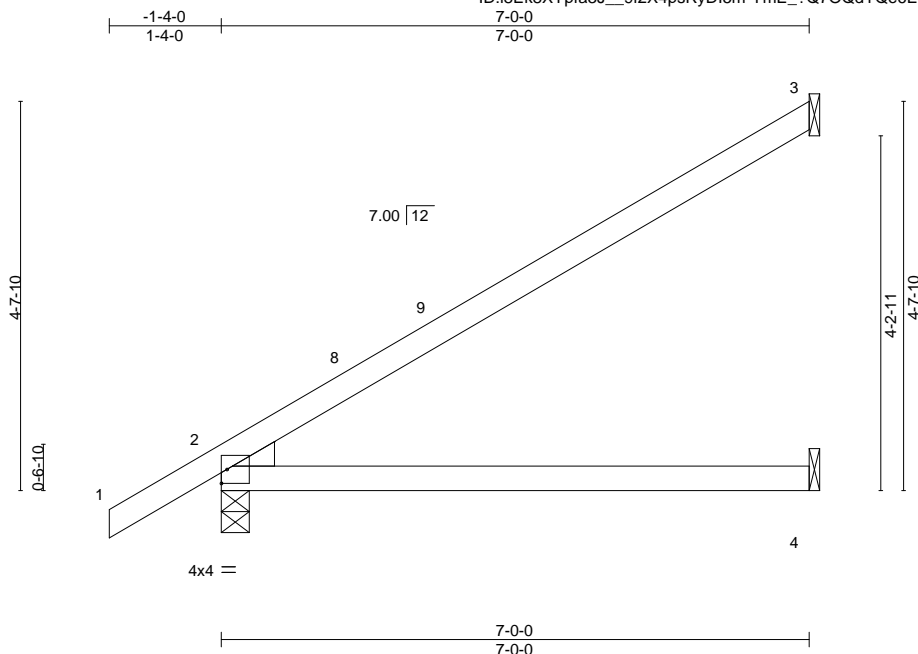

Scale = 1:27.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.61	Vert(LL)	-0.09	4-7	>897	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.52	Vert(CT)	-0.22	4-7	>381	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.02	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

WEDGE

Left: 2x4 SP No.3

BRACING-

TOP CHORD

Structural wood sheathing directly applied.

BOT CHORD

Rigid ceiling directly applied.

REACTIONS.

(size) 3=Mechanical, 2=0-4-0, 4=Mechanical

Max Horz 2=125(LC 12)


Max Uplift 3=55(LC 12), 2=5(LC 12)

Max Grav 3=189(LC 1), 2=365(LC 1), 4=126(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 6-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:28 2022 Page 1
ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-0zoMDm70BwgHFGpekk4Fol4?zxb9lFO0iMCr41z9zmr




LUMBER- TOP CHORD 2x4 SP No.2 BOT CHORD 2x4 SP No.2 WEDGE Left: 2x4 SP No.3	BRACING- TOP CHORD BOT CHORD	Structural wood sheathing directly applied. Rigid ceiling directly applied.
--	---	--

REACTIONS. (size) 4=Mechanical, 2=0-4-0, 5=Mechanical
 Max Horz 2=125(LC 12)
 Max Uplift 4=43(LC 12), 2=2(LC 12)
 Max Grav 4=174(LC 1), 2=369(LC 1), 5=122(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 6-11-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

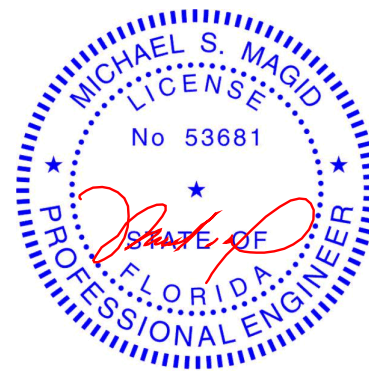

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911851
WESTON_OAKS_LOT_53	J14	Jack-Open	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:29 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-V9MIQ68eyEo8tQOqIRcULycCiLyH1ie9x0xPdTz9zmq

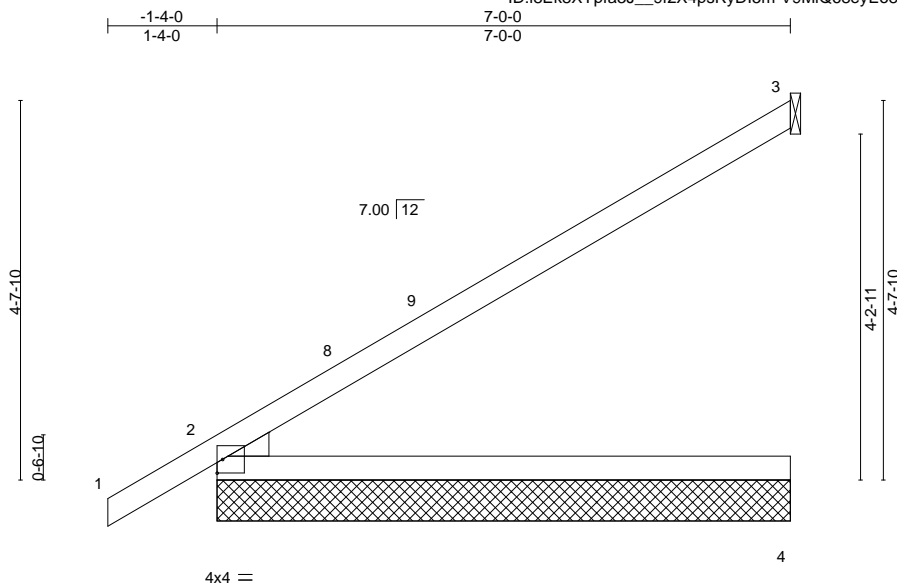

Scale = 1:28.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.62	Vert(LL)	-0.10	4-7	>867	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.53	Vert(CT)	-0.23	4-7	>369	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.02	2	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-AS						
								Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

WEDGE

Left: 2x4 SP No.3

BRACING-

TOP CHORD

Structural wood sheathing directly applied.

BOT CHORD

Rigid ceiling directly applied.

REACTIONS. All bearings 7'-0'-0 except (jt=length) 3=Mechanical, 3=Mechanical.

(lb) - Max Horz 2=125(LC 12)


Max Uplift All uplift 100 lb or less at joint(s) 3, 2

Max Grav All reactions 250 lb or less at joint(s) 3, 3, 4 except 2=366(LC 1), 2=366(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) -1-4-0 to 1-8-0, Interior(1) 1-8-0 to 6-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6"-0 tall by 2'-0"-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 2.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

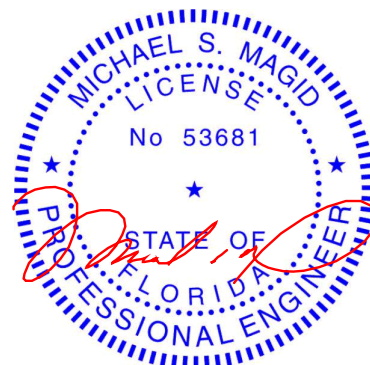

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911852
WESTON_OAKS_LOT_53	M01	GABLE	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:30 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-zLw7eS9HjYw?Vaz0s97jtA9TvkPGm99JAgHy9vz9zmp

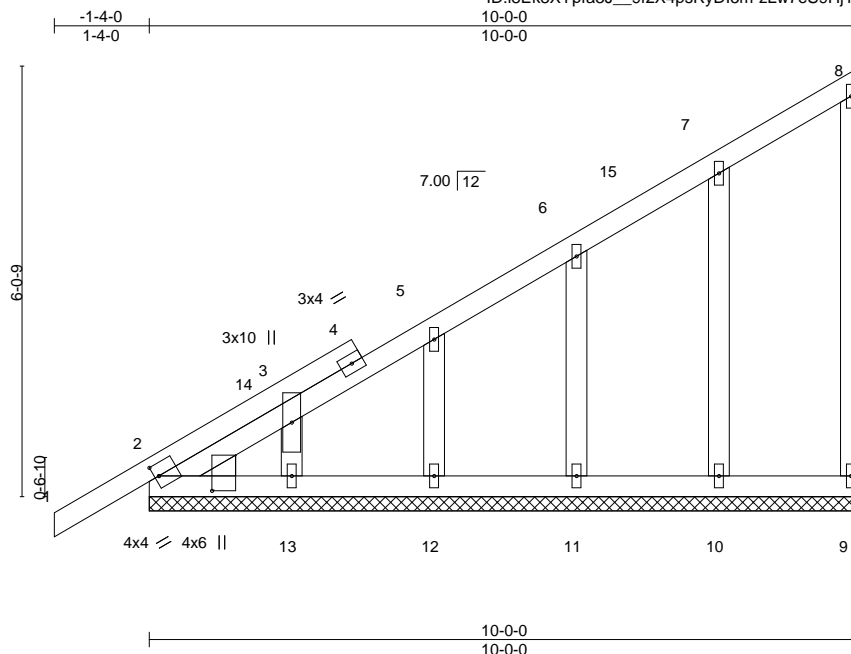

Scale = 1:32.4

Plate Offsets (X,Y)-- [2:0-0-11,0-2-0], [2:0-2-8,0-8-15]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.20	Vert(LL)	0.00 1 n/r 120	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.10	Vert(CT)	-0.00 1 n/r 120		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.05	Horz(CT)	0.00 9 n/a n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-S				Weight: 63 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2
 OTHERS 2x4 SP No.2
 WEDGE
 Left: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


All bearings 10-0-0.
 (lb) - Max Horz 2=178(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 9, 10, 11, 12
 Max Grav All reactions 250 lb or less at joint(s) 2, 9, 10, 11, 12, 13

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-327/207, 3-5=-282/193

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Corner(3E) -1-4-0 to 1-8-0, Exterior(2N) 1-8-0 to 9-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) All plates are 1.5x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 9, 10, 11, 12.

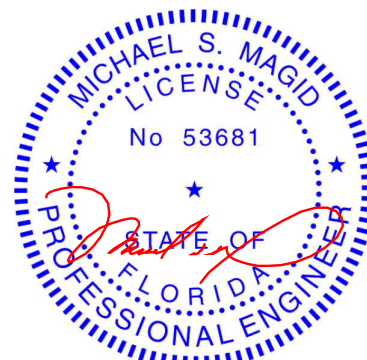

Michael S. Magid PE No.53681
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911853
WESTON_OAKS_LOT_53	PB01	Piggyback	1	1	Job Reference (optional)	


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:31 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-RXUVroAvUr2s6kYDPseyQNieD8j2VcfSOKQVhMz9zmo

12-6-14
12-6-14

Scale = 1:21.5

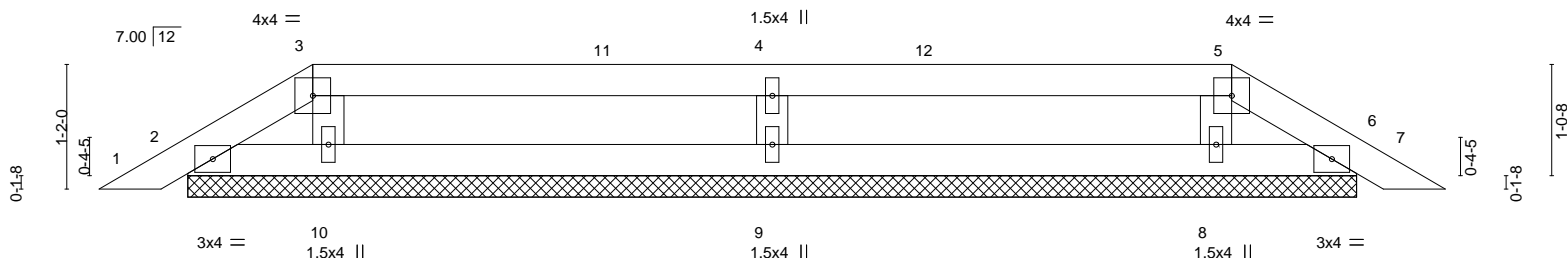

12-6-14
12-6-14

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.23	Vert(LL)	-0.00	6	n/r	120	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.13	Vert(CT)	-0.00	6	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	6	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						
								Weight: 38 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


All bearings 10-11-0.
(lb) - Max Horz 2=-17(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 6, 9
Max Grav All reactions 250 lb or less at joint(s) 2, 6, 10, 8 except 9=386(LC 21)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 4-9=-298/91

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 1-11-15, Exterior(2R) 1-11-15 to 6-3-7, Interior(1) 6-3-7 to 10-6-15, Exterior(2E) 10-6-15 to 12-3-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 9.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911854
WESTON_OAKS_LOT_53	PB02	Piggyback	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:32 2022 Page 1

ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-vk1t27BXf9Aiku6Pza9BzbEpdY4IE3zbd_A3Doz9zmn

16-10-14
16-10-14

Scale = 1:29.4

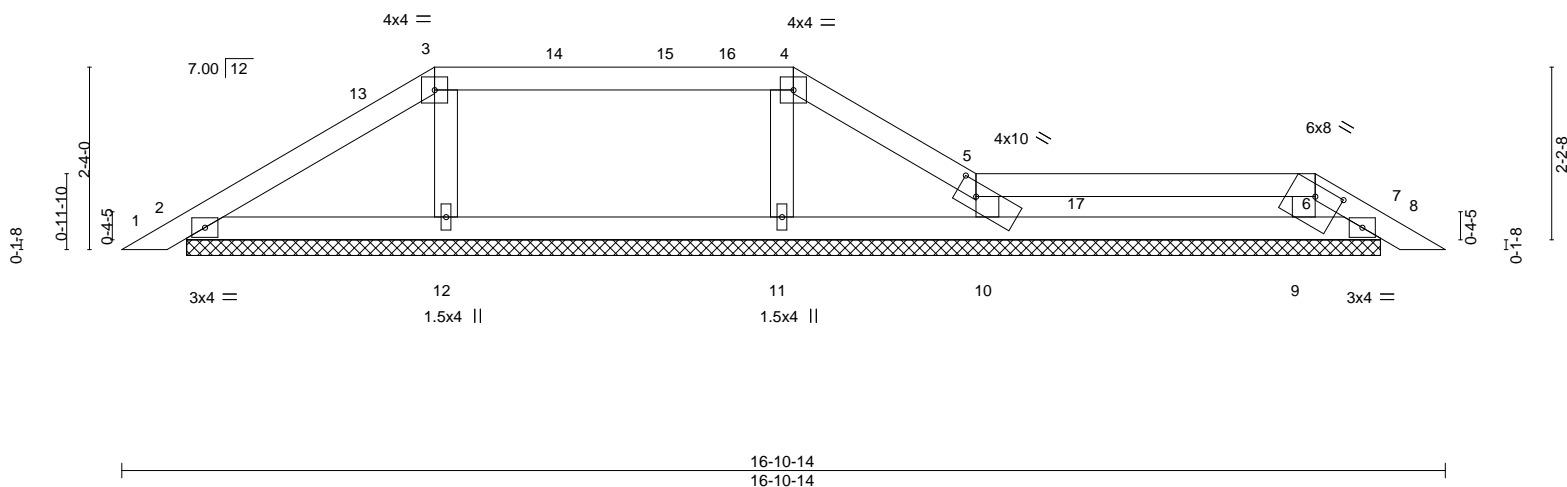


Plate Offsets (X,Y)--		[5:0-3-0,0-2-0], [6:0-4-0,0-1-11]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	L/defl	L/d
TCLL	20.0	Plate Grip DOL	1.25	TC	0.25	Vert(LL)	-0.00	7	n/r
TCDL	10.0	Lumber DOL	1.25	BC	0.13	Vert(CT)	-0.00	7	n/r
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	7	n/a
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-S					
						PLATES	GRIP		
						MT20	244/190		
						Weight: 56 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
6-0-0 oc bracing: 9-10.

REACTIONS.

All bearings 15-3-0.

(lb) - Max Horz 2=38(LC 11)


Max Uplift All uplift 100 lb or less at joint(s) 2, 7, 10

Max Grav All reactions 250 lb or less at joint(s) 2, 7 except 12=324(LC 21), 11=262(LC 22), 10=278(LC 1), 9=273(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-3-8, Interior(1) 3-3-8 to 3-11-15, Exterior(2R) 3-11-15 to 6-11-15, Interior(1) 6-11-15 to 8-6-15, Exterior(2E) 8-6-15 to 10-10-15, Interior(1) 10-10-15 to 15-2-15, Exterior(2E) 15-2-15 to 16-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) Gable requires continuous bottom chord bearing.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 7, 10.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911855
WESTON_OAKS_LOT_53	PB03	Piggyback	1	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:33 2022 Page 1

ID:i8Ek8XYpfa3Jl_9f2X4psRyDI5m-NwbFGTB90TlaM1hbXHgQVonymyOmzW?IsdvcmEz9zmm

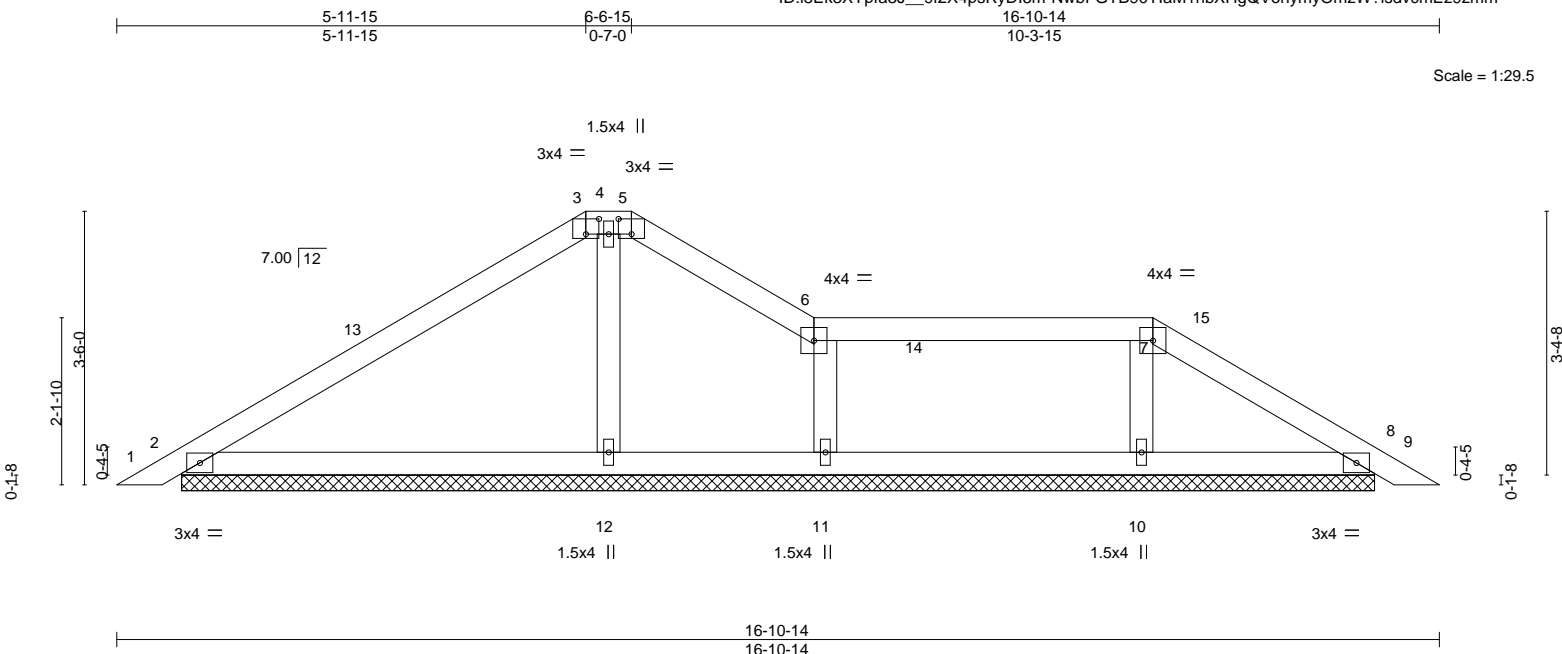


Plate Offsets (X,Y)--		[3:0-2-0,0-2-5], [5:0-2-0,0-2-5]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.36	Vert(LL)	0.00 9 n/r 120	MT20	244/190		
TCDL	10.0	Lumber DOL	1.25	BC	0.24	Vert(CT)	0.00 9 n/r 120				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00 8 n/a n/a				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-S				Weight: 59 lb	FT = 20%		

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 15-3-0.
(lb) - Max Horz 2=-58(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 11
Max Grav All reactions 250 lb or less at joint(s) 2, 8 except 12=348(LC 1), 11=270(LC 22), 10=302(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-3-8, Interior(1) 3-3-8 to 5-11-15, Exterior(2E) 5-11-15 to 8-10-15, Interior(1) 8-10-15 to 13-2-15, Exterior(2R) 13-2-15 to 16-0-15, Interior(1) 16-0-15 to 16-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 11.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

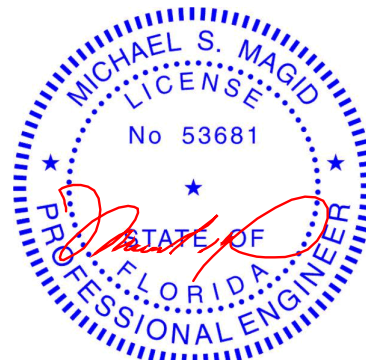

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911856
WESTON_OAKS_LOT_53	PB04	Piggyback	1	1	Job Reference (optional)	


Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:34 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-r69dTpCnmQRzBG05?Bf20K7OMkViz4u5HfAlhz9zml

16-10-14
16-10-14

Scale = 1:28.9

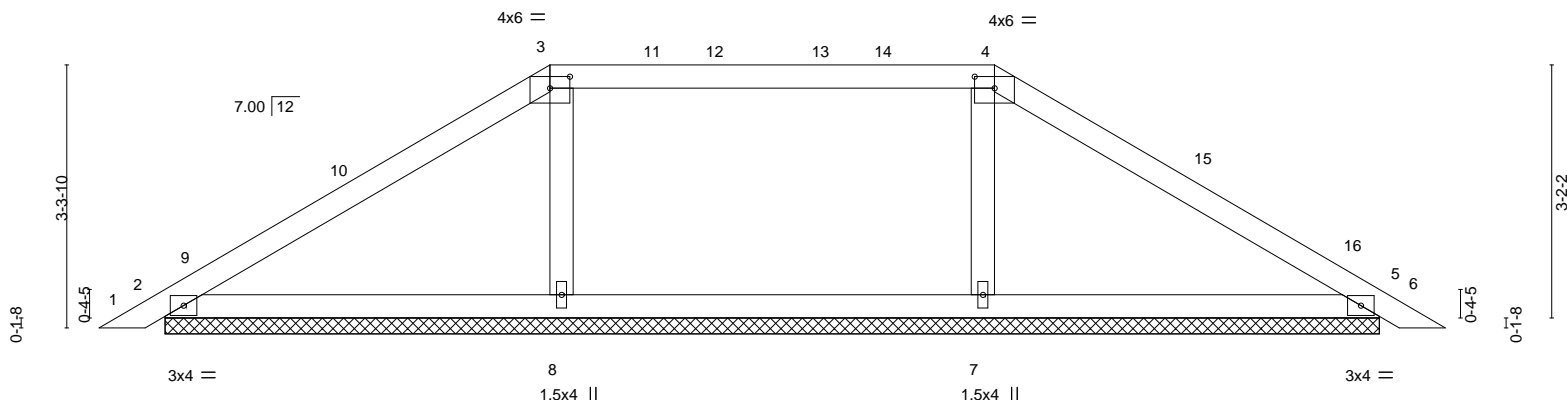

16-10-14
16-10-14

Plate Offsets (X,Y)--		[3:0-3-0,0-1-12], [4:0-3-0,0-1-12]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.36	Vert(LL)	0.01 6	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.21	Vert(CT)	0.02 6	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00 5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S					Weight: 58 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


All bearings 15-3-0.
(lb) - Max Horz 2=-55(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 5
Max Grav All reactions 250 lb or less at joint(s) 2, 5 except 8=435(LC 21), 7=435(LC 22)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-8=-310/80, 4-7=-310/79

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-3-8, Interior(1) 3-3-8 to 5-7-15, Exterior(2R) 5-7-15 to 9-10-14, Interior(1) 9-10-14 to 11-2-15, Exterior(2R) 11-2-15 to 15-5-14, Interior(1) 15-5-14 to 16-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911857
WESTON_OAKS_LOT_53	PB05	Piggyback	1	1	Job Reference (optional)	

Mayo Truss, Mayo, FL

8.530 s Feb 23 2022 MiTek Industries, Inc. Fri Jun 3 16:05:14 2022 Page 1
ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-gh5267FO475zrI9xkGe8nmlzHC89foBTFzY64dz9yc3

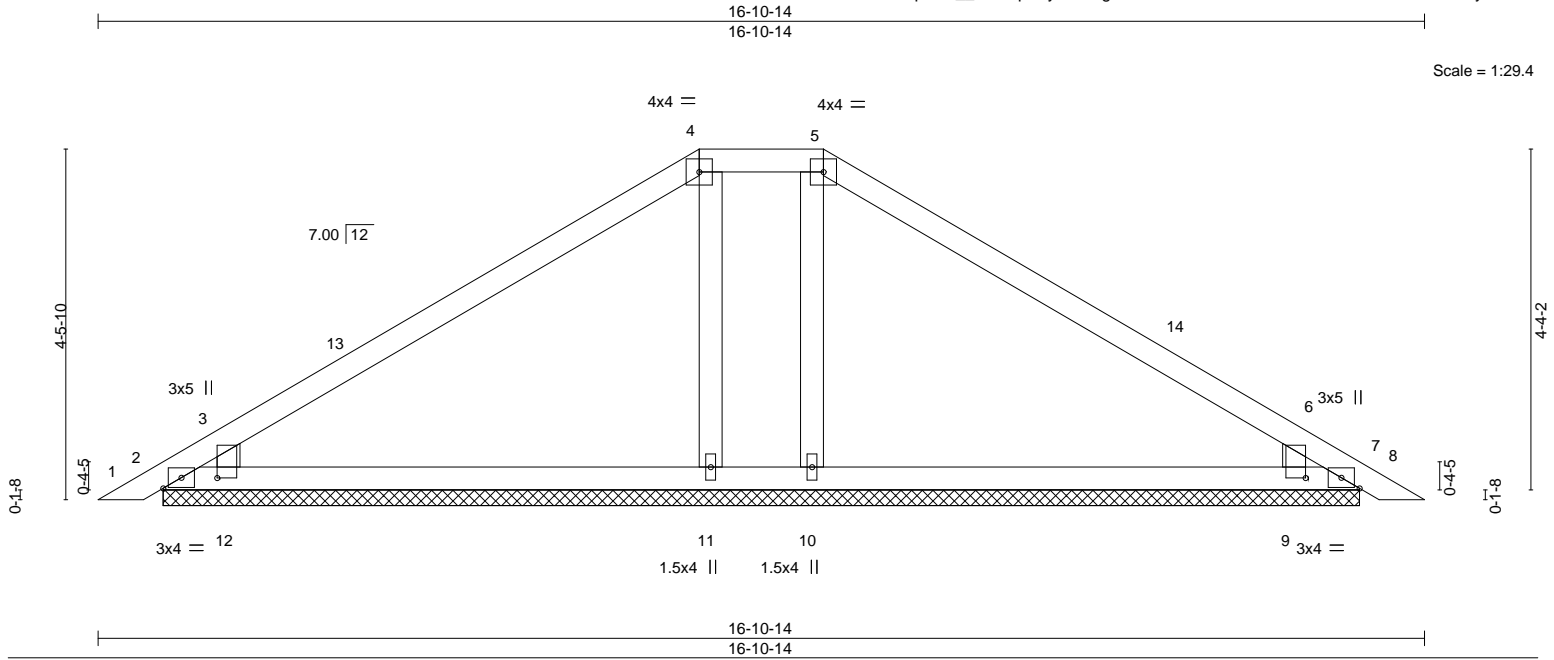


Plate Offsets (X,Y)-- [3:0-1-9,0-8-4], [6:0-1-9,0-8-4]

LOADING (psf)	SPACING-	2-0-0	CSL	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.41	Vert(LL)	-0.00	8	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.25	Vert(CT)	-0.00	8	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 63 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-3-0.
(lb) - Max Horz 2=75(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 12, 9 except 2=248(LC 17), 7=235(LC 18)
Max Grav All reactions 250 lb or less at joint(s) 2, 7 except 11=300(LC 21), 10=300(LC 22), 12=602(LC 1), 9=602(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-12=-495/230, 6-9=-495/227

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-3-8, Interior(1) 3-3-8 to 7-7-15, Exterior(2E) 7-7-15 to 9-2-15, Exterior(2R) 9-2-15 to 13-5-14, Interior(1) 13-5-14 to 16-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) Gable requires continuous bottom chord bearing.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 9 except (jt=lb) 2=248, 7=235.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

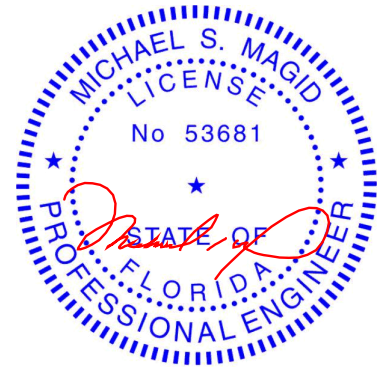

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911858
WESTON_OAKS_LOT_53	PB06	Piggyback	3	1	Job Reference (optional)	

Mayo Truss Company, Inc., Mayo, FL - 32066,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:36 2022 Page 1

ID:8Ek8XYpfa3J_9f2X4psRyDI5m-nVHOuVE1JOg9DVQACQE77RPSK9P?AspBYb8GMZz9zmj

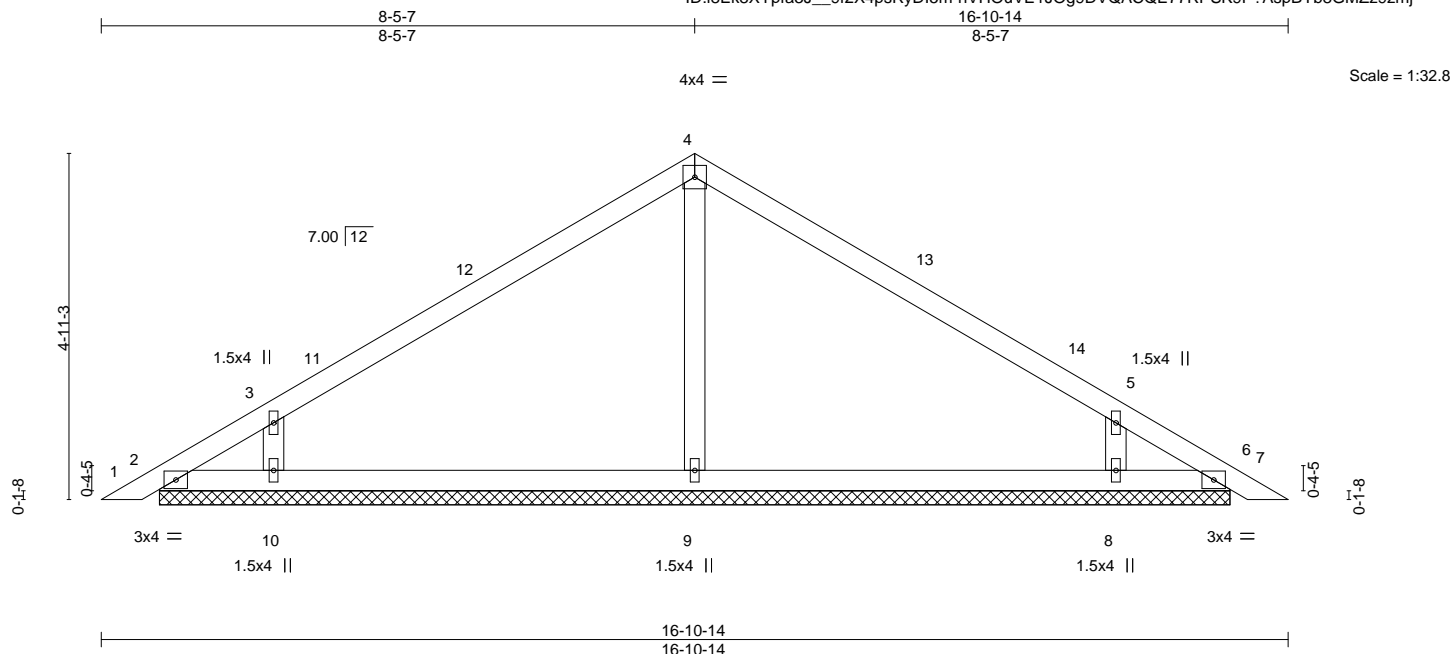

LOADING (psf)	SPACING-		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.40		Vert(LL)	-0.00	7	n/r	120	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.27		Vert(CT)	-0.00	7	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.10		Horz(CT)	0.00	6	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S							
									Weight: 60 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.


All bearings 15'-3-0.
(lb) - Max Horz 2=-83(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 6, 10, 8
Max Grav All reactions 250 lb or less at joint(s) 2, 6 except 9=414(LC 1), 10=458(LC 21), 8=458(LC 22)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 4-9=-285/34, 3-10=-377/164, 5-8=-377/164

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-3-8, Interior(1) 3-3-8 to 8-5-7, Exterior(2R) 8-5-7 to 11-5-7, Interior(1) 11-5-7 to 16-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 10, 8.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911859
WESTON_OAKS_LOT_53	PB07	Piggyback	1	1	Job Reference (optional)	

Mayo Truss, Mayo, FL

8.530 s Feb 23 2022 MiTek Industries, Inc. Fri Jun 3 16:07:04 2022 Page 1
ID:i8Ek8XYpfa3J__9f2X4psRyDI5m-SskdCkbOAwyM1CZ4ANcxFzsk5YejRY9fY4CwxFz9yaL

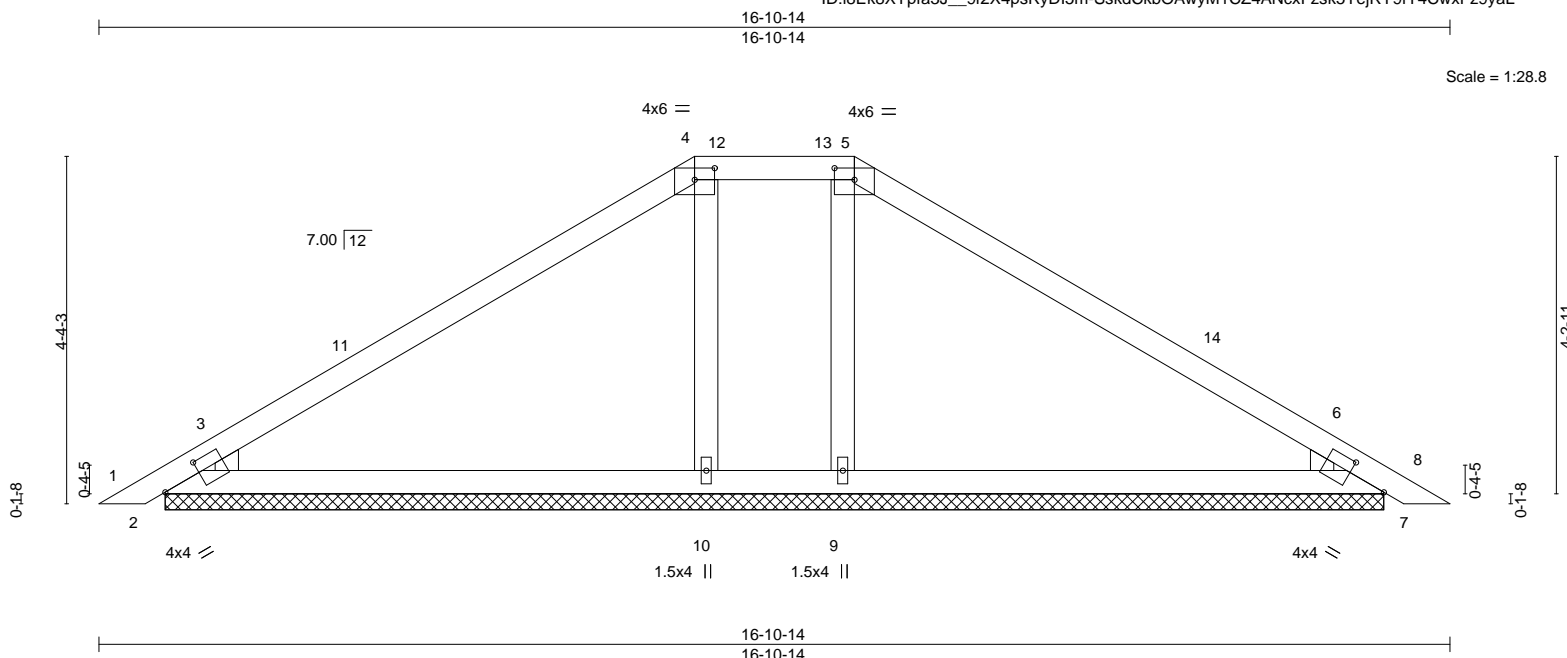


Plate Offsets (X,Y)-- [2:0-5-14,0-1-12], [4:0-3-0,0-1-12], [5:0-3-0,0-1-12], [7:0-5-14,0-1-12]									
LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.57	Vert(LL)	0.02	8	n/r	120	MT20 244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.39	Vert(CT)	0.04	8	n/r	120	
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.00	7	n/a	n/a	
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-S						Weight: 63 lb FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-3-0.
(lb) - Max Horz 2=-73(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 7
Max Grav All reactions 250 lb or less at joint(s) except 2=277(LC 1), 7=277(LC 1), 10=434(LC 21), 9=434(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 4-10=-300/74, 5-9=-300/70

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-3-8, Interior(1) 3-3-8 to 7-5-7, Exterior(2E) 7-5-7 to 9-5-7, Exterior(2R) 9-5-7 to 13-8-6, Interior(1) 13-8-6 to 16-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 7.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

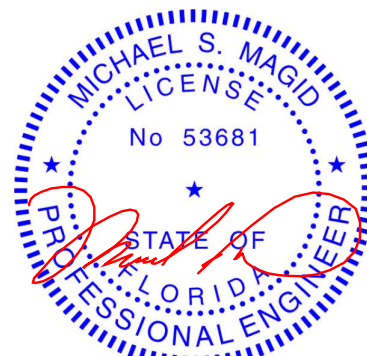

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	PAYNE	T27911860
WESTON_OAKS_LOT_53	PB08	Piggyback	1	1	Job Reference (optional)	

Mayo Truss Company, Inc.,

Mayo, FL - 32066,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:38 2022 Page 1

ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-kuP8JBFIq?wtSpaZKqGbCsUoGz5Fen5U0vdNRSz9zmh

16-10-14

11-5-7

Scale = 1:28.9

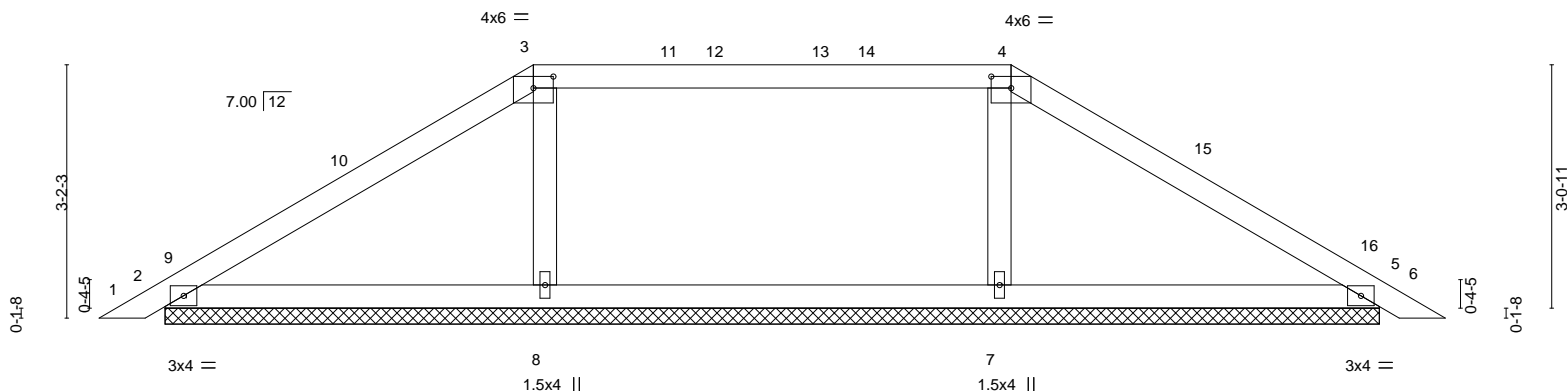

16-10-14

16-10-14

Plate Offsets (X,Y)--		[3:0-3-0,0-1-12], [4:0-3-0,0-1-12]									
LOADING	(psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC 0.43	Vert(LL)	0.01	6	n/r	120	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC 0.22	Vert(CT)	0.01	6	n/r	120		
BCLL	0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	5	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 58 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


All bearings 15-3-0.
(lb) - Max Horz 2=52(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 5
Max Grav All reactions 250 lb or less at joint(s) 2, 5 except 8=444(LC 21), 7=444(LC 22)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-8=-318/81, 4-7=-318/79

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-3-8, Interior(1) 3-3-8 to 5-5-7, Exterior(2R) 5-5-7 to 9-8-6, Interior(1) 9-8-6 to 11-5-7, Exterior(2R) 11-5-7 to 15-8-6, Interior(1) 15-8-6 to 16-7-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Design Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

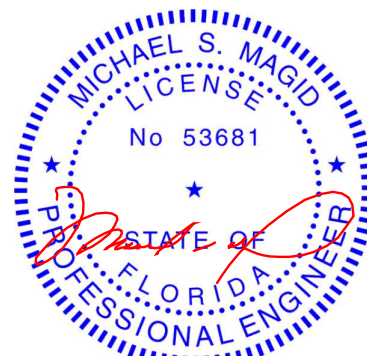

Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Mayo Truss Company, Inc., Mayo, FL - 32066, 8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Jun 3 13:45:39 2022 Page 1
ID:i8Ek8XYpfa3J_9f2X4psRyDI5m-C4yWWXGwbJ2j4y9ltYnq31_tNSCNDWdEzNmWzuz9zmrg
3-5-7 16-10-14
3-5-7 13-5-7
Scale = 1:28.8

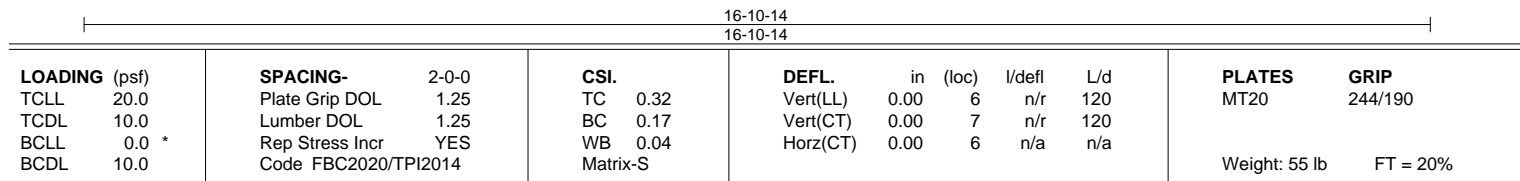


REACTIONS. All bearings 15-3-0.
(lb) - Max Horz 2=32(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 6, 9
Max Grav All reactions 250 lb or less at joint(s) 2, 6 except 9=451(LC 21), 10=291(LC 1), 8=291(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 4-9=-349/80

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDF=6.0psf; BCDF=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (directional) and C-C Exterior(2E) 0-3-8 to 3-5-7, Exterior(2R) 3-5-7 to 7-8-6, Interior(1) 7-8-6 to 13-5-7, Exterior(2E) 13-5-7 to 16-7-7 zone; cantilever left and right exposed ; end vertical left and right exposed; C/C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) Gable requires continuous bottom chord bearing.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 9.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Michael S. Magid PE No.53681
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

June 4, 2022



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

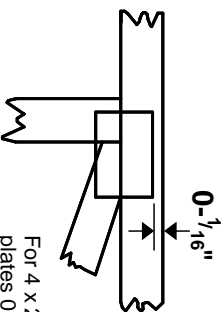

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*** Plate location details available in MITek 20/20 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

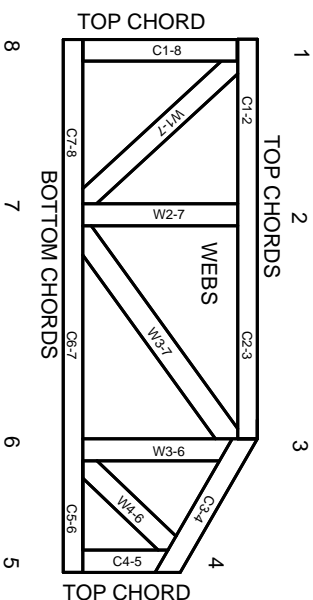

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITEK Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.