


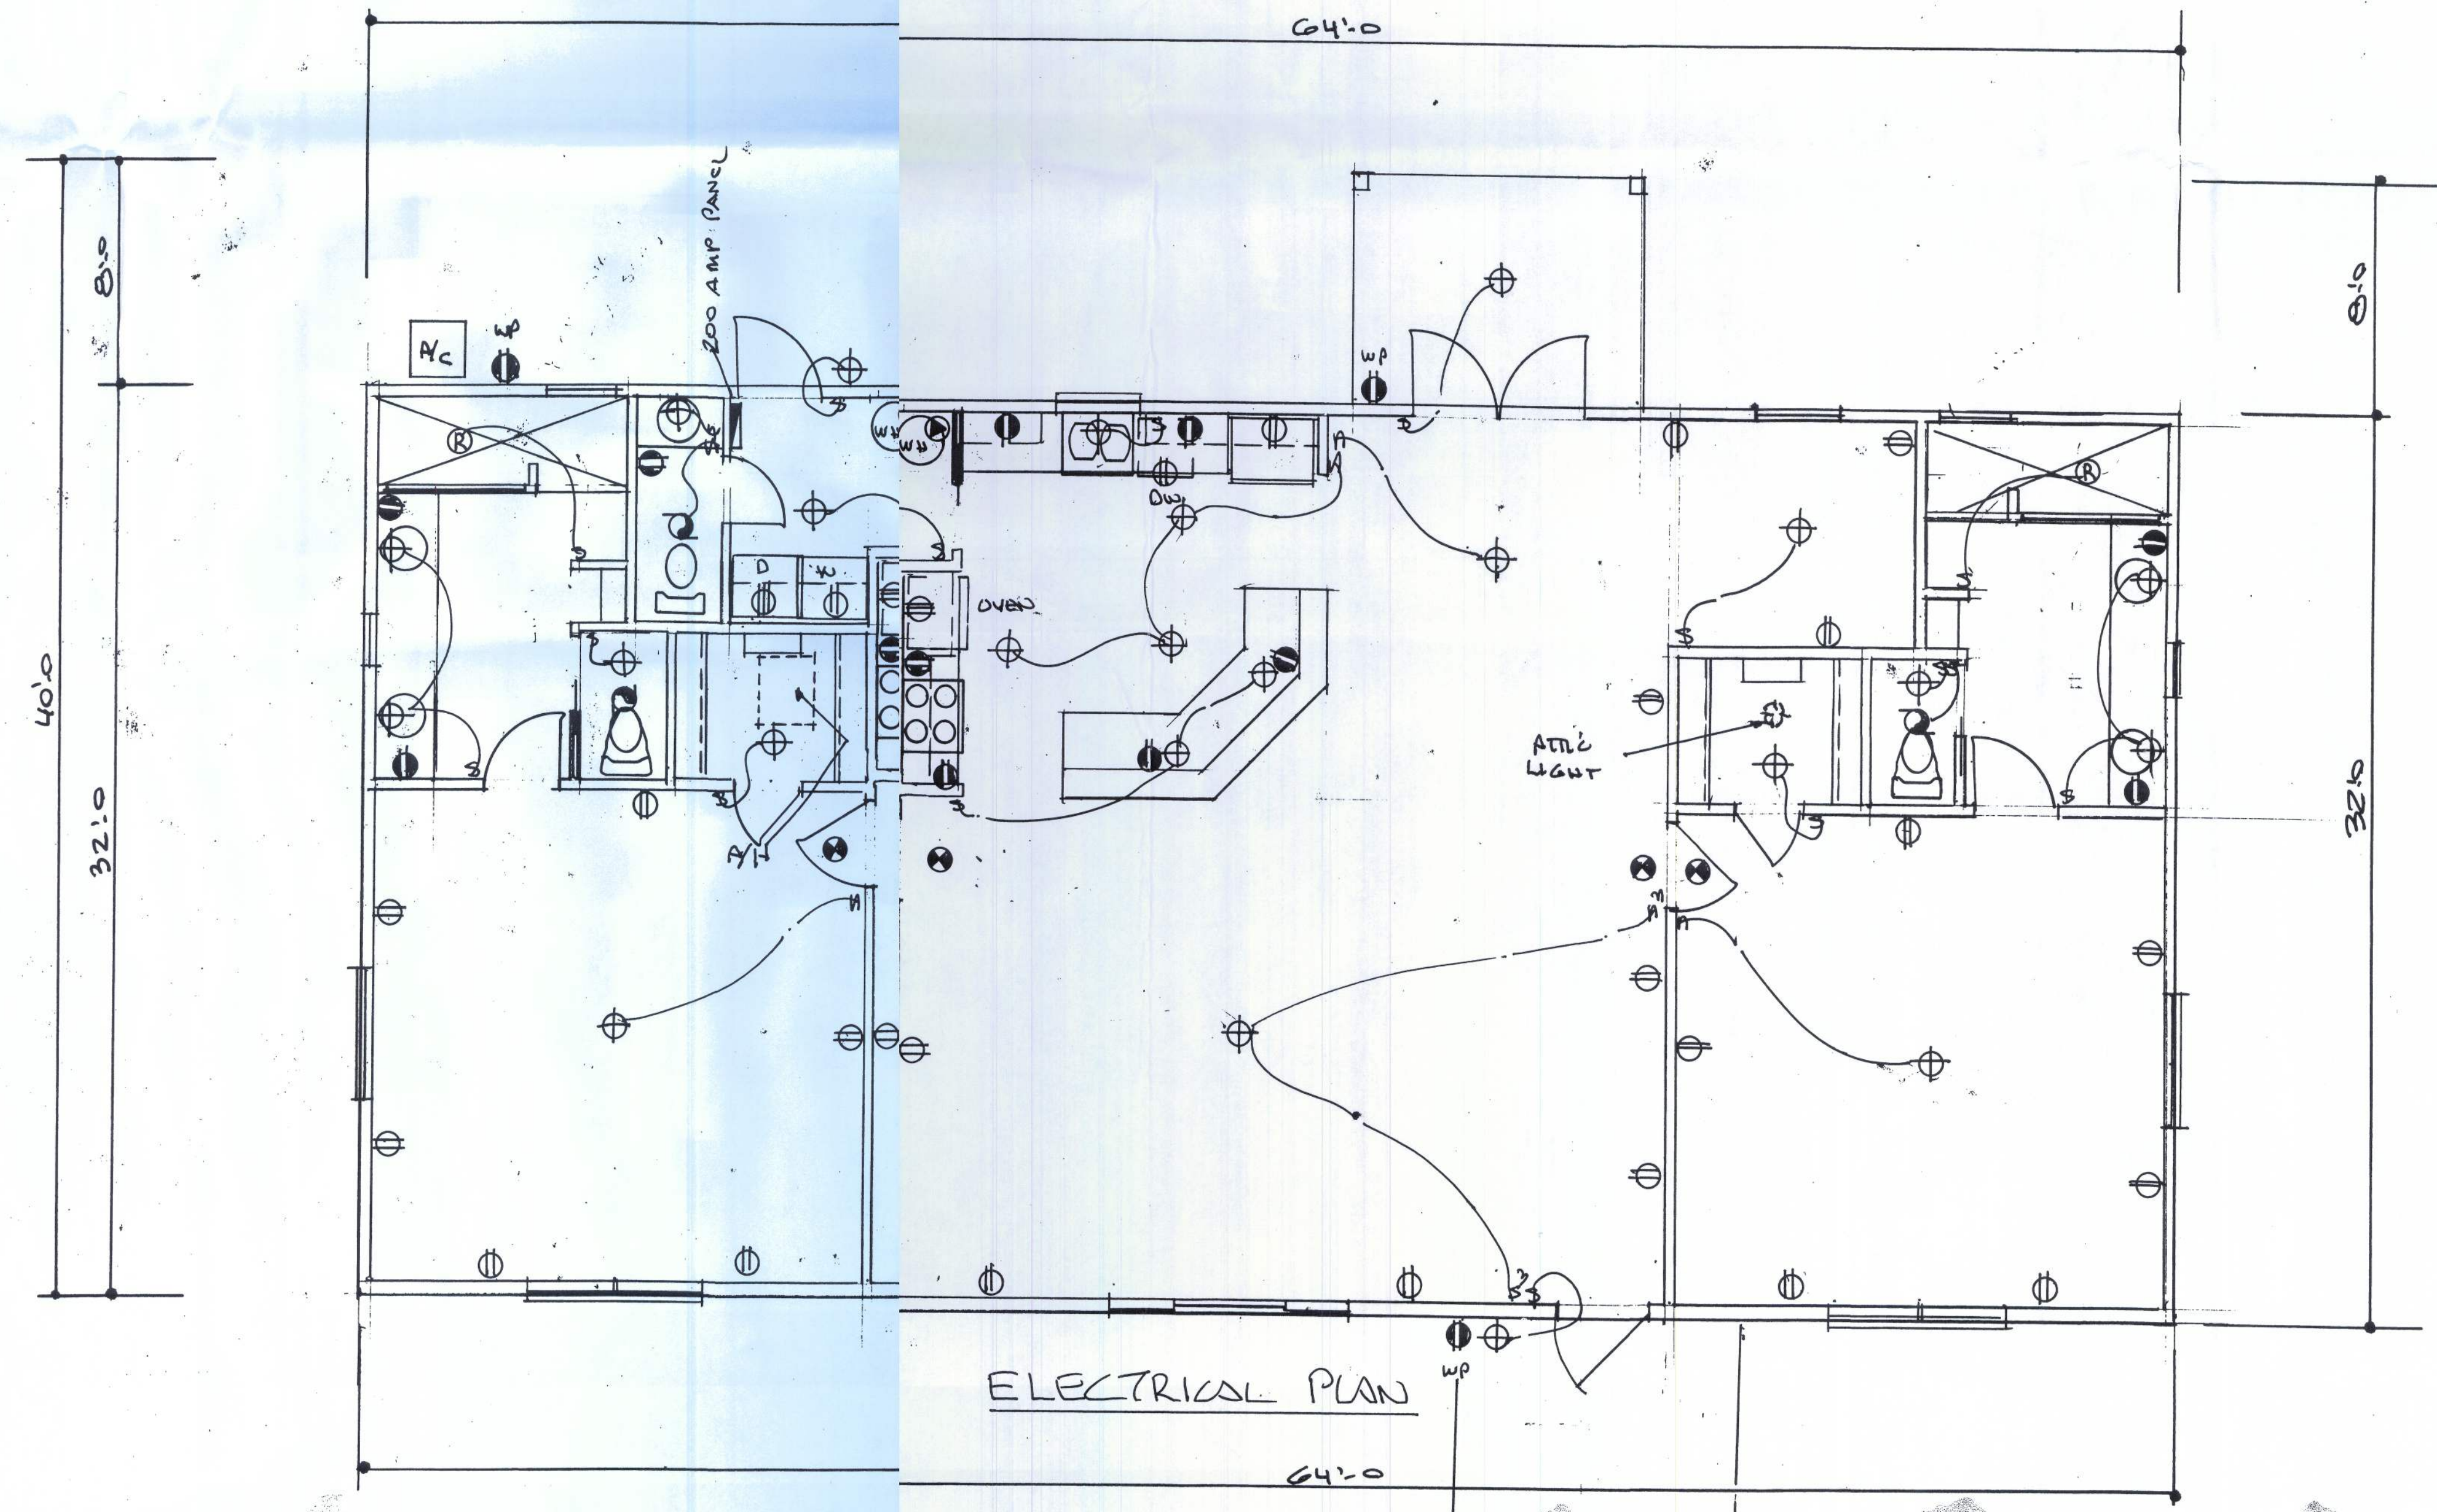

- HOUSES WITH ATTACHED GARAGES, OR FIREPLACES, OR GAS APPLIANCES NEED A CARBON MONOXIDE SENSOR IN THE LIVING AREA.
- ⊕ DUPLEX RECEPTACLE
 - ⊕ 1/2 SWITCHED RECEPTACLE
 - ⊕ G.F.I. OUTLET
 - ⊕ FLOOR OUTLET
 - ⊕ WP WEATHER PROOF OUTLET (G.F.I.)
 - ⊕ SWITCH
 - ⊕ 3 WAY SWITCH
 - ⊕ 4 WAY SWITCH
 - ⊕ LIGHT FIXTURE
 - ⊕ WEATHER-PROOF LIGHT
 - ⊕ SINGLE BULB FLUORESCENT
 - ⊕ 2 LAMP FLUORESCENT
 - ⊕ FLOOD LIGHT
 - ⊕ EXHAUST FAN
 - ⊕ HEAT LAMP
 - ⊕ PHONE
 - ⊕ SMOKE DETECTOR
 - ⊕ T.V. OUTLET
 - ⊕ 220 VOLT OUTLET
 - ⊕ CEILING FAN
 - ⊕ FAN AND LIGHT
 - ⊕ LIGHT IN ATTIC
 - ⊕ RE. POOL EQUIPMENT WITH BOX FOR POOL LIGHT
 - ⊕ P.L. BOX FOR FUTURE POST LIGHT
 - ⊕ B. BUTTON FOR GARAGE DOOR OPENER
 - ⊕ D.O. ROUGH IN FOR GARAGE DOOR OPENER
 - ⊕ D.B. DOOR BELL
 - ⊕ CHIME DOOR CHIME
 - ⊕ 220V Plug
 - ⊕ DISCONNECT
 - ⊕ R. RECESSED LIGHT
 - ⊕ ELECTRIC PANEL
 - ⊕ ELECTRIC METER
 - ⊕ WALL MOUNTED LIGHT FIXTURE

Bedrooms and smoke detectors to be on arc-fault circuit

All outlets in garage to be g.f.i.c. and located 42" above floor

REVISIONS	BY
12/1	

OWNER AND GENERAL CONTRACTOR TO CHECK PLANS AND REPORT ANY DISCREPANCIES TO DESIGNER WITHIN 10 DAYS AFTER RECEIPT OF PLANS. DESIGNER NOT RESPONSIBLE FOR ANY COSTS IN RECTIFYING SAME. DESIGNER ASSUMES NO LIABILITY FOR LOCATION OF STRUCTURE ON THE LOT, LOCATION OF EASEMENTS, EASEMENTS TO PROPERTY LINES, EASEMENTS OR EASEMENTS TO ADJACENT PROPERTY, OR EASEMENTS TO ADJACENT STATE LICENSED SURVEYOR. DESIGNER NOT RESPONSIBLE FOR INFORMATION FURNISHED BY OTHERS. PLANS TO BE SUBMITTED FOR REVIEW AND APPROVAL BY LOCAL BUILDING DEPARTMENT. DESIGNER DOES NOT ASSUME ANY RESPONSIBILITY FOR ANY AMENDMENTS OR CHANGES TO PLANS OR ANY AMENDMENTS BY LOCAL BUILDING DEPARTMENT.

COVINGTON DESIGN WORKS
10767 EAST FLORIAN DRIVE
FLORAL CITY, FL 34436
352-344-0893

352-228-7978
GUY AND NANCY SHANAHAN

DATE	11/29/2010
SCALE	1/4" = 1'-0"
JOB NO.	261
SHEET	5