



DESIGN SPECIFICATIONS

- DESIGN CODES:
 - 2023 FLORIDA BUILDING CODE (FBC) - RESIDENTIAL
- OCCUPANCY: RESIDENTIAL GROUP R-3 (ONE- AND TWO-FAMILY DWELLINGS)
- DESIGN LOADS:
 - ROOF CONVENTIONAL FRAMING:
 - LL 20 PSF RAFTERS
 - LL 20 PSF CEILING JOISTS
 - DL 10 PSF RAFTERS
 - DL 10 PSF CEILING JOISTS
 - DL 30 PSF ATTICS WITH STORAGE
 - DL 10 PSF ATTICS W/O STORAGE
 - FLOORS:
 - LL 40 PSF TOP CHORD
 - LL 0 PSF BOTTOM CHORD
 - DL 10 PSF TOP CHORD
 - DL 5 PSF BOTTOM CHORD
- NUMBER OF STORIES: 1
- TYPE OF CONSTRUCTION: TYPE V-6, UNPROTECTED, UNSPRINKLERED
- WIND ZONE INFORMATION
 - BUILDING: ENCLOSED STRUCTURE
 - ULTIMATE DESIGN WIND SPEED: 130 MPH
 - NOMINAL DESIGN WIND SPEED: 110 MPH
 - BUILDING RISK CATEGORY: II
 - WIND EXPOSURE CATEGORY: C
 - INTERNAL PRESSURE COEFFICIENT: 0.18 CG_{pl} ±

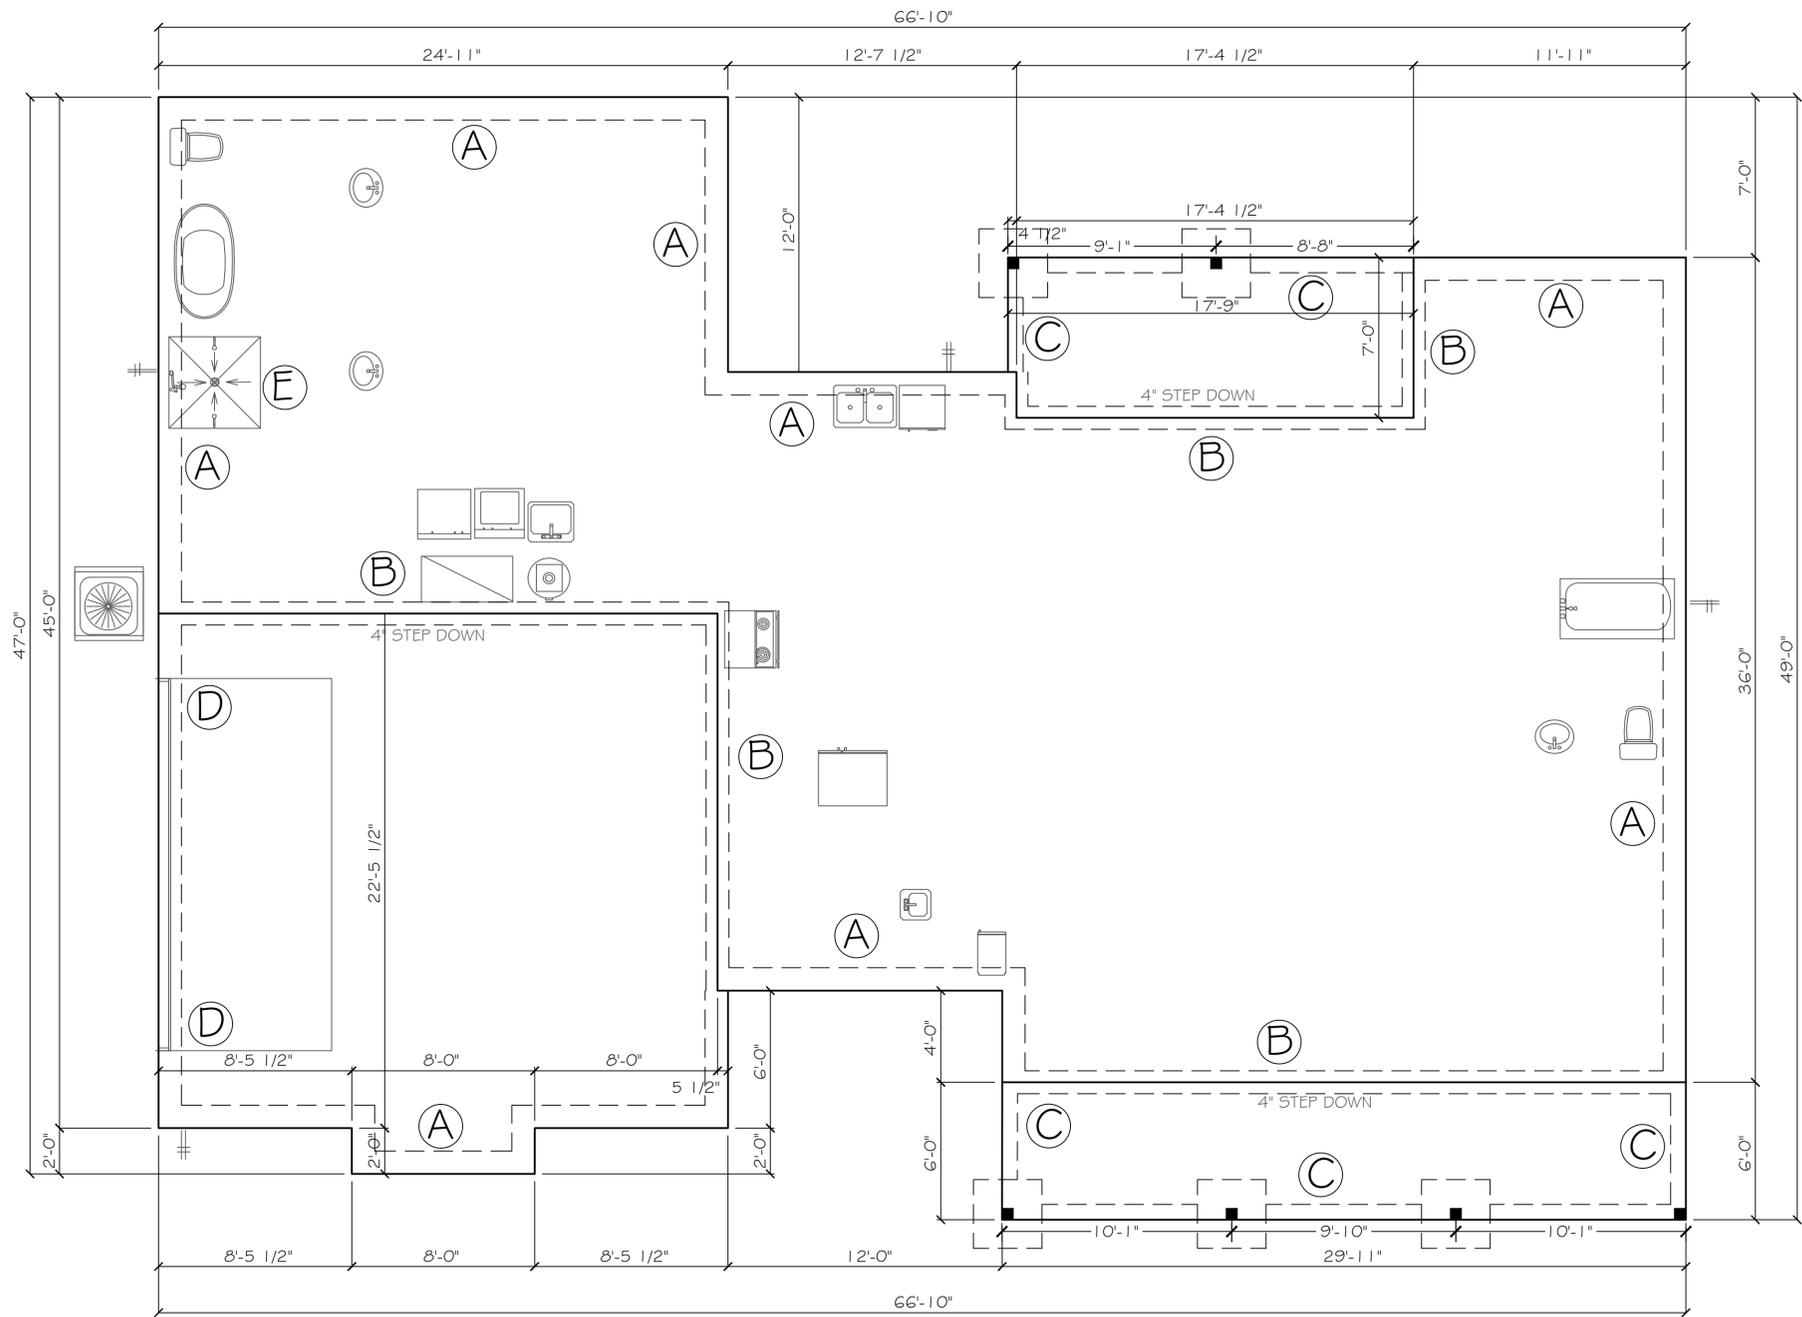


- REFER TO ARCHITECTURAL & BUILDING PLANS FOR ACTUAL DIMENSIONS, RECESSES IN SLAB, STEP DOWNS, ETC.
- CONTRACTOR SHALL VERIFY ALL ROUGH PLUMBING LOCATIONS WITH OWNER PRIOR TO POURING SLAB
- THE SLAB SHALL BE 4" CONCRETE SLAB REINFORCED W/ 6X6-1.4/1.4 WELDED WIRE MESH PLACED ON CHAIRS 1 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER W/ 6" LAPS SEALED W/ POLY TAPE OVER TERMITE-TREATED & COMPACTED FILL
- BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL
- SOIL UNDER FOOTING SHALL BE COMPRESSED TO 2000 PSF AT 95% DENSITY. CONCRETE STRENGTH SHALL BE 2500 PSI.


FOUNDATION PLAN
SCALE: 1/4" = 1'

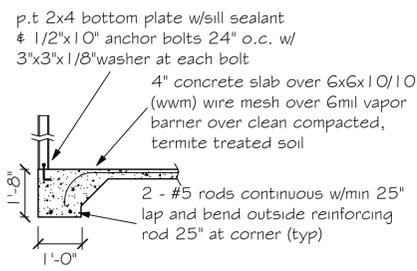


(A) Monolithic slab detail

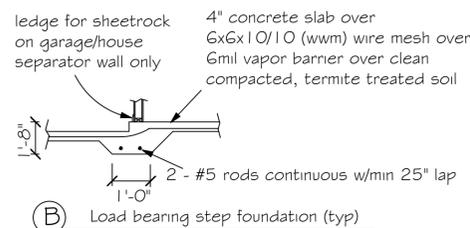


(B) Load bearing step foundation (typ)

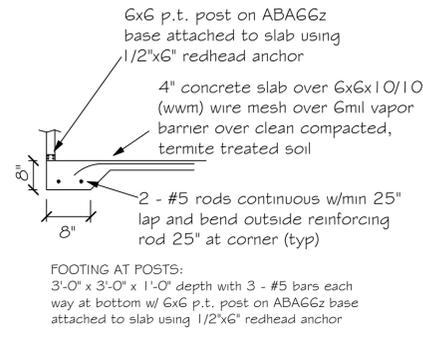

(C) Monolithic slab detail at porch/carport

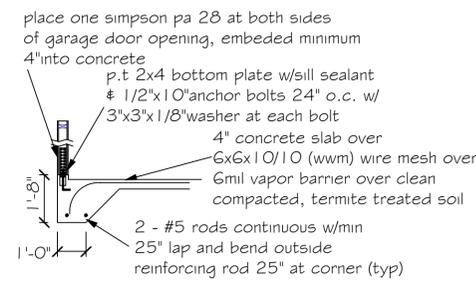

(D) Monolithic slab detail at garage



(E) Recessed Shower Detail

THE CYPRESS - MODEL A
 FOUNDATION PLAN
 SHEET 5-1
 DATE: JUNE 4, 2024
 PROJECT NO: F124274

Digitally signed by
 Carol Chadwick
 DN: c=US,
 o=Florida,
 ou=Qualifier-A0141
 ou=0000018D46384
 ou=E7500032FEE,
 cn=Carol Chadwick
 Date: 2024.06.04
 17:47:59 -0400

This document has been digitally signed and sealed by Carol Chadwick, P.E. on the date shown above. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copy.

ROOF VENT CALCULATION

FORMULA

1 SQUARE INCH FOR EVERY 300 SQUARE INCHES OF CEILING
 1.44 SQUARE INCHES = 1 SQUARE FOOT
 BUILDING CEILING (50 FT) x 144 = BUILDING SQ IN
 BUILDING SQ IN / 300 = SQ IN OF VENT REQUIRED
 SQ IN OF VENT REQUIRED x 2 = 50% AT HIGH AND 50% AT LOW
 PER IRC SECTION R803.2.4: 40% MIN, BUT NOT MORE THAN 50% OF
 VENTILATION MUST BE PROVIDED BY VENTILATORS LOCATED A
 MIN 3'-0" ABOVE EAVE

BASE OF CALCULATION:

(a) OFF EDGE VENTS - STAMPCO W/ 36 SQ IN (IN/VA) PER LINEAL FT
 (b) SOFFIT VENTS - GP T3-1/3" FULL VENT PERFORATED W/ 9.19 SQ IN
 (IN/VA) PER LINEAL FT

CALCULATED LINEAL FOOT OF SOFFIT VENT SHALL NOT INCLUDE
 NON-VENTED FIRE RATED SOFFIT LOCATED LESS THAN 5' FROM
 PROPERTY LINE

AREA (SQ FT)	REQUIRED (SQ IN)	VENTS (SQ IN)	LINEAL FT	LOW (SQ IN)

SOFFIT TABLE VENT SPECS

Double 5" perforated soffits have a 6.20 sq. inches/ sq. foot rating
 Triple 4" center vent soffits has a 1.95 sq. inches/ sq. foot rating
 Triple 4" full vent soffits has a 5.62 sq. inches/ sq. foot rating
 Triple 4" basketweave full vent has a 1.43 sq. inches/ sq. foot rating
 Triple 4" center vent has a 4.70 sq. inches/ sq. foot rating
 Beaded hidden vent soffits has 2.66 sq. inches/ sq. foot rating
 Triple 3-1/2" hidden vent soffits has a 9.19 sq. inches/ sq. foot rating

NOTE
 7/16" O.S.B. NAILED WITH 8D 6"
 O.C. IN FIELD & 4" O.C. ON EDGES

NOTE
 Simpson Strong-Tie Co. Strong-Drive SDWC TRUSS Screws may be used for uplift connection in lieu of straps. Strong-Drive SDWC TRUSS Screws to be installed per manufacturer's specifications.


Simpson Strong-Tie Co. Titen HD Heavy-Duty Screw Anchors 5/8" x 8", maximum spacing of 24" o.c., may be used in lieu of 5/8" x 10" anchor bolts with 3"x3"x1/8" washer. Titen HD Heavy-Duty Screw Anchors shall be installed per manufacturer's specifications.

ROOF SHEATHING FASTENING


- 4" O.C. GABLE END
 - 6" O.C. EDGES (ALL ZONES)
 - 6" O.C. INTERMEDIATE FRAMING (ZONE 3)
 - 12" O.C. INTERMEDIATE FRAMING (ZONES 1 & 2)
- SEE FIGURE R803.2.3.1, SECTION R803.1, 2017 FLORIDA BUILDING CODE - RESIDENTIAL, SIXTH EDITION FOR ROOF SHEATHING NAILING ZONES

ROOF NOTES


- ROOF PITCH LESS THEN 4/12 DBL LAYER OF UNDERLAYMENT IS REQUIRED
- OVERLAP ROOFING UNDERLAYMENT 4" MIN OVER HIP AND RIDGES
- BUTTON CAP NAILS ARE USED TO FASTEN UNDERLAYMENT TO ROOF DECK WHEN SHINGLES NOT INSTALLED SAME DAY
- DRIP EDGE INSTALLED OVER THE UNDERLAYMENT AT RAKES AND UNDER THE UNDERLAYMENT AT EAVES
- ALL ROOF PENETRATIONS ARE PROPERLY FLASHED W/ FLASHING OF THE CORRECT SIZE FOR THE PENETRATION
- METAL ROOFING ATTACHED W/ CORRECT FASTENERS PER CODE AND MANUFACTURERS SPECS
- 1" SPACE IS MAINTAINED BETWEEN THE END OF THE GUTTER AND THE WALL CLADDING

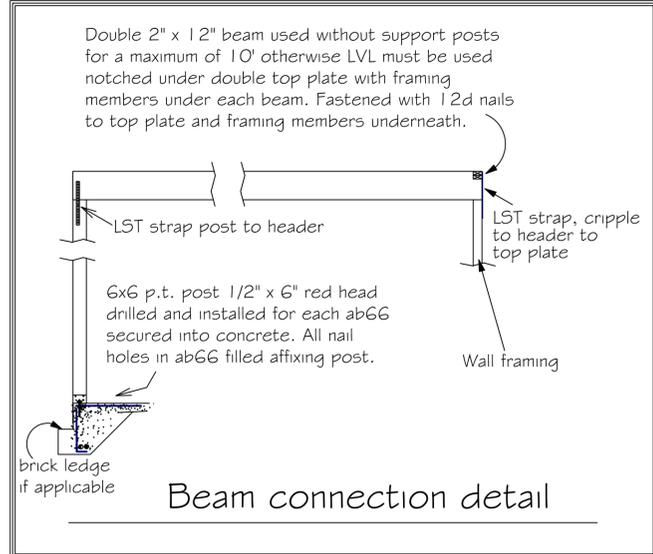


Double 1 3/4" x 11-1/4" LVL beam over opening up to 12'
 Double 1 3/4" x 11-7/8" LVL beam over opening over 12' and up to 14'
 Double 1 3/4" x 14" LVL beam over opening over 14' and up to 16' with 3 king studs each end and 2 trimmers each end of beam. Fastened with 12d nails to top plate and framing members. One PA28 at both sides of opening embedded min 4" into concrete. LST18 strap over trimmer to header each side.

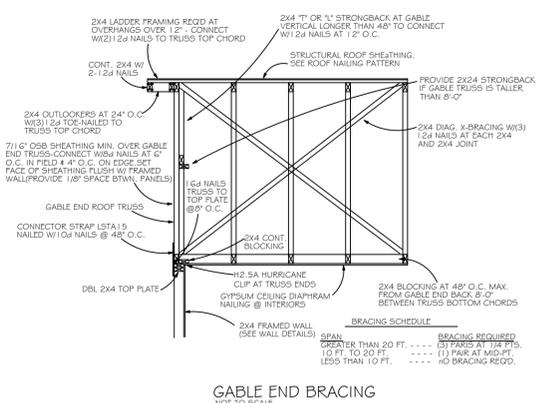


GABLE END BRACING
 NOT TO SCALE

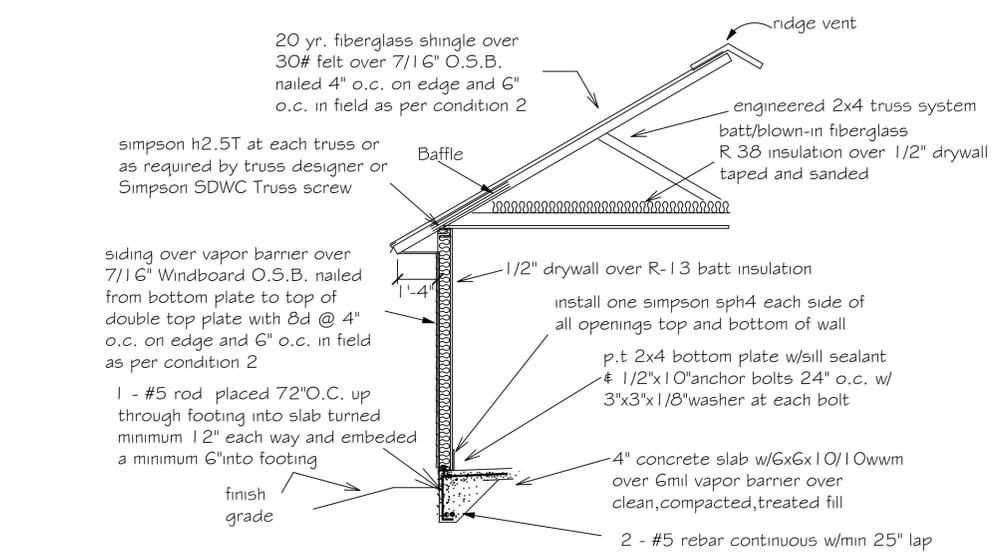


"AA" Windboard wall detail

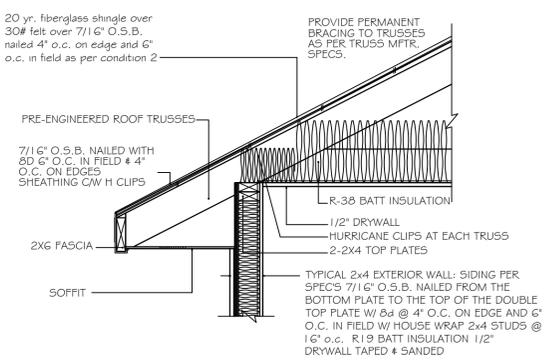

4" STUD EAVE

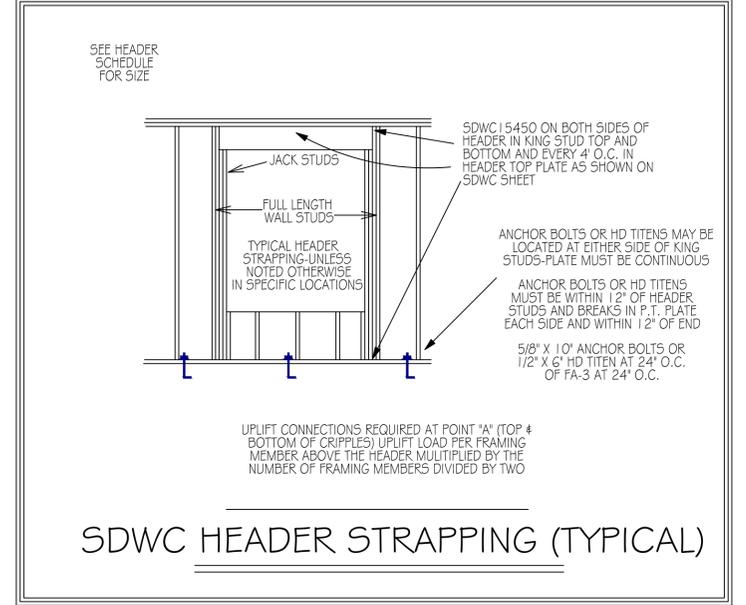

SDWC HEADER STRAPPING (TYPICAL)

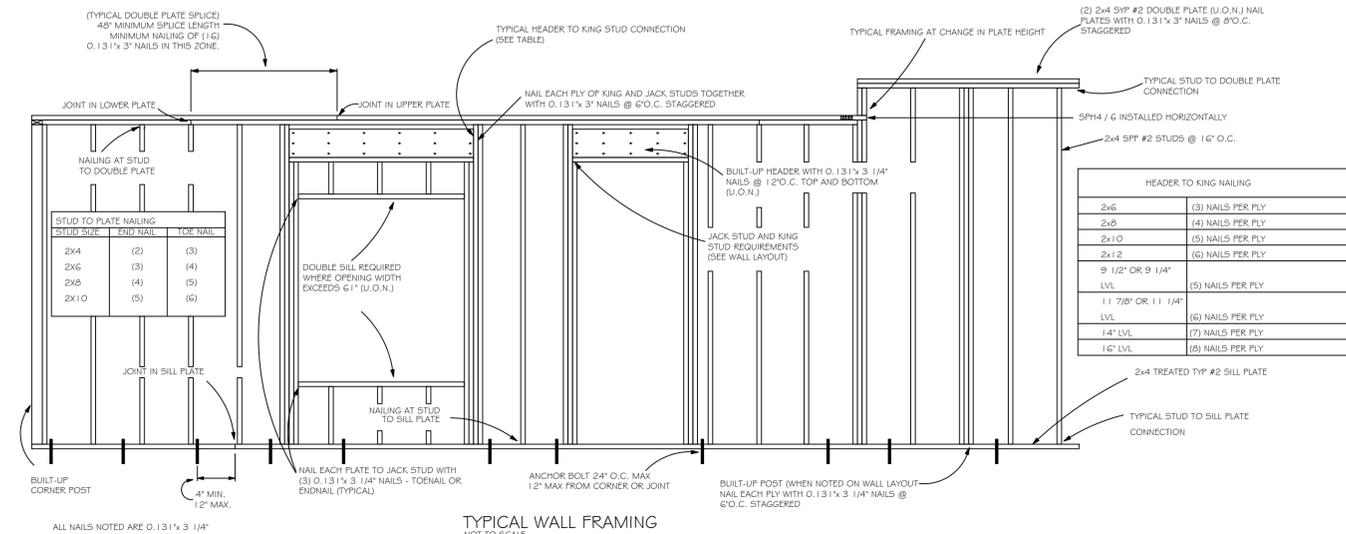

TYPICAL WALL FRAMING
 NOT TO SCALE

HEADER SCHEDULE

2X STUD CONTINUOUS TO TOP PLATE

HEADER - CONTINUOUS

2 - 2X STUDS UNDER LINTELS WITH OPENINGS LARGER THEN 5'-0"

NOTE:
 UPLIFT CONNECTION IS REQUIRED AT EACH END OF HEADER AND AT BOTTOM OF HEADER STUDS IN ADDITION TO CONNECTORS AT WALL STUDS AND AT TOP AND BOTTOM OF CRIPPLES

OPENING WIDTH	BEARING OR SHEAR WALL	NON-BEARING WALLS
0'-0" TO 3'-0"	2 - 2 X 6's	2 - 2 x 4's
3'-1" TO 5'-0"	2 - 2 x 10's	2 - 2 x 6's
5'-1" TO 7'-0"	2 - 2 x 10's	2 - 2 x 8's
7'-1" TO 10'-0"	2 - 2 x 10's	2 - 2 x 10's

MAXIMUM HEADER SPAN

3'	6'	9'	12'	15'	18'
----	----	----	-----	-----	-----

NUMBER OF HEADER STUDS SUPPORTING END OF HEADER

1	1	2	2	2
---	---	---	---	---

NUMBER OF FULL LENGTH STUDS AT END OF HEADER

2

Digitally signed by Carol Chadwick, P.E. on the date 2024.06.04 17:47:40 -0400

REGISTERED PROFESSIONAL ENGINEER
 STATE OF FLORIDA
 ENGINEERING
 No. 124274
 EXPIRES 12/31/2026
 CAROL CHADWICK, P.E.
 11000 W. BAYVIEW BLVD., SUITE 100
 MIAMI, FL 33147
 (305) 555-1100
 www.carolchadwick.com
 carol@carolchadwick.com

THE CYPRESS - MODEL A
 FRAMING DETAILS
 SHEET 5-2