

106.87
N 47° 10' 14" W

41.18
N 62° 32' 00" W

79'-1 1/2"

50'-5"

54'-4"

20'-0"

○ WELL

SEPTIC

204.40
N 24° 13' 30"

184.26
S 31° 46' 15" W

NEW SINGLE STORY RESIDENCE

60'-2"

CONCRETE DRIVEWAY


WISE ESTATES BLOCK C LOT 21
0.58 ACRES

45'-0"

119.71
S 58° 42' 50" W

SW MELBA GLEN

PREMDOR (ENTERGY BRAND) DOUBLE DOOR
WITH SIDELITES IN WOOD FRAMES
WITH BUMPER THRESHOLD (INSWING)

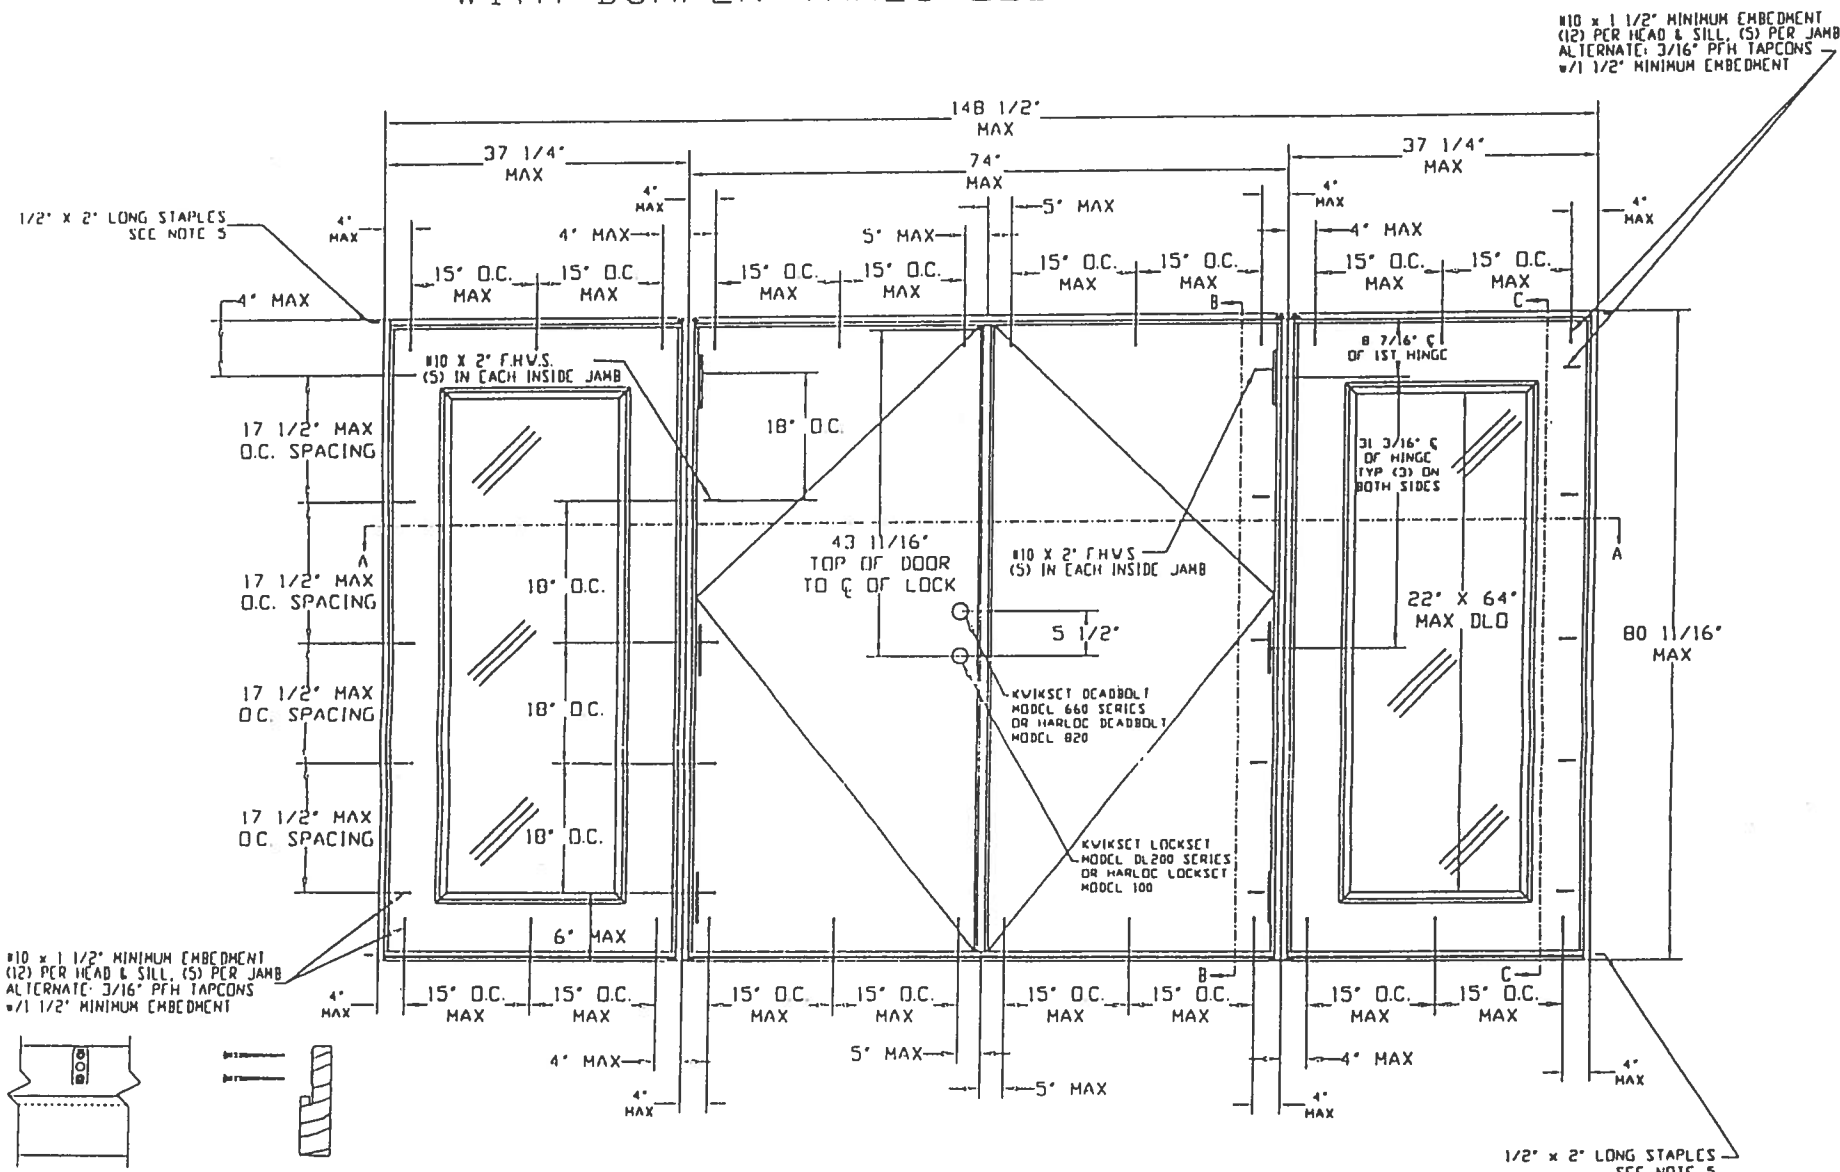

ATTACH ASTRAGAL THROW BOLT
STRIKE PLATE TO THE HEADER
AND THRESHOLD WITH #10 x 1 3/4\"/>

NOTES:
> WOOD BUCKS BY OTHERS, MUST BE ANCHORED
PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
> THE PRECEDING DRAWINGS ARE INTENDED TO
QUALIFY THE FOLLOWING INSTALLATIONS.

WOOD FRAME CONSTRUCTION WHERE DOOR
SYSTEM IS ANCHORED TO A MINIMUM TWO BY WOOD
PENING.

MASONRY OR CONCRETE CONSTRUCTION WHERE
DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY
STRUCTURAL WOOD BUCK.

MASONRY OR CONCRETE CONSTRUCTION WHERE
DOOR SYSTEM IS ANCHORED DIRECTLY TO CONCRETE
OR MASONRY WITH OR WITHOUT A NON-STRUCTURAL
NE BY WOOD BUCK.

ALL ANCHORING SCREWS TO BE #10 WITH
MINIMUM 1 1/2\"/>


UNIT MUST BE INSTALLED WITH 'MIAMI-DADE COUNTY
'PROVED' SHUTTERS

THREE STAPLES PER SIDE JAMB INTO HEADER ON SIDELITES
AND DOOR, THREE STAPLES PER JAMB INTO THRESHOLD ON
SIDELITES AND DOOR.


LATEX SEALANT TO BE APPLIED AT SIDE BY SIDE
JAMBS AND SIDELITES.

DOOR/SIDELITE HEADER, DOOR/SIDELITE JAMBS, AND SIDELITE BASE
CORNERS ARE COPED AND BUTT JOINED.

DOORS SHALL BE PRE-PAINTED WITH A WATER-BASED EPOXY RUST
INHIBITIVE PRIMER PAINT WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.
FRAMES SHALL BE PRE-PAINTED WITH AN ACRYLIC LATEX WATER-BASED/
WATER-REDUCIBLE WHITE PRIMER WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.

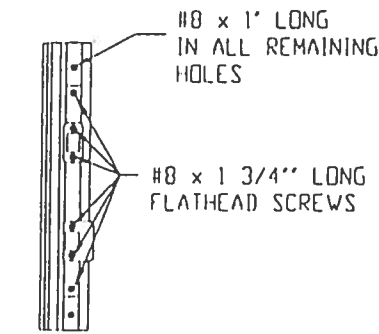

ASTRAGAL

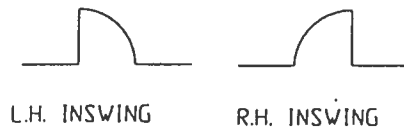

DESIGN PRESSURE RATINGS		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED *	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
Positive	NOT APPROVED *	+55.0 psf
Negative	NOT APPROVED *	-55.0 psf


* UNITS SHALL BE INSTALLED ONLY AT LOCATIONS PROTECTED BY A CANOPY OR
OVERHANG SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG
TO SILL IS LESS THAN 45 DEGREES. UNLESS UNIT IS INSTALLED IN
NON-HABITABLE AREAS WHERE THE UNIT AND THE AREA ARE DESIGNED TO
ACCEPT WATER INFILTRATION.

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2001
BY *Marcus Terry*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0314, 23

LIMITS: UNLESS NOTED, FRAC : DEC : ANG :		C	DADE COUNTY MODIFICATIONS		11/11/00	JD
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.		B	ADDED PAGE 5 (DOOR OPTIONS)		10-1-98	RS
ENGINEER:		A	ADD OTHER DOOR CONFIGURATIONS		12/18/97	RS
DR. BY R.S.		LTR.	REVISIONS		DATE	BY
DATE 7-29-97		PART NAME: ENTERGY METAL EDGED DOUBLE DOOR W/ SIDELITES		SCALE: N.T.S.		
PREMDOR ENTRY SYSTEMS		31-1029-EM-I		SHEET 1 OF 6		
911 E. JEFFERSON						
PITTSBURG, KS 66762						
				REVISION LETTER		C

MATERIALS LIST

ITEM NO.	DESCRIPTION	PART NUMBER	COMMENTS
①	WOOD HEAD JAMB	EM-14	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
②	COMPRESSION WEATHERSTRIP	EM-25	LOCKSCREEN BRAND LOXSEAL 9650 (BRONZE)
③	ALUMINUM ASTRAGAL	EM-12	PREMDOR BRAND OR EQUIVALENT - 5/8" ALUMINUM ASTRAGAL
④	ALUMINUM-BUMPER THRESHOLD	EM-15	PREMDOR BRAND OR EQUIVALENT - 1 1/4" X 4 9/16"
⑤	TOP CHANNEL	EM-08	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑥	STEEL SKIN	26 ga. (017 +.004 -.000)	MIN THICK STRIKEH 3500 PSI MAX THICKETS PER THICKL TEST REPORT IS 12"
⑦	POLYURETHANE FOAM CORE	BASF FOAM - DENSITY 2.0 TO 2.5 lbs./ft ³	
⑧	BOTTOM CHANNEL	EM-07	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑨	WOOD LOCK BLOCK	EM-09	4" X 9 1/2" MTL. TO BE PINE OR EQUIVALENT
⑩	STRIKE STILE	EM-06	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑪	HINGE STILE	EM-05	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑫	LOCK PREP FILLER PLATE	EM-10	PREMDOR BRAND - .050" THICK - MTL. TO BE POLYETHYLENE
⑬	4"x4" HINGE	EM-16	HAGER BRAND HINGE OR EQUIVALENT - .097 THICK (STEEL)
⑭	WOOD HINGE JAMB	EM-13	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
⑮	#10-24 X 1/2" F.H.W.S.		(4) SCREWS PER HINGE INTO DOOR
⑯	#10 X 2" F.H.W.S.		(5) SCREWS THROUGH HINGE JAMB INTO SIDELITE JAMB. 8" DOWN FROM TOP, MAX 18" O.C. THEREAFTER (10) SCREWS THROUGH STRIKE JAMB INTO SIDELITE JAMB. 4" DOWN FROM TOP MAX 8" O.C. THEREAFTER (6) SCREWS THROUGH EACH SIDELITE JAMB INTO SIDELITE. 4" DOWN FROM TOP, MAX 15" O.C. THEREAFTER
⑰	10 F.H.W.S. V/MINIMUM 1 1/2" EMBEDMENT OR 3/16" PTH TAPCONS V/MINIMUM 1 1/2" EMBEDMENT		REFER TO ELEVATION VIEW, FOR # OF SCREWS USED AND LOCATIONS
⑱	#10 X 3/4" F.H.W.S.		(2) SCREWS PER HINGE INTO JAMB
⑲	#8 X 2" F.H.W.S.		(2) SCREWS AT EACH STRIKE PLATE
⑳	LOCKSET		KWIKSET BRAND 200 LOCK OR HARLOC BRAND 100 LOCK
㉑	#10 X 1 3/4" F.H.W.S.		(2) SCREWS PER HINGE INTO JAMB
㉒	WOOD SIDELITE JAMB	EM-18	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
㉓	22" X 64" SINGLE PANEL GLASS	EM-19	TEMPERED GLASS IN POLYPROPYLENE FRAME - DC-1643 - (DDL-23) 1/8" CLEAR TEMPERED GLASS
㉔	SIDELITE TRIM (WOOD)	EM-20	5/16" X 1/2" MTL. TO BE PINE OR EQUIVALENT
㉕	WOOD CASING	EM-21	1/8" X 1" MTL. TO BE PINE OR EQUIVALENT - ITEMS ARE MOLDINGS USED FOR "SIDE BY SIDE JAMBS" AS MULLIONS
㉖	WOOD SIDELITE HEAD JAMB	EM-22	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
㉗	WOOD SIDELITE BASE	EM-23	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
㉘	POLYPROPYLENE LITE FRAME	DC-1643, DDL-2	HP Polypropylene by DDL
㉙	#6 X 1 1/2" PAN HEAD SCREWS		SCREW SPACING TO BE 3" IN FROM EACH CORNER AND NOT 18 PER FRAME TO EXCEED 14" O.C. THERE AFTER.
㉚	SIDELITE STILES	EM-26	15/16" X 1 11/16" MTL. TO BE PINE OR EQUIVALENT
㉛	PIN NAIL		3/4" LONG NAIL. 4" IN FROM END, MAX 8" O.C. THEREAFTER, USED ON MULLIONS AND TRIM

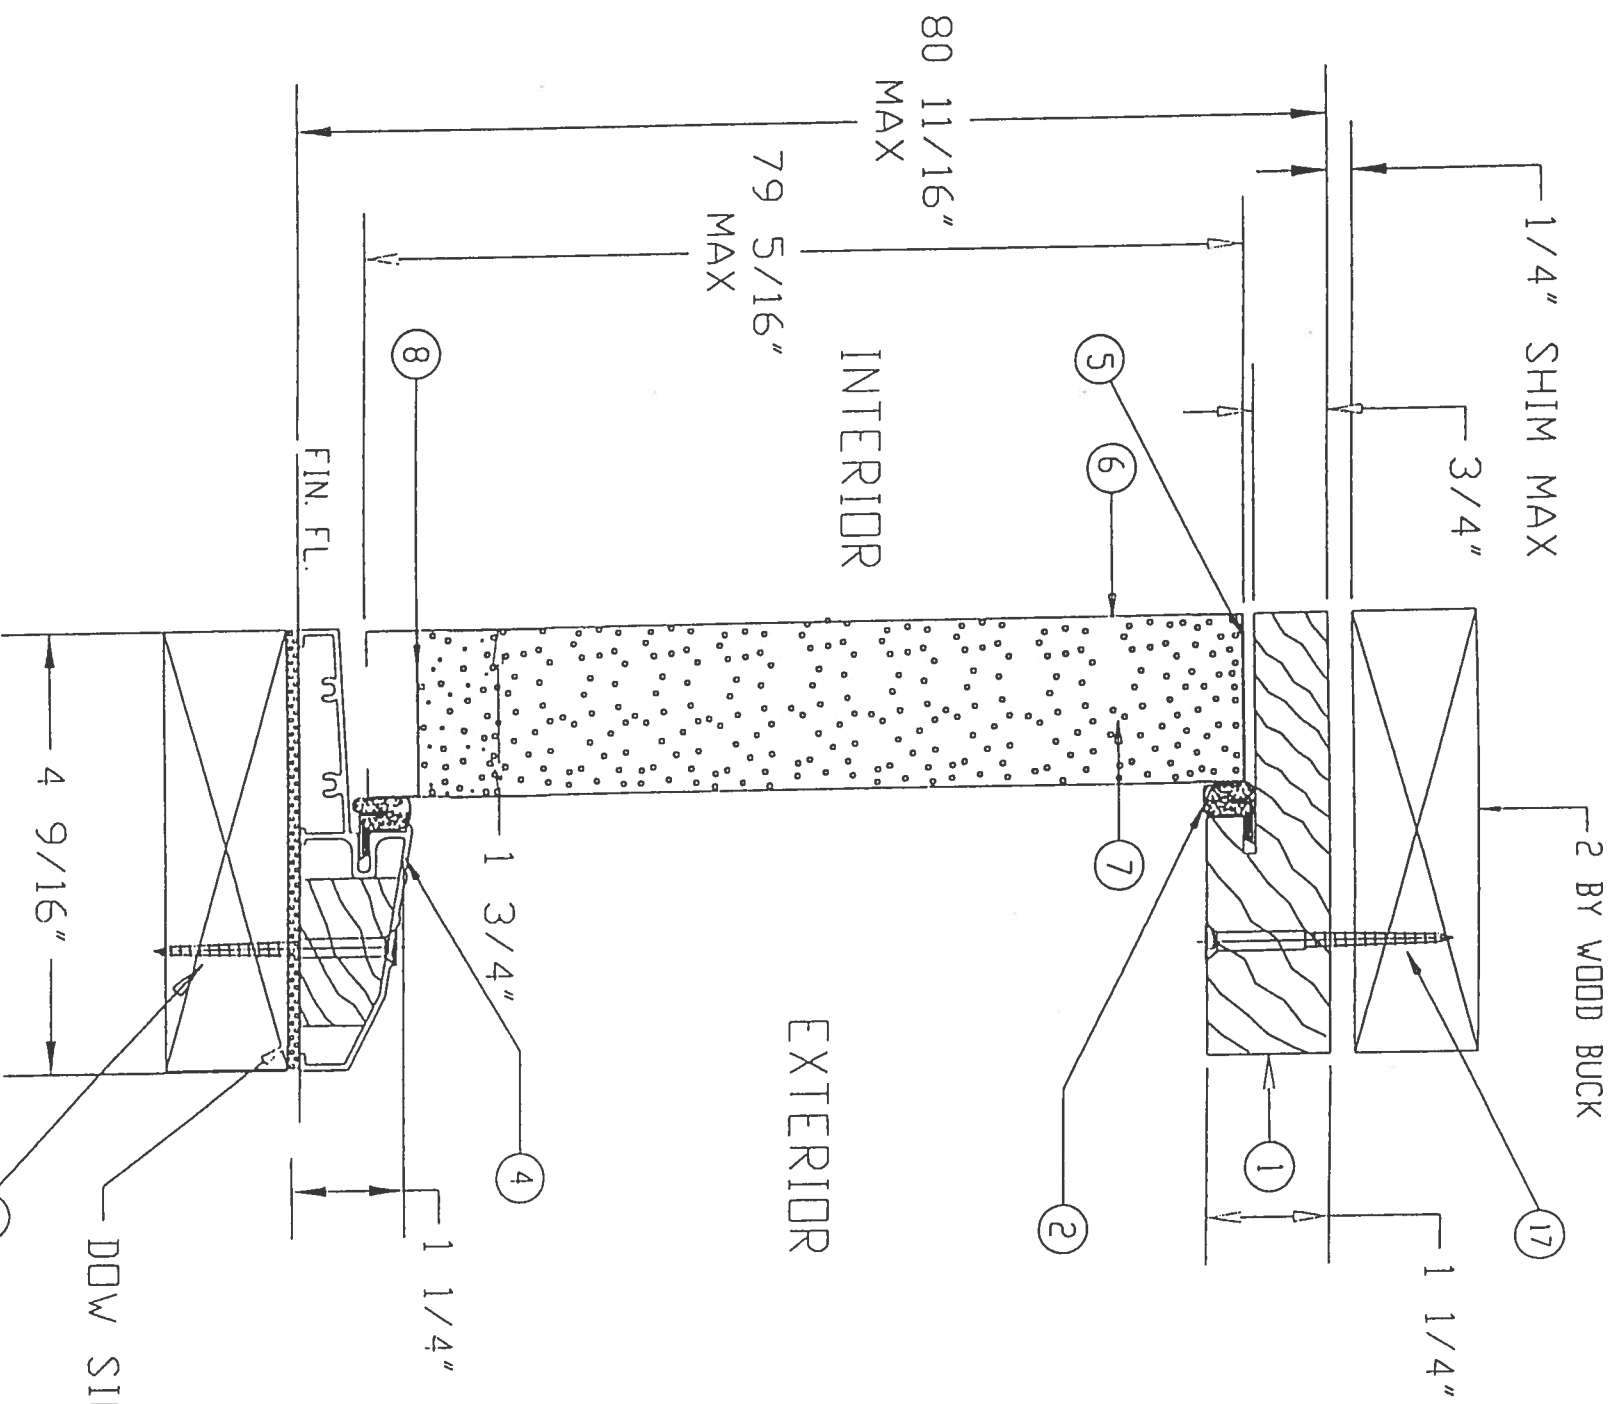

DOW SILICONE #995

APPROVED AS COMPLYING WITH THE

SOUTH FLORIDA BUILDING CODE


DATE JUN 05 2001

BY [Signature]

PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0314-23

SECTION B-B

DR. BY R.S.	DATE 7-29-97	SCALE:
PREMDOR ENTRY SYSTEMS		
911 E. JEFFERSON PILLSBURY, KS 66762		
31-1029-EM-1 SHEET 3 OF 6		
REVISION LETTER B		

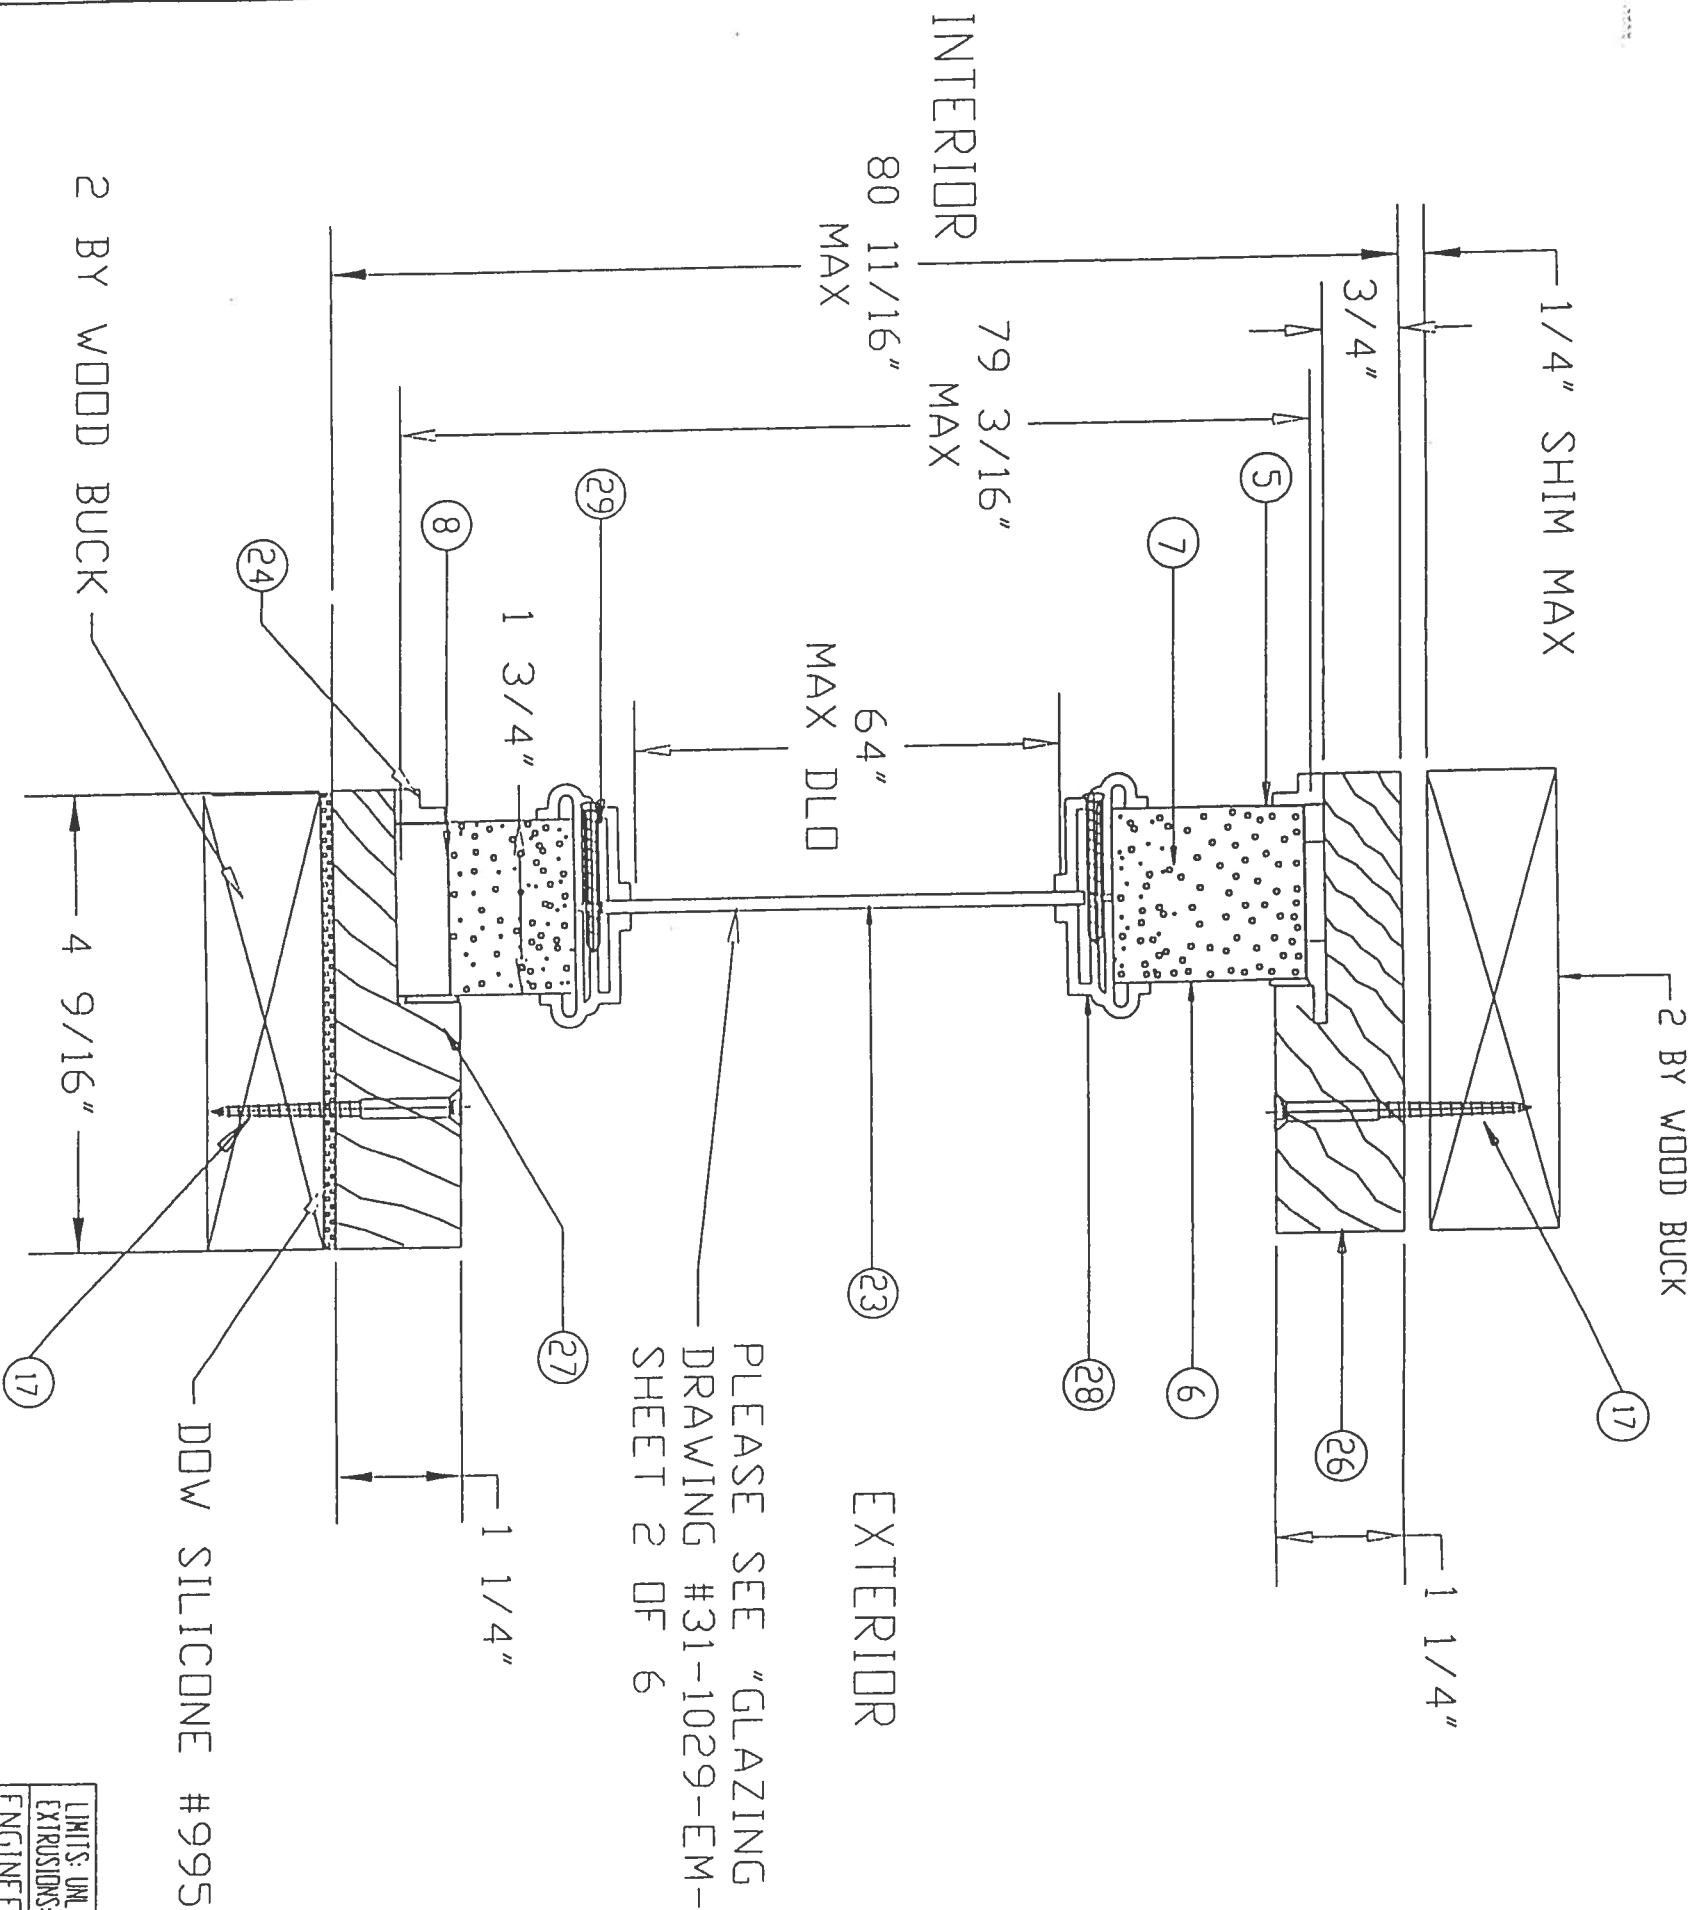


PLEASE SEE "GLAZING DETAIL"
DRAWING #31-1029-EM-I
SHEET 2 OF 6

SECTION C-C

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **JUN 05 2004**
BY *Shawnee*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. **01-0314-23**

LIMITS: UNLESS NOTED, FRAC. :		DEC. :		ANG. :	
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.		A		ADD SCREWS TO LITE FRAME & MATERIAL LIST	
ENGINEER:		LIR.		REVISIONS	
DR. BY R.S.		DATE 7-29-97		PART NAME: ENERGY METAL EDGE SILL/LE (C-C)	
PREMDOR ENTRY SYSTEMS		HAIR:		SCALE:	
911 E. JEFFERSON		31-1029-EM-I		SHEET 4 OF 6	
PITTSBURG, KS. 66762		REVISION LETTER		D	

10



LIMITS: UNLESS NOTED, 1/8" :	DEC :	ANG :		
EXTENSIONS: UNLESS NOTED, STD. COM'L. TOL'S.				
ENGINEER:	LIR	REVISIONS	DATE	BY

[illegible]

סמל המדינה

APPENDIX

211

111135K, YJ 05/05

PART NAME:	
MAF'l:	SCALE:

LIR.	REVISIONS	DATE	BY
------	-----------	------	----

[illegible]

REVISIONS	DATE	BY
-----------	------	----

[illegible]


SCALE:

31-1029-EM-I


SHEET 5 OF 6

PROVISION LETTER

OTHER DOOR PANEL STYLES

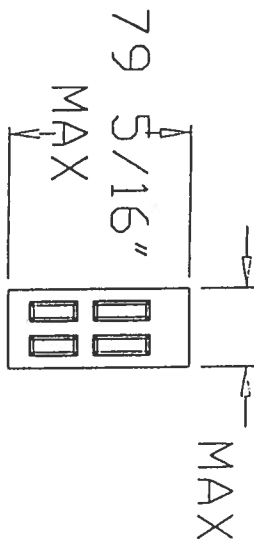	BLANK TOP 4-PANEL	6-PANEL	4-PANEL	9-PANEL	10-PANEL	18-PANEL	FLUSH	8-PANEL	CROSSBUCK	12-PANEL	4-PANEL EYEBROW	5-PANEL W/SCROLL	5-PANEL EYEBROW W/SCROLL	5-PANEL	5-PANEL EYEBROW
--	----------------------	---------	---------	---------	----------	----------	-------	---------	-----------	----------	--------------------	---------------------	--------------------------------	---------	--------------------

OTHER SIDELITE STYLES

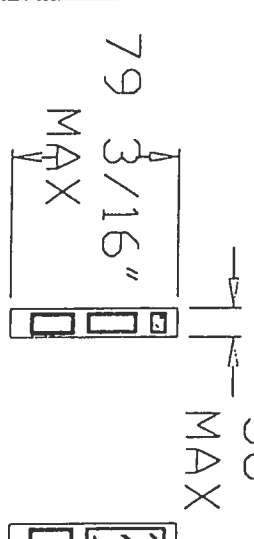	SL-10	SL-20	SL-30	SL-60	SL-50	SL-50B	SL-69A	SL-69B	SL-69C	SL-25	SL-55	SL-30D	SL-40	SL-90A	SL-90B	SL-90C	SL-30B	SL-30C	SL-70	SL-80
--	-------	-------	-------	-------	-------	--------	--------	--------	--------	-------	-------	--------	-------	--------	--------	--------	--------	--------	-------	-------

PD-1	PD-2	PD-3	PD-4	PD-5	PD-6	PD-7	PD-8	PD-9	PD-10	PD-11	PD-12	PD-13	PD-14	PD-15	PD-16	PD-17
------	------	------	------	------	------	------	------	------	-------	-------	-------	-------	-------	-------	-------	-------

PD-18	PD-19	PD-20	PD-21	PD-22	PD-23	PD-24	PD-25	PD-26	PD-27	PD-28	PD-29	PD-30	PD-31	PD-32	PD-33	PD-34
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

PD-35	PD-36	PD-37	PD-38	PD-39	PD-40	PD-41	PD-42	PD-43	PD-43A	PD-43B
-------	-------	-------	-------	-------	-------	-------	-------	-------	--------	--------

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2001
BY *Maunick Jurek*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO 01-0314.23

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :			
ENGINEER:			
DATE 1/15/01			
REV. NAME: PREMDOR DOOR OPTIONS			
SCALE:			

DR. BY J.D.			
PREMDOR ENTRY SYSTEMS			
911 E. JEFFERSON			
PITTSBURG, KS 66762			
31-1029-EM-1			
SHEET 6 OF 6			