



PREMDOR (ENTERGY BRAND) DOUBLE DOOR WITH SIDELITES IN WOOD FRAMES WITH A BUMPER THRESHOLD (OUTSWING)

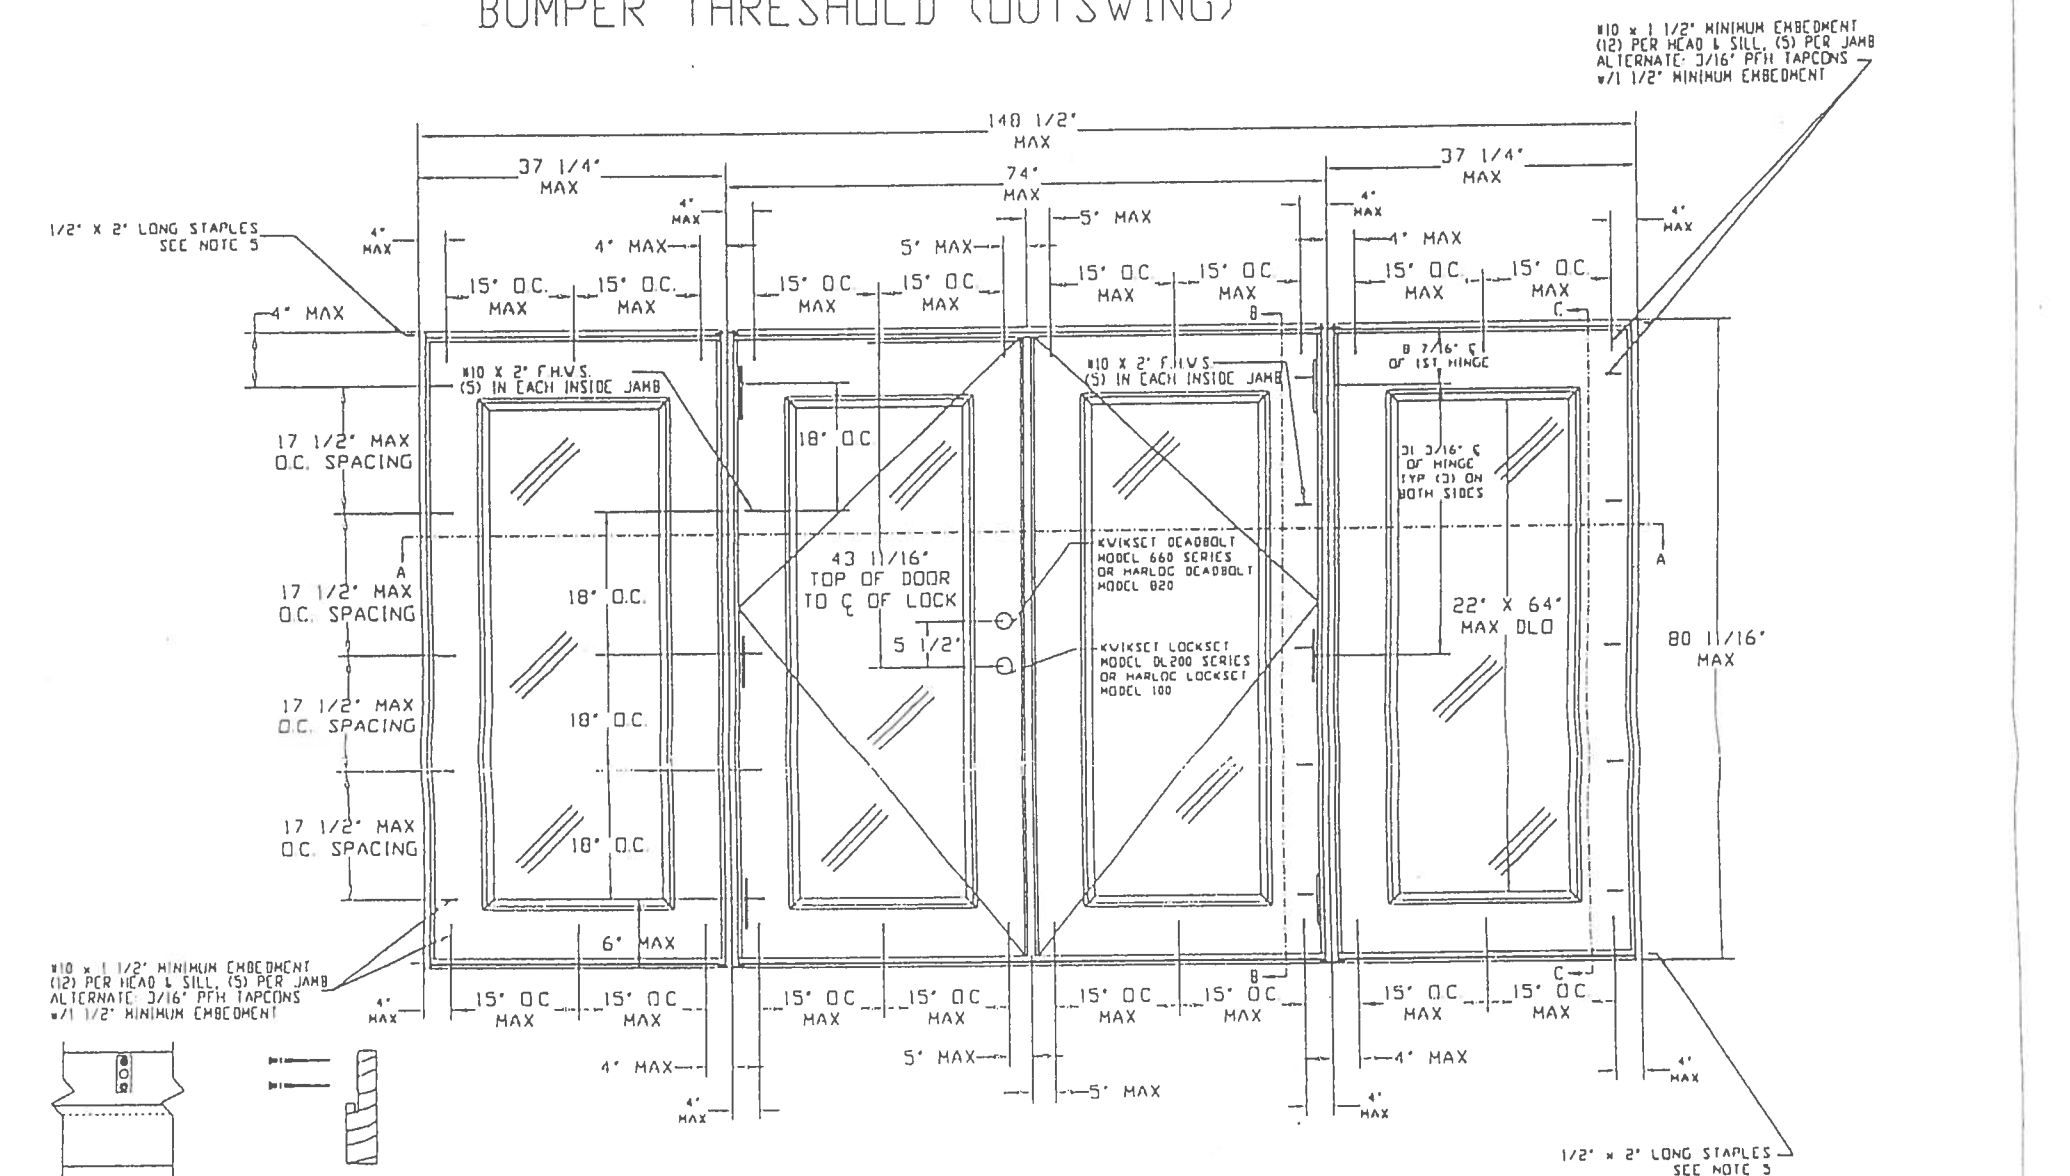


ATTACH ASTRAGAL THROW BOLT STRIKE PLATE TO THE HEADER AND THRESHOLD WITH #10 x 1 3/4" FLATHEAD SCREWS

NOTES:

- 1.) WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- 2.) THE PRECEDING DRAWINGS ARE INTENDED TO QUALIFY THE FOLLOWING INSTALLATIONS.
- A. WOOD FRAME CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY WOOD OPENING.
- B. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY STRUCTURAL WOOD BUCK.
- C. MASONRY OR CONCRETE CONSTRUCTION WHERE DOOR SYSTEM IS ANCHORED DIRECTLY TO CONCRETE OR MASONRY WITH OR WITHOUT A NON-STRUCTURAL ONE BY WOOD BUCK.
3. ALL ANCHORING SCREWS TO BE #10 WITH MINIMUM 1 1/2" EMBEDMENT INTO WOOD SUBSTRATE OR 3/16" PFH TAPCONS WITH 1 1/2" MINIMUM EMBEDMENT INTO MASONRY.
4. UNIT MUST BE INSTALLED WITH 'MIAMI-DADE COUNTY APPROVED' SHUTTERS
5. THREE STAPLES PER SIDE JAMB INTO HEADER ON SIDELITES AND DOOR, THREE STAPLES PER JAMB INTO THRESHOLD ON SIDELITES AND DOOR.
6. LATEX SEALANT TO BE APPLIED AT SIDE BY SIDE JAMBS AND SIDELITES.
7. DOOR/SIDELITE HEADER, DOOR/SIDELITE JAMBS, AND SIDELITE BASE CORNERS ARE COPED AND BUTT JOINED.
8. DOORS SHALL BE PRE-PAINTED WITH A WATER-BASED EPOXY RUST INHIBITIVE PRIMER PAINT WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.
9. FRAMES SHALL BE PRE-PAINTED WITH AN ACRYLIC LATEX WATER-BASED/ WATER-REDUCIBLE WHITE PRIMER WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.

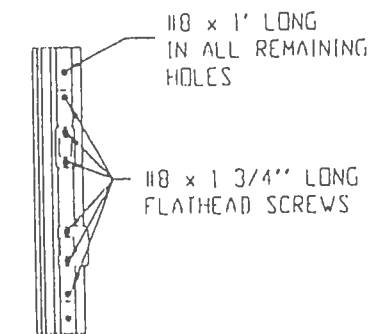

ASTRAGAL

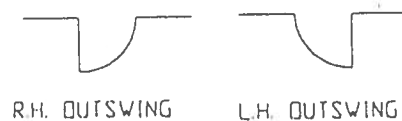


DESIGN PRESSURE RATINGS		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED *	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
Positive	+ 50.5 psf	+50.5 psf
Negative	NOT APPROVED*	-50.5 psf

* UNITS SHALL BE INSTALLED ONLY AT LOCATIONS PROTECTED BY A CANOPY OR OVERHANG SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO SILL IS LESS THAN 45 DEGREES. UNLESS UNIT IS INSTALLED IN NON-HABITABLE AREAS WHERE THE UNIT AND THE AREA ARE DESIGNED TO ACCEPT WATER INFILTRATION



APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2001
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO 01-0314.29

LIMITS UNLESS NOTED, FRAC : DEC. : ANG. :		DADE COUNTY MODIFICATIONS		1/11/00	JD
EXTRUSIONS: UNLESS NOTED, STD. COM. I.D.'S		B	ADDED PAGE 5 (DOOR OPTIONS)	10-1-98	RS
ENGINEER:		A	ADD OTHER DOOR CONFIGURATIONS	12/18/97	RS
DR. BY R.S.		LTR	REVISIONS	DATE	3Y
DATE 7-29-97		PART NAME: ENTERGY INVOCS CODED DOUBLE DOOR W/ SIDELITES		SCALE: N.T.S.	
PREMDOR ENTRY SYSTEMS		31-1028-EW-0		SHEET 1 OF 6	
911 E. JEFFERSON		REVISION LETTER		C	
PII153801, KS 66762					

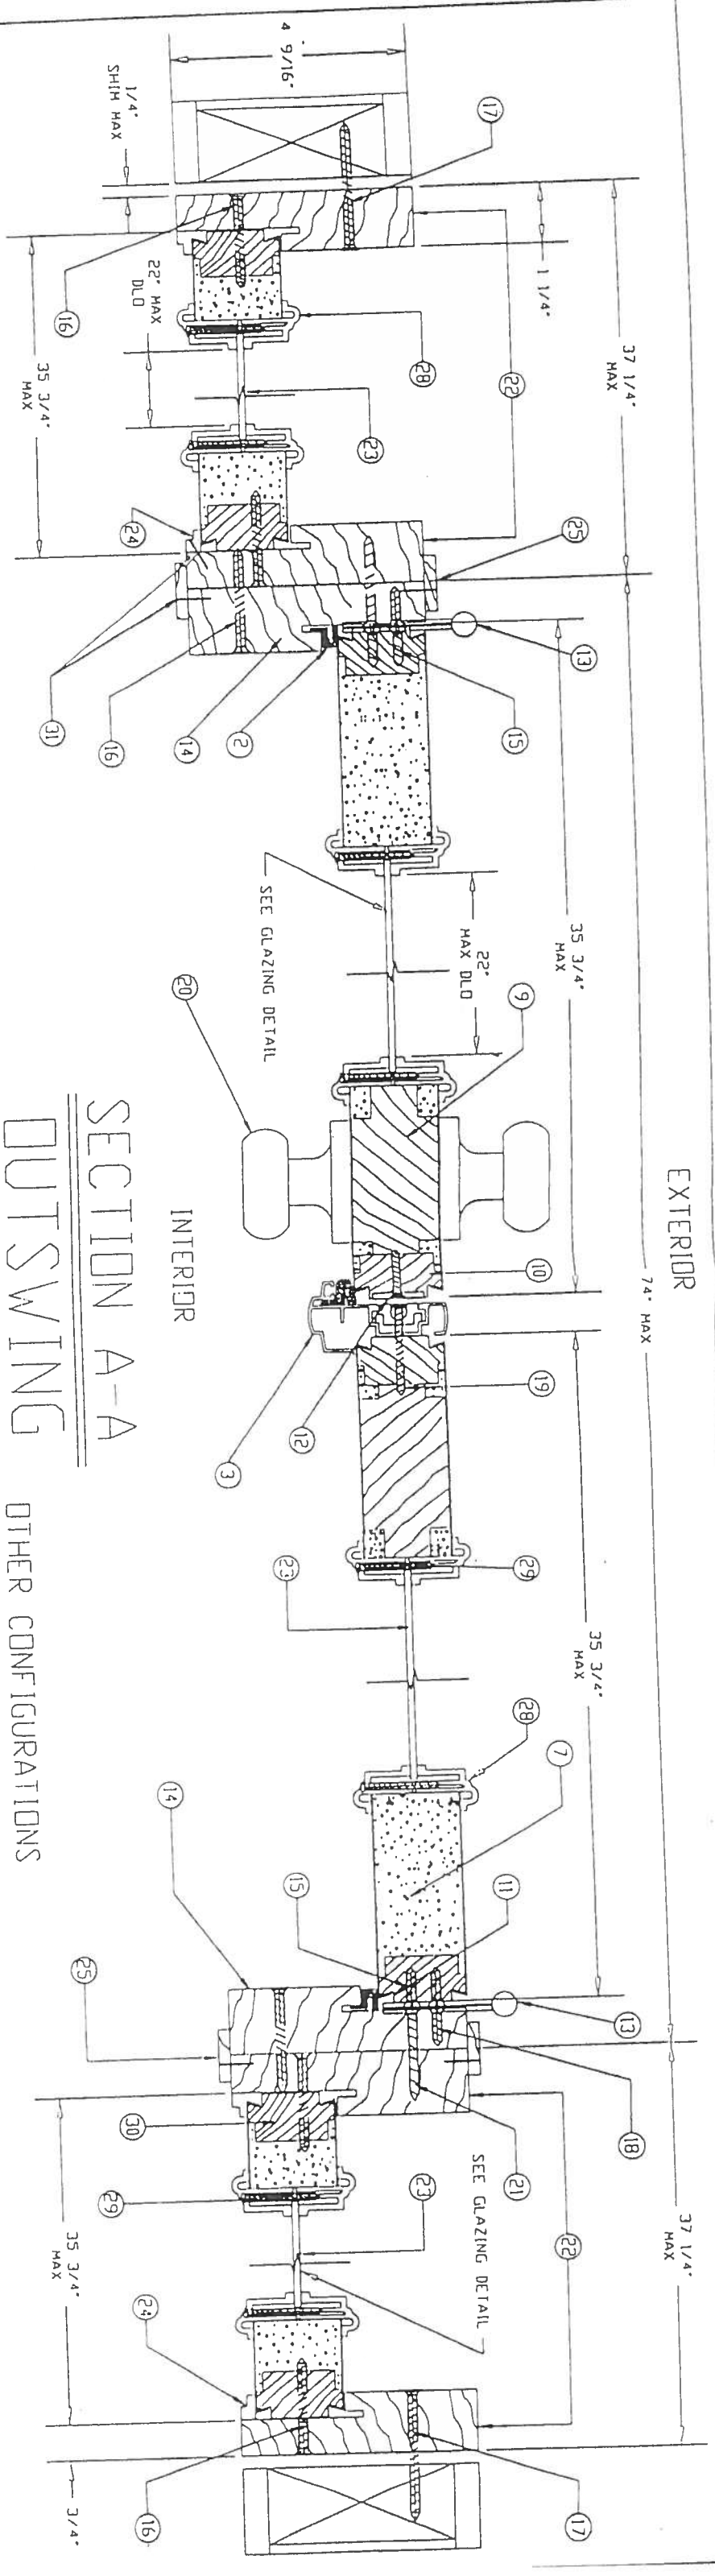


SECTION A-A
OUTSWING

OTHER CONFIGURATIONS

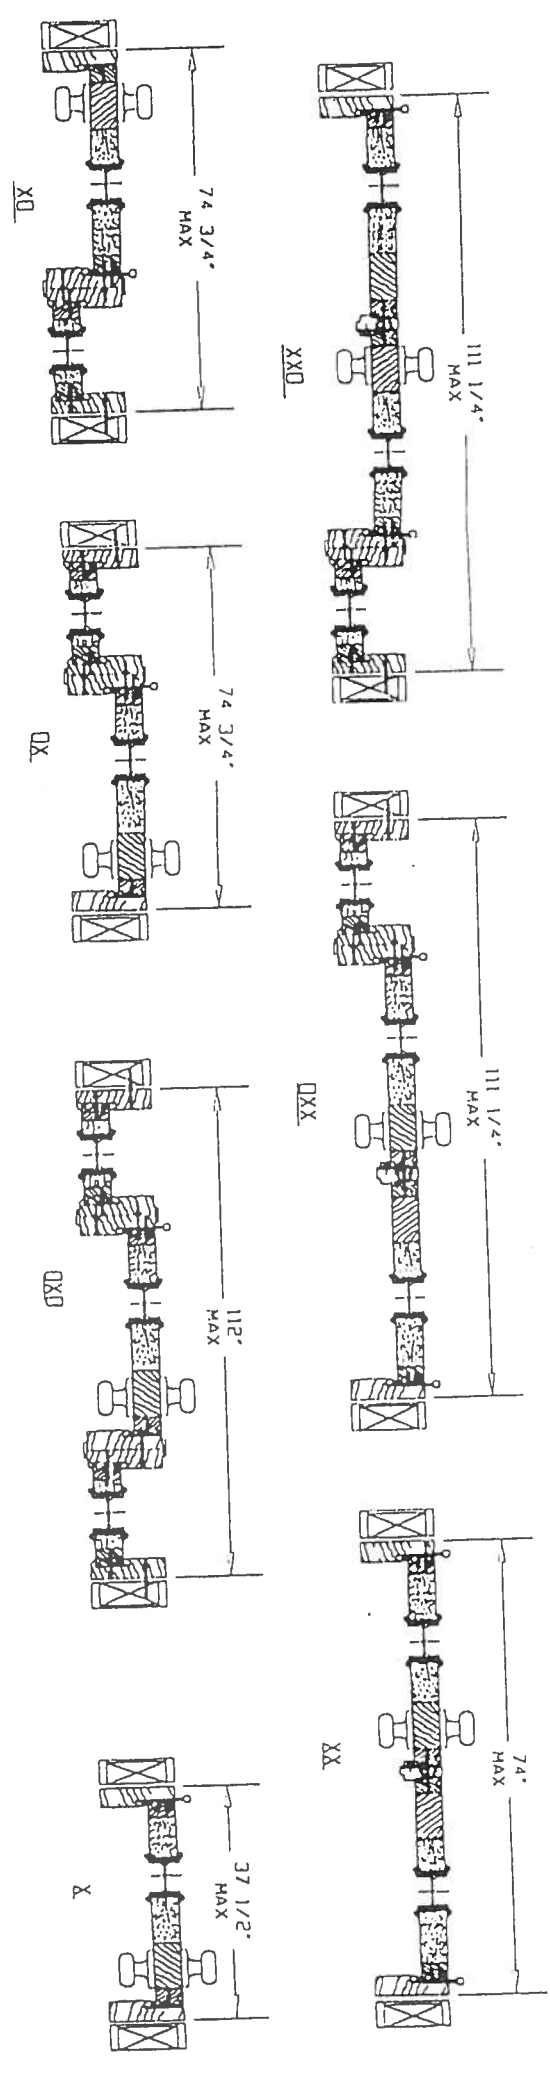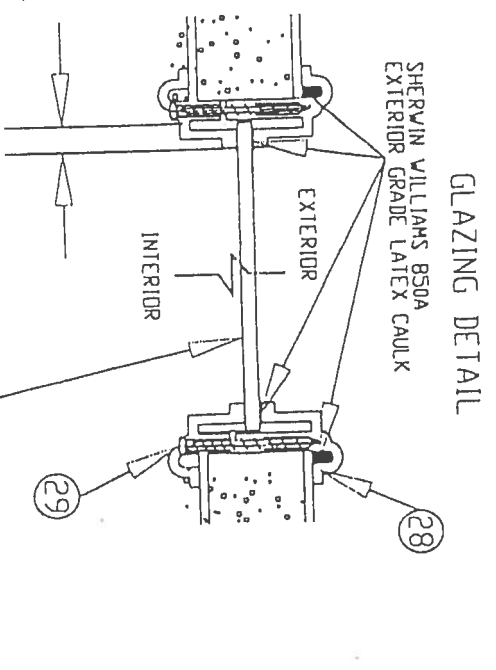

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2001
BY *Matthew K. King*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCESSION NO 01-0314-29

DATE COUNTY MODIFICATIONS		DATE	BY
ADDED PAGE 5 (DOOR OPTIONS)		10-1-98	RS
ADD SECTIONS TO LITE FRAMES &		2-18-97	RS
ADD OTHER DOOR CONFIGURATIONS		DATE	BY
PART NAME: CONTROL DOOR VARIOUS TYPES (A-E)		DATE	BY
PART NUMBER: 31-1028-EW-0		DATE	BY
SHEET 2 OF 6		DATE	BY
REVISION LETTER		DATE	BY

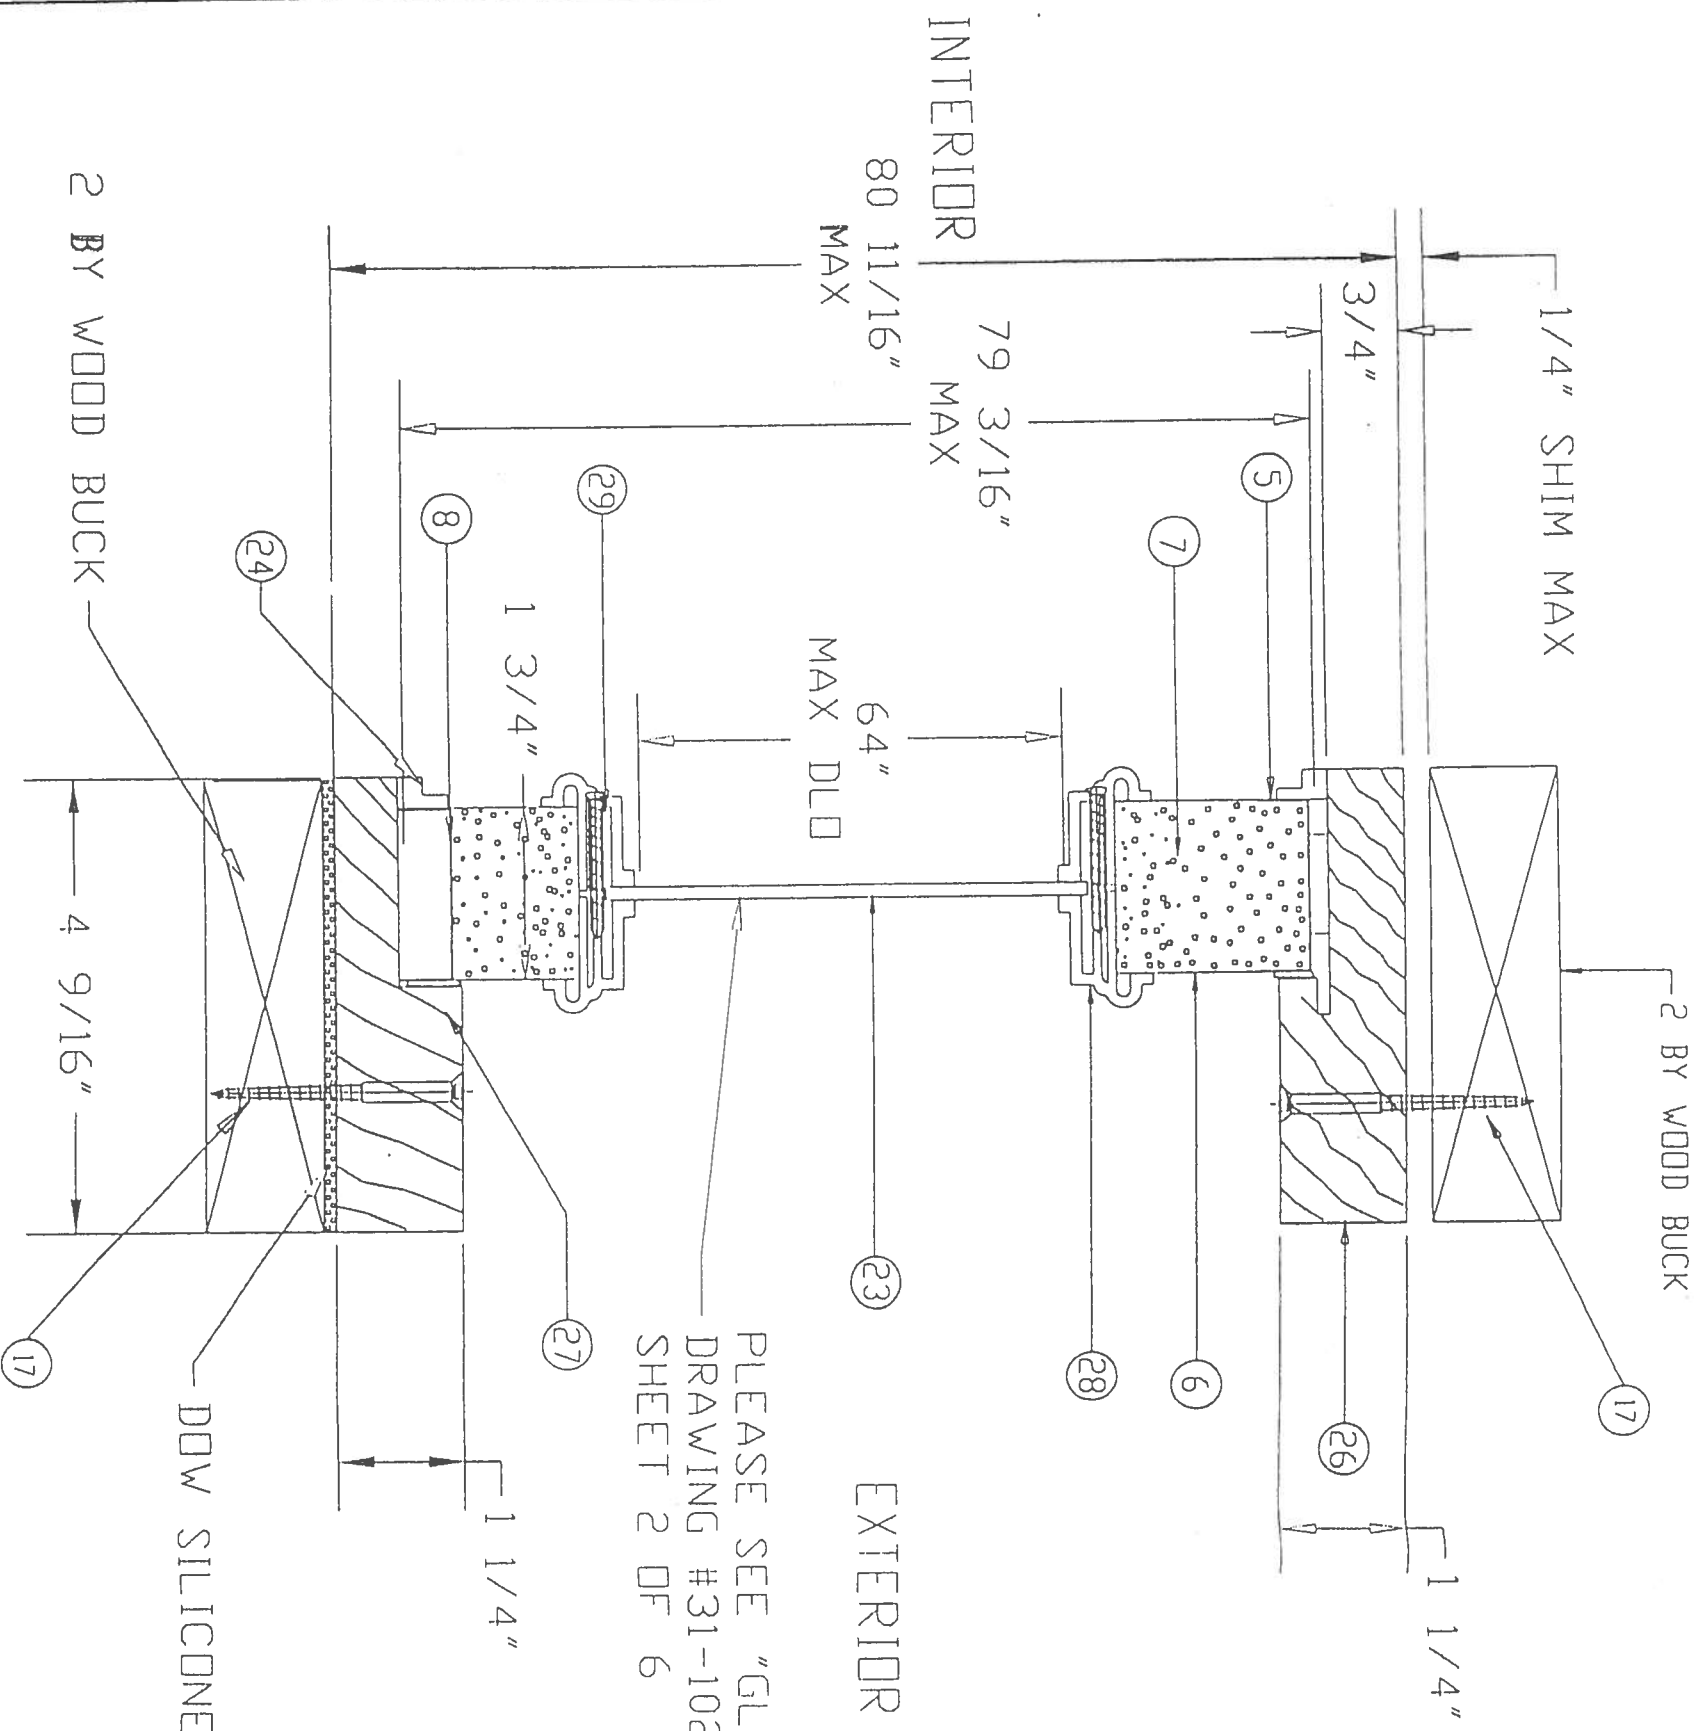

PLEASE SEE "GLAZING DETAIL"
DRAWING #31-1028-EW-D
SHEET 2 OF 6

SECTION C-C

APPROVED AS COMPLYING WITH THE
SCUTTH FLORIDA BUILDING CODE
DATE JUN 05 2009
BY M. M. M. M. M.
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0314-29

UNITS: UNLESS NOTED, FRAC. :	DEC. :	ANG. :
EXTRUSIONS: UNLESS NOTED, STD. COM'L. 100'S.		
ENGINEER:		
PART NAME: EMERGENCY WOOD EDGE SIDELITE CC-C		

DR. BY: R.S.	DATE: 7-29-97	
--------------	---------------	--

PREMDOR ENTRY SYSTEMS
911 E. JEFFERSON
PITTSBURG, KS. 66762

DADE COUNTY MODIFICATIONS	DATE	BY
C MATERIAL WAS PM LYSTYRENE	6-2-99	RS
B ADDED PAGE 5 (DOOR OPTIONS)	10-1-98	RS
A ADD SCREWS TO LITE FRAME & MATERIAL LIST	12-10-97	RS.
REV.:		


31-1028-EW-D
SHEET 4 OF 6

REVISION LETTER D

MATERIALS LIST

ITEM NO	DESCRIPTION	PART NUMBER	COMMENTS
1	WOOD HEAD JAMB	EW-14	1 1/4" X 4 9/16" MIL. TO BE PINE OR EQUIVALENT
2	COMPRESSION WEATHERSTRIP	EW-25	LOCKSCREEN BRAND LOCKSEAL 9650 (BRONZE)
3	ALUMINUM ASTRAGAL	EW-12	PREMDOR BRAND OR EQUIVALENT - 5/8" ALUMINUM ASTRAGAL
4	ALUMINUM-BUMPER THRESHOLD	EW-15	PREMDOR BRAND OR EQUIVALENT - 1 1/4" x 4 9/16"
5	TOP CHANNEL	EW-08	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
6	STEEL SKIN	26 ga. (017 +.004 - .000)	MIN. MIN.0 SURFACE 15.000 PSI MAX. IMPACTS PER 10000 FT2 SURF. AREA IS 127
7	POLYURETHANE FOAM CORE	BASF FOAM - DENSITY 2.0 TO 2.5 lbs./ft ³	
8	BOTTOM CHANNEL	EW-07	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
9	WOOD LOCK BLOCK	EW-09	4" X 9 1/2" MIL. TO BE PINE OR EQUIVALENT
10	STRIKE STILE	EW-06	15/16" X 1 11/16" MIL. TO BE PINE OR EQUIVALENT
11	HINGE STILE	EW-05	15/16" X 1 11/16" MIL. TO BE PINE OR EQUIVALENT
12	LOCK PREP FILLER PLATE	EW-10	PREMDOR BRAND - .050" THICK - MIL. TO BE POLYETHYLENE
13	4"x4" HINGE	EW-16	HAGER BRAND HINGE OR EQUIVALENT - .097 THICK (STEEL)
14	WOOD HINGE JAMB	EW-13	1 1/4" X 4 9/16" MIL. TO BE PINE OR EQUIVALENT
15	#10 X 3/4" F.H.W.S.		(4) SCREWS PER HINGE INTO DOOR
16	#10 X 2" F.H.W.S.		(5) SCREWS THROUGH HINGE JAMB INTO SIDELITE JAMB, 8" DOWN FROM TOP (5) SCREWS THROUGH HINGE JAMB INTO SIDELITE JAMB, 4" DOWN FROM TOP (10) SCREWS THROUGH STRIKE JAMB INTO SIDELITE JAMB, 4" DOWN FROM TOP (6) SCREWS THROUGH EACH SIDELITE JAMB INTO SIDELITE, 4" DOWN FROM TOP, MAX 15" OC. THEREAFTER
17	#10 F.H.W.S. V/MINIMUM 1 1/2" EMBEDED IN 3/16" PTH. TAPED IN V/MINIMUM 1 1/2" EMBEDED IN		REFER TO ELEVATION VIEW, FOR # OF SCREWS USED AND LOCATIONS
18	#10 X 3/4" F.H.W.S.		(2) SCREWS PER HINGE INTO JAMB
19	#8 X 2" F.H.W.S.		(2) SCREWS AT EACH STRIKE PLATE
20	LOCKSET		KWIKSET BRAND 200 LOCK OR HARLOC BRAND 100 LOCK
21	#10 X 1 3/4" F.H.W.S.		(2) SCREWS PER HINGE INTO JAMB
22	WOOD SIDELITE JAMB	EW-19	1 1/4" X 4 9/16" MIL. TO BE PINE OR EQUIVALENT
23	22" X 64" SINGLE PANEL GLASS	EW-20	TEMPERED GLASS IN POLYPROPYLENE FRAME - DC-1643 - (DDL-2 1/8" CLEAR TEMPERED GLASS
24	SIDELITE TRIM (WOOD)	EW-21	5/16" X 1 1/2" MIL. TO BE PINE OR EQUIVALENT
25	WOOD CASING	EW-22	1/8" X 1" MIL. TO BE PINE OR EQUIVALENT - ITEMS ARE HOLDINGS USE FOR SIDE BY SIDE JAMBS AS HOLDINGS
26	WOOD SIDELITE HEAD JAMB	EW-23	1 1/4" X 4 9/16" MIL. TO BE PINE OR EQUIVALENT
27	WOOD SIDELITE BASE	EW-24	1 1/4" X 4 9/16" MIL. TO BE PINE OR EQUIVALENT
28	POLYPROPYLENE LITE FRAME	DC-1643, DDL-2	HP Polypropylene by DDL
29	#6 X 1 1/2" PAN HEAD SCREWS		18 PER FRAME TO EXCEED 14" OC THERE AFTER.
30	SIDELITE STILES	EW-26	15/16" X 1 11/16" MIL. TO BE PINE OR EQUIVALENT
31	PIN NAIL		3/4" LONG NAIL, 4" IN FROM END, MAX 8" OC. THEREAFTER, USED ON HOLDINGS AND RAIL

DOW SILICONE #995




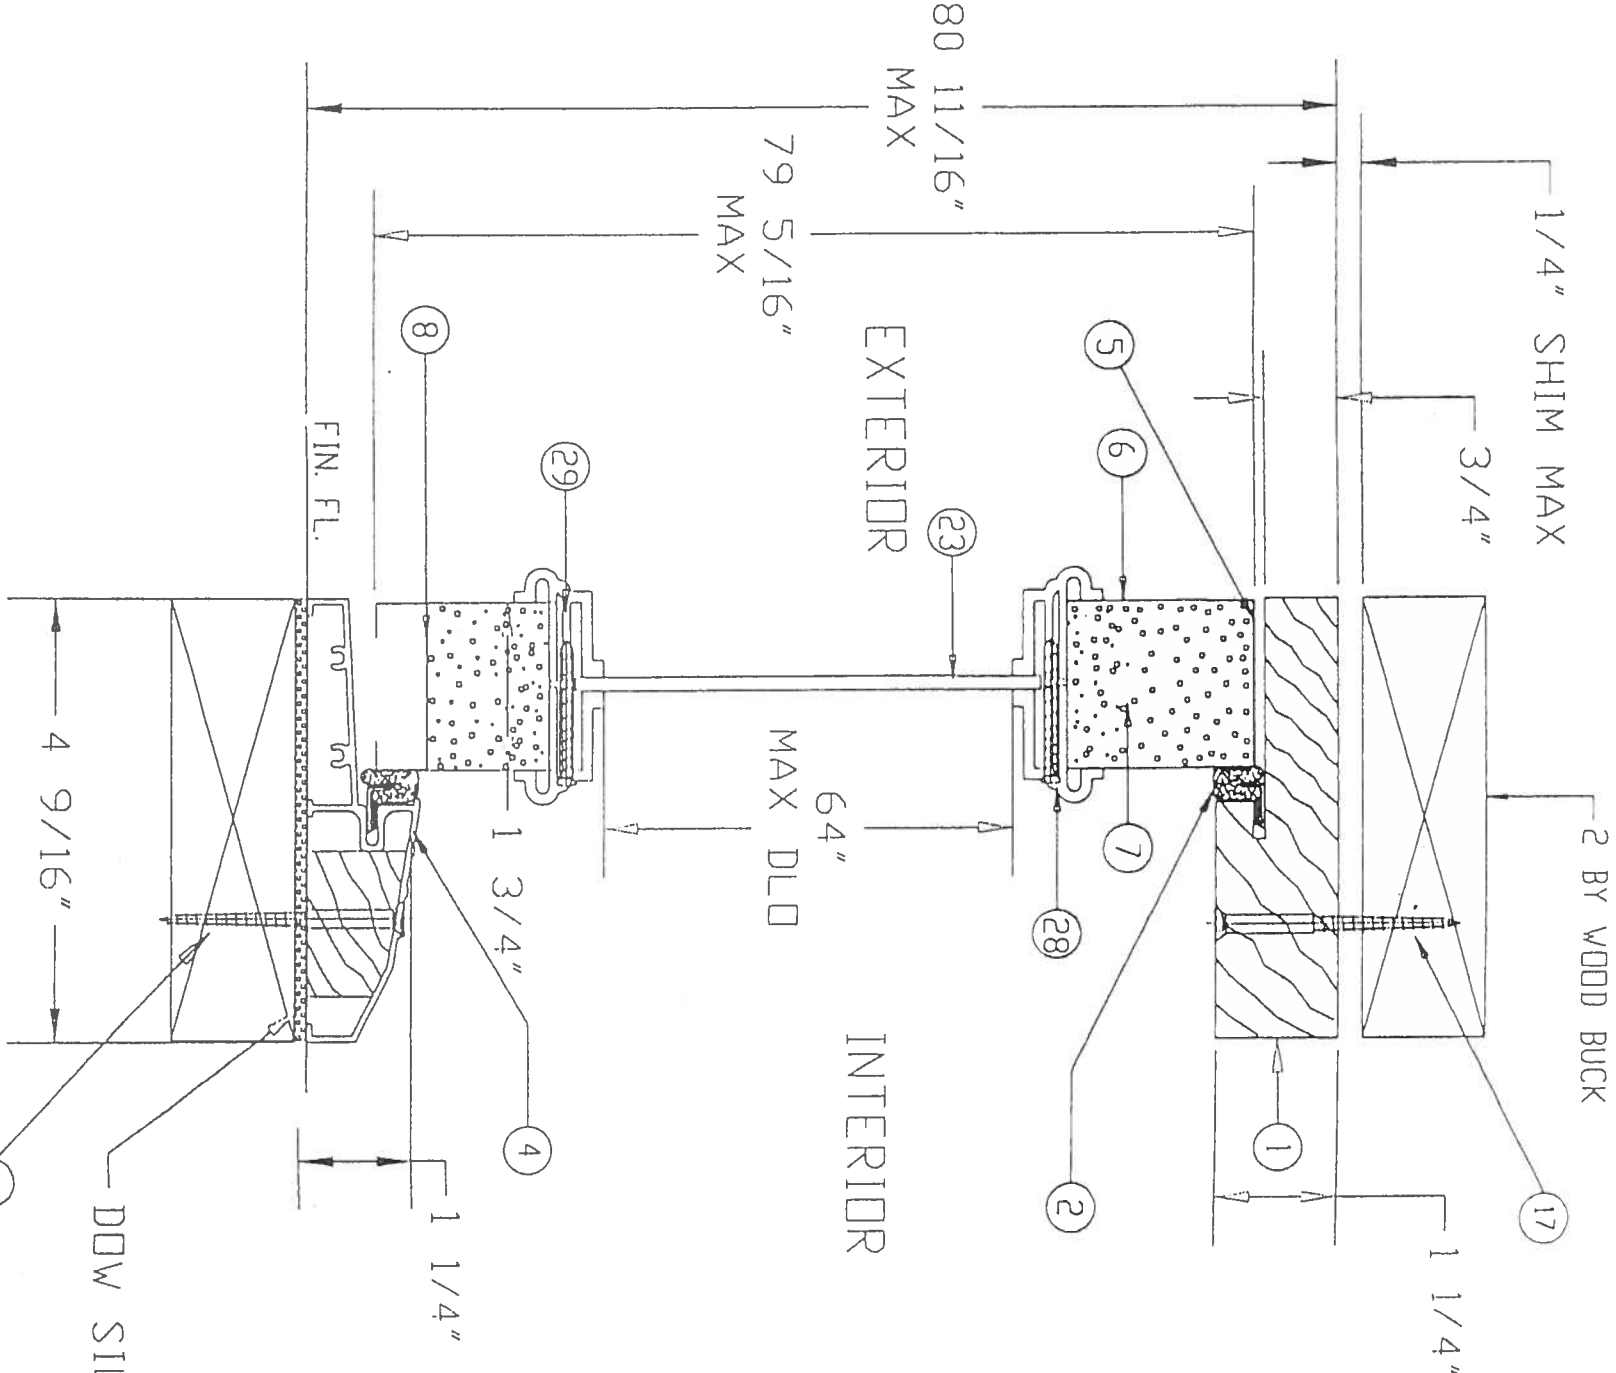


SECTION B-B

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2005
BY *Matthew K. Jones*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO 01-03147.24

LIMITS: UNLESS NOTED, FRAC. :	DEC. :	ANG. :	B :	DATE COUNTY MODIFICATIONS	1/11/01	JUD
EXTRUSIONS: UNLESS NOTED, STD. COMPL. TOL'S.			A :	ADDED PAGE 5 (DOOR OPTIONS)	10-1-98	RS
ENGINEER:			11R :	REVISIONS	DATE	BY
DR. BY R.S.	DATE 7-29-97		MA11 :	PART NAME: ENTRY WOOD EDGE DOOR (B-B2)	SCALE:	
PREMDOR ENTRY SYSTEMS				31-1028-EW-0		
911 E. JEFFERSON PITTSBURG, KS. 66762				SHEET 3 OF 6		
				REVISION LETTER B		

OTHER DOOR CONFIGURATIONS

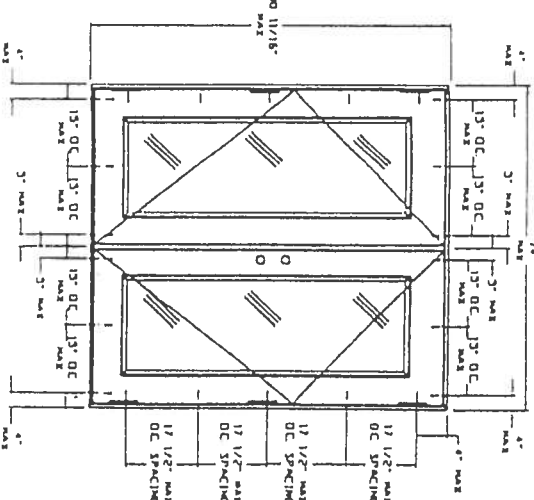
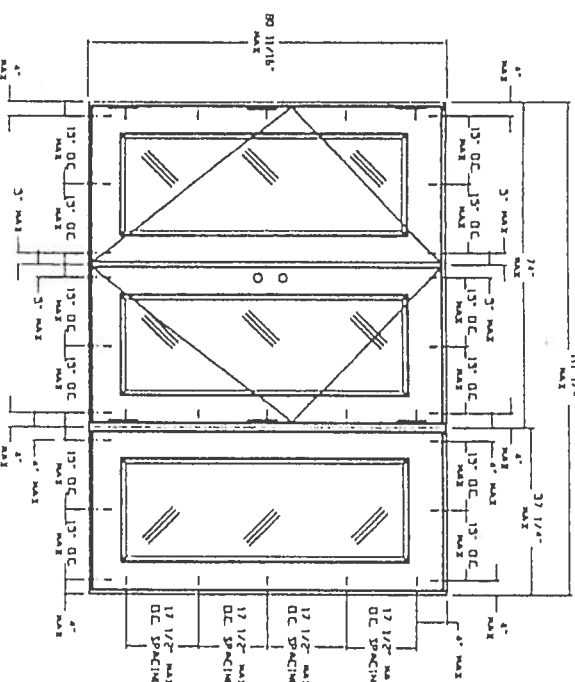
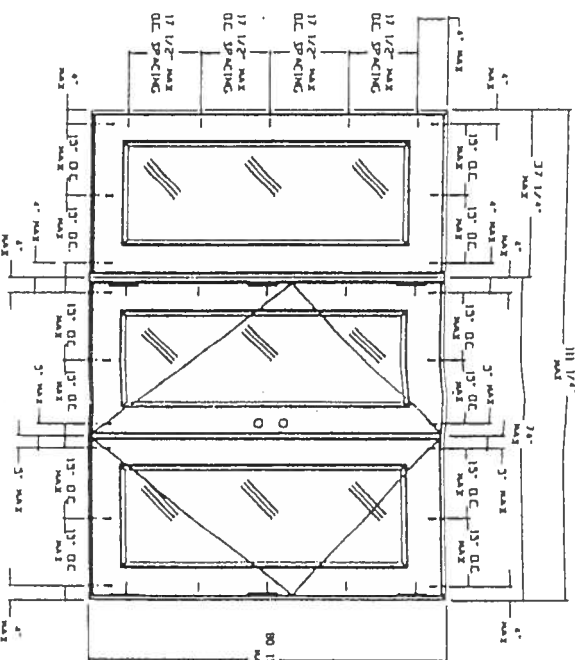
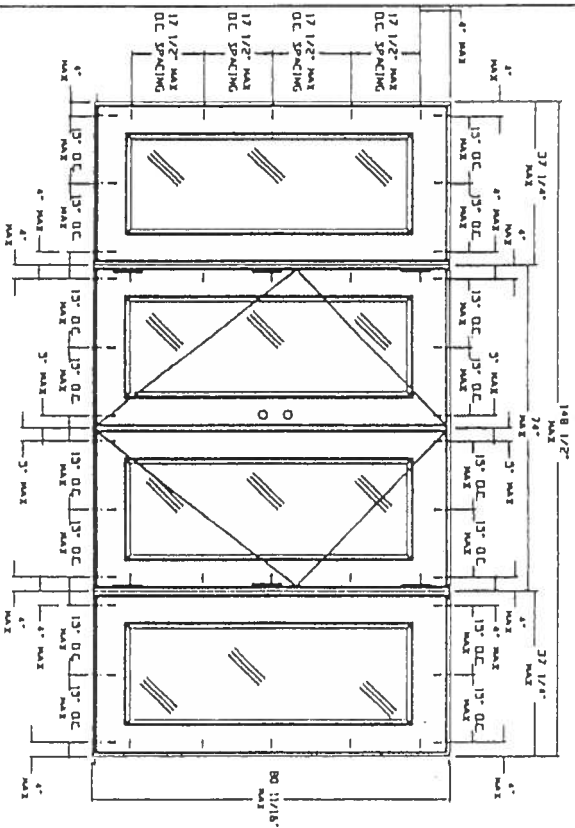


XXXX

XXX

XXD

XX

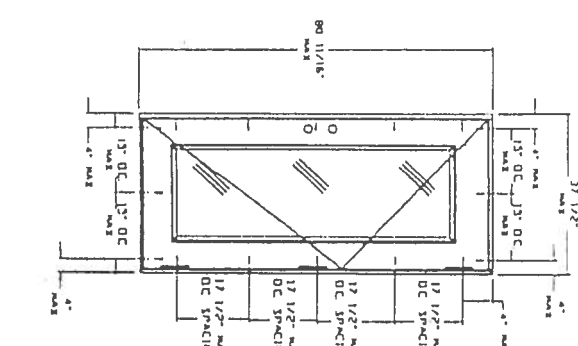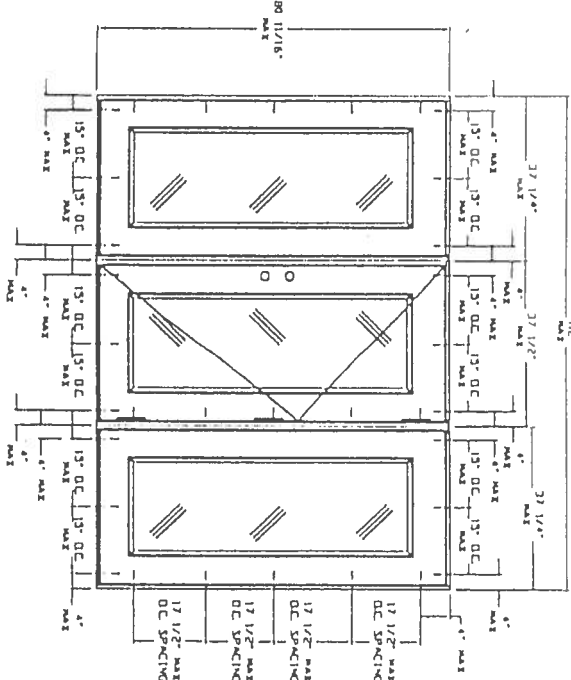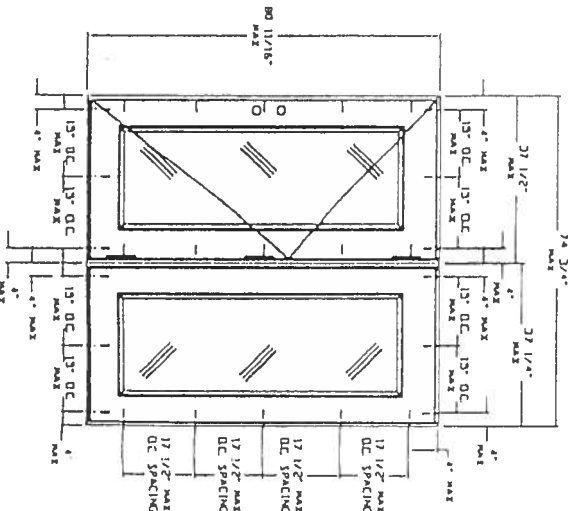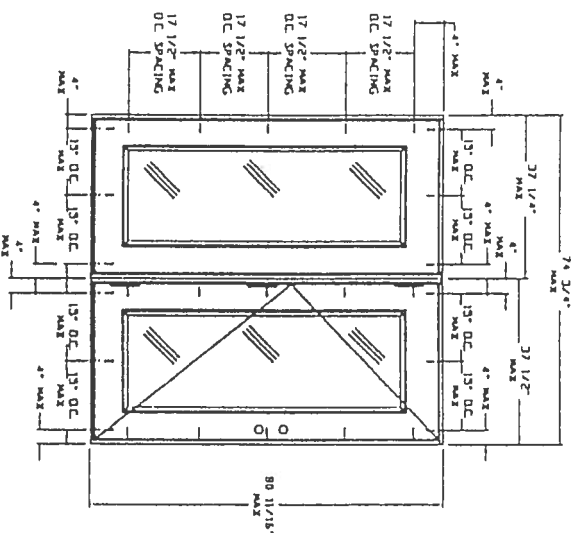

DX

XD

DXD

X

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2004
BY *Michael J. ...*
PROJECT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO 01-0314-29

LIMITS: UNLESS NOTED, FRAC. :		DEC. :		ANG. :					
EXTENSIONS: UNLESS NOTED, STD. CORN. 100.5.									
ENGINEER:									
								</	

