



ROOF SHEATHING FASTENINGS		
NAILING ZONE	FASTENER	SPACING
1	16" x 95D	6" @ GC EDGE 12" @ GC FIELD
2	16" x 95D OR 16" x 100D ADVANCED STY-NAILS	6" @ GC EDGE 12" @ GC FIELD
3	16" x 95D OR 16" x 100D ADVANCED STY-NAILS	6" @ GC EDGE 12" @ GC FIELD

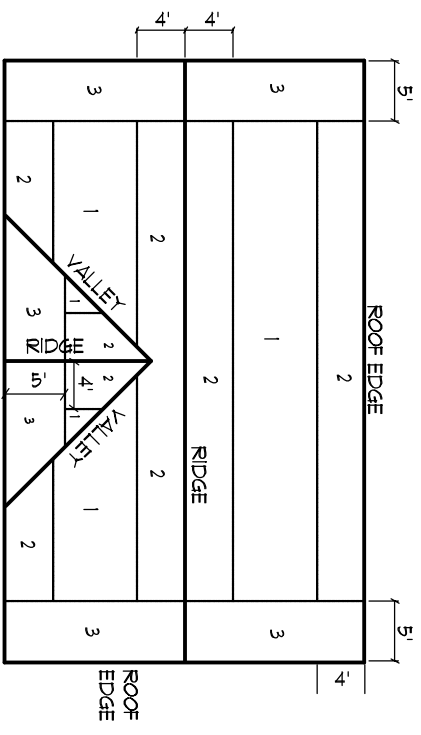

ROOF SHEATHING NAILING ZONES
(GABLE ROOF)

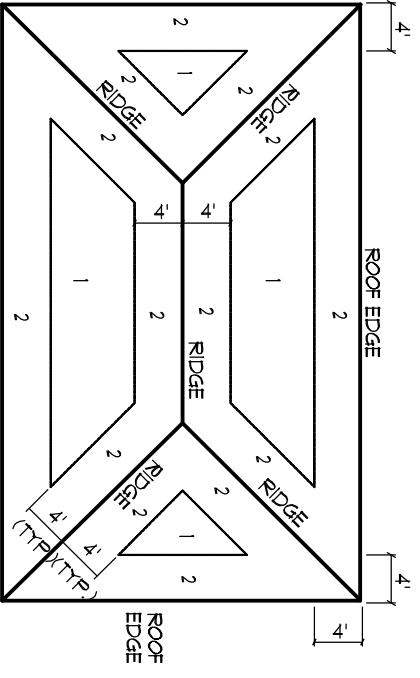


ROOF SHEATHING NAILING ZONES
(HIP ROOF)


Roof Nail Pattern Det. A

SCALE: NONE


HEADER SPANS FOR EXTERIOR BEARING WALLS				
HEADERS SUPPORTING	HEADER SIZE	BUILDING WIDTH (FT)		
		20'	28'	36'
ROOF CEILING	2-2x4	SPAN * JACKS	SPAN * JACKS	SPAN * JACKS
	2-2x6	5'-5"	4'-8"	4'-2"
	2-2x8	6'-10"	5'-11"	5'-4"
	2-2x10	8'-5"	7'-3"	6'-6"
	2-2x12	9'-9"	8'-5"	7'-6"
	3-2x10	10'-6"	9'-11"	8'-8"
	3-2x12	12'-2"	10'-7"	9'-5"
	4-2x10	9'-2"	8'-4"	7'-2"
	4-2x12	11'-8"	10'-6"	9'-5"
	4-2x12	14'-11"	12'-2"	10'-11"

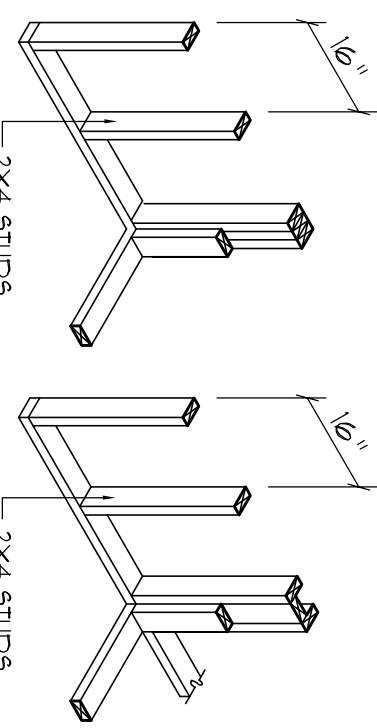


WALL CORNER WALL INTERSECTION

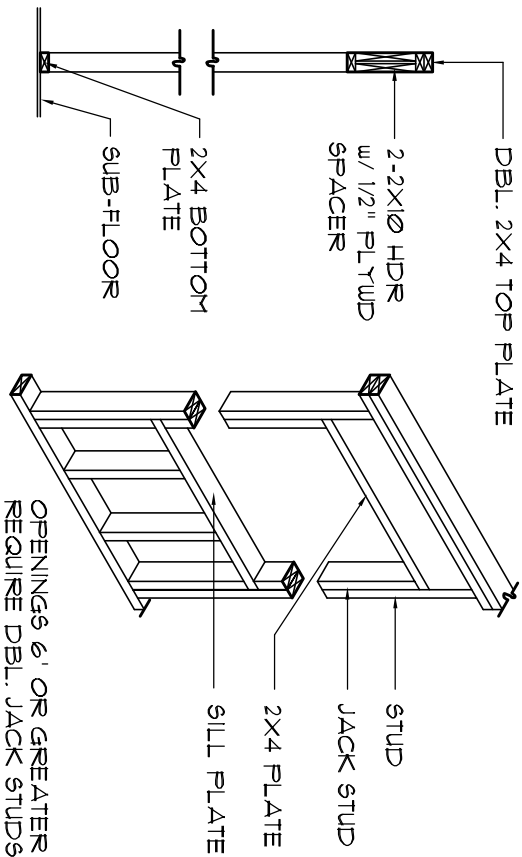

TYPICAL WINDOW HEADER

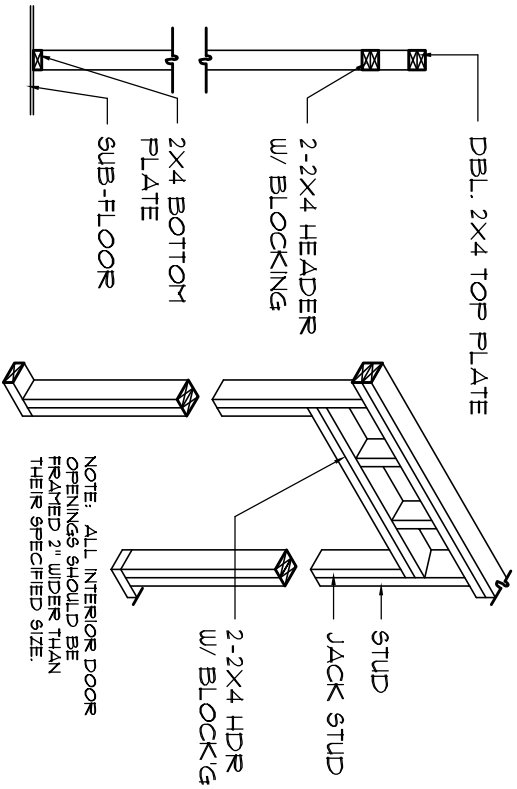


NON-BEARING WALL HEADER

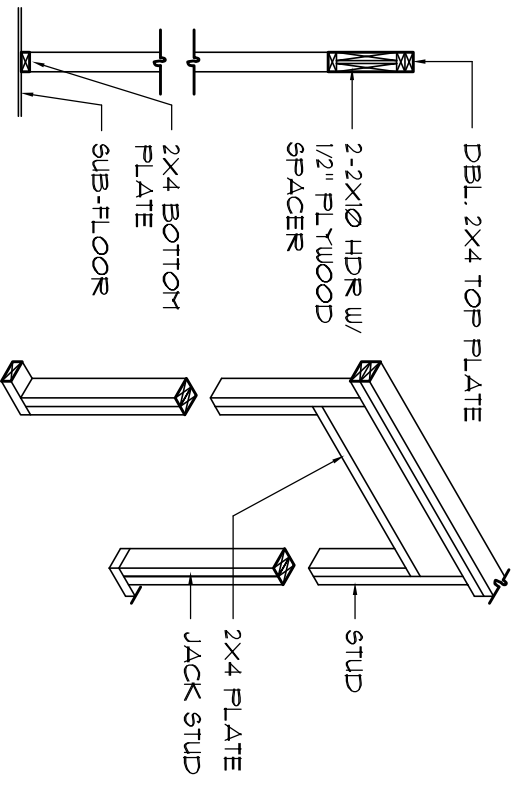

BEARING WALL HEADER


Wall Framing/ Header Det's B

SCALE: NONE

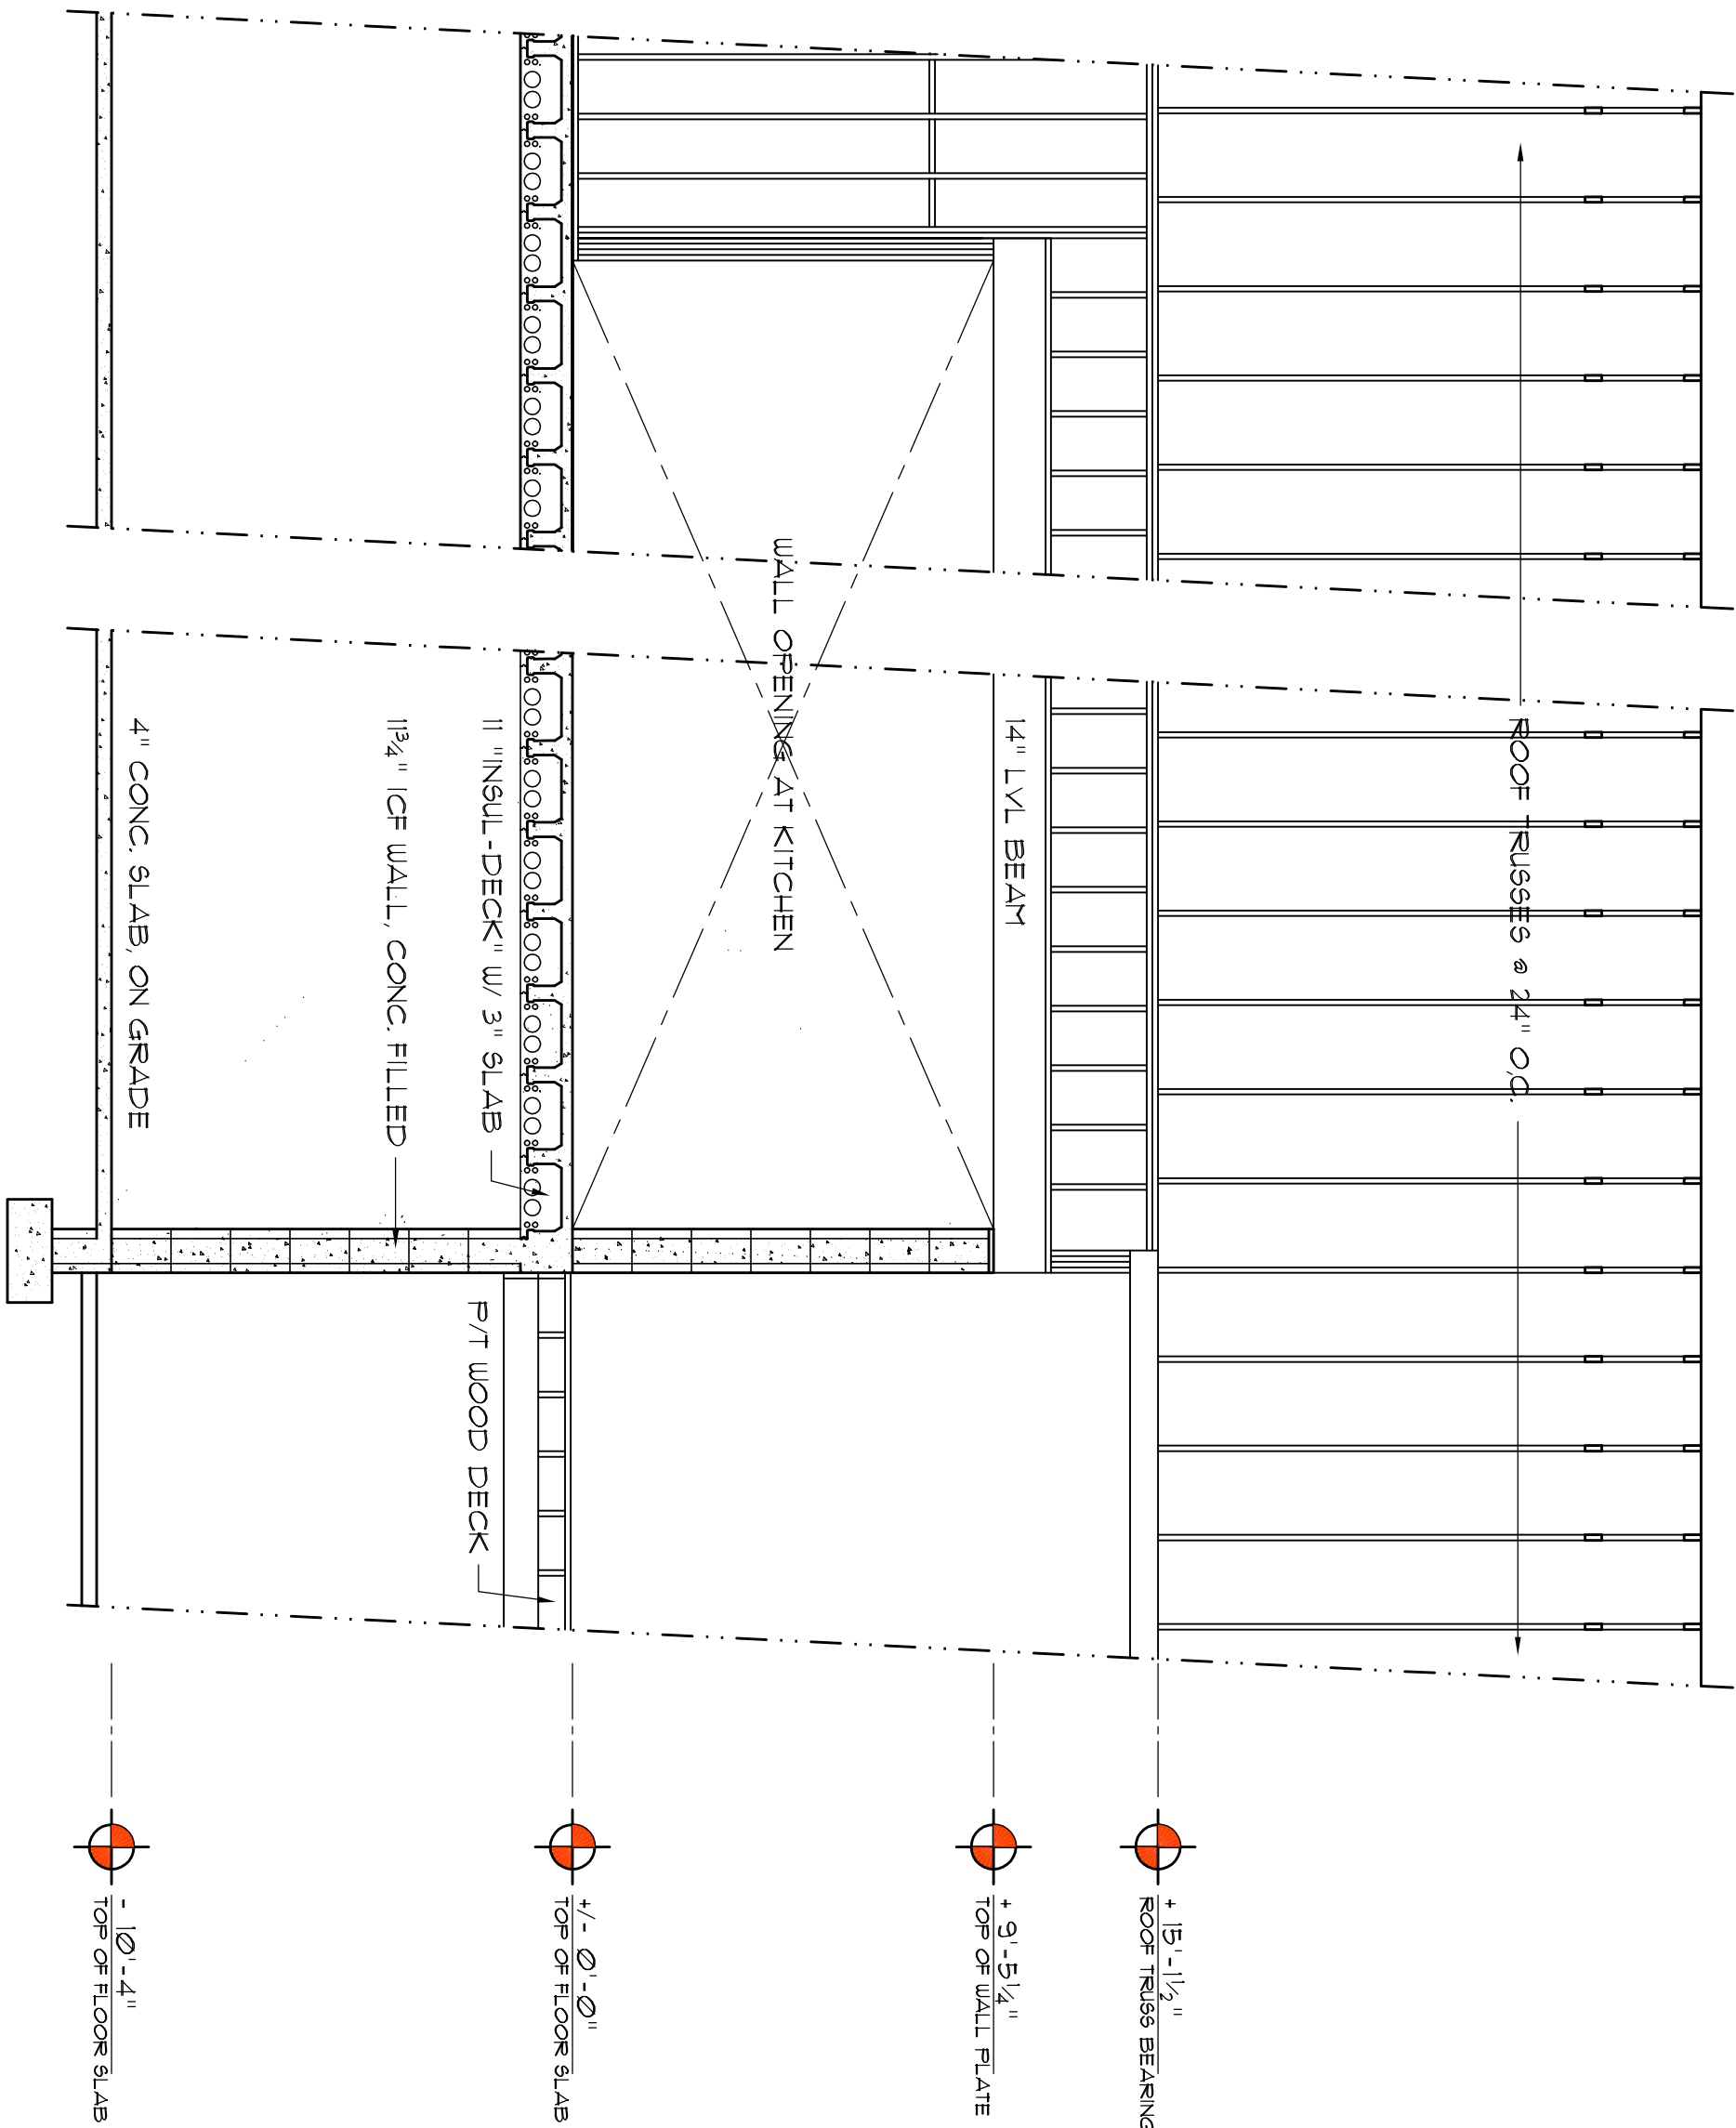


PARTIAL WALL ELEVATION

SCALE: 1/4" = 1'-0"

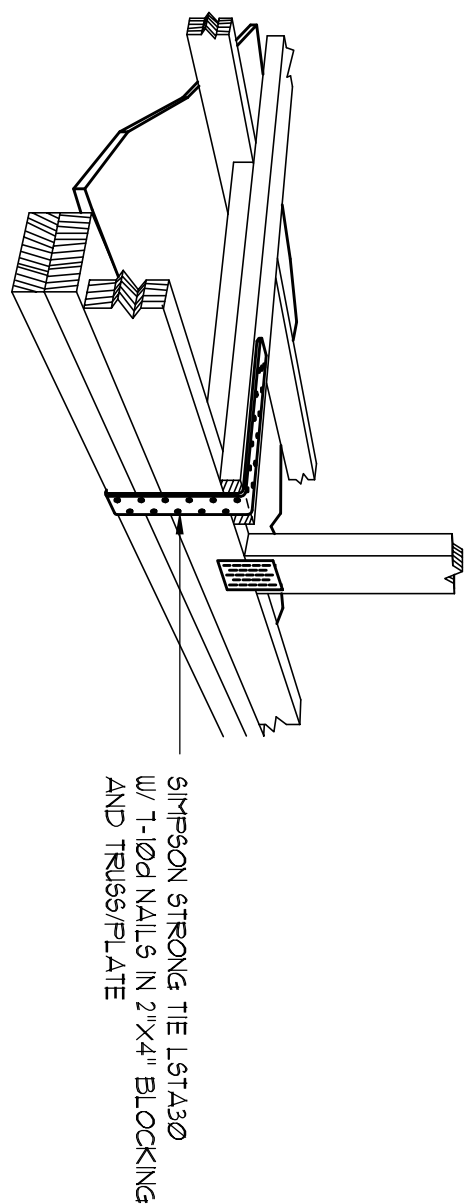

GABLE END GYPSUM DIAPHRAGM
HOLDOWN CONNECTOR

SCALE: NONE

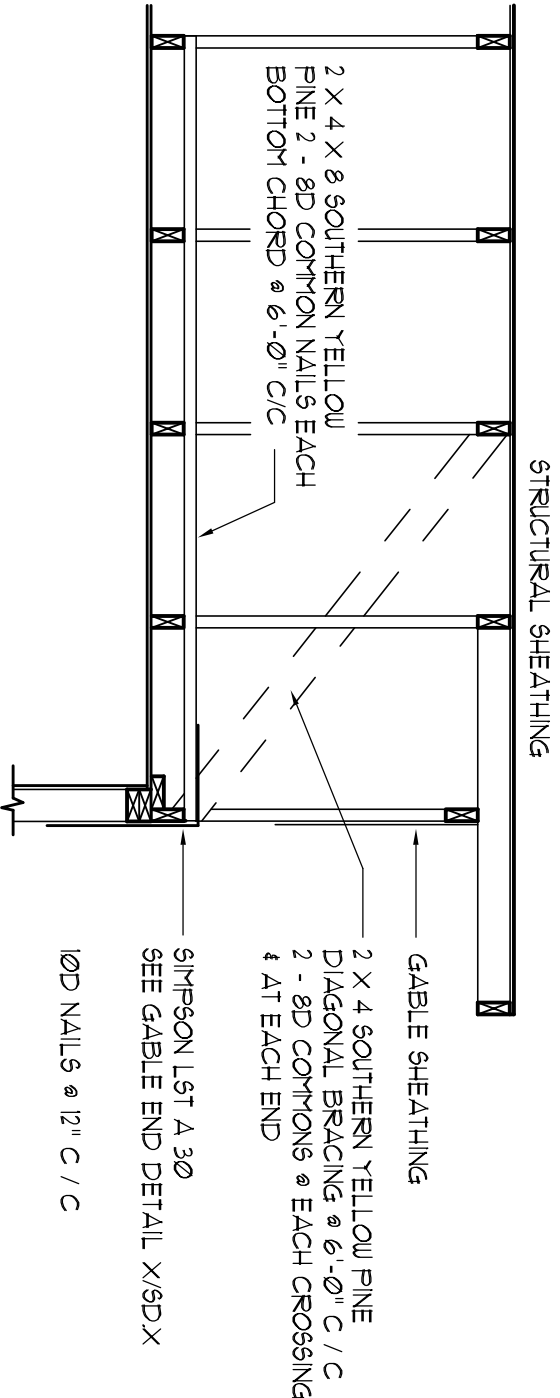


END WALL BRACING FOR
CEILING DIAPHRAGM

NT5

(ALTERNATIVE TO BALLOON FRAMING)
NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

C.2

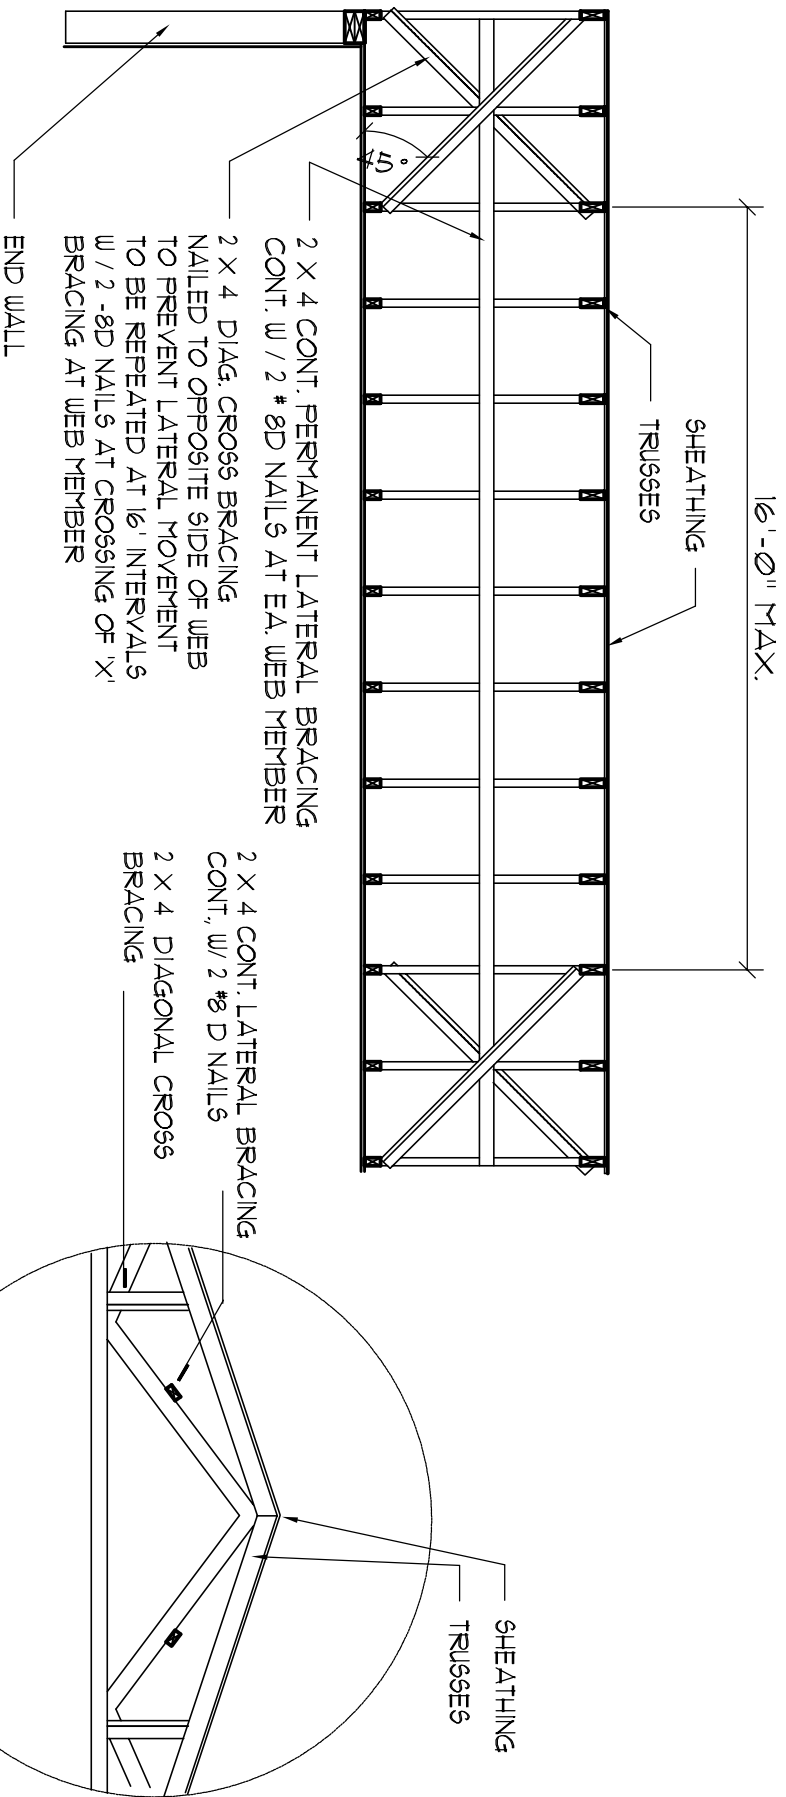

TYP. PERMANENT TRUSS BRACING DIA.

NT5

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

Truss Bracing Details D

SCALE: AS NOTED