




REAR ELEVATION

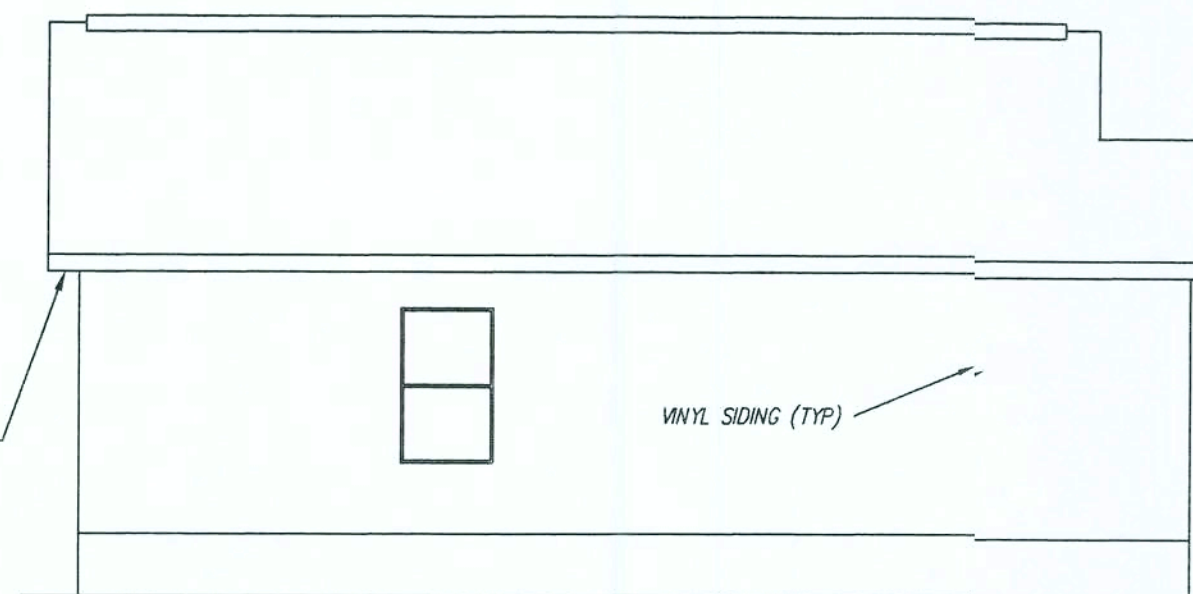

LEFT ELEVATION

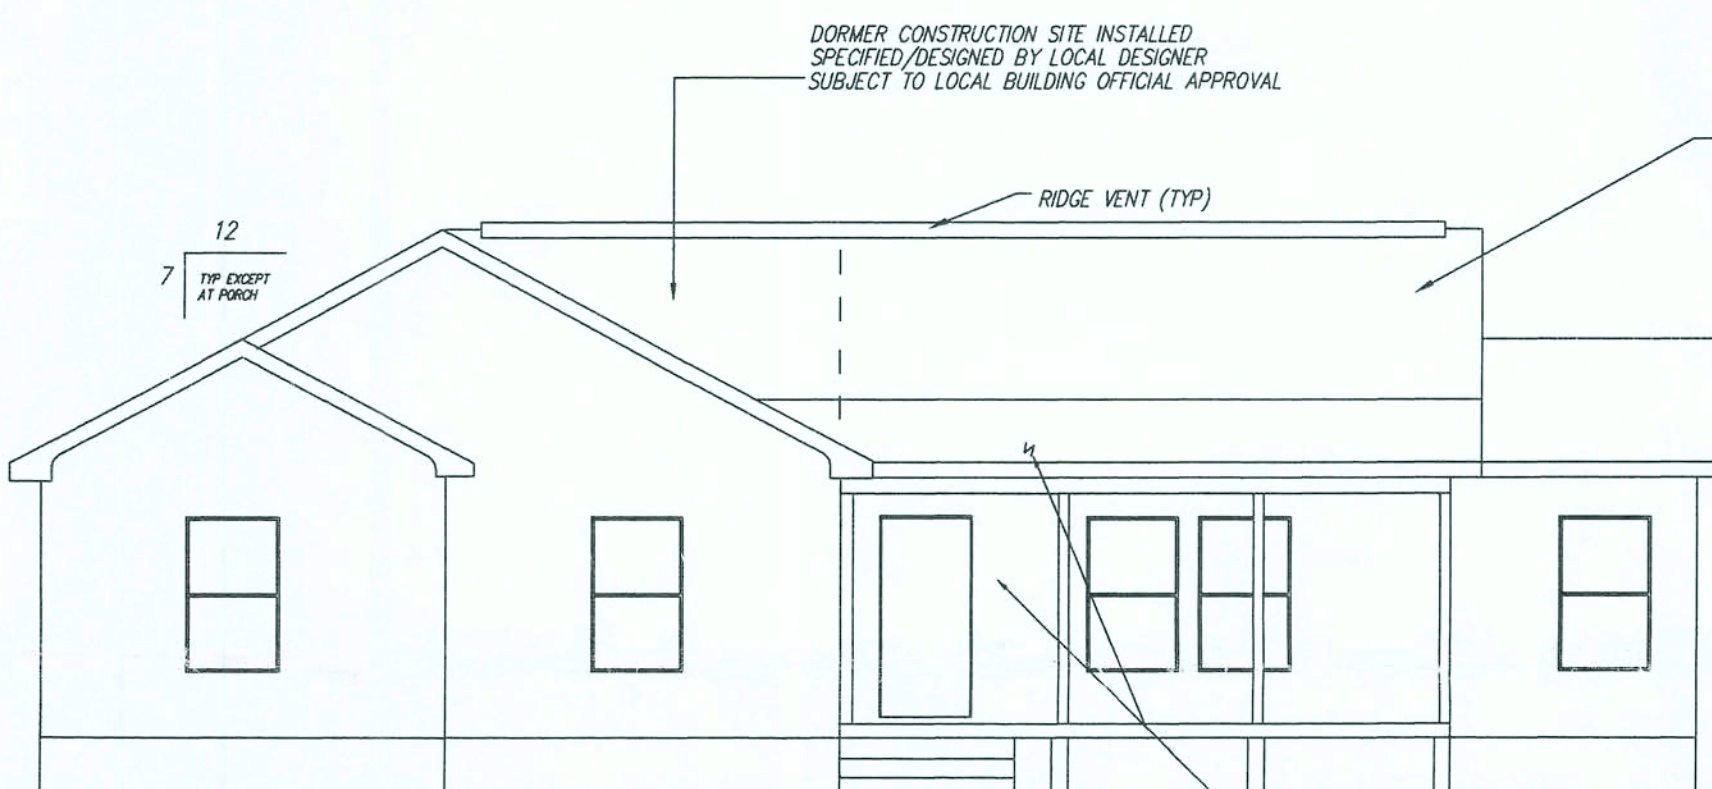

FRONT ELEVATION

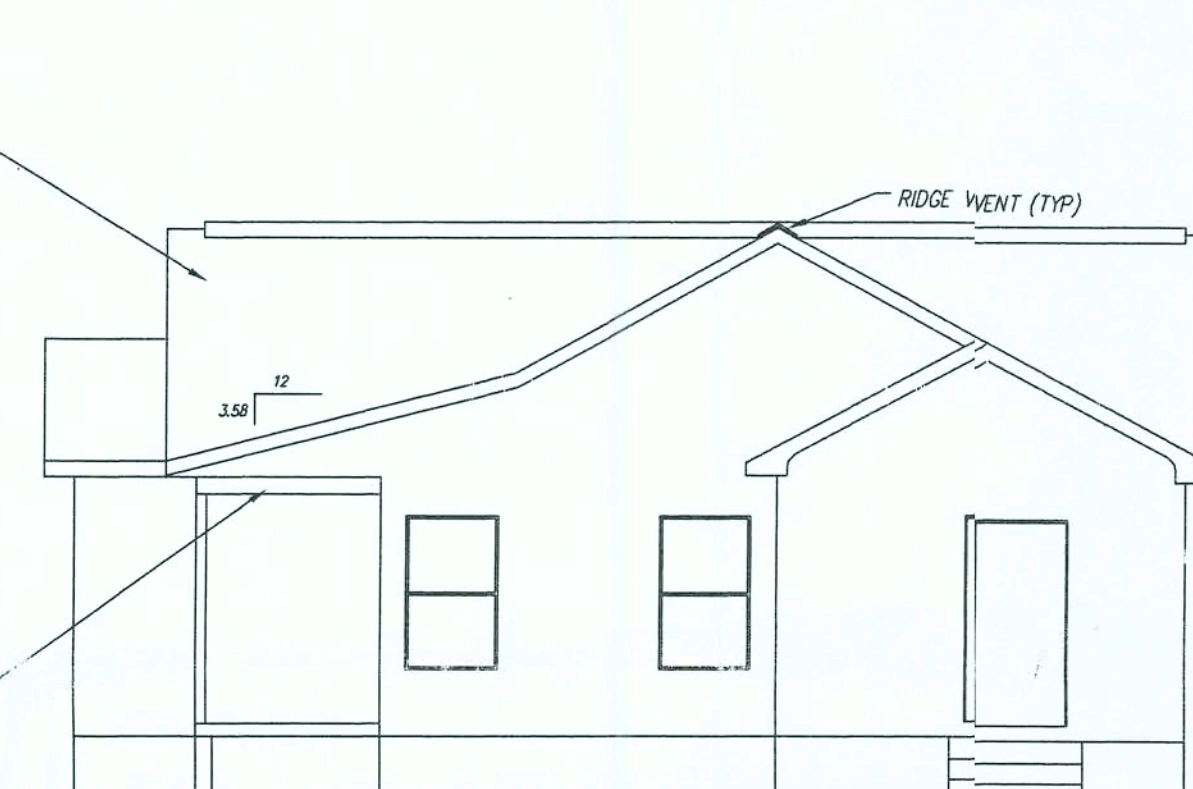

OPTIONAL PORCH CONSTRUCTION SHOWN IN ELEVATIONS:

THE STANDARD 7/12 TRUSSES ARE PROVIDED WITHOUT PORCH OPTION; OPTIONAL PORCH CONSTRUCTION AVAILABLE WITH UNIVERSAL PORCH TRUSS #H430802 INSTALLED 16" O.C. IN INTERIOR ZONE AND DOUBLE TRUSSES 16" O.C. IN BD ZONE IN THE MODULE THE OPTIONAL PORCH IS SHOWN ON THE FLOOR PLAN

ONLY THE PORCH ROOF IS PROVIDED WITH THIS TRUSS INSTALLED BY PRECISION HOMES IN THE MODULAR BUILDING FACTORY - ALL OTHER PORTIONS OF THE PORCH TO BE SITE-BUILT, DESIGNED AND/OR SPECIFIED BY OTHER DESIGNER OR CONTRACTOR, SUBJECT TO THE LOCAL BUILDING OFFICIAL REVIEW AND APPROVAL (PRECISION HOMES TO PROVIDE TRUSS DESIGN DRAWING TO HOME OWNER TO PERMIT PROPER DESIGN OF PORCH)

PORTIONS OF PORCH CONSTRUCTION TO BE SITE-BUILT INCLUDE, BUT ARE NOT LIMITED TO, THE DRCH HEADERS, PORCH POSTS, PORCH FLOOR, PORCH FOUNDATION AND ALL FASTENINGS AND/OR INTERCONNECTIONS BETWEEN THE PORCH COMPONENTS AND THE TRUSSES ABOVE AND THE MODULAR BUILDING COMPONENTS

BUILDING SITE INSTALLATION REQUIREMENTS
ATTENTION LOCAL INSPECTIONS DEPARTMENT:

The following items have not been completed by the building manufacturer, have not been inspected by the third party inspection agency and are not certified by the state modular label and/or certification. Code compliance for these items must be determined at the local level:

- 1) The completed foundation support system and tiedown and/or anchorage system.
- 2) Ramps, stairs and general access to the building.
- 3) Building drains, cleanouts and hook-ups to plumbing system, and finish plumbing.
- 4) Electrical service hook-up (including feeders and the main Electrical Panel).
- 5) Connection of electrical circuits crossing over modular mating lines (multi-wide units only).
- 6) Structural and aesthetic interconnections between modules (multi-units only).
- 7) Installation of insulation at floor, ceiling and end-walls at mating lines (multi-wide units only).
- 8) Install R6.5 insulation on all piping installed in unconditioned spaces.
- 9) Install firestopping at all module mate lines at the marriage wall ceiling height and at the floor system.
- 10) Crawl space light and switch
- 11) HVAC system crossover ducts, and HVAC systems*
- 12) Ridge vents must be installed in accordance with the vent manufacturers instructions.
- 13) Storm Protection Panels Required For Glazed Openings Per FBC-R Section R301.2.1.2
- 14) Plan review and inspection required by Chapter 633 F.S. to be done on-site by local fire safety inspector.
- 15) On-site fastenings and framing at gable walls, truss transitions and/or hinged trusses.
- 16) Dormer Construction

* Heat Pump Cooling System Required With a SEER = 12.0 (min) and Programmable Thermostat

STATE OF FLORIDA

CODE: 2004 FBC, RESIDENTIAL WITH '05 SUPPLEMENT AND 2002 NEC
FLOOR LIVE LOAD: 40 PSF
FLOOR DEAD LOAD: 8 PSF
ROOF LIVE LOAD: 20 PSF
ROOF DEAD LOAD: 6 PSF
ATTIC LIVE LOAD: 0 PSF
ATTIC DEAD LOAD: 10 PSF
MAX. WIND SPEED: 130 MPH, EXPB, Iw=1.0 (3 SEC. GUST; ENCLOSED BLDG)
OCCUPANCY GROUP: SINGLE FAMILY DWELL.
CONSTRUCTION TYPE: WOOD FRAME
BUILDING CATEGORY: II (PER ASCE 7-02)
MEAN ROOF HEIGHT NOT TO EXCEED 15' ABOVE GRADE
COMPONENT & CLADDING DESIGN LOADS:
WALL ZONE 4: 39.9 PSF WALL ZONE 5: 49.2 PSF
ROOF ZONE 1: 33.6 PSF ROOF ZONE 2: 71.0 PSF
ROOF ZONE 3: 71.0 PSF OHNG ZONE 3: 115.3 PSF
OHNG ZONE 2: 71.0 PSF

Not to be located in coastal or flood plain areas or in HIGH VELOCITY HURRICANE ZONES

FOUNDATION NOTES

IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA DEPARTMENT OF COMMUNITY AFFAIRS, THESE BUILDING PLANS DO NOT CONTAIN FOUNDATION SUPPORT AND TIEDOWN SYSTEM DETAILS AND SPECIFICATIONS. THE DESIGNER OF THE BUILDING PLANS SHOULD BE CONTACTED TO OBTAIN APPROPRIATE FOUNDATION PLANS. IF FOUNDATION PLANS ARE DESIGNED BY OTHERS, THE DESIGNER OF THE BUILDING PLANS SHALL NOT BE HELD RESPONSIBLE OR LIABLE FOR THE FOUNDATION DESIGN AND THE CONSEQUENTIAL PERFORMANCE OF THE SUPERSTRUCTURE'S STRUCTURAL COMPONENTS AND SYSTEMS RELATED THERETO.

NOTE: ALL MATERIALS USED IN THE CONSTRUCTION OF THIS BUILDING WHICH ARE COVERED BY THE FLORIDA BUILDING COMMISSION CHAPTER 9B-72 RULES SHALL HAVE A CURRENT FLORIDA PRODUCT APPROVAL

THIS STRUCTURE CANNOT BE LOCATED ON THE UPPER HALF OF AN "ISOLATED HILL, RIDGE OR ESCARPMENT" WHICH SATISFIES ALL OF THE FOLLOWING:
(i) HILL, RIDGE OR ESCARPMENT IS HIGHER THAN 30 FEET IN EXPC LOCATIONS AND 60 FEET IN EXPB LOCATIONS
(ii) AVERAGE SLOPE OF HILL EXCEEDS TEN PERCENT
(iii) THE HILL, RIDGE OR ESCARPMENT HAS NO OBSTRUCTIONS TO WIND MOVEMENT BY TOPOGRAPHIC FEATURES FOR A DISTANCE FROM THE HIGH POINT OF THE HILL, RIDGE OR ESCARPMENT EQUAL TO 50 TIMES THE HEIGHT OF THE HILL, RIDGE OR ESCARPMENT OR ONE MILE, WHICHEVER IS LESS

SITE INSTALLED ITEMS

NOTE THAT THIS LIST DOES NOT NECESSARILY LIMIT THE ITEMS OF WORK AND MATERIALS THAT MAY BE REQUIRED FOR A COMPLETE INSTALLATION. ALL SITE RELATED ITEMS ARE SUBJECT TO LOCAL BUILDING OFFICIAL REVIEW AND APPROVAL.

- 1) THE COMPLETE FOUNDATION SUPPORT AND TIEDOWN SYSTEM
- 2) RAMPS, STAIRS AND GENERAL ACCESS TO THE BUILDING
- 3) PORTABLE FIRE EXTINGUISHER(S)
- 4) BUILDING DRAINS, CLEANOUTS AND HOOK-UP TO PLUMBING SYSTEM
- 5) ELECTRICAL SERVICE HOOK-UP, INCLUDING THE FEEDERS, TO THE BUILDING
- 6) THE MAIN ELECTRICAL PANEL AND SUB-FEEDERS
- 7) CONNECTION OF ELECTRICAL CIRCUITS CROSSING OVER MODULE MATE LINES (MULTI-UNITS ONLY)
- 8) STRUCTURAL AND AESTHETIC INTERCONNECTIONS BETWEEN MODULES (MULTI-UNITS ONLY)

ALSO SEE LIST OF REQUIREMENTS IN LOCAL INSPECTORS NOTES BELOW

NOTE THE BUILDING SPECIFIED ON THESE DRAWINGS IS EXCLUDED FROM COVERAGE OF THE MANUFACTURED HOUSING CONSTRUCTION AND SAFETY STANDARDS ACT, 42 U.S.C. 5401 ET SEQ. UNDER PROVISIONS OF 24 CFR 3282.12, IN THAT THE BUILDING IS:

- 1) INTENDED ONLY FOR ERECTION OR INSTALLATION ON A SITE-BUILT PERMANENT FOUNDATION;
- 2) NOT DESIGNED TO BE MOVED ONCE ERECTED OR INSTALLED; AND
- 3) DESIGNED AND MANUFACTURED TO COMPLY WITH A NATIONALLY RECOGNIZED MODEL BUILDING CODE OR AN EQUIVALENT BUILDING CODE FOR SITE-BUILT HOUSING.

LISTING
AGENCY APPROVAL

These prints comply with the Florida Manufactured Building Act of 1979 Construction Code and adhere to the following criteria:

Coast Type: VB
Occupancy: R3
Allowable No. of Floors: 1
Wind Velocity: 130
Fire Rating of Ext. Walls: 0
Plan No: 12-2056-0871 F
Allow. Floor Load: 40
Approval Date: 2-28-06
Manufacturer: Prec
Approved for High Velocity Hurricane Zone: 16
HWC
COA # 1025

Date: 2-28-06 Plan No: 12-2056-0871 F
Approved By: JAMES A. LYONS

James A. Lyons

Modular Building Plans Examiner
Florida License No. SMP-112

ELEVATION NOTES: Typical

See cross section for method of roof ventilation.

Handicap ramp(s), Stair(s), and Handrails are site installed, designed by others, and subject to local jurisdiction review and approval.



Foundation enclosure (when provided) must have 1 square foot net vent area per 1/150th of the floor area and an 18"x24" minimum crawl space access, site installed by others, subject to local jurisdiction, review & approval. (min 10.1 ft² net vent area req'd)

PRECISION MODULAR

309 E. 4TH STREET
OCILLA, GEORGIA 31774

DATE: 3/4/03		
CODES: FBC		
LABELS: FL	REVISIONS: 2/23/06 2/23/06	DRAWN BY: C.A. Leblanc
SCALE: NTS		
MODEL : YORKSHIRE ELEVATIONS	PLAN NO. PRE-14FL	SHEET
WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER	33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167	I OF 6

2056-0871

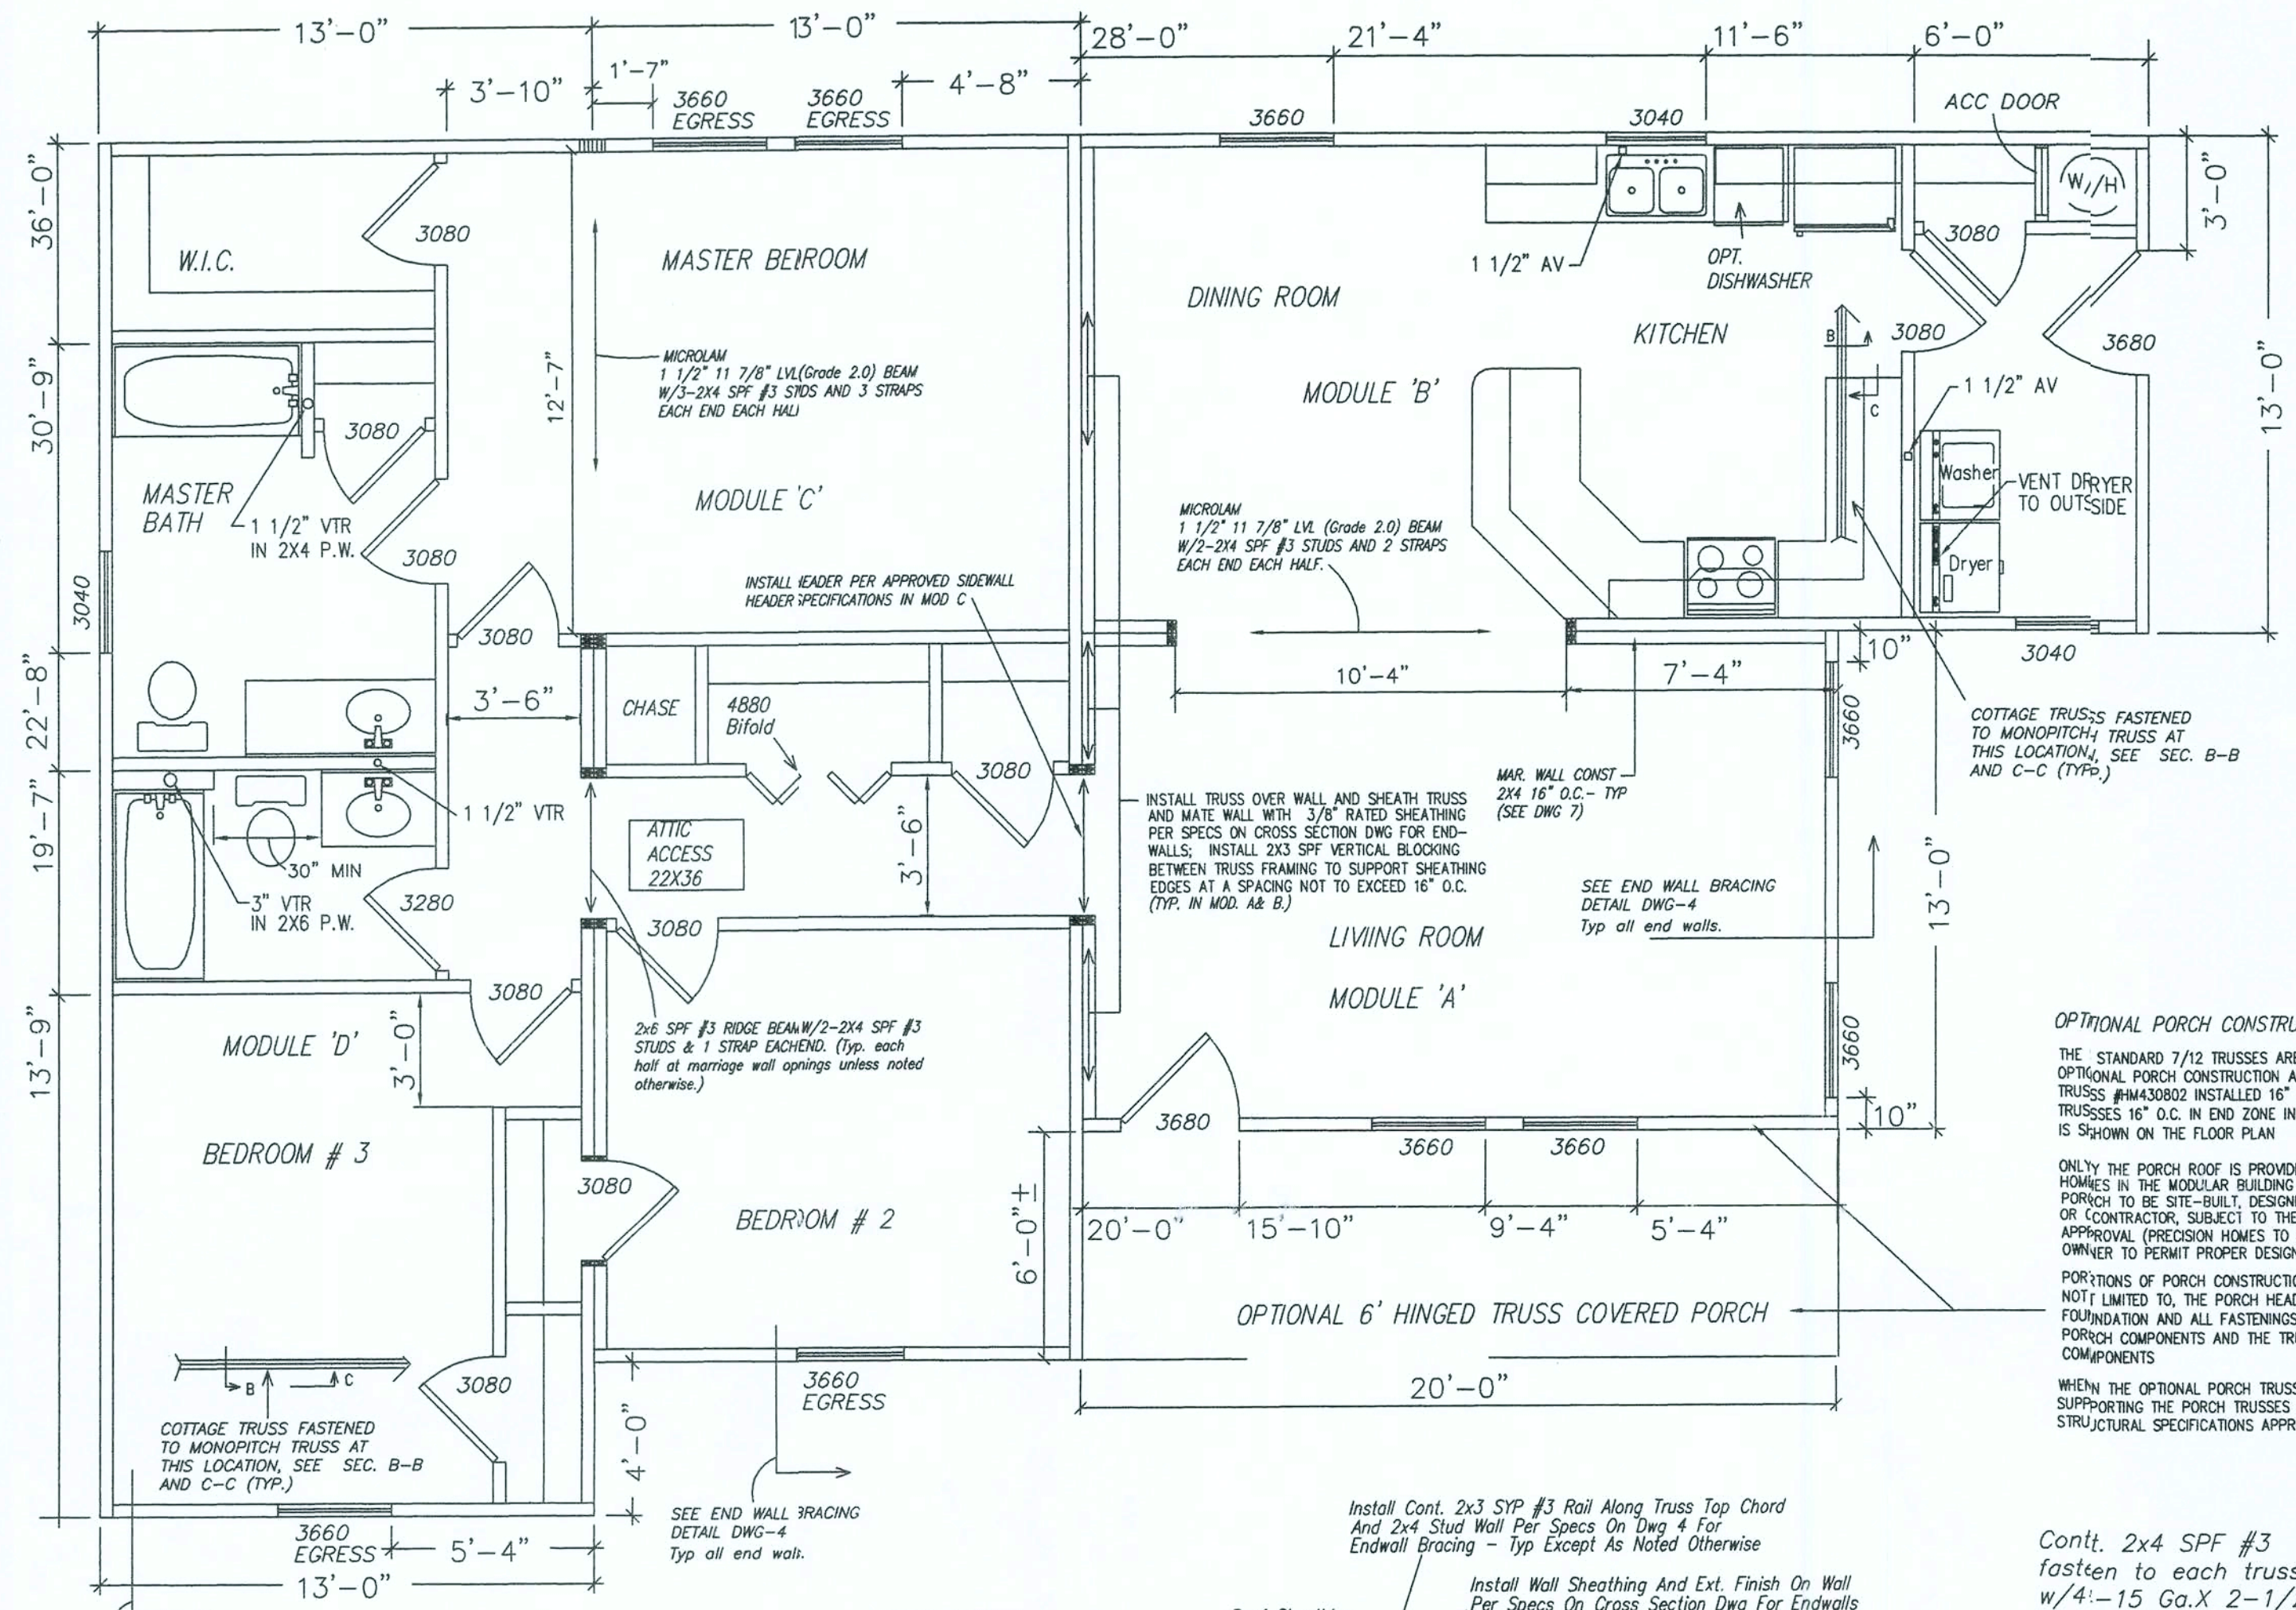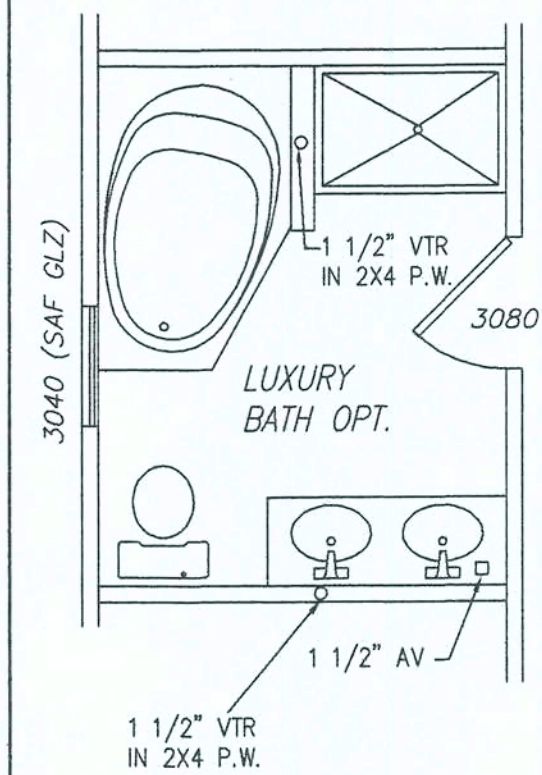

THE FBC-R CODE REQUIRES THAT ALL BUILDINGS LOCATED IN AREAS WITH WIND SPEEDS EQUAL TO OR GREATER THAN 120 MPH AND ALL BUILDINGS LOCATED IN AREAS WITH WIND SPEEDS EQUAL TO OR GREATER THAN 110 MPH WHICH ARE WITHIN ONE MILE OF THE COASTAL MEAN WATER LINE BE PROVIDED WITH EITHER OF THE FOLLOWING:

(I) IMPACT RESISTANT GLAZING COMPLYING WITH AN IMPACT GLAZING STANDARD, ASTM E1996 AND/OR ASTM E1886

(II) STORM PROTECTION WOOD STRUCTURAL PANELS (I.E. MIN. 7/16\"/>

NOTE: THE STORM PROTECTIVE PANELS MAY BE PROVIDED BY THE LOCAL CONTRACTOR OR INSTALLER RATHER THAN THE BUILDING MANUFACTURER.

IN ADDITION, EXTERIOR WINDOWS AND DOORS MUST BE DESIGNED TO RESIST THE DESIGN WIND LOADS SPECIFIED IN TABLE R301.2(2) OF THE FBC-R CODE ADJUSTED FOR HEIGHT AND EXPOSURE PER TABLE R301.2(3) OF THE FBC-R CODE.

ALL EXTERIOR WINDOWS AND GLASS DOORS MUST BE TESTED AND APPROVED BY AN APPROVED INDEPENDENT LABORATORY AND BEAR A LABEL INDICATING COMPLIANCE WITH AAMA/NWDA 101/1.5.2

OPTIONAL PORCH CONSTRUCTION:

THE STANDARD 7/12 TRUSSES ARE PROVIDED WITHOUT PORCH OPTION; OPTIONAL PORCH CONSTRUCTION AVAILABLE WITH UNIVERSAL PORCH TRUSSES #H430802 INSTALLED 16\"/>


ONLY THE PORCH ROOF IS PROVIDED WITH THIS TRUSS INSTALLED BY PRECISION HOMES IN THE MODULAR BUILDING FACTORY - ALL OTHER PORTIONS OF THE PORCH TO BE SITE-BUILT, DESIGNED AND/OR SPECIFIED BY OTHER DESIGNER OR CONTRACTOR, SUBJECT TO THE LOCAL BUILDING OFFICIAL REVIEW AND APPROVAL (PRECISION HOMES TO PROVIDE TRUSS DESIGN DRAWING TO HOME OWNER TO PERMIT PROPER DESIGN OF PORCH)

PORTIONS OF PORCH CONSTRUCTION TO BE SITE-BUILT INCLUDE, BUT ARE NOT LIMITED TO, THE PORCH HEADERS, PORCH POSTS, PORCH FLOOR, PORCH FOUNDATION AND ALL FASTENINGS AND/OR INTERCONNECTIONS BETWEEN THE PORCH COMPONENTS AND THE TRUSSES ABOVE AND THE MODULAR BUILDING COMPONENTS


WHEN THE OPTIONAL PORCH TRUSSES ARE INSTALLED THE SIDEWALL CONSTRUCTION SUPPORTING THE PORCH TRUSSES MUST BE CONSTRUCTED IN ACCORDANCE WITH THE STRUCTURAL SPECIFICATIONS APPROVED FOR THE PORCH TRUSS INSTALLATION

Handwritten note: 11/15/05

FRONT

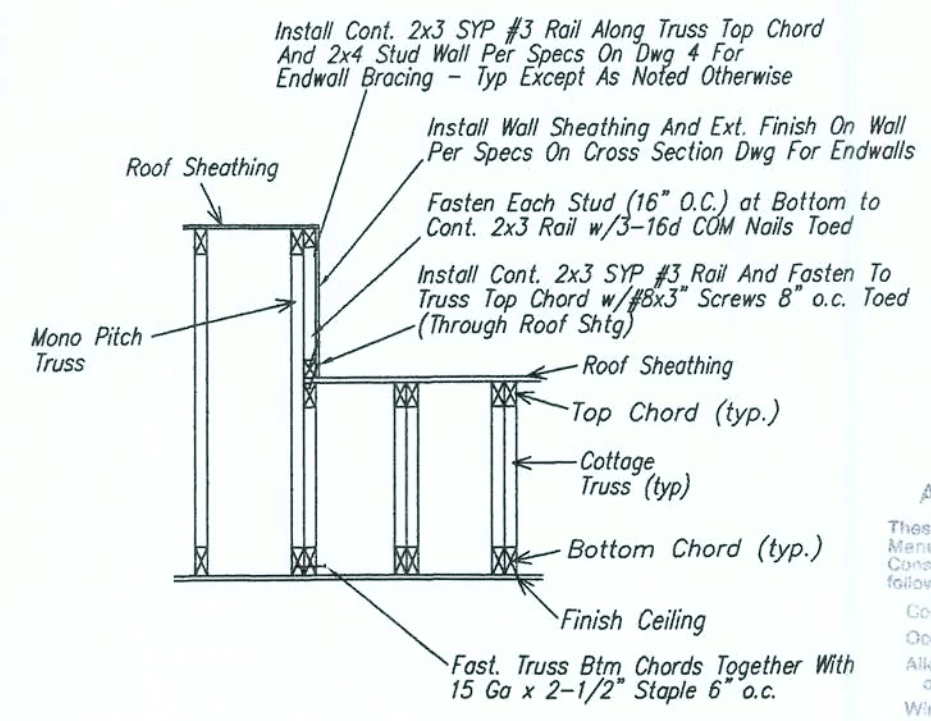

SECTION B-B

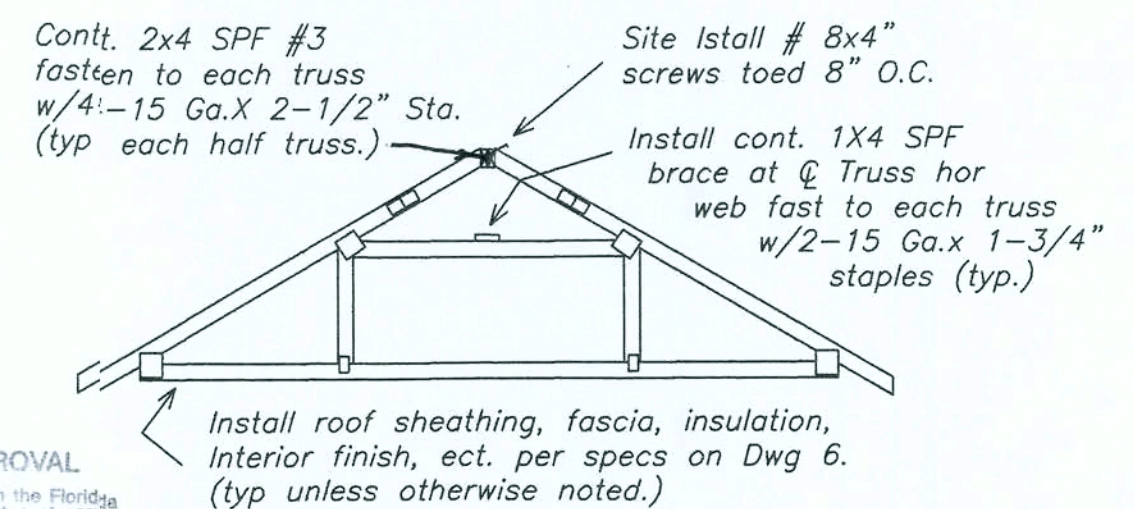

SECTION C-C

LISTING AGENCY APPROVAL

These prints comply with the Florida Manufactured Building Act of 1979 Construction Code and adhere to the following criteria:

Code Type	VB
Occupancy	R3
Allowable No. of Floors	1
Wind Velocity	130
Fire Rating of Ext. Walls	0
Plan No.	2056-08711P
Allow. Floor Load	40
Approval Date	10-14-05
Manufacturer	Precision
Approved for High Velocity Hurricane Zone	10
HWC	
COA # 1025	

LIGHT & VENT CHART	FLOOR AREA SQ. FT.	LIGHT		VENT	
		REQUIRED PROVIDED	REQUIRED PROVIDED	REQUIRED PROVIDED	REQUIRED PROVIDED
MASTER BEDROOM	207.6	16.61 24.40	8.30 12.28		
BEDROOM #2	135.7	10.86 12.20	5.43 6.14		
BEDROOM #3	141.2	11.30 12.20	5.65 6.14		
LIVING ROOM	238.4	19.07 48.80	9.54 24.56		
KITCHEN/DINING AREA	261.1	20.89 18.48*	10.44 9.28*		
UTILITY ROOM	56.7	N/A 6.28	N/A 3.14		
*ART. LIGHT & MECH. VENT. PROVIDED					

WINDOW & DOOR SCHEDULE					
WIDTH	HEIGHT	TYPE	LIGHT SQ FT	VENT SQ FT	
24"	60"	Single hung	7.69	3.93	
30"	60"	Single hung	9.95	5.03	
36"	60"	Single hung	12.20	6.14	
40"	60"	Single hung	13.71	6.87	
30"	40"	Single hung	6.28	3.14	
30"	27"	Single hung	3.90	1.90	
34"	80"	Door			
36"	80"	Door			

NOTE: All windows to be single hung w/insulated glazing
All egress windows must comply w/FBC-R
Section R310 (U=.48 max; Kinro series 9750)

All Exterior doors to be insulated (U=.52) except Sliding Glass Doors and/or Patio Doors to have U=.70 max

All Interior partitions 2x4 studs @ 24\"/>


All straps referenced on the floor plan are 1-1/2\"/>

PRECISION MODULAR

309 E. 4TH STREET
OCILLA, GEORGIA 31774

DATE: 8/15/02		
CODES: FBC	REVISIONS:	DRAWN BY:
LABELS: FL	10/15/05	C.A. Leblanc
SCALE: 1/4" = 1'-0"	PLAN NO. PRE-14FL	SHEET
MODEL: YORKSHIRE FLOOR PLAN	WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER	33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167

2 OF 6

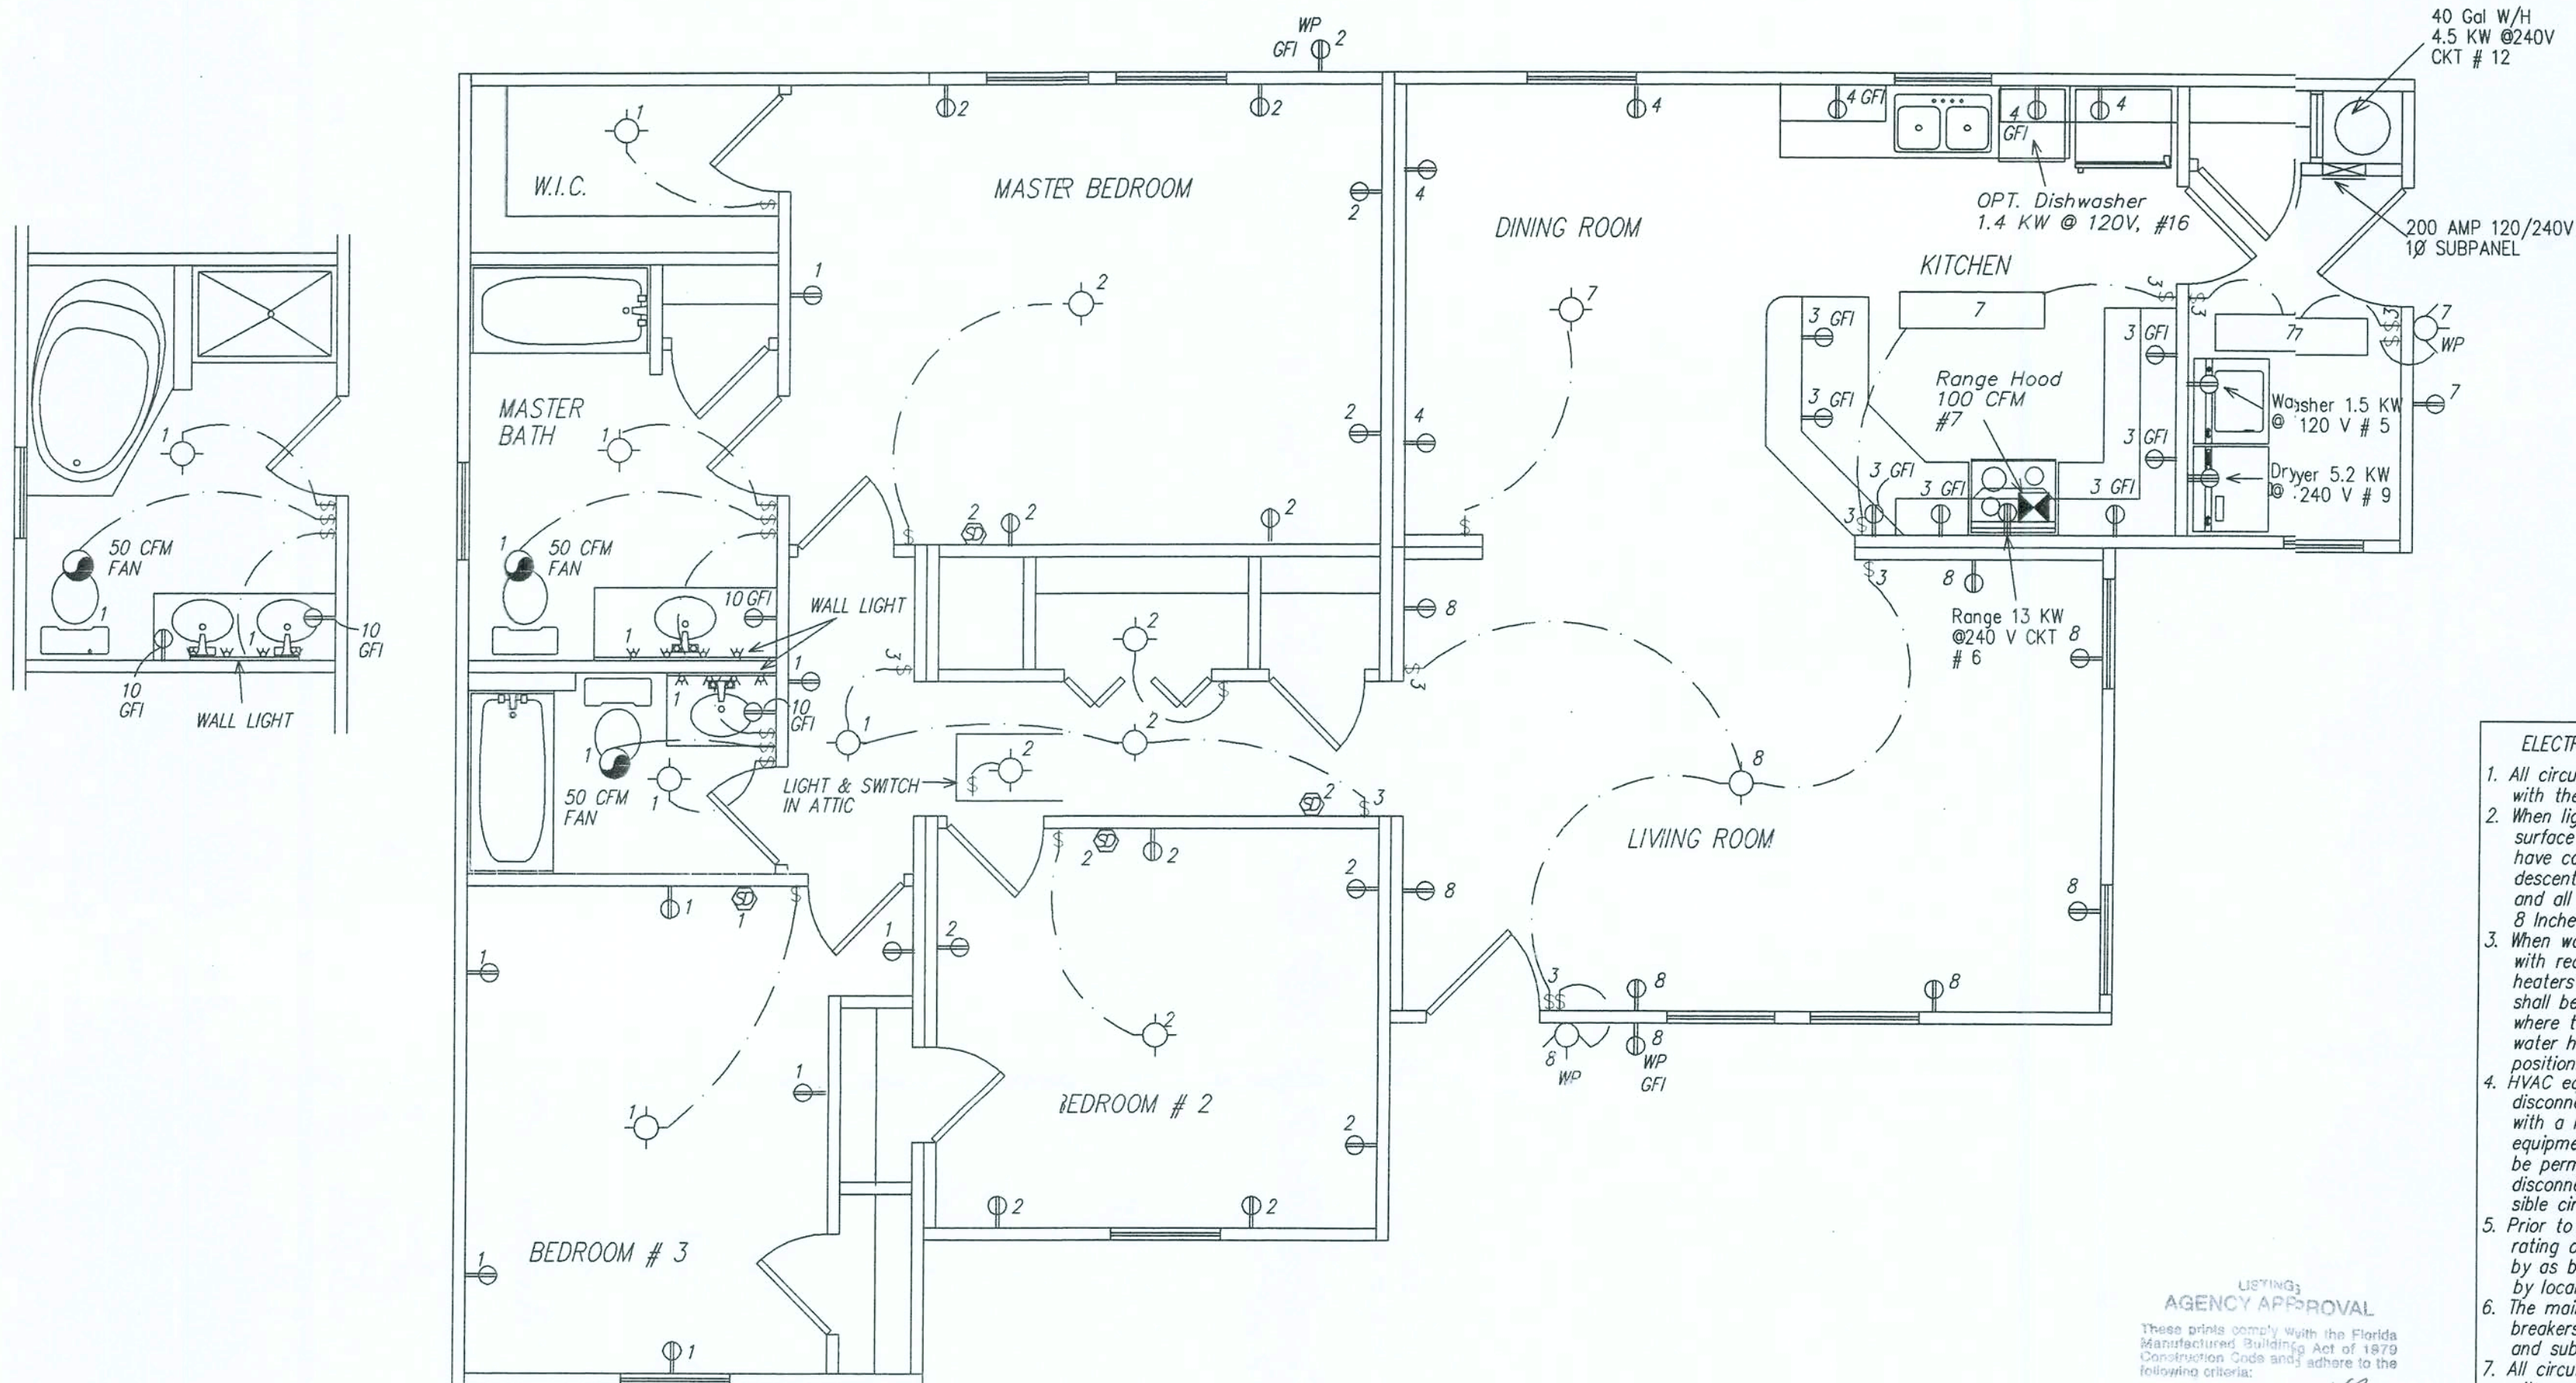

NOTE: ALL BRANCH CIRCUITS SUPPLYING 15 AND 20 AMP OUTLETS IN BEDROOMS MUST BE PROTECTED BY AN ARC-FAULT CIRCUIT INTERRUPTER IN ACCORDANCE WITH SECTION 210.12 OF THE NEC. (CIRCUITS 1 & 2 MUST BE PROTECTED BY AN ARC-FAULT TYPE CIRCUIT BREAKER)

NOTE: HVAC SYSTEM TO BE SITE INSTALLED AND DESIGNED BY OTHERS, SUBJECT TO LOCAL BUILDING OFFICIAL REVIEW AND APPROVAL.


ELECTRICAL NOTES: NEC

1. All circuits and equipment shall be grounded in accordance with the appropriate articles of the NEC.
2. When light fixtures are installed in closets they shall be surface mounted or recessed. Incandescent fixtures shall have completely enclosed lamps. Surface mounted incandescent fixtures shall have minimum clearance of 12 inches and all other fixtures shall have a minimum clearance of 8 inches from "Storage Area" as defined by NEC 410-8.
3. When water heaters are installed they shall be provided with readily accessible disconnects adjacent to the water heaters served. The branch circuit switch or circuit breakers shall be permitted to serve as disconnecting means only where the switch or circuit breaker is within sight from the water heater or is capable of being locked in the open position.
4. HVAC equipment shall be provided with readily accessible disconnects adjacent to the equipment served. A unit switch with a marked "OFF" position that is a part of the HVAC equipment and disconnects all ungrounded conductors shall be permitted as the disconnecting means where other disconnecting means are also provided by a readily accessible circuit breaker.
5. Prior to energizing the electrical system the interrupting rating of the main breaker must be designed and verified by as being in compliance with section 110-9 of the NEC by local electrical consultant.
6. The main electrical panel, service disconnect (main circuit breakers) and feeders are site installed, designed by others and subject to local jurisdiction review and approval.
7. All circuits crossing over modular mating line(s) shall be site connected with approved accessible junction boxes, located below the floor or in the attic.
8. All circuits to be copper NM except HVAC and Range circuits to be copper SE cable, (75°C).
9. Light and switch to be site-installed in the crawl space near the crawl space access door (light to be connected to any of the installed general lighting circuits).
- 10) Receptacles installed in wet locations must be in a weatherproof enclosure the integrity of which is not affected when the attachment plug cap is inserted or removed.
- 11) Smoke detectors must be wired to activate all alarms simultaneously if any detector is activated. All smoke detectors located within twenty feet of a cooking appliance shall be the photoelectric type.
- 12) All fans must be ducted to the exterior of the building and terminate at an approved vent cap.

AGENCY APPROVAL

These prints comply with the Florida Manufactured Building Act of 1979. Construction Code and adhere to the following criteria:

Const. Type: VB
Occupancy: R3
Allowable No. of Floors: 1
Wind Velocity: 130
Fire Rating of Ext. Walls: 0
Plan No.: 20556-0871/F
Allow. Floor Load: 40
Approval Date: 7/10/05
Manufacturer: FBC
Approved for High Velocity Hurricane Zone: No
HWC
COA # 10225

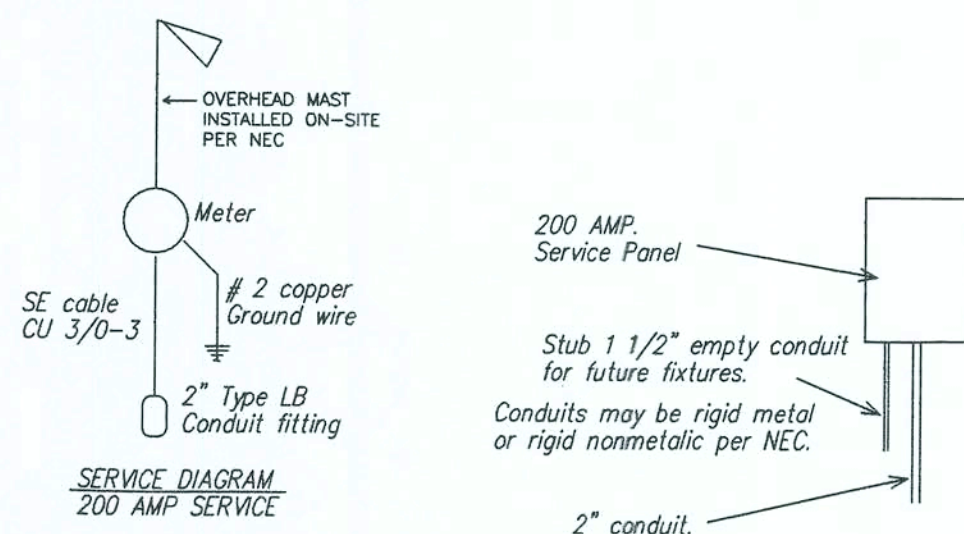

PANEL SIZING

1508 Sq. Ft. @ 3 watts/Sq. Ft.	4.52 KW
2-20 AMP Appliance circuits	3.00 KW
Laundry circuit	1.50 KW
Range	13.00 KW
Clothes Dryer	5.20 KW
Water Heater	4.50 KW
Dishwasher	1.40 KW
TOTAL	33.12 KW

First 10 KW @ 100%	10.00 KW
Remainder @ 4% (23.12)(.4)=	9.25 KW
Assumed HVAC	20.90 KW
TOTAL	40.15 KW

Calculated Load for service size
40.150 w/240 volts= 167.3 Amperes
200 AMP service standard

ELECTRICAL LEDGEND

- \$ Light Switch
- ⊖ Duplex Recept
- ⊖ 240V Recept
- ⊖ Thermostat
- ⊖ Smoke Detector w/Battery Backup
- ⊖ Porch light W/P
- ⊖ Incandescent Light
- ⊖ Exhaust fan w/Light
- ⊖ Panel box
- ⊖ Exhaust fan
- ⊖ Fluorescent Light
- ⊖ Range hood w/Exhaust Fan and Light

ELECTRICAL CIRCUIT SCHEDULE


CIR	DESCRIPTION	COND.	SIZE (CU)	BRK(A)
1,2	General Lighting	14-2	w/GND	15
3,4	Small Appliance	12-2	w/GND	20
5	Washer	12-2	w/GND	20
6	Range	8-3	w/GND	40 2P
7,8	General Lighting	14-2	w/GND	15
9	Dryer	10-3	w/GND	30 2P
10	Bath	12-2	w/GND	20
12	Water Heater	10-2	w/GND	25 2P
13				
14,15	General Lighting	14-2	w/GND	15
16	Dishwasher (opt)	12-2	w/GND	20
17	Freezer (opt)	12-2	w/GND	20
18,19	General Lighting	14-2	w/GND	15
20	Small Appliance	12-2	w/GND	20

PRECISION MODULAR


309 E. 4TH STREET
OCILLA, GEORGIA 31774

DATE: 8/15/02	REVISIONS:	DRAWN BY:
CODES: FBC	7/12/05	C.A. Leblanc
LABELS: FL	SCALE: 1/4" = 1'-0"	SHEET
MODEL: YORKSHIRE ELECTRICAL	PLAN NO. PRE-14FL	3 OF 6
WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER	33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167	

TYPICAL FLOOR FRAMING PLAN

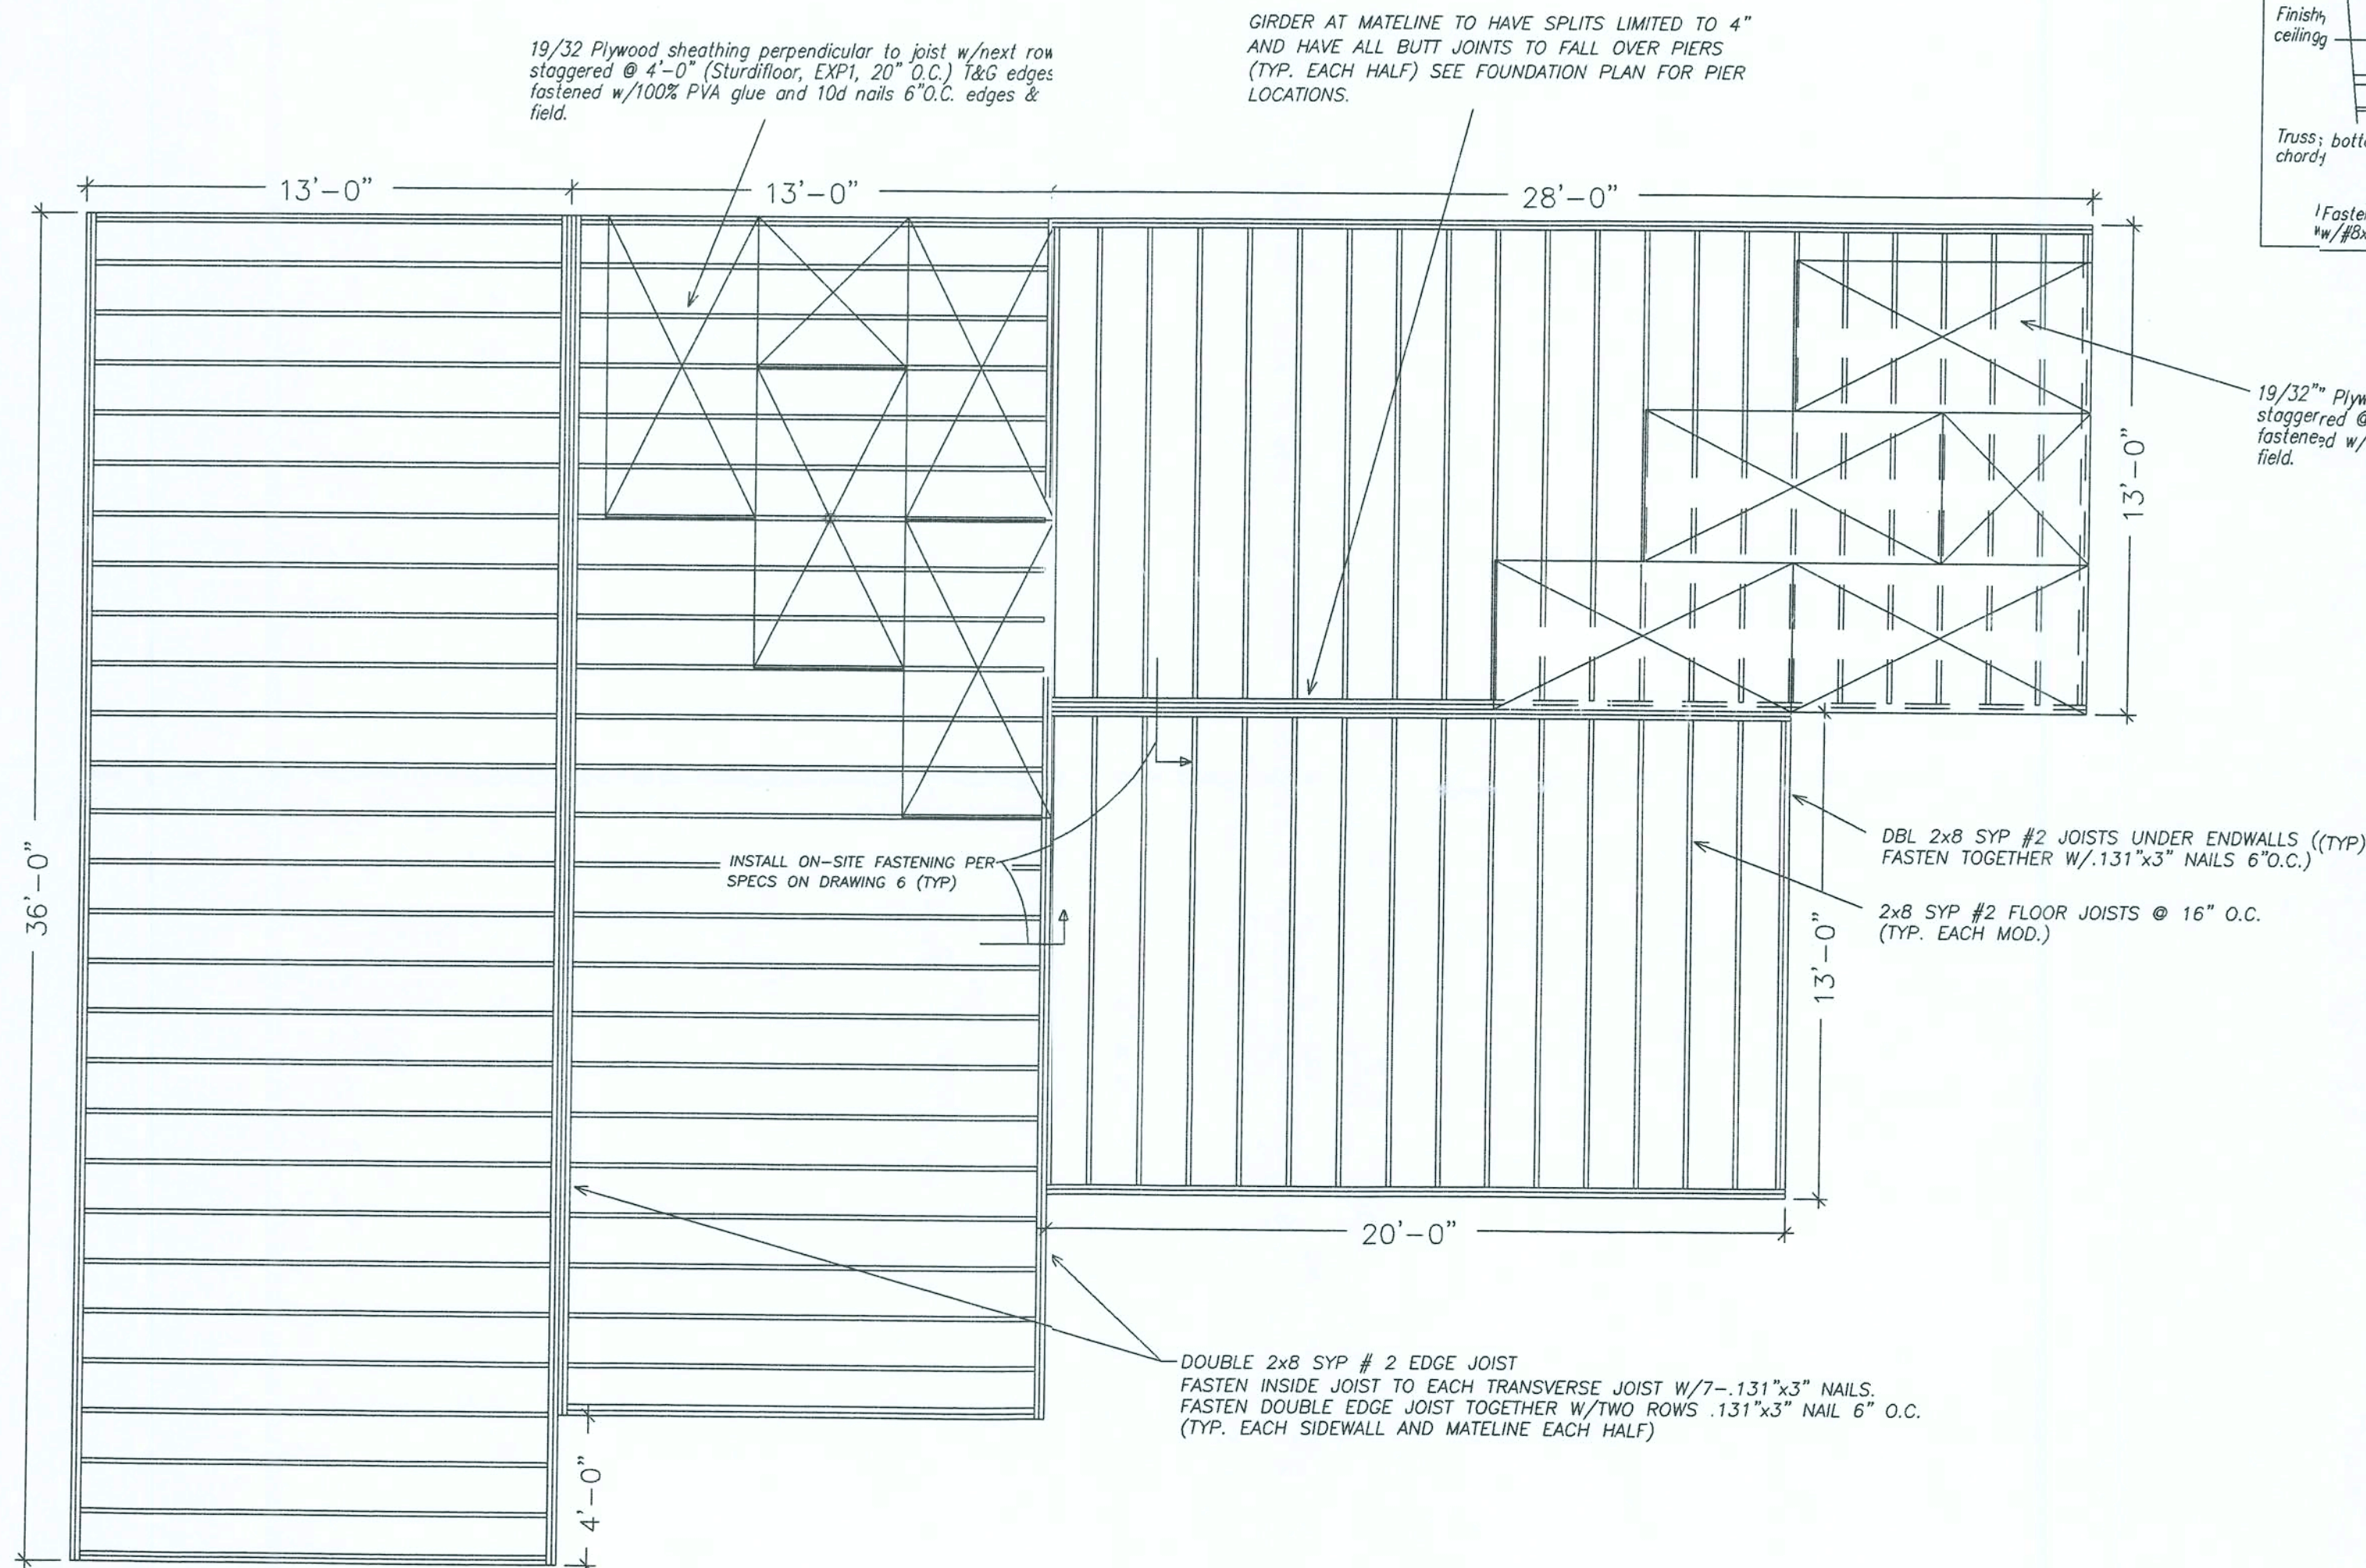

FRONT

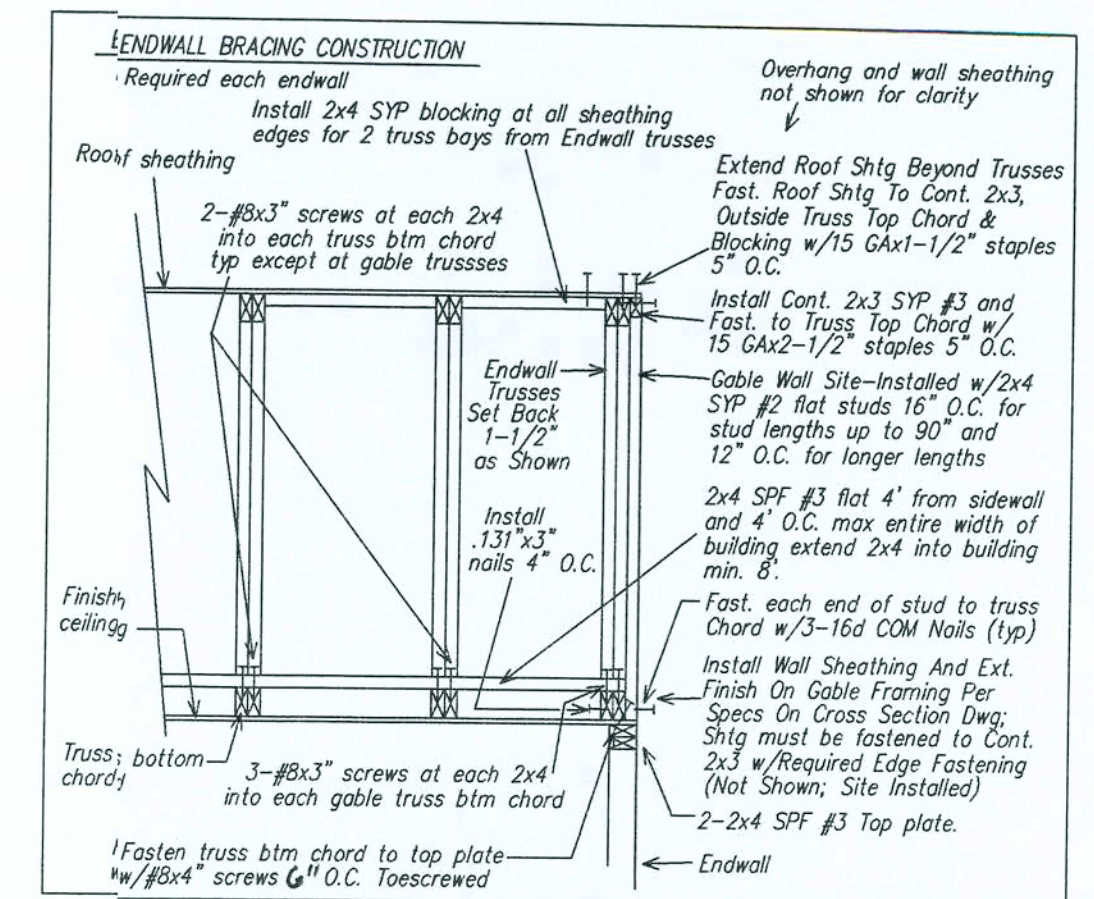

LISTING AGENCY APPROVAL


These prints comply with the Florida Manufactured Building Act of 1979 Construction Code and adhere to the following criteria:

Const. Type	VB
Occupancy	R3
Allowable No. of Floors	1
Wind Velocity	130
Fire Rating of Ext. Walls	0
Plan No.	2056-0871F
Allow. Floor Load	40
Approval Date	10-24-05
Manufacturer	AWC
Approved for High Velocity Hurricane Zone	10
HW/C	
COA # 1026	


PRECISION MODULAR

309 E. 4TH STREET
OCILLA, GEORGIA 31774


DATE: 8/15/02		
CODES: FBC		
LABELS: FL	REVISIONS: 10/5/05	DRAWN BY: C.A. Leblanc
SCALE: NTS	7/12/05	
MODEL: YORKSHIRE FRAMING	PLAN NO. PRE-14FL	SHEET
WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER	33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167	4 OF 6

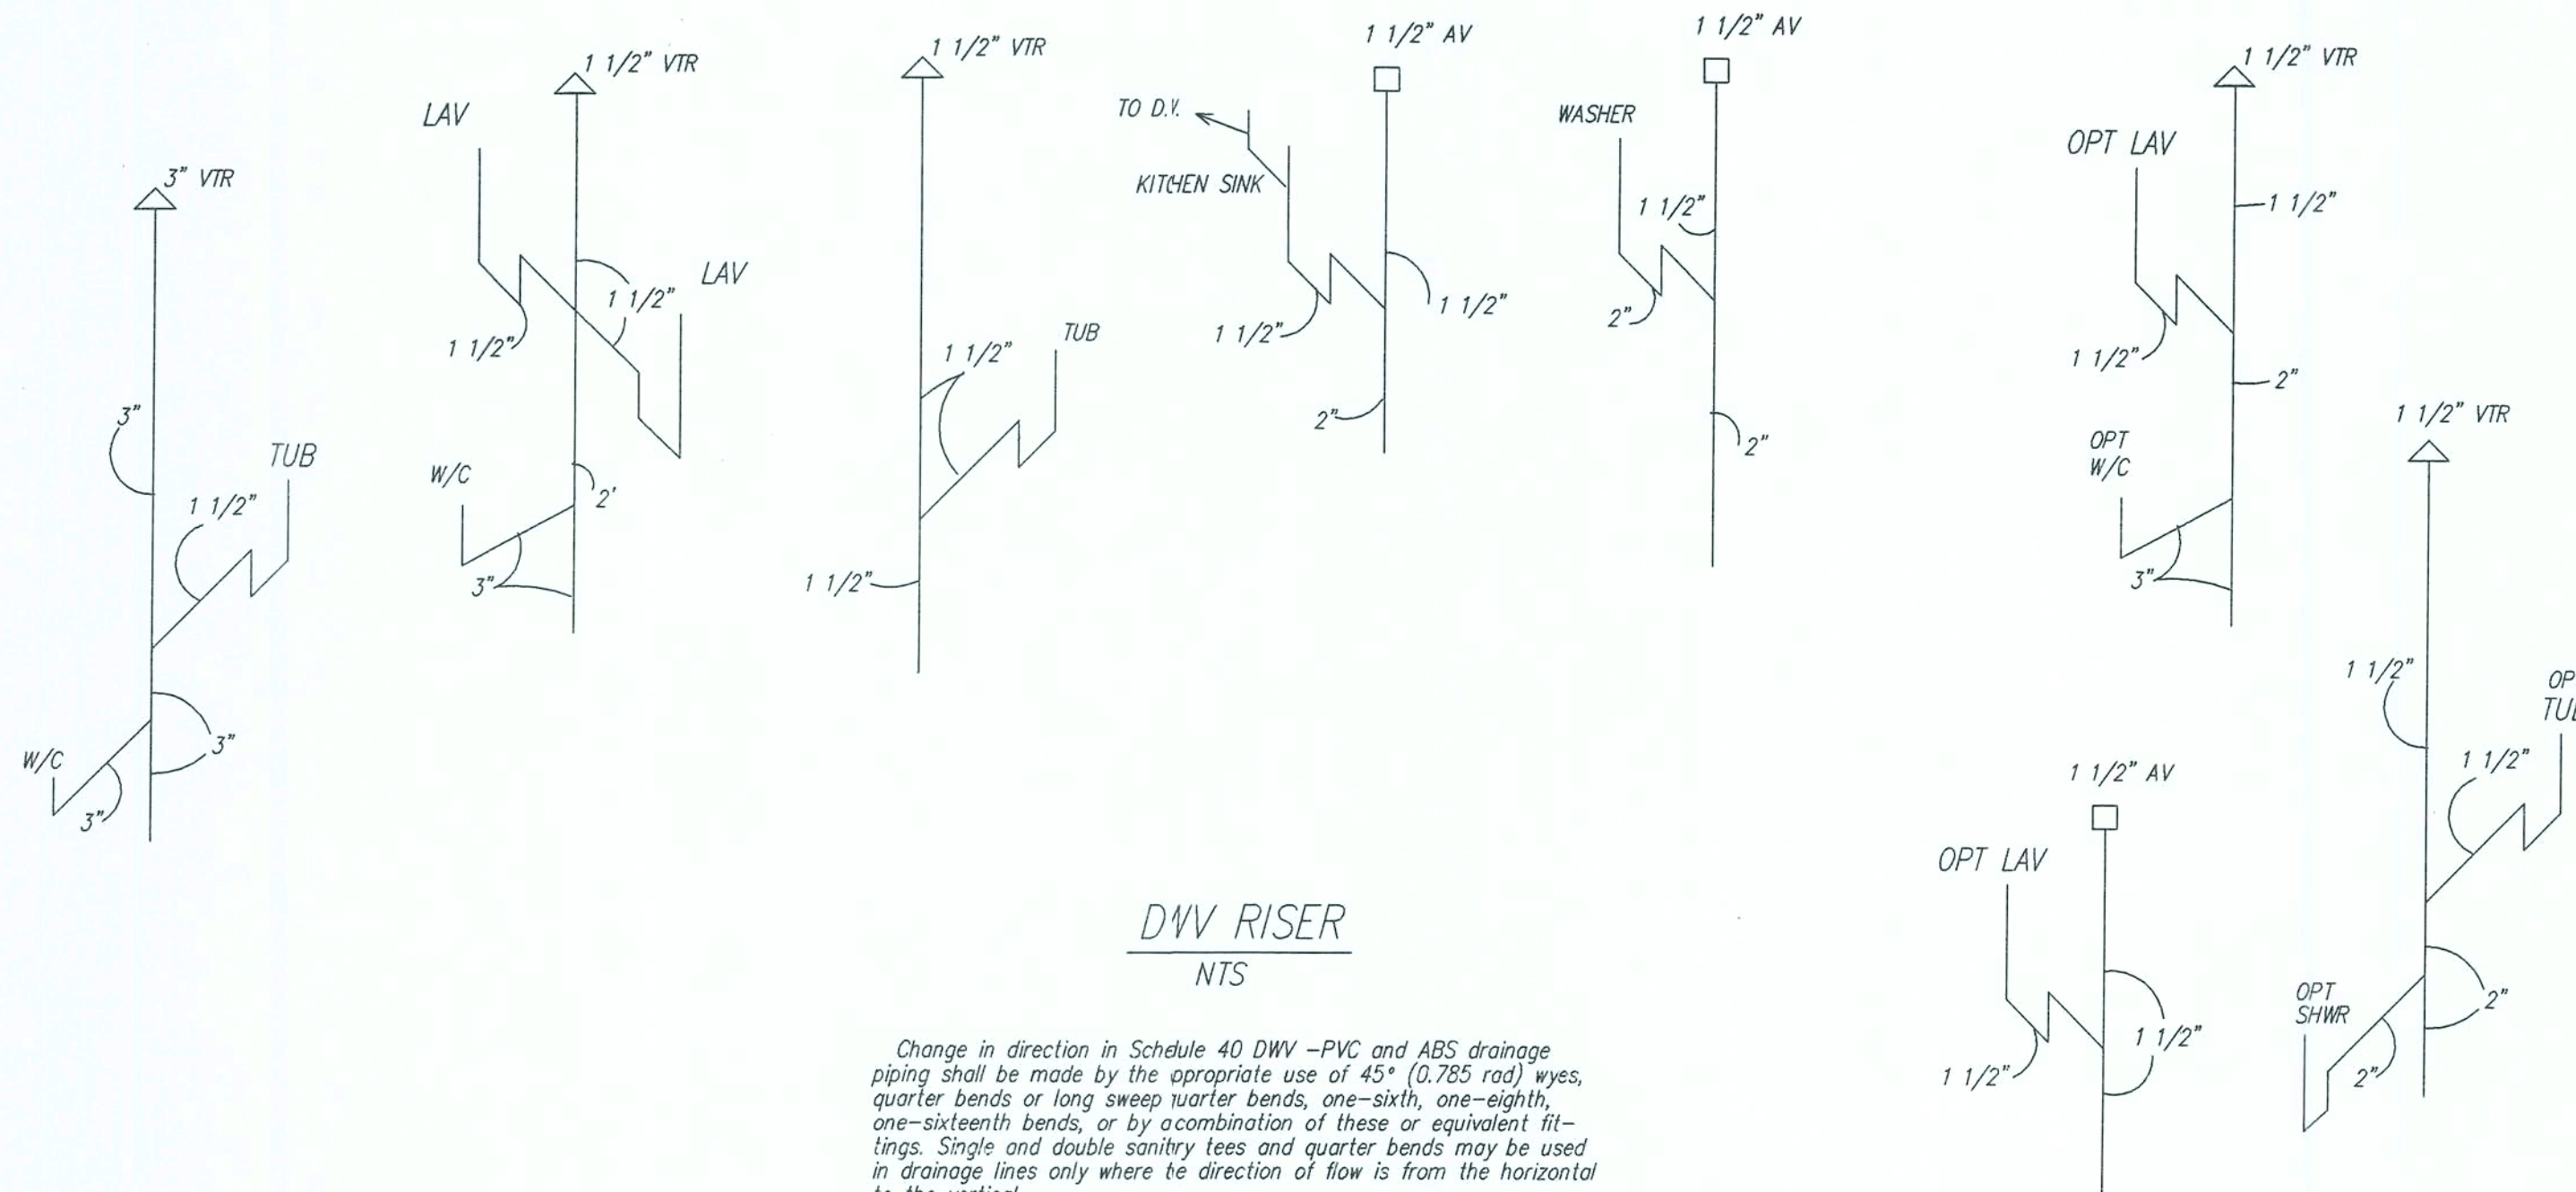

- PLUMBING NOTES:**
1. Tub access provided under home unless otherwise noted.
 2. All plumbing fixtures shall have separate shut-off valves.
 3. Water heater shall have safety pan with 1" drain to exterior. T & P relief valve with drain to exterior. And a shut-off valve within 3 feet on the cold water supply line.
 4. DWV system shall be either ABS or PVC-DWV.
 5. Water supply lines shall be CPVC (SCH 40 or SDR11) or PEX. Water supply lines may be stubbed through the floor (only) with the on-site installation of all lines below the floor to be in accordance with the specifications on this drawing.
 6. Water closets average water usage shall not exceed 1.6 gal./flush.
 7. Building drain and cleanouts are designed and site installed by others, subject to local jurisdiction approval. Underfloor trap arms not installed in the factory due to possible in-transit damage are to be site installed in accordance with the specifications on this drawing.
 8. An accessible shut off valve shall be provided ahead of the first outlet or branch connection to the service or distribution pipe. This shut-off valve may be site installed.
 9. Sinks and lavs shall not use more than 2.2 gal./min @ 60 PSI.
 10. Shower heads shall not use more than 2.5 gal./min @ 80 PSI per ANSI Std A 112.18.1M.
 11. All showers to have temperature of water controlled by a balanced pressure, thermostatic or combination balanced-pressure/thermostatic valve to limit the water temp. to 120°F (valve to comply w/ASSE 1016 or CSA CAN/CSA-B125).
 12. Air admittance valves (AV) shall conform to ASSE 1051. The AV valves shall be located a minimum of 4 inches above the horizontal drain or fixture drain being vented and must be installed in well ventilated spaces or provided with ventilated access doors.
 13. When metal water supply lines are installed, water hammer arrestors must also be installed where quick closing valves are utilized (i.e., dishwashers, clothes washers, ice makers or other quick closing devices with solenoid valves). Arrestors must comply with ASSE/ANSI 1010 and must be installed in accordance with the manufacturers instructions.
 14. An approved thermal expansion device shall be installed in the water supply system in accordance with the manufacturers installation instructions. (this device is required when backflow preventors, pressure reducing valves, check valves or storage water heaters are installed in the water supply system which may prevent pressure relief in the system)

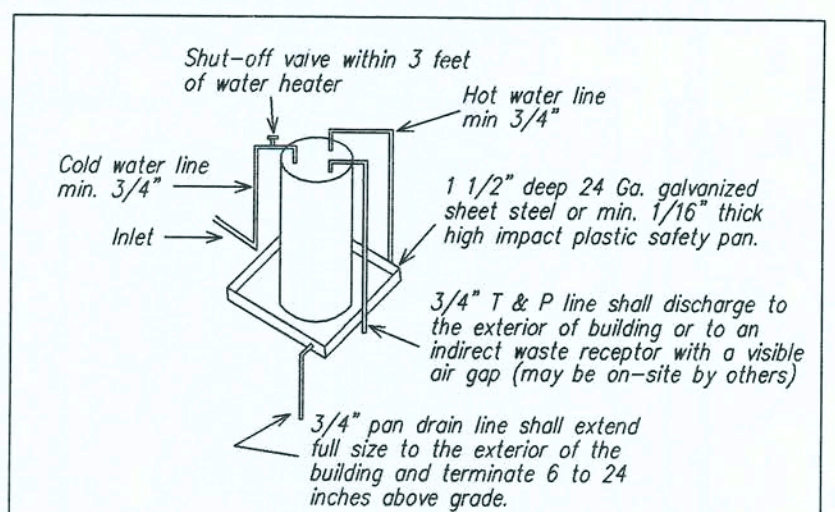

- NOTES:**
1. Water heater shall be provided with a cold water "Dip" tube with a hole at the top or a vacuum relief valve installed in the cold water supply line above the top of the water heater tank; bottom fed water heaters shall have a vacuum relief valve complying with ANSI Z21.22 installed.
 2. Water heaters shall be provided with a temperature and pressure relief valve complying with ANSI Z21.22 installed in the shell of the water heater tank. The valve shall be actuated by the water in the top 6 inches of the tank and shall have a temperature rating of not more than 210° F and a pressure setting not exceeding the tanks rated working pressure or 150 psi, whichever is less.
 3. Water heaters shall be equipped with an energy cutoff device that will cut off the supply of heat energy to the water tank before the temperature of the water in the tank exceeds 210° F.

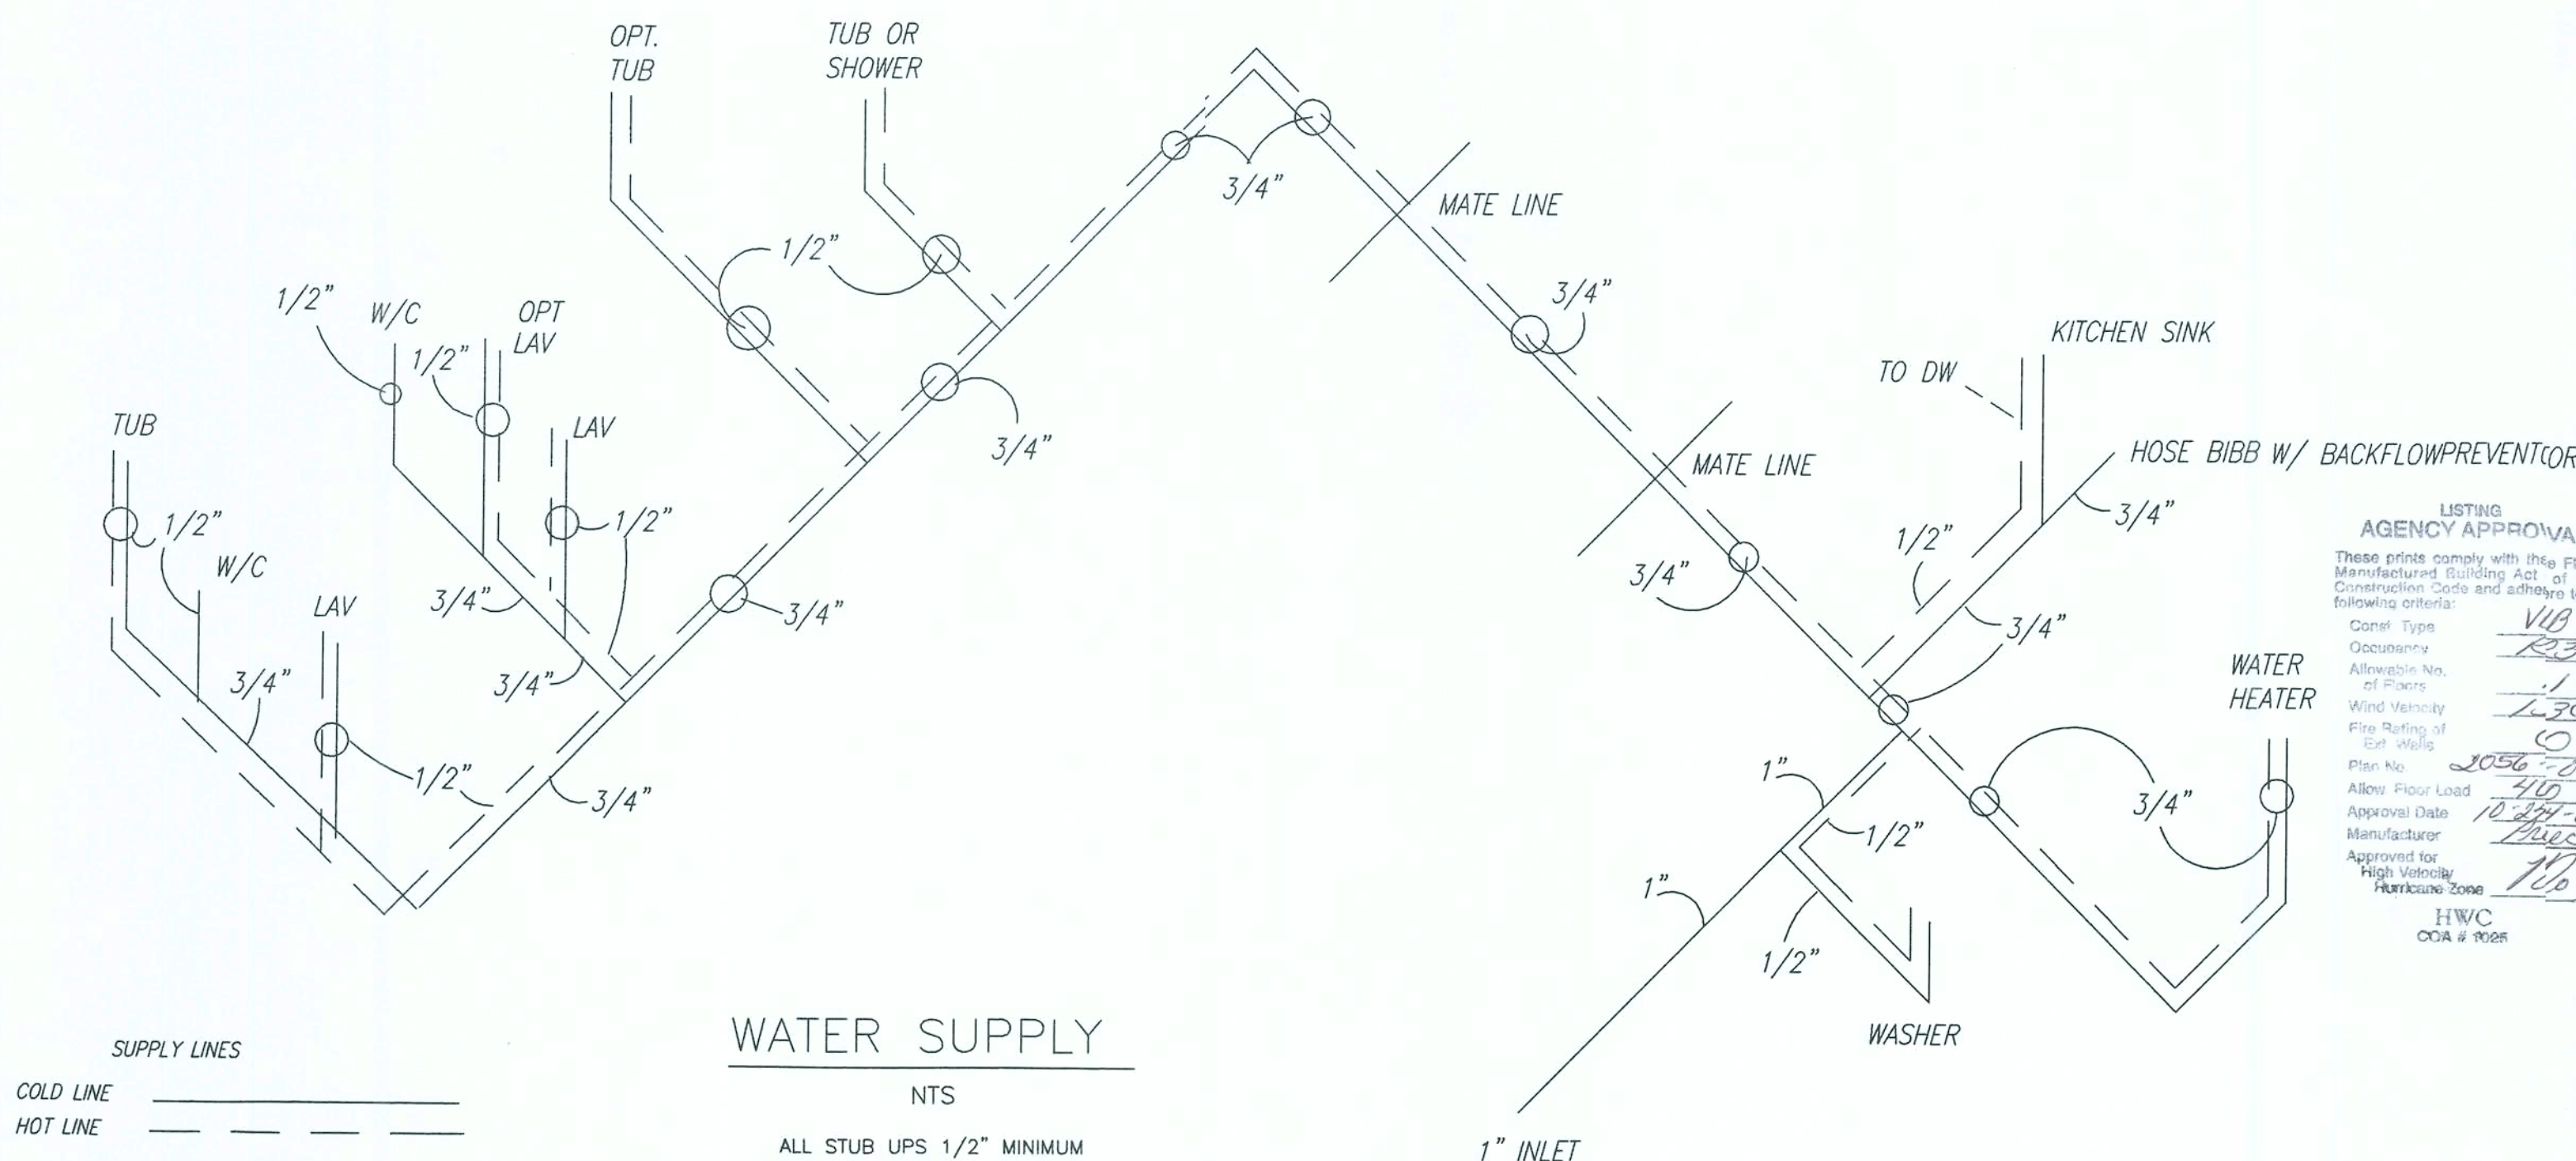

PRECISION MODULAR			
309 E. 4TH STREET OCILLA, GEORGIA 31774			
DATE: 8/15/02			
CODES: FBC			
LABELS: FL	REVISIONS:	DRAWN BY:	
SCALE: NTS	7/12/05	C.A. Leblanc	
MODEL: YORKSHIRE WATER SUPPLY	PLAN NO. PRE-14FL	SHEET	
WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER	33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167	5 OF 6	

GENERAL NOTES

Exterior joints in the building envelope that are sources of air leakage. Such as around windows and door frames; Between wall cavities and windows or door frames; Between walls and foundations; Between walls and roof/ceiling and between wall panels; Openings at penetrations of utility services through walls, floors and roofs; and all other such openings in the building envelope shall be caulked, gasketed, weather stripped or otherwise sealed in an approved manner.

Soffit vents and ridge vents equal to 1/150 of total roof area (this factor may be reduced to 1/300 when a vapor barrier of 1 perm or less is installed in attic.) (min 5.1 sq. ft. net vent air is required w/vapor barrier.)

TRUSS DESIGN LOADS:

20 PSF ROOF LL ON TOP CHORD
6 PSF ROOF DL ON TOP CHORD
0 PSF ATTIC LL ON BTM CHORD
10 PSF ROOF DL ON BTM CHORD
(EXCEPT COTTAGE TRUSS HAS 10 PSF ATTIC LL)

UFP DWGS HM2695R01 & P283301
LISTED TRUSSES 24" O.C. EXCEPT DOUBLE TRUSSES 24" O.C. IN END ZONES (FASTEN DBL TRUSS TOP CHORDS TOGETHER WITH 15 GA X 2-1/2" STAPLE 6" O.C.) (TYP EACH HALF)
EXCEPT OVER OPTIONAL PORCH IN MODULE 'A' USE UFP DWG HM430802 (PORCH TRUSS) WITH PORCH TRUSSES 16" O.C. EXCEPT DOUBLE TRUSSES 16" O.C. IN END ZONE IN PORCH AREAS (FASTEN DBL TRUSS TOP CHORDS TOGETHER WITH 15 GA X 2-1/2" STAPLE 6" O.C.) (PORCH TRUSSES TO FALL OVER STUDS)

INSTALL CONT 1X4 SPF BRACE AT E OF TRUSS DIAGONAL WEB MEMBER AS SHOWN - FASTEN BRACE TO EACH TRUSS WITH 3-15 GA X 1-3/4" STAPLES (TYP EACH TRUSS IN EACH HALF)

ASPHALT SHINGLES INSTALLED PER MANUFACTURERS INSTRUCTIONS OVER ONE LAYER OF 15# FELT FOR ROOF PITCHES EXCEEDING 4/12 AND TWO LAYERS OF 15# FELT FOR ROOF PITCHES LESS THAN AND EQUAL TO 4/12 (WIND RESISTANT SHINGLES; CLASS A)


2X6 SYP #3 SUB-FASCIA (TYP)

VINYL FASCIA AND VENTED SOFFIT INSTALLED WITH RECEIVERS FASTENED TO THE SIDEWALL AND 2X6 SUB-FASCIA IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS

VINYL SIDING INSTALLED PER MANUFACTURERS INSTRUCTIONS OVER 3/8" RATED SHEATHING FASTENED WITH 15 GA X 1-1/2" STAPLE 3-1/4" O.C. EDGES AND 6" O.C. FIELD ON ENDWALLS & 5" O.C. EDGES AND 6" O.C. FIELD ON SIDEWALLS (TYP) ON ENDWALLS SHEATHING SHALL EXTEND CONTINUOUSLY FROM TOP OF TRUSS TOP CHORD TO BOTTOM OF EDGE JOIST(S) WITH 2X SPF BLOCKING BEHIND ALL HORIZONTAL SEAMS; ON SIDEWALLS SHEATHING SHALL EXTEND CONTINUOUSLY FROM TOP OF TOP PLATE TO BOTTOM PLATE WITH ALL EDGES SUPPORTED BY 2X SPF BLOCKING (TYP)

EXTERIOR WALL STUDS 2X4 SPF #2 MAX. 16" O.C. (SEE THE APPROVED STRUCTURAL PACKAGE FOR THE LOCATIONS AND WALL HEIGHTS WHICH WILL REQUIRE CLOSER SPACINGS AND/OR DOUBLE STUDS) (SEE THE APPROVED STRUCTURAL PACKAGE FOR ALTERNATIVE SPECS AND/OR FRAMING REQUIREMENTS AT OPENINGS)


FASTEN EXTERIOR WALLS TO EDGE JOIST(S) WITH #8X3" SCREW 8" O.C. (TYP EACH SIDEWALL AND ENDWALL)

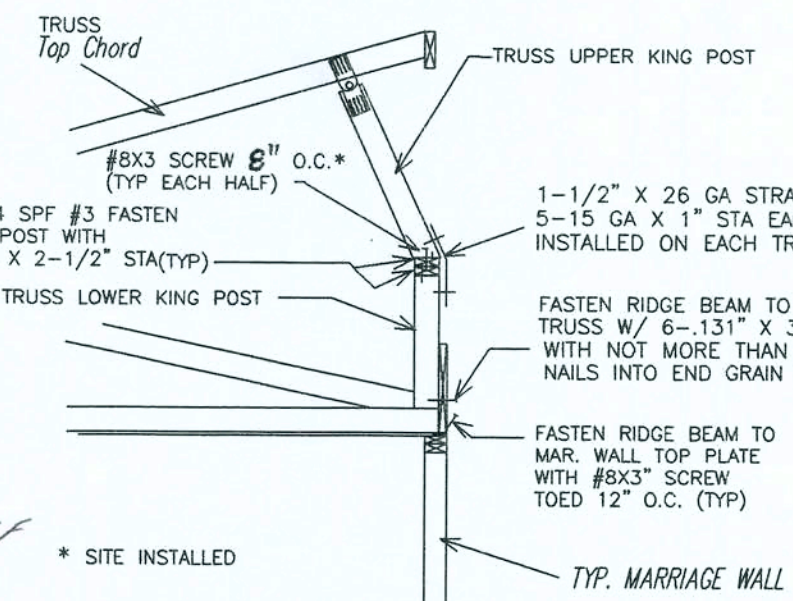


DETAIL A

CROSS SECTION

NTS

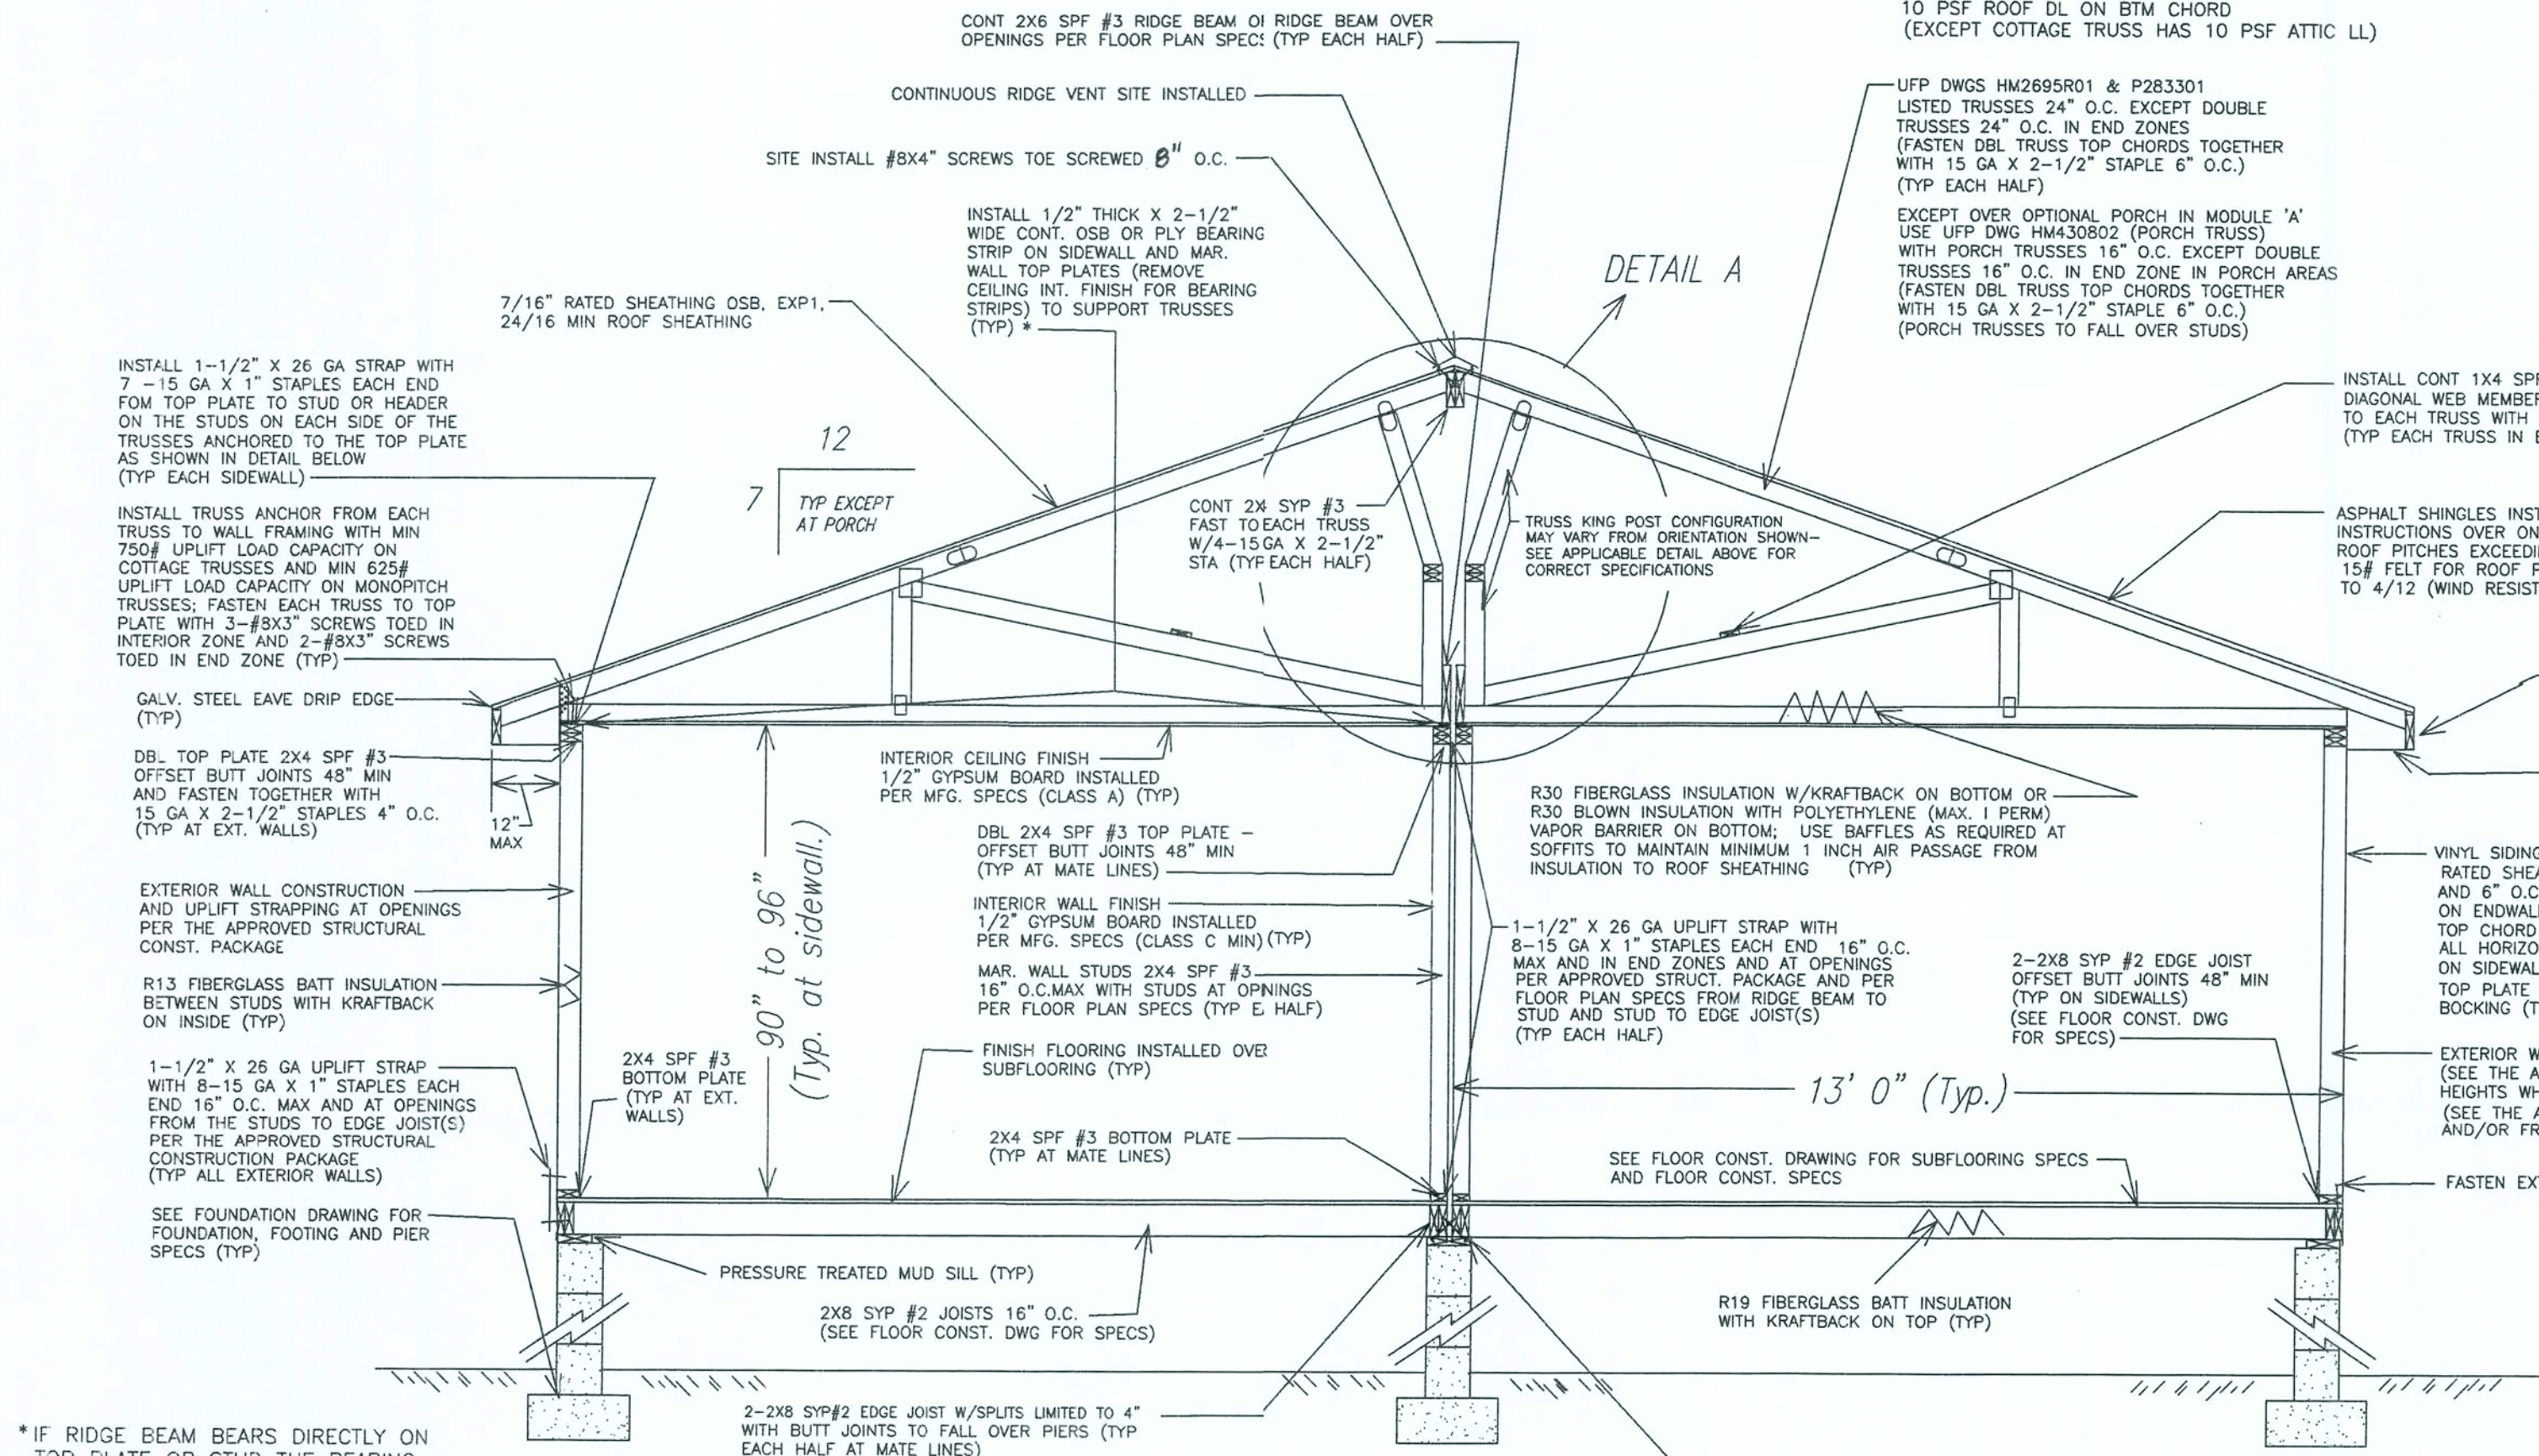



* IF RIDGE BEAM BEARS DIRECTLY ON TOP PLATE OR STUD THE BEARING STRIP MAY BE OMITTED.

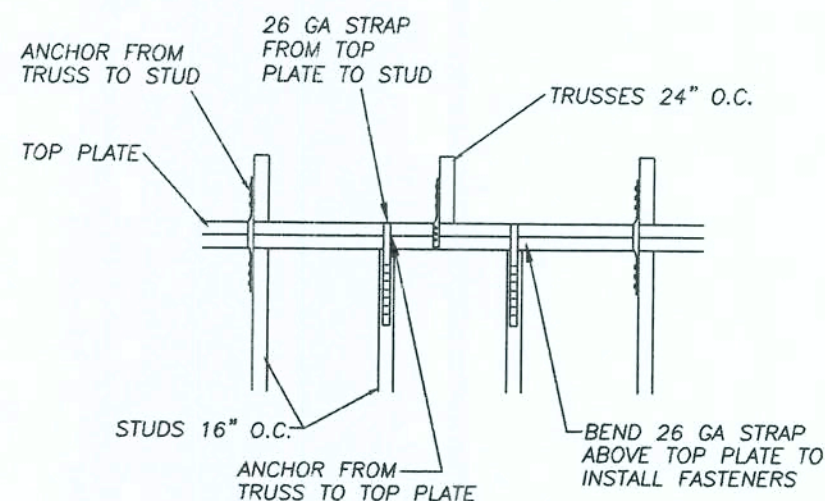

TRUSS ANCHORAGE DETAIL

2x6 SPF #3 splice plate fastened @ all ridge beam butt joints with 100% PVA glue and 3-rows 15 Ga x 2 1/2" staples 3" O.C. (Splice plate may be used as bearing stiffener.)

LUMBER AND/OR LVL RIDGE BEAM SPLICE DETAIL

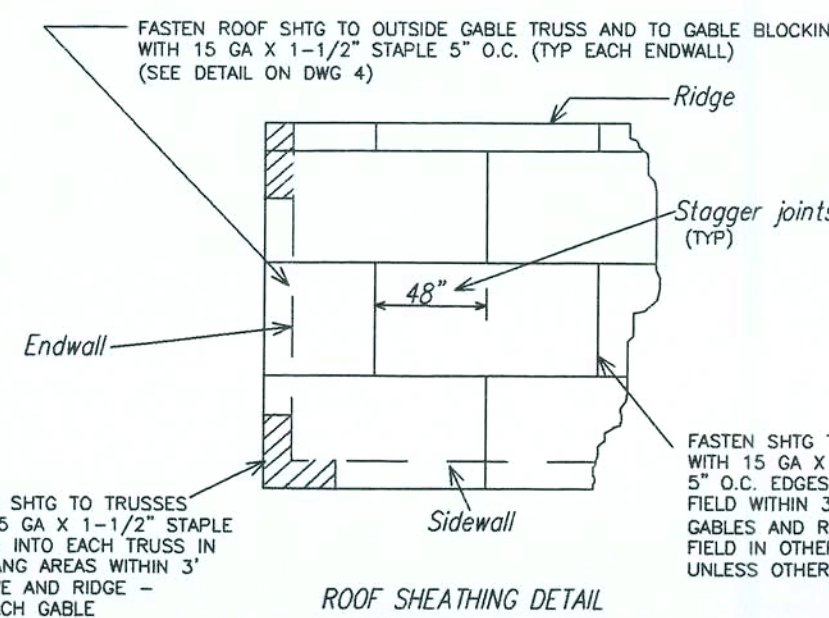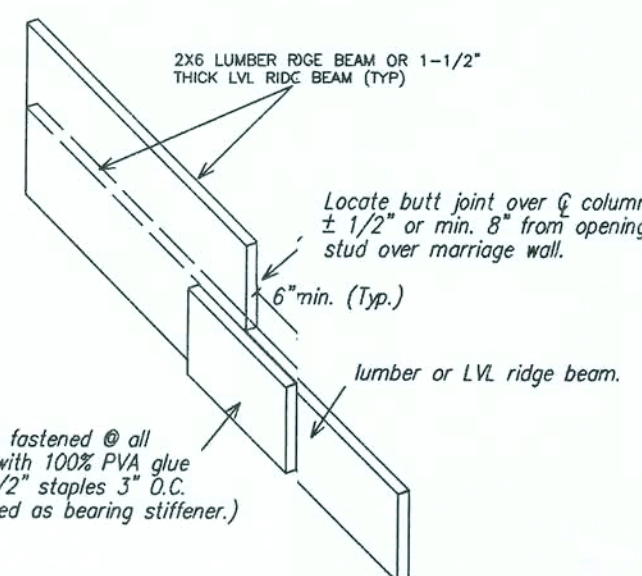

ROOF SHEATHING DETAIL

** FASTEN SHTG TO TRUSS INSTALLED OVER MATE LINE IN MODULES 'A' AND 'B' W/15 GA X 1-1/2" STAPLE 5" O.C.

LISTING AGENCY APPROVAL
These prints comply with the Florida Manufactured Building Act of 1979. Construction Code and adhere to the following criteria:
Const. Type: VB
Occupancy: R3
Allowable No. of Floors: 1
Wind Velocity: 130
Fire Rating of Ext. Walls: 0
Plan No.: 2036-0871F
Allow. Floor Load: 40
Approval Date: 10-24-05
Manufacturer: HWC
Approved for High Velocity Hurricane Zone: 7/10
HWC COA # 1026

* SITE INSTALLED

PRECISION MODULAR


309 E. 4TH STREET
OCILLA, GEORGIA 31774

DATE: 8/15/02	REVISIONS: 7/15/05 10/15/05	DRAWN BY: C.A. Leblanc
CODES: FBC	PLAN NO. PRE-14FL	SHEET 6 OF 6
LABELS: FL	MODEL: YORKSHIRE CROSS SECTION	
SCALE: NTS		
WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER		
33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167		

FOUNDATION NOTES:

1. FOUNDATION PLAN IS SHOWN AS TYPICAL STANDARD (FOR REFERENCE ONLY)
2. CONCRETE TO BE STANDARD WEIGHT CONCRETE (150 PCF) WITH A MINIMUM COMPRESSIVE STRENGTH EQUAL TO 2500 PSI @ 28 DAYS.
3. SOIL BEARING CAPACITY TO BE 2000 PSF MINIMUM (ASSUMED).
4. FOUNDATION WALL AND FOOTING SIZES ARE SUBJECT TO CHANGE DUE TO LOCAL CODES AND/OR SOIL CONDITIONS.
5. THE BOTTOM OF ALL FOOTINGS MUST BE BELOW THE FROST DEPTH AND BE A MIN. OF 12 INCHES BELOW THE NATURAL GRADE.
6. WHERE THE INTERIOR GROUND LEVEL IS BELOW THE OUTSIDE FINISH GRADE, ADEQUATE PRECAUTIONARY MEASURES SHALL BE TAKEN TO ASSURE POSITIVE DRAINAGE AT ALL TIMES.
7. ALL CONCRETE BLOCKS SHALL BE LAID IN TYPE "M" OR TYPE "S" MORTAR.
8. THE FOUNDATION ENCLOSURE MUST HAVE A MINIMUM OF 1 SQUARE FOOT OF NET VENT AREA FOR EACH 150 SQUARE FEET OF ENCLOSED CRAWL SPACE AREA AND MUST BE PROVIDED WITH A 18" X 24" MIN CRAWL SPACE ACCESS DOOR (SITE INSTALLED BY OTHERS, SUBJECT TO LOCAL BUILDING OFFICIAL APPROVAL). VENT OPENINGS MUST PROVIDE CROSS VENTILATION AND BE COVERED WITH CORROSION RESISTANT WIRE MESH OF NOT LESS THAN 1/4" OR MORE THAN 1/2".
9. INSTALL P.T. SYP LUMBER MUD SILLS ON ALL CONCRETE BLOCK PIERS.
10. THE CRAWL SPACE MUST HAVE A MINIMUM 18" CLEARANCE FROM THE GROUND TO THE BOTTOM OF THE JOISTS. THE CRAWL SPACE GROUND AND/OR FLOOR MUST BE COVERED WITH AN APPROVED VAPOR BARRIER.
11. ALL CONCRETE BLOCKS MUST COMPLY WITH ASTM C90 WITH A MINIMUM $f_m' = 2000$ PSI (USE STANDARD WEIGHT BLOCKS)
12. ALL REINFORCEMENT BARS SHALL COMPLY WITH ASTM A615, GRADE 60. REINFORCEMENT TO BE UNCOATED DEFORMED BARS (NO EPOXY). REINFORCEMENT BARS SHALL BE EQUALLY SPACED AND PLACED WITH 3 INCHES OF CLEARANCE (COVER) FROM THE BOTTOM OF THE FOOTING TO THE BOTTOM LAYER OF REBAR. ALL REBAR MUST BE INSTALLED WITH A MIN. 4 INCHES CLEARANCE FROM THE SIDES OF THE FOOTING. LAP ALL #4 BARS A MINIMUM OF 24 INCHES AT SPLICES AND LAP ALL #5 BARS A MINIMUM OF 30 INCHES AT SPLICES WITH ALL SPLICES OFF SET A MINIMUM OF 30 INCHES FROM ADJACENT SPLICES.
13. ALL FOUNDATION AND/OR PIER CONSTRUCTION MUST COMPLY WITH THE MINIMUM SPECIFICATIONS PROVIDED ON THIS DRAWING UNLESS THE SITE CONDITIONS PERMIT ALTERNATE METHODS AND/OR THE FOUNDATION HAS BEEN DESIGNED BY OTHERS AND APPROVED BY THE LOCAL BUILDING OFFICIAL.
14. TERMITE SHIELDS AND/OR OTHER INSECT PROTECTION TO BE SPECIFIED BY LOCAL DESIGNER


NOTE: THE CONTRACTOR MUST ADJUST THE FOUNDATION DIMENSIONS SPECIFIED ABOVE TO ACCOMMODATE FOR THE NORMAL GAPS WHICH OCCUR BETWEEN THE MODULES DURING SETUP.

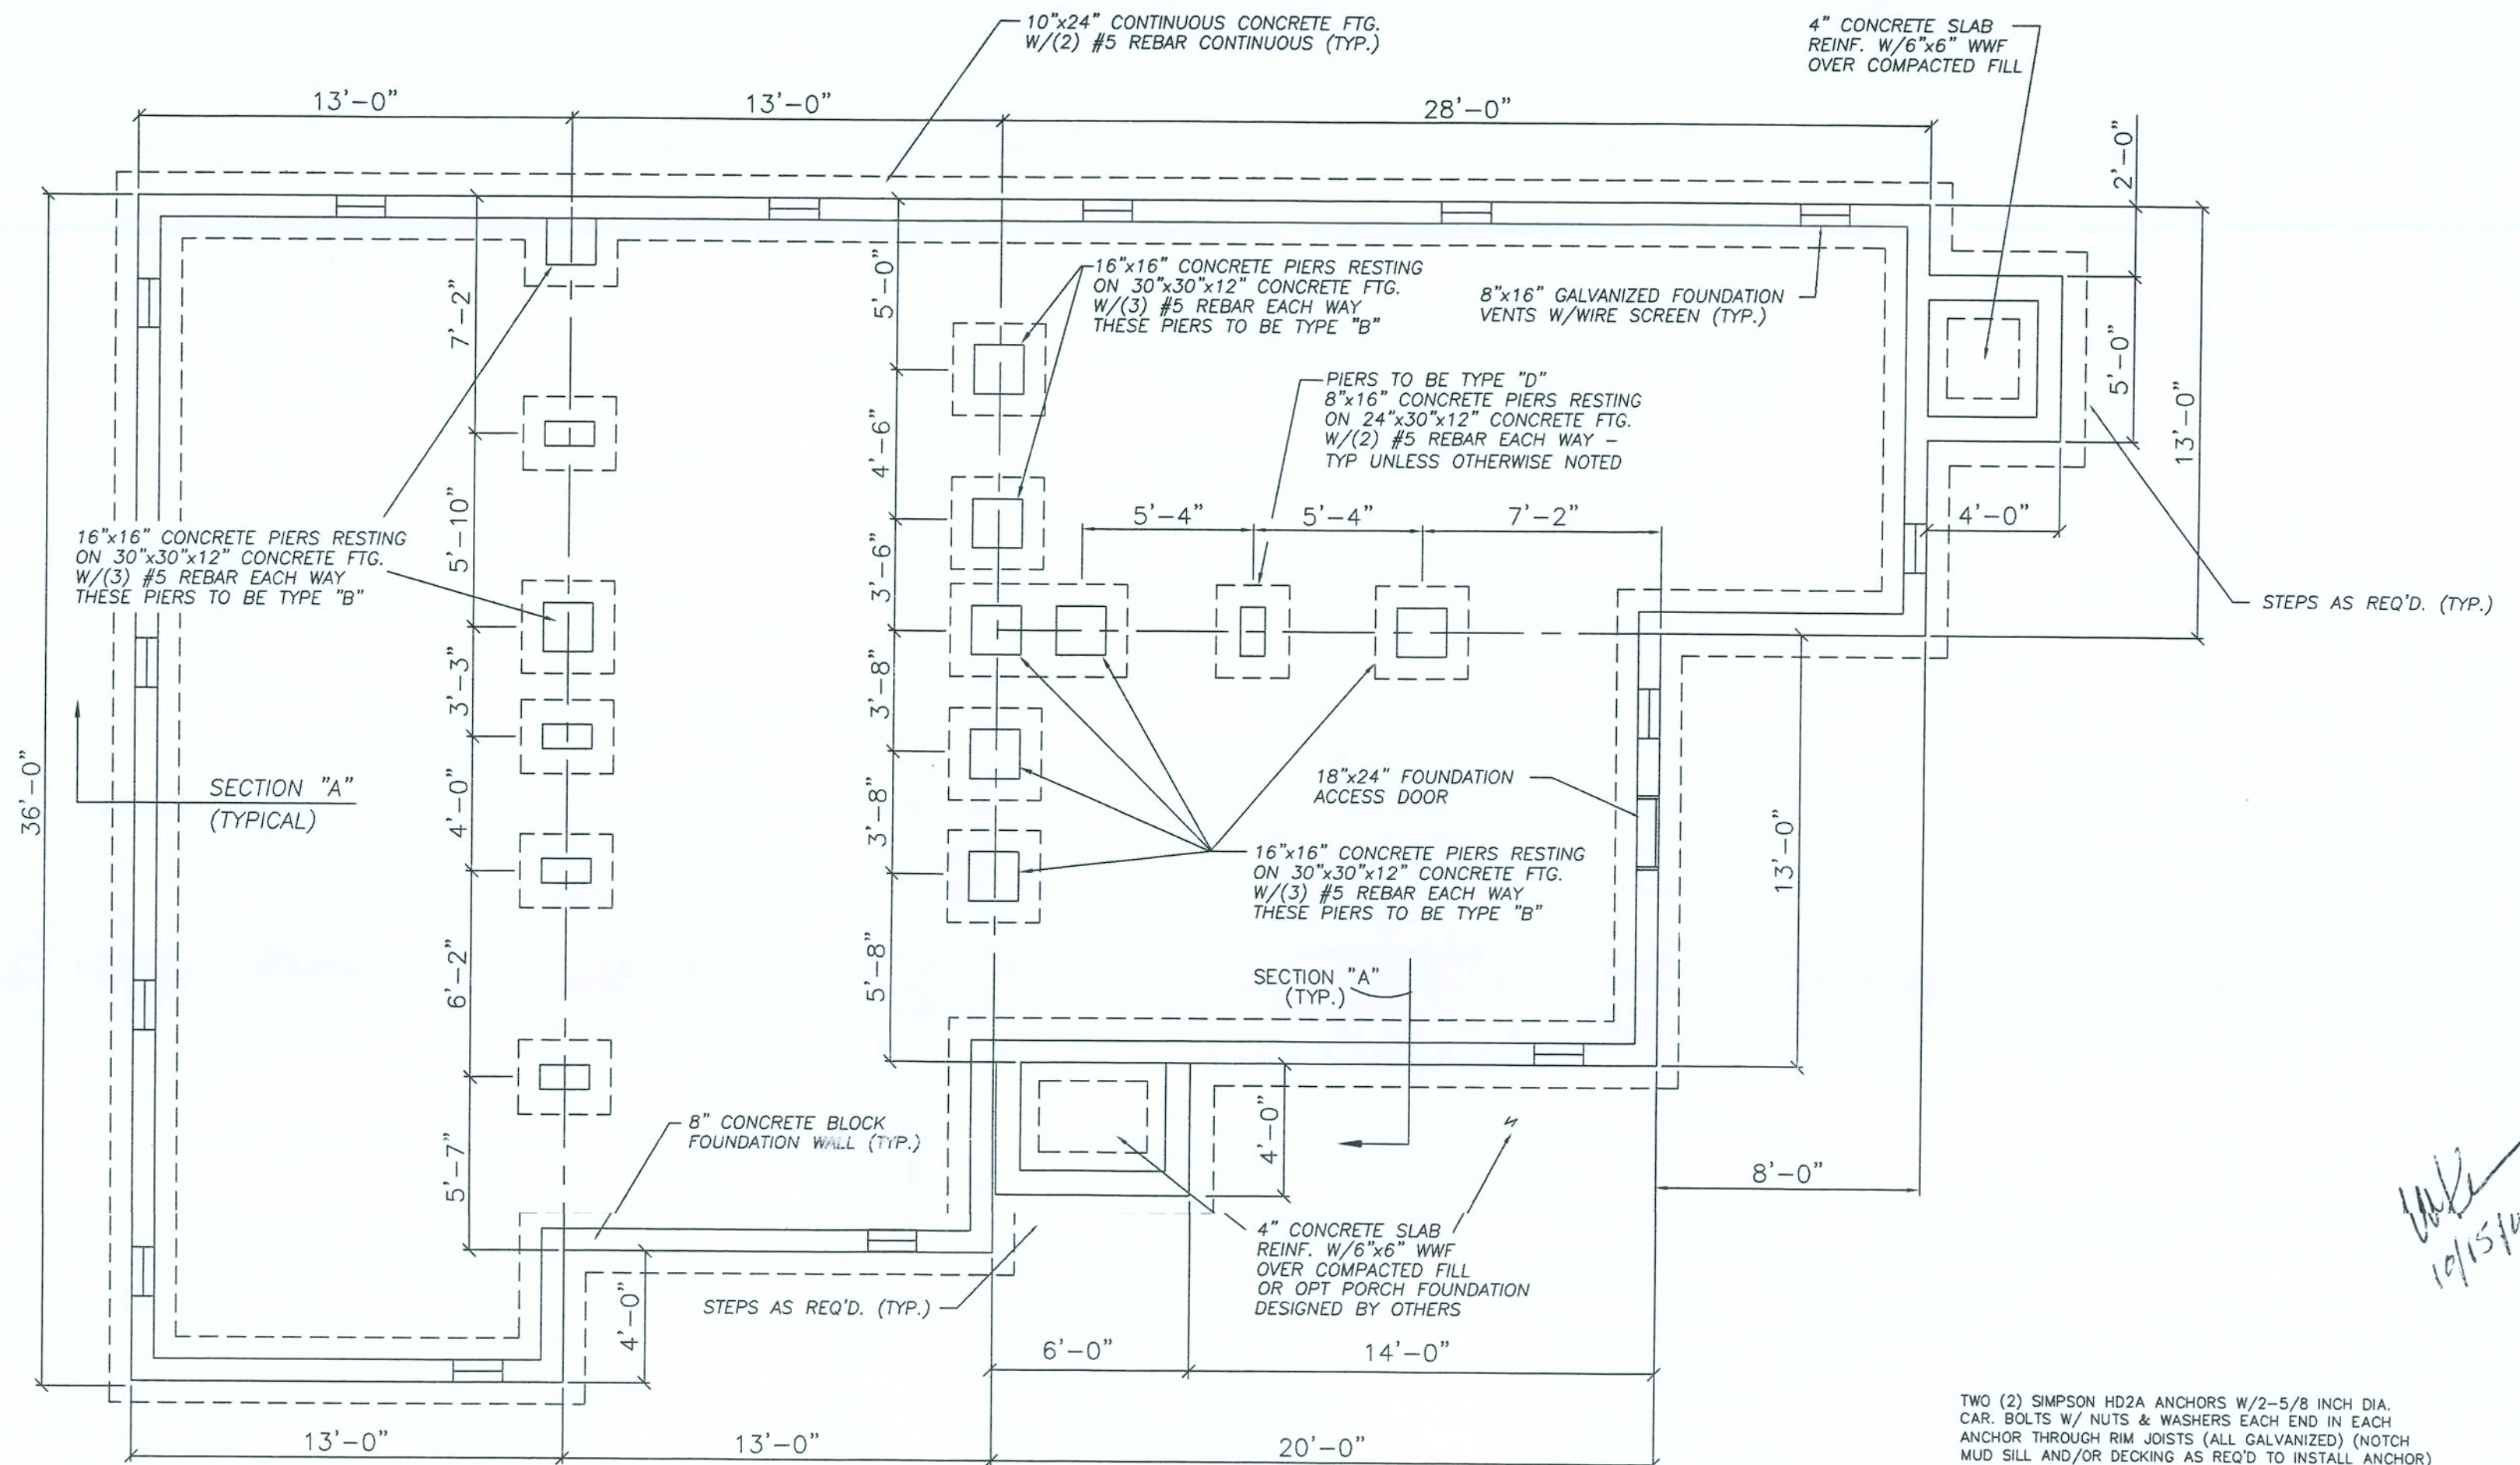


FRONT

CRAWL SPACE FOUNDATION


FOUNDATION DESIGNED FOR MAX. 130 MPH WIND SPEED (EXPB) PER 2004 FBC FOR MODEL 'YORKSHIRE' (PRE-14FL)

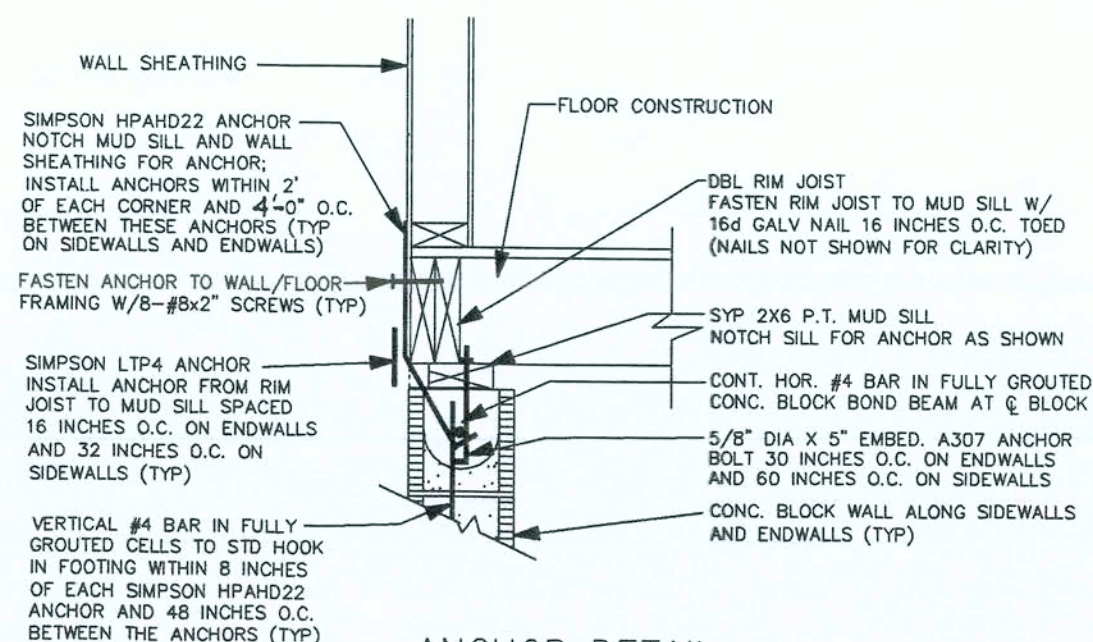


ANCHOR DETAIL
NTS

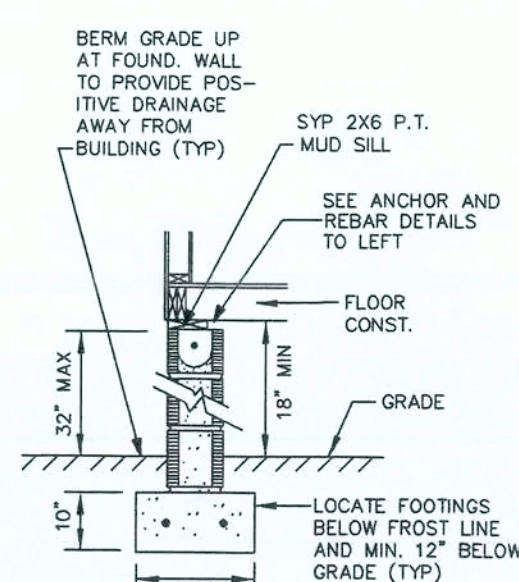


SECTION "A"
NTS

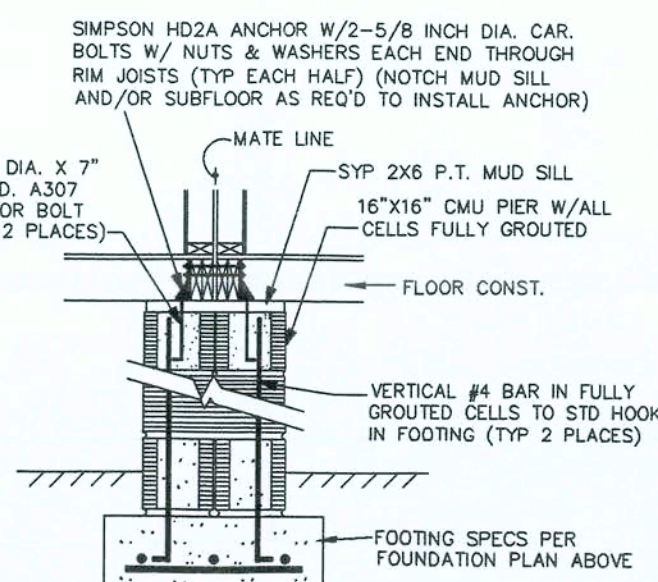

PIER TYPE "B"
NTS

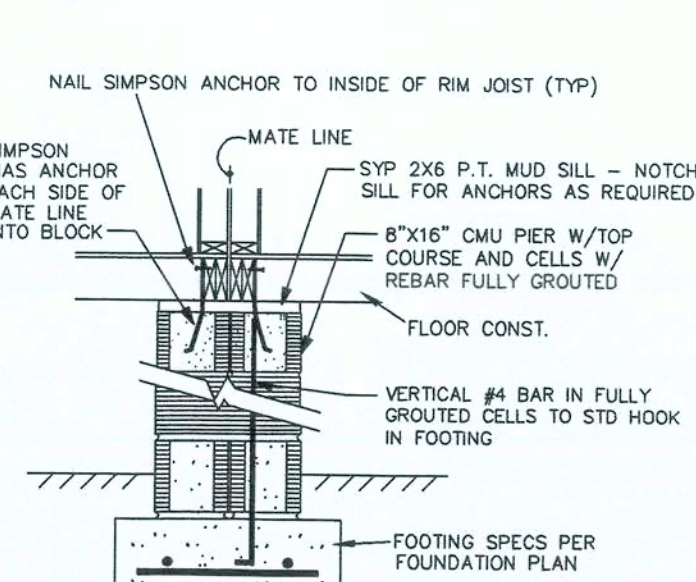

PIER TYPE "D"
NTS

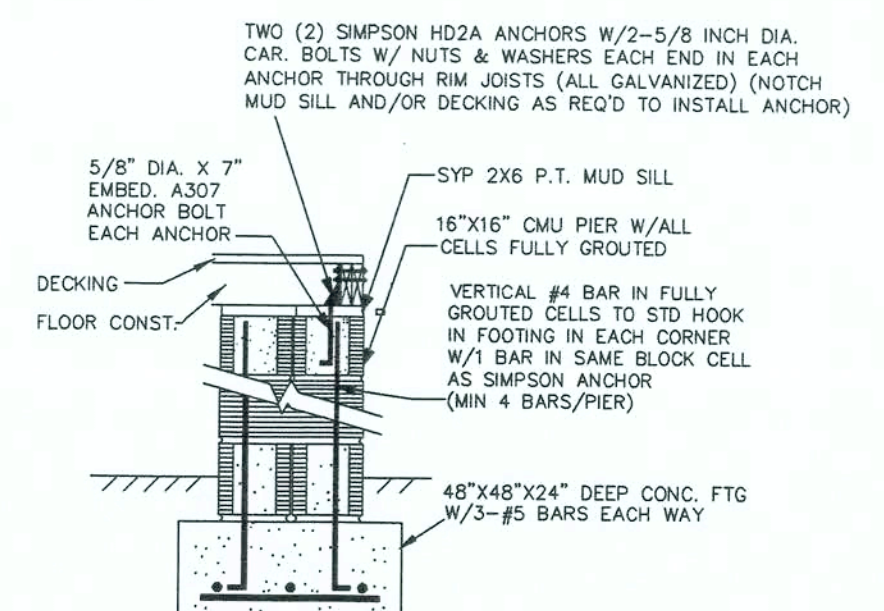

PIER TYPE "C"
NTS

PRECISION MODULAR

309 E. 4TH STREET
OCILLA, GEORGIA 31774

DATE: 8/15/02	REVISIONS: 7/12/05 10/15/05	DRAWN BY: C.A. LeBlanc
CODES: FBC	SCALE: NTS	PLAN NO. PRE-14FL
LABELS: FL	MODEL: YORKSHIRE CRAWL SPACE FOUNDATION	SHEET 1 OF 1
WILLIAM J. KALKER, JR., P.E. CONSULTING ENGINEER	33 ROCKWOOD LANE MONROE, CT 06468 (203) 261-1167	