

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Business and Professional Regulation - Residential Performance Method

Project Name: Lot 44 Mayfair Subdivision
 Street:
 City, State, Zip: Lake City, FL, 32055-
 Owner: TBA
 Design Location: FL, Gainesville

Builder Name: Trent Giebeig
 Permit Office: Columbia County
 Permit Number:
 Jurisdiction:

1. New construction or existing	New (From Plans)	
2. Single family or multiple family	Single-family	
3. Number of units, if multiple family	1	
4. Number of Bedrooms	3	
5. Is this a worst case?	No	
6. Conditioned floor area above grade (ft ²)	1726	
Conditioned floor area below grade (ft ²)	0	
7. Windows (144.0 sqft.)	Description	Area
a. U-Factor:	Dbl, U=0.55	144.00 ft ²
SHGC:	SHGC=0.50	
b. U-Factor:	N/A	ft ²
SHGC:		
c. U-Factor:	N/A	ft ²
SHGC:		
d. U-Factor:	N/A	ft ²
SHGC:		
Area Weighted Average Overhang Depth:		4.556 ft.
Area Weighted Average SHGC:		0.500
8. Floor Types (1726.0 sqft.)	Insulation	Area
a. Slab-On-Grade Edge Insulation	R=0.0	1726.00 ft ²
b. N/A	R=	ft ²
c. N/A	R=	ft ²

9. Wall Types (1527.0 sqft.)	Insulation	Area
a. Face Brick - Wood, Exterior	R=13.0	1367.00 ft ²
b. Frame - Wood, Adjacent	R=13.0	160.00 ft ²
c. N/A	R=	ft ²
d. N/A	R=	ft ²
10. Ceiling Types (1728.0 sqft.)	Insulation	Area
a. Under Attic (Vented)	R=30.0	1728.00 ft ²
b. N/A	R=	ft ²
c. N/A	R=	ft ²
11. Ducts		R ft ²
a. Sup: Attic, Ret: Attic, AH: Main		6 345.2

12. Cooling systems	kBtu/hr	Efficiency
a. Central Unit	30.0	SEER:15.00

13. Heating systems	kBtu/hr	Efficiency
a. Electric Heat Pump	30.0	HSPF:7.70

14. Hot water systems		
a. Electric		Cap: 50 gallons
		EF: 0.920

b. Conservation features	
None	

15. Credits	Pstat
-------------	-------

Glass/Floor Area: 0.083

Total Proposed Modified Loads: 28.30

Total Standard Reference Loads: 38.44

PASS

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.

PREPARED BY: Willie H. FilerDATE: 6/3/13

I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.

OWNER/AGENT: _____

DATE: _____

Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.



BUILDING OFFICIAL: _____

DATE: _____

- Compliance requires certification by the air handler unit manufacturer that the air handler enclosure qualifies as certified factory-sealed in accordance with 403.2.2.1.1.

- Compliance requires completion of a Florida Air Barrier and Insulation Inspection Checklist



PROJECT

Title: Lot 44 Mayfair Subdivision	Bedrooms: 3	Address Type: Lot Information
Building Type: User	Conditioned Area: 1726	Lot #: 44
Owner: TBA	Total Stories: 1	Block/SubDivision: Mayfair phase 3
# of Units: 1	Worst Case: No	PlatBook:
Builder Name: Trent Giebeig	Rotate Angle: 0	Street:
Permit Office: Columbia County	CrossVentilation:	County: Columbia
Jurisdiction:	Whole House Fan:	City, State, Zip: Lake City , FL , 32055-
Family Type: Single-family		
New/Existing: New (From Plans)		
Comment:		

CLIMATE

✓	Design Location	TMY Site	IECC Zone	Design Temp 97.5 %	Design Temp 2.5 %	Int Design Temp Winter	Int Design Temp Summer	Heating Degree Days	Design Moisture	Daily Temp Range
_____	FL, Gainesville	FL_GAINESVILLE_REGI	2	32	92	70	75	1305.5	51	Medium

BLOCKS

Number	Name	Area	Volume
1	Block1	1726	14671

SPACES

Number	Name	Area	Volume	Kitchen	Occupants	Bedrooms	Infil ID	Finished	Cooled	Heated
1	Main	1726	14671	Yes	1	3	1	Yes	Yes	Yes

FLOORS

✓	#	Floor Type	Space	Perimeter	R-Value	Area		Tile	Wood	Carpet
_____	1	Slab-On-Grade Edge Insulatio	Main	186 ft	0	1726 ft²	----	0.1	0.4	0.5

ROOF

✓	#	Type	Materials	Roof Area	Gable Area	Roof Color	Solar Absor.	SA Tested	Emitt	Emitt Tested	Deck Insul.	Pitch (deg)
_____	1	Hip	Composition shingles	1930 ft²	0 ft²	Medium	0.96	No	0.9	No	0	26.6

ATTIC

✓	#	Type	Ventilation	Vent Ratio (1 in)	Area	RBS	IRCC
_____	1	Full attic	Vented	300	1726 ft²	N	N

CEILING

✓	#	Ceiling Type	Space	R-Value	Area	Framing Frac	Truss Type
_____	1	Under Attic (Vented)	Main	30	1728 ft²	0.11	Wood

WALLS

✓ #	Ornt	Adjacent To	Wall Type	Space	Cavity R-Value	Width Ft	In	Height Ft	In	Area	Sheathing R-Value	Framing Fraction	Solar Absor.	Below Grade%
1	N	Exterior	Face Brick - Wood	Main	13	30	1	8		240.6666	0	0.23	0.75	0
2	W	Exterior	Face Brick - Wood	Main	13	39	7	8		316.6666	0	0.23	0.75	0
3	N	Exterior	Face Brick - Wood	Main	13	5		8		40 ft²	0	0.23	0.75	0
4	W	Exterior	Face Brick - Wood	Main	13	14	1	8		112.6666	0	0.23	0.75	0
5	S	Exterior	Face Brick - Wood	Main	13	35	1	8		280.6666	0	0.23	0.75	0
6	E	Exterior	Face Brick - Wood	Main	13	14	1	8		112.6666	0	0.23	0.75	0
7	N	Exterior	Face Brick - Wood	Main	13	4	8	8		37.33333	0	0.23	0.75	0
8	E	Exterior	Face Brick - Wood	Main	13	7	9	9	4	72.33333	0	0.23	0.75	0
9	S	Exterior	Face Brick - Wood	Main	13	4	8	9	4	43.55555	0	0.23	0.75	0
10	E	Exterior	Face Brick - Wood	Main	13	11	10	9	4	110.4444	0	0.23	0.75	0
11	E	Garage	Frame - Wood	Main	13	20		8		160 ft²		0.23	0.75	0

DOORS

✓ #	Ornt	Door Type	Space	Storms	U-Value	Width Ft	In	Height Ft	In	Area
1	E	Insulated	Main	None	0.460000	4	1	6	8	27.22222
2	E	Wood	Main	None	0.460000	4	1	6	8	16.66666

WINDOWS

Orientation shown is the entered, Proposed orientation.

✓ #	Ornt	Wall ID	Frame	Panes	NFRC	U-Factor	SHGC	Area	Overhang Depth	Separation	Int Shade	Screening
1	N	1	Metal	Double (Clear)	Yes	0.55	0.5	5 ft²	1 ft 6 in	1 ft 0 in	Drapes/blinds	None
2	W	2	Metal	Double (Clear)	Yes	0.55	0.5	30 ft²	1 ft 6 in	1 ft 0 in	Drapes/blinds	None
3	W	2	Metal	Double (Clear)	Yes	0.55	0.5	9 ft²	1 ft 6 in	1 ft 0 in	Drapes/blinds	None
4	W	2	Metal	Double (Clear)	Yes	0.55	0.5	40 ft²	12 ft 6 in	1 ft 0 in	Drapes/blinds	None
5	W	4	Metal	Double (Clear)	Yes	0.55	0.5	15 ft²	1 ft 6 in	1 ft 0 in	Drapes/blinds	None
6	E	6	Metal	Double (Clear)	Yes	0.55	0.5	15 ft²	1 ft 6 in	1 ft 0 in	Drapes/blinds	None
7	E	10	Metal	Double (Clear)	Yes	0.55	0.5	30 ft²	1 ft 6 in	1 ft 0 in	Drapes/blinds	None

GARAGE

✓ #	Floor Area	Ceiling Area	Exposed Wall Perimeter	Avg. Wall Height	Exposed Wall Insulation
1	440 ft²	440 ft²	64 ft	8 ft	1

INFILTRATION

#	Scope	Method	SLA	CFM 50	ELA	EqLA	ACH	ACH 50
1	Wholehouse	BestGuess	0.000500	2263.66	124.272	233.711	0.38500	9.25770

HEATING SYSTEM									
✓	#	System Type	Subtype	Efficiency	Capacity	Block	Ducts		
✓	1	Electric Heat Pump	None	HSPF: 7.7	30 kBtu/hr	1	sys#1		

COOLING SYSTEM									
✓	#	System Type	Subtype	Efficiency	Capacity	Air Flow	SHR	Block	Ducts
✓	1	Central Unit	Split	SEER: 15	30 kBtu/hr	900 cfm	0.75	1	sys#1

HOT WATER SYSTEM									
✓	#	System Type	SubType	Location	EF	Cap	Use	SetPnt	Conservation
✓	1	Electric	None	Garage	0.92	50 gal	60 gal	120 deg	None

SOLAR HOT WATER SYSTEM									
✓	FSEC Cert #	Company Name	System Model #	Collector Model #	Collector Area	Storage Volume	FEF		
✓	None	None			ft²				

DUCTS														
✓	#	--- Supply ---			--- Return ---		Leakage Type	Air Handler	CFM 25	Percent Leakage	QN	RLF	HVAC # Heat	Cool
		Location	R-Value	Area	Location	Area								
✓	1	Attic	6	345.2 ft	Attic	86.3 ft²	Default Leakage	Main	(Default)	(Default) %			1	1

TEMPERATURES														
Programable Thermostat: Y						Ceiling Fans:								
Cooling	Heating	Venting	<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec
			<input checked="" type="checkbox"/> Jan	<input checked="" type="checkbox"/> Feb	<input checked="" type="checkbox"/> Mar	<input checked="" type="checkbox"/> Apr	<input checked="" type="checkbox"/> May	<input checked="" type="checkbox"/> Jun	<input checked="" type="checkbox"/> Jul	<input checked="" type="checkbox"/> Aug	<input checked="" type="checkbox"/> Sep	<input checked="" type="checkbox"/> Oct	<input checked="" type="checkbox"/> Nov	<input checked="" type="checkbox"/> Dec

Thermostat Schedule: HERS 2006 Reference		Hours											
Schedule Type		1	2	3	4	5	6	7	8	9	10	11	12
Cooling (WD)	AM	78	78	78	78	78	78	78	78	80	80	80	80
	PM	80	80	78	78	78	78	78	78	78	78	78	78
Cooling (WEH)	AM	78	78	78	78	78	78	78	78	78	78	78	78
	PM	78	78	78	78	78	78	78	78	78	78	78	78
Heating (WD)	AM	66	66	66	66	66	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	66	66
Heating (WEH)	AM	66	66	66	66	66	68	68	68	68	68	68	68
	PM	68	68	68	68	68	68	68	68	68	68	66	66

MECHANICAL VENTILATION							
Type	Supply CFM	Exhaust CFM	Fan Watts	HRV	Heating System	Run Time	Cooling System
None	0	0		0	1 - Electric Heat Pump	0%	1 - Central Unit

Florida Code Compliance Checklist

Florida Department of Business and Professional Regulations
Residential Whole Building Performance Method

ADDRESS:

Lake City, FL, 32055-

PERMIT #:

MANDATORY REQUIREMENTS SUMMARY - See individual code sections for full details.

COMPONENT	SECTION	SUMMARY OF REQUIREMENT(S)	CHECK
Air leakage	402.4	To be caulked, gasketed, weatherstripped or otherwise sealed. Recessed lighting IC-rated as meeting ASTM E 283. Windows and doors = 0.30 cfm/sq.ft. Testing or visual inspection required. Fireplaces: gasketed doors & outdoor combustion air. Must complete envelope leakage report or visually verify Table 402.4.2.	✓
Thermostat & controls	403.1	At least one thermostat shall be provided for each separate heating and cooling system. Where forced-air furnace is primary system, programmable thermostat is required. Heat pumps with supplemental electric heat must prevent supplemental heat when compressor can meet the load.	✓
Ducts	403.2.2	All ducts, air handlers, filter boxes and building cavities which form the primary air containment passageways for air distribution systems shall be considered ducts or plenum chambers, shall be constructed and sealed in accordance with Section 503.2.7.2 of this code.	✓
	403.3.3	Building framing cavities shall not be used as supply ducts.	
Water heaters	403.4	Heat trap required for vertical pipe risers. Comply with efficiencies in Table 403.4.3.2. Provide switch or clearly marked circuit breaker (electric) or shutoff (gas). Circulating system pipes insulated to = R-2 + accessible manual OFF switch.	✓
Mechanical ventilation	403.5	Homes designed to operate at positive pressure or with mechanical ventilation systems shall not exceed the minimum ASHRAE 62 level. No make-up air from attics, crawlspaces, garages or outdoors adjacent to pools or spas.	✓
Swimming Pools & Spas	403.9	Pool pumps and pool pump motors with a total horsepower (HP) of = 1 HP shall have the capability of operating at two or more speeds. Spas and heated pools must have vapor-retardant covers or a liquid cover or other means proven to reduce heat loss except if 70% of heat from site-recovered energy. Off/timer switch required. Gas heaters minimum thermal efficiency=78% (82% after 4/16/13). Heat pump pool heaters minimum COP= 4.0.	N/A
Cooling/heating equipment	403.6	Sizing calculation performed & attached. Minimum efficiencies per Tables 503.2.3. Equipment efficiency verification required. Special occasion cooling or heating capacity requires separate system or variable capacity system. Electric heat >10kW must be divided into two or more stages.	✓
Ceilings/knee walls	405.2.1	R-19 space permitting.	✓

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 74

The lower the EnergyPerformance Index, the more efficient the home.

, Lake City, FL, 32055-

1. New construction or existing	New (From Plans)		9. Wall Types	Insulation	Area
2. Single family or multiple family	Single-family		a. Face Brick - Wood, Exterior	R=13.0	1367.00 ft ²
3. Number of units, if multiple family	1		b. Frame - Wood, Adjacent	R=13.0	160.00 ft ²
4. Number of Bedrooms	3		c. N/A	R=	ft ²
5. Is this a worst case?	No		d. N/A	R=	ft ²
6. Conditioned floor area (ft ²)	1726		10. Ceiling Types	Insulation	Area
7. Windows**	Description	Area	a. Under Attic (Vented)	R=30.0	1728.00 ft ²
a. U-Factor:	DbI, U=0.55	144.00 ft ²	b. N/A	R=	ft ²
SHGC:	SHGC=0.50		c. N/A	R=	ft ²
b. U-Factor:	N/A	ft ²	11. Ducts	R	ft ²
SHGC:			a. Sup: Attic, Ret: Attic, AH: Main	6	345.2
c. U-Factor:	N/A	ft ²	12. Cooling systems	kBtu/hr	Efficiency
SHGC:			a. Central Unit	30.0	SEER:15.00
d. U-Factor:	N/A	ft ²	13. Heating systems	kBtu/hr	Efficiency
SHGC:			a. Electric Heat Pump	30.0	HSPF:7.70
Area Weighted Average Overhang Depth:	4.556 ft.		14. Hot water systems	Cap: 50 gallons	
Area Weighted Average SHGC:	0.500		a. Electric	EF: 0.92	
8. Floor Types	Insulation	Area	b. Conservation features		
a. Slab-On-Grade Edge Insulation	R=0.0	1726.00 ft ²	None		
b. N/A	R=	ft ²	15. Credits		Pstat
c. N/A	R=	ft ²			

I certify that this home has complied with the Florida Energy Efficiency Code for Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: _____ City/FL Zip: _____



*Note: This is not a Building Energy Rating. If your Index is below 70, your home may qualify for energy efficient mortgage (EEM) incentives if you obtain a Florida EnergyGauge Rating. Contact the EnergyGauge Hotline at (321) 638-1492 or see the EnergyGauge web site at energygauge.com for information and a list of certified Raters. For information about the Florida Building Code, Energy Conservation, contact the Florida Building Commission's support staff.

**Label required by Section 303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.

TABLE 402.4.2

AIR BARRIER AND INSULATION INSPECTION COMPONENT CRITERIA

Project Name: Lot 44 Mayfair Subdivision Street: City, State, Zip: Lake City, FL, 32055- Owner: TBA Design Location: FL, Gainesville			Builder Name: Trent Giebeig Permit Office: Columbia County Permit Number: Jurisdiction:		
COMPONENT	CRITERIA				CHECK
Air barrier and thermal barrier	Exterior thermal envelope insulation for framed walls is installed in substantial contact and continuous alignment with building envelope air barrier. Breaks or joints in the air barrier are filled or repaired. Air-permeable insulation is not used as a sealing material. Air-permeable insulation is inside of an air barrier.				
Ceiling/attic	Air barrier in any dropped ceiling/soffit is substantially aligned with insulation and any gaps are sealed. Attic access (except unvented attic), knee wall door, or drop down stair is sealed.				
Walls	Corners and headers are insulated. Junction of foundation and sill plate is sealed.				
Windows and doors	Space between window/door jambs and framing is sealed.				
Rim joists	Rim joists are insulated and include an air barrier.				
Floors (including above-garage and cantilevered floors)	Insulation is installed to maintain permanent contact with underside of subfloor decking. Air barrier is installed at any exposed edge of insulation.				
Crawl space walls	Insulation is permanently attached to walls. Exposed earth in unvented crawl spaces is covered with Class I vapor retarder with overlapping joints taped.				
Shafts, penetrations	Duct shafts, utility penetrations, knee walls and flue shafts opening to exterior or unconditioned space are sealed.				
Narrow cavities	Batts in narrow cavities are cut to fit, or narrow cavities are filled by sprayed/blown insulation.				
Garage separation	Air sealing is provided between the garage and conditioned spaces.				
Recessed lighting	Recessed light fixtures are air tight, IC rated, and sealed to drywall. Exception—fixtures in conditioned space.				
Plumbing and wiring	Insulation is placed between outside and pipes. Batt insulation is cut to fit around wiring and plumbing, or sprayed/blown insulation extends behind piping and wiring.				
Shower/tub on exterior wall	Showers and tubs on exterior walls have insulation and an air barrier separating them from the exterior wall.				
Electrical/phone box on	Air barrier extends behind boxes or air sealed-type boxes are installed.				
Common wall	Air barrier is installed in common wall between dwelling units.				
HVAC register boots	HVAC register boots that penetrate building envelope are sealed to subfloor or drywall.				
Fireplace	Fireplace walls include an air barrier.				

Residential System Sizing Calculation

Summary

TBA

Project Title:
Lot 44 Mayfair Subdivision

Lake City, FL 32055-


6/2/2013

Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(152 ft.) Temp Range(M)			
Humidity data: Interior RH (50%) Outdoor wet bulb (77F) Humidity difference(54gr.)			
Winter design temperature(MJ8 99%)	33 F	Summer design temperature(MJ8 99%)	92 F
Winter setpoint	70 F	Summer setpoint	75 F
Winter temperature difference	37 F	Summer temperature difference	17 F
Total heating load calculation	27881 Btuh	Total cooling load calculation	29363 Btuh
Submitted heating capacity	% of calc Btuh	Submitted cooling capacity	% of calc Btuh
Total (Electric Heat Pump)	107.6 30000	Sensible (SHR = 0.75)	109.2 22500
Heat Pump + Auxiliary(0.0kW)	107.6 30000	Latent	85.7 7500
		Total (Electric Heat Pump)	102.2 30000

WINTER CALCULATIONS

Winter Heating Load (for 1726 sqft)


Load component		Load	
Window total	144 sqft	2930	Btuh
Wall total	1339 sqft	3999	Btuh
Door total	44 sqft	747	Btuh
Ceiling total	1728 sqft	2036	Btuh
Floor total	1726 sqft	8121	Btuh
Infiltration	151 cfm	6104	Btuh
Duct loss		3946	Btuh
Subtotal		27881	Btuh
Ventilation	0 cfm	0	Btuh
TOTAL HEAT LOSS		27881	Btuh

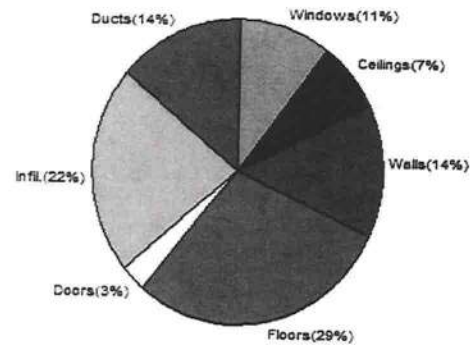

SUMMER CALCULATIONS

Summer Cooling Load (for 1726 sqft)

Load component		Load	
Window total	144 sqft	5868	Btuh
Wall total	1339 sqft	1551	Btuh
Door total	44 sqft	565	Btuh
Ceiling total	1728 sqft	2311	Btuh
Floor total		0	Btuh
Infiltration	113 cfm	2102	Btuh
Internal gain		3630	Btuh
Duct gain		4584	Btuh
Sens. Ventilation	0 cfm	0	Btuh
Blower Load		0	Btuh
Total sensible gain		20612	Btuh
Latent gain(ducts)		1023	Btuh
Latent gain(infiltration)		4128	Btuh
Latent gain(ventilation)		0	Btuh
Latent gain(internal/occupants/other)		3600	Btuh
Total latent gain		8751	Btuh
TOTAL HEAT GAIN		29363	Btuh

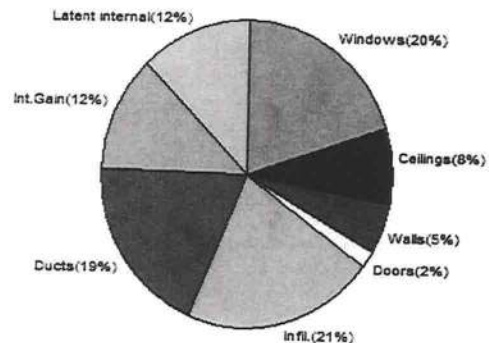

8th Edition

EnergyGauge® System Sizing

PREPARED BY: _____

DATE: _____