

PHOTOVOLTAIC ROOF MOUNT SYSTEM

24 MODULES-ROOF MOUNTED - 9.960 kW DC, 7.600 kW AC

251 IRENE LN, LAKE CITY, FL 32055



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

PROJECT DATA

PROJECT ADDRESS: 251 IRENE LN, LAKE CITY, FL 32055

OWNER: CHARLES DOWNING

CONTRACTOR: LUNEX POWER, 4721 N GRADY AVE TAMPA FL 33614 PHONE: 813-540-8807

DESIGNER: ESR

SCOPE: 9.960 KW DC ROOF MOUNT SOLAR PV SYSTEM WITH 24 TRINA SOLAR: TSM-NE09RC.05 415W PV MODULES WITH 24 SOLAREEDGE: S440 POWER OPTIMIZERS 01 SOLAREEDGE: SE7600H-USMNUBL15 (DOMESTIC) INVERTER

AUTHORITIES HAVING JURISDICTION:
BUILDING: COLUMBIA COUNTY
ZONING: COLUMBIA COUNTY
UTILITY: FPL

SHEET INDEX

PV-1	COVER SHEET
PV-2	SITE PLAN
PV-3	ROOF PLAN & MODULES
PV-4	ELECTRICAL PLAN
PV-5	STRUCTURAL DETAIL
PV-6	ELECTRICAL LINE DIAGRAM
PV-7	WIRING CALCULATIONS
PV-8	LABELS
PV-9	PLACARD
PV-10	OPTIMIZER CHART
PV-11+	EQUIPMENT SPECIFICATIONS

GENERAL NOTES

- ALL COMPONENTS ARE UL LISTED AND CEC CERTIFIED, WHERE WARRANTED.
- THE SOLAR PV SYSTEM WILL BE INSTALLED IN ACCORDANCE WITH ARTICLE 690 OF THE NEC 2020.
- THE UTILITY INTERCONNECTION APPLICATION MUST BE APPROVED AND PV SYSTEM INSPECTED PRIOR TO PARALLEL OPERATION.
- ALL CONDUCTORS OF A CIRCUIT, INCLUDING THE EGC, MUST BE INSTALLED IN THE SAME RACEWAY, OR CABLE, OR OTHERWISE RUN WITH THE PV ARRAY CIRCUIT CONDUCTORS WHEN THEY LEAVE THE VICINITY OF THE PV ARRAY.
- WHERE METALLIC CONDUIT CONTAINING DC CONDUCTORS IS USED INSIDE THE BUILDING, IT SHALL BE IDENTIFIED AS "CAUTION: SOLAR CIRCUIT" EVERY 10FT.
- HEIGHT OF THE AC DISCONNECT SHALL NOT EXCEED 6'-7" PER NEC CODE 240.24.
- A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH NEC 2020 690.47 AND 250.50 THROUGH 60 AND 250-166 SHALL BE PROVIDED. PER NEC GROUNDING ELECTRODE SYSTEM OF EXISTING BUILDING MAY BE USED AND BONDED TO THE SERVICE ENTRANCE. IF EXISTING SYSTEM IS INACCESSIBLE OR INADEQUATE A SUPPLEMENTAL GROUNDING ELECTRODE WILL BE USED AT THE INVERTER LOCATION CONSISTING OF A UL LISTED 8 FT. GROUND ROD WITH ACORN CLAMP. GROUNDING ELECTRODE CONDUCTORS SHALL BE NO LESS THAN #8 AWG AND NO LARGER THAN #6 AWG COPPER AND BONDED TO THE EXISTING GROUNDING ELECTRODE TO PROVIDE FOR A COMPLETE SYSTEM.
- PHOTOVOLTAIC MODULES ARE TO BE CONSIDERED NON-COMBUSTIBLE.
- PHOTOVOLTAIC INSTALLATION WILL NOT OBSTRUCT ANY PLUMBING. MECHANICAL, OR BUILDING ROOF VENTS.
- ALL WIRING MUST BE PROPERLY SUPPORTED BY DEVICES OR MECHANICAL MEANS DESIGNED AND LISTED FOR SUCH USE. WIRING MUST BE PERMANENTLY AND COMPLETELY HELD OFF THE ROOF SURFACE.
- ALL SIGNAGE TO BE PLACED IN ACCORDANCE WITH THE LOCAL BUILDING CODE. IF EXPOSED TO SUNLIGHT, IT SHALL BE UV RESISTANT. ALL PLAQUES AND SINAGE WILL BE INSTALLED AS REQUIRED BY THE NEC AND AHJ.
- INVERTER(S) USED IN UNGROUNDED SYSTEM SHALL BE UL 1741 LISTED.
- THE INSTALLATION OF EQUIPMENT AND ALL ASSOCIATED WIRING AND INTERCONNECTION SHALL BE PERFORMED ONLY BY QUALIFIED PERSONS [NEC 690.4(C)]
- ALL OUTDOOR EQUIPMENT SHALL BE NEMA 3R RATED (OR BETTER), INCLUDING ALL ROOF MOUNTED TRANSITION BOXES AND SWITCHES.
- ALL EQUIPMENT SHALL BE PROPERLY GROUNDED AND BONDED IN ACCORDANCE WITH NEC ARTICLE 250.
- SYSTEM GROUNDING SHALL BE IN ACCORDANCE WITH NEC 690.41.
- PV SYSTEM CIRCUITS INSTALLED ON OR IN BUILDINGS SHALL INCLUDE A RAPID SHUTDOWN FUNCTION IN ACCORDANCE WITH NEC 690.12
- DISCONNECTING MEANS SHALL BE LOCATED IN A VISIBLE, READILY ACCESSIBLE LOCATION WITHIN THE PV SYSTEM EQUIPMENT OR A MAXIMUM OF 10 FEET AWAY FROM THE SYSTEM [NEC 690.13(A)]
- ALL WIRING METHODS SHALL BE IN ACCORDANCE WITH NEC 690.31
- WORK CLEARANCES AROUND ELECTRICAL EQUIPMENT WILL BE MAINTAINED PER NEC 110.26(A)(1), 110.26(A)(2) AND 110.26(A)(3).
- ROOFTOP MOUNTED PHOTOVOLTAIC PANELS AND MODULES SHALL BE TESTED, LISTED & IDENTIFIED IN ACCORDANCE WITH UL1703
- ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT EXPANSION JOINTS AND ANCHOR CONDUIT RUNS AS REQUIRED PER NEC.

VICINITY MAP



HOUSE PHOTO



CODE REFERENCES


PROJECT TO COMPLY WITH THE FOLLOWING:

FLORIDA RESIDENTIAL CODE, 8TH EDITION 2023 (FRC)
FLORIDA PLUMBING CODE, 8TH EDITION 2023 (FPC)
FLORIDA BUILDING CODE, 8TH EDITION 2023 EDITION (FBC)
FLORIDA MECHANICAL CODE, 8TH EDITION 2023 (FMC)
2020 NATIONAL ELECTRICAL CODE
FLORIDA FIRE PREVENTION CODE, 8TH EDITION 2023 (FFPC)

Andrew D. Leone
Digitally signed by Andrew D. Leone
Date: 2025.03.05 15:46:38 -05'00'

REVISIONS

DESCRIPTION	DATE	REV

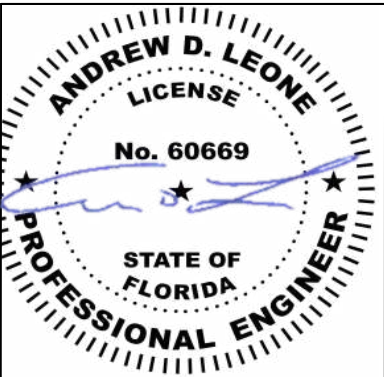

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME

COVER SHEET

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-1

PROFESSIONAL ENGINEER SEAL

This item has been digitally signed and sealed by Andrew D. Leone on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

PROJECT DESCRIPTION:

24 X TRINA SOLAR: TSM-NE09RC.05 415W PV MODULES
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES
DC SYSTEM SIZE: 24 x 415 = 9.960KW DC
AC SYSTEM SIZE: 01 x 7.600 = 7.600KW AC

EQUIPMENT SUMMARY
24 TRINA SOLAR: TSM-NE09RC.05 415W MONO MODULES
24 SOLAREEDGE: S440 POWER OPTIMIZERS
01 SOLAREEDGE: SE7600H-USMNUBL15 (DOMESTIC) INVERTER

ROOF ARRAY AREA #1:- 344.00 SQ FT.
ROOF ARRAY AREA #2:- 172.00 SQ FT.



NOTE: VISIBLE, LOCKABLE, LABELED AC DISCONNECT
LOCATED WITHIN 10' OF UTILITY METER

(E) DETACHED
STRUCTURE (TYP.)

This item has been digitally
signed and sealed by
Andrew D. Leone on the date
adjacent to the seal.


Printed copies of this
document are not considered
signed and sealed and the
signature must be verified on
any electronic copies.

ROOF #2
(8) TRINA SOLAR:TSM-NE09RC.05
415W MONO MODULES WITH SOLAREEDGE:
S440 POWER OPTIMIZERS
ROOF #1
(16) TRINA SOLAR:TSM-NE09RC.05
415W MONO MODULES WITH SOLAREEDGE:
S440 POWER OPTIMIZERS

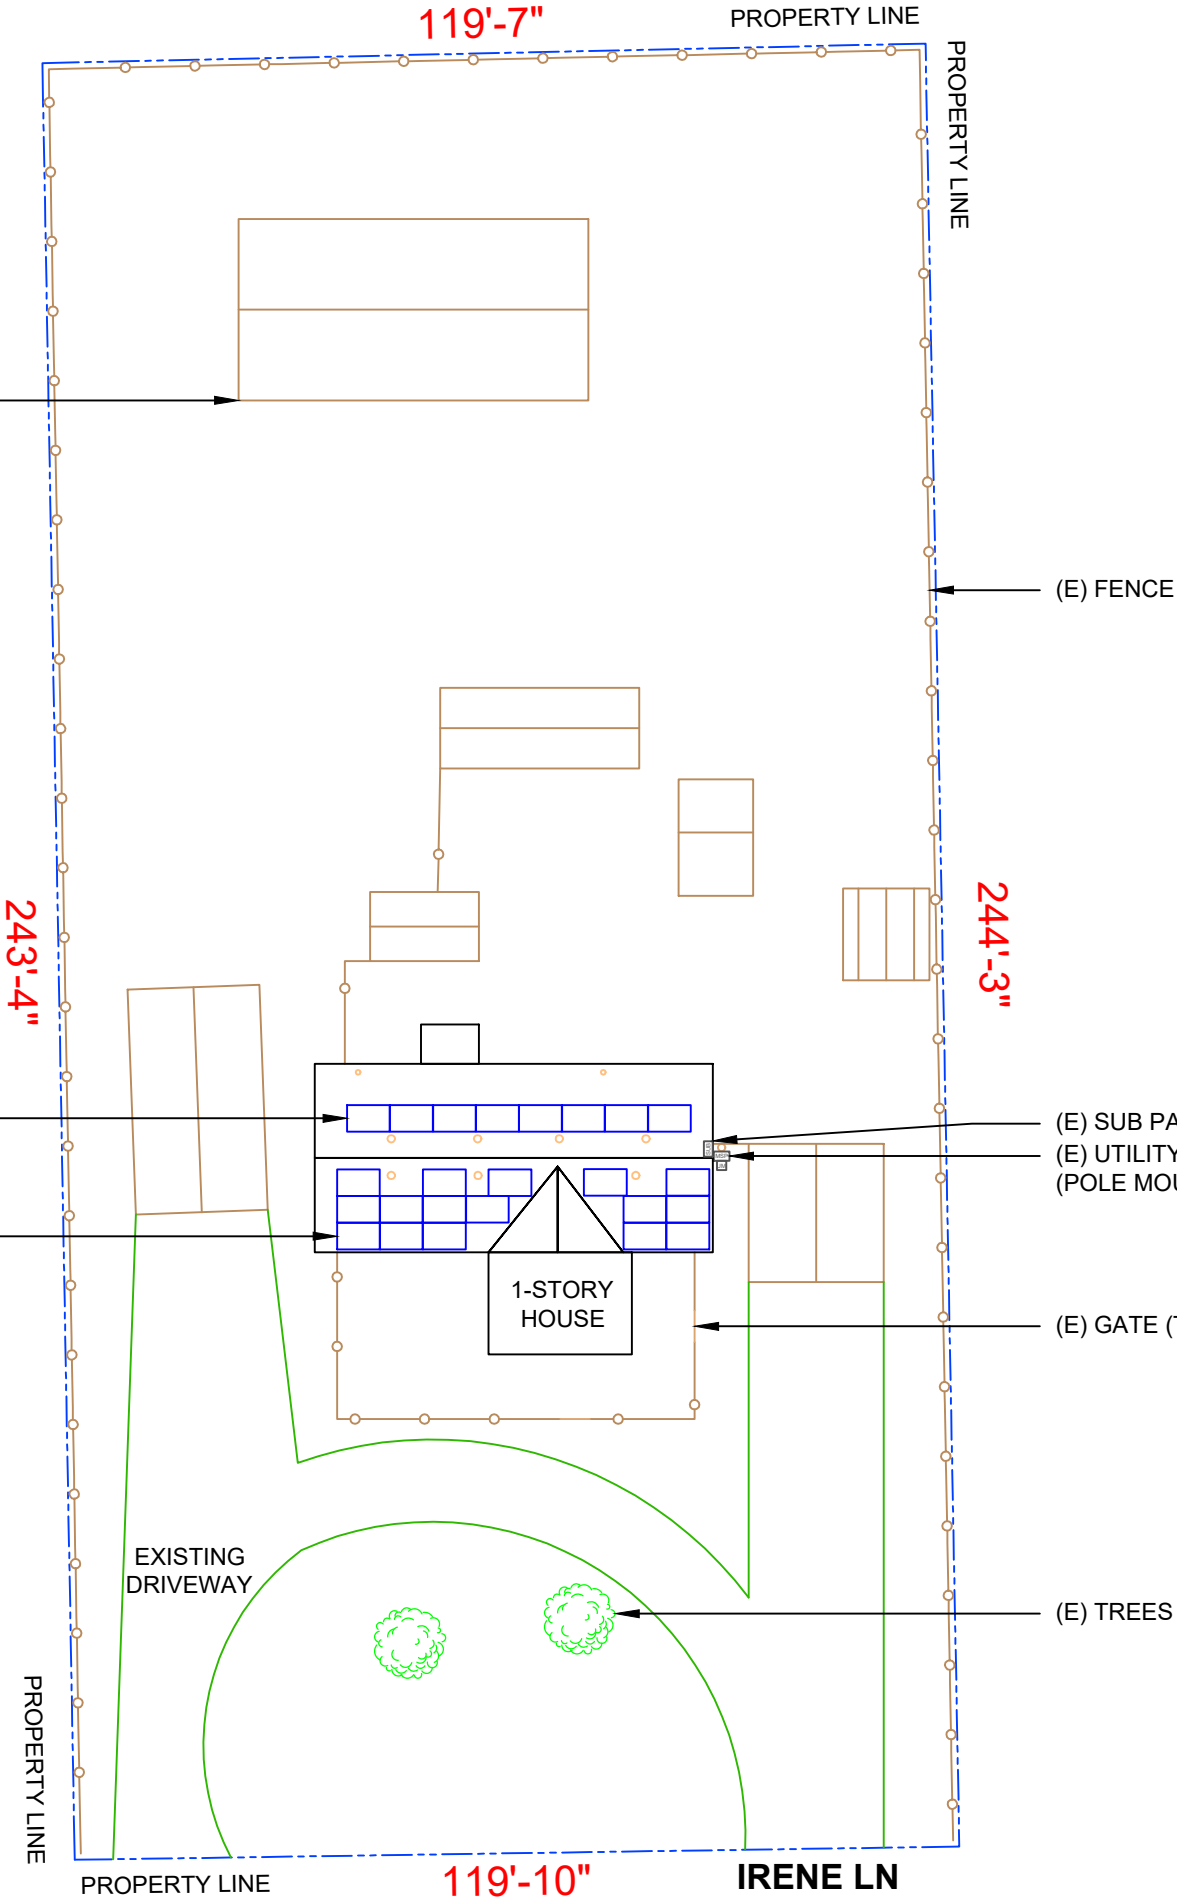

LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

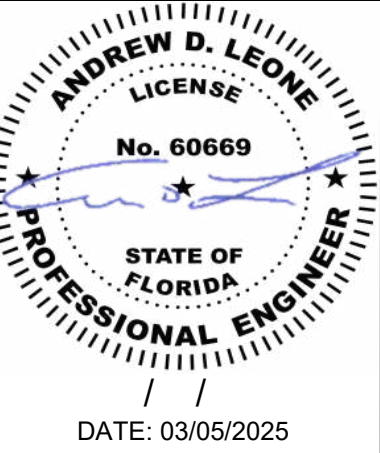

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY
ESR


SHEET NAME
SITE PLAN

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
PV-2

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 24 MODULES
MODULE TYPE = TRINA SOLAR: TSM-NE09RC.05 415W MONO MODULES
MODULE WEIGHT = 47.0 LBS / 21.3KG.
MODULE DIMENSIONS = 69.37" x 44.65" = 21.50 SF




ARRAY AREA & ROOF AREA CALC'S				
ROOF	# OF MODULES	ARRAY AREA (Sq. Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)
#1	16	344.00	581.89	59
#2	8	172.00	687.54	25
TOTAL	24	516.00	1684.48	31

ROOF DESCRIPTION				
ROOF TYPE		ASPHALT SHINGLE		
ROOF	ROOF PITCH	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	15°	180°	2"X2"	24"
#2	15°	0°	2"X2"	24"



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

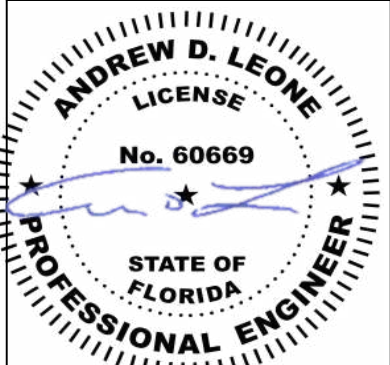

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE

251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME


ROOF PLAN & MODULES

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-3

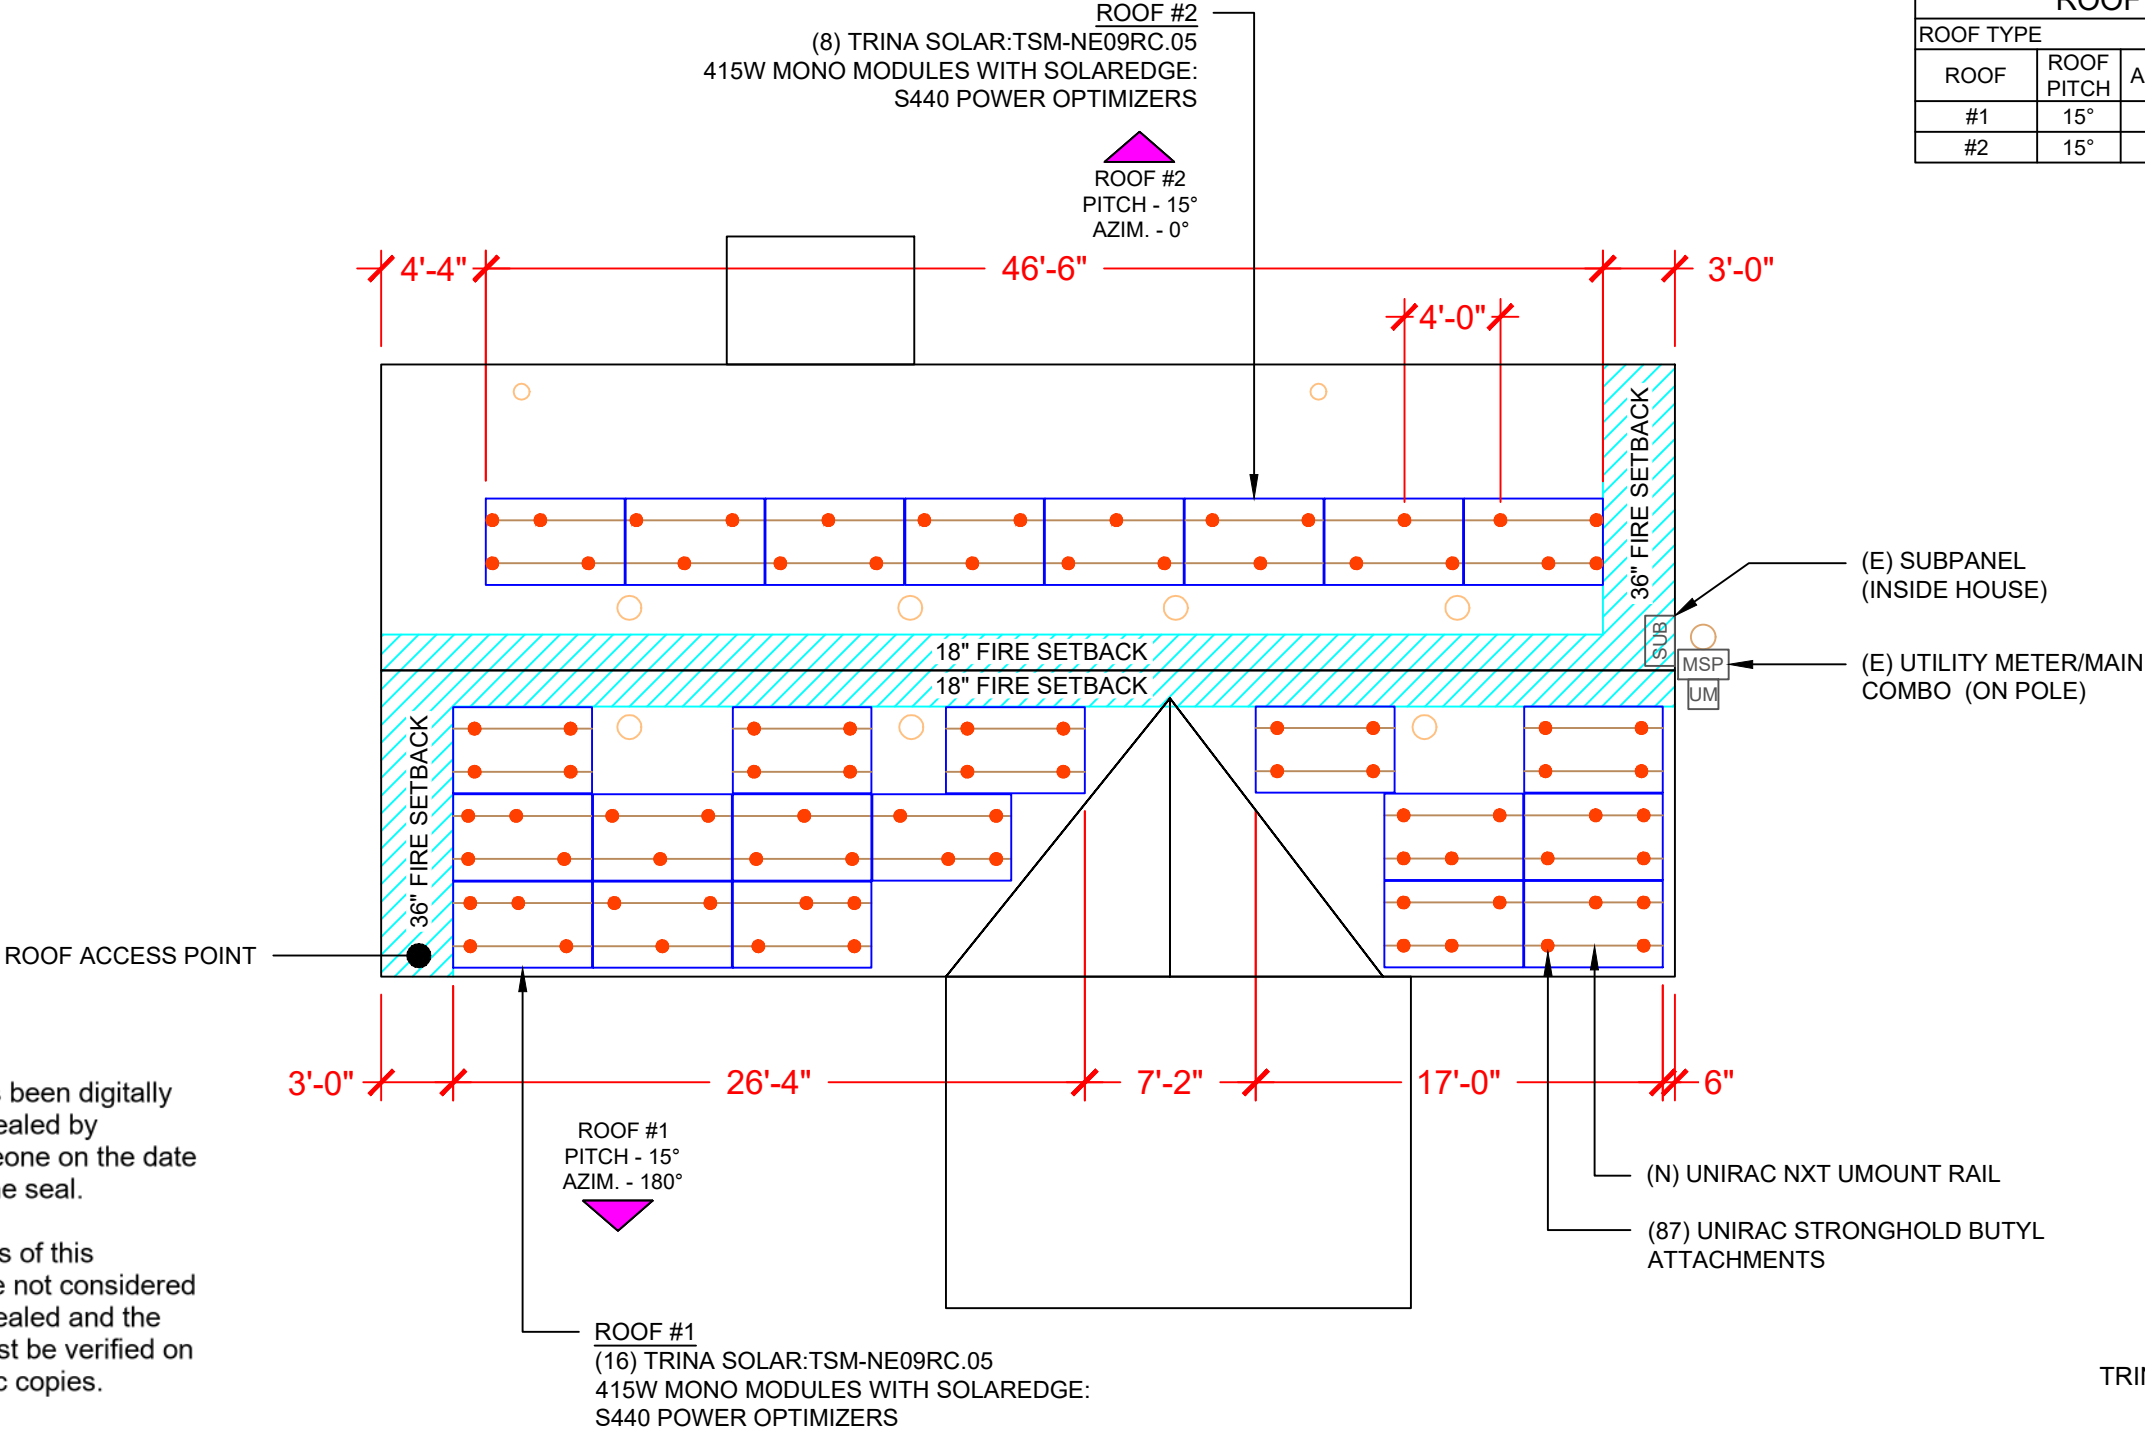

LEGEND

- VENT, ATTIC FAN
(ROOF OBSTRUCTION)

- ROOF ATTACHMENT


- MAIN SERVICE PANEL

- UTILITY METER

CIRCUIT LEGENDS

STRING #1

STRING #2



This item has been digitally signed and sealed by Andrew D. Leone on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

LEGEND

JB

- JUNCTION BOX

INV

- INVERTER

ACD

- AC DISCONNECT

UM

- UTILITY METER

MSP

- MAIN SERVICE PANEL

- CONDUIT

LUNEX POWER

THE PURE SOURCE

LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

ANDREW D. LEONE

LICENSE

No. 60669

STATE OF FLORIDA

PROFESSIONAL ENGINEER

/ /

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE

251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME


ELECTRICAL PLAN

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-4

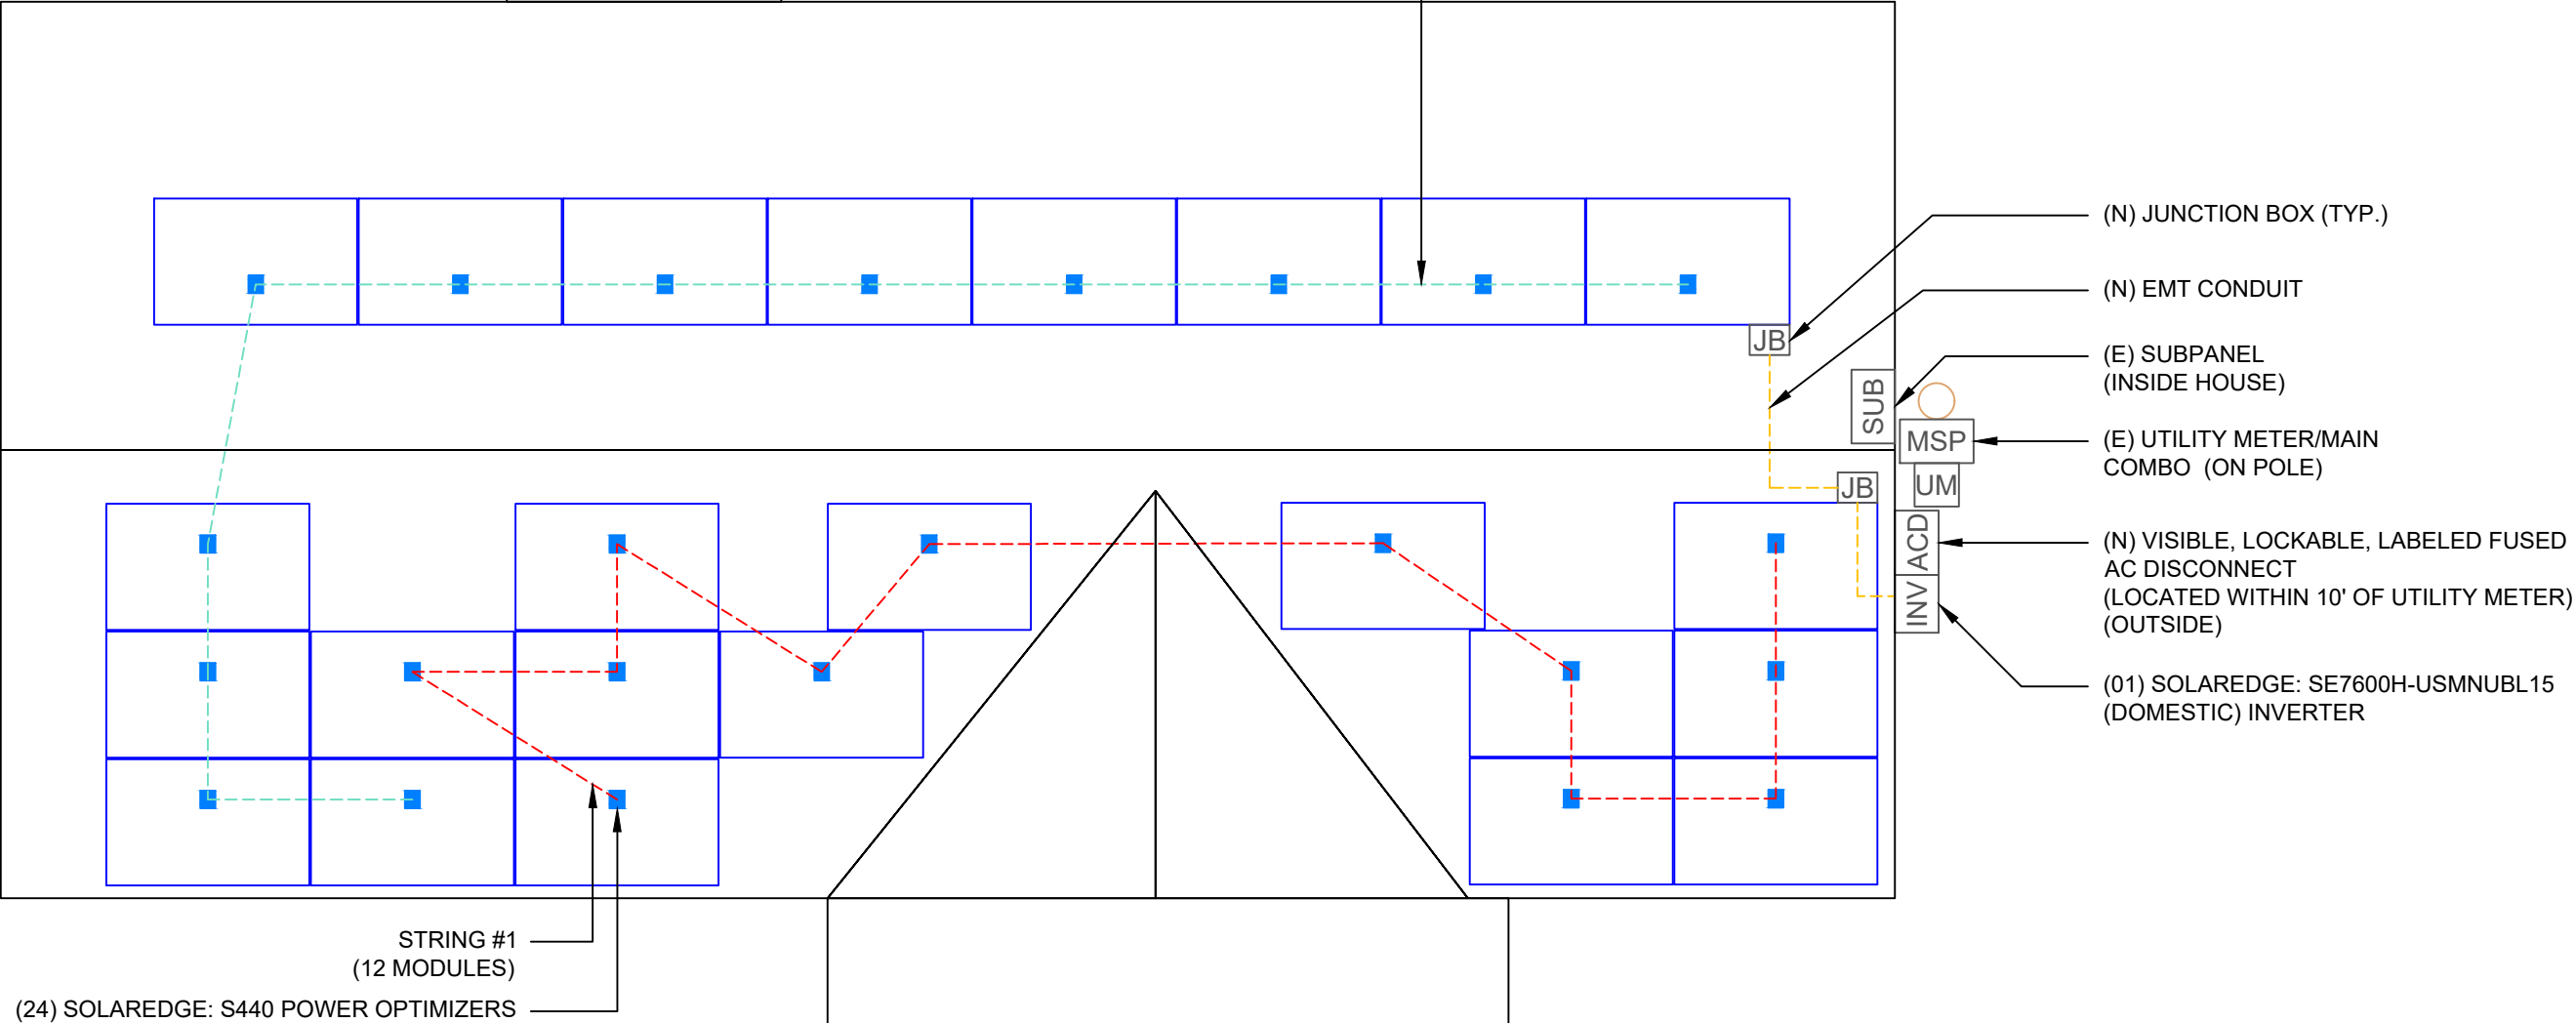

BILL OF MATERIALS		
EQUIPMENT	QTY	DESCRIPTION
SOLAR PV MODULES	24	TRINA SOLAR: TSM-NE09RC.05 415W MODULE
POWER OPTIMIZERS	24	SOLAREEDGE: S440 POWER OPTIMIZERS
INVERTER	1	SOLAREEDGE: SE7600H-USMNUBL15 (DOMESTIC) INVERTER
JUNCTION BOX	2	JUNCTION BOXES
RAILS	20	UNIRAC NXT U MOUNT RAIL
SPLICES	10	SPLICE KIT
MID MODULE CLAMPS	28	MID MODULE CLAMPS
END CLAMPS	40	END CLAMPS / STOPPER SLEEVE
ATTACHMENTS	87	UNIRAC STRONGHOLD BUTYL ATTACHMENTS


1

ELECTRICAL PLAN

PV-4

SCALE: 3/16" = 1'-0"


DESCRIPTION: CANTILEVER
CANTILEVER CONSIDER 1/3RD OF ROOF ATTACHMENT SPACING.
ATTACHMENT SPACING= 48" O/C
CANTILEVER = 16"

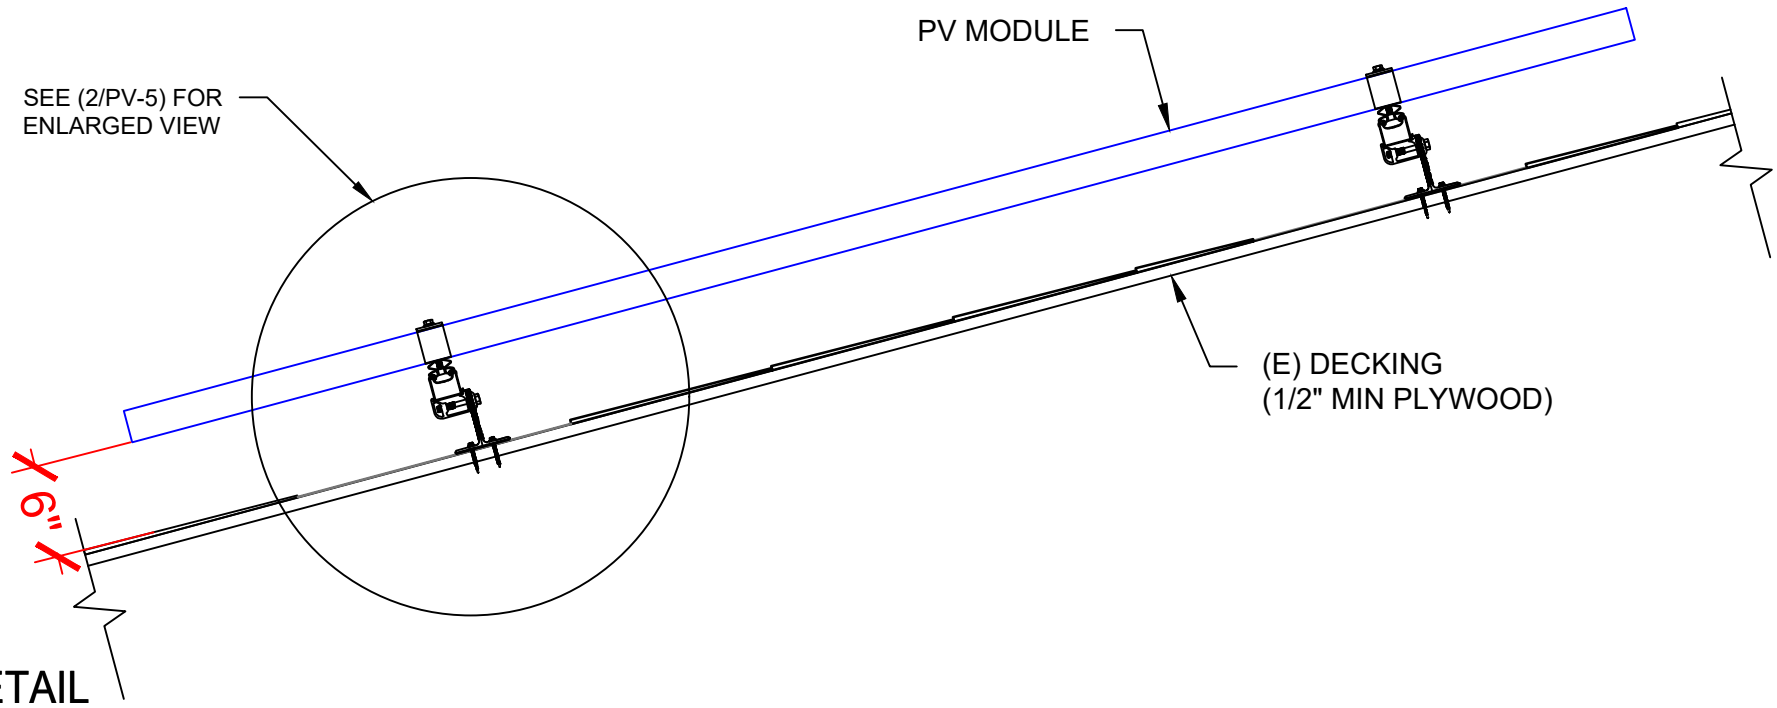

1 ATTACHMENT DETAIL
PV-5 SCALE: NTS

This item has been digitally signed and sealed by Andrew D. Leone on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

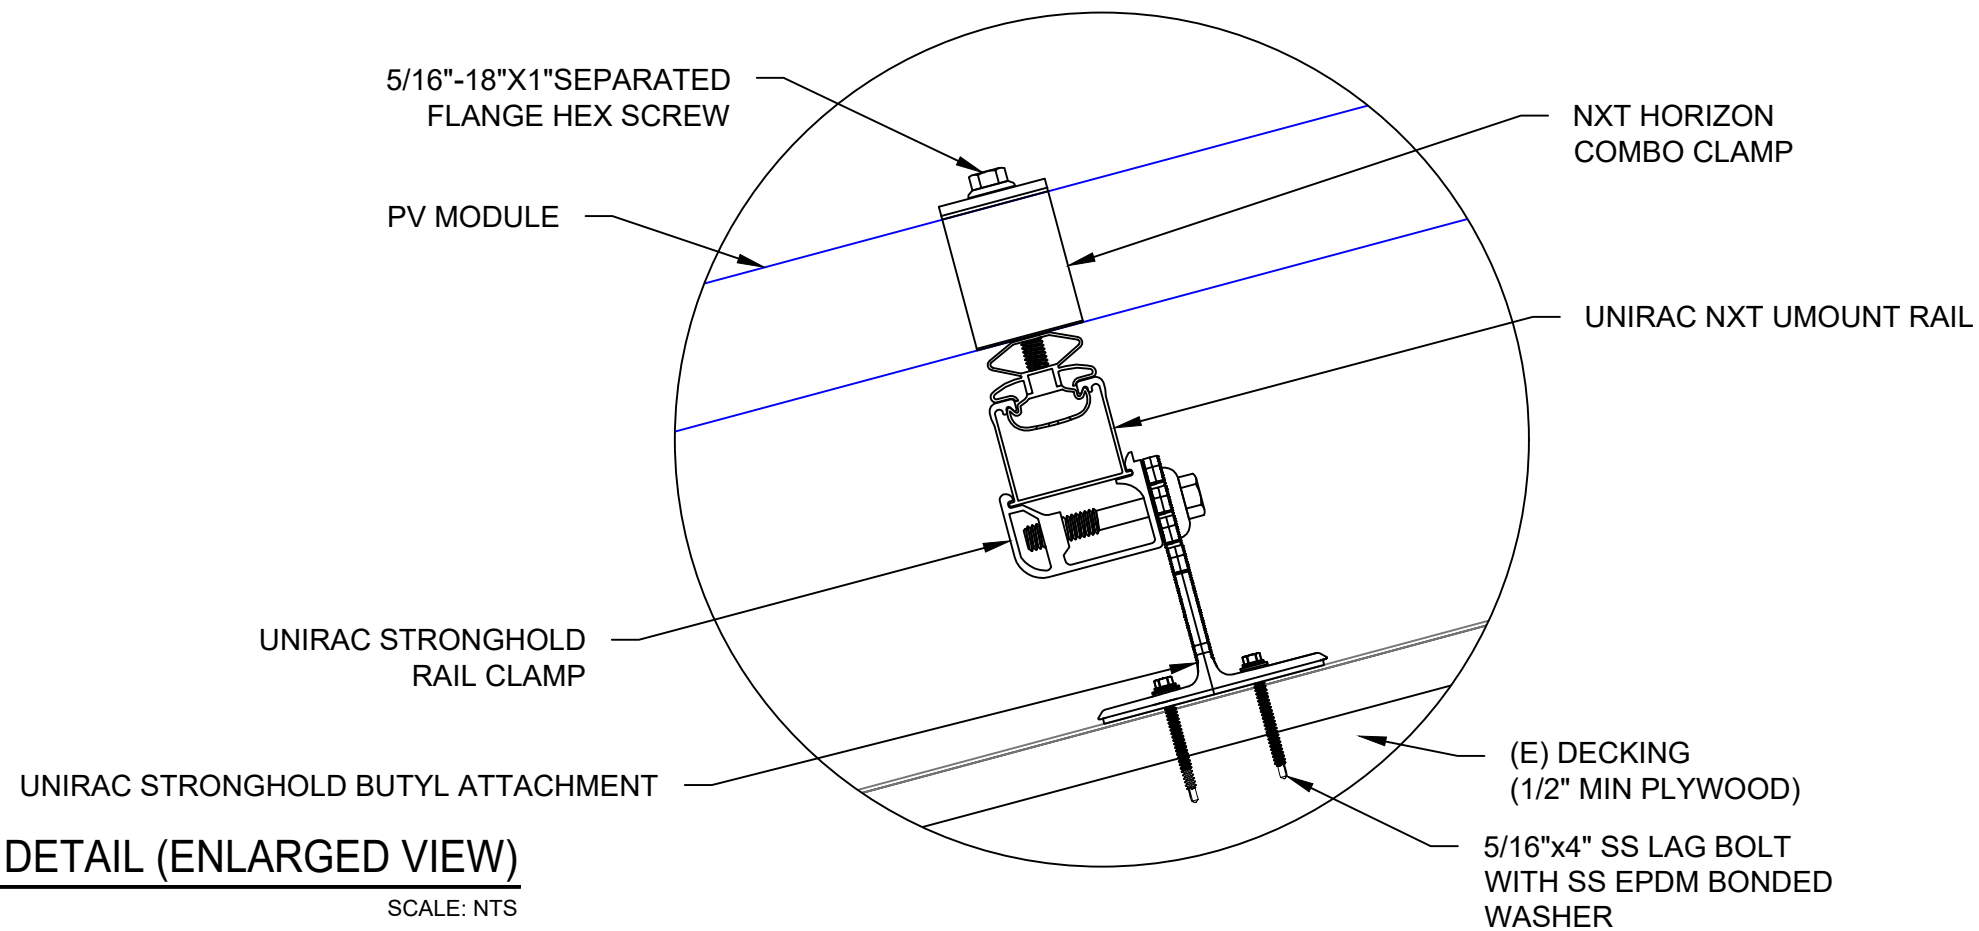


2 ATTACHMENT DETAIL (ENLARGED VIEW)
PV-5 SCALE: NTS



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

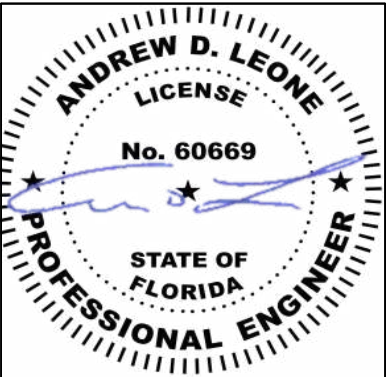

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY
ESR

SHEET NAME
STRUCTURAL DETAIL

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
PV-5

DC SYSTEM SIZE: 24 x 415 = 9.960KW DC
AC SYSTEM SIZE: 01 x 7.600 = 7.600KW AC

(24) TRINA SOLAR: TSM-NE09RC.05 415W MONO MODULES WITH
(24) SOLAREEDGE: S440 POWER OPTIMIZERS
01 SOLAREEDGE: SE7600H-USMNUBL15 (DOMESTIC) INVERTER

(2) BRANCH CIRCUITS OF 12 MODULES ARE CONNECTED IN PARALLEL

INTERCONNECTION NOTES:

1. INTERCONNECTION SIZING, LIMITATIONS AND COMPLIANCE DETERMINED IN ACCORDANCE WITH [NEC 705.12], AND [NEC 690.59].
2. GROUND FAULT PROTECTION IN ACCORDANCE WITH [NEC 215.9], [NEC 230.95].
3. ALL EQUIPMENT TO BE RATED FOR BACKFEEDING.
4. PV BREAKER TO BE POSITIONED AT THE OPPOSITE END OF THE BUSBAR RELATIVE TO THE MAIN BREAKER.

DISCONNECT NOTES:

1. DISCONNECTING SWITCHES SHALL BE WIRED SUCH THAT WHEN THE SWITCH IS OPENED THE CONDUCTORS REMAINING LIVE ARE CONNECTED TO THE TERMINALS MARKED "LINE SIDE" (TYPICALLY THE UPPER TERMINALS)
2. AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH
3. DISCONNECT MEANS AND THEIR LOCATION SHALL BE IN ACCORDANCE WITH [NEC 225.31] AND [NEC 225.32].

RACKING NOTES:


1. BOND EVERY OTHER RAIL WITH #6 BARE COPPER

GROUNDING & GENERAL NOTES:

1. **GROUNDING ELECTRODES AND GROUNDING ELECTRODE CONDUCTORS.** ADDITIONAL GROUNDING ELECTRODES SHALL BE PERMITTED TO BE INSTALLED IN ACCORDANCE WITH 250.52 AND 250.54. GROUNDING ELECTRODES SHALL BE PERMITTED TO BE CONNECTED DIRECTLY TO THE PV MODULE FRAME(S) OR SUPPORT STRUCTURE PER [NEC 690.47(B)]
2. PV INVERTER IS UNGROUNDED, TRANSFORMER-LESS TYPE.
3. DC GEC AND AC EGC TO REMAIN UNSPLICED, OR SPLICED TO EXISTING ELECTRODE
4. ANY EXISTING WIRING INVOLVED WITH PV SYSTEM CONNECTION THAT IS FOUND TO BE INADEQUATE PER CODE SHALL BE CORRECTED PRIOR TO FINAL INSPECTION.
5. JUNCTION BOX QUANTITIES, AND PLACEMENT SUBJECT TO CHANGE IN THE FIELD - JUNCTION BOX DEPICTED ON ELECTRICAL DIAGRAM REPRESENT WIRE TYPE TRANSITIONS.
6. AC DISCONNECT NOTED IN EQUIPMENT SCHEDULE OPTIONAL IF OTHER AC DISCONNECTING MEANS IS LOCATED WITHIN 10' OF SERVICE DISCONNECT.
7. RACEWAYS AND CABLES EXPOSED TO SUNLIGHT ON ROOFTOPS SHOULD BE INSTALLED MORE THAN 7/8" ABOVE THE ROOF USING CONDUIT SUPPORTS.

INSTALLER / ELECTRICIAN NOTE:

EC IS TO MEASURE VOLTAGE BEFORE STARTING WORK.
IF RESULT IS ANY OTHER VOLTAGE MEASURED THAN 120/240V IS OBSERVED, DO NOT PROCEED. CONTACT ENGINEER.

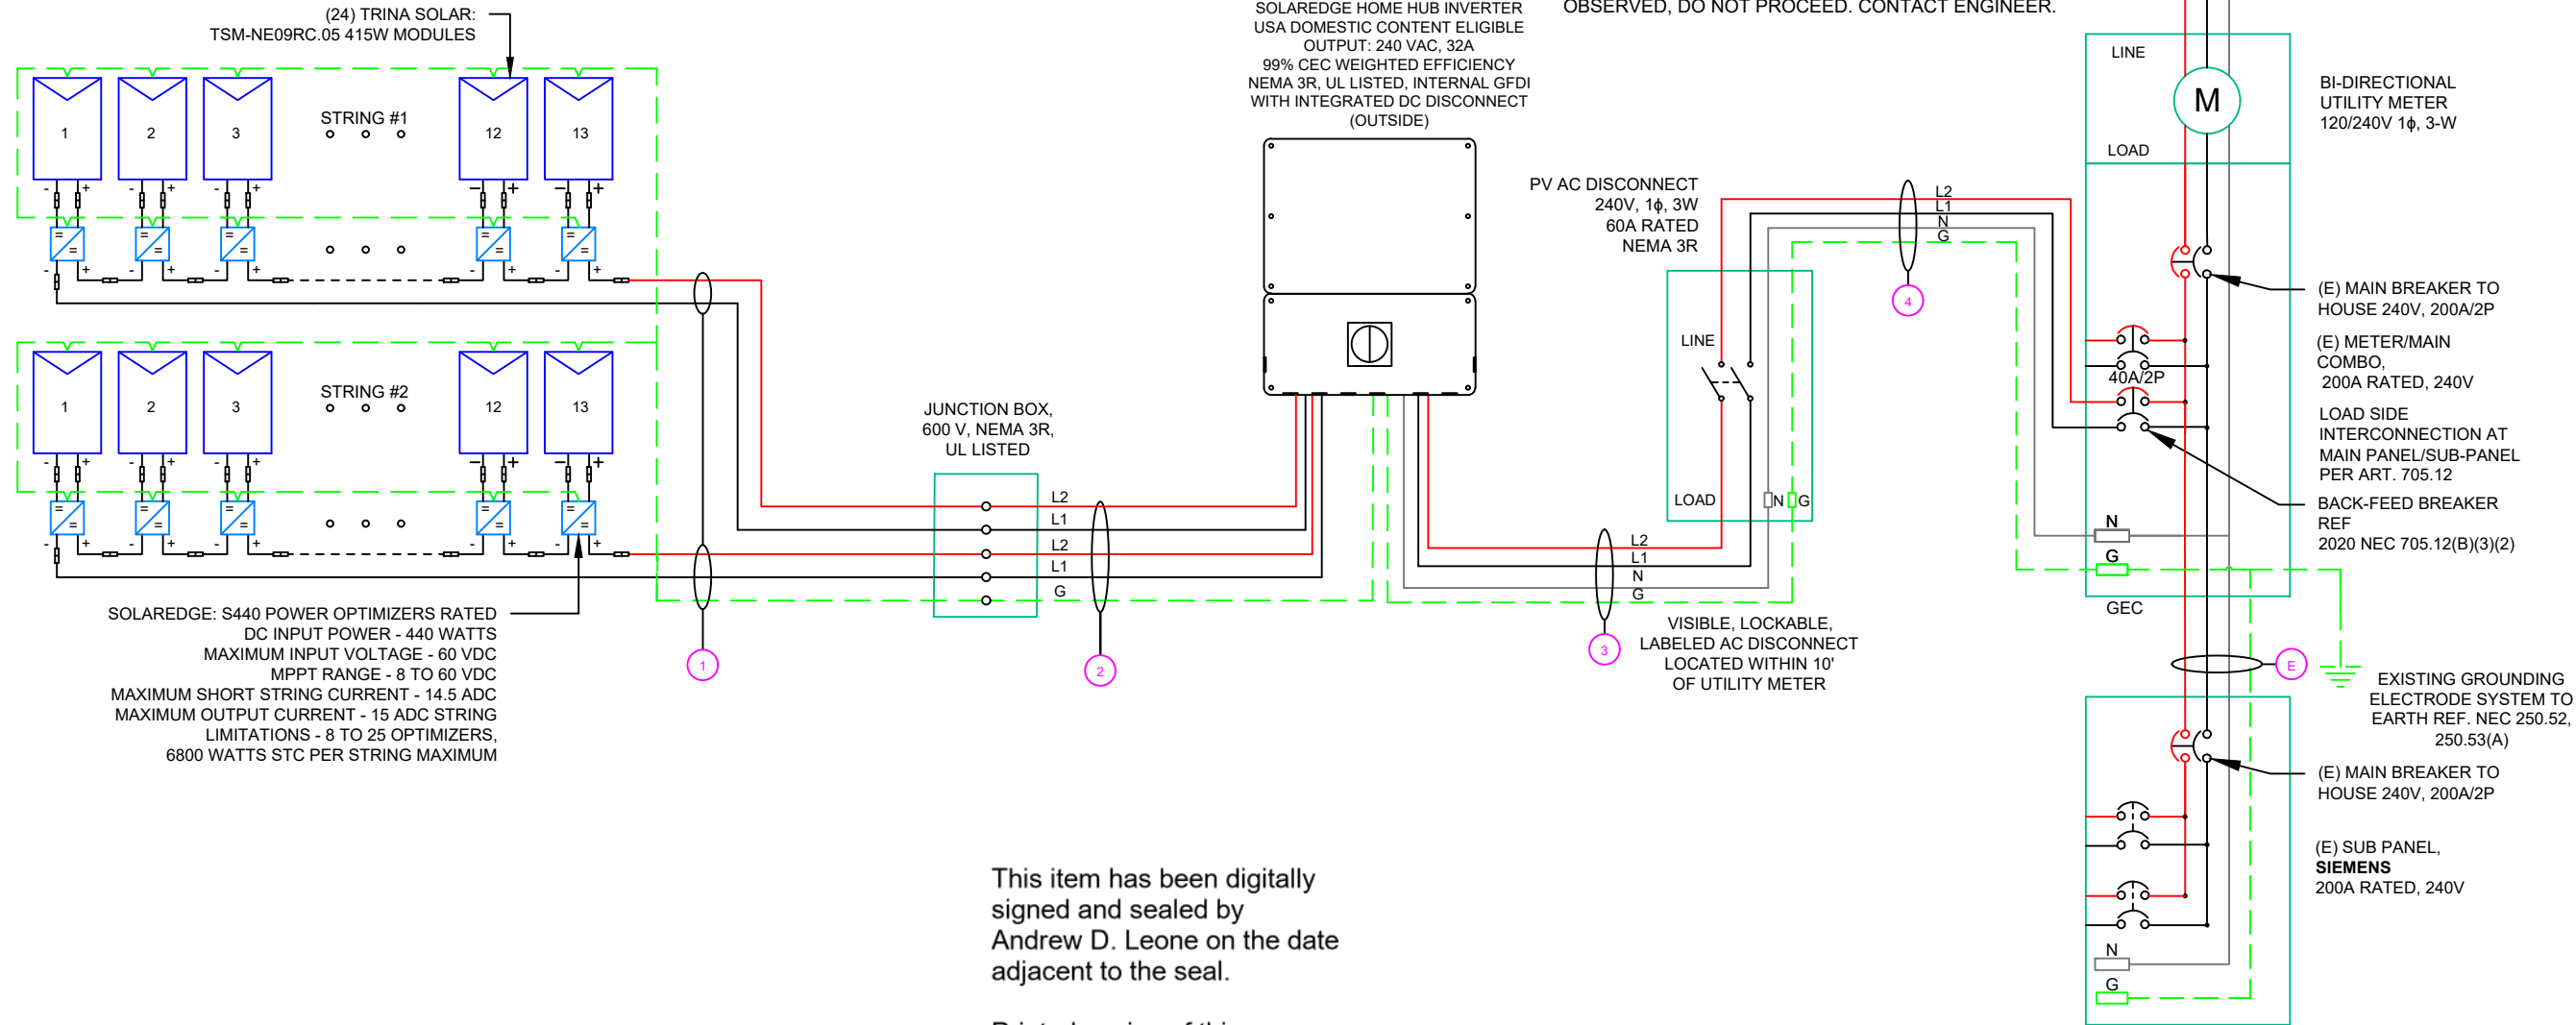


This item has been digitally
signed and sealed by
Andrew D. Leone on the date
adjacent to the seal.

Printed copies of this
document are not considered
signed and sealed and the
signature must be verified on
any electronic copies.

QTY	CONDUCTOR INFORMATION		CONDUIT TYPE	CONDUIT SIZE
① (4)	CU#10AWG -	PV WIRE/USE-2	N/A	N/A
(1)	CU#6AWG -	BARE COPPER IN FREE AIR		
② (4)	CU#10AWG -	THWN-2 (L1,L2)	EMT OR LFMC IN ATTIC	3/4"
(1)	CU#10AWG -	THWN-2 GND		
(2)	CU#8AWG -	THWN-2 (L1,L2)	EMT OR LFMC IN ATTIC	3/4"
(1)	CU#8AWG -	THWN-2 N		
(1)	CU#10AWG -	THWN-2 GND	EMT, LFMC OR LFNC	3/4"
(3)	CU#8AWG -	THWN-2 (L1,L2,N)		
(1)	CU#10AWG -	THWN-2 GND		

REVISIONS		
DESCRIPTION	DATE	REV

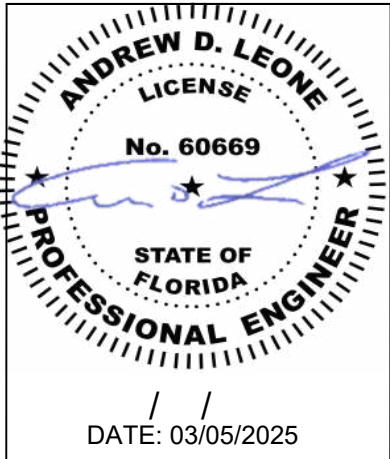

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME

ELECTRICAL LINE DIAGRAM

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-6

INVERTER SPECIFICATIONS	
MANUFACTURER / MODEL #	SOLAREEDGE: SE7600H-USMNUBL15(DOMESTIC) INVERTER
NOMINAL AC POWER	7.600 KW
NOMINAL OUTPUT VOLTAGE	240 VAC
NOMINAL OUTPUT CURRENT	32A

SOLAR MODULE SPECIFICATIONS	
MANUFACTURER / MODEL #	TRINA SOLAR: TSM-NE09RC.05 415W MODULE
VMP	42.5V
IMP	9.77A
VOC	50.5V
ISC	10.40A
TEMP. COEFF. VOC	-0.24%/°C
MODULE DIMENSION	69.37"L x 44.65"W x 1.18"D (In Inch)

AMBIENT TEMPERATURE SPECS	
RECORD LOW TEMP	-5°
AMBIENT TEMP (HIGH TEMP 2%)	37°
MODULE TEMPERATURE COEFFICIENT OF Voc	-0.24%/°C

PERCENT OF VALUES	NUMBER OF CURRENT CARRYING CONDUCTORS IN EMT
.80	4-6
.70	7-9
.50	10-20

DC FEEDER CALCULATIONS																					
CIRCUIT ORIGIN	CIRCUIT DESTINATION	VOLTAGE (V)	FULL LOAD AMPS "FLA" (A)	FLA*1.25 (A)	OCPD SIZE (A)	GROUND SIZE	CONDUCTOR SIZE	75°C AMPACITY (A)	AMPACITY CHECK #1	AMBIENT TEMP. (°C)	TOTAL CC CONDUCTORS IN RACEWAY	90°C AMPACITY (A)	DERATION FACTOR FOR AMBIENT TEMPERATURE NEC 310.15(B)(1)	DERATION FACTOR FOR CONDUCTORS PER RACEWAY NEC 310.15(C)(1)	90°C AMPACITY DERATED (A)	AMPACITY CHECK #2	FEEDER LENGTH (FEET)	CONDUCTOR RESISTANCE (OHM/KFT)	VOLTAGE DROP AT FLA (%)	CONDUIT SIZE	CONDUIT FILL (%)
STRING 1	JUNCTION BOX	400	15.00	18.75	20	BARE COPPER #6 AWG	CU #10 AWG	35	PASS	37	2	40	0.91	1	36.4	PASS	65	1.24	0.605	N/A	#N/A
STRING 2	JUNCTION BOX	400	15.00	18.75	20	BARE COPPER #6 AWG	CU #10 AWG	35	PASS	37	2	40	0.91	1	36.4	PASS	62	1.24	0.577	N/A	#N/A
JUNCTION BOX	INVERTER	400	15.00	18.75	20	CU #10 AWG	CU #10 AWG	35	PASS	37	4	40	0.91	0.8	29.12	PASS	16	1.24	0.149	3/4" EMT	19.79362
																			String 1 Voltage Drop	0.753	
																			String 2 Voltage Drop	0.725	

AC FEEDER CALCULATIONS																						
CIRCUIT ORIGIN	CIRCUIT DESTINATION	VOLTAGE (V)	FULL LOAD AMPS "FLA" (A)	FLA*1.25 (A)	OCPD SIZE (A)	NEUTRAL SIZE	GROUND SIZE	CONDUCTOR SIZE	75°C AMPACITY (A)	AMPACITY CHECK #1	AMBIENT TEMP. (°C)	TOTAL CC CONDUCTORS IN RACEWAY	90°C AMPACITY (A)	DERATION FACTOR FOR AMBIENT TEMPERATURE NEC 310.15(B)(1)	DERATION FACTOR FOR CONDUCTORS PER RACEWAY NEC 310.15(C)(1)	90°C AMPACITY DERATED (A)	AMPACITY CHECK #2	FEEDER LENGTH (FEET)	CONDUCTOR RESISTANCE (OHM/KFT)	VOLTAGE DROP AT FLA (%)	CONDUIT SIZE	CONDUIT FILL (%)
INVERTER	AC DISCONNECT	240	32	40	40	CU #8 AWG	CU #10 AWG	CU #8 AWG	50	PASS	37	2	55	0.91	1	50.05	PASS	5	0.778	0.104	3/4" EMT	24.5591
AC DISCONNECT	POI	240	32	40	40	CU #8 AWG	CU #10 AWG	CU #8 AWG	50	PASS	37	2	55	0.91	1	50.05	PASS	5	0.778	0.104	3/4" EMT	24.5591
																			CUMULATIVE VOLTAGE		0.207	

This item has been digitally signed and sealed by Andrew D. Leone on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.


ELECTRICAL NOTES

1. ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
2. ALL CONDUCTORS SHALL BE RATED UPTO 600V FOR RESIDENTIAL AND 1000V FOR COMMERCIAL AND 90 DEGREE C WET ENVIRONMENT.
3. WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
4. WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
5. DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
6. WHERE SIZES OF JUNCTION BOX, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
7. ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
8. MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
9. MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
10. TEMPERATURE RATINGS OF ALL CONDUCTORS, TERMINATIONS, BREAKERS, OR OTHER DEVICES ASSOCIATED WITH THE SOLAR PV SYSTEM SHALL BE RATED FOR AT LEAST 75 DEGREE C.



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

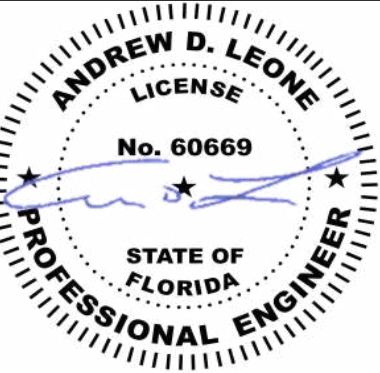

/ /
DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE

251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME

WIRING CALCULATIONS

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-7

CAUTION:
AUTHORIZED SOLAR
PERSONNEL ONLY!

LABEL-1:
LABEL LOCATION:
AC DISCONNECT

 **WARNING**

ELECTRICAL SHOCK HAZARD

TERMINALS ON THE LINE AND LOAD SIDES MAY
BE ENERGIZED IN THE OPEN POSITION

LABEL- 2:
LABEL LOCATION:
AC DISCONNECT
COMBINER
MAIN SERVICE PANEL
SUBPANEL
MAIN SERVICE DISCONNECT
CODE REF: NEC 690.13(B)

 **WARNING DUAL POWER SOURCE**

SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL- 3:
LABEL LOCATION:
PRODUCTION METER
UTILITY METER
MAIN SERVICE PANEL
SUBPANEL
CODE REF: NEC 705.12(C) & NEC 690.59

 **WARNING**

**TURN OFF PHOTOVOLTAIC AC
DISCONNECT PRIOR TO
WORKING INSIDE PANEL**

LABEL- 4:
LABEL LOCATION:
MAIN SERVICE PANEL
SUBPANEL
MAIN SERVICE DISCONNECT
COMBINER
CODE REF: NEC 110.27(C) & OSHA 1910.145 (f) (7)


 **WARNING**

**POWER SOURCE OUTPUT
CONNECTION. DO NOT
RELOCATE THIS
OVERCURRENT DEVICE**

LABEL- 5:
LABEL LOCATION:
MAIN SERVICE PANEL (ONLY IF SOLAR IS BACK-FED)
SUBPANEL (ONLY IF SOLAR IS BACK-FED)
CODE REF: NEC 705.12(B)(3)(2)

SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE
"OFF" POSITION TO
SHUT DOWN PV SYSTEM
AND REDUCE
SHOCK HAZARD
IN THE ARRAY



LABEL- 6:
LABEL LOCATION:
AC DISCONNECT
CODE REF: IFC 605.11.3.1(1) & NEC 690.56(C)

RAPID SHUTDOWN SWITCH
FOR SOLAR PV SYSTEM

LABEL- 7:
LABEL LOCATION:
AC DISCONNECT
CODE REF: NEC 690.56(C)(2)

PHOTOVOLTAIC

AC DISCONNECT

LABEL- 8:
LABEL LOCATION:
AC DISCONNECT
CODE REF: NEC 690.13(B)

PHOTOVOLTAIC
AC DISCONNECT

NOMINAL OPERATING AC VOLATGE240 V

RATED AC OUTPUT CURRENT32 A

LABEL- 9:
LABEL LOCATION:
MAIN SERVICE PANEL
SUBPANEL
AC DISCONNECT
CODE REF: NEC 690.54

MAIN PHOTOVOLTAIC
SYSTEM DISCONNECT

LABEL- 10:
LABEL LOCATION:
MAIN SERVICE DISCONNECT (ONLY IF MAIN SERVICE DISCONNECT IS PRESENT)
CODE REF: NEC 690.13(B)

PRODUCTION
METER

LABEL- 11:
LABEL LOCATION:
PRODUCTION METER (ONLY IF PRODUCTION METER IS USED)

This item has been digitally
signed and sealed by
Andrew D. Leone on the date
adjacent to the seal.

Printed copies of this
document are not considered
signed and sealed and the
signature must be verified on
any electronic copies.

CAUTION: PHOTOVOLTAIC SYSTEM
FOR SERVICE : LUNEX POWER
813-540-8807

LABEL-12:

WARNING: PHOTOVOLTAIC
POWER SOURCE

LABEL-13:
LABEL LOCATION:
EMT/CONDUIT RACEWAY
SOLADECK/JUNCTION BOX
CODE REF : NEC 690.31 (D) (14)

EMERGENCY RESPONDER
THIS SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE 'OFF'
POSITION TO SHUTDOWN
ENTIRE PV SYSTEM.

THE LABEL SHALL BE REFLECTIVE, WITH ALL LETTERS CAPITALIZED AND HAVING
A MINIMUM HEIGHT OF 3/8 IN. (9.5 MM), IN WHITE ON A RED BACKGROUND.

LABEL- 14:
LABEL LOCATION:
AC DISCONNECT
CODE REF:NFPA 1 (11.12.2.1.1.1.1)
1. THE RAPID SHUTDOWN LABEL SHALL BE LOCATED ON OR NO MORE
THAN 3 FT (1 M) FROM THE SERVICE DISCONNECTING MEANS
2. (HEIGHT OF LABEL IS 3/8 IN. (9.5 MM), IN WHITE ON A RED BACKGROUND)

MAXIMUM VOLTAGE:480 V

MAXIMUM CIRCUIT CURRENT:40 A


MAXIMUM RATED OUTPUT
CURRENT OF THE CHARGE
CONTROLLER OR DC-TO-DC
CONVERTER (IF INSTALLED):

LABEL- 15:
LABEL LOCATION:
INVERTER
CODE REF: NEC 690.53



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

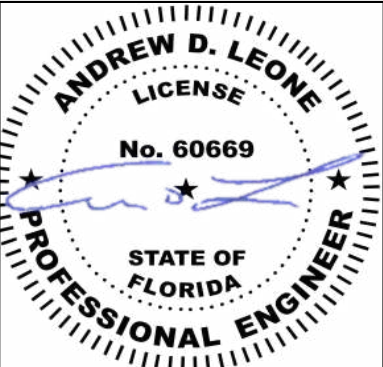

/ /
DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME


LABELS

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-8

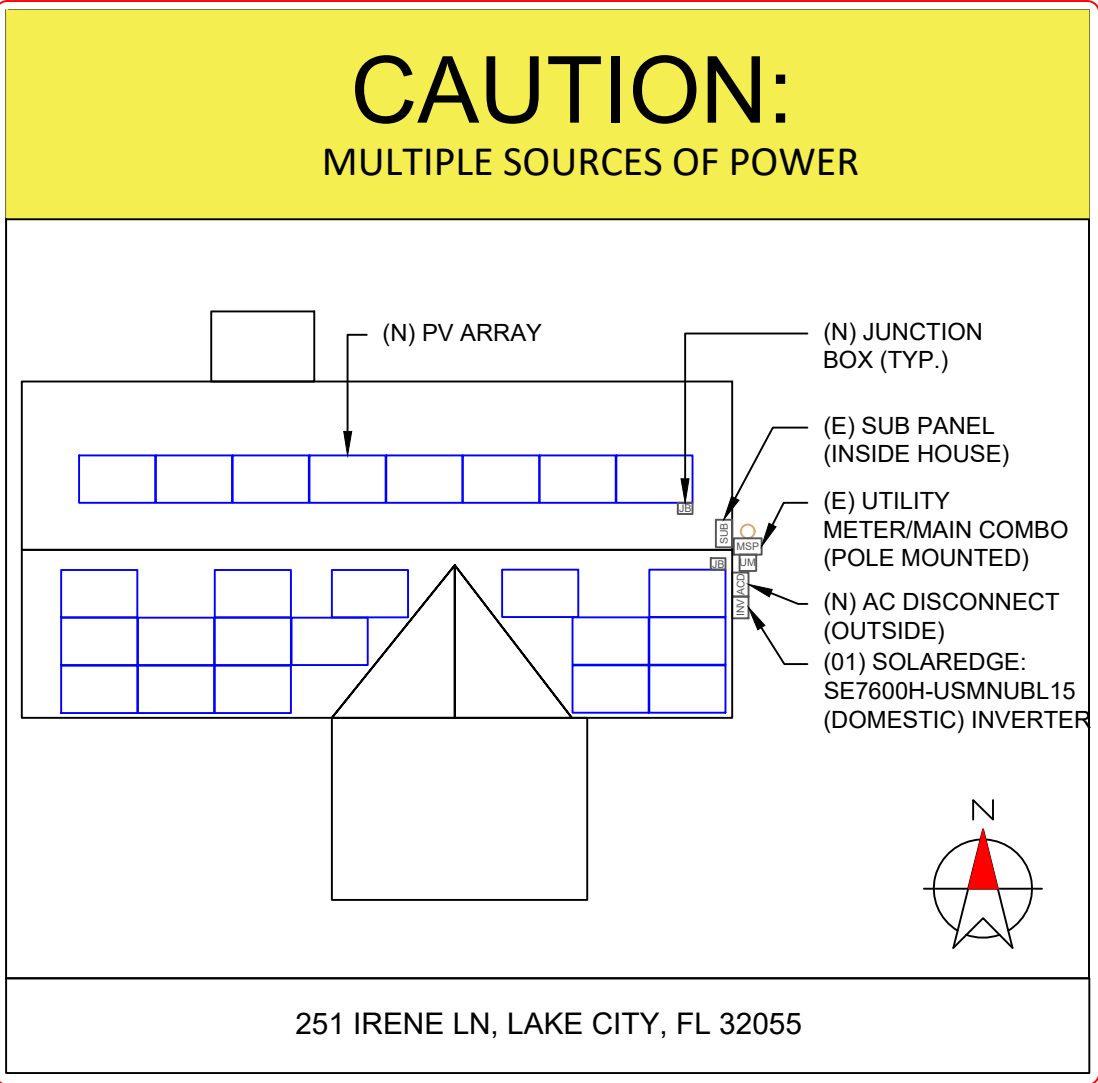

This item has been digitally signed and sealed by Andrew D. Leone on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

- LABELING NOTES:
1. LABELS CALLED OUT ACCORDING TO ALL COMMON CONFIGURATIONS. ELECTRICIAN TO DETERMINE EXACT REQUIREMENTS IN THE FIELD PER CURRENT NEC AND LOCAL CODES AND MAKE APPROPRIATE ADJUSTMENTS.
 2. LABELING REQUIREMENTS BASED ON THE 2020 NATIONAL ELECTRIC CODE, OSHA STANDARD 19010.145, ANSI Z535.
 3. MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
 4. LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED [NEC 110.21]
 5. LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8", WHITE ON RED BACKGROUND; REFLECTIVE, AND PERMANENTLY AFFIXED [IFC 605.11.1.1]


DIRECTORY
PERMANENT PLAQUE OR DIRECTORY PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS AND THE PHOTOVOLTAIC SYSTEM.

(ALL PLAQUES AND SIGNAGE WILL BE INSTALLED AS OUTLINED WITHIN:
NEC 690.56(B)&(C), [NEC 705.10])



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

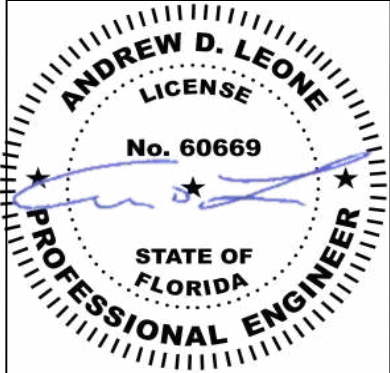

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME

PLACARD

SHEET SIZE


ANSI B
11" X 17"

SHEET NUMBER


PV-9

1-1011-2021-3031-4041-5051-6061-70

1
2
3
4
5
6
7
8
9
10

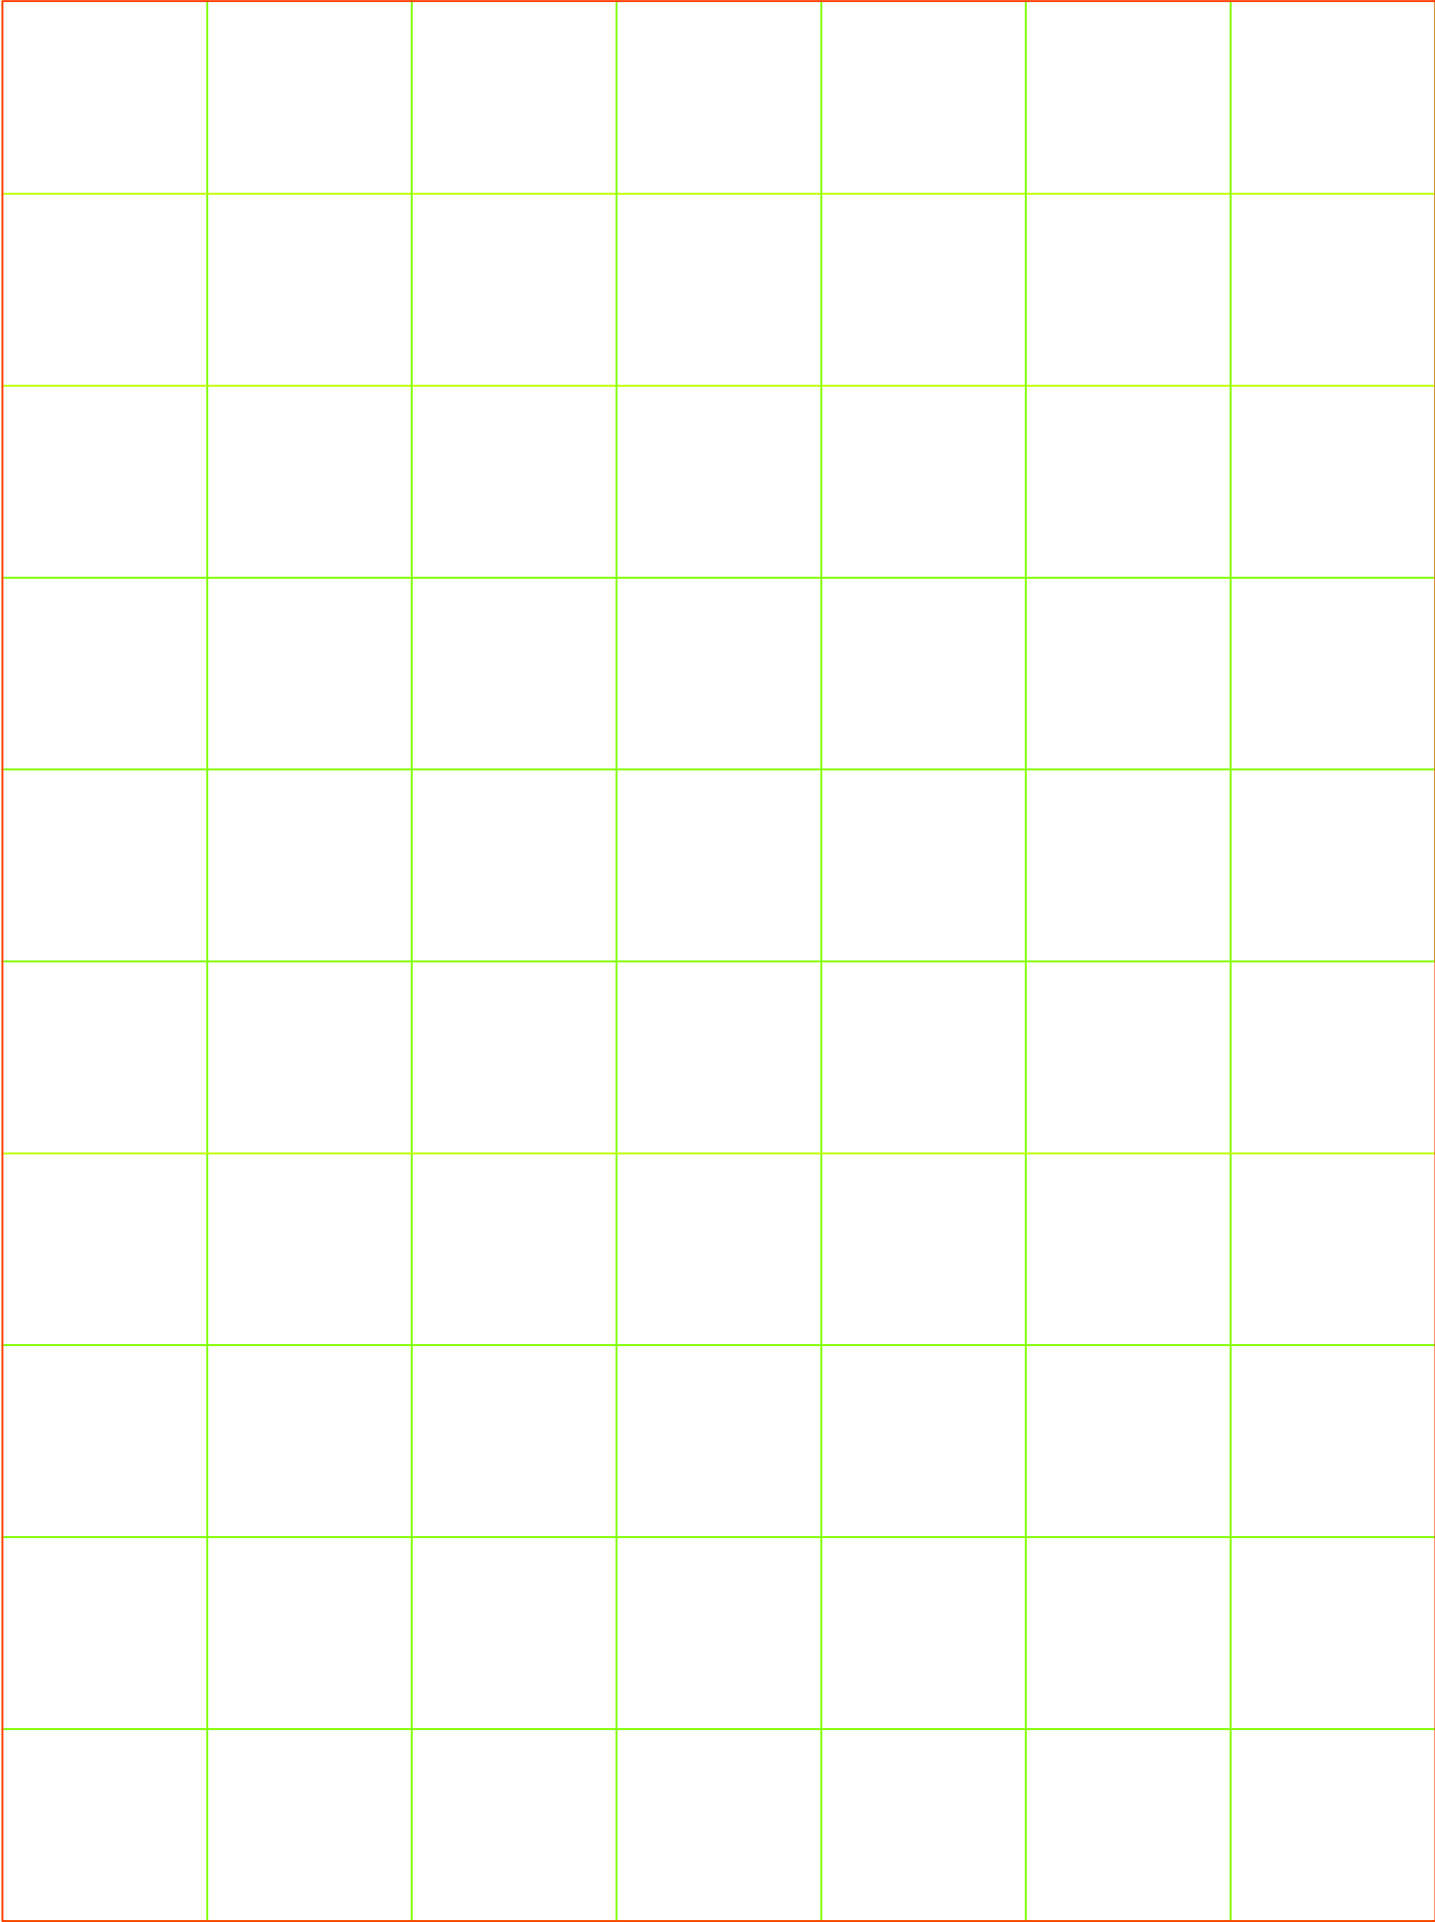

OPTIMIZER CHART

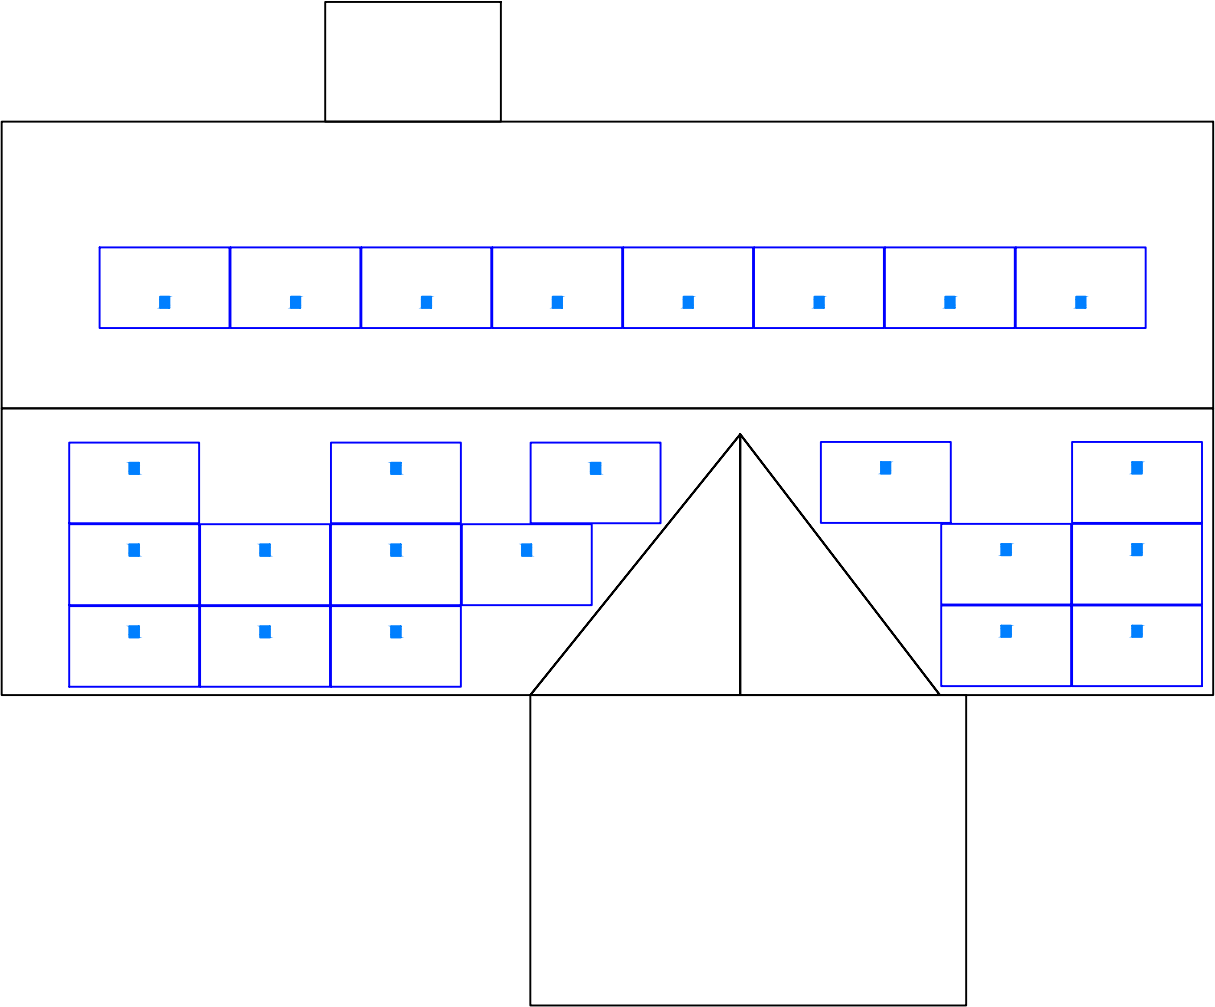



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE

251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME

OPTIMIZER CHART

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-10



BACKSHEET MONOCRYSTALLINE MODULE

PRODUCT: TSM-NE09RC.05
PRODUCT RANGE: 400-430W

430W

MAXIMUM POWER OUTPUT

0~+5W

POSITIVE POWER TOLERANCE

21.5%

MAXIMUM EFFICIENCY



Small in size, bigger on power

- Up to 430W, 21.5% module efficiency with high density interconnect technology
- Reduce installation cost with higher power bin and efficiency
- Boost performance in warm weather with low temperature coefficient and operating temperature



High Reliability

- Innovative non-destructive cutting for improved mechanical resistance and strength
- Excellent fire rating, weather resistance, salt spray, sand dust, ammonia performance which is fully applicable in coastal, high temperature, humidity area and harsh environment



Ultra-low Degradation, longer warranty, higher output


- First-year degradation 1% and annual degradation at 0.4%
- Up to 25 years product warranty and 25 years power warranty



Universal solution for residential and C&I rooftops




- Easy for integration, designed for compatibility with existing mainstream inverters and diverse mounting systems
- Perfect size and low weight for handling and installation
- Most valuable solution on low load capacity rooftops (weight similar to backsheet version)
- Mechanical performance up to 6000 Pa positive load and 4000 Pa negative load

Trina Solar's Vertex Bifacial Backsheet Performance Warranty

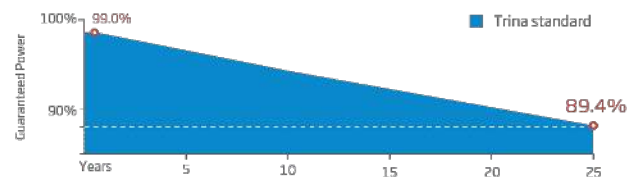

BACKSHEET MONOCRYSTALLINE MODULE

DIMENSIONS OF PV MODULE(mm)

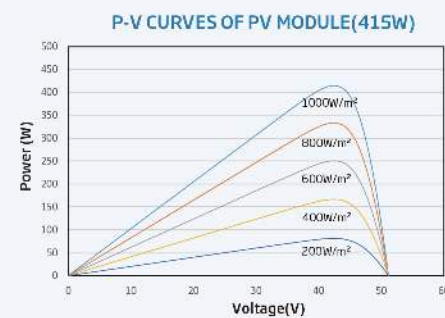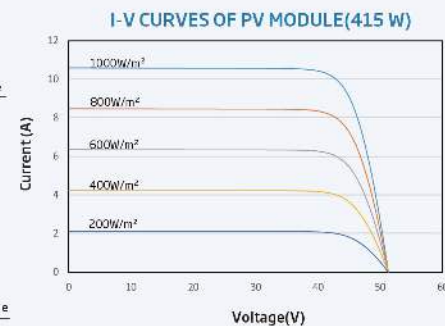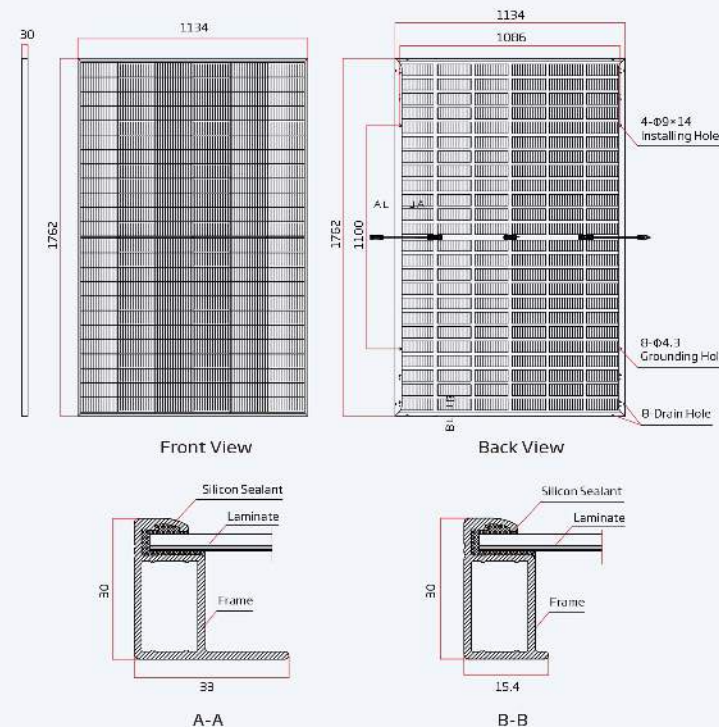

ELECTRICAL DATA (STC)

Peak Power Watts-P _{max} (Wp)*	400	405	410	415	420	425	430
Power Tolerance-PMAX (W)				0~+5			
Maximum Power Voltage-V _{mp} (V)	41.3	41.7	42.1	42.5	42.8	43.2	43.6
Maximum Power Current-I _{mp} (A)	9.68	9.71	9.73	9.77	9.80	9.84	9.87
Open Circuit Voltage-V _{oc} (V)	49.2	49.6	50.1	50.5	50.9	51.4	51.8
Short Circuit Current-I _{sc} (A)	10.30	10.33	10.37	10.40	10.43	10.47	10.50
Module Efficiency, η _m (%)	20.0	20.3	20.5	20.8	21.0	21.3	21.5

STC: Irradiance 1000W/m², Cell Temperature 25°C, Air Mass AM1.5. *Measuring tolerance: ±3%

Electrical characteristics with different power bin (reference to 10% Irradiance ratio)

Total Equivalent power-P _{max} (Wp)	425	431	437	442	447	453	458
Maximum Power Voltage-V _{mp} (V)	41.3	41.7	42.1	42.5	42.8	43.2	43.6
Maximum Power Current-I _{mp} (A)	10.31	10.34	10.36	10.41	10.44	10.48	10.51
Open Circuit Voltage-V _{oc} (V)	49.2	49.6	50.1	50.5	50.9	51.4	51.8
Short Circuit Current-I _{sc} (A)	10.97	11.00	11.04	11.08	11.11	11.15	11.18
Irradiance ratio (rear/front)				10%			

Power Tolerance: ±5%±10%

ELECTRICAL DATA (NOCT)

Maximum Power-P _{max} (Wp)	312	308	312	316	319	324	328
Maximum Power Voltage-V _{mp} (V)	38.6	39.0	39.3	39.7	40.0	40.4	40.7
Maximum Power Current-I _{mp} (A)	7.08	7.91	7.93	7.96	7.98	8.01	8.04
Open Circuit Voltage-V _{oc} (V)	46.6	47.0	47.5	47.8	48.2	48.7	49.1
Short Circuit Current-I _{sc} (A)	8.30	8.32	8.36	8.38	8.41	8.44	8.46

NOCT: Irradiance at 800W/m², Ambient Temperature 20°C, Wind Speed 1m/s

MECHANICAL DATA

Solar Cells	Topcon Bifacial
No. of cells	144cells
Module Dimensions	1762×1134×30mm (69.37×44.65×1.18 inches)
Weight	21.3kg (47.0 lb)
Front Glass	3.2mm (0.12 inches), High Transmission, Tempered Glass
Encapsulant material	POE/EVA
Backsheet	Black Grid Transparent Backsheet
Frame	30mm (1.18 inches) Anodized Aluminium Alloy, Black
J-Box	IP68 rated
Cables	Photovoltaic Technology Cable 4.0mm² (0.006 inches²) Landscape: V1100mm/P1100mm (43.31/43.31 inches)
Connector	MC4 EVO2
Fire Type	Type 1 or Type 2

TEMPERATURE RATINGS

NOCT (Nominal Operating Cell Temperature)	43°C (±2°C)
Temperature Coefficient of P _{max}	-0.30%/°C
Temperature Coefficient of V _{oc}	-0.24%/°C
Temperature Coefficient of I _{sc}	0.04%/°C

MAXIMUM RATINGS

Operational Temperature	-40~+85°C
Maximum System Voltage	1500V DC (IEC)
Max Series Fuse Rating	25 A

WARRANTY


25 year Product Workmanship Warranty
25 year Power Warranty
1% first year degradation
0.4% Annual Power Attenuation

(Please refer to product warranty for details)

PACKAGING CONFIGURATION

Modules per box: 35 pieces
Modules per 40' container: 792 pieces
Pallet dimensions (L x W x H): 1800 x 1135 x 1259 mm
Pallet weight: 829 kg (1827 lb)

Comprehensive Products and System Certificates



CAUTION: READ SAFETY AND INSTALLATION INSTRUCTIONS BEFORE USING THE PRODUCT.

© 2023 Trina Solar Co., Ltd. All rights reserved. Specifications included in this datasheet are subject to change without notice.

Version number: TSM_NA_EN_2023_A

www.trinasolar.com

LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS

DESCRIPTION	DATE	REV

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-11

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US /
SE11400H-US



12-25
YEAR
WARRANTY

HOME BACKUP



Eligible for domestic content: SolarEdge USA-manufactured inverters*, when paired with certain SolarEdge power optimizers, are intended to be eligible for the enhanced federal income tax credit for domestic content.	Fast and easy installation – small and lightweight, with reduced commissioning time
The ultimate home energy manager in charge of PV production, battery storage, backup operation during a power outage**, EV Charging, and smart energy devices	A scalable solution that supports future homeowner needs through easy connection to a growing ecosystem of products
Record breaking 99% weighted efficiency with up to 200% DC oversizing	Advanced safety features with integrated arc fault protection and rapid shutdown for 690.11 and 690.12
Ability to start high LRA HVAC systems during backup operation	Advanced reliability with automotive-grade components
Integrates seamlessly with the complete SolarEdge Home Smart Energy Ecosystem, through SolarEdge Home Network	Embedded revenue grade production data, ANSI C12.20, Class 0.5
Module-level monitoring and visibility of battery status, PV production, and self-consumption data	NEMA 4X-rated, for indoor and outdoor installations
	Embedded Power Control System (PCS) – install larger systems while avoiding main panel upgrade

[illegible]

solaredge.com

USA Domestic Content Eligible
Single Phase, for North America

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US / SE11400H-US

Applicable to inverters with part number	SExxxxxX-USMNXbLx5 / USExxxxxX-USMNBbL75				
Model Number ¹⁾	SE3800H-US	SE5700H-US	SE7600H-US	SE10000H-US	SE11400H-US
OUTPUT – AC ON GRID					
Maximum AC Power Output	3800 @ 240V 3100 @ 208V	5760 @ 240V 5200 @ 208V	7680 @ 240V	10,000 @ 240V 9000 @ 208V	11,400 @ 240V 10,000 @ 208V
AC Output Voltage (Nominal)	208 / 240				
AC Output Voltage Range	181 – 274				
AC Frequency Range (Hz) – nominal	50.3 – 60.5 ²⁾				
Maximum Continuous Output Current	16 @ 240V 16 @ 208V	24 @ 240V 21 @ 208V	32 @ 240V	42 @ 240V	47.5 @ 240V 46 @ 208V
GFN Threshold	1				
Total Harmonic Distortion (THD)	< 5				
Power Factor	1, adjustable > 0.95 (to 0.85)				
Utility Mains Voltage, Maximum Protection	Yes				
Current Limitable Trips (inrush)	Yes				
Charge Battery from AC (if allowed)	Yes				
Typical Nighttime Power Consumption	< 2.5				
OUTPUT – AC STANDALONE (BACKUP) ³⁾					
Rated AC Power in Standalone Operation ⁴⁾	7,400				
Maximum Continuous Output Current in Standalone Operation ⁵⁾	48				
Maximum AC Voltage @ 80%	Up to 100				
AC L-L Output Voltage Range in Standalone Operation	211 – 261				
AC L-N Output Voltage Range in Standalone Operation	105 – 132				
AC Frequency Range in Standalone Operation (Hz) – nominal	55 – 60 – 65				
GFN	1				
THD	< 5				
INPUT – DC (PV AND BATTERY)					
Transformer-less, Ungrounded	Yes				
Maximum Input Voltage	630				
Nominal DC Input Voltage	550				
Reverse Polarity Protection	Yes				
Cross-Line Isolation Detection	60VDC Sensitivity				
Maximum Input Short-Circuit Current	N/A				
Maximum Inverter Efficiency	99.4				
CEC Weighted DC Energy	98.5				
2-Pole Disconnection	Yes				
DC CONNECTION – PV					
Maximum Input Power	3900 @ 240V 6000 @ 208V	11,500 @ 240V 15,000 @ 208V	15,000 @ 240V	20,000 @ 240V	32,000 @ 240V 20,000 @ 208V
Maximum Input Current	20 @ 240V 17.5 @ 208V	30 @ 240V 26 @ 208V	40 @ 240V	58 @ 240V	65 @ 240V 53.5 @ 208V
Number of Ports	2				
Maximum Current per Port	40				

[illegible]

© 2012 Wiley Periodicals, Inc. All rights reserved. DOI: 10.1002/anie.201200444. The Wiley Online Library on Wiley InterScience (www.interscience.wiley.com) is a service that allows registered users to access Wiley InterScience journals and Wiley InterScience databases. For more information on Wiley InterScience, please visit the Wiley InterScience website at <http://www.interscience.wiley.com>. Date: September 17, 2012 11:41:14 AM. Subject: Organic Chemistry.



USA Domestic Content Eligible
Single Phase, for North America

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US / SE11400H-US

Applicable to inverters with part number	SExxxx0H-USMNXBLx5 / USExxx0H-USMNBTLx5			
Model Number ⁽¹⁾	SE3800H-US	SE5700H-US	SE7600H-US	SE10000H-US
DC CONNECTION – BATTERY				
Supported Battery Types	SolarEdge home Battery 400V			
Number of Batteries per Inverter	Up to 3			
Maximum Continuous Power (Charge and Discharge) ⁽²⁾	13,600			
Number of Ports	2			
Maximum Current per Port	40			
2-wire Disconnection	Up to the inverter rated transience power			
SMART ENERGY CAPABILITIES				
Consumption Matching	Built-in ⁽³⁾			
Standalone & Battery Storage	With Back-up Interface (part sold separately) for service up to 20kVA, up to 3 inverters			
EV Charging	Direct connection to the SolarEdge home EV Charger ⁽⁴⁾			
ADDITIONAL FEATURES				
Supported Communication Interfaces	RS-485, Ethernet, Cellular ⁽⁵⁾ , Wi-Fi ⁽⁶⁾ (optional), SolarEdge home Network ⁽⁷⁾ (optional)			
Reverse Grade-Marking, A-IO, CIG-IO ⁽⁸⁾	Built-in ⁽³⁾			
Integrated AC, DC, and Communication Connection Unit	Yes			
Power Monitoring	With the SEApp mobile application using built-in Wi-Fi Access Point for local connection			
AC Voltage, Power, Shunt, CT and Energy	Yes, NEMA 3R ⁽⁹⁾			
STANDARD COMPLIANCE				
Safety	UL 1741, UL 1741A, UL 1718, UL 1699, CSA 22.2 117, IEC 62109-1, IEC 62109-2, IEC 62470, IEC 62473, IEC 62540, IEC 62541, IEC 62542, IEC 62543, IEC 62544, IEC 62545, IEC 62546, IEC 62547, IEC 62548, IEC 62549, IEC 62550, IEC 62551, IEC 62552, IEC 62553, IEC 62554, IEC 62555, IEC 62556, IEC 62557, IEC 62558, IEC 62559, IEC 62560, IEC 62561, IEC 62562, IEC 62563, IEC 62564, IEC 62565, IEC 62566, IEC 62567, IEC 62568, IEC 62569, IEC 62570, IEC 62571, IEC 62572, IEC 62573, IEC 62574, IEC 62575, IEC 62576, IEC 62577, IEC 62578, IEC 62579, IEC 62580, IEC 62581, IEC 62582, IEC 62583, IEC 62584, IEC 62585, IEC 62586, IEC 62587, IEC 62588, IEC 62589, IEC 62590, IEC 62591, IEC 62592, IEC 62593, IEC 62594, IEC 62595, IEC 62596, IEC 62597, IEC 62598, IEC 62599, IEC 62600, IEC 62601, IEC 62602, IEC 62603, IEC 62604, IEC 62605, IEC 62606, IEC 62607, IEC 62608, IEC 62609, IEC 62610, IEC 62611, IEC 62612, IEC 62613, IEC 62614, IEC 62615, IEC 62616, IEC 62617, IEC 62618, IEC 62619, IEC 62620, IEC 62621, IEC 62622, IEC 62623, IEC 62624, IEC 62625, IEC 62626, IEC 62627, IEC 62628, IEC 62629, IEC 62630, IEC 62631, IEC 62632, IEC 62633, IEC 62634, IEC 62635, IEC 62636, IEC 62637, IEC 62638, IEC 62639, IEC 62640, IEC 62641, IEC 62642, IEC 62643, IEC 62644, IEC 62645, IEC 62646, IEC 62647, IEC 62648, IEC 62649, IEC 62650, IEC 62651, IEC 62652, IEC 62653, IEC 62654, IEC 62655, IEC 62656, IEC 62657, IEC 62658, IEC 62659, IEC 62660, IEC 62661, IEC 62662, IEC 62663, IEC 62664, IEC 62665, IEC 62666, IEC 62667, IEC 62668, IEC 62669, IEC 62670, IEC 62671, IEC 62672, IEC 62673, IEC 62674, IEC 62675, IEC 62676, IEC 62677, IEC 62678, IEC 62679, IEC 62680, IEC 62681, IEC 62682, IEC 62683, IEC 62684, IEC 62685, IEC 62686, IEC 62687, IEC 62688, IEC 62689, IEC 62690, IEC 62691, IEC 62692, IEC 62693, IEC 62694, IEC 62695, IEC 62696, IEC 62697, IEC 62698, IEC 62699, IEC 62700, IEC 62701, IEC 62702, IEC 62703, IEC 62704, IEC 62705, IEC 62706, IEC 62707, IEC 62708, IEC 62709, IEC 62710, IEC 62711, IEC 62712, IEC 62713, IEC 62714, IEC 62715, IEC 62716, IEC 62717, IEC 62718, IEC 62719, IEC 62720, IEC 62721, IEC 62722, IEC 62723, IEC 62724, IEC 62725, IEC 62726, IEC 62727, IEC 62728, IEC 62729, IEC 62730, IEC 62731, IEC 62732, IEC 62733, IEC 62734, IEC 62735, IEC 62736, IEC 62737, IEC 62738, IEC 62739, IEC 62740, IEC 62741, IEC 62742, IEC 62743, IEC 62744, IEC 62745, IEC 62746, IEC 62747, IEC 62748, IEC 62749, IEC 62750, IEC 62751, IEC 62752, IEC 62753, IEC 62754, IEC 62755, IEC 62756, IEC 62757, IEC 62758, IEC 62759, IEC 62760, IEC 62761, IEC 62762, IEC 62763, IEC 62764, IEC 62765, IEC 62766, IEC 62767, IEC 62768, IEC 62769, IEC 62770, IEC 62771, IEC 62772, IEC 62773, IEC 62774, IEC 62775, IEC 62776, IEC 62777, IEC 62778, IEC 62779, IEC 62780, IEC 62781, IEC 62782, IEC 62783, IEC 62784, IEC 62785, IEC 62786, IEC 62787, IEC 62788, IEC 62789, IEC 62790, IEC 62791, IEC 62792, IEC 62793, IEC 62794, IEC 62795, IEC 62796, IEC 62797, IEC 62798, IEC 62799, IEC 62800, IEC 62801, IEC 62802, IEC 62803, IEC 62804, IEC 62805, IEC 62806, IEC 62807, IEC 62808, IEC 62809, IEC 62810, IEC 62811, IEC 62812, IEC 62813, IEC 62814, IEC 62815, IEC 62816, IEC 62817, IEC 62818, IEC 62819, IEC 62820, IEC 62821, IEC 62822, IEC 62823, IEC 62824, IEC 62825, IEC 62826, IEC 62827, IEC 62828, IEC 62829, IEC 62830, IEC 62831, IEC 62832, IEC 62833, IEC 62834, IEC 62835, IEC 62836, IEC 62837, IEC 62838, IEC 62839, IEC 62840, IEC 62841, IEC 62842, IEC 62843, IEC 62844, IEC 62845, IEC 62846, IEC 62847, IEC 62848, IEC 62849, IEC 62850, IEC 62851, IEC 62852, IEC 62853, IEC 62854, IEC 62855, IEC 62856, IEC 62857, IEC 62858, IEC 62859, IEC 62860, IEC 62861, IEC 62862, IEC 62863, IEC 62864, IEC 62865, IEC 62866, IEC 62867, IEC 62868, IEC 62869, IEC 62870, IEC 62871, IEC 62872, IEC 62873, IEC 62874, IEC 62875, IEC 62876, IEC 62877, IEC 62878, IEC 62879, IEC 62880, IEC 62881, IEC 62882, IEC 62883, IEC 62884, IEC 62885, IEC 62886, IEC 62887, IEC 62888, IEC 62889, IEC 62890, IEC 62891, IEC 62892, IEC 62893, IEC 62894, IEC 62895, IEC 62896, IEC 62897, IEC 62898, IEC 62899, IEC 62900, IEC 62901, IEC 62902, IEC 62903, IEC 62904, IEC 62905, IEC 62906, IEC 62907, IEC 62908, IEC 62909, IEC 62910, IEC 62911, IEC 62912, IEC 62913, IEC 62914, IEC 62915, IEC 62916, IEC 62917, IEC 62918, IEC 62919, IEC 62920, IEC 62921, IEC 62922, IEC 62923, IEC 62924, IEC 62925, IEC 62926, IEC 62927, IEC 62928, IEC 62929, IEC 62930, IEC 62931, IEC 62932, IEC 62933, IEC 62934, IEC 62935, IEC 62936, IEC 62937, IEC 62938, IEC 62939, IEC 62940, IEC 62941, IEC 62942, IEC 62943, IEC 62944, IEC 62945, IEC 62946, IEC 62947, IEC 62948, IEC 62949, IEC 62950, IEC 62951, IEC 62952, IEC 62953, IEC 62954, IEC 62955, IEC 62956, IEC 62957, IEC 62958, IEC 62959, IEC 62960, IEC 62961, IEC 62962, IEC 62963, IEC 62964, IEC 62965, IEC 62966, IEC 62967, IEC 62968, IEC 62969, IEC 62970, IEC 62971, IEC 62972, IEC 62973, IEC 62974, IEC 62975, IEC 62976, IEC 62977, IEC 62978, IEC 62979, IEC 62980, IEC 62981, IEC 62982, IEC 62983, IEC 62984, IEC 62985, IEC 62986, IEC 62987, IEC 62988, IEC 62989, IEC 62990, IEC 62991, IEC 62992, IEC 62993, IEC 62994, IEC 62995, IEC 62996, IEC 62997, IEC 62998, IEC 62999, IEC 63000, IEC 63001, IEC 63002, IEC 63003, IEC 63004, IEC 63005, IEC 63006, IEC 63007, IEC 63008, IEC 63009, IEC 63010, IEC 63011, IEC 63012, IEC 63013, IEC 63014, IEC 63015, IEC 63016, IEC 63017, IEC 63018, IEC 63019, IEC 63020, IEC 63021, IEC 63022, IEC 63023, IEC 63024, IEC 63025, IEC 63026, IEC 63027, IEC 63028, IEC 63029, IEC 63030, IEC 63031, IEC 63032, IEC 63033, IEC 63034, IEC 63035, IEC 63036, IEC 63037, IEC 63038, IEC 63039, IEC 63040, IEC 63041, IEC 63042, IEC 63043, IEC 63044, IEC 63045, IEC 63046, IEC 63047, IEC 63048, IEC 63049, IEC 63050, IEC 63051, IEC 63052, IEC 63053, IEC 63054, IEC 63055, IEC 63056, IEC 63057, IEC 63058, IEC 63059, IEC 63060, IEC 63061, IEC 63062, IEC 63063, IEC 63064, IEC 63065, IEC 63066, IEC 63067, IEC 63068, IEC 63069, IEC 63070, IEC 63071, IEC 63072, IEC 63073, IEC 63074, IEC 63075, IEC 63076, IEC 63077, IEC 63078, IEC 63079, IEC 63080, IEC 63081, IEC 63082, IEC 63083, IEC 63084, IEC 63085, IEC 63086, IEC 63087, IEC 63088, IEC 63089, IEC 63090, IEC 63091, IEC 63092, IEC 63093, IEC 63094, IEC 63095, IEC 63096, IEC 63097, IEC 63098, IEC 63099, IEC 63100, IEC 63101, IEC 63102, IEC 63103, IEC 63104, IEC 63105, IEC 63106, IEC 63107, IEC 63108, IEC 63109, IEC 63110, IEC 63111, IEC 63112, IEC 63113, IEC 63114, IEC 63115, IEC 63116, IEC 63117, IEC 63118, IEC 63119, IEC 63120, IEC 63121, IEC 63122, IEC 63123, IEC 63124, IEC 63125, IEC 63126, IEC 63127, IEC 63128, IEC 63129, IEC 63130, IEC 63131, IEC 63132, IEC 63133, IEC 63134, IEC 63135, IEC 63136, IEC 63137, IEC 63138, IEC 63139, IEC 63140, IEC 63141, IEC 63142, IEC 63143, IEC 63144, IEC 63145, IEC 63146, IEC 63147, IEC 63148, IEC 63149, IEC 63150, IEC 63151, IEC 63152, IEC 63153, IEC 63154, IEC 63155, IEC 63156, IEC 63157, IEC 63158, IEC 63159, IEC 63160, IEC 63161, IEC 63162, IEC 63163, IEC 63164, IEC 63165, IEC 63166, IEC 63167, IEC 63168, IEC 63169, IEC 63170, IEC 63171, IEC 63172, IEC 63173, IEC 63174, IEC 63175, IEC 63176, IEC 63177, IEC 63178, IEC 63179, IEC 63180, IEC 63181, IEC 63182, IEC 63183, IEC 63184, IEC 63185, IEC 63186, IEC 63187, IEC 63188, IEC 63189, IEC 63190, IEC 63191, IEC 63192, IEC 63193, IEC 63194, IEC 63195, IEC 63196, IEC 63197, IEC 63198, IEC 63199, IEC 63200, IEC 63201, IEC 63202, IEC 63203, IEC 63204, IEC 63205, IEC 63206, IEC 63207, IEC 63208, IEC 63209, IEC 63210, IEC 63211, IEC 63212, IEC 63213, IEC 63214, IEC 63215, IEC 63216, IEC 63217, IEC 63218, IEC 63219, IEC 63220, IEC 63221, IEC 63222, IEC 63223, IEC 63224, IEC 63225, IEC 63226, IEC 63227, IEC 63228, IEC 63229, IEC 63230, IEC 63231, IEC 63232, IEC 63233, IEC 63234, IEC 63235, IEC 63236, IEC 63237, IEC 63238, IEC 63239, IEC 63240, IEC 63241, IEC 63242, IEC 63243, IEC 63244, IEC 63245, IEC 63246, IEC 63247, IEC 63248, IEC 63249, IEC 63250, IEC 63251, IEC 63252, IEC 63253, IEC 63254, IEC 63255, IEC 63256, IEC 63257, IEC 63258, IEC 63259, IEC 63260, IEC 63261, IEC 63262, IEC 63263, IEC 63264, IEC 63265, IEC 63266, IEC 63267, IEC 63268, IEC 63269, IEC 63270, IEC 63271, IEC 63272, IEC 63273, IEC 63274, IEC 63275, IEC 63276, IEC 63277, IEC 63278, IEC 63279, IEC 63280, IEC 63281, IEC 63282, IEC 63283, IEC 63284, IEC 63285, IEC 63286, IEC 63287, IEC 63288, IEC 63289, IEC 63290, IEC 63291, IEC 63292, IEC 63293, IEC 63294, IEC 63295, IEC 63296, IEC 63297, IEC 63298, IEC 63299, IEC 63300, IEC 63301, IEC 63302, IEC 63303, IEC 63304, IEC 63305, IEC 63306, IEC 63307, IEC 63308, IEC 63309, IEC 63310, IEC 63311, IEC 63312, IEC 63313, IEC 63314, IEC 63315, IEC 63316, IEC 63317, IEC 63318, IEC 63319, IEC 63320, IEC 63321, IEC 63322, IEC 63323, IEC 63324, IEC 63325, IEC 63326, IEC 63327, IEC 63328, IEC 63329, IEC 63330, IEC 63331, IEC 63332, IEC 63333, IEC 63334, IEC 63335, IEC 63336, IEC 63337, IEC 63338, IEC 63339, IEC 63340, IEC 63341, IEC 63342, IEC 63343, IEC 63344, IEC 63345, IEC 63346, IEC 63347, IEC 63348, IEC 63349, IEC 63350, IEC 63351, IEC 63352, IEC 63353, IEC 63354, IEC 63355, IEC 63356, IEC 63357, IEC 63358, IEC 63359, IEC 63360, IEC 63361, IEC 63362, IEC 63363, IEC 63364, IEC 63365, IEC 63366, IEC 63367, IEC 63368, IEC 63369, IEC 63370, IEC 63371, IEC 63372, IEC 63373, IEC 63374, IEC 63375, IEC 63376, IEC 63377, IEC 63378, IEC 63379, IEC 63380, IEC 63381, IEC 63382, IEC 63383, IEC 63384, IEC 63385, IEC 63386, IEC 63387, IEC 63388, IEC 63389, IEC 63390, IEC 63391, IEC 63392, IEC 63393, IEC 63394, IEC 63395, IEC 63396, IEC 63397, IEC 63398, IEC 63399, IEC 63400, IEC 63401, IEC 63402, IEC 63403, IEC 63404, IEC 63405, IEC 63406, IEC 63407, IEC 63408, IEC 63409, IEC 63410, IEC 63411, IEC 63412, IEC 63413, IEC 63414, IEC 63415, IEC 63416, IEC 63417, IEC 63418, IEC 63419, IEC 63420, IEC 63421, IEC 63422, IEC 63423, IEC 63424, IEC 63425, IEC 63426, IEC 63427, IEC 63428, IEC 63429, IEC 63430, IEC 63431, IEC 63432, IEC 63433, IEC 63434, IEC 63435, IEC 63436, IEC 63437, IEC 63438, IEC 63439, IEC 63440, IEC 63441, IEC 63442, IEC 63443, IEC 63444, IEC 63445, IEC 63446, IEC 63447, IEC 63448, IEC 63449, IEC 63450, IEC 63451, IEC 63452, IEC 63453, IEC 63454, IEC 63455, IEC 63456, IEC 63457, IEC 63458, IEC 63459, IEC 63460, IEC 63461, IEC 63462, IEC 63463, IEC 63464, IEC 63465, IEC 63466, IEC 63467, IEC 63468, IEC 63469, IEC 63470, IEC 63471, IEC 63472, IEC 63473, IEC 63474, IEC 63475, IEC 63476, IEC 63477, IEC 63478, IEC 63479, IEC 63480, IEC 63481, IEC 63482, IEC 63483, IEC 63484, IEC 63485, IEC 63486, IEC 63487, IEC 63488, IEC 63489, IEC 63490, IEC 63491, IEC 63492, IEC 63493, IEC 63494, IEC 63495, IEC 63496, IEC 63497, IEC 63498, IEC 63499, IEC 63500, IEC 63501, IEC 63502, IEC 63503, IEC 63504, IEC 63505, IEC 63506, IEC 63507, IEC 63508, IEC 63509, IEC 63510, IEC 63511, IEC 63512, IEC 63513, IEC 63514, IEC 63515, IEC 63516, IEC 63517, IEC 63518, IEC 63519, IEC 63520, IEC 63521, IEC 63522, IEC 63523, IEC 63524, IEC 63525, IEC 63526, IEC 63527, IEC 63528, IEC 63529, IEC 63530, IEC 63531, IEC 63532, IEC 63533, IEC 63534, IEC 63535, IEC 63536, IEC 63537, IEC 63538, IEC 63539, IEC 63540, IEC 63541, IEC 63542, IEC 63543, IEC 63544, IEC 63545, IEC 63546, IEC 63547, IEC 63548, IEC 63549, IEC 63550, IEC 63551, IEC 63552, IEC 63553, IEC 63554, IEC 63555, IEC 63556, IEC 63557, IEC 63558, IEC 63559, IEC 63560, IEC 63561, IEC 63562, IEC 63563, IEC 63564, IEC 63565, IEC 63566, IEC 63567, IEC 63568, IEC 63569, IEC 63570, IEC 63571, IEC 63572, IEC 63573, IEC 63574, IEC 63575, IEC 63576, IEC 63577, IEC 63578, IEC 63579, IEC 63580, IEC 63581, IEC 63582, IEC 63583, IEC 63584, IEC 63585, IEC 63586, IEC 63587, IEC 63588, IEC 63589, IEC 63590, IEC 63591, IEC 63592, IEC 63593, IEC 63594, IEC 63595, IEC 63596, IEC 63597, IEC 63598, IEC 63599, IEC 63600, IEC 63601, IEC 63602, IEC 63603, IEC 63604, IEC 63605, IEC 63606, IEC 63607, IEC 63608, IEC 63609, IEC 63610, IEC 63611, IEC 63612, IEC 63613, IEC 63614, IEC 63615, IEC 63616, IEC 63617, IEC 63618, IEC 63619, IEC 63620, IEC 63621, IEC 63622, IEC 63623, IEC 63624, IEC 63625, IEC 63626, IEC 63627, IEC 63628, IEC 63629, IEC 63630, IEC 63631, IEC 63632, IEC 63633, IEC 63634, IEC 63635, IEC 63636, IEC 63637, IEC 63638, IEC 63639, IEC 63640, IEC 63641, IEC 63642, IEC 63643, IEC 63644, IEC 63645, IEC 63646, IEC 63647, IEC 63648, IEC 63649, IEC 63650, IEC 63651, IEC 63652, IEC 63653, IEC 63654, IEC 63655, IEC 63656, IEC 63657, IEC 63658, IEC 63659, IEC 63660, IEC 63661, IEC 63662, IEC 63663, IEC 63664, IEC 63665, IEC 63666, IEC 63667, IEC 63668, IEC 63669, IEC 63670, IEC 63671, IEC 63672, IEC 63673, IEC 63674, IEC 63675, IEC 63676, IEC 63677, IEC 63678, IEC 63679, IEC 63680, IEC 63681, IEC 63682, IEC 63683, IEC 63684, IEC 63685, IEC 63686, IEC 63687, IEC 63688, IEC 63689, IEC 63690, IEC 63691, IEC 63692, IEC 63693, IEC 63694, IEC 63695, IEC 63696, IEC 63697, IEC 63698, IEC 63699, IEC 63700, IEC 63701, IEC 63702, IEC 63703, IEC 63704, IEC 63705, IEC 63706, IEC 63707, IEC 63708, IEC 63709, IEC 63710, IEC 63711, IEC 63712, IEC 63713, IEC 63714, IEC 63715, IEC 63716, IEC 63717, IEC 63718, IEC 63719, IEC 63720, IEC 63721, IEC 63722, IEC 63723, IEC 63724, IEC 63725, IEC 63726, IEC 63727, IEC 63728, IEC 63729, IEC 63730, IEC 63731, IEC 63732, IEC 63733, IEC 63734, IEC 63735, IEC 63736, IEC 63737, IEC 63738, IEC 63739, IEC 63740, IEC 63741, IEC 63742, IEC 63743, IEC 63744, IEC 63745, IEC 63746, IEC 63747, IEC 63748, IEC 63749, IEC 63750, IEC 63751, IEC 63752, IEC 63753, IEC 63754, IEC 63755, IEC 63756, IEC 63757, IEC 63758, IEC 63759, IEC 63760, IEC 63761, IEC 63762, IEC 63763, IEC 63764, IEC 63765, IEC 63766, IEC 63767, IEC 63768, IEC 63769, IEC 63770, IEC 63771, IEC 63772, IEC 63773, IEC 63774, IEC 63775, IEC 63776, IEC 63777, IEC 63778, IEC 63779, IEC 63780, IEC 63781, IEC 63782, IEC 63783, IEC 63784, IEC 63785, IEC 63786, IEC 63787, IEC 63788, IEC 63789, IEC 63790, IEC 63791, IEC 63792, IEC 63793, IEC 63794, IEC 63795, IEC 63796, IEC 63797, IEC 63798, IEC 63799, IEC 63800, IEC 63801, IEC 63802, IEC 63803, IEC 63804, IEC 63805, IEC 63806, IEC 63807, IEC 63808, IEC 63809, IEC 63810, IEC 63811, IEC 63812, IEC 63813, IEC 63814, IEC 63815, IEC 63816, IEC 63817, IEC 63818, IEC 63819, IEC 63820, IEC 63821, IEC 63822, IEC 63823, IEC 63824, IEC 63825, IEC 63826, IEC 63827, IEC 63828, IEC 6			

[illegible]

LUNEX POWER
THE PURE SOURCE

LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE

DRAWN BY
ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER

PV-12

Residential Power Optimizer
For North America

S440 / S500B / S650B



POWER OPTIMIZER

PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Detected abnormal PV connector behavior, preventing potential safety issues
- Module-level voltage shutdown for installer and firefighter safety
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading
- Faster installations with simplified cable management and easy assembly using a single bolt
- Flexible system design for maximum space utilization
- Compatible with bifacial PV modules
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)

Residential Power Optimizer

For North America

S440 / S500B / S650B

	S440	S500B	S650B	
INPUT				
Rated Input DC Power ⁽¹⁾	440	500	650	W
Absolute Maximum Input Voltage (Voc)	60	125	85	Vdc
MPPT Operating Range	8 – 60	12.5 – 105	12.5 – 85	Vdc
Maximum Input Current (Maximum Isc of Connected PV Module)	14.5	15		Adc
Maximum Input Short Circuit Current ⁽²⁾		18.75		Adc
Maximum Efficiency		99.5		%
Weighted Efficiency		98.6		%
Overvoltage Category		II		
OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREGE INVERTER)				
Maximum Output Current		15		Adc
Maximum Output Voltage	60	80		Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREGE INVERTER OR INVERTER OFF)				
Safety Output Voltage per Power Optimizer		1 ± 0.1		Vdc
STANDARD COMPLIANCE				
Photovoltaic Rapid Shutdown System		NEC 2014 – 2023		
EMC		FCC Part 15 Class B, IEC 61000-6-2, IEC 61000-6-3		
Safety		IEC 62109-1 (class II safety), UL 1741		
Material		UL 94 V-0, UV Resistant		
RoHS		Yes		
Fire Safety		VDE-AR-E 2100-712:2013-05		
INSTALLATION SPECIFICATIONS				
Maximum Allowed System Voltage		1000		Vdc
Dimensions (W x L x H)	129 x 155 x 30 / 5.07 x 6.10 x 1.18	129 x 165 x 45 / 5.07 x 6.49 x 1.77		mm / in
Weight	720 / 1.6	790 / 1.74		gr / lb
Input Connector		MC4		
Input Wire Length		0.1 / 0.32		m / ft
Output Connector		MC4		
Output Wire Length		(+) 2.3, (-) 0.10 / (+) 7.54, (-) 0.32		m / ft
Operating Temperature Range ⁽³⁾		-40 to +85		°C
Protection Rating		IP68 / NEMA6P		
Relative Humidity		0 – 100		%

(1) Rated power of the module at STC will not exceed the power optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed.
(2) The Maximum Input Short Circuit Current is adjusted for worst case conditions of ambient temperature, irradiance, bifacial gain, and so on, in accordance with NEC and CSA.
(3) Power derating is applied for ambient temperatures above +85°C / +185°F for S440, and for ambient temperatures above +75°C / 167°F for S500B. Refer to the Power Optimizers Temperature Derating technical note for more details.

PV System Design Using a SolarEdge Inverter ⁽⁴⁾		SolarEdge Home Wave/Hub Single Phase	Three Phase for 208V Grid	Three Phase for 277/480V Grid	
Minimum String Length (Power Optimizers)	S440	8	10	18	
	S500B, S650B	6	8	14	
Maximum String Length (Power Optimizers)		25		50 ⁽⁵⁾	
Maximum Usable Power Delivered per String		5700	6000	12,750	W
Maximum Allowed Connected Power per String ⁽⁷⁾⁽⁸⁾	Inverters with Rated AC Power ≤ 5700W	Per the inverter's maximum input DC power ⁽⁶⁾	One string: 7200 Two strings or more: 7800	15,000	W
	Inverters with Rated AC Power of 6000W	5700			
	Inverters with Rated AC Power ≥ 7600W	6800, only when connected to at least two strings			
Parallel Strings of Different Lengths or Orientations		Yes			



(4) It is not allowed to mix S-series and P-series Power Optimizers in new installations in the same string.
(5) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30 V requirement.
(6) Refer to the Single String Design Guidelines application note for more details.
(7) For the 208 V grid, the maximum is permitted only when the difference in connected power between strings is 1,000 W or less.
(8) For the 240 V or 277/480 V grids, the maximum is permitted only when the difference in connected power between strings 2,000 W or less.

REVISIONS		
DESCRIPTION	DATE	REV

DATE: 03/05/2025	
PROJECT NAME & ADDRESS	
CHARLES DOWNING RESIDENCE 251 IRENE LN, LAKE CITY, FL 32055	

DRAWN BY ESR	
SHEET NAME EQUIPMENT SPECIFICATION	
SHEET SIZE ANSI B 11" X 17"	
SHEET NUMBER PV-13	

PART # TABLE		
P/N	DESCRIPTION	LENGTH
084RLM1	NXT HORIZON RAIL 84" MILL	84"
084RLD1	NXT HORIZON RAIL 84" DARK	84"
168RLM1	NXT HORIZON RAIL 168" MILL	168"
168RLD1	NXT HORIZON RAIL 168" DARK	168"
208RLM1	NXT HORIZON RAIL 208" MILL	208"
208RLD1	NXT HORIZON RAIL 208" DARK	208"
246RLM1	NXT HORIZON RAIL 246" MILL	246"
246RLD1	NXT HORIZON RAIL 246" DARK	246"

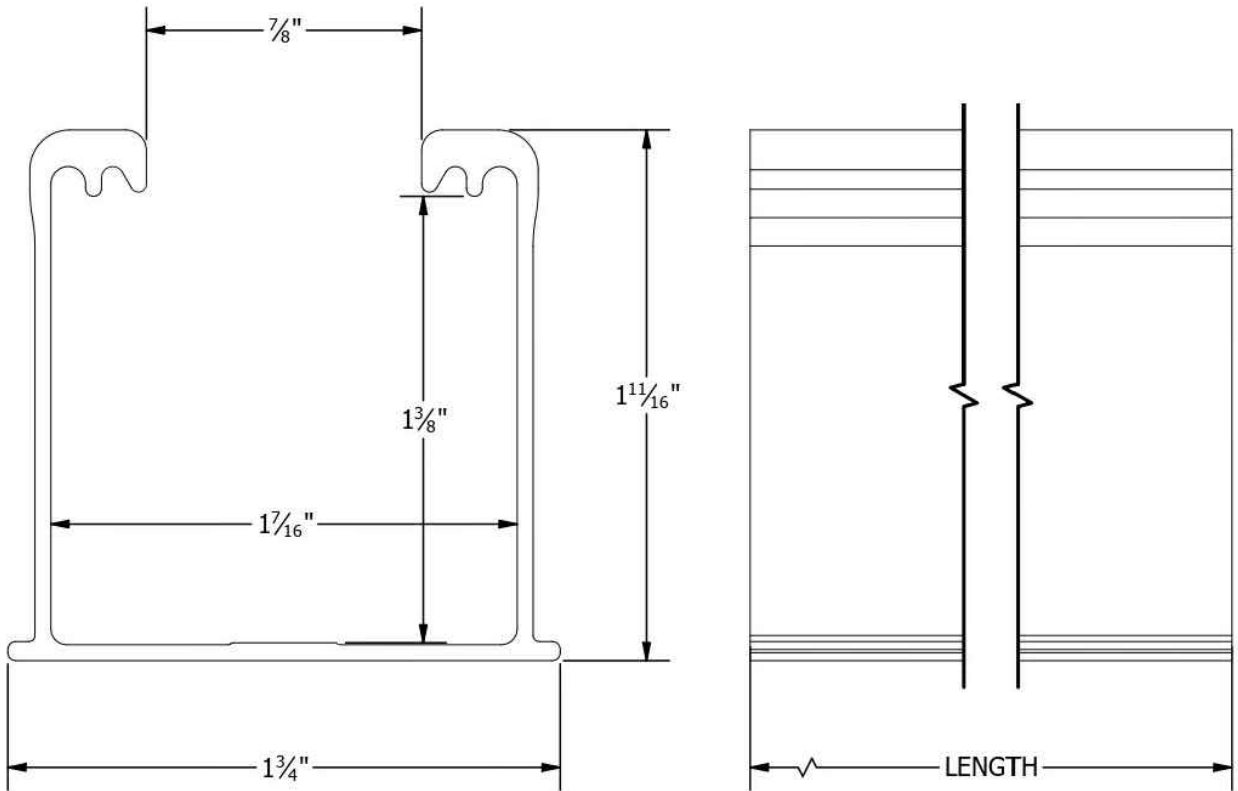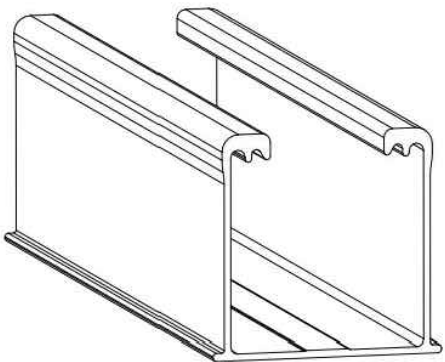

1411 BROADWAY BLVD. NE
ALBUQUERQUE, NM 87102 USA
PHONE: 505.242.6411
WWW.UNIRAC.COM

PRODUCT LINE:	NXT HORIZON
DRAWING TYPE:	PART DETAIL
DESCRIPTION:	RAIL
REVISION DATE:	9/13/2021

DRAWING NOT TO SCALE
ALL DIMENSIONS ARE
NOMINAL

PRODUCT PROTECTED BY
ONE OR MORE US PATENTS
LEGAL NOTICE

NH-P01

SHEET



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

DATE: 03/05/2025

PROJECT NAME & ADDRESS


CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY
ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
PV-14

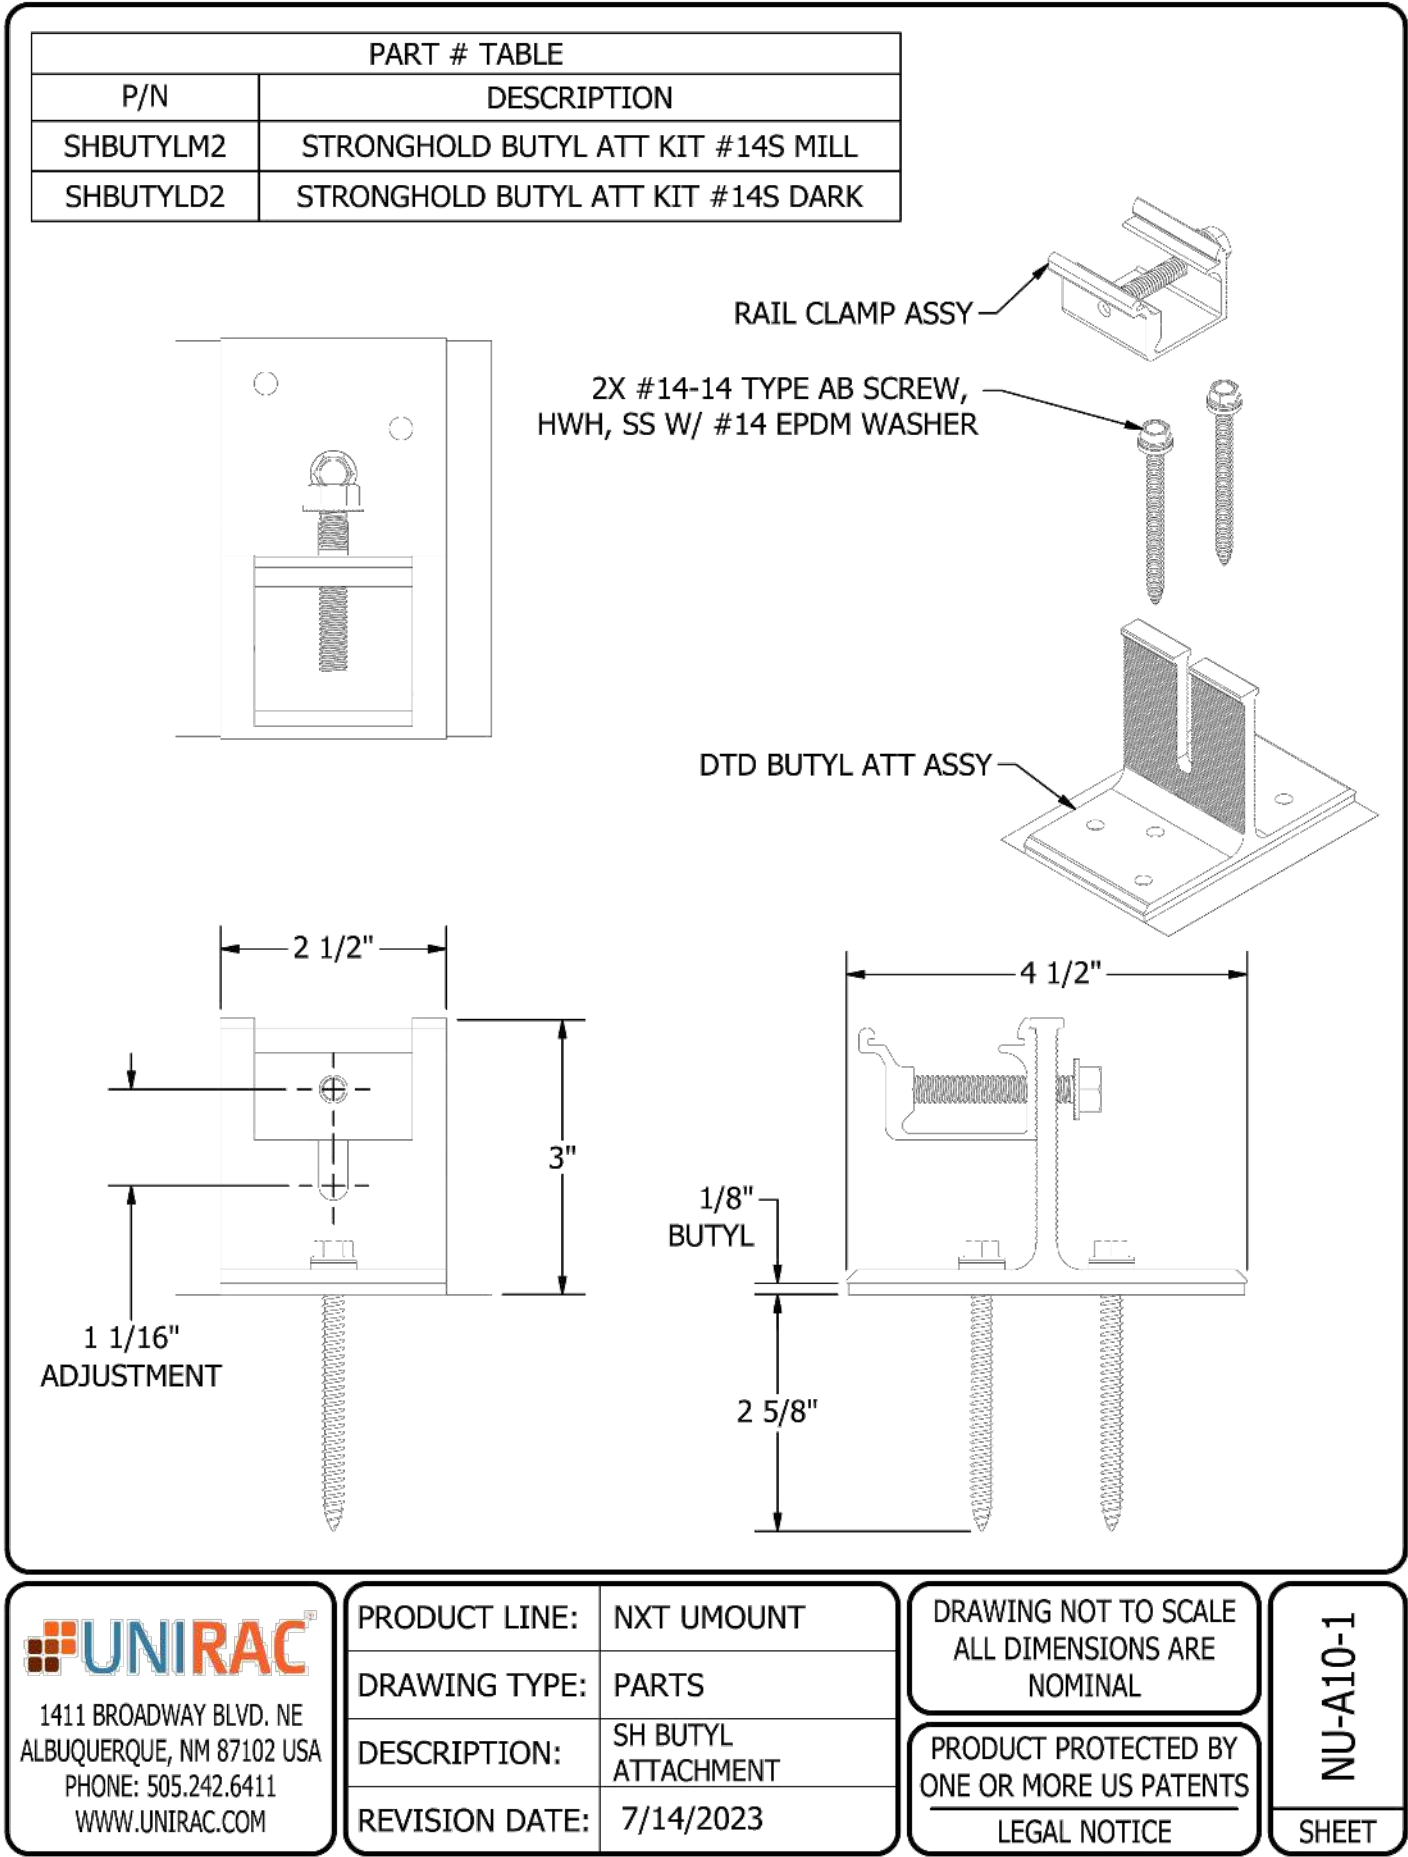

LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS		
DESCRIPTION	DATE	REV

DATE: 03/05/2025		
------------------	--	--



PROJECT NAME & ADDRESS		
CHARLES DOWNING RESIDENCE		
251 IRENE LN, LAKE CITY, FL 32055		

DRAWN BY
ESR

SHEET NAME
EQUIPMENT SPECIFICATION

SHEET SIZE
ANSI B 11" X 17"


SHEET NUMBER
PV-15

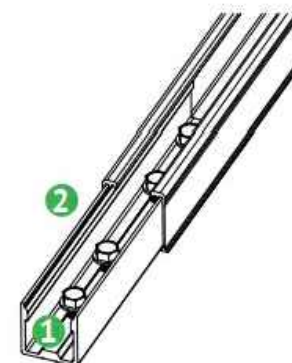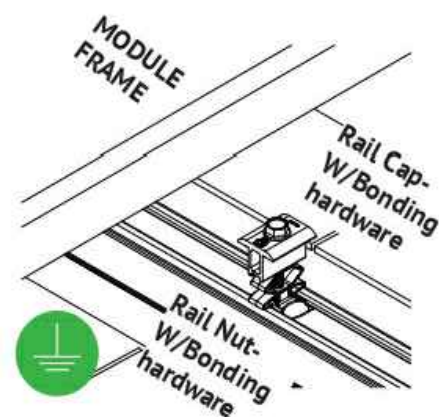

BONDING COMBO MID-END CLAMP ASSEMBLY

- 1 Aluminum combo mid-end clamp cap with stainless steel bonding pins that pierce module frame anodization to bond module to module through clamp
- 2 Stainless steel bolt bonds aluminum clamp to stainless steel Hex bolt
- 3 Aluminum combo mid-end clamp rail nut with stainless steel bonding pins that pierce rail anodization to bond module to module through clamp

NOTE: See Page 19 for installation details.

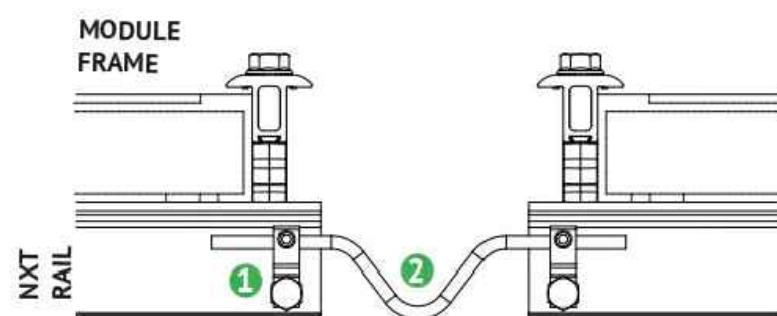

BONDING BETWEEN THERMAL BREAKS

- 1 Lug is connected at the end of each thermal break to the rail.
- 2 Solid copper wire is connected across the gap to bond the two ends.


NOTE: See Page 5 for installation details.

BONDING RAIL SPLICE

- 1 Bonding Hardware creates bond between Splice bar and each rail section.
- 2 Aluminum splice bar spans across rail gap to create rail to rail bond. Rail on at least one side of splice will be grounded.

NOTE:

- See Page 15 for installation details
- Splice certified for single-use only

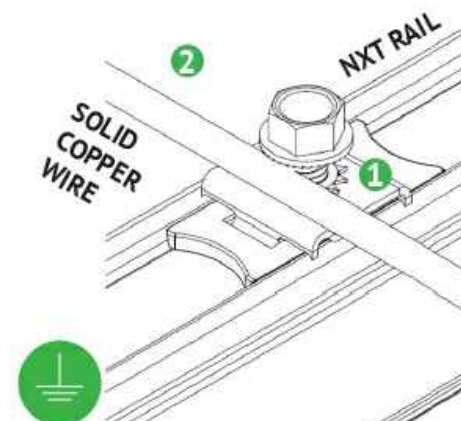

RACK SYSTEM GROUNDING

- 1 Tabs on the stainless-steel washer pierce anodization on the rail to bond rail to ground wire.
- 2 Solid copper wire connected to lug is routed to provide final system ground connection.

NOTE: See Page 16 for installation details and alternate racking system grounding methods.

REVISIONS

DESCRIPTION	DATE	REV

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY

ESR

SHEET NAME

EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-16


NXTUMOUNTTM

BONDING CONNECTIONS & GROUNDING PATHS

INSTALLATION GUIDE

22


PAGE

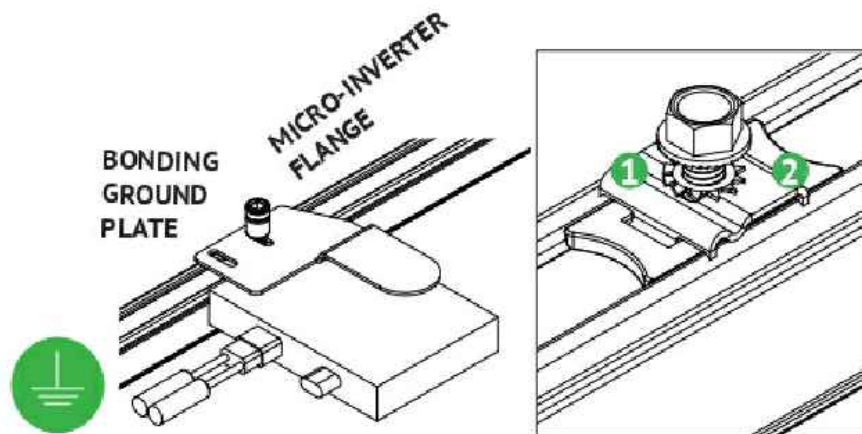

BONDING MICROINVERTER MOUNT

- 1 Stainless steel Tooth lock washer beneath the MLPE flange remove anodization on the MLPE and bonds.
- 2 Tabs on the stainless steel washer remove anodization on the rail and bonds.

NOTE: See Page 17 for installation details

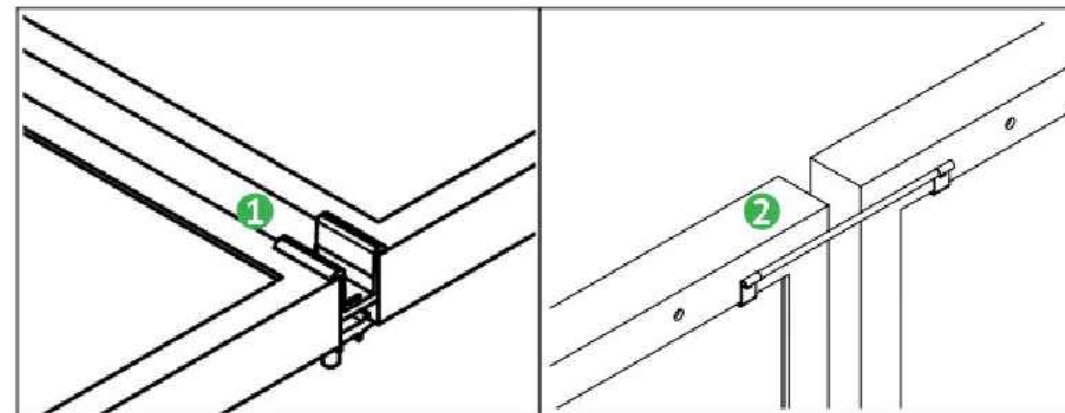

ALTERNATE ROW-TO-ROW BONDING PATHS

- 1 Row-to-row module bonding is accomplished with bonding clamp with 2 integral bonding pins.
- 2 Alternate method by connecting clips on either module to complete the bonding path.

NOTE:

- See Page 16 for installation details
- Row-to-row module bonding certified for single-use only

REVISIONS		
DESCRIPTION	DATE	REV

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE
251 IRENE LN,
LAKE CITY, FL 32055

DRAWN BY
ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE
ANSI B
11" X 17"

SHEET NUMBER
PV-17



JB-1.2, JB-1.XL

Specification Sheet

PV Junction Box for Composition/Asphalt Shingle Roofs

A. System Specifications and Ratings

- Maximum Voltage: 1,000 Volts
- Maximum Current: **JB-1.2:** 80 Amps; **JB-1.XL:** 120 Amps
- Allowable Wire: 14 AWG – 6 AWG
- Spacing: Please maintain a spacing of at least ½” between uninsulated live parts and fittings for conduit, armored cable, and uninsulated live parts of opposite polarity.
- Enclosure Rating: Type 3R
- Roof Slope Range: 2.5 – 12:12
- Max Side Wall Fitting Size: 1”
- Max Floor Pass-Through Fitting Size: 1”
- Ambient Operating Conditions: (-35°C) - (+75°C)
- Compliance:
 - **JB-1.2:** UL1741, CSA C22.2 No. 290; **JB-1.XL:** UL1741, CSA C22.2 No. 290
 - Approved wire connectors: must conform to UL1741, CSA C22.2 No. 290
- System Marking: **Intertek Symbol and File #5019942**
- Periodic Re-inspections: If re-inspections yield loose components, loose fasteners, or any corrosion between components, components that are found to be affected are to be replaced immediately.



Table 1: Typical Wire Size, Torque Loads and Ratings

	1 Conductor	2 Conductor	Torque				
			Type	NM	Inch Lbs	Voltage	Current
ABB ZS6 terminal block	10-24 awg	16-24 awg	Sol/Str	0.5-0.7	6.2-8.85	600V	30 amp
ABB ZS10 terminal block	6-24 awg	12-20 awg	Sol/Str	1.0-1.6	8.85-14.16	600V	40 amp
ABB ZS16 terminal block	4-24 awg	10-20 awg	Sol/Str	1.6-2.4	14.6-21.24	600V	60 amp
ABB M6/8 terminal block	8-22 awg		Sol/Str	.08-1	8.85	600V	50 amp
Ideal 452 Red WING-OUT Wire Connector	8-18 awg		Sol/Str	Self-Torque	Self-Torque	600V	
Ideal 451 Yellow WING-OUT Wire Connector	10-18 awg		Sol/Str	Self-Torque	Self-Torque	600V	
Ideal, In-Sure Push-In Connector Port #93	10-14 awg		Sol/Str	Self-Torque	Self-Torque	600V	
WAGO, 2204-1201	10-20 awg	16-24 awg	Sol/Str	Self-Torque	Self-Torque	600V	30 amp
WAGO, 221-612	10-20 awg	10-24 awg	Sol/Str	Self-Torque	Self-Torque	600V	30 amp
Dottie DRC75	6-12 awg		Sol/Str	Snap-In	Snap-In		
ESP NG-53	4-6 awg		Sol/Str		45	2000V	
	10-14 awg		Sol/Str		35		
ESP NG-717	4-6 awg		Sol/Str		45	2000V	
	10-14 awg		Sol/Str		35		
Brumall 4-5,3	4-6 awg		Sol/Str		45	2000V	
	10-14 awg		Sol/Str		35		

Table 2: Minimum wire-bending space for conductors through a wall opposite terminals in mm (inches)

Wire size, AWG or kcmil (mm2)	Wires per terminal (pole)			
	1 mm (inch)	2 mm (inch)	3 mm (inch)	4 or More mm (inch)
14-10 (2.1-5.3)	Not Specified	-	-	-
8 (8.4)	38.1 (1-1/2)	-	-	-
6 (13.3)	50.8 (2)	-	-	-



LUNEX POWER INC.
4721 N GRADY AVE
TAMPA FL 33614
LIC #: CVC57085
PHONE: 813-540-8807

REVISIONS

DESCRIPTION	DATE	REV

DATE: 03/05/2025

PROJECT NAME & ADDRESS

CHARLES DOWNING
RESIDENCE

DRAWN BY

ESR

SHEET NAME
EQUIPMENT
SPECIFICATION

SHEET SIZE

ANSI B
11" X 17"

SHEET NUMBER

PV-18



PHONE: 801-613-2759 | WWW.EZSOLARPRODUCTS.COM