



**ONE STORY WALL SECTION ON RAISED WOOD FLOOR FRAMING**  
SCALE: 3/4" = 1'-0"

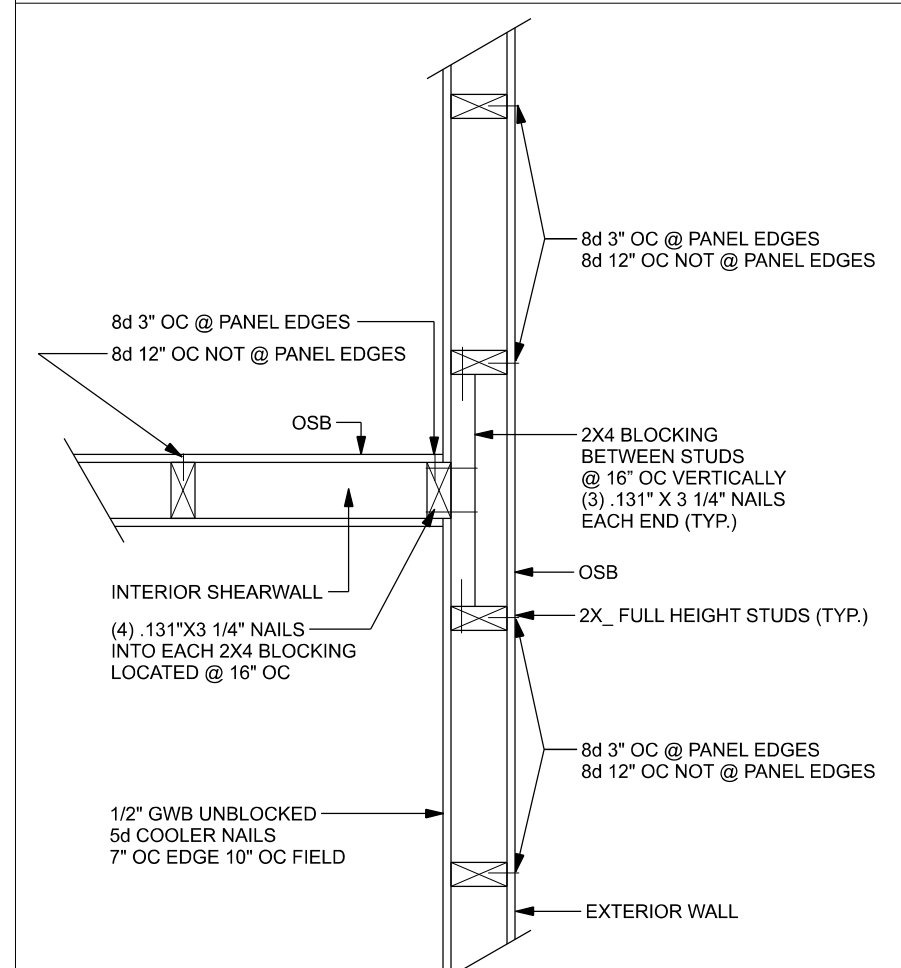


**(TYP.) INTERSECTING WALL FRAMING WOOD FRAME**

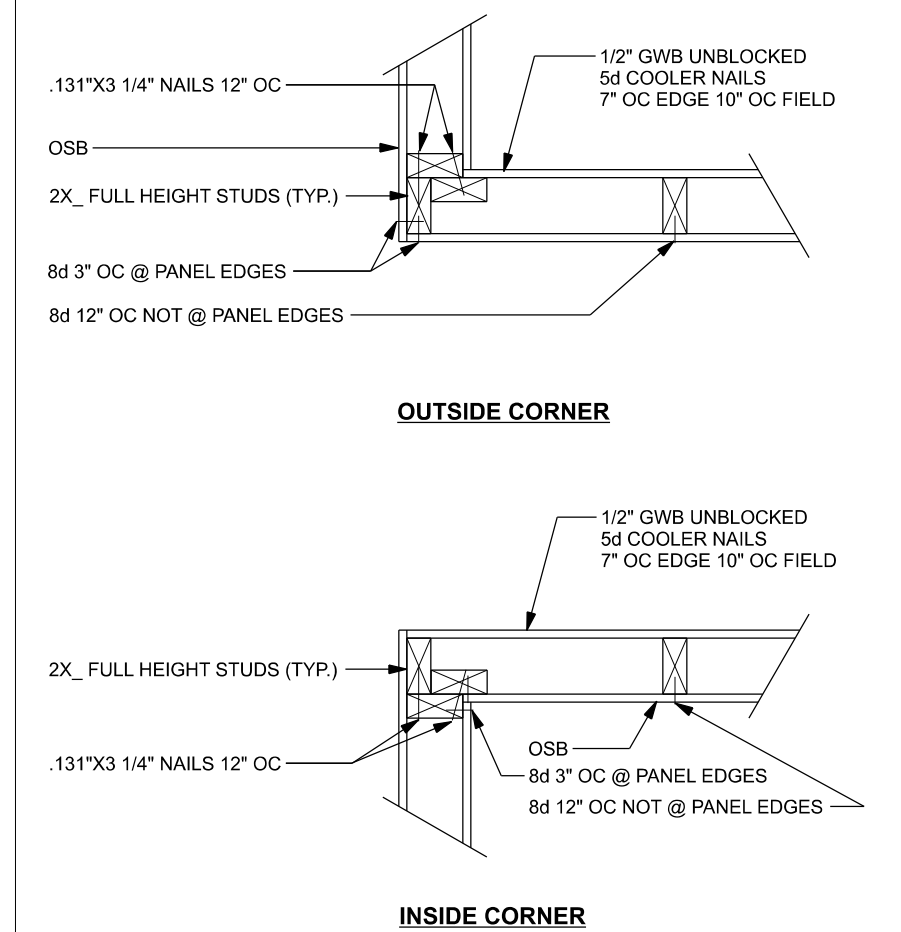

**(TYP.) CORNER FRAMING WOOD FRAME**


Wind Speed	Sheathing Thickness Plywood Or OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	12" oc
120 mph Exp. C	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
120 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. C	15/32"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	4" oc	4" oc

Note: For sheathing located a minimum of 4 feet from the perimeter edge of the roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 8 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field. Note: This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

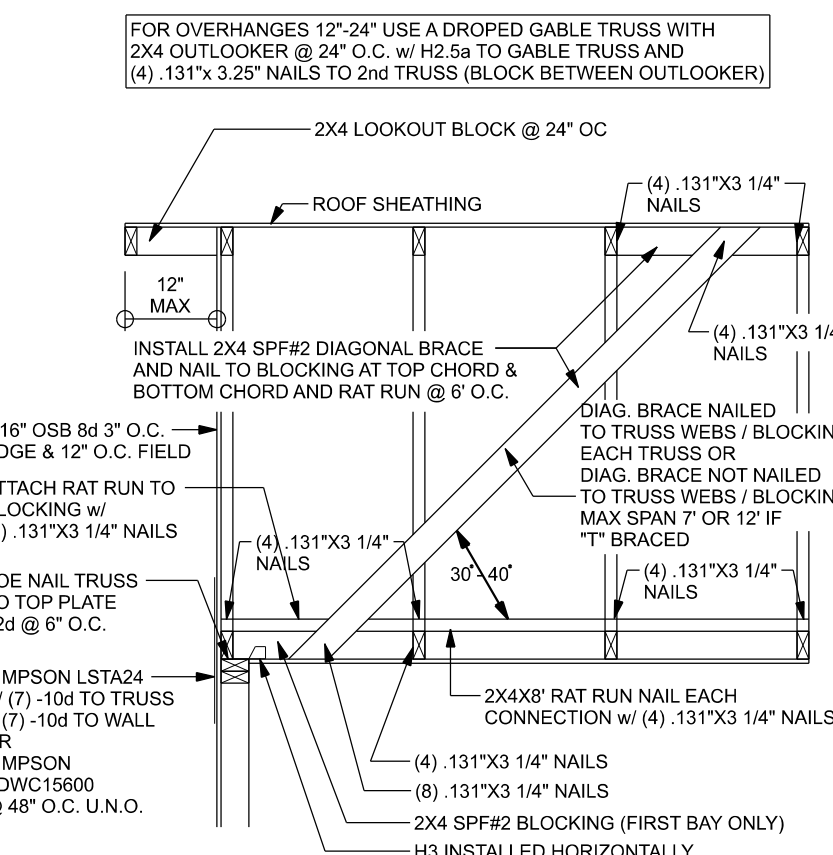


**(TYP.) GABLE BRACING DETAIL WOOD FRAME**


SPACE RAT RUN & DIAGONAL BRACE 6"-0" O.C. FOR GABLE HEIGHT UP TO 25'-0" 130 MPH, EXP. C, ENCLOSED

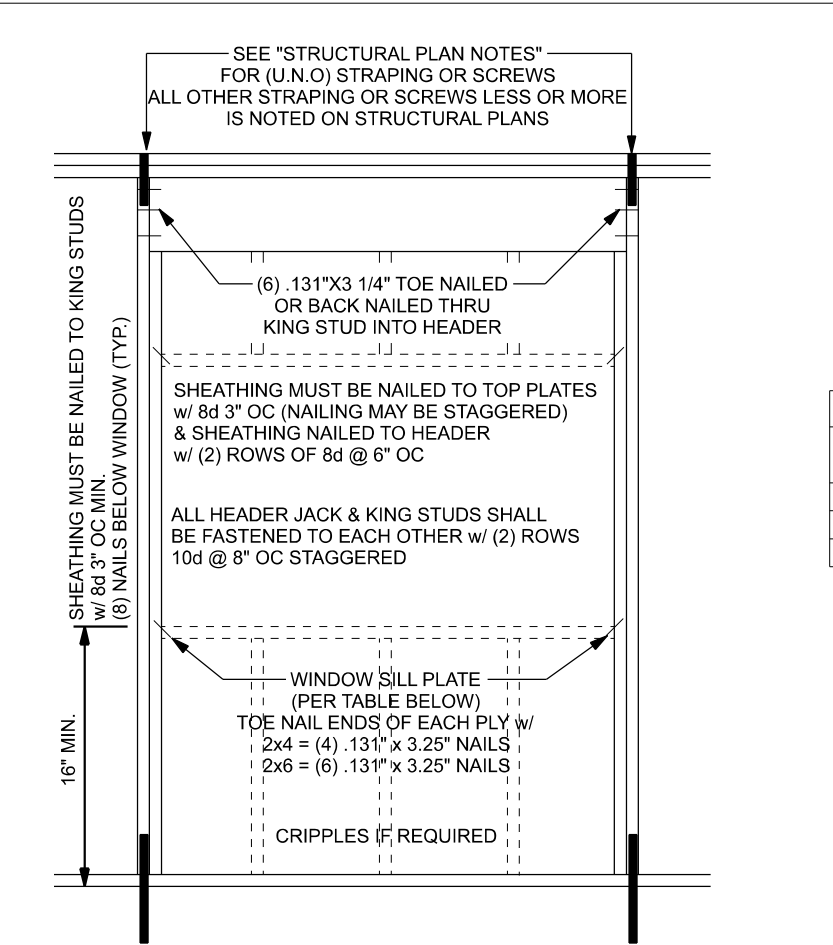


**TYPICAL HEADER STRAPPING OR SCREWS DETAIL ONE STORY WOOD FRAME w/ STRAPS & ANCHORS**

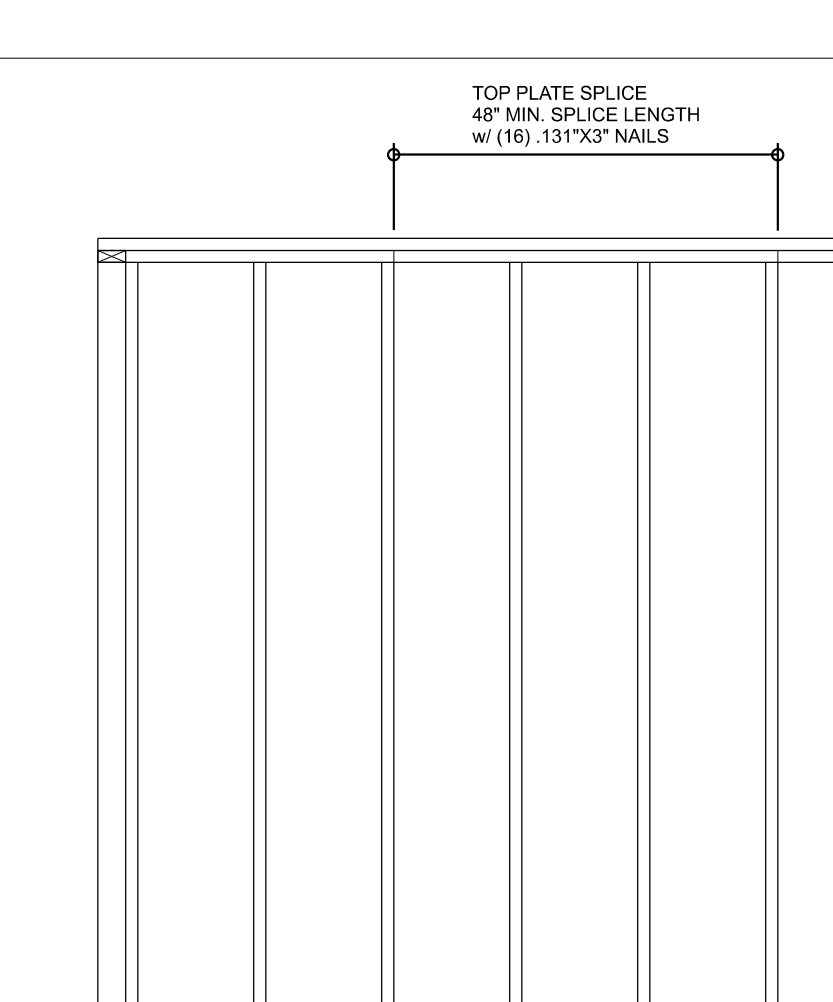


**(TYP.) WALL CONNECTIONS ONE STORY WOOD FRAME**

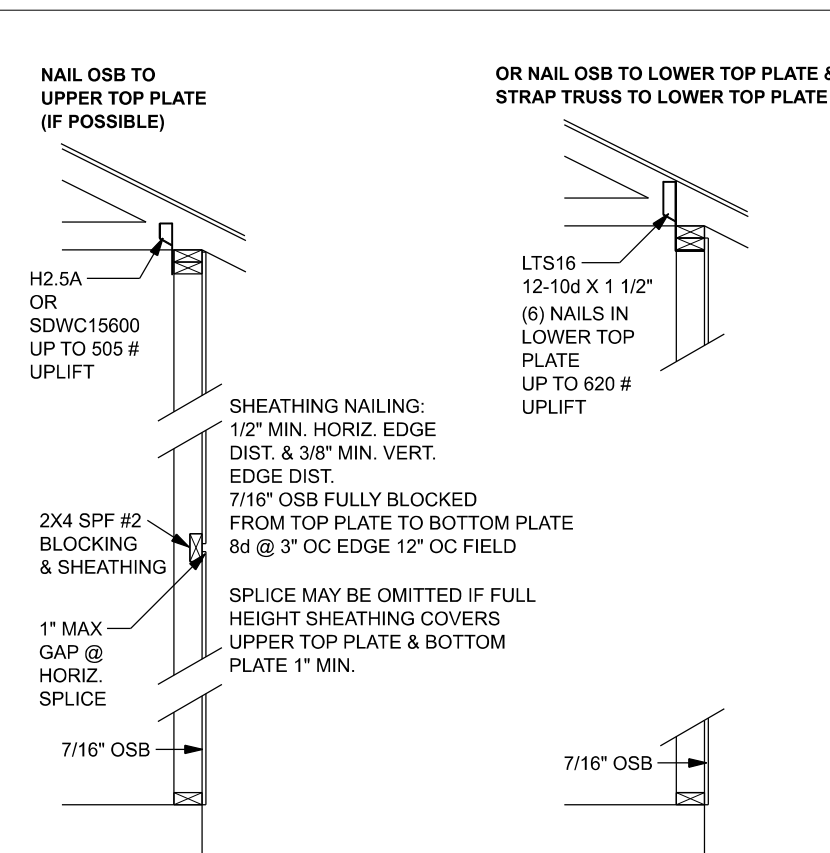

**SHEATHING FOR UPLIFT ATTACHMENT DETAILS ONE STORY WOOD FRAME**

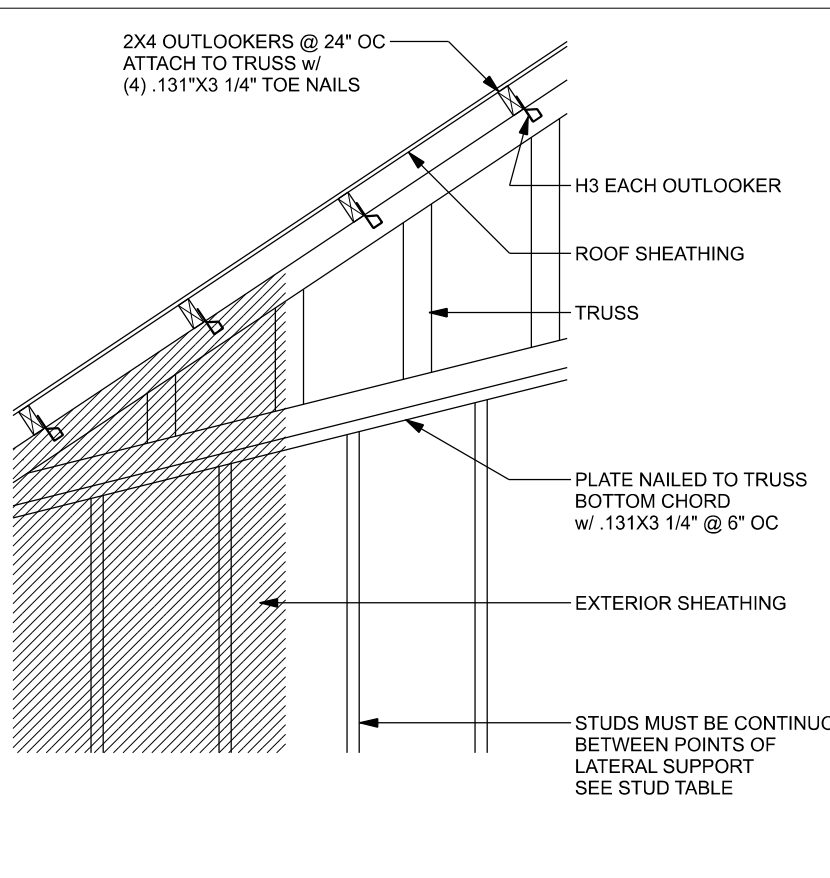

**(TYP.) GABLE WALL w/ VAULTED CEILING WOOD FRAME**

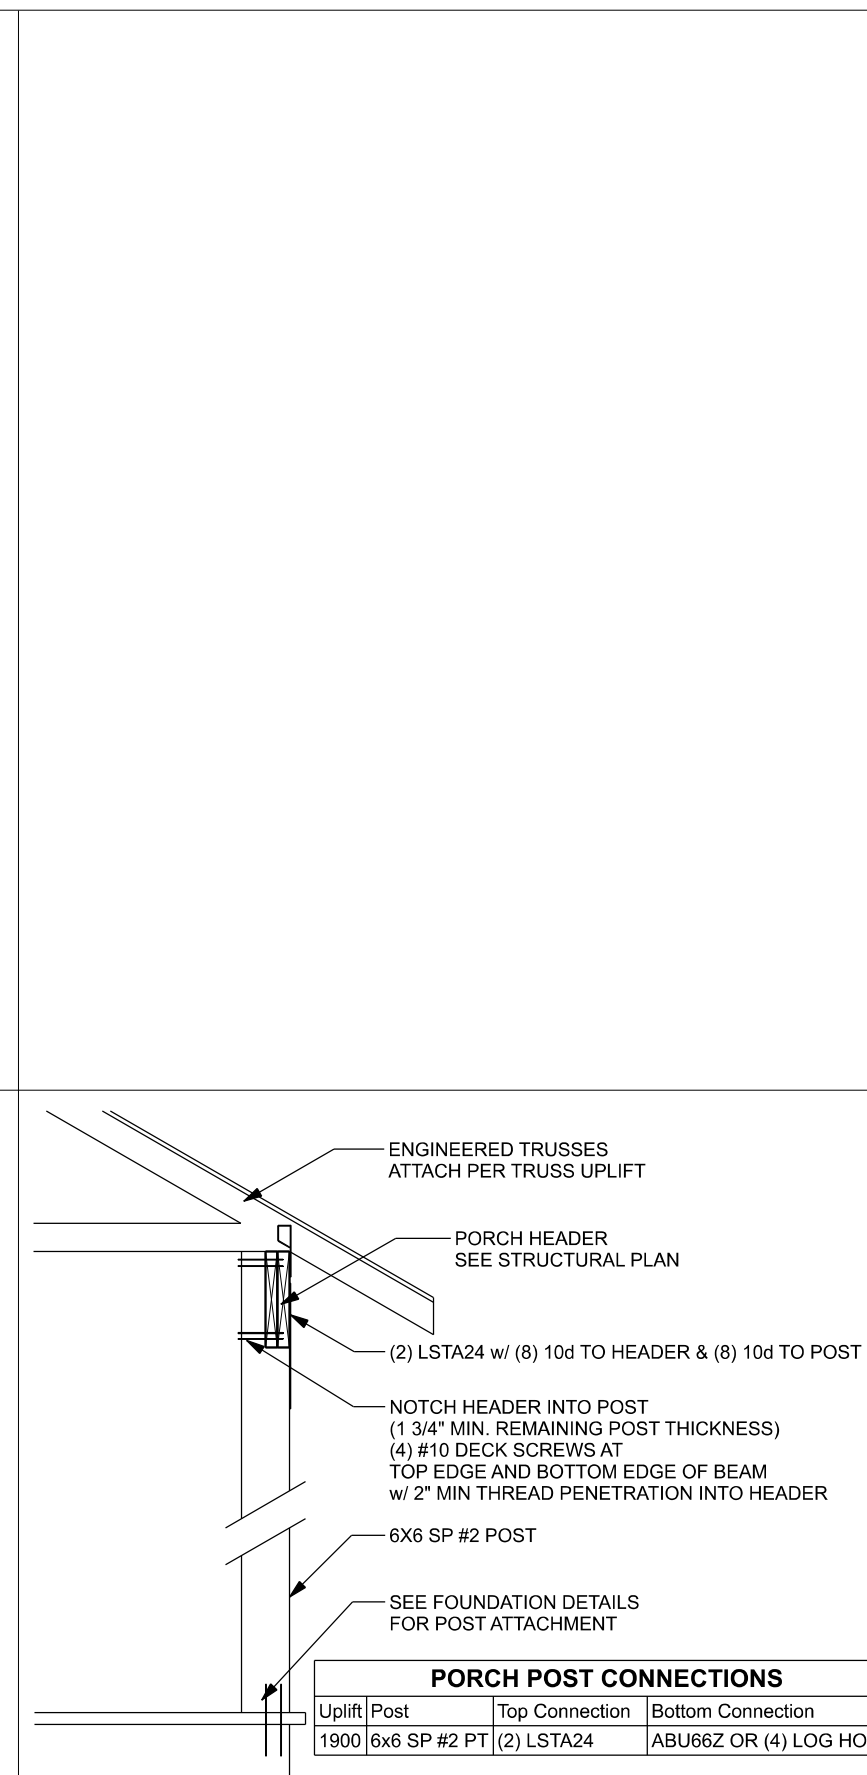


POSTS CUT FLUSH WITHOUT NOTCH - BRACE TO PREVENT ROTATION:


EAVE / HIP ROOF:

- STRAP TRUSSES w/ H2.5A OR EQUAL TO EACH SIDE OF HEADER (FRONT & BACK)
- USE LONGER STRAP AS NEEDED IF TOP PLATES ARE INSTALLED
- (2) LSTA24 16-10d OR (2) MTS20 14-10d ON FRONT AND REAR OF POST TO HEADER
- ATTACH HEADER TO POST w/ (8) 131" x 3.25" TOE-NAIL GABLE END
- EXTEND GABLE SHEATHING TO BOTTOM OF HEADER NAILED WITH 8d NAILS @ 6" MIN. INTO TRUSS BOTTOM CHORD AND INTO BEAM AT 1 1/2" FROM TOP & BOTTOM EDGE
- ATTACH HEADER TO POST w/ (8) 131" x 3.25" TOE-NAIL


**(TYP.) PORCH POST ONE STORY WOOD**

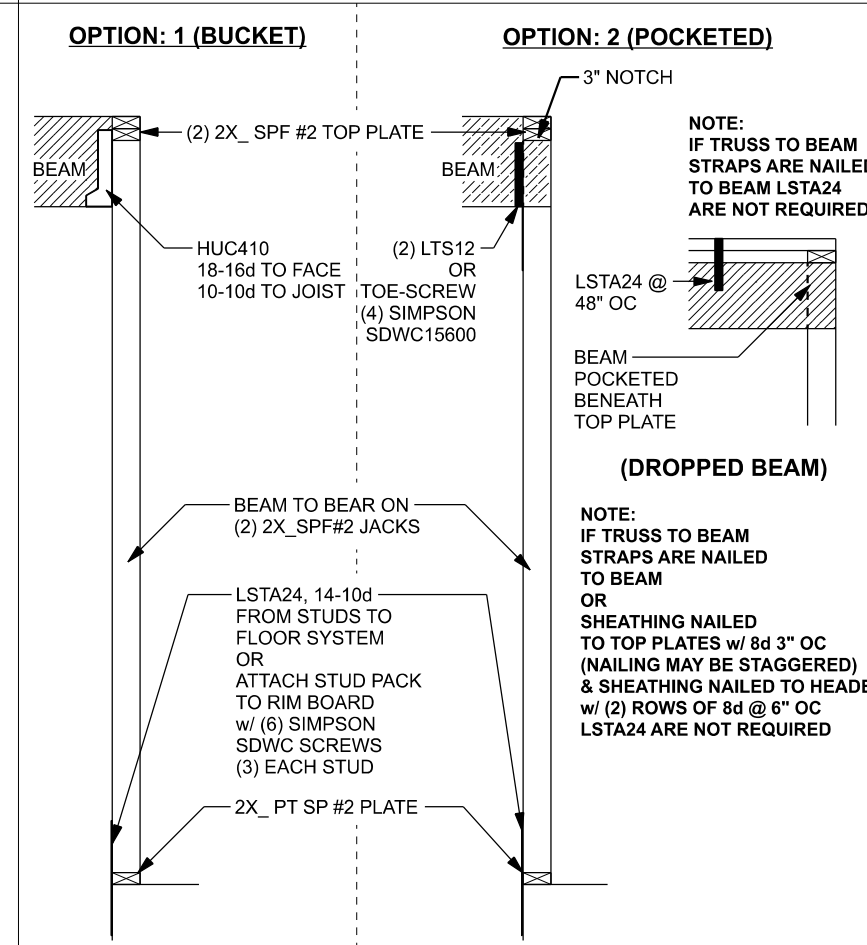

**(TYP.) BEAM TO WALL WOOD FRAME w/ STRAPS & ANCHORS**

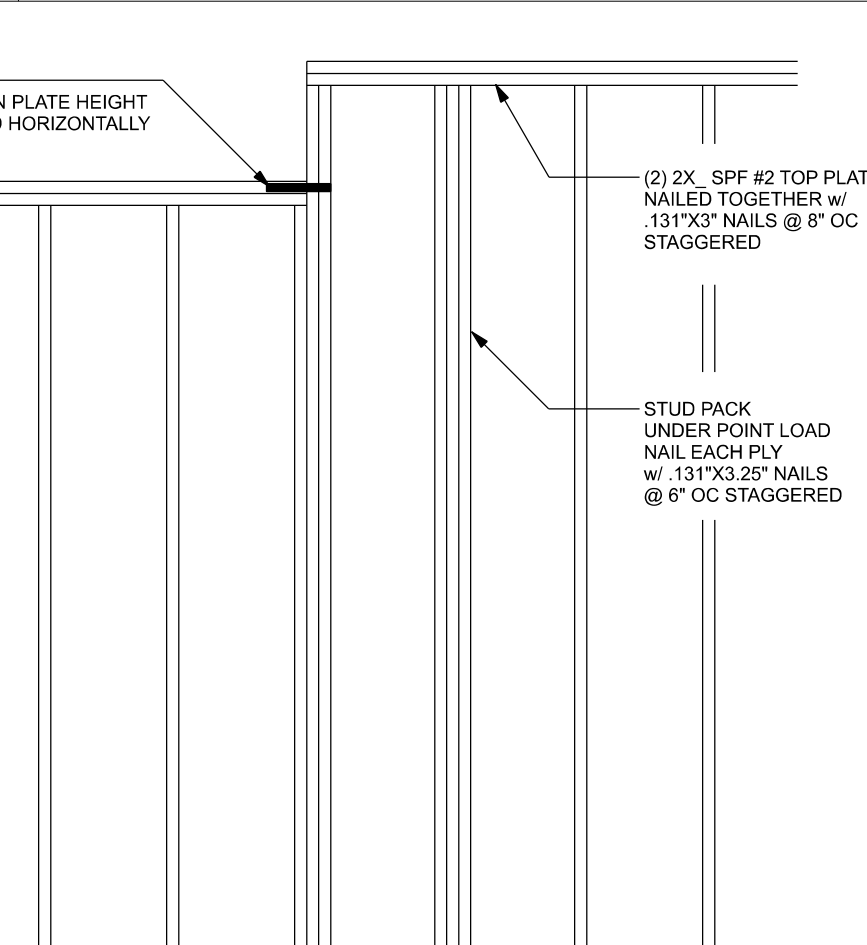

**OPENING FORCE TRANSFER WOOD FRAME**

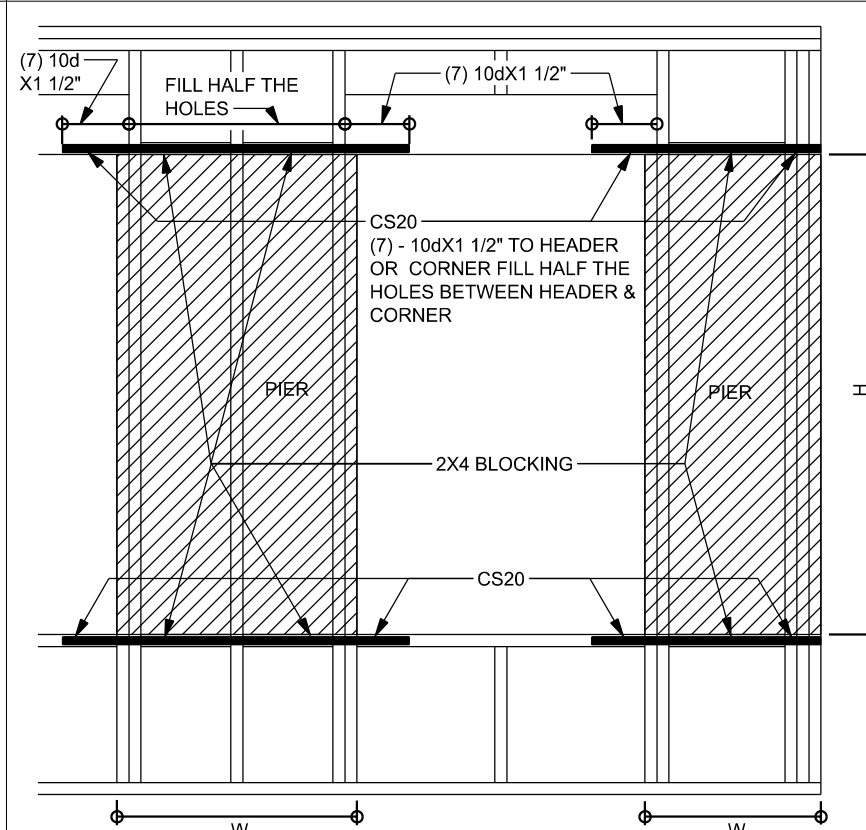

NOTE: THIS DETAIL IS INTENDED TO BE USED ONLY FOR NARROW SHEARWALL SEGMENTS AS SPECIFIED ON THE PLAN. THE PIER BESIDE THE OPENING MUST MEET THE ASPECT RATIO REQUIREMENT HW < 3.5:1 WHERE H IS THE PIER HEIGHT. FOR WINDOWS NOT GREATER THAN 2' HIGH OR 5' WIDE THE WIDTH OF THE OPENING MAY BE INCLUDED AS FULL HEIGHT SHEARWALL IN ADDITION TO THE PIER WIDTH WHEN STRAPPED ACCORDING TO THIS DETAIL.

Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter
805	505	SDWC15600	-	-
415	290	H3	4-8d x 1 1/2"	4-8d x 1 1/2"
615	540	H2.5A	5-8d x 1 1/2"	5-8d x 1 1/2"
1340	1015	H10A	9-10d x 1 1/2"	9-10d x 1 1/2"
720	620	LTS12-20	6-10d x 1 1/2"	6-10d x 1 1/2"
1000	860	MTS12-30	7-10d x 1 1/2"	7-10d x 1 1/2"
1450	1245	HTS20-30	12-10d x 1 1/2"	12-10d x 1 1/2"
Uplift SP	Uplift SPF	Strap Ties	To One Member	To Other Member
1235	1235	LSTA21	8-10d	8-10d
1640	1455	MTA24	9-10d	9-10d
1030	1030	CS20	7-10d	7-10d
Uplift SP	Uplift SPF	Stud Plate Ties	To Stud	To Plate
585	535	SP1	6-10d	4-10d
1065	605	SP2	6-10d	6-10d
771	771	LSTA24	10-10d	wrap under or over plate
1235	1235	LSTA24	14-10d	wrap under or over plate
Uplift SP	Uplift SPF	Holdowns @ Stewall	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235	3540	HTT4	18-16d x 2 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Holdowns @ Mono	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235	3540	HTT4	18-16d x 2 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Post Bases @ Stewall	To Post	Anchor
1900		ABU4Z	12-16d	5/8"x12" Drill & Epoxy
2475		ABU6Z	12-16d	5/8"x12" Drill & Epoxy
Uplift SP	Uplift SPF	Post Bases @ Mono	To Post	Anchor
1900		ABU4Z	12-16d	5/8"x7" Drill & Epoxy
2475		ABU6Z	12-16d	5/8"x7" Drill & Epoxy

**EXTERIOR WALL STUD TABLE FOR SPF #2 STUDS:**

Stud Height	Stud Spacing	Stud Height	Stud Spacing
(1) 2x4 @ 16" OC	TO 10'-1" STUD HEIGHT	(1) 2x4 @ 16" OC	TO 11'-2" STUD HEIGHT
(1) 2x4 @ 12" OC	TO 11'-2" STUD HEIGHT	(1) 2x6 @ 16" OC	TO 15'-7" STUD HEIGHT
(1) 2x6 @ 16" OC	TO 15'-7" STUD HEIGHT	(1) 2x6 @ 12" OC	TO 17'-3" STUD HEIGHT

Grade	Species	Fb	E
2x8	SP #2	925	1.4
2x10	SP #2	800	1.4
2x12	SP #2	750	1.4
GLB	24F-V3 SP	2600	1.9
LSL	TIMBERSTRAND	1700	1.7
LVL	MICROLAM	2950	2.0
PSL	PARALAM	2900	2.0

## GENERAL NOTES:

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT AND TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER'S DESIGN REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS DESIGN ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 415LB EACH END; 2X8 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN. FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1600 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVIDES OTHERWISE).

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F'c = 2500 PSI. WELDED WIRE REINFORCED SLAB: 6" x 6" W1.4 x W1.4, FB = 89KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.R.) CONFORMING TO ASTM A185, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT, FIBER LENGTH 12 INCH TO 2 INCHES, DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE LEFT DO NOT CUT WMM OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)

REBAR: ASTM A615, GRADE 40, DEFORMED BARS, FY = 40 KSI. ALL LAP SPLICES 40" DB (25" FOR #5 BARS); UNQ. ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 318, U.N.Q.

ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL. DIAPHRAGMS, SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE, NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CMU.

**BUILDER'S RESPONSIBILITY:** THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK. CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE. PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCR REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.

PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMITS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.

VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.

**ROOF SYSTEM DESIGN:** THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR, IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBCR REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE REINFORCEMENT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT (WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

PROJECT ADDRESS:  
161 SW Winthrop Place  
Fort White, FL 32036

Scott Kremser Res.

FL PE 53915

This item has been digitally signed and sealed by Mark Discoway P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=US, O=Florida, dnQualifier=A014 10C0000017E97D E07CA000746F0, CN=Mark d Discoway



2022-09-14 12:46:03

DIMENSIONS: Stated dimensions supercede scaled dimensions. Refer all questions to Mark Discoway, P.E. for resolution. Do not proceed without clarification.



COPYRIGHTS AND PROPERTY RIGHTS: Mark Discoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Discoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020



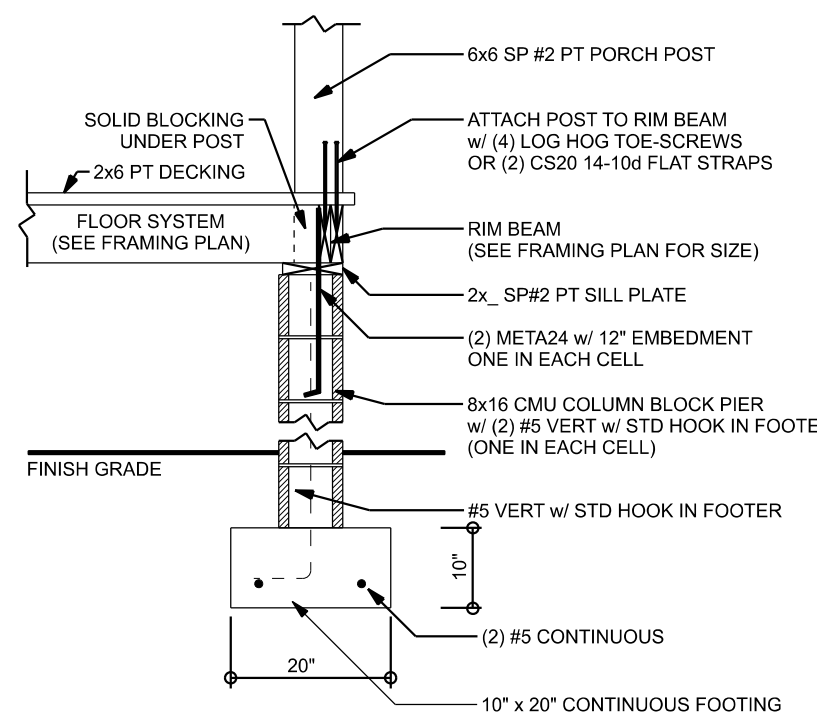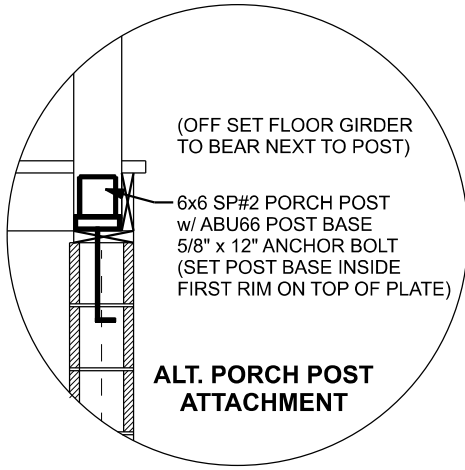

**F4 PORCH PIER FOUNDATION (AT POST)**  
**S-2 WOOD FLOOR OVER CRAWLSPACE** SCALE: 1/2" = 1'-0"

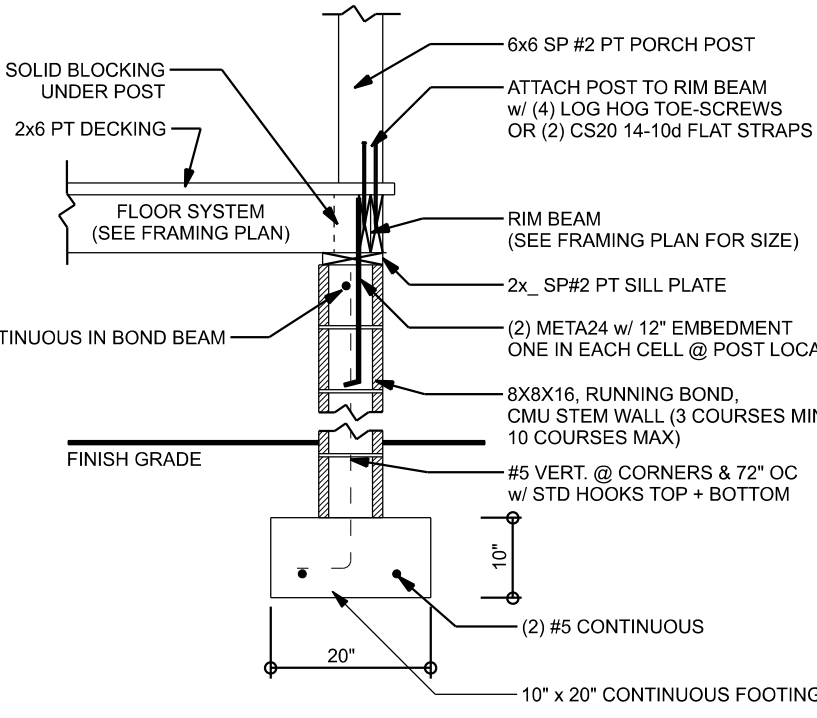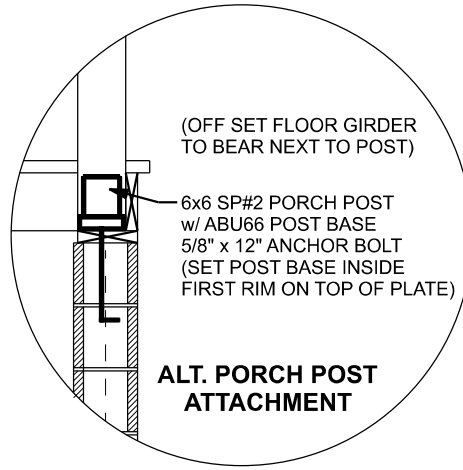

**F6 STEMWALL FOUNDATION (AT PORCH)**  
**S-2 WOOD FLOOR OVER CRAWLSPACE** SCALE: 1/2" = 1'-0"

MASONRY NOTE: MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.	
Specific Requirements	
1.4A Compressive strength	8" block bearing walls F'm = 1500 psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, admixtures require approval
2.3 CMU standard	ASTM C 90-02, Normal weight, Hollow, medium surface finish, 8"x16" running bond and 12"x12" or 16"x16" column block
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"
2.4 Reinforcing bars, #3 - #11	ASTM 615, Grade 40, Fy = 40 ksi, Lap splices min 40 bar dia. (28" for #5)
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A525, Class 980, 0.60 oz/lb or 304SS
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A153, Class B2, 1.50 oz/lb or 304SS
3.3.E.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.

#### SECTION R408 UNDER-FLOOR SPACE

##### R408.1 Ventilation.

The under-floor space between the bottom of the floor joists and the earth under any building (except space occupied by a basement) shall have ventilation openings through foundation walls or exterior walls. The minimum net area of ventilation openings shall be not less than 1 square foot (0.0929 m<sup>2</sup>) for each 150 square feet (14 m<sup>2</sup>) of under-floor space area, unless the ground surface is covered by a Class 1 vapor retarder material. Where a Class 1 vapor retarder material is used, the minimum net area of ventilation openings shall be not less than 1 square foot (0.0929 m<sup>2</sup>) for each 1,500 square feet (140 m<sup>2</sup>) of under-floor space area. One such ventilating opening shall be within 3 feet (914 mm) of each corner of the building.

##### R408.2 Openings for under-floor ventilation.

The minimum net area of ventilation openings shall be not less than 1 square foot (0.0929 m<sup>2</sup>) for each 150 square feet (14 m<sup>2</sup>) of under-floor area. One ventilation opening shall be within 3 feet (915 mm) of each corner of the building. Ventilation openings shall be covered for their height and width with any of the following materials provided that the least dimension of the covering shall not exceed 1/4 inch (6.4 mm):

1. Perforated sheet metal plates not less than 0.070 inch (1.8 mm) thick.
2. Expanded sheet metal plates not less than 0.047 inch (1.2 mm) thick.
3. Cast-iron grill or grating.
4. Extruded load-bearing brick vents.
5. Hardware cloth of 0.035 inch (0.89 mm) wire or heavier.
6. Corrosion-resistant wire mesh, with the least dimension being 1/8 inch (3.2 mm) thick.

Exception: The total area of ventilation openings shall be permitted to be reduced to 1/1,500 of the under-floor area where the ground surface is covered with an approved Class 1 vapor retarder material and the required openings are placed to provide cross ventilation of the space. The installation of operable louvers shall not be prohibited.


##### R408.3 Unvented crawl space.

Ventilation openings in under-floor spaces specified in Sections R408.1 and R408.2 shall not be required where the following items are provided:


1. Exposed earth is covered with a continuous Class 1 vapor retarder. Joints of the vapor retarder shall overlap by 6 inches (152 mm) and shall be sealed or taped. The edges of the vapor retarder shall extend not less than 6 inches (152 mm) up the stem wall and shall be attached and sealed to the stem wall or insulation.
2. One of the following is provided for the under-floor space:
  - 2.1. Continuously operated mechanical exhaust ventilation at a rate equal to 1 cubic foot per minute (0.47 L/s) for each 50 square feet (4.7 m<sup>2</sup>) of crawl space floor area, including an air pathway to the common area (such as a duct or transfer grille), and perimeter walls insulated in accordance with the Florida Building Code, Energy Conservation.
  - 2.2. Conditioned air supply sized to deliver at a rate equal to 1 cubic foot per minute (0.47 L/s) for each 50 square feet (4.7 m<sup>2</sup>) of under-floor area, including a return air pathway to the common area (such as a duct or transfer grille), and perimeter walls insulated in accordance with the Florida Building Code, Energy Conservation.
  - 2.3. Plenum in existing structures complying with Section M1601.5, if under-floor space is used as a plenum.
  - 2.4. Dehumidification sized to provide 70 pints (33 L) of moisture removal per day for every 1,000 square feet (93 m<sup>2</sup>) of crawl space floor area.

##### R408.4 Access.


Access shall be provided to all under-floor spaces. Access openings through the floor shall be a minimum of 18 inches by 24 inches (457 mm by 610 mm). Openings through a perimeter wall shall be not less than 16 inches by 24 inches (407 mm by 610 mm). Where any portion of the through-wall access is below grade, an areaway not less than 16 inches by 24 inches (407 mm by 610 mm) shall be provided. The bottom of the areaway shall be below the threshold of the access opening. Through wall access openings shall not be located under a door to the residence. See Section M1305.1.4 for access requirements where mechanical equipment is located under floors.

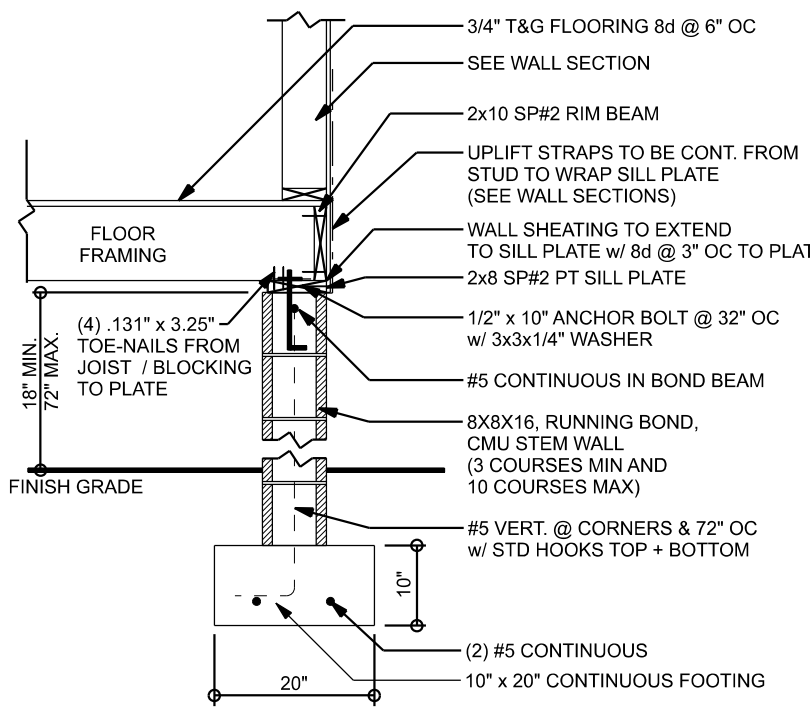


**F1 STEMWALL FOUNDATION (10" x 20")**  
**S-2 WOOD FLOOR OVER CRAWLSPACE** SCALE: 1/2" = 1'-0"

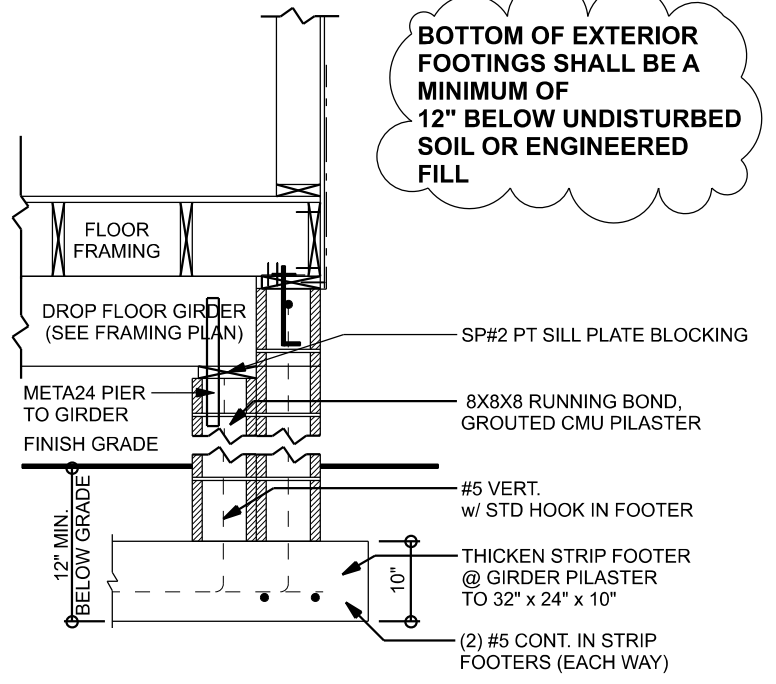

**F2 8x8 PILASTER @ GIRDER BEARING**  
**S-2 WOOD FLOOR OVER CRAWLSPACE** SCALE: 1/2" = 1'-0"

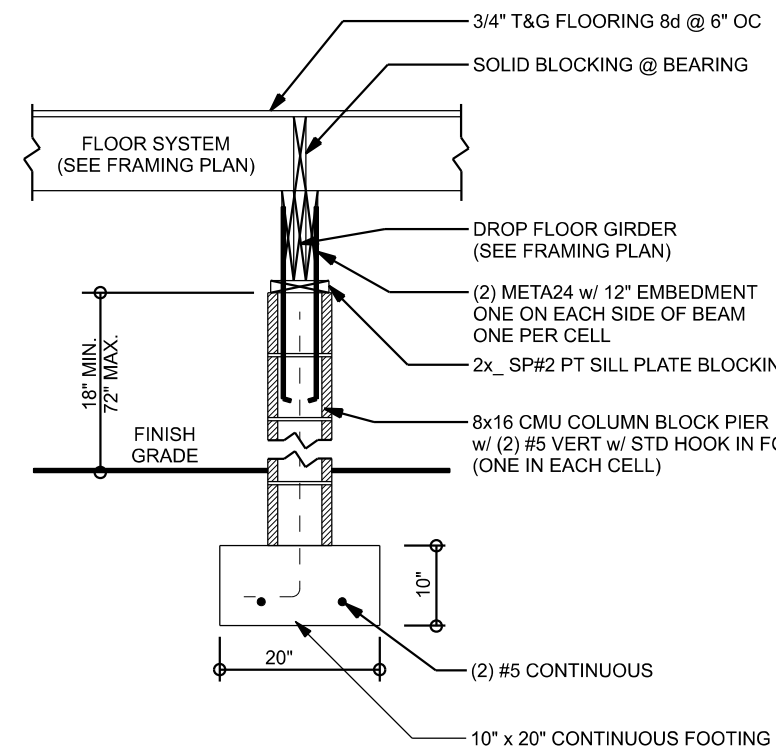

**F3 PIER FOUNDATION (10" x 20")**  
**S-2 WOOD FLOOR OVER CRAWLSPACE** SCALE: 1/2" = 1'-0"

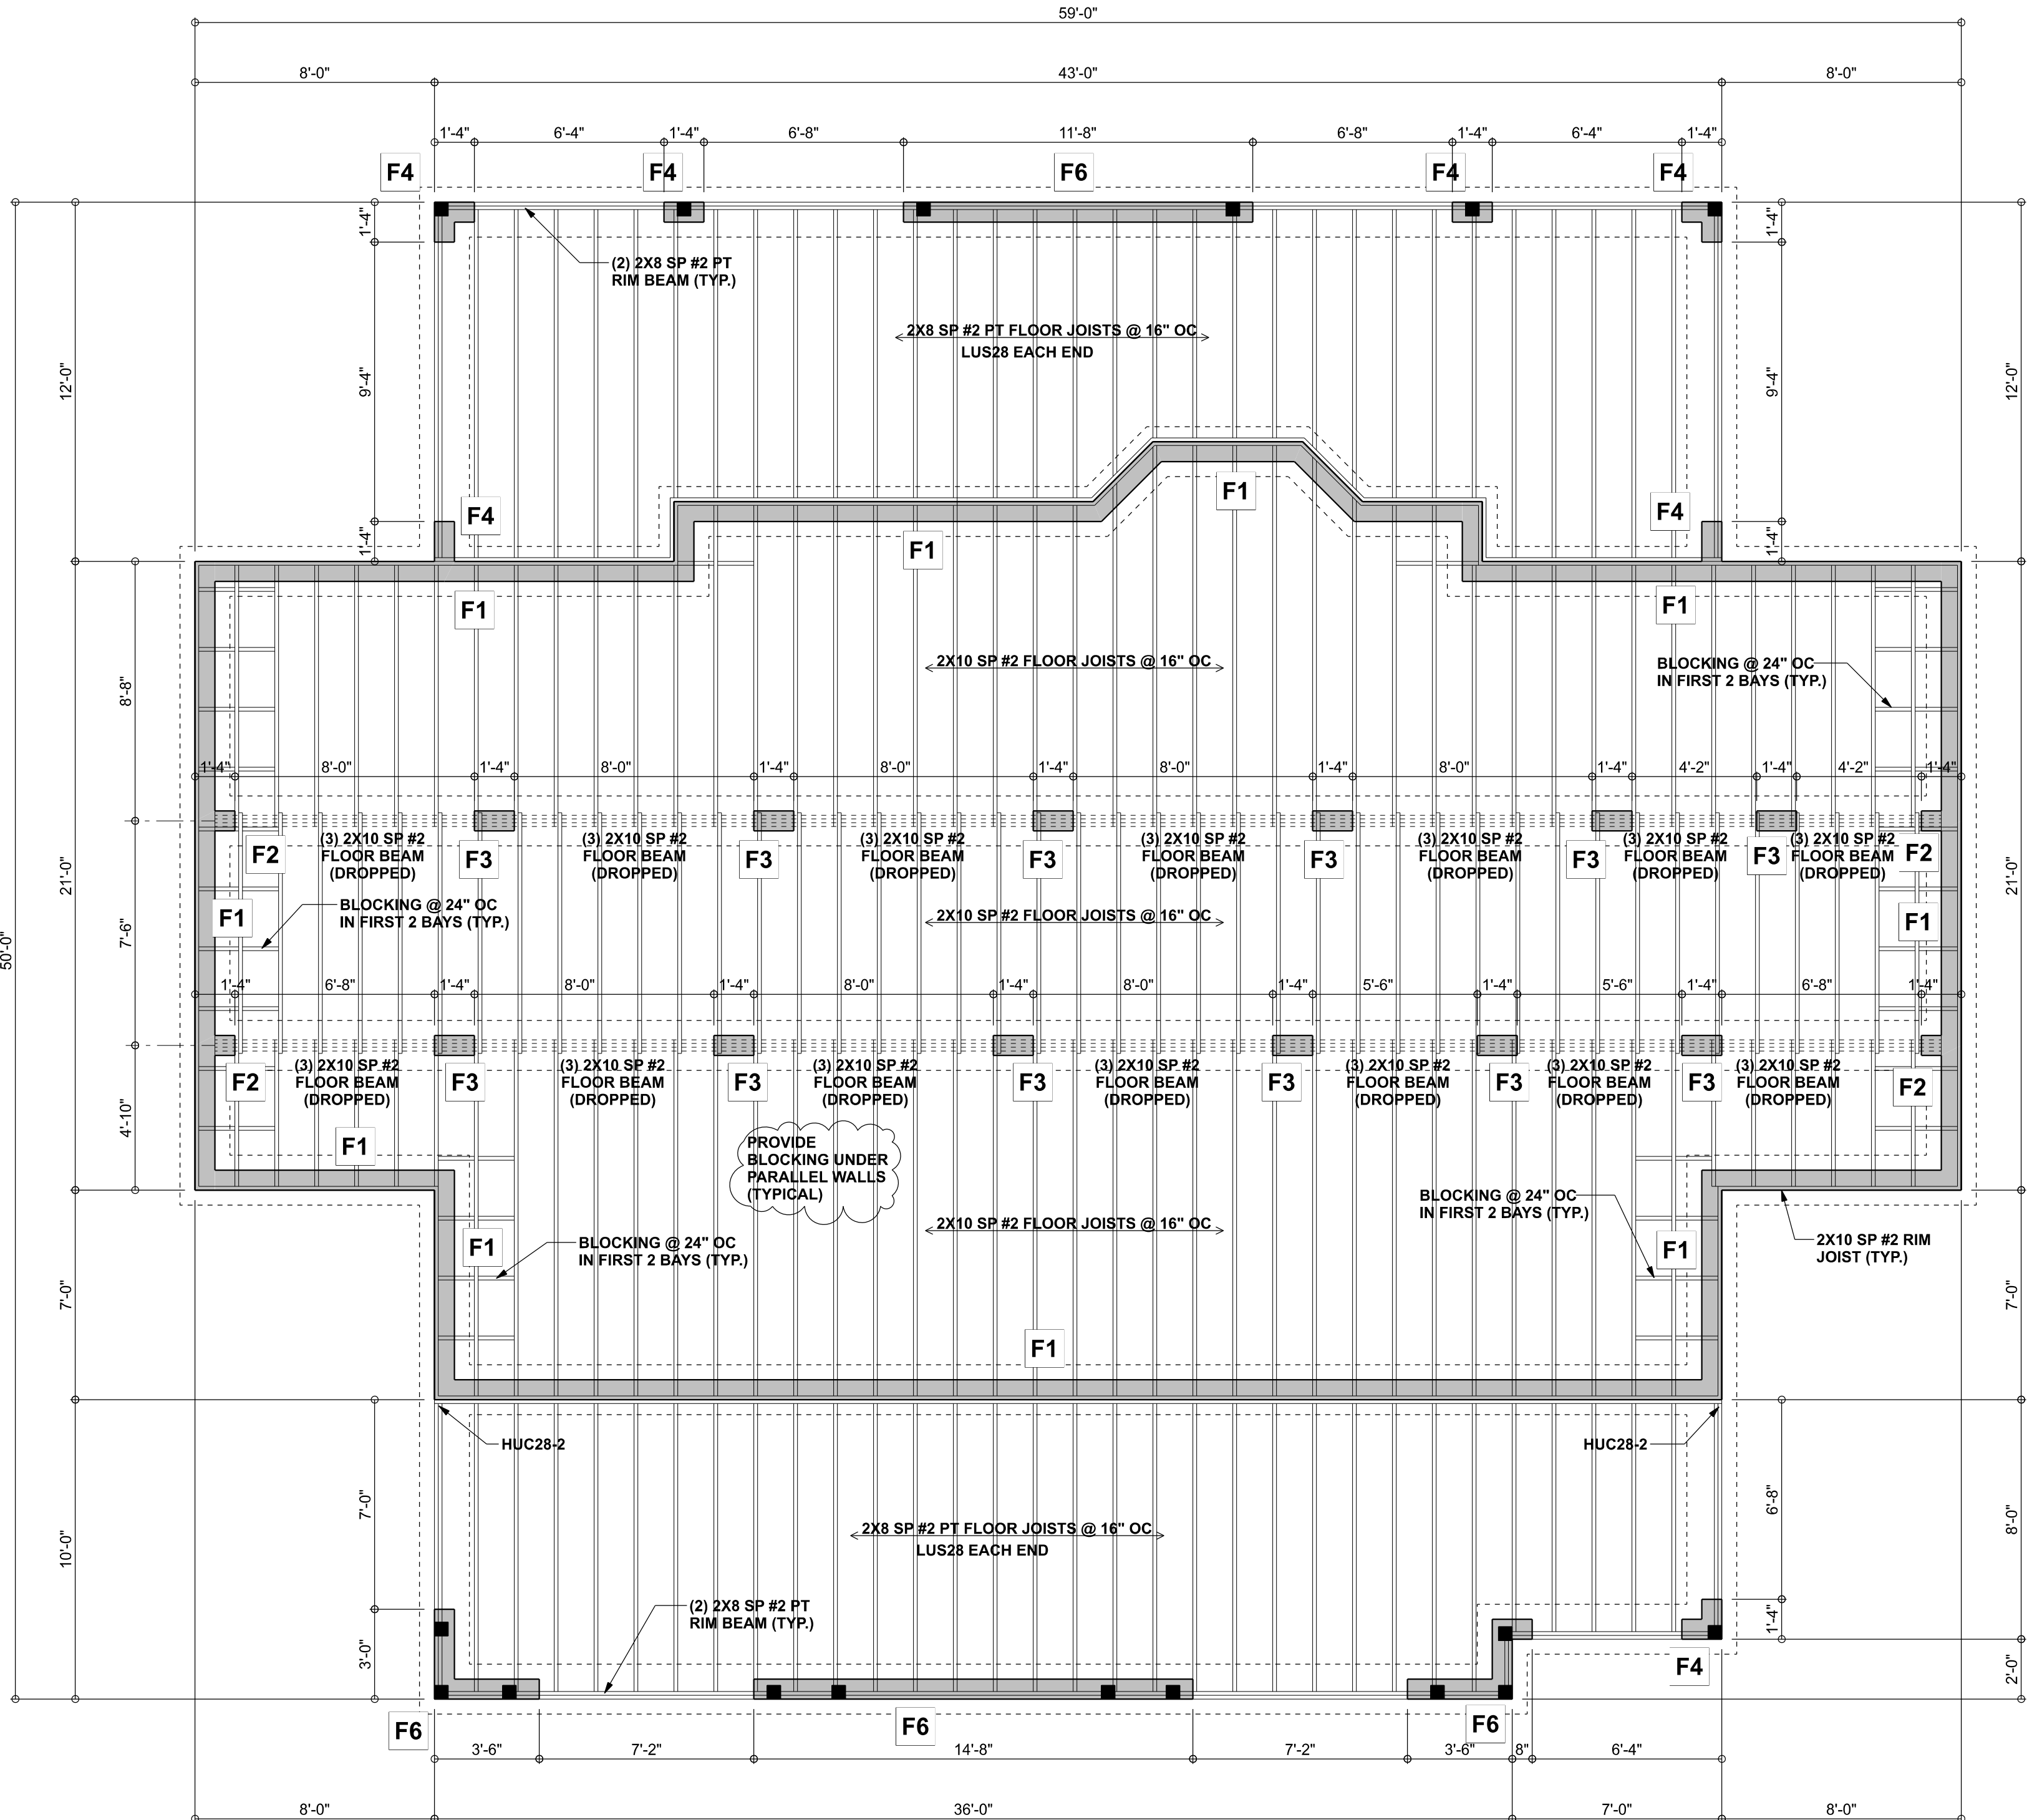

#### FOUNDATION LAYOUT / FLOOR FRAMING

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS. RECESSES IN SLAB STEP DOWNS, ETC. DISOSWAY DESIGN GROUP OR MARK DISOSWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING IN ALL AREAS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN
FN - 3	ALL WOOD MUST BE TREATED OR PROTECTED AS PER FBCCR

**CONTRACTOR SHALL VERIFY  
NEED FOR INTERIOR BEARING  
IN ALL AREAS BY REVIEWING  
THE ROOF TRUSS PLAN  
( BY THE SUPPLIER )**

Scott Kremser Res.

PROJECT ADDRESS:  
161 SW Winthrop Place  
Fort White, FL 32038

FL PE 53915

This item has been digitally signed and sealed by Mark Disosway, P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=U.S., O=Florida, dnQualifier=A01410C000017E97DE07CA000746F0, CN=Mark d Disosway  
2022-09-14 12:46: 21

**DIMENSIONS:**  
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

**COPYRIGHTS AND PROPERTY RIGHTS:**  
Mark Disosway, P.E. hereby expressly reserves its common law copyright and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

**CERTIFICATION:** I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

**LIMITATION:** This design is valid for one building, at specified location.

**Mark Disosway P.E.**  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.754.5419  
disoswaydesign@gmail.com

**JOB NUMBER:**  
220807


**S-2**

OF 3 SHEETS



# LUMBER SIZE & GRADE MINIMUM REQUIREMENTS

RIDGE BOARD	2X6 SYP #2
RAFTER SPANS 20'-0" OR LESS	2X4 SYP #2
PURLINS (LATERAL BRACING)	2X4 SYP #2
SLEEPERS	2X (WIDTH OF RAFTER BEAT CUT) SPF #3 OR 2X (VALLEY) 2X4 SYP #2
CRIPPLES & BLOCKING	2X4 SYP #2 OR BETTER
TRUSS BELOW	SEE TRUSS DESIGN - SOUTHERN PINE MATERIAL

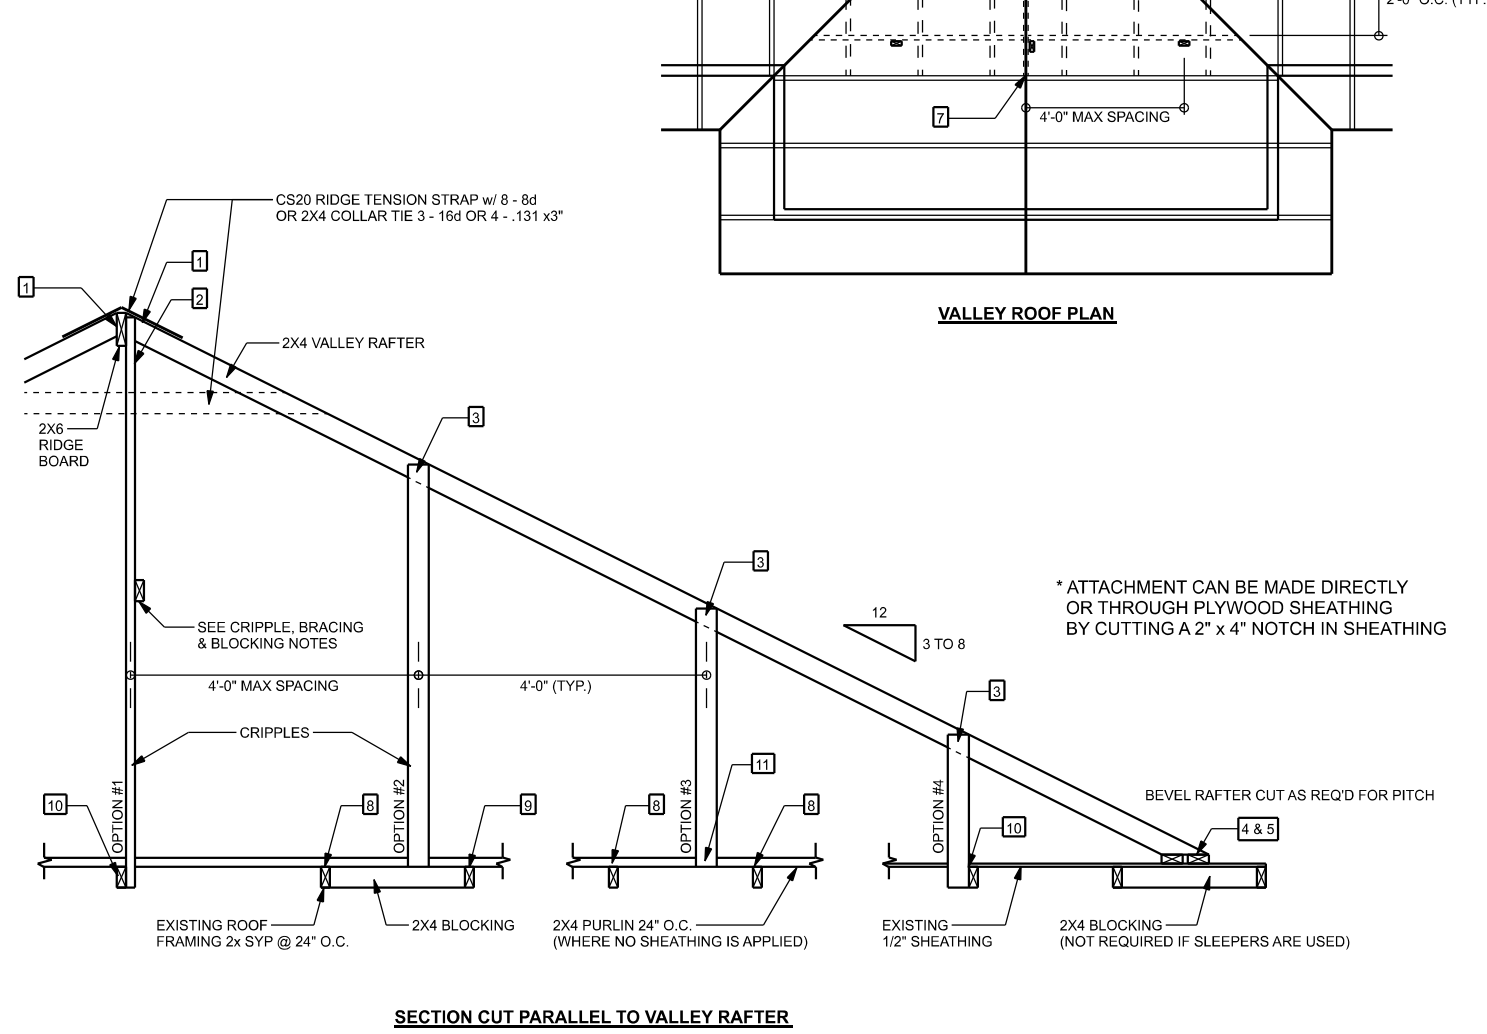

ROOF OVER FRAMING & BRACING DETAIL  
SCALE: N.T.S.

# VALLEY ROOF PLAN MEMBER LEGEND

=====	TRUSS
==	TRUSS UNDER VALLEY FRAMING
---	VALLEY RAFTER OR RIDGE
•	CRIPPLE

# CONNECTION REQUIREMENT NOTES


1	2X4 RAFTER TO RIDGE	3-16d OR 6" - 131 x 3" TOE NAILS
2	CRIPPLE TO RIDGE	3-16d OR 6" - 131 x 3" FACE NAILS
3	CRIPPLE TO RAFTERS	3-16d OR 6" - 131 x 3" FACE NAILS
4	RAFTER TO SLEEPER OR BLOCKING	3-16d OR 6" - 131 x 3" TOE NAILS
5	SLEEPER TO TRUSS	4-16d OR 8" - 131 x 3" FACE NAILS EACH TRUSS
6	RIDGE BOARD TO ROOF BLOCK	3-16d OR 6" - 131 x 3" TOE NAILS
7	RIDGE BOARD TO TRUSS	3-16d OR 6" - 131 x 3" TOE NAILS
8	PURLIN TO TRUSS (TYP)	3-16d OR 6" - 131 x 3" NAILS
9	PURLIN TO TRUSS (IF CRIPPLE IS ATTACHED TO PURLIN)	4-16d OR 8" - 131 x 3" NAILS
10	TRUSS TO BLOCKING	3-16d OR 6" - 131 x 3" END NAILS
11	CRIPPLE TO TRUSS	3-16d OR 6" - 131 x 3" FACE NAILS
12	CRIPPLE TO PURLIN	3-16d OR 6" - 131 x 3" FACE NAILS

# GENERAL NOTES

MAXIMUM RAFTER SPANS  
(6'-0" FOR 2X4, 9'-0" FOR 2X6 SYP #2 OR SYP #2)  
MAXIMUM ROOF AREA PER SUPPORT  
160' IN ZONE 2 & 3, 240' IN ZONE 1, (EXAMPLE: 4'-0" O.C. X 4'-0" SPAN = 160' OR 2'-0" X 8'-0" SPAN = 160')  
PURLIN REQUIRED 2'-0" O.C. IF EXISTING SHEATHING IS REMOVED  
PURLIN SHOULD OVERLAP SHEATHING ONE TRUSS SPACING MINIMUM  
IN CASES THAT THIS IS IMPRACTICAL, OVERLAP SHEATHING A MINIMUM OF 6" AND NAIL UPWARDS THROUGH SHEATHING INTO PURLIN WITH A MINIMUM OF 6" COMMON WIRE NAILS.  
THIS DRAWING APPLIES TO VALLEYS WITH THE FOLLOWING CONDITIONS:  
- SPACING DISTANCE BETWEEN RISERS 48" OR LESS  
- MAXIMUM VALLEY HEIGHT: 14'-0" OR LESS  
- MAXIMUM WIND SPEED: 135 MPH  
- MAXIMUM MEAN ROOF HEIGHT: 30 FEET  
- MAXIMUM TOTAL LOADING: 45 psf  
- MEET SECTION 1900 WIND REQUIREMENTS  
- EXPOSURE CATEGORY "C": 1 + 1.0, Kd = 1.0  
- ENCLOSED BUILDING

# CRIPPLE, BRACING, & BLOCKING NOTES

2X4 CONTINUOUS LATERAL BRACE (CLB) MIN. IS REQUIRED FOR CRIPPLES 5'-0" TO 10'-0" LONG NAILED 2" x 10" NAIL OR 2X4 "T" OR SCAB BRACE NAILED TO PLATE EDGE OF CRIPPLE WITH 6d NAILS @ 16" O.C. "T" OR SCAB MUST BE 50% OF CRIPPLE LENGTH. CRIPPLES OVER 10'-0" LONG REQUIRE TWO CLB OR BOTH FACES w/ "T" OR SCAB. USE STRESS GRADED LUMBER & BOX OR COMMON NAILS  
- NARROW EDGE OF CRIPPLE CAN FACE RIDGE OR RAFTER, AS LONG AS THE PROPER NUMBER OF NAILS ARE INSTALLED INTO RIDGE BOARD  
- INSTALL BLOCKING UNDER RAFTER IF SLEEPERS ARE NOT USED  
- INSTALL BLOCKING UNDER CRIPPLES IF CRIPPLES FALL BETWEEN LOWER TRUSS TOP CHORDS AND LATERAL BRACING IS NOT USED  
- APPLY ALL NAILING IN ACCORDANCE TO NDS-1997 SECTION 12. NAILS ARE COMMON WIRE NAILS UNLESS NOTED OTHERWISE.

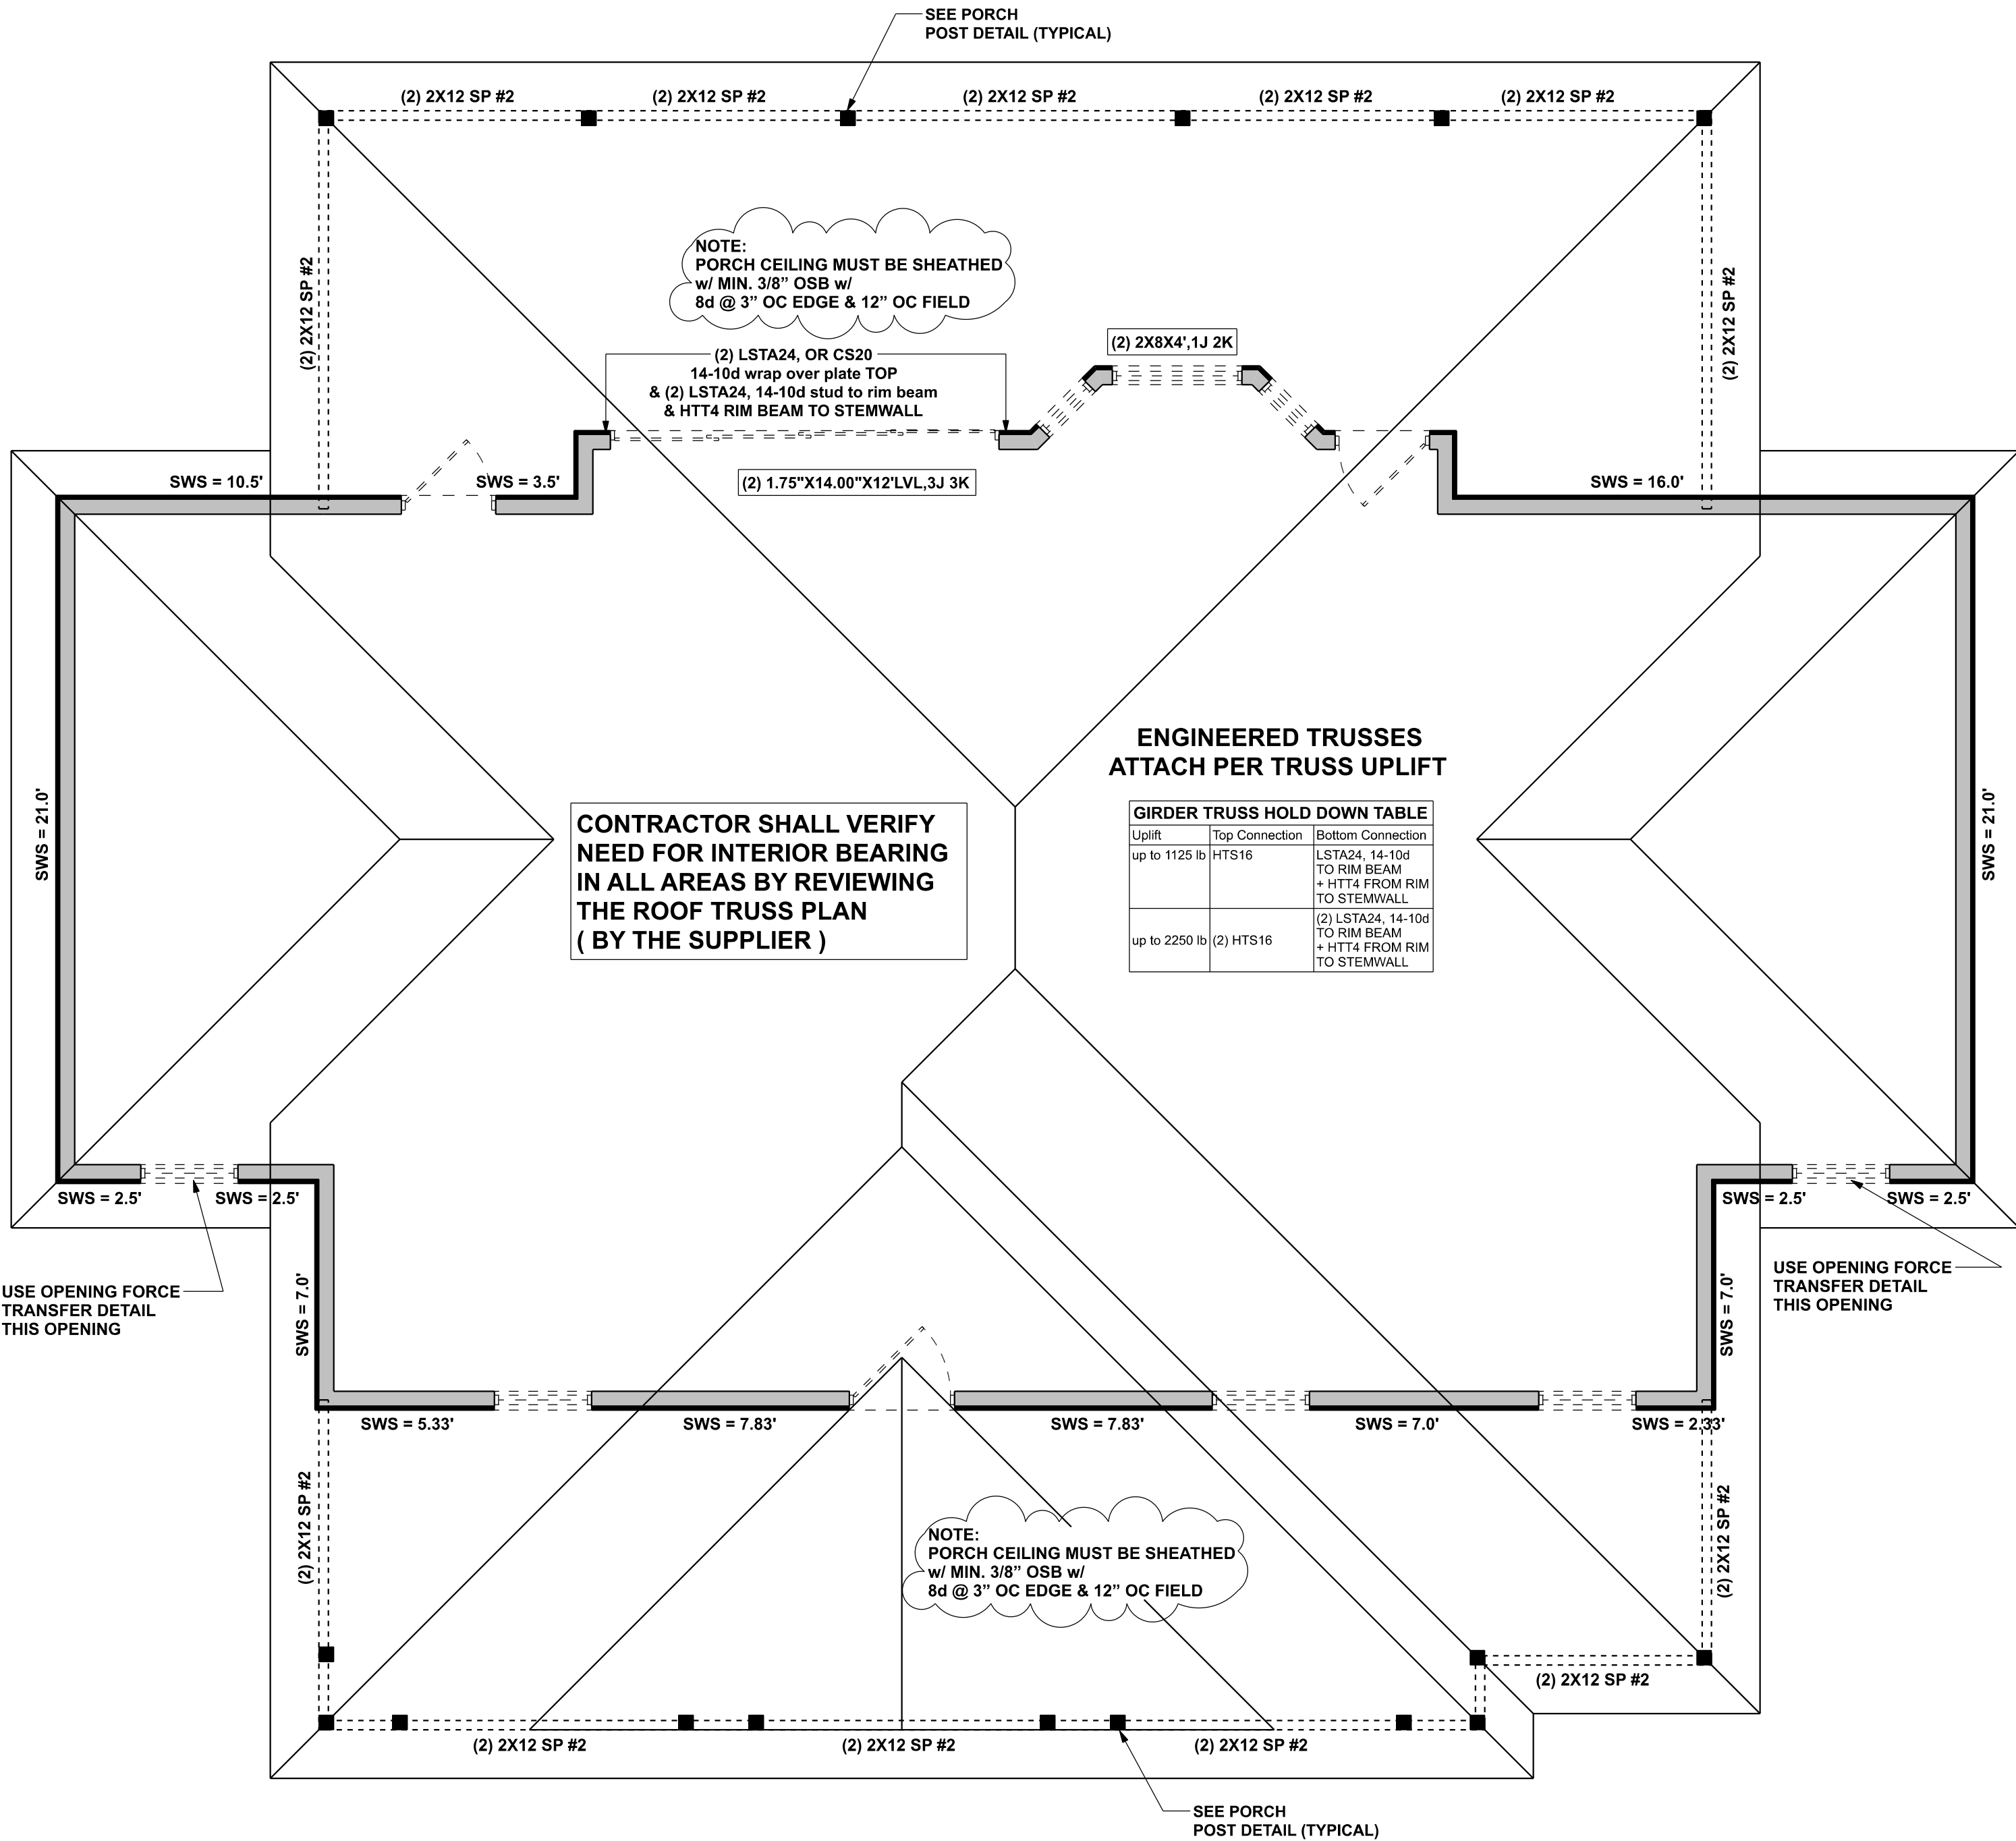

# STRUCTURAL PLAN

SCALE: 1/4" = 1'-0"

# STRUCTURAL PLAN NOTES

- SN-1 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
- SN-2 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCS1-1-03, BCS1-B1, BCS1-B2, & BCS1-B3. BCS1-B1, BCS1-B2, & BCS1-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

ACTUAL vs REQUIRED SHEARWALL		
	TRANSVERSE	LONGITUDINAL
ACTUAL	16800 LBF	16876 LBF
REQUIRED	16431 LBF	14169 LBF

UNLESS NOTED OTHERWISE (MINIMUM REQUIERMENTS)	
***SEE STRUCTURAL PLAN FOR ANY SPECIFIC CALL OUTS***	
BEAM / HEADERS (SIZE)	ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (UNO)
HEADERS (JACK & KING STUDS)	ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (UNO)
HEADERS (STRAPING)	SEE HEADER STRAPING DETAIL ON SHEET S-1
JACK STUDS UNDER GIRDER TRUSS	USE ONE JACK STUD GIRDER SUPPORT PER 2000 LB LOAD

# HEADER LEGEND

- (2) 2X6X0", 1J 1K → HEADER/BEAM CALL-OUT (U.N.O.)
- ↑ NUMBER OF KING STUDS EACH SIDE OF OPENING (FULL LENGTH)
- ↑ NUMBER OF JACK STUDS EACH SIDE OF OPENING (UNDER HEADER)
- ↑ SPAN OF HEADER
- ↑ SIZE OF HEADER MATERIAL
- ↑ NUMBER OF PLIES IN HEADER

Scott Kremsler Res.

PROJECT ADDRESS:  
163 SW Midtown Place  
Fort White, FL 32038

FL PE 53915

This item has been digitally signed and sealed by Mark Disosway P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=US, O=Florida, dnQualifier=A014, 10C0000017E97D, E07CA000746F0, CN=Mark d Disosway  
2022-09-14 12:46:37

DIMENSIONS: Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disosway P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disosway P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disosway P.E.  
163 SW Midtown Place  
Suite 103  
Lake City, Florida 32025  
386.754.5419  
disoswaydesign@gmail.com

JOB NUMBER:  
220807

S-3  
OF 3 SHEETS