

Maronda Systems

Maronda Systems 4005 Maronda Way Sanford FL 32771 (407) 321-0064 Fax (407) 321-3913
 Engineer/Architect of Record: Carl Brown P.E. 258 Southhall Lane, Suite 200 Maitland, FL 32751 FL PE # 56126
 Engineer/Architect of Record: Luis Jose Burgos Pasado, P.E. 258 Southhall Lane, Suite 200 Maitland, FL 32751 FL PE # 92724
 Engineer/Architect of Record: Scott A Lewkowski P.E. 258 Southhall Lane, Suite 200 Maitland, FL 32751 FL PE # 78750
 Design Criteria: TPI Design: Matrix Analysis MiTek software

PLAN JOB #	LOT	ADDRESS	DIV/SUB	MODEL
9FC00401	004 - 1	TBD SW CADENCE GLEN LAKE CITY, FL 32024	JAW/9FC	MEMJ32F/LH

MEMPHIS J BASE

This structure was designed in accordance with, and meets the requirements of TPI standards and the FLORIDA BUILDING CODE 8thTH EDITION (2023) for 160 M.P.H. Wind Zone. Exposure C
 Truss loading is in accordance with ASCE 7-22. These trusses are designed for an enclosed building.
 With risk category II.

The Truss Engineering package for the above referenced site was generated by the Truss Designer/Architect/MiTek.

I, the Delegated Truss Engineer for the above referenced lot
 Have reviewed the package and confirmed that it matches the physical and structural
 Parameters found on the set of permit drawings.

Truss ID	Run Date	Drawing Reviewed	Truss ID	Run Date	Drawing Reviewed	No. of Eng. Dwg's:	38
Layout	11/14/23					Roof Loads-	
REACTION SUMMARY	11/14/23					TC Live:	16.0 psf
MII web plate	2017					TC Dead:	7.0 psf
OR1	2009					BC Live:	0.0 psf
ST-4ply Screw	2012					BC Dead:	10.0 psf
VC1	2009					Total	33.0 psf
TN1	2009					DurFac- Lbr:	1.25
ST-Rep01A1	2014					DurFac- Plt:	1.25
G15	11/14/23					O.C. Spacing:	24.0"
G21	11/14/23					Floor Loads-	
G22	11/14/23					TC Live:	40.0 psf
GP8	11/14/23					TC Dead:	10.0 psf
H01	11/14/23					BC Live:	0.0 psf
H02	11/14/23					BC Dead:	5.0 psf
H03	11/14/23					Total	55.0 psf
H04	11/14/23					DurFac- Lbr:	1.00
H05	11/14/23					DurFac- Plt:	1.00
H06	11/14/23					O.C. Spacing:	24.0"
H08	11/14/23						
H14	11/14/23						
HGR07	11/14/23						
HGR09	11/14/23						
J16F	11/14/23						
J16PF	11/14/23						
J20	11/14/23						
J36F	11/14/23						
J36PF	11/14/23						
J56F	11/14/23						
J56PF	11/14/23						
J76F	11/14/23						
J76PF	11/14/23						
JGR76F	11/14/23						
JGR76PF	11/14/23						
LT01	11/14/23		INV #	DESC	QNTY		
T01	11/14/23		050060.0110	JUS26			
T11	11/14/23		050060.0047	THD28			
T12	11/14/23		050060.0049	THD28-2			
T13	11/14/23		050060.0106	HUS26			
			050060.0272	HUS179			
			050060.0058	HJC26	3		
			050060.0312	HJC26-SK60			
			SEAT PLATES				
			FLOOR SEAT PLATES				




TOTAL SOLUTIONS GROUP
 258 Southhall Lane, Suite 200
 Maitland, Florida 32751
 (407) 680 2333
 CA No. 9161
 100% Employee Owned
 myTSGhome.com
☐ CARL A. BROWN, PE - FL # 56126
☐ SCOTT A. LEWKOWSKI, PE - FL # 78750
☐ THIEN BAO DUONG, PE - FL # 94452



1-17-25
 TO THE BEST OF THE ENGINEER'S
 KNOWLEDGE AND UNDERSTANDING, THE
 STRUCTURAL PLANS AND SPECIFICATIONS
 COMPLY WITH THE FLORIDA BUILDING
 CODE SIGNED AND SEALED FOR THE
 STRUCTURAL PORTION OF THIS DRAWING.

		EXPOSURE	C	GENERAL TRUSS NOTES:
TC LIVE	16.0 lb/ft ²	SNOW LOAD	0.00	
TC DEAD	7.0 lb/ft ²	LUMBER DOL	1.25	
BC LIVE	0.0 lb/ft ²	PLATE DOL	1.25	
BC DEAD	10.0 lb/ft ²	WIND	160.0 mph Vasd=124.0 mph	
TOTAL	33.0 lb/ft ²	SPACING	24" O.C.	1. INFORMATION BASED ON 160.0 MPH WIND LOAD. ALL PRESSURES WERE CALCULATED USING MWFRS/C-C HYBRID WIND ASCE 7-22. 2. PROVIDE TRUSS BRACING PER TRUSS ENGINEERING AND BCSI I-03.

TRUSS PLACEMENT PLAN

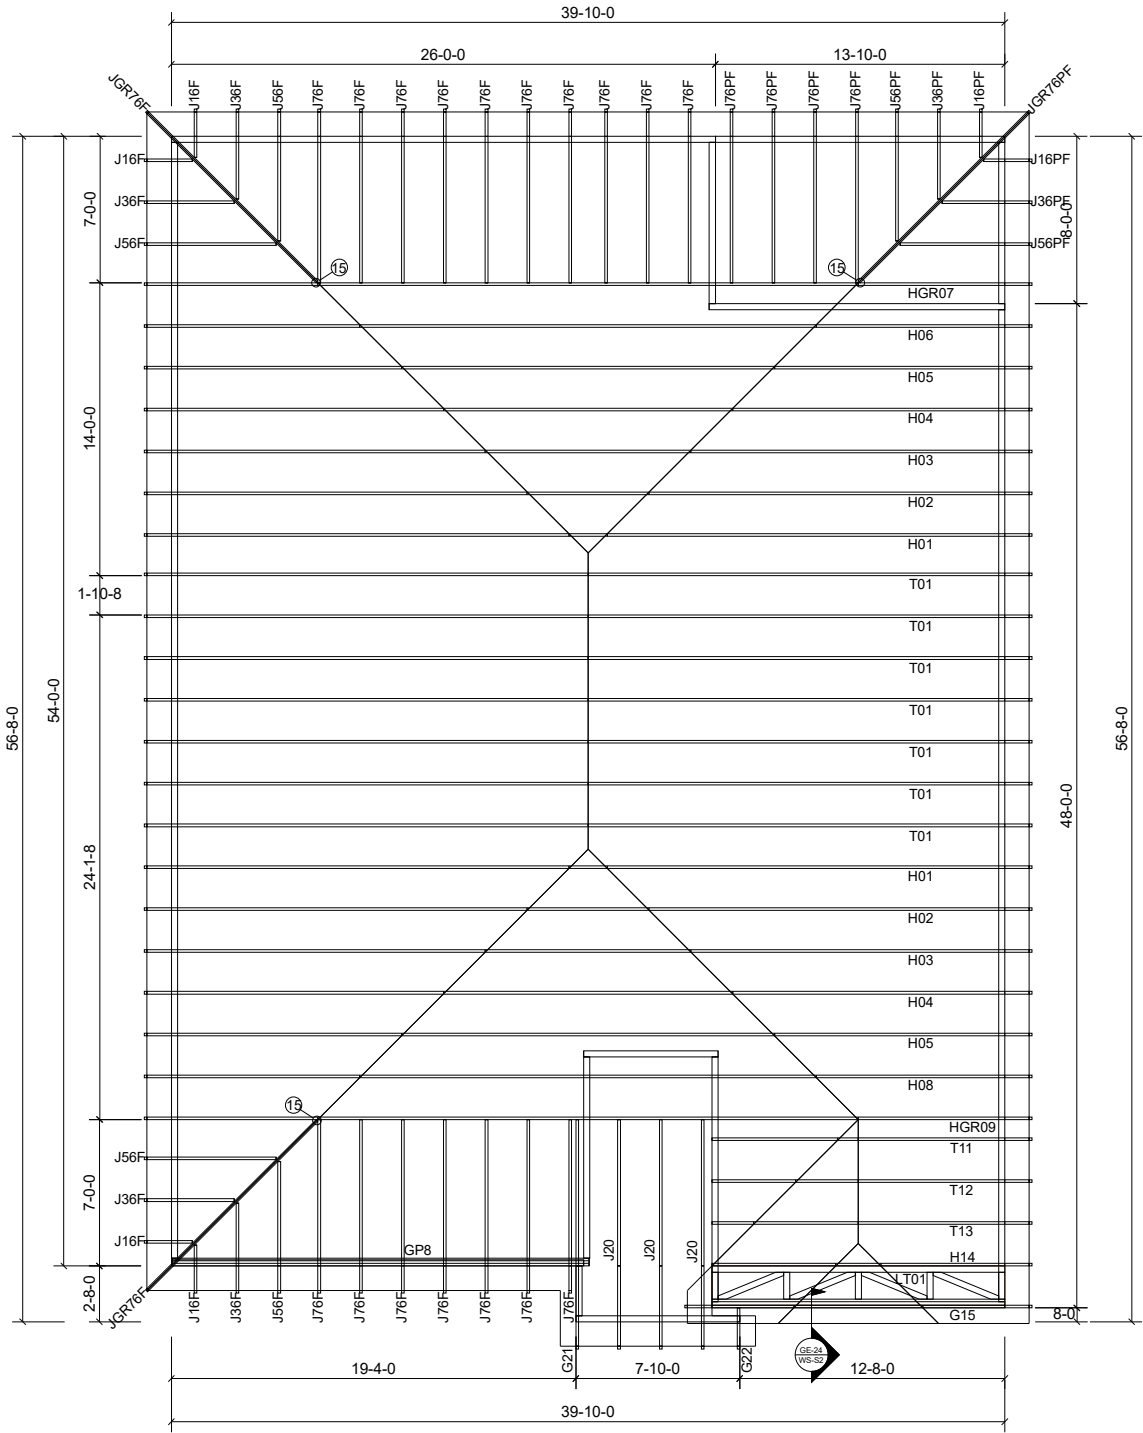

MEMPHIS 'J' FRAME
GARAGE LEFT



4005 Maronda Way
Sanford, FL 32771
(407) 321-0064

CUSTOMER:Maronda Systems
Model: MEMPHIS
ELEVATION: J - FRAME
DRAWN BY: E. RIOS
RELEASE DATE: 11/15/2023
GARAGE: LEFT



Making Dreams Come True

TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 880 2333
CA No. 9181

100% Employee Owned
myTSGhome.com

- ☐ CARL A. BROWN, PE - FL # 56126
- ☐ SCOTT A. LEWKOWSKI, PE - FL # 78750
- ☐ THIEN BAO DUONG, PE - FL # 94452

1-17-25

TO THE BEST OF THE ENGINEER'S
KNOWLEDGE AND UNDERSTANDING, THE
STRUCTURAL PLANS AND SPECIFICATIONS
COMPLY WITH THE FLORIDA BUILDING CODE
SIGNED AND SEALED FOR THE STRUCTURAL
PORTION OF THIS DRAWING.

FLORIDA:

THIS STRUCTURE WAS DESIGNED IN
ACCORDANCE AND MEETS THE
REQUIREMENTS OF SECTION R301 OF THE
FLORIDA BUILDING CODE 8th EDITION
(2023): RESIDENTIAL. ALL CONNECTORS
HAVE BEEN CHECKED TO WITHSTAND ALL
APPLICABLE LOADS AND DESIGN CRITERIA
STATED ON THE COVER SHEET.

DEFINITIONS





















- MWF = MAIN WIND FORCE
- C&C = COMPONENTS AND CLADDING
- TOB = TOP OF BEARING
- TC = TOP CHORD
- BC = BOTTOM CHORD
- LL = LIVE LOAD
- DL = DEAD LOAD
- psf = POUNDS PER SQUARE FOOT
- # = POUNDS





LOADS PER FBC & FRC

- * NON-CONCURRENT BC LL 10psf
- CONCURRENT STORAGE BC LL 20 psf

SHEET:


TR1

MARONDA HOMES INC. of 4005 MARONDA WAY SANFORD, FL. 32771 (407) 321-9877 Fax: (407) 688-8522				To: Valued Customer			Reaction						
							Job Number: Page: 1 Date: 11/15/23 15:50:19 Account No: 000000001 Designer: Estimator: Salesperson: Inside Sales Quote Number: P.O. Number:						
Project: Memphis		Block No:		Deliver To:									
Model: J Frame (base)		Lot No:											
Contact:	Site:	Office:											
Name:													
Phone:													
Fax:													
			Qty:	Truss Id:	Span:	Truss Type:	Slope	Reactions:					
			1	G15	14-00-00	HIP	6.00	Joint 2 156.61 -88.50	Joint 10 156.61 -99.87	Joint 12 179.69 -101.55	Joint 13 114.82 -59.73	Joint 14 141.72 -74.41	
			1	G21	09-08-00	MONOPITCH	6.00	Joint 2 84.62	Joint 5 202.11 -145.47	Joint 6 409.47 -296.89			
			1	G22	00-08-00	MONOPITCH	6.00	Joint 2 151.93 -173.15	Joint 4 267.32 -222.22				
			1	GP8	19-11-00	ROOF SPECIAL	0.00	Joint 18 1135.07 -943.57	Joint 19 1970.70 -1616.29	Joint 21 1098.67 -864.82	Joint 22 1889.18 -1908.36		
			2	H01	39-10-00	HIP	6.00	Joint 2 1551.38 -581.74	Joint 9 1551.39 -581.74				
			2	H02	39-10-00	HIP	6.00	Joint 2 1560.94 -587.08	Joint 9 1563.81 -587.08				
			2	H03	39-10-00	HIP	6.00	Joint 2 1534.08 -591.84	Joint 8 1534.08 -591.84				
			2	H04	39-10-00	HIP	6.00	Joint 2 1542.65 -596.01	Joint 8 1542.65 -596.01				
			2	H05	39-10-00	HIP	6.00	Joint 2 1538.35 -599.58	Joint 10 1538.35 -599.58				
			1	H06	39-10-00	HIP	6.00	Joint 2 1371.17 -602.57	Joint 10 1371.17 -602.57				
			1	H08	39-10-00	HIP	6.00	Joint 2 424.93 -229.14	Joint 10 620.06 -335.84	Joint 15 1101.68 -539.33	Joint 16 659.78 -372.59		
			1	H14	14-00-00	HIP	6.00	Joint 2 521.16 -239.27	Joint 5 459.51 -188.50				
			1	HGR07	39-10-00	HIP GIRDER	6.00	Joint 2 372.17 -348.16	Joint 9 1482.71 -930.33	Joint 14 3745.15 -2757.81			
			1	HGR09	39-10-00	HIP GIRDER	6.00	Joint 2 398.17 -273.35	Joint 9 971.88 -645.03	Joint 14 2572.78 -1805.59	Joint 15 1010.95 -640.13		
			4	J16F	01-00-00	JACK-OPEN	6.00	Joint 2 124.60 -93.33	Joint 3 8.65 -2.45	Joint 4 19.76 -5.59			
			2	J16PF	01-00-00	JACK-OPEN	6.00	Joint 2 124.60 -93.33	Joint 3 5.83 -5.73	Joint 4 19.76 -6.97			
			3	J20	09-08-00	MONOPITCH	6.00	Joint 2 362.73 -156.80	Joint 8 306.11 -224.20				
			4	J36F	03-00-00	JACK-OPEN	6.00	Joint 2 165.49 -88.57	Joint 3 53.84 -61.82	Joint 4 31.23			
			2	J36PF	03-00-00	JACK-OPEN	6.00	Joint 2 165.49 -88.57	Joint 3 53.84 -61.82	Joint 4 31.22 -23.72			
			4	J56F	05-00-00	JACK-OPEN	6.00	Joint 2 226.68 -103.94	Joint 3 98.36 -114.55	Joint 4 57.51			

MARONDA HOMES INC. of 4005 MARONDA WAY SANFORD, FL. 32771 (407) 321-9877 Fax: (407) 688-8522			To: Valued Customer ,			Reaction				
						Job Number: Page: 2 Date: 11/15/23 15:50:23				
Project: Memphis Model: J Frame (base)		Block No: Lot No:	Deliver To:			Account No: 000000001				
Contact:	Site:	Office:				Designer:				
Name:						Estimator:				
Phone:						Salesperson: Inside Sales				
Fax:						Quote Number:				
						P.O. Number:				
	Qty:	Truss Id:	Span:	Truss Type:	Slope	Reactions:				
	2	J56PF	05-00-00	JACK-OPEN	6.00	Joint 2 226.68 -103.94	Joint 3 98.36 -114.55	Joint 4 57.51 -41.65		
	17	J76F	07-00-00	JACK-OPEN	6.00	Joint 2 292.07 -122.82	Joint 4 64.09 -94.19	Joint 5 159.64 -65.54		
	4	J76PF	07-00-00	JACK-OPEN	6.00	Joint 2 292.07 -129.78	Joint 4 64.21 -94.32	Joint 5 159.52 -115.71		
	2	JGR76F	09-09-05	DIAGONAL HIP	4.24	Joint 2 553.05 -391.75	Joint 4 62.18 -81.85	Joint 5 347.25 -166.57	Joint 6 135.31 -189.26	Joint 8 897.05 -407.93
	1	JGR76PF	09-09-05	DIAGONAL HIP	4.24	Joint 2 446.20 -423.17	Joint 4 62.37 -78.92	Joint 5 347.05 -343.80		
	1	LT01	14-00-00	LAY-IN GABLE	0.00	Joint 6 1645.00 -1370.83	Joint 10 1645.00 -1370.83			
	7	T01	39-10-00	COMMON	6.00	Joint 2 1564.17 -579.19	Joint 10 1564.17 -579.19			
	1	T11	14-00-00	ROOF SPECIAL	6.00	Joint 2 516.37 -233.63	Joint 6 454.67 -207.23			
	1	T12	14-00-00	ROOF SPECIAL	6.00	Joint 2 516.37 -234.43	Joint 6 454.67 -193.73			
	1	T13	14-00-00	ROOF SPECIAL	6.00	Joint 2 516.37 -234.92	Joint 6 454.67 -185.51			




1. ALL MATERIAL IS 2x4
2. THIS DETAIL IS APPLICABLE FOR DESIGNS WITH DOLS. OF 1.15 OR 1.25 AND LUMBER SPECIES SP, DF, HF, OR SPF.
3. DETAIL SHALL BE USED FOR CONDITIONS OF A MISSING OR LOOSE CONNECTOR PLATE ONLY.
4. CHORD MATERIAL IS CONTINUOUS THROUGH JOINT, THERE IS NO MAXIMUM CHORD FORCE AND NO SPLICE PERMITTED.
5. REFER TO MITTEK DESIGN DRAWING FOR WEB FORCES.



ATTACH 1/2" PLYWOOD OR OSB GUSSET (15/32" RATED SHEATHING 32/16 EXP 1) TO EACH FACE OF TRUSS WITH (0.131" X MIN 2.5") NAILS IN 3 ROWS SPACED @ 4" O.C. NAILS TO BE DRIVEN FROM BOTH FACES. STAGGER SPACING FROM FRONT TO BACK FACE FOR A NET 2" O.C. SPACING IN THE TRUSS. USE 2" MEMBER END DISTANCE.

EDGE OF WEB NOT TO EXTEND BEYOND CORNER OF GUSSET


WEB MEMBER
MAX. FORCE
800 LBS

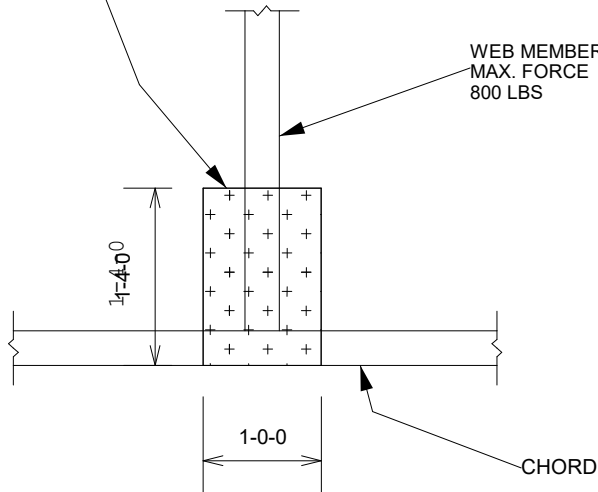

WEB MEMBER
MAX. FORCE
1200 LBS

EDGE OF WEB NOT TO EXTEND BEYOND CORNER OF GUSSET


EDGE OF WEB NOT TO EXTEND BEYOND CORNER OF GUSSET

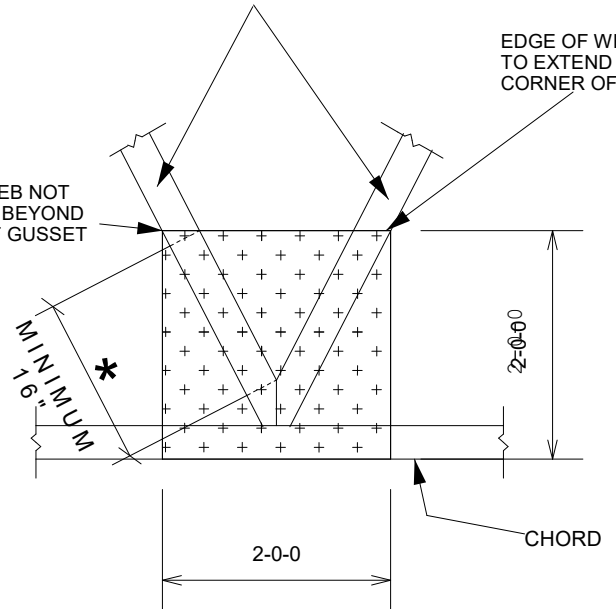


EDGE OF WEB NOT TO EXTEND BEYOND CORNER OF GUSSET


WEB MEMBER
MAX. FORCE
1200 LBS

EDGE OF WEB NOT TO EXTEND BEYOND CORNER OF GUSSET

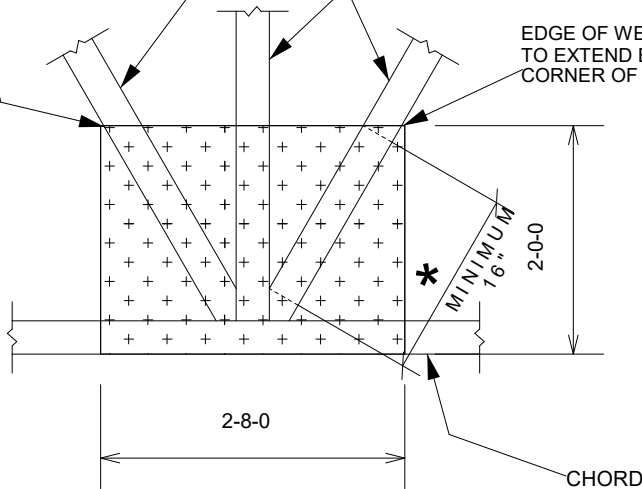

* MEASUREMENT TAKEN AT POINTS WHERE WEB ACHIEVES FULL MEMBER DEPTH (AS MEASURED PERPENDICULAR TO WEB'S SAW-MILLED EDGE)






MiTek USA, Inc.

Four ply girder trusses are to be connected together using the nailing or screw schedule provided by Mitek 20/20 software. In addition to the nailing typically specified, 1/2" dia. bolts are sometimes specified throughout certain chords as indicated on the truss design drawing. In lieu of these bolts, the following wood screws may be used: USP WS6, MiTek Trusslok 6", or equivalent.

These screws are to be installed in two rows spaced 24"o.c. in 2x 6 and larger chords (use one row in 2x 4 chords) as shown in the detail below.


These connections are intended to provide clamping force to aid in allowing the four ply assembly to act as a unit and are not included in the calculation of ply to ply load transfer.

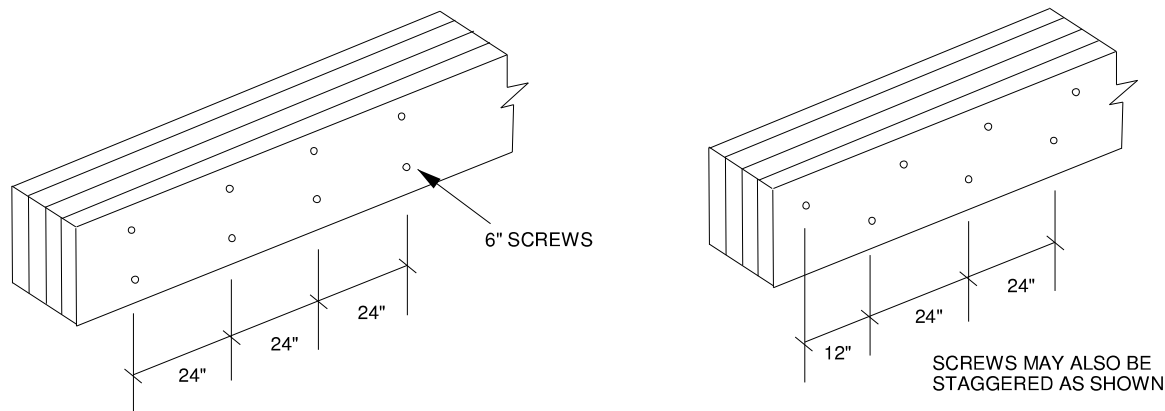

Please note that screws are not required from the back face. However, it is vitally important that the plies are tightly clamped together during the installation of the screws to prevent gaps between the plies.

For trusses where screws are specified for the ply to ply connection instead of nails, the bolts called in the connection notes may be omitted.

NON-BEVELED
BOTTEM CHORD
NO-SHEATHING

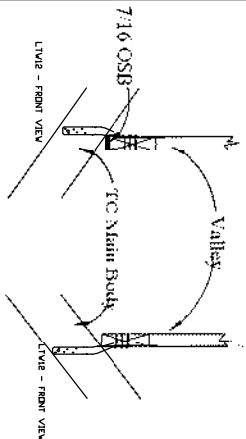



VALLEY CONNECTIONS

(ELEMENTS NOT SHOWN FOR CLARITY)



VALLEY KAT

Notes: Valley trusses can be installed either a top main body roof trusses or a top 7/16 sheathing. Connections of strapping remain the same as illustrated. Valley kats are required when a top main body truss option is utilized. See truss engineering and standard details for truss bracing requirements.

Main body trusses 2'OC perpendicular to valley is considered to be continuous bearing. If sheathing exists under valleys, Sheathing is not required to be continuous See NON BEVELED BOTTOM CHORD Detail

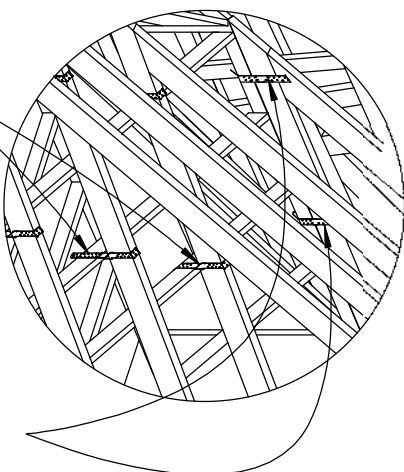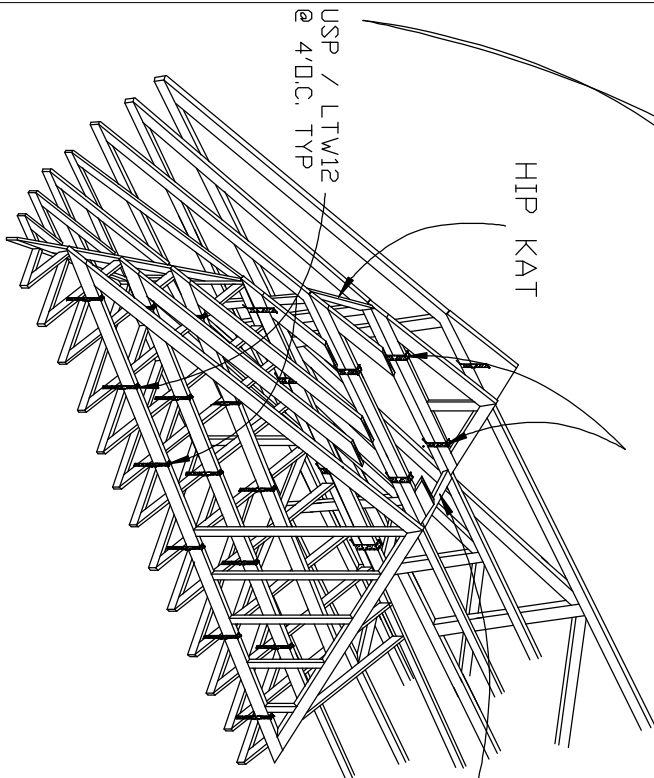USP / MSTA12
@ 4'D.C. TYP

HIP KAT

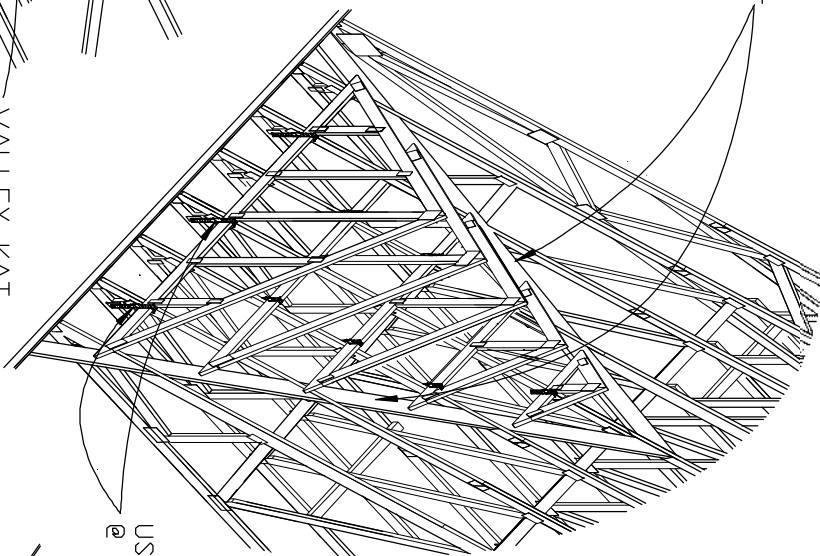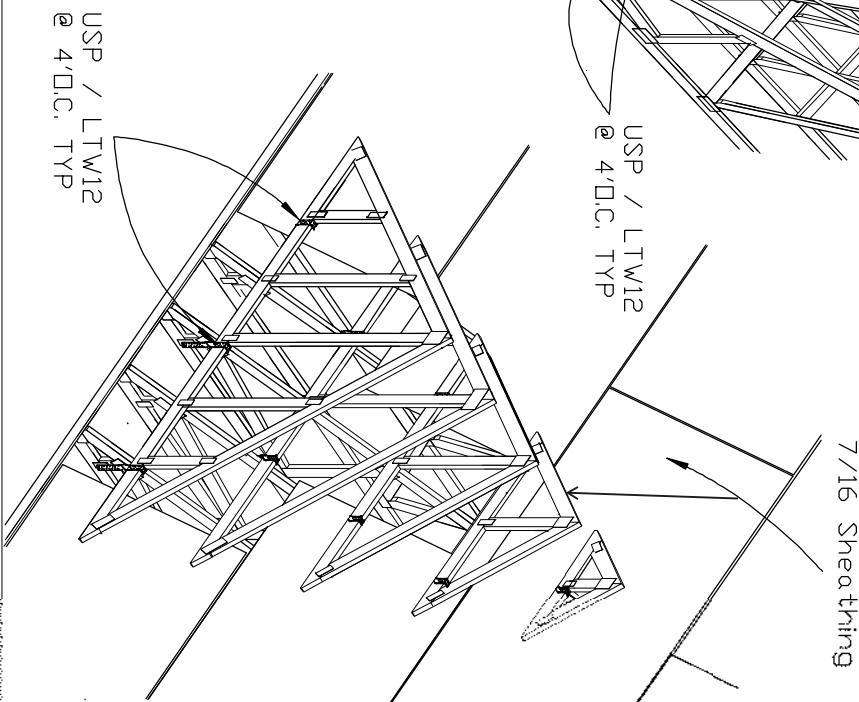USP / LTW12
@ 4'D.C. TYP

7/16 Shea thing

TRUSS DETAILS

VALLEY CONNECTIONS

DRAWN BY: J.FESSIA GARAGE:

RELEASE DATE: 12/7/09



REVIEWS

000000 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100 101 102 103 104 105 106 107 108 109 110 111 112 113 114 115 116 117 118 119 120 121 122 123 124 125 126 127 128 129 130 131 132 133 134 135 136 137 138 139 140 141 142 143 144 145 146 147 148 149 150 151 152 153 154 155 156 157 158 159 160 161 162 163 164 165 166 167 168 169 170 171 172 173 174 175 176 177 178 179 180 181 182 183 184 185 186 187 188 189 190 191 192 193 194 195 196 197 198 199 200 201 202 203 204 205 206 207 208 209 210 211 212 213 214 215 216 217 218 219 220 221 222 223 224 225 226 227 228 229 230 231 232 233 234 235 236 237 238 239 240 241 242 243 244 245 246 247 248 249 250 251 252 253 254 255 256 257 258 259 260 261 262 263 264 265 266 267 268 269 270 271 272 273 274 275 276 277 278 279 280 281 282 283 284 285 286 287 288 289 290 291 292 293 294 295 296 297 298 299 300 301 302 303 304 305 306 307 308 309 310 311 312 313 314 315 316 317 318 319 320 321 322 323 324 325 326 327 328 329 330 331 332 333 334 335 336 337 338 339 340 341 342 343 344 345 346 347 348 349 350 351 352 353 354 355 356 357 358 359 360 361 362 363 364 365 366 367 368 369 370 371 372 373 374 375 376 377 378 379 380 381 382 383 384 385 386 387 388 389 390 391 392 393 394 395 396 397 398 399 400 401 402 403 404 405 406 407 408 409 410 411 412 413 414 415 416 417 418 419 420 421 422 423 424 425 426 427 428 429 430 431 432 433 434 435 436 437 438 439 440 441 442 443 444 445 446 447 448 449 450 451 452 453 454 455 456 457 458 459 460 461 462 463 464 465 466 467 468 469 470 471 472 473 474 475 476 477 478 479 480 481 482 483 484 485 486 487 488 489 490 491 492 493 494 495 496 497 498 499 500 501 502 503 504 505 506 507 508 509 510 511 512 513 514 515 516 517 518 519 520 521 522 523 524 525 526 527 528 529 530 531 532 533 534 535 536 537 538 539 540 541 542 543 544 545 546 547 548 549 550 551 552 553 554 555 556 557 558 559 560 561 562 563 564 565 566 567 568 569 570 571 572 573 574 575 576 577 578 579 580 581 582 583 584 585 586 587 588 589 590 591 592 593 594 595 596 597 598 599 600 601 602 603 604 605 606 607 608 609 610 611 612 613 614 615 616 617 618 619 620 621 622 623 624 625 626 627 628 629 630 631 632 633 634 635 636 637 638 639 640 641 642 643 644 645 646 647 648 649 650 651 652 653 654 655 656 657 658 659 660 661 662 663 664 665 666 667 668 669 670 671 672 673 674 675 676 677 678 679 680 681 682 683 684 685 686 687 688 689 690 691 692 693 694 695 696 697 698 699 700 701 702 703 704 705 706 707 708 709 710 711 712 713 714 715 716 717 718 719 720 721 722 723 724 725 726 727 728 729 730 731 732 733 734 735 736 737 738 739 740 741 742 743 744 745 746 747 748 749 750 751 752 753 754 755 756 757 758 759 760 761 762 763 764 765 766 767 768 769 770 771 772 773 774 775 776 777 778 779 780 781 782 783 784 785 786 787 788 789 790 791 792 793 794 795 796 797 798 799 800 801 802 803 804 805 806 807 808 809 810 811 812 813 814 815 816 817 818 819 820 821 822 823 824 825 826 827 828 829 830 831 832 833 834 835 836 837 838 839 840 841 842 843 844 845 846 847 848 849 850 851 852 853 854 855 856 857 858 859 860 861 862 863 864 865 866 867 868 869 870 871 872 873 874 875 876 877 878 879 880 881 882 883 884 885 886 887 888 889 890 891 892 893 894 895 896 897 898 899 900 901 902 903 904 905 906 907 908 909 910 911 912 913 914 915 916 917 918 919 920 921 922 923 924 925 926 927 928 929 930 931 932 933 934 935 936 937 938 939 940 941 942 943 944 945 946 947 948 949 950 951 952 953 954 955 956 957 958 959 960 961 962 963 964 965 966 967 968 969 970 971 972 973 974 975 976 977 978 979 980 981 982 983 984 985 986 987 988 989 990 991 992 993 994 995 996 997 998 999 1000 1001 1002 1003 1004 1005 1006 1007 1008 1009 1010 1011 1012 1013 1014 1015 1016 1017 1018 1019 1020 1021 1022 1023 1024 1025 1026 1027 1028 1029 1030 1031 1032 1033 1034 1035 1036 1037 1038 1039


SHEET:

VCI

THE GREEN PAPER COMING FROM THE

TOE-NAILED CONNECTIONS AT BEARING LOCATIONS


TYPICAL CORNER FRAMING

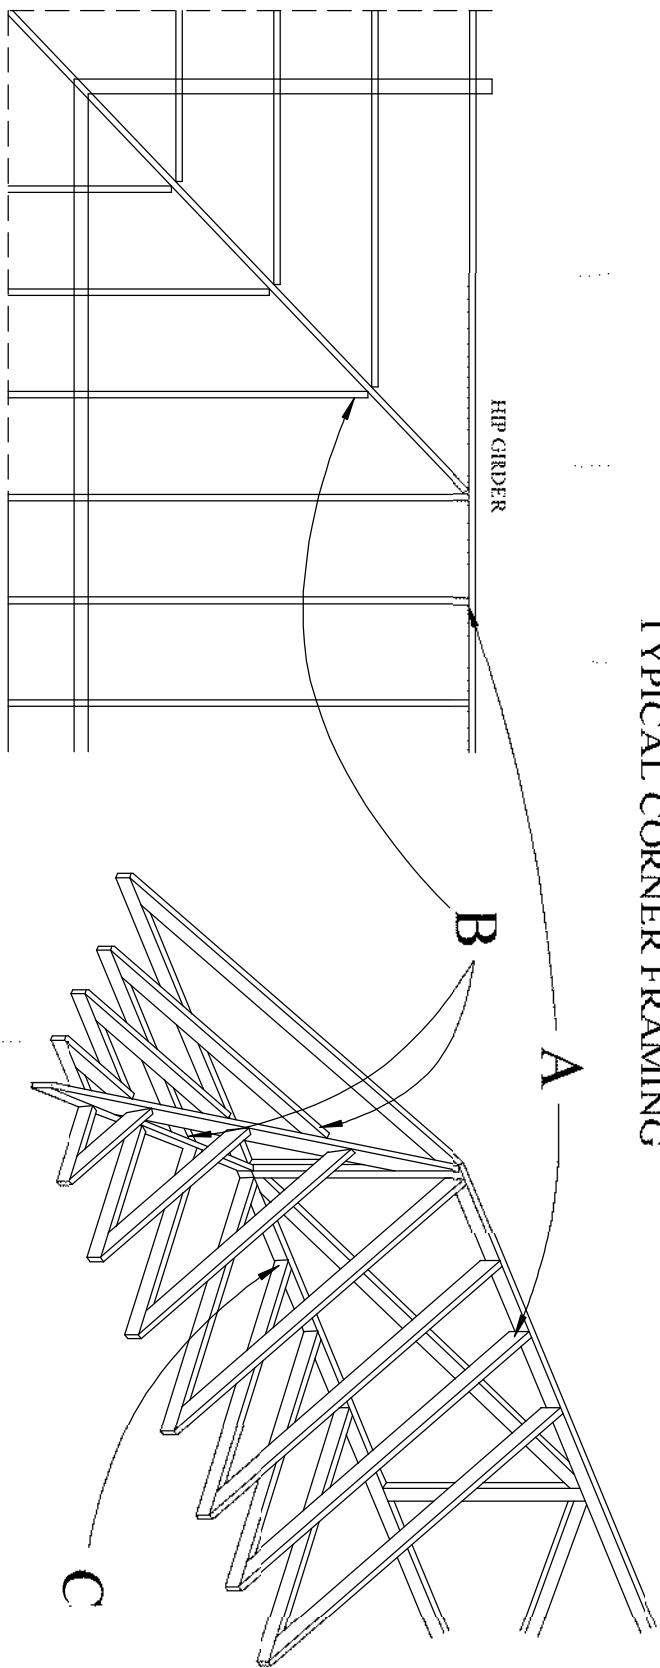

90 DEGREE ANGLE/SQUARE CUT

Connection at A


Connection at C



10d (0.131" x 3") nails

45 DEGREE ANGLE / SQUARE CUT

Connection at B



10d (0.131" x 3") nails

CONNECTION VALUES:

	GRAVITY	UPLIFT
(3)10D	320	385
(3)16D	355	462

Wind loading: Basic wind speed is 160 MPH U.T. (124 ASD)

Exposure category B or C

Occupancy category II

4.8 psf top chord dead load

4.2 psf bottom chord dead load

25' roof height

INTERIOR gable end zone

Enclosed building (Cond. I)

PRR-10, TPI-07, ASCE 7-10

Duration of load is 1.60

L = NAIL LENGTH

TRUSS DETAILS

TOE-NAILED CONNECTIONS

DRAWN BY:

GARAGE

RELEASE DATE: 2/9/09

Maronda Homes

1001 201 60th Ave NW, Suite 200, Atlanta, GA 30328

SHEET

TN1




TOTAL NUMBER OF NAILS EACH SIDE OF BREAK *		X INCHES	MAXIMUM FORCE (lbs) 15% LOAD DURATION							
			SP		DF		SPF		HF	
			2x4	2x6	2x4	2x6	2x4	2x6	2x4	2x6
20	30	24"	1706	2559	1561	2342	1320	1980	1352	2028
26	39	30"	2194	3291	2007	3011	1697	2546	1738	2608
32	48	36"	2681	4022	2454	3681	2074	3111	2125	3187
38	57	42"	3169	4754	2900	4350	2451	3677	2511	3767
44	66	48"	3657	5485	3346	5019	2829	4243	2898	4347

* DIVIDE EQUALLY FRONT AND BACK

ATTACH 2x SCAB OF THE SAME SIZE AND GRADE AS THE BROKEN MEMBER TO EACH FACE OF THE TRUSS (CENTER ON BREAK OR SPLICE) WITH 10d (0.131" X 3") NAILS (TWO ROWS FOR 2x4, THREE ROWS FOR 2x6) SPACED 4" O.C. AS SHOWN. STAGGER NAIL SPACING FROM FRONT FACE AND BACK FACE FOR A NET 0-2-0 O.C. SPACING IN THE MAIN MEMBER. USE A MIN. 0-3-0 MEMBER END DISTANCE.

THE LENGTH OF THE BREAK (C) SHALL NOT EXCEED 12". (C=PLATE LENGTH FOR SPLICE REPAIRS)
THE MINIMUM OVERALL SCAB LENGTH REQUIRED (L) IS CALCULATED AS FOLLOWS:

$$L = (2) X + C$$

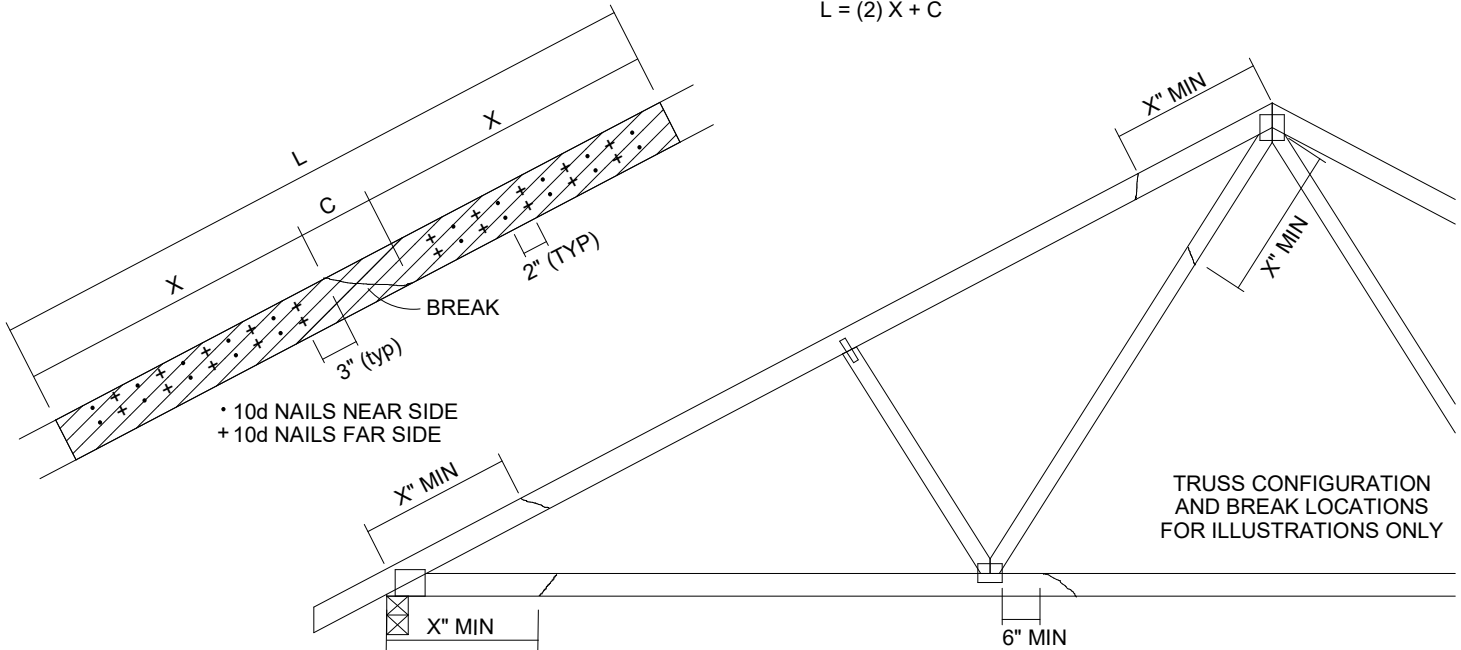


THE LOCATION OF THE BREAK MUST BE GREATER THAN OR EQUAL TO THE REQUIRED X DIMENSION FROM ANY PERIMETER BREAK OR HEEL JOINT AND A MINIMUM OF 6" FROM ANY INTERIOR JOINT (SEE SKETCH ABOVE)

DO NOT USE REPAIR FOR JOINT SPLICES

NOTES:

1. THIS REPAIR DETAIL IS TO BE USED ONLY FOR THE APPLICATION SHOWN. THIS REPAIR DOES NOT IMPLY THAT THE REMAINING PORTION OF THE TRUSS IS UNDAMAGED. THE ENTIRE TRUSS SHALL BE INSPECTED TO VERIFY THAT NO FURTHER REPAIRS ARE REQUIRED. WHEN THE REQUIRED REPAIRS ARE PROPERLY APPLIED, THE TRUSS WILL BE CAPABLE OF SUPPORTING THE LOADS INDICATED.
2. ALL MEMBERS MUST BE RETURNED TO THEIR ORIGINAL POSITIONS BEFORE APPLYING REPAIR AND HELD IN PLACE DURING APPLICATION OF REPAIR.
3. THE END DISTANCE, EDGE DISTANCE AND SPACING OF NAILS SHALL BE SUCH AS TO AVOID UNUSUAL SPLITTING OF THE WOOD.
4. WHEN NAILING THE SCABS, THE USE OF A BACKUP WEIGHT IS RECOMMENDED TO AVOID LOOSENING OF THE CONNECTOR PLATES AT THE JOINTS OR SPLICES.
5. THIS REPAIR IS TO BE USED FOR SINGLE PLY TRUSSES IN THE 2x ORIENTATION ONLY.
6. THIS REPAIR IS LIMITED TO TRUSSES WITH NO MORE THAN THREE BROKEN MEMBERS.

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	G15	Hip Supported Gable	1	1	Job Reference (optional)

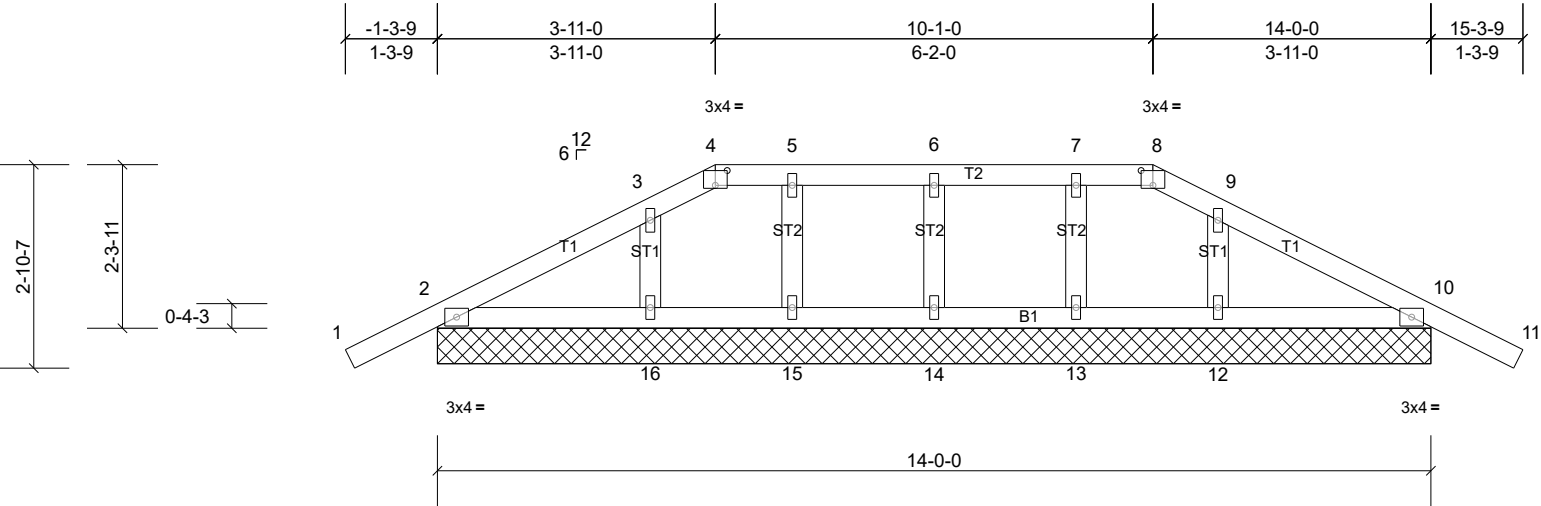

Scale = 1:32.5

Plate Offsets (X, Y): [4:0-2-0,0-2-8], [8:0-2-0,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.15	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	7.0	Lumber DOL	1.25	BC	0.06	Vert(CT)	n/a	-	n/a	999	244/190
BCLL	0.0*	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	10	n/a	n/a	Weight: 59 lb
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied.
OTHERS	2x4 SP No.2		

REACTIONS All bearings 14-0-0.

(lb) - Max Horiz 2=61 (LC 11), 17=61 (LC 11)

Max Uplift All uplift 100 (lb) or less at joint(s) 2, 10, 13, 14, 15, 17, 20 except 12=-102 (LC 12), 16=-108 (LC 11)


Max Grav All reactions 250 (lb) or less at joint(s) 2, 10, 12, 13, 14, 15, 16, 17, 20

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 1.5x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 14, 15, 13, 2, 10 except (jt=lb) 16=108, 12=102.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	G21	Monopitch Structural Gable	1	1	Job Reference (optional)

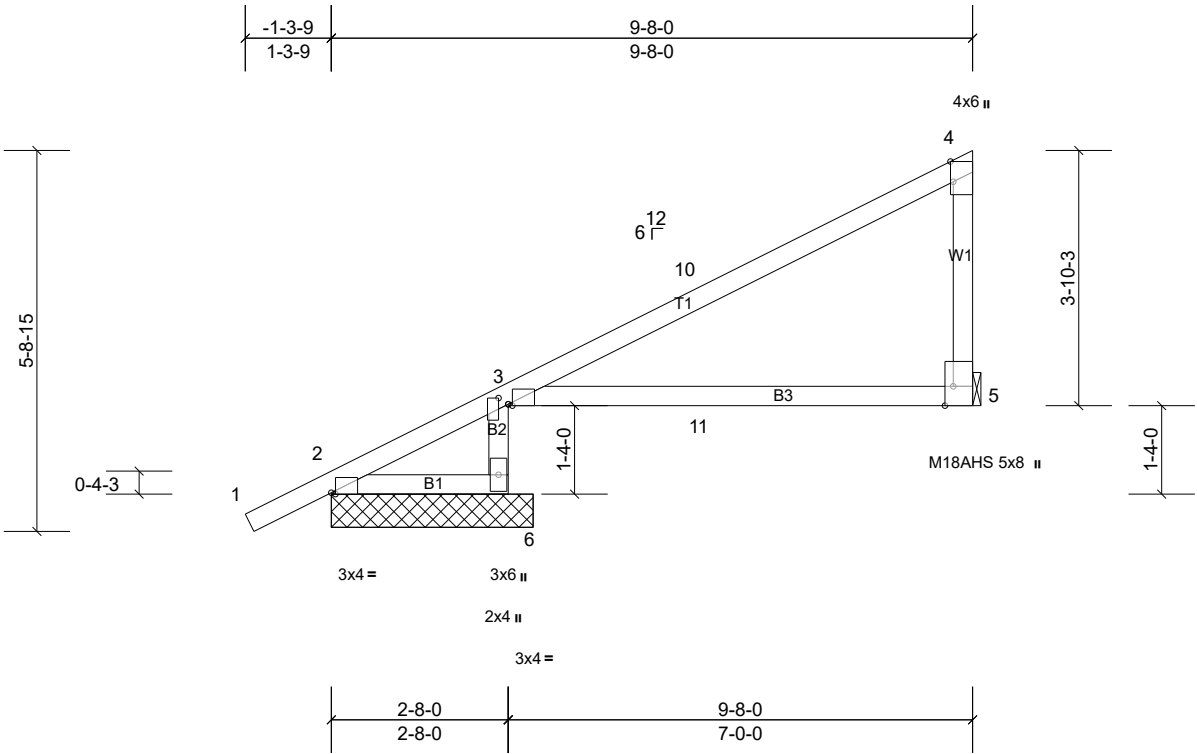

Scale = 1:34.7

Plate Offsets (X, Y): [2:0-0-12,Edge], [3:0-0-12,Edge], [3:0-1-2,0-1-12], [4:0-3-11,Edge], [5:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.92	Vert(LL)	0.26	3-5	>319	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.75	Vert(CT)	0.23	3-5	>370	180	M18AHS	186/179
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	5	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 39 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied.


REACTIONS All bearings 3-0-8. except 5= Mechanical
(lb) - Max Horiz 2=288 (LC 11), 7=288 (LC 11)
Max Uplift All uplift 100 (lb) or less at joint(s) except 5=-146 (LC 11), 6=-297 (LC 11)
Max Grav All reactions 250 (lb) or less at joint(s) 2, 5, 7 except 6=410 (LC 1)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-574/186, 4-5=-144/313
BOT CHORD 3-6=-426/1141


- NOTES**
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 9-6-4 to 9-6-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are MT20 plates unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 145 lb uplift at joint 5 and 297 lb uplift at joint 6.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard


Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	G22	Monopitch	1	1	user bearing Job Reference (optional)



12
6

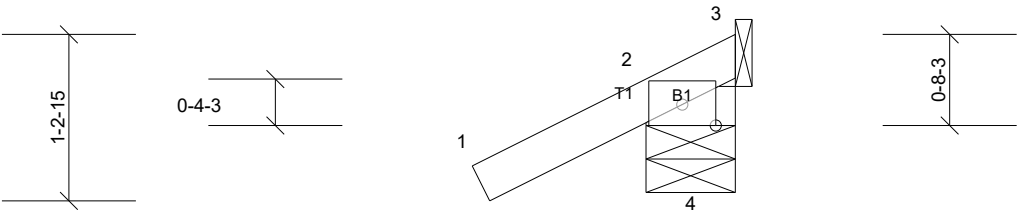

4x6 =



Scale = 1:17.2


Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.24	Vert(LL)	0.00	5	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.31	Vert(CT)	0.00	5	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 4 lb	FT = 20%

LUMBER			BRACING	
TOP CHORD	2x4	SP No.2	TOP CHORD	Structural wood sheathing directly applied or 0-8-0 oc purlins. Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD	2x4	SP No.2	BOT CHORD	
REACTIONS (lb/size) 2=-173/ Mechanical, (min. 0-1-8), 4=267/0-8-0, (min. 0-1-8)				
	Max Horiz	4=46 (LC 11)		
	Max Uplift	2=-173 (LC 1), 4=-222 (LC 11)		
	Max Grav	2=152 (LC 11), 4=267 (LC 1)		
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.				
BOT CHORD	2-4=-145/348			

- NOTES**
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 173 lb uplift at joint 2 and 222 lb uplift at joint 4.
 - Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.

LOAD CASE(S) Standard

Maronda Homes, Sanford, Edwin Rios Run: 8.72 S Nov 2 2023 Print: 8.720 S Nov 2 2023 MiTek Industries, Inc. Wed Nov 15 16:10:01 Page: 1

[illegible]

NOTES

- 3-ply truss to be connected together as follows:
Top chords connected with WS45 as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected with WS45 as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web chords connected with 10d (0.148"x3") nails as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 944 lb uplift at joint 18, 1616 lb uplift at joint 19, 865 lb uplift at joint 21 and 1908 lb uplift at joint 22.
- Load case(s) 13, 43, 44, 45, 46 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- This truss has been designed for a total drag load of 4000 lb. Lumber DOL=(1.33) Plate grip DOL=(1.33) Connect truss to resist drag loads along bottom chord from 1-6-0 to 19-11-0 for 217.2 plf.

LOAD CASE(S)

Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	GP8	Roof Special Girder	1	3	garage Job Reference (optional)

- Uniform Loads (lb/ft)

Vert: 1-9=-172, 10-17=-10
- 13)

Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90

Uniform Loads (lb/ft)

Vert: 1-9=-82, 10-17=-10
- 43)

Dead + DragE LC#1 Left: Lumber Increase=1.33, Plate Increase=1.33

Uniform Loads (lb/ft)

Vert: 1-9=-82, 10-17=-10

Drag: 2-9=201, 10-22=-217, 8-10=-217, 10-17=-217
- 44)

Dead + DragE LC#1 Right: Lumber Increase=1.33, Plate Increase=1.33

Uniform Loads (lb/ft)

Vert: 1-9=-82, 10-17=-10

Drag: 2-9=-201, 10-22=217, 8-10=217, 10-17=217
- 45)

0.6 Dead + DragE LC#1 Left: Lumber Increase=1.33, Plate Increase=1.33

Uniform Loads (lb/ft)

Vert: 1-9=-49, 10-17=-6

Drag: 2-9=201, 10-22=-217, 8-10=-217, 10-17=-217
- 46)


0.6 Dead + DragE LC#1 Right: Lumber Increase=1.33, Plate Increase=1.33

Uniform Loads (lb/ft)

Vert: 1-9=-49, 10-17=-6

Drag: 2-9=-201, 10-22=217, 8-10=217, 10-17=217

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	H01	Hip	2	1	Job Reference (optional)

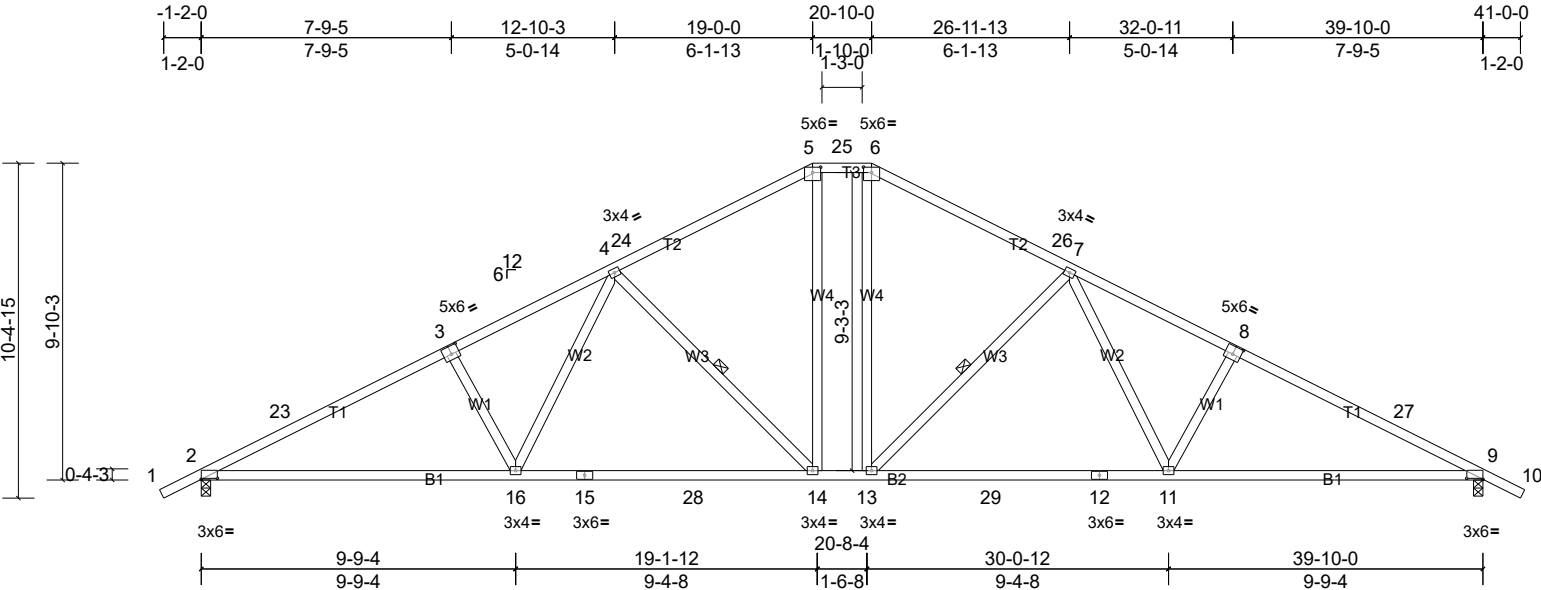

Scale = 1:71.6

Plate Offsets (X, Y): [2:0-6-0,0-0-6], [3:0-3-0,0-3-0], [5:0-3-0,0-2-0], [6:0-3-0,0-2-0], [8:0-3-0,0-3-0], [9:0-6-0,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.64	Vert(LL)	-0.35	14-16	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.91	Vert(CT)	-0.59	14-16	>809	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.31	Horz(CT)	0.12	9	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 216 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.1D *Except* B2:2x4 SP No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 4-14, 7-13


REACTIONS (lb/size) 2=1371/0-3-8, (min. 0-1-9), 9=1371/0-3-8, (min. 0-1-9)
Max Horiz 2=238 (LC 15)
Max Uplift 2=-582 (LC 11), 9=-582 (LC 12)
Max Grav 2=1551 (LC 2), 9=1551 (LC 2)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-23=-2789/945, 3-23=-2753/964, 3-4=-2674/976, 4-24=-1848/733, 5-24=-1839/757, 5-25=-1613/733, 6-25=-1613/733, 6-26=-1839/757, 7-26=-1848/733, 7-8=-2674/976, 8-27=-2753/964, 9-27=-2789/946
BOT CHORD 2-16=-950/2463, 15-16=-690/2050, 15-28=-690/2050, 14-28=-690/2050, 13-14=-355/1613, 13-29=-528/2050, 12-29=-528/2050, 11-12=-528/2050, 9-11=-712/2463
WEBS 3-16=-286/339, 4-16=-235/701, 4-14=-658/484, 5-14=-190/656, 6-13=-190/656, 7-13=-658/484, 7-11=-236/701, 8-11=-286/339

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 26-5-10 to 41-0-13 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 582 lb uplift at joint 2 and 582 lb uplift at joint 9.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	H02	Hip	2	1	Job Reference (optional)

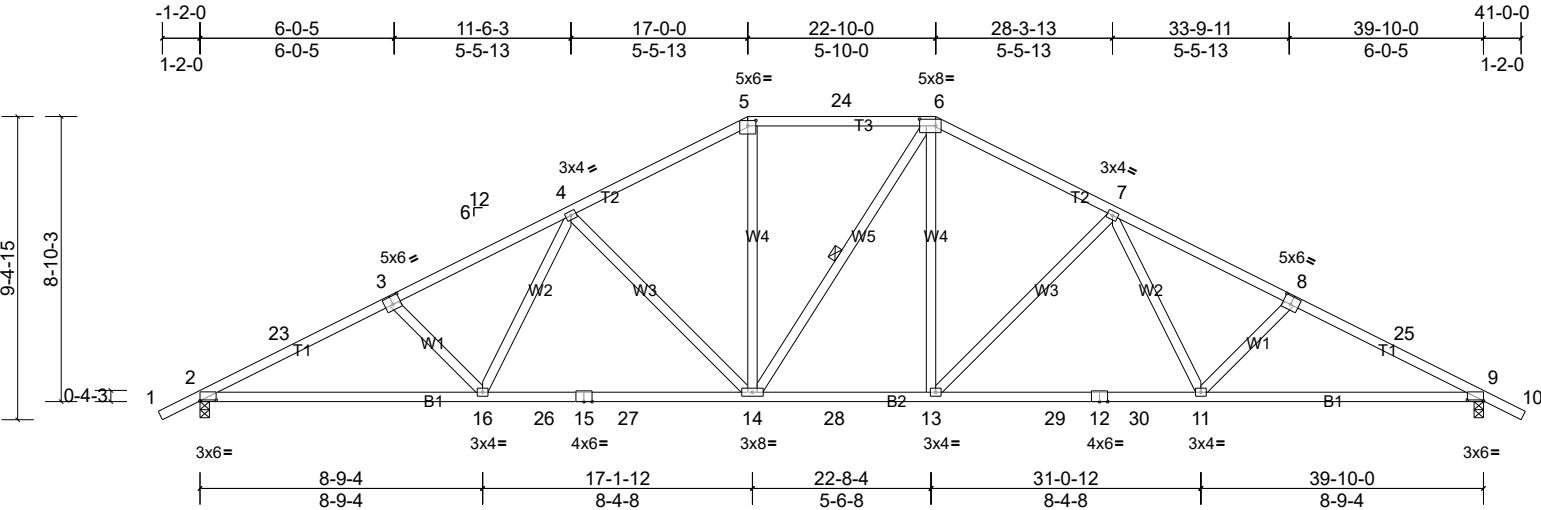

Scale = 1:71.5

Plate Offsets (X, Y): [2:0-6-0,0-0-6], [3:0-3-0,0-3-0], [5:0-3-0,0-2-0], [6:0-6-0,0-2-8], [8:0-3-0,0-3-0], [9:0-6-0,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.41	Vert(LL)	-0.28	11-13	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.99	Vert(CT)	-0.51	11-13	>939	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.65	Horz(CT)	0.14	9	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 221 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 6-14


REACTIONS (lb/size) 2=1371/0-3-8, (min. 0-1-13), 9=1371/0-3-8, (min. 0-1-14)
Max Horiz 2=-215 (LC 16)
Max Uplift 2=-587 (LC 11), 9=-587 (LC 12)
Max Grav 2=1561 (LC 2), 9=1564 (LC 2)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-23=-2888/1019, 3-23=-2860/1030, 3-4=-2740/960, 4-5=-2028/825, 5-24=-1781/799, 6-24=-1781/799, 6-7=-2034/825, 7-8=-2746/961, 8-25=-2866/1031, 9-25=-2895/1019
BOT CHORD 2-16=-1014/2564, 16-26=-740/2164, 15-26=-740/2164, 15-27=-740/2164, 14-27=-740/2164, 14-28=-390/1786, 13-28=-390/1786, 13-29=-610/2169, 12-29=-610/2169, 12-30=-610/2169, 11-30=-610/2169, 9-11=-800/2569
WEBS 3-16=-264/312, 4-16=-139/569, 4-14=-572/416, 5-14=-168/675, 6-13=-217/691, 7-13=-573/416, 7-11=-140/569, 8-11=-264/313

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 28-3-13 to 41-0-13 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 587 lb uplift at joint 2 and 587 lb uplift at joint 9.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	H03	Hip	2	1	Job Reference (optional)

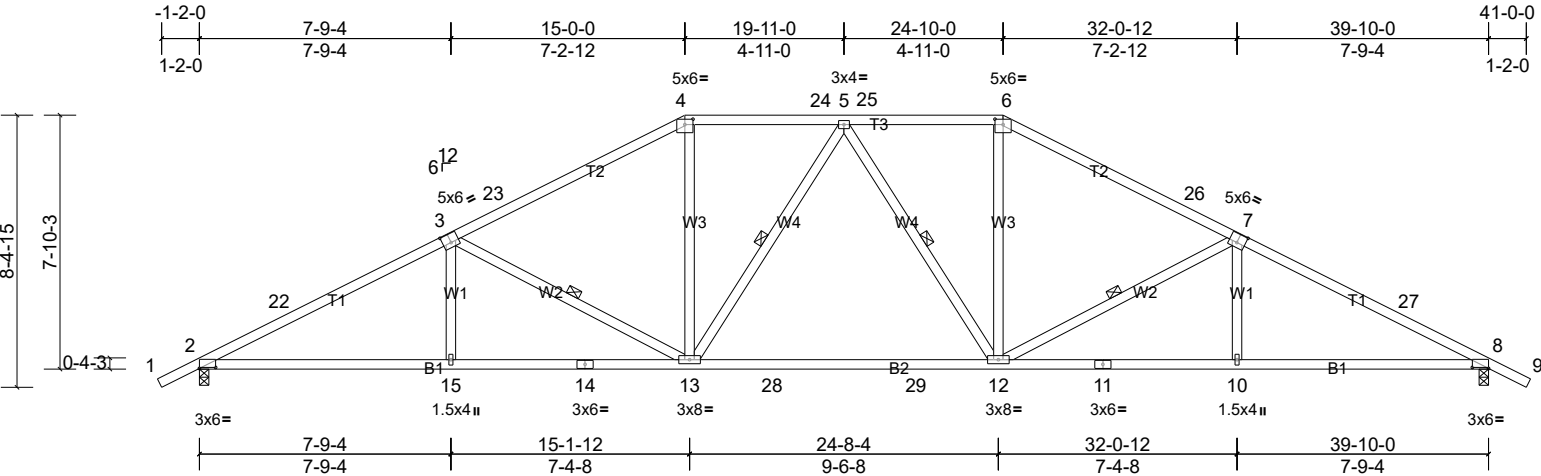

Scale = 1:71.2

Plate Offsets (X, Y): [2:0-6-0,0-0-6], [3:0-3-0,0-3-4], [4:0-3-0,0-2-0], [6:0-3-0,0-2-0], [7:0-3-0,0-3-4], [8:0-6-0,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.52	Vert(LL)	-0.36	12-13	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.85	Vert(CT)	-0.62	12-13	>766	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.13	8	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 210 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2 *Except* B2:2x4 SP No.1D	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SP No.2	WEBS	1 Row at midpt 3-13, 5-13, 5-12, 7-12


REACTIONS (lb/size) 2=1371/0-3-8, (min. 0-1-13), 8=1371/0-3-8, (min. 0-1-13)
Max Horiz 2=-191 (LC 12)
Max Uplift 2=-592 (LC 11), 8=-592 (LC 12)
Max Grav 2=1534 (LC 2), 8=1534 (LC 2)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-22=-2793/979, 3-22=-2759/998, 3-23=-2198/806, 4-23=-2128/831, 4-24=-1916/819, 5-24=-1916/819, 5-25=-1916/819, 6-25=-1916/819, 6-26=-2128/831, 7-26=-2198/806, 7-27=-2759/999, 8-27=-2793/980
BOT CHORD 2-15=-942/2468, 14-15=-941/2471, 13-14=-941/2471, 13-28=-510/1971, 28-29=-510/1971, 12-29=-510/1971, 11-12=-758/2471, 10-11=-758/2471, 8-10=-760/2468
WEBS 3-15=0/279, 3-13=-648/461, 4-13=-163/733, 6-12=-162/733, 7-12=-648/462, 7-10=0/279

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 30-5-10 to 41-0-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00" tall by 2'-00"-00" wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 592 lb uplift at joint 2 and 592 lb uplift at joint 8.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	H04	Hip	2	1	Job Reference (optional)

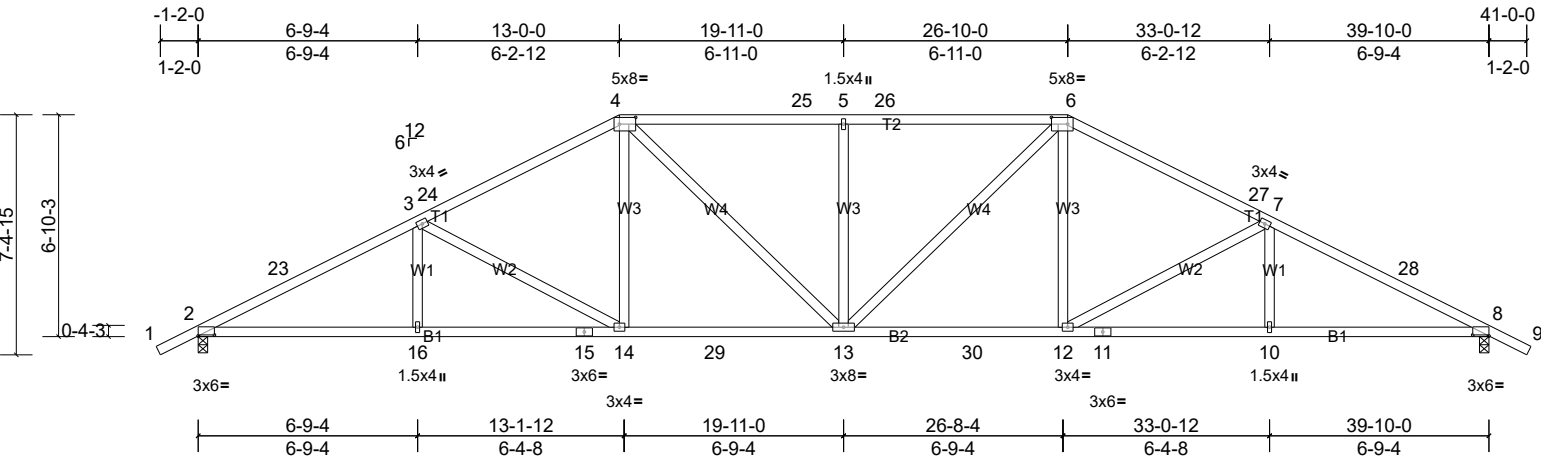

Scale = 1:71.1

Plate Offsets (X, Y): [2:0-6-0,0-0-6], [4:0-6-0,0-2-8], [6:0-6-0,0-2-8], [8:0-6-0,0-0-6]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.42	Vert(LL)	-0.23	13-14	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.75	Vert(CT)	-0.42	13-14	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.51	Horz(CT)	0.15	8	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 212 lb	FT = 20%

- LUMBER**
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
- REACTIONS** (lb/size) 2=1371/0-3-8, (min. 0-1-13), 8=1371/0-3-8, (min. 0-1-13)
Max Horiz 2=-168 (LC 12)
Max Uplift 2=-596 (LC 11), 8=-596 (LC 12)
Max Grav 2=1543 (LC 2), 8=1543 (LC 2)
- FORCES** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-23=-2864/1006, 3-23=-2831/1021, 3-24=-2348/844, 4-24=-2338/868, 4-25=-2346/935, 5-25=-2346/935, 5-26=-2346/935, 6-26=-2346/935, 6-27=-2338/868, 7-27=-2348/844, 7-28=-2831/1022, 8-28=-2864/1007
BOT CHORD 2-16=-950/2532, 15-16=-950/2532, 14-15=-950/2532, 14-29=-620/2060, 13-29=-620/2060, 13-30=-517/2060, 12-30=-517/2060, 11-12=-783/2532, 10-11=-783/2532, 8-10=-783/2532
WEBS 3-16=0/259, 3-14=-564/377, 4-14=-97/530, 4-13=-268/474, 5-13=-352/358, 6-13=-268/474, 6-12=-98/530, 7-12=-564/378, 7-10=0/259
- NOTES**
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 32-5-10 to 41-0-13 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) Provide adequate drainage to prevent water ponding.
4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 596 lb uplift at joint 2 and 596 lb uplift at joint 8.
6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- LOAD CASE(S)** Standard


Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	H05	Hip	2	1	Job Reference (optional)

Maronda Homes, Sanford, Edwin Rios

Run: 8.72 S Nov 2 2023 Print: 8.720 S Nov 2 2023 MiTek Industries, Inc. Wed Nov 15 16:10:01

Page: 1

ID:eEM3WKUGp3FRmcVDWFnEhnyow1C-knlSLVT4R_RiZ5aqVw6YoWxDVCg?cHbQ3QREooylv?M

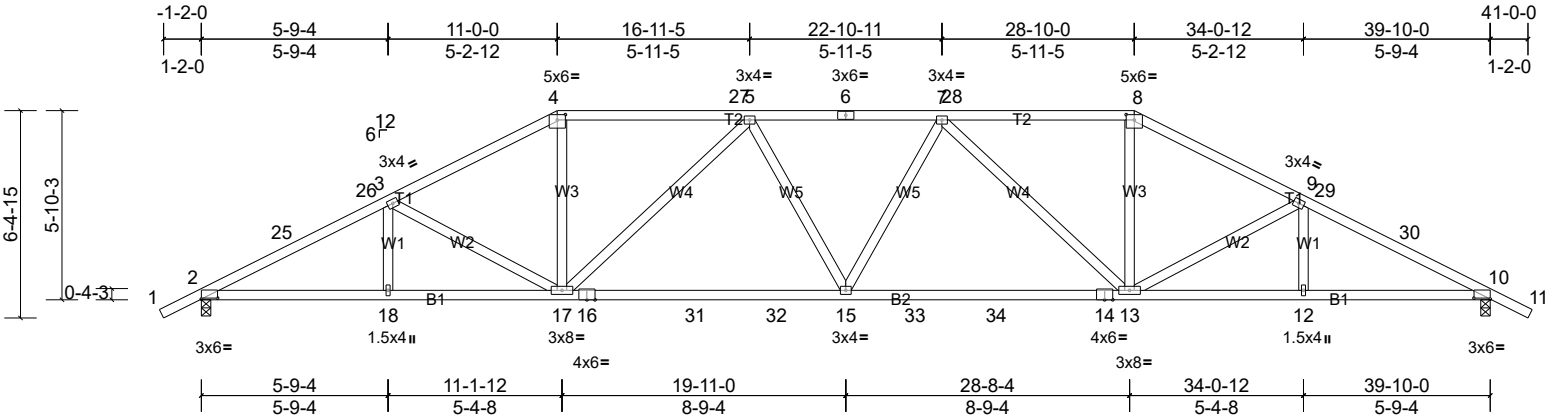

Scale = 1:71.2

Plate Offsets (X, Y): [2:0-6-0,0-0-6], [4:0-3-0,0-2-0], [8:0-3-0,0-2-0], [10:0-6-0,0-0-6]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.34	Vert(LL)	-0.29	15-17	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.83	Vert(CT)	-0.54	15-17	>887	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.76	Horz(CT)	0.15	10	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 208 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except* B2:2x4 SP No.1D
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (lb/size) 2=1371/0-3-8, (min. 0-1-13), 10=1371/0-3-8, (min. 0-1-13)

Max Horiz 2=144 (LC 11)
Max Uplift 2=-600 (LC 11), 10=-600 (LC 12)
Max Grav 2=1538 (LC 2), 10=1538 (LC 2)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-25=-2892/1038, 25-26=-2862/1048, 3-26=-2812/1050, 3-4=-2495/911, 4-27=-2212/877, 5-27=-2212/877, 5-6=-2756/992, 6-7=-2756/992, 7-28=-2212/877, 8-28=-2212/877, 8-9=-2495/911, 9-29=-2812/1051, 29-30=-2862/1049, 10-30=-2892/1039
BOT CHORD 2-18=-965/2560, 17-18=-965/2560, 16-17=-867/2653, 16-31=-867/2653, 31-32=-867/2653, 15-32=-867/2653, 15-33=-833/2653, 33-34=-833/2653, 14-34=-833/2653, 13-14=-833/2653, 12-13=-822/2560, 10-12=-822/2560
WEBS 3-17=-441/315, 4-17=-190/895, 5-17=-669/381, 5-15=-69/318, 7-15=-69/318, 7-13=-669/381, 8-13=-190/895, 9-13=-442/316

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 34-5-10 to 41-0-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 600 lb uplift at joint 2 and 600 lb uplift at joint 10.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Maronda Homes, Sanford, Edwin Rios Run: 8.72 S Nov 2 2023 Print: 8.720 S Nov 2 2023 MiTek Industries, Inc. Wed Nov 15 16:10:01 Page: 1
ID:D7d4lh13XhahqxA5zrcZhzyow1n-knlsLVT4R RiZ5aqVw6YoWxADCiBclgQ3OREooylv?M




LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SP No.2	WEBS	1 Row at midpt 5-14
REACTIONS (lb/size) 2=1371/0-3-8, (min. 0-1-10), 10=1371/0-3-8, (min. 0-1-10)			
	Max Horiz 2=-121 (LC 12)		
	Max Uplift 2=-603 (LC 11), 10=-603 (LC 12)		
FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.			
TOP CHORD	2-24=-2543/1086, 24-25=-2506/1093, 3-25=-2493/1100, 3-4=-2330/965, 4-26=-2832/1274, 5-26=-2832/1274, 5-6=-2832/1274, 6-7=-2832/1274, 7-27=-2832/1274, 8-27=-2832/1274, 8-9=-2330/965, 9-28=-2493/1100, 28-29=-2506/1093, 10-29=-2543/1087		
BOT CHORD	2-17=-995/2253, 16-17=-790/2054, 15-16=-790/2054, 14-15=-1180/2832, 13-14=-719/2054, 12-13=-719/2054, 10-12=-875/2253		
WEBS	3-17=-235/257, 4-17=-22/278, 4-15=-548/982, 5-15=-381/372, 7-14=-350/350, 8-14=-547/982, 8-12=-23/278, 9-12=-235/258		

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 36-5-10 to 41-0-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 603 lb uplift at joint 2 and 603 lb uplift at joint 10.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	H08	Hip	1	1	Job Reference (optional)

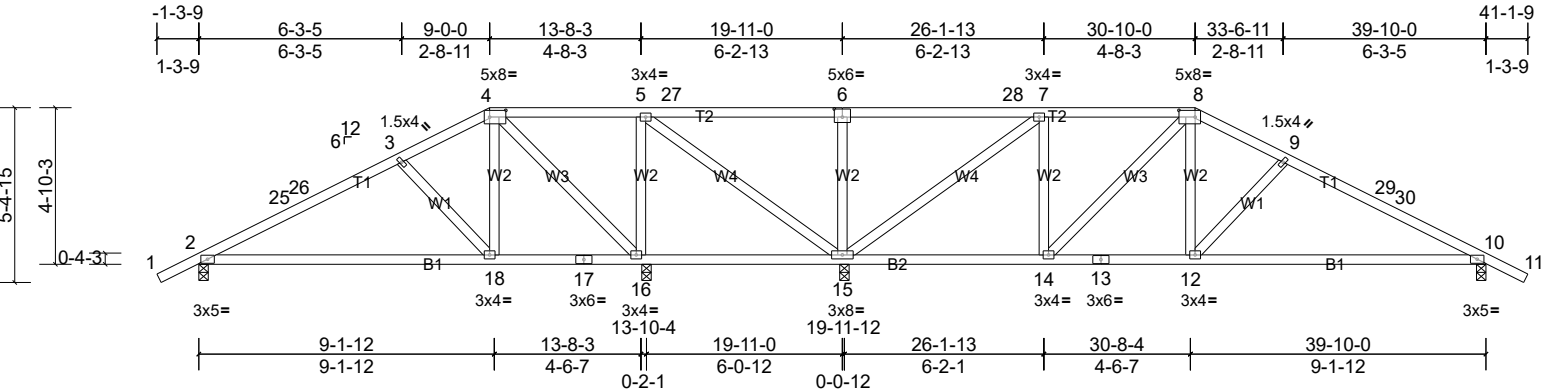

Scale = 1:71.3

Plate Offsets (X, Y): [4:0-6-0,0-2-8], [6:0-3-0,0-3-0], [8:0-6-0,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.35	Vert(LL)	0.10	12-24	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.47	Vert(CT)	-0.21	12-24	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.92	Horz(CT)	0.02	10	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 209 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS All bearings 0-3-8.

(lb) - Max Horiz 2=121 (LC 15)
Max Uplift All uplift 100 (lb) or less at joint(s) except 2=-230 (LC 11),
10=-336 (LC 12), 15=-540 (LC 7), 16=-373 (LC 11)
Max Grav All reactions 250 (lb) or less at joint(s) except 2=425 (LC 24),
10=621 (LC 25), 15=1102 (LC 25), 16=660 (LC 24)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-25=-407/221, 25-26=-373/223, 3-26=-360/233, 5-27=-87/386, 6-27=-87/386, 6-28=-87/386, 7-28=-87/386,
7-8=-361/308, 8-9=-656/399, 9-29=-790/468, 29-30=-802/458, 10-30=-836/456
BOT CHORD 2-18=-202/339, 15-16=-251/230, 14-15=-74/361, 13-14=-105/552, 12-13=-105/552, 10-12=-291/721
WEBS 3-18=-267/278, 4-18=-129/359, 8-12=-128/356, 9-12=-262/276, 6-15=-298/298, 5-16=-205/256, 7-14=-14/265,
7-15=-905/489, 4-16=-555/249, 8-14=-274/103

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 36-5-10 to 41-0-13 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 229 lb uplift at joint 2, 539 lb uplift at joint 15, 373 lb uplift at joint 16 and 336 lb uplift at joint 10.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	H14	Hip	1	1	Job Reference (optional)

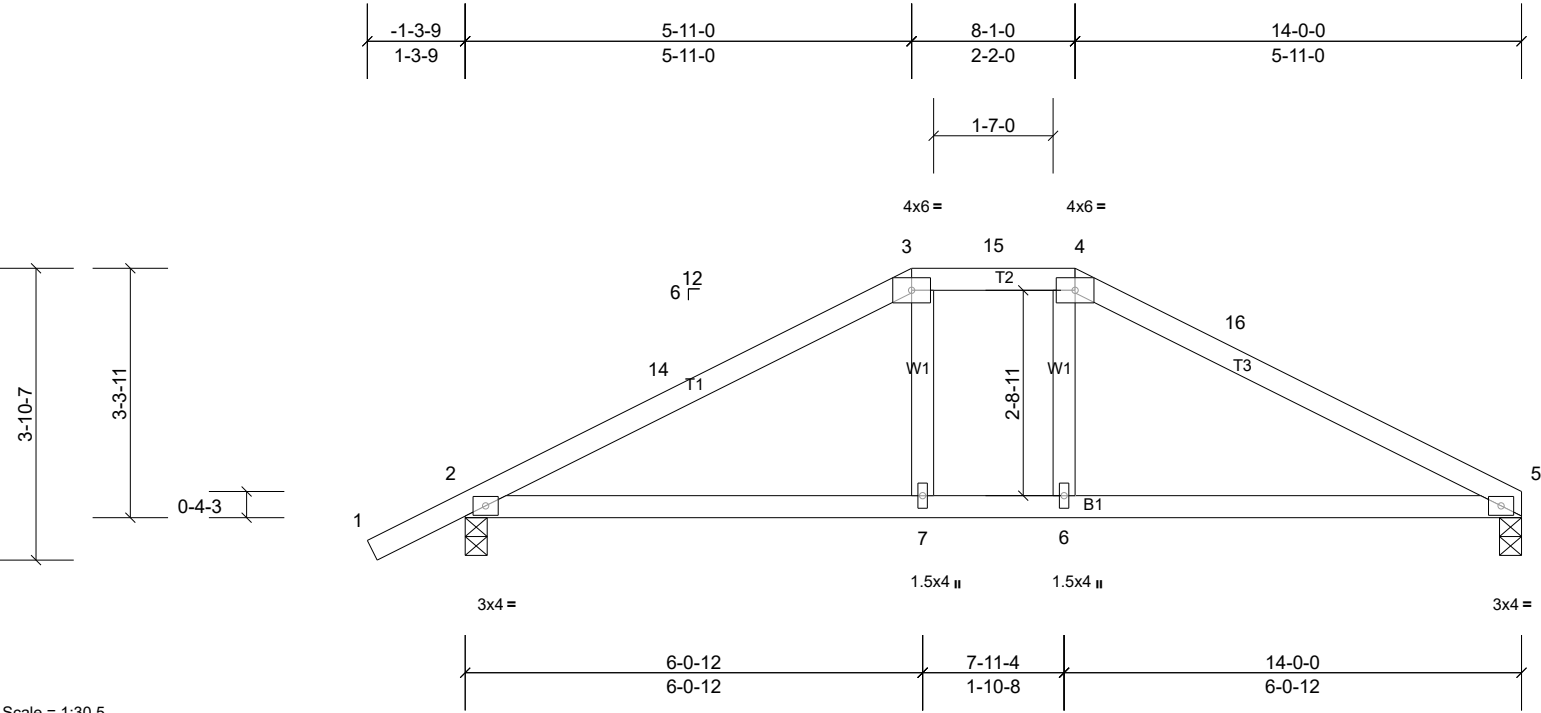

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.32	Vert(LL)	0.09	6-10	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.34	Vert(CT)	-0.11	6-10	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 54 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	

REACTIONS (lb/size) 2=521/0-3-8, (min. 0-1-8), 5=460/0-3-8, (min. 0-1-8)
Max Horiz 2=99 (LC 15)
Max Uplift 2=-239 (LC 11), 5=-188 (LC 12)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-14=-671/364, 3-14=-632/376, 3-15=-569/406, 4-15=-569/406, 4-16=-610/384, 5-16=-670/374
BOT CHORD 2-7=-242/564, 6-7=-240/569, 5-6=-241/564

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 8-1-0 to 14-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 188 lb uplift at joint 5 and 239 lb uplift at joint 2.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard


Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	HGR07	Hip Girder	1	1	Job Reference (optional)

Maronda Homes, Sanford, Edwin Rios

Run: 8.72 S Nov 2 2023 Print: 8.720 S Nov 2 2023 MiTek Industries, Inc. Wed Nov 15 16:10:01

Page: 1

ID:qvZluGpeHeuxwZUfh8uoA3ymLnl-knlsLVT4R_RiZ5aqVw6YoWx69CgScGRQ3OREooylv?M

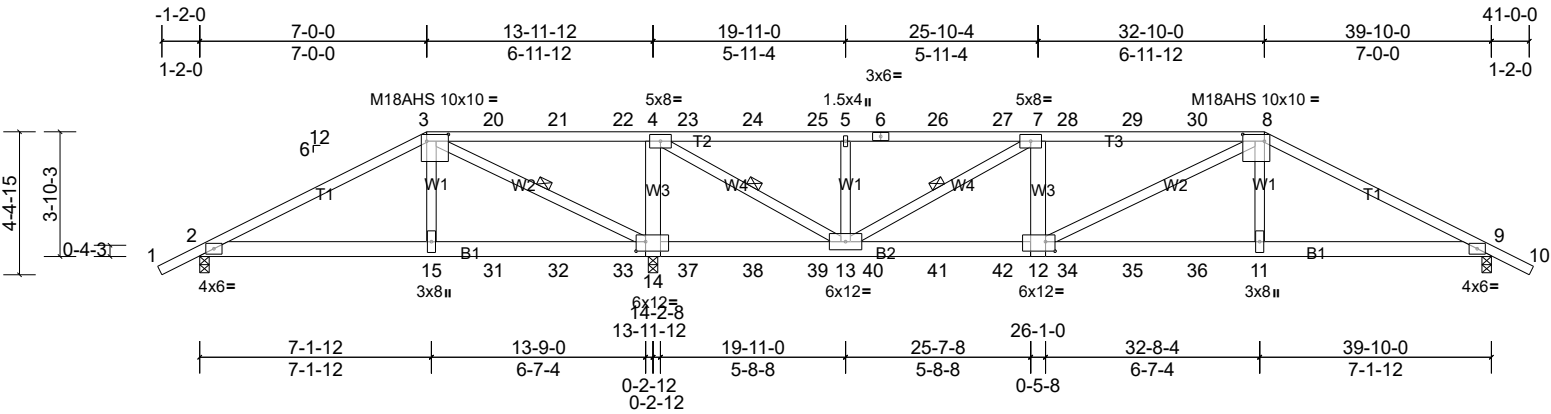

Scale = 1:71.1

Plate Offsets (X, Y): [3:0-8-0,0-2-8], [8:0-8-0,0-2-8], [12:0-3-8,0-3-8], [14:0-3-8,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.81	Vert(LL)	0.26	11-12	>999	240	M18AHS 186/179
TCDL	7.0	Lumber DOL	1.25	BC	0.80	Vert(CT)	-0.29	11-12	>999	180	MT20 244/190
BCLL	0.0*	Rep Stress Incr	NO	WB	0.77	Horz(CT)	0.05	9	n/a	n/a	
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MS							Weight: 228 lb FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2 *Except* T2,T3:2x4 SP No.1D
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2 *Except* W3:2x6 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-6-14 oc purlins.
BOT CHORD Rigid ceiling directly applied or 5-3-6 oc bracing.
WEBS 1 Row at midpt 3-14, 7-13, 4-13

REACTIONS (lb/size) 2=363/0-3-8, (min. 0-1-8), 9=1480/0-3-8, (min. 0-1-12),
14=3745/0-3-8, (min. 0-1-8)
Max Horiz 2=-97 (LC 8)
Max Uplift 2=-348 (LC 7), 9=-930 (LC 8), 14=-2758 (LC 4)
Max Grav 2=372 (LC 20), 9=1483 (LC 21), 14=3745 (LC 1)

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-350/511, 3-20=-1143/1811, 20-21=-1143/1811, 21-22=-1143/1811, 4-22=-1143/1811, 4-23=-1151/782,
23-24=-1151/782, 24-25=-1151/782, 5-25=-1151/782, 5-6=-1151/782, 6-26=-1151/782, 26-27=-1151/782, 7-27=-1151/782,
7-28=-2646/1817, 28-29=-2646/1817, 29-30=-2646/1817, 8-30=-2646/1817, 8-9=-2861/1799
BOT CHORD 2-15=-422/323, 15-31=-452/353, 31-32=-452/353, 32-33=-452/353, 14-33=-452/353, 12-34=-1474/2537,
34-35=-1474/2537, 35-36=-1474/2537, 11-36=-1474/2537, 9-11=-1459/2501, 14-37=-1811/1310, 37-38=-1811/1310,
38-39=-1811/1310, 13-39=-1811/1310, 13-40=-1625/2646, 40-41=-1625/2646, 41-42=-1625/2646, 12-42=-1625/2646
WEBS 3-15=-703/843, 8-11=-342/877, 3-14=-2327/1869, 8-12=-252/200, 4-14=-2137/1623, 7-12=-112/523, 7-13=-1735/1199,
5-13=-279/361, 4-13=-2176/3414

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 348 lb uplift at joint 2, 930 lb uplift at joint 9 and 2758 lb uplift at joint 14.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 60 lb down and 170 lb up at 7-0-0, 29 lb down and 88 lb up at 9-0-12, 29 lb down and 88 lb up at 11-0-12, 29 lb down and 88 lb up at 13-0-12, 29 lb down and 88 lb up at 15-0-12, 29 lb down and 88 lb up at 17-0-12, 29 lb down and 88 lb up at 19-0-12, 29 lb down and 88 lb up at 20-9-4, 29 lb down and 88 lb up at 22-9-4, 29 lb down and 88 lb up at 24-9-4, 29 lb down and 88 lb up at 26-9-4, 29 lb down and 88 lb up at 28-9-4, and 29 lb down and 88 lb up at 30-9-4, and 60 lb down and 173 lb up at 32-10-0 on top chord, and 458 lb down and 488 lb up at 7-0-0, 140 lb down and 128 lb up at 9-0-12, 140 lb down and 128 lb up at 11-0-12, 140 lb down and 128 lb up at 13-0-12, 140 lb down and 78 lb up at 15-0-12, 140 lb down and 78 lb up at 17-0-12, 140 lb down and 78 lb up at 19-0-12, 140 lb down and 78 lb up at 20-9-4, 140 lb down and 78 lb up at 22-9-4, 140 lb down and 78 lb up at 24-9-4, 140 lb down and 78 lb up at 26-9-4, 140 lb down and 78 lb up at 28-9-4, and 140 lb down and 78 lb up at 30-9-4, and 459 lb down and 261 lb up at 32-9-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)


Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	HGR07	Hip Girder	1	1	Job Reference (optional)

Vert: 1-3=-46, 3-8=-46, 8-10=-46, 2-12=-20, 9-12=-20

Concentrated Loads (lb)

Vert: 3=-18, 6=-18, 8=-18, 15=-458, 11=-459, 20=-18, 21=-18, 22=-18, 23=-18, 24=-18, 25=-18, 26=-18, 27=-18, 28=-18, 29=-18, 30=-18, 31=-140, 32=-140, 33=-140, 34=-140, 35=-140, 36=-140, 37=-140, 38=-140, 39=-140, 40=-140, 41=-140, 42=-140

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	HGR09	Hip Girder	1	1	Job Reference (optional)

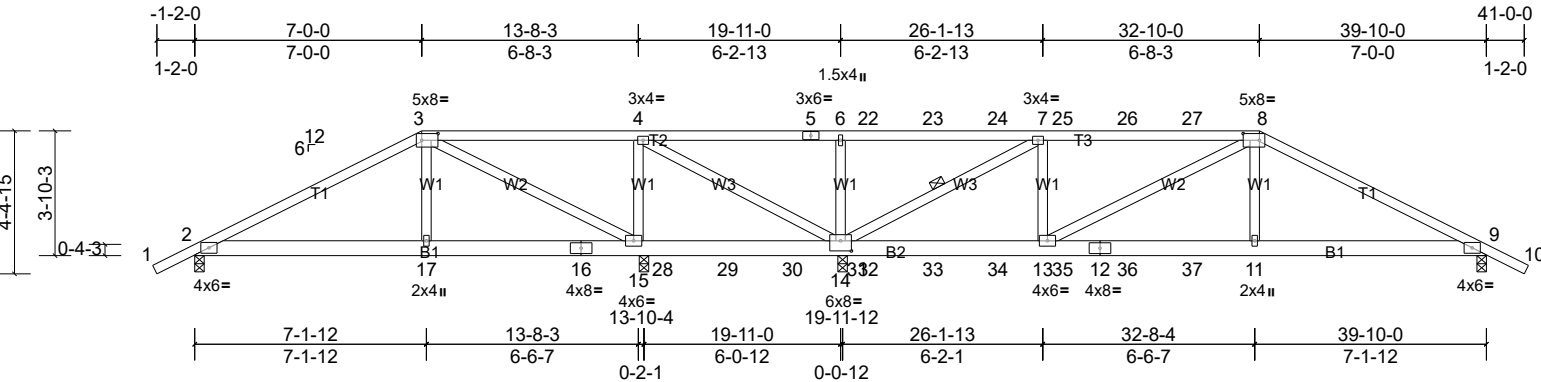

Scale = 1:71.1

Plate Offsets (X, Y): [3:0-6-0,0-2-8], [8:0-6-0,0-2-8], [14:0-4-0,0-3-12]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.67	Vert(LL)	0.13	11-13	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.78	Vert(CT)	-0.14	11-13	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.60	Horz(CT)	0.03	9	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MS							Weight: 223 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-10-5 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 7-14

REACTIONS All bearings 0-3-8.
(lb) - Max Horiz 2=-97 (LC 8)
Max Uplift All uplift 100 (lb) or less at joint(s) except 2=-274 (LC 26), 9=-646 (LC 8), 14=-1806 (LC 3), 15=-641 (LC 7)
Max Grav All reactions 250 (lb) or less at joint(s) except 2=399 (LC 20), 9=972 (LC 21), 14=2573 (LC 21), 15=1011 (LC 20)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-352/297, 3-4=-120/318, 4-5=-396/684, 5-6=-396/684, 6-22=-396/684, 22-23=-396/684, 23-24=-396/684, 7-24=-396/684, 7-25=-1208/911, 25-26=-1208/911, 26-27=-1208/911, 8-27=-1208/911, 8-9=-1701/1156
BOT CHORD 2-17=-212/273, 16-17=-212/279, 15-16=-212/279, 15-28=-318/294, 28-29=-318/294, 29-30=-318/294, 14-30=-318/294, 14-31=-739/1208, 31-32=-739/1208, 32-33=-739/1208, 33-34=-739/1208, 13-34=-739/1208, 13-35=-895/1487, 12-35=-895/1487, 12-36=-895/1487, 36-37=-895/1487, 11-37=-895/1487, 9-11=-884/1463
WEBS 8-11=-250/563, 6-14=-306/345, 4-15=-161/394, 7-13=-223/670, 4-14=-446/360, 7-14=-2157/1487, 3-15=-649/331, 8-13=-319/229

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 273 lb uplift at joint 2, 1806 lb uplift at joint 14, 640 lb uplift at joint 15 and 645 lb uplift at joint 9.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 29 lb down and 88 lb up at 20-9-4, 29 lb down and 88 lb up at 22-9-4, 29 lb down and 88 lb up at 24-9-4, 29 lb down and 88 lb up at 26-9-4, 29 lb down and 88 lb up at 28-9-4, and 29 lb down and 88 lb up at 30-9-4, and 33 lb down and 90 lb up at 32-10-0 on top chord, and 286 lb down and 236 lb up at 14-5-4, 286 lb down and 236 lb up at 16-5-4, 286 lb down and 236 lb up at 18-5-4, 182 lb down and 157 lb up at 20-5-4, 140 lb down and 78 lb up at 20-9-4, 140 lb down and 78 lb up at 22-9-4, 140 lb down and 78 lb up at 24-9-4, 140 lb down and 78 lb up at 26-9-4, 140 lb down and 78 lb up at 28-9-4, and 140 lb down and 78 lb up at 30-9-4, and 183 lb down and 171 lb up at 32-9-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.


LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-3=-46, 3-8=-46, 8-10=-46, 2-9=-20
Concentrated Loads (lb)


Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	HGR09	Hip Girder	1	1	Job Reference (optional)

Vert: 8=-18, 11=-183, 22=-18, 23=-18, 24=-18, 25=-18, 26=-18, 27=-18, 28=-286, 29=-286, 30=-286, 31=-182, 32=-140, 33=-140, 34=-140, 35=-140, 36=-140, 37=-140

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J16F	Jack-Open	4	1	Job Reference (optional)



6 12

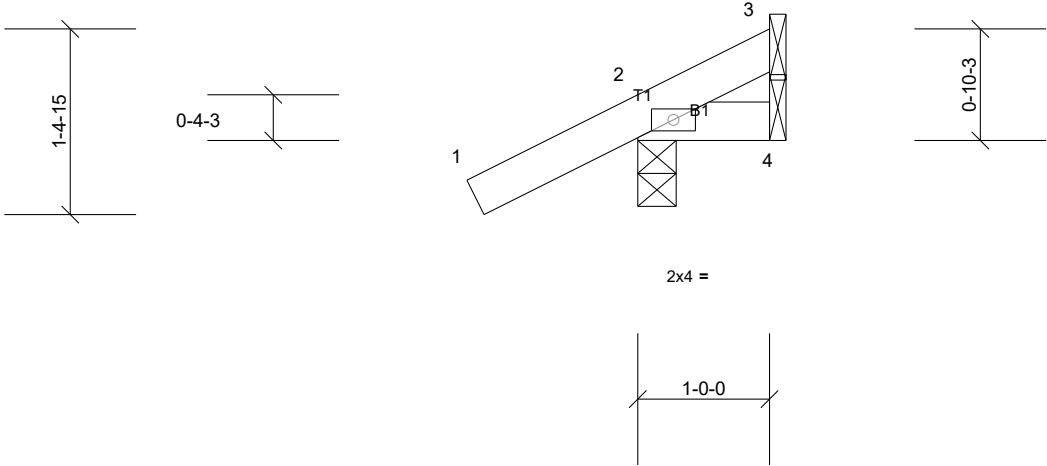

Scale = 1:17.5

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.18	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.03	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 5 lb	FT = 0%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size) 2=125/0-3-8, (min. 0-1-8), 3=3/ Mechanical, (min. 0-1-8), 4=-6/ Mechanical, (min. 0-1-8)
Max Horiz 2=56 (LC 11)
Max Uplift 2=-93 (LC 11), 3=-2 (LC 11), 4=-6 (LC 1)
Max Grav 2=125 (LC 1), 3=9 (LC 7), 4=20 (LC 15)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


NOTES
1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 2 lb uplift at joint 3, 93 lb uplift at joint 2 and 6 lb uplift at joint 4.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J16PF	Jack-Open	2	1	Job Reference (optional)

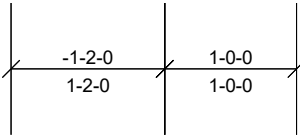

6 12

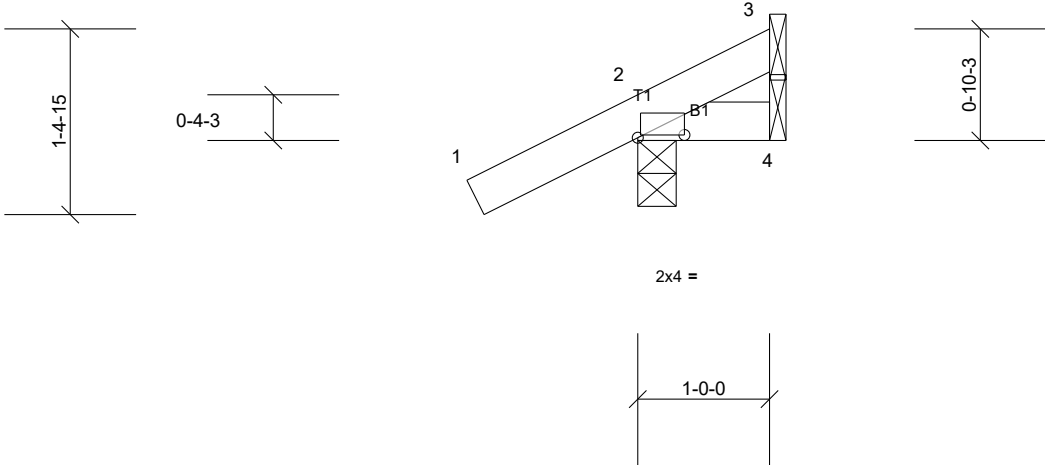

Scale = 1:17.5

Plate Offsets (X, Y): [2:0-4-4,0-0-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.18	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.03	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 5 lb	FT = 0%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=125/0-3-8, (min. 0-1-8), 3=3/ Mechanical, (min. 0-1-8), 4=-6/ Mechanical, (min. 0-1-8)
Max Horiz 2=56 (LC 11)
Max Uplift 2=-93 (LC 11), 3=-6 (LC 8), 4=-7 (LC 18)
Max Grav 2=125 (LC 1), 3=6 (LC 16), 4=20 (LC 15)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES
1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C zone; cantilever left exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 6 lb uplift at joint 3, 93 lb uplift at joint 2 and 7 lb uplift at joint 4.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J20	Monopitch	3	1	Job Reference (optional)

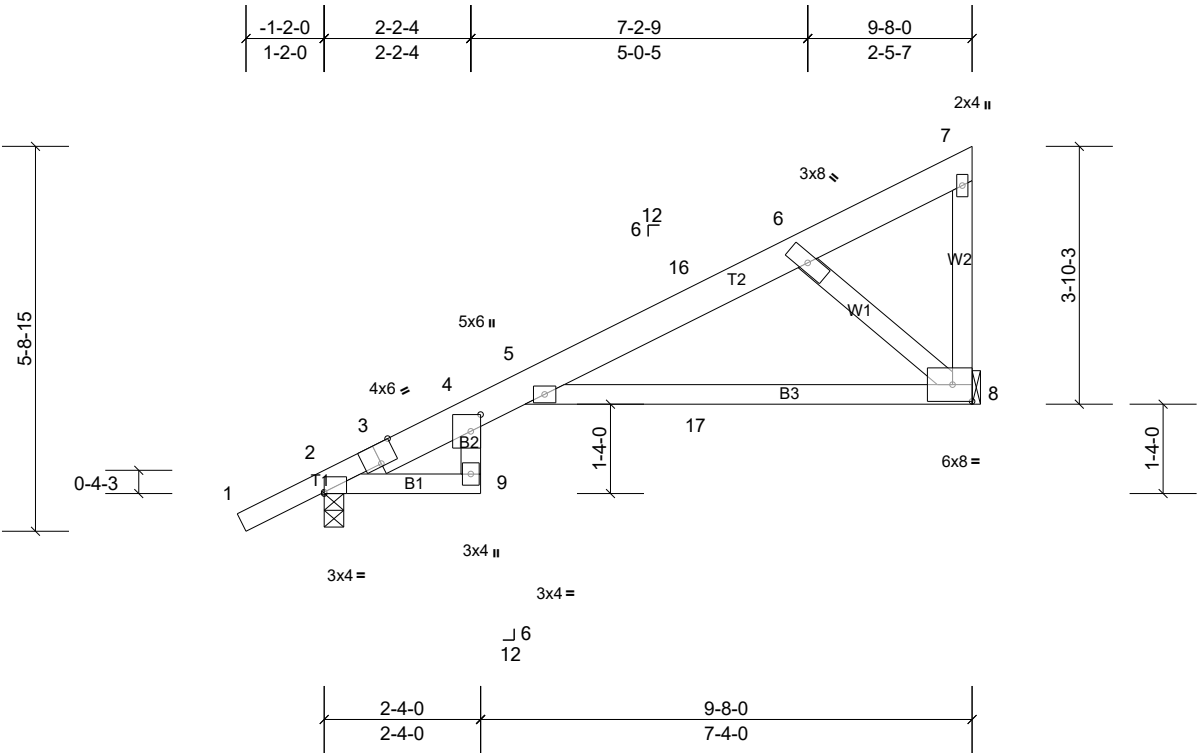


Plate Offsets (X, Y): [2:Edge,0-0-4], [3:0-3-0,Edge], [4:0-3-0,0-1-12]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.70	Vert(LL)	0.34	8-15	>340	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.67	Vert(CT)	0.29	8-15	>397	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.21	Horz(CT)	-0.14	8	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 50 lb	FT = 20%

LUMBER	BRACING
TOP CHORD 2x4 SP No.2 *Except* T2:2x6 SP No.1D	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SP No.2	


REACTIONS (lb/size) 2=363/0-3-8, (min. 0-1-8), 8=306/ Mechanical, (min. 0-1-8)
Max Horiz 2=283 (LC 11)
Max Uplift 2=-157 (LC 11), 8=-224 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-275/314, 3-4=-240/286, 5-16=-836/2066, 6-16=-280/571
BOT CHORD 2-9=-522/154, 5-17=-1483/578, 8-17=-967/340
WEBS 6-8=-425/1164

- NOTES**
- 1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 9-6-4 to 9-6-4 zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 157 lb uplift at joint 2 and 224 lb uplift at joint 8.
 - 5) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J36F	Jack-Open	4	1	Job Reference (optional)

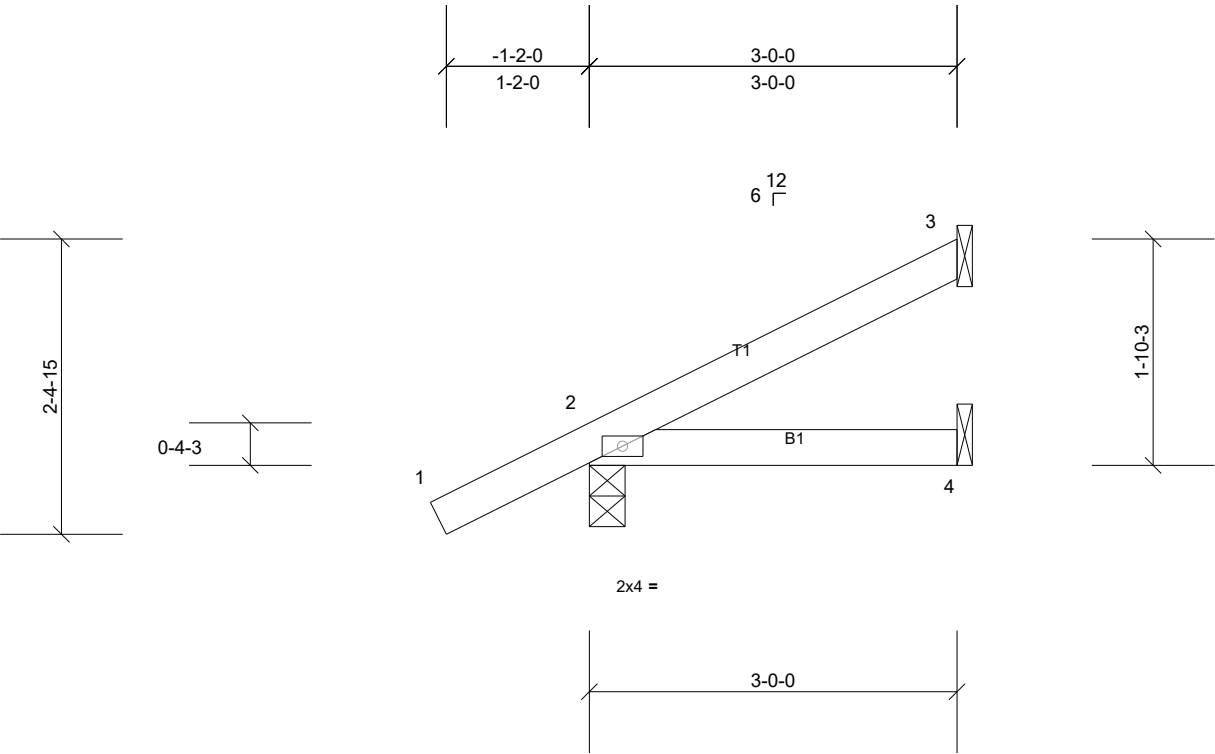

Scale = 1:18.8

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.18	Vert(LL)	0.00	4-7	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.08	Vert(CT)	-0.01	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	n/a	-	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 12 lb	FT = 0%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size) 2=165/0-3-8, (min. 0-1-8), 3=54/ Mechanical, (min. 0-1-8), 4=31/ Mechanical, (min. 0-1-8)
Max Horiz 2=109 (LC 11)
Max Uplift 2=-89 (LC 11), 3=-62 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES
1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 3 and 89 lb uplift at joint 2.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J36PF	Jack-Open	2	1	Job Reference (optional)

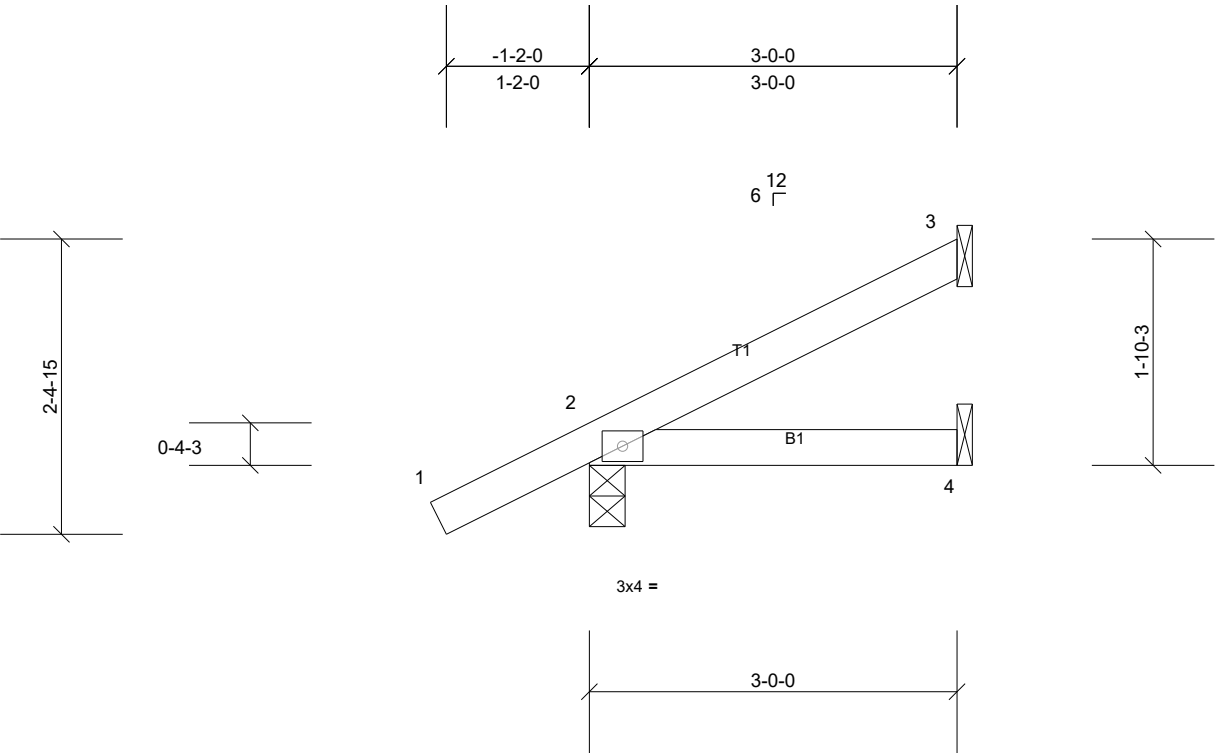

Scale = 1:18.8

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.18	Vert(LL)	0.02	4-7	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.19	Vert(CT)	0.01	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 12 lb	FT = 0%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size) 2=165/0-3-8, (min. 0-1-8), 3=54/ Mechanical, (min. 0-1-8), 4=31/ Mechanical, (min. 0-1-8)
Max Horiz 2=109 (LC 11)
Max Uplift 2=-89 (LC 11), 3=-62 (LC 11), 4=-24 (LC 8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES
1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C zone; cantilever left exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 3, 89 lb uplift at joint 2 and 24 lb uplift at joint 4.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J56F	Jack-Open	4	1	Job Reference (optional)

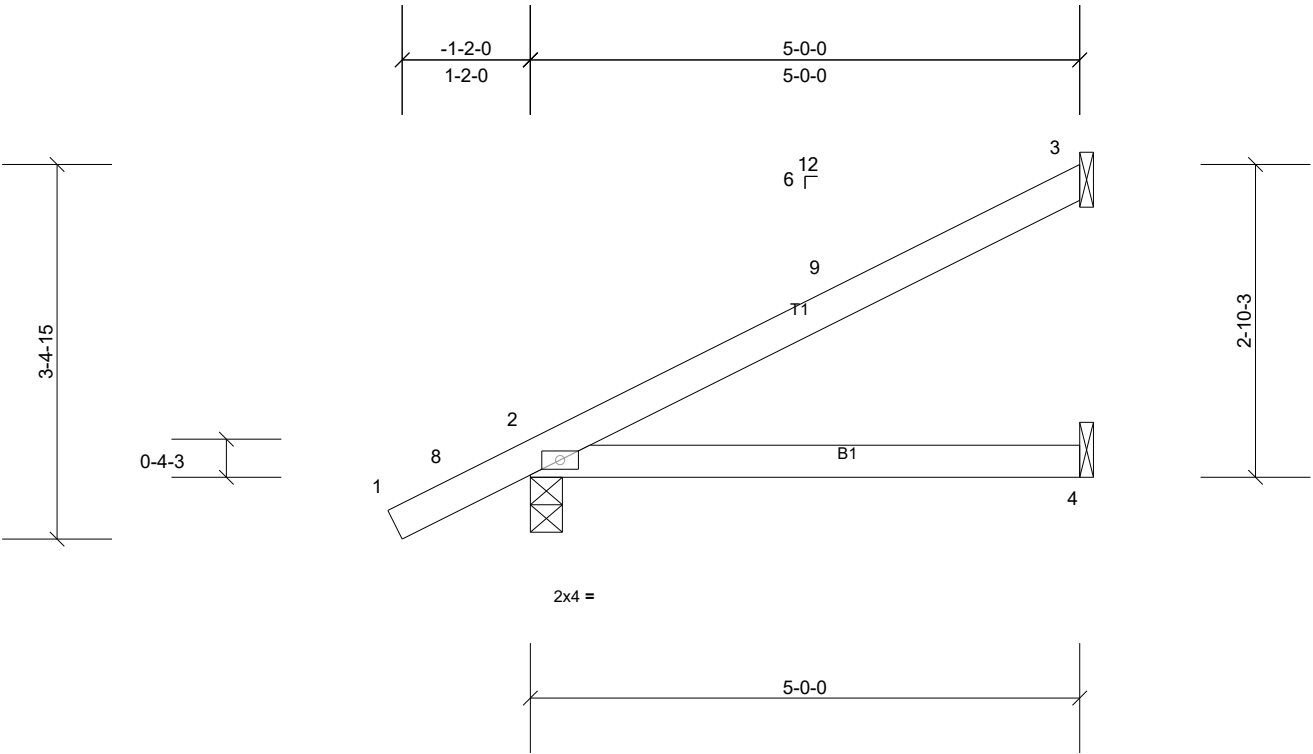

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.41	Vert(LL)	0.05	4-7	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.36	Vert(CT)	-0.06	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 18 lb	FT = 0%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 5'-0-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0" oc bracing.


REACTIONS (lb/size) 2=227/0-3-8, (min. 0-1-8), 3=98/ Mechanical, (min. 0-1-8), 4=58/ Mechanical, (min. 0-1-8)
Max Horiz 2=163 (LC 11)
Max Uplift 2=-104 (LC 11), 3=-115 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES
1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 2-9-0 to 4-11-4 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06-00 tall by 2'-00-00 wide will fit between the bottom chord and any other members.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 115 lb uplift at joint 3 and 104 lb uplift at joint 2.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J56PF	Jack-Open	2	1	Job Reference (optional)

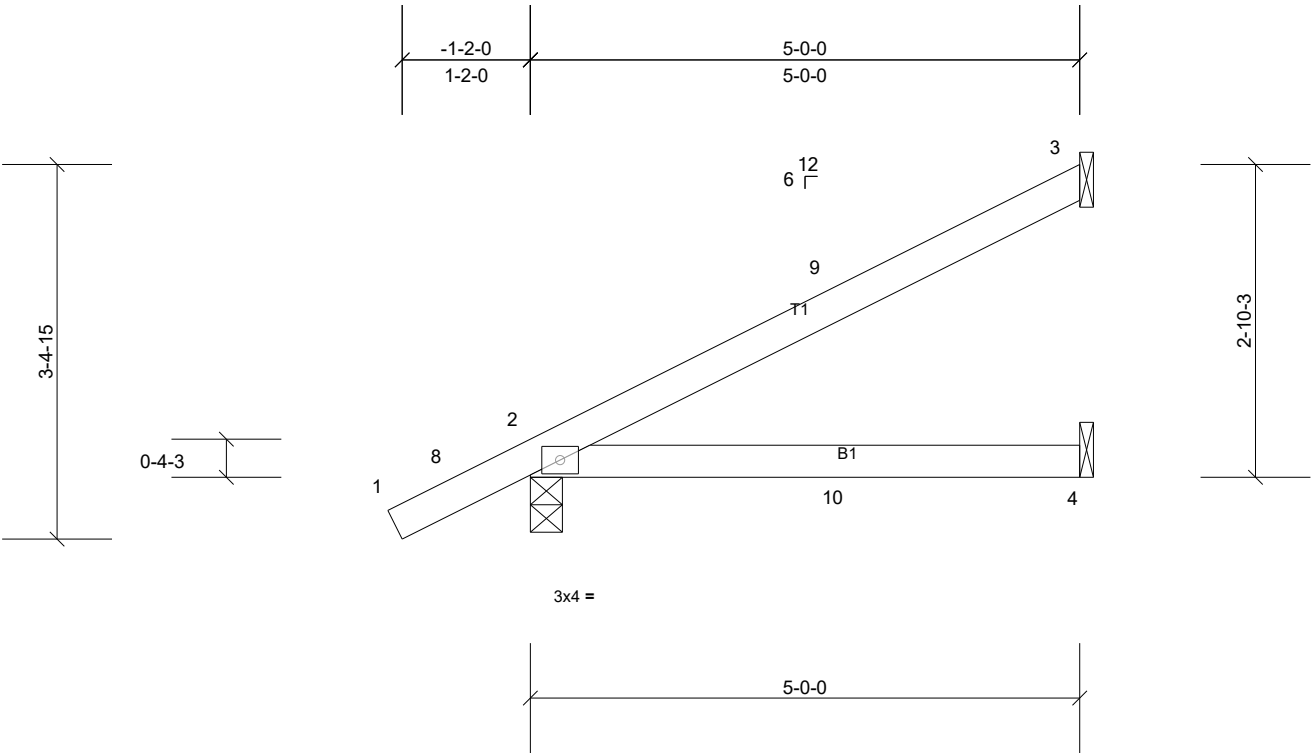

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.63	Vert(LL)	0.16	4-7	>380	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.67	Vert(CT)	0.14	4-7	>429	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 18 lb	FT = 0%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 5'-0-0" oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0" oc bracing.


REACTIONS (lb/size) 2=227/0-3-8, (min. 0-1-8), 3=98/ Mechanical, (min. 0-1-8), 4=58/ Mechanical, (min. 0-1-8)
Max Horiz 2=163 (LC 11)
Max Uplift 2=-104 (LC 11), 3=-115 (LC 11), 4=-42 (LC 8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES
1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 2-9-0 to 4-11-4 zone; cantilever left exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06-00 tall by 2'-00-00 wide will fit between the bottom chord and any other members.
3) Refer to girder(s) for truss to truss connections.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 115 lb uplift at joint 3, 104 lb uplift at joint 2 and 42 lb uplift at joint 4.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J76F	Jack-Open	17	1	Job Reference (optional)

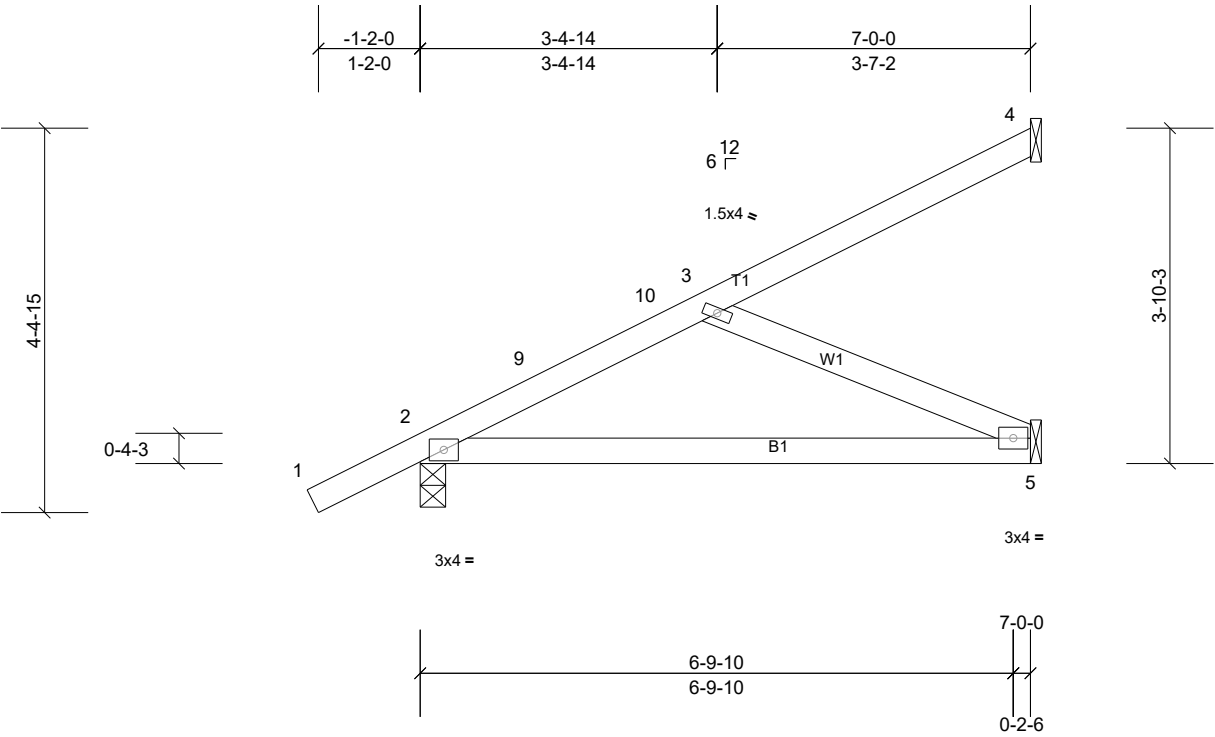

Scale = 1:26.4

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.25	Vert(LL)	-0.01	5-8	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.30	Vert(CT)	-0.08	5-8	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horz(CT)	0.00	5	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 30 lb	FT = 0%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 9-4-12 oc bracing.
WEBS	2x4 SP No.2		


REACTIONS (lb/size) 2=292/0-3-8, (min. 0-1-8), 4=64/ Mechanical, (min. 0-1-8), 5=160/ Mechanical, (min. 0-1-8)
Max Horiz 2=218 (LC 11)
Max Uplift 2=-123 (LC 11), 4=-94 (LC 11), 5=-66 (LC 11)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-9=-269/176, 9-10=-255/183
BOT CHORD 2-5=-383/305
WEBS 3-5=-333/418

- NOTES**
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 2-9-0 to 6-11-4 zone; cantilever left exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 4, 123 lb uplift at joint 2 and 66 lb uplift at joint 5.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	J76PF	Jack-Open	4	1	Job Reference (optional)

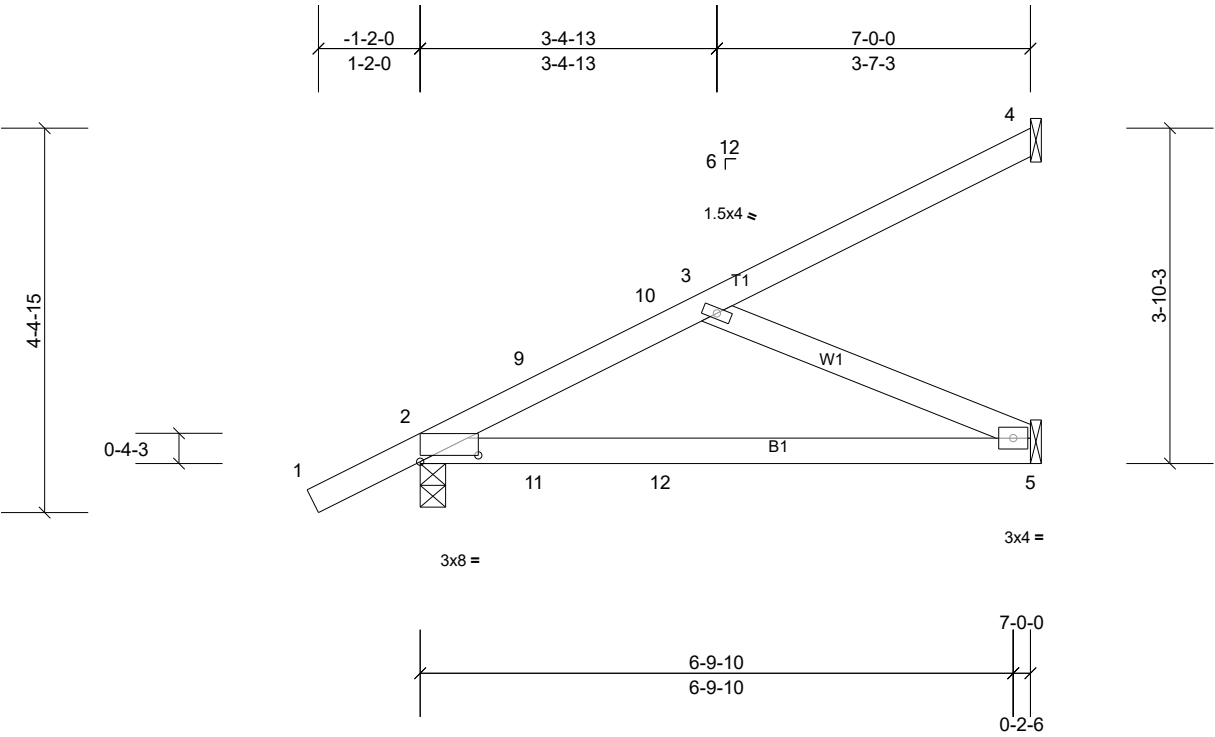

Scale = 1:26.4

Plate Offsets (X, Y): [2:0-8-0,0-0-14]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.73	Vert(LL)	0.29	5-8	>292	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.86	Vert(CT)	0.25	5-8	>341	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horz(CT)	-0.01	5	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MP							Weight: 30 lb	FT = 0%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 2-11-3 oc bracing.
WEBS	2x4 SP No.2		

REACTIONS (lb/size) 2=292/0-3-8, (min. 0-1-8), 4=64/ Mechanical, (min. 0-1-8), 5=160/ Mechanical, (min. 0-1-8)
Max Horiz 2=218 (LC 11)
Max Uplift 2=-130 (LC 8), 4=-94 (LC 11), 5=-116 (LC 8)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-9=-269/402, 9-10=-256/403, 3-10=-222/411
BOT CHORD 2-11=-682/267, 11-12=-682/267, 5-12=-682/267
WEBS 3-5=-291/744

- NOTES**
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 2-9-0 to 6-11-4 zone; cantilever left exposed ; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 4, 130 lb uplift at joint 2 and 116 lb uplift at joint 5.

LOAD CASE(S) Standard


Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	JGR76F	Diagonal Hip Girder	2	1	Job Reference (optional)

Maronda Homes, Sanford, Edwin Rios

Run: 8.72 S Nov 2 2023 Print: 8.720 S Nov 2 2023 MiTek Industries, Inc. Wed Nov 15 16:10:01

Page: 1

ID:kzFhDxYHshtFX3rmsR2UE7ymLrz-CzJEZrTjCiZZBF913denKkTPjc8CLsaZI2AnKFyIv?L

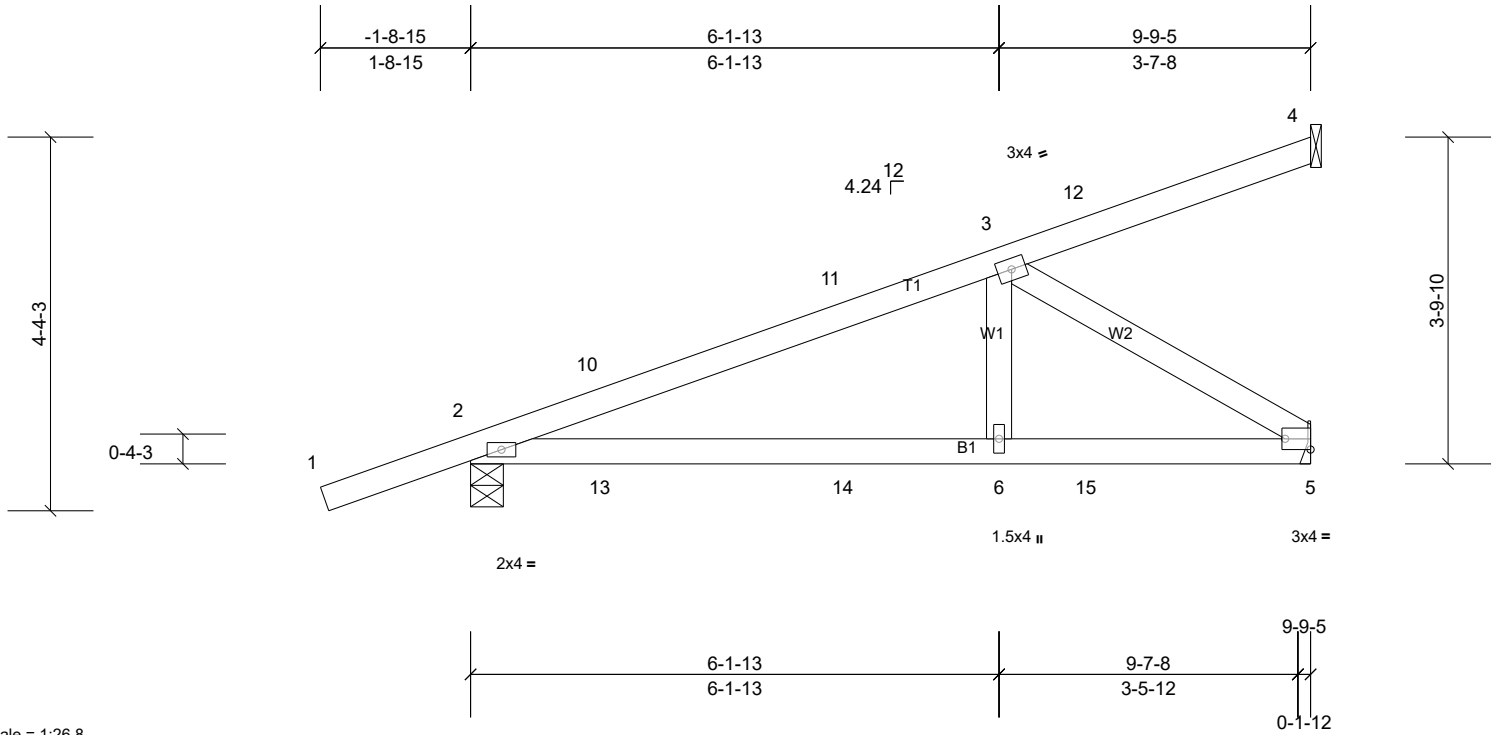

Scale = 1:26.8

Plate Offsets (X, Y): [5:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.31	Vert(LL)	0.04	6-9	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.32	Vert(CT)	-0.06	6-9	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.20	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-MS							Weight: 42 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (lb/size) 2=446/0-4-9, (min. 0-1-8), 4=62/ Mechanical, (min. 0-1-8),
5=347/ Mechanical, (min. 0-1-8)
Max Horiz 2=231 (LC 24)
Max Uplift 2=-265 (LC 3), 4=-82 (LC 3), 5=-167 (LC 7)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-10=-577/207, 10-11=-551/215, 3-11=-511/201
BOT CHORD 2-13=-308/520, 13-14=-308/520, 6-14=-308/520, 6-15=-308/520, 5-15=-308/520
WEBS 3-5=-610/361


NOTES

- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 82 lb uplift at joint 4, 265 lb uplift at joint 2 and 167 lb uplift at joint 5.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 91 lb down and 5 lb up at 1-6-1, 91 lb down and 5 lb up at 1-6-1, 31 lb down and 66 lb up at 4-4-0, 31 lb down and 66 lb up at 4-4-0, and 55 lb down and 110 lb up at 7-1-15, and 55 lb down and 110 lb up at 7-1-15 on top chord, and 18 lb down and 9 lb up at 1-6-1, 18 lb down and 9 lb up at 1-6-1, 15 lb down at 4-4-0, 15 lb down at 4-4-0, and 33 lb down at 7-1-15, and 33 lb down at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S)

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-4=-46, 5-7=-20
Concentrated Loads (lb)
Vert: 11=0, 12=-67, 14=-10, 15=-58

Maronda Homes, Sanford, Edwin Rios Run: 8.72 S Nov 2 2023 Print: 8.720 S Nov 2 2023 MiTek Industries, Inc. Wed Nov 15 16:10:01 Page: 1
ID:Ymzpewb|TPwTzwLk7yXTymLtC-CzJEZrT|C|ZZBF913denKkTO6c8CLsaZl2AnKFyIv/L




LUMBER		BRACING
TOP CHORD	2x4 SP No.2	TOP CHORD
BOT CHORD	2x4 SP No.2	Structural wood sheathing directly applied or 6-0-0 oc purlins.
WEBS	2x4 SP No.2	BOT CHORD
		Rigid ceiling directly applied or 7-10-9 oc bracing.
REACTIONS		
(lb/size)	2=446/0-4-9, (min. 0-1-8), 4=62/ Mechanical, (min. 0-1-8), 5=347/ Mechanical, (min. 0-1-8)	
Max Horiz	2=231 (LC 3)	
Max Uplift	2=-423 (LC 3), 4=-79 (LC 7), 5=-344 (LC 3)	
FORCES		
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-10=-578/439, 10-11=-552/444, 3-11=-511/439	
BOT CHORD	2-13=-529/520, 13-14=-529/520, 6-14=-529/520, 6-15=-529/520, 5-15=-529/520	
WEBS	3-5=-610/621	

- ### NOTES
- 1) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone; cantilever left and right exposed ; end vertical left and right exposed; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 79 lb uplift at joint 4, 423 lb uplift at joint 2 and 344 lb uplift at joint 5.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 87 lb down and 8 lb up at 1-6-1, 87 lb down and 8 lb up at 1-6-1, 31 lb down and 66 lb up at 4-4-0, 31 lb down and 66 lb up at 4-4-0, and 55 lb down and 110 lb up at 7-1-15, and 55 lb down and 110 lb up at 7-1-15 on top chord, and 53 lb down and 9 lb up at 1-6-1, 53 lb down and 9 lb up at 1-6-1, 12 lb down and 40 lb up at 4-4-0, 12 lb down and 40 lb up at 4-4-0, and 34 lb down and 59 lb up at 7-1-15, and 34 lb down and 59 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-4=-46, 5-7=-20
Concentrated Loads (lb)
Vert: 11=0, 12=-67, 14=-10, 15=-58

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	LT01	Lay-In Gable	1	1	gable bracing only
					Job Reference (optional)

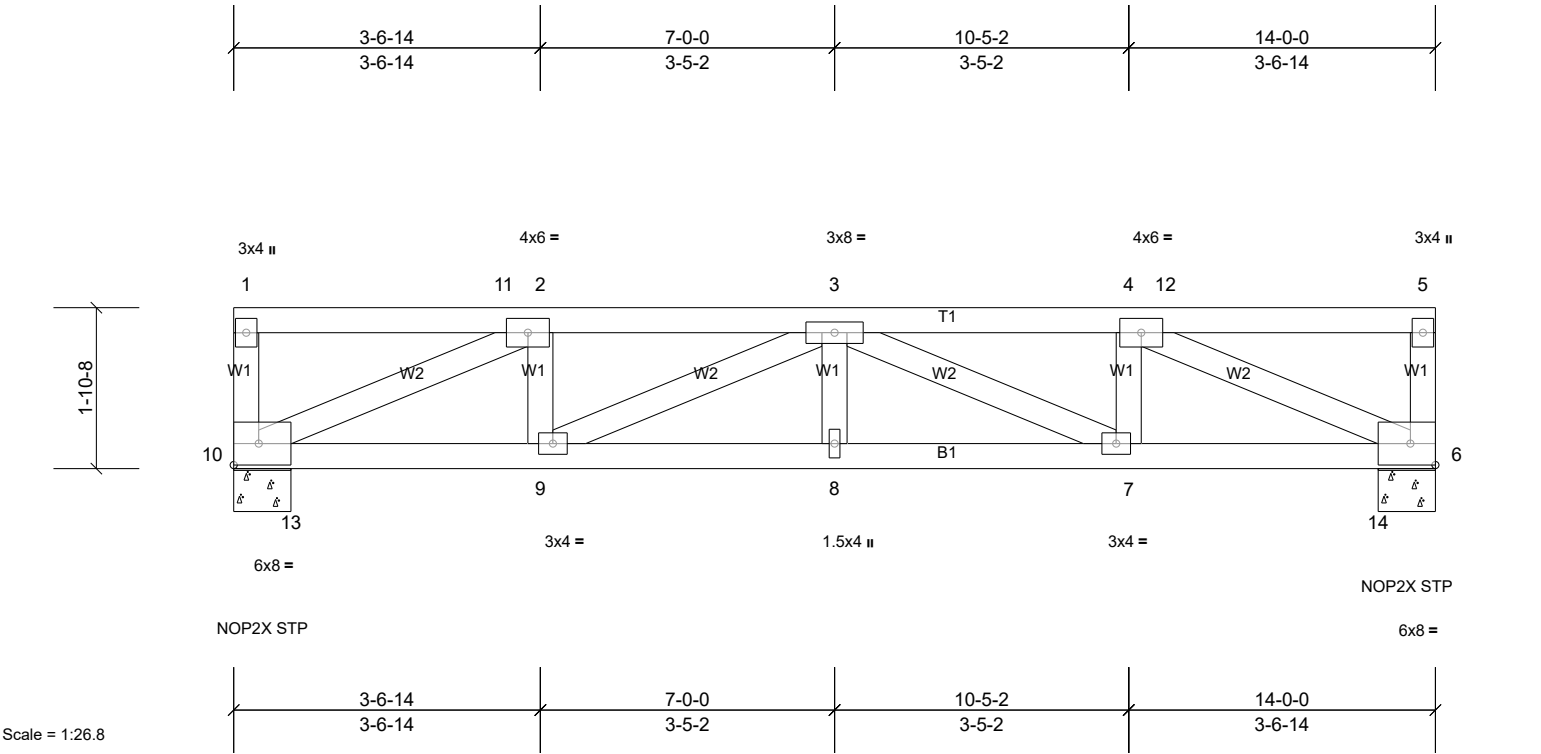

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	5.0	Plate Grip DOL	1.25	TC	0.96	Vert(LL)	0.21	8-9	>787	240	MT20	244/190
TCDL	5.0	Lumber DOL	1.25	BC	0.97	Vert(CT)	-0.21	8	>769	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.73	Horz(CT)	0.07	6	n/a	n/a		
BCDL	5.0	Code	FRC2023/TPI2014	Matrix-MS								
											Weight: 71 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-1-13 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 3-0-3 oc bracing.
WEBS	2x4 SP No.2		


REACTIONS (lb/size) 6=1645/0-8-0, (min. 0-1-15), 10=1645/0-8-0, (min. 0-1-15)
Max Horiz 10=-81 (LC 7)
Max Uplift 6=-1371 (LC 24), 10=-1371 (LC 24)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-10=-364/330, 2-3=-2780/2324, 3-4=-2780/2324, 5-6=-364/330
BOT CHORD 10-13=-2324/2780, 9-13=-2324/2780, 8-9=-3055/3646, 7-8=-3055/3646, 7-14=-2324/2780, 6-14=-2324/2780
WEBS 4-6=-2955/2476, 2-9=-1127/906, 2-10=-2955/2476, 3-9=-954/806, 3-8=-730/557, 3-7=-954/806, 4-7=-1127/906

- NOTES**
- Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=3.0psf; BCDL=3.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 13-10-4 to 13-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - Dead loads shown include weight of truss. Top chord dead load of 5.0 psf (or less) is not adequate for a shingle roof. Architect to verify adequacy of top chord dead load.
 - All plates are MT20 plates unless otherwise indicated.
 - WARNING: Top chord live load is below 12.0psf. Architect and/or engineer of the overall structure to verify adequacy of top chord live load.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1371 lb uplift at joint 10 and 1371 lb uplift at joint 6.
 - Load case(s) 1, 2, 24, 25 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

- LOAD CASE(S)** Standard Except:
- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-5=-230, 6-10=-10
 - Dead + 0.75 Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-5=-18, 10-13=-10, 13-14=-167, 6-14=-10
 - User defined (1): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-5=210, 6-10=-10
 - User defined (2): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-5=-18, 10-13=-10, 13-14=220, 6-14=-10

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	T01	Common	7	1	Job Reference (optional)

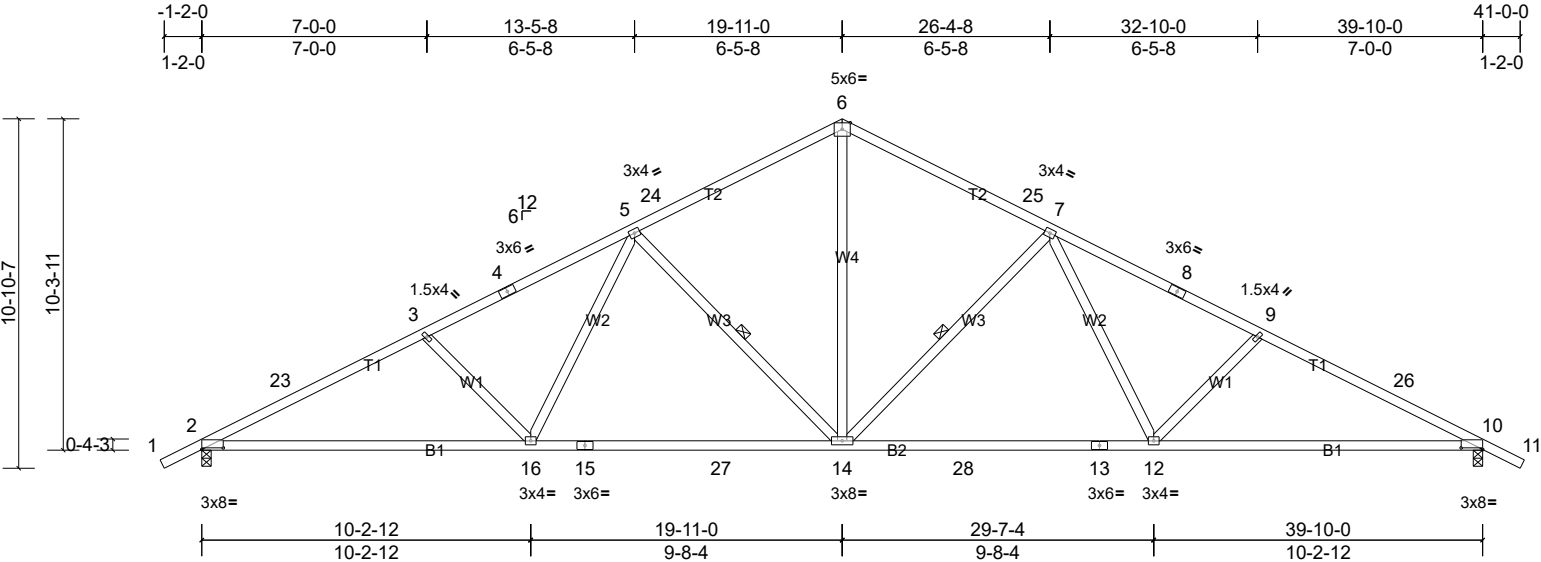

Scale = 1:71.7

Plate Offsets (X, Y): [2:0-8-0,0-0-10], [10:0-8-0,0-0-10]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	PLATES
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.56	Vert(LL)	-0.29	14-16	GRIP
TCDL	7.0	Lumber DOL	1.25	BC	0.77	Vert(CT)	-0.50	14-16	MT20
BCLL	0.0*	Rep Stress Incr	YES	WB	0.74	Horz(CT)	0.11	10	244/190
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS					Weight: 206 lb FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.1D
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 7-14, 5-14

REACTIONS (lb/size) 2=1371/0-3-8, (min. 0-1-9), 10=1371/0-3-8, (min. 0-1-9)
Max Horiz 2=-249 (LC 12)
Max Uplift 2=-579 (LC 11), 10=-579 (LC 12)
Max Grav 2=1564 (LC 2), 10=1564 (LC 2)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-23=-2832/998, 3-23=-2805/1014, 3-4=-2653/931, 4-5=-2594/953, 5-24=-1820/771, 6-24=-1765/793, 6-25=-1765/793, 7-25=-1820/771, 7-8=-2594/953, 8-9=-2653/931, 9-26=-2805/1014, 10-26=-2832/998
BOT CHORD 2-16=-1004/2511, 15-16=-674/2032, 15-27=-674/2032, 14-27=-674/2032, 14-28=-547/2032, 13-28=-547/2032, 12-13=-547/2032, 10-12=-766/2511
WEBS 6-14=-419/1337, 7-14=-664/494, 7-12=-173/671, 9-12=-314/370, 5-14=-664/494, 5-16=-173/671, 3-16=-314/369

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 25-6-10 to 41-0-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 579 lb uplift at joint 2 and 579 lb uplift at joint 10.
5) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	T11	Roof Special	1	1	Job Reference (optional)

Maronda Homes, Sanford, Edwin Rios

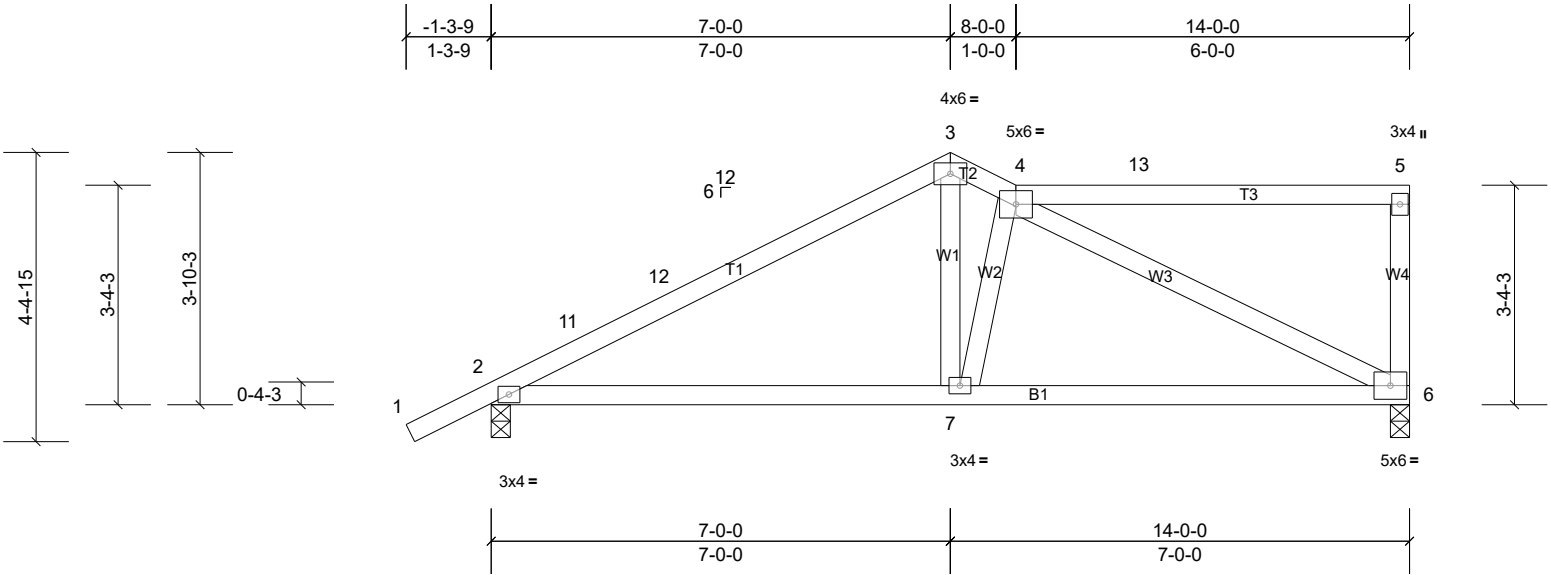

Scale = 1:35.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.44	Vert(LL)	0.10	7-10	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.36	Vert(CT)	-0.11	7-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.44	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 68 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SP No.2		


REACTIONS (lb/size) 2=516/0-3-8, (min. 0-1-8), 6=455/0-3-8, (min. 0-1-8)
 Max Horiz 2=193 (LC 10)
 Max Uplift 2=-234 (LC 11), 6=-207 (LC 12)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-11=-620/338, 11-12=-587/343, 3-12=-574/359, 3-4=-557/405
 BOT CHORD 2-7=-495/593, 6-7=-519/600
 WEBS 4-6=-568/492, 3-7=-67/321

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 13-10-4 to 13-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - WARNING:** Top chord live load is below minimum required by FRC. The building design professional for the overall structure to verify adequacy of top chord live load.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06'-00" tall by 2'-00'-00" wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 234 lb uplift at joint 2 and 207 lb uplift at joint 6.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	T12	Roof Special	1	1	Job Reference (optional)

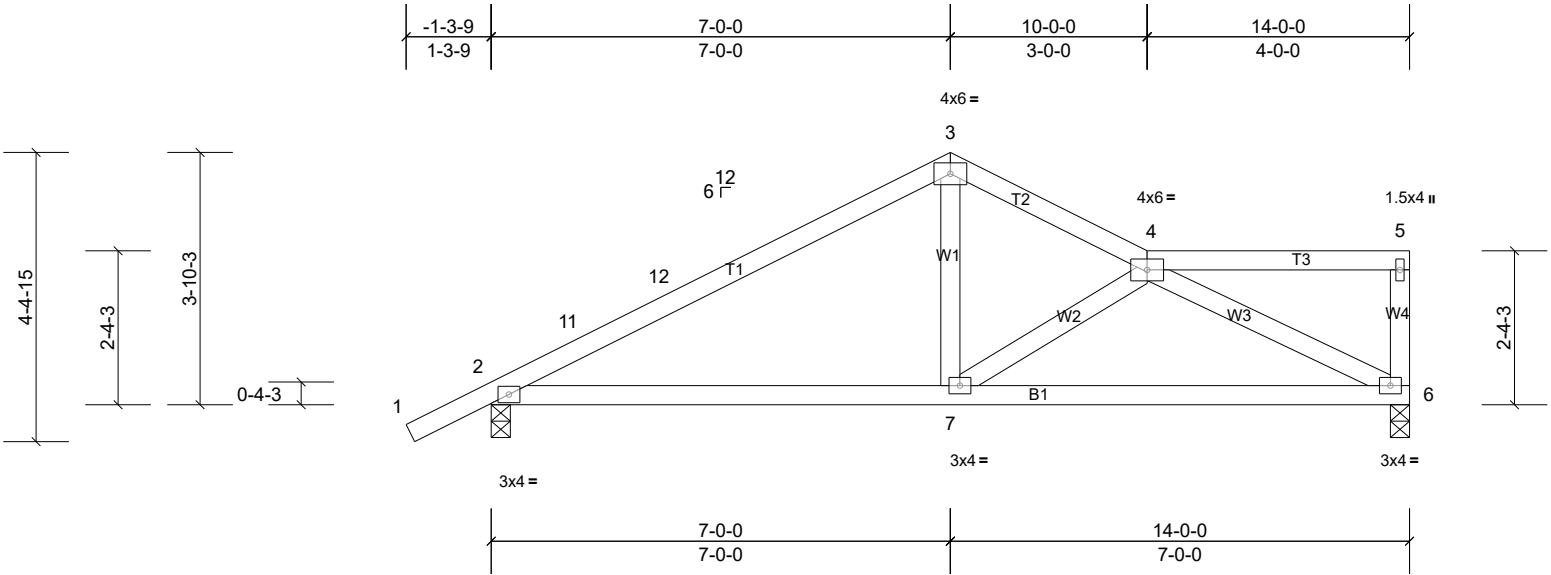

Scale = 1:35.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.46	Vert(LL)	0.10	7-10	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.37	Vert(CT)	-0.12	7-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.22	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 64 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SP No.2		


REACTIONS (lb/size) 2=516/0-3-8, (min. 0-1-8), 6=455/0-3-8, (min. 0-1-8)
Max Horiz 2=155 (LC 10)
Max Uplift 2=-234 (LC 11), 6=-194 (LC 12)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-11=-616/388, 11-12=-584/393, 3-12=-569/409, 3-4=-583/426
BOT CHORD 2-7=-430/547, 6-7=-549/612
WEBS 4-6=-638/568

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 13-10-4 to 13-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - WARNING:** Top chord live load is below minimum required by FRC. The building design professional for the overall structure to verify adequacy of top chord live load.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00" tall by 2'-00"-00" wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 234 lb uplift at joint 2 and 194 lb uplift at joint 6.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	Memphis J Frame
Memphis Frame	T13	Roof Special	1	1	Job Reference (optional)

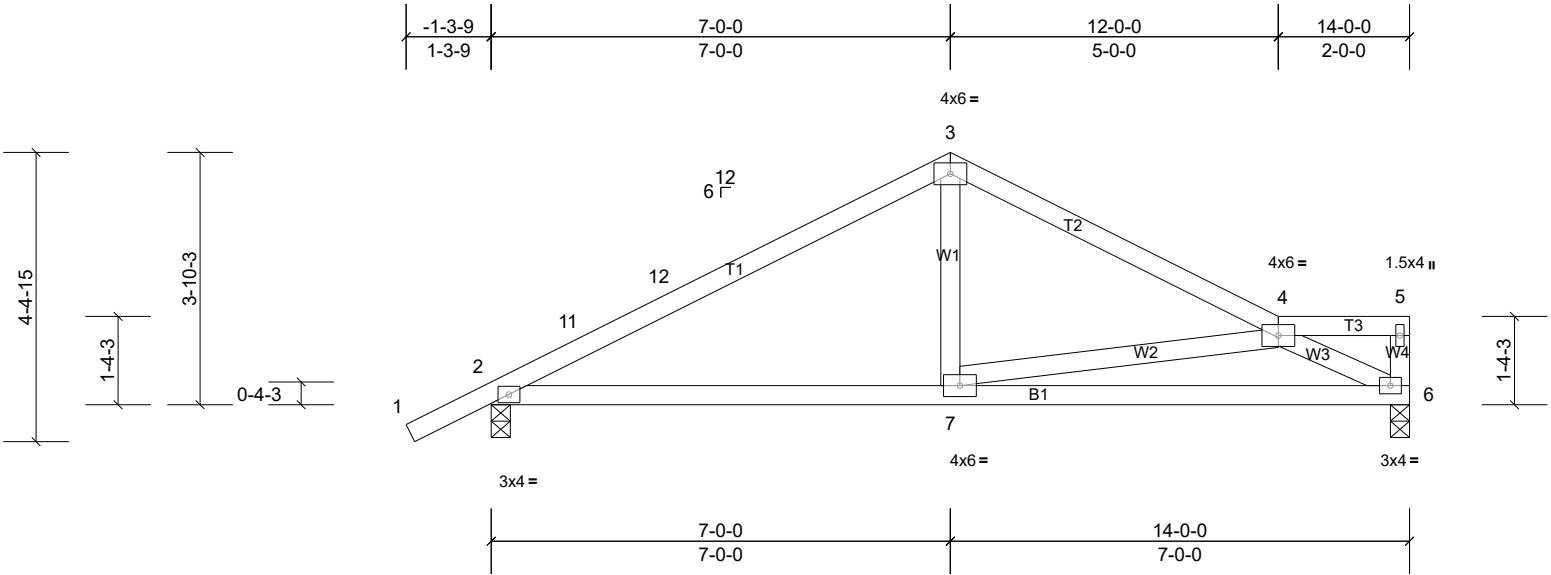

Scale = 1:35.1

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	16.0	Plate Grip DOL	1.25	TC	0.45	Vert(LL)	0.10	7-10	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.37	Vert(CT)	-0.11	7-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	FRC2023/TPI2014	Matrix-AS							Weight: 62 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SP No.2		

REACTIONS (lb/size) 2=516/0-3-8, (min. 0-1-8), 6=455/0-3-8, (min. 0-1-8)
Max Horiz 2=116 (LC 10)
Max Uplift 2=-235 (LC 11), 6=-186 (LC 12)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-11=-619/428, 11-12=-587/434, 3-12=-573/450, 3-4=-614/431
BOT CHORD 2-7=-343/513, 6-7=-580/680
WEBS 4-6=-729/762, 4-7=-222/363

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=140mph (3-second gust) Vasd=108mph; TCDL=4.2psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior (2) zone and C-C 13-10-4 to 13-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - WARNING:** Top chord live load is below minimum required by FRC. The building design professional for the overall structure to verify adequacy of top chord live load.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00" tall by 2'-00"-00" wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 186 lb uplift at joint 6 and 235 lb uplift at joint 2.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard