

This Permit Expires One Year From the Date of Issue

APPLICANT

MATT CASON

PHONE

752-8453

ADDRESS

2910SW CR 242

LAKE CITY

FL

32024

OWNER

VENTURE POINTE LLC

PHONE

752-8453

ADDRESS

232SW OAKWOOD COURT

LAKE CITY

FL

32025

CONTRACTOR

MATT CASON

PHONE

752-8453

LOCATION OF PROPERTY

47S, TR ON KING, TL ON MAULDIN, TL ON DOCKERY, TL ON OAKWOOD

5TH LOT ON LEFT

TYPE DEVELOPMENT

SFD, UTILITY

ESTIMATED COST OF CONSTRUCTION

95050.00

HEATED FLOOR AREA

1901.00

TOTAL AREA

2712.00

HEIGHT

STORIES

1

FOUNDATION

CONC

WALLS

FRAMED

ROOF PITCH

7/12

FLOOR

SLAB

LAND USE & ZONING

A-3

MAX. HEIGHT

21

Minimum Set Back Requirments:

STREET-FRONT

30.00

REAR

25.00

SIDE

25.00

NO. EX.D.U.

0

FLOOD ZONE

X PS

DEVELOPMENT PERMIT NO.

PARCEL ID

34-4S-16-03276-105

SUBDIVISION

HUNTERS OAK

LOT

5

BLOCK

PHASE


UNIT

TOTAL ACRES

1.87

000001407

CBC1254765



Culvert Permit No.

Culvert Waiver

Contractor's License Number

Applicant/Owner/Contractor

CULVERT

07-483

BK

JH

Y

Driveway Connection

Septic Tank Number

LU & Zoning checked by

Approved for Issuance

New Resident

COMMENTS: ONE FOOT ABOVE THE ROAD, SEC 2.31 LEGAL NON-CONFORMING LOT OF RECORD

Check # or Cash155

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power

Foundation

Monolithic

date/app. by

date/app. by

date/app. by

Under slab rough-in plumbing

Slab

Sheathing/Nailing

date/app. by

date/app. by

date/app. by

Framing

Rough-in plumbing above slab and below wood floor

date/app. by

date/app. by

Electrical rough-in

Heat & Air Duct

Peri. beam (Lintel)

date/app. by

date/app. by

date/app. by

Permanent power

C.O. Final

Culvert

date/app. by

date/app. by

date/app. by

M/H tie downs, blocking, electricity and plumbing

Pool

date/app. by

date/app. by

Reconnection

Pump pole

Utility Pole

date/app. by

date/app. by

date/app. by

M/H Pole

Travel Trailer

Re-roof

date/app. by

date/app. by

date/app. by

BUILDING PERMIT FEE \$

480.00

CERTIFICATION FEE \$

13.56

SURCHARGE FEE \$

13.56

MISC. FEES \$

0.00

ZONING CERT. FEE \$

50.00

FIRE FEE \$

0.00

WASTE FEE \$

FLOOD DEVELOPMENT FEE \$

FLOOD ZONE FEE \$

25.00

CULVERT FEE \$

25.00

TOTAL FEE

607.12

INSPECTORS OFFICE



CLERKS OFFICE



NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

This Permit Must Be Prominently Posted on Premises During Construction

PLEASE NOTIFY THE COLUMBIA COUNTY BUILDING DEPARTMENT AT LEAST 24 HOURS IN ADVANCE OF EACH INSPECTION, IN ORDER THAT IT MAY BE MADE WITHOUT DELAY OR INCONVENIENCE, PHONE 758-1008. THIS PERMIT IS NOT VALID UNLESS THE WORK AUTHORIZED BY IT IS COMMENCED WITHIN 6 MONTHS AFTER ISSUANCE.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

This instrument was Prepared By:
CASON CONSTRUCTION
LAKE CITY, FLORIDA

PERMIT NO. _____

TAX FOLIO NO.: _____

NOTICE OF COMMENCEMENT

STATE OF FLORIDA
COUNTY OF COLUMBIA

The undersigned hereby gives notice that improvement will be made to certain real Property, and in accordance with Chapter 713, Florida Statutes, the following information is provided in this Notice of Commencement.

1. Description of property: Lot 5 Hunters Oak 5/0
2. General description of improvement: Construction of Dwelling
3. Owner information: Venture Pointe, LLC, a FL-LLC #LOS000021112
Name and address: P.O. Box 304 - Lake City, FL 32056

b. Interest in property: Fee Simple

c. Name and address of fee simple title holder (if other
Than owner): NONE

Contractor: Cason Construction
Lake City, Florida

5. Surety N/A

a. Name and address:

b. Amount of bond:

Inst:200712014846 Date:7/3/2007 Time:4:41 PM

42 DC, P. DeWitt Cason, Columbia County Page 1 of 1

6. Lender:

7. Persons within the State of Florida designated by Owner upon whom notices
Or other documents may be served as provided by Section 713.13 (1) (a) 7.,
Florida Statutes : NONE

8. In addition to himself, Owner designates _____
_____ to receive a copy of the Lienor's
Notice as provided in section 713.13 (1) (b), Florida Statutes.

9. Expiration date of notice of commencement (the expiration date is 1 year from
The date of recording unless a different date is specified).


[Signature]

Arnon Nielsen / MGR

The foregoing instrument was acknowledged before me this 3 day of
July, 2007 by [Signature]
who are personally known to me and who did not take an oath.

[Signature]
Notary Public

My Commission Expires: 10/19/2010

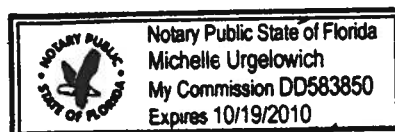

Columbia County Building Permit Application CK#155

Revised 9-23-0

For Office Use Only Application # 0706-47 Date Received 6/13 By JW Permit # 1407/25968
 Application Approved by - Zoning Official BK Date 27.06.07 Plans Examiner CKJH Date 6-22-07
 Flood Zone 1 Per Supervisor Development Permit N/A Zoning A-3 Land Use Plan Map Category A-3
 Comments Section 2.3.1 legal Non-conforming lot of Record
NOC + 8/10

Applicants Name Matt Cason Phone 386 752 8453
 Address 2910 SW CR 242 LC FL 32024
 Owners Name Venture Pointe LLC Phone 386 752 8453
 911 Address 232 SW Oakwood Ct LC FL 32025
 Contractors Name Cason Construction & Development Phone 752 8453
 Address 2910 SW CR 242 LC FL 32024

Fee Simple Owner Name & Address

Bonding Co. Name & Address

Architect/Engineer Name & Address Mark Disosway 754 5409Mortgage Lenders Name & Address Millenium BankCircle the correct power company - FL Power & Light - Clay Elec. - Suwannee Valley Elec. - Progressive EnergyProperty ID Number 34-45-16-03276-105 Estimated Cost of Construction 125,000.00Subdivision Name Hunters Oak Lot 5 Block Unit Phase Driving Directions State Road 47 South, TR on King, TL on Mauldin,
TL on Dockery, TL on Oakwood Ct, 5th lot on left.

Type of Construction Single Fam / Res Number of Existing Dwellings on Property 0
 Total Acreage 1.87 Lot Size Do you need a Culvert Permit or Culvert Waiver or Have an Existing Drive
 Actual Distance of Structure from Property Lines - Front 93 Side 25 Side 33 Rear 450
 Total Building Height 21'11" Number of Stories 1 Heated Floor Area 1901 Roof Pitch 7/12
TOTAL 2,712

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standards of all laws regulating construction in this jurisdiction.

OWNERS AFFIDAVIT: I hereby certify that all the foregoing information is accurate and all work will be done in compliance with all applicable laws and regulating construction and zoning.

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

[Signature]
 Owner Builder or Agent (Including Contractor)

STATE OF FLORIDA
 COUNTY OF COLUMBIA

Sworn to (or affirmed) and subscribed before me

this 13th day of June 2007.Personally known ✓ or Produced Identification

Contractor Signature

Contractors License Number CBC1254765Competency Card Number

NOTARY STAMP/SEAL


[Signature]
 Notary Signature



**Application for Onsite Sewage Disposal System
Construction Permit. Part II Site Plan**
Permit Application Number: 07-483

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT

VENTURE POINT LLC/CR 06-4012

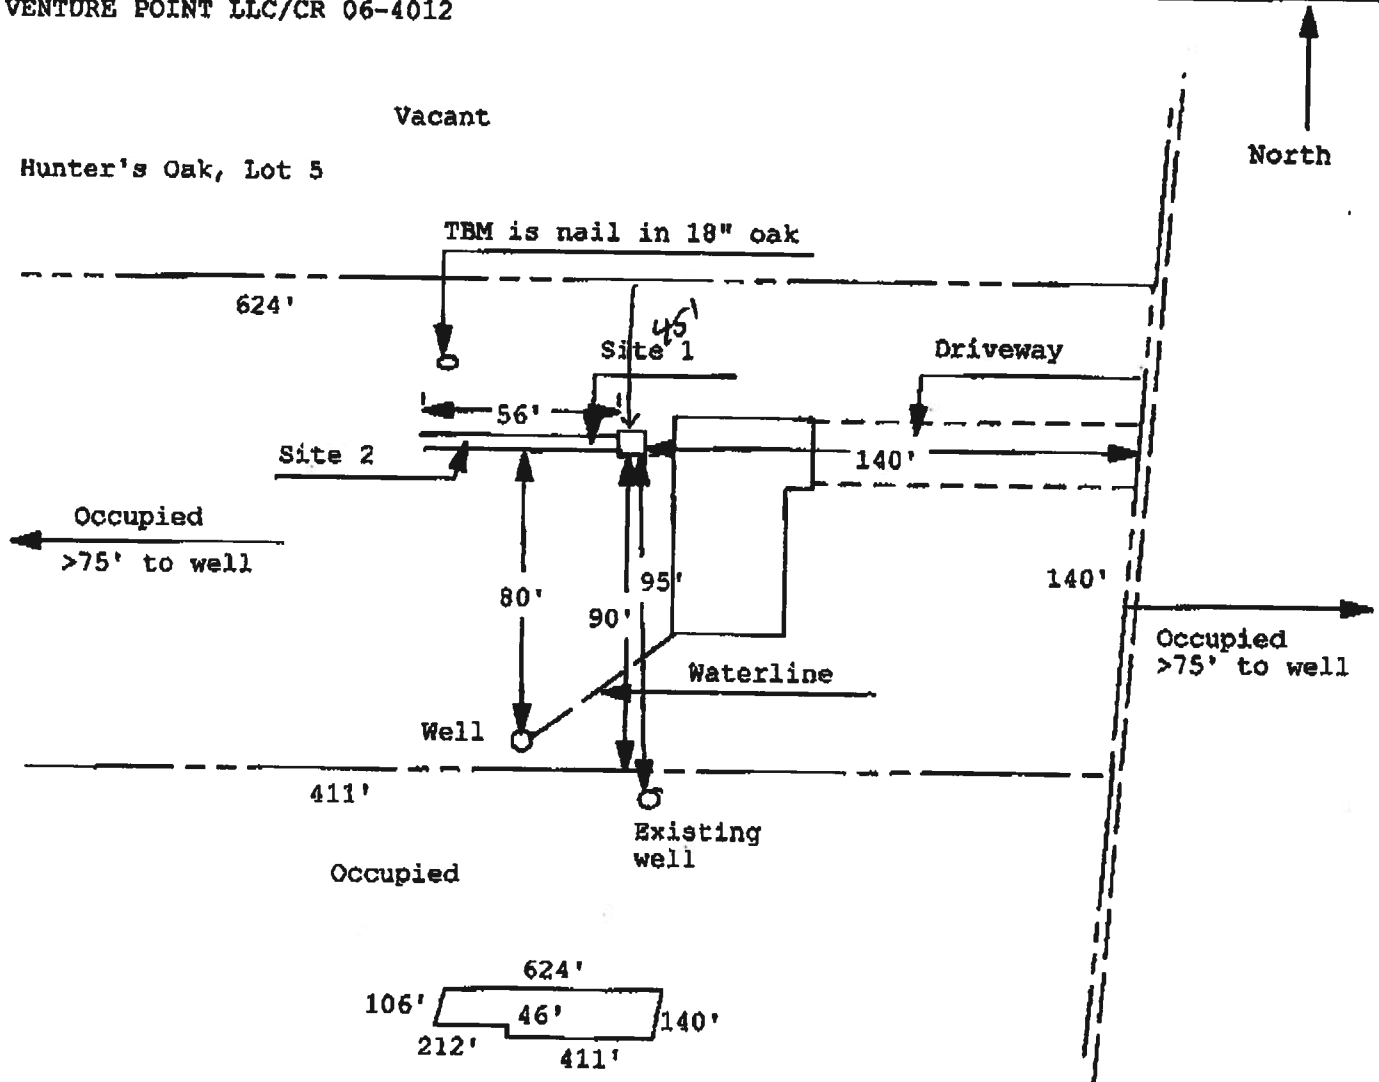

Site Plan Submitted By Paul L. L. Date 6/17/07
Plan Approved ☒ Not Approved ☐ Date 6/14/07
By Mr. S. Larch Columbia CPHU

Notes: _____

Prepared by:

Sierra Title, LLC
619 SW Baya Drive, Suite 102
Lake City, Florida 32025

File Number: 07-0098

Inst:2007007320 Date:04/02/2007 Time:08:50
Doc Stamp-Deed : 297.50
1.7 DC, P. DeWitt Cason, Columbia County B:1115 P:602

General Warranty Deed

Made this March 22, 2007 A.D. By **Timothy M. Shaheen and Sara A. Shaheen, Husband and Wife**, whose address is: SW Oakwood Court, Lake City, Florida 32024, hereinafter called the grantor, to **Venture Pointe, LLC, a Florida Limited Liability Company**, whose post office address is: P.O. Box 304, Lake City, Florida 32056, hereinafter called the grantee:

(Whenever used herein the term "grantor" and "grantee" include all the parties to this instrument and the heirs, legal representatives and assigns of individuals, and the successors and assigns of corporations)

Witnesseth, that the grantor, for and in consideration of the sum of Ten Dollars, (\$10.00) and other valuable considerations, receipt whereof is hereby acknowledged, hereby grants, bargains, sells, aliens, remises, releases, conveys and confirms unto the grantee, all that certain land situate in Columbia County, Florida, viz:

Lot 5, Hunters Oak Subdivision, a subdivision according to the plat thereof as recorded in Plat Book 6, Page 57 of the public records of Columbia County, Florida.

Parcel ID Number:

Together with all the tenements, hereditaments and appurtenances thereto belonging or in anywise appertaining.

To Have and to Hold, the same in fee simple forever.


And the grantor hereby covenants with said grantee that the grantor is lawfully seized of said land in fee simple; that the grantor has good right and lawful authority to sell and convey said land; that the grantor hereby fully warrants the title to said land and will defend the same against the lawful claims of all persons whomsoever; and that said land is free of all encumbrances except taxes accruing subsequent to December 31, 2006.

In Witness Whereof, the said grantor has signed and sealed these presents the day and year first above written.


Signed, sealed and delivered in our presence:




Witness Printed Name **Matthew D. Rocco**



Witness Printed Name **LISA KRAUS**




Timothy M. Shaheen (Seal)
Address: SW Oakwood Court, Lake City, Florida 32024



Sara A. Shaheen (Seal)
Address: P.O. Box 2044, Lake City, Florida 32056


State of Florida
County of Columbia

The foregoing instrument was acknowledged before me this 22nd day of March, 2007, by Timothy M. Shaheen and Sara A. Shaheen, Husband and Wife, who is/are personally known to me or who has produced a Drivers License as identification.






Notary Public
Print Name: _____
My Commission Expires: _____



ER'S OAK' AS PER PLAT THEREOF RECORDED IN PLAT BOOK 6, PAGE 57
RECORDS OF COLUMBIA COUNTY, FLORIDA.


ES)
USED ON MONUMENTATION FOUND IN ACCORDANCE WITH THE RETRACEMENT OF
L SURVEY FOR SAID PLAT OF RECORD.
E BASED ON SAID PLAT OF RECORD.
IS IN ZONE "X" AND IS DETERMINED TO BE OUTSIDE THE 500 YEAR FLOOD
R FLOOD RATE MAP, DATED 6 JANUARY, 1988 COMMUNITY PANEL NUMBER
B. HOWEVER, THE FLOOD INSURANCE RATE MAPS ARE SUBJECT TO CHANGE.
MENTS, IF ANY, INDICATED ON THIS SURVEY DRAWING ARE AS LOCATED ON
LD SURVEY AS SHOWN HEREON.
ST, NO UNDERGROUND ENCROACHMENTS AND/OR UTILITIES WERE LOCATED FOR
Y EXCEPT AS SHOWN HEREON.
' WAS COMPLETED WITHOUT THE BENEFIT OF A TITLE COMMITMENT OR A TITLE

SCALE: 1" = 60'



S Y M B O L L E G E N D

■	4"x4" CONCRETE MONUMENT FOUND
□	4"x4" CONCRETE MONUMENT SET
●	IRON PIPE FOUND
○	IRON PIN AND CAP SET
⊙	POWER POLE
⊕	WATER METER
⊗	CENTERLINE
*	WELL
⊙	SATELLITE DISH
⊙	TELEPHONE BOX
⊙	ELECTRIC LINES
⊙	WIRE FENCE
⊙	CHAIN LINK FENCE
⊙	WOODEN FENCE

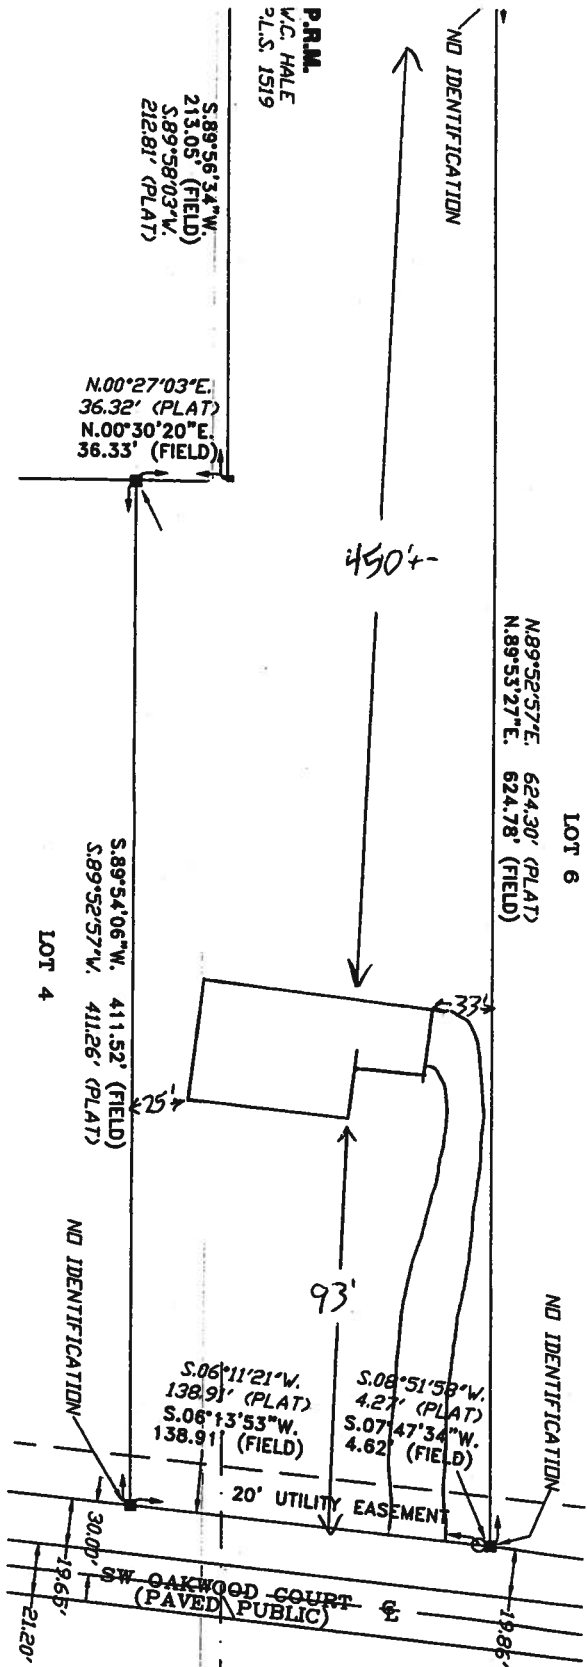

ED TO:
IDA QUARTEN

SURVEYOR'S CERTIFICATION

NOTARY NOTATION

FLORIDA ENERGY EFFICIENCY CODE FOR BUILDING CONSTRUCTION

Florida Department of Community Affairs
Residential Whole Building Performance Method A

Project Name:	Venture Point LLC - Lot 5 Hunters Oak	Builder:	Cason Construction
Address:	Lot: 5, Sub: Hunters Oak, Plat:	Permitting Office:	Columbia County
City, State:	Columbia Cnty, FL 32024-	Permit Number:	25968
Owner:	Spec House	Jurisdiction Number:	221000
Climate Zone:	North		

1. New construction or existing	New	12. Cooling systems	
2. Single family or multi-family	Single family	a. Central Unit	Cap: 44.0 kBtu/hr SEER: 12.00
3. Number of units, if multi-family	1	b. N/A	
4. Number of Bedrooms	4	c. N/A	
5. Is this a worst case?	No	13. Heating systems	
6. Conditioned floor area (ft²)	1901 ft²	a. Electric Heat Pump	Cap: 44.0 kBtu/hr HSPF: 7.20
7. Glass type ¹ and area: (Label reqd. by 13-104.4.5 if not default)		b. N/A	
a. U-factor:	Description Area	c. N/A	
(or Single or Double DEFAULT) 7a(Sngle Default) 245.3 ft²		14. Hot water systems	
b. SHGC:		a. Electric Resistance	Cap: 50.0 gallons EF: 0.90
(or Clear or Tint DEFAULT) 7b. (Clear) 245.3 ft²		b. N/A	
8. Floor types		c. N/A	
a. Slab-On-Grade Edge Insulation	R=0.0, 195.0(p) ft	15. HVAC credits	
b. N/A		(CF-Ceiling fan, CV-Cross ventilation, HF-Whole house fan, PT-Programmable Thermostat, MZ-C-Multizone cooling, MZ-H-Multizone heating)	PT, —
c. N/A			
9. Wall types			
a. Frame, Wood, Exterior	R=13.0, 1262.7 ft²		
b. Frame, Wood, Adjacent	R=13.0, 171.0 ft²		
c. N/A			
d. N/A			
e. N/A			
10. Ceiling types			
a. Under Attic	R=30.0, 1950.0 ft²		
b. N/A			
c. N/A			
11. Ducts(Leak Free)			
a. Sup: Unc. Ret: Unc. AH: Attic	Sup. R=6.0, 40.0 ft		
b. N/A			

Glass/Floor Area: 0.13

Total as-built points: 29089

Total base points: 30163

PASS

I hereby certify that the plans and specifications covered by this calculation are in compliance with the Florida Energy Code.

PREPARED BY: [Signature]DATE: 6-4-07

I hereby certify that this building, as designed, is in compliance with the Florida Energy Code.

OWNER/AGENT: _____

DATE: _____

Review of the plans and specifications covered by this calculation indicates compliance with the Florida Energy Code. Before construction is completed this building will be inspected for compliance with Section 553.908 Florida Statutes.

BUILDING OFFICIAL: _____

DATE: _____



¹ Predominant glass type. For actual glass type and areas, see Summer & Winter Glass output on pages 2&4.

SUMMER CALCULATIONS**Residential Whole Building Performance Method A - Details**

ADDRESS: Lot: 5, Sub: Hunters Oak, Plat: , Columbia Cnty, FL, 32024-

PERMIT #:

BASE				AS-BUILT							
GLASS TYPES											
.18 X Conditioned X BSPM = Points Floor Area				Type/SC	Overhang Ornt Len Hgt		Area X SPM X SOF = Points				
.18	1901.0	20.04	6857.3	Single, Clear	W	1.5	9.0	18.0	43.84	0.97	765.7
				Single, Clear	W	11.5	9.0	40.0	43.84	0.47	832.3
				Single, Clear	W	1.5	9.0	30.0	43.84	0.97	1276.1
				Single, Clear	N	1.5	9.0	30.0	21.73	0.98	636.0
				Single, Clear	N	1.5	9.0	4.0	21.73	0.98	84.8
				Single, Clear	E	1.5	9.0	60.0	47.92	0.97	2788.2
				Single, Clear	E	7.5	10.0	30.0	47.92	0.59	852.5
				Single, Clear	E	7.5	10.0	13.3	47.92	0.59	377.9
				Single, Clear	S	1.5	9.0	20.0	40.81	0.94	770.6
				As-Built Total: 245.3 8384.1							
WALL TYPES Area X BSPM = Points				Type	R-Value		Area X SPM = Points				
Adjacent	171.0	0.70	119.7	Frame, Wood, Exterior	13.0		1262.7	1.50		1894.0	
Exterior	1262.7	1.70	2146.6	Frame, Wood, Adjacent	13.0		171.0	0.60		102.6	
Base Total: 1433.7 2266.3				As-Built Total: 1433.7 1996.6							
DOOR TYPES Area X BSPM = Points				Type	Area X SPM = Points						
Adjacent	18.0	1.60	28.8	Exterior Insulated			20.0	4.10		82.0	
Exterior	20.0	4.10	82.0	Adjacent Insulated			18.0	1.60		28.8	
Base Total: 38.0 110.8				As-Built Total: 38.0 110.8							
CEILING TYPES Area X BSPM = Points				Type	R-Value		Area X SPM X SCM = Points				
Under Attic	1901.0	1.73	3288.7	Under Attic	30.0		1950.0	1.73 X 1.00		3373.5	
Base Total: 1901.0 3288.7				As-Built Total: 1950.0 3373.5							
FLOOR TYPES Area X BSPM = Points				Type	R-Value		Area X SPM = Points				
Slab	195.0(p)	-37.0	-7215.0	Slab-On-Grade Edge Insulation	0.0		195.0(p)	-41.20		-8034.0	
Raised	0.0	0.00	0.0								
Base Total: -7215.0				As-Built Total: 195.0 -8034.0							
INFILTRATION Area X BSPM = Points				Area X SPM = Points							
1901.0 10.21 19409.2				1901.0 10.21 19409.2							

SUMMER CALCULATIONS**Residential Whole Building Performance Method A - Details**

ADDRESS: Lot: 5, Sub: Hunters Oak, Plat: , Columbia Cnty, FL, 32024-

PERMIT #:

BASE				AS-BUILT						
Summer Base Points: 24717.3				Summer As-Built Points: 25240.3						
Total Summer Points	X System Multiplier	=	Cooling Points	Total Component (System - Points)	X Cap Ratio	X Duct Multiplier (DM x DSM x AHU)	X System Multiplier	X Credit Multiplier	=	Cooling Points
24717.3	0.4266		10544.4	(sys 1: Central Unit 44000 btuh , SEER/EFF(12.0) Ducts:Unc(S),Unc(R),Att(AH),R6.0(INS) 25240	1.00	(1.09 x 1.000 x 1.11)	0.284	0.950		8251.3
				25240.3	1.00	1.210	0.284	0.950		8251.3

WINTER CALCULATIONS

Residential Whole Building Performance Method A - Details

ADDRESS: Lot: 5, Sub: Hunters Oak, Plat: , Columbia Cnty, FL, 32024-

PERMIT #:

BASE				AS-BUILT							
GLASS TYPES											
.18 X Conditioned X BWPM = Points Floor Area				Type/SC	Overhang Ornt Len Hgt		Area X WPM X WOF = Points				
.18	1901.0	12.74	4359.4	Single, Clear	W	1.5	9.0	18.0	28.84	1.01	523.2
				Single, Clear	W	11.5	9.0	40.0	28.84	1.19	1375.3
				Single, Clear	W	1.5	9.0	30.0	28.84	1.01	872.0
				Single, Clear	N	1.5	9.0	30.0	33.22	1.00	997.1
				Single, Clear	N	1.5	9.0	4.0	33.22	1.00	132.9
				Single, Clear	E	1.5	9.0	60.0	26.41	1.02	1609.3
				Single, Clear	E	7.5	10.0	30.0	26.41	1.21	959.7
				Single, Clear	E	7.5	10.0	13.3	26.41	1.21	425.5
				Single, Clear	S	1.5	9.0	20.0	20.24	1.02	414.2
				As-Built Total:				245.3		7309.3	
WALL TYPES Area X BWPM = Points				Type	R-Value		Area X WPM = Points				
Adjacent	171.0	3.60	615.6	Frame, Wood, Exterior	13.0		1262.7	3.40		4293.2	
Exterior	1262.7	3.70	4672.0	Frame, Wood, Adjacent	13.0		171.0	3.30		564.3	
Base Total:				1433.7		5287.6		As-Built Total:		1433.7 4857.5	
DOOR TYPES Area X BWPM = Points				Type	R-Value		Area X WPM = Points				
Adjacent	18.0	8.00	144.0	Exterior Insulated			20.0	8.40		168.0	
Exterior	20.0	8.40	168.0	Adjacent Insulated			18.0	8.00		144.0	
Base Total:				38.0		312.0		As-Built Total:		38.0 312.0	
CEILING TYPES Area X BWPM = Points				Type	R-Value		Area X WPM X WCM = Points				
Under Attic	1901.0	2.05	3897.0	Under Attic	30.0		1950.0	2.05 X 1.00		3997.5	
Base Total:				1901.0		3897.0		As-Built Total:		1950.0 3997.5	
FLOOR TYPES Area X BWPM = Points				Type	R-Value		Area X WPM = Points				
Slab	195.0(p)	8.9	1735.5	Slab-On-Grade Edge Insulation	0.0		195.0(p)	18.80		3666.0	
Raised	0.0	0.00	0.0								
Base Total:				1735.5		As-Built Total:		195.0		3666.0	
INFILTRATION Area X BWPM = Points								Area X WPM = Points			
1901.0 -0.59 -1121.6								1901.0 -0.59 -1121.6			

WINTER CALCULATIONS**Residential Whole Building Performance Method A - Details**

ADDRESS: Lot: 5, Sub: Hunters Oak, Plat: , Columbia Cnty, FL, 32024-

PERMIT #:

BASE			AS-BUILT					
Winter Base Points: 14469.9			Winter As-Built Points: 19020.7					
Total Winter Points	X System Multiplier	= Heating Points	Total Component (System - Points)	X Cap Ratio	X Duct Multiplier (DM x DSM x AHU)	X System Multiplier	X Credit Multiplier	= Heating Points
14469.9	0.6274	9078.4	(sys 1: Electric Heat Pump 44000 btuh ,EFF(7.2) Ducts:Unc(S),Unc(R),Att(AH),R6.0 19020.7	1.000	(1.069 x 1.000 x 1.10)	0.474	0.950	10063.4
14469.9	0.6274	9078.4	19020.7	1.00	1.176	0.474	0.950	10063.4

WATER HEATING & CODE COMPLIANCE STATUS**Residential Whole Building Performance Method A - Details**

ADDRESS: Lot: 5, Sub: Hunters Oak, Plat: , Columbia Cnty, FL, 32024-

PERMIT #:

BASE				AS-BUILT						
WATER HEATING				Tank	EF	Number of	X	Tank	X	Credit
Number of	X	Multiplier	=	Volume		Bedrooms		Ratio	Multiplier	=
Bedrooms			Total							Total
4		2635.00	10540.0	50.0	0.90	4		1.00	2693.56	1.00
				As-Built Total:						10774.2

CODE COMPLIANCE STATUS									
BASE					AS-BUILT				
Cooling	+	Heating	+	Hot Water	=	Cooling	+	Heating	=
Points		Points		Points	Total	Points		Points	Total
10544		9078		10540	30163	8251		10063	29089

PASS

Code Compliance Checklist

Residential Whole Building Performance Method A - Details

ADDRESS: Lot: 5, Sub: Hunters Oak, Plat: , Columbia Cnty, FL, 32024-

PERMIT #:

6A-21 INFILTRATION REDUCTION COMPLIANCE CHECKLIST

COMPONENTS	SECTION	REQUIREMENTS FOR EACH PRACTICE	CHECK
Exterior Windows & Doors	606.1.ABC.1.1	Maximum: .3 cfm/sq.ft. window area; .5 cfm/sq.ft. door area.	
Exterior & Adjacent Walls	606.1.ABC.1.2.1	Caulk, gasket, weatherstrip or seal between: windows/doors & frames, surrounding wall; foundation & wall sole or sill plate; joints between exterior wall panels at corners; utility penetrations; between wall panels & top/bottom plates; between walls and floor. EXCEPTION: Frame walls where a continuous infiltration barrier is installed that extends from, and is sealed to, the foundation to the top plate.	
Floors	606.1.ABC.1.2.2	Penetrations/openings >1/8" sealed unless backed by truss or joint members. EXCEPTION: Frame floors where a continuous infiltration barrier is installed that is sealed to the perimeter, penetrations and seams.	
Ceilings	606.1.ABC.1.2.3	Between walls & ceilings; penetrations of ceiling plane of top floor; around shafts, chases, soffits, chimneys, cabinets sealed to continuous air barrier; gaps in gyp board & top plate; attic access. EXCEPTION: Frame ceilings where a continuous infiltration barrier is installed that is sealed at the perimeter, at penetrations and seams.	
Recessed Lighting Fixtures	606.1.ABC.1.2.4	Type IC rated with no penetrations, sealed; or Type IC or non-IC rated, installed inside a sealed box with 1/2" clearance & 3" from insulation; or Type IC rated with < 2.0 cfm from conditioned space, tested.	
Multi-story Houses	606.1.ABC.1.2.5	Air barrier on perimeter of floor cavity between floors.	
Additional Infiltration reqts	606.1.ABC.1.3	Exhaust fans vented to outdoors, dampers; combustion space heaters comply with NFPA, have combustion air.	

6A-22 OTHER PRESCRIPTIVE MEASURES (must be met or exceeded by all residences.)

COMPONENTS	SECTION	REQUIREMENTS	CHECK
Water Heaters	612.1	Comply with efficiency requirements in Table 612.1.ABC.3.2. Switch or clearly marked circuit breaker (electric) or cutoff (gas) must be provided. External or built-in heat trap required.	
Swimming Pools & Spas	612.1	Spas & heated pools must have covers (except solar heated). Non-commercial pools must have a pump timer. Gas spa & pool heaters must have a minimum thermal efficiency of 78%.	
Shower heads	612.1	Water flow must be restricted to no more than 2.5 gallons per minute at 80 PSIG.	
Air Distribution Systems	610.1	All ducts, fittings, mechanical equipment and plenum chambers shall be mechanically attached, sealed, insulated, and installed in accordance with the criteria of Section 610. Ducts in unconditioned attics: R-6 min. insulation.	
HVAC Controls	607.1	Separate readily accessible manual or automatic thermostat for each system.	
Insulation	604.1, 602.1	Ceilings-Min. R-19. Common walls-Frame R-11 or CBS R-3 both sides. Common ceiling & floors R-11.	

Tested sealed ducts must be certified in this house.

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE SCORE* = 83.8

The higher the score, the more efficient the home.

Spec House, Lot: 5, Sub: Hunters Oak, Plat: , Columbia Cnty, FL, 32024-

1. New construction or existing	New	___	12. Cooling systems	
2. Single family or multi-family	Single family	___	a. Central Unit	Cap: 44.0 kBtu/hr
3. Number of units, if multi-family	1	___		SEER: 12.00
4. Number of Bedrooms	4	___	b. N/A	___
5. Is this a worst case?	No	___	c. N/A	___
6. Conditioned floor area (ft ²)	1901 ft ²	___		___
7. Glass type ¹ and area: (Label reqd. by 13-104.4.5 if not default)		___		___
a. U-factor:	Description	Area	13. Heating systems	
(or Single or Double DEFAULT)	7a(Sngle Default)	245.3 ft ²	a. Electric Heat Pump	Cap: 44.0 kBtu/hr
b. SHGC:		___		HSPF: 7.20
(or Clear or Tint DEFAULT)	7b. (Clear)	245.3 ft ²	b. N/A	___
8. Floor types		___	c. N/A	___
a. Slab-On-Grade Edge Insulation	R=0.0, 195.0(p) ft	___		___
b. N/A	___	___	14. Hot water systems	
c. N/A	___	___	a. Electric Resistance	Cap: 50.0 gallons
9. Wall types		___		EF: 0.90
a. Frame, Wood, Exterior	R=13.0, 1262.7 ft ²	___	b. N/A	___
b. Frame, Wood, Adjacent	R=13.0, 171.0 ft ²	___	c. Conservation credits	___
c. N/A	___	___	(HR-Heat recovery, Solar	___
d. N/A	___	___	DHP-Dedicated heat pump)	___
e. N/A	___	___	15. HVAC credits	PT, ___
10. Ceiling types		___	(CF-Ceiling fan, CV-Cross ventilation,	___
a. Under Attic	R=30.0, 1950.0 ft ²	___	HF-Whole house fan,	___
b. N/A	___	___	PT-Programmable Thermostat,	___
c. N/A	___	___	MZ-C-Multizone cooling,	___
11. Ducts(Leak Free)		___	MZ-H-Multizone heating)	___
a. Sup: Unc. Ret: Unc. AH: Attic	Sup. R=6.0, 40.0 ft	___		___
b. N/A	___	___		___

I certify that this home has complied with the Florida Energy Efficiency Code For Building Construction through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL Display Card will be completed based on installed Code compliant features.

Builder Signature: _____

Date: _____

Address of New Home: _____

City/FL Zip: _____



**NOTE: The home's estimated energy performance score is only available through the FLA/RES computer program. This is not a Building Energy Rating. If your score is 80 or greater (or 86 for a US EPA/DOE EnergyStar™ designation), your home may qualify for energy efficiency mortgage (EEM) incentives if you obtain a Florida Energy Gauge Rating. Contact the Energy Gauge Hotline at 321/638-1492 or see the Energy Gauge web site at www.fsec.ucf.edu for information and a list of certified Raters. For information about Florida's Energy Efficiency Code For Building Construction, contact the Department of Community Affairs at 850/487-1824.*

¹ Predominant glass type. For actual glass type and areas, see Summer & Winter Glass output on pages 2&4.
EnergyGauge® (Version: FLRCPB v4.1)

Energy Code Compliance

Duct System Performance Report

Project Name: Venture Point LLC - Lot 5 Hunters Oak Address: City, State: Columbia Cnty, FL 32024- Owner: Spec House Climate Zone: North	Builder: Cason Construction Permitting Office: Columbia County Permit Number: Jurisdiction Number:
------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------

Total Duct System Leakage Test Results

CFM25 Total Duct Leakage Test Values			
Line	System	Duct Leakage Total	Duct Leakage to Outdoors
1	System1	_____ cfm25(tot)	_____ cfm25(out)
2	System2	_____ cfm25(tot)	_____ cfm25(out)
3	System3	_____ cfm25(tot)	_____ cfm25(out)
4	System4	_____ cfm25(tot)	_____ cfm25(out)
5	Total House Duct System Leakage	Sum lines 1-4 _____ Divide by _____ (Total Conditioned Floor Area) = _____ (Q _{n,tot}) <input type="checkbox"/> Receive credit if Q _{n,tot} ≤ 0.03	Sum lines 1-4 _____ Divide by _____ (Total Conditioned Floor Area) = _____ (Q _{n,out}) <input type="checkbox"/> Receive credit if Q _{n,out} ≤ 0.03 AND Q _{n,tot} ≤ 0.09

I hereby certify that the above duct testing performance results demonstrate compliance with the Florida Energy Code requirements in accordance with Section 610.1.A.1, Florida Building Code, Building Volume, Chapter 13 for leak free duct system credit.

Signature: _____
Printed Name: _____
Florida Rater Certification #: _____
DATE: _____

Florida Building Code requires that testing to confirm leak free duct systems be performed by a Class 1 Florida Energy Gauge Certified Energy Rater. Certified Florida Class 1 raters can be found at: <http://energygauge.com/search.htm>



BUILDING OFFICIAL: _____
DATE: _____

MEMBER OF
The
North Central
Florida Water
Well

Clyatt Well Drilling, Inc.
(Established in 1971)
POST OFFICE BOX 180
WORTHINGTON SPRINGS, FLORIDA 32697

K. Melaine
"Red" Clyatt

Telephone Number (386)496-2488
FAX Number (386)496-4640

June 18, 2002

Columbia County Building Department
Post Office Box 1529
Lake City, Florida 32056

To Whom It May Concern:

As required by building code regulations for Columbia County in order that a building permit can be issued, the following well information is provided with regard to the above-referenced well:

Size of Pump Motor:	1-1/2 Horse Power
Size of Pressure Tank:	220 Gallon Equivalent
Cycle Stop Valve Used:	No


Should you require any additional information, please do not hesitate to contact us.

Respectfully,


CLYATT WELL DRILLING, INC.



K. Melaine "Red" Clyatt
President



Clyatt Well Drilling, Inc.
(Established in 1971)
POST OFFICE BOX 180
WORTHINGTON SPRINGS, FLORIDA 32697



Telephone Number (386)496-2488
FAX Number (386)496-4640

**PUMP AND TANK SPECIFICATIONS FOR
STANDARD 4" RESIDENTIAL WELLS**

PUMPS

1 Horse Power Submersible Pump
20 Gallons Per Minute
Voltage: 240
Phase: (Single) 1

1.5 Horse Power Submersible Pump
25 Gallons Per Minute
Voltage: 240
Phase: (Single) 1

TANK

WF-255 Captive Air Tank
Capacity 81 Gallons
Equivalent 220 Gallons
Draw Down 25 Gallons

Columbia County Building Department Culvert Permit

Culvert Permit No.
000001407

DATE 06/28/2007 PARCEL ID # 34-4S-16-03276-105
APPLICANT MATT CASON PHONE 752-8453
ADDRESS 2910 SW CR 242 LAKE CITY FL 32024
OWNER VENTURE POINTE LLC PHONE 752-8453
ADDRESS 232 SW OAKWOOD COURT LAKE CITY FL 32025
CONTRACTOR MATT CASON PHONE 752-8453
LOCATION OF PROPERTY 47S, TR ON KING, TL ON MAULDIN, TL ON DOCKERY, TL ON OAKWOOD CT,
5TH LOT ON LEFT
SUBDIVISION/LOT/BLOCK/PHASE/UNIT HUNTERS OAK 5

SIGNATURE



INSTALLATION REQUIREMENTS



Culvert size will be 18 inches in diameter with a total length of 32 feet, leaving 24 feet of driving surface. Both ends will be mitered 4 foot with a 4 : 1 slope and poured with a 4 inch thick reinforced concrete slab.

INSTALLATION NOTE: Turnouts will be required as follows:

- a) a majority of the current and existing driveway turnouts are paved, or;
 - b) the driveway to be served will be paved or formed with concrete.
- Turnouts shall be concrete or paved a minimum of 12 feet wide or the width of the concrete or paved driveway, whichever is greater. The width shall conform to the current and existing paved or concreted turnouts.



Culvert installation shall conform to the approved site plan standards.



Department of Transportation Permit installation approved standards.



Other _____

ALL PROPER SAFETY REQUIREMENTS SHOULD BE FOLLOWED
DURING THE INSTALATION OF THE CULVERT.

135 NE Hernando Ave., Suite B-21
Lake City, FL 32055
Phone: 386-758-1008 Fax: 386-758-2160

Amount Paid 25.00



ITW Building Components Group, Inc.

1950 Marley Drive Haines City, FL 33844
Florida Engineering Certificate of Authorization Number: 567
Florida Certificate of Product Approval # FL1999
Page 1 of 1 Document ID: IT848228Z0112103333

Truss Fabricator: Anderson Truss Company
Job Identification: 7-166--Cason Construction Grand Ross -- , **
Truss Count: 21
Model Code: Florida Building Code 2004 and 2006 Supplement
Truss Criteria: ANSI/TPI-2002(STD)/FBC
Engineering Software: Alpine Software, Versions 7.36, 7.33, 7.25.
Structural Engineer of Record: The identity of the structural EOR did not exist as of
the seal date per section 61G15-31.003(5a) of the FAC
Address:
Minimum Design Loads: Roof - 40.0 PSF @ 1.25 Duration
Floor - N/A
Wind - 110 MPH ASCE 7-02 -Closed

Notes:

1. Determination as to the suitability of these truss components for the structure is the responsibility of the building designer/engineer of record, as defined in ANSI/TPI 1
2. The drawing date shown on this index sheet must match the date shown on the individual truss component drawing.
3. As shown on attached drawings; the drawing number is preceded by: HCUSR8228

Details: BRCLBSUB-A11015EE-GBLLETIN-A11030EE-A11015EC-

Seal Date: 06/12/2007

-Truss Design Engineer-
Arthur R. Fisher

Florida License Number: 59687
1950 Marley Drive
Haines City, FL 33844

#	Ref	Description	Drawing#	Date
1	79448--A		07162001	06/11/07
2	79449--AGE		07162002	06/11/07
3	79450--B3		07162003	06/11/07
4	79451--B2		07162004	06/11/07
5	79452--B4		07162005	06/11/07
6	79453--BGE1		07162006	06/11/07
7	79454--B5GE		07162007	06/11/07
8	79455--C4		07162008	06/11/07
9	79456--C3		07162009	06/11/07
10	79457--C2		07162010	06/11/07
11	79458--C1		07162011	06/11/07
12	79459--CGE5		07162012	06/11/07
13	79460--D		07162013	06/11/07
14	79461--DGE1		07162014	06/11/07
15	79462--E-1		07162015	06/11/07
16	79463--EGE		07162016	06/11/07
17	79464--E		07162017	06/11/07
18	79465--M		07162018	06/11/07
19	79466--M1		07162019	06/11/07
20	79467--MGE		07162020	06/11/07
21	79468--AP		07162021	06/11/07



110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg,
Located anywhere in roof, CAT 1I, EXP B, wind TC DL=5.0 psf
Wind BC DL=5.0 psf. Iw=1.00 gcpi(+/-)0.18

(A) Continuous lateral bracing equally spaced on member.



Scale = .1875"/Ft.

ARTHUR R. FISHER
N.C. LICENSE
No. 59687

STATE OF FLORIDA
PROFESSIONAL ENGINEER
No. 12456
Jun A. '07

TC LL	20.0 PSF	REF	R8228- 79448
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCUSR8228 07162001
BC LL	0.0 PSF	HC-ENG	MNM/AF
TOT.LD.	40.0 PSF	SEON-	17545
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1T848228201

See DWGS A11015EE0207 & GBLLETIN0207 for more requirements.

(**) (2) plate(s) require special positioning. Refer to scaled plate plot details for special positioning




JREF - 1T848228Z01

Wind reactions based on MMFRS pressures.
In lieu of structural panels use purlins to brace all flat TC @ 24" OC.

(A) Continuous lateral bracing equally spaced on member

(A) Continuous lateral bracing equally spaced on member.

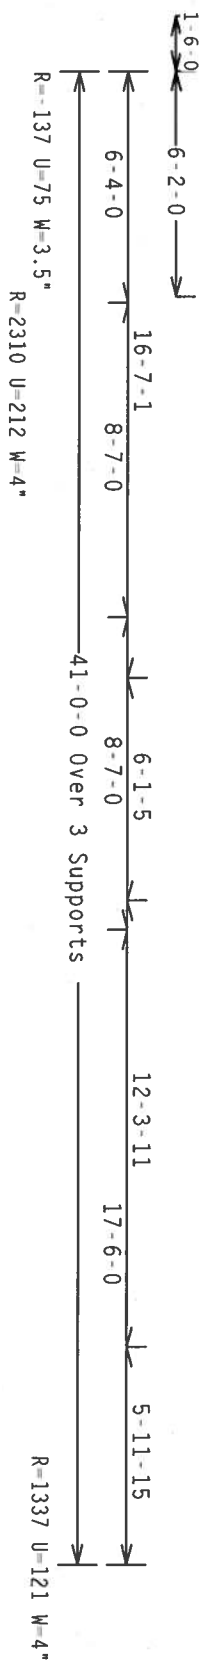

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)

 $Cq/RT=1.00(1.25)/10(0)$

7.36.0

PERMIT TO EXCAVATE

FL/-/4/-/-/R/-

Scale = .1875"/Ft.

*"MAINTAIN" FROES (BUILDING EXTRINSIC CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING REFER TO GC51 (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY TPI (TRUSS PAPER INSTITUTE), 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314) AND WPCA (WOOD TRUSS COUNCIL OF AMERICA, 65000 ENTERPRISE LANE, MOUNTAIN VIEW, NJ 07046) FOR THE PROPER CONSTRUCTION OF THESE COMPONENTS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE PROPERLY ATTACHED ROD CEILING.

ALPINE

ITW Building Components Group, Inc.
Haines City, FL 33844
Tel. Certificate # A-017419 - 4567

****IMPORTANT*****FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. IN REG. SMALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI; OR FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING OF TRUSSES.

DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF MOD (NATIONAL DESIGN SPEC. BY AREA) AND TPI. (IN REG. SMALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI; OR FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING OF TRUSSES.)

CONNECTION PLATES ARE MADE OF 2010/6064 (A36/A572). STEEL A565 GRADE 40/60 (A 36/A 55) GALV. STEEL. APPLY MINIMUM WELDING REQUIREMENTS AS SHOWN ON THESE CONNECTIONS. EXISTION PER DRINKERS' MOD. 1988.

A FULL INSPECTION OF ALL SITES FOLLOWED BY A RE-ENTRY OF THE TRUSS TO THE BUILDING SHALL BE REQUIRED. DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENTRY OF THE DESIGN SHOWN.


THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

TC LL	20.0 PSF	REF	R8228- 79450
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	H05R8228 07162003
BC LL	0.0 PSF	HC-ENG	JB/AF
TOT.LD.	40.0 PSF	SEQN-	17651
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1T848228Z01

In lieu of structural panels use purlins to brace all flat TC @ 24" OC.

110 mph wind, 15.22 ft mean hgt, ASCE 7-02, CLOSED bldg, located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCFI(+/-)-0.18

Deflection meets $L/240$ live and $L/180$ increase factor for dead load is 1.50.



Note: All Plates Are 3X4 Except As Shown.
PLT TYP. Wave Desig

$$\frac{\text{TPI}-2002(\text{STD})/\text{FBC}}{\text{Cq}/\text{RT}=1.00(1.25)/10(0.0001)}$$

7.36.04

MR. R. FISHER
CLERK
TY:1 FL/-/4/-/-R/

Scale = .1875"/Ft.

WARNING** TRUSSES REQUIRE EXTREME CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCSTI (BUILDING COMPONENT SAFETY INFORMATION) PUBLISHED BY TPI (TRUSS PLATE INSTITUTE), 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22304) AND MICA (WOOD TRUSS COUNCIL OF AMERICA), 6300 ENTERPRISE LANE, MADISON, MI 48073) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED FOR CONDO SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT**FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE DESIGN OR CONCRETE MIXTURE, APPLICATION OF MATERIALS, INSTALLING A BRACING, TRUSSES BY AREA) AND TPI. ITW BCG CONNECTOR PLATES ARE MADE OF 20/19/1664 (N/A/S/S/Y) ASTM A563 GRADE 40/60 (N/A/KH/55) GALV. STEEL. APPLY PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWINGS 160A-Z. ANY INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE PER ANNEX A OF TPI 1100-2002 SEC.3. A SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

ALPINE

TC LL	20.0 PSF	REF R8228- 79452
TC DL	10.0 PSF	DATE 06/11/07
BC DL	10.0 PSF	DRW HCUR8228 07162005
BC LL	0.0 PSF	HC-ENG JB/AF
TOT.LD.	40.0 PSF	SEQN- 17667
DUR.FAC.	1.25	
SPACING	24.0"	JREF- 1T848228Z01

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3 :W4, W5 2x4 SP #2 Dense:

110 mph wind, 15.06 ft mean hgt, ASCE 7-02, CLOSED bldg.
located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf.
Wind BC DL=5.0 psf. Iw=1.00 GCPI(+/-)=0.18

Right end vertical not exposed to wind pressure.

Truss spaced at 24.0" OC designed to support 1-0-0 top chord
outlookers. Cladding load shall not exceed 10.00 PSF. Top chord
must not be cut or notched.

See DWGS A11030E0207 & GBLLETIN0207 for more requirements.

(A) Continuous lateral bracing equally spaced on member.


In lieu of structural panels use purlins to brace all flat TC @
24" OC.

Deflection meets L/240 live and L/180 total load. Creep
increase factor for dead load is 1.50.

* WIND ON TRUSS RUN AS CLOSED IN INDICATED AREA
BUILDING DESIGNER OR ENGINEER OF RECORD TO
DETERMINE IF THIS IS ACCEPTABLE.*

(**) 2 plate(s) require special positioning. Refer to scaled
plate plot details for special positioning requirements.
Wind reactions based on MWFRS pressures.
+ MEMBER TO BE LATERALLY BRACED FOR HORIZONTAL WIND LOADS.
BRACING SYSTEM TO BE DESIGNED AND FURNISHED BY OTHERS.

THE BUILDING DESIGNER IS RESPONSIBLE FOR THE DESIGN OF THE
ROOF AND CEILING DIAPHRAGMS, GABLE END SHEAR WALLS, AND
SUPPORTING SHEAR WALLS. SHEAR WALLS MUST PROVIDE CONTINUOUS
LATERAL RESTRAINT TO THE GABLE END. ALL CONNECTIONS TO BE
DESIGNED BY THE BUILDING DESIGNER. CONNECTIONS SHALL BE
FROM THE ROOF DIAPHRAGM TO THE CEILING DIAPHRAGM. THIS
TRUSS IS NOT DESIGNED FOR LATERAL WIND PRESSURE APPLIED
TO THE FACE. ANY LATERAL LOAD FROM WIND MUST BE
TRANSFERRED TO THE BUILDING DIAPHRAGMS. LATERAL BRACING
FOR WIND TO BE DESIGNED AND FURNISHED BY OTHERS.

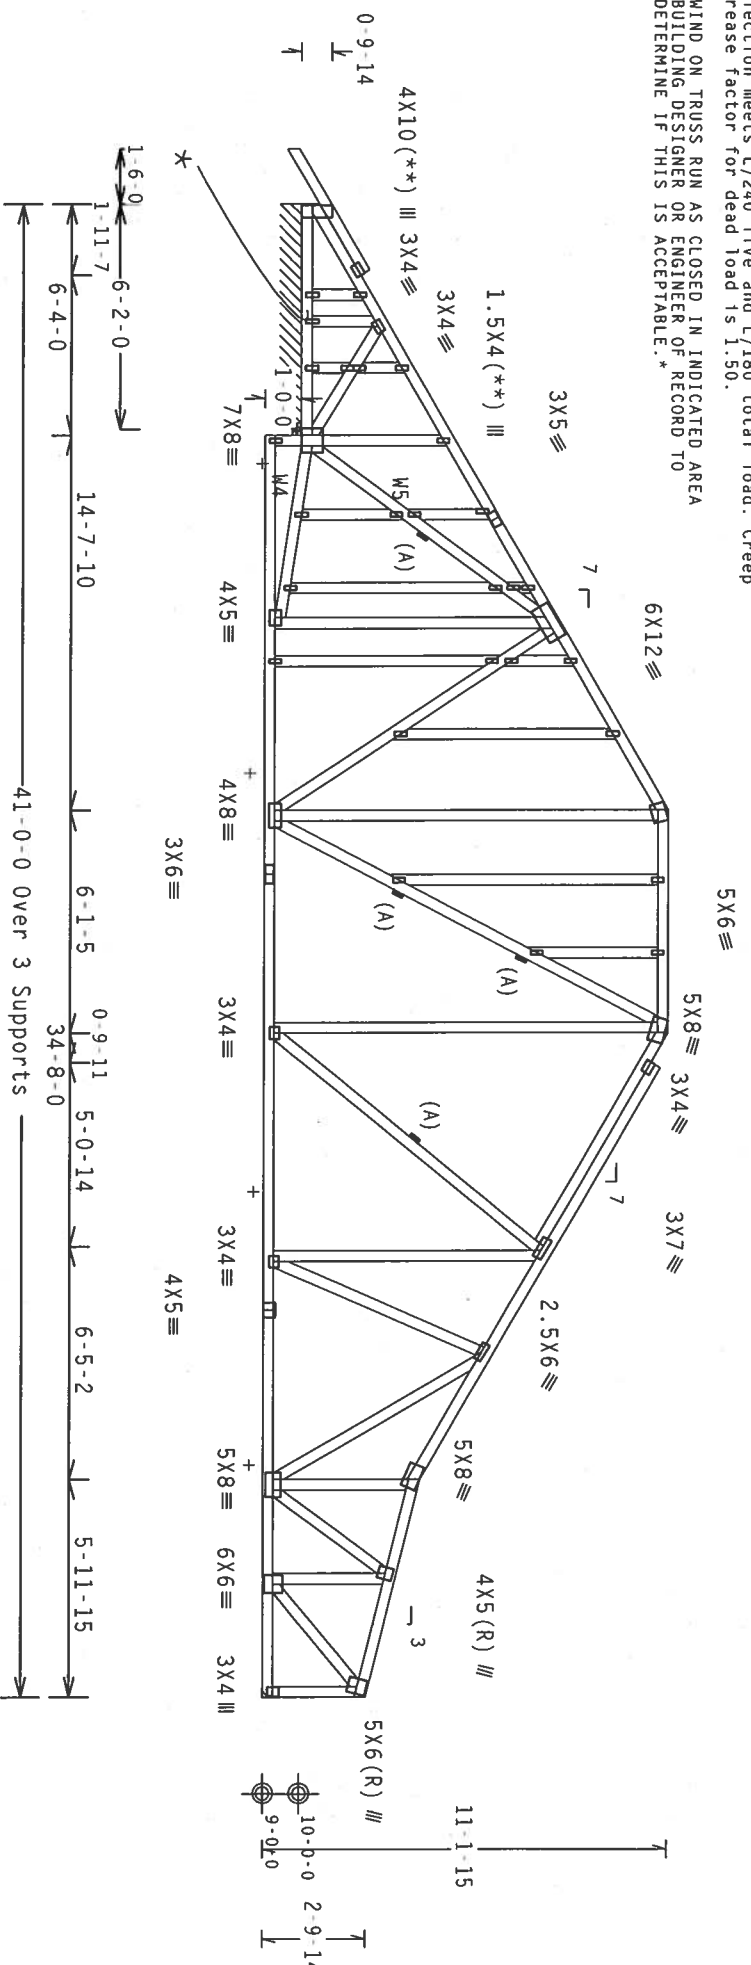

R=55 PLF U-5 PLF W-6-0-0
R=3520 U-234 W-4*

R=2529 U-150

Note: All Plates Are 1.5X4 Except As Shown.
PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10(0)

7.36.04

FL/-4/-/-/R/-

Scale = .1875"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN ERECTION, HANDLING, SHIPPING, INSTALLING AND BRACING.
REFER TO BCSI (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY THE NATIONAL ASSOCIATION OF BUILDING
NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22304 AND WICK (WOOD TRUSS COUNCIL OF AMERICA), 6300
ENTERPRISE LANE, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS
OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE
A PROPERLY ATTACHED RIGID CEILING.


IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR, JTW BCG, INC. SHALL NOT
BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH
TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.
DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF WDS (NATIONAL DESIGN SPEC. BY AIA) AND TPI.
CONNECTOR PLATES ARE MADE OF 2018/1604 (W/MS/S/S) ASTM A553 GRADE 40/60 (W/MS/S) GALV. STEEL. APPLY
LATERAL BRACING TO ALL TRUSSES AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWINGS 1604.2,
1604.3, 1604.4, 1604.5, 1604.6, 1604.7, 1604.8, 1604.9, 1604.10, 1604.11, 1604.12, 1604.13, 1604.14, 1604.15, 1604.16, 1604.17,
1604.18, 1604.19, 1604.20, 1604.21, 1604.22, 1604.23, 1604.24, 1604.25, 1604.26, 1604.27, 1604.28, 1604.29, 1604.30, 1604.31,
1604.32, 1604.33, 1604.34, 1604.35, 1604.36, 1604.37, 1604.38, 1604.39, 1604.40, 1604.41, 1604.42, 1604.43, 1604.44, 1604.45,
1604.46, 1604.47, 1604.48, 1604.49, 1604.50, 1604.51, 1604.52, 1604.53, 1604.54, 1604.55, 1604.56, 1604.57, 1604.58, 1604.59, 1604.60,
1604.61, 1604.62, 1604.63, 1604.64, 1604.65, 1604.66, 1604.67, 1604.68, 1604.69, 1604.70, 1604.71, 1604.72, 1604.73, 1604.74, 1604.75,
1604.76, 1604.77, 1604.78, 1604.79, 1604.80, 1604.81, 1604.82, 1604.83, 1604.84, 1604.85, 1604.86, 1604.87, 1604.88, 1604.89, 1604.90,
1604.91, 1604.92, 1604.93, 1604.94, 1604.95, 1604.96, 1604.97, 1604.98, 1604.99, 1604.100, 1604.101, 1604.102, 1604.103, 1604.104,
1604.105, 1604.106, 1604.107, 1604.108, 1604.109, 1604.110, 1604.111, 1604.112, 1604.113, 1604.114, 1604.115, 1604.116, 1604.117,
1604.118, 1604.119, 1604.120, 1604.121, 1604.122, 1604.123, 1604.124, 1604.125, 1604.126, 1604.127, 1604.128, 1604.129, 1604.130,
1604.131, 1604.132, 1604.133, 1604.134, 1604.135, 1604.136, 1604.137, 1604.138, 1604.139, 1604.140, 1604.141, 1604.142, 1604.143,
1604.144, 1604.145, 1604.146, 1604.147, 1604.148, 1604.149, 1604.150, 1604.151, 1604.152, 1604.153, 1604.154, 1604.155, 1604.156,
1604.157, 1604.158, 1604.159, 1604.160, 1604.161, 1604.162, 1604.163, 1604.164, 1604.165, 1604.166, 1604.167, 1604.168, 1604.169,
1604.170, 1604.171, 1604.172, 1604.173, 1604.174, 1604.175, 1604.176, 1604.177, 1604.178, 1604.179, 1604.180, 1604.181, 1604.182,
1604.183, 1604.184, 1604.185, 1604.186, 1604.187, 1604.188, 1604.189, 1604.190, 1604.191, 1604.192, 1604.193, 1604.194, 1604.195,
1604.196, 1604.197, 1604.198, 1604.199, 1604.200, 1604.201, 1604.202, 1604.203, 1604.204, 1604.205, 1604.206, 1604.207, 1604.208,
1604.209, 1604.210, 1604.211, 1604.212, 1604.213, 1604.214, 1604.215, 1604.216, 1604.217, 1604.218, 1604.219, 1604.220, 1604.221,
1604.222, 1604.223, 1604.224, 1604.225, 1604.226, 1604.227, 1604.228, 1604.229, 1604.230, 1604.231, 1604.232, 1604.233, 1604.234,
1604.235, 1604.236, 1604.237, 1604.238, 1604.239, 1604.240, 1604.241, 1604.242, 1604.243, 1604.244, 1604.245, 1604.246, 1604.247,
1604.248, 1604.249, 1604.250, 1604.251, 1604.252, 1604.253, 1604.254, 1604.255, 1604.256, 1604.257, 1604.258, 1604.259, 1604.260,
1604.261, 1604.262, 1604.263, 1604.264, 1604.265, 1604.266, 1604.267, 1604.268, 1604.269, 1604.270, 1604.271, 1604.272, 1604.273,
1604.274, 1604.275, 1604.276, 1604.277, 1604.278, 1604.279, 1604.280, 1604.281, 1604.282, 1604.283, 1604.284, 1604.285, 1604.286,
1604.287, 1604.288, 1604.289, 1604.290, 1604.291, 1604.292, 1604.293, 1604.294, 1604.295, 1604.296, 1604.297, 1604.298, 1604.299,
1604.300, 1604.301, 1604.302, 1604.303, 1604.304, 1604.305, 1604.306, 1604.307, 1604.308, 1604.309, 1604.310, 1604.311, 1604.312,
1604.313, 1604.314, 1604.315, 1604.316, 1604.317, 1604.318, 1604.319, 1604.320, 1604.321, 1604.322, 1604.323, 1604.324, 1604.325,
1604.326, 1604.327, 1604.328, 1604.329, 1604.330, 1604.331, 1604.332, 1604.333, 1604.334, 1604.335, 1604.336, 1604.337, 1604.338,
1604.339, 1604.340, 1604.341, 1604.342, 1604.343, 1604.344, 1604.345, 1604.346, 1604.347, 1604.348, 1604.349, 1604.350, 1604.351,
1604.352, 1604.353, 1604.354, 1604.355, 1604.356, 1604.357, 1604.358, 1604.359, 1604.360, 1604.361, 1604.362, 1604.363, 1604.364,
1604.365, 1604.366, 1604.367, 1604.368, 1604.369, 1604.370, 1604.371, 1604.372, 1604.373, 1604.374, 1604.375, 1604.376, 1604.377,
1604.378, 1604.379, 1604.380, 1604.381, 1604.382, 1604.383, 1604.384, 1604.385, 1604.386, 1604.387, 1604.388, 1604.389, 1604.390,
1604.391, 1604.392, 1604.393, 1604.394, 1604.395, 1604.396, 1604.397, 1604.398, 1604.399, 1604.400, 1604.401, 1604.402, 1604.403,
1604.404, 1604.405, 1604.406, 1604.407, 1604.408, 1604.409, 1604.410, 1604.411, 1604.412, 1604.413, 1604.414, 1604.415, 1604.416,
1604.417, 1604.418, 1604.419, 1604.420, 1604.421, 1604.422, 1604.423, 1604.424, 1604.425, 1604.426, 1604.427, 1604.428, 1604.429,
1604.430, 1604.431, 1604.432, 1604.433, 1604.434, 1604.435, 1604.436, 1604.437, 1604.438, 1604.439, 1604.440, 1604.441, 1604.442,
1604.443, 1604.444, 1604.445, 1604.446, 1604.447, 1604.448, 1604.449, 1604.450, 1604.451, 1604.452, 1604.453, 1604.454, 1604.455,
1604.456, 1604.457, 1604.458, 1604.459, 1604.460, 1604.461, 1604.462, 1604.463, 1604.464, 1604.465, 1604.466, 1604.467, 1604.468,
1604.469, 1604.470, 1604.471, 1604.472, 1604.473, 1604.474, 1604.475, 1604.476, 1604.477, 1604.478, 1604.479, 1604.480, 1604.481,
1604.482, 1604.483, 1604.484, 1604.485, 1604.486, 1604.487, 1604.488, 1604.489, 1604.490, 1604.491, 1604.492, 1604.493, 1604.494,
1604.495, 1604.496, 1604.497, 1604.498, 1604.499, 1604.500, 1604.501, 1604.502, 1604.503, 1604.504, 1604.505, 1604.506, 1604.507,
1604.508, 1604.509, 1604.510, 1604.511, 1604.512, 1604.513, 1604.514, 1604.515, 1604.516, 1604.517, 1604.518, 1604.519, 1604.520,
1604.521, 1604.522, 1604.523, 1604.524, 1604.525, 1604.526, 1604.527, 1604.528, 1604.529, 1604.530, 1604.531, 1604.532, 1604.533,
1604.534, 1604.535, 1604.536, 1604.537, 1604.538, 1604.539, 1604.540, 1604.541, 1604.542, 1604.543, 1604.544, 1604.545, 1604.546,
1604.547, 1604.548, 1604.549, 1604.550, 1604.551, 1604.552, 1604.553, 1604.554, 1604.555, 1604.556, 1604.557, 1604.558, 1604.559,
1604.560, 1604.561, 1604.562, 1604.563, 1604.564, 1604.565, 1604.566, 1604.567, 1604.568, 1604.569, 1604.570, 1604.571, 1604.572,
1604.573, 1604.574, 1604.575, 1604.576, 1604.577, 1604.578, 1604.579, 1604.580, 1604.581, 1604.582, 1604.583, 1604.584, 1604.585,
1604.586, 1604.587, 1604.588, 1604.589, 1604.590, 1604.591, 1604.592, 1604.593, 1604.594, 1604.595, 1604.596, 1604.597, 1604.598,
1604.599, 1604.600, 1604.601, 1604.602, 1604.603, 1604.604, 1604.605, 1604.606, 1604.607, 1604.608, 1604.609, 1604.610, 1604.611,
1604.612, 1604.613, 1604.614, 1604.615, 1604.616, 1604.617, 1604.618, 1604.619, 1604.620, 1604.621, 1604.622, 1604.623, 1604.624,
1604.625, 1604.626, 1604.627, 1604.628, 1604.629, 1604.630, 1604.631, 1604.632, 1604.633, 1604.634, 1604.635, 1604.636, 1604.637,
1604.638, 1604.639, 1604.640, 1604.641, 1604.642, 1604.643, 1604.644, 1604.645, 1604.646, 1604.647, 1604.648, 1604.649, 1604.650,
1604.651, 1604.652, 1604.653, 1604.654, 1604.655, 1604.656, 1604.657, 1604.658, 1604.659, 1604.660, 1604.661, 1604.662, 1604.663,
1604.664, 1604.665, 1604.666, 1604.667, 1604.668, 1604.669, 1604.670, 1604.671, 1604.672, 1604.673, 1604.674, 1604.675, 1604.676,
1604.677, 1604.678, 1604.679, 1604.680, 1604.681, 1604.682, 1604.683, 1604.684, 1604.685, 1604.686, 1604.687, 1604.688, 1604.689,
1604.690, 1604.691, 1604.692, 1604.693, 1604.694, 1604.695, 1604.696, 1604.697, 1604.698, 1604.699, 1604.700, 1604.701, 1604.702,
1604.703, 1604.704, 1604.705, 1604.706, 1604.707, 1604.708, 1604.709, 1604.710, 1604.711, 1604.712, 1604.713, 1604.714, 1604.715,
1604.716, 1604.717, 1604.718, 1604.719, 1604.720, 1604.721, 1604.722, 1604.723, 1604.724, 1604.725, 1604.726, 1604.727, 1604.728,
1604.729, 1604.730, 1604.731, 1604.732, 1604.733, 1604.734, 1604.735, 1604.736, 1604.737, 1604.738, 1604.739, 1604.740, 1604.741,
1604.742, 1604.743, 1604.744, 1604.745, 1604.746, 1604.747, 1604.748, 1604.749, 1604.750, 1604.751, 1604.752, 1604.753, 1604.754,
1604.755, 1604.756, 1604.757, 1604.758, 1604.759, 1604.760, 1604.761, 1604.762, 1604.763, 1604.764, 1604.765, 1604.766, 1604.767,
1604.768, 1604.769, 1604.770, 1604.771, 1604.772, 1604.773, 1604.774, 1604.775, 1604.776, 1604.777, 1604.778, 1604.779, 1604.780,
1604.781, 1604.782, 1604.783, 1604.784, 1604.785, 1604.786, 1604.787, 1604.788, 1604.789, 1604.790, 1604.791, 1604.792, 1604.793,
1604.794, 1604.795, 1604.796, 1604.797, 1604.798, 1604.799, 1604.800, 1604.801, 1604.802, 1604.803, 1604.804, 1604.805, 1604.806,
1604.807, 1604.808, 1604.809, 1604.810, 1604.811, 1604.812, 1604.813, 1604.814, 1604.815, 1604.816, 1604.817, 1604.818, 1604.819,
1604.820, 1604.821, 1604.822, 1604.823, 1604.824, 1604.825, 1604.826, 1604.827, 1604.828, 1604.829, 1604.830, 1604.831, 1604.832,
1604.833, 1604.834, 1604.835, 1604.836, 1604.837, 1604.838, 1604.839, 1604.840, 1604.841, 1604.842, 1604.843, 1604.844, 1604.845,
1604.846, 1604.847, 1604.848, 1604.849, 1604.850, 1604.851, 1604.852, 1604.853, 1604.854, 1604.855, 1604.856, 1604.857, 1604.858,
1604.859, 1604.860, 1604.861, 1604.862, 1604.863, 1604.864, 1604.865, 1604.866, 1604.867, 1604.868, 1604.869, 1604.870, 1604.871,
1604.872, 1604.873, 1604.874, 1604.875, 1604.876, 1604.877, 1604.878, 1604.879, 1604.880, 1604.881, 1604.882, 1604.883, 1604.884,
1604.885, 1604.886, 1604.887, 1604.888, 1604.889, 1604.890, 1604.891, 1604.892, 1604.893, 1604.894, 1604.895, 1604.896, 1604.897,
1604.898, 1604.899, 1604.900, 1604.901, 1604.902, 1604.903, 1604.904, 1604.905, 1604.906, 1604.907, 1604.908, 1604.909, 1604.910,
1604.911, 1604.912, 1604.913, 1604.914, 1604.915, 1604.916, 1604.917, 1604.918, 1604.919, 1604.920, 1604.921, 1604.922, 1604.923,
1604.924, 1604.925, 1604.926, 1604.927, 1604.928, 1604.929, 1604.930, 1604.931, 1604.932, 1604.933, 1604.934, 1604.935, 1604.936,
1604.937, 1604.938, 1604.939, 1604.940, 1604.941, 1604.942, 1604.943, 1604.944, 1604.945, 1604.946, 1604.947, 1604.948, 1604.949,
1604.950, 1604.951, 1604.952, 1604.953, 1604.954, 1604.955, 1604.956, 1604.957, 1604.958, 1604.959, 1604.960, 1604.961, 1604.962,
1604.963, 1604.964, 1604.965, 1604.966, 1604.967, 1604.968, 1604.969, 1604.970, 1604.971, 1604.972, 1604.973, 1604.974, 1604.975,
1604.976, 1604.977, 1604.978, 1604.979, 1604.980, 1604.981, 1604.982, 1604.983, 1604.984, 1604.985, 1604.986, 1604.987, 1604.988,
1604.989, 1604.990, 1604.991, 1604.992, 1604.993, 1604.994, 1604.995, 1604.996, 1604.997, 1604.998, 1604.999, 1605.000, 1605.001,
1605.002, 1605.003, 1605.004, 1605.005, 1605.006, 1605.007, 1605.008, 1605.009, 1605.010, 1605.011, 1605.012, 1605.013, 1605.014,
1605.015, 1605.016, 1605.017, 1605.018, 1605.019, 1605.020, 1605.0

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

Wind reactions based on MMFRS pressures.

(A) Continuous lateral bracing equally spaced on member.

(**) 4 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.
110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ $G_{CPI}(+/-)=0.18$
Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.

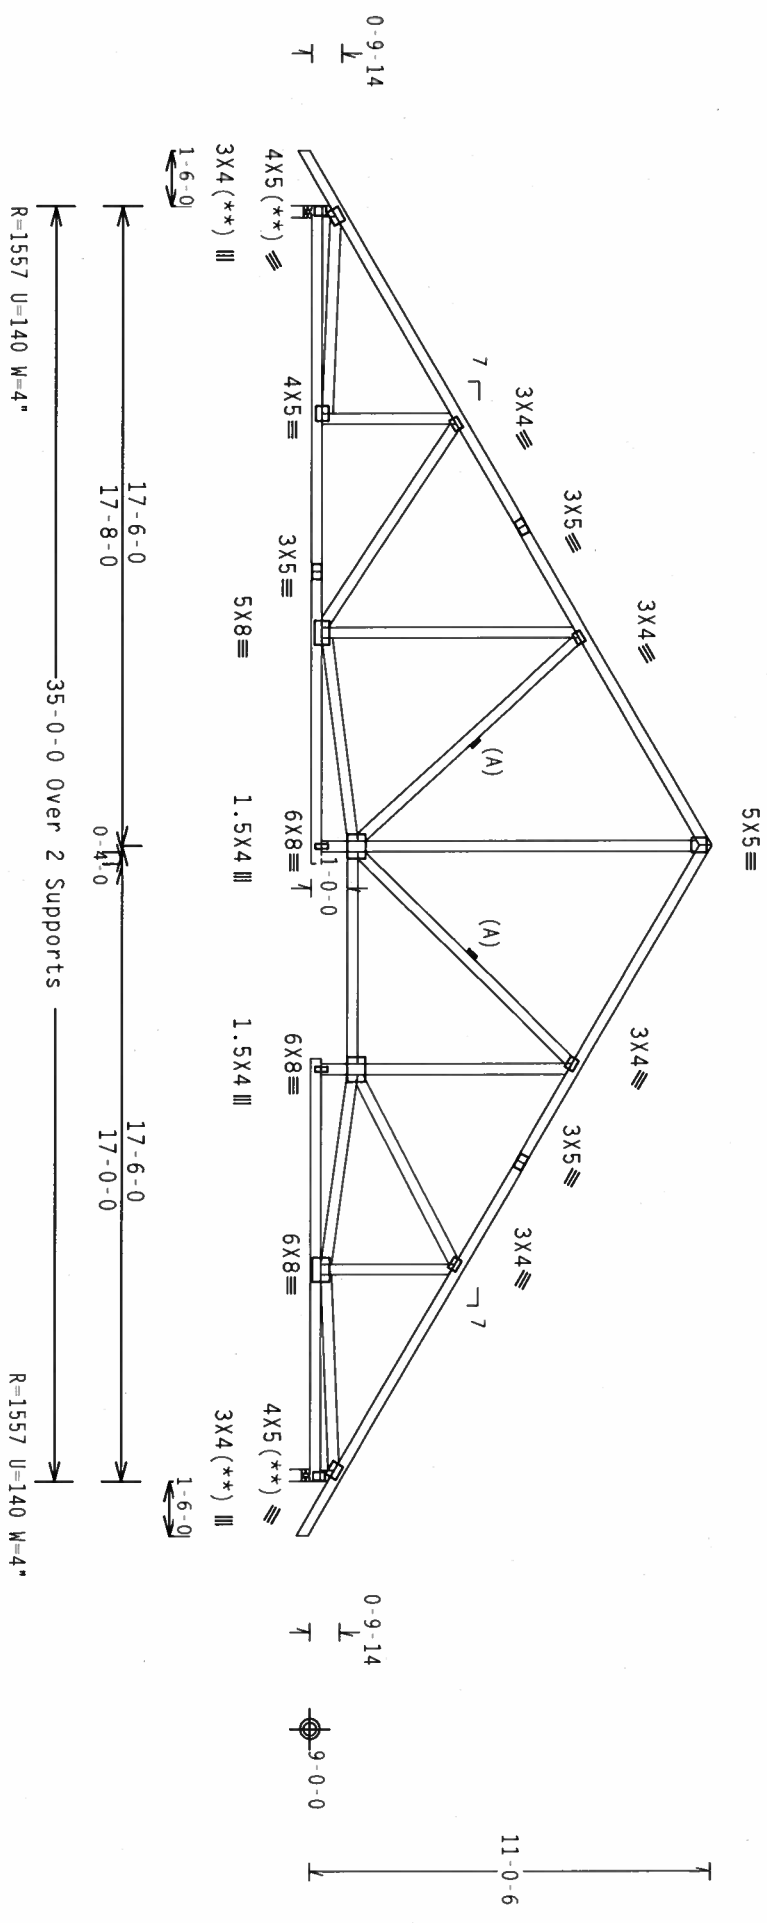

PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
 $C_q/RT=1.00(1.25)/10(0)$

7.36.04


Scale = .1875"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCSI (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY TPI TRUSS PLATE INSTITUTE, 216 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22304 AND NCA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LANE, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.


IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY ACPA) AND TPI. ITW BCG CONNECTOR PLATES ARE MADE OF 2018/1604 (W/55%) ASTM A653 GRADE 40/60 (K, K/H-55) GALV. STEEL. APPLY PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWINGS 160A-2.

INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE PER AMER AS OF TPI-2002 SEC.3. A SEAL ON THIS DRAWING INDICATES THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.



ITW Building Components Group, Inc.
Haines City, FL 33844




TC LL	20.0 PSF	REF	R8228 - 79455
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCUSR8228 07162008
BC LL	0.0 PSF	HC-ENG	MNM/AF
TOT.LD.	40.0 PSF	SEQN	17602
DUR.FAC.	1.25		
SPACING	24.0"	JREF	1T848228Z01

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

Wind reactions based on MWFRS pressures.

(A) Continuous lateral bracing equally spaced on member.

(**) 4 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.
110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCPI(+/-)=0.18
Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.

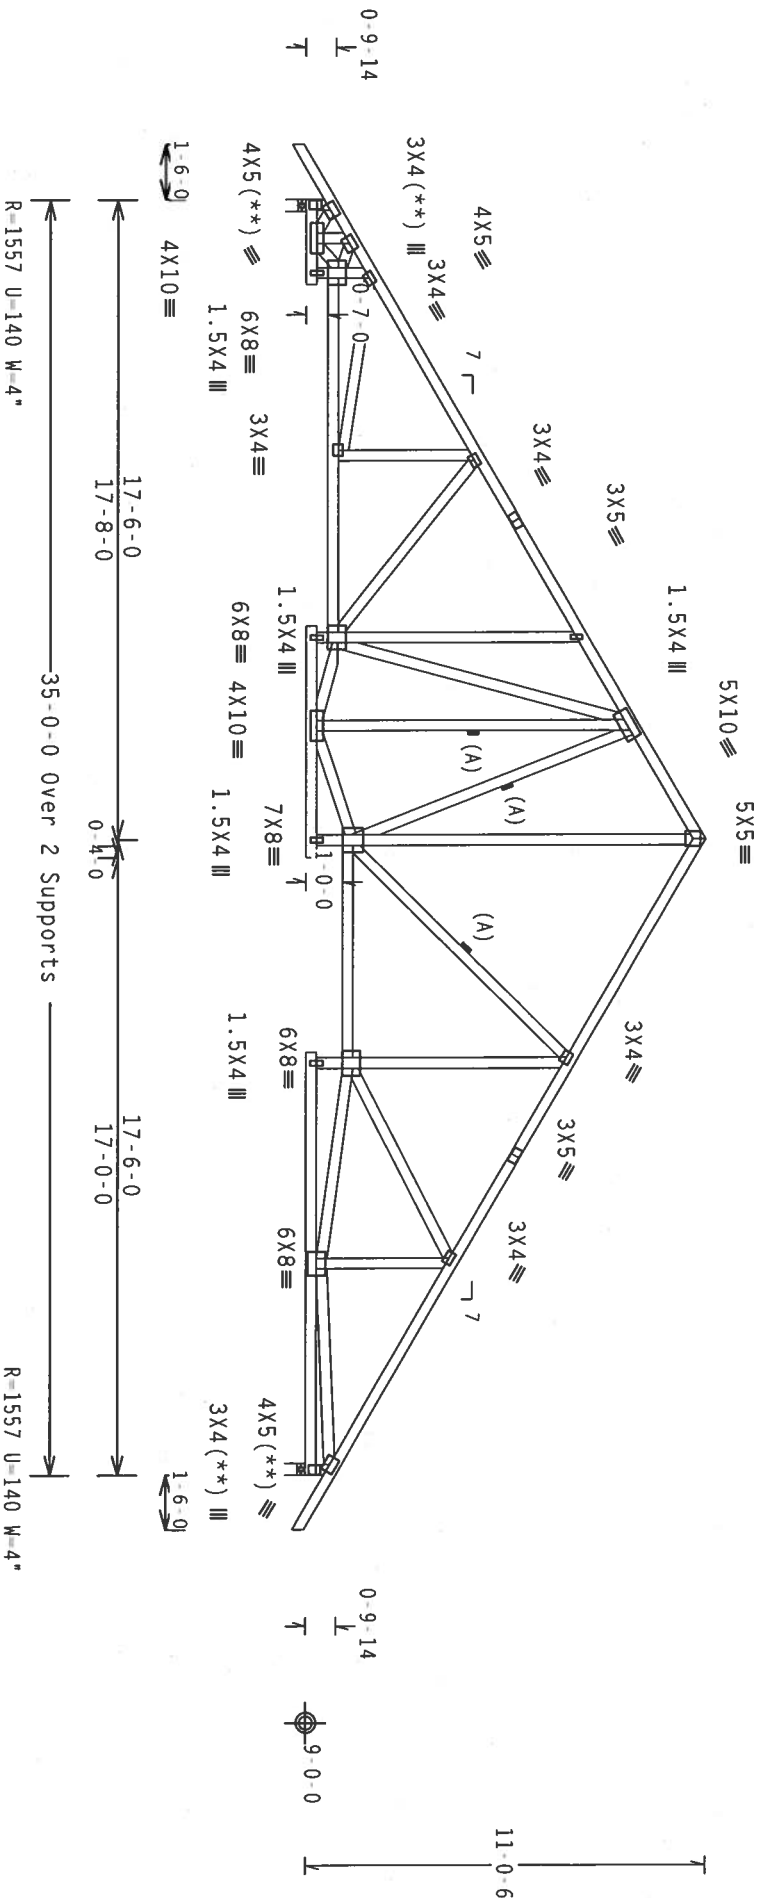

PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10(0)

TY:1 FL/-/4/-/-/R/-


Scale = .1875"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BC31 (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY TPI TRUSS PLATE INSTITUTE, 5300 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22304, AND NCA (NATIONAL TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LANE, MADISON, WI, 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSULATION CONTRACTOR. ITW BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES. DESIGN COMPLIES WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AIA/AS) AND TPI. ITW BCG CONNECTIONS ARE MADE OF 20/18/16GA (W/H/ST/ST) ASH A653 GRADE 40/60 (W, K/H-SS) GALV. STEEL. APPLY PLATES TO EACH FACE OF TRUSS AND UNLESS OTHERWISE SPECIFIED ON THIS DESIGN, POSITION PER DRAWINGS 160A-Z. THIS DESIGN IS THE PROPERTY OF ITW BUILDING COMPONENTS GROUP, INC. AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF ITW BUILDING COMPONENTS GROUP, INC. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

ALPINE

ITW Building Components Group, Inc.
Haines City, FL 33844



TC LL	20.0 PSF	REF	R8228-79456
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCUSR8228 07162009
BC LL	0.0 PSF	HC-ENG	MNM/AF
TOT.LD.	40.0 PSF	SEQN-	17624
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1T848228Z01

(**) 4 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, not located within 4.50 ft from roof edge, CAT 11, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. IW=1.00 Gcp1(+)=0.18

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.




TC LL	20.0 PSF	REF	R8228 - 79457
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCUSR8228 0716c010
BC LL	0.0 PSF	HC-ENG	MNM/AF
TOT.LD.	40.0 PSF	SEQN -	17639
DUR.FAC.	1.25		
SPACING	24.0"	JREF -	1T848228Z01

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3
:Rt Bearing Leg 2x6 SP #2:

Wind reactions based on MMFRS pressures.

(A) Continuous lateral bracing equally spaced on member.

(**) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.
110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $1W=1.00 GCPi(+/-)=0.18$
Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.

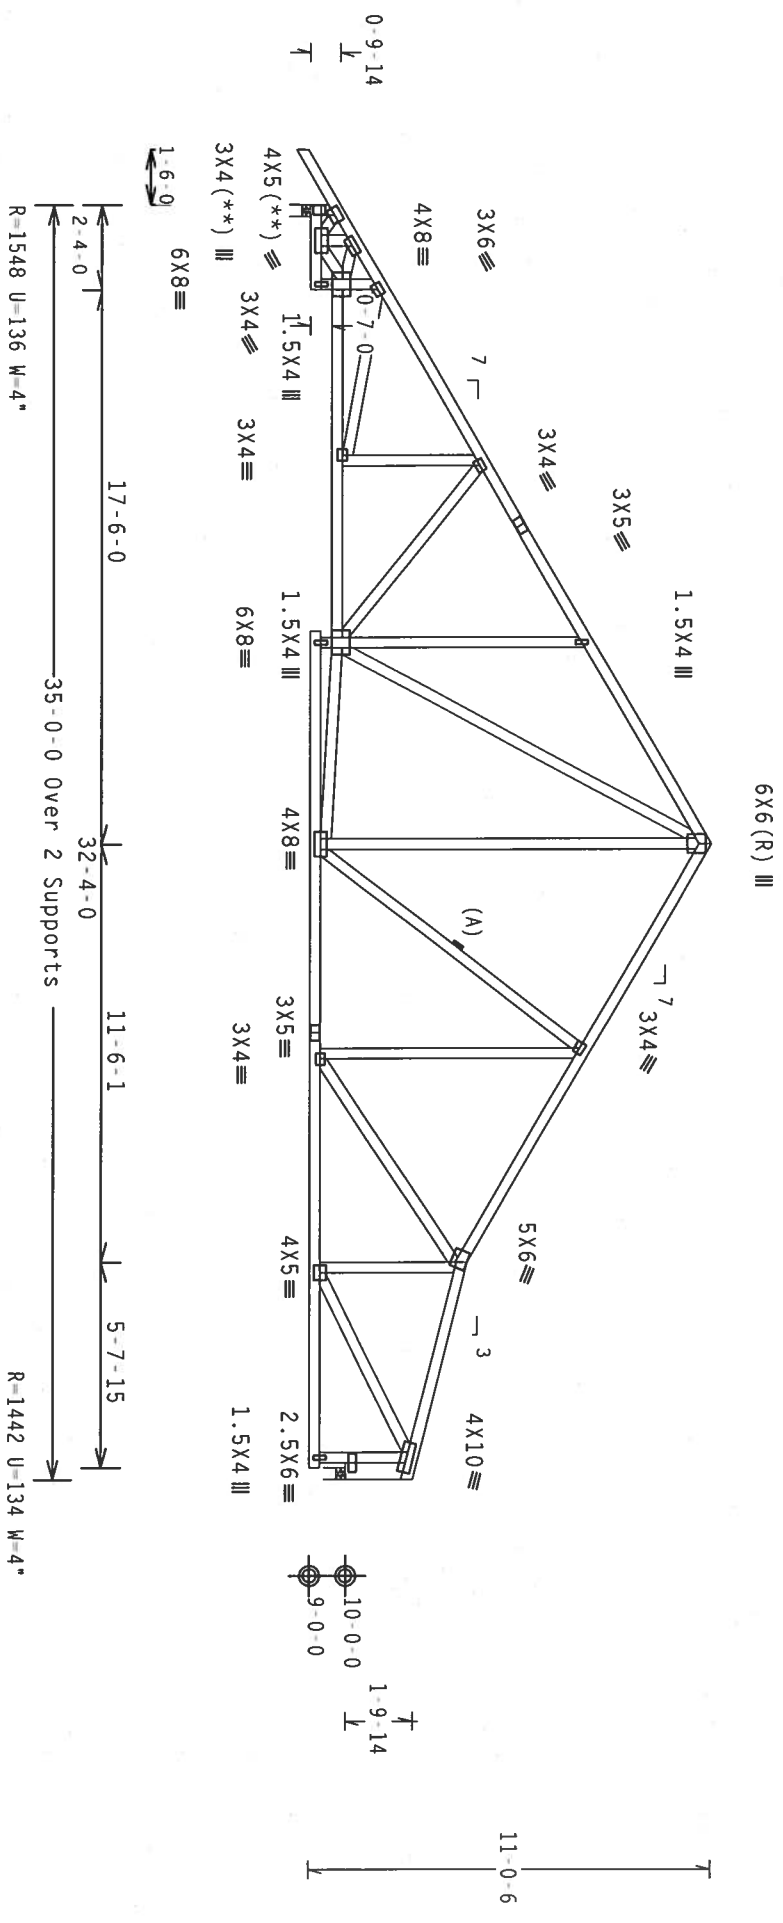

PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10(0)



FL/-/4/-/R/-

Scale =.1875"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCSI TRUSSING COMPONENT SAFETY INFORMATION, PUBLISHED BY BCSI, 5500 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22304 AND WICKIWOOD TRUSS COMPANY OF AMERICA, 6500 ENTERPRISE LANE, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AIAA) AND TPI. ITW BCG CORP. TRUSSES ARE MADE OF 20/18/16GA (W/H/55/S) ASTM A653 GRADE 40/60 (W, K/H/55) GALV. STEEL. APPLY PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWINGS 160A, Z. ANY INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE PERFORMED AS OF TPI-2002 SEC.3. A SEAL ON THIS DRAWING AND SIGNATURE OF THE DESIGNER SHALL BE REQUIRED. THE DESIGNER SHALL BE RESPONSIBLE FOR THE TRUSS COMPONENT DESIGN AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

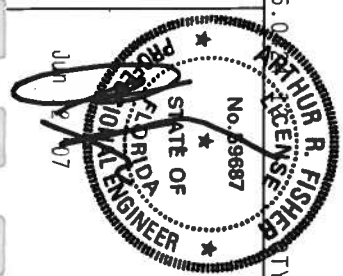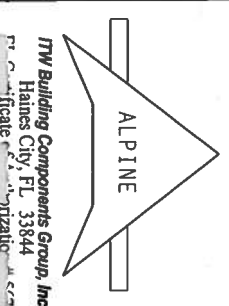

TC LL	20.0 PSF	REF	R8228-79458
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCSR8228 07162011
BC LL	0.0 PSF	HC-ENG	MNM/AF
TOT. LD.	40.0 PSF	SEQN-	17678
DUR. FAC.	1.25		
SPACING	24.0"	JREF-	1T848228Z01

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, located anywhere in roof, CAT 11, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ Gcpi (+/-)=0.18

(**) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.

Truss spaced at 24.0" OC designed to support 1-0-0 top chord outlookers. Cladding load shall not exceed 10.00 PSF. Top chord must not be cut or notched.

TRUSS IS NOT DESIGNED FOR LATERAL WIND PRESSURE APPLIED TO THE FACE. ANY LATERAL LOAD FROM WIND MUST BE

(A) Continuous lateral bracing equally spaced on member.

 $Cq/RT=1.00(1.25)/10(0)$

ANSWER

FL/-/4/-/-/R/-

Scale = .1875"/Ft.

STATE OF
No. 59687
★ ★ ★

SHALL NOT

11M BCG
CELL. APPLY
NGS 160A-2

12 '07

ITY OF THE

Scale = .1875"/Ft.

REF R8228 - 79459

DATE 06/11/07

06/11/01 DBH WUWDBB00 0710001

DRW HCU8K8228 0/1620

HC-ENG MNM/AF

SEQN - 17693 RE


JREF - 1T848228701

[illegible]

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

Wind reactions based on MFRS pressures.

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg,
located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf,
wind BC DL=5.0 psf. IW=1.00 GCPI(+/-)=0.18
Deflection meets L/240 live and L/180 total load. Creep
increase factor for dead load is 1.50.

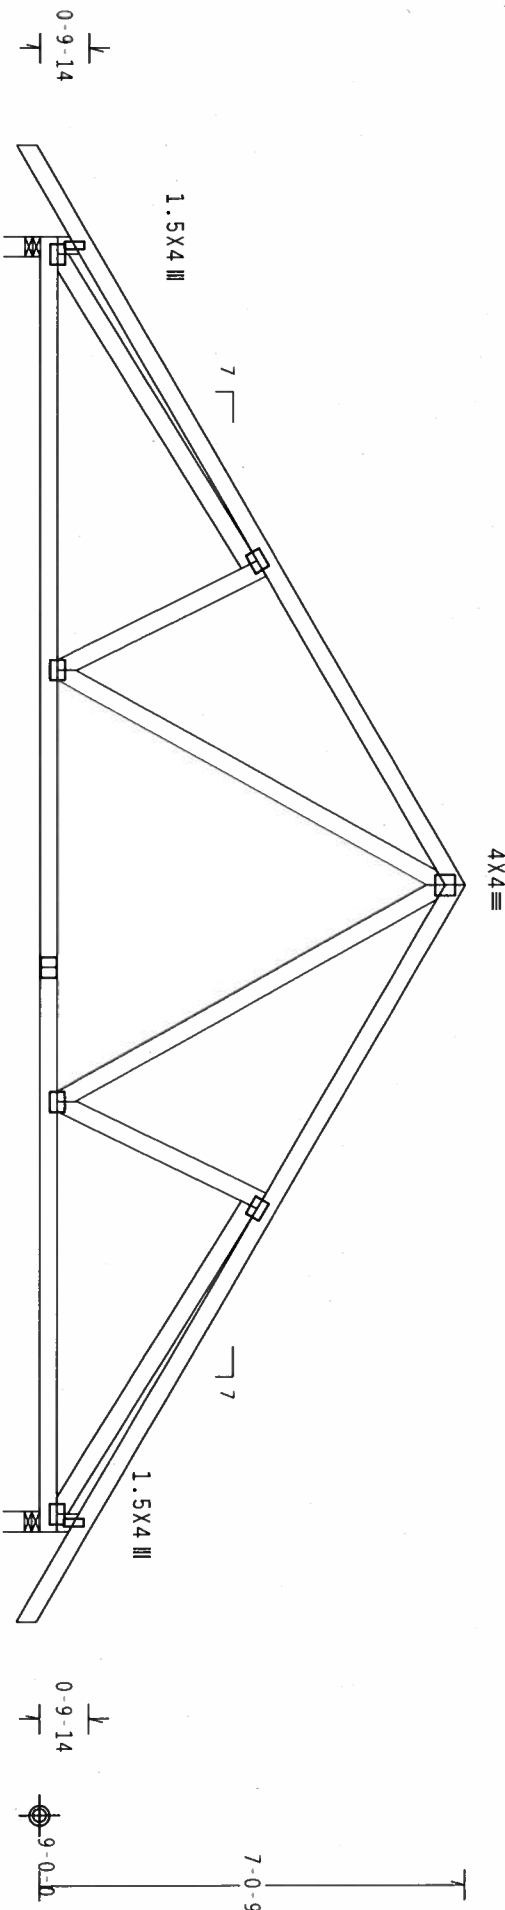

1-6-0
10-8-0
21-4-0 Over 2 Supports
10-8-0
1-6-0
R=989 U=92 W=4"
R=989 U=92 W=4"

Note: All Plates Are 3x4 Except As Shown.

PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10(0)


7.36.0

FL/-/4/-/R/-


Scale = .3125"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCSI (BUILDING COMPONENT SAFETY INSTITUTE), PUBLISHED BY TPI (TRUSS PLATE INSTITUTE), 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22304 AND WICA (WOOD TRUSS COUNCIL OF AMERICA), 6300 ENTERPRISE LANE, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI, OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES. ITW BCG DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF AWS (NATIONAL DESIGN SPEC. BY AISC) AND TPI. ITW BCG CONNECTION PLATES ARE MADE OF 2010/1604 (W/5/5/5) ASTM A653 GRADE 40/60 (W, K/H, S5) GALV. STEEL. APPLY ANY INSPECTION OF PLATES FOLLOWED BY PROFESSIONAL ENGINEERING RESPONSIBILITY SOCIETY FOR THE TRUSS COMPONENT DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.



ITW Building Components Group, Inc.
Haines City, FL 33844

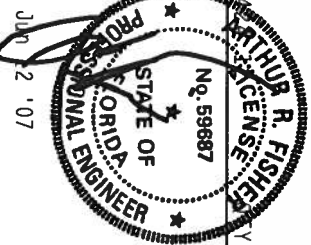

TC LL	20.0 PSF	REF	R8228-79460
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCSR8228 07162013
BC LL	0.0 PSF	HC-ENG	MNM/AF
TOT.LD.	40.0 PSF	SEON	17583
DUR.FAC.	1.25		
SPACING	24.0"	JREF	-1T848228Z01

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

Wind reactions based on MWFRS pressures.


Truss spaced at 24.0" OC designed to support 1-0-0 top chord
outlookers. Cladding load shall not exceed 10.00 PSF. Top chord
must not be cut or notched.

(**) (2) plate(s) require special positioning. Refer to
scaled plate plot details for special positioning
requirements.

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg,
located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf,
wind BC DL=5.0 psf. IW=1.00 GCPI(+/-)=0.18

See DWGS A11015EE0207 & GBLETTIN0207 for more requirements.

Deflection meets L/240 live and L/180 total load. Creep
increase factor for dead load is 1.50.

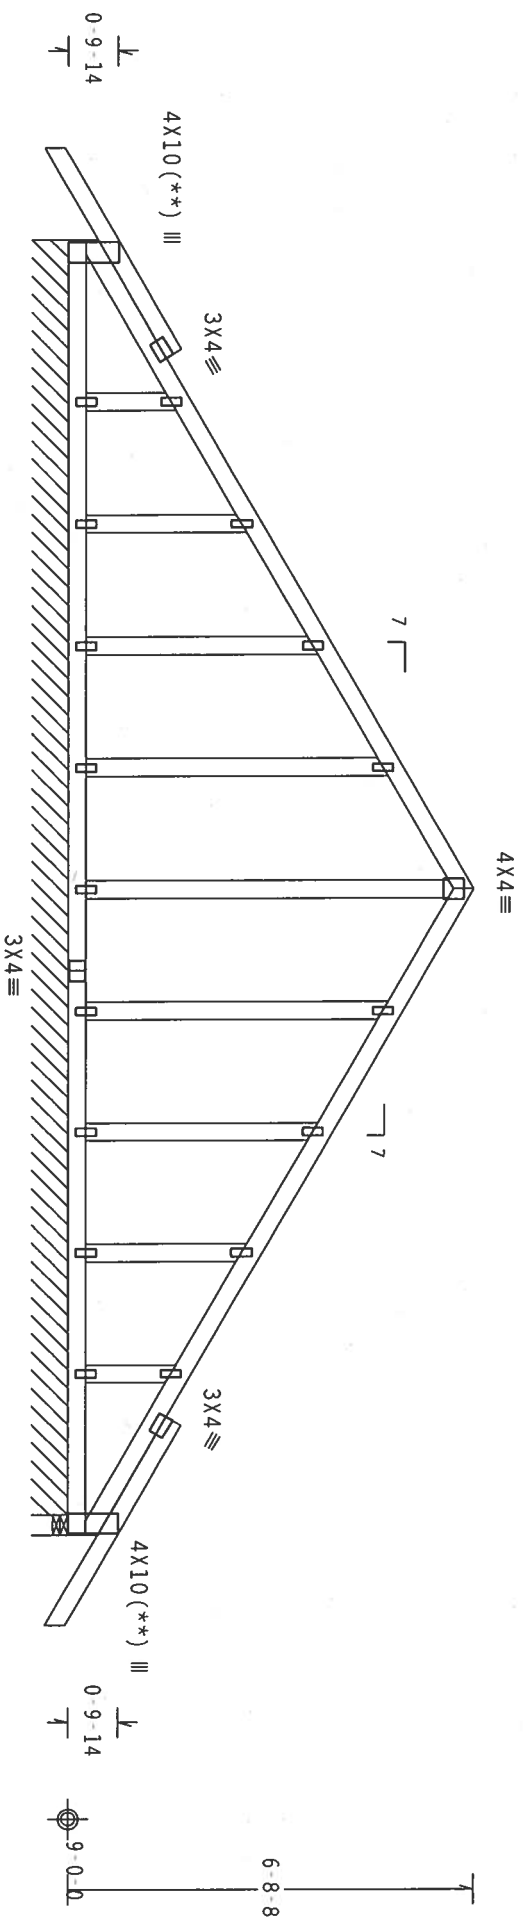

1-6-0
1-11-7
8-8-9
21-4-0 Over 2 Supports
R=115 PLF U=14 PLF W=21-0-0
R=324 U=9 W=4"

Note: All Plates Are 1.5X4 Except As Shown.


PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10(0)

7.36.00 RT HUR R. FISHER
No. 59687
STATE OF FLORIDA
Professional Engineer
JUL 12 '07

Scale = .3125"/ft.

TC LL		20.0 PSF	REF R8228-79461
TC DL		10.0 PSF	DATE 06/11/07
BC DL		10.0 PSF	DRW HCUSR8228 07162014
BC LL		0.0 PSF	HC-ENG MNM/AF
TOT.LD.		40.0 PSF	SEQN- 17589 REV
DUR.FAC.		1.25	
SPACING		24.0"	JREF- 1T848228201

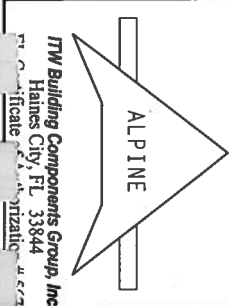

Top chord 2x4 SP #2 Dense
Bot chord 2x6 SP #1 Dense
Webs 2x4 SP #3

:Lt Slider 2x4 SP #3: BLOCK LENGTH = 1.500'
:Rt Slider 2x4 SP #3: BLOCK LENGTH = 1.500'

SPECIAL LOADS

----- (LUMBER DUR.FAC.=1.25 / PLATE DUR.FAC.=1.25)
TC - From 32 PLF at 0.00 to 32 PLF at 14.33
BC - From 10 PLF at 0.00 to 10 PLF at 14.33
BC - 1453 LB Conc. Load at 2.00, 4.00, 6.00, 8.00, 10.00
BC - 2529 LB Conc. Load at 12.00

2 COMPLETE TRUSSES REQUIRED


Nailing Schedule: (10d Box or Gun (0.128"x3", min.) nails)

Top Chord: 1 Row @12.00" o.c.
Bot Chord: 2 Rows @4.50" o.c. (Each Row)
Webs : 1 Row @4" o.c.
Use equal spacing between rows and stagger nails in each row to avoid splitting.

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf.

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.

(A) (1) 2X6X 6-0-0 SP#2 SCAB: ATTACH TO ONE FACE OF TRUSS WITH 16d COMMON(0.162"x3.5") NAILS IN EACH MEMBER COVERED WITHOUT SPLITTING LUMBER.

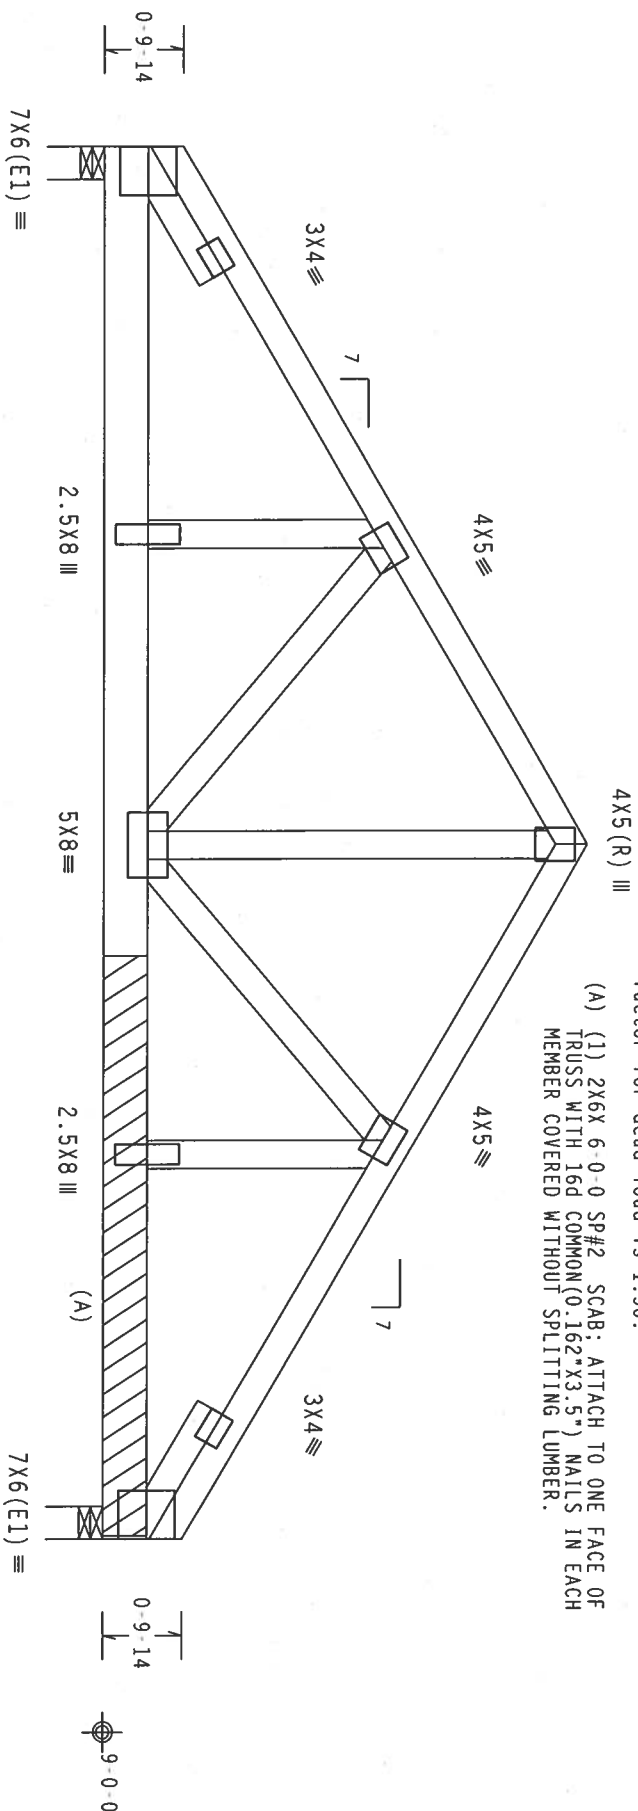

PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10.00



7.25

FL/-/4/-/R/-

Scale = .5"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BC51 (BUILDING COMPONENT SAFETY INFORMATION) PUBLISHED BY TPI TRUSS PLATE INSTITUTE, 2100 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA 22314 AND WCA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LANE, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITM BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE DESIGN OR FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BC51 (BUILDING COMPONENT SAFETY INFORMATION) PUBLISHED BY TPI TRUSS PLATE INSTITUTE, 2100 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA 22314 AND WCA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LANE, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.



ITW Building Components Group, Inc.
Haines City, FL 33844
Certification: 5/1/2007

Jun 1 '07


TC LL	20.0 PSF	REF R8228-79462
TC DL	10.0 PSF	DATE 06/11/07
BC DL	10.0 PSF	DRW HCUSR8228 07162015
BC LL	0.0 PSF	HC-ENG JB/AF
TOT.LD.	40.0 PSF	SEON-105447 REV
DUR.FAC.	1.25	
SPACING	24.0"	JREF-117848228201

THIS WORK PREPARED FROM COMPUTER INPUT (EVALUAS & DIMENSIONS) SUBMITTED BY INASS MEM.

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg,
located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf,
wind BC DL=5.0 psf. $I_w=1.00$ Gcpi (+/-)=0.18

See DWGS A11015EE0207 & GBLETTIN0207 for more requirements.

Deflection meets $L/240$ live and $L/180$ total load. Creep increase factor for dead load is 1.50.

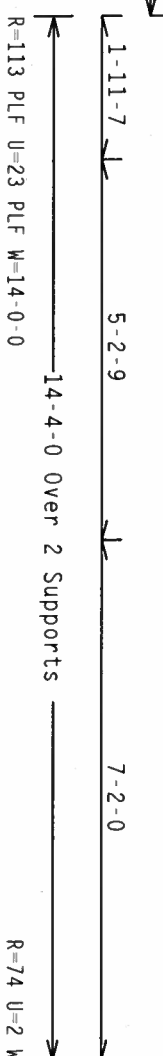Design Crit: $TPI-2002(STD)/FBC$ $Cq/RT=1.00(1.25)/10(0)$

7.36.0

QTY:1

FL/-/4/-/-/R/-

Scale = .375"/Ft.

No. 59687

****IMPORTANT** FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITH BCG, INC. SHALL NOT**




10 2000

TC LL	20.0 PSF	REF	R8228- 79463
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCUSR8228 07162016
BC LL	0.0 PSF	HC-ENG	MNM/AF
TOT.LD.	40.0 PSF	SECN-	17558 REV
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1T848228Z01

(7-166-Cason Construction Grand Ross , ** E)
Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

Wind reactions based on MMFRS pressures.
Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.



(**) 2 plate(s) require special positioning. Refer to scaled plate plot details for special positioning requirements.
110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCp1 (+/-)=0.18

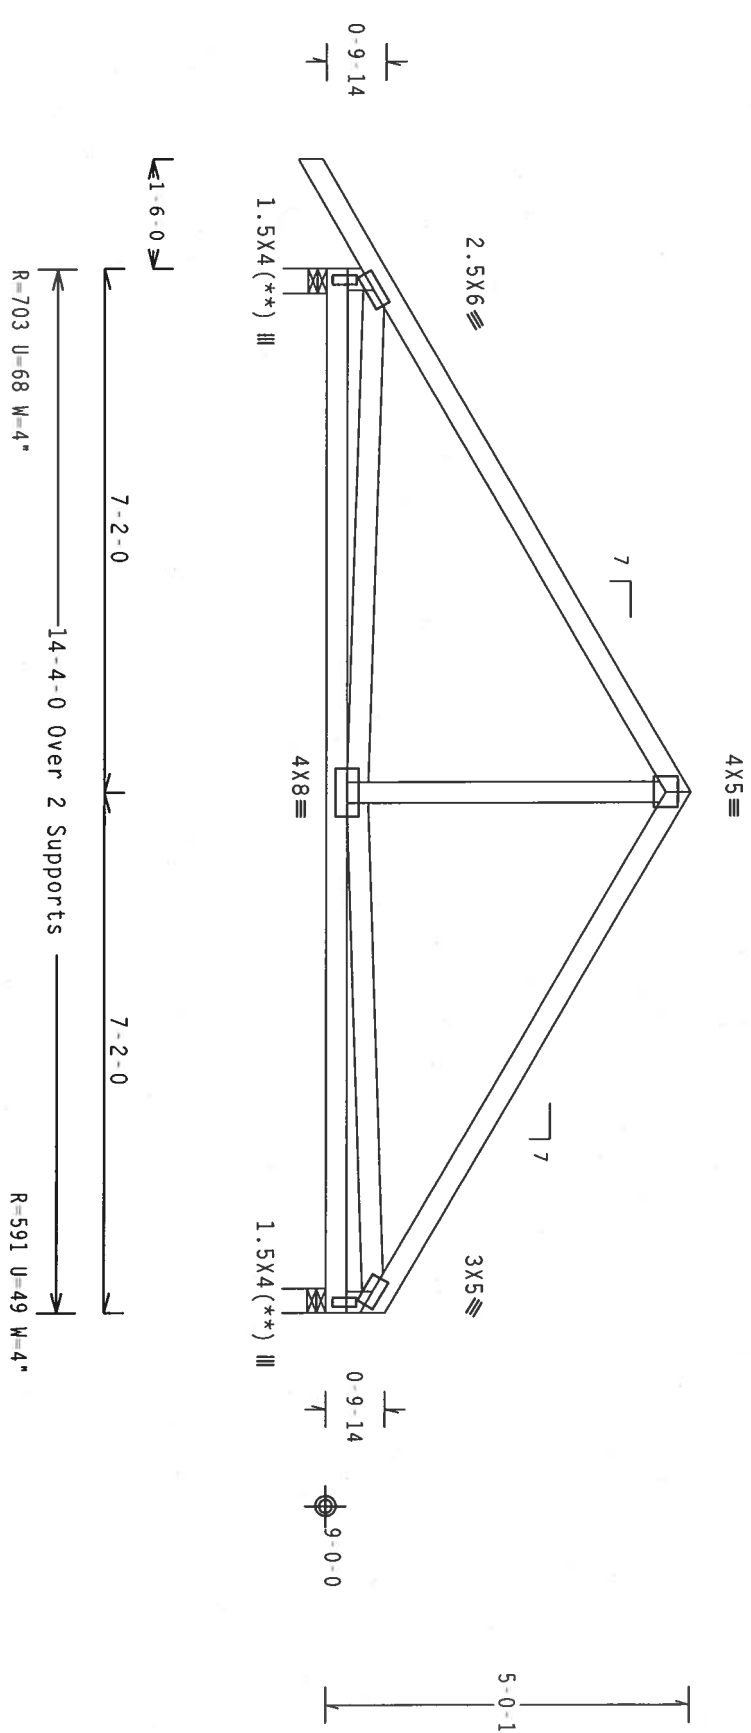

PLT TYP. Wave
Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10(0) 7.36
Scale = .375"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCSP (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY TPI (TRUSS PLATE INSTITUTE, 218 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA 22314) AND WCA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LANE, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN; ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES, BY AFAPA AND TPI. ITW BCG DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AFAPA) AND TPI. ITW BCG CONNECTION PLATES ARE MADE OF 20/18/18GA (N/A/SS/TK) ASH 6053 GRADE 40/60 (N/A/SS) GALV. STEEL. APPLY FINISHES TO EXPOSED SURFACES AND UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWINGS 160A, 2, 160B, 2, 160C, 2, 160D, 2, 160E, 2, 160F, 2, 160G, 2, 160H, 2, 160I, 2, 160J, 2, 160K, 2, 160L, 2, 160M, 2, 160N, 2, 160O, 2, 160P, 2, 160Q, 2, 160R, 2, 160S, 2, 160T, 2, 160U, 2, 160V, 2, 160W, 2, 160X, 2, 160Y, 2, 160Z, 2. DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

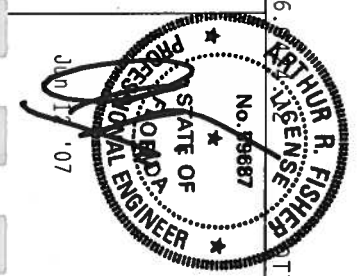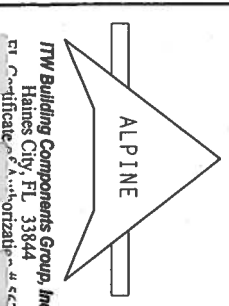


Y=1	FL -/4-/-/R/-	Scale =.375"/Ft.
TC LL	20.0 PSF	REF R8228- 79464
TC DL	10.0 PSF	DATE 06/11/07
BC DL	10.0 PSF	DRW HCUSR8228 07162017
BC LL	0.0 PSF	HC-ENG MMW/AF
TOT.LD.	40.0 PSF	SEQN- 17562
DUR.FAC.	1.25	
SPACING	24.0"	JREF- 17848228201

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, Located anywhere in roof, CAT 1I, EXP 8, wind TC DL=5.0 psf, Wind BC DL=5.0 psf. Iw=1.00 Gcpi(+/-)-0.18

Wind reactions based on MWFRS pressures.

Wind reactions based on MWFRS pressures.

Wind reactions based on MWFRS pressures.



PROPERTY: 1 FL/-/4/-/-/R/-

PLT TYP. Wave


STATE OF
No. 59687

...AUGUST 1984...
...VE...
...1984...

ENGINEERING

10 37-1100

1000000



Alpine
ITW Building Components Group, Inc.
 Haines City, FL 33844


Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3
:Rt Bearing Leg 2x6 SP #2:

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.

* WIND ON TRUSS RUN AS CLOSED IN INDICATED AREA
BUILDING DESIGNER OR ENGINEER OF RECORD TO DETERMINE IF THIS IS ACCEPTABLE.*

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg, not located within 4.50 ft from roof edge, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. 1w=1.00 Gcp1(+/-)=0.18

Wind reactions based on MWFRS pressures.

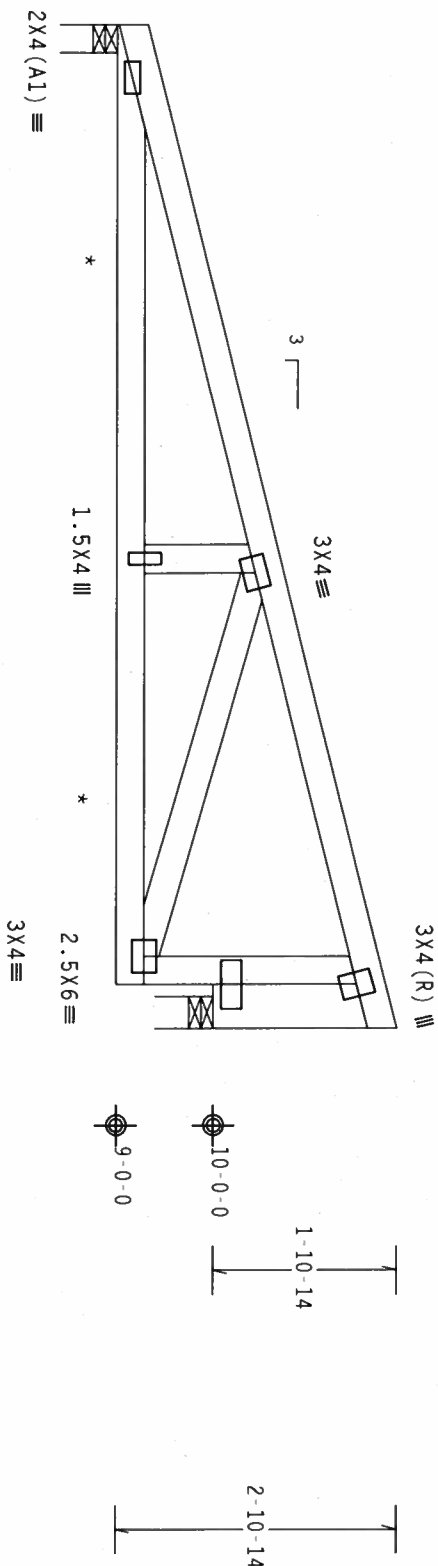

PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC

Cq/RT=1.00(1.25)/10(0)

7.36

QTY: 1 FL/-/4/-/R/-


Scale = .5"/ft.

*IMPORTANT: TRUSS REQUIRE EXTERIOR, CANE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST COPY OF DRAWING FOR SPECIFICATIONS. SEE DRAWING FOR LOCATION OF TRUSS. 6100 NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA 22314 AND WICA (WOOD TRUSS) COUNCIL OF AMERICA, ENTERPRISE LANE, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

ALPINE

TMW Building Components Group, Inc.
Haines City, FL 33844

TMW Building Components Group, Inc.
Haines City, FL 33844

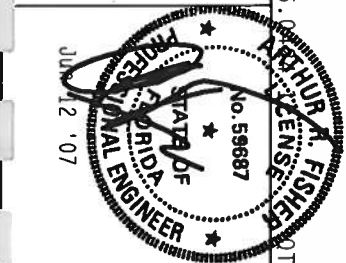

TC LL	20.0 PSF	REF	R8228 - 79466
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCUSR8228 07162019
BC LL	0.0 PSF	HC-ENG	JB/AF
TOT.LD.	40.0 PSF	SEON-	17573
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1T848228201

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3
Stack Chord SC1 2x4 SP #2 Dense:

Truss spaced at 24.0" OC designed to support 1-0-0 top chord
outlookers. Cladding load shall not exceed 10.00 PSF. Top chord
must not be cut or notched.

Stacked top chord must NOT be notched or cut in area (NML).
Dropped top chord braced at 24" o.c. intervals. Attach stacked
top chord (SC) to dropped top chord in notchable area using 3x4
tie plates 24" o.c. Center plate on stacked/dropped chord
interface, plate length perpendicular to chord length. Splice
top chord in notchable area using 3x6.


* WIND ON TRUSS RUN AS CLOSED IN INDICATED AREA
BUILDING DESIGNER OR ENGINEER OF RECORD TO
DETERMINE IF THIS IS ACCEPTABLE.*

110 mph wind, 15.00 ft mean hgt, ASCE 7-02, CLOSED bldg,
located anywhere in roof, CAT II, EXP B, Wind TC DL=5.0 psf,
Wind BC DL=5.0 psf. $I_w=1.00$ GCPI(+/-)=0.18

Wind reactions based on MMFRS pressures.
Right end vertical not exposed to wind pressure.

See DWGS A11015EE0207 & GBLETT10207 for more requirements.

In lieu of structural panels use purlins to brace TC @ 24" OC.
Deflection meets L/240 live and L/180 total load. Creep
increase factor for dead load is 1.50.

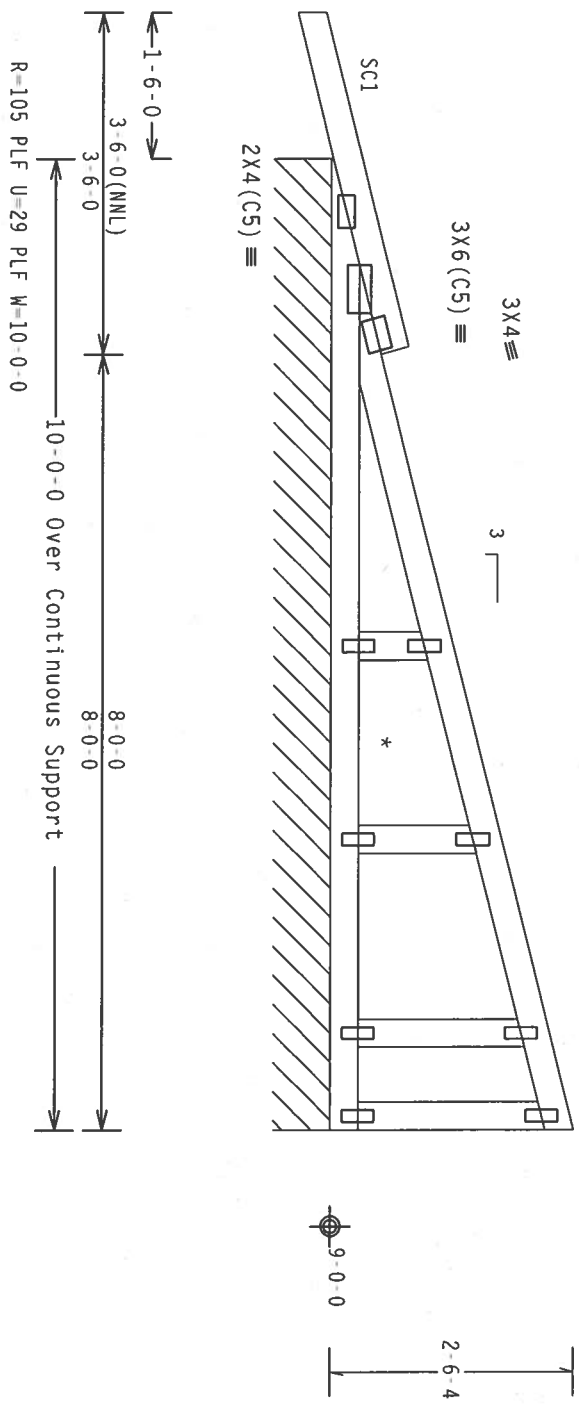

Note: All Plates Are 1.5X4 Except As Shown.


PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10(0)

7.36.0


Scale = .5"/ft.

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING.
REFER TO BEST BUILDING COMPONENT SAFETY INFORMATION FOR THE TRUSS MANUFACTURER'S INSTRUCTIONS. 6300
NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA 22314 AND WEA (WOOD TRUSS) COUNCIL OF AMERICA.
ENTERPRISE LANE, MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS
OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE
A PROPERLY ATTACHED RIGID CEILING.



TMW Building Components Group, Inc.
Haines City, FL 33844

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT
BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH
TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.
DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AF&PA) AND TPI.
CONNECTIONS ARE MADE OF 20/18/16GA (W/4/55/K) ASTM A653 GRADE 40/60 (K, K/4/55) GALV. STEEL. APPLY
PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWING 16GA. 2.
AN INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE PERFORMED AS OF TPI-2002 SEC.3. A SEAL ON THIS
DRAWING INDICATES THE TRUSS MANUFACTURER'S ACCEPTANCE OF THE DESIGN. THE TRUSS MANUFACTURER'S
DESIGN SHOWS THE LOCATION OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE
BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

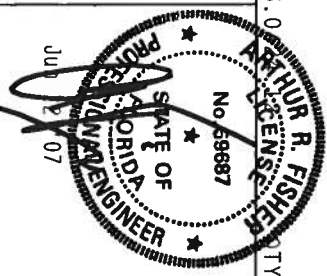

TC LL	20.0 PSF	REF	R8228 - 79467
TC DL	10.0 PSF	DATE	06/11/07
BC DL	10.0 PSF	DRW	HCUSR8228 07162020
BC LL	0.0 PSF	HC-ENG	JB/AF
TOT.LD.	40.0 PSF	SEQN-	17578
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1T848228Z01

Top chord 2x4 SP #2 Dense
Bot chord 2x4 SP #2 Dense
Webs 2x4 SP #3

110 mph wind, 21.40 ft mean hgt, ASCE 7-02, CLOSED bldg,
located anywhere in roof, CAT II, EXP B, Wind TC DL=5.0 psf,
Wind BC DL=2.0 psf. $I_w=1.00$ GCPI (+/-)=0.18


Deflection meets L/240 live and L/180 total load. Creep
increase factor for dead load is 1.50.

Refer to DWG PIGBACKA0207 or PIGBACKB0207 for piggyback
details. TOP CHORD OF SUPPORTING TRUSS UNDER PIGGYBACK TO BE
BRACED @ 24" OC, UNLESS OTHERWISE SPECIFIED.

SPECIAL LOADS

----- (LUMBER DUR.FAC.=1.25 / PLATE DUR.FAC.=1.25)
TC - From 63 PLF at -0.82 to 63 PLF at 2.19
TC - From 63 PLF at 2.19 to 63 PLF at 5.20
BC - From 4 PLF at -0.82 to 4 PLF at 5.20

Wind reactions based on MMFRS pressures.

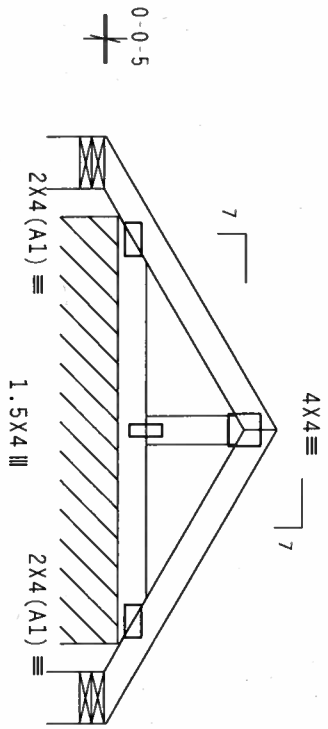


6'-0"-5" Over 3 Supports
R=9 U=20 W=6.45"
R=81 PLF U=25 PLF W=4-4-9
R=9 U=3 W=6.45"

PLT TYP. Wave

Design Crit: TPI-2002(STD)/FBC
Cq/RT=1.00(1.25)/10.0)


WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATION, HANDLING, SHIPPING, INSTALLING AND BRACING.
REFER TO BCSTI (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY TPI (TRUSS PLATE INSTITUTE, 218
NORTH LEE STREET, SUITE 312, ALEXANDRIA, VA, 22314) AND WCA (WOOD TRUSS COUNCIL OF AMERICA, 6300
ENTERPRISE LANE, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS
OTHERWISE INDICATED TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE
A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT FURNISH A COPY OF THIS DESIGN TO THE INSTALLATION CONTRACTOR. ITW BCG, INC. SHALL NOT
BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN. ANY FAILURE OF TRUSS IN COMPLIANCE WITH
TPI: OR FABRICATING, HANDLING, SHIPPING, INSTALLING A BRACING OF TRUSSES.
DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AF&PA) AND TPI.
ITW BCG
CONNECTIONS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AF&PA) AND TPI.
ITW BCG
APPLY
PLATES TO EACH FACE OF TRUSS AND UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DIMENSIONS 160A.2,
160A.3, 160A.4, 160A.5, 160A.6, 160A.7, 160A.8, 160A.9, 160A.10, 160A.11, 160A.12, 160A.13, 160A.14, 160A.15, 160A.16, 160A.17,
DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY. THE TRUSS COMPONENT
DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE
BUILDING DESIGNER PER ANSI/TPI 1 SEC. 2.

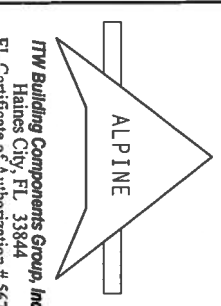

0-0-5
20'-6"-0"

1'-7"-10"

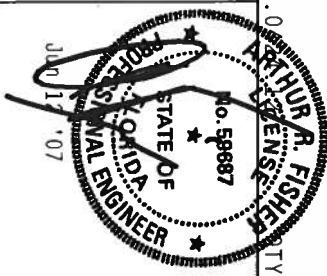

FL/-/4/-/-/R/-

Scale = .5" / ft.

TC LL	20.0 PSF	REF R8228 - 79468
TC DL	10.0 PSF	DATE 06/11/07
BC DL	10.0 PSF	DRW HCUSR8228 07162021
BC LL	0.0 PSF	HC-ENG MNM/AF
TOT.LD.	40.0 PSF	SEON - 17697
DUR.FAC.	1.25	
SPACING	24.0"	JREF - 1T848228201

THIS DETAIL IS TO BE USED WHEN CONTINUOUS LATERAL BRACING (CLB) IS SPECIFIED ON AN ALPINE TRUSS DESIGN BUT AN ALTERNATIVE WEB BRACING METHOD IS DESIRED.

THIS DETAIL IS ONLY APPLICABLE FOR CHANGING THE SPECIFIED
CLB SHOWN ON SINGLE PLY SEALED DESIGNS TO T-BRACING OR SCAB
BRACING.

ALTERNATIVE BRACING SPECIFIED IN CHART BELOW MAY BE CONSERVATIVE.
FOR MINIMUM ALTERNATIVE BRACING, RE-RUN DESIGN WITH APPROPRIATE
BRACING.

WEB MEMBER SIZE	SPECIFIED CLB BRACING	ALTERNATIVE T OR L-BRACE	BRACING SCAB BRACE
2X3 OR 2X4	1 ROW	2X4	1-2X4
2X3 OR 2X4	2 ROWS	2X6	2-2X4
2X6	1 ROW	2X4	1-2X6
2X6	2 ROWS	2X6	2-2X4(*)
2X8	1 ROW	2X6	1-2X8
2X8	2 ROWS	2X6	2-2X6(*)


T-BRACE, L-BRACE AND SCAB BRACE TO BE SAME SPECIES AND GRADE OR BETTER THAN WEB MEMBER UNLESS SPECIFIED OTHERWISE ON ENGINEERS SEALED DESIGN.

(*) CENTER SCAB ON WIDE FACE OF WEB. APPLY (1) SCAB TO EACH FACE OF WEB.




ITW BUILDING COMPONENTS GROUP, INC.
POMPANO BEACH, FLORIDA

APPLY TO EITHER SIDE OF WEB NARROW FACE
ATTACH WITH 10D BOX OR GUN
(0.128" x 3" MIN) NAILS.
AT 6" O.C. BRACE IS A
MINIMUM 80% OF WEB
MEMBER LENGTH

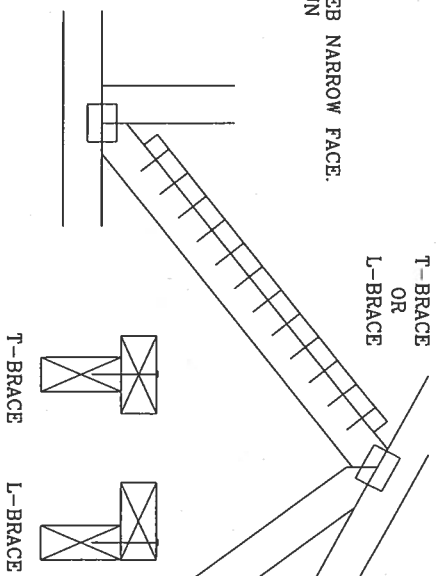

APPLY SCAB(S) TO WIDE FACE OF WEB.
NO MORE THAN (1) SCAB PER FACE.
ATTACH WITH 10d BOX OR GUN
(0.128" x 3." MIN) NAILS.
AT 6" O.C. BRACE IS A MINIMUM
80% OF WEB MEMBER LENGTH

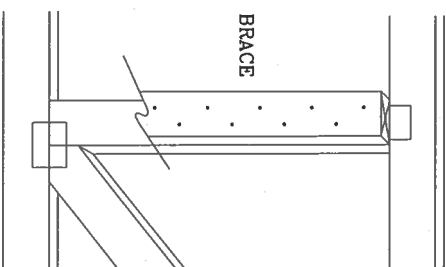


THIS DRAWING REPLACES DRAWING 579,640

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST BUILDING CONVENTIONAL SAFETY INFORMATION, PUBLISHED BY THE TRUSSING PLATE INSTITUTE, 218 NORTH 1ST ST., SUITE 312, ALEXANDRIA, VA 22304, AND VITA CAVOID TRUSS COUNCIL OF AMERICA, 10000 W. 10TH AVE., SUITE 100, DENVER, CO 80231, FOR THE LATEST INFORMATION ON TRUSS FUNCTIONS. UNLESS OTHERWISE INDICATED, THE CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

WARNING FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR. (TIV, BCG, INC.) SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN AND ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH THE FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING OF TRUSSES IN DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AIA/PDA) AND TIV, BCG CONNECTOR PLATES ARE MADE OF 6061-T6 ALUMINUM, ASTM A633 GRADE 40/60 (V.A.K.H.S.).

USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER, PER ANSI/A17.1 SEC. 2.




TC LL	PSF	REF	CLB	SUBST.
TC DL	PSF	DATE	2/23/07	
BC DL	PSF	DRWG	BRCBLSUB0207	
BC LL	PSF	-ENG	MLH/KAR	
TOT. LD.	PSF			
DUR. FAC.				
SPACING				

2x4 GABLE VERTICAL SPECIES		BRACE		NO		(1) 1x4 "L" BRACE *		(1) 2x4 "L" BRACE *		(2) 2x4 "L" BRACE *		(1) 2x6 "L" BRACE *		(2) 2x6 "L" BRACE *	
SPACING	GRADE	BRACE	NO	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
MAX GABLE VERTICAL LENGTH															
12" O.C.	SPF	#1 / #2	3' 10"	6' 8"	6' 10"	7' 11"	8' 1"	9' 5"	9' 8"	12' 5"	12' 9"	14' 0"	14' 0"	14' 0"	14' 0"
	SPF	#3	3' 9"	6' 0"	6' 0"	7' 11"	7' 11"	9' 5"	9' 5"	12' 4"	12' 4"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STANDARD	3' 9"	6' 0"	6' 0"	7' 11"	7' 11"	9' 5"	9' 5"	12' 3"	12' 3"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	#1	4' 3"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	10' 2"	12' 5"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
16" O.C.	SPF	#2	4' 0"	6' 2"	6' 2"	7' 11"	8' 1"	9' 5"	9' 11"	12' 5"	12' 6"	14' 0"	14' 0"	14' 0"	14' 0"
	SPF	#3	4' 0"	6' 1"	6' 1"	7' 11"	8' 0"	9' 5"	9' 11"	12' 5"	12' 6"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STANDARD	3' 10"	5' 3"	5' 3"	6' 11"	6' 11"	9' 4"	9' 4"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	#1 / #2	4' 5"	7' 8"	7' 8"	7' 10"	9' 1"	9' 4"	10' 10"	11' 1"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
24" O.C.	SPF	#3	4' 4"	7' 4"	7' 4"	7' 4"	9' 1"	9' 1"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	SPF	STANDARD	4' 4"	7' 4"	7' 4"	7' 4"	9' 1"	9' 1"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	#1	4' 10"	7' 8"	8' 3"	9' 1"	9' 9"	10' 10"	11' 8"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	#2	4' 9"	7' 8"	8' 3"	9' 1"	9' 9"	10' 10"	11' 8"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"

BRACING GROUP SPECIES AND GRADES:	
GROUP A:	
SPRUCE-PINE-FIR	HEM-FIR
#1 / #2 STANDARD	#2 STUD
#3 STUD	#3 STANDARD
DOUGLAS FIR-LARCH	
#3 STUD	#3 STANDARD
GROUP B:	
HEM-FIR	DOUGLAS FIR-LARCH
#1 & BTR	#1
SOUTHERN PINE	#2
#2	#2

GABLE TRUSS DETAIL NOTES:
 LIVE LOAD DEFLECTION CRITERIA IS L/240.
 PROVIDE UPLIFT CONNECTIONS FOR 80 PLF OVER CONTINUOUS BEARING (5 PSF TO DEAD LOAD).
 GABLE END SUPPORTS LOAD FROM 4' 0" OUTLOOKERS WITH 2' 0" OVERHANG. OR 12" PLYWOOD OVERHANG.
 ATTACH EACH "L" BRACE WITH 10d NAILS.
 * FOR (1) "L" BRACE: SPACE NAILS AT 2' 0" O.C. IN 18" END ZONES AND 4' 0" O.C. BETWEEN ZONES.
 ** FOR (2) "L" BRACES: SPACE NAILS AT 3' 0" O.C. IN 18" END ZONES AND 6' 0" O.C. BETWEEN ZONES.
 "L" BRACING MUST BE A MINIMUM OF 80% OF WEB MEMBER LENGTH.

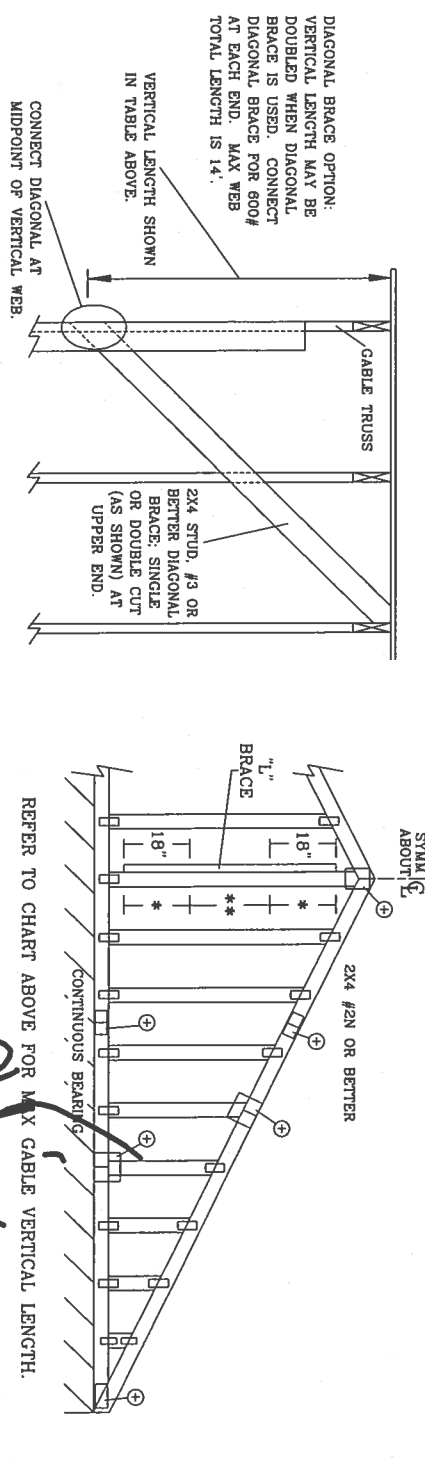

GABLE VERTICAL PLATE SIZES	
VERTICAL LENGTH	NO SPICE
LESS THAN 4' 0"	1x4 OR 2x3
GREATER THAN 4' 0", BUT LESS THAN 11' 6"	2x4
GREATER THAN 11' 6"	2.5x4
+ REFER TO COMMON TRUSS DESIGN FOR PEAK, SPICE, AND HEEL PLATES.	

DIAGONAL BRACE OPTION: VERTICAL LENGTH MAY BE DOUBLED WHEN DIAGONAL BRACE IS USED. CONNECT DIAGONAL BRACE FOR 600# AT EACH END. MAX WEB TOTAL LENGTH IS 14'.

VERTICAL LENGTH SHOWN IN TABLE ABOVE.

CONNECT DIAGONAL AT MIDPOINT OF VERTICAL WEB.

REFER TO CHART ABOVE FOR MAX GABLE VERTICAL LENGTH.

ALPINE

TRUSS BUILDING COMPONENTS GROUP, INC.
POMPANO BEACH, FLORIDA

VARNOTING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST BUILDING COMPONENT SAFETY INFORMATION. PUBLISHED BY TPI TRUSS PLATE INSTITUTE, 218 NORTH LEE STR., SUITE 312, ALEXANDRIA, VA 22314 AND VITA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LN, MADISON, VI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT: FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR. TPI BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES. DESIGN CONDITIONS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AIA/ASCE) AND TPI. TPI, BCG CONNECTOR PLATES ARE MADE OF 2018/1616 (A/H/SS) ASH A653 GRADE 48/60 (A/K/H/SS) DESIGNATION PER TPI. TPI TRUSSES ARE DESIGNED FOR 150 PSF DEAD LOAD AND 15 PSF LIVE LOAD PER ANNEX A3 OF TPI 1-2002 SEC. 3. A SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER. PER ANSI/TPI 1 SEC. 2.

STATE OF FLORIDA

PROFESSIONAL ENGINEER

No. 59687

DATE: 2/23/07

DRWG: A11015EE0207

ENG

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

Diagram illustrating the cable vertical length TYP. and the sum of cable lengths about the centerline (CL) for a cable-stayed bridge. The diagram shows a cross-section of the bridge deck and the cable stays. The cable stays are labeled with circled plus signs (+). The vertical length TYP. is indicated by a dimension line. The sum of cable lengths about the centerline is indicated by a dimension line labeled 'SUM OF CABLE LENGTHS ABOUT CL'.

EXAMPLE: 2/

LESS THAN 4' 0"
GREATER THAN 4' 0"
LESS THAN 11' 6"
GREATER THAN 11' 6"

⊕ REFER TO ENGINEER
SPLICE, WEB AND
* IF CABLE VERTICAL
SINGLE PLATE TO

* IF CABLE VERTICAL PLATES OVERLAP, USE A SINGLE PLATE TO SPAN THE WEB.

PROVIDE CONNECTIONS FOR UPLIFT SPECIFIED ON THE ENGINEERED TRUSS DESIGN.
ATTACH EACH "T" REINFORCING MEMBER WITH

HAND DRIVEN NAILS:

(4) 16d COMMON (0.162" X 3.5", MIN) TOENAILS IN TOP AND BOTTOM CHORD

GUN DRIVEN NAILS:

8d COMMON (0.131"X 2.5".MIN) TOENAILS AT 4" O.C. PLUS
(4) TOENAILS IN TOP AND BOTTOM CHORD.

THIS DETAIL TO BE USED WITH THE APPROPRIATE ALPINE CABLE DETAIL FOR ASCE OR SBCI WIND LOAD.

ASCE 7-93 CABLE DETAIL DRAWINGS

ASCE 7-98 GABLE DETAIL DRAWINGS

ASCE 7-98 GABLE DETAIL DRAWINGS

A13015EC0207, A12015EC0207, A11015EC0207, A10015EC0207, A08515EC0207,

A13030EC0207, A12030EC0207, A11030EC0207, A08530EC0207


ASCE 7-02 CABLE DETAIL DRAWINGS A11
A13015FEF0207 A12015FEF0207 A11

A13030EE0207 A12030EE0207 A11030EE0207 A08530EE0207
A13030EE0207 A12030EE0207 A11030EE0207 A08530EE0207
A13030EE0207 A12030EE0207 A11030EE0207 A08530EE0207
A13030EE0207 A12030EE0207 A11030EE0207 A08530EE0207

ASCE 7-05 CABLE DETAIL DRAWINGS

A13015E50207, A12015E50207, A1015E50207, A10015E50207, A08515E50207, A13030E50207, A12030E50207, A11030E50207, A10030E50207, A08530E50207

SEE APPROPRIATE ALPINE CABLE DETAIL (ASCE OR SBCS
WIND LOAD) FOR MAXIMUM UNREINFORCED CABLE
VERTICAL LENGTH.

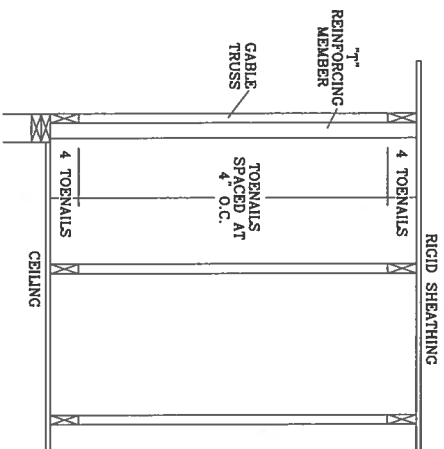

THIS DRAWING REPLACES DRAWINGS GAB98117 876,719 & HC26294035

The diagram shows a cross-section of a two-span continuous beam. The beam is divided into three sections: a left span, a central support, and a right span. The left span is labeled '2x4 REINFORCING MEMBER' and the right span is labeled '2x6 REINFORCING MEMBER'. The central support is labeled 'TOENAIL'. The beam is shown with a cross-section of a rectangular member, with diagonal lines indicating the internal structure. The beam is supported by a base, which is shown with a cross-section of a rectangular member. The beam is shown with a cross-section of a rectangular member, with diagonal lines indicating the internal structure. The beam is supported by a base, which is shown with a cross-section of a rectangular member.

TO CONVERT FROM "L" TO "W" REINFORCING MEMBERS
MULTIPLY "W" FACTOR BY LENGTH (BASED ON CABLE
VERTICAL SPECIES, GRADE AND SPACING) FOR (1)
2X4 "L" BRACE GROUP A, OBTAINED FROM THE
APPROPRIATE ALPINE CABLE DETAIL FOR ASCE OR
SBCB WIND LOAD.

MAXIMUM ALLOWABLE "T" REINFORCED GABLE VERTICAL LENGTH IS 14' FROM TOP TO BOTTOM CHORD.

WIND SPEED AND MRH		"I" REINF. MBR. SIZE	SBCI	ASCE
110 MPH	2x4	10 %	10 %	
15 FT	2x6	40 %	50 %	
110 MPH	2x4	10 %	10 %	
30 FT	2x6	50 %	50 %	
100 MPH	2x4	10 %	10 %	
15 FT	2x6	30 %	50 %	
100 MPH	2x4	10 %	10 %	
30 FT	2x6	40 %	40 %	
90 MPH	2x4	20 %	10 %	
15 FT	2x6	20 %	40 %	
90 MPH	2x4	10 %	10 %	
30 FT	2x6	30 %	50 %	
80 MPH	2x4	10 %	20 %	
15 FT	2x6	10 %	30 %	
80 MPH	2x4	20 %	10 %	
30 FT	2x6	20 %	40 %	
70 MPH	2x4	0 %	20 %	
15 FT	2x6	0 %	20 %	
70 MPH	2x4	10 %	20 %	
30 FT	2x6	10 %	30 %	

EXAMPLE:

ASCE WIND SPEED = 100 MPH

MEAN ROOF HEIGHT = 30 FT

GABLE VERTICAL = 24" O.C. SP #3

1 REINFORCING MEMBER SIZE = 2X4

(1) 2X4 "L" BRACE LENGTH = 6' 7"

MAXIMUM "T" REINFORCED CABLE VERTICAL LENGTH
110 x 6' 7" = 7' 3"

$$1.10 \times 6' 7'' = 7' 3''$$


ITW BUILDING COMPONENTS GROUP, INC.
POMPANO BEACH, FLORIDA


NOTES: 1. **WARNING:** TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST PRACTICE COMPONENT SAFETY INFORMATION, PUBLISHED BY TPI TRUSS PLATE INSTITUTE, 218 NORTH LEE ST., SUITE 312, ALEXANDRIA, VA 22314) AND WITA (WOOD TRUSS COUNCIL OF AMERICA, 6300 ENTERPRISE LN, MADISON, WI 53719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE ACTIONS. UNLESS OTHERWISE INDICATED, TPI CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

2. **NOT REPRINTABLE:** FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR. (TPI BCG, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI, OR FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING OF TRUSSES.)

3. DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF NDS (NATIONAL DESIGN SPEC. BY AF&PA) AND TPI.


4. TPI BCG CONNECTOR PLATES ARE MADE OF 2018/1816A (A/H/SSV) ASTM A563 GRADE 40/60 (A/H/A453) ALUMINUM. ALL DIMENSIONS ARE IN INCHES.

5. DESIGN POSITION PER DRAWINGS 1604-2, 1604-3, 1604-4, 1604-5, 1604-6, 1604-7, 1604-8, 1604-9, 1604-10, 1604-11 PER ANNEX A3 OF TPI 1-2006 SEC. 3. A SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER. PER ANSI/TPI 1 SEC. 2.

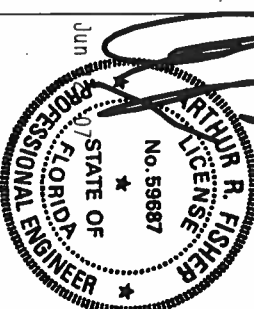

REF	LET-IN VERT
DATE	2/23/07
DRWG	GBLETTIN0207
-ENG	DLJ/KAR

2x4 GABLE VERTICAL LENGTH		BRACE		NO BRACES		(1) 1x4 "L" BRACE *		(1) 2x4 "L" BRACE *		(2) 2x4 "L" BRACE **		(1) 2x6 "L" BRACE *		(2) 2x6 "L" BRACE **	
GABLE VERTICAL SPACING	SPECIES	GRADE	BRACE	NO	BRACES	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
12" O.C.	SPF	#1 / #2	STUD	3' 8"	6' 4"	6' 4"	7' 6"	7' 6"	8' 11"	9' 2"	11' 9"	12' 1"	14' 0"	14' 0"	14' 0"
				3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"	11' 2"	11' 2"	14' 0"	14' 0"	14' 0"
				3' 7"	5' 5"	5' 5"	7' 1"	7' 1"	8' 11"	8' 11"	11' 1"	11' 1"	14' 0"	14' 0"	14' 0"
				3' 7"	4' 8"	4' 8"	6' 1"	6' 1"	8' 3"	8' 3"	9' 6"	9' 6"	12' 11"	12' 11"	12' 11"
				4' 0"	6' 4"	6' 4"	7' 6"	7' 6"	8' 11"	8' 11"	9' 7"	11' 9"	12' 8"	14' 0"	14' 0"
16" O.C.	SPF	#1 / #2	STUD	3' 11"	6' 4"	6' 4"	7' 6"	7' 6"	8' 11"	9' 7"	11' 9"	12' 8"	14' 0"	14' 0"	14' 0"
				3' 9"	5' 7"	5' 7"	7' 4"	7' 4"	8' 11"	8' 11"	9' 5"	11' 5"	14' 0"	14' 0"	14' 0"
				3' 9"	5' 6"	5' 6"	7' 3"	7' 3"	8' 11"	8' 11"	9' 5"	11' 4"	14' 0"	14' 0"	14' 0"
				3' 8"	4' 9"	4' 9"	6' 3"	6' 3"	8' 5"	8' 5"	9' 9"	9' 9"	13' 3"	14' 0"	14' 0"
				4' 2"	7' 3"	7' 3"	8' 7"	8' 7"	10' 3"	10' 3"	13' 5"	13' 5"	14' 0"	14' 0"	14' 0"
24" O.C.	SPF	#1 / #2	STUD	4' 1"	8' 0"	8' 0"	8' 7"	8' 7"	10' 3"	10' 3"	13' 5"	13' 5"	14' 0"	14' 0"	14' 0"
				4' 1"	8' 0"	8' 0"	8' 7"	8' 7"	10' 3"	10' 3"	13' 5"	13' 5"	14' 0"	14' 0"	14' 0"
				4' 1"	5' 8"	5' 8"	7' 6"	7' 6"	10' 1"	10' 1"	11' 8"	11' 8"	14' 0"	14' 0"	14' 0"
				4' 7"	7' 3"	7' 3"	8' 7"	8' 7"	10' 3"	10' 3"	13' 5"	13' 5"	14' 0"	14' 0"	14' 0"
				4' 6"	7' 3"	7' 3"	8' 7"	8' 7"	10' 3"	10' 3"	13' 5"	13' 5"	14' 0"	14' 0"	14' 0"

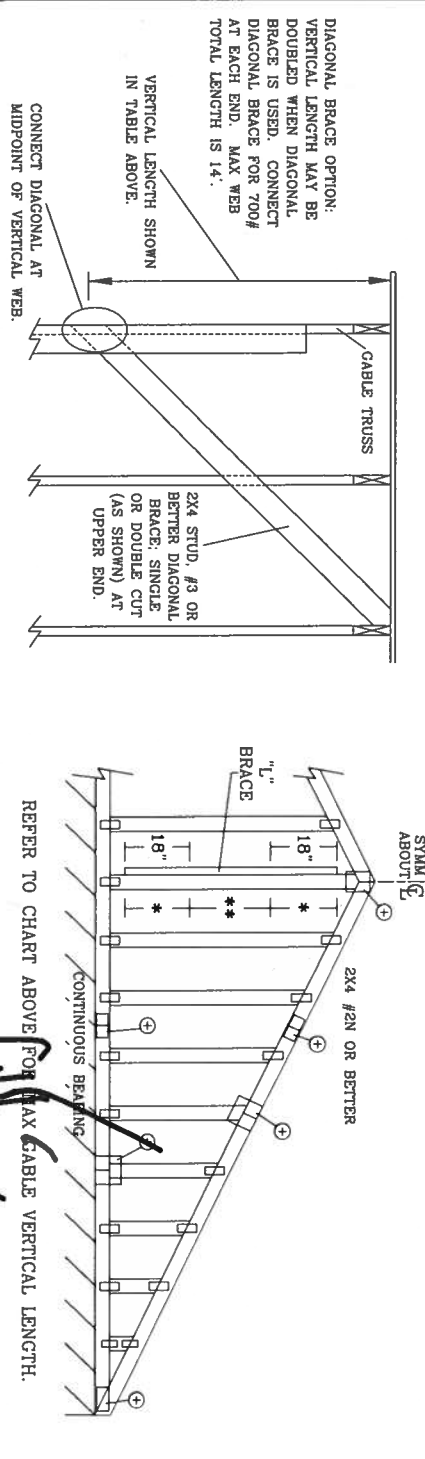

GABLE VERTICAL PLATE SIZES		NO SPICE	
VERTICAL LENGTH	LESS THAN 4' 0"	1x4 OR 2x3	2x4
VERTICAL LENGTH	GREATER THAN 4' 0", BUT LESS THAN 11' 6"	2x4	2x4
VERTICAL LENGTH	GREATER THAN 11' 6"	2x4	2x4

+ REFER TO COMMON TRUSS DESIGN FOR PEAK, SPICE, AND HEEL PLATES.

ALPINE

ITW BUILDING COMPONENTS GROUP, INC.
POMPAHO BEACH, FLORIDA

STATE OF FLORIDA
PROFESSIONAL ENGINEER
No. 59687
A. FISHER

MAX. TOT. LD. 60 PSF

MAX. SPACING 24' 0"

REF	ASCE7-02-CAB1030
DATE	2/23/07
DRWG	A11030E0207
ENG	

2x4 CABLE TRUSS		BRACE		NO BRACES		(1) 1x4 "L" BRACE *		(1) 2x4 "L" BRACE *		(2) 2x4 "L" BRACE *		(1) 2x6 "L" BRACE *		(2) 2x6 "L" BRACE *	
SPACING	SPECIES	GRADE	BRACES	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
12" O.C.	SPF	#1 / #2	3' 10"	6' 8"	6' 10"	7' 11"	8' 1"	9' 5"	9' 8"	12' 5"	12' 9"	14' 0"	14' 0"	14' 0"	14' 0"
	STUD	#3	3' 9"	6' 0"	6' 0"	7' 11"	7' 11"	9' 5"	9' 5"	12' 3"	12' 3"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STANDARD	3' 9"	6' 0"	6' 0"	7' 11"	7' 11"	9' 5"	9' 5"	12' 3"	12' 3"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	#1	4' 3"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	10' 2"	12' 5"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
16" O.C.	SPF	#1 / #2	4' 2"	6' 8"	7' 2"	7' 11"	8' 6"	9' 5"	10' 2"	12' 5"	13' 5"	14' 0"	14' 0"	14' 0"	14' 0"
	STUD	#3	4' 0"	6' 2"	6' 2"	7' 11"	8' 1"	9' 5"	9' 11"	12' 5"	12' 8"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STANDARD	4' 0"	6' 1"	6' 1"	7' 11"	8' 0"	9' 5"	9' 11"	12' 5"	12' 6"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	#1	4' 5"	6' 3"	5' 3"	6' 11"	8' 1"	9' 4"	9' 4"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"
24" O.C.	SPF	#1 / #2	4' 5"	7' 8"	7' 10"	9' 1"	9' 4"	10' 10"	11' 1"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	STUD	#3	4' 4"	7' 4"	7' 4"	9' 1"	9' 1"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	HF	STANDARD	4' 4"	7' 4"	7' 4"	9' 1"	9' 1"	10' 10"	10' 10"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"
	SP	#1	4' 10"	7' 8"	8' 3"	9' 1"	9' 9"	10' 10"	11' 8"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"	14' 0"

BRACING GROUP SPECIES AND GRADES:

GROUP A:

SPRUC-PINE-FIR

#1 / #2 STANDARD

#3 STUD

HEM-FIR

#2 STUD

#3 STANDARD

DOUGLAS FIR-LARCH

#3 STUD

STANDARD

SOUTHERN PINE

#3 STUD

STANDARD

GROUP B:

HEM-FIR

#1 & BTR

#1

SOUTHERN PINE

#1

#2

DOUGLAS FIR-LARCH

#1

#2

CABLE TRUSS DETAIL NOTES:

LIVE LOAD DEFLECTION CRITERIA IS L/240.

PROVIDE UPLIFT CONNECTIONS FOR 80 PLF OVER CONTINUOUS BEARING (5 PSF TC DEAD LOAD).


CABLE END SUPPORTS LOAD FROM 4' 0" OUTLOOKERS WITH 2' 0" OVERHANG, OR 12" PLYWOOD OVERHANG.

ATTACH EACH "L" BRACE WITH 10d NAILS.

* FOR (1) "L" BRACE: SPACE NAILS AT 2' O.C. IN 18" END ZONES AND 4' O.C. BETWEEN ZONES.

** FOR (2) "L" BRACES: SPACE NAILS AT 3' O.C. IN 18" END ZONES AND 6' O.C. BETWEEN ZONES.

"L" BRACING MUST BE A MINIMUM OF 80% OF WEB MEMBER LENGTH.

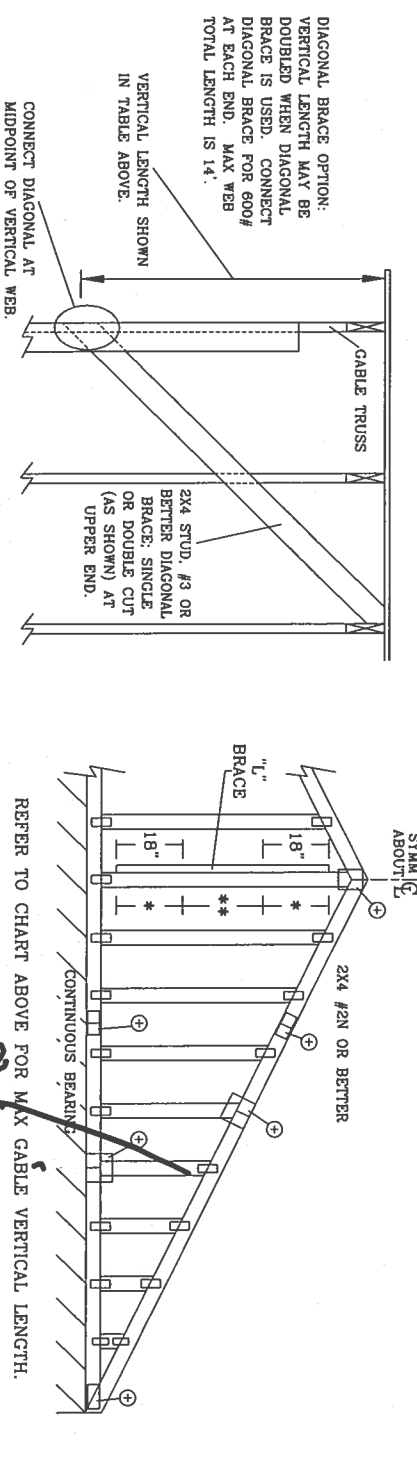

GABLE VERTICAL PLATE SIZES	
VERTICAL LENGTH	NO SPICE
LESS THAN 4' 0"	1X4 OR 2X3
GREATER THAN 4' 0", BUT LESS THAN 11' 6"	2X4
GREATER THAN 11' 6"	2.5X4

+ REFER TO COMMON TRUSS DESIGN FOR PEAK, SPICE, AND HEEL PLATES.

DIAGONAL BRACE OPTION:

VERTICAL LENGTH MAY BE DOUBLED WHEN DIAGONAL BRACE IS USED. CONNECT DIAGONAL BRACE FOR 600# AT EACH END. MAX WEB TOTAL LENGTH IS 14'.

VERTICAL LENGTH SHOWN IN TABLE ABOVE.

CONNECT DIAGONAL AT MIDPOINT OF VERTICAL WEB.

ALPINE

TRUSSING COMPONENTS GROUP, INC. POMPANO BEACH, FLORIDA

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCSI (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY TPI (TRUSS PLATE INSTITUTE), 218 NORTH LEE STR., SUITE 312, ALEXANDRIA, VA 22314, AND VITA (WOOD TRUSS COUNCIL OF AMERICA), 6300 ENTERPRISE LN., MADISON, WI 53719 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

IMPORTANT FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR. ITV BCS, INC. SHALL NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN, ANY FAILURE TO BUILD THE TRUSS IN CONFORMANCE WITH TPI, OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES. (AV. BECS CONNECTOR PLATES ARE MADE OF 6061-T6 ALUMINUM ALLOY TO MEET A633 GRADE 40/60 (V.A./K.H.S.S.) DESIGN POSITION PER DRAWING 1604-2. ANY INSPECTION OF PLATES FILLED BY HAND SHALL BE PER ANNEX A3 OF TPI 1-2002 SEC. 3. A SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN SHOWN, THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER, PER ANSI/TPI 1 SEC. 2.

PROFESSIONAL ENGINEER
STATE OF FLORIDA
J. R. FISHER
No. 58687

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

REF ASCET-98-CAB11015

DATE 2/23/07

DRWG A11015EC0207

-ENG

**RESIDENTIAL MINIMUM PLAN REQUIREMENTS AND CHECKLIST FOR
FLORIDA BUILDING CODE 2001
ONE (1) AND TWO (2) FAMILY DWELLINGS
ALL REQUIREMENTS ARE SUBJECT TO CHANGE
EFFECTIVE MARCH 1, 2002**

1. ALL BUILDINGS CONSTRUCTED EAST OF SAID LINE SHALL BE ----- 100 MPH
2. ALL BUILDINGS CONSTRUCTED WEST OF SAID LINE SHALL BE -----110 MPH
3. NO AREA IN COLUMBIA COUNTY IS IN A WIND BORNE DEBRIS REGION

Applicant	Plans Examiner	
<input checked="" type="checkbox"/>	<input type="checkbox"/>	All drawings must be clear, concise and drawn to scale ("Optional" details that are not used shall be marked void or crossed off). Square footage of different areas shall be shown on plans.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	Designers name and signature on document (FBC 104.2.1). If licensed architect or engineer, official seal shall be affixed.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>Site Plan including:</u> <ol style="list-style-type: none"> Dimensions of lot Dimensions of building set backs Location of all other buildings on lot, well and septic tank if applicable, and all utility easements. Provide a full legal description of property.
<input checked="" type="checkbox"/>	<input type="checkbox"/>	<u>Wind-load Engineering Summary, calculations and any details required</u> <ol style="list-style-type: none"> Plans or specifications must state compliance with FBC Section 1806 The following information must be shown as per section 1806.1.7 FBC <ol style="list-style-type: none"> Basic wind speed (MPH) Wind importance factor (I) and building category Wind exposure – if more than one wind exposure is used, the wind exposure and applicable wind direction shall be indicated The applicable internal pressure coefficient Components and Cladding. The design wind pressure in terms of psf (kN/m²), to be used for the design of exterior component and cladding materials not specifically designed by the registered design professional
<input type="checkbox"/>	<input type="checkbox"/>	<u>Elevations including:</u> <ol style="list-style-type: none"> All sides Roof pitch Overhang dimensions and detail with attic ventilation Location, size and height above roof of chimneys Location and size of skylights Building height Number of stories

Floor Plan including:

- a) Rooms labeled and dimensioned
- b) Shear walls
- c) Windows and doors (including garage doors) showing size, mfg., approval listing and attachment specs. (FBC 1707) and safety glazing where needed (egress windows in bedrooms to be shown)
- d) Fireplaces (gas appliance) (vented or non-vented) or wood burning with hearth
- e) Stairs with dimensions (width, tread and riser) and details of guardrails and handrails
- f) Must show and identify accessibility requirements (accessible bathroom)

Foundation Plan including:

- a) Location of all load-bearing wall with required footings indicated as standard Or monolithic and dimensions and reinforcing
- b) All posts and/or column footing including size and reinforcing
- c) Any special support required by soil analysis such as piling
- d) Location of any vertical steel

Roof System:

- a) Truss package including:
 - 1. Truss layout and truss details signed and sealed by FI. Pro. Eng.
 - 2. Roof assembly (FBC 104.2.1 Roofing system, materials, manufacturer, fastening requirements and product evaluation with wind resistance rating)
- b) Conventional Framing Layout including:
 - 1. Rafter size, species and spacing
 - 2. Attachment to wall and uplift
 - 3. Ridge beam sized and valley framing and support details
 - 4. Roof assembly (FBC 104.2.1 Roofing systems, materials, manufacturer, fastening requirements and product evaluation with wind resistance rating)

Wall Sections including:

- a) Masonry wall
 - 1. All materials making up wall
 - 2. Block size and mortar type with size and spacing of reinforcement
 - 3. Lintel, tie-beam sizes and reinforcement
 - 4. Gable ends with rake beams showing reinforcement or gable truss and wall brace details
 - 5. All required connectors with uplift rating and required number and size of fastener for continuous tie from roof to foundation
 - 6. Roof assembly shown here or on roof system detail (FBC 104.2.1 Roofing system materials, manufacturer, fastening requirements and product evaluation with resistance rating)
 - 7. Fire resistant construction (if required)
 - 8. Fireproofing requirements
 - 9. Shoe type of termite treatment (termicide or alternative method)
 - 10. Slab on grade
 - a. Vapor retardant (8mil. Polyethylene with joints lapped 6 inches and sealed)
 - b. Must show control joints, synthetic fiber reinforcement or Welded fire fabric reinforcement and supports
 - 11. Indicate where pressure treated wood will be placed
 - 12. Provide insulation R value for the following:
 - a. Attic space
 - b. Exterior wall cavity
 - c. Crawl space (if applicable)

☐ ☐ **b) Wood frame wall**

1. All materials making up wall
2. Size and species of studs
3. Sheathing size, type and nailing schedule
4. Headers sized
5. Gable end showing balloon framing detail or gable truss and wall hinge bracing detail
6. All required fasteners for continuous tie from roof to foundation (truss anchors, straps, anchor bolts and washers)
7. Roof assembly shown here or on roof system detail (FBC104.2.1 Roofing system materials, manufacturer, fastening requirements and product evaluation with wind resistance rating)
8. Fire resistant construction (if applicable)
9. Fireproofing requirements
10. Show type of termite treatment (termicide or alternative method)
11. Slab on grade
 - a. Vapor retardant (6Mil. Polyethylene with joints lapped 6 inches and sealed)
 - b. Must show control joints, synthetic fiber reinforcement or welded wire fabric reinforcement and supports
12. Indicate where pressure treated wood will be placed
13. Provide insulation R value for the following:
 - a. Attic space
 - b. Exterior wall cavity
 - c. Crawl space (if applicable)

☐ ☐ **c) Metal frame wall and roof (designed, signed and sealed by Florida Prof. Engineer or Architect)**☐ ☐ **Floor Framing System:**

- a) Floor truss package including layout and details, signed and sealed by Florida Registered Professional Engineer
- b) Floor joist size and spacing
- c) Girder size and spacing
- d) Attachment of joist to girder
- e) Wind load requirements where applicable

☐ ☐ **Plumbing Fixture layout**☐ ☐ **Electrical layout including:**

- a) Switches, outlets/receptacles, lighting and all required GFCI outlets identified
- b) Ceiling fans
- c) Smoke detectors
- d) Service panel and sub-panel size and location(s)
- e) Meter location with type of service entrance (overhead or underground)
- f) Appliances and HVAC equipment
- g) Arc Fault Circuits (AFCI) in bedrooms

☐ ☐ **HVAC Information**

- a) Manual J sizing equipment or equivalent computation
- b) Exhaust fans in bathroom

☐ ☐ **Energy Calculations (dimensions shall match plans)**☐ ☐ **Gas System Type (LP or Natural) Location and BTU demand of equipment**☐ ☐ **Disclosure Statement for Owner Builders**☐ ☐ *****Notice Of Commencement Required Before Any Inspections Will Be Done**☐ ☐ **Private Potable Water**

- a) Size of pump motor
- b) Size of pressure tank
- c) Cycle stop valve if used

Residential System Sizing Calculation

Summary

Spec House

Project Title:
Venture Point LLC - Lot 5 Hunters Oak

Code Only
Professional Version
Climate: North

Columbia Cnty, FL 32024-


6/4/2007

Location for weather data: Gainesville - Defaults: Latitude(29) Altitude(152 ft.) Temp Range(M)					
Humidity data: Interior RH (50%) Outdoor wet bulb (77F) Humidity difference(54gr.)					
Winter design temperature	33	F	Summer design temperature	92	F
Winter setpoint	70	F	Summer setpoint	75	F
Winter temperature difference	37	F	Summer temperature difference	17	F
Total heating load calculation	36779	Btuh	Total cooling load calculation	41423	Btuh
Submitted heating capacity	% of calc	Btuh	Submitted cooling capacity	% of calc	Btuh
Total (Electric Heat Pump)	119.6	44000	Sensible (SHR = 0.75)	101.5	33000
Heat Pump + Auxiliary(0.0kW)	119.6	44000	Latent	123.7	11000
			Total (Electric Heat Pump)	106.2	44000

WINTER CALCULATIONS

Winter Heating Load (for 1901 sqft)


Load component		Load	
Window total	245 sqft	11527	Btuh
Wall total	1434 sqft	4708	Btuh
Door total	38 sqft	492	Btuh
Ceiling total	1950 sqft	2298	Btuh
Floor total	195 sqft	8514	Btuh
Infiltration	228 cfm	9240	Btuh
Duct loss		0	Btuh
Subtotal		36779	Btuh
Ventilation	0 cfm	0	Btuh
TOTAL HEAT LOSS		36779	Btuh

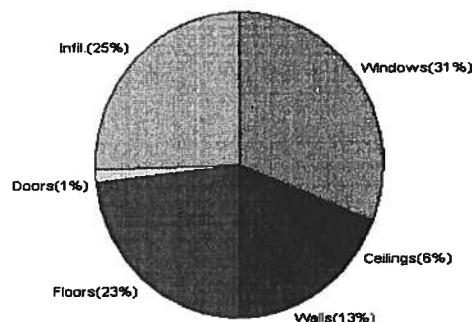

SUMMER CALCULATIONS

Summer Cooling Load (for 1901 sqft)

Load component		Load	
Window total	245 sqft	18080	Btuh
Wall total	1434 sqft	2892	Btuh
Door total	38 sqft	372	Btuh
Ceiling total	1950 sqft	3229	Btuh
Floor total		0	Btuh
Infiltration	200 cfm	3715	Btuh
Internal gain		4240	Btuh
Duct gain		0	Btuh
Sens. Ventilation	0 cfm	0	Btuh
Total sensible gain		32528	Btuh
Latent gain(ducts)		0	Btuh
Latent gain(infiltration)		7295	Btuh
Latent gain(ventilation)		0	Btuh
Latent gain(internal/occupants/other)		1600	Btuh
Total latent gain		8895	Btuh
TOTAL HEAT GAIN		41423	Btuh

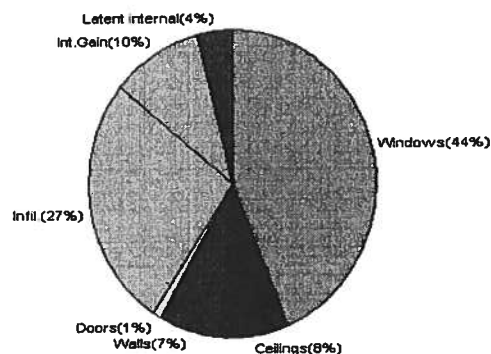

For Florida residences only

EnergyGauge® System Sizing

PREPARED BY: 06-04-07

DATE: 6-4-07

System Sizing Calculations - Winter

Residential Load - Whole House Component Details

Spec House

Project Title:

Code Only

Columbia Cnty, FL 32024-

Venture Point LLC - Lot 5 Hunters Oak

Professional Version

Climate: North

Reference City: Gainesville (Defaults) Winter Temperature Difference: 37.0 F

6/4/2007

Component Loads for Whole House

Window	Panes/SHGC/Frame/U	Orientation	Area(sqft) X	HTM=	Load
1	1, Clear, Metal, 1.27	W	18.0	47.0	846 Btuh
2	1, Clear, Metal, 1.27	W	40.0	47.0	1880 Btuh
3	1, Clear, Metal, 1.27	W	30.0	47.0	1410 Btuh
4	1, Clear, Metal, 1.27	N	30.0	47.0	1410 Btuh
5	1, Clear, Metal, 1.27	N	4.0	47.0	188 Btuh
6	1, Clear, Metal, 1.27	E	60.0	47.0	2819 Btuh
7	1, Clear, Metal, 1.27	E	30.0	47.0	1410 Btuh
8	1, Clear, Metal, 1.27	E	13.3	47.0	625 Btuh
9	1, Clear, Metal, 1.27	S	20.0	47.0	940 Btuh
Window Total			245(sqft)		11527 Btuh
Walls	Type	R-Value	Area X	HTM=	Load
1	Frame - Wood - Ext(0.09)	13.0	1263	3.3	4147 Btuh
2	Frame - Wood - Adj(0.09)	13.0	171	3.3	562 Btuh
Wall Total			1434		4708 Btuh
Doors	Type		Area X	HTM=	Load
1	Insulated - Adjacent		18	12.9	233 Btuh
2	Insulated - Exterior		20	12.9	259 Btuh
Door Total			38		492Btuh
Ceilings	Type/Color/Surface	R-Value	Area X	HTM=	Load
1	Vented Attic/D/Shin)	30.0	1950	1.2	2298 Btuh
Ceiling Total			1950		2298Btuh
Floors	Type	R-Value	Size X	HTM=	Load
1	Slab On Grade	0	195.0 ft(p)	43.7	8514 Btuh
Floor Total			195		8514 Btuh
Zone Envelope Subtotal:					27539 Btuh
Infiltration	Type	ACH X	Zone Volume	CFM=	Load
	Natural	0.80	17109	228.1	9240 Btuh
Ductload	Proposed leak free, R6.0, Supply(Attic), Return(Attic) (DLM of 0.00)				0 Btuh
Zone #1	Sensible Zone Subtotal				36779 Btuh

Manual J Winter Calculations

Residential Load - Component Details (continued)

Spec House

Project Title:

Code Only

Professional Version

Climate: North

Columbia Cnty, FL 32024-

Venture Point LLC - Lot 5 Hunters Oak

6/4/2007

WHOLE HOUSE TOTALS

	Subtotal Sensible	36779 Btuh
	Ventilation Sensible	0 Btuh
	Total Btuh Loss	36779 Btuh

Key: Window types (SHGC - Shading coefficient of glass as SHGC numerical value or as clear or tint)

(Frame types - metal, wood or insulated metal)

(U - Window U-Factor or 'DEF' for default)

(HTM - ManualJ Heat Transfer Multiplier)

Key: Floor size (perimeter(p) for slab-on-grade or area for all other floor types)



For Florida residences only

System Sizing Calculations - Winter

Residential Load - Room by Room Component Details

Spec House

Project Title:
Venture Point LLC - Lot 5 Hunters Oak

Code Only
Professional Version
Climate: North

Columbia Cnty, FL 32024-

Reference City: Gainesville (Defaults) Winter Temperature Difference: 37.0 F

6/4/2007

Component Loads for Zone #1: Main

Window	Panes/SHGC/Frame/U	Orientation	Area(sqft)	X	HTM=	Load
1	1, Clear, Metal, 1.27	W	18.0		47.0	846 Btuh
2	1, Clear, Metal, 1.27	W	40.0		47.0	1880 Btuh
3	1, Clear, Metal, 1.27	W	30.0		47.0	1410 Btuh
4	1, Clear, Metal, 1.27	N	30.0		47.0	1410 Btuh
5	1, Clear, Metal, 1.27	N	4.0		47.0	188 Btuh
6	1, Clear, Metal, 1.27	E	60.0		47.0	2819 Btuh
7	1, Clear, Metal, 1.27	E	30.0		47.0	1410 Btuh
8	1, Clear, Metal, 1.27	E	13.3		47.0	625 Btuh
9	1, Clear, Metal, 1.27	S	20.0		47.0	940 Btuh
Window Total			245(sqft)			11527 Btuh
Walls	Type	R-Value	Area	X	HTM=	Load
1	Frame - Wood - Ext(0.09)	13.0	1263		3.3	4147 Btuh
2	Frame - Wood - Adj(0.09)	13.0	171		3.3	562 Btuh
Wall Total			1434			4708 Btuh
Doors	Type		Area	X	HTM=	Load
1	Insulated - Adjacent		18		12.9	233 Btuh
2	Insulated - Exterior		20		12.9	259 Btuh
Door Total			38			492Btuh
Ceilings	Type/Color/Surface	R-Value	Area	X	HTM=	Load
1	Vented Attic/D/Shin)	30.0	1950		1.2	2298 Btuh
Ceiling Total			1950			2298Btuh
Floors	Type	R-Value	Size	X	HTM=	Load
1	Slab On Grade	0	195.0 ft(p)		43.7	8514 Btuh
Floor Total			195			8514 Btuh
Zone Envelope Subtotal:						27539 Btuh
Infiltration	Type	ACH X	Zone Volume	CFM=		Load
	Natural	0.80	17109	228.1		9240 Btuh
Ductload	Proposed leak free, R6.0, Supply(Attic), Return(Attic) (DLM of 0.00)					0 Btuh
Zone #1	Sensible Zone Subtotal					36779 Btuh

Manual J Winter Calculations

Residential Load - Component Details (continued)

Spec House

Project Title:

Code Only

Venture Point LLC - Lot 5 Hunters Oak

Professional Version

Columbia Cnty, FL 32024-

Climate: North

6/1/2007

WHOLE HOUSE TOTALS

	Subtotal Sensible	36779 Btuh
	Ventilation Sensible	0 Btuh
	Total Btuh Loss	36779 Btuh

Key: Window types (SHGC - Shading coefficient of glass as SHGC numerical value or as clear or tint)

(Frame types - metal, wood or insulated metal)

(U - Window U-Factor or 'DEF' for default)

(HTM - ManualJ Heat Transfer Multiplier)

Key: Floor size (perimeter(p) for slab-on-grade or area for all other floor types)



For Florida residences only

System Sizing Calculations - Summer

Residential Load - Whole House Component Details

Spec House

Project Title:

Code Only

Columbia Cnty, FL 32024-

Venture Point LLC - Lot 5 Hunters Oak

Professional Version

Climate: North

Reference City: Gainesville (Defaults) Summer Temperature Difference: 17.0 F

6/4/2007

Component Loads for Whole House											
Window	Type*		Overhang		Window Area(sqft)			HTM		Load	
	Pn/SHGC/U/InSh/ExSh/IS	Ornt	Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded		
1	1, Clear, 1.27, None,N,N	W	1.5ft	9ft.	18.0	0.0	18.0	37	94	1693	Btuh
2	1, Clear, 1.27, None,N,N	W	11.5f	9ft.	40.0	40.0	0.0	37	94	1498	Btuh
3	1, Clear, 1.27, None,N,N	W	1.5ft	9ft.	30.0	0.0	30.0	37	94	2821	Btuh
4	1, Clear, 1.27, None,N,N	N	1.5ft	9ft.	30.0	0.0	30.0	37	37	1124	Btuh
5	1, Clear, 1.27, None,N,N	N	1.5ft	9ft.	4.0	0.0	4.0	37	37	150	Btuh
6	1, Clear, 1.27, None,N,N	E	1.5ft	9ft.	60.0	0.0	60.0	37	94	5643	Btuh
7	1, Clear, 1.27, None,N,N	E	7.5ft	10ft.	30.0	7.3	22.7	37	94	2405	Btuh
8	1, Clear, 1.27, None,N,N	E	7.5ft	10ft.	13.3	5.8	7.5	37	94	924	Btuh
9	1, Clear, 1.27, None,N,N	S	1.5ft	9ft.	20.0	20.0	0.0	37	43	749	Btuh
	Excursion									1073	Btuh
	Window Total				245 (sqft)					18080 Btuh	
Walls	Type		R-Value/U-Value		Area(sqft)			HTM		Load	
1	Frame - Wood - Ext			13.0/0.09	1262.7			2.1		2634 Btuh	
2	Frame - Wood - Adj			13.0/0.09	171.0			1.5		258 Btuh	
	Wall Total				1434 (sqft)					2892 Btuh	
Doors	Type				Area (sqft)			HTM		Load	
1	Insulated - Adjacent				18.0			9.8		176 Btuh	
2	Insulated - Exterior				20.0			9.8		196 Btuh	
	Door Total				38 (sqft)					372 Btuh	
Ceilings	Type/Color/Surface		R-Value		Area(sqft)			HTM		Load	
1	Vented Attic/DarkShingle			30.0	1950.0			1.7		3229 Btuh	
	Ceiling Total				1950 (sqft)					3229 Btuh	
Floors	Type		R-Value		Size			HTM		Load	
1	Slab On Grade			0.0	195 (ft(p))			0.0		0 Btuh	
	Floor Total				195.0 (sqft)					0 Btuh	
	Zone Envelope Subtotal:									24573 Btuh	
Infiltration	Type		ACH		Volume(cuft)			CFM=		Load	
	SensibleNatural			0.70	17109			199.6		3715 Btuh	
Internal gain			Occupants		Btuh/occupant			Appliance		Load	
				8	X	230	+	2400		4240 Btuh	
Duct load	Proposed leak free, R6.0, Supply(Attic), Return(Attic)							DGM = 0.00		0.0 Btuh	
	Sensible Zone Load									32528 Btuh	

Manual J Summer Calculations

Residential Load - Component Details (continued)

Spec House

Project Title:

Code Only

Venture Point LLC - Lot 5 Hunters Oak

Professional Version

Columbia Cnty, FL 32024-

Climate: North

6/4/2007

WHOLE HOUSE TOTALS

Whole House Totals for Cooling	Sensible Envelope Load All Zones	32528 Btuh
	Sensible Duct Load	0 Btuh
	Total Sensible Zone Loads	32528 Btuh
	Sensible ventilation	0 Btuh
	Blower	0 Btuh
	Total sensible gain	32528 Btuh
	Latent infiltration gain (for 54 gr. humidity difference)	7295 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	0 Btuh
	Latent occupant gain (8 people @ 200 Btuh per person)	1600 Btuh
	Latent other gain	0 Btuh
	Latent total gain	8895 Btuh
	TOTAL GAIN	41423 Btuh

*Key: Window types (Pn - Number of panes of glass)

(SHGC - Shading coefficient of glass as SHGC numerical value or as clear or tint)

(U - Window U-Factor or 'DEF' for default)

(InSh - Interior shading device: none(N), Blinds(B), Draperies(D) or Roller Shades(R))

(ExSh - Exterior shading device: none(N) or numerical value)

(BS - Insect screen: none(N), Full(F) or Half(H))

(Ornt - compass orientation)



For Florida residences only

System Sizing Calculations - Summer

Residential Load - Room by Room Component Details

Spec House

Project Title:

Code Only

Venture Point LLC - Lot 5 Hunters Oak

Professional Version

Columbia Cnty, FL 32024-

Climate: North

Reference City: Gainesville (Defaults) Summer Temperature Difference: 17.0 F

6/4/2007

Component Loads for Zone #1: Main

Window	Type*	Ornt	Overhang		Window Area(sqft)			HTM		Load		
	Pn/SHGC/U/InSh/ExSh/IS		Len	Hgt	Gross	Shaded	Unshaded	Shaded	Unshaded			
1	1, Clear, 1.27, None,N,N	W	1.5ft	9ft.	18.0	0.0	18.0	37	94	1693	Btuh	
2	1, Clear, 1.27, None,N,N	W	11.5f	9ft.	40.0	40.0	0.0	37	94	1498	Btuh	
3	1, Clear, 1.27, None,N,N	W	1.5ft	9ft.	30.0	0.0	30.0	37	94	2821	Btuh	
4	1, Clear, 1.27, None,N,N	N	1.5ft	9ft.	30.0	0.0	30.0	37	37	1124	Btuh	
5	1, Clear, 1.27, None,N,N	N	1.5ft	9ft.	4.0	0.0	4.0	37	37	150	Btuh	
6	1, Clear, 1.27, None,N,N	E	1.5ft	9ft.	60.0	0.0	60.0	37	94	5643	Btuh	
7	1, Clear, 1.27, None,N,N	E	7.5ft	10ft.	30.0	7.3	22.7	37	94	2405	Btuh	
8	1, Clear, 1.27, None,N,N	E	7.5ft	10ft.	13.3	5.8	7.5	37	94	924	Btuh	
9	1, Clear, 1.27, None,N,N	S	1.5ft	9ft.	20.0	20.0	0.0	37	43	749	Btuh	
	Excursion									1073	Btuh	
	Window Total				245 (sqft)					18080 Btuh		
Walls	Type		R-Value/U-Value		Area(sqft)		HTM		Load			
1	Frame - Wood - Ext			13.0/0.09	1262.7			2.1	2634 Btuh			
2	Frame - Wood - Adj			13.0/0.09	171.0			1.5	258 Btuh			
	Wall Total				1434 (sqft)				2892 Btuh			
Doors	Type				Area (sqft)		HTM		Load			
1	Insulated - Adjacent				18.0			9.8	176 Btuh			
2	Insulated - Exterior				20.0			9.8	196 Btuh			
	Door Total				38 (sqft)				372 Btuh			
Ceilings	Type/Color/Surface		R-Value		Area(sqft)		HTM		Load			
1	Vented Attic/DarkShingle			30.0	1950.0			1.7	3229 Btuh			
	Ceiling Total				1950 (sqft)				3229 Btuh			
Floors	Type		R-Value		Size		HTM		Load			
1	Slab On Grade			0.0	195 (ft(p))			0.0	0 Btuh			
	Floor Total				195.0 (sqft)				0 Btuh			
	Zone Envelope Subtotal:									24573 Btuh		
Infiltration	Type		ACH		Volume(cuft)		CFM=		Load			
	SensibleNatural			0.70	17109			199.6	3715 Btuh			
Internal gain			Occupants		Btuh/occupant		Appliance		Load			
				8	X	230 +		2400	4240 Btuh			
Duct load	Proposed leak free, R6.0, Supply(Attic), Return(Attic)									DGM = 0.00		0.0 Btuh
	Sensible Zone Load									32528 Btuh		

Manual J Summer Calculations

Residential Load - Component Details (continued)

Spec House

Project Title:

Code Only

Venture Point LLC - Lot 5 Hunters Oak

Professional Version

Columbia Cnty, FL 32024-

Climate: North

6/4/2007

WHOLE HOUSE TOTALS

Whole House Totals for Cooling	Sensible Envelope Load All Zones	32528 Btuh
	Sensible Duct Load	0 Btuh
	Total Sensible Zone Loads	32528 Btuh
	Sensible ventilation	0 Btuh
	Blower	0 Btuh
	Total sensible gain	32528 Btuh
	Latent infiltration gain (for 54 gr. humidity difference)	7295 Btuh
	Latent ventilation gain	0 Btuh
	Latent duct gain	0 Btuh
	Latent occupant gain (8 people @ 200 Btuh per person)	1600 Btuh
	Latent other gain	0 Btuh
	Latent total gain	8895 Btuh
	TOTAL GAIN	41423 Btuh

*Key: Window types (Pn - Number of panes of glass)

(SHGC - Shading coefficient of glass as SHGC numerical value or as clear or tint)

(U - Window U-Factor or 'DEF' for default)

(InSh - Interior shading device: none(N), Blinds(B), Draperies(D) or Roller Shades(R))

(ExSh - Exterior shading device: none(N) or numerical value)

(BS - Insect screen: none(N), Full(F) or Half(H))

(Ornt - compass orientation)



For Florida residences only

Residential Window Diversity

MidSummer

Spec House

Project Title:

Columbia Cnty, FL 32024-

Venture Point LLC - Lot 5 Hunters Oak

Code Only

Professional Version


Climate: North

6/4/2007

Weather data for: Gainesville - Defaults

Summer design temperature	92 F	Average window load for July	14173 Btu
Summer setpoint	75 F	Peak window load for July	19498 Btu
Summer temperature difference	17 F	Excursion limit(130% of Ave.)	18425 Btu
Latitude	29 North	Window excursion (July)	1073 Btuh

WINDOW Average and Peak Loads

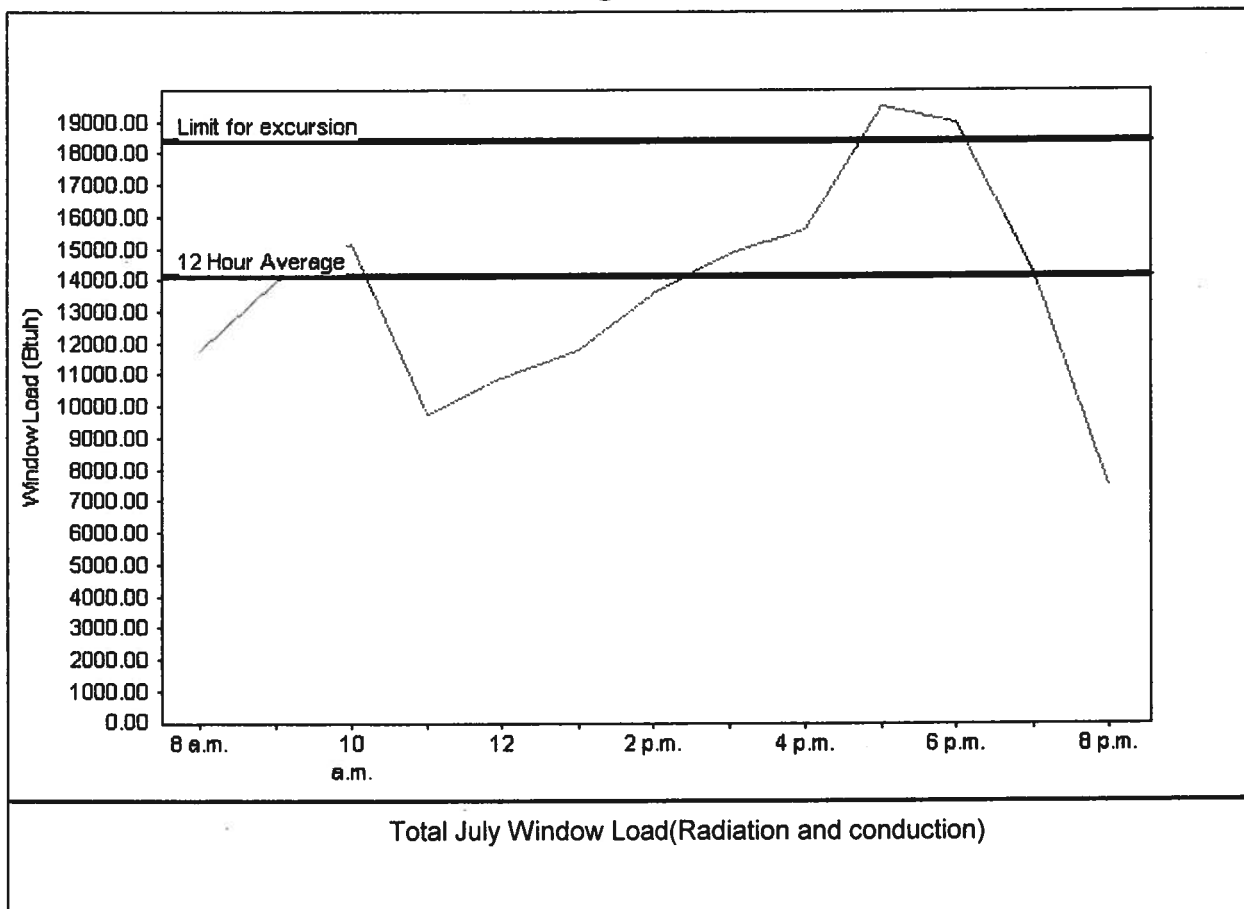

Warning: This application has glass areas that produce relatively large heat gains for part of the day. Variable air volume devices may be required to overcome spikes in solar gain for one or more rooms. A zoned system may be required or some rooms may require zone control.

EnergyGauge® System Sizing for Florida residences only

PREPARED BY: _____

DATE: _____





BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 375-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Premdor Entry Systems
911 E. Jefferson, P.O. Box 76
Pittsburgh, KS 66762

Your application for Notice of Acceptance (NOA) of:
Entergy 6-8 S/E Inswing Opaque Double w/sidelites Residential Insulated Steel Door
under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0314.23
EXPIRES: 04/02/2006

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL CONDITIONS BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 06/05/2001

Premdor Entry Systems

ACCEPTANCE No. 01-0314.23

APPROVED : JUN 05 2001

EXPIRES : April 02, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This renews the Notice of Acceptance No. 00-0321.25 which was issued on April 28, 2000. It approves a residential insulated door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The Series Entergy 6-8 S/E Inswing Opaque Double Residential Insulated Steel Doors with Sidelites-Impact Resistant Door Slab Only and its components shall be constructed in strict compliance with the following documents: Drawing No 31-1029-EM-I, Sheets 1 through 6 of 6, titled "Premdor (Entergy Brand) Double Door with Sidelites in Wood Frames with Bumper Threshold (Inswing)," prepared by manufacturer, dated 7/29/97 with revision C dated 01/11/00, bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 This approval applies to single unit applications of pair of doors and single door only, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.
- 3.2 Unit shall be installed only at locations protected by a canopy or overhang such that the angle between the edge of canopy or overhang to sill is less than 45 degrees. Unless unit is installed in non-habitable areas where the unit and the area are designed to accept water infiltration.

4. INSTALLATION

- 4.1 The residential insulated steel door and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters):
- 4.2.1 Door: the installation of this unit will not require a hurricane protection system.
- 4.2.2 Sidelite: the installation of this unit will require a hurricane protection system.

5. LABELING

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system


Manuel Perez, P.E. Product Control Examiner
Product Control Division

Premdor Entry Systems

ACCEPTANCE No. 01-0314.23


APPROVED : JUN 05-2001


EXPIRES : April 02, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS



1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE

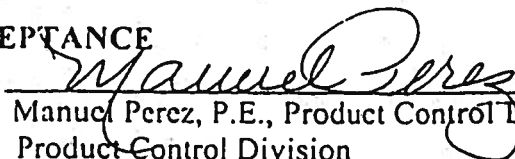
Manuel Perez, P.E., Product Control Examiner
Product Control Division

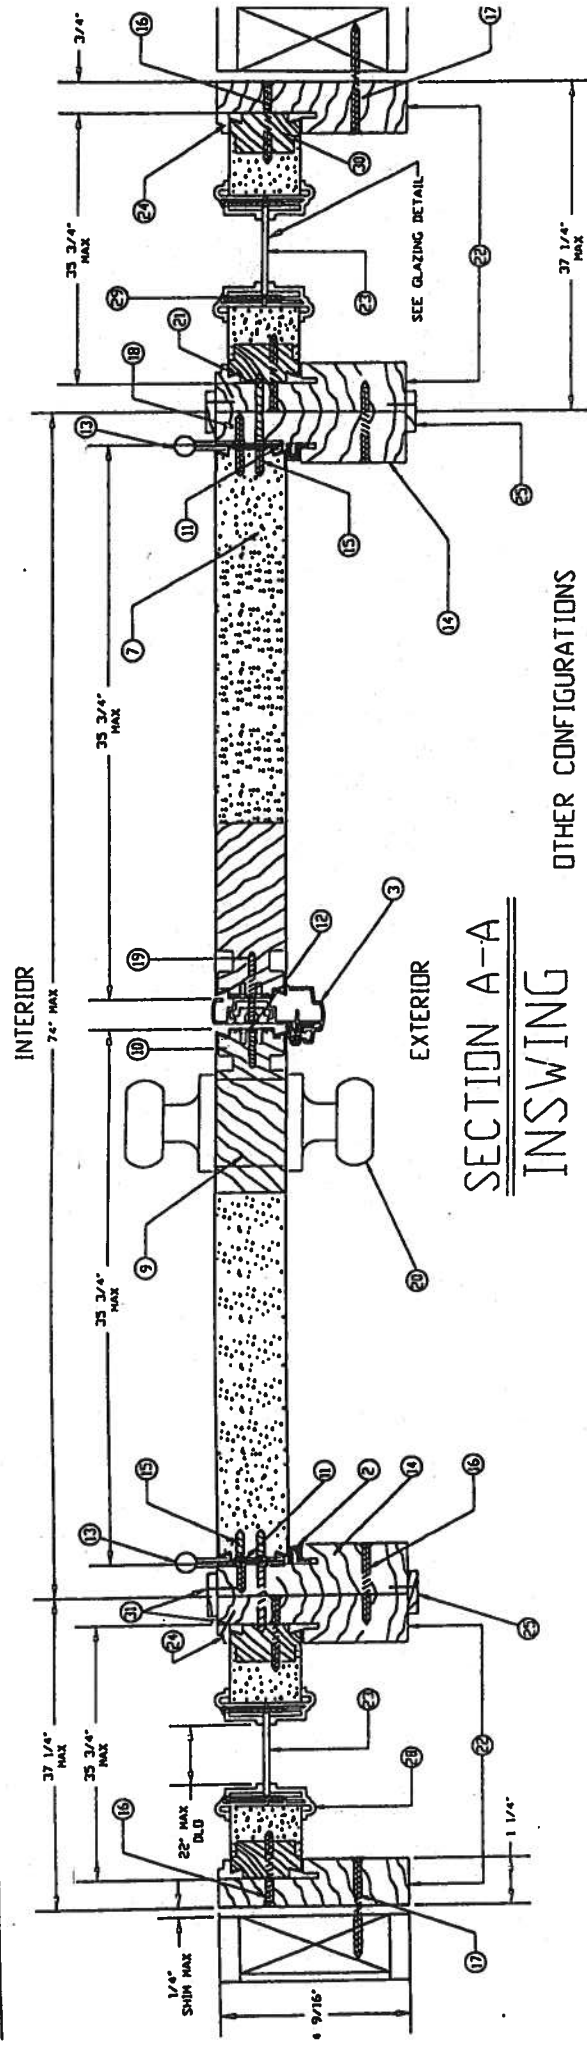

OTHER CONFIGURATIONS

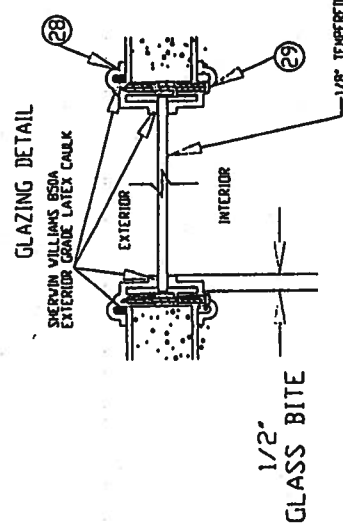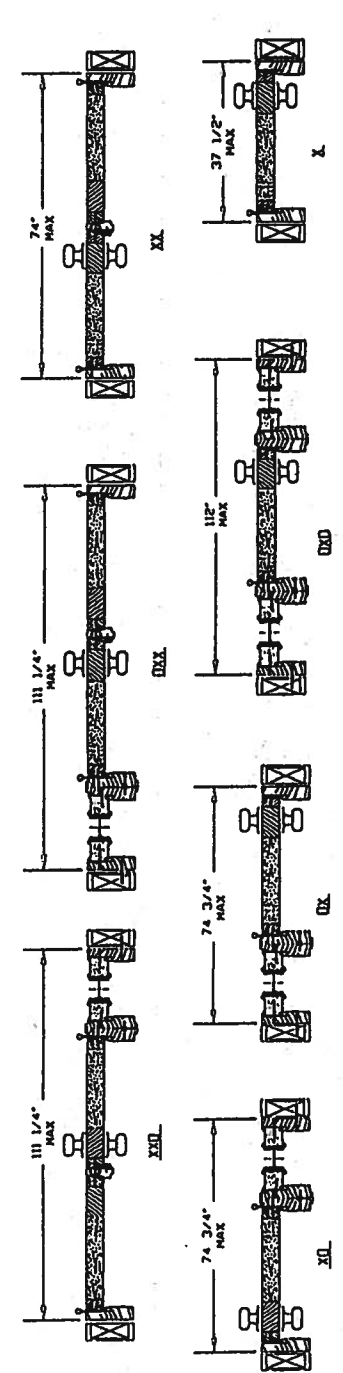

APPROVED AS COMPLYING WITH THE
SCM BUILDING CODE
DATE: JUN 15 2001
BY: [Signature]

PREMIER ENTRY SYSTEMS
1111 JORDON
PHILADELPHIA, PA 19104


31-1029-EM-1
SHEET 2 OF 6

C	DATE	REVISIONS
B	ADDED PAGE 3 (OPTIONAL)	
A	ADDED SCREWS TO LITE FRAMES & OTHER OTHER CONFIGURATIONS	
1	ORIGINAL	

REVISION LETTER C

MATERIALS LIST

ITEM NO.	DESCRIPTION	PART NUMBER	COMMENTS
1	WOOD HEAD JAMB	EM-14	1 1/4" X 4 9/16" MTL TO BE PINE OR EQUIVALENT
2	COMPRESSION WEATHERSTRIP	EM-25	LOCKSCREEN BRAND LONSEAL 9650-BRONZE
3	ALUMINUM ASTRAGAL	EM-12	PREMIOR BRAND OR EQUIVALENT - 5/8" ALUMINUM ASTRAL
4	ALUMINUM-BUMPER THRESHOLD	EM-15	PREMIOR BRAND OR EQUIVALENT - 1 1/4" X 4 9/16"
5	TOP CHANNEL	EM-08	PREMIOR BRAND - 1 11/16" - 20 GA STEEL
6	STEEL SKIN	28 GA 407 40M 400	MAX 100% THROUGH 2000 PSI MAX 100% THROUGH 2000 PSI
7	POLYURETHANE FOAM CORF	BASF FOAM -	DENSITY 2.0 TO 2.5 LBS./FT. ³
8	BOTTOM CHANNEL	EM-07	PREMIOR BRAND - 1 11/16" - 20 GA STEEL
9	WOOD LOCK BLOCK	EM-09	4" X 9 1/2" MTL TO BE PINE OR EQUIVALENT
10	STRIKE STILE	EM-06	PREMIOR BRAND - 1 11/16" - 20 GA STEEL
11	HINGE STILE	EM-05	PREMIOR BRAND - 1 11/16" - 20 GA STEEL
12	LOCK PREP FILLER PLATE	EM-10	PREMIOR BRAND - .050" THICK - MTL TO BE POLYETHYLE
13	4"x4" HINGE	EM-16	HAGER BRAND HINGE OR EQUIVALENT - .097 THICK (STE
14	WOOD HINGE JAMB	EM-13	1 1/4" X 4 9/16" MTL TO BE PINE OR EQUIVALENT
15	#10-24 x 1/2" F.H.V.S.		(1) SCREWS PER HINGE INTO DOOR
16	#10 X 2" F.H.V.S.		(2) SCREWS THROUGH HINGE JAMB INTO SIBELITE JAMB, 8" DOWN FROM MAX 18" O.C. THEREAFTER (3) SCREWS THROUGH STRIKE JAMB INTO SIBELITE JAMB, 4" DOWN FROM MAX 8" O.C. THEREAFTER (4) SCREWS THROUGH EACH SIBELITE JAMB INTO SIBELITE, 4" DOWN FROM TOP, MAX 15" O.C. THEREAFTER
17	100 PAVS VANDUIN 1/2" LONG SET OR 3/16" PPH TAPCONS VANDUIN 1/2" LONG SET		REFER TO ELEVATION VIEW FOR # OF SCREWS USED AND LOCATION
18	#10 X 3/4" F.H.V.S.		(2) SCREWS PER HINGE INTO JAMB
19	#8 X 2" F.H.V.S.		(2) SCREWS AT EACH STRIKE PLATE
20	LOCKSET		KVIKSET BRAND 200 LOCK OR HARLOC BRAND 100 LOCK
21	#10 X 1 3/4" F.H.V.S.		(2) SCREWS PER HINGE INTO JAMB
22	WOOD SIBELITE JAMB	EM-18	1 1/4" X 4 9/16" MTL TO BE PINE OR EQUIVALENT
23	22" X 64" SINGLE PANEL GLASS	EM-19	TEMPERED GLASS IN POLYPROPYLENE FRAME - BC-1643 - (COR
24	SIBELITE TRIM (WOOD)	EM-20	5/16" X 1/2" MTL TO BE PINE OR EQUIVALENT
25	WOOD CASING	EM-21	1/8" X 1" MTL TO BE PINE OR EQUIVALENT - TIEKS ARE HOLDINGS L FOR SIDE BY SIDE JAMBS AS MULLIONS
26	WOOD SIBELITE HEAD JAMB	EM-22	1 1/4" X 4 9/16" MTL TO BE PINE OR EQUIVALENT
27	WOOD SIBELITE BASE	EM-23	1 1/4" X 4 9/16" MTL TO BE PINE OR EQUIVALENT
28	POLYPROPYLENE LITE FRAME	BC-1643, OR-2	HP Polypropylene by ODL
29	#6 X 1 1/2" PAN HEAD SCREWS		SCREWS SPACING TO BE 2" IN FROM EACH CORNER AND 18 PER FRAME TO EXCEED 14" OF THERE AFTER
30	SIBELITE STILES	EM-26	15/16" X 1 11/16" MTL TO BE PINE OR EQUIVALENT
31	PIN NAIL		24" LONG NAIL, 4" IN FROM COR. MAX 8" O.C. THEREAFTER USED ON MULLIONS AND

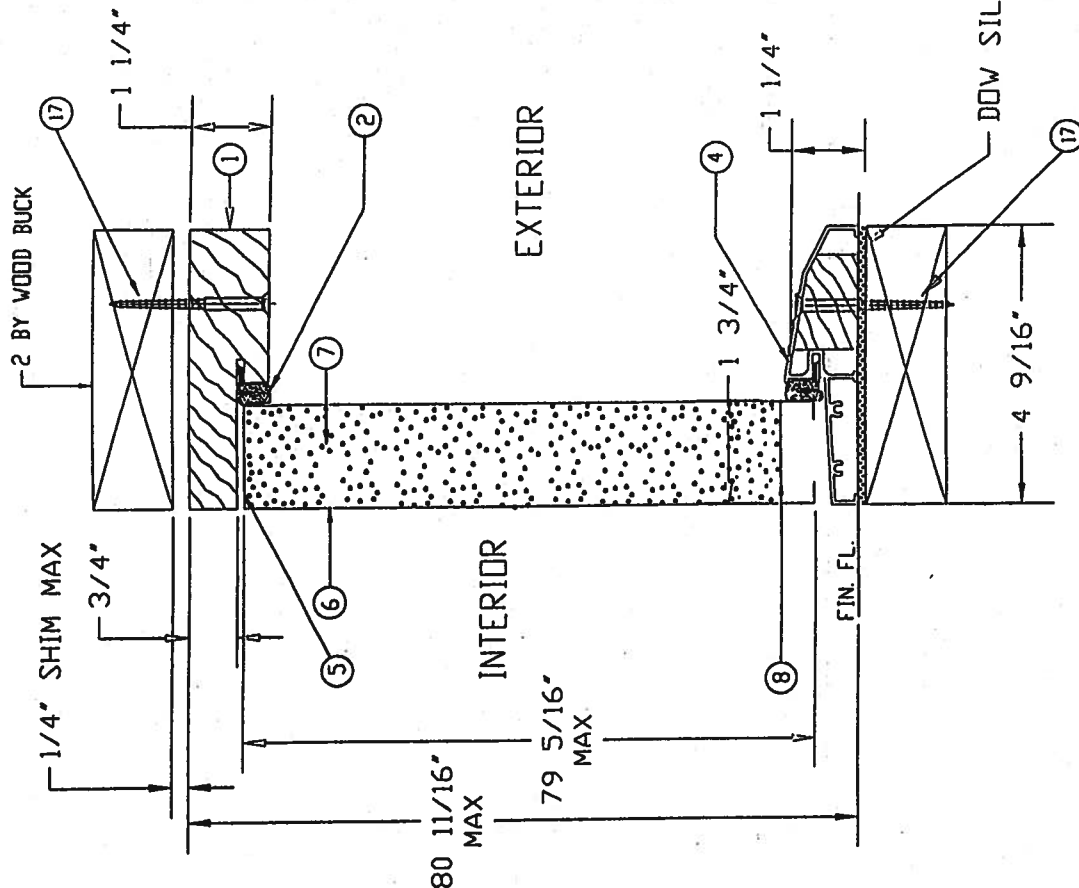


DOW SILICONE #995

SECTION B-B

APPROVED AS COMPLIES WITH THE
SOUTH FLORIDA BUILDING CODE
DATE: JUN 03 2001
BY: [Signature]
PROJECT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0314.2.3


UNITS: UNLESS NOTED, PRC. :		DC :	ANG :
EXTRUSIONS: UNLESS NOTED, STD. COMPL. 100'S			
ENGINEER:			
DR. BY R.S.	DATE 7-29-97		
PREMIOR ENTRY SYSTEMS			
911 L. JETERSON			
PITTSBURG, KS 66702			
31-1029-EM-1			
SHEET 3 OF 6			
REVISION LETTER B			




APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2005
BY *Maureen*
PROJECT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0314.23

LIMIT DUESS NOTED, PRC :		REC :		ANG :	
EXTENDING DUESS NOTED, STD CORR 100.3					
ENGINEER:		LIR :		REVISIONS	
DATE 7-29-97		PRG NAME: EXTRACT META. ENG. SUDLITE C-C		SCALE:	
PREDDOR ENTRY SYSTEMS		DATE:		31-1029-EM-1	
901 C. JEFFERSON				SHEET 4 OF 6	
PITTSBURG, KS 66102				REVISION LETTER D	


OTHER DOOR CONFIGURATIONS

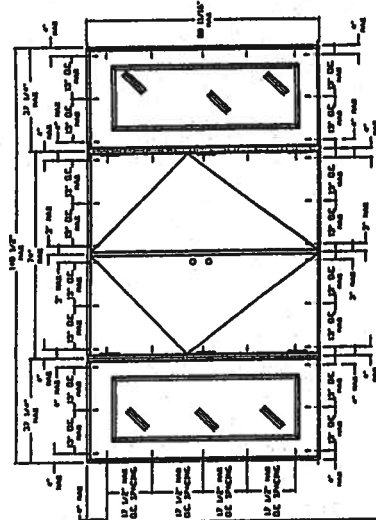


DXXD

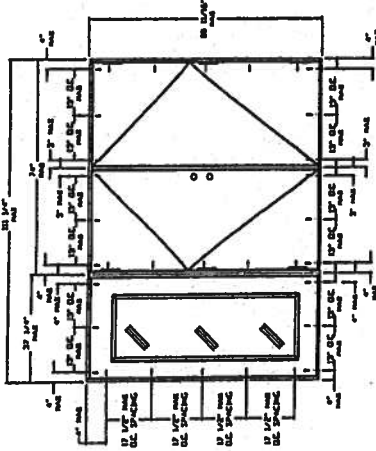


DXX

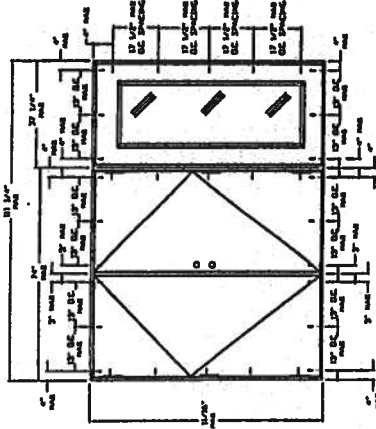


DXXD

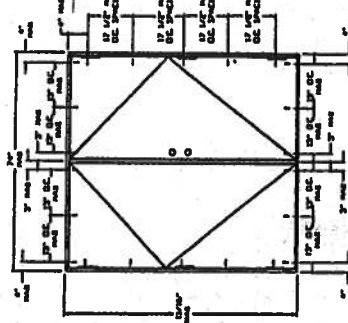


XX

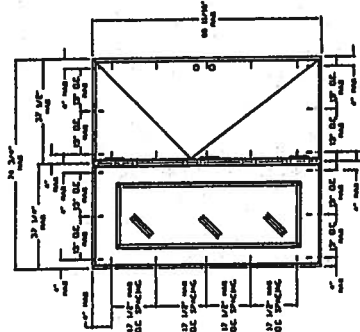


DX

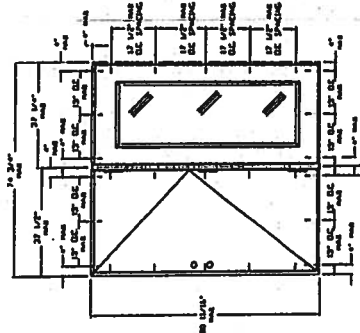

DX

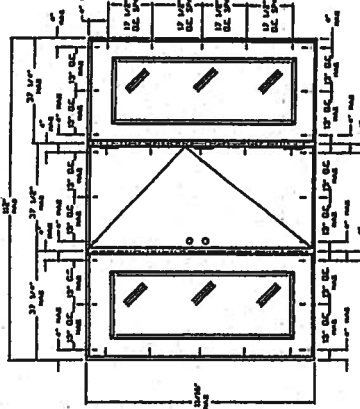

DXD

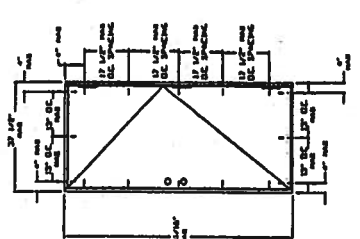








X

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2000
BY: [Signature]
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-03147-23

LIMITS: UNLESS NOTED, FABRIC : REC : ANGLE :		EXTENDING UNLESS NOTED, STD. CORR. 10.5	
ENGINEER:	DATE 1-11-01	SCALE:	REVISIONS
PREMIER ENTRY SYSTEMS	DATE 1-11-01	SCALE:	REVISIONS
31-1029-EM-I	DATE 1-11-01	SCALE:	REVISIONS
SHEET 5 OF 6	DATE 1-11-01	SCALE:	REVISIONS
REVISION LETTER		REVISION LETTER	













OTHER DOOR PANEL STYLES

79 5/16" MAX
36" MAX



OTHER SIDELITE STYLES


79 3/16" MAX
36" MAX



APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2001
BY *Maun...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO 01-0314.23

UNIT: INCHES MILLI METER	SCALE: 1/4" = 1'-0"	DATE: JUN 12/15/01	BY: J.L.
EXEMPTIONS: NONE	ENGINEER: J.L.	DATE: JUN 12/15/01	BY: J.L.
PREMIER ENTRY SYSTEMS			
PHILADELPHIA, PA 19102			
SHEET 6 OF 6			

PREMDOR (ENTERGY BRAND) DOUBLE DOOR WITH SIDELITES IN WOOD FRAMES WITH BUMPER THRESHOLD (INSWING)

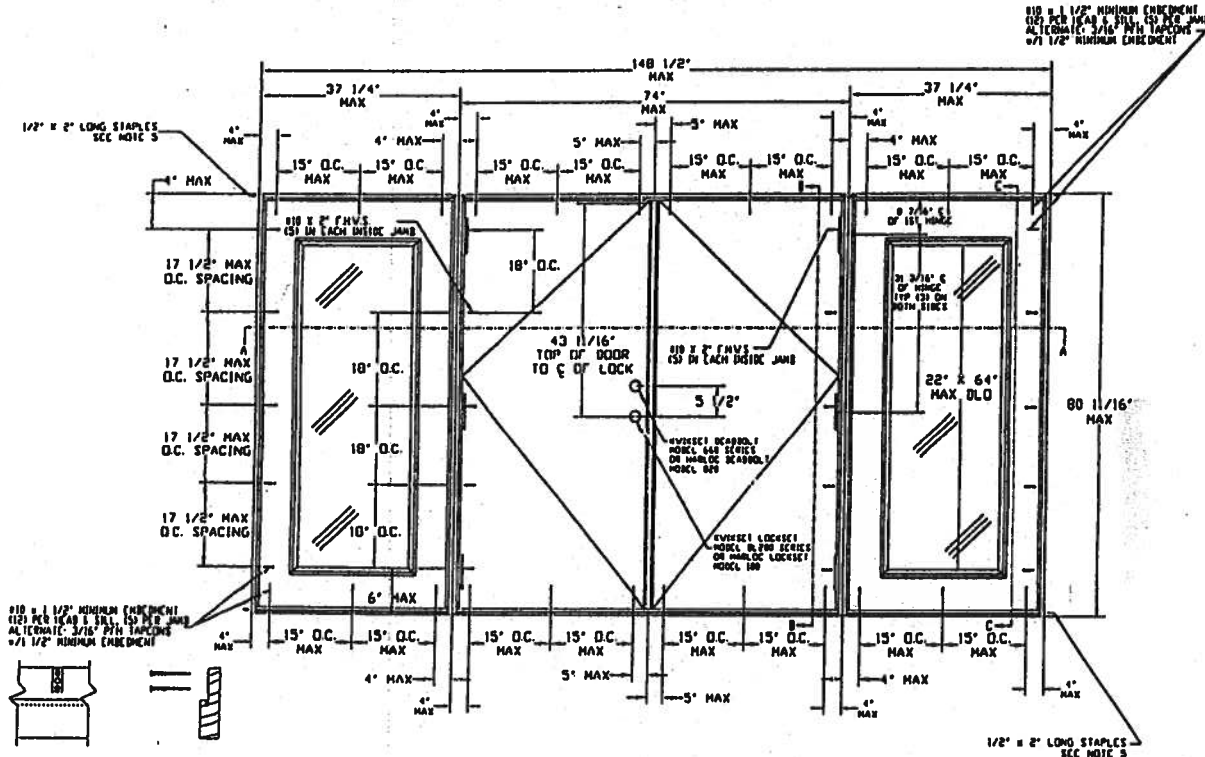

ATTACH ASTRAGAL THROW BOLT
STRIKE PLATE TO THE HEADER
AND THRESHOLD WITH #10 x 1 3/4\"/>

NOTES:

1. WOOD BUCKS BY OTHERS. MUST BE ANCHORED
PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
2. THE PRECEDING DRAWINGS ARE INTENDED TO
QUALIFY THE FOLLOWING INSTALLATIONS.

1. WOOD FRAME CONSTRUCTION WHERE DOOR
SYSTEM IS ANCHORED TO A MINIMUM TWO BY WOOD
JPCING.

1. MASONRY OR CONCRETE CONSTRUCTION WHERE
DOOR SYSTEM IS ANCHORED TO A MINIMUM TWO BY
STRUCTURAL WOOD BUCK.

1. MASONRY OR CONCRETE CONSTRUCTION WHERE
DOOR SYSTEM IS ANCHORED DIRECTLY TO CONCRETE
OR MASONRY WITH OR WITHOUT A NON-STRUCTURAL
INC BY WOOD BUCK.

1. ALL ANCHORING SCREWS TO BE #10 WITH
MINIMUM 1 1/2\"/>

1. UNIT MUST BE INSTALLED WITH 'MIAMI-DADE COUNTY
APPROVED' SHUTTERS


1. THREE STAPLES PER SIDE JAMB INTO HEADER ON SIDELITES
AND DOOR, THREE STAPLES PER JAMB INTO THRESHOLD ON
SIDELITES AND DOOR.

1. LATEX SEALANT TO BE APPLIED AT SIDE BY SIDE
AMBS AND SIDELITES.


1. DOOR/SIDELITE HEADER, DOOR/SIDELITE JAMBS, AND SIDELITE BASE
ORNERS ARE COPED AND BUTT JOINED.

1. DOORS SHALL BE PRE-PAINTED WITH A WATER-BASED EPOXY RUST
INHIBITIVE PRIMER PAINT WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.

1. FRAMES SHALL BE PRE-PAINTED WITH AN ACRYLIC LATEX WATER-BASED/
WATER-REDUCIBLE WHITE PRIMER WITH A DRY FILM THICKNESS OF 0.8 TO 1.2 MIL.



ASTRAGAL



DESIGN PRESSURE RATINGS		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED *	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
Positive	NOT APPROVED *	+55.0 psf
Negative	NOT APPROVED *	-55.0 psf

* UNITS SHALL BE INSTALLED ONLY AT LOCATIONS PROTECTED BY A CANOPY OR
OVERHANG SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG
TO SILL IS LESS THAN 45 DEGREES. UNLESS UNIT IS INSTALLED IN
NON-HABITABLE AREAS WHERE THE UNIT AND THE AREA ARE DESIGNED TO
ACCEPT WATER INFILTRATION.

APPROVED AS COMPLYING WITH THE

SOUTH FLORIDA BUILDING CODE

DATE JUN 05 2001

BY *Michael Terry*

PRODUCT CONTROL DIVISION

BUILDING CODE COMPLIANCE OFFICE

ACCEPTANCE NO. 01-0314.23

UNITS: UNLESS NOTED, FRAM : (CC : AVG :	C	DADE COUNTY MODIFICATIONS	10/11/00	JD
EXTRUSIONS: UNLESS NOTED, SIB COM. 101'S	A	ADDED PAGE 5 (DOOR OPTIONS)	10-1-98	RS
ENGINEER:	LIB	ADD OTHER DOOR CONFIGURATIONS	12/09/97	RS
DATE: 7-29-97	LIB	REVISIONS	DATE	BY
PREMDOR ENTRY SYSTEMS	PREMDOR ENTRY SYSTEMS	PREMDOR ENTRY SYSTEMS	PREMDOR ENTRY SYSTEMS	PREMDOR ENTRY SYSTEMS
911 E. JEFFERSON	911 E. JEFFERSON	911 E. JEFFERSON	911 E. JEFFERSON	911 E. JEFFERSON
PULPINBURG, MS 39132	PULPINBURG, MS 39132	PULPINBURG, MS 39132	PULPINBURG, MS 39132	PULPINBURG, MS 39132
31-1029-EM-1	31-1029-EM-1	31-1029-EM-1	31-1029-EM-1	31-1029-EM-1
SHEET 1 OF 6	SHEET 1 OF 6	SHEET 1 OF 6	SHEET 1 OF 6	SHEET 1 OF 6



March 6, 2002

Subject: Elk Product Approval Information

All Prestique® and Capstone® products manufactured in Tuscaloosa, AL are certified under the Miami – Dade County Building Code Office (BCCO). These products also meet the requirements for the Florida Building Code since they are MD approved. The following test protocols must be passed by each of the products in order for MD product certification:

ASTM D3462

PA 100 (110 mph uplift and wind driven rain resistance)

PA 107 (Modified ASTM D3161 - 110 mph wind uplift resistance)

The nailing patterns that were used during the PA 100 and PA 107 wind test protocols for the Prestique and Capstone products are listed below. Also listed below are the Miami – Dade Notice of Acceptance Numbers (NOA).

Raised Profile, Prestique High Definition, Prestique 25, or Prestique 30 –

PA 100 = 4 nails

PA 107 = 5 nails

MD NOA# = 01-1226.04

Prestique I 35 or Prestique I* –

PA 100 = 4 nails

PA 107 = 5 nails

MD NOA# = 01-1226.05

Prestique Plus or Prestique Gallery Collection* –

PA 100 = 4 nails

PA 107 = 4 nails

MD NOA# = 01-1226.03

Capstone*

PA 100 = 4 Nails

PA 107 = 4 Nails

MD NOA# = 01-0523.01


* As per the Elk Limited Warranty, six nails are required for the Elk high wind warranty.

If there are any questions please contact:


Mike Reed – Technical Manager
(205) 342-0287

or

Daniel DeJarnette – QA Engineer
(205) 342-0298



**PRESTIQUE®
HIGH DEFINITION®**



RAISED PROFILE™

**Prestique Plus High Definition
and Prestique Gallery Collection***

Product size.....13"x 39"
Exposure.....5"
Pieces/Bundle.....16
Bundles/Square.....4/98.5 sq.ft.
Squares/Pallet.....11

50-year limited warranty period:
non-prorated coverage for
shingles and application labor for
the initial 5 years, plus an option
for transferability*; prorated
coverage for application labor and
shingles for balance of limited
warranty period; 5-year limited
wind warranty*.

Raised Profile

Product size.....13"x 38"
Exposure.....5"
Pieces/Bundle.....22
Bundles/Square.....3/100 sq.ft.
Squares/Pallet.....16

30-year limited warranty period:
non-prorated coverage for
shingles and application labor for
the initial 5 years, plus an option
for transferability*; prorated
coverage for application labor and
shingles for balance of limited
warranty period; 5-year limited
wind warranty*.

Prestique I High Definition

Product size.....13"x 39"
Exposure.....5"
Pieces/Bundle.....16
Bundles/Square.....4/98.5 sq.ft.
Squares/Pallet.....14

40-year limited warranty period:
non-prorated coverage for
shingles and application labor for
the initial 5 years, plus an option
for transferability*; prorated
coverage for application labor and
shingles for balance of limited
warranty period; 5-year limited
wind warranty*.

HIP AND RIDGE SHINGLES

Seal-A-Ridge w/FLX®

Size: 12"x 12"
Exposure: 6"
Pieces/Bundle: 45
Coverage: 4 Bundles = 100 linear feet

Prestique High Definition

Product size.....13"x 38"
Exposure.....5"
Pieces/Bundle.....22
Bundles/Square.....3/100 sq.ft.
Squares/Pallet.....16

30-year limited warranty period:
non-prorated coverage for
shingles and application labor for
the initial 5 years, plus an option
for transferability*; prorated
coverage for application labor and
shingles for balance of limited
warranty period; 5-year limited
wind warranty*.

Elk Starter Strip

52 Bundles/Pallet
18 Pallets/Truck
936 Bundles/Truck
19 Pieces/Bundle
1 Bundle = 120.33 linear feet

Available Colors: Antique Slate, Weatheredwood, Shakedown, Sablewood, Hickory, Barkwood**, Forest Green, Wedgewood**, Birchwood**, Sandalwood.
Gallery Collection: Balsam Forest*, Weathered Sage*, Sierra Sunset*.

All Prestique, Raised Profile and Seal-A-Ridge roofing products contain Elk WindGuard® sealant. WindGuard activates with the sun's heat, bonding shingles into a wind and weather resistant cover that resists blow-offs and leaks.

Check for availability with built-in StainGuard® treatment to inhibit the discoloration of roofing granules caused by the growth of certain types of algae. Not available in Sablewood.

All Prestique and Raised Profile shingles meet UL® Wind Resistant (UL 997) and Class "A" Fire Ratings (UL 790); and ASTM Specifications D 3018, Type-I; D 3161, Type-I; E 108 and the requirements of ASTM D 3462.

All Prestique and Raised Profile shingles meet the latest Metro Dade building code requirements.

*See actual limited warranty for conditions and limitations.
**Check for product availability.

SPECIFICATIONS

SCOPE: Work includes furnishing all labor, materials and equipment necessary to complete installation of (name) shingles specified herein. Color shall be (name of color). Hip and ridge type to be Elk Seal-A-Ridge with formula FLX.

All exposed metal surfaces (flashing, vents, etc.) to be painted with matching Elk roof accessory paint.

PREPARATION OF ROOF DECK: Roof deck to be dry, well-seasoned 1" x 6" (25.4mm x 152.4mm) boards; exterior-grade plywood (exposure 1 rated sheathing) at least 3/8" (9.525mm) thick conforming to the specifications of the American Plywood Association; 7/16" (11.074mm) oriented strandboard; or chipboard. Most fire retardant plywood decks are NOT approved substrates for Elk shingles. Consult Elk Field Service for application specifications over other decks and other slopes.

MATERIALS: Underlayment for standard roof slopes, 4" per foot (101.6/304.8mm) or greater; apply non-perforated No. 15 or 30 asphalt-saturated felt underlayment. For low slopes (4" per foot (101.6/304.8mm) to a minimum of 2" per foot (50.8/304.8mm)), use two plies of underlayment overlapped a minimum of 19". Fasteners shall be of sufficient length and holding power for securing material as required by the application instructions printed on shingle wrapper.

For areas where algae is a problem, shingles shall be (name) with StainGuard treatment, as manufactured by the Elk Tuscaloosa plant. Hip and ridge type to be Seal-A-Ridge with formula FLX with StainGuard treatment.

Complete application instructions are published by Elk and printed on the back of every shingle bundle. All

warranties are contingent upon the correct installation as shown on the instructions. These instructions are the minimum required to meet Elk application requirements. In some areas, building codes may require additional application techniques or methods beyond our instructions. In these cases, the local code must be followed. Under no circumstances will Elk accept application requirements less than those contained in its application instructions.

For specifications in CSI format, call 800.354.SPEC (7732) or e-mail specinfo@elkcorp.com.

**SOUTHEAST &
ATLANTIC OFFICE:**
800.945.5551


CORPORATE HEADQUARTERS:
800.354.7732

PLANT LOCATION:
800.945.5545


ELK
www.elkcorp.com
SSOOT 01/02

DIRECTIONS FOR APPLICATION


Please read carefully. Failure to follow these instructions may void the product warranty. See specific application instructions for Prestique® Plus and Prestique Gallery Collection™ 110 MPH and Prestique 1 90 MPH limited wind warranty requirements.

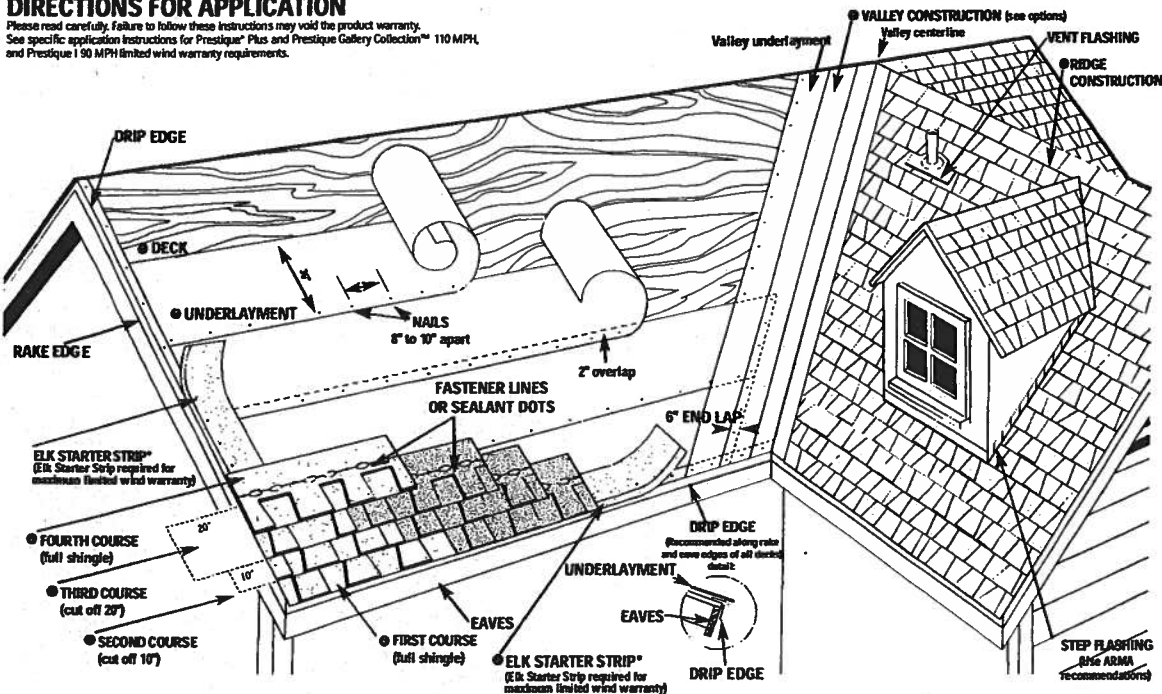


● VALLEY CONSTRUCTION OPTION (California Open and California Closed are also acceptable) NOTE: For complete ARMA valley installation details, see ARMA Residential Asphalt Roofing Manual.



VALLEY CENTER LINE



VALLEY CENTER LINE



VALLEY CENTER LINE

DIRECTIONS FOR APPLICATION

These application instructions are the minimum required to meet Elk's application requirements. Your failure to follow these instructions may void the product warranty. In some areas, the building codes may require additional application techniques or methods beyond our instructions. In these cases, the local code must be followed. Under no circumstances will Elk accept application requirements that are less than those printed here. Shingles should not be jammed tightly together. All attics should be properly ventilated. Note: It is not necessary to remove tape on back of shingle.

● DECK PREPARATION

Roof decks should be dry, well-seasoned 1" x 6" boards or exterior grade plywood minimum 3/8" thick and conform to the specifications of the American Plywood Association or 7/16" oriented strandboard, or 7/16" chipboard.

● UNDERLAYMENT

Apply underlayment (Non-Perforated No. 15 or 30 asphalt saturated felt). Cover drip edge at eaves only.

For low slope (2/12 up to 4/12), completely cover the deck with two plies of underlayment overlapping a minimum of 18". Begin by fastening a 19" wide strip of underlayment placed along the eaves. Place a full 36" wide sheet over the starter, horizontally placed along the eaves and completely overlapping the starter strip.

EAVE FLASHING FOR ICE DAMS (ASK A ROOFING CONTRACTOR, REFER TO ARMA MANUAL OR CHECK LOCAL CODES)

For standard slope (4/12 to less than 21/12), use coated roll roofing of no less than 50 pounds over the felt underlayment extending from the eave edge to a point at least 24" beyond the inside wall of the living space below or one layer of a self-adhered eave and flashing membrane.

For low slope (2/12 up to 4/12), use a continuous layer of asphalt plastic cement between the two plies of underlayment from the eave edge up roof to a point at least 24" beyond the inside wall of the living space below or one layer of a self-adhered eave and flashing membrane.

Consult the Elk Field Service Department for application specifications over other decks and other slopes.

● STARTER SHINGLE COURSE

USE AN ELK STARTER STRIP OR A STRIP SHINGLE INVERTED WITH THE HEADLAP APPLIED AT THE EAVE EDGE. With at least 4" trimmed from the end of the first shingle, start at the rake edge overhanging the eave 1/2" to 3/4". Fasten 2" from the lower edge and 1" from each side. Shingles may be applied with a course alignment of 45° on the roof.

● FIRST COURSE

Start at rake and continue course with full shingles laid flush with the starter course.

● SECOND COURSE

Start at the rake with the shingle having 10" trimmed off and continue across roof with full shingles.

● THIRD COURSE

Start at the rake with the shingle having 20" trimmed off and continue across roof with full shingles.

● FOURTH COURSE

Start at the rake and continue with full shingles across roof.

FIFTH AND SUCCEEDING COURSES.

Repeat application as shown for second, third, and fourth courses. Do not rock shingles straight up the roof.

● VALLEY CONSTRUCTION

Open, woven and closed cut valleys are acceptable when applied by Asphalt Roofing Manufacturing Association (ARMA) recommended procedures. For metal valleys, use 36" wide vertical underlayment prior to applying 18" metal flashing (secure edge with nails). No nails are to be within 6" of valley center.

● RIDGE CONSTRUCTION

For ridge construction use Class "A" Seal-A-Ridge® with formula FLX® (See ridge package for installation instructions.)

FASTENERS

While nailing is the preferred method for Elk shingles, Elk will accept fastening methods according to the following instructions.

Always nail or staple through the fastener line or on products without fastener lines, nail or staple between and in line with sealant dots.

NAILS: Corrosive resistant, 3/8" head, minimum 12-gauge roofing nails. Elk recommends 1-1/4" for new roofs and 1-1/2" for re-roofs. In cases where you are applying shingles to a roof that has an exposed overhang, for new roofs only 3/4" ring shank nails are allowed to be used from the eave's edge to a point up the roof that is past the outside wall line. 1" ring shank nails allowed for re-roof.

STAPLES: Corrosive resistant, 16-gauge minimum, crown width minimum of 15/16". Note: An improperly adjusted staple gun can result in raised staples that can cause a fish-mouthed appearance and can prevent sealing.

Fasteners should be long enough to obtain 3/4" deck penetration or penetration through deck, whichever is less.


MANSARD APPLICATIONS

Correct fastening is critical to the performance of the roof. For slopes exceeding 60° (or 21/12) use six fasteners per shingle. Locate fasteners in the fastener area 1" from each side edge with the remaining four fasteners equally spaced along the length of the double thickness (laminated) area. Only fastening methods according to the above instructions are acceptable.

LIMITED WIND WARRANTY

For a Limited Wind Warranty, all Prestique and Raised Profile® shingles must be applied with 4 properly placed fasteners, or in the case of mansard applications, 6 properly placed fasteners per shingle.

For a Limited Wind Warranty up to 110 MPH for Prestique Gallery Collection or Prestique Plus or 90 MPH for Prestique I, shingles must be applied with 6 properly placed NAILS per shingle. SHINGLES APPLIED WITH STAPLES WILL NOT QUALIFY FOR THIS ENHANCED LIMITED WIND WARRANTY. Also, Elk Starter Strip shingles must be applied at the eaves and rake edges to qualify Prestique Plus, Prestique Gallery Collection and Prestique I shingles for this enhanced Limited Wind Warranty. Under no circumstances should the Elk Shingles or the Elk Starter Strip overhang the eaves or rake edge more than 3/4" of an inch.



HELP STOP BLOW-OFFS AND CALL-BACKS

A minimum of four fasteners must be driven into the DOUBLE THICKNESS (laminated) area of the shingle. Nails or staples must be placed along – and through – the "fastener line" or on products without fastener lines, nail or staple between and in line with sealant dots. CAUTION: Do not use fastener line for shingle alignment.



Refer to local codes which in some areas may require specific application techniques beyond those Elk has specified. All Prestique and Raised Profile shingles have a UL® Wind Resistance Rating when applied in accordance with these instructions using nails or staples on re-roofs as well as new construction.

CAUTION TO WHOLESALER: Careless and improper storage or handling can harm fiberglass shingles. Keep these shingles completely covered, dry, reasonably cool, and protected from the weather. Do not store near various sources of heat. Do not store in direct sunlight until applied. DO NOT DOUBLE STACK. Systematically rotate all stock so that the material that has been stored the longest will be the first to be moved out.

© 2002 Elk Corporation of Dallas.

All trademarks & are registered trademarks of Elk Corporation of Dallas, an ELCOR company. Raised Profile, RidgeCrest, Gallery Collection and FLX are trademarks pending registration of Elk Corporation of Dallas. UL is a registered trademark of Underwriters Laboratories, Inc.

ELK
www.elkcorp.com

FLORIDA DEPARTMENT OF
Community Affairs



[BCIS Home](#) | [Log In](#) | [Hot Topics](#) | [Submit Surcharge](#) | [Stats & Facts](#) | [Publications](#) | [FBC Staff](#) | [B](#)



Product Approval
USER: Public User

Product Approval Menu > Product or Application Search > Application List > Application Detail

FL # FL1476-R2

Application Type Revision

Code Version 2004

Application Status	Approved
---------------------------	-----------------

Comments

Archived

Product Manufacturer

Elk Corporation

Address/Phone/Email

4600 Stillman Blvd.
Tuscaloosa, AL 35401

(205) 342-0298

daniel.dejarnette@elkcorp.com

Authorized Signature

Daniel DeJarnette

daniel.dejarnette@elkcorp.com

Technical Representative

Daniel DeJarnette

Address/Phone/Email

4600 Stillman Blvd
Tuscaloosa, AL 35401

(205) 342-0298

daniel.dejarnette@elkcorp.com

Quality Assurance Representative

Address/Phone/Email

Category

Roofing

Subcategory

Asphalt Shingles

Compliance Method

Certification Mark or Listing

Certification Agency

Underwriters Laboratories Inc.

Referenced Standard and Year (of Standard)

Standard

ASTM D3462

TAS 107

Equivalence of Product Standards Certified By

Product Approval Method

Method 1 Option A

Date Submitted

09/20/2005

Date Validated

09/27/2005

Date Pending FBC Approval

09/29/2005

Date Approved

10/11/2005

Summary of Products

FL #	Model, Number or Name	Description
1476.1	Elk Prestique Shingles	Laminated Asphalt Shingles
Limits of Use (See Other) Approved for use in HVHZ: Approved for use outside HVHZ: Impact Resistant: Design Pressure: +/- Other: 1) All FBC sections apply except for those pertaining to Miami - Dade and Broward Counties 2) Refer to NOA # 0500706.07 for use in Dade and Broward Counties		Certification Agency Certificate Installation Instruction PTID 1476 R2 I Specs PTID 1476 R2 I UL Pre-verified Verified By:

Back

Next

DCA Administration

Department of Community Affairs
Florida Building Code Online
Codes and Standards

2555 Shumard Oak Boulevard
 Tallahassee, Florida 32399-2100

(850) 487-1824, Suncom 277-1824, Fax (850) 414-8436


© 2000-2005 The State of Florida. All rights reserved. Copyright and Disclaimer

Product Approval Accepts:



CERTIFIED TESTING LABORATORIES

Architectural Division • 7252 Narcoossee Rd. • Orlando, FL 32822
(407) 384-7744 • Fax (407) 384-7751
Web Site: www.ctlarch.com
E-mail: ctlarch.com

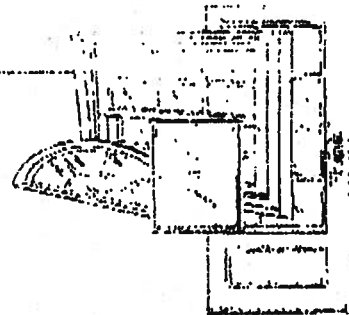

Report Number: CTLA-1038W-2-AWT
Report Date: March 4, 2003

STRUCTURAL PERFORMANCE TEST REPORT

Client: ACTION WINDOW TECHNOLOGY INC.
1312 W. CROSBY ROAD
CARROLLTON, TX 75006

Product Type and Series: AWT Series 3180 Vinyl Fin Frame Picture Window F-R80 (48" x 72")

Test Specifications: AAMA/NWWDA 101/1.5 2-97 "Voluntary Specifications for Aluminum, Vinyl (PVC) and Wood Windows and Glass Doors"

Frame: Vinyl Fin frame measured 47.50" wide x 71.50" high overall. Mitered corner weld construction. Clear lite measured 44.50" wide x 68.50" high.

Ventilator: N/A

Weather Stripping: N/A

Hardware & Location: N/A

Glazing: 3/4" insulated muntined glass consisting of .1875" glass .375" air space with swiggle .1875" glass. Sash exterior glazed. Fixed lite interior glazed adhesive foam strip backbedding and vinyl snap in glazing bead.

Sealant: A silicone type sealant was used at frame corners and to seal specimen to test buck.

Weep System: N/A

Muntins: N/A

Reinforcement: N/A

Additional Description: N/A

Screen: N/A

Installation: Twenty-eight (28) 1.75" roofing nails were used to secure the specimen to the wood test buck. Six (6) were located in head and sill measuring 5.50", 13", 20.625", 28.25", 35.875" and 43.50" from left jamb. Eight (8) were located in each jamb measuring 5.50", 14", 22.75", 31.50", 40", 48.75", 57.75" and 66.50" from sill.

Surface Finish: White Vinyl

Comment: Nominal 2 mil polyethylene film was used to seal against air leakage during structural loads. The film was used in a manner that did not influence the test results.

Performance Test Results

<u>Paragraph No</u>	<u>Title of Test</u>	<u>Method</u>	<u>Measured</u>	<u>Allowed</u>
2.1.2	Air Infiltration @ 1.57 psf	ASTM E283-91	.02 cfm/ft ²	.34 cfm/ft ²

The tested specimen meets or exceeds the performance levels specified in AAMA/NWDA 101/IS-2-97. Results recorded in two (2) decimals at the clients request.

2.1.3	Water Resistance @ 5.0 gph/ft ²	ASTM E547-93 Four (4) five (5) minute cycles	No Entry	No Entry
	WTP= 13.5 psf	ASTM E331-93 Fifteen (15) minute duration	No Entry	No Entry

2.1.4.2	Uniform Load Structural Permanent Deformation @ 120 psf positive @ 120 psf negative	ASTM E330-90 Ten (10) second load	Neg. Neg.	.192" .192"
---------	----------------------------------------------------------------------------------------------	--------------------------------------	--------------	----------------

2.1.7	Welded Corner Test	AAMA/NWDA 101/IS2-97	Passed
-------	--------------------	----------------------	--------

2.1.8	Forced Entry Resistance Test D Window Assemblies This specimen as tested complies to a grade 10-T1-5 minutes Tools used: A spatula (10.1.1.1) and a piece of stiff wire (10.1.3.2)	ASTM F 588-97	Passed
-------	---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	---------------	--------

Test Date January 28, 2003


Test Completion Date: January 28, 2003

Remarks: Detailed drawings were available for laboratory records and comparison to the test specimen at the time of this report. A copy of this report along with representative sections of the test specimen will be retained by CTL for a period of four (4) years. The results obtained apply only to the specimen tested.

This test report does not constitute certification of this product, but only that the above test results were obtained using the designated test methods and they indicate compliance with the performance requirements (paragraphs as listed) of the above referenced specifications.

Certified Testing Laboratories assumes that all information provided by the client is accurate and that the physical and chemical properties of the components are as stated by the manufacturer.

Certified Testing Laboratories, Inc.

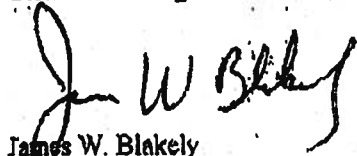


James W. Blakely
Vice President
Architectural Division

cc: Action Window Technology Inc. (3)
File (1)

CERTIFIED TESTING LABORATORIES

Architectural Division • 7252 Narcoossee Rd. • Orlando, FL 32822
(407) 384-7744 • Fax (407) 384-7751
Web Site: www.ctlarch.com
E-mail: ctlarch.com

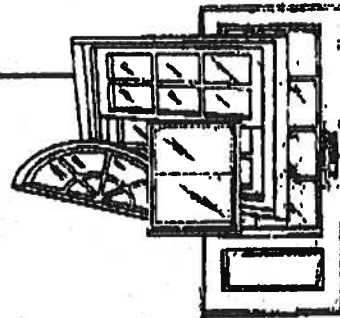

Report Number: CTLA-991W-1-AWT
Report Date: February 18, 2003

STRUCTURAL PERFORMANCE TEST REPORT

Client: ACTION WINDOW TECHNOLOGY INC
1312 W. CROSBY ROAD
CARROLTON, TX 75006

Product Type and Series: AWT Series 3950 Vinyl Fin Frame Single Hung Window with Reinforced Sash Top Rail, Stiles & Meeting Rail H-R40 (36"x 72")

Test Specifications: AAMA/NWWDA 101/IS-2-97 "Voluntary Specifications for Aluminum, Vinyl (PVC) and Wood Windows and Glass Doors"

Frame: Vinyl Fin frame measured 35.50" wide x 71.50" high overall. Mitered corner weld construction. Fixed meeting rail secured to each frame jamb with one (1) #8 x 2" PH., PH. screw.

Ventilator: Operable sash measured 33.375" wide x 35.25" high overall. Mitered corner weld construction. Clear lite measured 31.5625" high x 33.5625" high. Fixed lite measured 32.50" wide x 33.4375" high.

Weather Stripping: One (1) strip of woolpile .220" high with integral plastic fin frame sill. One (1) strip of woolpile .250" high with integral plastic fin sash top rail exterior. One (1) strip of woolpile .250" high each sash stile exterior leg. One (1) strip of woolpile .250" high with integral plastic fin each sash stile interior leg. One (1) strip of foam filled bulb weatherstrip sash bottom rail.

Hardware & Location: Two (2) metallic sweep locks located on sash top rail approx 8" from each end of rail. Two (2) metallic keepers located on fixed meeting rail. One (1) tilt latch at each end of sash top rail. One (1) block and tackle at each frame jamb. One (1) pivot bar at each end of sash bottom rail.

Glazing: 5/8" insulated annealed glass consisting of .125" glass .375" air space with swiggle .125" glass. Sash exterior glazed. Fixed lite interior glazed adhesive foam strip backbedding and vinyl snap in glazing bead.

Sealant: A silicone type sealant was used on sill and to seal specimen to test buck.

Weep System: Weep notch measuring 2.25" x leg height located each end of sill weeping to the exterior.

Muntins: N/A

Reinforcement: Fixed meeting rail has one (1) piece of extruded aluminum reinforcement measuring .662" wide x .755" high x .099" thick x full length. Top rail, and sash stiles has one (1) piece of extruded aluminum reinforcement measuring .590" wide x .995" high x .115" thick x full length.

Additional Description: N/A

Screen: Roll formed aluminum frame, fiberglass mesh with vinyl splino. Two (2) metallic retainer clips and two (2) metallic plungers. Corners secured with plastic corner keys

Installation: Twenty-six (26) 1.75" roofing nails were used to secure the specimen to the wood test buck. Five (5) were located in head and sill measuring 4", 13", 21", 29", and 33" from left jamb. Eight (8) were located in each jamb measuring 4.50", 14.25", 24", 32.75", 42", 57.25", 60.50" and 70" from sill.

Surface Finish: White Vinyl

Comment: Nominal 2 mil polyethylene film was used to seal against air leakage during structural loads. The film was used in a manner that did not influence the test results.

Performance Test Results

Paragraph No	Title of Test	Method	Measured	Allowed
2.1.2	Air Infiltration @ 1.57 psf	ASTM E283-91	.18 cfm/ft ²	.34 cfm/ft ²
The tested specimen meets or exceeds the performance levels specified in AAMA/NWWDA 101/1.5-97. Results recorded in two (2) decimals at the clients request. Unit tested with shims installed under cam locks.				
2.1.3	Water Resistance @ 5.0 gph/ft ²	ASTM E547-93 Four (4) five (5) minute cycles	No Entry	No Entry
	WTP= 6.75 psf	ASTM E331-93 Fifteen (15) minute duration	No Entry	No Entry
Unit tested with insect screen.				
2.1.3	Water Resistance @ 5.0 gph/ft ²	ASTM E547-93 Four (4) five (5) minute cycles	No Entry	No Entry
	WTP= 6 psf	ASTM E331-93 Fifteen (15) minute duration	No Entry	No Entry
Unit tested without insect screen.				
2.1.4.2	Uniform Load Structural Permanent Deformation @ 60 psf positive @ 60 psf negative	ASTM E330-90 Ten (10) second load	.015" .005"	.134" .134"
2.1.8	Forced Entry Resistance	AAMA 1302.5-76		
	Test A		0"	1/4"
	Test B		0"	1/4"
	Test C		0"	1/4"
	Test D, E and F		0"	1/4"
	Test G		0"	1/4"

Performance Test Results (continued)

<u>Paragraph No</u>	<u>Title of Test</u>	<u>Method</u>	<u>Measured</u>	<u>Allowed</u>
2.2.2.5.1	Operating Force Sash	AAMA/NWWDA 101/IS-2-97	18 lbs.	30 lbs.
2.2.2.5.2	Deglazing Top Rail 70 lbs. Bottom Rail 70 lbs. Left Side 50 lbs. Right Side 50 lbs.	ASTM E987-88	.039" = 7.8% < 100% .038" = 7.6% < 100% .050" = 10% < 100% .035" = 7.0% < 100%	
2.1.7	Welded Corner Test	AAMA/NWWDA 101/IS-2-97	Passed	

Test Date November 21, 2002


Test Completion Date: November 21, 2002

Remarks: Detailed drawings were available for laboratory records and comparison to the test specimen at the time of this report. A copy of this report along with representative sections of the test specimen will be retained by CTL for a period of four (4) years. The results obtained apply only to the specimen tested.

This test report does not constitute certification of this product, but only that the above test results were obtained using the designated test methods and they indicate compliance with the performance requirements (paragraphs as listed) of the above referenced specifications.

Certified Testing Laboratories assumes that all information provided by the client is accurate and that the physical and chemical properties of the components are as stated by the manufacturer.


Certified Testing Laboratories, Inc.


James W. Blakely
Vice President
Architectural Division

cc: Action Window Technology Inc. (3)
File (1)

CERTIFIED TESTING LABORATORIES

Architectural Division • 7252 Narcoossee Rd. • Orlando, FL 32822
(407) 384-7744 • Fax (407) 384-7751
Web Site: www.ctlarch.com
E-mail: ctlarch.com

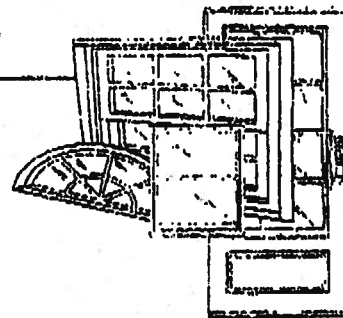

Report Number: CTLA-1038W-AWT
Report Date: February 19, 2003

STRUCTURAL PERFORMANCE TEST REPORT

Client: ACTION WINDOW TECHNOLOGY INC.
1312 W. CROSBY ROAD
CARROLLTON, TX 75006

Product Type and Series: AWT Series 3950 Vinyl Fin Frame Single Hung Window with Transom and Reinforced Meeting Rail & Top Rail (36" x 72") Design Pressure 45

Test Specifications: ASTM E 283-91 "Test Method for Determining the Rate of Air Leakage Through Exterior Windows, Curtain Walls and Doors Under Specified Pressure Differences Across the Specimen."
ASTM E 547-93 "Test Method for Water Penetration of Exterior Windows, Curtain Walls and Doors by Uniform Static Air Pressure Difference."
ASTM E 331-93 "Test Method for Water Penetration of Exterior Windows, Curtain Walls and Doors by Cyclic Static Air Pressure Differential."
ASTM E 330-90 "Test Method for Structural Performance of Exterior Windows, Curtain Walls and Doors by Uniform Static Air Pressure Difference."

Frame: Vinyl fin frame measured 35.50" wide x 71.50" high overall. Mitered corner weld construction. Fixed meeting rail secured to each frame jamb with one (1) #8 x 2" PH. screw. Transom bottom rail secured to each frame jamb with four (4) #8 x 2" PH. screws

Ventilator: Operable sash measured 33.375" wide x 29.25" high overall. Mitered corner weld construction. Clear lite measured 31.5625" high x 27.5625" high. Fixed lite measured 32.50" wide x 27.4375" high. Transom lite measured 32.50" wide x 8.50" high.

Weather Stripping: One (1) strip of woolpile .220" high with integral plastic fin frame sill. One (1) strip of woolpile .250" high with integral plastic fin sash top rail exterior. One (1) strip of woolpile .250" high each sash stile exterior leg. One (1) strip of woolpile .250" high with integral plastic fin each sash stile interior leg. One (1) strip of foam filled bulb weatherstrip sash bottom rail.

Hardware & Location: Two (2) metallic sweep locks located on sash top rail approx 8" from each end of rail. One (1) tilt latch at each end of sash top rail. One (1) block and tackle at each frame jamb. One (1) pivot bar at each end of sash bottom rail.

Glazing: 5/8" insulated annealed glass consisting of .125" glass .375" air space with swiggle .125" glass. Sash exterior glazed. Fixed and transom lites interior glazed adhesive foam strip backbedding and vinyl snap in glazing bead.

Sealant: A silicone type sealant was used at sill corners and to seal specimen to test buck.

Weep System: Weep notch measuring 2.25" x leg height located each end of sill weeping to the exterior.

Muntins: N/A

Reinforcement: Fixed meeting rail has one (1) piece of extruded aluminum reinforcement measuring .662" wide x .755" high x .099" thick x full length. Top rail has one (1) piece of extruded aluminum reinforcement measuring .590" wide x .995" high x .115" thick x full length.

Additional Description: N/A

Screen: Roll formed aluminum frame, fiberglass mesh with vinyl spline. Two (2) metallic retainer clips and two (2) metallic plungers. Corners secured with plastic corner keys

Installation: Twenty-six (26) 1.75" roofing nails were used to secure the specimen to the wood test buck. Five (5) were located in head and sill measuring 4", 13", 21", 29", and 33" from left jamb. Eight (8) were located in each jamb measuring 4", 14.25", 24", 32.75", 42", 51", 60" and 69" from sill.

Surface Finish: White Vinyl

Comment: Nominal 2 mil polyethylene film was used to seal against air leakage during structural loads. The film was used in a manner that did not influence the test results.

Performance Test Results

<u>Paragraph No</u>	<u>Title of Test</u>	<u>Method</u>	<u>Measured</u>	<u>Allowed</u>
2.1.2	Air Infiltration @ 1.57 psf	ASTM E283-91	.28 cfm/ft ²	.34 cfm/ft ²
The tested specimen meets or exceeds the performance levels specified in AAMA/NWDA 101/1.5.2-97. Results recorded in two (2) decimals at the clients request.				
2.1.3	Water Resistance @ 5.0 gph/ft ²	ASTM E547-93 Four (4) five (5) minute cycles	No Entry	No Entry
	WTP= 6.75 psf	ASTM E331-93 Fifteen (15) minute duration	No Entry	No Entry
Unit tested with and without insect screen.				
2.1.4.2	Uniform Load Structural Permanent Deformation	ASTM E330-90 Ten (10) second load		
DP= +45	@ 67.9 psf positive		.019"	.142"
DP= - 45	@ 67.5 psf negative		.009"	.142"

Test Date January 27, 2003


Test Completion Date: January 27, 2003

Remarks: Detailed drawings were available for laboratory records and comparison to the test specimen at the time of this report. A copy of this report along with representative sections of the test specimen will be retained by CTL for a period of four (4) years. The results obtained apply only to the specimen tested.

This test report does not constitute certification of this product, but only that the above test results were obtained using the designated test methods and they indicate compliance with the performance requirements (paragraphs as listed) of the above referenced specifications.

Certified Testing Laboratories assumes that all information provided by the client is accurate and that the physical and chemical properties of the components are as stated by the manufacturer.

Certified Testing Laboratories, Inc.

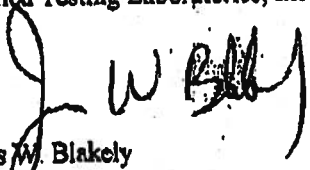

James W. Blakely
Vice President
Architectural Division

cc: Action Window Technology Inc. (3)
File (1)

Report Number: ETC-04-034-14644.0
Test Start Date: 04/10/03
Test Finish Date: 03/16/04
Report Date: 03/18/04
Expiration Date: 03/18/08

Penetration Structural Test Report
Rendered To:

Vinyl Building Products, Inc.
One Raritan Road
Oakland, NJ 07436

Series/Model
2900 Horizontal Slider (OX)

Description: The product tested was a vinyl Horizontal Sliding window. The test specimen was glazed with 5/8-inch thick insulating glass units constructed with double strength annealed glass. The frame size was 69 inches wide by 48 inches high by 2-3/4 inches deep. See Appendix A.

Test Specification: ANSI/AAMA/NWDA 101/I.S.2

Summary of Results

Overall Design Pressure	35.0 psf
Air Leakage Rate	0.18 scfm/ft ²
Maximum Water Pressure Achieved	5.25 psf
Maximum Structural Pressure Achieved	60.0 psf
Forced Entry Resistance - (ASTM)	Grade 10

Product Designation **H-R35 69 x 48**

TEST REPORT

ETC Laboratories

Specifications: The test specimen was evaluated in accordance with ANSI/AAMA/NWDA 101/I.S.2 "Voluntary Specification for Aluminum, Vinyl and Wood Windows and Glass Doors". Sections 1, 2 and 4 only. All performance specifications in this standard shall be met for full compliance to the standard and for product certification, labeling or represented as conforming to this standard.

Referenced Test Reports: NONE

Note - The test data in any section below with an "RTR" comment have not been obtained from this specimen but from the Referenced Test Report with a specimen of the same or larger size and identical construction.

Design Pressure (DP): The product tested herein has been first evaluated to the Gateway pressure in the referenced specification for the performance class rating achieved.

Gateway Performance Tests

<u>Specification Paragraph</u>	<u>Title of Test</u>	<u>Results</u>	<u>Allowed</u>
2.1.2	<u>Air Infiltration - ASTM E283</u> Test Pressure - 1.57 psf The tested specimen exceeds the performance levels specified in ANSI/AAMA/NWDA 101/I.S.2 for air infiltration.	0.18 scfm/ft ²	0.30 scfm/ft ²
2.1.3	<u>Water Resistance - ASTM E547</u> 5 gal/hr-ft ² - 4 Test cycles - 24 Minutes Design Pressure - 15.0 psf Test Pressure - 2.86 psf With and Without Screen	Pass	No Leakage
2.1.4.2	<u>Uniform Structural Load - ASTM E330</u> Design Pressure - 15.0 psf Test Pressure Positive Load - 22.5 psf (150% x DP) Negative Load - 22.5 psf (150% x DP) Note: Measurement taken after load from center of the meeting stile	0.033 in. 0.020 in.	0.177 in. 0.177 in.
2.1.7	<u>Corner Weld</u> Frame - 4 Corners Sashes - 4 Corners	Pass Pass	< 100% < 100%
2.1.8	<u>Forced Entry Resistance - ASTM F588</u> Lock/Tool Manipulation Tests A1 through A7 Lock/Tool Manipulation	Pass Pass Pass	No Entry No Entry No Entry
2.2.1.6.1	<u>Operating Force - No Standardized Method</u> Right Sash - Open/Close	18/18 lbf	20 lbf
2.2.1.6.2	<u>De-glazing - ASTM E987</u> Right Sash: Left Stile - 70 lbf Right Stile - 70 lbf Top Rail - 50 lbf Bottom Rail - 50 lbf	0.0% 0.0% 0.0% 0.0%	<100% <100% <100% <100%

Conditions, Terms, and General Notes Regarding These Tests

The product tested Has Been compared to the detailed drawings, bill of materials and fabrication information supplied by the client so named herein. Our analysis, which includes dimensional and component description comparisons, indicate the tested product and engineering information supplied by the client: "Are Equivalent". See Appendix A. The report and representative samples will be retained for four years from the date of initial test.

These test results were obtained by employing all requirements of the designated test methods with no deviations. The test results and specimen supplied for testing are in compliance with the referenced specifications.

The test results are specific to the product tested by this laboratory and of the sample supplied by the client named herein, and they relate to no other product either manufactured by the client, a Fabricator of the client or of installed field performance.


This report does not constitute an AAMA or NWWDA certified product under the certification programs of these organizations. The program administrator of these programs and organizations may only grant product certification.

ETC Laboratories makes no opinions or endorsements regarding this product and its performance. This report may not be reproduced or quoted in partial form without the expressed written approval of ETC Laboratories.

No conclusions of any kind regarding the adequacy of the glass in the test specimen may be drawn from the test. Procedure "A" in ASTM E330 was used for this test.

ETC Laboratories letters, reports, its name or insignia or mark are for the exclusive use of the client so named herein and any other use is strictly prohibited. The report, letters and the name of ETC Laboratories, its seal or mark shall not be used in any circumstance to the general public or in any advertising.

Limitation of Liability: Due diligence was used in rendering this professional opinion. By acceptance of this report, this client agrees to hold harmless and indemnify ETC Laboratories, its employees and offices and owners against all claims and demands of any kind whatsoever, which arise out of or in any manner connected with the performance of work referred to herein.

FOR ETC LABORATORIES

Mark Sennett
AWS Supervisor



Arthur Murray, VP
Manager, Wind Engineering Laboratory

TEST REPORT

ETC Laboratories

Optional Performance Tests

The manufacturer specified herein has successfully achieved all the required criteria in Section 2 of the referenced specification for the Gateway size of the achieved Performance Rating and has further successfully tested the product to higher performance levels as indicated below.

Design Pressure (DP): The product tested herein has been additionally evaluated to the Design Pressure referenced below.

<u>Specification Paragraph</u>	<u>Title of Test</u>	<u>Results</u>	<u>Allowed</u>
4.3	<u>Water Resistance - ASTM E547</u> 5 gal/hr-ft ² - 4 Test cycles - 24 Minutes Design Pressure - 35.0 psf Test Pressure - 5.25 psf (15% x DP) With and Without Screen	Pass	No Leakage
4.4	<u>Uniform Structural Load - ASTM E330</u> Design Pressure - 40.0 psf Test Pressure Positive Load - 60.0 psf (150% x DP) Negative Load - 60.0 psf (150% x DP) Note: Measurement taken after load from center of meeting stile	0.069 in. 0.066 in.	0.177 in. 0.177 in.

COLUMBIA COUNTY OFFICE OF ALTERNATE

OCCUPANCY

COLUMBIA COUNTY, FLORIDA

Department of Building and Zoning Inspection

This Certificate of Occupancy is issued to the below named permit holder for the building and premises at the below named location, and certifies that the work has been completed in accordance with the Columbia County Building Code.

Parcel Number 34-4S-16-03276-105

Building permit No. 000025968

Use Classification SFD, UTILITY

Fire: 70.62

Permit Holder MATT CASON

Waste: 184.25

Owner of Building VENTURE POINTE LLC

Total: 254.87

Location: 232 SW OAKWOOD COURT, LAKE CITY, FL

Date: 11/02/2007

Sharyn Rich

Building Inspector



POST IN A CONSPICUOUS PLACE
(Business Places Only)