


HELIOCOL COLLECTOR GENERAL NOTES:

1. APPLICABLE CODE: 2023 FLORIDA RESIDENTIAL CODE (8TH EDITION) & ASCE-7-22 MINIMUM DESIGN LOADS FOR BUILDING AND OTHER STRUCTURES.
2. BOLT DIAMETER AND EMBEDMENT LENGTHS ARE DESIGNED PER 2023 FLORIDA BUILDING CODE (8TH EDITION) REQUIREMENTS. ALL BOLT CAPACITIES ARE BASED ON A SOUTHERN YELLOW PINE (SYP) RESIDENTIAL WOOD ROOF TRUSS AS EMBEDMENT MATERIAL.
3. WIND DESIGN CRITERIA AND PARAMETERS ARE FOR HIP AND GABLE RESIDENTIAL ROOFS, CONSIDERING FROM A 7° TO A MAXIMUM 27° (2/12 TO A MAXIMUM 6/12 PITCH) ROOF WITH A MEAN ROOF HEIGHT NOT EXCEEDING 30 FT AND RISK CATEGORY II. SEE WIND PRESSURE TABLE BELOW.
4. WIND TUNNEL TEST DATA FOR THIS COLLECTOR MAY BE REQUESTED THROUGH MAGEN ECO ENERGY AND HAS BEEN COMPILED BY PRI CONSTRUCTION AND MATERIAL TESTING, INC.
5. ROOF SEALANTS SHALL CONFORM TO ASTM C920 AND IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO PILOT FILL ALL HOLES PRIOR TO INSTALLATION OF BOLTS.
6. THE CONTRACTOR SHALL REFER TO THE HELIOCOL INSTALLATION MANUAL OR AUTHORIZED HELIOCOL REPRESENTATIVE FOR ALL INSTALLATION INSTRUCTIONS FOR THE HELIOCOL COLLECTOR.
7. LAG SCREW SHALL BE ASTM A276 TYPE 304 STAINLESS STEEL UNLESS OTHERWISE NOTED AND CONTRACTOR SHALL EMBED LAG SCREW 2.5" OF THREADED EMBEDMENT INTO THE TRUSS.
8. ALL HELIOCOL COLLECTOR MODELS MAY BE INSTALLED PER THIS STRUCTURAL CONNECTION DRAWING.
9. CONTRACTOR SHALL ENSURE ALL ROOF PENETRATIONS TO BE WATERTIGHT AND SEALED PER 2023 FLORIDA BUILDING CODE (8TH EDITION) OR LOCAL GOVERNING CODE.
10. THE ADDITION OF THE HELIOCOL COLLECTOR SYSTEM ADDS APPROXIMATELY 1 PSF TO THE ROOF STRUCTURE AND WILL NOT ADVERSELY AFFECT THE STRUCTURAL INTEGRITY OF THE BUILDING.

EXPOSURE C - p_{nc10} Pressures - Gable Roof > 7 to 27 Degrees - 10 ft ² Tributary Area							
Vult (MPH)	ROOF PITCH	GROUP 1		GROUP 2		GROUP 3	
		Wind Zone 1	Wind Zone 2	Wind Zone 1	Wind Zone 2	Wind Zone 1	Wind Zone 2
140	7-20°	22.4	-54.7	22.4	-79.9	22.4	-94.9
	20-27°	22.4	-12.2	22.4	-67.2	22.4	-86.7


EXPOSURE C - p_{nc20} Pressures - Hip Roof > 7 to 27 Degrees - 10 ft ² Tributary Area							
Vult (MPH)	ROOF PITCH	GROUP 1		GROUP 2		GROUP 3	
		Wind Zone 1	Wind Zone 2	Wind Zone 1	Wind Zone 2	Wind Zone 1	Wind Zone 2
140	7-20°	22.4	-49.7	22.4	-64.8	22.4	-69.8
	20-27°	22.4	-39.7	22.4	-54.7	22.4	-54.7

TABLE ABOVE REFLECTS COMPONENTS AND CLADDING (ASD) PRESSURES FROM SECTION 30 OF THE ASCE 7-22 AS REQUIRED BY THE 2023 FLORIDA RESIDENTIAL CODE (8TH EDITION) SECTION R324.2, M2301.2.2.1 AND R905.1 (SOLAR THERMAL SYSTEMS).
NOTE: THIS IS **NOT** A SOLAR PHOTOVOLTAIC SYSTEM

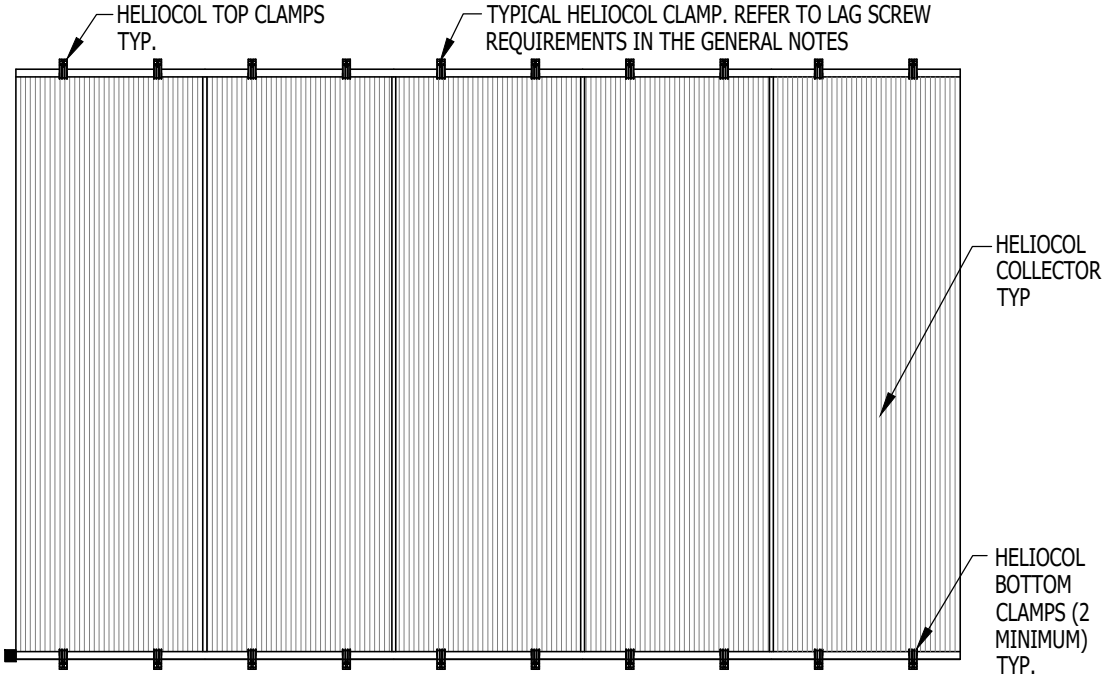


TYPICAL MULTIPLE COLLECTOR ARRAY PLAN

SCALE: N.T.S.

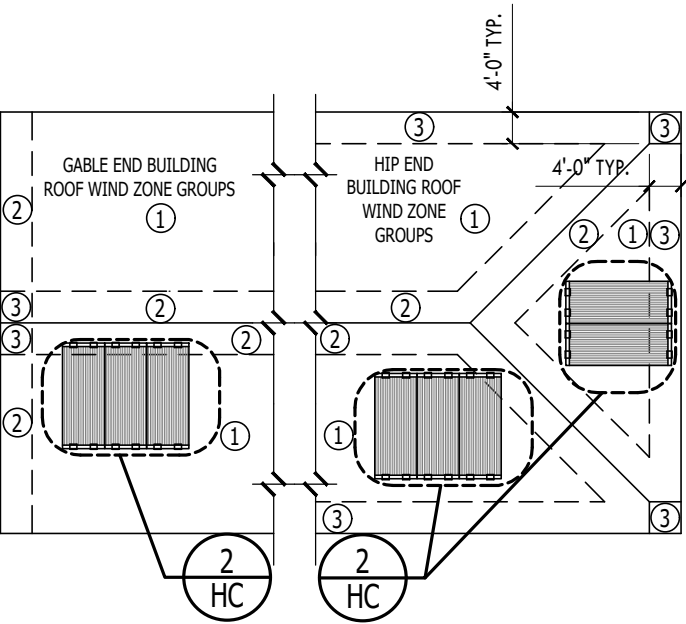

TYPICAL COLLECTOR PITCHED ROOF LAYOUT - WIND ZONES - SCHEDULE - PLAN

SCALE: NONE

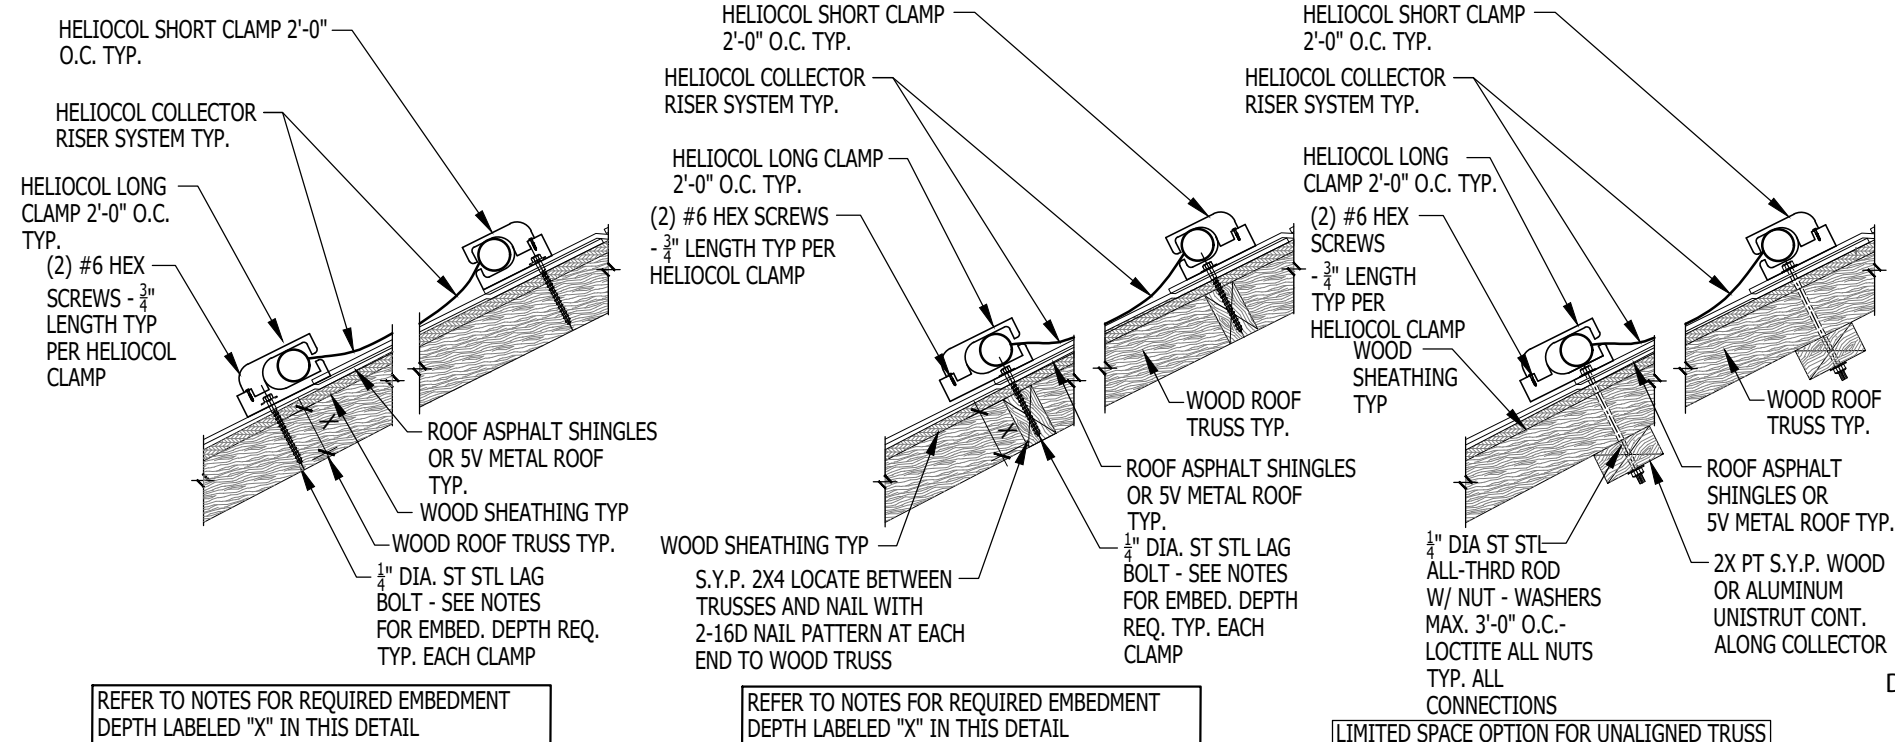

TYP TOP - BOTTOM ASPHALT - METAL SHINGLE CONNECTION DETAIL

SCALE: 1"=1'-0"

OPTIONAL WOOD SPANNER OPTION CONNECTION DETAIL

SCALE: 1"=1'-0"

OPTIONAL ALL THREAD CONNECTION DETAIL

SCALE: 1"=1'-0"

Digitally signed by Jeffrey A Torres

Date: 2024.02.26

'11:28:46 -05'00

APPROVED

REVISIONS DESCRIPTION

DATE

JEFFREY A. TORRES, P.E.
FL PE #80379

SUNSMART ENGINEERING LLC
FL COA #35170
925 SUNSHINE LANE
SUITE #1010
ALTAMONTE SPRINGS FL, 32714

Date: 02/26/2024

Sheet 1 of 1

JAMES BRYANT RESIDENCE
SOLAR POOL SYSTEM RETROIT
9781 SW 194TH CIR
DUNNELLON, FL 34432

SOLAR POOL SYSTEM IMPROVEMENT

CONSTRUCTION DOCUMENT

DO NOT SCALE DRAWINGS. CONTRACTORS SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB AND THIS OFFICE MUST BE NOTIFIED OF ANY VARIATION FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS. THE USER ASSURES THAT ANY PARTY WITHOUT FIRST OBTAINING THE EXPRESS PERMISSION AND CONSENT OF THE DESIGNER, NOR ARE HIS COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS AND DRAWINGS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY MANNER WITHOUT FIRST OBTAINING THE EXPRESS PERMISSION AND CONSENT OF THE DESIGNER.