



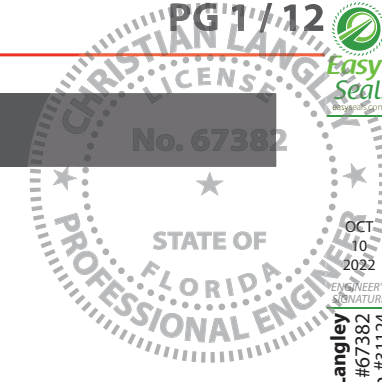

## US HWY 90 &amp; CENTURION CT

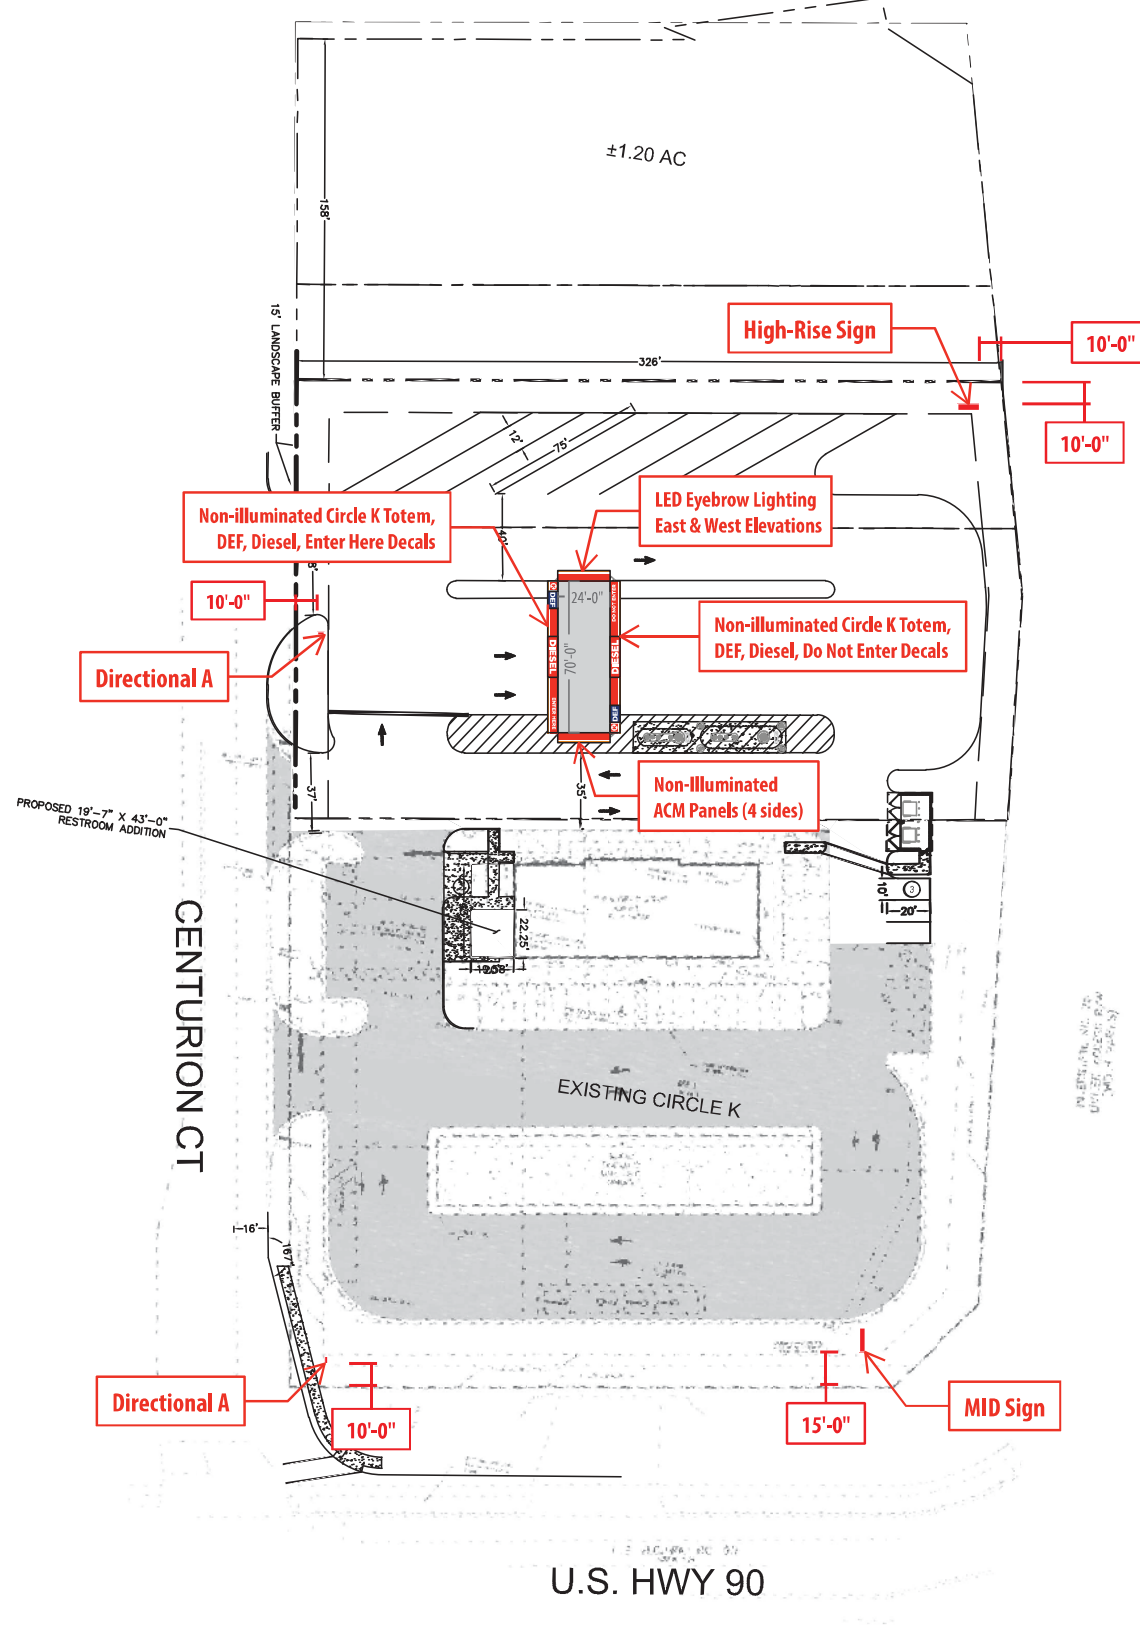

Christian Langley  
Florida PE #67382  
Cert of Auth #31124

1200 N Federal Hwy, #200  
Boca Raton, FL 33432  
1-888-371-3113

• Solid freestanding sign above grade:  $\pm 29.0$  psf  
• CF= 1.85 (w/h ratio = 0.2 to 10, any clearance ratio s/h)

• Sign Height = 30 ft max  
• Kzt= 1.0, Kd=0.85, G=0.85

• Risk Category 1 Struct.  
• ASD Load Coeff= 0.6

• V=120 mph  
• Exposure 'C'

ASCE 7-16  
WIND LOADS:



CORPORATE  
IDENTIFICATION  
SOLUTIONS

CUSTOMER  
CIRCLE K  
SITE NUMBER  
9831

LOCATION  
LAKE CITY, FL  
ACCOUNT REP  
BEN DEHAYES

DRAWN BY  
KL  
DATE  
10/07/22  
REVISION  
03  
SCALE  
NTS

CORPORATE ID SOLUTIONS  
5563 N ELSTON AVE.  
CHICAGO, IL 60630  
P: 773-763-9600 | F: 773-763-9606  
CORPORATEIDSOLUTIONS.COM

CUSTOMER ACCEPTANCE  
THIS DRAWING IS THE PROPERTY OF CORPORATE IDENTIFICATION SOLUTIONS, INC., CHICAGO, IL, AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION. THIS DRAWING IS TRANSFERRED TO THE CUSTOMERS AND SUPPLIERS OF CORPORATE IDENTIFICATION SOLUTIONS, INC BY WAY OF LOAN. THIS DRAWING MAY NOT BE COPIED OR REPRODUCED, IN WHOLE OR IN PART, NOR MAY IT OR THE INFORMATION IT CONTAINS BE DISCLOSED OR TRANSFERRED TO ANY OTHER PARTY OR PERSONS WITHOUT THE PRIOR WRITTEN CONSENT OF CORPORATE IDENTIFICATION SOLUTIONS, INC.  
SIGNATURE \_\_\_\_\_ DATE \_\_\_\_\_

General • Design is in accordance with the requirements of the Fla Bldg Code 7th Ed (2020) for use within & outside the High Velocity Hurricane Zone (HVHZ). • This engineering certifies only the structural integrity of those systems, components, and/or other construction explicitly specified herein. • Electrical notes, details, & specifications are provided by and are the sole responsibility of the electrical contractor. No electrical review has been performed and no certification of such is intended. • Structural design meets requirements of ACI 318-14, AISI 360-16, ADM1-15, & NDS-18, as applicable. • Steel components shall be coated, painted, or otherwise protected against corrosion per FBC Sec 2203.2/2222.6. • Alum components in contact with steel or embedded in concrete shall be painted or protected as prescribed in ADM1-15(1a), or plastic/neoprene spacers provided. • All exposed fasteners shall be S.S. or have a protective coating for corrosion protection. • All welding shall comply with AWS requirements. • Steel welds: E70xx electrodes. • Aluminum welds: 4043 filler alloy. • Alum extrusions: 6063-T6 or stronger, U.S.C.