

DATE 02/12/2008

Columbia County Building Permit

PERMIT

This Permit Must Be Prominently Posted on Premises During Construction

000026744

APPLICANT CRAIG TIMBERLAKE PHONE 352 472-6855  
ADDRESS 25370 NW 8TH PLACE NEWBERRY FL 32669  
OWNER SHARON BAKER PHONE 386.454.0708  
ADDRESS 674 SW WOODLAND AVENUE FT. WHITE FL 32038  
CONTRACTOR C. HELMS PHONE 352 472-6850  
LOCATION OF PROPERTY 47S, TL ON 27, TR ON BRIDLEWOOD RD, TL ON WOODLAND AVE,  
2ND HOME ON LEFT  
TYPE DEVELOPMENT POOL ENCLOSURE ESTIMATED COST OF CONSTRUCTION 5500.00  
HEATED FLOOR AREA                      TOTAL AREA                      HEIGHT            STORIES             
FOUNDATION                      WALLS                      ROOF PITCH                      FLOOR                       
LAND USE & ZONING A-3 MAX. HEIGHT                       
Minimum Set Back Requirments: STREET-FRONT 30.00 REAR 25.00 SIDE 25.00  
NO. EX.D.U. 1 FLOOD ZONE N/A DEVELOPMENT PERMIT NO.                     

PARCEL ID 30-7S-17-10058-551 SUBDIVISION SANTA FE RIVER PLANTATIONS  
LOT 41 BLOCK            PHASE            UNIT            TOTAL ACRES                     

SCG056710  
Culvert Permit No.            Culvert Waiver            Contractor's License Number            Applicant/Owner/Contractor *Craig Timberlake*  
EXISTING X08-033 CS JH N  
Driveway Connection            Septic Tank Number            LU & Zoning checked by            Approved for Issuance            New Resident           

COMMENTS: NOC ON FILE

Check # or Cash 1598

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power                      Foundation                      Monolithic                       
                     date/app. by                      date/app. by                      date/app. by                       
Under slab rough-in plumbing                      Slab                      Sheathing/Nailing                       
                     date/app. by                      date/app. by                      date/app. by                       
Framing                      Rough-in plumbing above slab and below wood floor                       
                     date/app. by                      date/app. by                       
Electrical rough-in                      Heat & Air Duct                      Peri. beam (Lintel)                       
                     date/app. by                      date/app. by                      date/app. by                       
Permanent power                      C.O. Final                      Culvert                       
                     date/app. by                      date/app. by                      date/app. by                       
M/H tie downs, blocking, electricity and plumbing                      Pool                       
                     date/app. by                      date/app. by                       
Reconnection                      Pump pole                      Utility Pole                       
                     date/app. by                      date/app. by                      date/app. by                       
M/H Pole                      Travel Trailer                      Re-roof                       
                     date/app. by                      date/app. by                      date/app. by                     

BUILDING PERMIT FEE \$ 30.00 CERTIFICATION FEE \$ 0.00 SURCHARGE FEE \$ 0.00  
MISC. FEES \$ 0.00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ 0.00 WASTE FEE \$             
FLOOD DEVELOPMENT FEE \$            FLOOD ZONE FEE \$            CULVERT FEE \$            TOTAL FEE 80.00  
INSPECTORS OFFICE *Gale Edgerly* CLERKS OFFICE *ms*

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

EVERY PERMIT ISSUED SHALL BECOME INVALID UNLESS THE WORK AUTHORIZED BY SUCH PERMIT IS COMMENCED WITHIN 180 DAYS AFTER ITS ISSUANCE, OR IF THE WORK AUTHORIZED BY SUCH PERMIT IS SUSPENDED OR ABANDONED FOR A PERIOD OF 180 DAYS AFTER THE TIME THE WORK IS COMMENCED. A VALID PERMIT RECIEVES AN APPROVED INSPECTION EVERY 180 DAYS. WORK SHALL BE CONSIDERED TO BE IN ACTIVE PROGRESS WHEN THE PERMIT HAS RECIEVED AN APPROVED INSPECTION WITHIN 180 DAYS.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

**Columbia County Building Permit Application**

<b>For Office Use Only</b>		Application # <u>0802-04</u>	Date Received <u>2/6</u>	By <u>JW</u>	Permit # <u>26744</u>
Zoning Official <u>efs</u>	Date <u>2/11/08</u>	Flood Zone <u>N/A</u>	FEMA Map # _____	Zoning <u>A-3</u>	
Land Use <u>A-3</u>	Elevation _____	MFE _____	River _____	Plans Examiner <u>OK JTH</u>	Date <u>2-8-8</u>
Comments _____					
<input checked="" type="checkbox"/> NOC <input checked="" type="checkbox"/> EH <input checked="" type="checkbox"/> Deed or PA <input checked="" type="checkbox"/> Site Plan <input type="checkbox"/> State Road Info <input type="checkbox"/> Parent Parcel # _____					
<input type="checkbox"/> Dev Permit # _____ <input type="checkbox"/> In Floodway <input type="checkbox"/> Letter of Authorization from Contractor					
<input type="checkbox"/> Unincorporated area <input type="checkbox"/> Incorporated area <input type="checkbox"/> Town of Fort White <input type="checkbox"/> Town of Fort White Compliance letter					

Septic Permit No. \_\_\_\_\_ Fax 352-472-6855

Name Authorized Person Signing Permit Craig Timberlake Phone 352-472-6850

Address 25370 NW 8th Place Newberry, FL 32669

Owners Name Sharon L. Baker Stockwell Phone \_\_\_\_\_

911 Address 674 SW Woodland Ave. Ft. White, FL 32038

Contractors Name Timberlake Aluminum Const. C. HELMS Phone 352-472-6850

Address 25370 NW 8th Place Newberry, FL 32669

Fee Simple Owner Name & Address N/A

Bonding Co. Name & Address N/A

Architect/Engineer Name & Address Lawrence Bennett PO Box 214368 S. Daytona, FL 32121

Mortgage Lenders Name & Address N/A

Circle the correct power company – FL Power & Light – Clay Elec. – Suwannee Valley Elec. – Progress Energy

Property ID Number 30-75-17-10058-551-HK Estimated Cost of Construction 5,500.00

Subdivision Name Santa Fe River Plantations Lot 41 Block \_\_\_\_\_ Unit \_\_\_\_\_ Phase \_\_\_\_\_

Driving Directions North on NE Hernando Ave toward NE Justice St.; Turn left at NE Madison St; Turn left at N. Marion Ave/US-441; Right at W Duval St; Left at SW Main Blvd; Right toward SR-47, Left at SR-20; Right at SW Bridlewood Rd. Left at SW Woodland Ave.

Number of Existing Dwellings on Property \_\_\_\_\_

Construction of Screen enclosure Total Acreage 1.780 Lot Size \_\_\_\_\_

Do you need a - Culvert Permit or Culvert Waiver or Have an Existing Drive Total Building Height \_\_\_\_\_

Actual Distance of Structure from Property Lines - Front 50' Side 50' Side 50' Rear 100'

Number of Stories \_\_\_\_\_ Heated Floor Area \_\_\_\_\_ Total Floor Area 726 sq ft Roof Pitch \_\_\_\_\_

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standards of all laws regulating construction in this jurisdiction.

JW LEA. MESSAGE: 2.11.08

Columbia County Building Permit Application

**WARNING TO OWNER:** YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.


**FLORIDA'S CONSTRUCTION LIEN LAW: Protect Yourself and Your Investment**

According to Florida Law, those who work on your property or provide materials, and are not paid-in-full, have a right to enforce their claim for payment against your property. This claim is known as a construction lien. If your contractor fails to pay subcontractors or material suppliers or neglects to make other legally required payments, the people who are owed money may look to your property for payment, even if you have paid your contractor in full. This means if a lien is filed against your property, it could be sold against your will to pay for labor, materials or other services which your contractor may have failed to pay.


**NOTICE OF RESPONSIBILITY TO BUILDING PERMITEE:**

**YOU ARE HEREBY NOTIFIED** as the recipient of a building permit from Columbia County, Florida, you will be held responsible to the County for any damage to sidewalks and/or road curbs and gutters, concrete features and structures, together with damage to drainage facilities, removal of sod, major changes to lot grades that result in ponding of water, or other damage to roadway and other public infrastructure facilities caused by you or your contractor, subcontractors, agents or representatives in the construction and/or improvement of the building and lot for which this permit is issued. No certificate of occupancy will be issued until all corrective work to these public infrastructures and facilities has been corrected.

**OWNERS CERTIFICATION:** I hereby certify that all the foregoing information is accurate and all work will be done in compliance with all applicable laws and regulating construction and zoning. I further understand the above written responsibilities in Columbia County for obtaining this Building Permit.

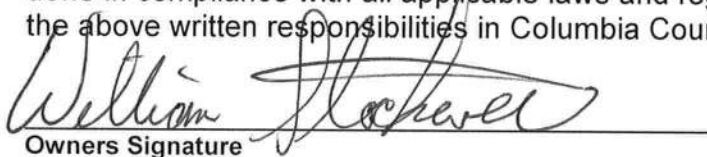  
Owners Signature

**CONTRACTORS AFFIDAVIT:** By my signature I understand and agree that I have informed and provided this written statement to the owner of all the above written responsibilities in Columbia County for obtaining this Building Permit.

  
Contractor's Signature (Permitee)

Contractor's License Number \_\_\_\_\_  
Columbia County  
Competency Card Number \_\_\_\_\_

Affirmed under penalty of perjury to by the Contractor and subscribed before me this 1 day of Feb 2008.  
Personally known ☒ or Produced Identification \_\_\_\_\_

  
State of Florida Notary Signature (For the Contractor)

SEAL:



# NOTICE OF COMMENCEMENT

Tax Parcel Identification Number 30-75-17-10058-551-HX

Inst:200812002302 Date:2/6/2008 Time:8:35 AM

29 DC, P. DeWitt Cason, Columbia County Page 1 of 1

THE UNDERSIGNED hereby gives notice that improvements will be made to certain real property, and in accordance with Section 713.13 of the Florida Statutes, the following information is provided in this NOTICE OF COMMENCEMENT.

1. Description of property (legal description): Lot 41 Santa Fe River Plantations ORB 458-242,859-2397, WD 1127-1653  
a) Street (job) Address: 674 SW Woodland Ave. Ft. White, FL 32038
2. General description of improvements: Screen enclosure
3. Owner Information  
a) Name and address: Sharon Stockwell 674 SW Woodland Ave Ft. White  
b) Name and address of fee simple titleholder (if other than owner) N/A  
c) Interest in property owner
4. Contractor Information  
a) Name and address: Timberlake Aluminum Corps. 25370 NW 8th Pl. Newberry, FL  
b) Telephone No.: 352-472-6850 Fax No. (Opt.) \_\_\_\_\_
5. Surety Information  
a) Name and address: N/A  
b) Amount of Bond: \_\_\_\_\_  
c) Telephone No.: \_\_\_\_\_ Fax No. (Opt.) \_\_\_\_\_
6. Lender  
a) Name and address: N/A  
b) Phone No. \_\_\_\_\_
7. Identity of person within the State of Florida designated by owner upon whom notices or other documents may be served:  
a) Name and address: \_\_\_\_\_  
b) Telephone No.: \_\_\_\_\_ Fax No. (Opt.) \_\_\_\_\_
8. In addition to himself, owner designates the following person to receive a copy of the Lienor's Notice as provided in Section 713.13(1)(b) Florida Statutes:  
a) Name and address: \_\_\_\_\_  
b) Telephone No.: \_\_\_\_\_ Fax No. (Opt.) \_\_\_\_\_
9. Expiration date of Notice of Commencement (the expiration date is one year from the date of recording unless a different date is specified): \_\_\_\_\_

**WARNING TO OWNER:** ANY PAYMENTS MADE BY THE OWNER AFTER THE EXPIRATION OF THE NOTICE OF COMMENCEMENT ARE CONSIDERED IMPROPER PAYMENTS UNDER CHAPTER 713, PART I, SECTION 713.13, FLORIDA STATUTES, AND CAN RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY: A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT YOUR LENDER OR AN ATTORNEY BEFORE COMMENCING WORK OR RECORDING YOUR NOTICE OF COMMENCEMENT.

STATE OF FLORIDA  
COUNTY OF COLUMBIA


10. William Stockwell  
Signature of Owner or Owner's Authorized Office/Director/Partner/Manager  
William Stockwell  
Print Name

The foregoing instrument was acknowledged before me, a Florida Notary, this 30 day of January, 20 08, by:  
William Stockwell as owner (type of authority, e.g. officer, trustee, attorney  
fact) for \_\_\_\_\_ (name of party on behalf of whom instrument was executed).

Personally Known OR Produced Identification ☒ Type License

Notary Signature Ray M. Drewnowski Notary Stamp or Seal:

11. Verification pursuant to Section 92.525, Florida Statutes. Under penalties of perjury, I declare that I have read the foregoing and that the facts stated in it are true to the best of my knowledge and belief.

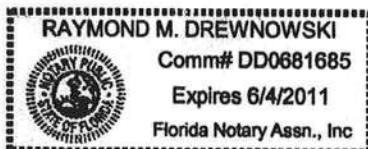

William Stockwell  
Signature of Natural Person Signing (in line #10 above.)




A hand-drawn site plan on a rectangular sheet of paper. The plan shows a central 'House' represented by a T-shaped rectangle. To the left of the house is a horizontal double-headed arrow labeled '50'ft'. To the right of the house is a horizontal double-headed arrow labeled '50'ft'. Below the house is a vertical double-headed arrow labeled '50'ft'. Above the house, there is a dashed rectangle labeled '33x22' with an arrow pointing to it from the text 'Proposed Pool Enclosure'. To the right of the pool enclosure are two small squares, one labeled 'GARAGE' and the other 'SHED'. A horizontal double-headed arrow labeled '50'ft' spans the distance from the right side of the pool enclosure to the right edge of the paper. At the top of the page, a long vertical double-headed arrow is labeled '100'ft' and 'ALL TREES'.

N ↓

Baker/Stockwell  
 674 SW Woodland Ave  
 Ft White FL

*Cal R*


TIMBERLAKE ALUMINUM  
 CONSTRUCTION, INC.  
 25370 NW 8th Place  
 NEWBERRY, FL 32669

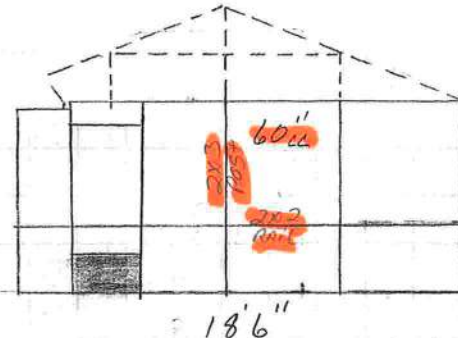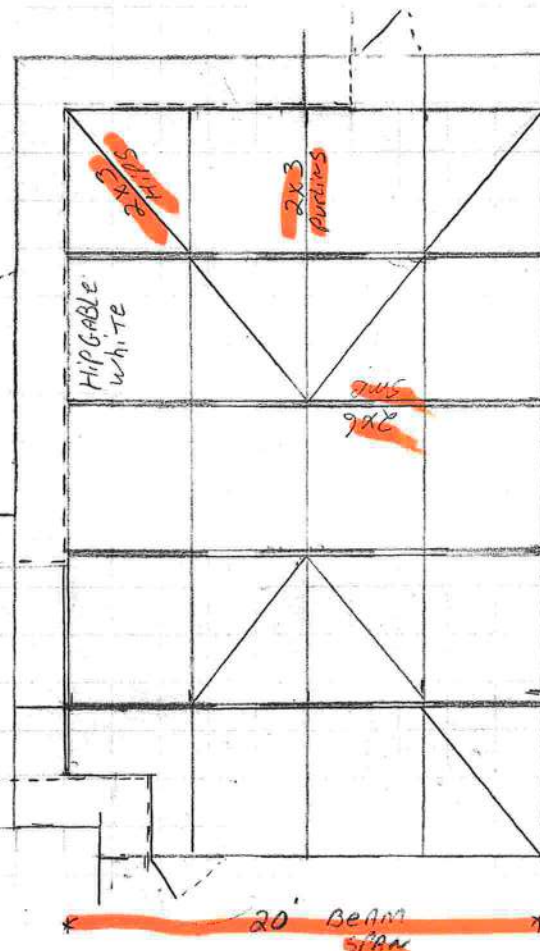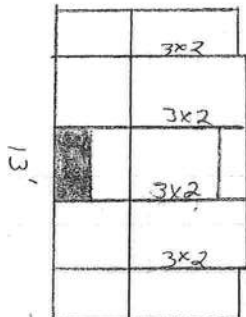

4' 1/2" gain  
 4'

BENETT 06  
 7'-9" x 1.10 = 8'-6"

FILE COPY





## Design Check List for Pool Enclosures (Page 2 of 4)

Wall frame member allowable span conversions from 120 MPH wind zone, "B" Exposure to \_\_\_\_\_  
 MPH wind zone and / or  "C" or  "D" Exposure for load width of 1.00 :  
 Look up span in appropriate 120 MPH span table and apply the following formula:

Span / Height  
@ 120 MPH  
or \_\_\_\_ MPH

7.91 (b or d) x 1.10 (b or d) x 1.00 (b or d) = 8.70

Wind Zone  
Multiplier \*\*

Exposure Multiplier  
(see page 1ii)

Required Converted  
Span / Height

Yes No

- |   |                                     |                                     |
|---|-------------------------------------|-------------------------------------|
| 7. Enclosure roof diagonal bracing in plan view   | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 8. Knee braces length, location, & size<br>(Table 1.7)  | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 9. Wall cables or K-bracing sizes shown in wall views   | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| <b>IV. Highlight details from the Aluminum Structures Design Manual:</b>  | <b>Yes</b>                          | <b>No</b>                           |
| A. Beam & purlin tables with size, thickness, spacing, & spans / lengths<br>(Tables 1.1 & 1.2 or 1.9.1 & 1.9.2) | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| B. Upright & girt tables with size, thickness, spacing, & spans / lengths<br>(Tables 1.3 & 1.4)                 | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| C. Table 1.6 with beam & upright combination  | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| D. Connection details to be use such as:  |                                     |                                     |
| 1. Beam to upright  | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 2. Beam to wall   | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 3. Beam to beam   | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 4. Chair rail, purlins, & knee braces   | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 5. Extruded gutter connections  | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 6. Angle to deck and / or sole plate  | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 7. Anchors go through pavers into concrete  | <input type="checkbox"/>            | <input checked="" type="checkbox"/> |
| 8. Minimum footing and / or knee wall details   | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
| 9. Cable or K- brace details Section 1  | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |

Wall area calculations for cables:

W = wall width, H = wall height, R = rise

W1 = width @ top of mansard, W2 = width @ top of wall

- E. Select footing from examples in manual.

### Example 1: Flat Roof

Front wall @ eave:  $\frac{\text{W}}{\text{H}}$  ft. x  $\frac{\text{H}}{\text{a}}$  ft. =  $\frac{0.00}{\text{a}}$  ft.<sup>2</sup> @ 100% = .....  $\frac{0.00}{\text{a}}$  ft.<sup>2</sup>

Largest side wall:  $\frac{\quad}{W}$  ft. x  $\frac{\quad}{H}$  ft. =  $\frac{0.00}{b}$  ft.<sup>2</sup> @ 50% =  $\frac{0.00}{\quad}$  ft.<sup>2</sup>

TOTAL = 0.00 ft.<sup>2</sup>

Total area / (233 ft.<sup>2</sup> / cable for 3/32") = 0 cable pairs

or

Total area / (445 ft.<sup>2</sup> / cable for 1/8") = 0 cable pairs


Side wall cable calculation:  $\frac{0.00 \text{ ft.}^2 @ 100\%}{b} = \dots\dots\dots \frac{0.00 \text{ ft.}^2}{b}$

Side wall area / (233 ft.<sup>2</sup> / cable for 3/32") = 0 cable(s)

or

Side wall area / (445 ft.<sup>2</sup> / cable for 1/8") = 0 cable(s)

## Design Check List for Pool Enclosures (Page 3 of 4)

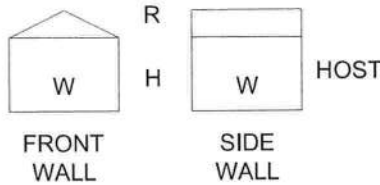

### Example 2: Gable Roof

Front wall @ eave:  $\frac{W}{ft.} \times \frac{H}{ft.} = \frac{0.00 ft.^2}{a} @ 100\% = 0.00 ft.^2$

Front gable rise:  $\frac{R}{ft.} \times \frac{1}{2}(\frac{W}{ft.}) = \frac{0.00 ft.^2}{b} @ 100\% = 0.00 ft.^2$

Largest side wall:  $\frac{W}{ft.} \times \frac{H}{ft.} = \frac{0.00 ft.^2}{c} @ 50\% = 0.00 ft.^2$

Largest side gable rise:  $\frac{R}{ft.} \times \frac{W}{ft.} = \frac{0.00 ft.^2}{d} @ 50\% = 0.00 ft.^2$

TOTAL = 0.00 ft.<sup>2</sup>

Total area / (233 ft.<sup>2</sup> / cable for 3/32") = 0 cable pairs

or


Total area / (445 ft.<sup>2</sup> / cable for 1/8") = 0 cable pairs

Side wall cable calculation:  $\frac{0.00 ft.^2}{c} + \frac{0.00 ft.^2}{d} = \frac{0.00 ft.^2}{e} @ 100\% = 0.00 ft.^2$

Side wall area / (233 ft.<sup>2</sup> / cable for 3/32") = 0 cable(s)

or

Side wall area / (445 ft.<sup>2</sup> / cable for 1/8") = 0 cable(s)

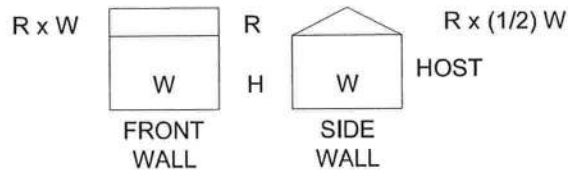

### Example 3: Transverse Gable Roof

Front wall @ eave:  $\frac{33.00 ft.}{W} \times \frac{8.00 ft.}{H} = \frac{264.00 ft.^2}{a} @ 100\% = 264.00 ft.^2$

Front gable rise:  $\frac{4.00 ft.}{R} \times \frac{6.00 ft.}{W} = \frac{24.00 ft.^2}{b} @ 100\% = 24.00 ft.^2$

Largest side wall:  $\frac{18.50 ft.}{W} \times \frac{8.00 ft.}{H} = \frac{148.00 ft.^2}{c} @ 50\% = 74.00 ft.^2$

Largest side gable rise:  $\frac{4.00 ft.}{R} \times \frac{1}{2}(\frac{9.00 ft.}{W}) = \frac{18.00 ft.^2}{d} @ 50\% = 9.00 ft.^2$

TOTAL = 371.00 ft.<sup>2</sup>

Total area / (233 ft.<sup>2</sup> / cable for 3/32") = 2 cable pairs

or

Total area / (445 ft.<sup>2</sup> / cable for 1/8") = 1 cable pairs


Side wall cable calculation:  $\frac{148.00 ft.^2}{c} + \frac{18.00 ft.^2}{d} = \frac{166.00 ft.^2}{e} @ 100\% = 166.00 ft.^2$

Side wall area / (233 ft.<sup>2</sup> / cable for 3/32") = 1 cable(s)

or

Side wall area / (445 ft.<sup>2</sup> / cable for 1/8") = 0 cable(s)

## SITE EXPOSURE EVALUATION FORM

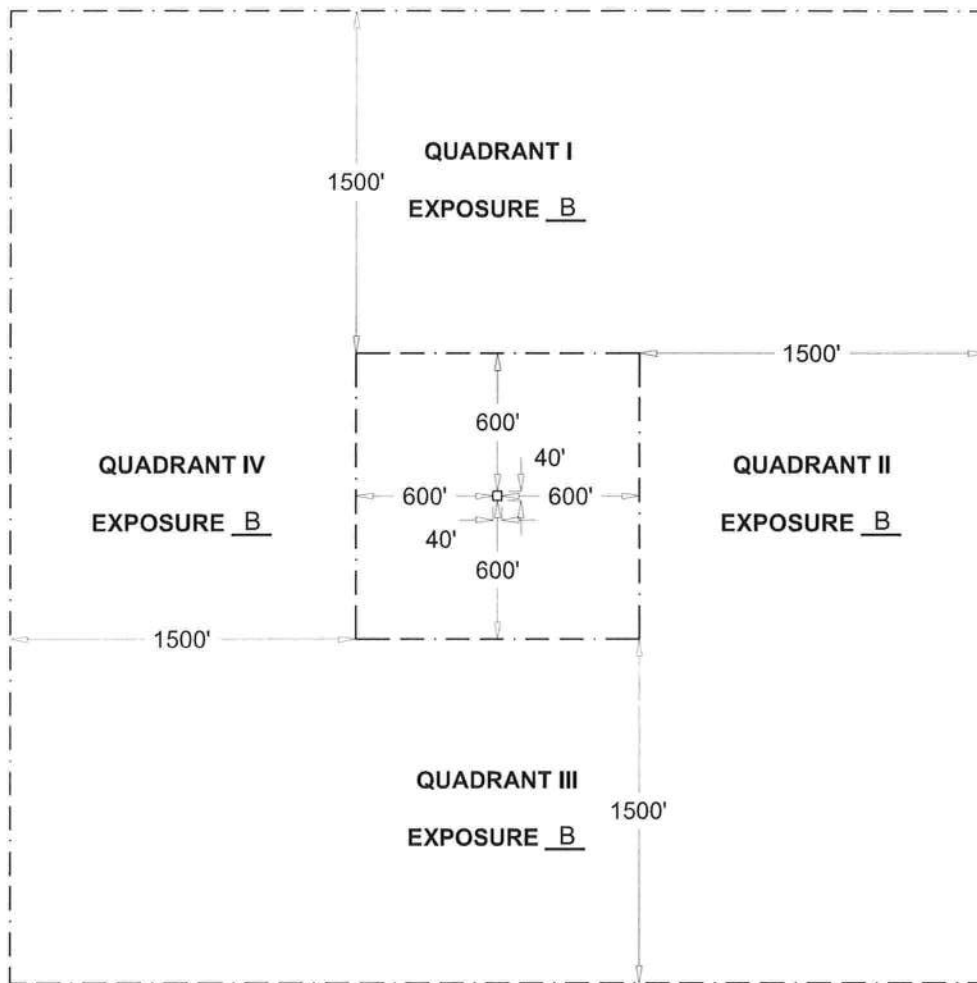

**NOTE:** ZONES ARE MEASURED FROM STRUCTURE OUTWARD

### SITE

SCALE: 1" = 800'


USING THE FOLLOWING CRITERIA, EVALUATE EACH QUADRANT AND MARK IT AS 'B', 'C', OR 'D' EXPOSURE. 'C' OR 'D' EXPOSURE IN ANY QUADRANT MAKE THE SITE THAT EXPOSURE.

- EXPOSURE C:
1. OPEN TERRAIN FOR MORE THAN 1,500 FEET IN ANY QUADRANT.
  2. ANY 'C' EXPOSURE FOR GREATER THAN 600 FEET IN ANY QUADRANT.
  3. NO SHORT TERM CHANGES IN 'B', 2 YEARS BEFORE SITE EVALUATION AND BUILD OUT WITHIN 3 YEARS, SITE WILL BE 'B'.
  4. FLAT, OPEN COUNTRY, GRASSLANDS, PONDS AND OCEAN OR SHORELINES IN ANY QUADRANT FOR GREATER THAN 1,500 FEET.


EXPOSURE D: FLAT, UNOBSTRUCTED AREAS THAT ARE 1,500 FT INLAND FROM THE SHORE LINE AND ARE EXPOSED TO WIND FLOWING OVER WATER FOR A DISTANCE OF AT LEAST 1 MILE.

SITE IS EXPOSURE: B EVALUATED BY: Carl R. Helms DATE: 2/1/08

SIGNATURE: [Signature] LICENSE #: SCC056710

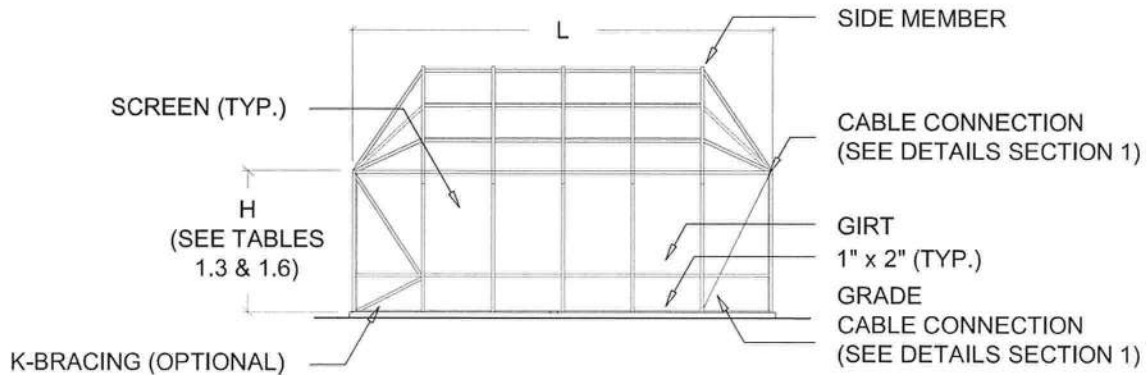**SECTION 1****SCREENED ENCLOSURES****TYPICAL MODIFIED HIP ROOF - FRONT WALL ELEVATION**

SCALE: N.T.S.

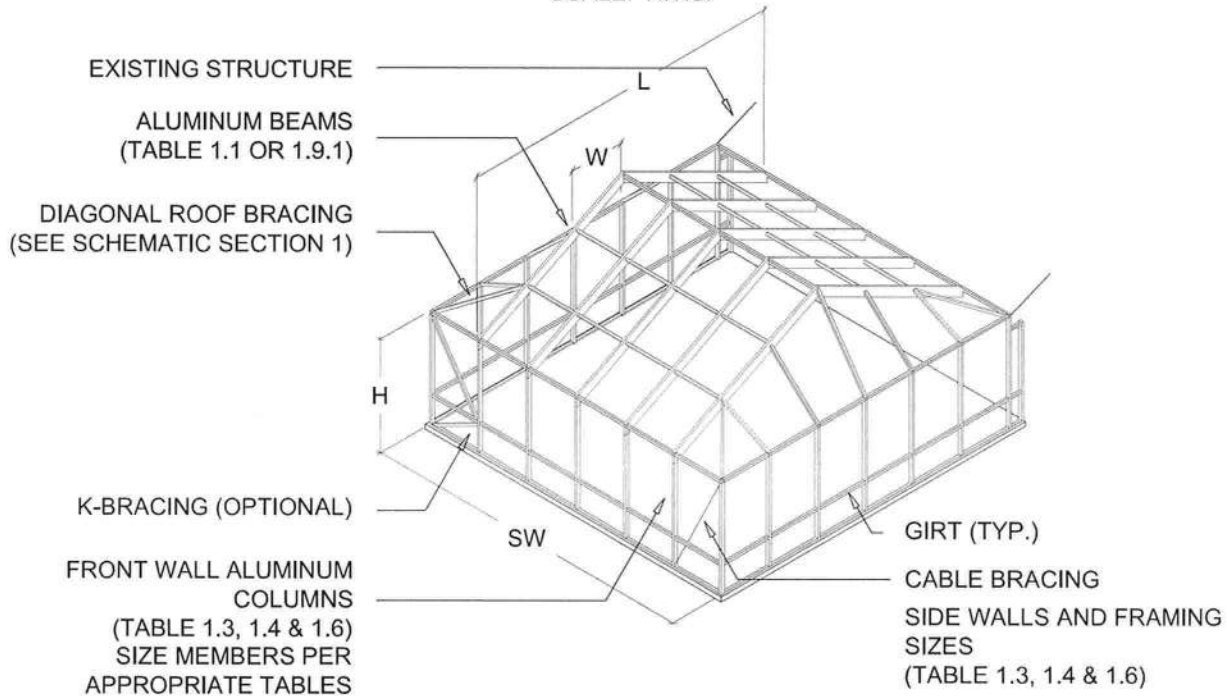**TYPICAL MODIFIED HIP ROOF - ISOMETRIC**

SCALE: N.T.S.

Lawrence E. Bennett, P.E. FL # 16644

CIVIL &amp; STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: lebpe@bellsouth.net

PAGE


**1-6**

© COPYRIGHT 2006


NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

# SCREENED ENCLOSURES

## SECTION 1



MINIMUM POST SIZES  
REQUIRED FOR EACH BEAM  
SIZE (SEE TABLE 1.6)

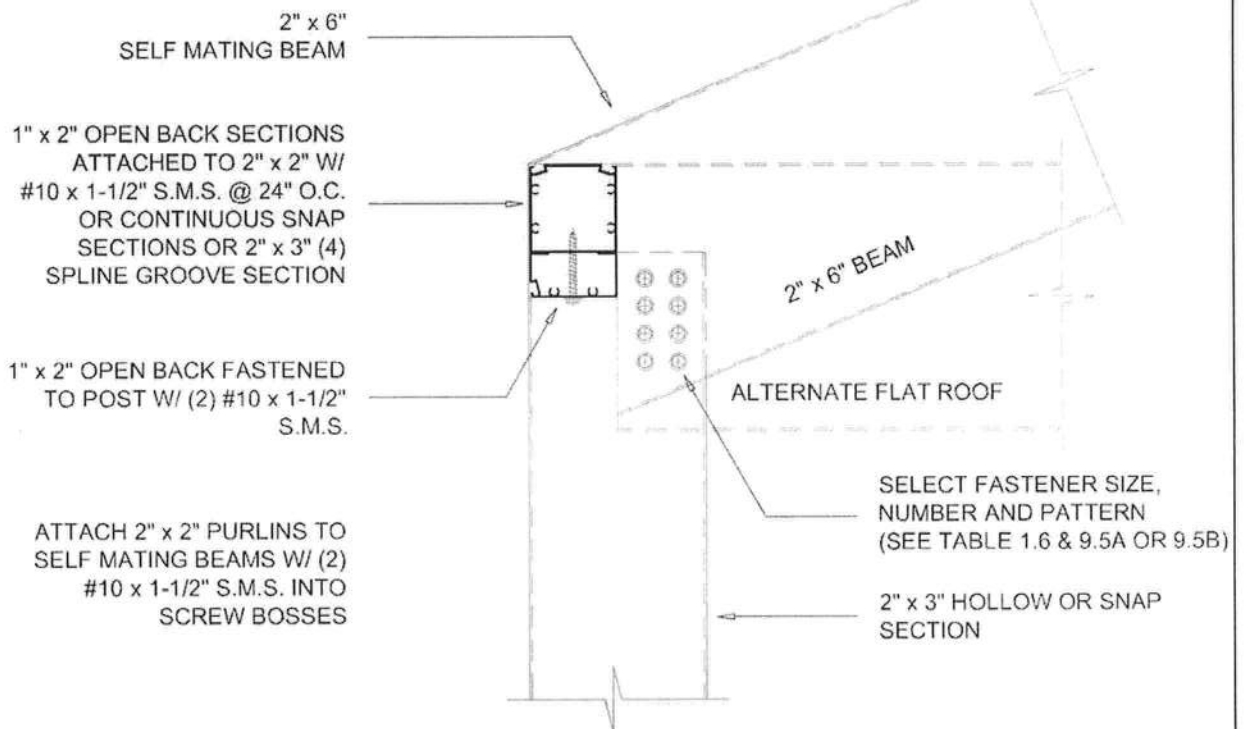

### SLOPING BEAM TO UPRIGHT CONNECTION DETAIL (PARTIAL LAP)

SCALE: 3" = 1'-0"

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121


Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: lebpe@bellsouth.net

# SECTION 1

# SCREENED ENCLOSURES

2" x 2" PURLINS ATTACHED  
TO BEAM W/ MIN.  
(3) #10 x 1-1/2" S.M.S.

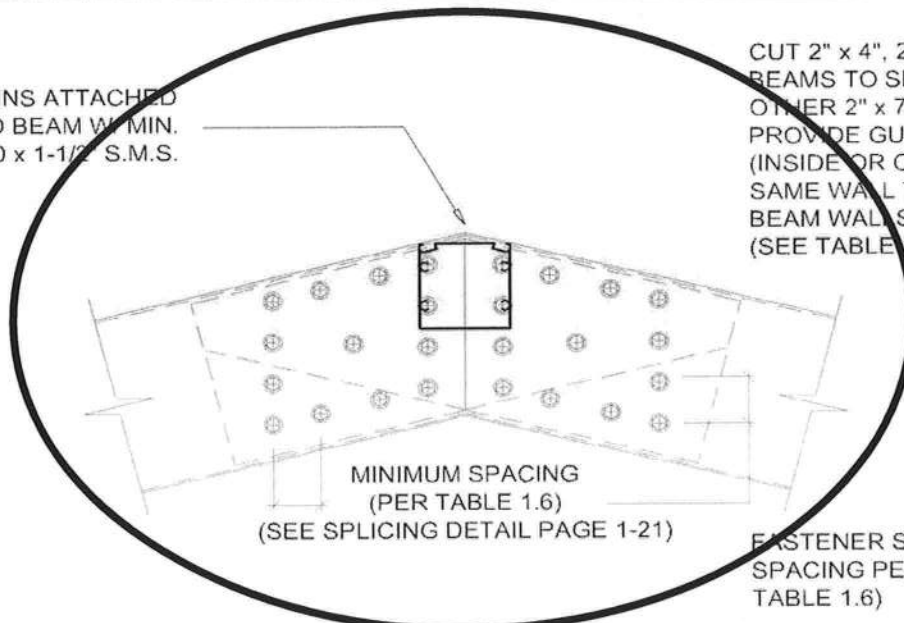

CUT 2" x 4", 2" x 5", OR 2" x 6"  
BEAMS TO SLIDE OVER EACH  
OTHER 2" x 7" & LARGER  
PROVIDE GUSSET PLATE  
(INSIDE OR OUTSIDE BEAM)  
SAME WALL THICKNESS AS  
BEAM WALLS OR LARGER  
(SEE TABLE 1.6)


MINIMUM SPACING  
(PER TABLE 1.6)  
(SEE SPLICING DETAIL PAGE 1-21)

FASTENER SIZE, NUMBER AND  
SPACING PER PAGE 1-20(SEE  
TABLE 1.6)

## ALTERNATE SIDE PLATE CONNECTION DETAIL GUSSET PLATE MOUNTED INTERNALLY

SCALE: 3" = 1'-0"

CUT 2" x 4", 2" x 5", OR 2" x 6"  
BEAMS TO SLIDE OVER EACH  
OTHER 2" x 7" & LARGER  
PROVIDE GUSSET PLATE  
(INSIDE BEAM) SAME WALL  
THICKNESS AS BEAM WALLS  
OR LARGER  
(SEE TABLE 1.6)

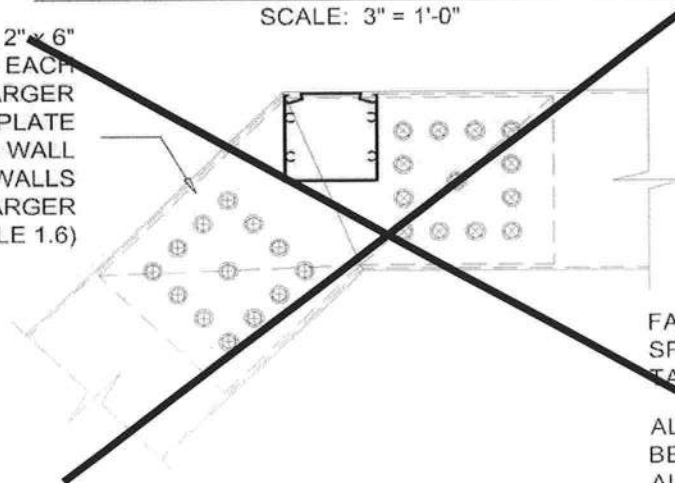

FASTENER SIZE, NUMBER AND  
SPACING PER PAGE 1-20(SEE  
TABLE 1.6)

ALL GUSSET PLATES SHALL  
BE A MINIMUM OF 5052 H-32  
ALLOY OR HAVE AN ULTIMATE  
YIELD STRENGTH OF 30 KSI

## ALTERNATE SIDE PLATE CONNECTION DETAIL - MANSARD ROOF GUSSET PLATE MOUNTED INTERNALLY

SCALE: 3" = 1'-0"

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: lebpe@bellsouth.net

PAGE

1-20

© COPYRIGHT 2006

NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

# SCREENED ENCLOSURES

## SECTION 1

1/4" x 2" LAG SCREWS @ 24"  
O.C. OR #10 x 2" SCREWS @  
12" O.C. MIN. AND (2) @ EACH  
STRAP  
OPTIONAL 1" x 2" OR 2" x 2"  
FOR SCREEN

SELF-MATING  
BEAM  
(SIZE VARIES)

SUPER OR  
EXTRUDED  
GUTTER

ANGLE, INTERIOR OR  
EXTERIOR RECEIVING  
CHANNEL (SEE SECTION 9)

2" x \_\_\_\_" x 0.050" STRAP  
@ EACH BEAM CONNECTION  
AND @ 1/2 BEAM SPACING W/  
(2) #8 x 1/2" S.M.S. PER STRAP

MAX. DISTANCE FROM FASCIA  
TO HOST STRUCTURE WALL  
(SEE TABLE 1.11)

### ALTERNATE SELF MATING BEAM CONNECTION TO SUPER OR EXTRUDED GUTTER

SCALE: 3" = 1'-0"

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: labpe@bellsouth.net

© COPYRIGHT 2006


NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

PAGE

1-27

# SECTION 1

# SCREENED ENCLOSURES

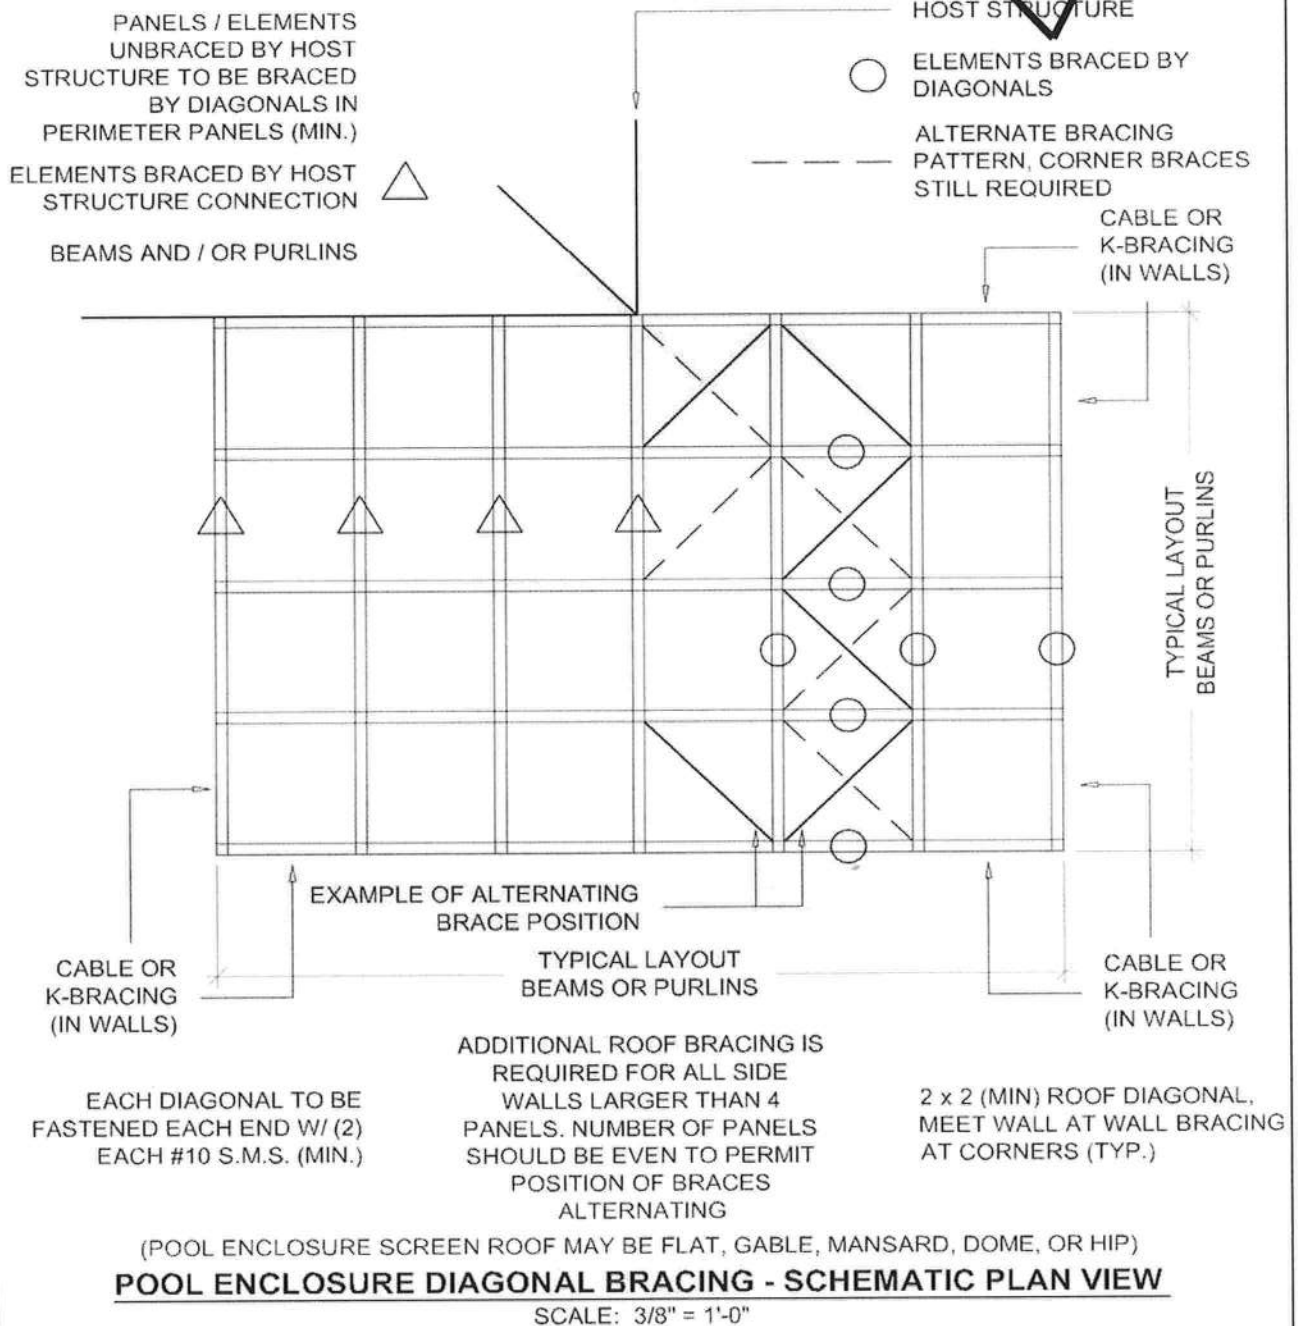

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: lebpe@bellsouth.net

PAGE



1-48

© COPYRIGHT 2006

NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

# SCREENED ENCLOSURES

## SECTION 1

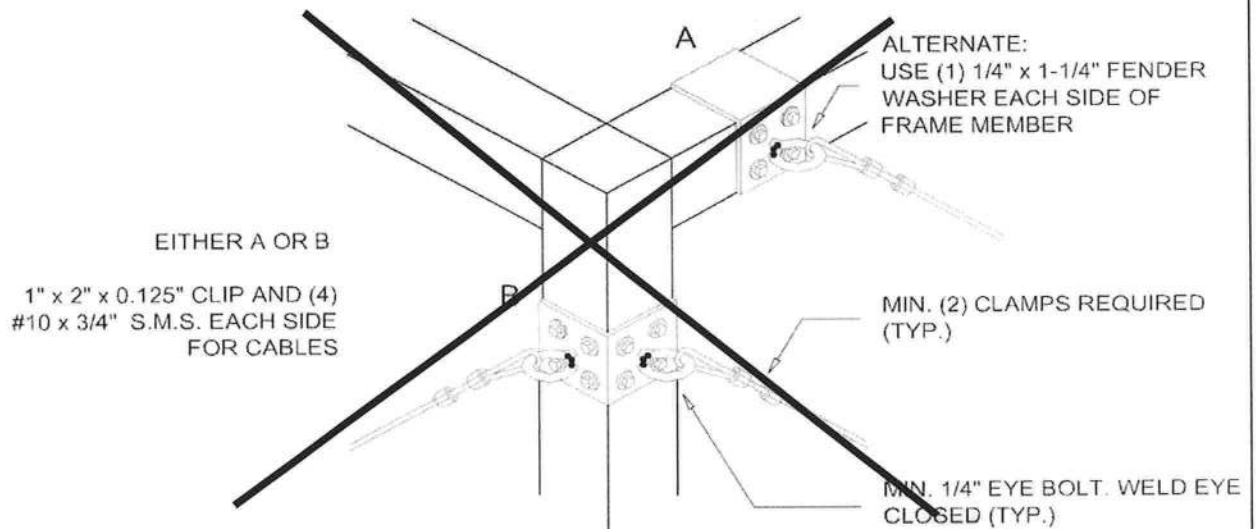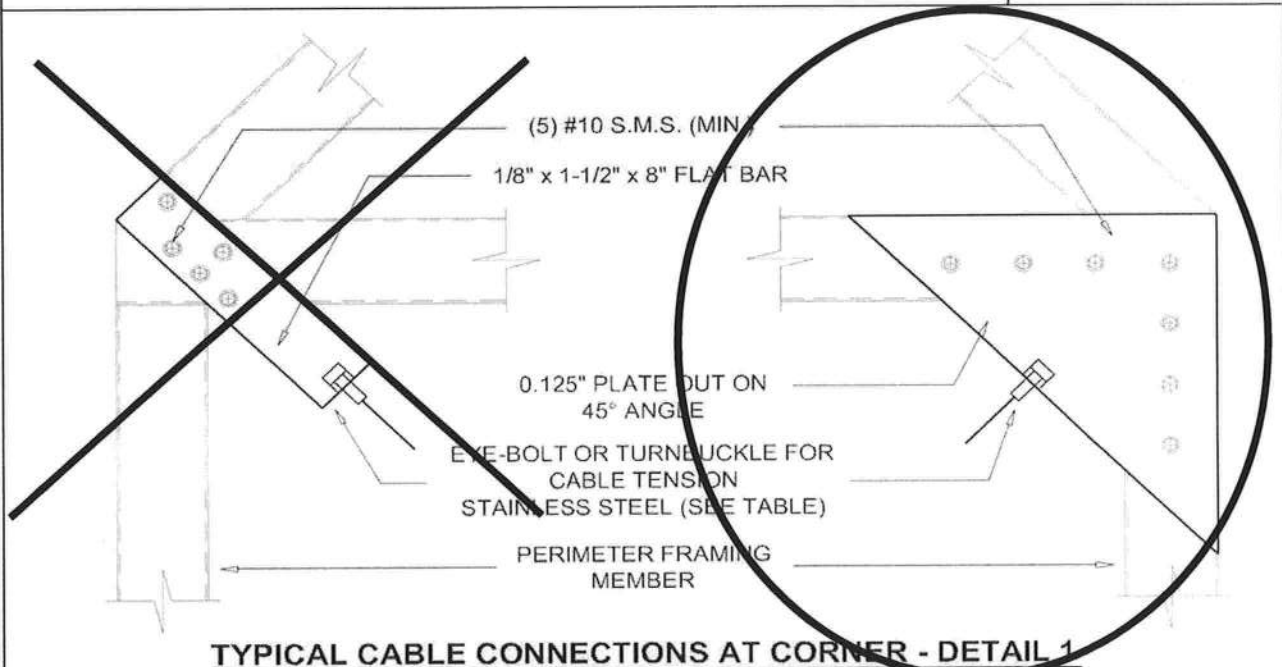

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: labpe@bellsouth.net

© COPYRIGHT 2006


NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

PAGE

1-51


# SCREENED ENCLOSURES

# SECTION 1

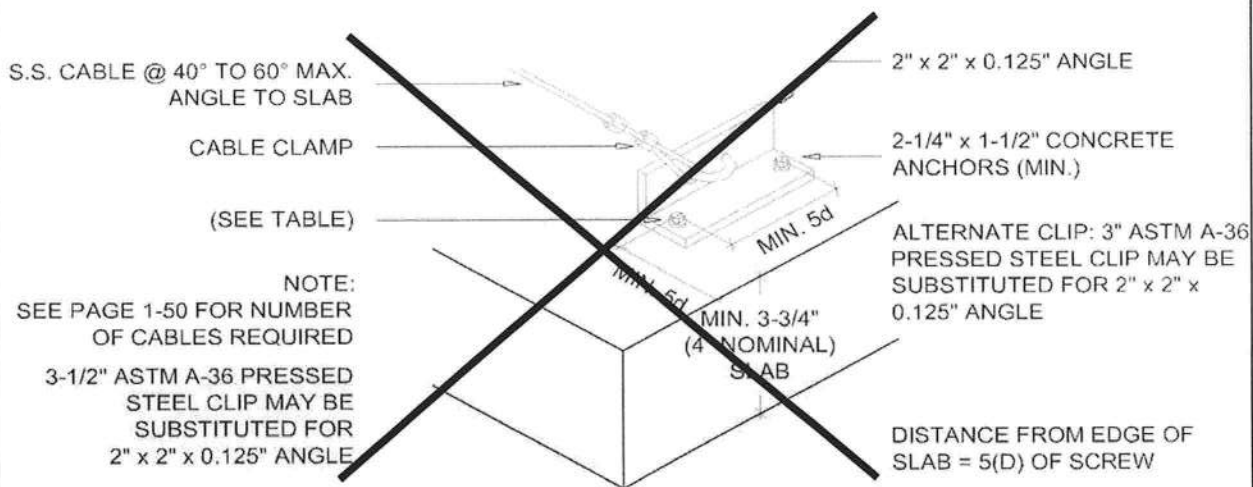

## ALTERNATE CABLE CONNECTION AT SLAB DETAIL - DETAIL 2B

SCALE: 3" = 1'-0"

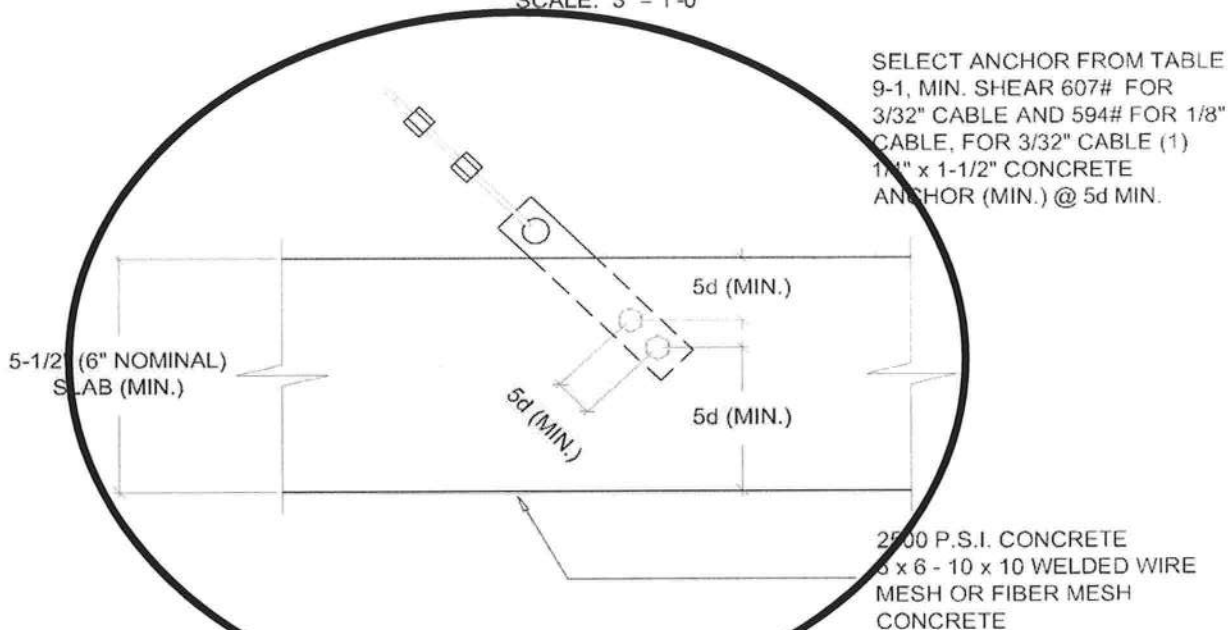


## ALTERNATE CABLE CONNECTIONS AT FOUNDATION - DETAIL 2C

SCALE: 3" = 1'-0"

Lawrence E. Bennett, P.E. FL # 16644  
 CIVIL & STRUCTURAL ENGINEERING  
 P.O. Box 214368, South Daytona, FL 32121  
 Telephone #: (386) 767-4774 Fax #: (386) 767-6556  
 Email: lebennet@bellsouth.net

# SECTION 1

# SCREENED ENCLOSURES

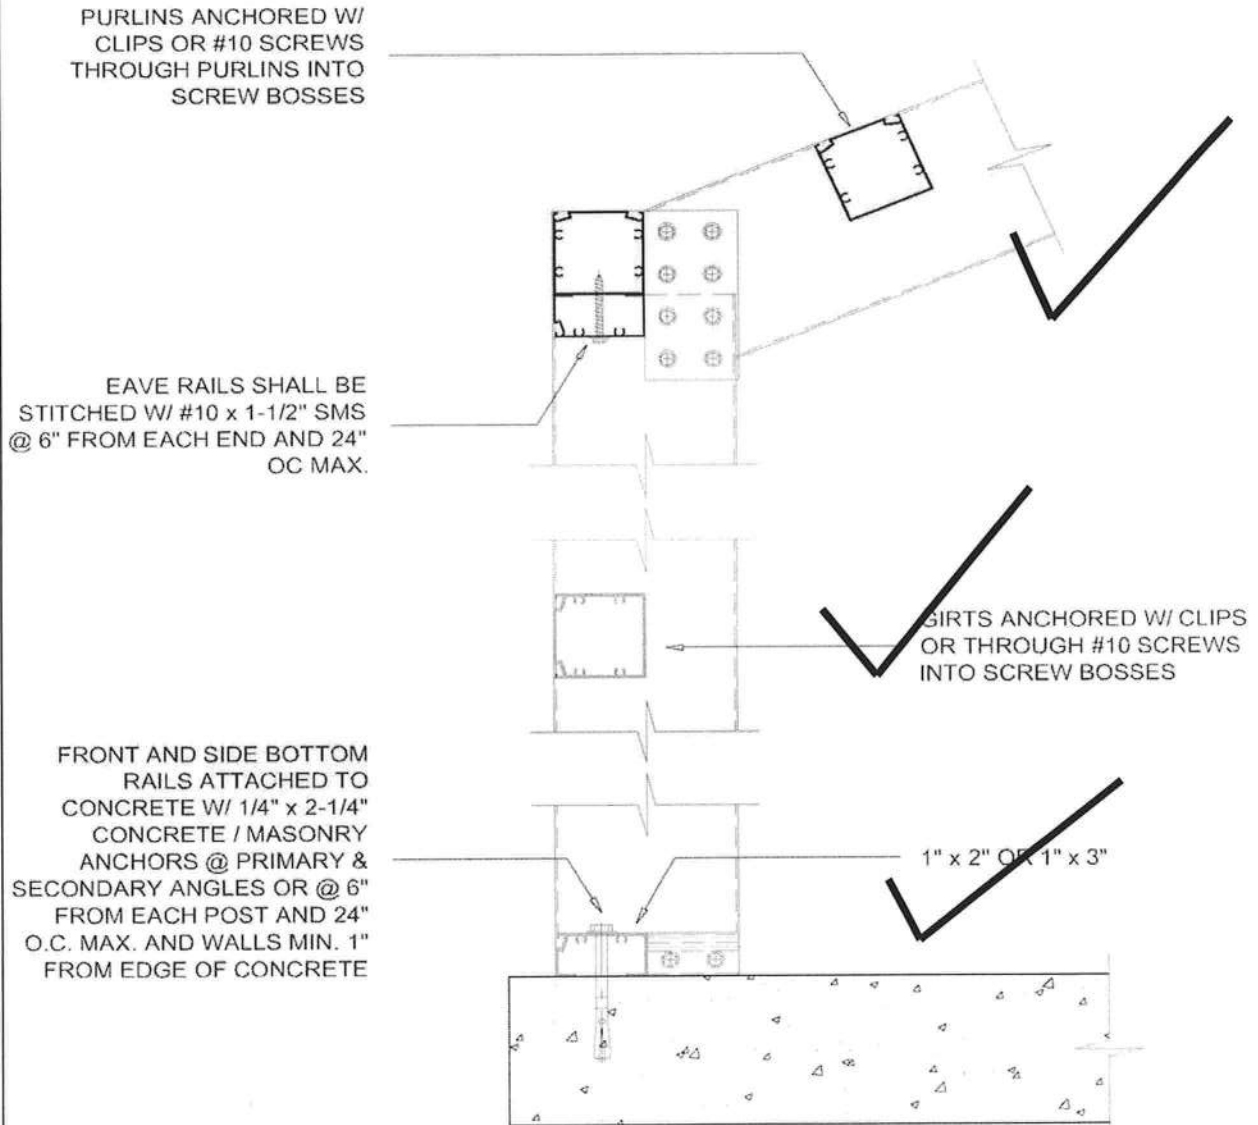

**PURLIN & CHAIR RAIL DETAIL**

SCALE: 3" = 1'-0"

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: lebpe@bellsouth.net

PAGE

1-58

© COPYRIGHT 2006


NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

## SCREENED ENCLOSURES

## SECTION 1

1" x 2" EXTRUSION ANCHOR  
TO CONCRETE W/ CONCRETE  
ANCHORS OR THRU PRIMARY  
ANGLE 6" MAX. EACH SIDE OF  
EACH POST AND @  
24" O.C. MAX.  
SELECT CONCRETE ANCHORS  
FROM SECTION 9

MIN. 3-1/2" SLAB 2500 P.S.I.  
CONCRETE 6 x 6 - 10 x 10  
WELDED WIRE MESH OR  
FIBER MESH CONCRETE

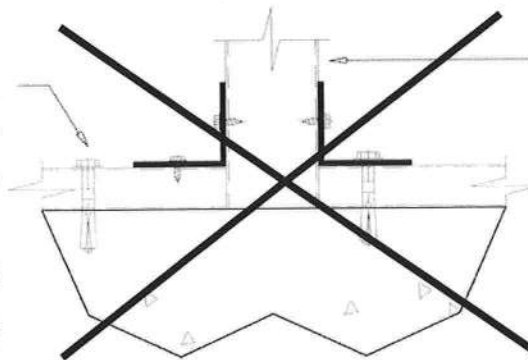

POST SIZE 2" x 4" MAX.

### SIDE WALL POST TO PLATE TO CONCRETE DETAIL

SCALE: 3" = 1'-0"


1" x 2" EXTRUSION ANCHOR  
TO CONC. W/ CONC. ANCH. 6"  
MAX. EA. SIDE OF EA. POST  
AND @ 24" O.C. MAX. SELECT  
CONCRETE ANCHORS FROM  
SECTION 9

2" x 2", 2" x 3" OR 2" x 4"  
HOLLOW SECTION  
(SEE TABLES)

MIN. (3) #10 x 1-1/2" S.M.S. INTO  
SCREW BOLTS

MIN. 3-1/2" SLAB 2500 P.S.I.  
CONC. 6 x 6 - 10 x 10 W.W.M.  
OR FIBER MESH CONC.

MASONRY ANCHOR @ 6" EA.  
SIDE OF POST AND @ 24" O.C.  
MAX. SELECT CONCRETE  
ANCHORS FROM SECTION 9

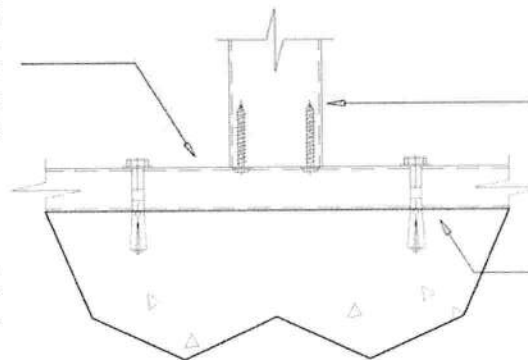

### SIDE WALL HOLLOW POST TO BASE DETAIL

SCALE: 3" = 1'-0"

### POOL ENCLOSURE UPRIGHT TO DECK ANCHOR REQUIREMENTS

#### General Notes and Specifications:

1. The uplift load on a pool enclosure upright is calculated as 1/2 the beam span x the beam spacing x the screen load of 7# / Sq. Ft.

#### EXAMPLE:

FOR A 2" x 6" BEAM WITH A SPAN OF 23' AND A BEAM & UPRIGHT SPACING  
OF 7' USE: 1/2 x 17'-11" x 7' x 10# / Sq. Ft. = 627.2# UPLIFT

2. Table 1.6 of this manual uses the worst case loads for all cases.
3. In all cases there must be a primary anchor within 6" of each side of the upright.
4. For attachment to wood deck (min. 2" nominal thickness) use wood anchors with details shown above (min. 1-3/8" embedment).

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING


P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: lebbe@bellsouth.net


## SCREENED ENCLOSURES

## SECTION 1

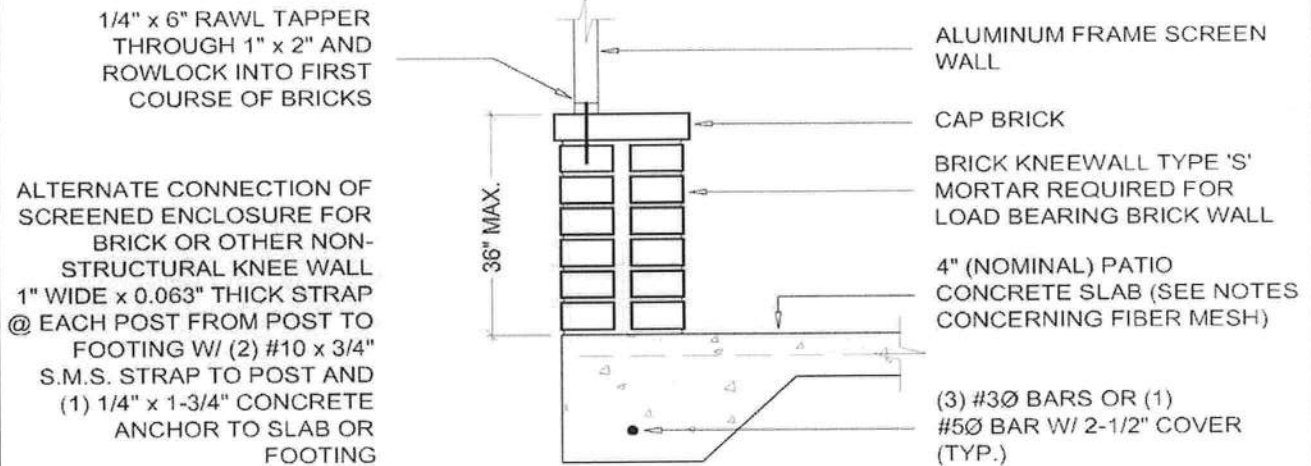

### BRICK KNEEWALL AND FOUNDATION FOR SCREEN WALLS

SCALE: 3/4" = 1'-0"

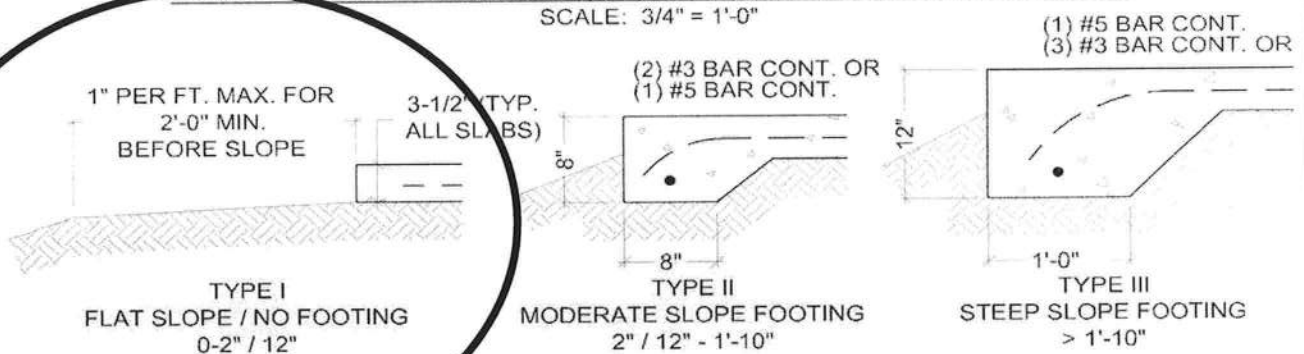

#### Notes for all foundation types:

1. The foundations shown are based on a minimum soil bearing pressure of 1,500 PSF. Bearing capacity of soil shall be verified prior to placing slab by field soil test (soil penetrometer) or a soil testing lab.
2. The slab / foundation shall be cleared of debris, roots and compacted prior to placement of concrete.
3. No footing is required except when addressing erosion until the slab width in the direction of the primary beams exceeds the span per table on page 1-69, then a type II slab is required under the load bearing wall only unless the side wall exceeds 16' in height or the enclosure is in a "C" exposure category in which case a type II footing is required.
4. Monolithic slabs and footings shall be minimum 2,500 psi concrete with 6 x 6 - 10 x 10 welded wire mesh or crack control fiber mesh; Fibermesh® Mesh, InForce™ e3™ (Formerly Fibermesh MD) per manufacturer's specification may be used in lieu of wire mesh. All slabs / footings shall be allowed to cure for 7 days before installing anchors.
5. If local codes require a minimum footing use Type II footing or footing section required by local code. Local codes govern.

### SLAB-FOOTING DETAILS

SCALE: 3/4" = 1'-0"

Lawrence E. Bennett, P.E. FL # 16644  
CIVIL & STRUCTURAL ENGINEERING  
P.O. Box 214368, South Daytona, FL 32121  
Telephone #: (386) 767-4774 Fax #: (386) 767-6556  
Email: lebbe@bellsouth.net

## SECTION 1

## SCREENED ENCLOSURES

**Table 1.1 120 Allowable Spans for Primary Screen Roof Frame Members**  
Aluminum Alloy 6063 T-6

For Wind Zones up to 120 M.P.H., Exposure "B" and Latitudes Below 30°-30'-00" North (Jacksonville, FL)  
Uniform Load = 4 #/SF, a Point Load of 300 #/SF over (1) linear ft. is also considered

Tributary Load Width 'W' = Beam Spacing												
Hollow Sections	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"					
	Allowable Span 'L' / Point Load (P) or Uniform Load (U), bending (b), deflection (d)											
2" x 2" x 0.044"	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb
2" x 2" x 0.050"	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb
2" x 2" x 0.090"	7'-6"	Pb	7'-6"	Pb	7'-6"	Pb	7'-6"	Pb	7'-6"	Pb	7'-6"	Pb
2" x 3" x 0.045"	7'-7"	Pb	7'-7"	Pb	7'-7"	Pb	7'-7"	Pb	7'-7"	Pb	7'-7"	Pb
2" x 4" x 0.050"	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb
2" x 5" x 0.062"	20'-5"	Pb	20'-5"	Pb	20'-5"	Pb	20'-4"	Ud	19'-4"	Ud	18'-6"	Ud

Tributary Load Width 'W' = Beam Spacing												
Self Mating Sections	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"					
	Allowable Span 'L' / Point Load (P) or Uniform Load (U), bending (b), deflection (d)											
2" x 4" x 0.044 x 0.100"	11'-8"	Pd	11'-8"	Pd	11'-8"	Pd	11'-8"	Pd	11'-8"	Pd	11'-8"	Pd
2" x 5" x 0.050 x 0.100"	16'-1"	Pd	16'-1"	Pd	16'-1"	Pd	16'-1"	Pd	15'-9"	Ud	15'-1"	Ud
2" x 6" x 0.050 x 0.120"	20'-4"	Pd	20'-4"	Pd	20'-4"	Pd	20'-3"	Ud	19'-3"	Ud	18'-5"	Ud
2" x 7" x 0.055 x 0.120"	24'-9"	Pd	24'-9"	Pd	24'-6"	Ud	23'-1"	Ud	21'-11"	Ud	20'-11"	Ud
2" x 8" x 0.072 x 0.224"	34'-2"	Pd	32'-9"	Ud	30'-5"	Ud	28'-7"	Ud	27'-2"	Ud	25'-11"	Ud
2" x 9" x 0.072 x 0.224"	39'-3"	Pd	35'-11"	Ud	33'-4"	Ud	31'-5"	Ud	29'-10"	Ud	28'-6"	Ud
2" x 9" x 0.082 x 0.310"	42'-5"	Ud	38'-7"	Ud	35'-10"	Ud	33'-8"	Ud	31'-11"	Ud	30'-7"	Ud
2" x 10" x 0.092 x 0.369"	49'-3"	Ud	44'-9"	Ud	41'-7"	Ud	39'-1"	Ud	37'-2"	Ud	35'-6"	Ud

Tributary Load Width 'W' = Beam Spacing												
Snap Sections	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"					
	Allowable Span 'L' / Point Load (P) or Uniform Load (U), bending (b), deflection (d)											
2" x 2" x 0.044"	4'-10"	Pd	4'-10"	Pd	4'-10"	Pd	4'-10"	Pd	4'-10"	Pd	4'-10"	Pd
2" x 3" x 0.045"	7'-6"	Pd	7'-6"	Pd	7'-6"	Pd	7'-6"	Pd	7'-6"	Pd	7'-6"	Pd
2" x 4" x 0.045"	10'-8"	Pd	10'-8"	Pd	10'-8"	Pd	10'-8"	Pd	10'-8"	Pd	10'-8"	Pd
2" x 6" x 0.062"	22'-2"	Pd	22'-2"	Pd	22'-2"	Pd	21'-5"	Ud	20'-5"	Ud	19'-6"	Ud
2" x 7" x 0.062"	26'-8"	Pd	26'-8"	Pd	25'-9"	Ud	24'-3"	Ud	23'-0"	Ud	22'-0"	Ud

**Note:**

1. Thicknesses shown are "nominal" industry standard tolerances. No wall thickness shall be less than 0.040".
  2. The structures designed using this section shall be limited to a maximum combined span and upright height of 50' and a maximum upright height of 16'. Structures larger than these limits shall have site specific engineering.
  3. Span is measured from center of beam and upright connection to fascia or wall connection.
  4. Above spans do not include length of knee brace. Add horizontal distance from upright to center of brace to beam connection to the above spans for total beam spans.
  5. Tables are based on a maximum wall height of 16' including a 4' max. mansard or gable. Other conditions may offer better spans w/ enclosure site specific engineering.
  6. Spans may be interpolated.
  7. To convert spans to "C" and "D" exposure categories see exposure multipliers and example on page 1-i.
- Example: Max. 'L' for 2" x 4" x 0.050" hollow section with 'W' = 5'-0" = 9'-1"**

Lawrence E. Bennett, P.E. FL # 16644  
**CIVIL & STRUCTURAL ENGINEERING**  
 P.O. Box 214368, South Daytona, FL 32121  
 Telephone #: (386) 767-4774 Fax #: (386) 767-6556  
 Email: lebbe@bellsouth.net

# SCREENED ENCLOSURES

# SECTION 1

**Table 1.2 120 Allowable Spans for Secondary Screen Roof Frame Members**

Aluminum Alloy 6063 T-6

For Wind Zones up to 120 M.P.H., Exposure "B", and Latitudes Below 30°-30'-00" North (Jacksonville, FL)

Uniform Load = 4 #/SF, a Point Load of 300 #/SF over (1) linear ft. is also considered

A. Sections Fastened To Beams With Clips

Hollow Sections	Tributary Load Width 'W' = Purlin Spacing													
	3'-6"		4'-0"		4'-6"		5'-0"		5'-6"		6'-0"		6'-8"	
	Allowable Span 'L' / Point Load (P) or Uniform Load (U), bending (b), deflection (d)													
2" x 2" x 0.044"	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb	4'-5"	Pb
2" x 2" x 0.050"	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb	5'-2"	Pb
2" x 2" x 0.090"	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd
3" x 2" x 0.045"	5'-8"	Pb	5'-8"	Pb	5'-8"	Pb	5'-8"	Pb	5'-8"	Pb	5'-8"	Pb	5'-8"	Pb
3" x 2" x 0.070"	7'-8"	Pd	7'-8"	Pd	7'-8"	Pd	7'-8"	Pd	7'-8"	Pd	7'-8"	Pd	7'-8"	Pd
2" x 3" x 0.045"	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd	7'-4"	Pd
2" x 4" x 0.050"	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb	9'-1"	Pb
2" x 5" x 0.062"	14'-1"	Pd	14'-1"	Pd	14'-1"	Pd	14'-1"	Pd	14'-1"	Pd	14'-1"	Pd	14'-1"	Pd

Snap Sections	Tributary Load Width 'W' = Purlin Spacing													
	3'-6"		4'-0"		4'-6"		5'-0"		5'-6"		6'-0"		6'-8"	
	Allowable Span 'L' / Point Load (P) or Uniform Load (U), bending (b), deflection (d)													
2" x 2" x 0.044	4'-11"	Pb	4'-11"	Pb	4'-11"	Pb	4'-11"	Pb	4'-11"	Pb	4'-11"	Pb	4'-11"	Pb
2" x 3" x 0.045"	7'-3"	Pd	7'-3"	Pd	7'-3"	Pd	7'-3"	Pd	7'-3"	Pd	7'-3"	Pd	7'-3"	Pd
2" x 4" x 0.045"	9'-2"	Pd	9'-2"	Pd	9'-2"	Pd	9'-2"	Pd	9'-2"	Pd	9'-2"	Pd	9'-2"	Pd

B. Sections Fastened Through Beam Webs Into Screw Bosses

Hollow Sections	Tributary Load Width 'W' = Purlin Spacing													
	3'-6"		4'-0"		4'-6"		5'-0"		5'-6"		6'-0"		6'-8"	
	Allowable Span 'L' / Point Load (P) or Uniform Load (U), bending (b), deflection (d)													
2" x 3" x 0.050"	11'-5"	Pb	11'-5"	Pb	11'-5"	Pb	11'-4"	Ud	10'-11"	Ud	10'-8"	Ud	10'-3-3"	Ud
2" x 4" x 0.050"	13'-8"	Pb	13'-8"	Pb	13'-8"	Pb	13'-8"	Pb	13'-8"	Pb	13'-8"	Pb	13'-8"	Pb
2" x 5" x 0.062"	22'-4"	Pd	22'-4"	Pd	22'-4"	Pd	21'-7"	Ud	20'-11"	Ud	20'-4"	Ud	19'-7"	Ud

Snap Sections	Tributary Load Width 'W' = Purlin Spacing													
	3'-6"		4'-0"		4'-6"		5'-0"		5'-6"		6'-0"		6'-8"	
	Allowable Span 'L' / Point Load (P) or Uniform Load (U), bending (b), deflection (d)													
2" x 2" x 0.044"	4'-4"	Pb	4'-4"	Pb	4'-4"	Pb	4'-4"	Pb	4'-4"	Pb	4'-4"	Pb	4'-4"	Pb

## Notes:

1. Thicknesses shown are "nominal" industry standard tolerances. No wall thickness shall be less than 0.040".
  2. Span is measured from center of beam and upright connection to fascia or wall connection.
  3. Tables are based on a maximum wall height of 16' including a 4' max. mansard or gable. Other conditions may offer better spans w/ enclosure site specific engineering.
  4. Spans may be interpolated.
  5. 2" x 4" & 2" x 5" Hollow Girts shall be connected w/ an internal or external 1-1/2" x 1-1/2" x 0.044" angle.
  6. To convert spans to "C" and "D" exposure categories see exposure multipliers and example on page 1-ii.
- CHECK TABLE 1.6 FOR MINIMUM UPRIGHT SIZE FOR BEAMS.
- Example: Max. 'L' for 2" x 4" x 0.050" hollow section fastened to beam with clips with 'W' = 5'-0" = 9'-1"

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-6556

Email: lebpe@bellsouth.net

## SECTION 1

## SCREENED ENCLOSURES

**Table 1.3 110 Allowable Post / Upright Heights for Primary Screen Wall Frame Members**  
**Aluminum Alloy 6063 T-6**

For 3 second wind gust at a velocity of 110 MPH, Exposure "B" or an applied load of 13 #/sq. ft.

Hollow Sections	Tributary Load Width 'W' = Upright Spacing													
	3'-0"		4'-0"		5'-0"		6'-0"		7'-0"		8'-0"		9'-0"	
	Allowable Height "H" / bending (b), deflection (d)													
2" x 2" x 0.044"	7'-5"	d	6'-5"	b	5'-8"	b	5'-1"	b	4'-8"	b	4'-3"	b	3'-11"	b
2" x 2" x 0.050"	7'-10"	d	7'-1"	b	6'-3"	b	5'-8"	b	5'-2"	b	4'-9"	b	4'-5"	b
2" x 2" x 0.090"	8'-11"	d	8'-2"	d	7'-10"	d	7'-1"	b	6'-7"	b	6'-1"	b	5'-9"	b
2" x 3" x 0.045"	8'-4"	d	7'-7"	d	7'-9"	d	6'-11"	d	6'-5"	d	5'-11"	b	5'-6"	b
2" x 4" x 0.050"	11'-2"	b	9'-7"	b	8'-2"	b	7'-9"	b	7'-1"	b	6'-7"	b	6'-1"	b
2" x 5" x 0.062"	17'-3"	b	14'-10"	b	13'-2"	b	11'-11"	b	10'-9"	b	10'-3"	b	9'-7"	b

Self Mating Sections	Tributary Load Width 'W' = Upright Spacing													
	3'-0"		4'-0"		5'-0"		6'-0"		7'-0"		8'-0"		9'-0"	
	Allowable Height "H" / bending (b), deflection (d)													
2" x 4" x 0.044 x 0.100"	11'-11"	d	10'-10"	d	10'-0"	d	9'-5"	b	8'-8"	b	8'-0"	b	7'-6"	b
2" x 5" x 0.050" x 0.100"	14'-9"	d	13'-5"	d	12'-5"	d	11'-7"	b	10'-8"	b	9'-11"	b	9'-4"	b
2" x 6" x 0.050" x 0.120"	17'-3"	d	15'-8"	d	14'-4"	b	13'-1"	b	12'-0"	b	11'-3"	b	10'-6"	b
2" x 7" x 0.055" x 0.120"	19'-8"	d	17'-6"	b	15'-7"	b	14'-2"	b	13'-1"	b	12'-2"	b	11'-5"	b
2" x 8" x 0.072" x 0.224"	24'-4"	d	22'-1"	d	20'-6"	d	19'-4"	d	18'-4"	d	17'-6"	d	16'-10"	d
2" x 9" x 0.072" x 0.224"	26'-8"	d	24'-3"	d	22'-6"	d	21'-2"	d	20'-1"	d	19'-3"	d	18'-2"	b
2" x 9" x 0.082" x 0.310"	28'-8"	d	26'-0"	d	24'-2"	d	22'-9"	d	21'-7"	d	20'-8"	d	19'-10"	d
2" x 10" x 0.092" x 0.369"	33'-3"	d	30'-3"	d	28'-1"	d	26'-5"	d	25'-1"	d	23'-11"	d	23'-1"	d

Snap Sections	Tributary Load Width 'W' = Upright Spacing													
	3'-0"		4'-0"		5'-0"		6'-0"		7'-0"		8'-0"		9'-0"	
	Allowable Height "H" / bending (b), deflection (d)													
2" x 2" x 0.044"	6'-7"	d	5'-11"	d	5'-7"	d	5'-3"	d	4'-10"	b	4'-5"	b	4'-1"	b
2" x 3" x 0.045"	8'-10"	d	8'-1"	d	7'-6"	d	6'-11"	b	6'-3"	b	5'-9"	b	5'-3"	b
2" x 4" x 0.045"	11'-2"	d	10'-2"	d	9'-2"	b	8'-2"	b	7'-5"	b	6'-9"	b	6'-2"	b
2" x 6" x 0.062"	18'-3"	d	16'-7"	d	15'-5"	d	14'-6"	d	13'-9"	d	13'-2"	d	12'-8"	d
2" x 7" x 0.062"	20'-7"	d	18'-9"	d	17'-5"	d	16'-4"	d	15'-7"	d	14'-10"	d	14'-2"	d

**Notes:**

1. Thicknesses shown are "nominal" industry standard tolerances. No wall thickness shall be less than 0.040".
2. Using screen panel width "W" select upright length "H".
3. Above heights do not include length of knee brace. Add vertical distance from upright to center of brace to beam connection to the above spans for total beam spans.
4. Site specific engineering required for pool enclosures over 30' in mean roof height.
5. Height is to be measured from center of beam and upright connection to fascia or wall connection.
6. Chair rails of 2" x 2" x 0.044" min. and set @ 36" in height are designed to be residential guardrails provided they are attached with min. (3) #10 x 1-1/2" S.M.S. into the screw bosses and do not exceed 8'-0" in span.
7. Max. beam size for 2" x 5" is 2" x 7" x 0.055" x 0.120"
8. Spans may be interpolated.
9. To convert spans to "C" and "D" exposure categories see exposure multipliers and example on page 1-ii.

Lawrence E. Bennett, P.E. FL # 16644  
**CIVIL & STRUCTURAL ENGINEERING**  
 P.O. Box 214368, South Daytona, FL 32121  
 Telephone #: (386) 767-4774 Fax #: (386) 767-6556  
 Email: lebbe@bellsouth.net

PAGE

1-80

© COPYRIGHT 2006

NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

## SECTION 1

## SCREENED ENCLOSURES

**Table 1.4 110 Allowable Post / Girt / Chair Rail Spans, Header Spans & Upright Heights for Secondary Screen Wall Frame Members**  
Aluminum Alloy 6063 T-6

For 3 second wind gust at a velocity of 110 MPH, Exposure "B" or an applied load of 13 # / sq. ft.

A. Sections As Horizontals Fastened To Posts With Clips

Hollow Sections	Tributary Load Width "W" = Upright Spacing							
	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	
	Allowable Height "H" or Span "L" / bending (b), deflection (d)							
2" x 2" x 0.044"	7'-5" d	6'-5" b	5'-8" b	5'-1" b	4'-8" b	4'-3" b	3'-11" b	
2" x 2" x 0.050"	7'-10" d	7'-1" b	6'-3" b	5'-8" b	5'-2" b	4'-9" b	4'-5" b	
2" x 2" x 0.090"	8'-11" d	8'-2" d	7'-10" d	7'-1" b	6'-7" b	6'-1" b	5'-9" b	
3" x 2" x 0.045"	8'-4" d	7'-4" b	6'-6" b	5'-10" b	5'-4" b	4'-11" b	4'-7" b	
3" x 2" x 0.070"	9'-5" d	8'-6" d	7'-9" b	7'-0" b	6'-5" b	5'-11" b	5'-7" b	
2" x 3" x 0.045"	8'-4" d	7'-7" d	7'-9" d	6'-11" d	6'-5" d	5'-11" b	5'-6" b	
2" x 4" x 0.050"	11'-2" b	9'-7" b	8'-6" b	7'-9" b	7'-1" b	6'-7" b	6'-1" b	
2" x 5" x 0.062"	17'-3" b	14'-10" b	13'-2" b	11'-11" b	11'-0" b	10'-3" b	9'-7" b	

Snap Sections	Tributary Load Width "W" = Upright Spacing							
	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	
	Allowable Height "H" or Span "L" / bending (b), deflection (d)							
2" x 2" x 0.044"	6'-7" d	5'-11" d	5'-7" d	5'-3" d	4'-10" b	4'-5" b	4'-1" b	

B. Sections As Horizontals Fastened To Posts Through Side Into Screw Bosses

Hollow Sections	Tributary Load Width "W" = Upright Spacing							
	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	
	Allowable Height "H" or Span "L" / bending (b), deflection (d)							
2" x 2" x 0.044"	8'-4" b	7'-2" b	6'-4" b	5'-8" b	5'-2" b	4'-9" b	4'-5" b	
3" x 2" x 0.045"	9'-7" b	8'-3" b	7'-3" b	6'-6" b	5'-11" b	5'-6" b	5'-1" b	
3" x 2" x 0.070"	11'-5" b	9'-10" b	8'-8" b	7'-10" b	7'-2" b	6'-8" b	6'-3" b	
2" x 3" x 0.045"	11'-2" d	9'-9" b	8'-8" b	7'-10" b	7'-2" b	6'-8" b	6'-2" b	
2" x 4" x 0.050"	12'-6" b	10'-9" b	9'-6" b	8'-7" b	7'-11" b	7'-4" b	6'-10" b	
2" x 5" x 0.062"	19'-3" b	16'-7" b	14'-9" b	13'-5" b	12'-4" b	11'-6" b	10'-9" b	

Snap Sections	Tributary Load Width "W" = Upright Spacing							
	3'-0"	4'-0"	5'-0"	6'-0"	7'-0"	8'-0"	9'-0"	
	Allowable Height "H" or Span "L" / bending (b), deflection (d)							
2" x 2" x 0.044"	8'-10" d	7'-8" b	6'-9" b	6'-0" b	5'-5" b	4'-11" b	4'-7" b	

**Note:**

1. Thicknesses shown are "nominal" industry standard tolerances. No wall thickness shall be less than 0.040".
2. Using screen panel width "W" select girt lengths.
3. Site specific engineering required for pool enclosures over 30' in mean roof height.
4. Span/height is to be measured from center of beam and upright connection to fascia or wall connection.
5. Chair rails of 2" x 2" x 0.044" min. and set @ 36" in height are designed to be residential guardrails provided they are attached with min. (3) #10 x 1-1/2" s.m.s. into the screw bosses and do not exceed 8'-0" o.c.
6. Girt spacing shall not exceed 6'-8".
7. Max. beam size for 2" x 5" is 2" x 7" x 0.055" x 0.120"
8. 2" x 4" & 2" x 5" hollow girts shall be connected w/ an internal or external 1-1/2" x 1-1/2" x 0.044" angle.
9. Spans/heights may be interpolated.
10. To convert spans to "C" and "D" exposure categories see exposure multipliers and example on page 1-ii.

REVISED APRIL 2007

Lawrence E. Bennett, P.E. FL # 16644  
CIVIL & STRUCTURAL ENGINEERING  
P.O. Box 214365, South Daytona, FL 32121  
Telephone #: (386) 767-4774 Fax #: (386) 767-6556  
Email: ltbpe@bellsouth.net

PAGE

1-84

© COPYRIGHT 2006

NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.

## SECTION 1

## SCREENED ENCLOSURES

Table 1.6 Minimum Upright Sizes and Number of Screws for Connection of Roof Beams To Wall Uprights or Beam Splicing

Beam/Upright or Post	Upright or Post/Beam	Minimum Purlin, Girt & Knee Brace Size	Notes	Minimum Number of Screws*			Beam Stitching Screw at 24" OC
				#8 x 1/2"	#10 x 1/2"	#12 x 1/2"	
2 x 4 SMB	2 x 3 SMB or H	2" x 2" x 0.044"	Partial Lap	8	6	4	#10
2 x 5 SMB	2 x 3 SMB or H	2" x 2" x 0.044"	Partial Lap	8	6	4	#8
2 x 6 SMB	2 x 3 SMB or H	2" x 2" x 0.044"	Partial Lap	10	8	6	#10
2 x 7 SMB	2 x 4 SMB or H	2" x 3" x 0.044"	Full Lap	14	12	10	#12
2 x 8 SMB	2 x 5 SMB or H	2" x 3" x 0.044"	Full Lap	16	14	12	#14
2 x 9 SMB	2 x 6 SMB	2" x 3" x 0.045"	Full Lap	18	16	14	#14**
2 x 9 SMB *	2 x 7 SMB	2" x 4" x 0.050"	Full Lap	20	18	16	#14**
2 x 10 SMB	2 x 8 SMB	2" x 5" x 0.050"	Full Lap	20	18	16	#14**

Screw Size	Minimum Distance and Spacing of Screws		Gusset Plate Thickness	
	Edge To Center	Center To Center	Beam Size	Thickness
#8	5/16"	5/8"	2" x 7" x 0.055" x 0.120"	0.063"
#10	3/8"	3/4"	2" x 8" x 0.072" x 0.224"	0.125"
#12	1/2"	1"	2" x 9" x 0.072" x 0.224"	0.125"
#14 or 1/4"	3/4"	1-1/2"	2" x 9" x 0.082" x 0.306"	0.190"
5/16"	7/8"	1-3/4"	2" x 10" x 0.092" x 0.369"	0.250"
3/8"	1"	2"		

\* 0.082" wall thickness, 0.310" flange thickness

\*\* (1) Stitching screw at 16" O.C. max.

**Connection Example:**

2" x 7" beam & 2" x 5" at beam & gusset plate, (14) #8 x 1/2" sms & upright & gusset plate  
(14) #8 x 1/2" sms ea. side of beam & upright.

**Note:**

1. Connection of 2" x 6" to 2" x 4" shall use a full lap cut or 1/16" gusset plate.
2. For beam splice connections the number of screws shown is the total for each splice with 1/2 the screws on each side of the cut.
3. The number of screws is based on the maximum allowable moment of the beam.
4. The number of deck anchors is based on RAWL R Tapper allowable load data for 2,500 psi concrete and / or equal anchors may be used. The number shown is the total use 1/2 per side.
5. Hollow splice connections can be made provided the connection is approved by the engineer.
6. If a larger than minimum upright is used the number of screws is the same for each splice with 1/2 the screws on each side of the cut.
7. The side wall upright shall have a minimum beam size as shown above, i.e., a 2" x 4" upright shall have a 2" x 3" beam.
8. For minimum girt size read upright size as a beam and purlin size is minimum girt size. (i.e. 2" x 9" x 0.072" x 0.224" s.m.b. w/ 2" x 6" x 0.050 x 0.120" s.m.b. upright requires a 2" x 3" x 0.045" girt / chair rail.)

Lawrence E. Bennett, P.E. FL # 16644

CIVIL & STRUCTURAL ENGINEERING

P.O. Box 214368, South Daytona, FL 32121

Telephone #: (386) 767-4774 Fax #: (386) 767-5558

Email: lebbe@bellsouth.net

PAGE

1-94

© COPYRIGHT 2006

NOT TO BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF LAWRENCE E. BENNETT, P.E.