

24' WIDE FRAME

'CARPORT STYLE' METAL BUILDING GENERICS



SCOPE OF PLANS:

- 1. TO PROVIDE STRUCTURAL DESIGN FOR A VARIETY OF PRE-FAB METAL BUILDINGS PER THE SPECIFIED DESIGN LOADS, AND APPLICABLE BUILDING CODES
- 2. DOES NOT PROVIDE ANY ARCHITECTURAL, SITE, ZONING, HVAC, ELEC, MECH DESIGN OR REQUIREMENTS. THESE ITEMS MUST BE ADDRESSED BY THEIR RESPECTIVE PROFESSIONALS IN CHARGE.
- 3. DOES NOT PROVIDE ANY DOOR OR WINDOW DESIGN INFORMATION. THOSE SHALL BE ADDRESSED BY DOOR AND WINDOW MANUFACTURER
- 4. THESE DOCUMENT SHALL NOT BE USED TO PERMIT OR JUSTIFY DESIGN OF AS-BUILT / EXISTING STRUCTURES OR BUILDINGS BUILT WITHOUT A PERMIT

GENERAL DESIGN NOTES

- 1. THESE STRUCTURES ARE DESIGNED AS **RISK CATEGORY I (NON-HABITABLE)**, UTILITY / STORAGE / PRIVATE GARAGE / SHED TYPE BUILDINGS - THAT ONLY DESIGNED TO RESIST THE DEAD LOADS, LIVE LOADS, AND WIND LOADS LISTED UNDER "STRUCTURAL DESIGN CRITERIA". ANY ADDITIONAL LOADINGS WITHOUT RE-DESIGN OR ENGINEERING CONSULTATION SHALL NOT BE PERMITTED
- 2. ALL MATERIALS IDENTIFIED BY A MANUFACTURER NAME MAY BE SUBSTITUTED WITH MATERIAL EQUAL OR EXCEEDING ORIGINAL.
- 3. ALL WELDED CONNECTIONS SHALL BE SHOP WELDED CONNECTIONS. **FIELD WELDING IS NOT PERMITTED NOR REQUIRED.**
- 4. ALL STRUCTURAL LIGHT GAUGE TUBING AND CHANNELS SHALL BE:
ASTM A500 GRADE C OR EQUAL.
Fy = 50 KSI Fu = 65 KSI
- 5. GYPSUM BOARD OR DRYWALL FINISH OR ANY BRITTLE BASE MATERIAL IS NOT CONSIDERED OR ACCOUNTED FOR ON THE DESIGN CRITERIA OF THIS STRUCTURE, U.N.O

STRUCTURAL DESIGN CRITERIA

ALL CONSTRUCTION SHALL BE PROVIDED IN ACCORDANCE WITH THE PREVAILING CODES LISTED BELOW AND ALL APPLICABLE LOCAL REQUIREMENTS
PREVAILING CODE: **FBC 2023 (IBC 2021) 8th Edition**
MINIMUM DESIGN STANDARD **ASCE 7-22**

- OCCUPANCY GROUP: U (CARPORT / UTILITY / GARAGE / SHED)
- CONSTRUCTION TYPE: V - B
- RISK CATEGORY: I (NON-HABITABLE)**
- 1. ROOF DEAD LOAD (D): **2.0 PSF (COLLATERAL)**
- 2. ROOF LIVE LOAD (Lr): **Lr = 20 TO 61 PSF (VARIES BASED ON FRAME SPACING AND DESIGN OPTIONS)**
- 3. SNOW LOAD (S):
GROUND SNOW LOAD
Pg = 20 TO 90 PSF (VARIES BASED ON FRAME SPACING AND DESIGN OPTIONS)
Is = 0.80
Ct = 1.2
Ce = 1.0
Cs = 1.0
Pf = 20 TO 61 PSF
PLAT ROOF SNOW LOAD
SLOPED ROOF SNOW LOAD
P_s = 20 TO 61 PSF
P_m = 20

- 4. WIND LOAD (W):
EXPOSURE
DESIGN WIND SPEED
C
Vult = 105 TO 180 MPH (VARIES BASED ON FRAME SPACING AND DESIGN OPTIONS)
- 5. SEISMIC LOAD (E):
DESIGN CATEGORY
IMPORTANCE FACTOR
ASD LOAD COMBINATIONS
1. **D + (Lr OR S)**
2. **D + (0.6W OR ±0.7E)**
3. **D + 0.75 (0.6W OR ±0.7E) + 0.5 (Lr OR S)**
4. **0.6D + (0.6W OR ±0.7E)**

CONTACT INFORMATION

FOR QUESTIONS OR INFORMATION NEEDED PLEASE, CONTACT THE **METAL BUILDINGS MANUFACTURER LISTED ON PLANS**. ENGINEER OF RECORD REQUIRES AUTHORIZATION FROM THE METAL BUILDINGS MANUFACTURER TO ADDRESS ANY QUERIES

THE INFORMATION CONTAINED IN THESE DRAWINGS IS THE SOLE PROPERTY OF METAL BUILDING MANUFACTURER LISTED ON THIS PAGE. ANY REPRODUCTION IN PART OR WHOLE WITHOUT THE WRITTEN PERMISSION OF METAL BUILDING MANUFACTURER LISTED BELOW IS PROHIBITED. LEGAL ACTION WILL BE TAKEN AS NECESSARY AS A RESULT

ANY REQUESTS, CHANGES, MODIFICATIONS, REVISIONS TO INFORMATION PROVIDED IN THIS DOCUMENT WILL REQUIRE A COMPLETELY SEPARATE SITE-SPECIFIC SET OF PLANS. INQUIRE WITH THE LISTED METAL BUILDING MANUFACTURER

STRUCTURAL SHEET INDEX

- COVER SHEET 1
- SCHEDULES & MEMBER - SECTIONS 2
- FRAME SECTIONS & DETAILS 3A, 3B
- SPACING SCHEDULES & ENCLOSURE NOTES 4
- PURLIN & GIRT SCHEDULES 5
- SHEATHING OPTIONS 6

- SIDE WALL FRAMING & OPENINGS 7A, 7B
- END WALL FRAMING & OPENINGS 8A, 8B
- CORNER BRACING DETAILS 9
- OPTIONAL LEAN-TO ADDITION 10
- FOUNDATION OPTIONS 11A TO 11D

Digitally signed by **Omar Abu-Yasein**
Date: 2024.08.09
08:11:21 +03'00'

DESIGNING INFORMATION

FRAME TYPE:	☐ A-FRAME ☐ REGULAR
ENCLOSURE TYPE:	☐ FULL ☐ PARTIAL ☐ OPEN
WIDTH:	
LENGTH:	
HEIGHT:	

DESIGN LOADS

GROUND SNOW:	
ROOF LIVE LOAD:	
BASIC WIND SPEED:	

CUSTOMER INFORMATION

OWNER:	
ADDRESS:	

CERTIFICATION VALIDITY NOTICE

DATE OF PLANS EXPIRATION	01-25-2025
CERTIFICATION ON THESE DRAWINGS IS VALID FOR ONE YEAR FROM DATE OF ISSUE	

MANUFACTURED BY:

REAL STEEL
METAL
BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL - STRUCTURAL


DRAWING INFORMATION

PROJECT:	24' WIDE
LOCATION:	STATE OF FLORIDA
PROJECT NO.:	356-24-0180
SHEET TITLE:	COVER SHEET
SHEET NO.:	1 / 11
DRAWN BY:	DATE:
CHECKED BY:	OAA DATE: 1/25/24

LEGAL INFORMATION

- ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

SEAL

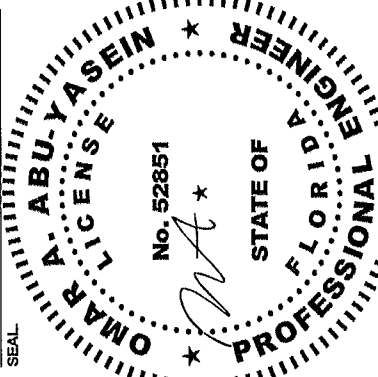

STAMP EXPIRY:	02-28-2025
DATE SIGNED:	01-25-2024

TABLE 2.1: MEMBER PROPERTIES

NO.	LABEL	PROPERTY	DETAIL NO.
1	COLUMN POST	2.5" X 2.5" X 14GA TUBE	1
2	ROOF BEAM	2.5" X 2.5" X 14GA TUBE	1
3	BASE RAIL	2.5" X 2.5" X 14GA TUBE	1
4	PEAK BRACE	2.5" X 2.5" X 14GA CHANNEL	4
5	KNEE BRACES	2.5" X 1.5" X 14GA CHANNEL	4
6	CONNECTOR SLEEVE	2.25" X 2.25" X 12GA TUBE	2
7	BASE ANGLE	2" X 2" X 3" LG 3/16" ANGLE	10
8	PURLIN	4 X 1" X 14GA / 18GA HAT CHANNEL	5
9	GIRT	4 X 1" X 14GA / 18GA HAT CHANNEL	5
9A	OPT END WALL GIRT	2.5" X 1.5" X 14GA CHANNEL	1
10	SHEATHING	29 GA CORRUGATED SHEET	8
11	END WALL POST	2.5" X 2.5" X 14GA TUBE	1
12	DOOR POST	2.5" X 2.5" X 14GA TUBE	1
13	SINGLE HEADER	2.5" X 2.5" X 14GA TUBE	1
14	DOUBLE HEADER	DBL 2.5" X 2.5" X 14GA TUBE	1
15	SERVICE DOOR / WINDOW FRAMING	2.5" X 2.5" X 14GA TUBE	1
16	ANGLE BRACKET	2" X 2" X 2 LG 14GA ANGLE	7
17	STRAIGHT BRACKET	2 X 2 X 4" LG 14GA PLATE	6
18	PB SUPPORT	2.5" X 2.5" X 14GA TUBE	1
19	DIAGONAL BRACE	2 X 2" X 14 GA TUBE	3
20	GABLE BRACE	2 X 2" X 14 GA TUBE	3
21	DB BRACKET	2.25" X 2.25" X 6" LG 14GA ANGLE	9
22	TRUSS SPACER	2.5" X 2.5" X 14GA TUBE	1
23	ALL FASTENERS	#12 X 1" SELF-DRILL SCREWS (ESR-2196 OR EQ) W/ NEOPRENE/STEEL WASHER	

TABLE 2.2: SHEATHING FASTENER SCHEDULE



LOCATION	CORNER PANELS	SIDE LAPS	EDGE LAPS	ELSEWHERE
SPACING	9" C/C	MIN 1	4 1/2" C/C	9" C/C

FASTENER TYPE: #12X1" SELF-DRILL SCREWS (ESR-2196 OR EQ) W/ NEOPRENE/STEEL WASHER


*SEE TYP SHEATHING FASTENER SCHEDULE DIAGRAM ON PAGE 6.

TABLE 2.3: GAUGE THICKNESS


GAUGE	29	18	14	12
THICKNESS (IN)	0.0135	0.049	0.083	0.109

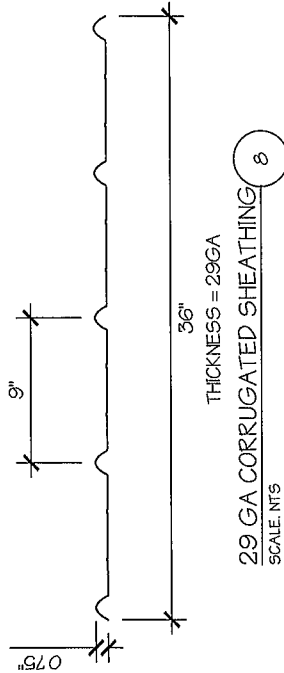


1




2




3




4

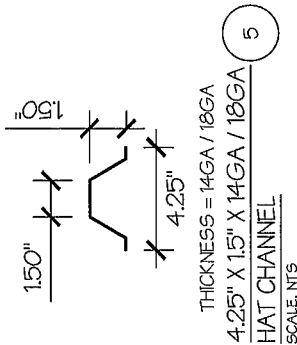


5




6




7

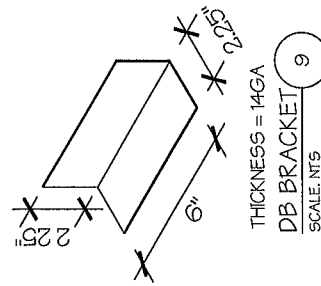

9

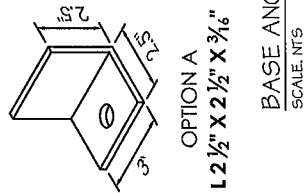

10

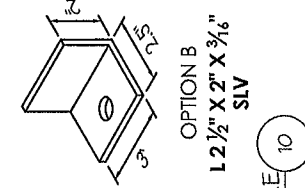

10

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL-STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:

SCHEDULES &
MEMBER SECTIONS


SHEET NO.: 2 / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

SEAL

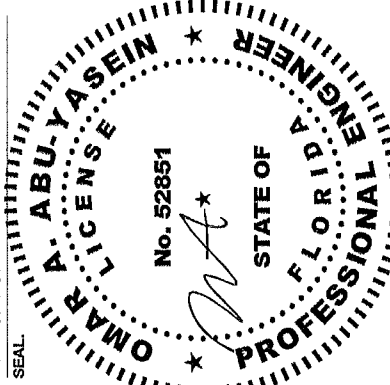

STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

REAL STEEL METAL BUILDINGS



A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT. 24' WIDE

LOCATION. STATE OF FLORIDA

PROJECT NO.. 356-24-0180

SHEET TITLE:

FRAME SECTIONS & DETAILS


SHEET NO.. 3-A / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION


SEAL **WARNING!**

SEAL.

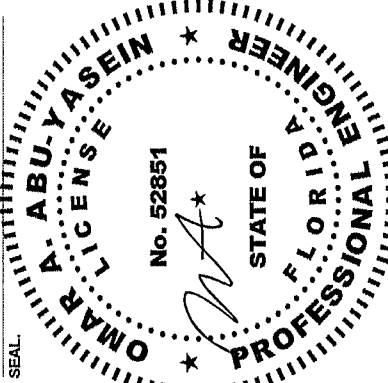

STAMP EXPIRY- 02-28-2025

DATE SIGNED. 01-25-2024

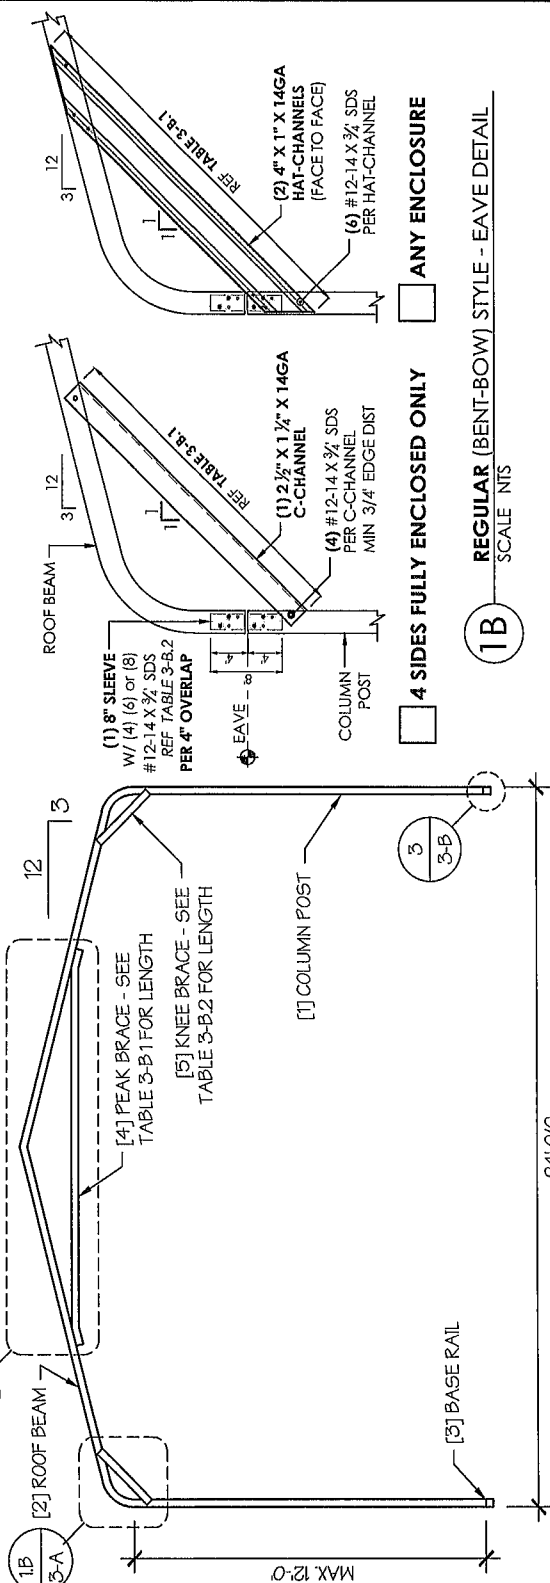

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:


FRAME DETAILS

SHEET NO.: 3-B / 11

CHECKED BY: OAA DATE: 1/25/24


LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY PROHIBITED. ANY VIOLATION WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. - DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE. SEAL.

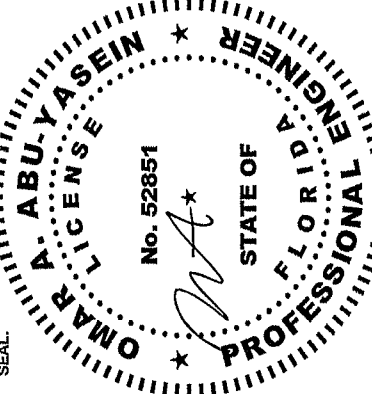


STAMP EXPIRY: 02-28-2025


DATE SIGNED: 01-25-2024

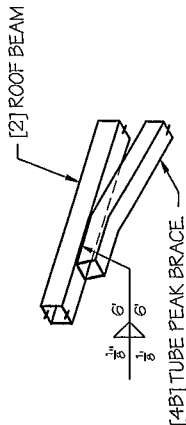


A. PEAK BRACE TUBE

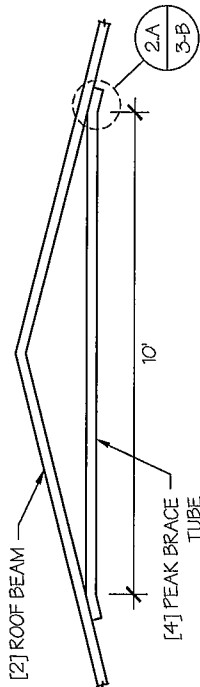

A. WELDED PEAK BRACE

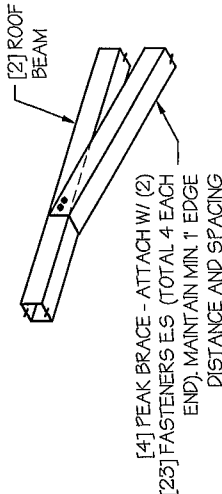

B. PEAK BRACE CHANNEL

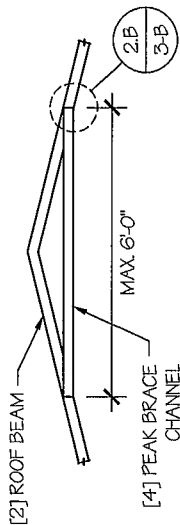

B. CHANNEL PEAK BRACE

PEAK BRACE DETAILS
SCALE: NTS 4

PEAK BRACE CONNECTION DETAILS
SCALE: NTS 2

TABLE 3-B.1: PEAK BRACE SCHEDULE


GROUND SNOW / ROOF LIVE LOAD (PSF)	WIND SPEED	
□ 50 / 20	□ 105 TO 130	□ 140 TO 180
□ 55 / 25 TO 90 / 61	6'	10'
	10'	10'

TABLE 3-B.2: KNEE BRACE SCHEDULE

EAVE HEIGHT	KNEE BRACE LENGTH
□ UP TO 8'	24"
□ 9' TO 12'	36"

TABLE 3-B.3 FASTENER SCHEDULE

WIND SPEED (MPH)	NO. OF FASTENERS
□ 105 TO 125	4
□ 130 TO 155	6
□ 160 TO 180	8

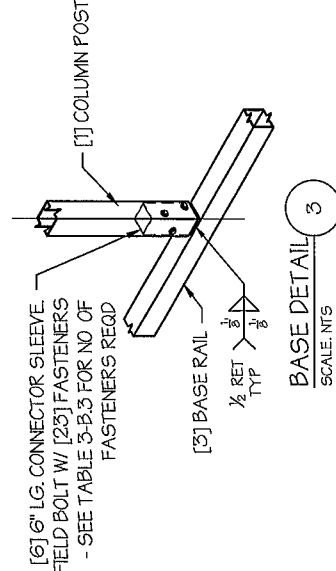

NOTE: COLUMN POST MAY BE ADJUSTED ±1" FOR LEVELING. MANUFACTURER IS NOT RESPONSIBLE FOR LEVELING OF GROUND AND/OR CONCRETE SURFACE PROVIDED BY OTHERS.

TABLE 4: FRAME SPACING CHART / SCHEDULE

[illegible]

NOTES:


1. FRAME SPACINGS ARE IN UNITS OF INCHES (IN)
2. WHERE TWO VALUES ARE SHOWN, THE HIGHER VALUE CAN ONLY BE USED FOR VERTICAL ROOF SHEATHING
3. SNOW LOADS AND ROOF LIVE LOADS ARE IN POUNDS PER SQUARE FOOT (PSF). WIND SPEED IS 3 SEC. GUST IN MILES PER HOUR (MPH).
4. FOR VALUES THAT LIE BETWEEN TWO CELLS, THE HIGHER (MORE STRINGENT) VALUE HAS TO BE USED. INTERPOLATION BETWEEN CELLS IS NOT ALLOWED

ENCLOSURE CLASSIFICATION:

- 1 ENCLOSED BUILDING = ALL 4 WALLS FULLY ENCLOSED WITH DOORS/WINDOWS = USE ENCLOSURE BUILDING SPACING CHART
2. OPEN BUILDING = ALL 4 WALLS FULLY OPEN = USE OPEN BUILDING SPACING CHART
- 3 3FT PARTIALLY ENCLOSED = BOTH END-WALLS FULLY OPEN, WITH BOTH SIDE-WALLS ONLY 3FT ENCLOSED = USE OPEN BUILDING SPACING CHART
- 4 PARTIALLY ENCLOSED = BOTH END-WALLS FULLY OPEN, WITH BOTH SIDE-WALLS ENCLOSED MORE THAN 3FT = START WITH OPEN BUILDING SPACING CHART AND THEN REDUCE SPACING BY 6"
5. 3 SIDED ENCLOSED = ALL WALLS ARE ENCLOSED EXCEPT FOR 1 END-WALL = START WITH ENCLOSURE BUILDING SPACING + THE OPEN END FRAME MUST HAVE EITHER A GABLED END OR HAVE DOUBLED WELDED LEGS & ROOF
6. FOR ALL SHEATHING ENCLOSURES NOT LISTED ABOVE, REFER TO SHEET 5 FOR SPACING AND DESIGN REQUIREMENTS


GENERAL NOTES:

- 1 THE MAX. BUILDING LENGTH FOR ENCLOSED BUILDINGS IS 50'-0" THIS CAN BE INCREASED BY ADDING A DOUBLE FRAME AT THE CENTER TO BREAK THE LENGTH OF THE BUILDING
- 2 BUILDINGS WITH PARTIALLY ENCLOSED END WALLS NEED TO HAVE SIDE WALL BRACING TO SUPPORT THE PARTIALLY ENCLOSED END WALL. (SEE FIGURE A ON SHEET 5)
- 3 ALL BUILDINGS WITH AN OPEN END WALL MUST HAVE A 10'-0" TUBE PEAK BRACE.

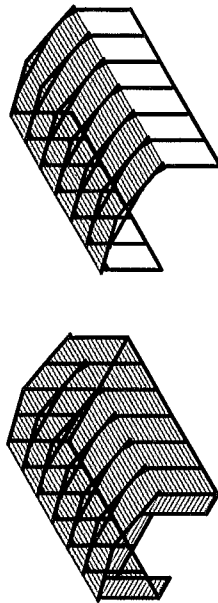

TYPE ENCLOSED BUILDING

SCALE, NTS

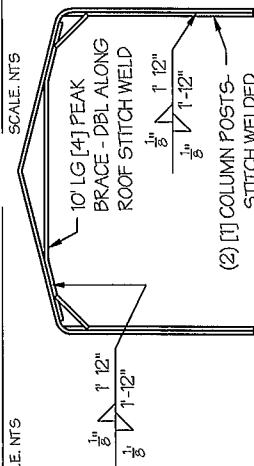

TYP OPEN BUILDING

SCALE. NTS



SCALE NT\$

**REAL STEEL
METAL
BUILDINGS**

ENGINEERED BY:



A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT- 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:


SPACING SCHEDULES
& ENCLOSURE NOTES

SHEET NO. 4 / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

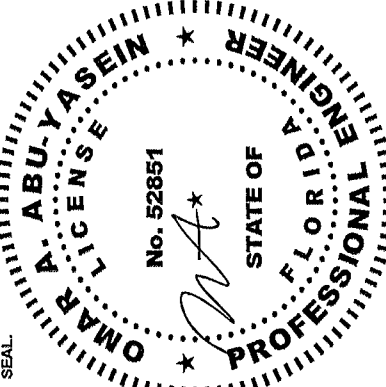

STAMP EXPIRY: 02-28-2025

DATE SIGNED 01-25-2024

MANUFACTURED BY:

TABLE 5.1: PURLIN SPACING SCHEDULE

GROUND SNOW / ROOF LIVE LOAD (PSF)	■ 14GA. HAT CHANNEL PURLIN										■ 18GA. HAT CHANNEL PURLIN									
	WIND SPEED (MPH)					WIND SPEED (MPH)					WIND SPEED (MPH)					WIND SPEED (MPH)				
	105	115	130	140	155	165	180	105	115	130	140	155	165	180	105	115	130	140	155	180
■ 30 / 20	54	48	42	36	30	24	24	36	30	24	18	18	12	12	36	30	24	18	18	12
■ 40 / 27	42	42	42	36	30	24	24	30	24	24	18	18	12	12	30	24	24	18	18	12
■ 50 / 34	40	40	40	36	30	24	24	24	24	24	18	18	12	12	24	24	18	18	12	12
■ 60 / 41	36	36	36	36	30	24	24	18	18	18	18	18	12	12	18	18	18	18	12	12
■ 70 / 47	32	32	32	32	30	24	24	18	18	18	18	18	12	12	18	18	18	18	12	12
■ 80 / 54	30	30	30	30	30	24	24	18	18	18	18	18	12	12	18	18	18	18	12	12
■ 90 / 61	24	24	24	24	24	24	24	12	12	12	12	12	12	12	12	12	12	12	12	12
■ 30 / 20	54	48	42	42	36	30	30	48	42	36	30	24	18	12	42	36	30	24	18	12
■ 40 / 27	42	42	42	42	36	30	30	36	36	30	24	18	18	12	36	30	24	18	18	12
■ 50 / 34	40	40	40	40	36	30	30	30	30	30	24	18	18	12	30	30	24	18	18	12
■ 60 / 41	36	36	36	36	36	30	30	30	30	30	24	18	18	12	30	30	24	18	18	12
■ 70 / 47	32	32	32	32	32	30	30	30	30	30	24	18	18	12	24	24	24	18	18	12
■ 80 / 54	30	30	30	30	30	30	30	24	24	24	24	24	24	18	24	24	24	24	24	18
■ 90 / 61	24	24	24	24	24	24	24	24	24	24	24	24	24	18	24	24	24	24	24	18
■ 30 / 20	54	48	42	42	36	30	30	54	48	42	42	42	36	30	42	36	30	24	18	12
■ 40 / 27	42	42	42	42	36	30	30	40	40	36	30	24	18	12	40	36	30	24	18	12
■ 50 / 34	40	40	40	40	36	30	30	36	36	30	24	18	18	12	36	36	30	24	18	12
■ 60 / 41	36	36	36	36	36	30	30	30	30	30	24	18	18	12	30	30	24	18	18	12
■ 70 / 47	32	32	32	32	32	30	30	30	30	30	24	18	18	12	30	30	24	18	18	12
■ 80 / 54	30	30	30	30	30	30	30	24	24	24	24	24	24	18	24	24	24	24	24	18
■ 90 / 61	24	24	24	24	24	24	24	24	24	24	24	24	24	18	24	24	24	24	24	18
■ 30 / 20	54	48	42	42	36	30	30	54	48	42	42	42	36	30	42	36	30	24	18	12
■ 40 / 27	42	42	42	42	36	30	30	42	42	36	30	24	18	12	42	36	30	24	18	12
■ 50 / 34	40	40	40	40	36	30	30	40	40	36	30	24	18	12	40	36	30	24	18	12
■ 60 / 41	36	36	36	36	36	30	30	36	36	30	24	18	18	12	36	36	30	24	18	12
■ 70 / 47	32	32	32	32	32	30	30	32	32	30	24	18	18	12	32	32	30	24	18	12
■ 80 / 54	30	30	30	30	30	30	30	30	30	30	24	18	18	12	30	30	24	18	18	12
■ 90 / 61	24	24	24	24	24	24	24	24	24	24	24	24	24	18	24	24	24	24	24	18
■ 30 / 20	54	48	42	42	36	30	30	54	48	42	42	42	36	30	42	36	30	24	18	12
■ 40 / 27	42	42	42	42	36	30	30	42	42	36	30	24	18	12	42	36	30	24	18	12
■ 50 / 34	40	40	40	40	36	30	30	40	40	36	30	24	18	12	40	36	30	24	18	12
■ 60 / 41	36	36	36	36	36	30	30	36	36	30	24	18	18	12	36	36	30	24	18	12
■ 70 / 47	32	32	32	32	32	30	30	32	32	30	24	18	18	12	32	32	30	24	18	12
■ 80 / 54	30	30	30	30	30	30	30	30	30	30	24	18	18	12	30	30	24	18	18	12
■ 90 / 61	24	24	24	24	24	24	24	24	24	24	24	24	24	18	24	24	24	24	24	18

NOTES:

1. PURLIN SPACING UNITS ARE IN INCHES
2. FRAME SPACING NEEDS TO BE DETERMINED FROM TABLE 4

IRREGULAR BUILDING NOTES:


1. FIGURES A, B, C & D ON THE RIGHT INDICATE EXAMPLES OF IRREGULAR BUILDINGS
2. FOR IRREGULAR BUILDINGS, FRAME SPACING MUST BE REDUCED BY 6" FROM OPEN BUILDING SPACING TABLE. SEE SHEET 4 FOR OPEN BUILDING TABLE.
3. SITE SPECIFICS MAY ALLOW FOR ALTERNATIVE SPACING
4. IRREGULAR BUILDING & BUILDINGS W/ MORE THAN 2 SIDE OPENINGS MUST HAVE A 10' TUBE PEAK BRACE ON ALL FRAMES

TABLE 5.2: GIRT SPACING SCHEDULE

FRAME SPACING	WIND SPEED (MPH)									
	105	115	130	140	155	165	180	105	115	130
■ 5'-0"	60	48	36	30	24	24	18	60	48	36
■ 4'-6"	60	60	48	42	36	30	24	60	60	48
■ 4'-0"	60	60	60	54	42	36	30	60	60	60
■ 3'-6"	60	60	60	54	54	48	42	60	60	60
■ 2'-0" TO 3'-0"	60	60	60	54	54	48	42	60	60	60

NOTES:

1. GIRT SPACING UNITS ARE IN INCHES
2. THIS SCHEDULE IS TO BE USED FOR BOTH 14GA AND 18GA PURLINS
3. FRAME SPACING NEEDS TO BE DETERMINED FROM TABLE 4

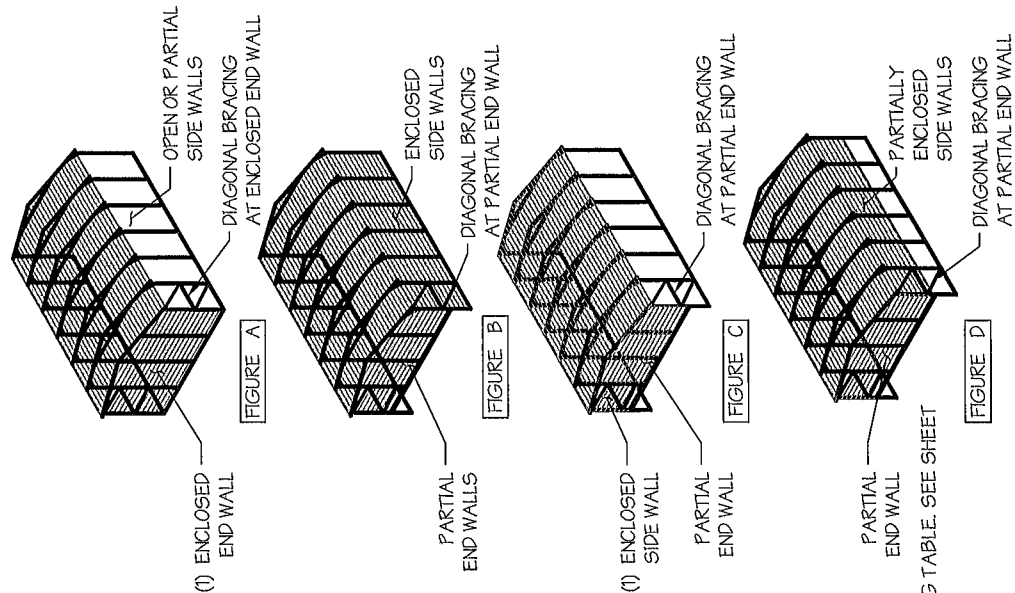

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL - STRUCTURAL


DRAWING INFORMATION

PROJECT: 24' WIDE
LOCATION: STATE OF FLORIDA
PROJECT NO.: 356-24-0180
SHEET TITLE: PURLIN & GIRT SPACING SCHEDULES
SHEET NO.: 5 / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

- ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW.
- DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.
SEAL

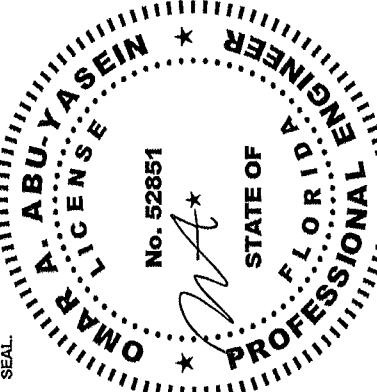

STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO. 356-24-0180

SHEET TITLE:


SHEATHING OPTIONS
& DETAILS

SHEET NO. 6 / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY PROHIBITED. FOR THE FULL TEXT OF THE LAW, BE PROVIDED UNDER THE FULL TEXT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.





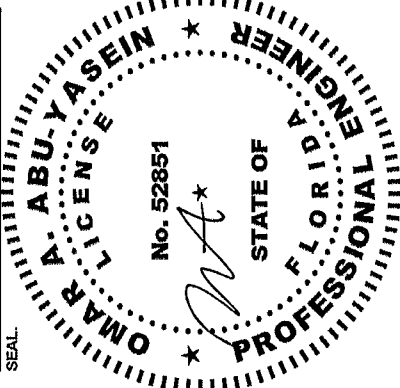


STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

GENERAL SHEATHING NOTES:

- 1 REGULAR STYLE BUILDINGS CAN ONLY HAVE HORIZONTAL SHEATHING ON ROOF AND WALLS
- 2 A-FRAME STYLE BUILDINGS CAN HAVE ANY COMBINATION OF HORIZONTAL OR VERTICAL SHEATHING ON ROOFS AND WALLS
- 3 BOTH HORIZONTAL AND VERTICAL ROOF SHEATHING CAN HAVE MAX. 6" OVERHANG
- 4 USING VERTICAL SHEATHING MAY ALLOW FOR GREATER FRAME SPACING SEE NOTE 2 UNDER TABLE 4
- 5 VERTICAL SHEATHING RECOMMENDED FOR BUILDINGS 30' OR LONGER

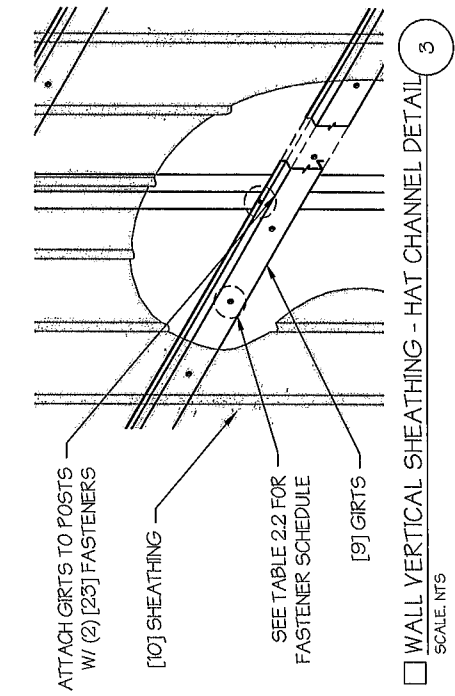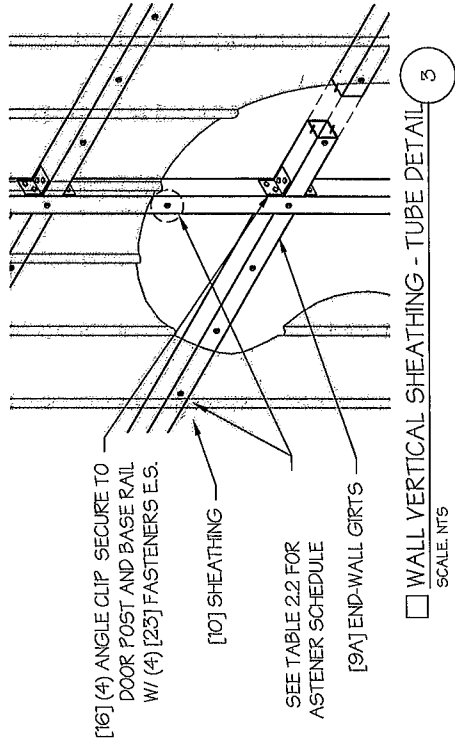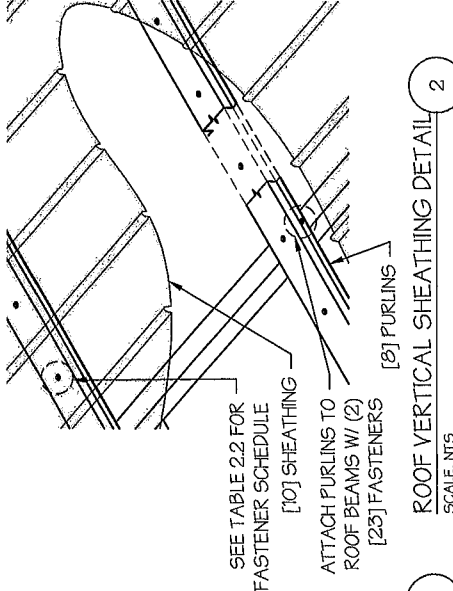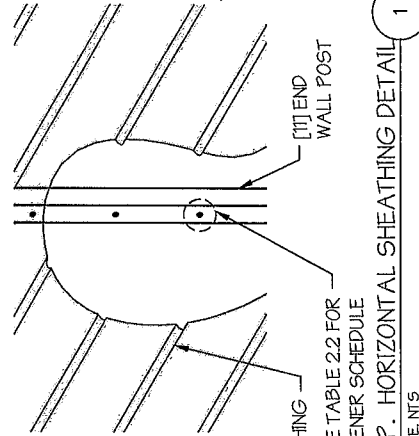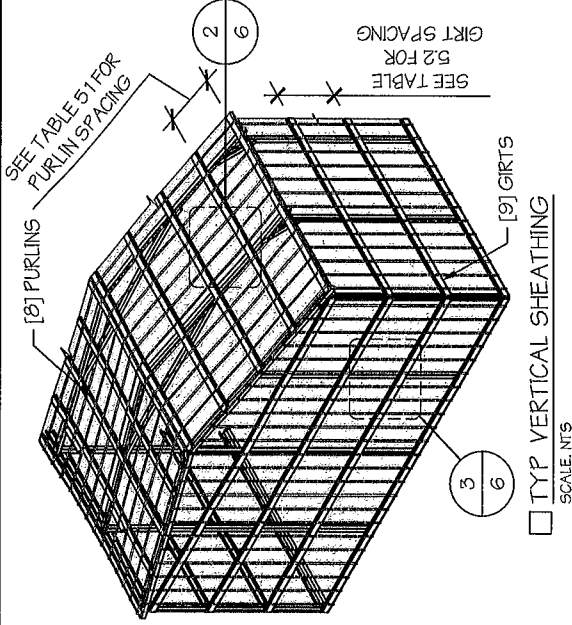

MANUFACTURED BY

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL-STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:


SIDE WALL FRAMING
& OPENINGS

SHEET NO.: 7-A / 11

CHECKED BY: OAA DATE: 1/25/24


LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

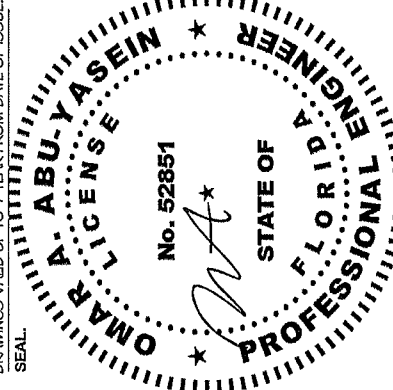


STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

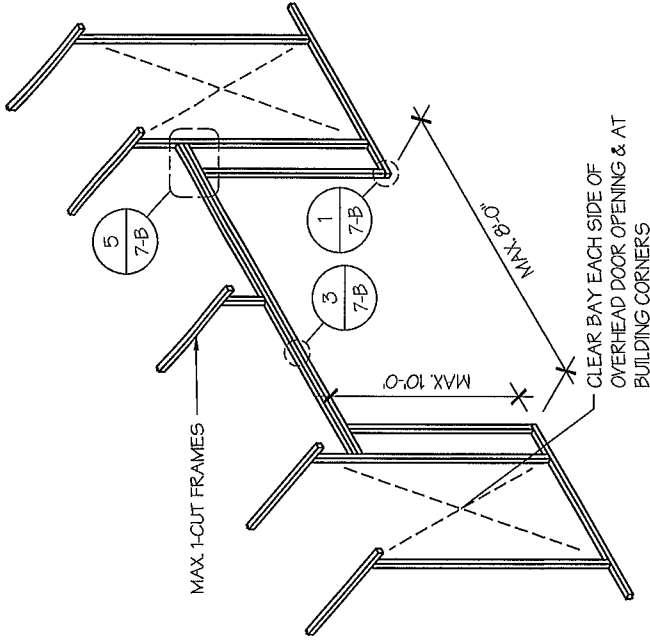

☐ SIDE WALL OVERHEAD DOOR OPENINGS

SCALE: NTS

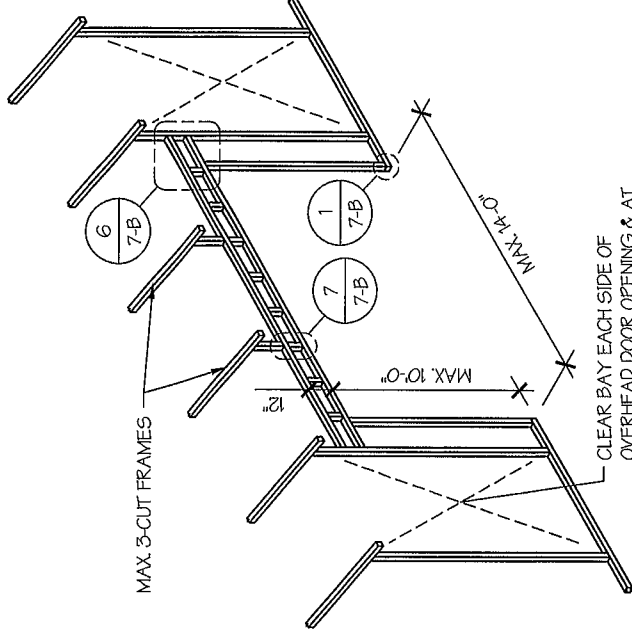


☐ SIDE WALL OVERHEAD DOOR OPENINGS

WITH TRUSS STYLE HEADER

SCALE: NTS

SIDE WALL FRAMING NOTES:

- 1 TRUSS-STYLE HEADERS ARE REQUIRED FOR WHERE THE GROUND SNOW LOAD IS 40 PSF OR GREATER.
- 2 DESIGNS AND DETAILS SHOWN HERE ARE APPLICABLE TO BOTH REGULAR AND A-FRAME STYLE BUILDINGS
- 3 MAX. HEIGHT OF SIDE WALL OVERHEAD DOOR OPENINGS IS 2 FT LESS THAN THE EAVE HEIGHT
- 4 OVERHEAD DOOR OPENINGS CANNOT CUT THROUGH MORE THAN 2 FULL FRAMES
- 5 MIN. 1 CLEAR BAY MUST BE MAINTAINED BETWEEN ANY 2 OVERHEAD DOOR OPENINGS. A CLEAR BAY IS A SPACE BETWEEN TWO FRAMES THAT HAS NO OVERHEAD DOOR OPENINGS
- 6 MIN. 1 CLEAR BAY MUST ALSO BE MAINTAINED FROM THE BUILDING CORNERS
- 7 SERVICE DOORS AND WINDOWS CAN BE PLACED IN CLEAR BAYS OR ANY WHERE ELSE AS NEEDED

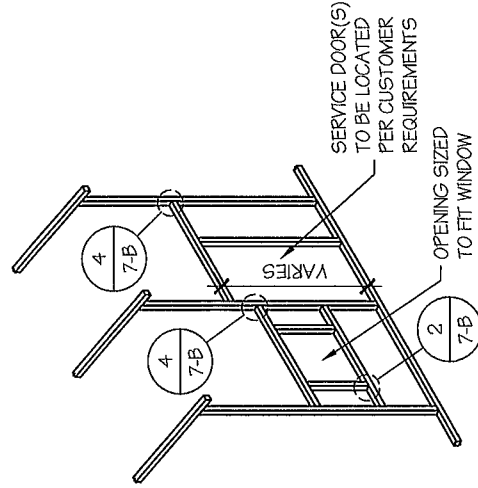

☐ SIDE WALL SERVICE DOOR / WINDOW OPENINGS

SCALE: NTS

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL-STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:

SIDE WALL FRAMING
DETAILS


SHEET NO.: 7-B / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION


- ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

SEAL

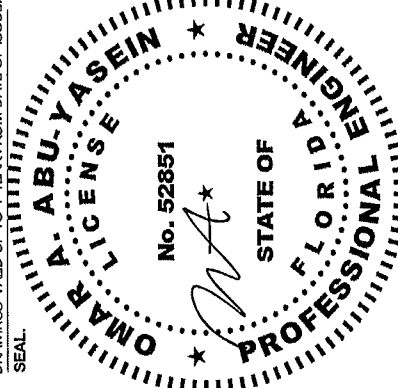


STAMP EXPIRY: 02-28-2025


DATE SIGNED: 01-25-2024

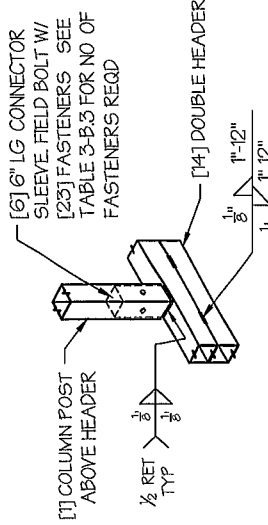


COLUMN POST ABOVE DBL.
DOOR HEADER CONN. DETAIL 3
SCALE: NTS

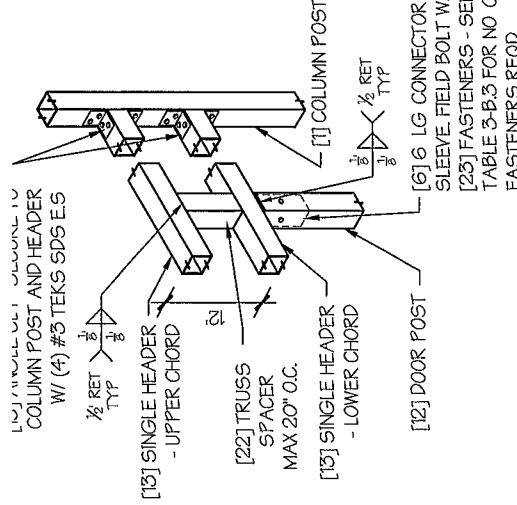


COLUMN POST ABOVE TRUSS
DOOR HEADER CONN. DETAIL 6
SCALE: NTS

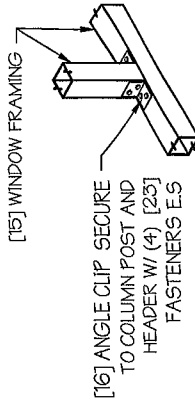


TYP WINDOW FRAMING
CONN. DETAIL 2
SCALE: NTS

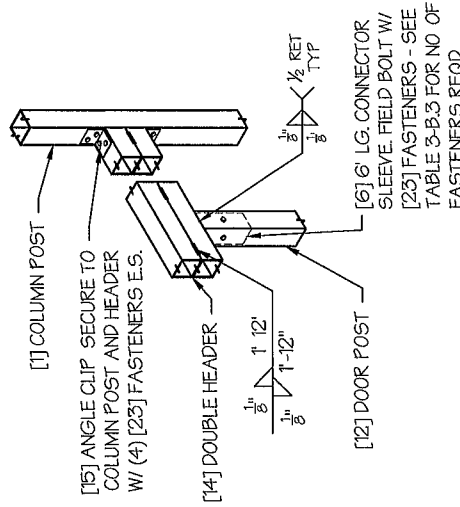


COLUMN POST ABOVE DBL.
DOOR HEADER CONN. DETAIL 5
SCALE: NTS

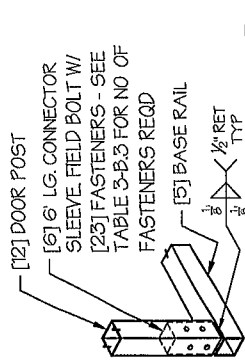

DOOR POST BOT. CONN. DETAIL 1
SCALE: NTS

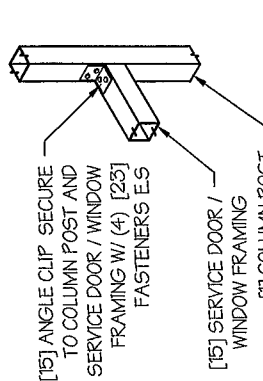

TYP. SERVICE DOOR / WINDOW
FRAMING CONN. DETAIL 4
SCALE: NTS

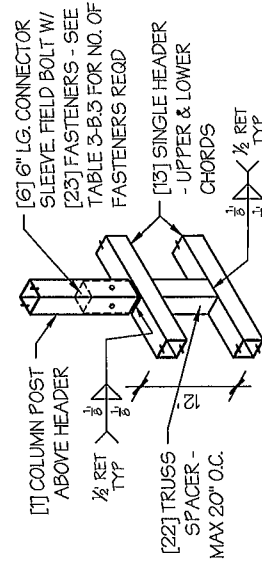

COLUMN POST ABOVE TRUSS
DOOR HEADER CONN. DETAIL 7
SCALE: NTS

**REAL STEEL
METAL
BUILDINGS**

DRAWING INFORMATION

LOCATION STATE OF FLORIDA

END WALL FRAMING

CHECKED BY: OAA DATE: 1/25/24

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW - DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.


SEAI

1. GABLE BRACE IS ONLY REQUIRED FOR PARTIALLY ENCLOSED END WALLS (END WALL POSTS ARE NOT ANCHORED TO THE GROUND).

2. FULLY ENCLOSED OR OPEN
END WALLS DO NOT REQUIRE
GABLE BRACING.


1. DESIGNS AND DETAILS SHOWN HERE ARE APPLICABLE TO BOTH REGULAR AND A-FRAME STYLE BUILDINGS
2. MIN. 12" CLEARANCE MUST BE MAINTAINED BETWEEN ANY TWO OPENINGS (OVERHEAD DOOR OR SERVICE DOOR) AND FROM CORNERS
3. SERVICE DOORS AND WINDOWS CAN BE PLACED AS NEEDED
4. DIAGONAL BRACES NEED TO BE ADDED FOR PARTIAL END WALL ENCLOSURES SEE SHEET 9 FOR DIAGONAL BRACE CONNECTION DETAILS

SCALE NTS




MIN 12" CORNER

SEE TABLE 8-A1 FOR MAX. END WALL POST SPACING



SCALES NTS



SEE TABLE 8-A.1 FOR MAX.
END WALL POST SPACING



WIND SPEED (MPH)	LEAVE HEIGHT ■ UP TO 7' ■ 8' TO 9' ■ 10' TO 12'				
	□ 105	5'	5'	5'	5'
□ 115	5'	5'	5'	4.5'	4.5'
□ 130	4.5'	4.5'	4.5'	4'	4'
□ 140	4.5'	4.5'	4.5'	3'	3'
□ 155	4	4	4'	2.5'	2.5'
□ 165 180	3.5'	3.5'	3'	2'	2'

TABLE 8-A.1 END WALL POST
SPACING SCHEDULE

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL - STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:


END WALL FRAMING
DETAILS

SHEET NO.: 8-B / 11


CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

- ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY PROHIBITED. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

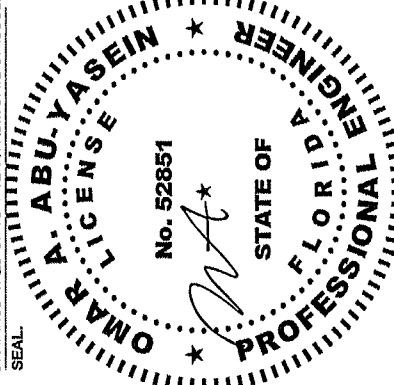

STAMP EXPIRY: 02-28-2025
DATE SIGNED: 01-25-2024

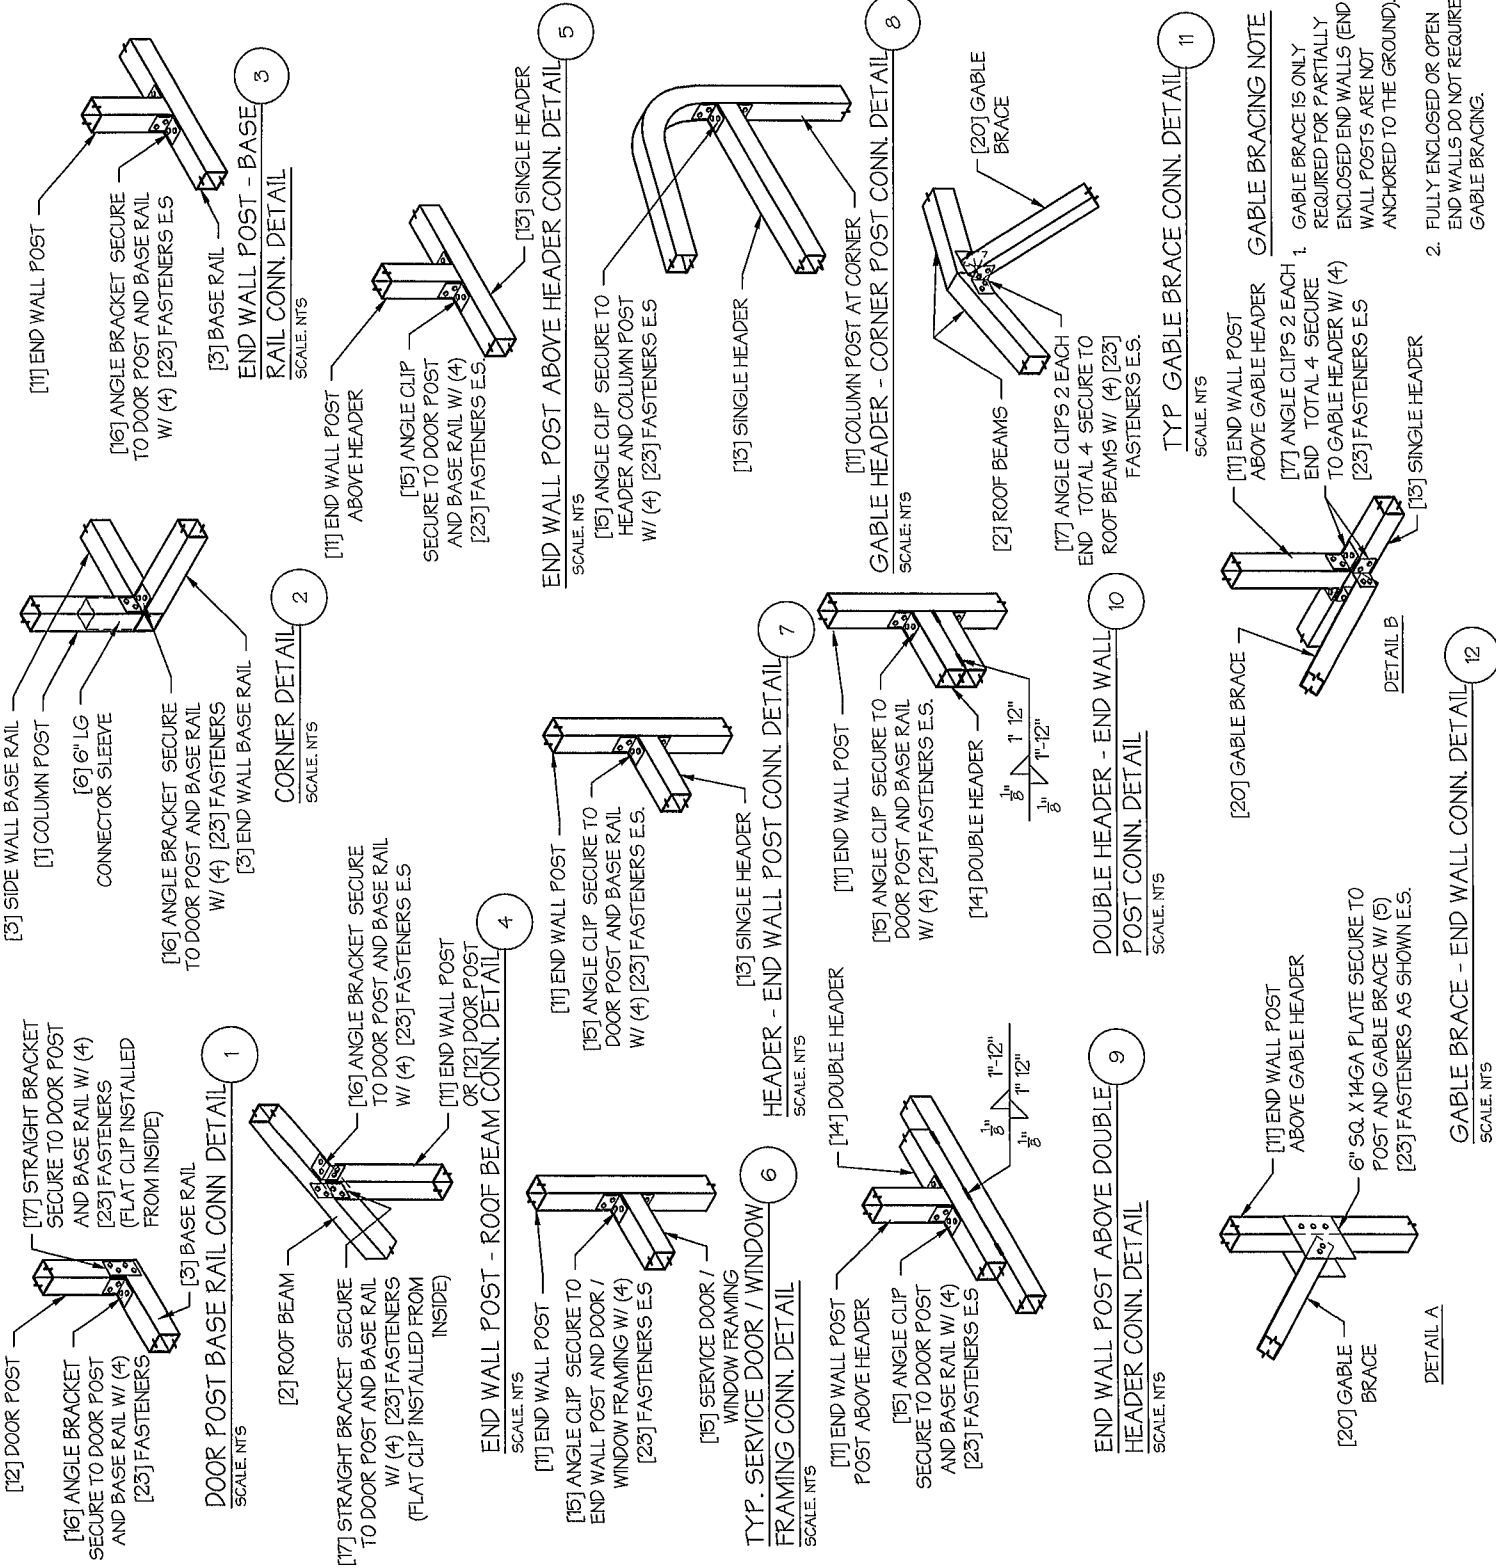

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO. 356-24-0180

SHEET TITLE:

CORNER BRACING
DETAILS


SHEET NO. 9 / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION


ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

SEAL:

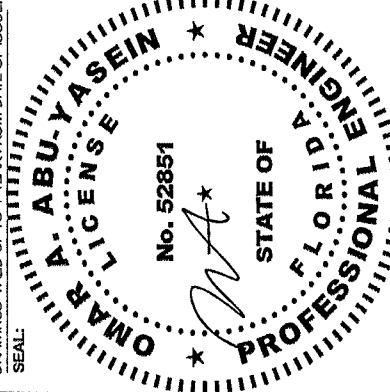

STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

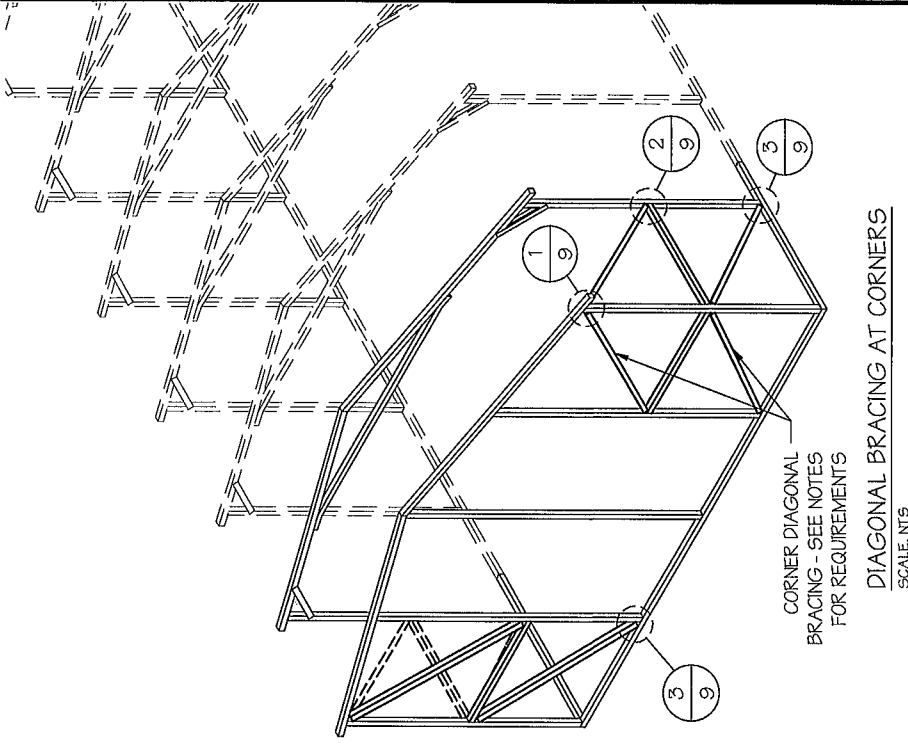


DIAGONAL BRACING AT CORNERS

SCALE: NTS


CORNER BRACING NOTES:

1. DIAGONAL BRACING AT BUILDING CORNERS IS REQUIRED FOR ALL BUILDINGS IN LOCATIONS WHERE WIND SPEED IS 140 MPH OR GREATER.
 - FOR 3 SIDED ENCLOSED BUILDINGS 140 MPH OR GREATER WIND SPEED
 - THE BUILDING MUST BE DESIGNED WITH OPEN BUILDING SPACING AND DIAGONAL BRACING IS REQUIRED ON ALL ENCLOSED WALLS.
2. SIDE-WALL DIAGONAL BRACING IS REQUIRED WHEN THE ADJACENT END-WALL IS PARTIALLY ENCLOSED
3. ALL BUILDINGS WITH IRREGULAR ENCLOSURE (SEE SHEET 5) WILL REQUIRE SIDE-WALL BRACING CLOSE TO THE PARTIALLY ENCLOSED END-WALL.

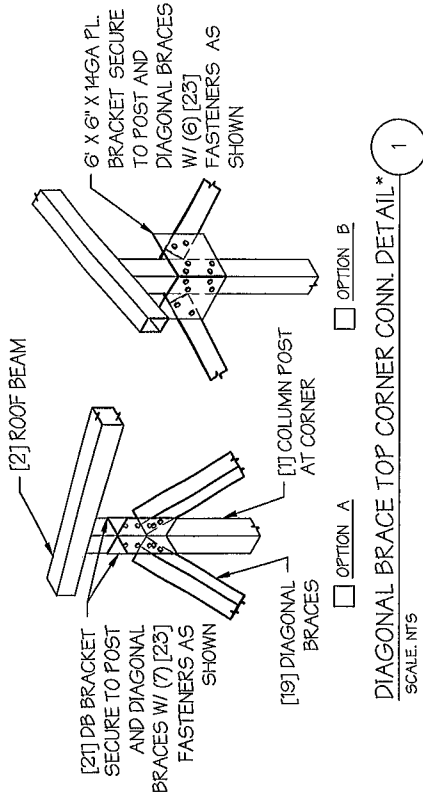


DIAGONAL BRACE TOP CORNER CONN. DETAIL

SCALE: NTS

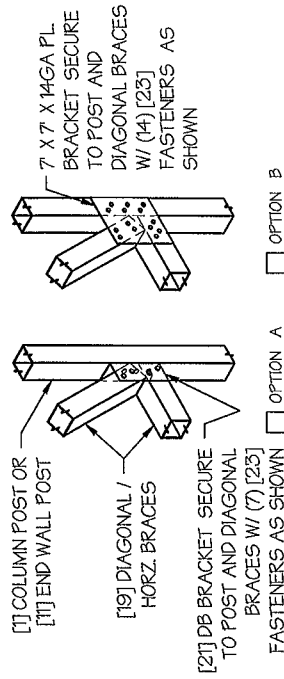

DIAGONAL BRACE - POST CONN. DETAIL

SCALE: NTS

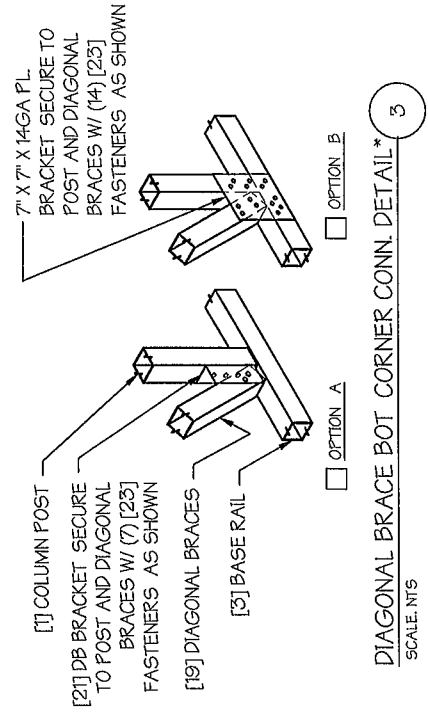

DIAGONAL BRACE BOT CORNER CONN. DETAIL

SCALE: NTS

* INSIDE VIEW SHOWN FOR CLARITY

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:


OPTIONAL LEAN-TO
ADDITION

SHEET NO.: 10 / 11

CHECKED BY: OAA DATE: 1/25/24


LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW.
- DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

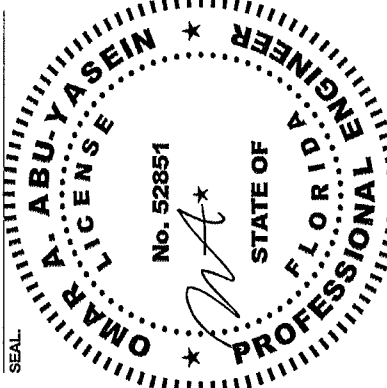


STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

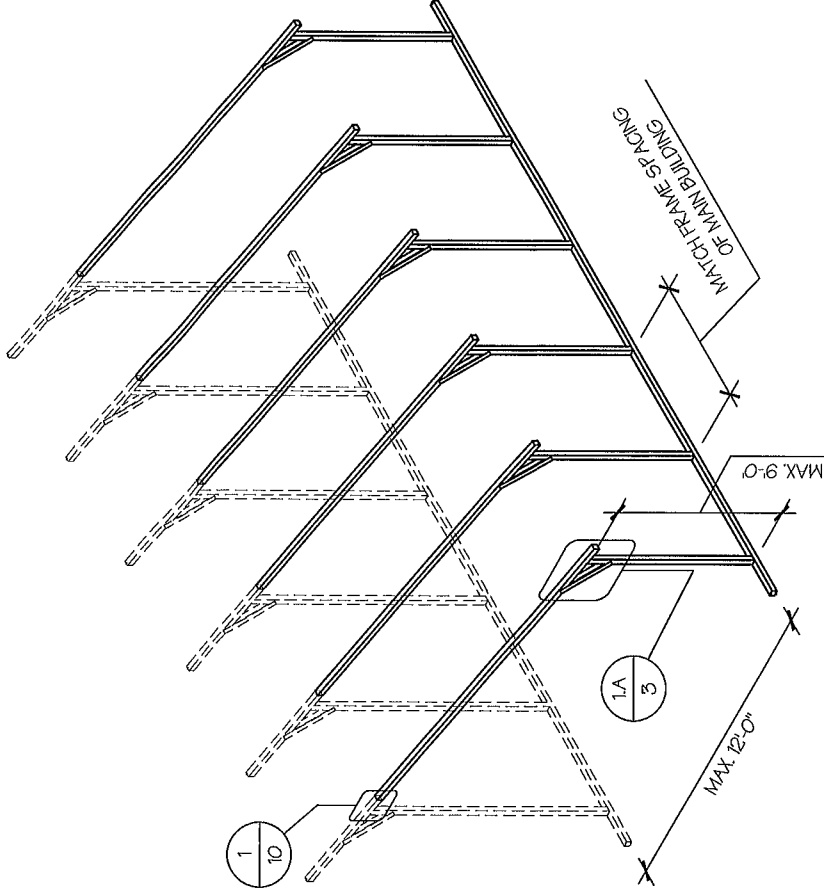

☐ OPTIONAL LEAN-TO ADDITION

SCALE: NTS

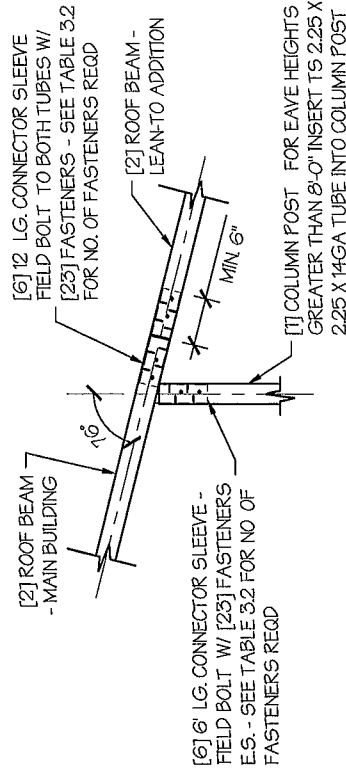

LEAN-TO ATTACHMENT DETAIL

SCALE: NTS

LEAN-TO ADDITION NOTES:

1. LEAN-TO ADDITIONS CAN BE ADDED ON EITHER OR BOTH SIDES OF THE BUILDING
2. ROOF SLOPE, PURLIN, GIRT AND FRAME SPACING OF THE ADDITION HAVE TO MATCH THAT OF THE MAIN STRUCTURE.
3. IF THE LEAN-TO ADDITION IS 'OPEN' (BOTH END WALLS OR SIDE WALL IS NOT ENCLOSED), THE DESIGN OF THE MAIN BUILDING HAS TO USE THE FRAME SPACING OF AN OPEN BUILDING FROM TABLE 4


FLUSH CONCRETE SLAB FOUNDATION NOTES:

- 1 THE SIZE OF THE SLAB SHALL EQUAL THE FOOT-PRINT OF THE BUILDING. **ANCHORS CANNOT BE INSTALLED THRU THE BASE RAIL. ANCHORS SHALL BE INSTALLED THRU WELDED ANGLES OR INTERNAL TUBE PIECES** (REF DETAIL 1) TO ALLOW ANCHOR EDGE DISTANCE.
- 2 DEPTH OF SLAB TURN DOWN FOOTING SHALL BE GREATER THAN FROST DEPTH SPECIFIED PER LOCAL CODE.
- 3 CONTROL JOINTS SHALL BE PLACED SO AS TO LIMIT MAX. SLAB SPANS TO 20' IN EACH DIRECTION
- 4 ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF
- 5 CONCRETE STRENGTH TO BE A MIN. OF 2500 PSI @ 28 DAYS
- 6 IT IS THE RESPONSIBILITY OF THE CONCRETE CONTRACTOR TO SECURE AND VERIFY ALL DESIGN DETAILS PRIOR TO STARTING ANY WORK

NOTE: ANY FOUNDATION POURED PRIOR TO BUILDING DEPARTMENTS APPROVAL OF THESE GENERICS, IS CONSIDERED "BY OTHERS", AND ITS DESIGN IS NO LONGER CERTIFIABLE BY THIS ENGINEER OF RECORD

ANCHORAGE NOTES:


- 1 ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS
- 2 MIN. EMBEDMENT DEPTH TO BE 3"
- 3 MINIMUM SPACING BETWEEN TWO ADJACENT ANCHORS TO BE 4"
- 4 ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS
- 5 REF TABLE 11 FOR ANCHORAGE SCHEDULE
- IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST
- AT MINIMUM, 1 CONCRETE ANCHOR SHALL BE LOCATED NEXT TO EVERY POST AND 1 ANCHOR ON EITHER SIDE OF OPENINGS
- AT MINIMUM, 2 ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL.

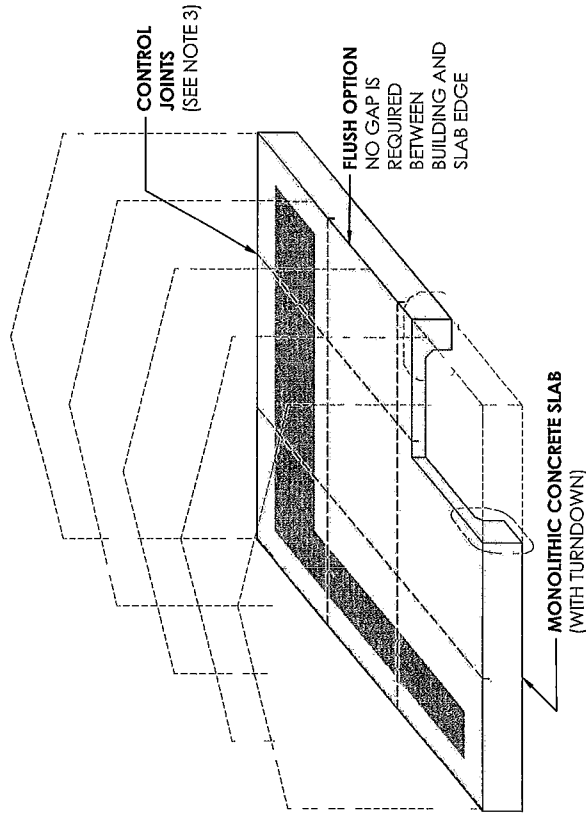

FLUSH CONCRETE SLAB
SCALE NTS

TABLE 11 ANCHORAGE SCHEDULE

ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"
OPEN	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"

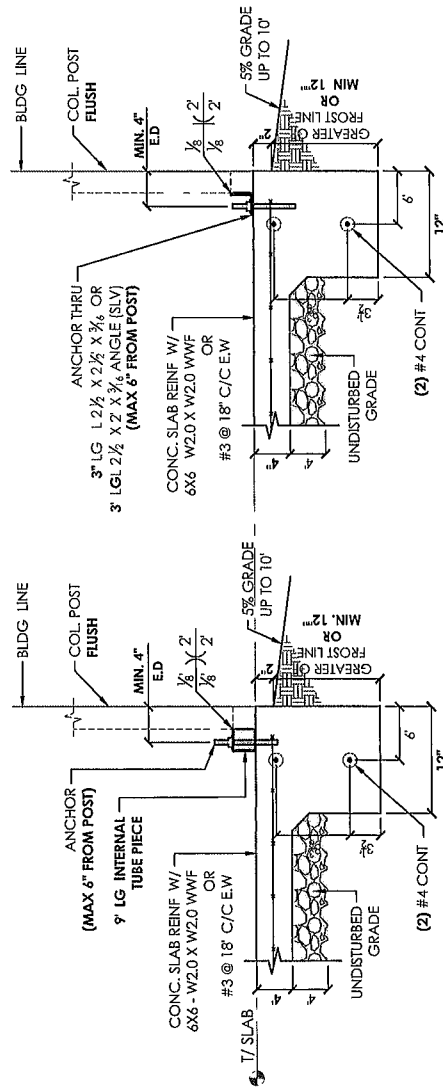

FLUSH PERIMETER DETAIL
SCALE NTS

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL - STRUCTURAL


DRAWING INFORMATION

PROJECT: 24' WIDE
LOCATION: STATE OF FLORIDA
PROJECT NO.: 356-24-0180
SHEET TITLE: FOUNDATION OPTION 1:
FLUSH CONCRETE SLAB
SHEET NO.: 11-A L-11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

- ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW.
- DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

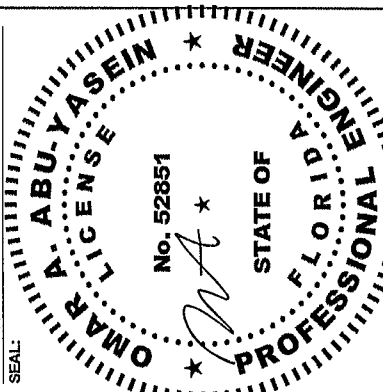

STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

NON-FLUSH CONCRETE SLAB FOUNDATION NOTES:

- THE LENGTH AND WIDTH OF THE SLAB SHALL **+6" GREATER** (3" GAP AROUND BUILDING PERIMETER ON ALL 4 SIDES) THAN THE FOOT-PRINT OF THE BUILDING TO ALLOW ANCHOR EDGE DISTANCE
 - DEPTH OF SLAB TURN DOWN FOOTING SHALL BE GREATER THAN FROST DEPTH SPECIFIED PER LOCAL CODE.
 - CONTROL JOINTS SHALL BE PLACED SO AS TO LIMIT MAX. SLAB SPANS TO 20' IN EACH DIRECTION
 - ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF
 - CONCRETE STRENGTH TO BE A MIN. OF 2500 PSI @ 28 DAYS
 - IT IS THE RESPONSIBILITY OF THE CONCRETE CONTRACTOR TO SECURE AND VERIFY ALL DESIGN DETAILS PRIOR TO STARTING ANY WORK
- NOTE:** ANY FOUNDATION POURED PRIOR TO BUILDING DEPARTMENTS APPROVAL OF THESE GENERICS, **IS CONSIDERED "BY OTHERS"**, AND ITS DESIGN IS NO LONGER CERTIFIABLE BY THIS ENGINEER OF RECORD

ANCHORAGE NOTES:



- ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS
- MIN. EMBEDMENT DEPTH TO BE 3"
- MINIMUM SPACING BETWEEN TWO ADJACENT ANCHORS TO BE 4"
- ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS
- REF. TABLE 11 FOR ANCHORAGE SCHEDULE:
 - IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST
 - AT MINIMUM, 1 CONCRETE ANCHOR SHALL BE LOCATED NEXT TO EVERY POST AND 1 ANCHOR ON EITHER SIDE OF OPENINGS
 - AT MINIMUM, 2 ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL

NON-FLUSH CONCRETE SLAB

SCALE: NTS

TABLE 11 ANCHORAGE SCHEDULE

ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"
OPEN	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"

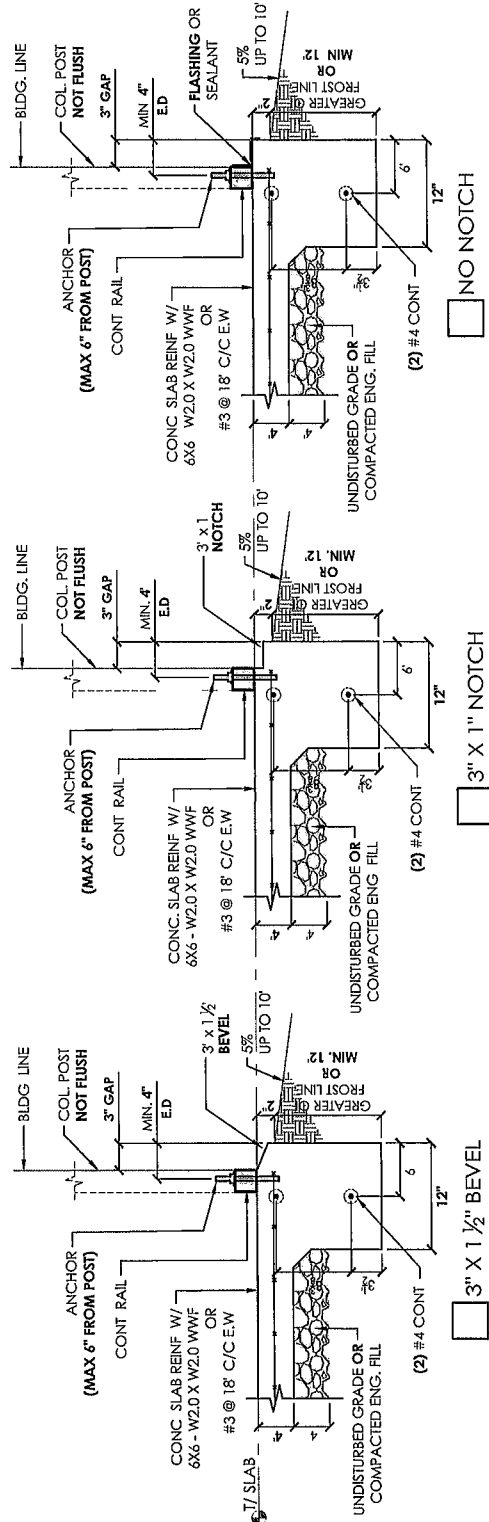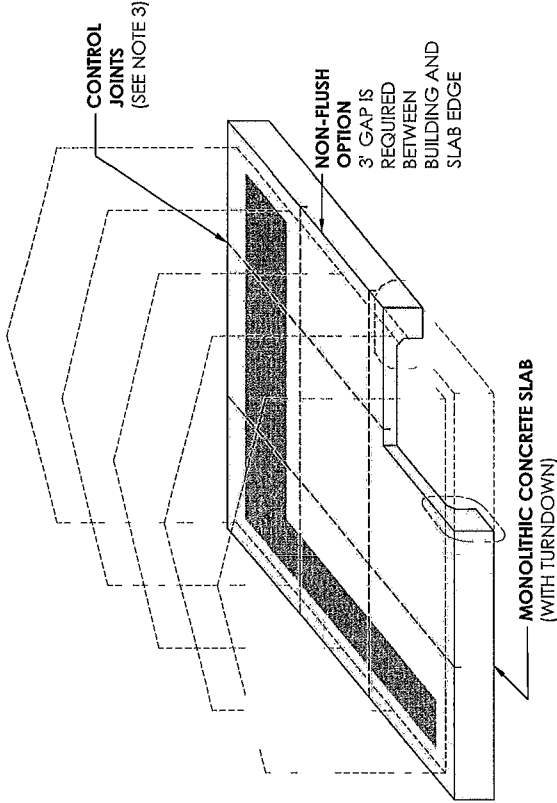

NON-FLUSH / OFFSET PERIMETER DETAIL

SCALE: NTS

MANUFACTURED BY:

REAL STEEL
METAL
BUILDINGS

ENGINEERED BY:




A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT: 24" WIDE
LOCATION: STATE OF FLORIDA
PROJECT NO.: 356-24-0180
SHEET TITLE:
FOUNDATION OPTION 1:
CONCRETE SLAB
SHEET NO.: 11-A / 11
CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.
SEAL:

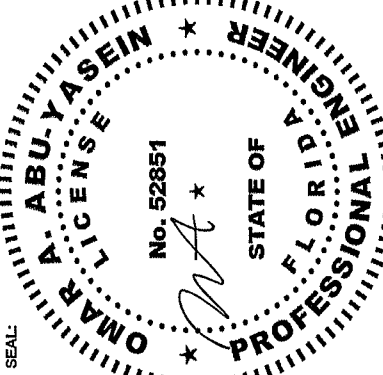

STAMP EXPIRY: 02-28-2025

DATE SIGNED 01-25-2024

MANUFACTURED BY:

REAL STEEL
METAL
BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL-STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:


FOUNDATION OPTION 2:
CONCRETE STRIP

SHEET NO.: 11-B / 11


CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

- ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE. SEAL.

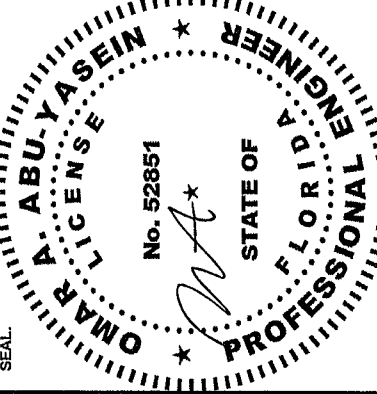


STAMP EXPIRY: 02-28-2025
DATE SIGNED: 01-25-2024

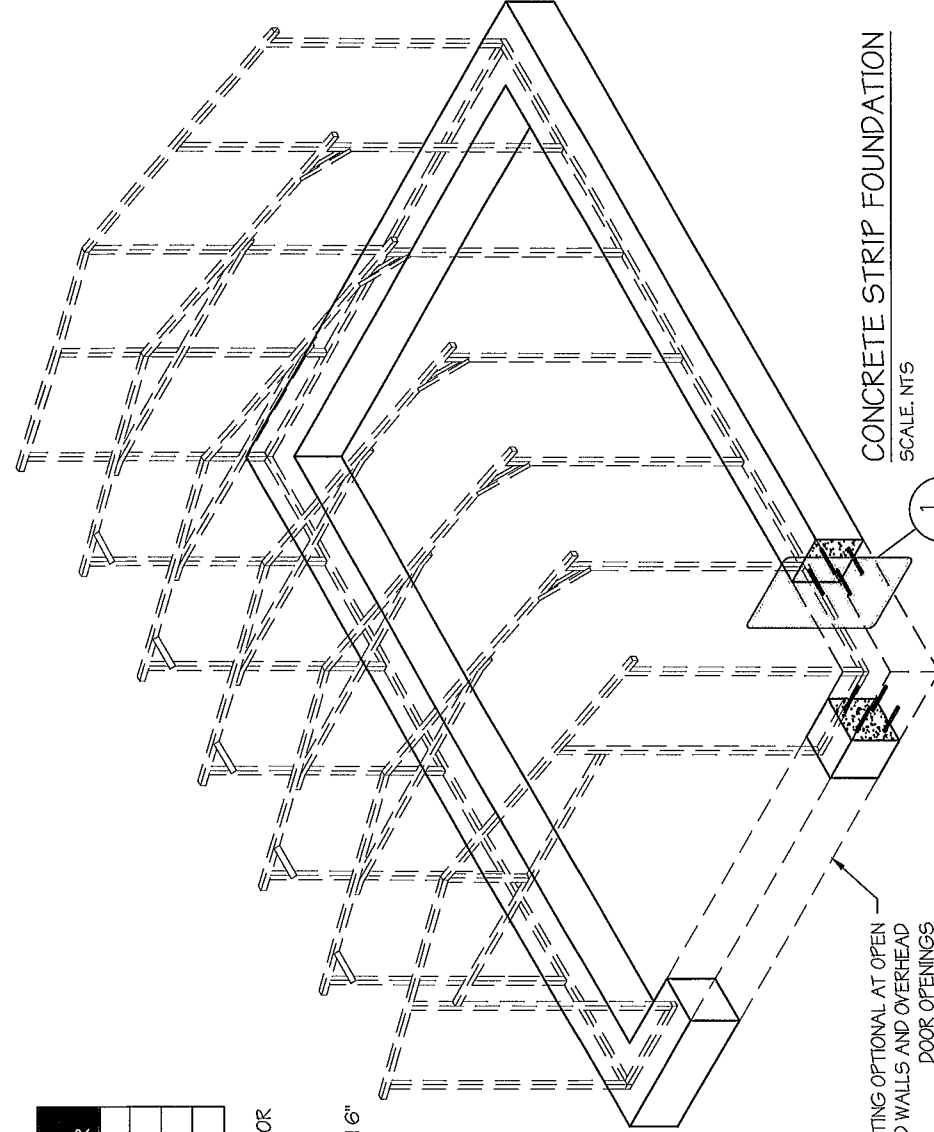

CONCRETE STRIP FOUNDATION

SCALE: NTS

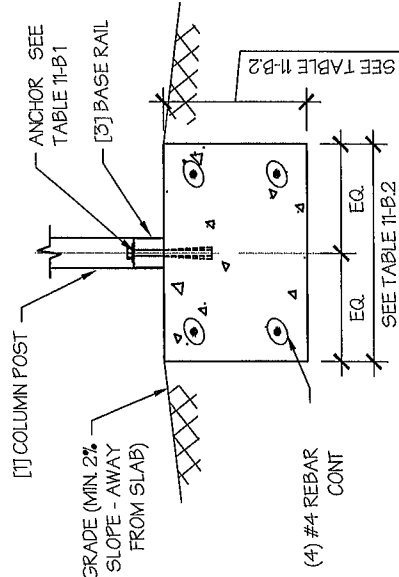

CONCRETE STRIP FOUNDATION DETAIL

SCALE: NTS

TABLE 11-B.1: ANCHOR SCHEDULE

ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"
OPEN	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"

NOTES:

1. ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS
2. MIN. EMBEDMENT DEPTH TO BE 2 1/2"
3. ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS

TABLE 11-B.2. CONC STRIP SCHEDULE

WIND SPEED (MPH)	MIN. SIZE REQD.
105 TO 130	15" X 12"
140 TO 155	24" X 12"
165 TO 180	30" X 12" 24" X 15" 20" X 18"

NOTES:

1. WIDTH AND DEPTH DIMENSIONS CAN BE INTERCHANGED

FOOTING OPTIONAL AT OPEN
END WALLS AND OVERHEAD
DOOR OPENINGS

CONCRETE STRIP FOUNDATION NOTES:

1. DESIGNS SHOWN ON THIS SHEET ARE FOR CONCRETE STRIP FOUNDATION. ANY OF THE FOUNDATIONS SHOWN ON SHEETS 11-A THRU C CAN BE USED
2. CONCRETE ANCHORS SHALL BE LOCATED NEXT TO EVERY POST AND ON EITHER SIDE OF OPENINGS. TWO ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL. IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST
3. MIN. NUMBER OF CONCRETE ANCHORS PER POST SHALL BE AS SHOWN IN TABLE 11-B1
4. ANCHORS IN CLOSE PROXIMITY TO EACH OTHER MUST HAVE A MIN. 4" SPACING
5. DEPTH OF CONCRETE STRIP FOOTING SHALL BE GREATER THAN FROST DEPTH SPECIFIED PER LOCAL CODE.
6. ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF
7. CONCRETE STRENGTH TO BE A MIN OF 2500 PSI @ 28 DAYS
8. BUILDING IS TO BE MOUNTED ON THE CENTER OF THE STRIP FOUNDATION.

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL - STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180
SHEET TITLE:

FOUNDATION OPTION 3:
CONCRETE PIERS


SHEET NO.: 11-C / 11

CHECKED BY: OAA DATE: 1/25/24

LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

SEAL

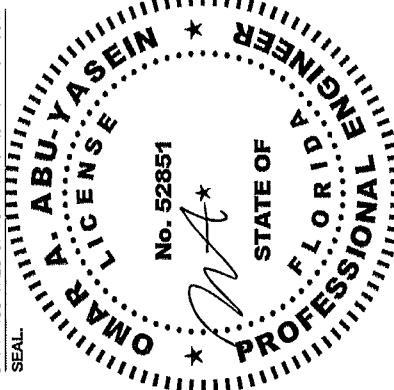

STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

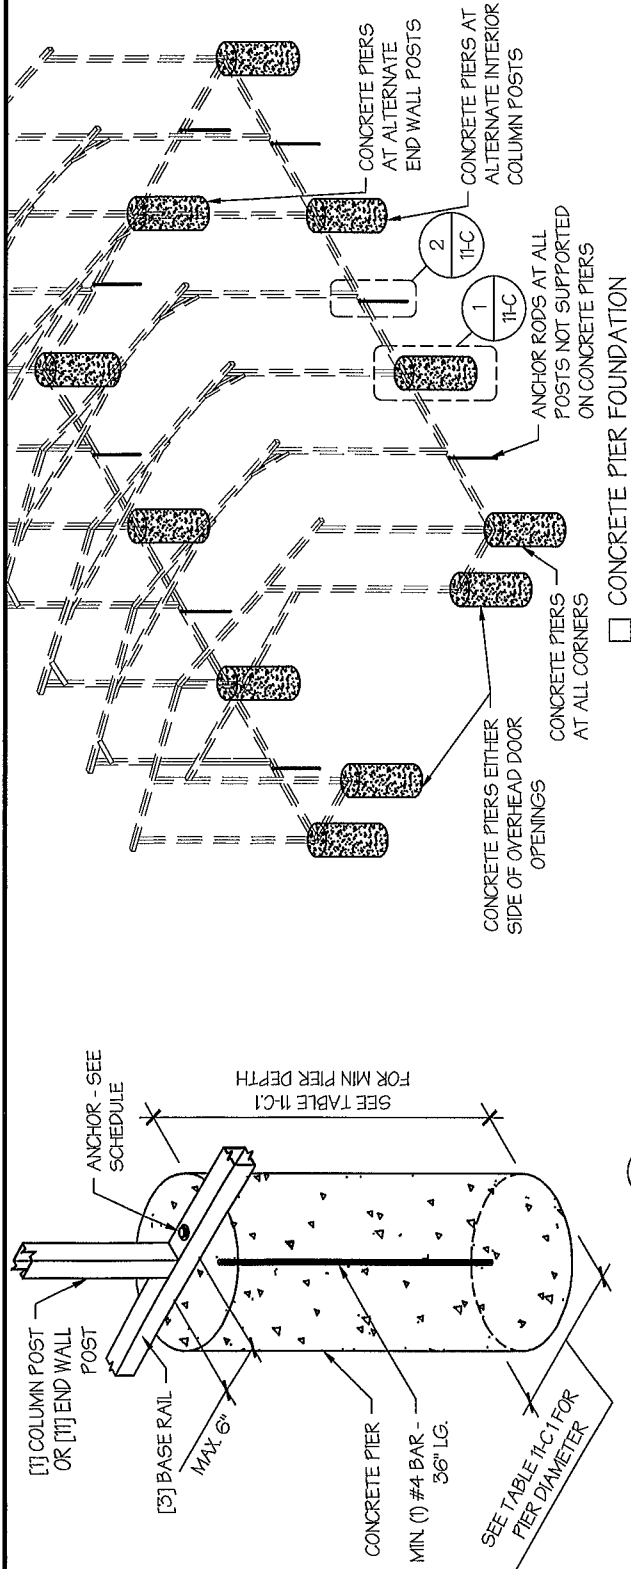


TABLE 11-C2: ANCHOR SCHEDULE

ENCLOSURE	WIND SPEED (MPH)	ANCHOR SIZE/NUMBER
ENCLOSED	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"
OPEN	105 TO 135	(1) 1/2"Ø X 7"
	136 TO 180	(2) 1/2"Ø X 7"


NOTES:

- ANCHORS ARE TO BE CONCRETE WEDGE OR EXPANSION ANCHORS
- MIN. EMBEDMENT DEPTH TO BE 2 $\frac{1}{2}$ "
- ANCHORS TO BE SPACED NO MORE THAN 6" FROM POSTS

CONCRETE PIER FOUNDATION NOTES:

- DESIGNS SHOWN ON THIS SHEET ARE FOR CONCRETE PIER FOUNDATION. ANY OF THE FOUNDATIONS SHOWN ON SHEETS 11-A THRU C CAN BE USED
- CONCRETE PIERS SHALL BE LOCATED AT ALL 4 CORNERS, ON EACH SIDE OF OVERHEAD DOOR OPENINGS AND ON ALTERNATE INTERIOR COLUMN POSTS AND END WALLS POSTS
- TWO ANCHORS SHALL BE INSTALLED AT CORNERS OF ENCLOSED BUILDINGS WITH END WALLS - ONE ON EACH BASE RAIL. IN LOCATIONS REQUIRING TWO ANCHORS DUE TO WIND, ONE ANCHOR IS TO BE ON EACH SIDE OF THE COLUMN POST WITH A PIER. ANCHORS IN CLOSE PROXIMITY TO EACH OTHER MUST HAVE A MIN. 4" SPACING
- MIN. NUMBER OF CONCRETE ANCHORS PER POST WITH A PIER SHALL BE AS SHOWN IN TABLE 11-C2
- TWO ANCHORS AND A PIER ARE REQUIRED AT DIAGONAL BRACING LOCATIONS WHEN REQUIRED
- ALL POSTS NOT SUPPORTED ON CONCRETE PIERS SHALL BE ANCHORED TO THE GROUND WITH A 1/2" X 30" LG. THREADED ROD. RODS WILL HAVE A PRE FORMED HEAD AT THE TOP AND ONE COAT OF RUST PROOF MATERIAL.
- PIERS SHALL BE FORMED BY DIGGING A HOLE OF THE SAME SIZE AS THE PIER ON LEVEL GRADE AND FILLING IT WITH CONCRETE. THIRD ROD ANCHORS SHOULD BE DROPPED INTO THE PIERS PRIOR TO POURING THE CONCRETE.
- ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 P.S.F.
- CONCRETE STRENGTH TO BE A MIN. OF 2500 P.S.I @ 28 DAYS

CONCRETE PIER DETAIL 1
SCALE: NTS

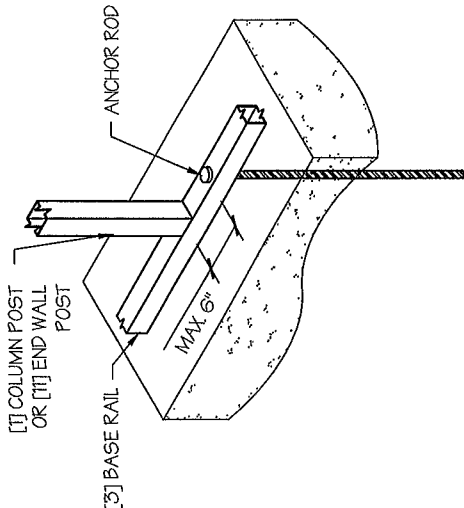

ANCHOR ROD INTO SOIL DETAIL 2
SCALE: NTS

TABLE 11-C1: CONC
PIER SCHEDULE

WIND SPEED (MPH)	MIN. SIZE REQD.
105 TO 130	24"Ø X 36"
131 TO 155	24"Ø X 42"
156 TO 180	24"Ø X 48"

MANUFACTURED BY:

REAL STEEL METAL BUILDINGS

ENGINEERED BY:



A&A ENGINEERING
CIVIL • STRUCTURAL

DRAWING INFORMATION

PROJECT: 24' WIDE

LOCATION: STATE OF FLORIDA

PROJECT NO.: 356-24-0180

SHEET TITLE:

FOUNDATION OPTION 4:


SOIL ANCHORS

SHEET NO.: 11-D / 11

CHECKED BY: OAA DATE: 1/25/24


LEGAL INFORMATION

ANY DUPLICATION OF THIS DRAWING IN WHOLE OR PART IS STRICTLY FORBIDDEN. ANYONE DOING SO WILL BE PROSECUTED UNDER THE FULL EXTENT OF THE LAW. DRAWINGS VALID UP TO 1 YEAR FROM DATE OF ISSUE.

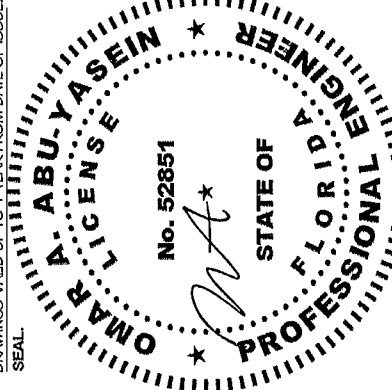

STAMP EXPIRY: 02-28-2025

DATE SIGNED: 01-25-2024

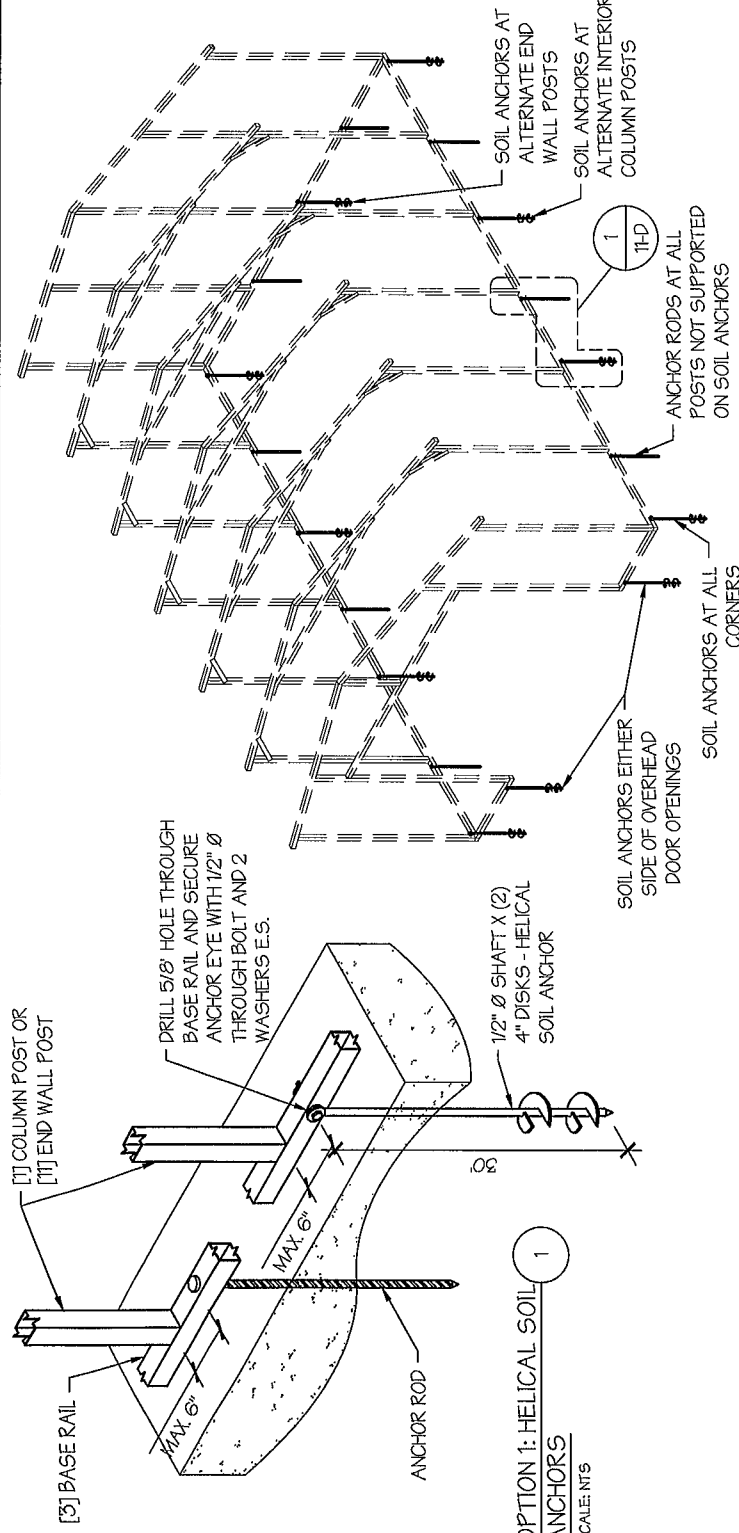

☐ OPTION 1: HELICAL SOIL ANCHORS
SCALE: NTS

SOIL FOUNDATION NOTES:


- DESIGNS SHOWN ON THIS SHEET ARE FOR SOIL ANCHOR FOUNDATION.
- SOIL ANCHORS (HELICAL OR ROCK/ASPHALT) SHALL BE LOCATED AT ALL 4 CORNERS, ON EACH SIDE OF OVERHEAD DOOR OPENINGS, ON POSTS WITH DIAGONAL BRACING IF REQUIRED, AND ON ALTERNATE INTERIOR COLUMN POSTS AND END WALLS POSTS
- HELICAL ANCHORS ARE TO BE USED ONLY IF THE DRIVING TORQUE INTO THE GROUND IS 150 FT-LBS OR GREATER. MANUFACTURER IS NOT RESPONSIBLE FOR SOIL QUALITY AT SITE.
- HELICAL ANCHORS CAN ONLY BE USED FOR CLASS 2, 3 & 4 SOILS (SEE SOIL CLASSIFICATIONS THIS PAGE)
- ALL POSTS WITH NO ANCHORS ADJACENT SHALL BE ANCHORED TO THE GROUND WITH A 1/2 X 30" LG. ROD. RODS WILL HAVE A PRE-FORMED HEAD AT THE TOP AND ONE COAT OF RUST PROOF MATERIAL.
- ASSUMED SOIL BEARING CAPACITY IS TO BE A MIN. OF 1500 PSF

SOIL CLASSIFICATIONS:

SOIL CLASS	DESCRIPTION
2	SANDY GRAVEL AND GRAVEL, VERY THIN DENSE AND/OR CEMENTED SANDS, COARSE GRAVEL/COBBLES, PRELOADED SILTS, CLAYS AND CORAL.
3	SAND, SILTY SAND, CLAYEY SAND, SILTY GRAVEL, MEDIUM DENSE COARSE SANDS, SANDY GRAVEL, VERY STIFF SILT AND SANDY CLAYS
4	LOOSE TO MEDIUM DENSE SANDS, FIRM TO STIFF CLAYS AND SILTS AND ALLUVIAL FILLS

*FROM HUD "MODEL MANUFACTURED HOME INSTALLATION STANDARDS"

SOIL FOUNDATION SCALE: NTS

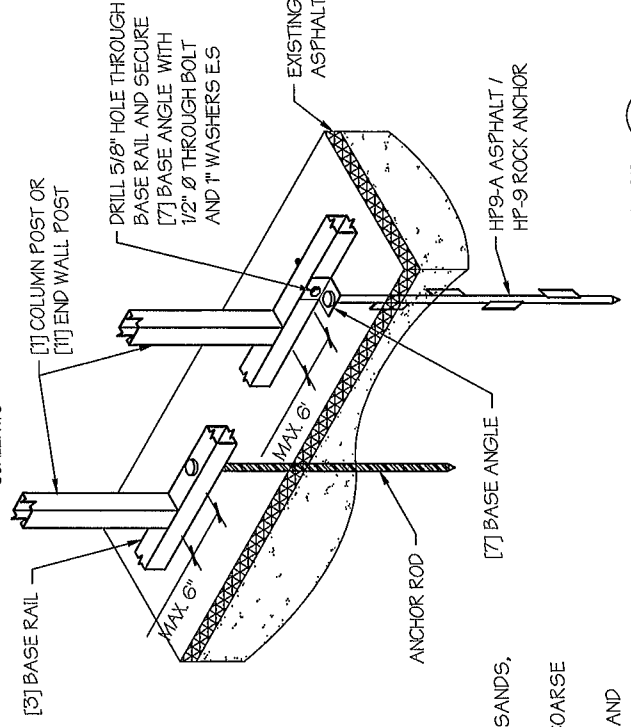

☐ OPTION 2: ROCK / ASPHALT ANCHORS
SCALE: NTS

1