


W.B. Four  
9/25/07  
P.E. 56031


EQUESTRIAN MANAGERS  
RESIDENCE

161 NW MADISON STREET  
SUITE 102  
LAKE CITY, FL 32055  
(386) 758-4209  
CERTIFICATE OF AUTHORIZATION # 00080701



Freeman  
Design Group, Inc.

DATE	DRAWN BY
9/25/07	J.T.D.
	APPROVED
	W.H.F.
REVISIONS	
SHEET	A-1
OF	6
PROJECT NO.	
07.C040	

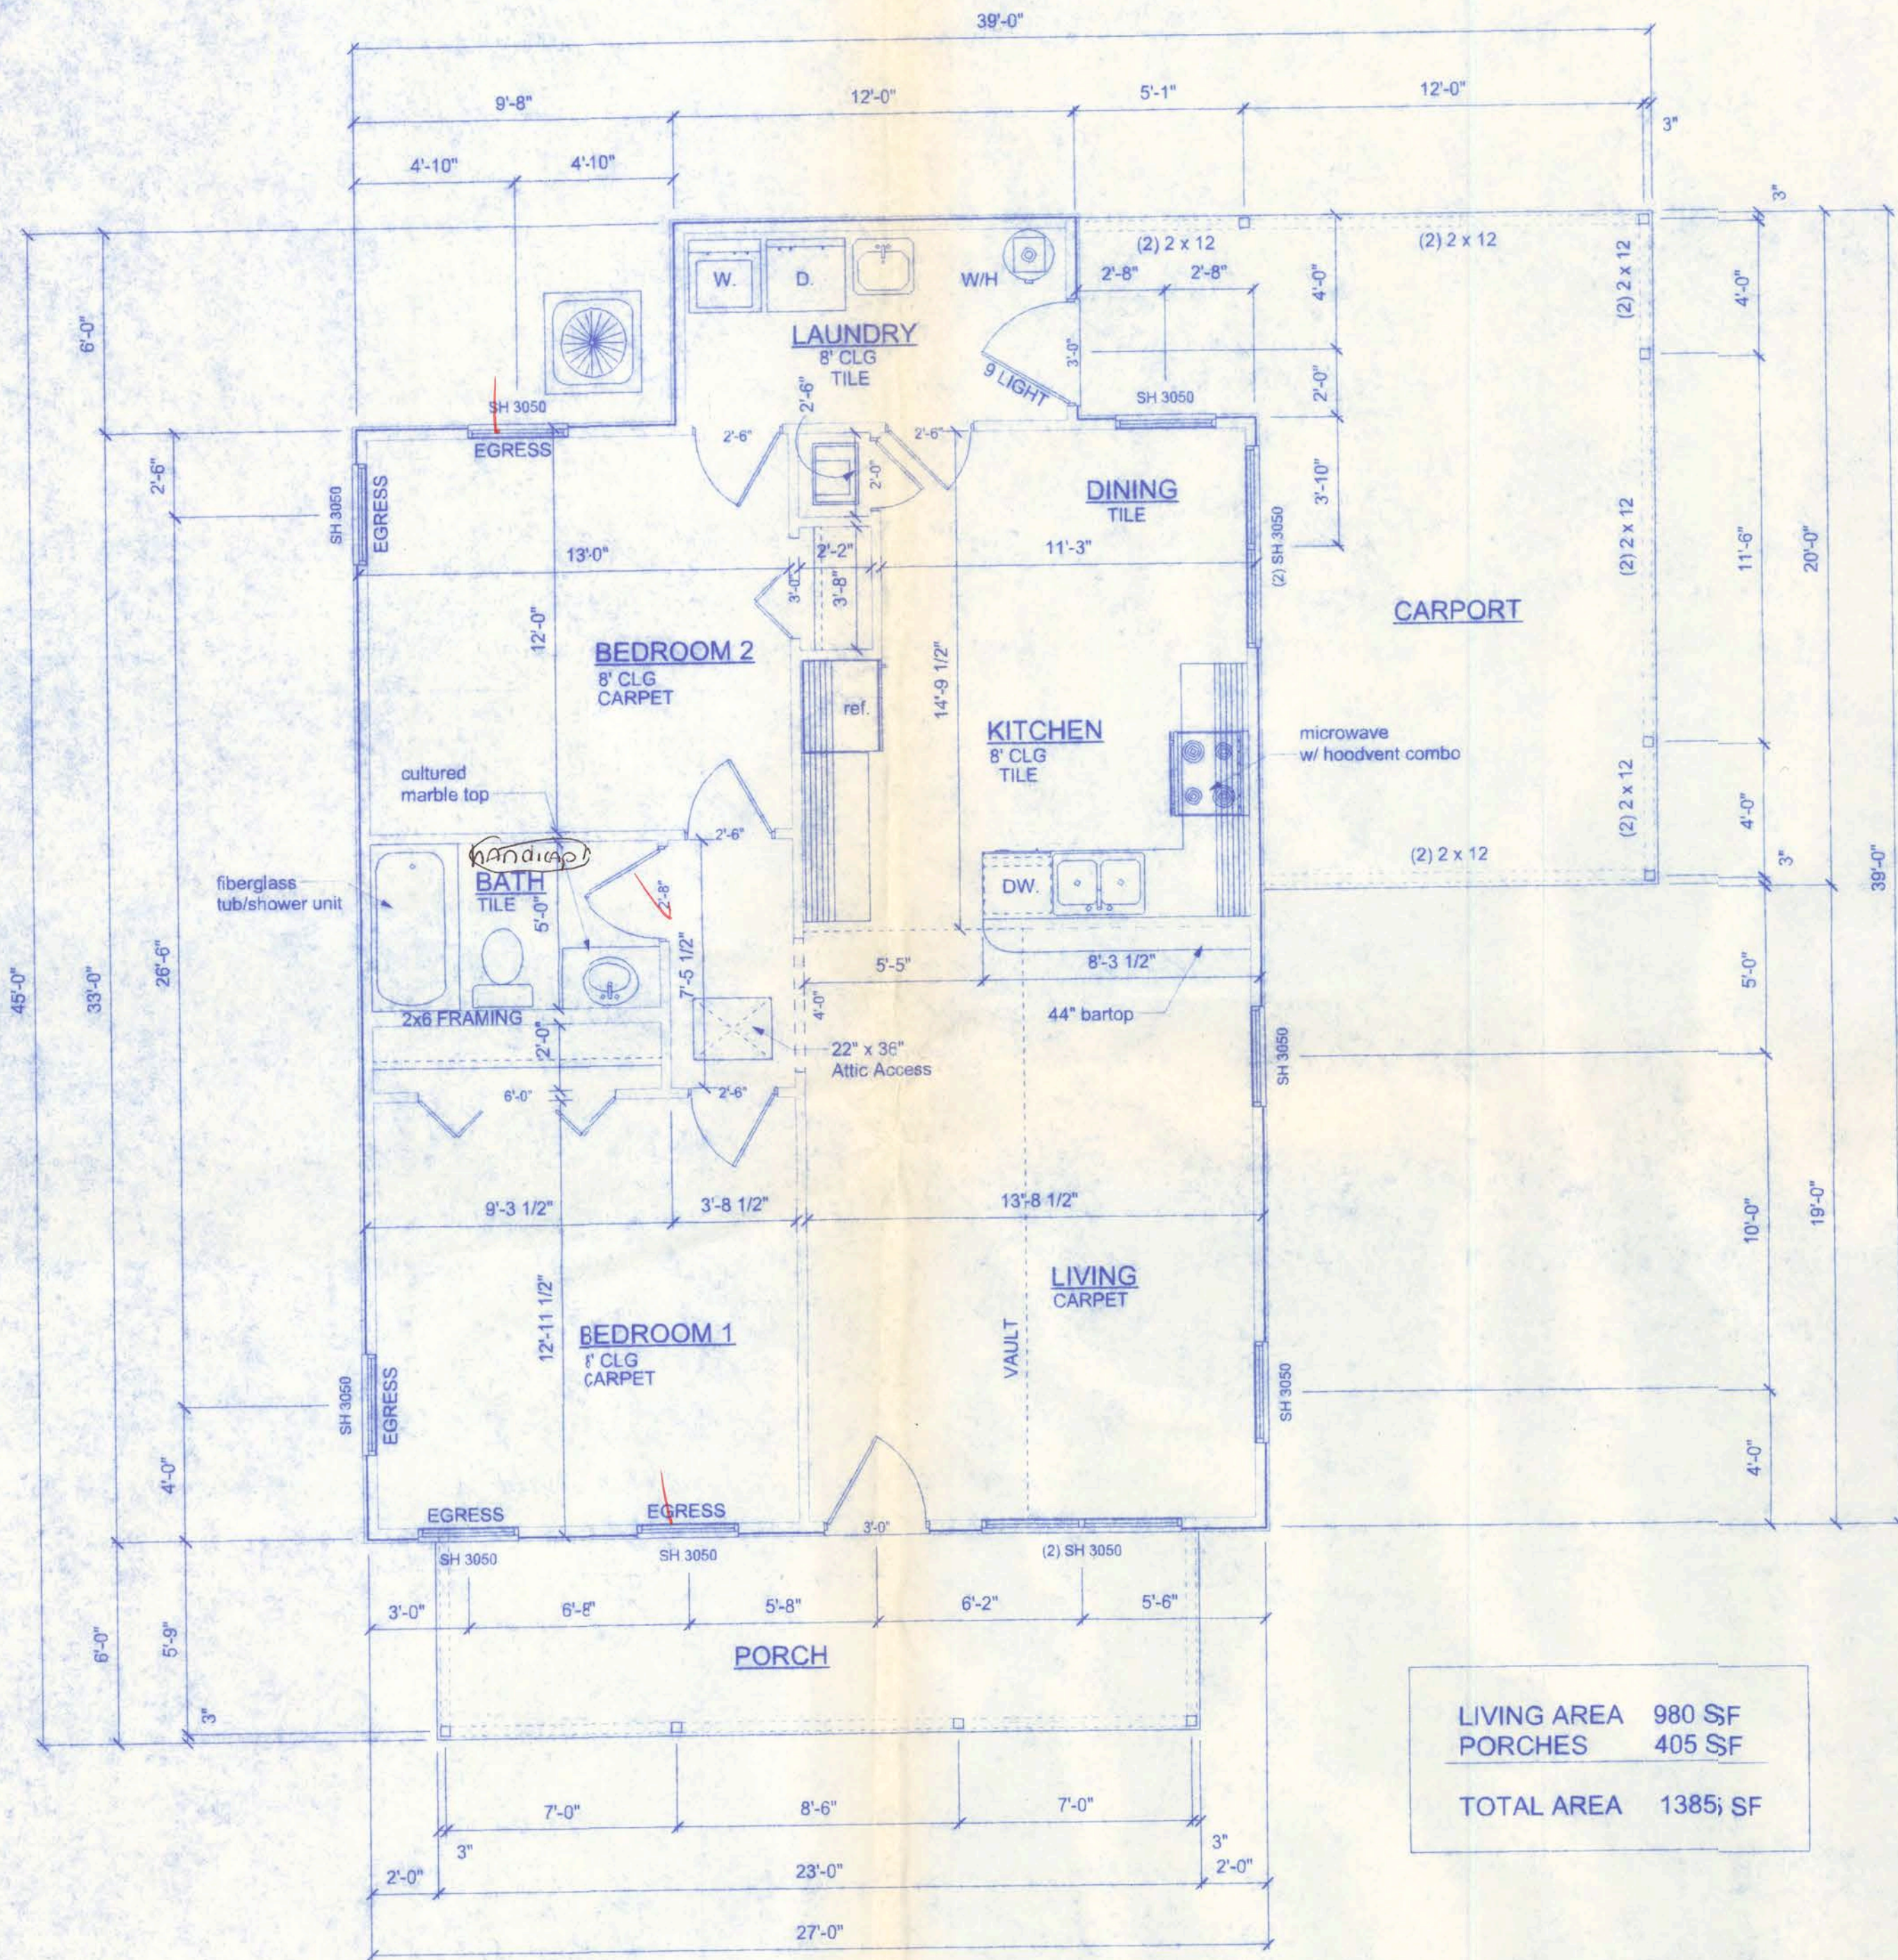


FLOOR PLAN  
SCALE: 1/4" = 1'-0"

PRODUCT CODE	SIZE	COUNT
36X80 BIFOLD COLONIAL	3'-0"	1
72X80 BIFOLD COLONIAL	6'-0"	1
2068	2'-0"	1
2668	2'-6"	4
2868	2'-8"	1
3068	3'-0"	2
(2) SH 3050	6'-0" x 5'-0"	2
SH 3050	3'-0" x 5'-0"	8

NOTE:  
ALL INTERIOR DOORS  
6 PANEL MASONITE

NOTE:  
ALL WIND LOADS ARE IN ACCORDANCE WITH SECTION  
1609, FLORIDA BUILDING CODE, 2004 EDITION W/ 2006 REVISIONS.

BASIC WIND SPEED	110 MPH
IMPORTANCE FACTOR	1.0
BUILDING CATEGORY	2
EXPOSURE	B
INTERNAL PRESSURE COEFFICIENT	+/- 0.18
COMPONENT AND CLADDING PRESSURE	WALLS +21.8/-29.1 PSF
	ROOF +12.5/-29.1 PSF
	OVERHANGS -71.6 PSF
TYPE OF STRUCTURE	ENCLOSED
ROOF DEAD LOAD	10 psf
ROOF LIVE LOAD	20 psf
FLOOR DEAD LOAD	20 psf
FLOOR LIVE LOAD	40 psf

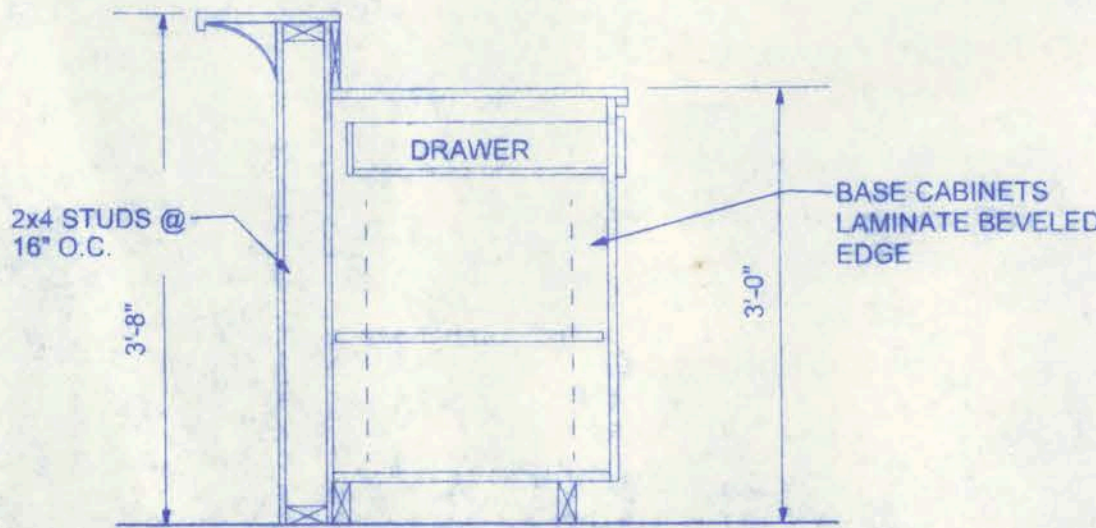

CABINET SECTION  
SCALE: 3/4" = 1'-0"

GENERAL NOTES:

- THE CONTRACTOR SHALL INDEMNIFY THE OWNER AGAINST ALL CLAIMS, WHETHER FROM PERSONAL INJURY OR PROPERTY DAMAGE, ARISING FROM EVENTS ASSOCIATED WITH THE WORK PERFORMED UNDER THE CONTRACT FOR THIS PROJECT.
- THE CONTRACTOR AND/OR SUB-CONTRACTORS SHALL WARRANT ALL WORK FOR A PERIOD OF ONE YEAR FOLLOWING THE WORK DATE OF FINAL COMPLETION AND ACCEPTANCE BY THE OWNER. DEFECTS IN MATERIALS, EQUIPMENT, COMPONENTS AND WORKMANSHIP SHALL BE CORRECTED AT NO FURTHER COST TO THE OWNER DURING THE ONE YEAR WARRANTY PERIOD.
- AT THE OWNER'S OPTION, A WARRANTY INSPECTION SHALL BE PERFORMED DURING THE ELEVENTH MONTH FOLLOWING THE COMMENCEMENT OF THE WARRANTY PERIOD. FOR THE PURPOSE OF DETERMINING ANY WARRANTY WORK THAT MAY BE REQUIRED, THE CONTRACTOR SHALL BE PRESENT DURING THIS INSPECTION IF REQUESTED BY THE OWNER.
- THE CONTRACTOR SHALL PAY FOR ALL PERMITS, LICENSES, TESTS AND THE LIKE THAT MAY BE REQUIRED BY THE VARIOUS AUTHORITIES HAVING JURISDICTION OVER THIS PROJECT BE THEY CITY, COUNTY, STATE OR FEDERAL.
- THE OWNER SHALL FILE A "NOTICE OF COMMENCEMENT" PRIOR TO THE BEGINNING OF THE PROJECT AND THE CONTRACTOR(S) SHALL FILE "NOTICE TO OWNER" AND PROVIDE "RELEASE OF LIEN" FOR ALL PAYMENT REQUESTS PRIOR TO DISBURSEMENT OF ANY FUNDS.
- ANY AND ALL DISPUTES ARISING FROM EVENTS ASSOCIATED WITH THE CONSTRUCTION OF THIS PROJECT BETWEEN THE OWNER, CONTRACTOR(S) AND SUPPLIERS SHALL BE RESOLVED THROUGH BINDING ARBITRATION.
- ALL WORK SHALL BE IN ACCORDANCE WITH APPLICABLE CODES AND LOCAL REGULATIONS INCLUDING APPLICABLE ENERGY CODES. ALL COMPONENTS OF THE BUILDING SHALL MEET WITH THE MINIMUM ENERGY REQUIREMENTS OF THE BUILDING CODE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT IN WRITING PRIOR TO THE COMMENCEMENT OF THE WORK.
- ALL INSULATION SHALL BE LEFT EXPOSED AND ALL LABELS LEFT INTACT ON THE WINDOWS AND DOORS UNTIL INSPECTED BY THE BUILDING OFFICIAL.
- ALL WOOD IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED.

NOTE:  
EXTERIOR WINDOWS AND GLASS DOORS SHALL BE TESTED BY AN APPROVED INDEPENDENT TESTING LABORATORY, AND BEAR AN AAMA OR WDMA OR OTHER APPROVED LABEL IDENTIFYING THE MANUFACTURER, PERFORMANCE CHARACTERISTICS AND APPROVED PRODUCT EVALUATION ENTITY TO INDICATE COMPLIANCE WITH THE REQUIREMENTS OF THE FOLLOWING SPECIFICATION:

ANSI/AAMA/NWMA 101/152 2/97

THE CONSTRUCTION SHALL BE TESTED IN ACCORDANCE WITH ASTM E 330, STANDARD TEST METHODS FOR STRUCTURAL PERFORMANCE OF EXTERIOR WINDOWS, CURTAIN WALLS, AND DOORS BY UNIFORM STATIC AIR PRESSURE.



W.H.F. / J.T.D.  
9/25/07  
P.E. 56001


EQUESTRIAN MANAGER'S  
RESIDENCE

161 NW MADISON STREET  
SUITE 102  
LAKE CITY, FL 32055  
(386) 758-4209



DATE	9/25/07	DRAWN BY	J.T.D.
		APPROVED	W.H.F.
REVISIONS			
SHEET	A-2		
OF	6		
PROJECT NO.			
07.C040			

NOTE:  
THE RIDGE HEIGHT IS GIVEN FOR MEAN ROOF  
HEIGHT DETERMINATION ONLY. DO NOT USE  
THIS DIMENSION FOR ROOF CONSTRUCTION.

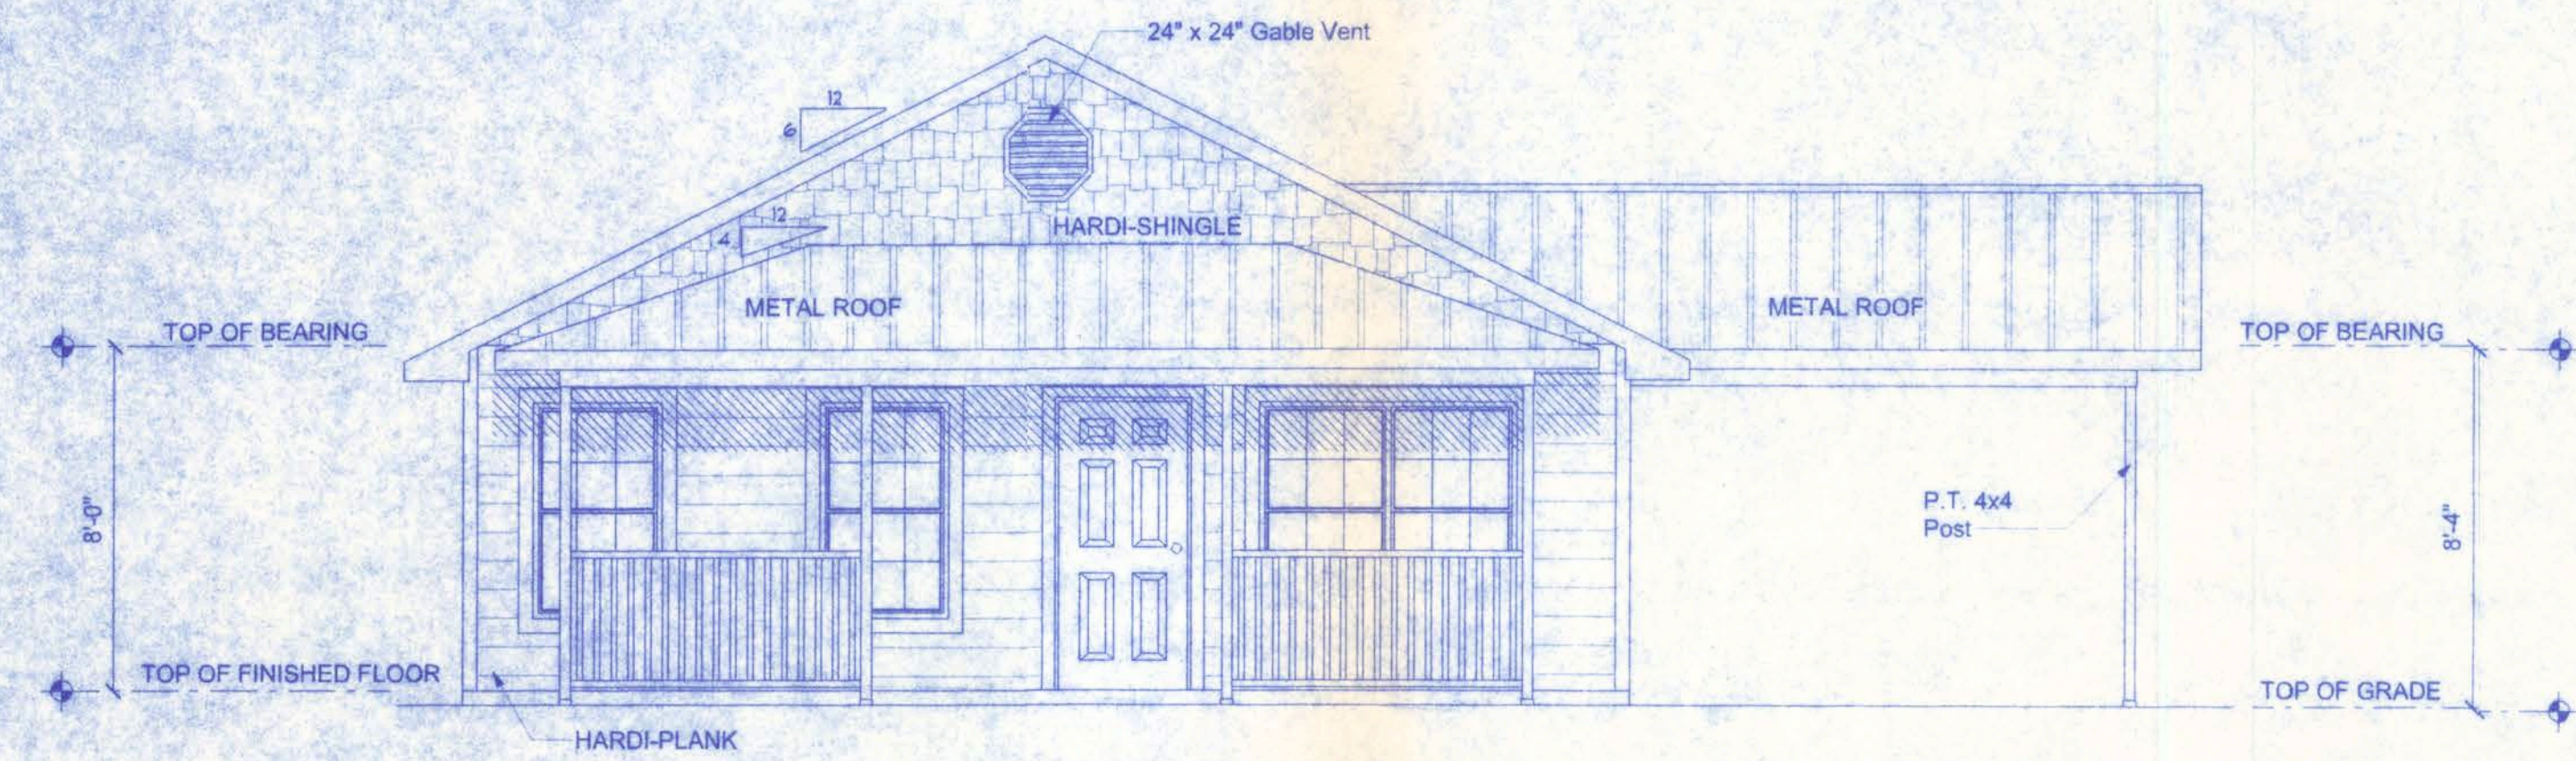


**FRONT ELEVATION**  
SCALE: 1/4" = 1'-0"


**CONSTRUCTION DOCUMENTS:**  
THE CUSTOMER IS RESPONSIBLE FOR DELIVERING THE REQUIRED SETS OF  
CONSTRUCTION DOCUMENTS TO THE PERMIT ISSUING AUTHORITY FOR THE  
ISSUANCE OF CONSTRUCTION PERMITS. THE CONTRACTOR IS SOLELY  
RESPONSIBLE FOR REVIEWING THE PLANS AND VERIFYING ALL EXISTING  
CONDITIONS, ELEVATIONS, AND DIMENSIONS PRIOR TO COMMENCING  
CONSTRUCTION INCLUDING FABRICATION. ALL DISCREPANCIES SHALL  
BE REPORTED TO THE ARCHITECT/ENGINEER FOR RESOLUTION.

**DO NOT SCALE THESE PLANS:**  
AMPLE DIMENSIONS ARE SHOWN ON THE PLANS TO LOCATE ALL ITEMS.  
SIMPLE ARITHMETIC MAY BE USED TO DETERMINE THE LOCATION OF THOSE  
ITEMS NOT DIMENSIONED.


**CHANGES TO PLAN SETS:**  
PLEASE DO NOT MAKE ANY STRUCTURAL CHANGES TO THESE PLANS WITHOUT  
CONSULTING WITH THE ARCHITECT/ENGINEER. THE OWNER SHALL ASSUME ANY  
AND ALL LIABILITY FOR STRUCTURAL DAMAGE RESULTING FROM CHANGES MADE  
TO THE PLANS OR BY SUBSTITUTION OF MATERIALS DIFFERENT FROM  
SPECIFICATIONS ON THE PLANS.

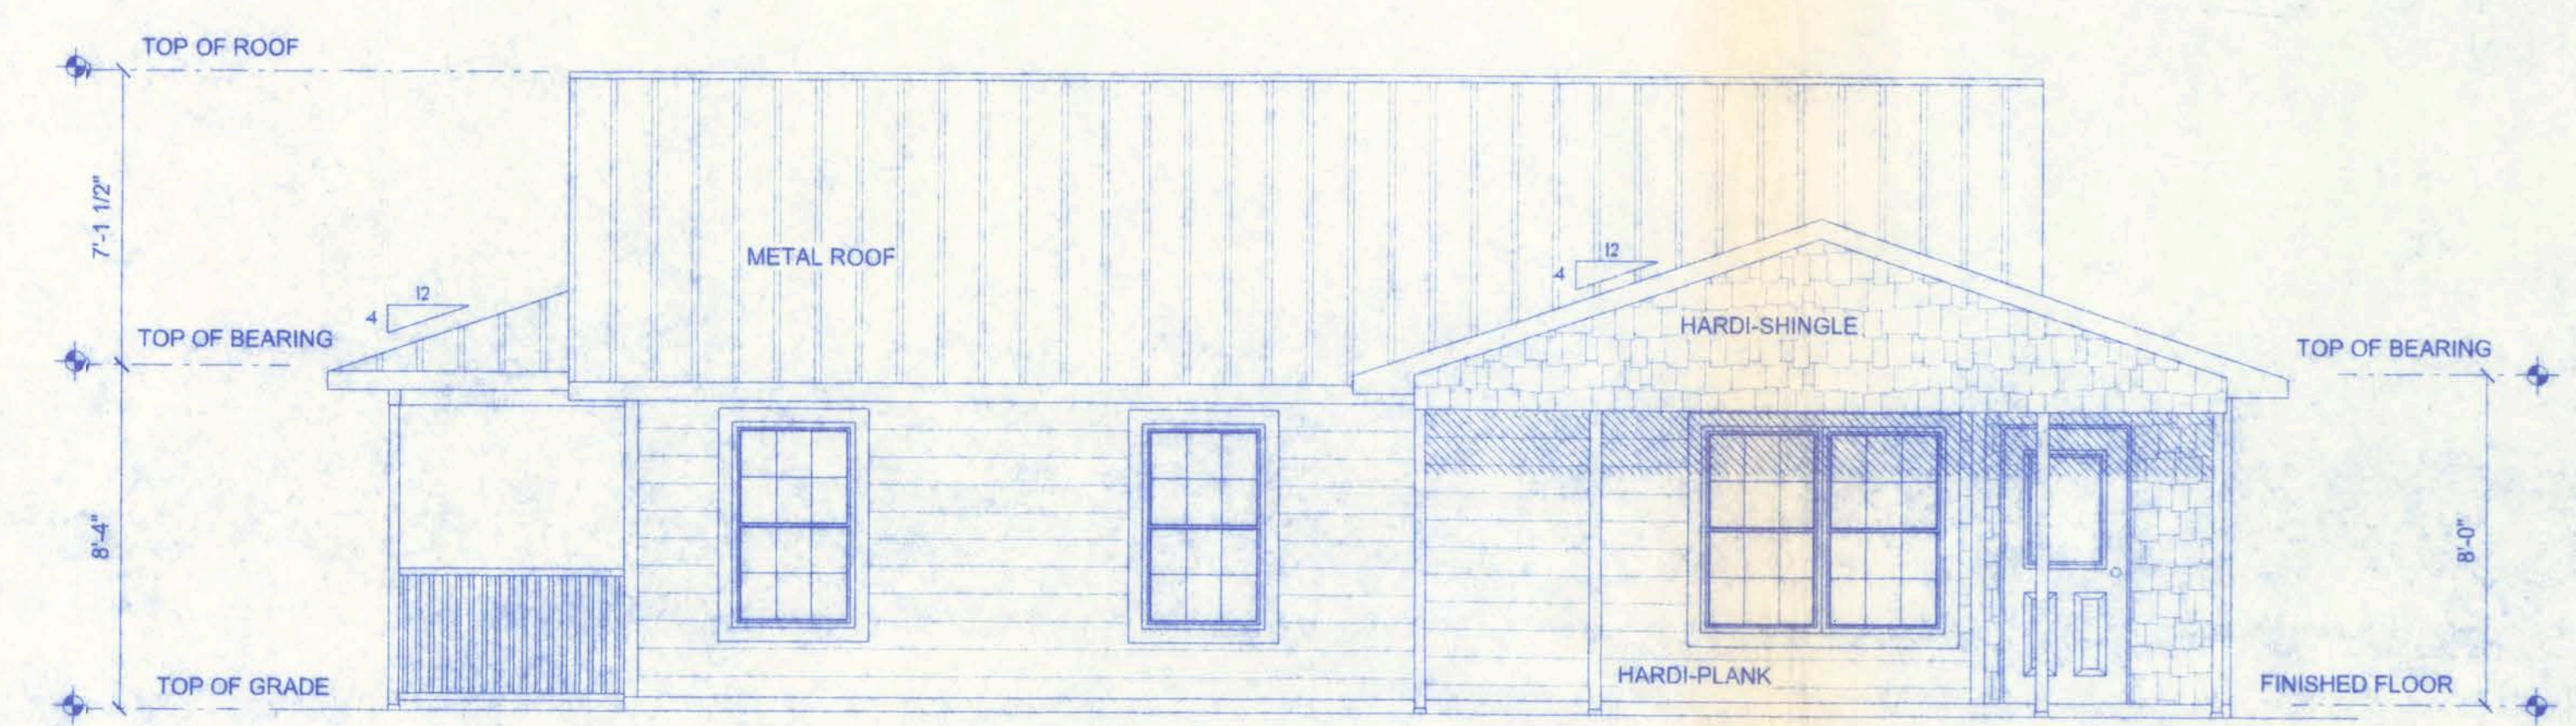

**RIGHT ELEVATION**  
SCALE: 1/4" = 1'-0"

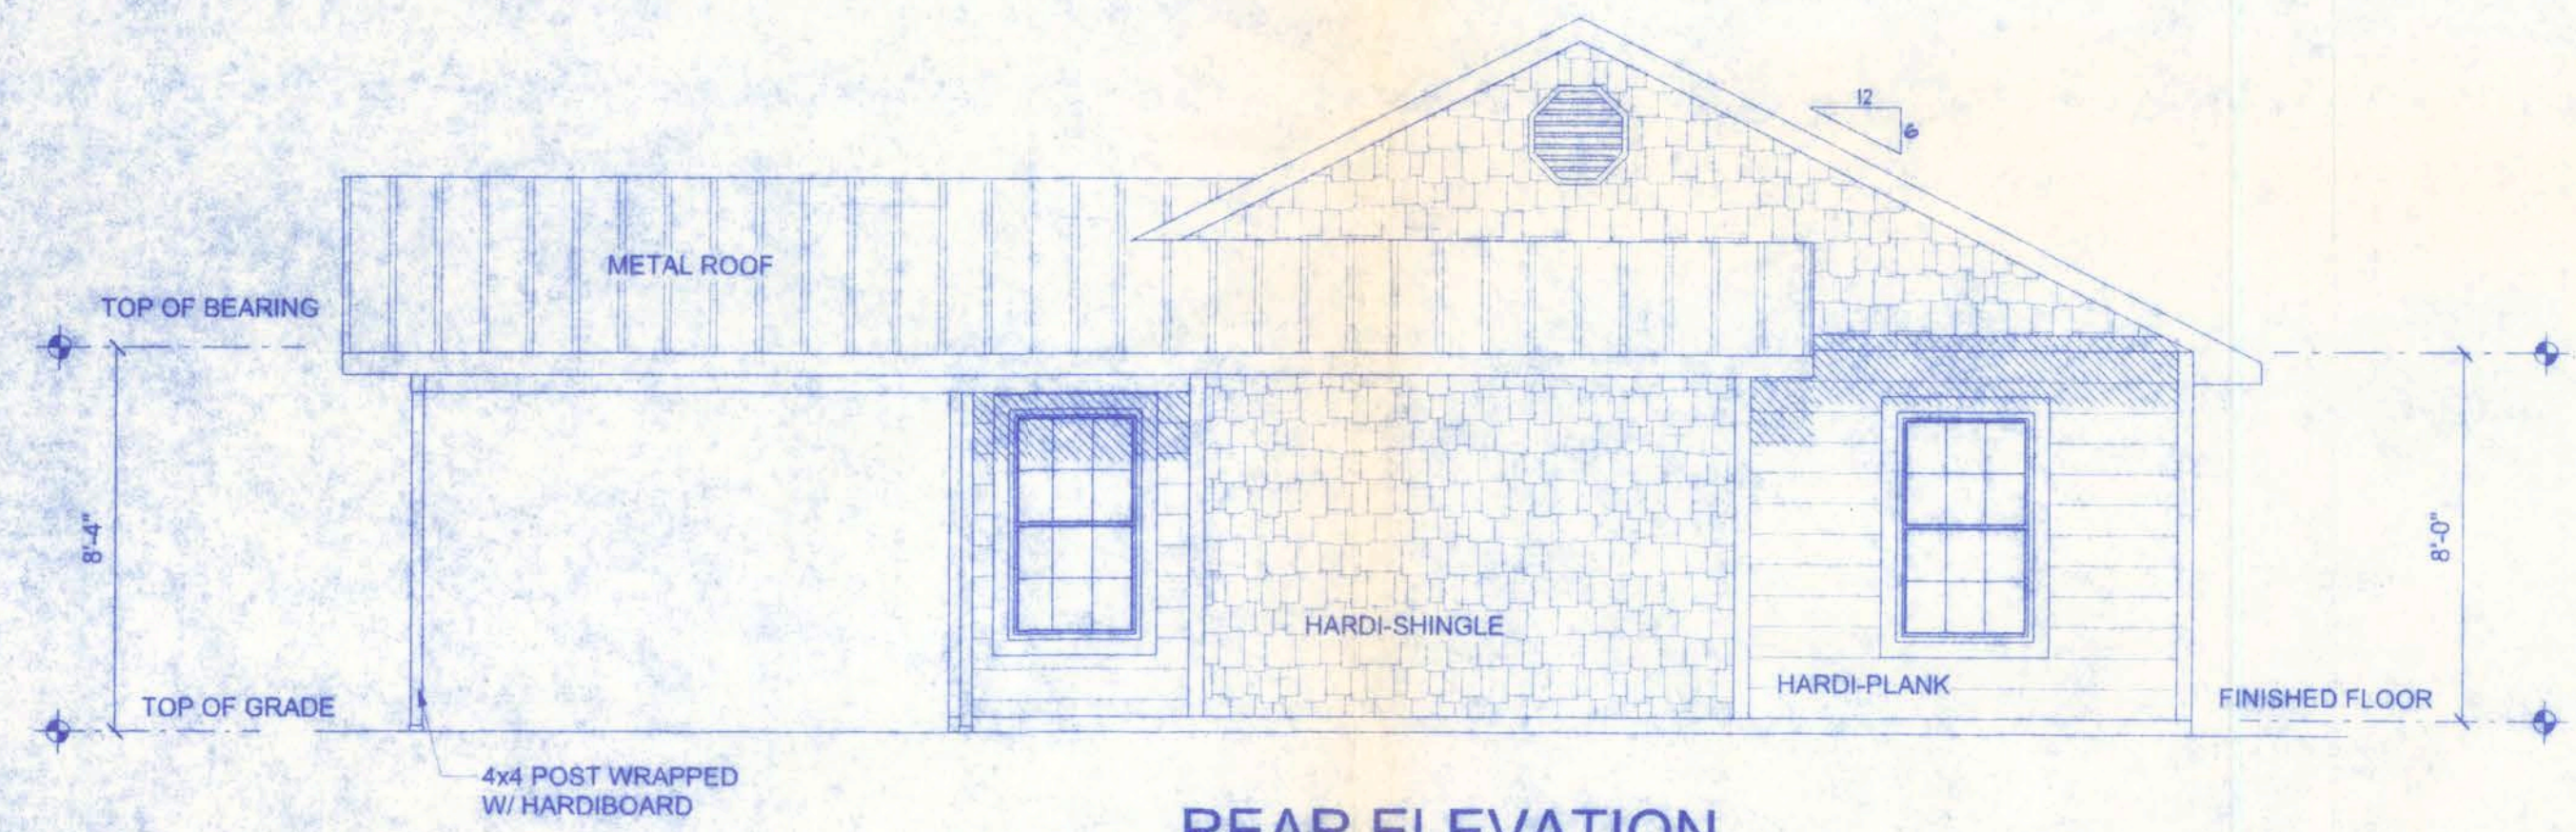


**REAR ELEVATION**  
SCALE: 1/4" = 1'-0"

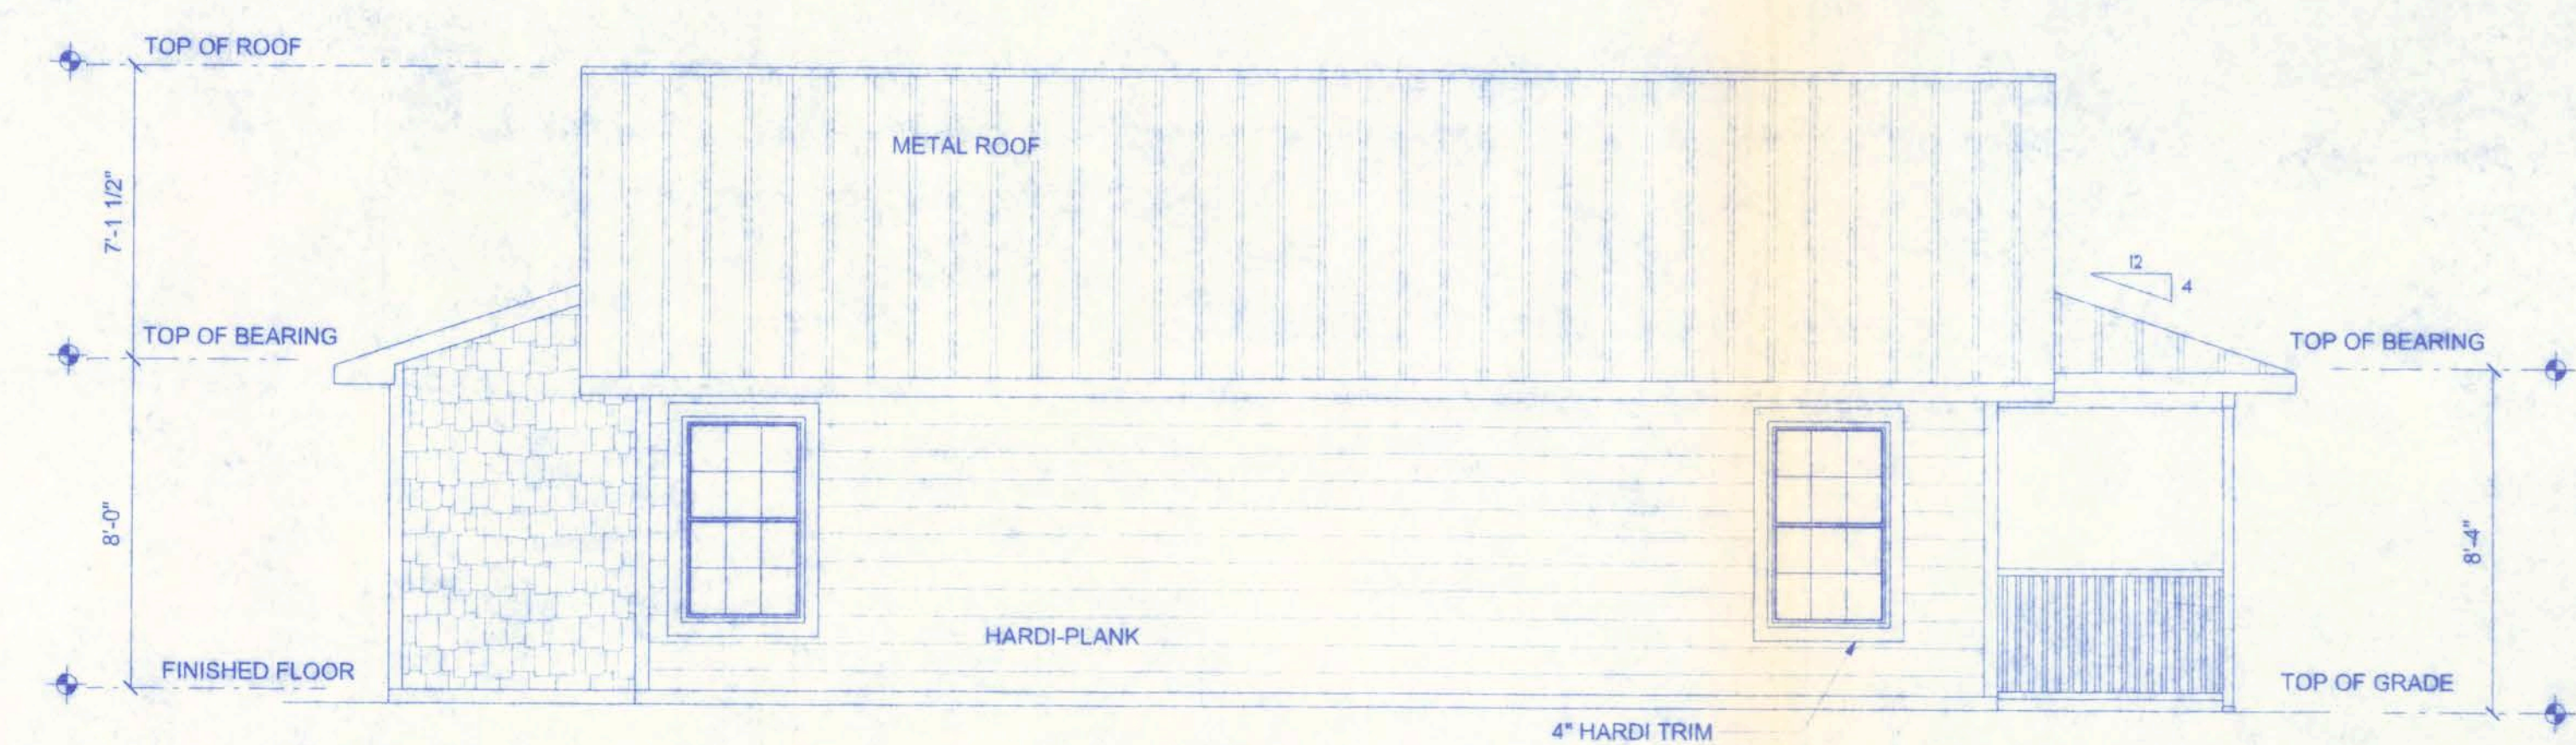

**LEFT ELEVATION**  
SCALE: 1/4" = 1'-0"



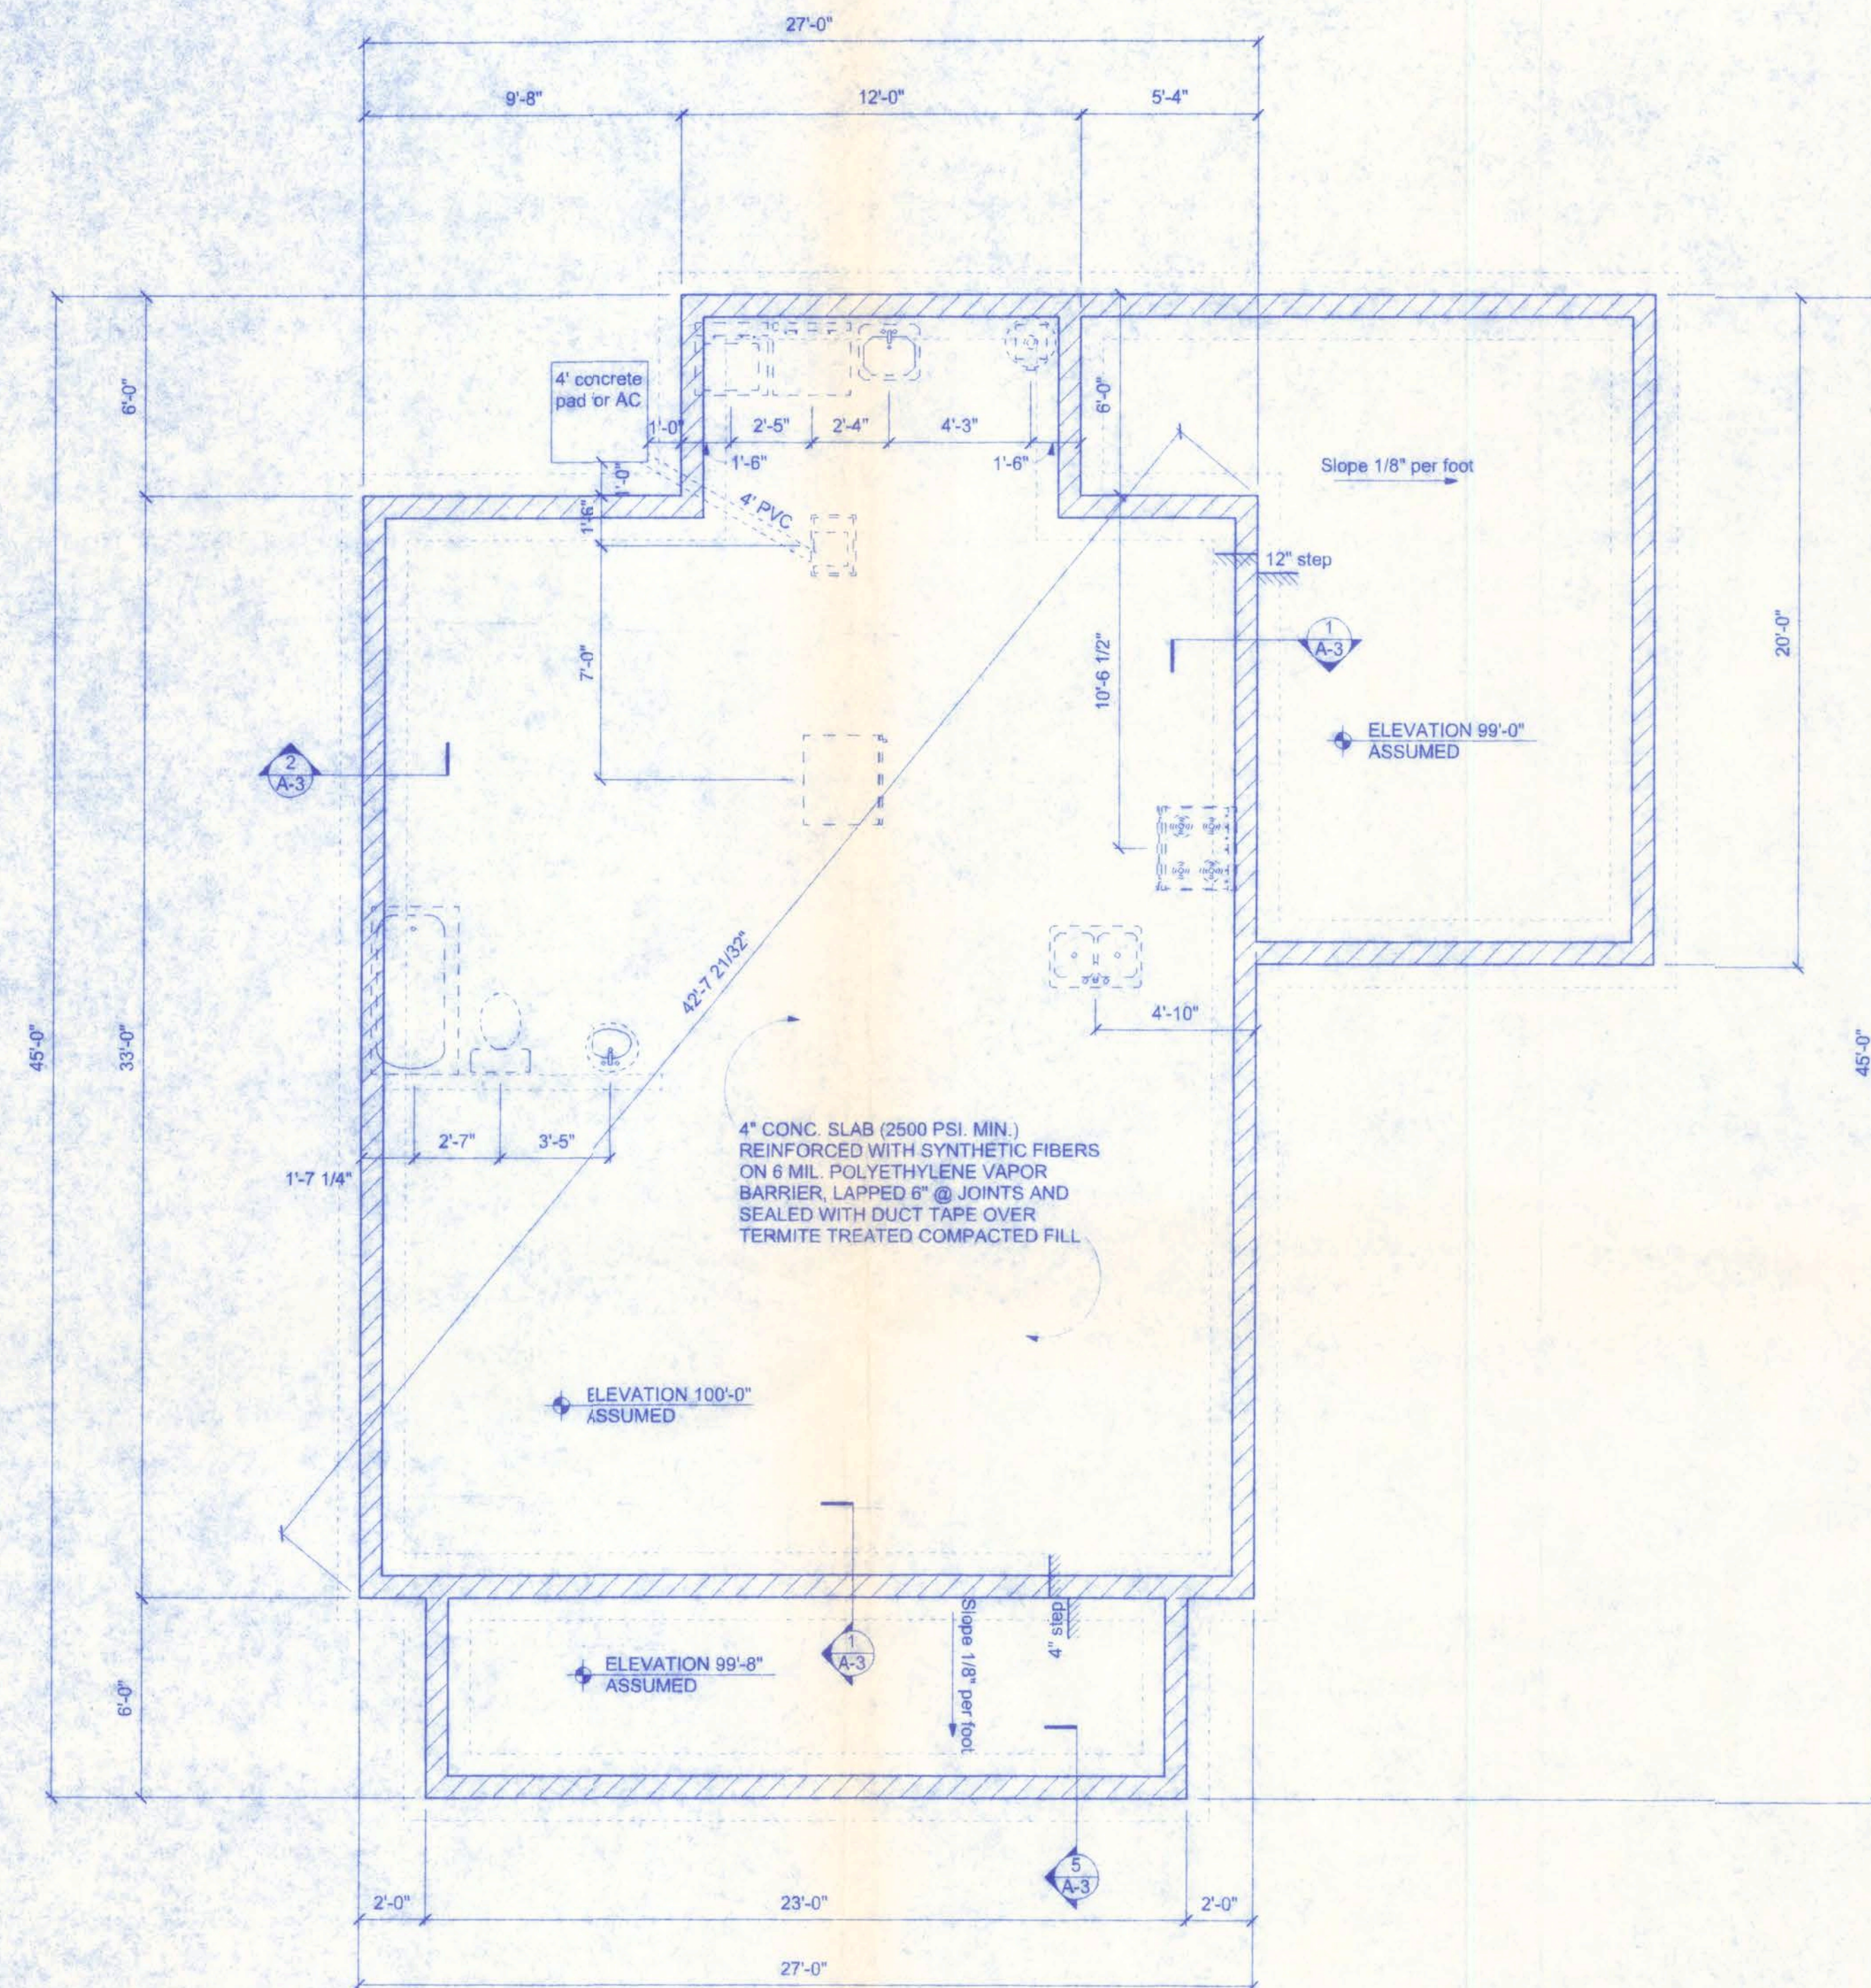

**FOUNDATION PLAN**  
SCALE: 1/4" = 1'-0"

#### FOUNDATION NOTES

COVER OVER REINFORCING STEEL  
FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE:  
3 INCHES IN FOUNDATIONS WHERE THE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH THE EARTH OR EXPOSED TO THE EARTH OR WEATHER AND 1 1/2 INCHES ELSEWHERE. REINFORCING BARS EMBEDDED IN GROUTED CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1/4 INCH FOR FINE GROUT OR 1/2 INCH FOR COARSE GROUT BETWEEN REINFORCING BARS AND ANY FACE OF A CELL. REINFORCING BARS USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN 2 INCHES FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER 1 1/2 INCHES FOR MASONRY UNITS NOT EXPOSED TO EARTH OR WEATHER

CONCRETE:  
CONCRETE SHALL HAVE A MINIMUM SPECIFIED COMPRESSIVE STRENGTH OF 2500 PSI AT 28 DAYS.

GALVANIZATION:  
METAL ACCESSORIES FOR USE IN EXTERIOR WALL CONSTRUCTION AND NOT DIRECTLY EXPOSED TO THE WEATHER SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A 153, CLASS B-2. METAL PLATE CONNECTORS, SCREWS, BOLTS AND NAILS EXPOSED DIRECTLY TO THE WEATHER SHALL BE STAINLESS STEEL OR HOT DIPPED GALVANIZED.






REINFORCING STEEL:  
THE REINFORCING STEEL SHALL BE MINIMUM GRADE 40.

#### SLAB REQUIREMENTS

JOINTS ARE NOT REQUIRED IN UNREINFORCED PLAIN CONCRETE SLABS ON GROUND OR IN SLABS FOR ONE AND TWO FAMILY DWELLINGS COMPLYING WITH ONE OF THE FOLLOWING:

1. CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTHS SHALL BE 1/2 INCH TO 2 INCHES IN LENGTH. DOSAGE AMOUNTS SHALL BE FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. SYNTHETIC FIBERS SHALL COMPLY WITH ASTM C 1116. THE MANUFACTURER OR SUPPLIER SHALL PROVIDE CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY THE BUILDING OFFICIAL. OR, CONCRETE SLABS ON GROUND CONTAINING 6x6 W1.4 x W1.4 WELDED WIRE REINFORCEMENT FABRIC LOCATED IN THE MIDDLE TO THE UPPER 1/3 OF THE SLAB. WELDED WIRE REINFORCEMENT FABRIC SHALL BE SUPPORTED WITH APPROVED MATERIAL OR SUPPORTS AT SPACING NOT TO EXCEED 3 FT OR IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATION. WELDED PLAIN WIRE REINFORCEMENT FABRIC FOR CONCRETE SHALL CONFORM TO ASTM A 185, STANDARD SPECIFICATION FOR STEEL WELDED WIRE REINFORCEMENT FABRIC, PLAIN, FOR CONCRETE REINFORCEMENT.
- 2.

BEARING CAPACITY:  
THE FOOTING IS DESIGNED FOR SOIL WITH AN ALLOWABLE BEARING CAPACITY OF 1,000 PSF. THE FOOTINGS SHALL REST ON UNDISTURBED OR COMPACTED SOIL OF UNIFORM DENSITY AND THICKNESS. AT THE OWNER'S REQUEST, COMPACTED SOILS SHALL BE TESTED TO A MINIMUM OF 95% OF MODIFIED PROCTOR AND COMPACTED IN LIFTS NOT TO EXCEED 12 INCHES.

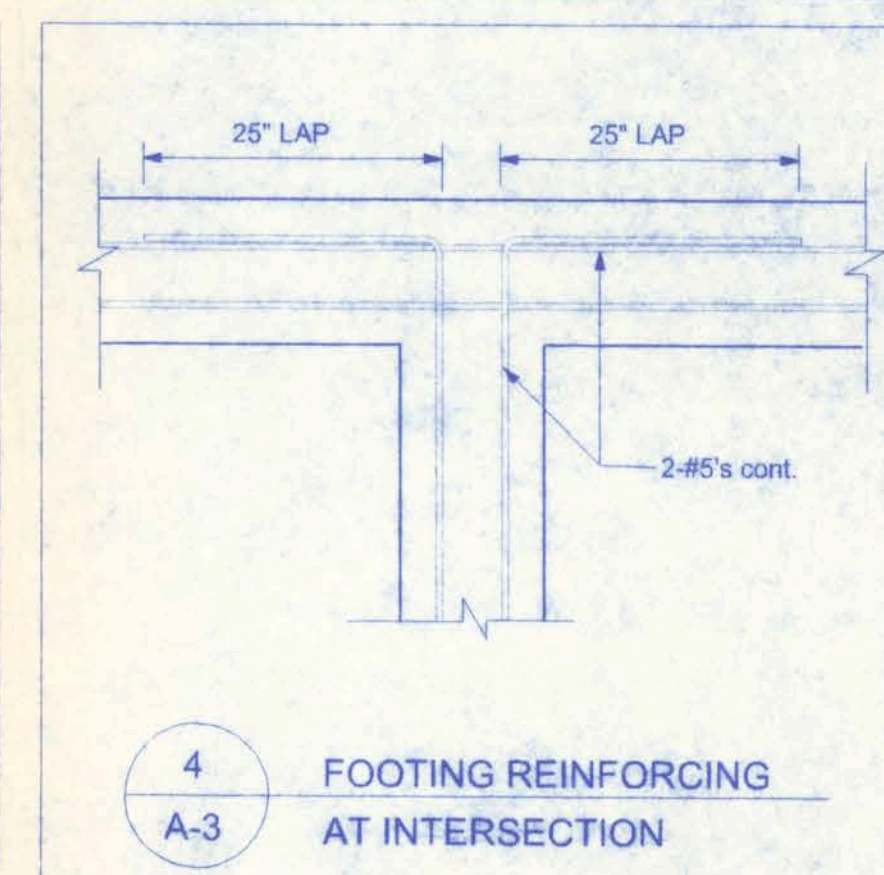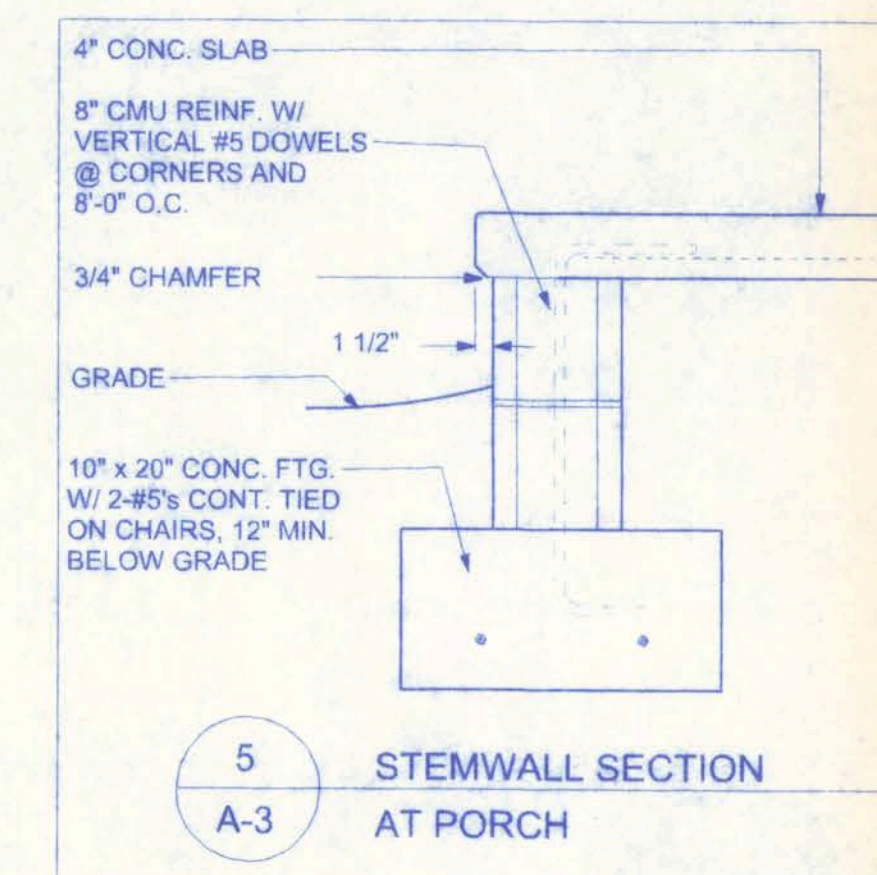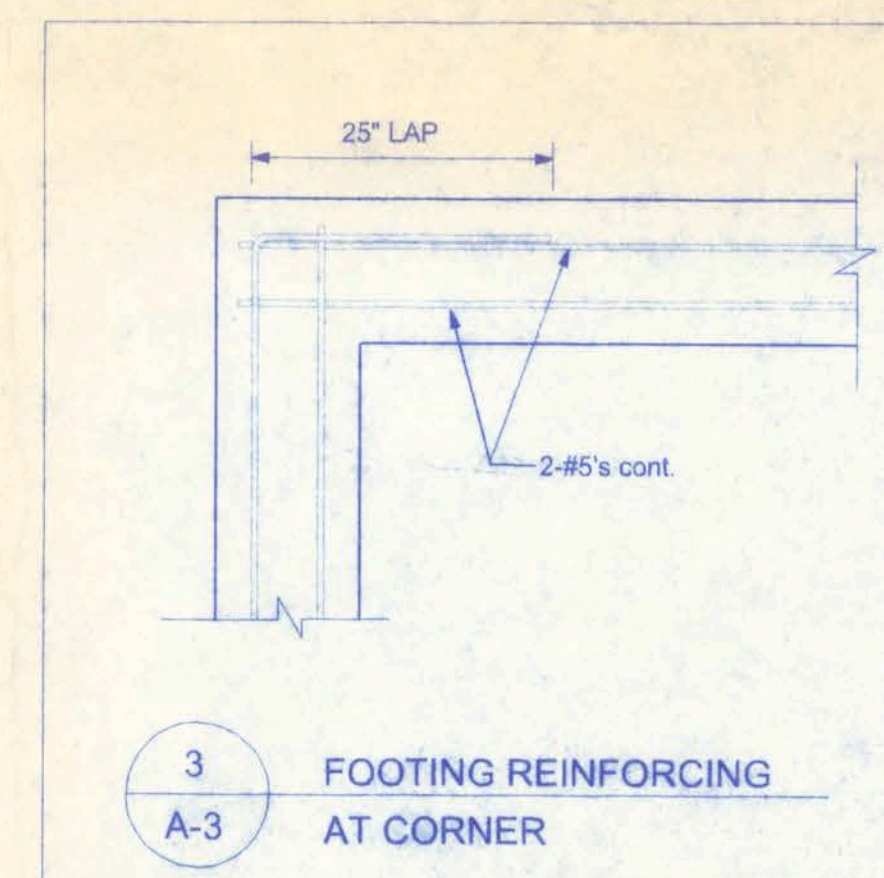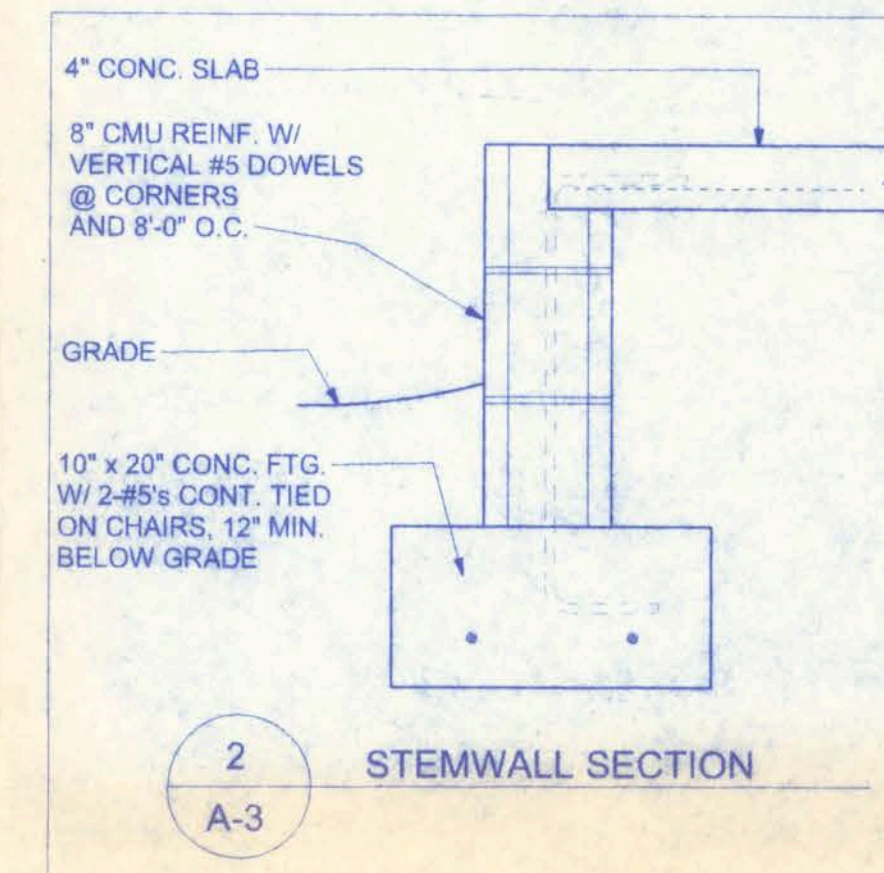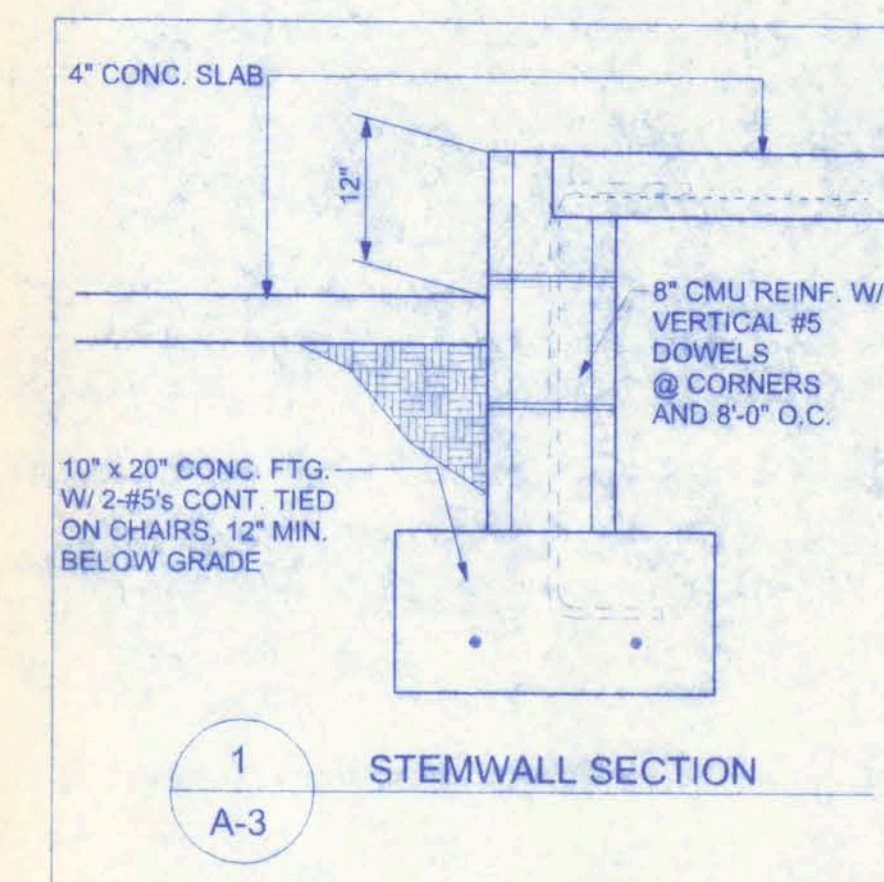

William H. Free  
9/2/07  
P.E. 56001

### EQUESTRIAN MANAGER'S RESIDENCE

161 NW MADISON STREET  
SUITE 102  
LAKE CITY, FL 32055  
(386) 758-4209  
CERTIFICATE OF AUTHORIZATION # 00008701


**Freeman**  
Design Group Inc.

DATE  
9/2/07  
DRAWN BY  
J.T.D.  
APPROVED  
W.H.F.

REVISIONS  
SHEET A-3

OF 6  
PROJECT NO.  
07.C040




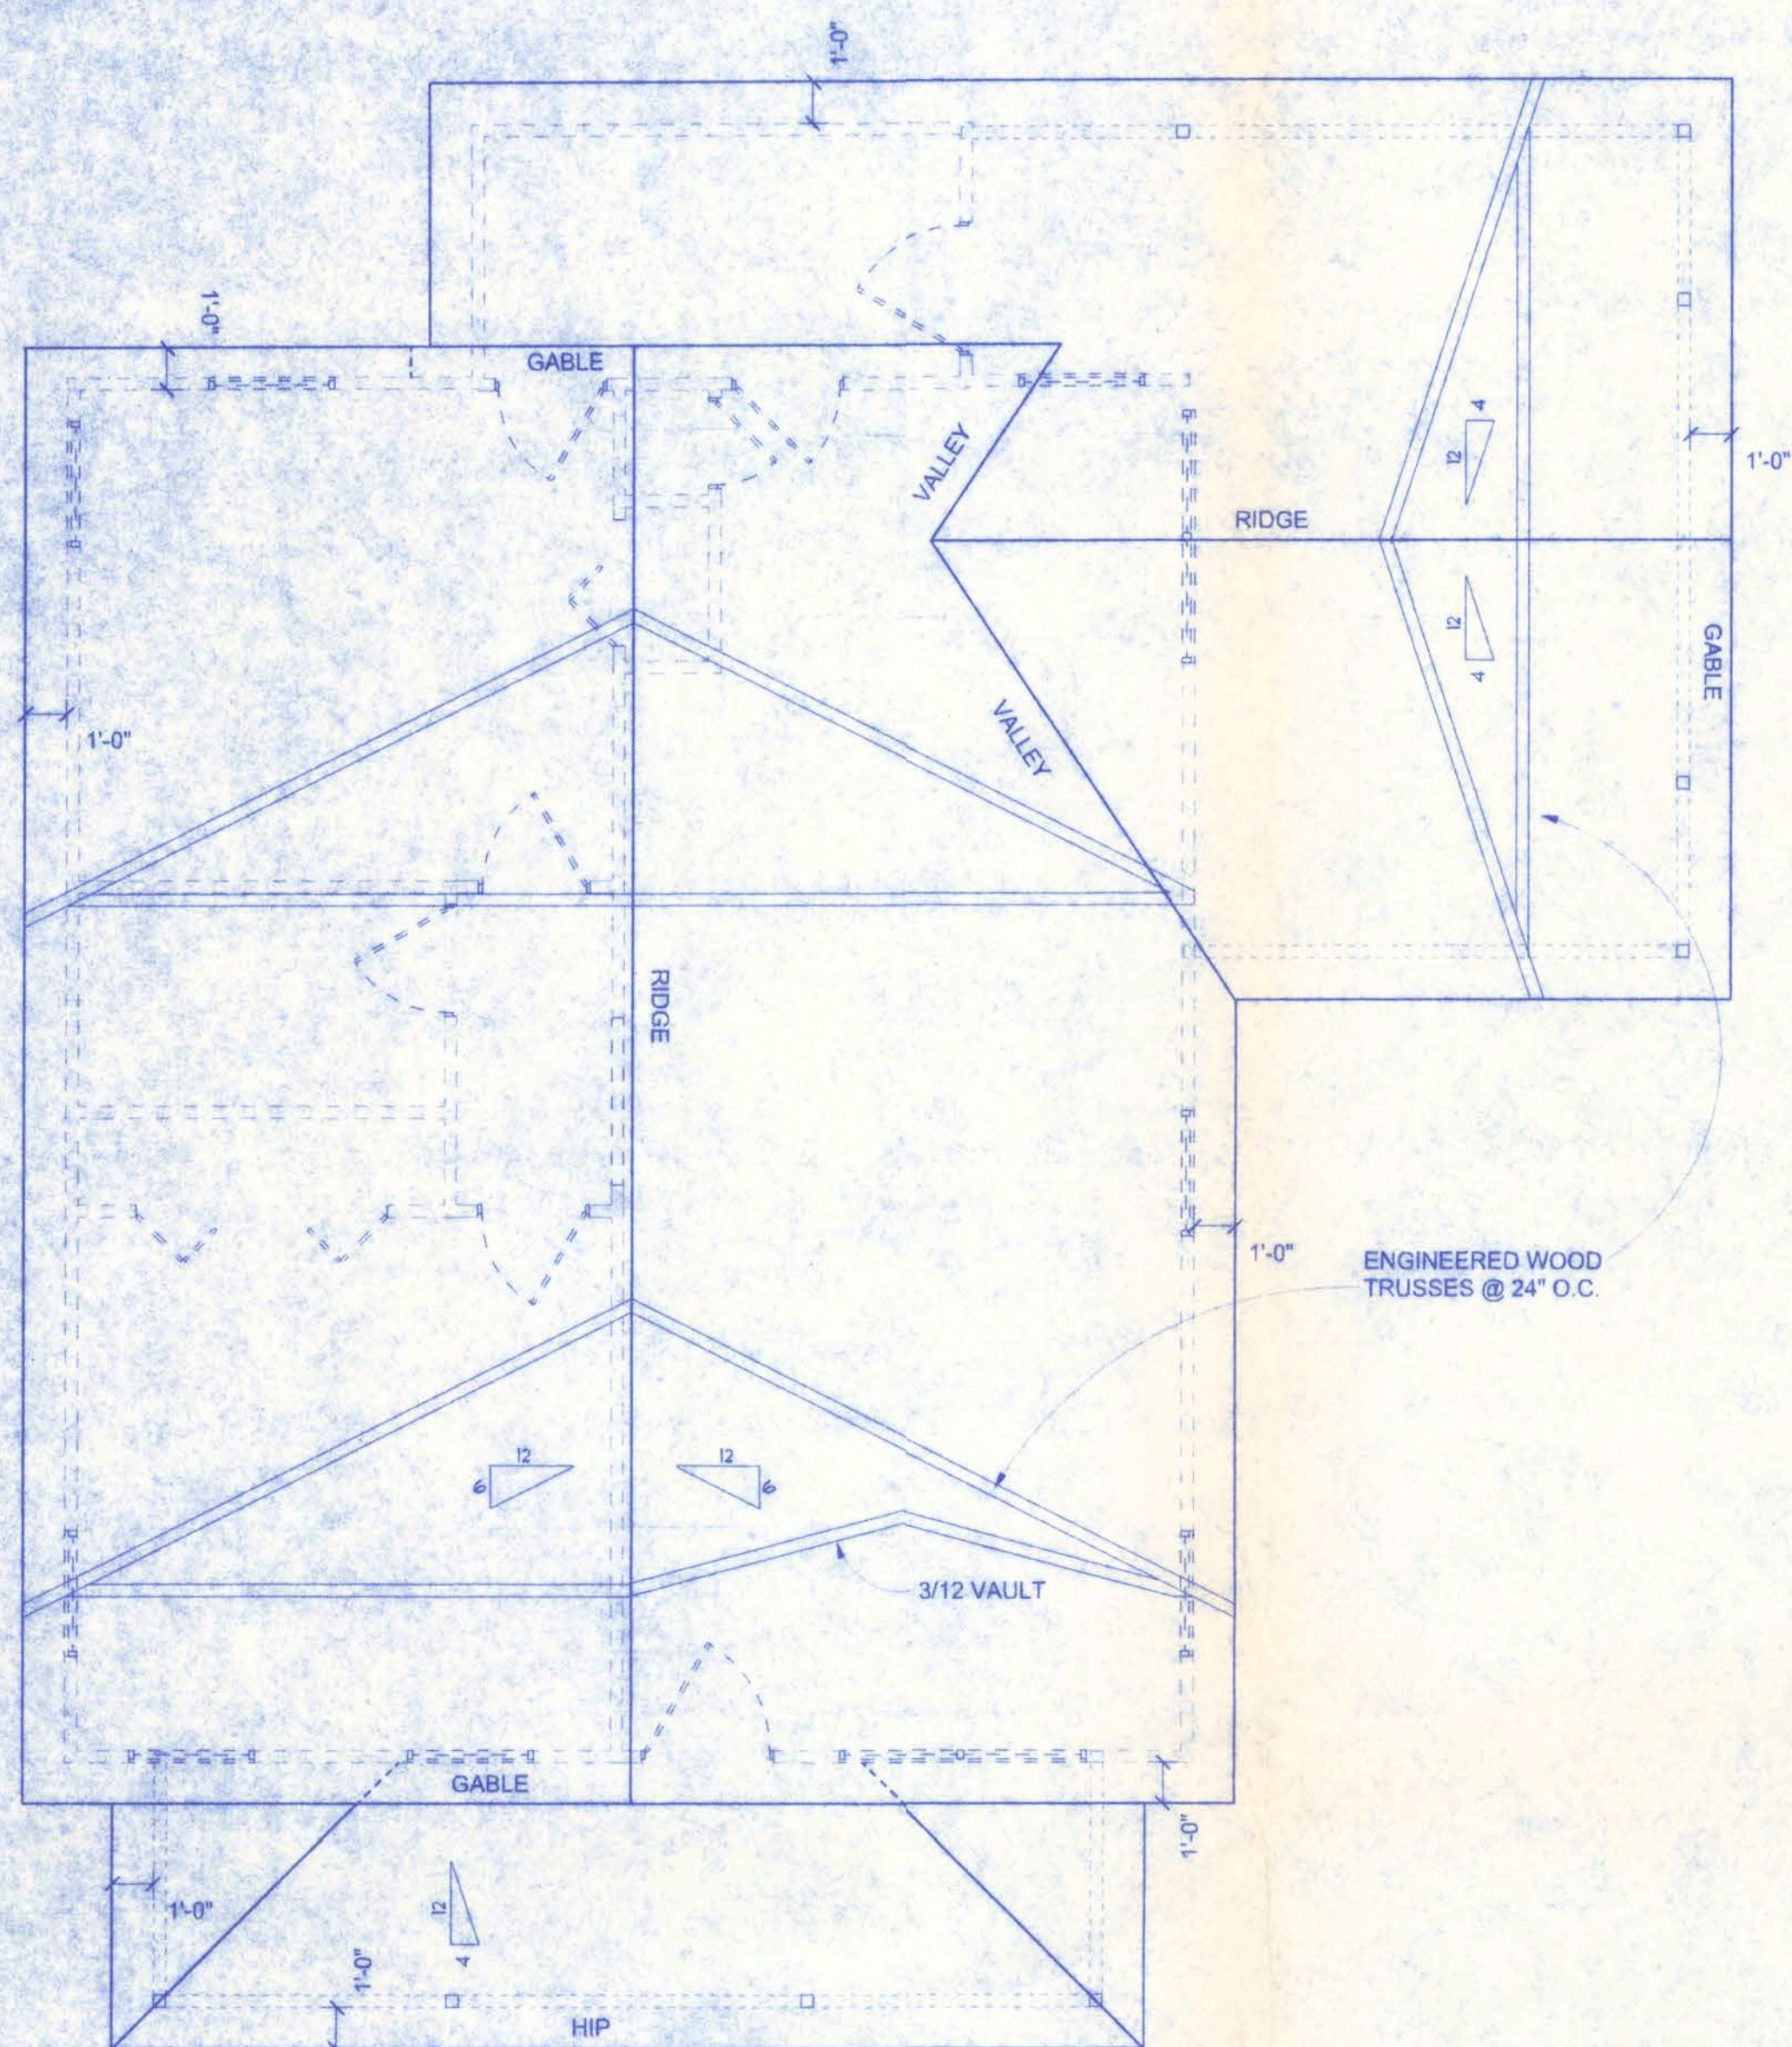

**ROOF PLAN**  
SCALE: 1/4" = 1'-0"

**HEADER SPANS FOR EXTERIOR BEARING WALLS**


	Size	Building Width (ft)			
		20'	28'	36'	
Headers Supporting		Span	# jacks	Span	# jacks
Roof, Ceiling	2-2x4	3'-6"	1	3'-2"	1
	2-2x6	5'-5"	1	4'-8"	1
	2-2x8	6'-10"	1	5'-11"	1
	2-2x10	8'-5"	2	7'-3"	2
	2-2x12	9'-9"	2	8'-5"	2
	3-2x8	8'-4"	1	7'-5"	1
	3-2x10	10'-6"	1	9'-1"	2
	3-2x12	12'-2"	2	10'-7"	2
	4-2x8	9'-2"	1	8'-4"	1
	4-2x10	11'-8"	1	10'-6"	1
	4-2x12	14'-1"	1	12'-2"	2

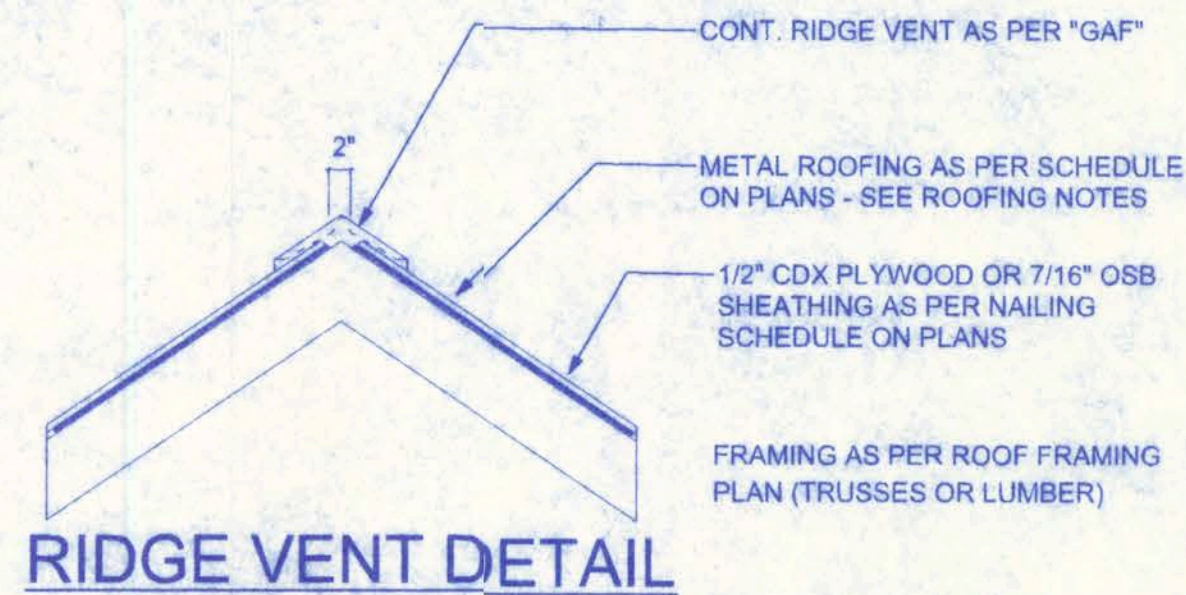

**VENTILATION REQUIREMENTS**


Total Attic Square Footage	Recommended Length of Cobra Rigid Vent II (Feet)	Minimum Intake Ventilation (Net Free Area in Sq. In.)
1600	21	384
1900	25	456
2200	29	528
2500	33	600
2800	41	744
3100	41	820
3400	45	816

CONNECTOR SCHEDULE FOR TRUSS ANCHORAGE				
CONNECTOR	TRUSS	TOP PLATE	UPLIFT PROVIDED	MANUFACTURER
H2.5	5-8d NAILS	5-8d NAILS	365 LBS	SIMPSON
H10	8-8d NAILS	8-8d NAILS	850 LBS	SIMPSON
MTS12	7-10d NAILS	7-10d NAILS	1,000 LBS	SIMPSON
H16	2-10d NAILS	10-10d NAILS	1,300 LBS	SIMPSON
(2)HTS20	10-10d NAILS	10-10d NAILS	2 x 1,450 = 2,900 LBS	SIMPSON

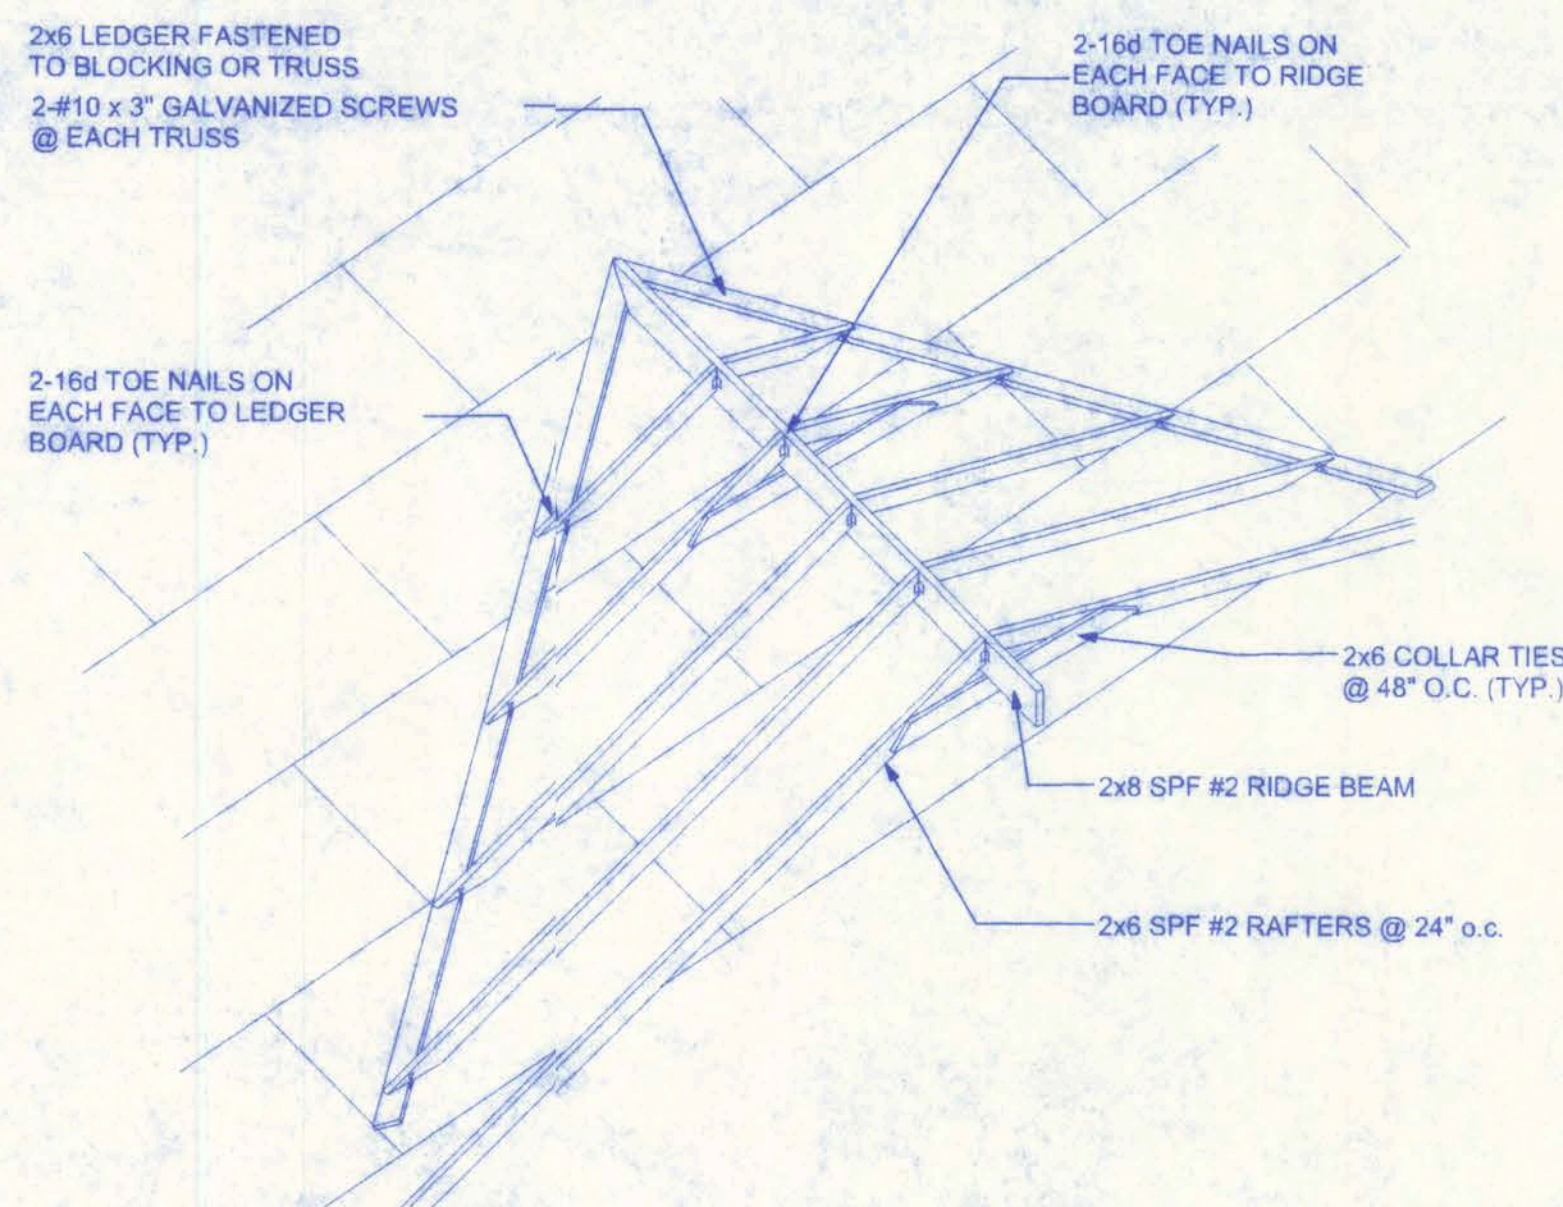


**ROOF INTERSECTION CONNECTION DETAIL**  
NTS



ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1	15/32 CDX	8d COMMON OR 8d HOT DIPPED GALVANIZED BOX NAILS	6 in. o.c. EDGE
2			12 in. o.c. FIELD
3			6 in. o.c. EDGE
			4 in. o.c. @ GABLE ENDWALL OR GABLE TRUSS
			6 in. o.c. EDGE
			6 in. o.c. FIELD

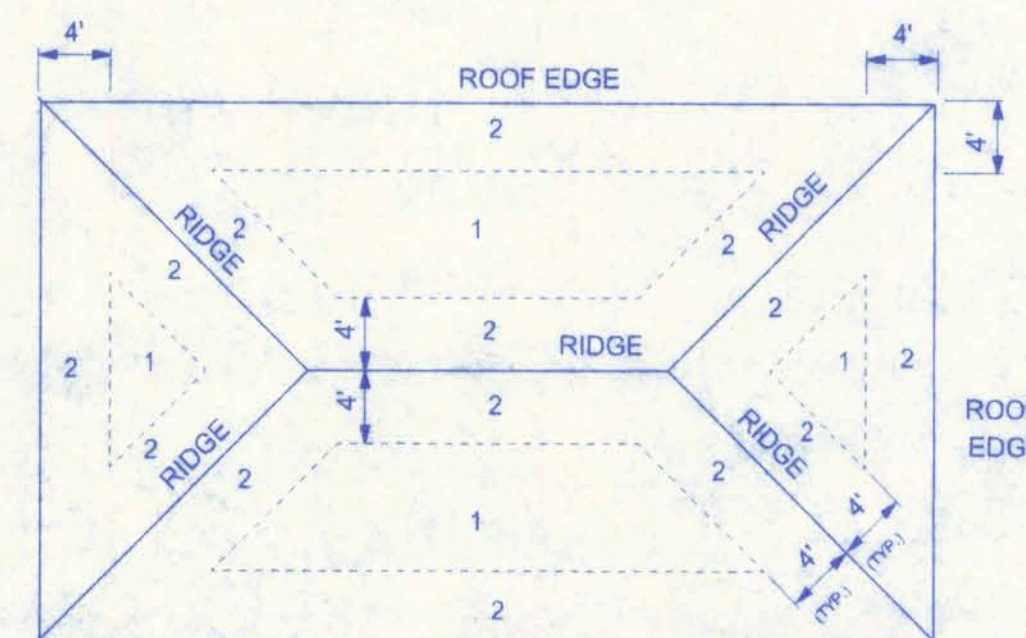

**ROOF SHEATHING NAILING ZONES (HIP ROOF)**

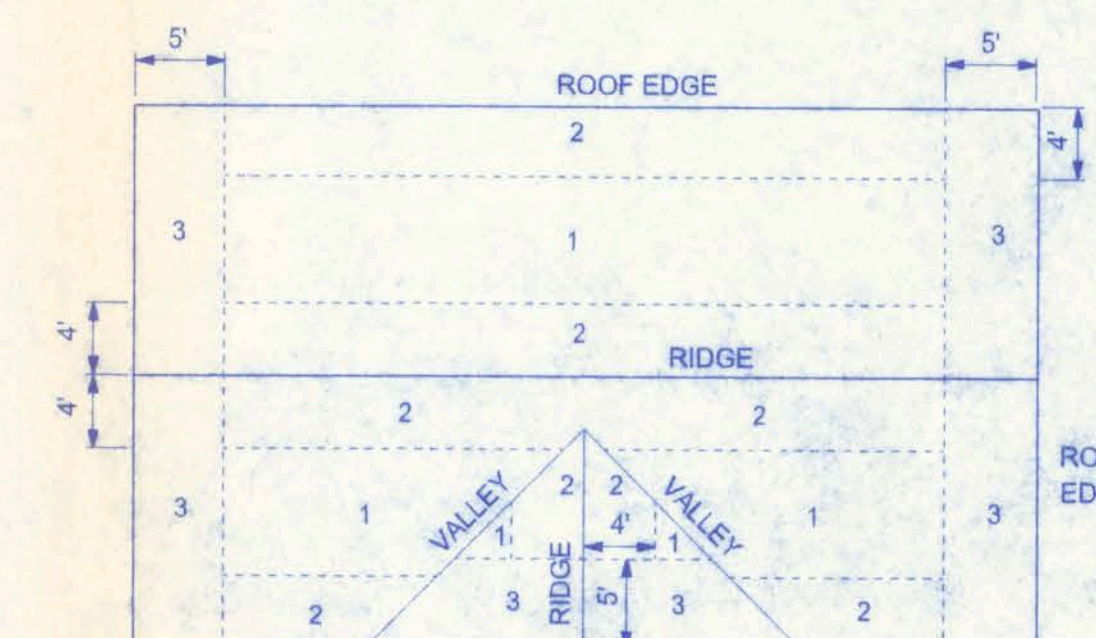


**ROOF SHEATHING NAILING ZONES (GABLE ROOF)**

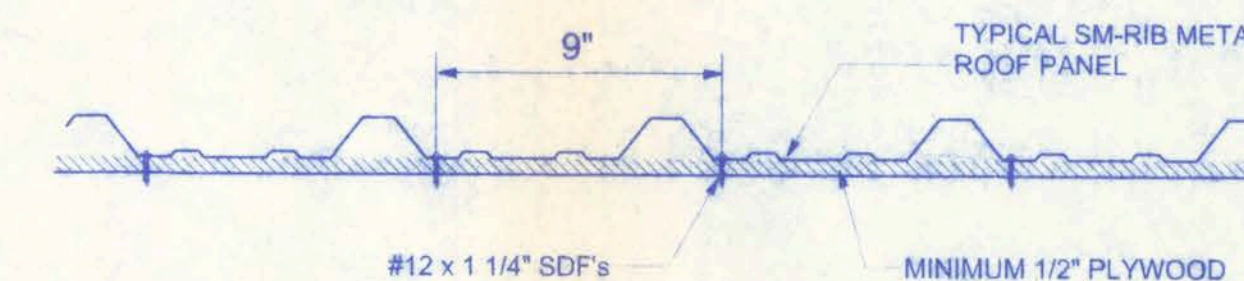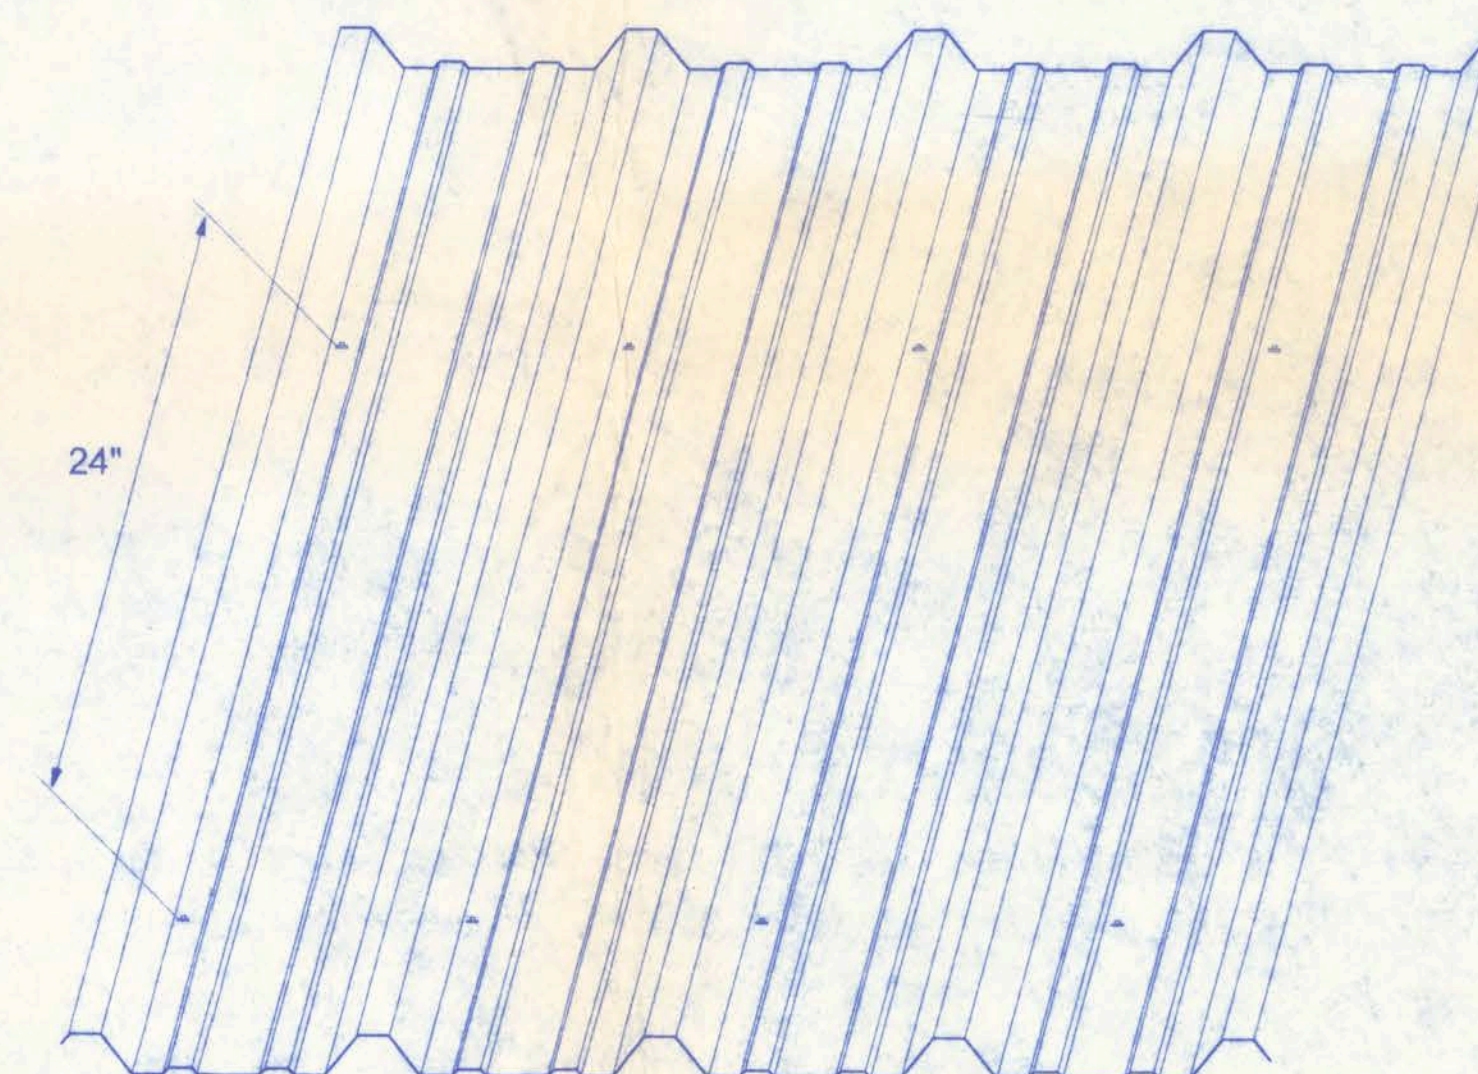

**PANEL FASTENER SPACING**  
SCALE: 1 1/2" = 1'-0"

**NOTE:**  
VENTILATION SHALL BE PROVIDED TO FURNISH CROSS VENTILATION OF EACH SEPARATE ATTIC SPACE WITH WEATHER PROTECTED VENTS. ALL VENTS SHALL BE SCREENED TO PROTECT THE INTERIOR FROM INTRUSION OF BIRDS. THE RATIO OF TOTAL NET FREE VENTILATING AREA TO THE AREA OF CEILING SHALL NOT BE LESS THAN 1/150.

161 NW MADISON STREET  
SUITE 102  
LAKE CITY, FL 32055  
(386)758-4209



**Freeman**  
Design Group

DATE: 9/25/07  
DRAWN BY: J.T.D.  
APPROVED: W.H.F.

REVISIONS


SHEET: A-4

OF: 6

PROJECT NO.: 07.C040

EQUESTRIAN MANAGER'S  
RESIDENCE

CERTIFICATE OF AUTHORIZATION # 0008701



J. T. D.  
No. 9125  
State of Florida

DATE: 9/25/07  
DRAWN BY: J.T.D.  
APPROVED: W.H.F.

REVISIONS


SHEET: A-4

OF: 6

PROJECT NO.: 07.C040

EQUESTRIAN MANAGER'S  
RESIDENCE

CERTIFICATE OF AUTHORIZATION # 0008701



J. T. D.  
No. 9125  
State of Florida

DATE: 9/25/07  
DRAWN BY: J.T.D.  
APPROVED: W.H.F.

REVISIONS


SHEET: A-4

OF: 6

PROJECT NO.: 07.C040

EQUESTRIAN MANAGER'S  
RESIDENCE



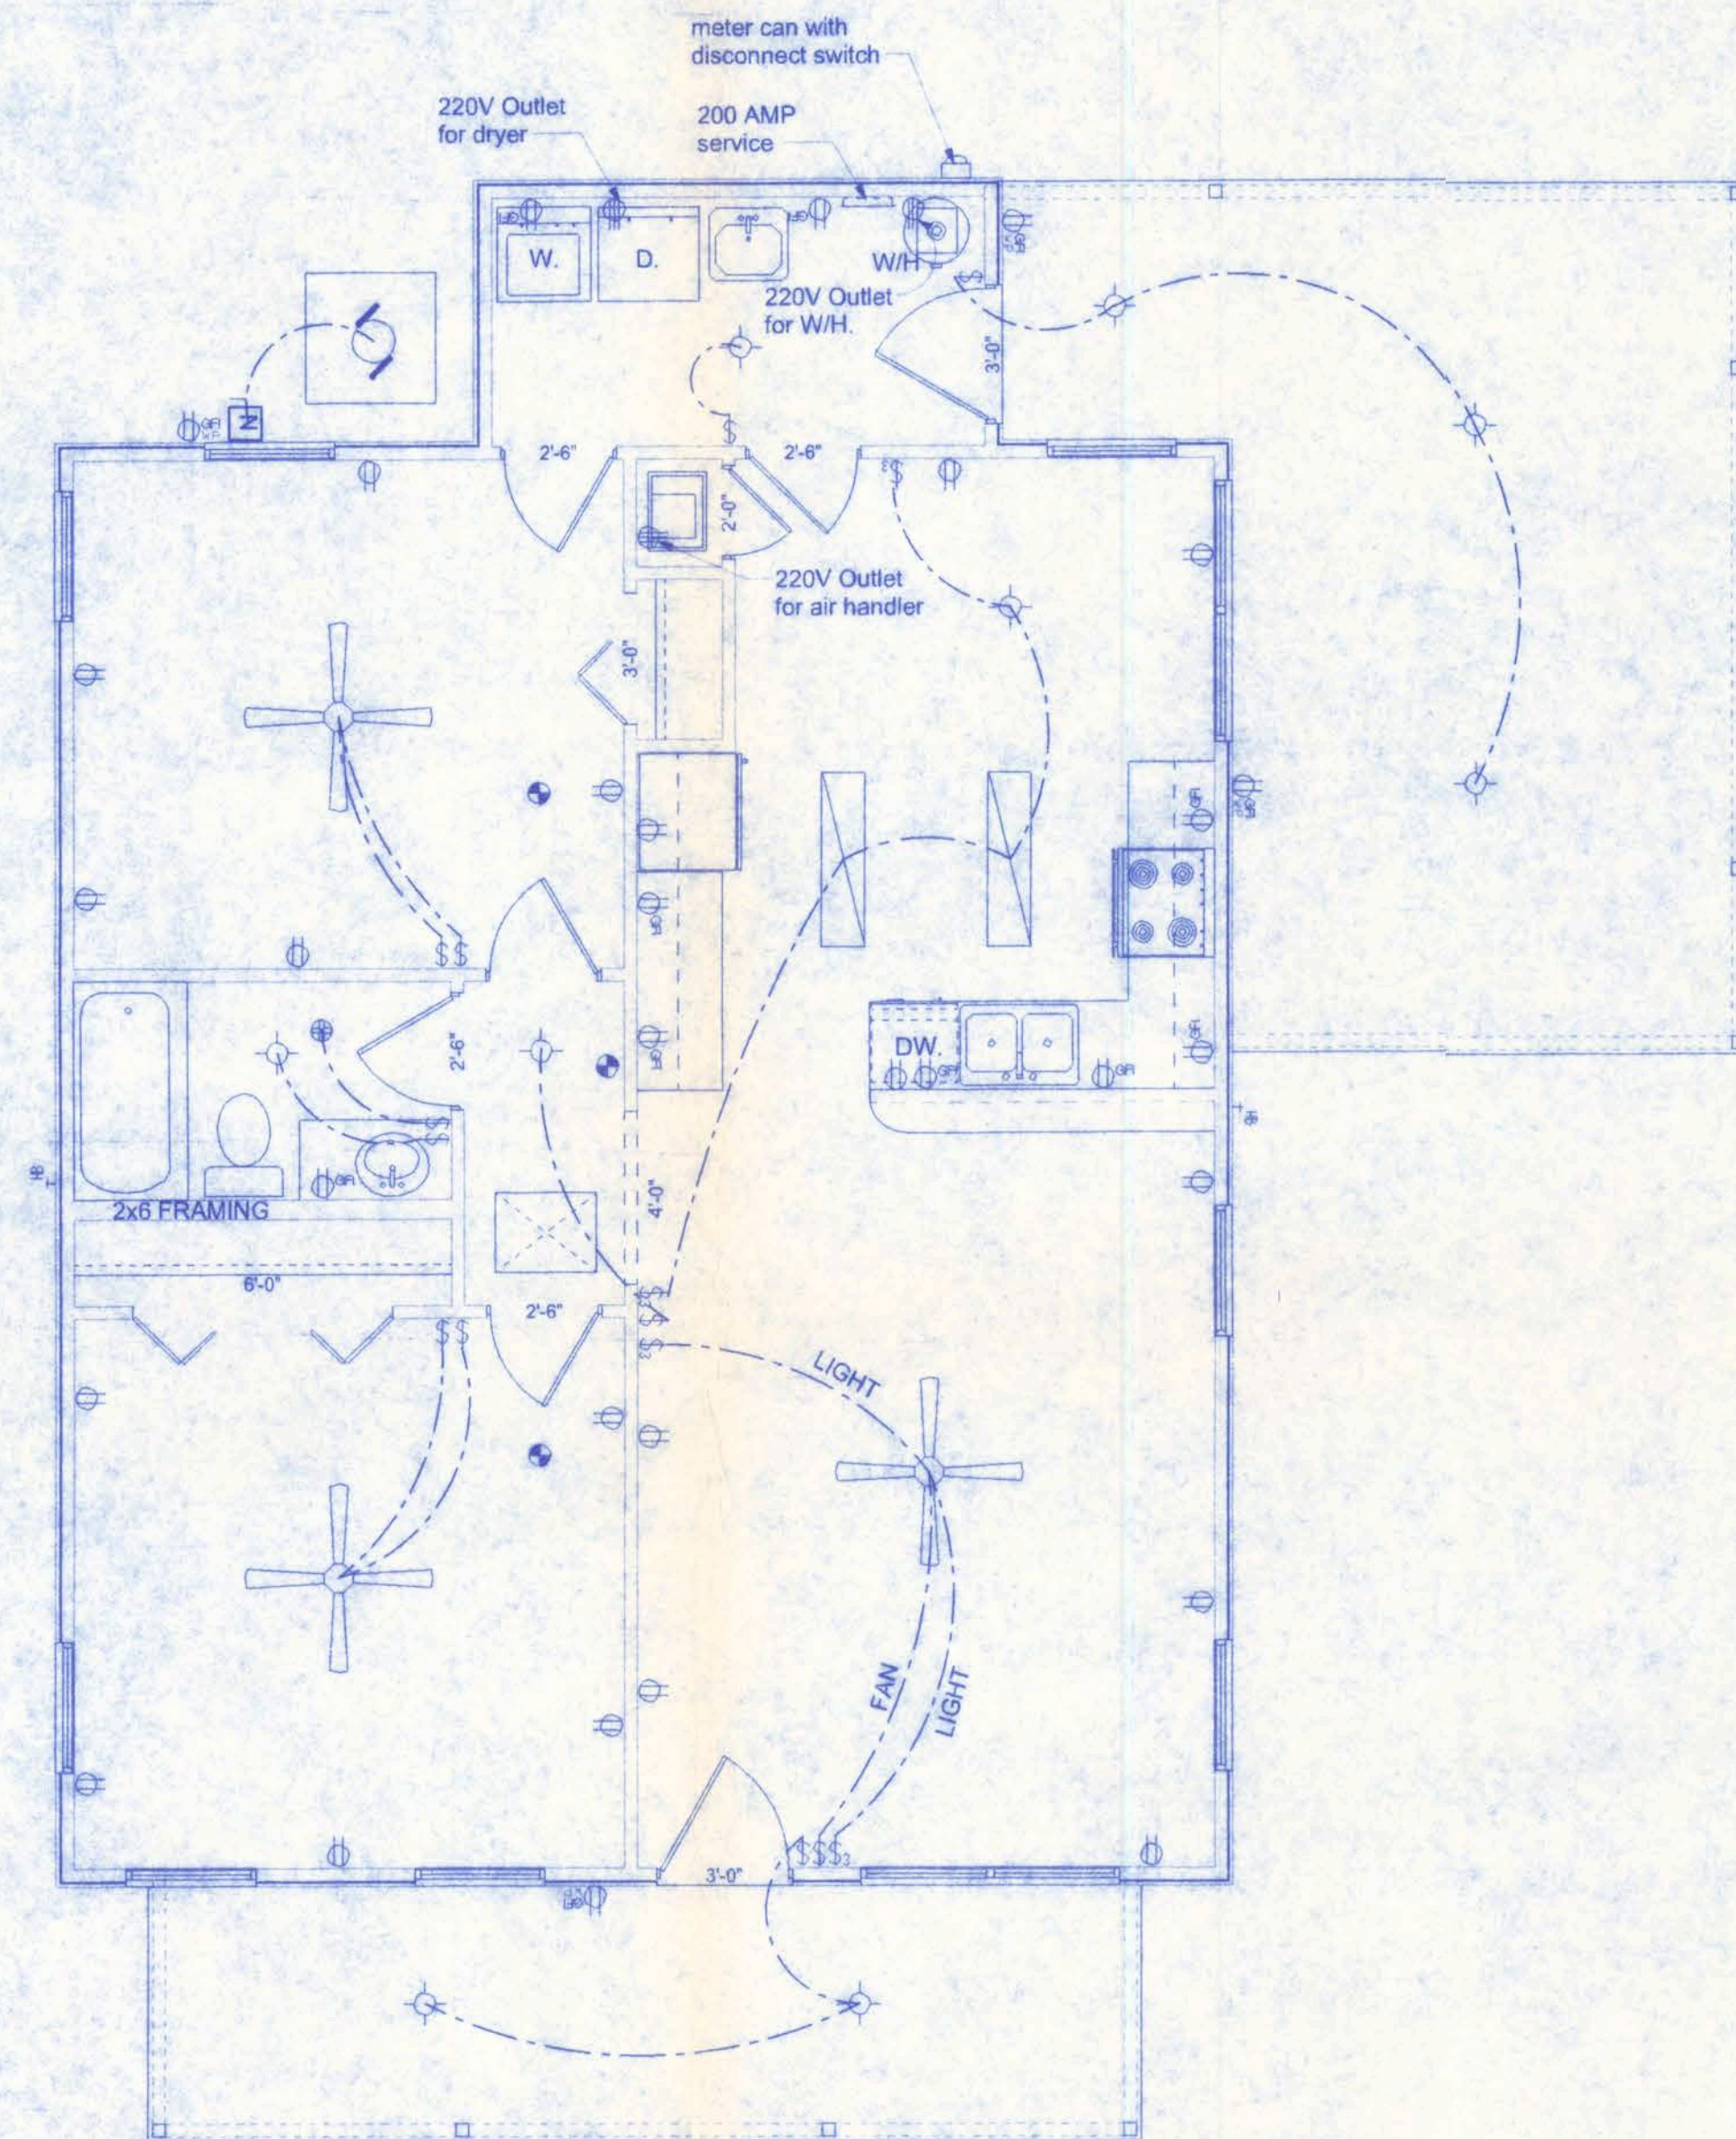

ELECTRICAL PLAN  
SCALE: 1/4" = 1'-0"

ELECTRICAL PLAN NOTES

WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.

CONSULT THE OWNER FOR THE NUMBER OF SEPERATE TELEPHONE LINES TO BE INSTALLED.

INSTALLATION SHALL BE PER NAT'L. ELECTRIC CODE.

ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.

TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.


ELECTRICAL CONTR SHALL PREPARE "AS-BUILT" SHOP DWGS INDICATING ALL ELECTRICAL WORK, INCLUDING ANY CHANGES TO THE ELEC. PLAN, ADDNS TO THE ELEC. PLAN, RISER DIAGRAM, AS-BUILT PANEL SCHEDULE W/ ALL CKTS IDENTIFIED W/ CKT Nr., DESCRIPTION & BRKR. SERVICE ENT. & ALL UNDERGROUND WIRE LOCATIONS/ROUTING/DEPTH. RISER DIA. SHALL INCLUDE WIRE SIZES/TYPE & EQUIPMENT TYPE W/ RATINGS & LOADS. CONTRACTOR SHALL PROVIDE 1 COPY OF AS-BUILT DWGS TO OWNER & 1 COPY TO THE PERMIT ISSUING AUTHORITY.

NOTE:

ALL BRANCH CIRCUITS THAT SUPPLY 125-VOLT, SINGLE PHASE, 15 AND 20 AMP OUTLETS INSTALLED IN DWELLING UNIT BEDROOMS SHALL BE PROTECTED BY AN ARC FAULT CIRCUIT INTERRUPTER LISTED TO PROVIDE PROTECTION OF THE ENTIRE BRANCH CIRCUIT.

ELECTRICAL	COUNT	SYMBOL
ceiling fan	3	
fluorescent fixture	2	
HVAC motor	1	
Meter can	1	
electrical panel	1	
non-fused disconnect	1	
50 cfm exhaust fan	1	
GFI receptacle	9	
light	9	
outlet	19	
outlet 220v	3	
smoke detector	3	
switch	11	
switch 3 way	4	
weather proof GFI	4	

161 NW MADISON STREET  
SUITE 102  
LAKE CITY, FL. 32055  
(386)758-4209



Freeman  
Design Group Inc

DATE  
9/21/07

DRAWN BY  
J.T.D.

APPROVED  
W.H.F.

REVISIONS

SHEET A-5


OF 6

PROJECT NO.  
07.C040

EQUESTRIAN MANAGER'S  
RESIDENCE

William H. Faw  
9/25/07  
P.E. 58001



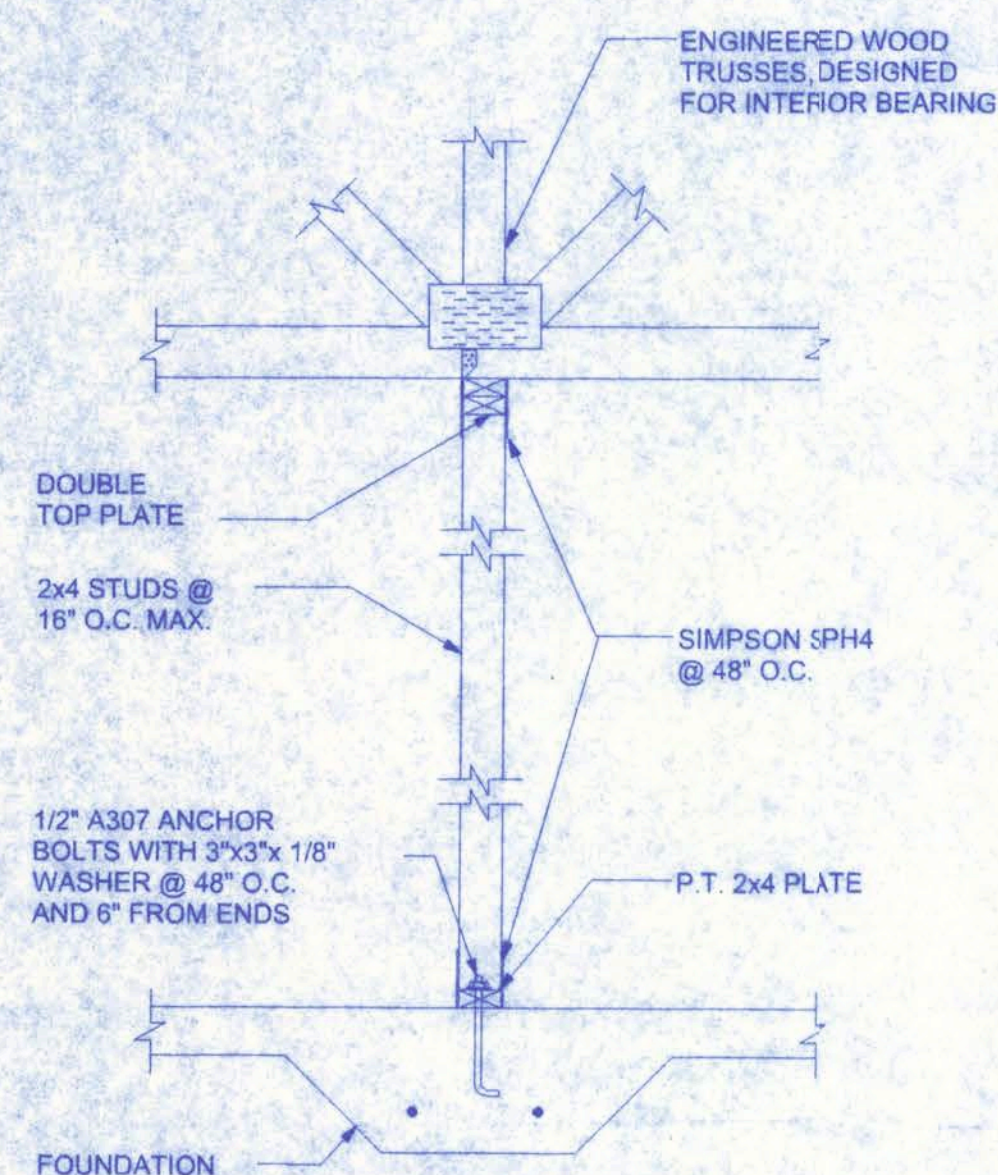


## INTERIOR BRG. WALL DETAIL

### FIREBLOCKING NOTES:


FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:

1. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
2. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.
3. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN.
4. AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH PYROPANEL MULTIFLEXSEALANT
5. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS. FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.

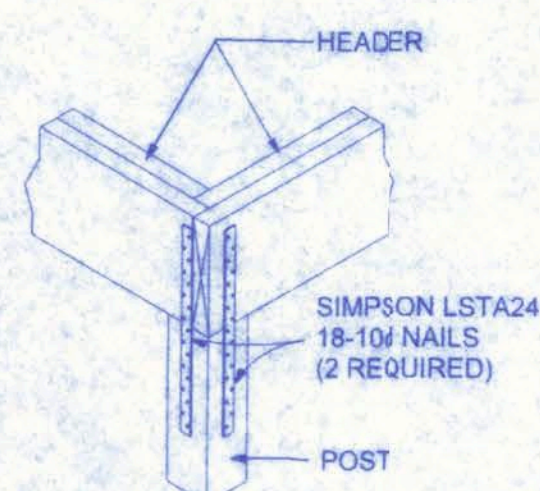


## CORNER POST/HEADER DETAIL

NTS

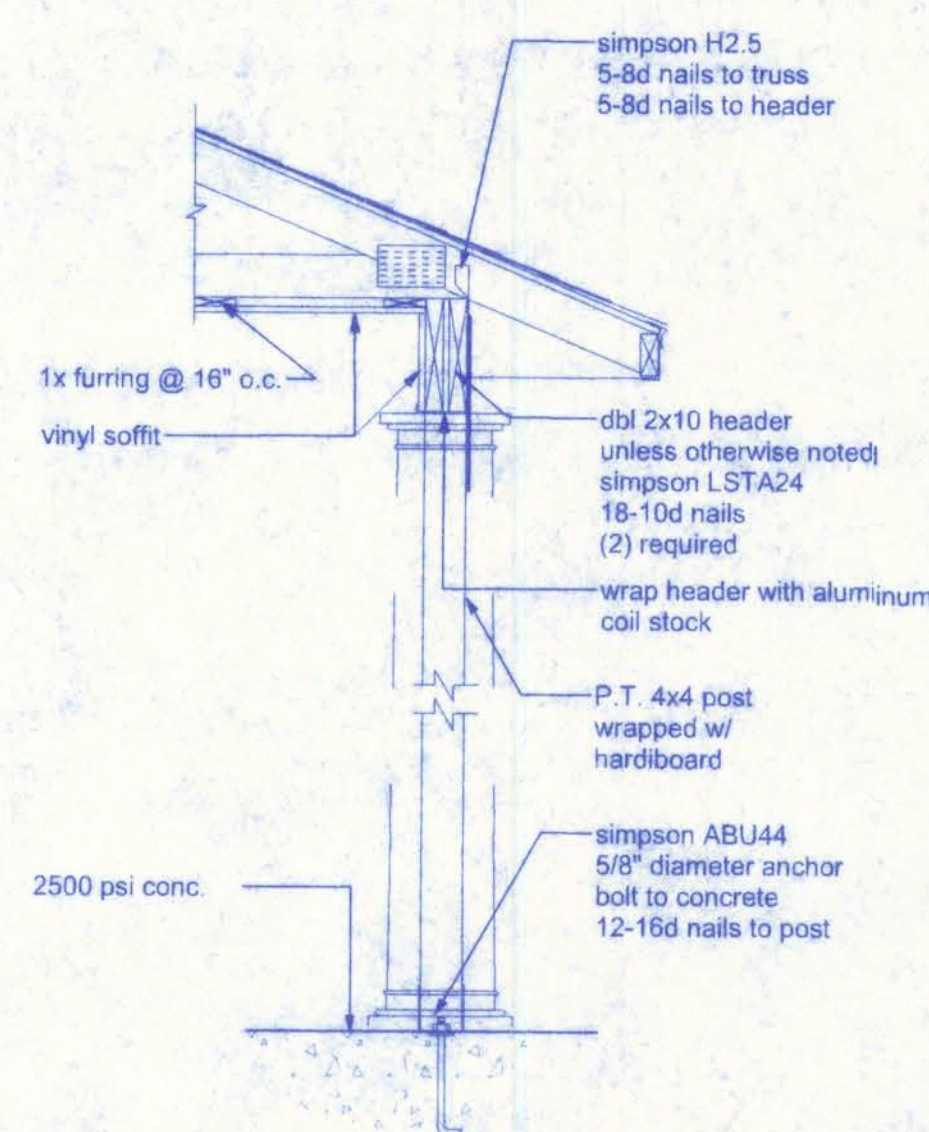


## PORCH SECTION

SCALE: 3/4" = 1'-0"

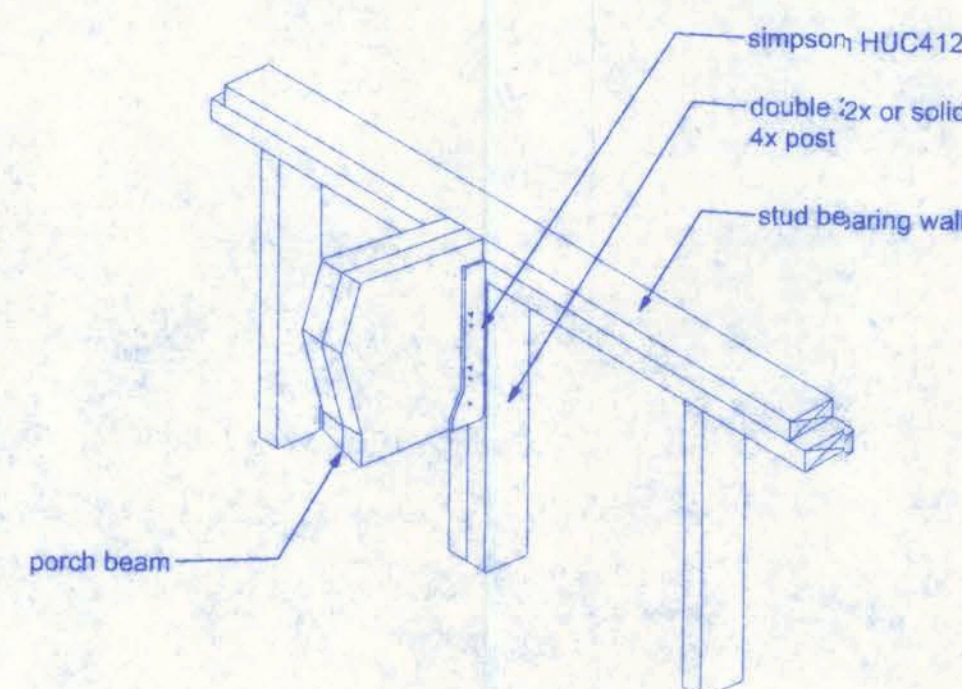


## BEAM/WALL CONNECTION

NTS

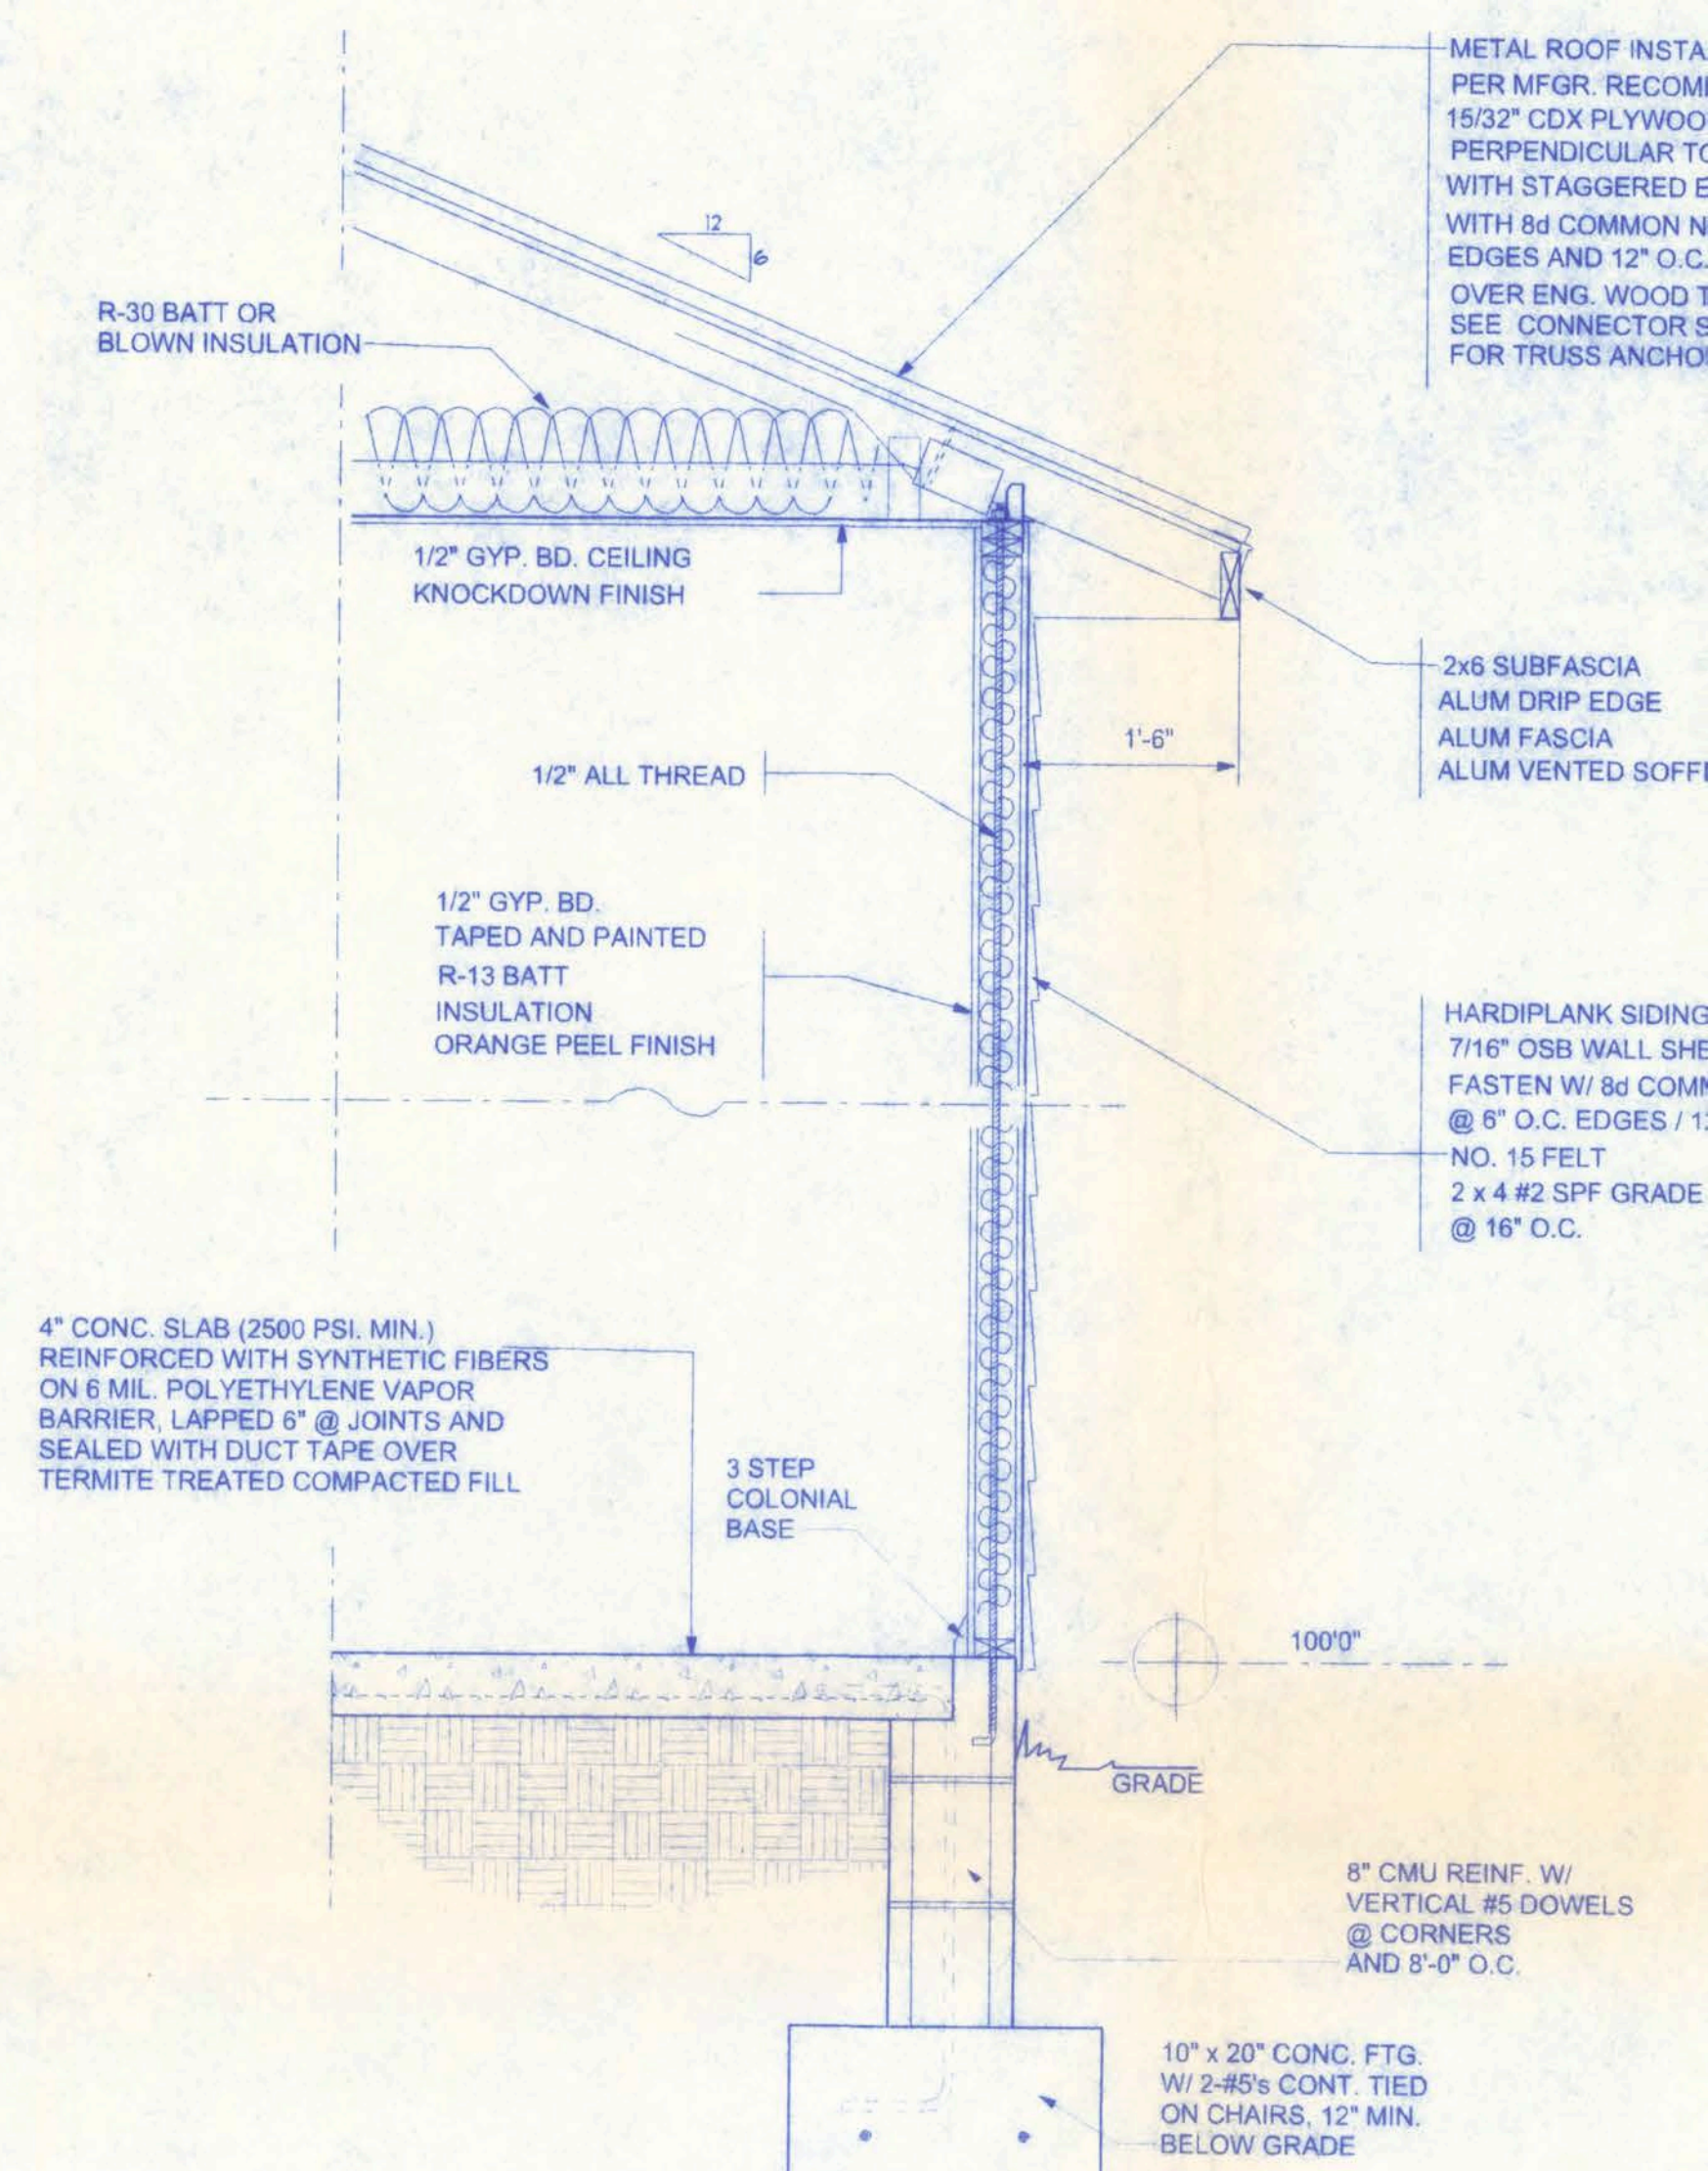

## TYPICAL WALL SECTION

3/4" = 1'-0"

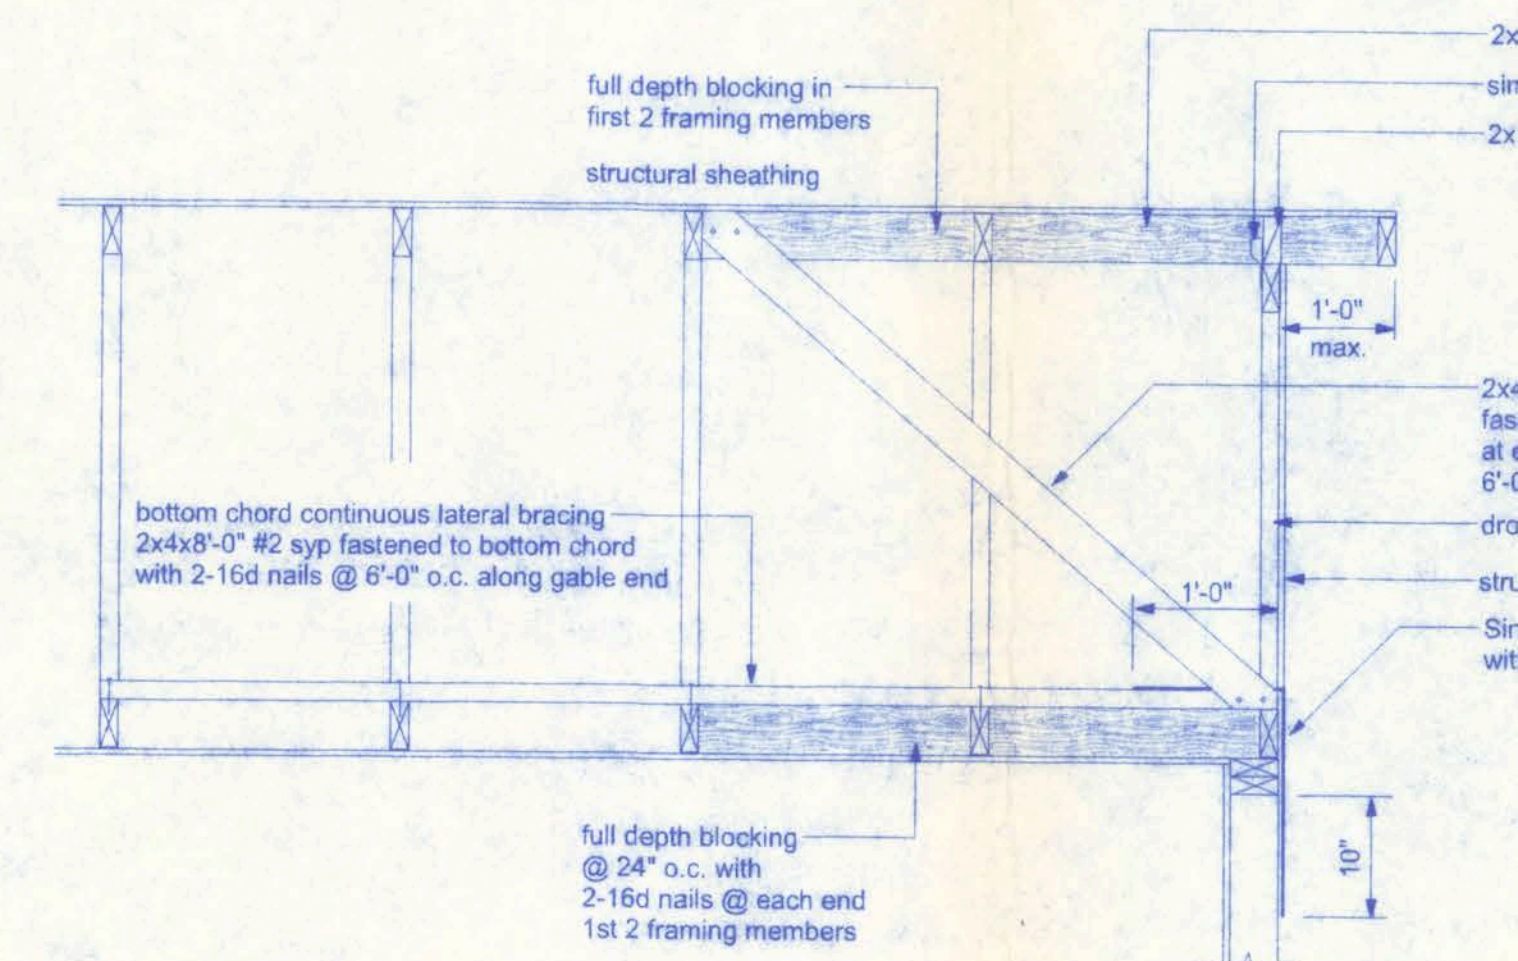


## END WALL BRACING FOR CEILING DIAPHRAGM

NTS

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE



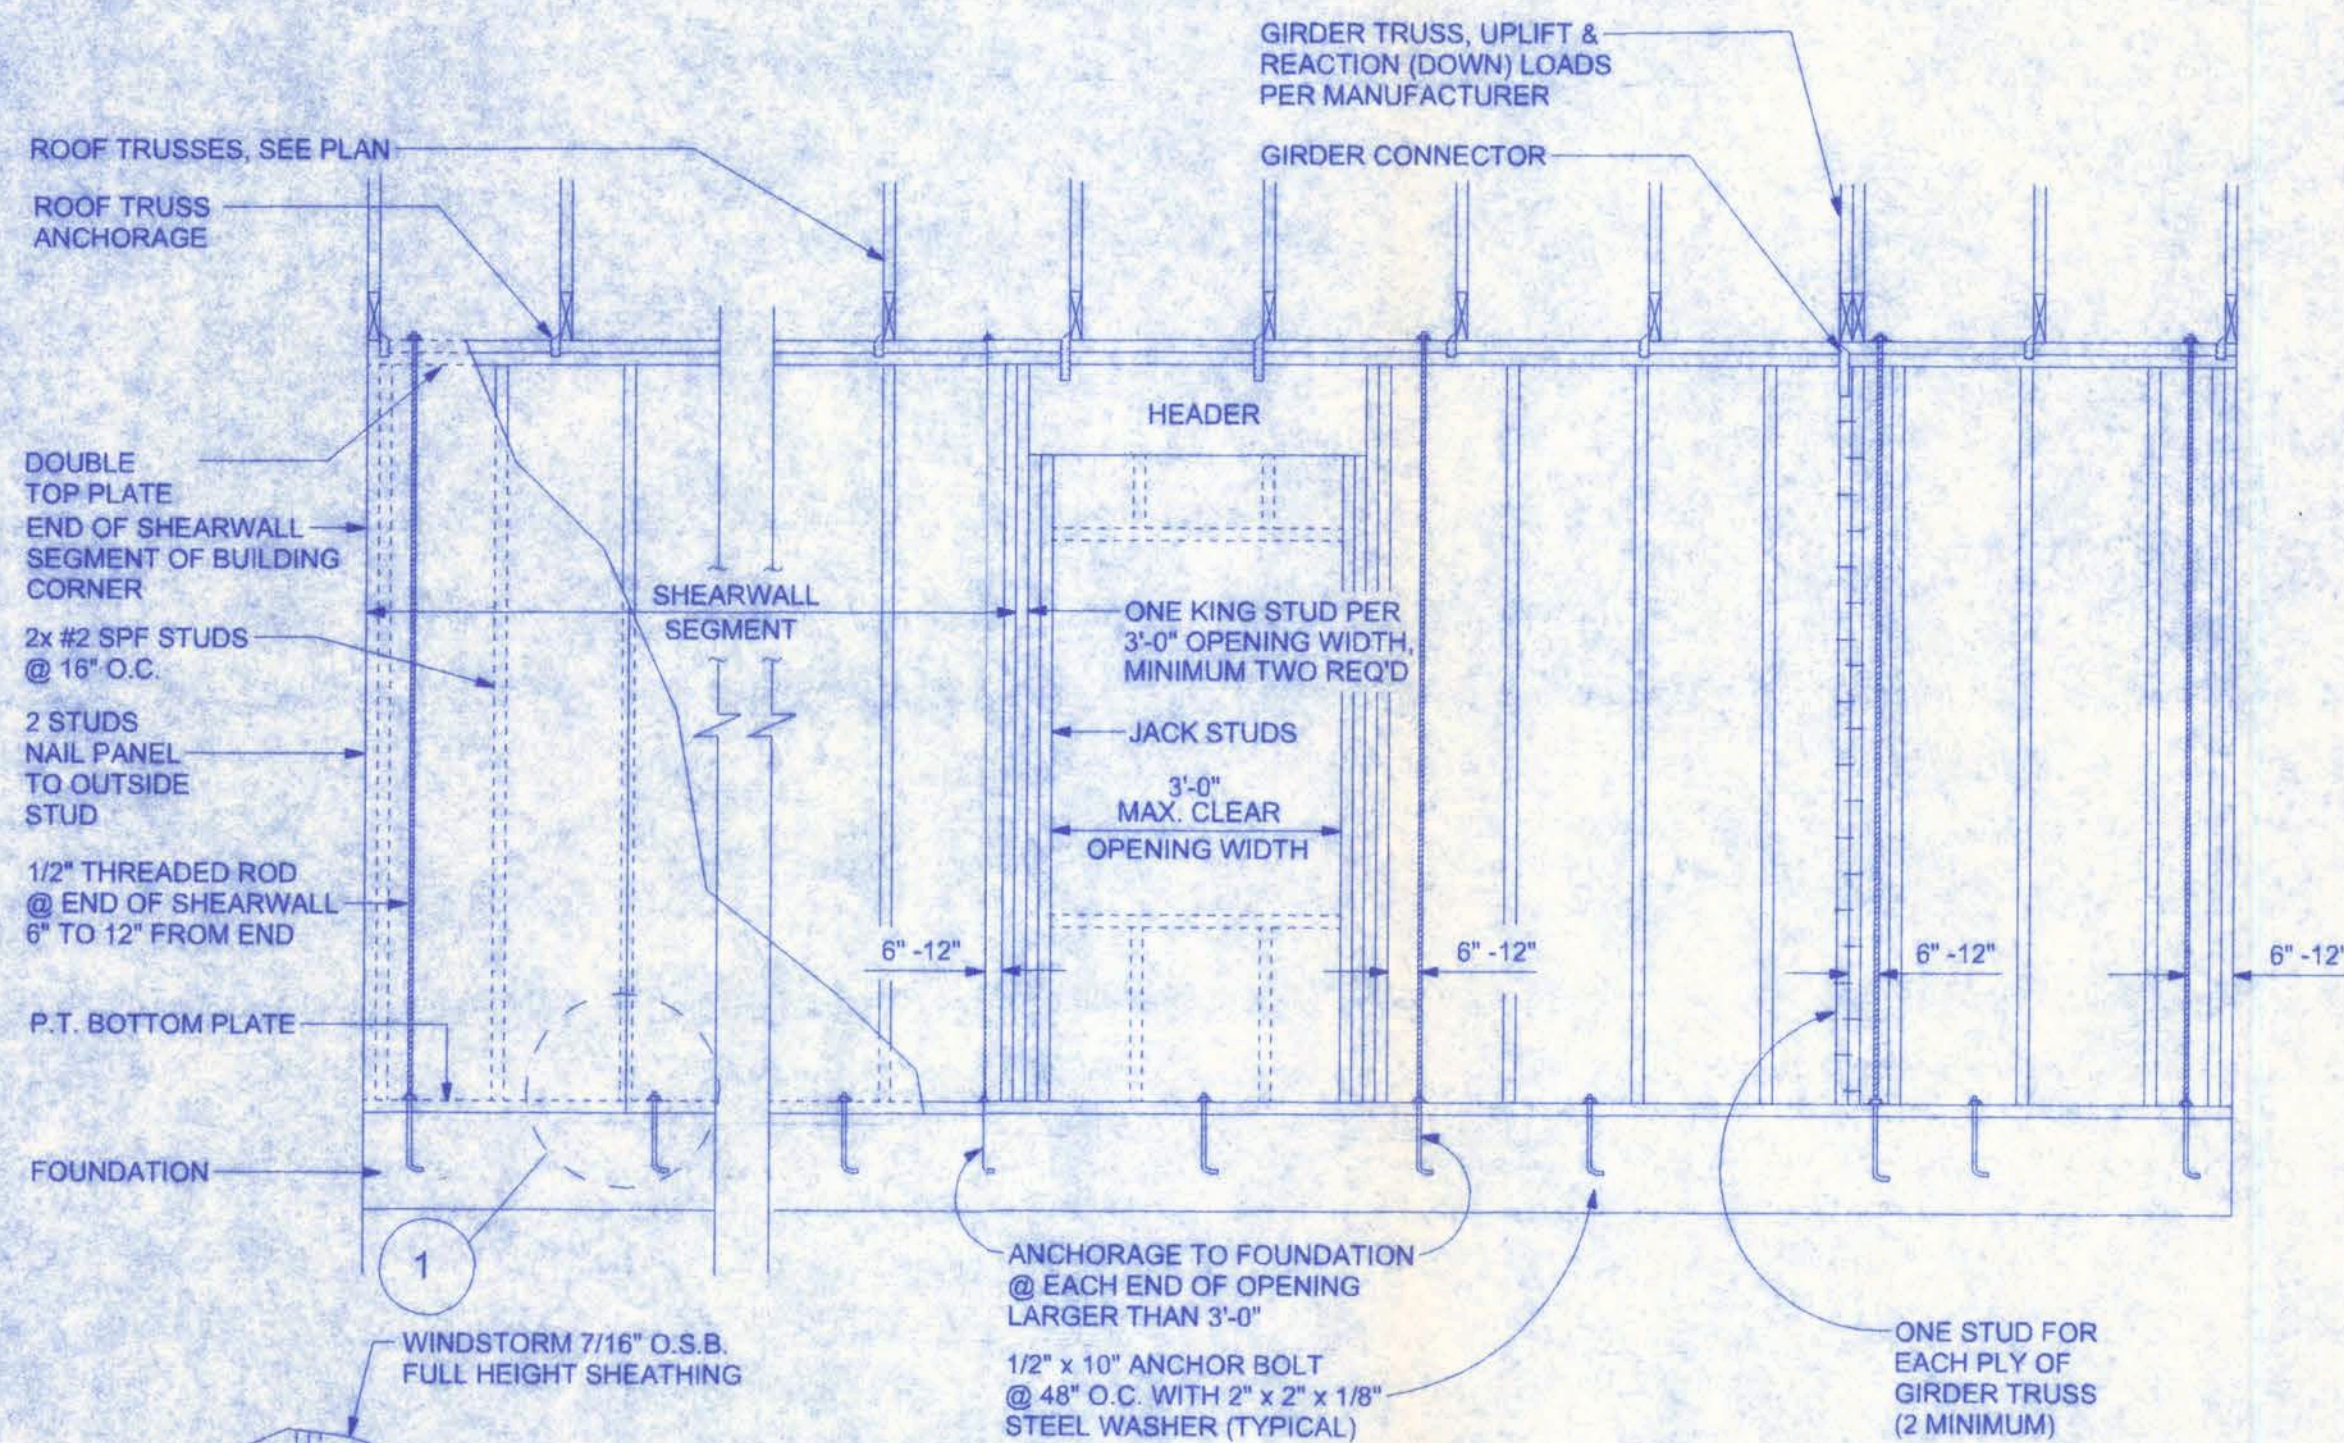

## SHEARWALL DETAILS

SCALE: 1/2" = 1'-0"

### DOUBLE NAIL EDGE SPACING TOP AND BOTTOM PLATE

UPLIFT CAPACITY = 474 plf  
(TABLE 305S1 SST10-99)

#### RULES:

1. One all-thread rod at each corner.
2. One all-thread rod at each end of shearwalls.
3. One all-thread rod at each end of opening headers greater than 3'-0".
4. Check sub-sheathing to top plate connection for horizontal transfer capability.
5. If necessary, add all-thread rods to girders individually to exclude the from average uplift plf.
6. Check sole plate to slab connection, additional anchors may be required for lateral and shear load transfer.

Connection Type	Allowable Value
Foundation / S.Y.P. Top Plate	3840 lbs.
Foundation / Spruce-Pine-Fir Top Plate	3840 lbs.
Lintel or Bond Beam / S.Y.P. Top Plate	3840 lbs.
Lintel or Bond Beam / Spruce-Pine-Fir Top Plate	3840 lbs.

#### Placement at slab level:

##### Corners

When presetting the all-thread rod at a building corner, the rod should be placed 8 to 12 inches away from the corner so it does not set under the corner framing members. When a all-thread rod is specified at a building corner, it may be placed on either side of the corner.

##### Header ends

When presetting the all-thread rod at a header end, the rod should be placed 8 to 12 inches away from the header end so it does not fall under the stud pack framing members.

##### Top Connections

Top connections made at corners and header ends shall be made within 2 inches of the framing pack. A nut and 3X3 washer shall be applied to the top plates and tightened securely.

##### Intermediate Coupler Connections

When using the rod coupler, care should be taken to ensure full and equal thread engagement. This is easily achieved by threading the coupler all the way onto the rod, then standing the two rods end to end, then threading the coupler back over the rod joint so each rod is halfway into the coupler.

##### Retro-fits

In the case of an all thread rod misplacement, the rod may be epoxied into the concrete.

##### Sole plate to slab connection:

The slab level sole plate shall be connected to the slab with the connectors specified and at the spacing specified within the design documents. All-thread rods shall be placed as per the design specifications. All-thread rods with a nut and washer at the sole plate will qualify as a sole plate connection but may require other anchors intermediate of the all-thread rod locations to qualify the specified spacing requirements.


##### System Tightening:

On multiple story applications, the all-thread rod system shall be rechecked for proper tension just before the walls are veneered. This will allow the all-thread rod system to compensate for the buildings dead load compression.

#### SHEARWALL NOTES:

1. ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS AS DEFINED BY STD 10-89 305.4.3.
2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" O.S.B. INCLUDING AREAS ABOVE AND BELOW OPENINGS.
3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURRING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
4. NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD.
5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 ie. FOR 8'-0" WALLS - (2'-3").

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3

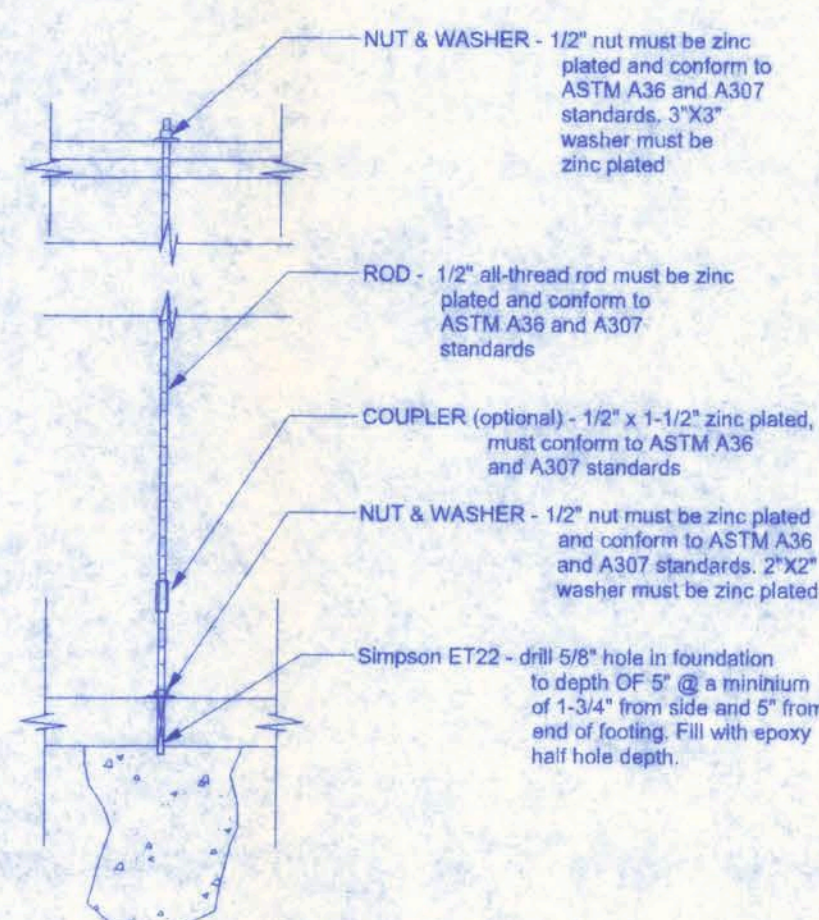


END (TOP OR BOTTOM)

## GIRDER COLUMN DETAIL

SCALE: 1/2" = 1'-0"

#### ALLOWABLE DEFLECTION OF STRUCTURAL MEMBERS


STRUCTURAL MEMBER	ALLOWABLE DEFLECTION
rafters having slopes greater than 2/12 with no finished ceiling attached to rafters	L/180
interior walls and partitions	H/180
floors and plastered ceilings	L/360
all other structural members	L/240
exterior walls with plaster or stucco finish	H/360
exterior walls - wind loads with brittle finishes	L/240
exterior walls - wind loads with flexible finishes	L/120

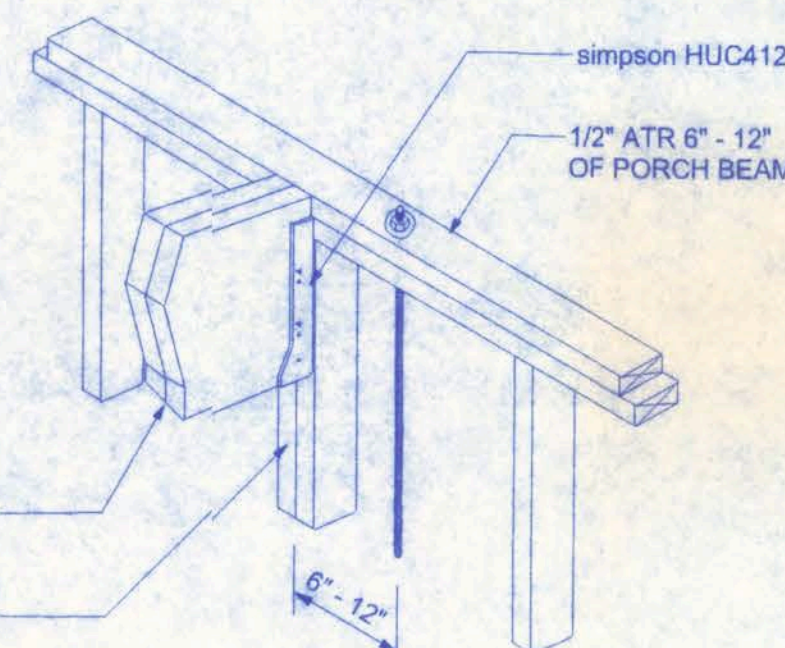

## ALL THREAD @ PORCH BEAM

NTS

NOTE:  
A SOLID MEMBER OF EQUAL OR GREATER SIZE THAN MULTIPLE MEMBERS MAY BE USED.  
IF RATED SHEATHING IS APPLIED TO NARROW EDGES, NAILED TO EACH STUD AT 12" O.C. MAXIMUM, THE LAMINATION NAILING SHOWN HERE IS NOT REQUIRED.


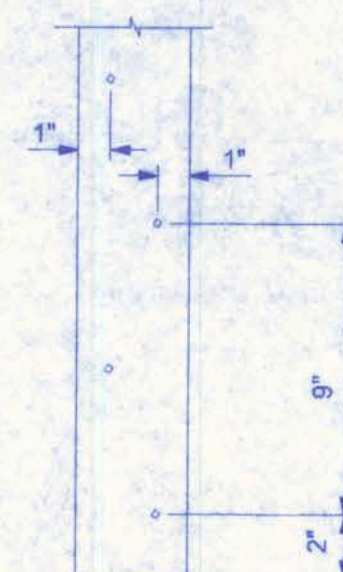


CLEAR OPENING WIDTH	HEADER SIZE #2 GRADE OR BETTER	END BEARING	CONNECTOR AT EACH END OF OPENING	ANCHORAGE TO FOUNDATION @ EACH END OF OPENING
0' - 3'	(2) 2x8	1.5"	N/A	N/A
>3' - 6'	(2) 2x10	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>6' - 9'	(2) 2x12	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>9' - 12'	(2) 1 3/4" x 11 1/4" LVL - 2.0E	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>12' - 15'	(2) 1 3/4" x 11 1/4" LVL - 2.0E	3"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD
>15' - 18'	(2) 1 3/4" x 11 1/4" LVL - 2.0E	4.5"	1/2" ALL THREAD ROD	1/2" ALL THREAD ROD

#### NOTE:

ALL WIND LOADS ARE IN ACCORDANCE WITH SECTION 1609, FLORIDA BUILDING CODE, 2004 EDITION.

BASIC WIND SPEED	110 MPH
IMPORTANCE FACTOR	1.0
BUILDING CATEGORY	2
EXPOSURE	B
INTERNAL PRESSURE	+/- 0.18
COEFFICIENT	
COMPONENT AND CLADDING PRESSURE	WALLS +21.8/-29.1 PSF ROOF +12.5/-29.1 PSF OVERHANGS -71.6 PSF
TYPE OF STRUCTURE	ENCLOSED
ROOF DEAD LOAD	10 PSF
ROOF LIVE LOAD	20 PSF
FLOOR DEAD LOAD	20 PSF
FLOOR LIVE LOAD	40 PSF

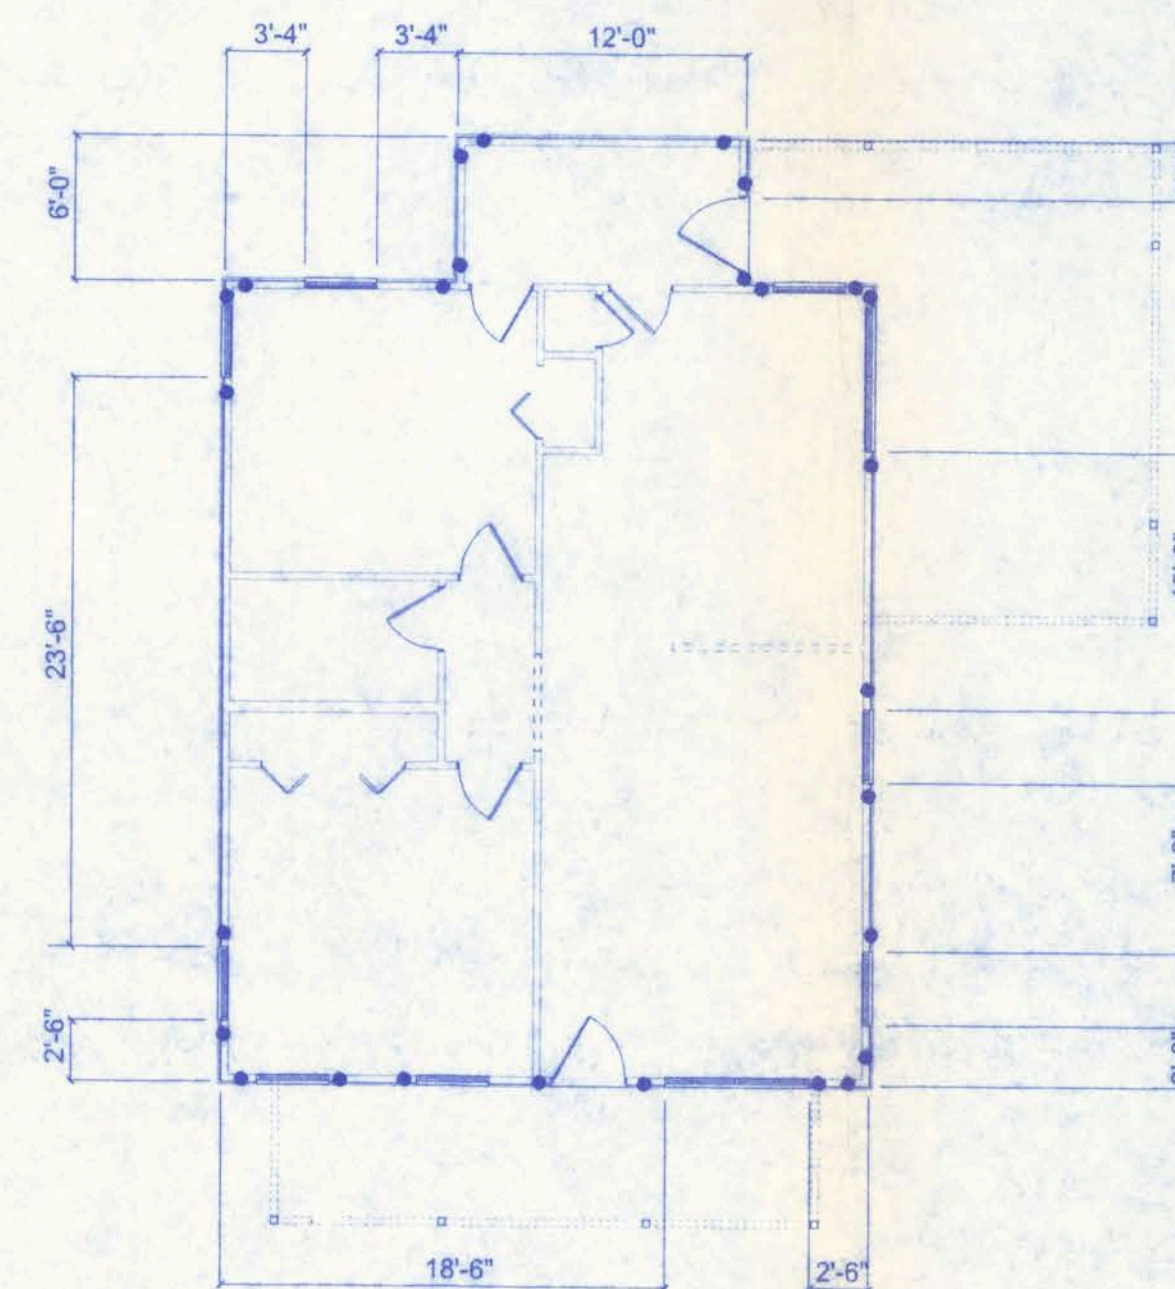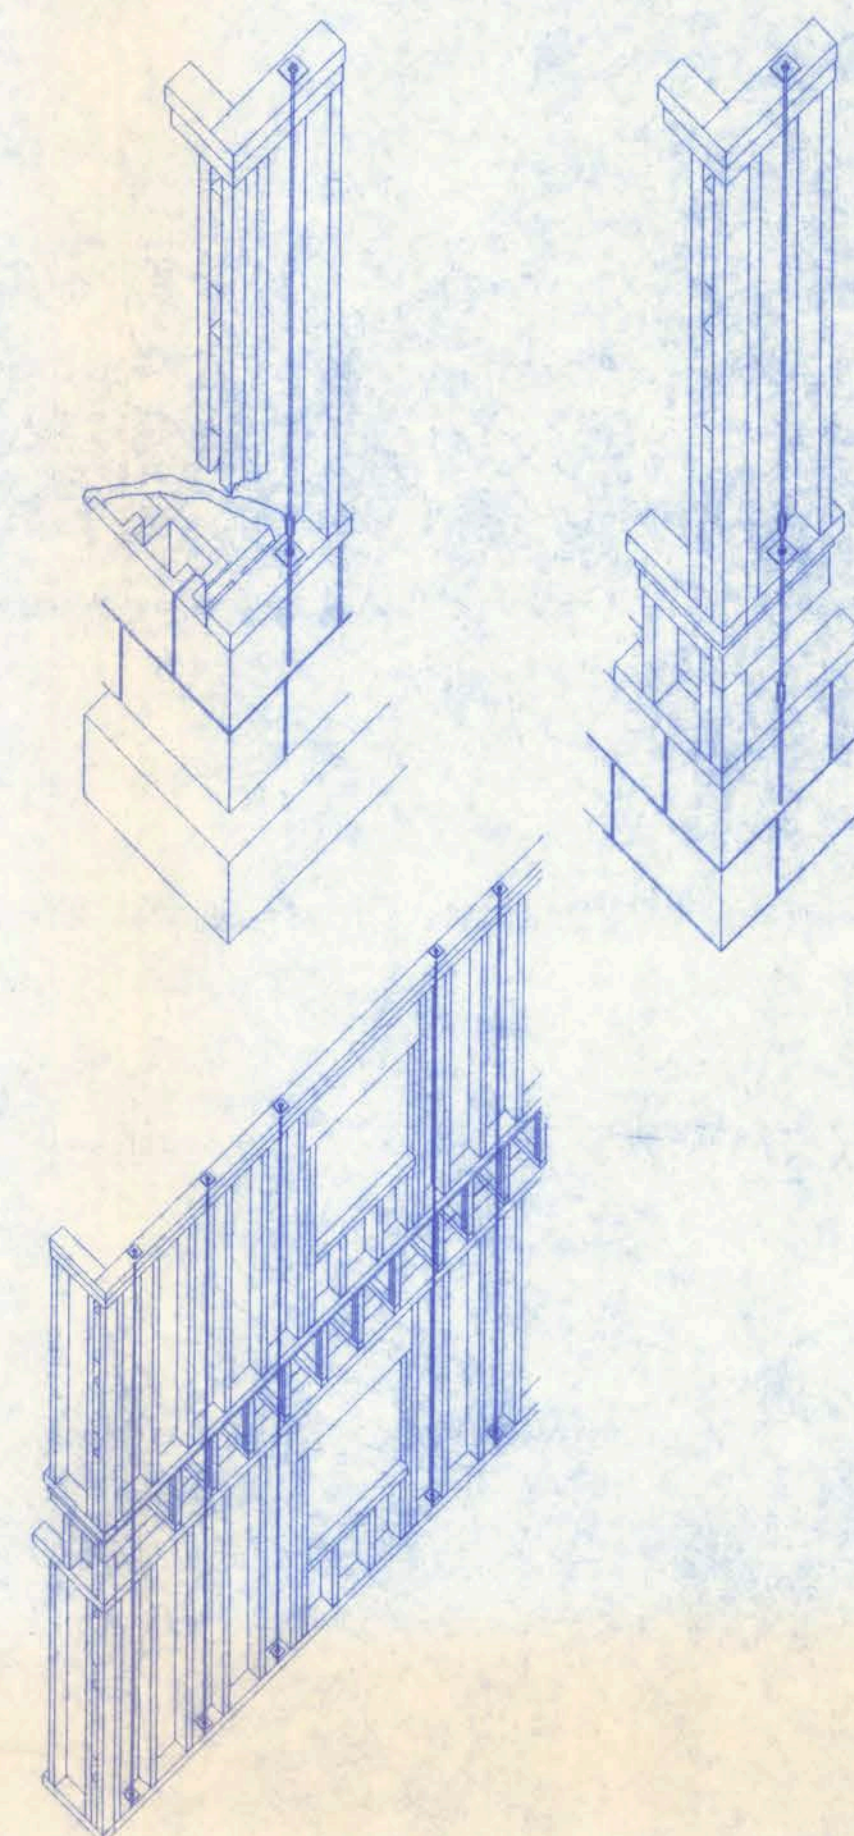

## THREAD ROD LOCATIONS

SCALE: 1/8" = 1'-0"

Walter H. Freeman  
9/25/07  
P.E. 56001

EQUESTRIAN MANAGER'S  
RESIDENCE

161 NW MADISON STREET  
SUITE 102  
LAKE CITY, FL 32055  
(386)758-4209

CERTIFICATE OF AUTHORIZATION # 0008901

Freeman  
Design Group, Inc.

DATE  
9/25/07

DRAWN BY  
J.T.D.

APPROVED  
W.H.F.

REVISIONS

SHEET S-1

OF 1

PROJECT NO.  
07.C040