

INPUT SUMMARY CHECKLIST REPORT

PROJECT

| | | | | | |
|----------------|----------------------|--------------------|------|--------------------|---------------------|
| Title: | Capital Metal Supply | Bedrooms: | 1 | Address Type: | Street Address |
| Building Type: | User | ConditionedArea: | 4000 | Lot # | |
| Owner Name: | | Total Stories: | 1 | Block/Subdivision: | |
| # of Units: | 1 | Worst Case: | No | PlatBook: | |
| BuilderName: | | RotateAngle: | 0 | Street: | |
| Permit Office: | ColumbiaCounty | Cross Ventilation: | Yes | County: | Columbia |
| Jurisdiction: | | Whole House Fan: | No | City, State, Zip: | Lake City , FL , |
| Family Type: | Single-family | | | | |
| New/Existing: | New (From Plans) | | | | |
| Comment: | | | | | |

CLIMATE

| | | | | | | | | | |
|-------|-----------------|---------------------|-----------------------|-------|---------------------------|--------|-----------------------|--------------------|---------------------|
| ✓ | Design Location | TMY Site | Design Temp 97.5 % | 2.5 % | Int Design Temp Winter | Summer | Heating DegreeDays | Design Moisture | Daily Temp Range |
| _____ | FL, Gainesville | FL_GAINESVILLE_REGI | 32 | 92 | 70 | 75 | 1305.5 | 51 | Medium |

BLOCKS

| Number | Name | Area | Volume |
|--------|--------|------|--------|
| 1 | Block1 | 4000 | 48000 |

SPACES

| Number | Name | Area | Volume | Kitchen | Occupants | Bedrooms | Infil ID | Finished | Cooled | Heated |
|--------|------|------|--------|---------|-----------|----------|----------|----------|--------|--------|
| 1 | Main | 4000 | 48000 | Yes | 8 | 1 | 1 | Yes | Yes | Yes |

FLOORS

| | | | | | | | | | | |
|-------|---|-------------------------------|-------|-----------|---------|----------|------|------|------|--------|
| ✓ | # | Floor Type | Space | Perimeter | R-Value | Area | | Tile | Wood | Carpet |
| _____ | 1 | Slab-On-Grade Edge Insulation | Main | 260 ft | 0 | 4000 ft² | ---- | 0 | 0 | 1 |

ROOF

| | | | | | | | | | | | | | |
|-------|---|---------------|----------------------|--------------|---------------|---------------|-------------|-----------------|--------------|-----------------|-----------------|----------------|----------------|
| ✓ | # | Type | Materials | Roof Area | Gable Area | Roof Color | Rad Barr | Solar Absor. | SA Tested | Emitt Tested | Emitt Tested | Deck Insul. | Pitch (deg) |
| _____ | 1 | Gable or shed | Composition shingles | 4474 ft² | 1002 ft² | Medium | Y | 0.96 | No | 0.9 | No | 38 | 26.6 |

ATTIC

| | | | | | | | |
|-------|---|------------|-------------|-------------------|----------|-----|------|
| ✓ | # | Type | Ventilation | Vent Ratio (1 in) | Area | RBS | IRCC |
| _____ | 1 | Full attic | Vented | 300 | 4000 ft² | Y | N |

CEILING

| | | | | | | | | |
|-------|---|----------------------|-------|---------|-------------|----------|--------------|------------|
| ✓ | # | Ceiling Type | Space | R-Value | Ins Type | Area | Framing Frac | Truss Type |
| _____ | 1 | Under Attic (Vented) | Main | 38 | Double Batt | 4000 ft² | 0.11 | Wood |

INPUT SUMMARY CHECKLIST REPORT

WALLS

| ✓ # | Ornt | Adjacent To | Wall Type | Space | Cavity R-Value | Width Ft In | Height Ft In | Area | Sheathing R-Value | Framing Fraction | Solar Absor. | Below Grade% |
|-------|------|-------------|--------------|-------|----------------|-------------|--------------|-----------|-------------------|------------------|--------------|--------------|
| ___ 1 | N | Exterior | Frame - Wood | Main | 19 | 80 | 12 | 960.0 ft² | | 0.23 | 0.75 | 0 |
| ___ 2 | W | Exterior | Frame - Wood | Main | 19 | 50 | 12 | 600.0 ft² | | 0.23 | 0.75 | 0 |
| ___ 3 | S | Exterior | Frame - Wood | Main | 19 | 80 | 12 | 960.0 ft² | | 0.23 | 0.75 | 0 |
| ___ 4 | E | Exterior | Frame - Wood | Main | 19 | 50 | 12 | 600.0 ft² | | 0.23 | 0.75 | 0 |

DOORS

| ✓ # | Ornt | Door Type | Space | Storms | U-Value | Width Ft In | Height Ft In | Area |
|-------|------|-----------|-------|--------|---------|-------------|--------------|--------|
| ___ 1 | S | Insulated | Main | None | .46 | 3 | 6 8 | 20 ft² |

WINDOWS

Orientation shown is the entered, Proposed orientation.

| ✓ # | Ornt | Wall ID | Frame | Panes | NFRC | U-Factor | SHGC | Imp | Area | Overhang Depth | Separation | Int Shade | Screening |
|-------|------|---------|-------|--------------|------|----------|------|-----|-----------|----------------|------------|-----------|-----------|
| ___ 1 | N | 1 | Metal | Low-E Double | Yes | 0.36 | 0.25 | N | 160.0 ft² | 7 ft 6 in | 2 ft 0 in | None | None |
| ___ 2 | N | 1 | Metal | Low-E Double | Yes | 0.36 | 0.25 | N | 54.0 ft² | 7 ft 6 in | 2 ft 0 in | None | None |
| ___ 3 | W | 2 | Metal | Low-E Double | Yes | 0.36 | 0.25 | N | 52.5 ft² | 1 ft 0 in | 4 ft 0 in | None | None |
| ___ 4 | S | 3 | Metal | Low-E Double | Yes | 0.36 | 0.25 | N | 52.5 ft² | 1 ft 6 in | 2 ft 0 in | None | None |
| ___ 5 | E | 4 | Metal | Low-E Double | Yes | 0.36 | 0.25 | N | 52.5 ft² | 1 ft 0 in | 4 ft 0 in | None | None |

INFILTRATION

| # | Scope | Method | SLA | CFM 50 | ELA | EqLA | ACH | ACH 50 |
|---|------------|------------------|---------|--------|--------|--------|-------|--------|
| 1 | Wholehouse | Proposed ACH(50) | .000381 | 4000 | 219.59 | 412.98 | .1687 | 5 |

HEATING SYSTEM

| ✓ # | System Type | Subtype | Speed | Efficiency | Capacity | Block | Ducts |
|-------|---------------------|---------|--------|------------|---------------|-------|-------|
| ___ 1 | Electric Heat Pump/ | None | Single | HSPF:8.2 | 51.67 kBtu/hr | 1 | sys#1 |

COOLING SYSTEM

| ✓ # | System Type | Subtype | Subtype | Efficiency | Capacity | Air Flow | SHR | Block | Ducts |
|-------|---------------|---------|---------|------------|---------------|----------|-----|-------|-------|
| ___ 1 | Central Unit/ | None | Single | SEER: 14 | 40.06 kBtu/hr | 1200 cfm | 0.7 | 1 | sys#1 |

HOT WATER SYSTEM

| ✓ # | System Type | SubType | Location | EF | Cap | Use | SetPnt | Conservation |
|-------|-------------|---------|----------|------|--------|--------|---------|--------------|
| ___ 1 | Electric | None | Main | 0.92 | 50 gal | 40 gal | 120 deg | None |

INPUT SUMMARY CHECKLIST REPORT

SOLAR HOT WATER SYSTEM

| | | | | | | | |
|-------|----------------|-------------|----------------|-------------------|-------------------|-------------------|-----|
| ✓ | FSEC Cert # | CompanyName | System Model # | Collector Model # | Collector Area | Storage Volume | FEF |
| _____ | None | None | | | ft² | | |

DUCTS

| | | | | | | | | | | | | | | |
|-------|---|------------------------------|---------|----------|------------------------------|---------|----------------|----------------|---------------|--------------|----|-----|----------------|------|
| ✓ | # | ---- Supply ---- Location | R-Value | Area | ---- Return ---- Location | Area | LeakageType | Air Handler | CFM 25 TOT | CFM25 OUT | QN | RLF | HVAC # Heat | Cool |
| _____ | 1 | Attic | 6 | 1000 ft² | Attic | 200 ft² | DefaultLeakage | Main | (Default) c | (Default) c | | | 1 | 1 |

TEMPERATURES

| | | | | | | | | | | | | | | |
|---|---|---|---|---|------------------------------|---|---|---|---|---|---|---|----|--|
| ProgramableThermostat: Y | | Ceiling Fans: | | | | | | | | | | | | |
| Cooling | <input type="checkbox"/> Jan | <input type="checkbox"/> Feb | <input type="checkbox"/> Mar | <input type="checkbox"/> Apr | <input type="checkbox"/> May | <input checked="" type="checkbox"/> Jun | <input checked="" type="checkbox"/> Jul | <input checked="" type="checkbox"/> Aug | <input checked="" type="checkbox"/> Sep | <input type="checkbox"/> Oct | <input type="checkbox"/> Nov | <input type="checkbox"/> Dec | | |
| Heating | <input checked="" type="checkbox"/> Jan | <input checked="" type="checkbox"/> Feb | <input checked="" type="checkbox"/> Mar | <input checked="" type="checkbox"/> Apr | <input type="checkbox"/> May | <input type="checkbox"/> Jun | <input type="checkbox"/> Jul | <input type="checkbox"/> Aug | <input type="checkbox"/> Sep | <input type="checkbox"/> Oct | <input checked="" type="checkbox"/> Nov | <input checked="" type="checkbox"/> Dec | | |
| Venting | <input type="checkbox"/> Jan | <input type="checkbox"/> Feb | <input checked="" type="checkbox"/> Mar | <input checked="" type="checkbox"/> Apr | <input type="checkbox"/> May | <input type="checkbox"/> Jun | <input type="checkbox"/> Jul | <input type="checkbox"/> Aug | <input type="checkbox"/> Sep | <input checked="" type="checkbox"/> Oct | <input checked="" type="checkbox"/> Nov | <input type="checkbox"/> Dec | | |
| ThermostatSchedule: HERS 2006 Reference | | Hours | | | | | | | | | | | | |
| ScheduleType | | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | |
| Cooling (WD) | AM | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 80 | 80 | 80 | 80 | |
| | PM | 80 | 80 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | |
| Cooling (WEH) | AM | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | |
| | PM | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | 78 | |
| Heating (WD) | AM | 66 | 66 | 66 | 66 | 66 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | |
| | PM | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 66 | |
| Heating (WEH) | AM | 66 | 66 | 66 | 66 | 66 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | |
| | PM | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 68 | 66 | |

MASS

| | | | | |
|-----------------------|-------|-----------|-------------------|-------|
| Mass Type | Area | Thickness | FurnitureFraction | Space |
| Default(8 lbs/sq.ft.) | 0 ft² | 0 ft | 0.3 | Main |

ENERGY PERFORMANCE LEVEL (EPL) DISPLAY CARD

ESTIMATED ENERGY PERFORMANCE INDEX* = 80

The lower the Energy Performance Index, the more efficient the home.

| | | | |
|---------------------------------------|----------------------------|---|--------------------------|
| 1. New home or, addition | 1. <u>New (From Plans)</u> | 12. Ducts, location & insulation level | |
| 2. Single-family or multiple-family | 2. <u>Single-family</u> | a) Supply ducts | R <u>6.0</u> |
| 3. No. of units (if multiple-family) | 3. <u>1</u> | b) Return ducts | R <u>6.0</u> |
| 4. Number of bedrooms | 4. <u>1</u> | c) AHU location | Main |
| 5. Is this a worst case? (yes/no) | 5. <u>No</u> | 13. Cooling system: | Capacity <u>40.1</u> |
| 6. Conditioned floor area (sq. ft.) | 6. <u>4000</u> | a) Split system | SEER <u> </u> |
| 7. Windows, type and area | | b) Single package | SEER <u> </u> |
| a) U-factor:(weighted average) | 7a. <u>0.360</u> | c) Ground/water source | SEER/COP <u> </u> |
| b) Solar Heat Gain Coefficient (SHGC) | 7b. <u>0.250</u> | d) Room unit/PTAC | EER <u> </u> |
| c) Area | 7c. <u>371.5</u> | e) Other | <u>14.0</u> |
| 8. Skylights | | 14. Heating system: | Capacity <u>51.7</u> |
| a) U-factor:(weighted average) | 8a. <u>NA</u> | a) Split system heat pump | HSPF <u> </u> |
| b) Solar Heat Gain Coefficient (SHGC) | 8b. <u>NA</u> | b) Single package heat pump | HSPF <u> </u> |
| 9. Floor type, insulation level: | | c) Electric resistance | COP <u> </u> |
| a) Slab-on-grade (R-value) | 9a. <u>0.0</u> | d) Gas furnace, natural gas | AFUE <u> </u> |
| b) Wood, raised (R-value) | 9b. <u> </u> | e) Gas furnace, LPG | AFUE <u> </u> |
| c) Concrete, raised (R-value) | 9c. <u> </u> | f) Other | <u>8.20</u> |
| 10. Wall type and insulation: | | 15. Water heating system | |
| A. Exterior: | | a) Electric resistance | EF <u>0.92</u> |
| 1. Wood frame (Insulation R-value) | 10A1. <u>19.0</u> | b) Gas fired, natural gas | EF <u> </u> |
| 2. Masonry (Insulation R-value) | 10A2. <u> </u> | c) Gas fired, LPG | EF <u> </u> |
| B. Adjacent: | | d) Solar system with tank | EF <u> </u> |
| 1. Wood frame (Insulation R-value) | 10B1. <u> </u> | e) Dedicated heat pump with tank | EF <u> </u> |
| 2. Masonry (Insulation R-value) | 10B2. <u> </u> | f) Heat recovery unit | HeatRec% <u> </u> |
| 11. Ceiling type and insulation level | | g) Other | |
| a) Under attic | 11a. <u>38.0</u> | 16. HVAC credits claimed (Performance Method) | |
| b) Single assembly | 11b. <u> </u> | a) Ceiling fans | <u> </u> |
| c) Knee walls/skylight walls | 11c. <u> </u> | b) Cross ventilation | <u>Yes</u> |
| d) Radiant barrier installed | 11d. <u>Yes</u> | c) Whole house fan | <u>No</u> |
| | | d) Multizone cooling credit | <u> </u> |
| | | e) Multizone heating credit | <u> </u> |
| | | f) Programmable thermostat | <u>Yes</u> |

*Label required by Section R303.1.3 of the Florida Building Code, Energy Conservation, if not DEFAULT.

I certify that this home has complied with the Florida Building Code, Energy Conservation, through the above energy saving features which will be installed (or exceeded) in this home before final inspection. Otherwise, a new EPL display card will be completed based on installed code compliant features.

Builder Signature: _____ Date: _____

Address of New Home: _____ City/FL Zip: Lake City, FL

Envelope Leakage Test Report (Blower Door Test)
Residential Prescriptive, Performance or ERI Method Compliance
2017 Florida Building Code, Energy Conservation, 6th Edition

Jurisdiction:

Permit #:

Job Information

Builder:

Community:

Lot: NA

Address:

City: Lake City

State: FL

Zip:

Air Leakage Test Results *Passing results must meet either the Performance, Prescriptive, or ERI Method*

☐ **PRESCRIPTIVE METHOD**-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding 7 air changes per hour at a pressure of 0.2 inch w.g. (50 Pascals) in Climate Zones 1 and 2.

☐ **PERFORMANCE or ERI METHOD**-The building or dwelling unit shall be tested and verified as having an air leakage rate of not exceeding the selected ACH(50) value, as shown on Form R405-2017 (Performance) or R406-2017 (ERI), section labeled as infiltration, sub-section ACH50.
ACH(50) specified on Form R405-2017-Energy Calc (Performance) or R406-2017 (ERI): 5.000

$$\frac{\text{CFM}(50)}{\text{Building Volume}} \times 60 \div \frac{48000}{\text{ACH}(50)} = \text{PASS}$$

☐ **PASS**

☐ When ACH(50) is less than 3, Mechanical Ventilation installation must be verified by building department.

Method for calculating building volume:

☐ Retrieved from architectural plans

☒ Code software calculated

☐ Field measured and calculated

R402.4.1.2 Testing. Testing shall be conducted in accordance with ANSI/RESNET/ICC 380 and reported at a pressure of 0.2 inch w.g. (50 Pascals). Testing shall be conducted by either individuals as defined in Section 553.993(5) or (7), *Florida Statutes*, or individuals licensed as set forth in Section 489.105(3)(f), (g), or (i) or an approved third party. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. Testing shall be performed at any time after creation of all penetrations of the *building thermal envelope*.

During testing:

1. Exterior windows and doors, fireplace and stove doors shall be closed, but not sealed, beyond the intended weatherstripping or other infiltration control measures.
2. Dampers including exhaust, intake, makeup air, back draft and flue dampers shall be closed, but not sealed beyond intended infiltration control measures.
3. Interior doors, if installed at the time of the test, shall be open.
4. Exterior doors for continuous ventilation systems and heat recovery ventilators shall be closed and sealed.
5. Heating and cooling systems, if installed at the time of the test, shall be turned off.
6. Supply and return registers, if installed at the time of the test, shall be fully open.

Testing Company

Company Name: _____ Phone: _____

I hereby verify that the above Air Leakage results are in accordance with the 2017 6th Edition Florida Building Code Energy Conservation requirements according to the compliance method selected above.

Signature of Tester: _____ Date of Test: _____

Printed Name of Tester: _____

License/Certification #: _____ Issuing Authority: _____

Residential System Sizing Calculation

Summary

Project Title:
Capital Metal Supply

Lake City, FL


12/30/2020

| | | | | | |
|---|--|--|-------------------|---------------------------------------|--|
| Location for weather data: Gainesville, FL - Defaults: Latitude(29.7) Altitude(152 ft.) Temp Range(M) | | | | | |
| Humidity data: Interior RH (50%) Outdoor wet bulb (77F) Humidity difference(51gr.) | | | | | |
| Winter design temperature(TMY3 99%) | | | 30 F | Summer design temperature(TMY3 99%) | |
| Winter setpoint | | | 70 F | Summer setpoint | |
| Winter temperature difference | | | 40 F | Summer temperature difference | |
| Total heating load calculation | | | 49722 Btuh | Total cooling load calculation | |
| Submitted heating capacity | | | % of calc Btuh | Submitted cooling capacity | |
| Total (Electric Heat Pump) | | | 103.9 51670 | Sensible (SHR = 0.70) | |
| Heat Pump + Auxiliary(0.0kW) | | | 103.9 51670 | Latent | |
| | | | | Total (Electric Heat Pump) | |
| | | | | 93.8 28043 | |
| | | | | 120.0 12018 | |
| | | | | 100.4 40062 | |

WINTER CALCULATIONS

Winter Heating Load (for 4000 sqft)


| Load component | | Load | |
|------------------------|-----------|-------------------|--|
| Window total | 372 sqft | 5350 Btuh | |
| Wall total | 2729 sqft | 8434 Btuh | |
| Door total | 20 sqft | 368 Btuh | |
| Ceiling total | 4000 sqft | 2174 Btuh | |
| Floor total | 4000 sqft | 12272 Btuh | |
| Infiltration | 216 cfm | 9455 Btuh | |
| Duct loss | | 11669 Btuh | |
| Subtotal | | 49722 Btuh | |
| Ventilation | 0 cfm | 0 Btuh | |
| TOTAL HEAT LOSS | | 49722 Btuh | |

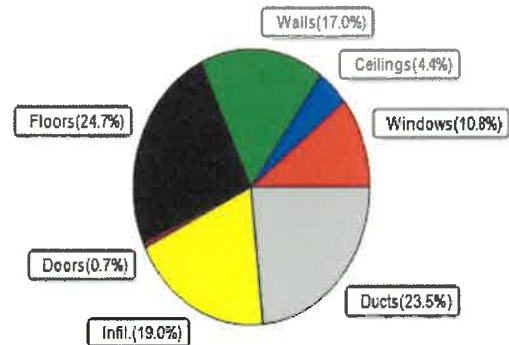

SUMMER CALCULATIONS

Summer Cooling Load (for 4000 sqft)

| Load component | | Load | |
|---------------------------------------|-----------|-------------------|--|
| Window total | 372 sqft | 6473 Btuh | |
| Wall total | 2729 sqft | 4512 Btuh | |
| Door total | 20 sqft | 276 Btuh | |
| Ceiling total | 4000 sqft | 1848 Btuh | |
| Floor total | | 0 Btuh | |
| Infiltration | 162 cfm | 3368 Btuh | |
| Internal gain | | 3240 Btuh | |
| Duct gain | | 10175 Btuh | |
| Sens. Ventilation | 0 cfm | 0 Btuh | |
| Blower Load | | 0 Btuh | |
| Total sensible gain | | 29892 Btuh | |
| Latent gain(ducts) | | 2830 Btuh | |
| Latent gain(infiltration) | | 5589 Btuh | |
| Latent gain(ventilation) | | 0 Btuh | |
| Latent gain(internal/occupants/other) | | 1600 Btuh | |
| Total latent gain | | 10019 Btuh | |
| TOTAL HEAT GAIN | | 39912 Btuh | |

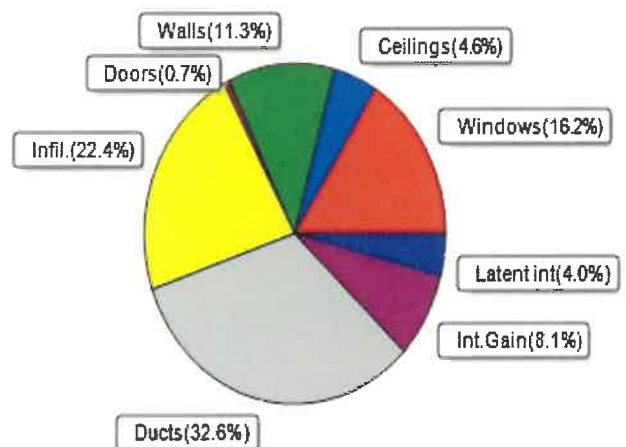

8th Edition

EnergyGauge® System Sizing

PREPARED BY:

DATE:

12/30/2020

System Sizing Calculations - Winter

Residential Load - Whole House Component Details

Lake City, FL

Project Title:
Capital Metal Supply
Building Type: User

12/30/2020

Reference City: Gainesville, FL (Defaults) Winter Temperature Difference: 40.0 F (TMY3 99%)

Component Loads for Whole House

| Window | Panes/Type | Frame | U | Orientation | Area(sqft) | X | HTM= | Load |
|--------------|---|------------|---------|---------------------|------------------|-------|------|------------|
| 1 | 2, NFRC 0.25 | Metal | 0.36 | N | 160.0 | | 14.4 | 2304 Btuh |
| 2 | 2, NFRC 0.25 | Metal | 0.36 | N | 54.0 | | 14.4 | 778 Btuh |
| 3 | 2, NFRC 0.25 | Metal | 0.36 | W | 52.5 | | 14.4 | 756 Btuh |
| 4 | 2, NFRC 0.25 | Metal | 0.36 | S | 52.5 | | 14.4 | 756 Btuh |
| 5 | 2, NFRC 0.25 | Metal | 0.36 | E | 52.5 | | 14.4 | 756 Btuh |
| | Window Total | | | | 371.5(sqft) | | | 5350 Btuh |
| Walls | Type | Ornt. | Ueff. | R-Value (Cav/Sh) | Area | X | HTM= | Load |
| 1 | Frame - Wood | - Ext | (0.077) | 19.0/0.0 | 746 | | 3.09 | 2306 Btuh |
| 2 | Frame - Wood | - Ext | (0.077) | 19.0/0.0 | 548 | | 3.09 | 1692 Btuh |
| 3 | Frame - Wood | - Ext | (0.077) | 19.0/0.0 | 888 | | 3.09 | 2743 Btuh |
| 4 | Frame - Wood | - Ext | (0.077) | 19.0/0.0 | 548 | | 3.09 | 1692 Btuh |
| | Wall Total | | | | 2729(sqft) | | | 8434 Btuh |
| Doors | Type | Storm | Ueff. | | Area | X | HTM= | Load |
| 1 | Insulated - Exterior, n | | (0.460) | | 20 | | 18.4 | 368 Btuh |
| | Door Total | | | | 20(sqft) | | | 368Btuh |
| Ceilings | Type/Color/Surface | | Ueff. | R-Value | Area | X | HTM= | Load |
| 1 | Vented Attic/L/Shing | | (0.014) | 38.0/38.0 | 4000 | | 0.5 | 2174 Btuh |
| | Ceiling Total | | | | 4000(sqft) | | | 2174Btuh |
| Floors | Type | | Ueff. | R-Value | Size | X | HTM= | Load |
| 1 | Slab On Grade | | (1.180) | 0.0 | 260.0 ft(perim.) | | 47.2 | 12272 Btuh |
| | Floor Total | | | | 4000 sqft | | | 12272 Btuh |
| | Envelope Subtotal: | | | | | | | 28597 Btuh |
| Infiltration | Type | Wholehouse | ACH | Volume(cuft) | Wall Ratio | CFM= | | |
| | Natural | | 0.27 | 48000 | 1.00 | 215.9 | | 9455 Btuh |
| Duct load | Average sealed, R6.0, Supply(Att), Return(Att) (DLM of 0.307) | | | | | | | 11669 Btuh |
| All Zones | Sensible Subtotal All Zones | | | | | | | 49722 Btuh |

Manual J Winter Calculations

Residential Load - Component Details (continued)

Lake City, FL

Project Title:
Capital Metal Supply
Building Type: User

12/30/2020

WHOLE HOUSE TOTALS

| | | |
|---------------------------|--------------------------------|------------|
| Totals for Heating | Subtotal Sensible Heat Loss | 49722 Btuh |
| | Ventilation Sensible Heat Loss | 0 Btuh |
| | Total Heat Loss | 49722 Btuh |

EQUIPMENT

| | | |
|-----------------------|---|------------|
| 1. Electric Heat Pump | # | 51670 Btuh |
|-----------------------|---|------------|

Key: Window types - NFRC (Requires U-Factor and Shading coefficient(SHGC) of glass as numerical values)
or - Glass as 'Clear' or 'Tint' (Uses U-Factor and SHGC defaults)
U - (Window U-Factor)
HTM - (ManualJ Heat Transfer Multiplier)



Version 8

System Sizing Calculations - Summer

Residential Load - Whole House Component Details

Project Title:
Capital Metal Supply

Lake City, FL

12/30/2020

Reference City: Gainesville, FL

Temperature Difference: 19.0F(TMY3 99%) Humidity difference: 51gr.

Component Loads for Whole House

| Window | Type* | | | | | | Overhang | | Window Area(sqft) | | | HTM | | Load | | |
|---------------|---|------------|----|------|----|------|-------------|--------|-------------------|---------------|---------------------|----------------|----------|------------|-----------|--|
| | Panes | SHGC | U | InSh | IS | Ornt | Len | Hgt | Gross | Shaded | Unshaded | Shaded | Unshaded | | | |
| 1 | 2 NFRC | 0.25, 0.36 | No | No | N | | 7.5ft. | 2.0ft. | 160.0 | 0.0 | 160.0 | 12 | 12 | 1936 | Btuh | |
| 2 | 2 NFRC | 0.25, 0.36 | No | No | N | | 7.5ft. | 2.0ft. | 54.0 | 0.0 | 54.0 | 12 | 12 | 653 | Btuh | |
| 3 | 2 NFRC | 0.25, 0.36 | No | No | W | | 1.0ft. | 4.0ft. | 52.5 | 0.0 | 52.5 | 12 | 31 | 1624 | Btuh | |
| 4 | 2 NFRC | 0.25, 0.36 | No | No | S | | 1.5ft. | 2.0ft. | 52.5 | 52.5 | 0.0 | 12 | 14 | 635 | Btuh | |
| 5 | 2 NFRC | 0.25, 0.36 | No | No | E | | 1.0ft. | 4.0ft. | 52.5 | 0.0 | 52.5 | 12 | 31 | 1624 | Btuh | |
| | Window Total | | | | | | | | | 372 (sqft) | | | | | 6473 Btuh | |
| Walls | Type | | | | | | U-Value | | R-Value | | Area(sqft) | | HTM | | Load | |
| | | | | | | | | | Cav/Sheath | | | | | | | |
| 1 | Frame - Wood - Ext | | | | | | 0.08 | | 19.0/0.0 | | 746.0 | | 1.7 | | 1234 Btuh | |
| 2 | Frame - Wood - Ext | | | | | | 0.08 | | 19.0/0.0 | | 547.5 | | 1.7 | | 905 Btuh | |
| 3 | Frame - Wood - Ext | | | | | | 0.08 | | 19.0/0.0 | | 887.5 | | 1.7 | | 1468 Btuh | |
| 4 | Frame - Wood - Ext | | | | | | 0.08 | | 19.0/0.0 | | 547.5 | | 1.7 | | 905 Btuh | |
| | Wall Total | | | | | | | | | 2729 (sqft) | | | | | 4512 Btuh | |
| Doors | Type | | | | | | | | Area (sqft) | | HTM | | Load | | | |
| | 1 Insulated - Exterior | | | | | | | | 20.0 | | 13.8 | | 276 Btuh | | | |
| | Door Total | | | | | | | | | 20 (sqft) | | | | | 276 Btuh | |
| Ceilings | Type/Color/Surface | | | | | | U-Value | | R-Value | | Area(sqft) | | HTM | | Load | |
| | 1 Vented Attic/Light/Shingle/RB | | | | | | 0.014 | | 38.0/38.0 | | 4000.0 | | 0.46 | | 1848 Btuh | |
| | Ceiling Total | | | | | | | | | 4000 (sqft) | | | | | 1848 Btuh | |
| Floors | Type | | | | | | | | R-Value | | Size | | HTM | | Load | |
| | 1 Slab On Grade | | | | | | | | 0.0 | | 4000 (ft-perimeter) | | 0.0 | | 0 Btuh | |
| | Floor Total | | | | | | | | | 4000.0 (sqft) | | | | | 0 Btuh | |
| | Envelope Subtotal: | | | | | | | | | | | | | 13109 Btuh | | |
| Infiltration | Type | | | | | | Average ACH | | Volume(cuft) | | Wall Ratio | | CFM= | | Load | |
| | Natural | | | | | | 0.20 | | 48000 | | 1 | | 161.9 | | 3368 Btuh | |
| Internal gain | | | | | | | Occupants | | Btuh/occupant | | Appliance | | Load | | | |
| | | | | | | | 8 | | X 230 | | + | | 1400 | | 3240 Btuh | |
| | Sensible Envelope Load: | | | | | | | | | | | | | 19718 Btuh | | |
| Duct load | Averagesealed, Supply(R6.0-Attic), Return(R6.0-Attic) | | | | | | | | | | | (DGM of 0.516) | | 10175 Btuh | | |
| | Sensible Load All Zones | | | | | | | | | | | | | 29892 Btuh | | |

Manual J Summer Calculations

Residential Load - Component Details (continued)

Project Title: Climate:FL_GAINESVILLE_REGIONAL_A
Capital Metal Supply

Lake City, FL

12/30/2020

WHOLE HOUSE TOTALS

| | | |
|---|---|-------------------|
| Whole House Totals for Cooling | Sensible Envelope Load All Zones | 19718 Btuh |
| | Sensible Duct Load | 10175 Btuh |
| | Total Sensible Zone Loads | 29892 Btuh |
| | Sensible ventilation | 0 Btuh |
| | Blower | 0 Btuh |
| | Total sensible gain | 29892 Btuh |
| | Latent infiltration gain (for 51 gr. humidity difference) | 5589 Btuh |
| | Latent ventilation gain | 0 Btuh |
| | Latent duct gain | 2830 Btuh |
| | Latent occupant gain (8.0 people @ 200 Btuh per person) | 1600 Btuh |
| | Latent other gain | 0 Btuh |
| | Latent total gain | 10019 Btuh |
| | TOTAL GAIN | 39912 Btuh |

EQUIPMENT

| | | |
|-----------------|---|------------|
| 1. Central Unit | # | 40062 Btuh |
|-----------------|---|------------|

*Key: Window types (Panels - Number and type of panes of glass)
(SHGC - Shading coefficient of glass as SHGC numerical value)
(U - Window U-Factor)
(InSh - Interior shading device: none(No), Blinds(B), Draperies(D) or Roller Shades(R))
- For Blinds: Assume medium color, half closed
For Draperies: Assume medium weave, half closed
For Roller shades: Assume translucent, half closed
(IS - Insect screen: none(N), Full(F) or Half($\frac{1}{2}$))
(Ornt - compass orientation)



Version 8