

DATE 07/26/2007

Columbia County Building Permit

PERMIT

This Permit Expires One Year From the Date of Issue

000026061

APPLICANT KEVIN MAY,AGENT FOR KC PETRO PHONE 904.693.3200

ADDRESS 650 TALLEYRAND AVENUE JACKSONVILLE FL 32202

OWNER ABP FL, LLC PHONE 800.727.6706

ADDRESS 694 SE CR 245 LAKE CITY FL 32056

CONTRACTOR K.C PETROLEUM/SCOTT LAMBERSO PHONE 904.693.3200

LOCATION OF PROPERTY SR 100 TO C-245 TO BLUE LINX (OLD GA PACIFIC) ON THE R.

TYPE DEVELOPMENT REPLACE FUEL SYSTEM ESTIMATED COST OF CONSTRUCTION 95000.00

HEATED FLOOR AREA TOTAL AREA HEIGHT STORIES

FOUNDATION WALLS ROOF PITCH FLOOR

LAND USE & ZONING INDUSTRIAL MAX. HEIGHT

Minimum Set Back Requirments: STREET-FRONT REAR SIDE

NO. EX.D.U. FLOOD ZONE X DEVELOPMENT PERMIT NO.

PARCEL ID 03-4S-17-07581-000 SUBDIVISION

LOT BLOCK PHASE UNIT TOTAL ACRES

Culvert Permit No. Culvert Waiver Contractor's License Number Applicant/Owner/Contractor

EXISTING P07-0297 BLK JTH N

Driveway Connection Septic Tank Number LU & Zoning checked by Approved for Issuance New Resident

COMMENTS: NOC ON FILE. LETTER OF AUTHORIZATION ON FILE.

Check # or Cash 1028

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power date/app. by Foundation date/app. by Monolithic date/app. by

Under slab rough-in plumbing date/app. by Slab date/app. by Sheathing/Nailing date/app. by

Framing date/app. by Rough-in plumbing above slab and below wood floor date/app. by

Electrical rough-in date/app. by Heat & Air Duct date/app. by Peri. beam (Lintel) date/app. by

Permanent power date/app. by C.O. Final date/app. by Culvert date/app. by

M/H tie downs, blocking, electricity and plumbing date/app. by Pool date/app. by

Reconnection date/app. by Pump pole date/app. by Utility Pole date/app. by

M/H Pole date/app. by Travel Trailer date/app. by Re-roof date/app. by

BUILDING PERMIT FEE \$ 475.00 CERTIFICATION FEE \$ 0.00 SURCHARGE FEE \$ 0.00

MISC. FEES \$ 0.00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ 0.00 WASTE FEE \$

FLOOD DEVELOPMENT FEE \$ FLOOD ZONE FEE \$ 25.00 CULVERT FEE \$ TOTAL FEE 550.00

INSPECTORS OFFICE CLERKS OFFICE

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.


"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

This Permit Must Be Prominently Posted on Premises During Construction


PLEASE NOTIFY THE COLUMBIA COUNTY BUILDING DEPARTMENT AT LEAST 24 HOURS IN ADVANCE OF EACH INSPECTION, IN ORDER THAT IT MAY BE MADE WITHOUT DELAY OR INCONVENIENCE, PHONE 758-1008. THIS PERMIT IS NOT VALID UNLESS THE WORK AUTHORIZED BY IT IS COMMENCED WITHIN 6 MONTHS AFTER ISSUANCE.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

CROSS-SECTION THRU UNDERGROUND TANK
NOT TO SCALE

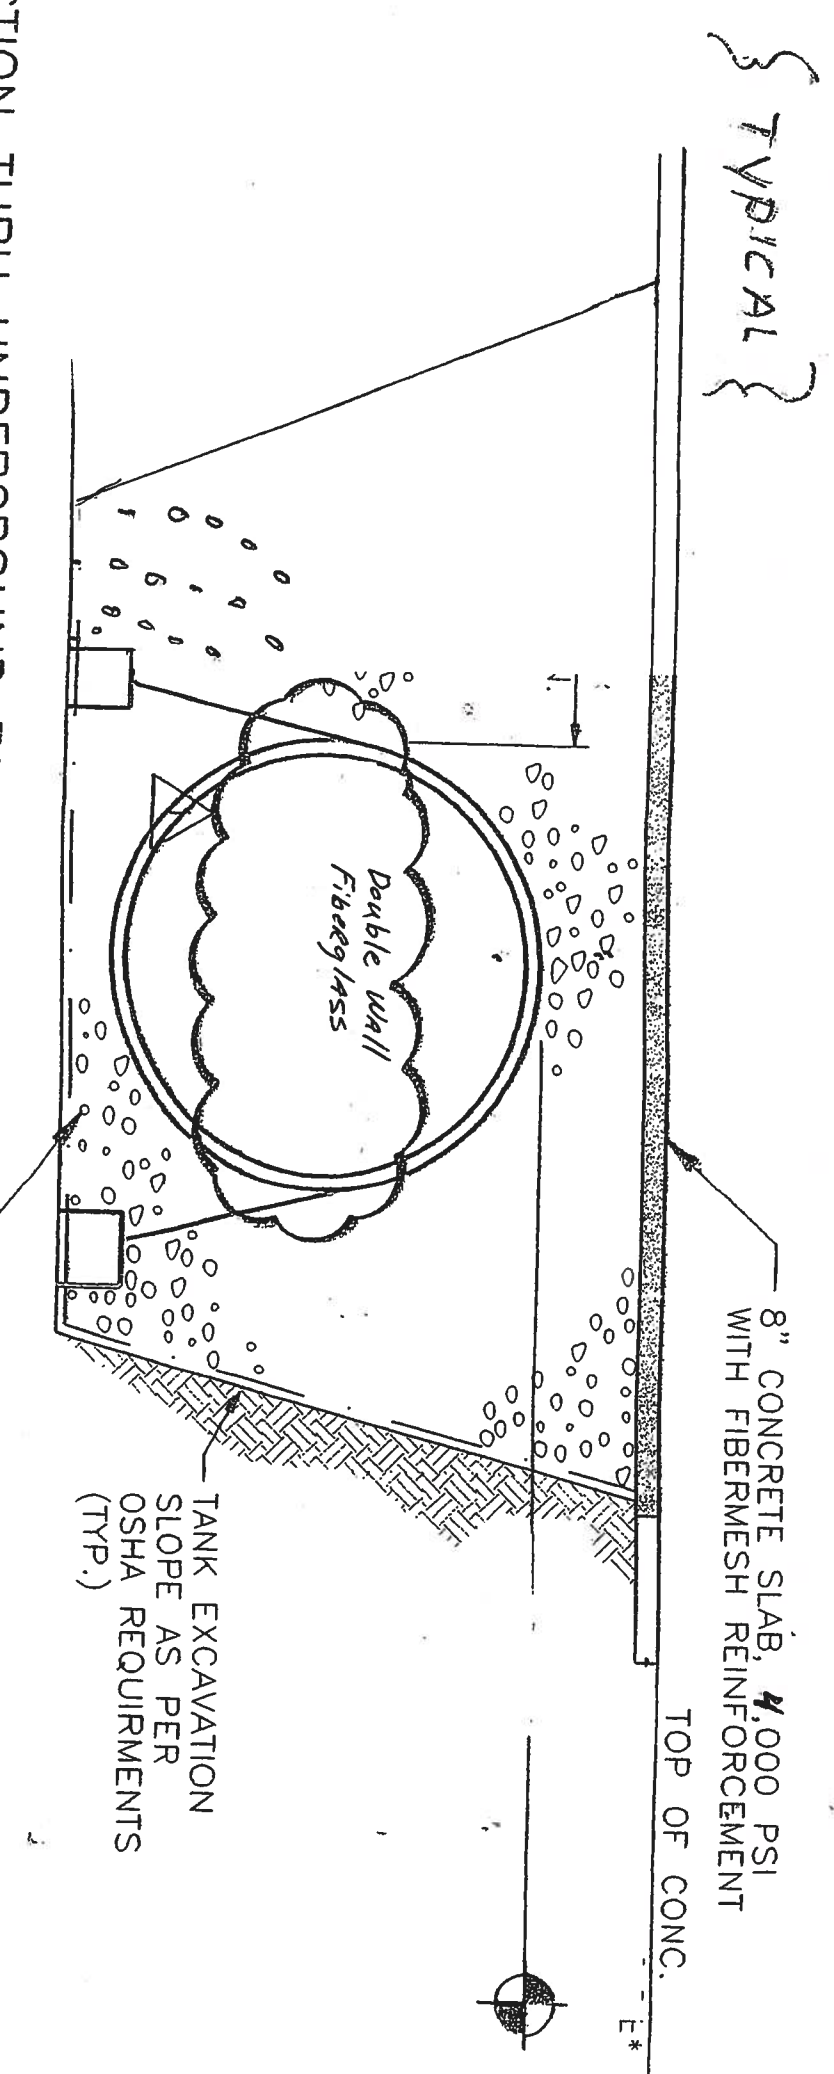


{ TYPICAL }

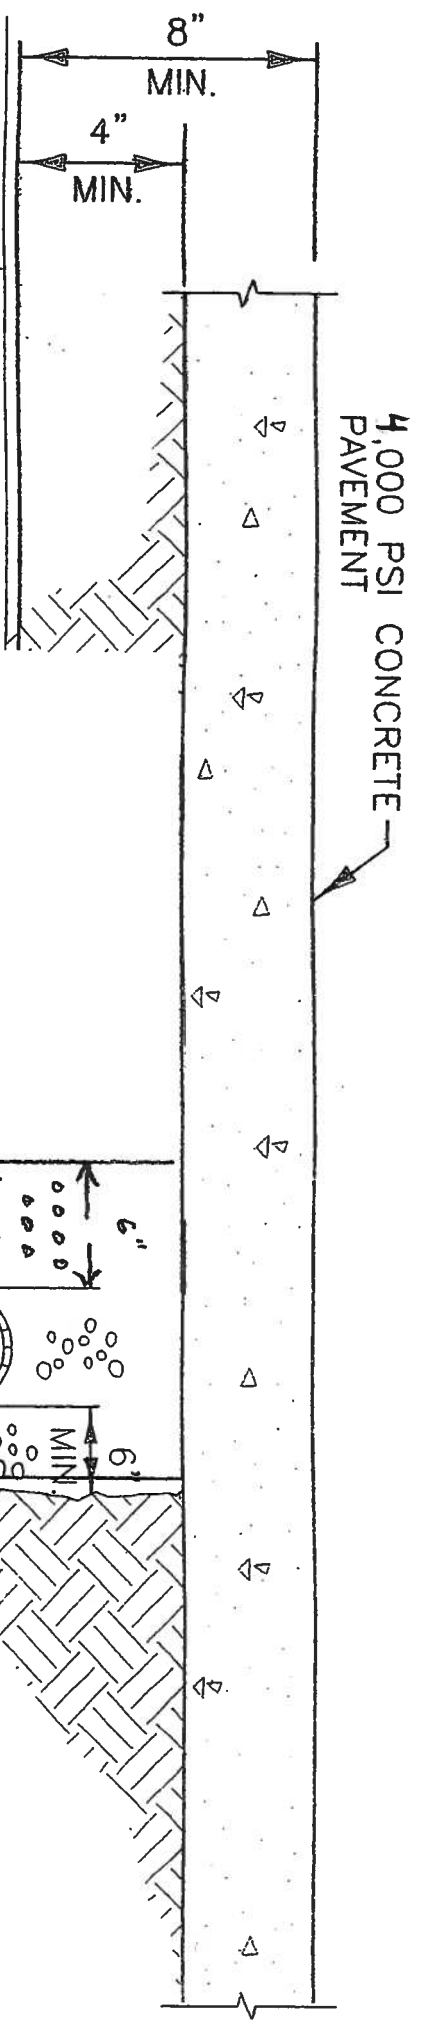


DEPTH MUST PERMIT SLOPING OF PIPE TO
TANK AREA


TYPICAL PIPE BURIAL DETAIL
NOT TO SCALE

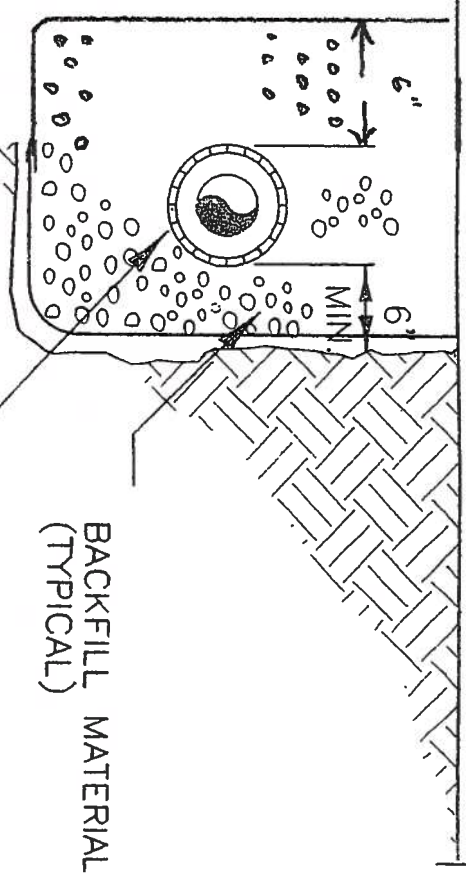

DOUBLE WALL PRODUCT

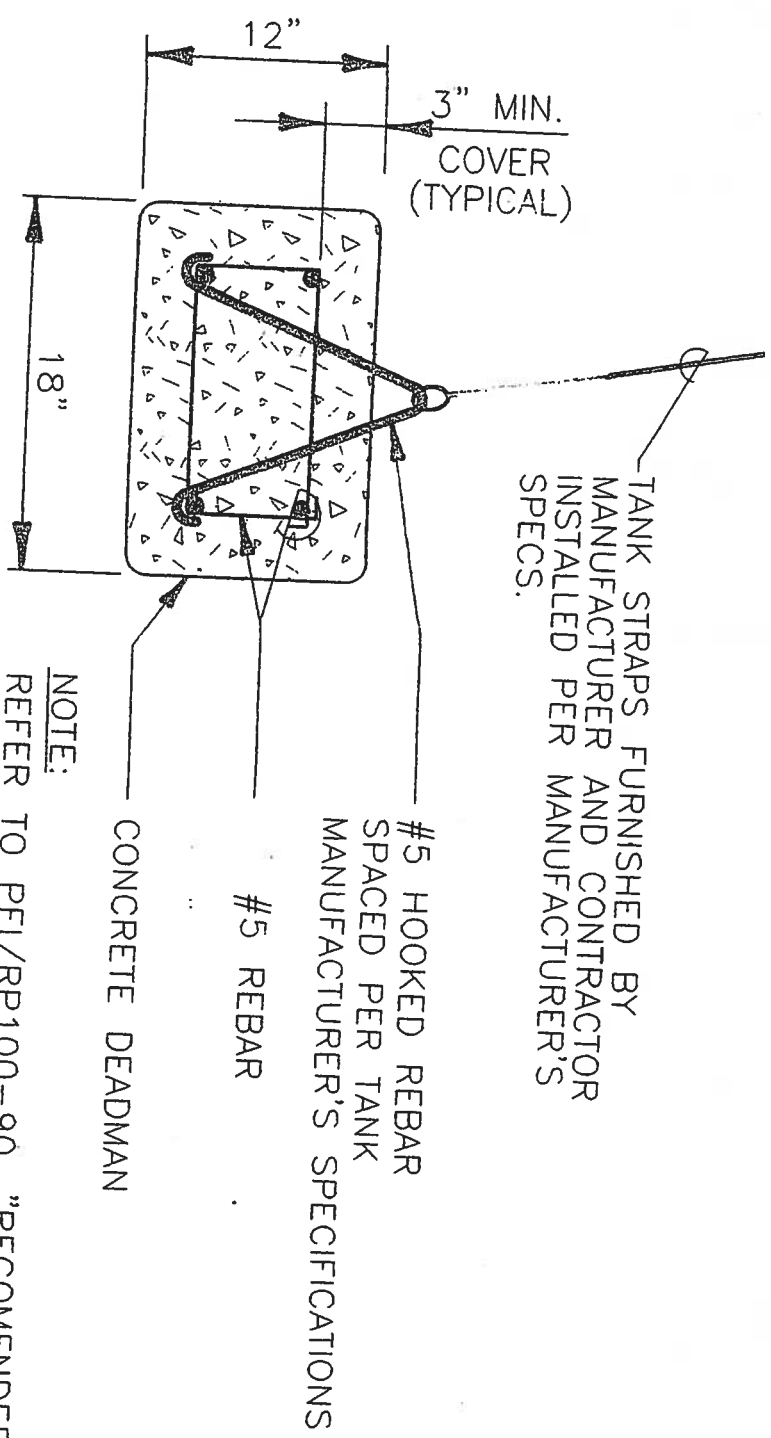

NOTE:
REFER TO PEI/RP100-90, "RECOMMENDED PRACTICES FOR THE INSTALLATION OF UNDERGROUND LIQUID STORAGE TANKS", SECTION 5.

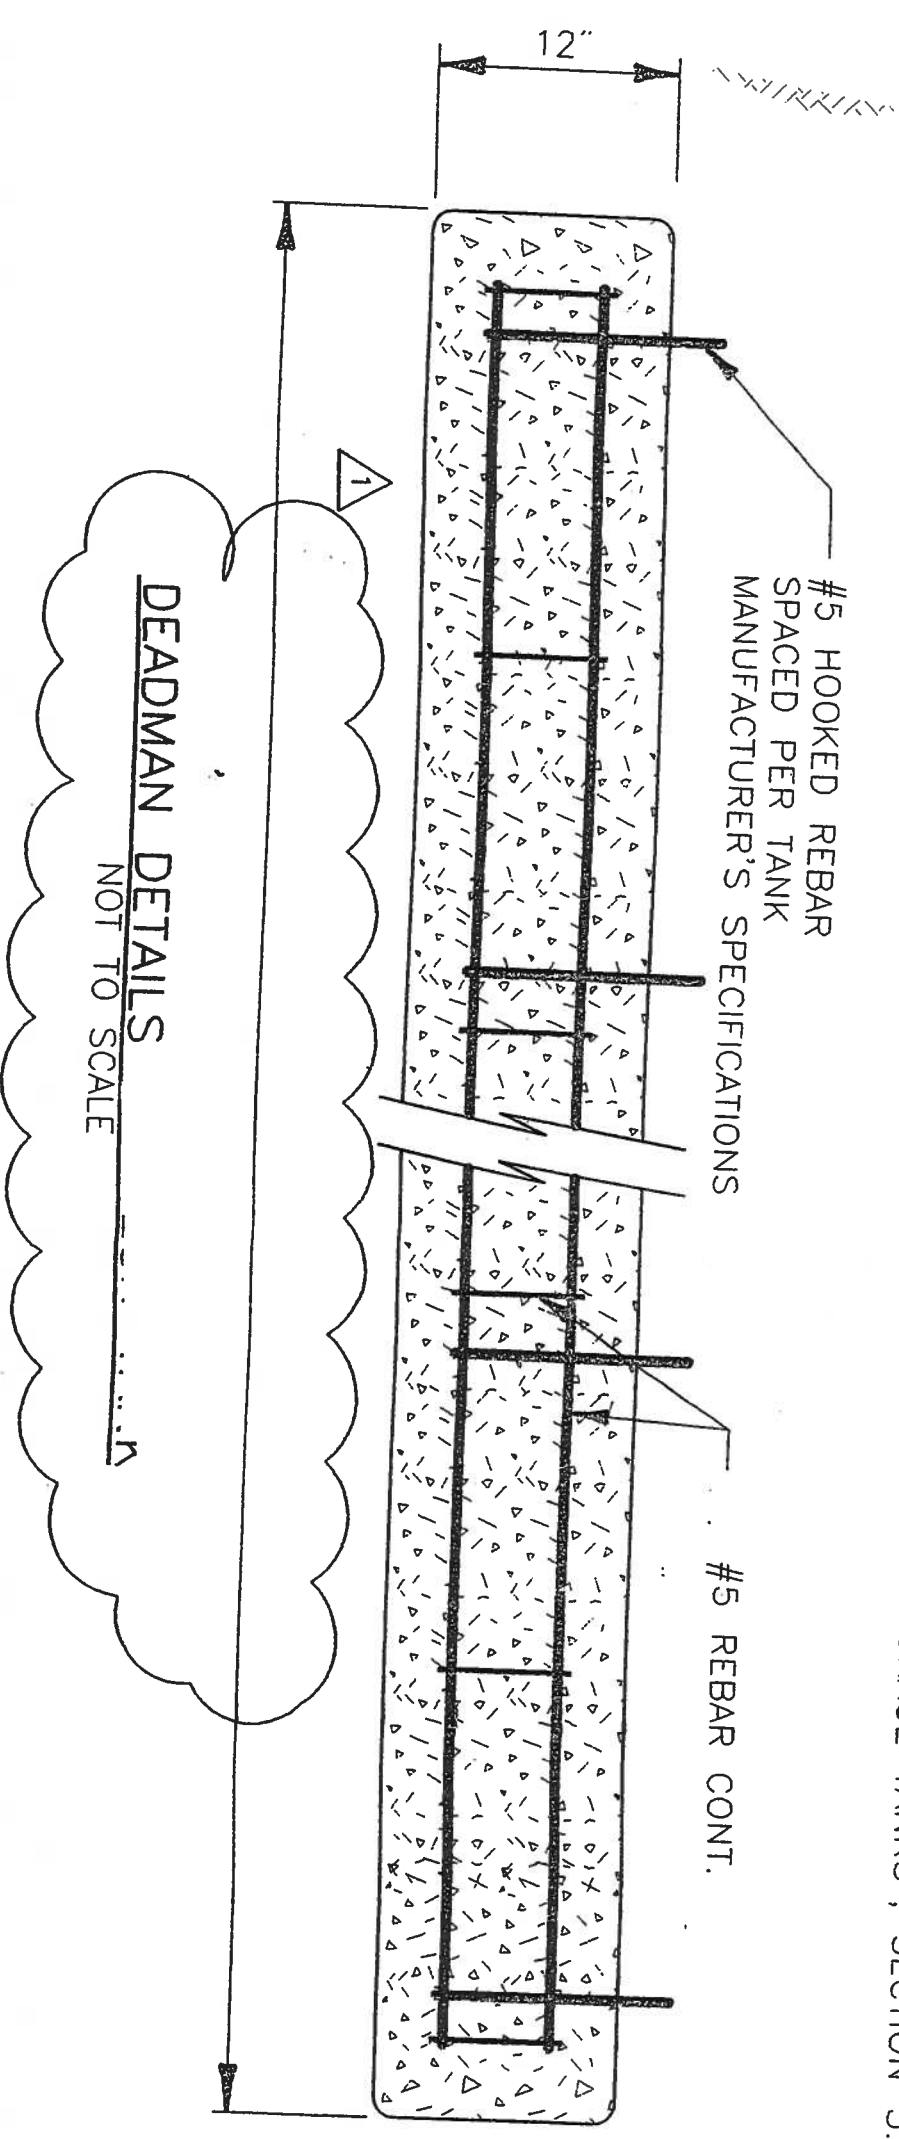

DEADMAN DETAILS
NOT TO SCALE

42 5/16"

42" HANWAY & COVER,
SEE "MATERIAL & EQUIPMENT
SCHEDULE" THIS SHEET

6"
(TYP.)

13/16"

2"

CONTAINMENT SUMP

EXPLOSION PROOF, WEATHER PROOF J-BOX. MIN.
16 CU IN. WITH 3/4" NPT OPENINGS. (AS
REQUIRED) INSTALLED SUCH THAT IT IS EASILY
ACCESSIBLE (TYP.)

SEALING FITTING (TYP.)

3/4" CONDUIT TO ELECTRICAL ROOM

3/4" CONDUIT TO
PROBE

DOUBLE WALL
PRIMARY PRODUCT PIPING

ENTRY
FITTING (TYP.) SEE NOTE 2

TOP OF TANK

SPARE BUNG

FLEX CONNECTOR, SEE
MATERIAL AND EQUIPMENT
SCHEDULE ON THIS SHEET

1 1/2" GALV.
ELL

BALL VALVE

1 1/2" GALV.
NIPPLE

2 HP, VARIABLE SPEED F.E. PETRO SUB-PUMP &
LEAK DETECTOR
60" CABLE (2 WIRE)
SUPPLIED WITH LEAK
SENSOR


2" Ø PVC LIQUID SENSOR
SLEEVE, SUPPLIED BY G.C.
TO BE HUNG FROM CONDUIT
& SECURED WITH STAINLESS
STEEL STRAPS

3/4" CONDUIT
FROM INTERSTICE


SKIRT API COLOR CODED FRP-
OR GALVANIZED

LEAK
SENSOR


2" Ø P.V.C.
SLEEVE




TYPICAL
SUBMERGED
PUMP
SUMP

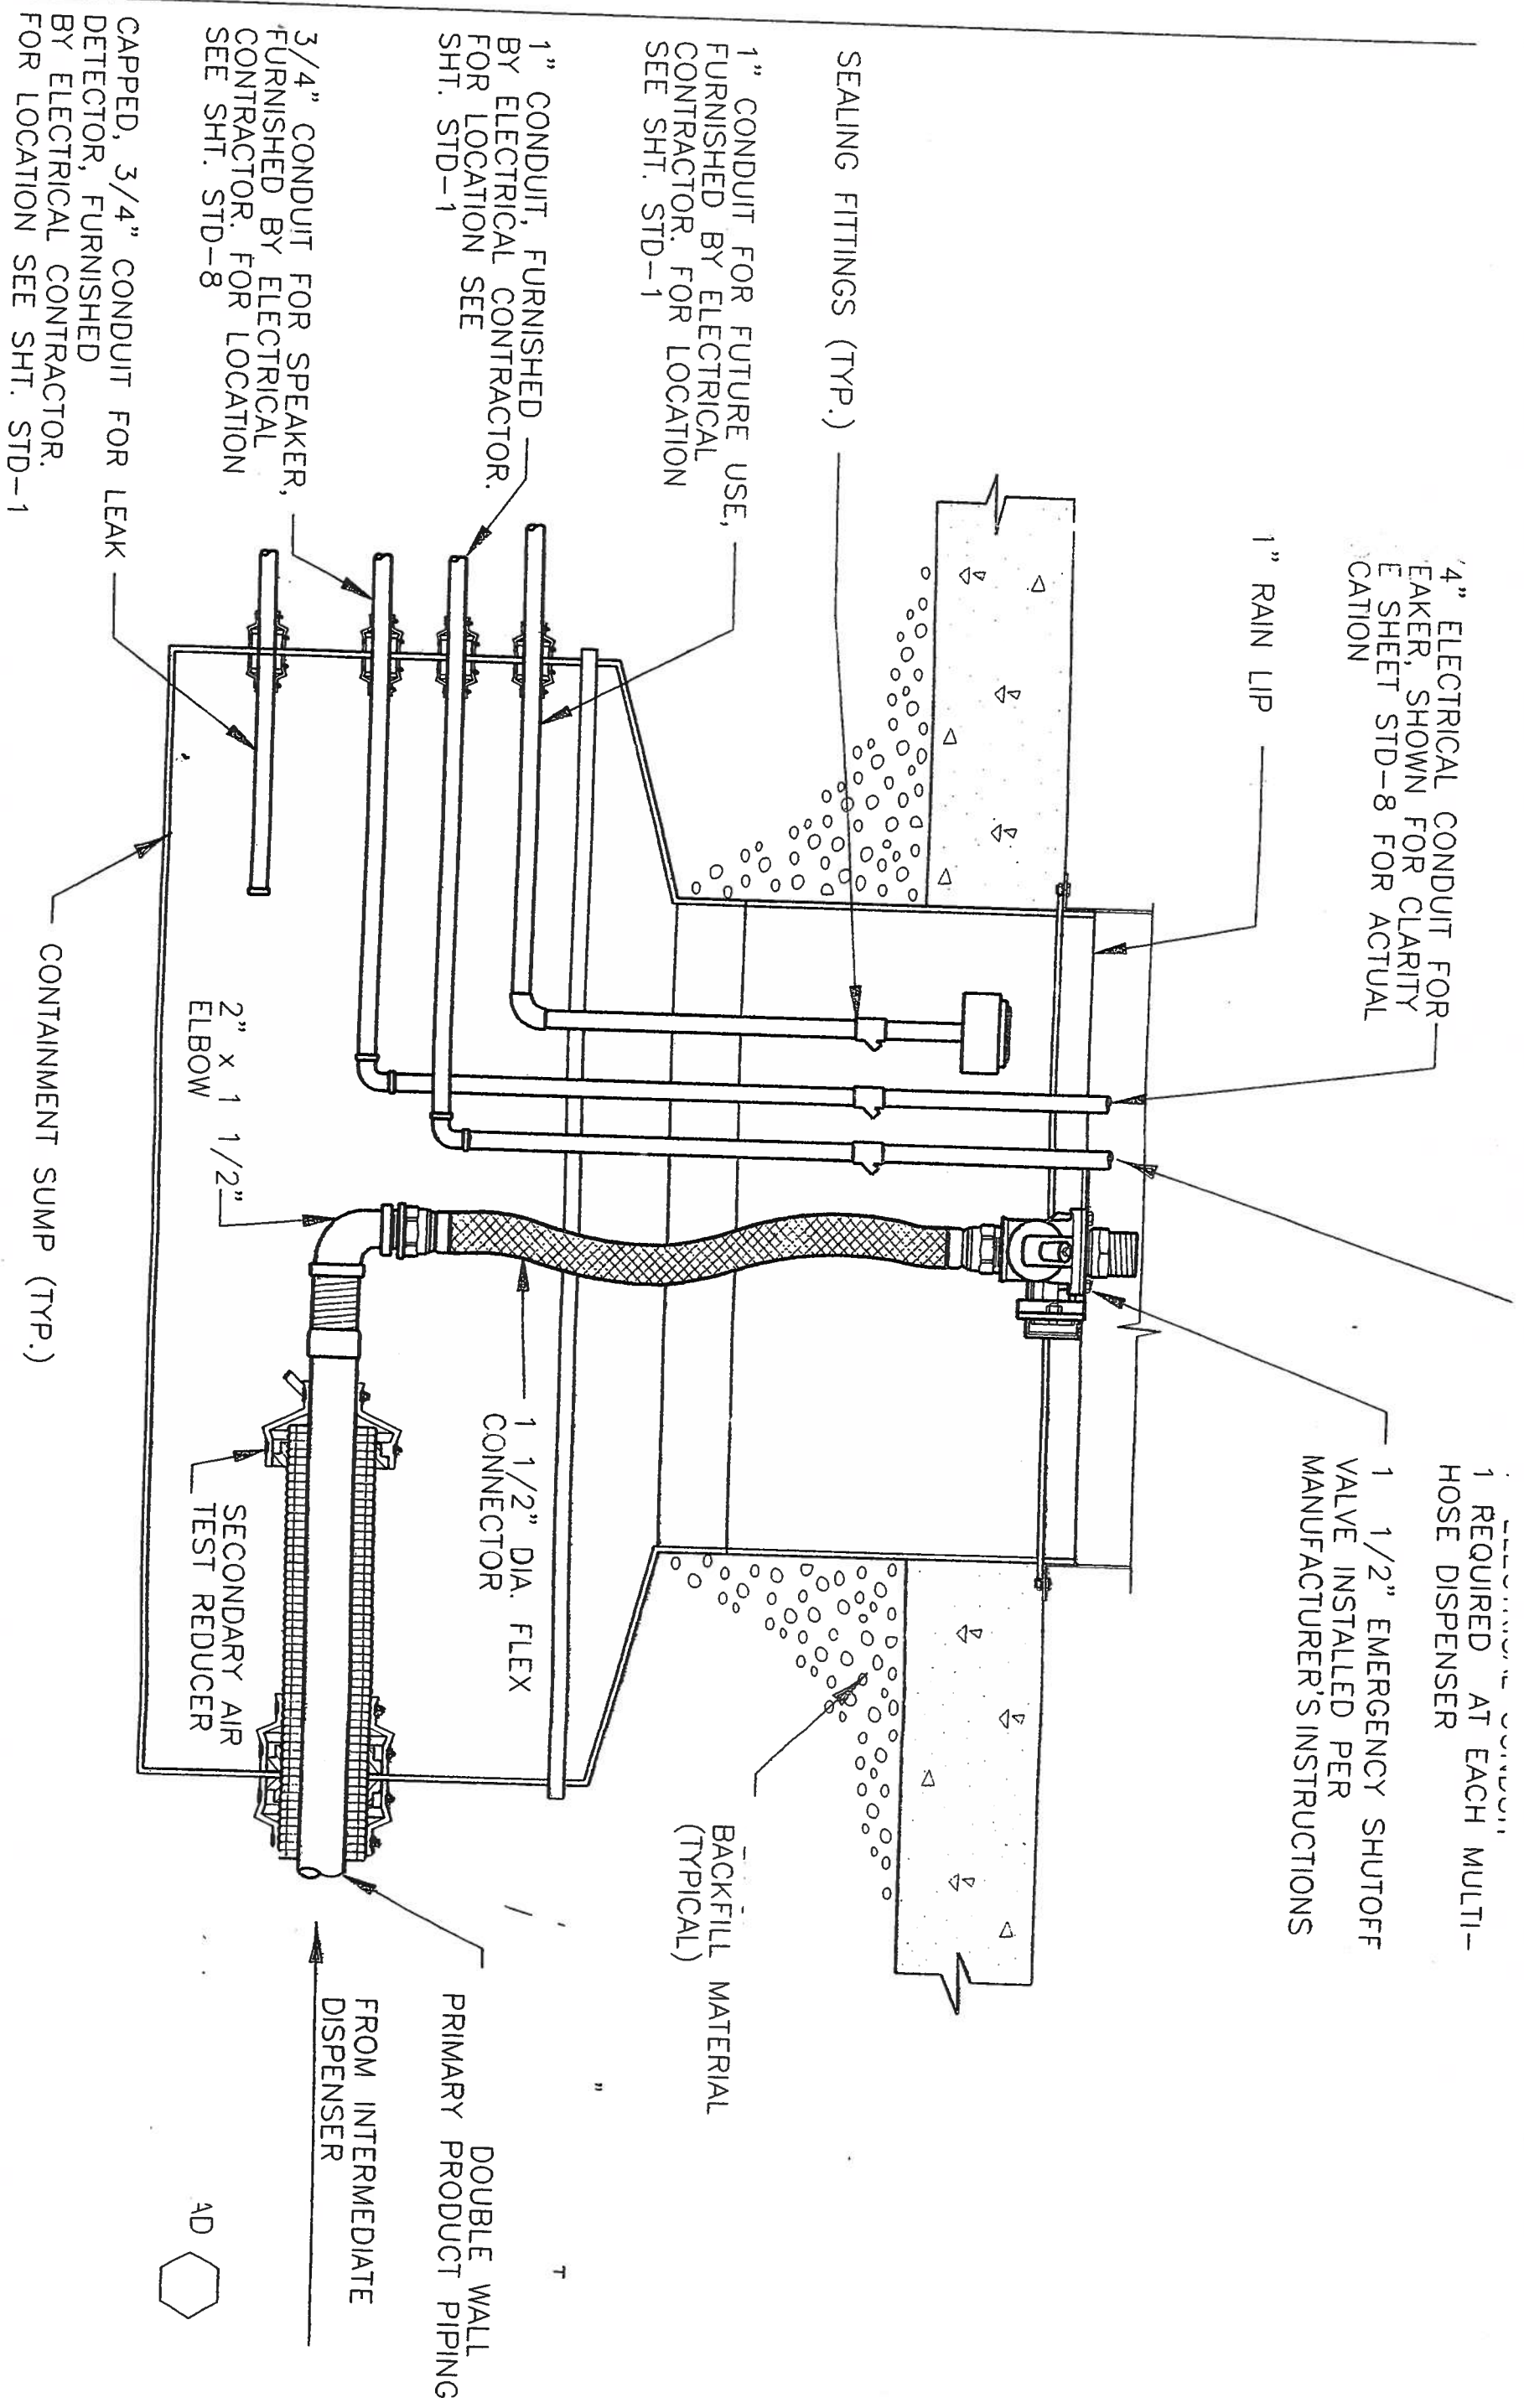

TYPICAL
DISPENSER SIMILAR)
SUMP SECTION AT END GASOLINE DISPENSER
NOT TO SCALE

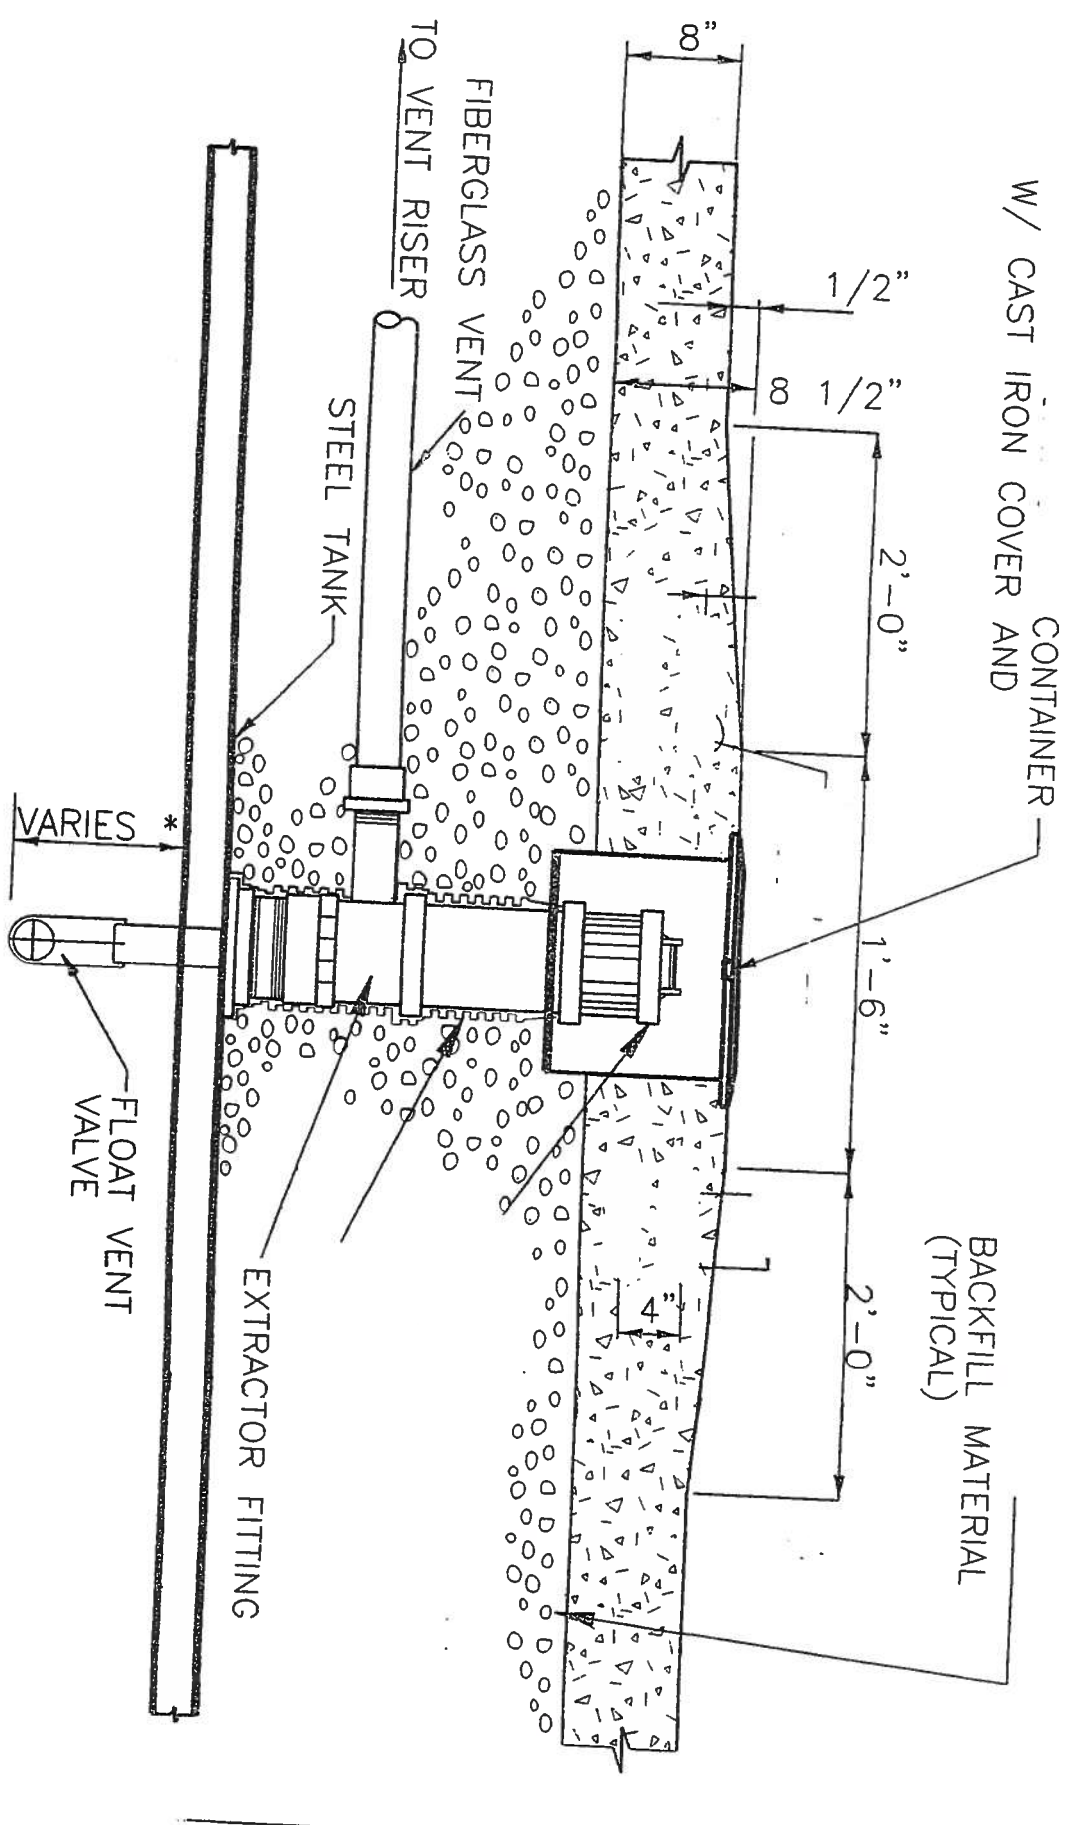

* FOR EXACT VALVE DEPTH FOR EACH TANK,
SEE CHART BELOW.

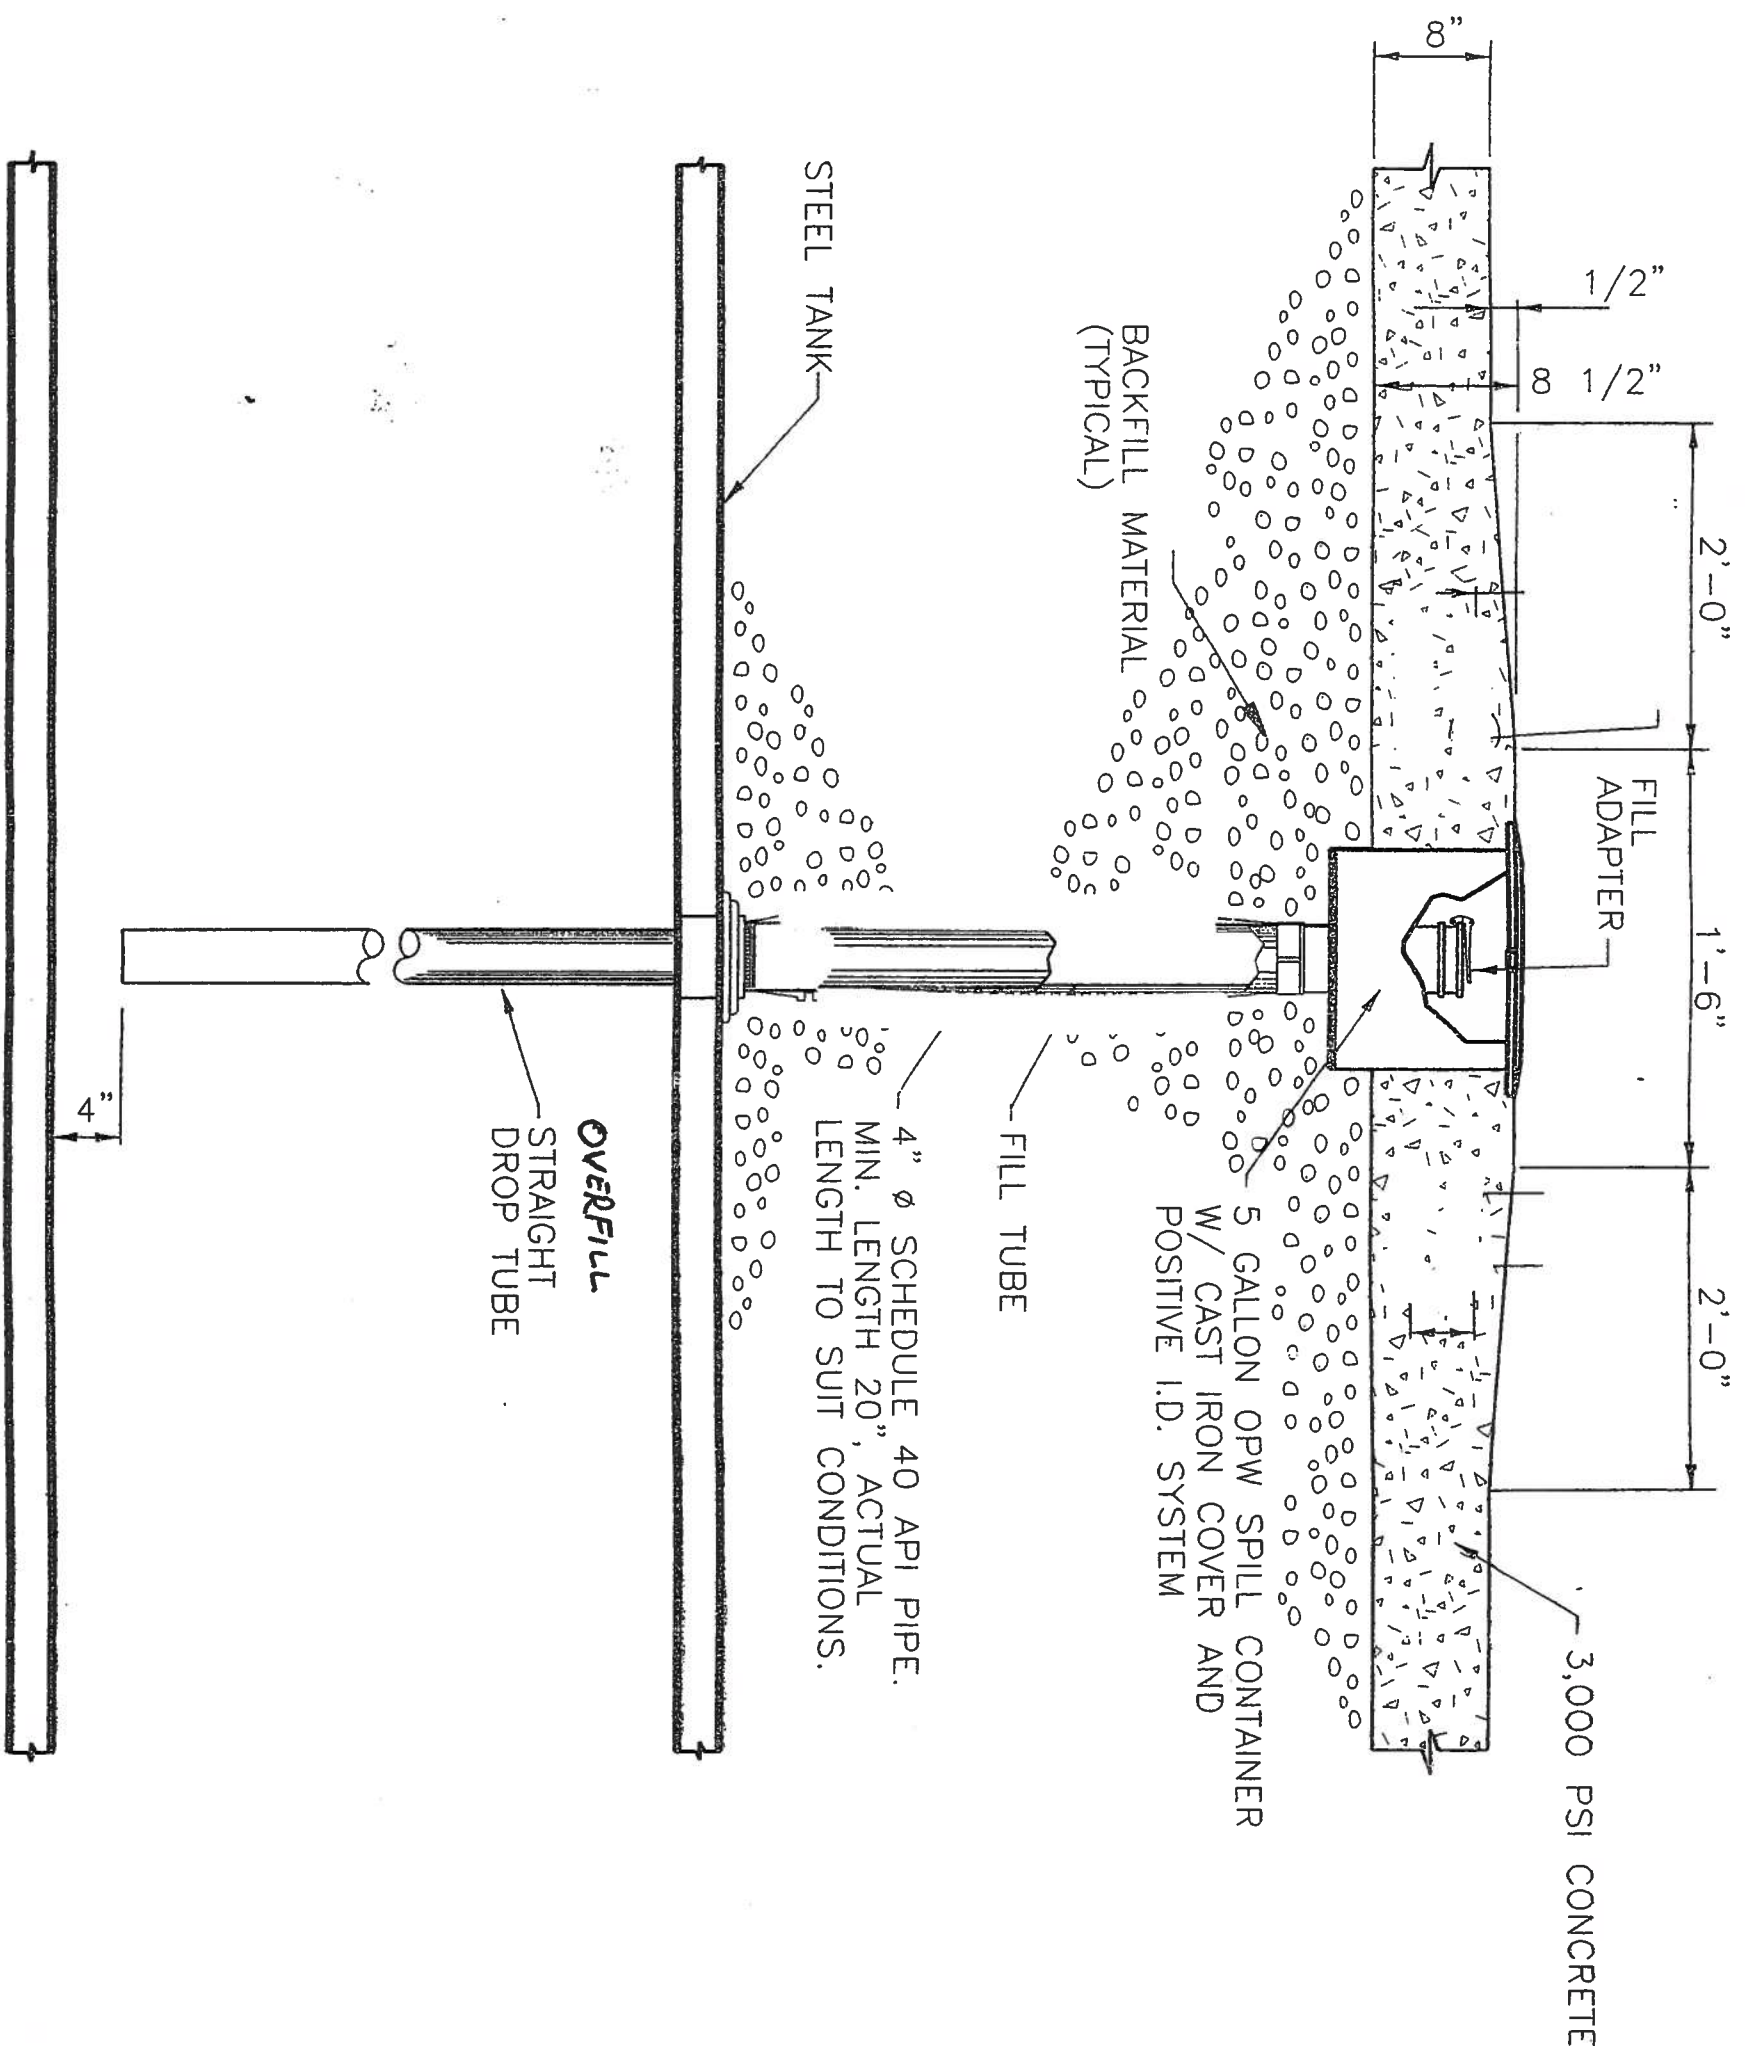

TANK FILL DETAIL